



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Page	1 of 7

Eagle Mountain - Woodfibre Gas Pipeline Project

BCER Waste Discharge Permit Weekly Report



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Page	2 of 7

Contents

Preamble	3
Introduction	3
Sampling Methodology	3
Summary-BC Rail Site	4
Site Activities	4
Point of Discharge from Water Treatment System Monitoring	4
Exceedances	5
Receiving Environment Monitoring	5
Receiving Environment Monitoring Details	5
Summary-Woodfibre	6
Site Activities	6
Point of Discharge from Water Treatment System Monitoring	6
Exceedance details	6
Receiving Environment Monitoring	7
Receiving Environment Monitoring Details	7

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Page	3 of 7

Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environment (upstream and downstream) and point of discharge.

FortisBC has retained Triton Environmental Consultants Ltd. as the Qualified Professional to implement and oversee the monitoring and sampling program in the receiving environments. The data represented below, including laboratory reported exceedances, represent background conditions from the receiving environment sampling as shown on the Waste Discharge Permit.

Introduction

The results provided in this document are submitted to BC Energy Regulator (BCER) by FortisBC as per the requirements listed in the Waste Discharge Permit PE-110163 Section 4.2:

The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to Waste.Management@bc-er.ca. A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and lab samples to meet daily and real time requirements for the Waste Discharge Permit.

At the receiving environments, real time and daily readings are being monitored at the same time with one piece of equipment, allowing all the daily readings real time. Visible sheen will be monitored with visual inspections during times of discharge or sampling.

At the point of discharge from the WTP, the parameters are being monitored using field equipment and sondes/real time meters make and models to be confirmed by the contractor. Table 1 and Table 2 below show how each parameter is being monitored.

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Page	4 of 7

Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
Daily	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real Time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observer NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples

Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
Daily	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real Time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples

Summary-BC Rail Site

Site Activities

- No discharges during this reporting period.

Point of Discharge from Water Treatment System Monitoring

Table 3 below includes information on water quality and lab sampling during discharges. Appendix A includes a full set of lab results with real time/field samples from discharges.

Table 3: Discharge from Water Treatment System Information

Location	Date of Discharge	Date of Lab Sample (for the discharge)	Real Time Monitored	Discharge Rate (batch)	Discharge Volume (batch)	Results
BC Rail- No discharges						

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Page	5 of 7

*Max discharge is 515 m3/day

Exceedances

No exceedances this reporting period.

Receiving Environment Monitoring

The receiving environment is being monitored as outlined in the permit.

Table 4: Upstream Monitoring Information

Location	Date of Lab Sample	Real Time Monitored	Results
Squamish River Upstream	2024-07-10	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix B.

Table 5: Downstream Monitoring Information

Location	Date of Lab Sample	Real Time Monitored	Results
Squamish River Downstream	2023-07-10	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix B.

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 10 minute intervals.

Receiving Environment Monitoring Details

- Visual sheen checks conducted for days of discharge.
- All receiving environment lab results are in Appendix B.
- Any recorded exceedances in the laboratory and field samples collected from the receiving environment (upstream and downstream) are indicative of the existing background water quality in the Squamish River, and are not related to the EGP Project activities.

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Page	6 of 7

Summary-Woodfibre

Site Activities

- The Woodfibre Portal has moved to continuous discharge, all information on discharge is in Appendix C.
- The downstream sonde/data logger was removed July 16th as there was not enough water in the watercourse to log data. BCER was notified.
- During this reporting period, Woodfibre Portal discharged a small volume each day from their water treatment plant, they discharged alternating each 10 min while monitoring the downstream sonde. The discharge rate was brought down to around 40 GPM to prevent overwhelming the watercourse.

Point of Discharge from Water Treatment System Monitoring

Table 3 below includes information on the continuous discharge water. Appendix C includes real time/field samples from the discharge.

Table 3: Discharges from Water Treatment System

Location	Date of Discharge	Real Time Monitored	Discharge Volume	Results
Woodfibre	2024-07-08	Yes	97.4 m ³	Yes-Appendix C
Woodfibre	2024-07-09	Yes	97.8 m ³	Yes-Appendix C
Woodfibre	2024-07-10	Yes	73.8 m ³	Yes-Appendix C
Woodfibre	2024-07-11	Yes	46.4 m ³	Yes-Appendix C
Woodfibre	2024-07-12	Yes	52 m ³	Yes-Appendix C
Woodfibre	2024-07-13	Yes	36.4 m ³	Yes-Appendix C
Woodfibre	2024-07-14	Yes	41.5 m ³	Yes-Appendix C

*Max discharge is 1500m³/day

Exceedance details

- During this time period, it was noted that there were instances where the temperature of the discharge water from the water treatment plant at Woodfibre fluctuated higher than the background temperature measured in the upstream of WC 309-R2. The QP reviewed the data from the receiving environment data logs and the water treatment plant data log, and with the support of field investigation efforts, it was inconclusive to report a temperature exceedance.
- Due low flow conditions, the receiving environment data logger did not have enough water to accurately record temperature values. Additional field assessments concluded that at the discharge location, flow went subsurface for approximately 60 m and came back out into WC 309-R2 further downstream.



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Page	7 of 7

- Due to this inconclusive determination, the QP and FortisBC are investigating if there is a more representative location to reinstall a sonde to give a more accurate representation of the receiving environment of WC 309-R2.
- Additionally, to prevent recurrence, during high ambient temperature time periods, the contractor is looking into measures to reduce the solar radiation from increasing temperature of the water being held in tanks at the water treatment plant.
- Sonde data upstream, downstream and from the water treatment plant has been included in Appendix C.

Receiving Environment Monitoring

The receiving environment is being monitored as outlined in the permit.

Table 4: Upstream Monitoring Information

Location	Date of Lab Sample	Real Time Monitored	Results
Woodfibre Upstream	2024-07-09	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix D.

Table 5: Downstream Monitoring Information

	Date of Lab Sample	Real Time Monitored	Results
Woodfibre Downstream	2024-07-09	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix D.

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 10 minute intervals.

Receiving Environment Monitoring Details

- Visual sheen checks are conducted during discharges.
- Any recorded exceedances in the laboratory and field samples collected from the receiving environment (upstream and downstream) are indicative of the existing background water quality in the East Creek and are not related to the EGP Project activities.



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix A	A-1

Appendix A: BCR Site Point of Discharge from Water Treatment Plant Documentation



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix A	A-2

BCR Site Batch Sample Analysis -No Discharge



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix A	A-3

BCR Site Batch Sample Lab Documentation -No Discharge



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix A	A-4

BCR Site WTP Discharge Field Notes and Logs -No Discharge

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix B	B-1

Appendix B: BCR Site Receiving Environment Documentation

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix B	B-2

BCR Site Receiving Environment Sample Analysis

Sample ID	LWD ID	Revised and signed off by:																																																																																																																																																																																																																																																																																																																																	
-----------	--------	----------------------------	---	---	---	---	---	---	---	---	--	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix B	B-3

BCR Site Receiving Environment Lab Documentation



CERTIFICATE OF ANALYSIS

Work Order : **VA24B6717**
Client : **Triton Environmental Consultants Ltd.**
Contact :
Address :

Telephone :
Project : 11964
PO : 11964-Task 20-Phase 3C-4C
C-O-C number : ----
Sampler : ----
Site : Water Analysis
Quote number : VA23-TRIT100-012_V2
No. of samples received : 5
No. of samples analysed : 5

Page : 1 of 6
Laboratory : ALS Environmental - Vancouver
Account Manager :
Address :

Telephone :
Date Samples Received : 10-Jul-2024 14:23
Date Analysis Commenced : 12-Jul-2024
Issue Date : 23-Jul-2024 14:16

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
	Analyst	Metals, Burnaby, British Columbia
	Supervisor - Metals Prep & Mercury	Metals, Burnaby, British Columbia
	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
	Account Manager Assistant	Administration, Burnaby, British Columbia
	Analyst	Metals, Burnaby, British Columbia



General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Qualifiers

<i>Qualifier</i>	<i>Description</i>
RRV	Reported result verified by repeat analysis.



Analytical Results

Sub-Matrix: Water				Client sample ID	SQU US 1	SQU DS 1	Duplicate	Field Blank	Travel Blank
(Matrix: Water)				Client sampling date / time	10-Jul-2024 09:18	10-Jul-2024 11:35	10-Jul-2024 09:18	10-Jul-2024 09:45	10-Jul-2024 00:00
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6717-001	VA24B6717-002	VA24B6717-003	VA24B6717-004	VA24B6717-005
					Result	Result	Result	Result	Result
Field Tests									
Conductivity, field	---	EF001/VA	0.10	µS/cm	23.000	23.000	---	---	---
pH, field	---	EF001/VA	0.10	pH units	7.80	7.35	---	---	---
Temperature, field	---	EF001/VA	0.10	°C	13.2	14.4	---	---	---
Physical Tests									
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	8.50	8.00	8.43	<0.60	---
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	18.2	19.6	18.0	<0.60	<0.60
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	46	36	43	<10	<10
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	195	165	149	<3.0	<3.0
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	7.8	7.5	7.9	<2.0	<2.0
Anions and Nutrients									
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	0.0564	0.0318	0.0568	<0.0050	<0.0050
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	<0.050	<0.050	<0.050	<0.050
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	0.58	0.57	0.59	<0.50	<0.50
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	<0.020	<0.020	<0.020	<0.020	<0.020
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	0.0146	0.0150	0.0132	<0.0050	<0.0050
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	<0.0010	<0.0010	<0.0010	<0.0010
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.128	0.104	0.136	<0.030	<0.030
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.220	0.166	0.223	<0.0020	<0.0020
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	2.20	2.08	2.21	<0.30	<0.30
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	1.98	1.09	0.94	<0.50	---
Total Sulfides									
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	<0.0015	---	---	---
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	<0.0016	<0.0016	<0.0016	<0.0016
Total Metals									
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	5.87	6.60	5.53	<0.0030	<0.0030
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010



Analytical Results

Sub-Matrix: Water					Client sample ID	SQU US 1	SQU DS 1	Duplicate	Field Blank	Travel Blank
(Matrix: Water)					Client sampling date / time	10-Jul-2024 09:18	10-Jul-2024 11:35	10-Jul-2024 09:18	10-Jul-2024 09:45	10-Jul-2024 00:00
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6717-001	VA24B6717-002	VA24B6717-003	VA24B6717-004	VA24B6717-005	
					Result	Result	Result	Result	Result	
Total Metals										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00040	0.00046	0.00035	<0.00010	<0.00010	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.0628	0.0735	0.0605	<0.00010	<0.00010	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	<0.000100	<0.000100	<0.000100	<0.000100	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	<0.010	<0.010	<0.010	<0.010	<0.010	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0000200	0.0000183	0.0000227	<0.0000050	<0.0000050	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	4.96	5.00	4.91	<0.050	<0.050	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000169	0.000191	0.000166	<0.000010	<0.000010	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	0.00141	0.00200	0.00136	<0.00050	<0.00050	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	0.00125	0.00167	0.00121	<0.00010	<0.00010	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00752	0.00814	0.00735	<0.00050	<0.00050	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	2.61	3.42	2.53	<0.010	0.018 ^{RRV}	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.000753	0.000736	0.000729	0.000108	<0.000050	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0021	0.0025	0.0020	<0.0010	<0.0010	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	1.40	1.74	1.39	<0.0050	<0.0050	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.0684	0.0884	0.0658	<0.00010	0.00014 ^{RRV}	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	<0.0000050	<0.0000050	<0.0000050	<0.0000050	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.000396	0.000396	0.000401	<0.000050	<0.000050	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	0.00159	0.00194	0.00159	<0.00050	<0.00050	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	0.210	0.232	0.202	<0.050	<0.050	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	1.56	1.70	1.45	<0.050	<0.050	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00418	0.00508	0.00405	<0.00020	<0.00020	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	11.5	12.0	10.1	<0.10	<0.10	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	0.000014	0.000014	0.000014	<0.000010	<0.000010	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	2.49	2.55	2.34	<0.050	<0.050	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0624	0.0635	0.0580	<0.00020	<0.00020	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	<0.50	<0.50	<0.50	<0.50	<0.50	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000022	0.000028	0.000023	<0.000010	<0.000010	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	0.00019	0.00023	0.00020	<0.00010	<0.00010	



Analytical Results

Sub-Matrix: Water (Matrix: Water)					Client sample ID	SQU US 1	SQU DS 1	Duplicate	Field Blank	Travel Blank
Client sampling date / time					10-Jul-2024 09:18	10-Jul-2024 11:35	10-Jul-2024 09:18	10-Jul-2024 09:45	10-Jul-2024 00:00	
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6717-001	VA24B6717-002	VA24B6717-003	VA24B6717-004	VA24B6717-005	
					Result	Result	Result	Result	Result	
Total Metals										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.158	0.227	0.151	<0.00030	<0.00030	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.000118	0.000159	0.000113	<0.000010	<0.000010	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	0.00692	0.00904	0.00678	<0.00050	<0.00050	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	0.0085	0.0102	0.0083	<0.0030	<0.0030	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	0.00091	0.00048	0.00054	<0.00020	<0.00020	
Dissolved Metals										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0558	0.0534	0.0564	<0.0010	----	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00010	0.00012	<0.00010	<0.00010	----	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00265	0.00308	0.00264	<0.00010	----	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	<0.000100	<0.000100	<0.000100	----	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	----	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	<0.010	<0.010	<0.010	<0.010	----	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	<0.0000050	<0.0000050	<0.0000050	<0.0000050	----	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	2.90	2.73	2.88	<0.050	----	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	----	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	----	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00062	0.00039	0.00050	<0.00020	----	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.034	0.034	0.035	0.012 ^{RRV}	----	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	----	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	<0.0010	<0.0010	<0.0010	<0.0010	----	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	0.306	0.287	0.301	<0.0050	----	
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00473	0.00554	0.00458	0.00013 ^{RRV}	----	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	<0.0000050	<0.0000050	<0.0000050	----	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.000374	0.000337	0.000342	<0.000050	----	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	----	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	<0.050	<0.050	<0.050	----	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	0.439	0.452	0.439	<0.050	----	



Analytical Results

Sub-Matrix: Water (Matrix: Water)					Client sample ID	SQU US 1	SQU DS 1	Duplicate	Field Blank	Travel Blank
Client sampling date / time					10-Jul-2024 09:18	10-Jul-2024 11:35	10-Jul-2024 09:18	10-Jul-2024 09:45	10-Jul-2024 00:00	
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6717-001	VA24B6717-002	VA24B6717-003	VA24B6717-004	VA24B6717-005	
					Result	Result	Result	Result	Result	
Dissolved Metals										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00050	0.00060	0.00055	<0.00020	----	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	----	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	2.37	2.15	2.36	<0.050	----	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	----	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	0.969	0.862	0.949	<0.050	----	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0163	0.0156	0.0163	<0.00020	----	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	0.57	<0.50	0.56	<0.50	----	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	----	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	----	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	0.00145	0.00151	0.00134	<0.00030	----	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.000015	0.000017	0.000016	<0.000010	----	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	0.00076	0.00067	0.00077	<0.00050	----	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	<0.0010	0.0013	<0.0010	<0.0010	----	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	----	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	Field	Field	Field	----	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	Field	Field	Field	----	
Speciated Metals										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	
Chromium, trivalent [Cr III], total	16065-83-1	EC535/VA	0.00050	mg/L	0.00141	0.00200	0.00136	<0.00050	<0.00050	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

QUALITY CONTROL INTERPRETIVE REPORT

<p>Work Order : VA24B6717</p> <p>Client : Triton Environmental Consultants Ltd.</p> <p>Contact : [REDACTED]</p> <p>Address : [REDACTED]</p> <p>Telephone : [REDACTED]</p> <p>Project : 11964</p> <p>PO : 11964-Task 20-Phase 3C-4C</p> <p>C-O-C number : ----</p> <p>Sampler : ----</p> <p>Site : Water Analysis</p> <p>Quote number : VA23-TRIT100-012_V2</p> <p>No. of samples received : 5</p> <p>No. of samples analysed : 5</p>	<p>Page : 1 of 20</p> <p>Laboratory : ALS Environmental - Vancouver</p> <p>Account Manager : [REDACTED]</p> <p>Address : [REDACTED]</p> <p>Telephone : [REDACTED]</p> <p>Date Samples Received : 10-Jul-2024 14:23</p> <p>Issue Date : 23-Jul-2024 14:16</p>
---	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- No Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.



Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) Travel Blank	E298	10-Jul-2024	13-Jul-2024	28 days	2 days	✔	18-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) Duplicate	E298	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	18-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) Field Blank	E298	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	18-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) SQU DS 1	E298	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	18-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) SQU US 1	E298	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	18-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE Duplicate	E235.Br-L	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE Field Blank	E235.Br-L	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE SQU DS 1	E235.Br-L	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE SQU US 1	E235.Br-L	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE Travel Blank	E235.Br-L	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Chloride in Water by IC											
HDPE Duplicate	E235.Cl	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Chloride in Water by IC											
HDPE Field Blank	E235.Cl	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Chloride in Water by IC											
HDPE SQU DS 1	E235.Cl	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Chloride in Water by IC											
HDPE SQU US 1	E235.Cl	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Chloride in Water by IC											
HDPE Travel Blank	E235.Cl	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Fluoride in Water by IC											
HDPE Duplicate	E235.F	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Fluoride in Water by IC											
HDPE Field Blank	E235.F	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Fluoride in Water by IC											
HDPE SQU DS 1	E235.F	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Fluoride in Water by IC											
HDPE SQU US 1	E235.F	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Fluoride in Water by IC											
HDPE Travel Blank	E235.F	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE Duplicate	E235.NO3-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✓	12-Jul-2024	3 days	2 days	✓	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE Field Blank	E235.NO3-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✓	12-Jul-2024	3 days	2 days	✓	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE SQU DS 1	E235.NO3-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✓	12-Jul-2024	3 days	2 days	✓	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE SQU US 1	E235.NO3-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✓	12-Jul-2024	3 days	2 days	✓	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE Travel Blank	E235.NO3-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✓	12-Jul-2024	3 days	2 days	✓	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Duplicate	E235.NO2-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✔	12-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Field Blank	E235.NO2-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✔	12-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE SQU DS 1	E235.NO2-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✔	12-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE SQU US 1	E235.NO2-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✔	12-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Travel Blank	E235.NO2-L	10-Jul-2024	12-Jul-2024	3 days	2 days	✔	12-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE Duplicate	E235.SO4	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE Field Blank	E235.SO4	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE SQU DS 1	E235.SO4	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE SQU US 1	E235.SO4	10-Jul-2024	12-Jul-2024	28 days	2 days	✔	12-Jul-2024	28 days	2 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Sulfate in Water by IC											
HDPE Travel Blank	E235.SO4	10-Jul-2024	12-Jul-2024	28 days	2 days	✓	12-Jul-2024	28 days	2 days	✓	
Anions and Nutrients : Total Nitrogen by Colourimetry											
Amber glass total (sulfuric acid) Travel Blank	E366	10-Jul-2024	13-Jul-2024	28 days	2 days	✓	16-Jul-2024	28 days	6 days	✓	
Anions and Nutrients : Total Nitrogen by Colourimetry											
Amber glass total (sulfuric acid) Duplicate	E366	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	6 days	✓	
Anions and Nutrients : Total Nitrogen by Colourimetry											
Amber glass total (sulfuric acid) Field Blank	E366	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	6 days	✓	
Anions and Nutrients : Total Nitrogen by Colourimetry											
Amber glass total (sulfuric acid) SQU DS 1	E366	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	6 days	✓	
Anions and Nutrients : Total Nitrogen by Colourimetry											
Amber glass total (sulfuric acid) SQU US 1	E366	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	6 days	✓	
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)											
Amber glass total (sulfuric acid) Travel Blank	E372-U	10-Jul-2024	13-Jul-2024	28 days	2 days	✓	19-Jul-2024	28 days	9 days	✓	
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)											
Amber glass total (sulfuric acid) Duplicate	E372-U	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	19-Jul-2024	28 days	10 days	✓	
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)											
Amber glass total (sulfuric acid) Field Blank	E372-U	10-Jul-2024	13-Jul-2024	28 days	3 days	✓	19-Jul-2024	28 days	10 days	✓	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) SQU US 1	E372-U	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	19-Jul-2024	28 days	10 days	✔
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) SQU DS 1	E372-U	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	19-Jul-2024	28 days	9 days	✔
Dissolved Metals : Dissolved Mercury in Water by CVAAS										
Glass vial - dissolved (lab preserved) Duplicate	E509	10-Jul-2024	18-Jul-2024	28 days	8 days	✔	18-Jul-2024	28 days	8 days	✔
Dissolved Metals : Dissolved Mercury in Water by CVAAS										
Glass vial - dissolved (lab preserved) Field Blank	E509	10-Jul-2024	18-Jul-2024	28 days	8 days	✔	18-Jul-2024	28 days	8 days	✔
Dissolved Metals : Dissolved Mercury in Water by CVAAS										
Glass vial - dissolved (lab preserved) SQU DS 1	E509	10-Jul-2024	18-Jul-2024	28 days	8 days	✔	18-Jul-2024	28 days	8 days	✔
Dissolved Metals : Dissolved Mercury in Water by CVAAS										
Glass vial - dissolved (lab preserved) SQU US 1	E509	10-Jul-2024	18-Jul-2024	28 days	8 days	✔	18-Jul-2024	28 days	8 days	✔
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS										
HDPE - dissolved (lab preserved) Duplicate	E421	10-Jul-2024	16-Jul-2024	180 days	6 days	✔	17-Jul-2024	180 days	7 days	✔
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS										
HDPE - dissolved (lab preserved) Field Blank	E421	10-Jul-2024	16-Jul-2024	180 days	6 days	✔	17-Jul-2024	180 days	7 days	✔
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS										
HDPE - dissolved (lab preserved) SQU DS 1	E421	10-Jul-2024	16-Jul-2024	180 days	6 days	✔	17-Jul-2024	180 days	7 days	✔



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS											
HDPE - dissolved (lab preserved) SQU US 1	E421	10-Jul-2024	16-Jul-2024	180 days	6 days	✔	17-Jul-2024	180 days	7 days	✔	
Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine											
Glass vial - total (lab preserved) SQU DS 1	EF001	10-Jul-2024	----	----	----		12-Jul-2024	----	2 days		
Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine											
Glass vial - total (lab preserved) SQU US 1	EF001	10-Jul-2024	----	----	----		12-Jul-2024	----	2 days		
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) Duplicate	E358-L	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	13-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) Field Blank	E358-L	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	13-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) SQU DS 1	E358-L	10-Jul-2024	13-Jul-2024	28 days	3 days	✔	13-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (lab preserved) SQU US 1	E358-L	10-Jul-2024	13-Jul-2024	3 days	3 days	✔	13-Jul-2024	28 days	0 days	✔	
Physical Tests : Alkalinity Species by Titration											
HDPE Duplicate	E290	10-Jul-2024	12-Jul-2024	14 days	2 days	✔	13-Jul-2024	14 days	3 days	✔	
Physical Tests : Alkalinity Species by Titration											
HDPE Field Blank	E290	10-Jul-2024	12-Jul-2024	14 days	2 days	✔	13-Jul-2024	14 days	3 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Physical Tests : Alkalinity Species by Titration											
HDPE SQU DS 1	E290	10-Jul-2024	12-Jul-2024	14 days	2 days	✓	13-Jul-2024	14 days	3 days	✓	
Physical Tests : Alkalinity Species by Titration											
HDPE SQU US 1	E290	10-Jul-2024	12-Jul-2024	14 days	2 days	✓	13-Jul-2024	14 days	3 days	✓	
Physical Tests : Alkalinity Species by Titration											
HDPE Travel Blank	E290	10-Jul-2024	12-Jul-2024	14 days	2 days	✓	13-Jul-2024	14 days	3 days	✓	
Physical Tests : TDS by Gravimetry											
HDPE SQU DS 1	E162	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✓	
Physical Tests : TDS by Gravimetry											
HDPE Travel Blank	E162	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✓	
Physical Tests : TDS by Gravimetry											
HDPE Duplicate	E162	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓	
Physical Tests : TDS by Gravimetry											
HDPE Field Blank	E162	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓	
Physical Tests : TDS by Gravimetry											
HDPE SQU US 1	E162	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓	
Physical Tests : TSS by Gravimetry											
HDPE SQU DS 1	E160	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✓	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Physical Tests : TSS by Gravimetry										
HDPE Travel Blank	E160	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✓
Physical Tests : TSS by Gravimetry										
HDPE Duplicate	E160	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓
Physical Tests : TSS by Gravimetry										
HDPE Field Blank	E160	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓
Physical Tests : TSS by Gravimetry										
HDPE SQU US 1	E160	10-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) SQU DS 1	E532	10-Jul-2024	----	----	----		22-Jul-2024	28 days	12 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Travel Blank	E532	10-Jul-2024	----	----	----		22-Jul-2024	28 days	12 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Duplicate	E532	10-Jul-2024	----	----	----		22-Jul-2024	28 days	13 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Field Blank	E532	10-Jul-2024	----	----	----		22-Jul-2024	28 days	13 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) SQU US 1	E532	10-Jul-2024	----	----	----		22-Jul-2024	28 days	13 days	✓



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Total Metals : Total Mercury in Water by CVAAS											
Glass vial - total (lab preserved) Duplicate	E508	10-Jul-2024	17-Jul-2024	28 days	7 days	✓	17-Jul-2024	28 days	7 days	✓	
Total Metals : Total Mercury in Water by CVAAS											
Glass vial - total (lab preserved) Field Blank	E508	10-Jul-2024	17-Jul-2024	28 days	7 days	✓	17-Jul-2024	28 days	7 days	✓	
Total Metals : Total Mercury in Water by CVAAS											
Glass vial - total (lab preserved) SQU DS 1	E508	10-Jul-2024	17-Jul-2024	28 days	7 days	✓	17-Jul-2024	28 days	7 days	✓	
Total Metals : Total Mercury in Water by CVAAS											
Glass vial - total (lab preserved) SQU US 1	E508	10-Jul-2024	17-Jul-2024	28 days	7 days	✓	17-Jul-2024	28 days	7 days	✓	
Total Metals : Total Mercury in Water by CVAAS											
Glass vial - total (lab preserved) Travel Blank	E508	10-Jul-2024	17-Jul-2024	28 days	7 days	✓	17-Jul-2024	28 days	7 days	✓	
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) Field Blank	E420	10-Jul-2024	18-Jul-2024	180 days	8 days	✓	18-Jul-2024	180 days	8 days	✓	
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) Travel Blank	E420	10-Jul-2024	18-Jul-2024	180 days	8 days	✓	18-Jul-2024	180 days	8 days	✓	
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) Duplicate	E420	10-Jul-2024	18-Jul-2024	180 days	8 days	✓	19-Jul-2024	180 days	9 days	✓	
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) SQU DS 1	E420	10-Jul-2024	18-Jul-2024	180 days	8 days	✓	19-Jul-2024	180 days	9 days	✓	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) SQU US 1	E420	10-Jul-2024	18-Jul-2024	180 days	8 days	✔	19-Jul-2024	180 days	9 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Duplicate	E395	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Field Blank	E395	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) SQU DS 1	E395	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) SQU US 1	E395	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Travel Blank	E395	10-Jul-2024	----	----	----		16-Jul-2024	7 days	6 days	✔	

Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Duplicates (DUP)							
Alkalinity Species by Titration	E290	1541821	1	7	14.2	5.0	✔
Ammonia by Fluorescence	E298	1542863	1	16	6.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1541819	1	5	20.0	5.0	✔
Chloride in Water by IC	E235.Cl	1541817	1	7	14.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1551717	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1541826	2	24	8.3	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1542859	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1541816	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1541814	1	20	5.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1541815	1	19	5.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1541818	1	7	14.2	5.0	✔
TDS by Gravimetry	E162	1548427	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1558766	1	5	20.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1550633	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1541777	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1542860	1	16	6.2	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1542864	1	10	10.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1547971	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1548418	1	20	5.0	5.0	✔
Laboratory Control Samples (LCS)							
Alkalinity Species by Titration	E290	1541821	1	7	14.2	5.0	✔
Ammonia by Fluorescence	E298	1542863	1	16	6.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1541819	1	5	20.0	5.0	✔
Chloride in Water by IC	E235.Cl	1541817	1	7	14.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1551717	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1541826	2	24	8.3	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1542859	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1541816	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1541814	1	20	5.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1541815	1	19	5.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1541818	1	7	14.2	5.0	✔
TDS by Gravimetry	E162	1548427	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1558766	1	5	20.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1550633	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1541777	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1542860	1	16	6.2	5.0	✔



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Control Samples (LCS) - Continued							
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1542864	1	10	10.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1547971	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1548418	1	20	5.0	5.0	✔
Method Blanks (MB)							
Alkalinity Species by Titration	E290	1541821	1	7	14.2	5.0	✔
Ammonia by Fluorescence	E298	1542863	1	16	6.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1541819	1	5	20.0	5.0	✔
Chloride in Water by IC	E235.Cl	1541817	1	7	14.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1551717	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1541826	2	24	8.3	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1542859	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1541816	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1541814	1	20	5.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1541815	1	19	5.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1541818	1	7	14.2	5.0	✔
TDS by Gravimetry	E162	1548427	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1558766	1	5	20.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1550633	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1541777	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1542860	1	16	6.2	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1542864	1	10	10.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1547971	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1548418	1	20	5.0	5.0	✔
Matrix Spikes (MS)							
Ammonia by Fluorescence	E298	1542863	1	16	6.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1541819	1	5	20.0	5.0	✔
Chloride in Water by IC	E235.Cl	1541817	1	7	14.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1551717	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1541826	2	24	8.3	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1542859	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1541816	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1541814	1	20	5.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1541815	1	19	5.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1541818	1	7	14.2	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1558766	1	5	20.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1550633	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1541777	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1542860	1	16	6.2	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1542864	0	10	0.0	5.0	✖



Matrix: **Water** Evaluation: * = QC frequency outside specification; ✓ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
Matrix Spikes (MS) - Continued							
Total Sulfide by Colourimetry (Automated Flow)	E395	1547971	1	17	5.8	5.0	✓



Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$, with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO ₂ . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H ₂ S" if reported represent the maximum possible H ₂ S concentration based on the total sulfide concentration in the sample. The H ₂ S calculation converts Total Sulphide as (S ₂ ⁻) and reports it as Total Sulphide as (H ₂ S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Vancouver	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection. Results are based on an un-filtered, field-preserved sample.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Vancouver	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.

QUALITY CONTROL REPORT

Work Order : **VA24B6717**

Client : Triton Environmental Consultants Ltd.

Contact : [REDACTED]

Address : [REDACTED]

Telephone : [REDACTED]

Project : 11964

PO : 11964-Task 20-Phase 3C-4C

C-O-C number : ----

Sampler : ----

Site : Water Analysis

Quote number : VA23-TRIT100-012_V2

No. of samples received : 5

No. of samples analysed : 5

Page : 1 of 19

Laboratory : ALS Environmental - Vancouver

Account Manager : [REDACTED]

Address : [REDACTED]

Telephone : [REDACTED]

Date Samples Received : 10-Jul-2024 14:23

Date Analysis Commenced : 12-Jul-2024

Issue Date : 23-Jul-2024 14:16

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
[REDACTED]	Analyst	Vancouver Metals, Burnaby, British Columbia
[REDACTED]	Supervisor - Metals Prep & Mercury	Vancouver Metals, Burnaby, British Columbia
[REDACTED]	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
[REDACTED]	Supervisor - Metals ICP Instrumentation	Vancouver Metals, Burnaby, British Columbia
[REDACTED]	Department Manager - Inorganics	Vancouver Inorganics, Burnaby, British Columbia
[REDACTED]	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
[REDACTED]	Analyst	Vancouver Metals, Burnaby, British Columbia

Page : 2 of 19
Work Order : VA24B6717
Client : Triton Environmental Consultants Ltd.
Project : 11964



General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

= Indicates a QC result that did not meet the ALS DQO.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.



Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Physical Tests (QC Lot: 1541821)											
VA24B6544-001	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	23.7	23.8	0.421%	20%	----
Physical Tests (QC Lot: 1548418)											
FJ2402004-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	<3.0	<3.0	0	Diff <2x LOR	----
Physical Tests (QC Lot: 1548427)											
FJ2402004-001	Anonymous	Solids, total dissolved [TDS]	----	E162	20	mg/L	976	1020	4.61%	20%	----
Anions and Nutrients (QC Lot: 1541814)											
VA24B6717-001	SQU US 1	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0050	mg/L	0.0146	0.0163	0.0018	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1541815)											
VA24B6717-001	SQU US 1	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1541816)											
VA24B6717-001	SQU US 1	Fluoride	16984-48-8	E235.F	0.020	mg/L	<0.020	0.020	0.00008	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1541817)											
VA24B6717-001	SQU US 1	Chloride	16887-00-6	E235.Cl	0.50	mg/L	0.58	0.59	0.02	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1541818)											
VA24B6717-001	SQU US 1	Sulfate (as SO4)	14808-79-8	E235.SO4	0.30	mg/L	2.20	2.20	0.0001	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1541819)											
VA24B6717-001	SQU US 1	Bromide	24959-67-9	E235.Br-L	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1542860)											
FJ2402006-001	Anonymous	Nitrogen, total	7727-37-9	E366	0.600	mg/L	32.0	32.0	0.274%	20%	----
Anions and Nutrients (QC Lot: 1542863)											
FJ2402006-001	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.0050	mg/L	0.0183	0.0178	0.0005	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1542864)											
FJ2402006-001	Anonymous	Phosphorus, total	7723-14-0	E372-U	0.0020	mg/L	0.0046	0.0046	0.00005	Diff <2x LOR	----
Organic / Inorganic Carbon (QC Lot: 1542859)											
FJ2402012-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	45.6	46.3	1.72%	20%	----
Total Sulfides (QC Lot: 1547971)											
CG2409591-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	<0.0015	0	Diff <2x LOR	----
Total Metals (QC Lot: 1541777)											
VA24B6634-001	Anonymous	Aluminum, total	7429-90-5	E420	0.0030	mg/L	0.0215	0.0160	0.0055	Diff <2x LOR	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	0.00010	<0.00010	0.000002	Diff <2x LOR	----



Sub-Matrix: **Water**

Laboratory Duplicate (DUP) Report

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Total Metals (QC Lot: 1541777) - continued											
VA24B6634-001	Anonymous	Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00023	0.00024	0.000006	Diff <2x LOR	----
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.0714	0.0728	2.08%	20%	----
		Beryllium, total	7440-41-7	E420	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	0.0000152	0.0000146	0.0000006	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.050	mg/L	30.0	30.5	1.34%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	0.000045	0.000043	0.000002	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	0.00011	0.00011	0.000003	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.010	mg/L	0.042	0.040	0.002	Diff <2x LOR	----
		Lead, total	7439-92-1	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	15.7	15.8	0.315%	20%	----
		Manganese, total	7439-96-5	E420	0.00010	mg/L	0.00269	0.00278	3.26%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.000272	0.000269	0.000002	Diff <2x LOR	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	0.00143	0.00142	0.00002	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.050	mg/L	0.640	0.656	2.46%	20%	----
		Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00059	0.00060	0.000009	Diff <2x LOR	----
		Selenium, total	7782-49-2	E420	0.000050	mg/L	0.000467	0.000500	0.000032	Diff <2x LOR	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	1.98	2.00	0.917%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, total	7440-23-5	E420	0.050	mg/L	12.9	13.2	1.99%	20%	----
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.155	0.156	0.612%	20%	----
		Sulfur, total	7704-34-9	E420	0.50	mg/L	27.5	28.5	3.62%	20%	----
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, total	7440-32-6	E420	0.00030	mg/L	<0.00060	<0.00030	0.00030	Diff <2x LOR	----
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.000470	0.000473	0.473%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Total Metals (QC Lot: 1541777) - continued											
VA24B6634-001	Anonymous	Vanadium, total	7440-62-2	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0030	mg/L	<0.0030	<0.0030	0	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
Total Metals (QC Lot: 1550633)											
VA24B6706-004	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1541826)											
VA24B6717-001	SQU US 1	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.0558	0.0536	4.04%	20%	----
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	0.00010	0.00010	0.0000003	Diff <2x LOR	----
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.00265	0.00269	1.31%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	2.90	2.87	0.797%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00062	0.00058	0.00004	Diff <2x LOR	----
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	0.034	0.033	0.0006	Diff <2x LOR	----
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	0.306	0.301	1.56%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.00473	0.00465	1.73%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.000374	0.000363	0.000011	Diff <2x LOR	----
		Nickel, dissolved	7440-02-0	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	0.439	0.445	0.006	Diff <2x LOR	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00050	0.00057	0.00007	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Silicon, dissolved	7440-21-3	E421	0.050	mg/L	2.37	2.32	2.35%	20%	----
		Silver, dissolved	7440-22-4	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.050	mg/L	0.969	0.976	0.724%	20%	----
		Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.0163	0.0161	1.32%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Dissolved Metals (QC Lot: 1541826) - continued											
VA24B6717-001	SQU US 1	Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	0.57	0.57	0.002	Diff <2x LOR	----
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	0.00145	0.00138	0.00007	Diff <2x LOR	----
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000010	mg/L	0.000015	0.000018	0.000003	Diff <2x LOR	----
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	0.00076	0.00073	0.00003	Diff <2x LOR	----
		Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	<0.0010	0.0012	0.0002	Diff <2x LOR	----
		Zirconium, dissolved	7440-67-7	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1549623)											
FJ2402035-008	Anonymous	Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0688	0.0678	1.47%	20%	----
Dissolved Metals (QC Lot: 1551717)											
VA24B6701-010	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Speciated Metals (QC Lot: 1558766)											
VA24B6717-001	SQU US 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----



Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Physical Tests (QCLot: 1541821)						
Alkalinity, total (as CaCO3)	---	E290	1	mg/L	<1.0	---
Physical Tests (QCLot: 1548418)						
Solids, total suspended [TSS]	---	E160	3	mg/L	<3.0	---
Physical Tests (QCLot: 1548427)						
Solids, total dissolved [TDS]	---	E162	10	mg/L	<10	---
Anions and Nutrients (QCLot: 1541814)						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	---
Anions and Nutrients (QCLot: 1541815)						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	---
Anions and Nutrients (QCLot: 1541816)						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	---
Anions and Nutrients (QCLot: 1541817)						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	---
Anions and Nutrients (QCLot: 1541818)						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	---
Anions and Nutrients (QCLot: 1541819)						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	---
Anions and Nutrients (QCLot: 1542860)						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	---
Anions and Nutrients (QCLot: 1542863)						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	---
Anions and Nutrients (QCLot: 1542864)						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	---
Organic / Inorganic Carbon (QCLot: 1542859)						
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	<0.50	---
Total Sulfides (QCLot: 1547971)						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	---
Total Metals (QCLot: 1541777)						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	---
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	---



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Total Metals (QCLot: 1541777) - continued						
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	----
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	----
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	----
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	----
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	----
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	----
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	----
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	----
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	----
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Total Metals (QCLot: 1550633)						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
Dissolved Metals (QCLot: 1541826)						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Dissolved Metals (QCLot: 1541826) - continued						
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
Dissolved Metals (QCLot: 1549623)						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Dissolved Metals (QCLot: 1549623) - continued						
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
Dissolved Metals (QCLot: 1551717)						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
Speciated Metals (QCLot: 1558766)						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----



Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Physical Tests (QCLot: 1541821)									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	108	85.0	115	----
Physical Tests (QCLot: 1548418)									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	109	85.0	115	----
Physical Tests (QCLot: 1548427)									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	105	85.0	115	----
Anions and Nutrients (QCLot: 1541814)									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	99.8	90.0	110	----
Anions and Nutrients (QCLot: 1541815)									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	98.8	90.0	110	----
Anions and Nutrients (QCLot: 1541816)									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	99.4	90.0	110	----
Anions and Nutrients (QCLot: 1541817)									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	100	90.0	110	----
Anions and Nutrients (QCLot: 1541818)									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	101	90.0	110	----
Anions and Nutrients (QCLot: 1541819)									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	101	85.0	115	----
Anions and Nutrients (QCLot: 1542860)									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	105	75.0	125	----
Anions and Nutrients (QCLot: 1542863)									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	99.1	85.0	115	----
Anions and Nutrients (QCLot: 1542864)									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	0.05 mg/L	93.6	80.0	120	----
Organic / Inorganic Carbon (QCLot: 1542859)									
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	8.57 mg/L	99.0	80.0	120	----
Total Sulfides (QCLot: 1547971)									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	99.7	80.0	120	----
Total Metals (QCLot: 1541777)									



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Total Metals (QCLot: 1541777) - continued									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	106	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	95.8	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	109	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	102	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	98.2	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	99.7	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	96.4	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	103	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	99.4	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	95.0	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	106	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	103	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	106	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	101	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	98.2	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	108	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	105	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	100	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	105	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	118	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	103	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	105	80.0	120	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	105	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	104	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	91.0	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	106	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	101	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	89.1	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	94.9	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	103	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	101	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	98.6	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	101	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	101	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	106	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Total Metals (QCLot: 1541777) - continued									
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	105	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	104	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	94.8	80.0	120	----
Total Metals (QCLot: 1550633)									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	97.4	80.0	120	----
Dissolved Metals (QCLot: 1541826)									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	101	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	100	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	100	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	101	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	101	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	100	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	95.6	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	99.0	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	98.5	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	99.5	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	99.6	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	97.5	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	97.7	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	94.8	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	102	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	102	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	99.5	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	96.4	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	101	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	94.7	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	110	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	105	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	96.0	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	97.5	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	101	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	93.0	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	104	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	105	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	89.9	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Dissolved Metals (QCLot: 1541826) - continued									
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	102	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	103	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	95.3	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	99.9	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	90.9	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	96.8	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	99.6	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	98.4	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	95.4	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	95.9	80.0	120	----
Dissolved Metals (QCLot: 1549623)									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	104	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	95.8	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	101	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	98.5	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	100	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	99.0	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	96.2	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	95.0	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	98.8	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	98.9	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	99.3	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	96.3	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	96.5	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	97.8	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	100	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	98.0	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	97.8	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	98.1	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	98.2	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	99.4	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	98.5	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	97.1	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	95.8	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	95.1	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	100	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Dissolved Metals (QCLot: 1549623) - continued									
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	92.6	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	97.2	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	101	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	94.0	80.0	120	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	94.6	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	102	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	95.5	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	97.5	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	94.7	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	97.2	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	100	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	98.0	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	96.9	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	93.9	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	93.4	80.0	120	----
Speciated Metals (QCLot: 1558766)									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.25 mg/L	101	80.0	120	----



Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Anions and Nutrients (QCLot: 1541814)										
VA24B6717-002	SQU DS 1	Nitrate (as N)	14797-55-8	E235.NO3-L	2.47 mg/L	2.5 mg/L	98.9	75.0	125	----
Anions and Nutrients (QCLot: 1541815)										
VA24B6717-002	SQU DS 1	Nitrite (as N)	14797-65-0	E235.NO2-L	0.492 mg/L	0.5 mg/L	98.4	75.0	125	----
Anions and Nutrients (QCLot: 1541816)										
VA24B6717-002	SQU DS 1	Fluoride	16984-48-8	E235.F	0.989 mg/L	1 mg/L	98.9	75.0	125	----
Anions and Nutrients (QCLot: 1541817)										
VA24B6717-002	SQU DS 1	Chloride	16887-00-6	E235.Cl	100 mg/L	100 mg/L	100	75.0	125	----
Anions and Nutrients (QCLot: 1541818)										
VA24B6717-002	SQU DS 1	Sulfate (as SO4)	14808-79-8	E235.SO4	100 mg/L	100 mg/L	100	75.0	125	----
Anions and Nutrients (QCLot: 1541819)										
VA24B6717-002	SQU DS 1	Bromide	24959-67-9	E235.Br-L	0.518 mg/L	0.5 mg/L	104	75.0	125	----
Anions and Nutrients (QCLot: 1542860)										
FJ2402006-002	Anonymous	Nitrogen, total	7727-37-9	E366	ND mg/L	----	ND	70.0	130	----
Anions and Nutrients (QCLot: 1542863)										
FJ2402006-002	Anonymous	Ammonia, total (as N)	7664-41-7	E298	ND mg/L	----	ND	75.0	125	----
Organic / Inorganic Carbon (QCLot: 1542859)										
VA24B6704-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	ND mg/L	----	ND	70.0	130	----
Total Sulfides (QCLot: 1547971)										
CG2409591-002	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.219 mg/L	0.2 mg/L	110	75.0	125	----
Total Metals (QCLot: 1541777)										
VA24B6634-002	Anonymous	Aluminum, total	7429-90-5	E420	0.202 mg/L	0.2 mg/L	101	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0186 mg/L	0.02 mg/L	93.1	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0209 mg/L	0.02 mg/L	105	70.0	130	----
		Barium, total	7440-39-3	E420	ND mg/L	----	ND	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0382 mg/L	0.04 mg/L	95.6	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00948 mg/L	0.01 mg/L	94.8	70.0	130	----
		Boron, total	7440-42-8	E420	0.093 mg/L	0.1 mg/L	93.4	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00395 mg/L	0.004 mg/L	98.7	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.00924 mg/L	0.01 mg/L	92.4	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0402 mg/L	0.04 mg/L	100	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0197 mg/L	0.02 mg/L	98.7	70.0	130	----
		Copper, total	7440-50-8	E420	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Total Metals (QCLot: 1541777) - continued										
VA24B6634-002	Anonymous	Iron, total	7439-89-6	E420	2.01 mg/L	2 mg/L	100	70.0	130	---
		Lead, total	7439-92-1	E420	0.0189 mg/L	0.02 mg/L	94.6	70.0	130	---
		Lithium, total	7439-93-2	E420	0.0936 mg/L	0.1 mg/L	93.6	70.0	130	---
		Magnesium, total	7439-95-4	E420	ND mg/L	---	ND	70.0	130	---
		Manganese, total	7439-96-5	E420	0.0195 mg/L	0.02 mg/L	97.3	70.0	130	---
		Molybdenum, total	7439-98-7	E420	0.0191 mg/L	0.02 mg/L	95.7	70.0	130	---
		Nickel, total	7440-02-0	E420	0.0388 mg/L	0.04 mg/L	97.0	70.0	130	---
		Phosphorus, total	7723-14-0	E420	10.6 mg/L	10 mg/L	106	70.0	130	---
		Potassium, total	7440-09-7	E420	3.74 mg/L	4 mg/L	93.5	70.0	130	---
		Rubidium, total	7440-17-7	E420	0.0196 mg/L	0.02 mg/L	98.0	70.0	130	---
		Selenium, total	7782-49-2	E420	0.0401 mg/L	0.04 mg/L	100	70.0	130	---
		Silicon, total	7440-21-3	E420	9.22 mg/L	10 mg/L	92.2	70.0	130	---
		Silver, total	7440-22-4	E420	0.00371 mg/L	0.004 mg/L	92.8	70.0	130	---
		Sodium, total	7440-23-5	E420	ND mg/L	---	ND	70.0	130	---
		Strontium, total	7440-24-6	E420	ND mg/L	---	ND	70.0	130	---
		Sulfur, total	7704-34-9	E420	ND mg/L	---	ND	70.0	130	---
		Tellurium, total	13494-80-9	E420	0.0368 mg/L	0.04 mg/L	92.1	70.0	130	---
		Thallium, total	7440-28-0	E420	0.00390 mg/L	0.004 mg/L	97.4	70.0	130	---
		Thorium, total	7440-29-1	E420	0.0202 mg/L	0.02 mg/L	101	70.0	130	---
		Tin, total	7440-31-5	E420	0.0190 mg/L	0.02 mg/L	94.9	70.0	130	---
		Titanium, total	7440-32-6	E420	0.0390 mg/L	0.04 mg/L	97.4	70.0	130	---
		Tungsten, total	7440-33-7	E420	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	---
		Uranium, total	7440-61-1	E420	0.00412 mg/L	0.004 mg/L	103	70.0	130	---
		Vanadium, total	7440-62-2	E420	0.101 mg/L	0.1 mg/L	101	70.0	130	---
		Zinc, total	7440-66-6	E420	0.385 mg/L	0.4 mg/L	96.4	70.0	130	---
		Zirconium, total	7440-67-7	E420	0.0374 mg/L	0.04 mg/L	93.4	70.0	130	---
Total Metals (QCLot: 1550633)										
VA24B6717-001	SQU US 1	Mercury, total	7439-97-6	E508	0.0000975 mg/L	0 mg/L	97.5	70.0	130	---
Dissolved Metals (QCLot: 1541826)										
VA24B6717-002	SQU DS 1	Aluminum, dissolved	7429-90-5	E421	0.195 mg/L	0.2 mg/L	97.5	70.0	130	---
		Antimony, dissolved	7440-36-0	E421	0.0189 mg/L	0.02 mg/L	94.5	70.0	130	---
		Arsenic, dissolved	7440-38-2	E421	0.0199 mg/L	0.02 mg/L	99.5	70.0	130	---
		Barium, dissolved	7440-39-3	E421	0.0193 mg/L	0.02 mg/L	96.6	70.0	130	---
		Beryllium, dissolved	7440-41-7	E421	0.0416 mg/L	0.04 mg/L	104	70.0	130	---
		Bismuth, dissolved	7440-69-9	E421	0.00962 mg/L	0.01 mg/L	96.2	70.0	130	---
		Boron, dissolved	7440-42-8	E421	0.103 mg/L	0.1 mg/L	103	70.0	130	---
		Cadmium, dissolved	7440-43-9	E421	0.00391 mg/L	0.004 mg/L	97.8	70.0	130	---
		Calcium, dissolved	7440-70-2	E421	3.92 mg/L	4 mg/L	97.9	70.0	130	---
		Cesium, dissolved	7440-46-2	E421	0.00986 mg/L	0.01 mg/L	98.6	70.0	130	---
		Chromium, dissolved	7440-47-3	E421	0.0388 mg/L	0.04 mg/L	97.0	70.0	130	---
		Cobalt, dissolved	7440-48-4	E421	0.0194 mg/L	0.02 mg/L	97.2	70.0	130	---
		Copper, dissolved	7440-50-8	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	---
		Iron, dissolved	7439-89-6	E421	1.91 mg/L	2 mg/L	95.5	70.0	130	---




Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Dissolved Metals (QCLot: 1541826) - continued										
VA24B6717-002	SQU DS 1	Lead, dissolved	7439-92-1	E421	0.0195 mg/L	0.02 mg/L	97.3	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.106 mg/L	0.1 mg/L	106	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	0.963 mg/L	1 mg/L	96.3	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0196 mg/L	0.02 mg/L	97.8	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0384 mg/L	0.04 mg/L	96.1	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	10.0 mg/L	10 mg/L	100	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	4.12 mg/L	4 mg/L	103	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0191 mg/L	0.02 mg/L	95.4	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0389 mg/L	0.04 mg/L	97.3	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	9.57 mg/L	10 mg/L	95.7	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00404 mg/L	0.004 mg/L	101	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	1.97 mg/L	2 mg/L	98.4	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	0.0217 mg/L	0.02 mg/L	108	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	19.7 mg/L	20 mg/L	98.5	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0399 mg/L	0.04 mg/L	99.8	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00384 mg/L	0.004 mg/L	95.9	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0210 mg/L	0.02 mg/L	105	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0196 mg/L	0.02 mg/L	98.2	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0366 mg/L	0.04 mg/L	91.5	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0189 mg/L	0.02 mg/L	94.5	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00394 mg/L	0.004 mg/L	98.5	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0970 mg/L	0.1 mg/L	97.0	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.381 mg/L	0.4 mg/L	95.2	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0400 mg/L	0.04 mg/L	100	70.0	130	----
Dissolved Metals (QCLot: 1549623)										
FJ2402035-010	Anonymous	Zinc, dissolved	7440-66-6	E421	0.360 mg/L	0.4 mg/L	90.1	70.0	130	----
Dissolved Metals (QCLot: 1551717)										
VA24B6717-001	SQU US 1	Mercury, dissolved	7439-97-6	E509	0.000101 mg/L	0 mg/L	101	70.0	130	----
Speciated Metals (QCLot: 1558766)										
VA24B6717-002	SQU DS 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.270 mg/L	0.25 mg/L	108	70.0	130	----



Chain of Custody (COC) / Analytical Request Form

Canada Toll Free: 1 800 668 9878



COC Number: 17 -

Page 1 of

Report To Contact and company name below will appear on the final report		Report Format / Distribution		Select Service Level Below - Contact your AM to confirm all E&P TATs (surcharges may apply)															
Company:	Triton Environmental	Select Report Format: <input checked="" type="checkbox"/> PDF <input checked="" type="checkbox"/> EXCEL <input type="checkbox"/> EDD (DIGITAL)		Regular [R] <input checked="" type="checkbox"/> Standard TAT if received by 3 pm - business days - no surcharges apply															
Contact:		Quality Control (QC) Report with Report <input checked="" type="checkbox"/> <input type="checkbox"/> NO		<table border="1"> <tr> <td rowspan="3">PRIORITY (Business Days)</td> <td>4 day [P4-20%]</td> <td><input type="checkbox"/></td> <td rowspan="3">EMERGENCY</td> <td>1 Business day [E1 - 100%]</td> <td><input type="checkbox"/></td> </tr> <tr> <td>3 day [P3-25%]</td> <td><input type="checkbox"/></td> <td>Same Day, Weekend or Statutory holiday [E2 -200% (Laboratory opening fees may apply)]</td> <td><input type="checkbox"/></td> </tr> <tr> <td>2 day [P2-50%]</td> <td><input type="checkbox"/></td> <td></td> <td></td> </tr> </table>		PRIORITY (Business Days)	4 day [P4-20%]	<input type="checkbox"/>	EMERGENCY	1 Business day [E1 - 100%]	<input type="checkbox"/>	3 day [P3-25%]	<input type="checkbox"/>	Same Day, Weekend or Statutory holiday [E2 -200% (Laboratory opening fees may apply)]	<input type="checkbox"/>	2 day [P2-50%]	<input type="checkbox"/>		
PRIORITY (Business Days)	4 day [P4-20%]	<input type="checkbox"/>	EMERGENCY	1 Business day [E1 - 100%]	<input type="checkbox"/>														
	3 day [P3-25%]	<input type="checkbox"/>		Same Day, Weekend or Statutory holiday [E2 -200% (Laboratory opening fees may apply)]	<input type="checkbox"/>														
	2 day [P2-50%]	<input type="checkbox"/>																	
Phone:		<input checked="" type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked		Date and Time Required for all E&P TATs: dd-mmm-yy hh:mm															
Street:		Select Distribution: <input checked="" type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX		or tests that can not be performed according to the service level selected, you will be contacted.															
City/Province:		Email 1 or Fax		Analysis Request															
Postal Code:		Email 2		Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below															
		Email 3																	

Invoice To		Invoice Distribution	
Same as Report To <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		Select Invoice Distribution: <input checked="" type="checkbox"/> EMAIL <input checked="" type="checkbox"/> MAIL <input checked="" type="checkbox"/> FAX	
Copy of Invoice with Report <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		Email 1 or Fax	
Company:		Email 2	
Contact:			
Project Information		Oil and Gas Required Fields (client use)	
ALS Account # / Quote #:	VA23-TRIT100-012	AFE/Cost Center:	PO#
Job #:	11964	Major/Minor Code:	Routing Code:
PO / AFE:	11964 - Task 20 - Phase 3C-4C	Requisitioner:	
LSD:		Location:	

ALS Lab Work Order # (lab use only)	ALS Contact:	Sampler:	ALS Sample # (lab use only)	Sample Identification and/or Coordinates (This description will appear on the report)	Date (dd-mmm-yy)	Time (hh:mm)	Sample Type	Total metals + mercury	Dissolved metals + mercury	Total hexavalent chromium	Total trivalent chromium	TSS	TDS	Nutrients (ammonia, ammonium, total nitrogen, total phosphorus)	Total sulfide (low) (as H2S)	Unionized Sulfide (low)	Anions scan (Br, Cl, F, NO2, NO3, SO4)	General parameters (alkalinity)	DOC	SAMPLES ON HOLD	Sample is hazardous (please provide further detail)	NUMBER OF CONTAINERS
6717				SQU US 1	10-Jul-24	09:18	Water	R	R	R	R	R	R	R	R	R	R	R	R		N	9
				pH: 7.80 cond: 23 µS/cm temp: 13.2 °C																		
				SQU DS 1	10-Jul-24	11:35	Water	R	R	R	R	R	R	R	R	R	R	R	R		N	9
				pH: 7.35 cond: 23 µS/cm temp: 14.4 °C																		
				Duplicate	10-Jul-24	09:18	Water	R	R	R	R	R	R	R	R	R	R	R	R		N	9
				Field Blank	10-Jul-24	9:45	Water	R	R	R	R	R	R	R	R	R	R	R	R		N	9
				Trip Blank	10-Jul-24	-	Water	R		R	R	R	R	R	R	R	R	R		N	6	

Drinking Water (DW)		Telephone: +1 804 253 4188		SAMPLE CONDITION AS RECEIVED (lab use only)	
Are samples taken from a Reg	<input type="checkbox"/> NO <input checked="" type="checkbox"/> YES	Specify Criteria to add on report by clicking on the drop-down list below (electronic COC only)		Frozen <input checked="" type="checkbox"/> SIF Observations Yes <input type="checkbox"/> No <input type="checkbox"/>	
Are samples for human consumption/ use?	<input type="checkbox"/> NO <input checked="" type="checkbox"/> YES	Triton Project # 11964		Ice Packs <input checked="" type="checkbox"/> Ice Cubes <input type="checkbox"/> Custody seal intact Yes <input type="checkbox"/> No <input type="checkbox"/>	
SHIPPING RELEASE (client use)		INITIAL SHIPMENT RECEPTION (lab use only)		Cooling Initiated <input checked="" type="checkbox"/>	
10 July 24		Time: Received by: Date:		INITIAL COOLER TEMPERATURES °C	
Time: Received by: Date:		Time: Received by: JC		FINAL COOLER TEMPERATURES °C	
Time: Received by: Date:		Time: Received by: JC		12 13	

SHIPPING RELEASE (client use)		INITIAL SHIPMENT RECEPTION (lab use only)		FINAL SHIPMENT RECEPTION (lab use only)	
10 July 24		Time: Received by: Date:		Time: Received by: JC	
Time: Received by: Date:		Time: Received by: JC		Date: 10 JUL 24	
Time: Received by: Date:		Time: Received by: JC		1423	

CIN 7

SEPT 2017 FRONT

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix B	B-4

BCR Site Receiving Environment Field Notes and Logs



FortisBC Eagle Mountain-Woodfibre Gas Pipeline

Water Discharge Authorization Water Quality Monitoring

2024-7-10-Chycoski-9BC03

Project Component:	Tunnel	Site Name:	Receiving Environment - Downstream of Discharge
Inspection Date:	07/10/2024	Location:	BC Rail Site
Triton QP:	Lily Chycoski	Latitude/Longitude:	49.725282 -123.165175
Temperature(c):	Low 13 High 28	Permit:	AE 111824
Weather Conditions:	Clear	Ground Conditions:	Dry

Observations

Time: 11:35:00 **Flow Volume (visual):** high

Notes: Conductivity: 23 micro Siemens per cm

Odour Detected?: No **Notes:**

Unusual Colour?: No **Notes:**

Unusual Observations?: No **Notes:**

Sheen on Water?: No **Notes:**

Samples Collected - Parameters

Total Metals + Mercury	Yes	General Parameters (Alkalinity)	Yes	Other Sample: Total hexavalent chromium and total trivalent chromium
Dissolved Metals + Mercury	Yes	Total Sulfide, Unionized Sulfide	Yes	
TSS	Yes	Anions	Yes	QA Samples: No Total hexavalent chromium and total trivalent chromium
TDS	Yes	VOC/VPH	No	
Nutrients	Yes	EPH, PAH, LEPH/HEPH	No	
DOC	Yes	Trout LC50	No	

Logger Maintenance

Logger Maintenance Performed?	Yes	Photo of COC with Lab Signature?	Yes
--------------------------------------	-----	---	-----

Describe Logger Maintenance

Cleaned logger and took out of the River due to weight missing. Will be placed back in river when a new weight is attached.

Photos



Photo: 1
Location: SQU DS 1
Description: US view



Photo: 2
Location: SQU DS 1
Description: Across view

Photos



Photo: 3
Location: SQU DS 1
Description: DS view

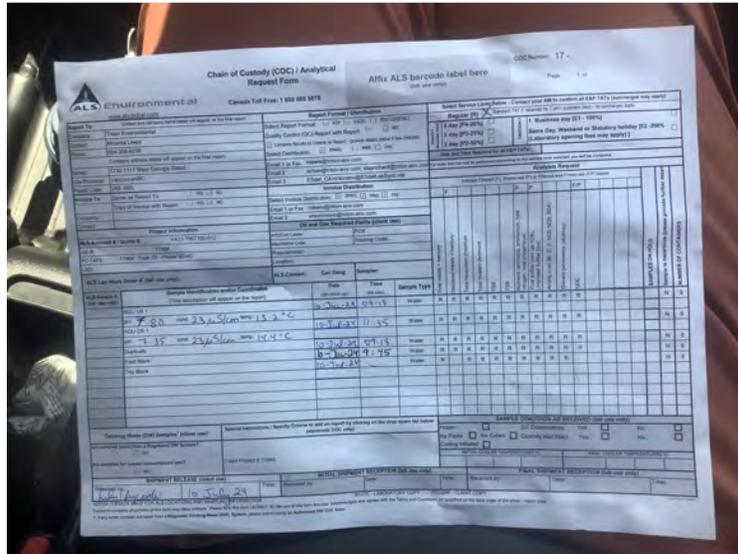


Photo: 4
Location: SQU DS 1
Description: Lab COC



2024-7-10-Chycoski-9BC03

Sign Off

Report Prepared By: Lily Chycoski

Report Reviewed:

Report Reviewer:

Professional(s) of Record:

Name:

Designation:

Designation Number:



FortisBC Eagle Mountain-Woodfibre Gas Pipeline

Water Discharge Authorization Water Quality Monitoring

2024-7-10-Chycoski-6695F

Project Component:	Tunnel	Site Name:	Receiving Environment - Upstream of Discharge
Inspection Date:	07/10/2024	Location:	BC Rail Site
Triton QP:	Lily Chycoski	Latitude/Longitude:	49.726866 -123.163912
Temperature(c):	Low 13 High 28	Permit:	AE 111824
Weather Conditions:	Clear	Ground Conditions:	Dry

Observations

Time: 09:18:00 **Flow Volume (visual):** high

Notes: Conductivity: 23 micro Siemens per cm
Logger not transmitting values properly.

Odour Detected?: No **Notes:**

Unusual Colour? No **Notes:**

Unusual Observations? No **Notes:**

Sheen on Water? No **Notes:**

Samples Collected - Parameters

Total Metals + Mercury	Yes	General Parameters (Alkalinity)	Yes	Other Sample:	Total hexavalent chromium and total trivalent chromium
Dissolved Metals + Mercury	Yes	Total Sulfide, Unionized Sulfide	Yes		
TSS	Yes	Anions	Yes		
TDS	Yes	VOC/VPH	No	QA Samples:	Yes Total hexavalent chromium and total trivalent chromium
Nutrients	Yes	EPH, PAH, LEPH/HEPH	No		
DOC	Yes	Trout LC50	No		

Logger Maintenance

Logger Maintenance Performed?	Yes	Photo of COC with Lab Signature?	Yes
--------------------------------------	-----	---	-----

Describe Logger Maintenance

Cleaning, changing out telemetry wire

Photos



Photo: 1
Location: SQU US 1
Description: US view



Photo: 2
Location: SQU US 1
Description: Across view

Photos



Photo: 3
Location: SQU US 1
Description: DS view

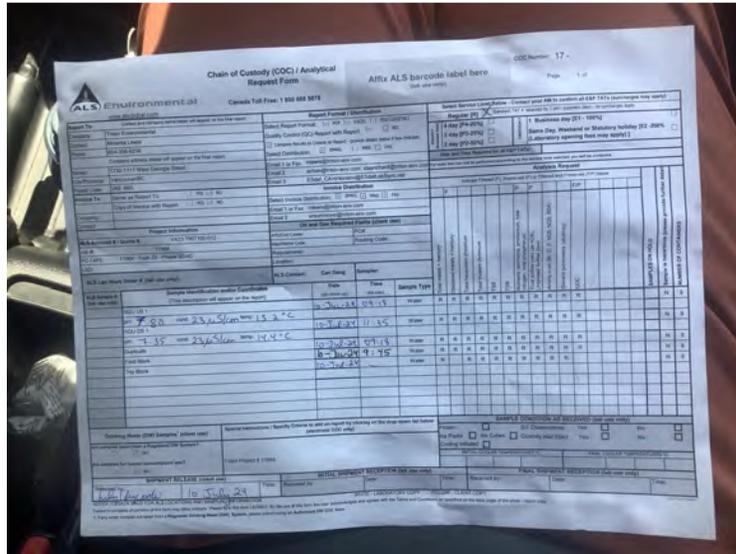


Photo: 4
Location: SQU US 1
Description: Lab COC



2024-7-10-Chycoski-6695F

Sign Off

Report Prepared By: Lily Chycoski

Report Reviewed:

Report Reviewer:

Professional(s) of Record:

Name:

Designation:

Designation Number:

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix C	C-1

Appendix C: Woodfibre Site Point of Discharge from Water Treatment Plant Documentation



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix C	C-2

Woodfibre Site Sample Analysis



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix C	C-3

Woodfibre Site Sample Lab Documentation

CERTIFICATE OF ANALYSIS

Work Order : **VA24B6482**
Client : **Triton Environmental Consultants Ltd.**
Contact :
Address :

Telephone :
Project : 11964
PO : 11964 - Task 30 - Phase 3C-4C
C-O-C number : ----
Sampler : ----
Site : Water Analysis
Quote number : VA23-TRIT100-012_V2
No. of samples received : 1
No. of samples analysed : 1

Page : 1 of 10
Laboratory : ALS Environmental - Vancouver
Account Manager :
Address :

Telephone :
Date Samples Received : 09-Jul-2024 17:00
Date Analysis Commenced : 10-Jul-2024
Issue Date : 23-Jul-2024 14:32

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
	Laboratory Analyst	Inorganics, Edmonton, Alberta
	Analyst	Metals, Burnaby, British Columbia
	Supervisor - Metals Prep & Mercury	Metals, Burnaby, British Columbia
	Supervisor - Organics Instrumentation	Organics, Burnaby, British Columbia
	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
	Technical Specialist	Inorganics, Waterloo, Ontario
	Technical Specialist	Metals, Waterloo, Ontario
	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
		Metals, Burnaby, British Columbia
	Account Manager Assistant	Administration, Burnaby, British Columbia
	Team Leader - Organics	Inorganics, Burnaby, British Columbia
	Team Leader - Organics	Organics, Burnaby, British Columbia
	Supervisor - Water Quality Instrumentation	Inorganics, Burnaby, British Columbia



General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µg/L	micrograms per litre
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.



Analytical Results

Sub-Matrix: Water					Client sample ID	W LNG EOP	---	---	---	---
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	---	---	---	---	
Field Tests										
Conductivity, field	---	EF001/VA	0.10	µS/cm	114.00	---	---	---	---	
pH, field	---	EF001/VA	0.10	pH units	6.94	---	---	---	---	
Temperature, field	---	EF001/VA	0.10	°C	23.3	---	---	---	---	
Physical Tests										
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	35.4	---	---	---	---	
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	37.6	---	---	---	---	
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	67	---	---	---	---	
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	<3.0	---	---	---	---	
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	48.8	---	---	---	---	
Anions and Nutrients										
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	<0.0050	---	---	---	---	
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	---	---	---	---	
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	2.43	---	---	---	---	
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	0.249	---	---	---	---	
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	<0.0050	---	---	---	---	
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	---	---	---	---	
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.095	---	---	---	---	
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.0077	---	---	---	---	
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	3.57	---	---	---	---	
Organic / Inorganic Carbon										
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	1.27	---	---	---	---	
Total Sulfides										
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	---	---	---	---	
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	---	---	---	---	
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	---	---	---	---	
Total Metals										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.0265	---	---	---	---	
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	0.00090	---	---	---	---	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Total Metals										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00060	----	----	----	----	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.00218	----	----	----	----	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	----	----	----	----	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	0.017	----	----	----	----	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	13.6	----	----	----	----	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000023	----	----	----	----	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	0.013	----	----	----	----	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0134	----	----	----	----	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	0.875	----	----	----	----	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.00085	----	----	----	----	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.0102	----	----	----	----	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	<0.050	----	----	----	----	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	5.68	----	----	----	----	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00857	----	----	----	----	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	0.000068	----	----	----	----	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	4.63	----	----	----	----	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	<0.000010	----	----	----	----	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	5.48	----	----	----	----	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0427	----	----	----	----	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	1.20	----	----	----	----	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000033	----	----	----	----	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Total Metals										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.00044	----	----	----	----	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	0.00049	----	----	----	----	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.000403	----	----	----	----	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	<0.0030	----	----	----	----	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Dissolved Metals										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0092	----	----	----	----	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	0.00087	----	----	----	----	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00054	----	----	----	----	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00179	----	----	----	----	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	----	----	----	----	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	0.017	----	----	----	----	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	12.8	----	----	----	----	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000024	----	----	----	----	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	<0.010	----	----	----	----	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	0.0141	----	----	----	----	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	0.828	----	----	----	----	
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00069	----	----	----	----	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.0105	----	----	----	----	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	----	----	----	----	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	5.34	----	----	----	----	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Dissolved Metals										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00873	----	----	----	----	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	0.000062	----	----	----	----	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	4.40	----	----	----	----	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	----	----	----	----	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	5.22	----	----	----	----	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0431	----	----	----	----	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	1.10	----	----	----	----	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	0.000029	----	----	----	----	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	<0.00030	----	----	----	----	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	0.00049	----	----	----	----	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.000454	----	----	----	----	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	<0.0010	----	----	----	----	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	----	----	----	----	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	----	----	----	----	
Speciated Metals										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/WT	0.00050	mg/L	<0.00050	----	----	----	----	
Chromium, trivalent [Cr III], total	16065-83-1	EC535/WT	0.00050	mg/L	<0.00050	----	----	----	----	
Aggregate Organics										
Phenols, total (4AAP)	----	E562/EO	0.0010	mg/L	<0.0010	----	----	----	----	
Volatile Organic Compounds										
Chlorobenzene	108-90-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Chloromethane	74-87-3	E611C/VA	5.0	µg/L	<5.0	----	----	----	----	
Dichlorobenzene, 1,2-	95-50-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichlorobenzene, 1,3-	541-73-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichlorobenzene, 1,4-	106-46-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloropropane, 1,2-	78-87-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Volatile Organic Compounds										
Dichloropropylene, cis+trans-1,3-	542-75-6	E611C/VA	0.75	µg/L	<0.75	----	----	----	----	
Dichloropropylene, cis-1,3-	10061-01-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C/VA	0.20	µg/L	<0.20	----	----	----	----	
Trichloroethane, 1,1,2-	79-00-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Trichlorofluoromethane	75-69-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Volatile Organic Compounds [Drycleaning]										
Carbon tetrachloride	56-23-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Chloroethane	75-00-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethane, 1,1-	75-34-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethane, 1,2-	107-06-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, 1,1-	75-35-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, cis-1,2-	156-59-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, trans-1,2-	156-60-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloromethane	75-09-2	E611C/VA	1.0	µg/L	<1.0	----	----	----	----	
Dichloropropylene, trans-1,3-	10061-02-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethylene	127-18-4	E611C/VA	0.50	µg/L	0.54	----	----	----	----	
Trichloroethane, 1,1,1-	71-55-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Trichloroethylene	79-01-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Vinyl chloride	75-01-4	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
Volatile Organic Compounds [Fuels]										
Benzene	71-43-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Ethylbenzene	100-41-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Styrene	100-42-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Toluene	108-88-3	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
Xylene, m+p-	179601-23-1	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
Xylene, o-	95-47-6	E611C/VA	0.30	µg/L	<0.30	----	----	----	----	
Xylenes, total	1330-20-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Volatile Organic Compounds [THMs]										
Bromodichloromethane	75-27-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Volatile Organic Compounds [THMs]										
Bromoform	75-25-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Chloroform	67-66-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dibromochloromethane	124-48-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Hydrocarbons										
EPH (C10-C19)	----	E601A/VA	250	µg/L	<250	----	----	----	----	
EPH (C19-C32)	----	E601A/VA	250	µg/L	<250	----	----	----	----	
VHw (C6-C10)	----	E581.VH+F1/ VA	100	µg/L	<100	----	----	----	----	
HEPHw	----	EC600A/VA	250	µg/L	<250	----	----	----	----	
LEPHw	----	EC600A/VA	250	µg/L	<250	----	----	----	----	
VPHw	----	EC580A/VA	100	µg/L	<100	----	----	----	----	
Hydrocarbons Surrogates										
Bromobenzotrifluoride, 2- (EPH surrogate)	392-83-6	E601A/VA	1.0	%	98.5	----	----	----	----	
Dichlorotoluene, 3,4-	95-75-0	E581.VH+F1/ VA	1.0	%	95.3	----	----	----	----	
Volatile Organic Compounds Surrogates										
Bromofluorobenzene, 4-	460-00-4	E611C/VA	1.0	%	90.6	----	----	----	----	
Difluorobenzene, 1,4-	540-36-3	E611C/VA	1.0	%	101	----	----	----	----	
Polycyclic Aromatic Hydrocarbons										
Acenaphthene	83-32-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Acenaphthylene	208-96-8	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Acridine	260-94-6	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Anthracene	120-12-7	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benz(a)anthracene	56-55-3	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(a)pyrene	50-32-8	E641A/VA	0.0050	µg/L	<0.0050	----	----	----	----	
Benzo(b+j)fluoranthene	n/a	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(b+j+k)fluoranthene	n/a	E641A/VA	0.015	µg/L	<0.015	----	----	----	----	
Benzo(g,h,i)perylene	191-24-2	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(k)fluoranthene	207-08-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Chrysene	218-01-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Dibenz(a,h)anthracene	53-70-3	E641A/VA	0.0050	µg/L	<0.0050	----	----	----	----	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Jul-2024 10:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6482-001	-----	-----	-----	-----	
					Result	----	----	----	----	
Polycyclic Aromatic Hydrocarbons										
Fluoranthene	206-44-0	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Fluorene	86-73-7	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Methylnaphthalene, 1-	90-12-0	E641A/VA	0.010	µg/L	0.023	----	----	----	----	
Methylnaphthalene, 2-	91-57-6	E641A/VA	0.010	µg/L	0.019	----	----	----	----	
Naphthalene	91-20-3	E641A/VA	0.050	µg/L	<0.050	----	----	----	----	
Phenanthrene	85-01-8	E641A/VA	0.020	µg/L	<0.020	----	----	----	----	
Pyrene	129-00-0	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Quinoline	91-22-5	E641A/VA	0.050	µg/L	<0.050	----	----	----	----	
Polycyclic Aromatic Hydrocarbons Surrogates										
Chrysene-d12	1719-03-5	E641A/VA	0.1	%	97.8	----	----	----	----	
Naphthalene-d8	1146-65-2	E641A/VA	0.1	%	111	----	----	----	----	
Phenanthrene-d10	1517-22-2	E641A/VA	0.1	%	106	----	----	----	----	
Glycols										
Diethylene glycol	111-46-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Ethylene glycol	107-21-1	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Propylene glycol, 1,2-	57-55-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Triethylene glycol	112-27-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Glycols, total (EG+DEG+PG)	----	E680E/VA	10	mg/L	<10	----	----	----	----	
Glycols Surrogates										
Propanediol, 1,3-	504-63-2	E680E/VA	1.0	%	103	----	----	----	----	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

QUALITY CONTROL INTERPRETIVE REPORT

<p>Work Order : VA24B6482</p> <p>Client : Triton Environmental Consultants Ltd.</p> <p>Contact : [REDACTED]</p> <p>Address : [REDACTED]</p> <p>Telephone : [REDACTED]</p> <p>Project : 11964</p> <p>PO : 11964 - Task 30 - Phase 3C-4C</p> <p>C-O-C number : ----</p> <p>Sampler : ----</p> <p>Site : Water Analysis</p> <p>Quote number : VA23-TRIT100-012_V2</p> <p>No. of samples received : 1</p> <p>No. of samples analysed : 1</p>	<p>Page : 1 of 14</p> <p>Laboratory : ALS Environmental - Vancouver</p> <p>Account Manager : [REDACTED]</p> <p>Address : [REDACTED]</p> <p>Telephone : [REDACTED]</p> <p>Date Samples Received : 09-Jul-2024 17:00</p> <p>Issue Date : 23-Jul-2024 14:32</p>
---	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- No Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.



Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Aggregate Organics : Phenols (4AAP) in Water by Colorimetry											
Amber glass total (sulfuric acid) WLNG EOP	E562	09-Jul-2024	17-Jul-2024	28 days	8 days	✔	17-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) WLNG EOP	E298	09-Jul-2024	17-Jul-2024	28 days	8 days	✔	17-Jul-2024	28 days	8 days	✔	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE WLNG EOP	E235.Br-L	09-Jul-2024	10-Jul-2024	28 days	1 days	✔	10-Jul-2024	28 days	1 days	✔	
Anions and Nutrients : Chloride in Water by IC											
HDPE WLNG EOP	E235.Cl	09-Jul-2024	10-Jul-2024	28 days	1 days	✔	10-Jul-2024	28 days	1 days	✔	
Anions and Nutrients : Fluoride in Water by IC											
HDPE WLNG EOP	E235.F	09-Jul-2024	10-Jul-2024	28 days	1 days	✔	10-Jul-2024	28 days	1 days	✔	
Anions and Nutrients : Nitrate in Water by IC (Low Level)											
HDPE WLNG EOP	E235.NO3-L	09-Jul-2024	10-Jul-2024	3 days	1 days	✔	10-Jul-2024	3 days	1 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE WLNG EOP	E235.NO2-L	09-Jul-2024	10-Jul-2024	3 days	1 days	✔	10-Jul-2024	3 days	1 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Anions and Nutrients : Sulfate in Water by IC										
HDPE WLNG EOP	E235.SO4	09-Jul-2024	10-Jul-2024	28 days	1 days	✓	10-Jul-2024	28 days	1 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (sulfuric acid) WLNG EOP	E366	09-Jul-2024	17-Jul-2024	28 days	8 days	✓	22-Jul-2024	28 days	13 days	✓
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) WLNG EOP	E372-U	09-Jul-2024	17-Jul-2024	28 days	8 days	✓	19-Jul-2024	28 days	10 days	✓
Dissolved Metals : Dissolved Mercury in Water by CVAAS										
Glass vial - dissolved (lab preserved) WLNG EOP	E509	09-Jul-2024	16-Jul-2024	28 days	7 days	✓	16-Jul-2024	28 days	7 days	✓
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS										
HDPE - dissolved (lab preserved) WLNG EOP	E421	09-Jul-2024	16-Jul-2024	180 days	7 days	✓	17-Jul-2024	180 days	8 days	✓
Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine										
Glass vial - total (lab preserved) WLNG EOP	EF001	09-Jul-2024	----	----	----		11-Jul-2024	----	2 days	
Glycols : Glycols (4 analytes) by GC-FID										
Glass vial WLNG EOP	E680E	09-Jul-2024	10-Jul-2024	7 days	1 days	✓	11-Jul-2024	40 days	1 days	✓
Hydrocarbons : BC PHCs - EPH by GC-FID										
Amber glass/Teflon lined cap (sodium bisulfate) WLNG EOP	E601A	09-Jul-2024	18-Jul-2024	14 days	9 days	✓	19-Jul-2024	40 days	1 days	✓
Hydrocarbons : VH and F1 by Headspace GC-FID										
Glass vial (sodium bisulfate) WLNG EOP	E581.VH+F1	09-Jul-2024	16-Jul-2024	14 days	7 days	✓	16-Jul-2024	14 days	7 days	✓



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)										
Amber glass dissolved (sulfuric acid) WLNG EOP	E358-L	09-Jul-2024	17-Jul-2024	28 days	8 days	✓	17-Jul-2024	28 days	8 days	✓
Physical Tests : Alkalinity Species by Titration										
HDPE WLNG EOP	E290	09-Jul-2024	10-Jul-2024	14 days	1 days	✓	10-Jul-2024	14 days	1 days	✓
Physical Tests : TDS by Gravimetry										
HDPE WLNG EOP	E162	09-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓
Physical Tests : TSS by Gravimetry										
HDPE WLNG EOP	E160	09-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓
Polycyclic Aromatic Hydrocarbons : PAHs in Water by Hexane LVI GC-MS										
Amber glass/Teflon lined cap (sodium bisulfate) WLNG EOP	E641A	09-Jul-2024	18-Jul-2024	14 days	9 days	✓	18-Jul-2024	40 days	0 days	✓
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) WLNG EOP	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✓
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) WLNG EOP	E508	09-Jul-2024	18-Jul-2024	28 days	9 days	✓	18-Jul-2024	28 days	9 days	✓
Total Metals : Total Metals in Water by CRC ICPMS										
HDPE - total (lab preserved) WLNG EOP	E420	09-Jul-2024	12-Jul-2024	180 days	3 days	✓	13-Jul-2024	180 days	4 days	✓
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)										
HDPE total (zinc acetate+sodium hydroxide) WLNG EOP	E395	09-Jul-2024	----	----	----		16-Jul-2024	7 days	7 days	✓



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Volatile Organic Compounds : VOCs (BC List) by Headspace GC-MS										
Glass vial (sodium bisulfate) WLNG EOP	E611C	09-Jul-2024	16-Jul-2024	14 days	7 days	✔	16-Jul-2024	14 days	7 days	✔

Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Duplicates (DUP)							
Alkalinity Species by Titration	E290	1537195	1	10	10.0	5.0	✔
Ammonia by Fluorescence	E298	1550037	1	18	5.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1537201	1	1	100.0	5.0	✔
Chloride in Water by IC	E235.Cl	1537198	1	10	10.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1546329	1	14	7.1	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1538274	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1550035	1	14	7.1	5.0	✔
Fluoride in Water by IC	E235.F	1537197	1	10	10.0	5.0	✔
Glycols (4 analytes) by GC-FID	E680E	1537687	1	5	20.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1537199	1	10	10.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1537200	1	10	10.0	5.0	✔
Phenols (4AAP) in Water by Colorimetry	E562	1547169	1	20	5.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1537196	1	19	5.2	5.0	✔
TDS by Gravimetry	E162	1546905	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1550888	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538123	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1550044	1	3	33.3	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1550043	1	8	12.5	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1547176	1	16	6.2	5.0	✔
TSS by Gravimetry	E160	1546909	1	20	5.0	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1546848	1	5	20.0	5.0	✔
VOCs (BC List) by Headspace GC-MS	E611C	1546849	1	18	5.5	5.0	✔
Laboratory Control Samples (LCS)							
Alkalinity Species by Titration	E290	1537195	1	10	10.0	5.0	✔
Ammonia by Fluorescence	E298	1550037	1	18	5.5	5.0	✔
BC PHCs - EPH by GC-FID	E601A	1550707	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1537201	1	1	100.0	5.0	✔
Chloride in Water by IC	E235.Cl	1537198	1	10	10.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1546329	1	14	7.1	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1538274	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1550035	1	14	7.1	5.0	✔
Fluoride in Water by IC	E235.F	1537197	1	10	10.0	5.0	✔
Glycols (4 analytes) by GC-FID	E680E	1537687	1	5	20.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1537199	1	10	10.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1537200	1	10	10.0	5.0	✔



Matrix: **Water**

Evaluation: * = QC frequency outside specification; ✓ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Control Samples (LCS) - Continued							
PAHs in Water by Hexane LVI GC-MS	E641A	1550706	1	13	7.6	5.0	✓
Phenols (4AAP) in Water by Colorimetry	E562	1547169	1	20	5.0	5.0	✓
Sulfate in Water by IC	E235.SO4	1537196	1	19	5.2	5.0	✓
TDS by Gravimetry	E162	1546905	1	20	5.0	5.0	✓
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✓
Total Mercury in Water by CVAAS	E508	1550888	1	20	5.0	5.0	✓
Total Metals in Water by CRC ICPMS	E420	1538123	1	20	5.0	5.0	✓
Total Nitrogen by Colourimetry	E366	1550044	1	3	33.3	5.0	✓
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1550043	1	8	12.5	5.0	✓
Total Sulfide by Colourimetry (Automated Flow)	E395	1547176	1	16	6.2	5.0	✓
TSS by Gravimetry	E160	1546909	1	20	5.0	5.0	✓
VH and F1 by Headspace GC-FID	E581.VH+F1	1546848	1	5	20.0	5.0	✓
VOCs (BC List) by Headspace GC-MS	E611C	1546849	1	18	5.5	5.0	✓
Method Blanks (MB)							
Alkalinity Species by Titration	E290	1537195	1	10	10.0	5.0	✓
Ammonia by Fluorescence	E298	1550037	1	18	5.5	5.0	✓
BC PHCs - EPH by GC-FID	E601A	1550707	1	19	5.2	5.0	✓
Bromide in Water by IC (Low Level)	E235.Br-L	1537201	1	1	100.0	5.0	✓
Chloride in Water by IC	E235.Cl	1537198	1	10	10.0	5.0	✓
Dissolved Mercury in Water by CVAAS	E509	1546329	1	14	7.1	5.0	✓
Dissolved Metals in Water by CRC ICPMS	E421	1538274	1	19	5.2	5.0	✓
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1550035	1	14	7.1	5.0	✓
Fluoride in Water by IC	E235.F	1537197	1	10	10.0	5.0	✓
Glycols (4 analytes) by GC-FID	E680E	1537687	1	5	20.0	5.0	✓
Nitrate in Water by IC (Low Level)	E235.NO3-L	1537199	1	10	10.0	5.0	✓
Nitrite in Water by IC (Low Level)	E235.NO2-L	1537200	1	10	10.0	5.0	✓
PAHs in Water by Hexane LVI GC-MS	E641A	1550706	1	13	7.6	5.0	✓
Phenols (4AAP) in Water by Colorimetry	E562	1547169	1	20	5.0	5.0	✓
Sulfate in Water by IC	E235.SO4	1537196	1	19	5.2	5.0	✓
TDS by Gravimetry	E162	1546905	1	20	5.0	5.0	✓
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✓
Total Mercury in Water by CVAAS	E508	1550888	1	20	5.0	5.0	✓
Total Metals in Water by CRC ICPMS	E420	1538123	1	20	5.0	5.0	✓
Total Nitrogen by Colourimetry	E366	1550044	1	3	33.3	5.0	✓
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1550043	1	8	12.5	5.0	✓
Total Sulfide by Colourimetry (Automated Flow)	E395	1547176	1	16	6.2	5.0	✓
TSS by Gravimetry	E160	1546909	1	20	5.0	5.0	✓
VH and F1 by Headspace GC-FID	E581.VH+F1	1546848	1	5	20.0	5.0	✓
VOCs (BC List) by Headspace GC-MS	E611C	1546849	1	18	5.5	5.0	✓



Matrix: **Water**

Evaluation: ✘ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
Matrix Spikes (MS)							
Ammonia by Fluorescence	E298	1550037	1	18	5.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1537201	0	1	0.0	5.0	✘
Chloride in Water by IC	E235.Cl	1537198	1	10	10.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1546329	1	14	7.1	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1538274	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1550035	1	14	7.1	5.0	✔
Fluoride in Water by IC	E235.F	1537197	1	10	10.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1537199	1	10	10.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1537200	1	10	10.0	5.0	✔
Phenols (4AAP) in Water by Colorimetry	E562	1547169	1	20	5.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1537196	1	19	5.2	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1550888	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538123	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1550044	1	3	33.3	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1550043	1	8	12.5	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1547176	1	16	6.2	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1546848	1	5	20.0	5.0	✔
VOCs (BC List) by Headspace GC-MS	E611C	1546849	1	18	5.5	5.0	✔



Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$, with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO ₂ . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H ₂ S" if reported represent the maximum possible H ₂ S concentration based on the total sulfide concentration in the sample. The H ₂ S calculation converts Total Sulphide as (S ₂ ⁻) and reports it as Total Sulphide as (H ₂ S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Waterloo	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection. Results are based on an un-filtered, field-preserved sample.
Phenols (4AAP) in Water by Colorimetry	E562 ALS Environmental - Edmonton	Water	EPA 9066	This automated method is based on the distillation of phenol and subsequent reaction of the distillate with alkaline ferricyanide (K ₃ Fe(CN) ₆) and 4-amino-antipyrine (4-AAP) to form a red complex which is measured colorimetrically.
VH and F1 by Headspace GC-FID	E581.VH+F1 ALS Environmental - Vancouver	Water	BC MOE Lab Manual / CCME PHC in Soil - Tier 1 (mod)	Volatile Hydrocarbons (VH and F1) is analyzed by static headspace GC-FID. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law. Analytical methods for CCME Petroleum Hydrocarbons (PHCs) are validated to comply fully with the Reference Method for the Canada-Wide Standard for PHC. Unless qualified, all required quality control criteria of the CCME PHC method have been met, including response factor and linearity requirements.
BC PHCs - EPH by GC-FID	E601A ALS Environmental - Vancouver	Water	BC MOE Lab Manual	Sample extracts are analyzed by GC-FID for BC hydrocarbon fractions.
VOCs (BC List) by Headspace GC-MS	E611C ALS Environmental - Vancouver	Water	EPA 8260D (mod)	Volatile Organic Compounds (VOCs) are analyzed by static headspace GC-MS. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law. Total Xylenes is the sum of m,p-Xylene & o-Xylene. Total BTEX is the sum of Benzene, Toluene, Ethylbenzene, & Total Xylenes. Total BTEX+Styrene is the sum of Total BTEX & Styrene. Total Trihalomethanes [THMs] is the sum of Bromodichloromethane, Bromoform, Chloroform, & Dibromochloromethane.
PAHs in Water by Hexane LVI GC-MS	E641A ALS Environmental - Vancouver	Water	EPA 8270E (mod)	Polycyclic Aromatic Hydrocarbons (PAHs) are analyzed by large volume injection (LVI) GC-MS.
Glycols (4 analytes) by GC-FID	E680E ALS Environmental - Vancouver	Water	EPA 8015D (mod)	Derivatized glycols are analyzed by GC-FID.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Waterloo	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
VPH: VH-BTEX-Styrene	EC580A ALS Environmental - Vancouver	Water	BC MOE Lab Manual (VPH in Water and Solids) (mod)	Volatile Petroleum Hydrocarbons (VPH) is calculated as follows: VPHw = Volatile Hydrocarbons (VH C6-C10) minus benzene, toluene, ethylbenzene, xylenes (BTEX) and styrene.
LEPH and HEPH: EPH-PAH	EC600A ALS Environmental - Vancouver	Water	BC MOE Lab Manual (LEPH and HEPH)	Light Extractable Petroleum Hydrocarbons (LEPH) and Heavy Extractable Petroleum Hydrocarbons (HEPH) are calculated as follows: LEPH = Extractable Petroleum Hydrocarbons (EPH10-19) minus Acenaphthene, Acridine, Anthracene, Fluorene, Naphthalene and Phenanthrene; HEPH = Extractable Petroleum Hydrocarbons (EPH19-32) minus Benz(a)anthracene, Benzo(a)pyrene, Fluoranthene, and Pyrene.
Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO ₃ .
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.
VOCs Preparation for Headspace Analysis	EP581 ALS Environmental - Vancouver	Water	EPA 5021A (mod)	Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler. An aliquot of the headspace is then injected into the GC/MS-FID system.
PHCs and PAHs Hexane Extraction	EP601 ALS Environmental - Vancouver	Water	EPA 3511 (mod)	Petroleum Hydrocarbons (PHCs) and Polycyclic Aromatic Hydrocarbons (PAHs) are extracted using a hexane liquid-liquid extraction.
Glycols Extraction and Derivatization (BC Only)	EP680E ALS Environmental - Vancouver	Water	EPA 8015D (mod)	Aqueous sample is derivatized and extracted with organic solvent.

QUALITY CONTROL REPORT

Work Order : **VA24B6482**

Client : Triton Environmental Consultants Ltd.

Contact : [REDACTED]

Address : [REDACTED]

Telephone : [REDACTED]

Project : 11964

PO : 11964 - Task 30 - Phase 3C-4C

C-O-C number : ----

Sampler : ----

Site : Water Analysis

Quote number : VA23-TRIT100-012_V2

No. of samples received : 1

No. of samples analysed : 1

Page : 1 of 23

Laboratory : ALS Environmental - Vancouver

Account Manager : [REDACTED]

Address : [REDACTED]

Telephone : [REDACTED]

Date Samples Received : 09-Jul-2024 17:00

Date Analysis Commenced : 10-Jul-2024

Issue Date : 23-Jul-2024 14:32

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
[REDACTED]	Laboratory Analyst	Edmonton Inorganics, Edmonton, Alberta
	Analyst	Vancouver Metals, Burnaby, British Columbia
	Supervisor - Metals Prep & Mercury	Vancouver Metals, Burnaby, British Columbia
	Supervisor - Organics Instrumentation	Vancouver Organics, Burnaby, British Columbia
	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
	Technical Specialist	Waterloo Inorganics, Waterloo, Ontario
	Technical Specialist	Waterloo Metals, Waterloo, Ontario
	Supervisor - Metals ICP Instrumentation	Vancouver Metals, Burnaby, British Columbia
		Vancouver Metals, Burnaby, British Columbia
	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
	Team Leader - Organics	Vancouver Inorganics, Burnaby, British Columbia
	Team Leader - Organics	Vancouver Organics, Burnaby, British Columbia
	Supervisor - Water Quality Instrumentation	Vancouver Inorganics, Burnaby, British Columbia



General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

= Indicates a QC result that did not meet the ALS DQO.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.



Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Physical Tests (QC Lot: 1537195)											
VA24B6455-006	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	13.6	13.5	0.738%	20%	----
Physical Tests (QC Lot: 1546905)											
FJ2401989-001	Anonymous	Solids, total dissolved [TDS]	----	E162	20	mg/L	179	182	4	Diff <2x LOR	----
Physical Tests (QC Lot: 1546909)											
FJ2401989-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	<3.0	<3.0	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1537196)											
VA24B6482-001	WLNG EOP	Sulfate (as SO4)	14808-79-8	E235.SO4	0.30	mg/L	3.57	3.54	0.878%	20%	----
Anions and Nutrients (QC Lot: 1537197)											
VA24B6482-001	WLNG EOP	Fluoride	16984-48-8	E235.F	0.020	mg/L	0.249	0.245	1.58%	20%	----
Anions and Nutrients (QC Lot: 1537198)											
VA24B6482-001	WLNG EOP	Chloride	16887-00-6	E235.Cl	0.50	mg/L	2.43	2.39	0.04	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1537199)											
VA24B6482-001	WLNG EOP	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1537200)											
VA24B6482-001	WLNG EOP	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1537201)											
VA24B6482-001	WLNG EOP	Bromide	24959-67-9	E235.Br-L	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1550037)											
VA24B6062-001	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.100	mg/L	1.04	1.05	1.10%	20%	----
Anions and Nutrients (QC Lot: 1550043)											
VA24B6062-001	Anonymous	Phosphorus, total	7723-14-0	E372-U	0.0400	mg/L	2.93	3.48	17.3%	20%	----
Anions and Nutrients (QC Lot: 1550044)											
VA24B6482-001	WLNG EOP	Nitrogen, total	7727-37-9	E366	0.030	mg/L	0.095	0.091	0.004	Diff <2x LOR	----
Organic / Inorganic Carbon (QC Lot: 1550035)											
VA24B6482-001	WLNG EOP	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	1.27	1.25	0.01	Diff <2x LOR	----
Total Sulfides (QC Lot: 1547176)											
CG2409644-005	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	<0.0015	0	Diff <2x LOR	----
Total Metals (QC Lot: 1538123)											
KS2402631-001	Anonymous	Aluminum, total	7429-90-5	E420	0.0100	mg/L	0.101	0.105	3.24%	20%	----
		Antimony, total	7440-36-0	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----



Sub-Matrix: **Water**

Laboratory Duplicate (DUP) Report

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Total Metals (QC Lot: 1538123) - continued											
KS2402631-001	Anonymous	Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00040	0.00043	0.00003	Diff <2x LOR	----
		Barium, total	7440-39-3	E420	0.0200	mg/L	0.0647	0.0663	0.00157	Diff <2x LOR	----
		Beryllium, total	7440-41-7	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.100	mg/L	<0.100	<0.100	0	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.000200	mg/L	<0.000200	<0.000200	0	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.100	mg/L	100	100	0.248%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.00200	mg/L	<0.00200	<0.00200	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	0.00011	<0.00010	0.000009	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00100	mg/L	0.00276	0.00280	0.00004	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.030	mg/L	0.104	0.110	0.006	Diff <2x LOR	----
		Lead, total	7439-92-1	E420	0.000500	mg/L	<0.000500	<0.000500	0	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.0038	0.0038	0.00004	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.100	mg/L	29.0	29.8	2.72%	20%	----
		Manganese, total	7439-96-5	E420	0.00200	mg/L	0.0186	0.0192	0.00054	Diff <2x LOR	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.000999	0.000954	4.62%	20%	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	0.00143	0.00139	0.00004	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.100	mg/L	2.34	2.36	1.26%	20%	----
		Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00023	0.00026	0.00003	Diff <2x LOR	----
		Selenium, total	7782-49-2	E420	0.00100	mg/L	0.00206	0.00218	0.000122	Diff <2x LOR	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	12.4	12.6	1.91%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, total	7440-23-5	E420	2.00	mg/L	3.78	3.78	0.001	Diff <2x LOR	----
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.450	0.446	0.989%	20%	----
		Sulfur, total	7704-34-9	E420	0.50	mg/L	17.2	17.9	4.04%	20%	----
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, total	7440-32-6	E420	0.00030	mg/L	0.00307	0.00327	6.17%	20%	----
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, total	7440-61-1	E420	0.000100	mg/L	0.00314	0.00323	2.69%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Total Metals (QC Lot: 1538123) - continued											
KS2402631-001	Anonymous	Vanadium, total	7440-62-2	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0500	mg/L	<0.0500	<0.0500	0	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
Total Metals (QC Lot: 1550888)											
KS2402662-002	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1538274)											
VA24B6238-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.290	0.289	0.389%	20%	----
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	0.00042	0.00042	0.0000003	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	0.00457	0.00459	0.471%	20%	----
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.0931	0.0949	1.85%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	0.00928	0.00919	0.938%	20%	----
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	47.0	46.9	0.293%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	0.000068	0.000076	0.000008	Diff <2x LOR	----
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	0.00114	0.00117	0.00003	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	0.00020	0.00022	0.00002	Diff <2x LOR	----
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00265	0.00270	2.13%	20%	----
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	0.312	0.339	8.34%	20%	----
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	0.00119	0.00120	1.21%	20%	----
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	8.01	7.97	0.520%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.0112	0.0111	0.166%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.00695	0.00707	1.80%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.00050	mg/L	0.0102	0.0102	0.532%	20%	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	0.685	0.701	2.23%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00178	0.00182	0.00003	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
Silicon, dissolved	7440-21-3	E421	0.050	mg/L	10.0	10.1	0.973%	20%	----		
Silver, dissolved	7440-22-4	E421	0.000010	mg/L	0.000059	0.000068	0.000009	Diff <2x LOR	----		
Sodium, dissolved	7440-23-5	E421	0.050	mg/L	3.84	3.76	2.07%	20%	----		
Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.342	0.345	1.01%	20%	----		



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Dissolved Metals (QC Lot: 1538274) - continued											
VA24B6238-001	Anonymous	Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	35.9	35.9	0.0496%	20%	----
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000010	mg/L	<0.000010	0.000011	0.0000009	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00030	mg/L	<0.00030	<0.00030	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	0.0101	0.0112	10.2%	20%	----
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	0.00011	0.00012	0.000005	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000010	mg/L	0.00145	0.00144	0.883%	20%	----
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	0.00086	0.00089	0.00003	Diff <2x LOR	----
		Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	1.32	1.26	4.63%	20%	----
		Zirconium, dissolved	7440-67-7	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1546329)											
VA24B6369-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Speciated Metals (QC Lot: 1539725)											
VA24B6482-001	WLNG EOP	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
Aggregate Organics (QC Lot: 1547169)											
EO2405818-019	Anonymous	Phenols, total (4AAP)	----	E562	0.0010	mg/L	0.0484	0.0477	1.54%	20%	----
Volatile Organic Compounds (QC Lot: 1546849)											
VA24B6482-001	WLNG EOP	Benzene	71-43-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Bromodichloromethane	75-27-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Bromoform	75-25-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Carbon tetrachloride	56-23-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Chlorobenzene	108-90-7	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Chloroethane	75-00-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Chloroform	67-66-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Chloromethane	74-87-3	E611C	5.0	µg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Dibromochloromethane	124-48-1	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichlorobenzene, 1,2-	95-50-1	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichlorobenzene, 1,3-	541-73-1	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichlorobenzene, 1,4-	106-46-7	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloroethane, 1,1-	75-34-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloroethane, 1,2-	107-06-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloroethylene, 1,1-	75-35-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloroethylene, cis-1,2-	156-59-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Volatile Organic Compounds (QC Lot: 1546849) - continued											
VA24B6482-001	W LNG EOP	Dichloroethylene, trans-1,2-	156-60-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloromethane	75-09-2	E611C	1.0	µg/L	<1.0	<1.0	0	Diff <2x LOR	----
		Dichloropropane, 1,2-	78-87-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Ethylbenzene	100-41-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Styrene	100-42-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.20	µg/L	<0.20	<0.20	0	Diff <2x LOR	----
		Tetrachloroethylene	127-18-4	E611C	0.50	µg/L	0.54	<0.50	0.04	Diff <2x LOR	----
		Toluene	108-88-3	E611C	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
		Trichloroethane, 1,1,1-	71-55-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichloroethane, 1,1,2-	79-00-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichloroethylene	79-01-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichlorofluoromethane	75-69-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Vinyl chloride	75-01-4	E611C	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
		Xylene, m+p-	179601-23-1	E611C	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
Xylene, o-	95-47-6	E611C	0.30	µg/L	<0.30	<0.30	0	Diff <2x LOR	----		
Hydrocarbons (QC Lot: 1546848)											
VA24B6482-001	W LNG EOP	VHw (C6-C10)	----	E581.VH+F1	100	µg/L	<100	<100	0.0%	30%	----
Glycols (QC Lot: 1537687)											
VA24B5871-001	Anonymous	Diethylene glycol	111-46-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Ethylene glycol	107-21-1	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Propylene glycol, 1,2-	57-55-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Triethylene glycol	112-27-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----



Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Physical Tests (QCLot: 1537195)						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
Physical Tests (QCLot: 1546905)						
Solids, total dissolved [TDS]	----	E162	10	mg/L	<10	----
Physical Tests (QCLot: 1546909)						
Solids, total suspended [TSS]	----	E160	3	mg/L	<3.0	----
Anions and Nutrients (QCLot: 1537196)						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----
Anions and Nutrients (QCLot: 1537197)						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
Anions and Nutrients (QCLot: 1537198)						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
Anions and Nutrients (QCLot: 1537199)						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
Anions and Nutrients (QCLot: 1537200)						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
Anions and Nutrients (QCLot: 1537201)						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
Anions and Nutrients (QCLot: 1550037)						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	----
Anions and Nutrients (QCLot: 1550043)						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	----
Anions and Nutrients (QCLot: 1550044)						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	----
Organic / Inorganic Carbon (QCLot: 1550035)						
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	<0.50	----
Total Sulfides (QCLot: 1547176)						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	----
Total Metals (QCLot: 1538123)						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	----
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Total Metals (QCLot: 1538123) - continued						
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	----
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	----
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	----
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	----
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	----
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	----
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	----
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	----
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	----
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Total Metals (QCLot: 1550888)						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
Dissolved Metals (QCLot: 1538274)						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Dissolved Metals (QCLot: 1538274) - continued						
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
Dissolved Metals (QCLot: 1546329)						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
Speciated Metals (QCLot: 1539725)						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----
Aggregate Organics (QCLot: 1547169)						
Phenols, total (4AAP)	----	E562	0.001	mg/L	<0.0010	----
Volatile Organic Compounds (QCLot: 1546849)						
Benzene	71-43-2	E611C	0.5	µg/L	<0.50	----
Bromodichloromethane	75-27-4	E611C	0.5	µg/L	<0.50	----
Bromoform	75-25-2	E611C	0.5	µg/L	<0.50	----
Carbon tetrachloride	56-23-5	E611C	0.5	µg/L	<0.50	----
Chlorobenzene	108-90-7	E611C	0.5	µg/L	<0.50	----
Chloroethane	75-00-3	E611C	0.5	µg/L	<0.50	----
Chloroform	67-66-3	E611C	0.5	µg/L	<0.50	----
Chloromethane	74-87-3	E611C	5	µg/L	<5.0	----
Dibromochloromethane	124-48-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,2-	95-50-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,3-	541-73-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,4-	106-46-7	E611C	0.5	µg/L	<0.50	----
Dichloroethane, 1,1-	75-34-3	E611C	0.5	µg/L	<0.50	----
Dichloroethane, 1,2-	107-06-2	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, 1,1-	75-35-4	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, cis-1,2-	156-59-2	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, trans-1,2-	156-60-5	E611C	0.5	µg/L	<0.50	----
Dichloromethane	75-09-2	E611C	1	µg/L	<1.0	----
Dichloropropane, 1,2-	78-87-5	E611C	0.5	µg/L	<0.50	----
Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.5	µg/L	<0.50	----
Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.5	µg/L	<0.50	----
Ethylbenzene	100-41-4	E611C	0.5	µg/L	<0.50	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Volatile Organic Compounds (QCLot: 1546849) - continued						
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.5	µg/L	<0.50	----
Styrene	100-42-5	E611C	0.5	µg/L	<0.50	----
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.5	µg/L	<0.50	----
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.2	µg/L	<0.20	----
Tetrachloroethylene	127-18-4	E611C	0.5	µg/L	<0.50	----
Toluene	108-88-3	E611C	0.4	µg/L	<0.40	----
Trichloroethane, 1,1,1-	71-55-6	E611C	0.5	µg/L	<0.50	----
Trichloroethane, 1,1,2-	79-00-5	E611C	0.5	µg/L	<0.50	----
Trichloroethylene	79-01-6	E611C	0.5	µg/L	<0.50	----
Trichlorofluoromethane	75-69-4	E611C	0.5	µg/L	<0.50	----
Vinyl chloride	75-01-4	E611C	0.4	µg/L	<0.40	----
Xylene, m+p-	179601-23-1	E611C	0.4	µg/L	<0.40	----
Xylene, o-	95-47-6	E611C	0.3	µg/L	<0.30	----
Hydrocarbons (QCLot: 1546848)						
VHw (C6-C10)	---	E581.VH+F1	100	µg/L	<100	----
Hydrocarbons (QCLot: 1550707)						
EPH (C10-C19)	---	E601A	250	µg/L	<250	----
EPH (C19-C32)	---	E601A	250	µg/L	<250	----
Polycyclic Aromatic Hydrocarbons (QCLot: 1550706)						
Acenaphthene	83-32-9	E641A	0.01	µg/L	<0.010	----
Acenaphthylene	208-96-8	E641A	0.01	µg/L	<0.010	----
Acridine	260-94-6	E641A	0.01	µg/L	<0.010	----
Anthracene	120-12-7	E641A	0.01	µg/L	<0.010	----
Benz(a)anthracene	56-55-3	E641A	0.01	µg/L	<0.010	----
Benzo(a)pyrene	50-32-8	E641A	0.005	µg/L	<0.0050	----
Benzo(b+j)fluoranthene	n/a	E641A	0.01	µg/L	<0.010	----
Benzo(g,h,i)perylene	191-24-2	E641A	0.01	µg/L	<0.010	----
Benzo(k)fluoranthene	207-08-9	E641A	0.01	µg/L	<0.010	----
Chrysene	218-01-9	E641A	0.01	µg/L	<0.010	----
Dibenz(a,h)anthracene	53-70-3	E641A	0.005	µg/L	<0.0050	----
Fluoranthene	206-44-0	E641A	0.01	µg/L	<0.010	----
Fluorene	86-73-7	E641A	0.01	µg/L	<0.010	----
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A	0.01	µg/L	<0.010	----
Methylnaphthalene, 1-	90-12-0	E641A	0.01	µg/L	<0.010	----
Methylnaphthalene, 2-	91-57-6	E641A	0.01	µg/L	<0.010	----



Sub-Matrix: **Water**

<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Result</i>	<i>Qualifier</i>
Polycyclic Aromatic Hydrocarbons (QCLot: 1550706) - continued						
Naphthalene	91-20-3	E641A	0.05	µg/L	<0.050	----
Phenanthrene	85-01-8	E641A	0.02	µg/L	<0.020	----
Pyrene	129-00-0	E641A	0.01	µg/L	<0.010	----
Quinoline	91-22-5	E641A	0.05	µg/L	<0.050	----
Glycols (QCLot: 1537687)						
Diethylene glycol	111-46-6	E680E	5	mg/L	<5.0	----
Ethylene glycol	107-21-1	E680E	5	mg/L	<5.0	----
Propylene glycol, 1,2-	57-55-6	E680E	5	mg/L	<5.0	----
Triethylene glycol	112-27-6	E680E	5	mg/L	<5.0	----



Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Physical Tests (QCLot: 1537195)									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	105	85.0	115	----
Physical Tests (QCLot: 1546905)									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	101	85.0	115	----
Physical Tests (QCLot: 1546909)									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	90.3	85.0	115	----
Anions and Nutrients (QCLot: 1537196)									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	100	90.0	110	----
Anions and Nutrients (QCLot: 1537197)									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	100	90.0	110	----
Anions and Nutrients (QCLot: 1537198)									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	100	90.0	110	----
Anions and Nutrients (QCLot: 1537199)									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	99.1	90.0	110	----
Anions and Nutrients (QCLot: 1537200)									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	97.2	90.0	110	----
Anions and Nutrients (QCLot: 1537201)									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	93.8	85.0	115	----
Anions and Nutrients (QCLot: 1550037)									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	98.1	85.0	115	----
Anions and Nutrients (QCLot: 1550043)									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	0.05 mg/L	95.1	80.0	120	----
Anions and Nutrients (QCLot: 1550044)									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	110	75.0	125	----
Organic / Inorganic Carbon (QCLot: 1550035)									
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	8.57 mg/L	103	80.0	120	----
Total Sulfides (QCLot: 1547176)									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	101	80.0	120	----
Total Metals (QCLot: 1538123)									



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Total Metals (QCLot: 1538123) - continued									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	104	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	100	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	110	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	97.0	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	107	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	102	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	102	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	100	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	108	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	99.8	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	101	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	101	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	102	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	103	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	98.3	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	105	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	105	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	99.9	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	102	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	98.8	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	105	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	103	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	106	80.0	120	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	104	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	114	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	94.3	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	107	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	100.0	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	97.8	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	99.9	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	98.3	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	92.6	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	100	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	97.7	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	98.3	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	101	80.0	120	----



Sub-Matrix: **Water**

Laboratory Control Sample (LCS) Report

Analyte	CAS Number	Method	LOR	Unit	Spike		Recovery (%)		Recovery Limits (%)		Qualifier
					Target Concentration	LCS	Low	High			
Total Metals (QCLot: 1538123) - continued											
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	104	80.0	120	120	----	
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	102	80.0	120	120	----	
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	97.5	80.0	120	120	----	
Total Metals (QCLot: 1550888)											
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	99.7	80.0	120	120	----	
Dissolved Metals (QCLot: 1538274)											
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	97.2	80.0	120	120	----	
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	98.0	80.0	120	120	----	
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	104	80.0	120	120	----	
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	97.8	80.0	120	120	----	
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	93.4	80.0	120	120	----	
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	101	80.0	120	120	----	
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	99.3	80.0	120	120	----	
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	98.9	80.0	120	120	----	
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	97.0	80.0	120	120	----	
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	98.0	80.0	120	120	----	
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	97.8	80.0	120	120	----	
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	97.6	80.0	120	120	----	
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	96.0	80.0	120	120	----	
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	95.1	80.0	120	120	----	
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	95.9	80.0	120	120	----	
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	105	80.0	120	120	----	
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	102	80.0	120	120	----	
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	95.3	80.0	120	120	----	
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	98.9	80.0	120	120	----	
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	95.7	80.0	120	120	----	
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	95.8	80.0	120	120	----	
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	100	80.0	120	120	----	
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	102	80.0	120	120	----	
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	98.9	80.0	120	120	----	
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	104	80.0	120	120	----	
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	89.8	80.0	120	120	----	
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	106	80.0	120	120	----	
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	98.2	80.0	120	120	----	
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	96.3	80.0	120	120	----	



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Dissolved Metals (QCLot: 1538274) - continued									
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	95.6	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	100	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	92.4	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	95.8	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	97.4	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	95.3	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	96.9	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	98.5	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	95.9	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	95.0	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	98.9	80.0	120	----
Speciated Metals (QCLot: 1539725)									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.025 mg/L	102	80.0	120	----
Aggregate Organics (QCLot: 1547169)									
Phenols, total (4AAP)	----	E562	0.001	mg/L	0.02 mg/L	101	85.0	115	----
Volatile Organic Compounds (QCLot: 1546849)									
Benzene	71-43-2	E611C	0.5	µg/L	100 µg/L	106	70.0	130	----
Bromodichloromethane	75-27-4	E611C	0.5	µg/L	100 µg/L	108	70.0	130	----
Bromoform	75-25-2	E611C	0.5	µg/L	100 µg/L	105	70.0	130	----
Carbon tetrachloride	56-23-5	E611C	0.5	µg/L	100 µg/L	113	70.0	130	----
Chlorobenzene	108-90-7	E611C	0.5	µg/L	100 µg/L	106	70.0	130	----
Chloroethane	75-00-3	E611C	0.5	µg/L	100 µg/L	116	60.0	140	----
Chloroform	67-66-3	E611C	0.5	µg/L	100 µg/L	108	70.0	130	----
Chloromethane	74-87-3	E611C	5	µg/L	100 µg/L	100	60.0	140	----
Dibromochloromethane	124-48-1	E611C	0.5	µg/L	100 µg/L	108	70.0	130	----
Dichlorobenzene, 1,2-	95-50-1	E611C	0.5	µg/L	100 µg/L	103	70.0	130	----
Dichlorobenzene, 1,3-	541-73-1	E611C	0.5	µg/L	100 µg/L	105	70.0	130	----
Dichlorobenzene, 1,4-	106-46-7	E611C	0.5	µg/L	100 µg/L	105	70.0	130	----
Dichloroethane, 1,1-	75-34-3	E611C	0.5	µg/L	100 µg/L	110	70.0	130	----
Dichloroethane, 1,2-	107-06-2	E611C	0.5	µg/L	100 µg/L	101	70.0	130	----
Dichloroethylene, 1,1-	75-35-4	E611C	0.5	µg/L	100 µg/L	103	70.0	130	----
Dichloroethylene, cis-1,2-	156-59-2	E611C	0.5	µg/L	100 µg/L	101	70.0	130	----
Dichloroethylene, trans-1,2-	156-60-5	E611C	0.5	µg/L	100 µg/L	102	70.0	130	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Volatile Organic Compounds (QCLot: 1546849) - continued									
Dichloromethane	75-09-2	E611C	1	µg/L	100 µg/L	107	70.0	130	----
Dichloropropane, 1,2-	78-87-5	E611C	0.5	µg/L	100 µg/L	108	70.0	130	----
Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.5	µg/L	100 µg/L	99.9	70.0	130	----
Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.5	µg/L	100 µg/L	100	70.0	130	----
Ethylbenzene	100-41-4	E611C	0.5	µg/L	100 µg/L	97.9	70.0	130	----
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.5	µg/L	100 µg/L	105	70.0	130	----
Styrene	100-42-5	E611C	0.5	µg/L	100 µg/L	101	70.0	130	----
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.5	µg/L	100 µg/L	107	70.0	130	----
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.2	µg/L	100 µg/L	98.7	70.0	130	----
Tetrachloroethylene	127-18-4	E611C	0.5	µg/L	100 µg/L	103	70.0	130	----
Toluene	108-88-3	E611C	0.4	µg/L	100 µg/L	104	70.0	130	----
Trichloroethane, 1,1,1-	71-55-6	E611C	0.5	µg/L	100 µg/L	115	70.0	130	----
Trichloroethane, 1,1,2-	79-00-5	E611C	0.5	µg/L	100 µg/L	100	70.0	130	----
Trichloroethylene	79-01-6	E611C	0.5	µg/L	100 µg/L	105	70.0	130	----
Trichlorofluoromethane	75-69-4	E611C	0.5	µg/L	100 µg/L	121	60.0	140	----
Vinyl chloride	75-01-4	E611C	0.4	µg/L	100 µg/L	108	60.0	140	----
Xylene, m+p-	179601-23-1	E611C	0.4	µg/L	200 µg/L	114	70.0	130	----
Xylene, o-	95-47-6	E611C	0.3	µg/L	100 µg/L	109	70.0	130	----
Hydrocarbons (QCLot: 1546848)									
VHw (C6-C10)	----	E581.VH+F1	100	µg/L	6310 µg/L	79.6	70.0	130	----
Hydrocarbons (QCLot: 1550707)									
EPH (C10-C19)	----	E601A	250	µg/L	6490 µg/L	111	70.0	130	----
EPH (C19-C32)	----	E601A	250	µg/L	3360 µg/L	111	70.0	130	----
Polycyclic Aromatic Hydrocarbons (QCLot: 1550706)									
Acenaphthene	83-32-9	E641A	0.01	µg/L	0.5 µg/L	95.8	60.0	130	----
Acenaphthylene	208-96-8	E641A	0.01	µg/L	0.5 µg/L	103	60.0	130	----
Acridine	260-94-6	E641A	0.01	µg/L	0.5 µg/L	91.8	60.0	130	----
Anthracene	120-12-7	E641A	0.01	µg/L	0.5 µg/L	95.1	60.0	130	----
Benz(a)anthracene	56-55-3	E641A	0.01	µg/L	0.5 µg/L	89.2	60.0	130	----
Benzo(a)pyrene	50-32-8	E641A	0.005	µg/L	0.5 µg/L	94.8	60.0	130	----
Benzo(b+j)fluoranthene	n/a	E641A	0.01	µg/L	0.5 µg/L	95.7	60.0	130	----
Benzo(g,h,i)perylene	191-24-2	E641A	0.01	µg/L	0.5 µg/L	102	60.0	130	----
Benzo(k)fluoranthene	207-08-9	E641A	0.01	µg/L	0.5 µg/L	94.1	60.0	130	----
Chrysene	218-01-9	E641A	0.01	µg/L	0.5 µg/L	95.9	60.0	130	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Polycyclic Aromatic Hydrocarbons (QCLot: 1550706) - continued									
Dibenz(a,h)anthracene	53-70-3	E641A	0.005	µg/L	0.5 µg/L	100	60.0	130	----
Fluoranthene	206-44-0	E641A	0.01	µg/L	0.5 µg/L	97.3	60.0	130	----
Fluorene	86-73-7	E641A	0.01	µg/L	0.5 µg/L	94.3	60.0	130	----
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A	0.01	µg/L	0.5 µg/L	96.3	60.0	130	----
Methylnaphthalene, 1-	90-12-0	E641A	0.01	µg/L	0.5 µg/L	89.8	60.0	130	----
Methylnaphthalene, 2-	91-57-6	E641A	0.01	µg/L	0.5 µg/L	97.2	60.0	130	----
Naphthalene	91-20-3	E641A	0.05	µg/L	0.5 µg/L	92.0	50.0	130	----
Phenanthrene	85-01-8	E641A	0.02	µg/L	0.5 µg/L	94.9	60.0	130	----
Pyrene	129-00-0	E641A	0.01	µg/L	0.5 µg/L	96.4	60.0	130	----
Quinoline	91-22-5	E641A	0.05	µg/L	0.5 µg/L	96.7	60.0	130	----
Glycols (QCLot: 1537687)									
Diethylene glycol	111-46-6	E680E	5	mg/L	25 mg/L	104	70.0	130	----
Ethylene glycol	107-21-1	E680E	5	mg/L	25 mg/L	103	70.0	130	----
Propylene glycol, 1,2-	57-55-6	E680E	5	mg/L	25 mg/L	102	70.0	130	----
Triethylene glycol	112-27-6	E680E	5	mg/L	25 mg/L	99.0	70.0	130	----



Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Anions and Nutrients (QCLot: 1537196)										
VA24B6450-002	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	102 mg/L	100 mg/L	102	75.0	125	----
Anions and Nutrients (QCLot: 1537197)										
VA24B6450-002	Anonymous	Fluoride	16984-48-8	E235.F	1.04 mg/L	1 mg/L	104	75.0	125	----
Anions and Nutrients (QCLot: 1537198)										
VA24B6450-002	Anonymous	Chloride	16887-00-6	E235.Cl	103 mg/L	100 mg/L	103	75.0	125	----
Anions and Nutrients (QCLot: 1537199)										
VA24B6450-002	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	2.73 mg/L	2.5 mg/L	109	75.0	125	----
Anions and Nutrients (QCLot: 1537200)										
VA24B6450-002	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	2.66 mg/L	2.5 mg/L	106	75.0	125	----
Anions and Nutrients (QCLot: 1550037)										
VA24B6062-002	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.0999 mg/L	0.1 mg/L	99.9	75.0	125	----
Anions and Nutrients (QCLot: 1550043)										
VA24B6062-002	Anonymous	Phosphorus, total	7723-14-0	E372-U	ND mg/L	----	ND	70.0	130	----
Anions and Nutrients (QCLot: 1550044)										
VA24B7185-009	Anonymous	Nitrogen, total	7727-37-9	E366	0.438 mg/L	0.4 mg/L	110	70.0	130	----
Organic / Inorganic Carbon (QCLot: 1550035)										
VA24B6634-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	5.35 mg/L	5 mg/L	107	70.0	130	----
Total Sulfides (QCLot: 1547176)										
CG2409644-006	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.236 mg/L	0.2 mg/L	118	75.0	125	----
Total Metals (QCLot: 1538123)										
KS2402639-001	Anonymous	Aluminum, total	7429-90-5	E420	0.197 mg/L	0.2 mg/L	98.6	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0190 mg/L	0.02 mg/L	95.2	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0214 mg/L	0.02 mg/L	107	70.0	130	----
		Barium, total	7440-39-3	E420	0.0194 mg/L	0.02 mg/L	96.9	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0408 mg/L	0.04 mg/L	102	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00942 mg/L	0.01 mg/L	94.2	70.0	130	----
		Boron, total	7440-42-8	E420	0.097 mg/L	0.1 mg/L	96.7	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00400 mg/L	0.004 mg/L	100	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.00980 mg/L	0.01 mg/L	98.0	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0395 mg/L	0.04 mg/L	98.8	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0191 mg/L	0.02 mg/L	95.6	70.0	130	----
		Copper, total	7440-50-8	E420	ND mg/L	----	ND	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Total Metals (QCLot: 1538123) - continued										
KS2402639-001	Anonymous	Iron, total	7439-89-6	E420	1.95 mg/L	2 mg/L	97.7	70.0	130	---
		Lead, total	7439-92-1	E420	0.0184 mg/L	0.02 mg/L	92.2	70.0	130	---
		Lithium, total	7439-93-2	E420	0.0957 mg/L	0.1 mg/L	95.7	70.0	130	---
		Magnesium, total	7439-95-4	E420	ND mg/L	---	ND	70.0	130	---
		Manganese, total	7439-96-5	E420	ND mg/L	---	ND	70.0	130	---
		Molybdenum, total	7439-98-7	E420	0.0198 mg/L	0.02 mg/L	98.8	70.0	130	---
		Nickel, total	7440-02-0	E420	0.0375 mg/L	0.04 mg/L	93.7	70.0	130	---
		Phosphorus, total	7723-14-0	E420	9.69 mg/L	10 mg/L	96.9	70.0	130	---
		Potassium, total	7440-09-7	E420	3.84 mg/L	4 mg/L	96.0	70.0	130	---
		Rubidium, total	7440-17-7	E420	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	---
		Selenium, total	7782-49-2	E420	0.0413 mg/L	0.04 mg/L	103	70.0	130	---
		Silicon, total	7440-21-3	E420	ND mg/L	---	ND	70.0	130	---
		Silver, total	7440-22-4	E420	0.00390 mg/L	0.004 mg/L	97.5	70.0	130	---
		Sodium, total	7440-23-5	E420	ND mg/L	---	ND	70.0	130	---
		Strontium, total	7440-24-6	E420	ND mg/L	---	ND	70.0	130	---
		Sulfur, total	7704-34-9	E420	21.0 mg/L	20 mg/L	105	70.0	130	---
		Tellurium, total	13494-80-9	E420	0.0383 mg/L	0.04 mg/L	95.8	70.0	130	---
		Thallium, total	7440-28-0	E420	0.00371 mg/L	0.004 mg/L	92.8	70.0	130	---
		Thorium, total	7440-29-1	E420	0.0204 mg/L	0.02 mg/L	102	70.0	130	---
		Tin, total	7440-31-5	E420	0.0192 mg/L	0.02 mg/L	96.0	70.0	130	---
		Titanium, total	7440-32-6	E420	0.0394 mg/L	0.04 mg/L	98.4	70.0	130	---
		Tungsten, total	7440-33-7	E420	0.0191 mg/L	0.02 mg/L	95.7	70.0	130	---
		Uranium, total	7440-61-1	E420	0.00382 mg/L	0.004 mg/L	95.4	70.0	130	---
		Vanadium, total	7440-62-2	E420	0.0999 mg/L	0.1 mg/L	99.9	70.0	130	---
		Zinc, total	7440-66-6	E420	0.379 mg/L	0.4 mg/L	94.7	70.0	130	---
		Zirconium, total	7440-67-7	E420	0.0409 mg/L	0.04 mg/L	102	70.0	130	---
Total Metals (QCLot: 1550888)										
KS2402647-001	Anonymous	Mercury, total	7439-97-6	E508	ND mg/L	---	ND	70.0	130	---
Dissolved Metals (QCLot: 1538274)										
VA24B6238-002	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.185 mg/L	0.2 mg/L	92.4	70.0	130	---
		Antimony, dissolved	7440-36-0	E421	0.0182 mg/L	0.02 mg/L	90.9	70.0	130	---
		Arsenic, dissolved	7440-38-2	E421	0.0201 mg/L	0.02 mg/L	100	70.0	130	---
		Barium, dissolved	7440-39-3	E421	0.0180 mg/L	0.02 mg/L	90.2	70.0	130	---
		Beryllium, dissolved	7440-41-7	E421	0.0362 mg/L	0.04 mg/L	90.4	70.0	130	---
		Bismuth, dissolved	7440-69-9	E421	0.00933 mg/L	0.01 mg/L	93.3	70.0	130	---
		Boron, dissolved	7440-42-8	E421	0.097 mg/L	0.1 mg/L	97.1	70.0	130	---
		Cadmium, dissolved	7440-43-9	E421	0.00370 mg/L	0.004 mg/L	92.5	70.0	130	---
		Calcium, dissolved	7440-70-2	E421	ND mg/L	---	ND	70.0	130	---
		Cesium, dissolved	7440-46-2	E421	0.00993 mg/L	0.01 mg/L	99.3	70.0	130	---
		Chromium, dissolved	7440-47-3	E421	0.0368 mg/L	0.04 mg/L	92.1	70.0	130	---
		Cobalt, dissolved	7440-48-4	E421	0.0187 mg/L	0.02 mg/L	93.4	70.0	130	---
		Copper, dissolved	7440-50-8	E421	0.0184 mg/L	0.02 mg/L	91.8	70.0	130	---
		Iron, dissolved	7439-89-6	E421	1.86 mg/L	2 mg/L	93.1	70.0	130	---



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Dissolved Metals (QCLot: 1538274) - continued										
VA24B6238-002	Anonymous	Lead, dissolved	7439-92-1	E421	0.0182 mg/L	0.02 mg/L	91.2	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0974 mg/L	0.1 mg/L	97.4	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	----	ND	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0183 mg/L	0.02 mg/L	91.4	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0197 mg/L	0.02 mg/L	98.5	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0368 mg/L	0.04 mg/L	92.1	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	9.95 mg/L	10 mg/L	99.5	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	3.81 mg/L	4 mg/L	95.2	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0194 mg/L	0.02 mg/L	97.2	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0403 mg/L	0.04 mg/L	101	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	9.53 mg/L	10 mg/L	95.3	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00375 mg/L	0.004 mg/L	93.8	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	ND mg/L	----	ND	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	ND mg/L	----	ND	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	ND mg/L	----	ND	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0401 mg/L	0.04 mg/L	100	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00362 mg/L	0.004 mg/L	90.4	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0184 mg/L	0.02 mg/L	92.1	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0388 mg/L	0.04 mg/L	97.0	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0185 mg/L	0.02 mg/L	92.7	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00368 mg/L	0.004 mg/L	92.0	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0930 mg/L	0.1 mg/L	93.0	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	ND mg/L	----	ND	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0386 mg/L	0.04 mg/L	96.6	70.0	130	----
Dissolved Metals (QCLot: 1546329)										
VA24B6369-003	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000996 mg/L	0 mg/L	99.6	70.0	130	----
Speciated Metals (QCLot: 1539725)										
VA24B6482-001	WLNG EOP	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0398 mg/L	0.04 mg/L	99.4	70.0	130	----
Aggregate Organics (QCLot: 1547169)										
EO2405818-022	Anonymous	Phenols, total (4AAP)	----	E562	0.0209 mg/L	0.02 mg/L	105	75.0	125	----
Volatile Organic Compounds (QCLot: 1546849)										
VA24B6482-001	WLNG EOP	Benzene	71-43-2	E611C	98.7 µg/L	100 µg/L	98.7	60.0	140	----
		Bromodichloromethane	75-27-4	E611C	103 µg/L	100 µg/L	103	60.0	140	----
		Bromoform	75-25-2	E611C	106 µg/L	100 µg/L	106	60.0	140	----
		Carbon tetrachloride	56-23-5	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Chlorobenzene	108-90-7	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Chloroethane	75-00-3	E611C	97.4 µg/L	100 µg/L	97.4	50.0	150	----
		Chloroform	67-66-3	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Chloromethane	74-87-3	E611C	77.6 µg/L	100 µg/L	77.6	50.0	150	----
		Dibromochloromethane	124-48-1	E611C	106 µg/L	100 µg/L	106	60.0	140	----
		Dichlorobenzene, 1,2-	95-50-1	E611C	101 µg/L	100 µg/L	101	60.0	140	----



Sub-Matrix: Water

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Volatile Organic Compounds (QCLot: 1546849) - continued										
VA24B6482-001	WLNG EOP	Dichlorobenzene, 1,3-	541-73-1	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Dichlorobenzene, 1,4-	106-46-7	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Dichloroethane, 1,1-	75-34-3	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Dichloroethane, 1,2-	107-06-2	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Dichloroethylene, 1,1-	75-35-4	E611C	88.8 µg/L	100 µg/L	88.8	60.0	140	----
		Dichloroethylene, cis-1,2-	156-59-2	E611C	95.3 µg/L	100 µg/L	95.3	60.0	140	----
		Dichloroethylene, trans-1,2-	156-60-5	E611C	92.4 µg/L	100 µg/L	92.4	60.0	140	----
		Dichloromethane	75-09-2	E611C	103 µg/L	100 µg/L	103	60.0	140	----
		Dichloropropane, 1,2-	78-87-5	E611C	104 µg/L	100 µg/L	104	60.0	140	----
		Dichloropropylene, cis-1,3-	10061-01-5	E611C	100.0 µg/L	100 µg/L	100.0	60.0	140	----
		Dichloropropylene, trans-1,3-	10061-02-6	E611C	103 µg/L	100 µg/L	103	60.0	140	----
		Ethylbenzene	100-41-4	E611C	91.1 µg/L	100 µg/L	91.1	60.0	140	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	108 µg/L	100 µg/L	108	60.0	140	----
		Styrene	100-42-5	E611C	98.9 µg/L	100 µg/L	98.9	60.0	140	----
		Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Tetrachloroethylene	127-18-4	E611C	93.5 µg/L	100 µg/L	93.5	60.0	140	----
		Toluene	108-88-3	E611C	97.3 µg/L	100 µg/L	97.3	60.0	140	----
		Trichloroethane, 1,1,1-	71-55-6	E611C	103 µg/L	100 µg/L	103	60.0	140	----
		Trichloroethane, 1,1,2-	79-00-5	E611C	100 µg/L	100 µg/L	100	60.0	140	----
		Trichloroethylene	79-01-6	E611C	96.0 µg/L	100 µg/L	96.0	60.0	140	----
		Trichlorofluoromethane	75-69-4	E611C	99.7 µg/L	100 µg/L	99.7	50.0	150	----
		Vinyl chloride	75-01-4	E611C	83.0 µg/L	100 µg/L	83.0	50.0	150	----
		Xylene, m+p-	179601-23-1	E611C	213 µg/L	200 µg/L	107	60.0	140	----
		Xylene, o-	95-47-6	E611C	102 µg/L	100 µg/L	102	60.0	140	----
Hydrocarbons (QCLot: 1546848)										
VA24B6819-001	Anonymous	VHw (C6-C10)	----	E581.VH+F1	5220 µg/L	6310 µg/L	82.7	60.0	140	----



Chain of Custody (COC) / Analytical Request Form

Affix ALS barcode label here (lab use only)

Canada Toll Free: 1 800 668 9878

www.alsglobal.com

Contact and company name below will appear on the final report

Report To
 Company: Triton Environmental
 Contact: [Redacted]
 Phone: [Redacted]
 Street: [Redacted]
 City/Province: [Redacted]
 Postal Code: [Redacted]

Report Format / Distribution
 Select Report Format: PDF EXCEL EDD (DIGITAL)
 Quality Control (QC) Report with Report YES NO
 Compare Results to Criteria on Report - provide details below if box checked
 Select Distribution: EMAIL MAIL FAX
 Email 1 or Fax: [Redacted]
 Email 2: [Redacted]
 Email 3: [Redacted]

Invoice Distribution
 Select Invoice Distribution: EMAIL MAIL FAX
 Email 1 or Fax: [Redacted]
 Email 2: [Redacted]

Project Information
 A/E/Cost Center: VA23-TRIT100-012
 Major/Minor Code: 11964
 Requisitioner: 11964 - Task 30 - Phase 3C-4C
 Location: LSD:

ALS Lab Work Order # (lab use only): [Redacted]

ALS Sample # (lab use only)
 Sample Identification and/or Coordinates (This description will appear on the report)
 BCR EOP
 pH: [Redacted] cond: [Redacted] temp: [Redacted]
 WLNG EOP
 pH: 6.94 cond: 114 μ S/cm temp: 23.3°C
 Duplicate
 Field Blank
 Trip Blank

ALS Contact: [Redacted] **Sampler:** [Redacted]
 Date: 09-Jul-24 10:30 Time (hh:mm) [Redacted] Sample Type: Water
 Date: 09-Jul-24 10:30 Time (hh:mm) [Redacted] Sample Type: Water
 Date: [Redacted] Time (hh:mm) [Redacted] Sample Type: Water
 Date: [Redacted] Time (hh:mm) [Redacted] Sample Type: Water

Shipping Information
 Special Instructions / Specify Criteria to add (elect):
 Drinking Water (DW) Samples (client use)
 YES NO
 Are samples taken from a Regulated DW System?
 YES NO
 Are samples for human consumption/ use?
 YES NO

SHIPMENT RELEASE (client use)
 Received by: [Redacted] Date: 09 July 24 16:54 Time: [Redacted]
 TITON AND SAMPLING INFORMATION / delay analysis. Please fill in this form LEGIBLY. By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.

SHIPMENT RECEPTION (lab use only)
 Received by: [Redacted] Date: 30/9 Time: [Redacted]

Environmental Division
 Vancouver
 Work Order Reference
VA24B6482

Barcode: [Barcode]

Telephone: -- 1 804 253 4188

Analysis Request
 Indicate Filtered (F), Preserved (P) or Filled and Preserved (F/P) below

Sample's hazardous (please provide further details)	F	P	P	P	P	F/P	General parameters (alkalinity)
Total metals - mercury	R	R	R	R	R	R	R
Dissolved metals + mercury	R	R	R	R	R	R	R
Total hexavalent chromium	R	R	R	R	R	R	R
Total trivalent chromium	R	R	R	R	R	R	R
TSS, TDS, T-Alkalinity, Anions scan (Br, Cl, F)	R	R	R	R	R	R	R
Total sulfide (low) (as H2S), (Unfiltered Sulfide (low))	R	R	R	R	R	R	R
Nutrients (ammonia, ammonium, total nitrogen, total phosphorus, phenols)	R	R	R	R	R	R	R
VOCMPH	R	R	R	R	R	R	R
EPA PAH, LEPA/HEPA	R	R	R	R	R	R	R
DOC	R	R	R	R	R	R	R
Glycols	R	R	R	R	R	R	R

Analysis Request
 Date and Time Required for all E&P TATs:
 or tests that can not be performed according to the service level selected, you will be contacted.

Sample Condition AS RECEIVED (lab use only)
 Frozen SIF Observations Yes No
 Ice Packs Ice Cubes Custody seal intact Yes No
 Cooling Initiated

FINAL SHIPMENT RECEPTION (lab use only)
 Received by: [Redacted] Date: 30/9 Time: [Redacted]

1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.



Chain of Custody (COC) / Analytical Request Form

Canada Toll Free: 1 800 668 9878

Affix ALS barcode label here (lab use only)

www.alsglobal.com

Report To
 Triton Environmental
 Contact: [Redacted]
 Phone: [Redacted]
 Street: [Redacted]
 City/Province: [Redacted]
 Postal Code: [Redacted]

Report Format / Distribution
 Select Report Format: PDF EXCEL EDD (DIGITAL)
 Quality Control (QC) Report with Report YES NO
 Compare Results to Criteria on Report - provide details below if box checked
 Select Distribution: EMAIL MAIL FAX

Invoice Distribution
 Select Invoice Distribution: EMAIL MAIL FAX

Project Information
 ALS Account # / Quote #: VA23-TRIT100-012
 Job #: 11964
 PO / AFE: 11964 - Task 30 - Phase 3C-4C
 LSD:

ALS Lab Work Order # (lab use only):

ALS Sample # (lab use only):

Sample Identification and/or Coordinates (This description will appear on the report)
 BCR EOP
 pH: [Redacted] cond: [Redacted] temp: [Redacted]
 WLNG EOP
 pH: 6.94 cond: 114 µS/cm temp: 23.3°C
 Duplicate
 Field Blank
 Trip Blank

ALS Contact: [Redacted] **Sampler:** [Redacted]

Date: 09-Jul-24 **Time (hh:mm):** 10:30 **Sample Type:** Water

Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below	F	P	P	P	P	P	P	P	P	P	F/P	SAMPLES ON HOLD	Sample is hazardous (please provide further details)	NUMBER OF CONTAINERS
Total metals + mercury	R	R	R	R	R	R	R	R	R	R	R			15
Dissolved metals + mercury	R	R	R	R	R	R	R	R	R	R	R			15
Total hexavalent chromium	R	R	R	R	R	R	R	R	R	R	R			15
Total trivalent chromium	R	R	R	R	R	R	R	R	R	R	R			15
Total inorganic chromium	R	R	R	R	R	R	R	R	R	R	R			15
TSS, TDS, T-Alkalinity, Anions scan (Br, Cl, F)	R	R	R	R	R	R	R	R	R	R	R			15
Total sulfide (low) (as H2S), Unfiltered Sulfide (low)	R	R	R	R	R	R	R	R	R	R	R			15
Nutrients (ammonia, ammonium, total nitrogen, total phosphorus, phenols)	R	R	R	R	R	R	R	R	R	R	R			15
VOC/MPH	R	R	R	R	R	R	R	R	R	R	R			15
EPH, PAH, LEPH/HEPH	R	R	R	R	R	R	R	R	R	R	R			15
DOC	R	R	R	R	R	R	R	R	R	R	R			15
Glycols	R	R	R	R	R	R	R	R	R	R	R			15
General parameters (alkalinity)	R	R	R	R	R	R	R	R	R	R	R			15

Drinking Water (DW) Samples (client use)
 Are samples taken from a Regulated DW System? YES NO
 Are samples for human consumption/ use? YES NO

Special Instructions / Specify Criteria to add (electr)

SHIPMENT RELEASE (client use)
 Received by: [Redacted] Date: 9 July 24 Time: 16:54

INITIAL SHIPMENT RECEPTION (lab use only)
 Received by: [Redacted] Date: 30/9 Time: [Redacted]

FINAL SHIPMENT RECEPTION (lab use only)
 Received by: [Redacted] Date: 30/9 Time: [Redacted]

SAMPLE CONDITION AS RECEIVED (lab use only)
 Frozen Ice Packs Ice Cubes Custody seal intact Yes No
 Cooling Initiated

INITIAL COOLER TEMPERATURES °C: [Redacted]
 FINAL COOLER TEMPERATURES °C: [Redacted]

Telephone: +1 804 253 4186

Environmental Division
Vancouver
 Work Order Reference
VA24B6482

Barcode: [Barcode]

Failure to complete all portions of this form may delay analysis. Please fill in this form LEGIBLY. By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.
 1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix C	C-4

Woodfibre Site WTP Discharge Field Notes and Logs



FortisBC Eagle Mountain-Woodfibre Gas Pipeline

Water Discharge Authorization Water Quality Monitoring

2024-7-9-Chycoski-BCDDA

Project Component:	Tunnel	Site Name:	WLNG Treatment Discharge
Inspection Date:	07/09/2024	Location:	WLNG
Triton QP:	Lily Chycoski	Latitude/Longitude:	49.669351 -123.248439
Temperature(c):	Low 18 High 32	Permit:	PE 110136
Weather Conditions:	Clear	Ground Conditions:	Dry

Observations

Time: 10:38:00 **Flow Volume (visual):** moderate

Notes: Conductivity: 114 micro Siemens per cm

Odour Detected?: No **Notes:**

Unusual Colour?: No **Notes:**

Unusual Observations?: No **Notes:**

Sheen on Water?: No **Notes:**

Samples Collected - Parameters

Total Metals + Mercury	Yes	General Parameters (Alkalinity)	Yes	Other Sample: Total trivalent chromium and total hexavalent chromium
Dissolved Metals + Mercury	Yes	Total Sulfide, Unionized Sulfide	Yes	
TSS	Yes	Anions	Yes	QA Samples: No Total trivalent chromium and total hexavalent chromium
TDS	Yes	VOC/VPH	Yes	
Nutrients	Yes	EPH, PAH, LEPH/HEPH	Yes	
DOC	Yes	Trout LC50	N/A	

Logger Maintenance

Logger Maintenance Performed?	No	Photo of COC with Lab Signature?	Yes
--------------------------------------	----	---	-----

Describe Logger Maintenance

Photos



Photo: 1
Location: WLNG EOP
Description: US view



Photo: 2
Location: WLNG EOP
Description: Across view

Photos



Photo: 3
Location: WLNG EOP
Description: DS view

Photo: 4
Location: WLNG EOP
Description: Lab COC



Sign Off

Report Prepared By: Lily Chycoski

Report Reviewed:

Report Reviewer:

Professional(s) of Record:

Name:

Designation:

Designation Number:



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix D	D-1

Appendix D: Woodfibre Site Receiving Environment Documentation

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix D	D-2

Woodfibre Site Receiving Environment Sample Analysis



**Eagle Mountain - Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 8 th to July 14 th , 2024
Report #	16
Appendix D	D-3

Woodfibre Site Receiving Environment Lab Documentation

CERTIFICATE OF ANALYSIS

<p>Work Order : VA24B6483</p> <p>Client : Triton Environmental Consultants Ltd.</p> <p>Contact : Miranda Lewis</p> <p>Address : Suite 1730, 1111 West Georgia St Vancouver BC Canada V6E 4M3</p> <p>Telephone : 604 631 2213</p> <p>Project : 11964</p> <p>PO : 11964 - Task 20 - Phase 3C-4C</p> <p>C-O-C number : ----</p> <p>Sampler : ----</p> <p>Site : Water Analysis</p> <p>Quote number : VA23-TRIT100-012_V2</p> <p>No. of samples received : 5</p> <p>No. of samples analysed : 5</p>	<p>Page : 1 of 6</p> <p>Laboratory : ALS Environmental - Vancouver</p> <p>Account Manager : Can Dang</p> <p>Address : 8081 Lougheed Highway Burnaby BC Canada V5A 1W9</p> <p>Telephone : +1 604 253 4188</p> <p>Date Samples Received : 09-Jul-2024 17:00</p> <p>Date Analysis Commenced : 11-Jul-2024</p> <p>Issue Date : 17-Jul-2024 15:31</p>
---	--

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Daniel Shabestani	Lab Assistant	Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Metals, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Nik Perkio	Senior Analyst	Inorganics, Waterloo, Ontario
Nik Perkio	Senior Analyst	Metals, Waterloo, Ontario
Owen Cheng		Metals, Burnaby, British Columbia
Paolo Obillo	Account Manager Assistant	Administration, Burnaby, British Columbia
Raymond Lin	Analyst	Metals, Burnaby, British Columbia
Tracy Harley	Supervisor - Water Quality Instrumentation	Inorganics, Burnaby, British Columbia



General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.



Analytical Results

Sub-Matrix: Water				Client sample ID	WLNG US 1	WLNG DS 1	Duplicate	Field Blank	Trip Blank
(Matrix: Water)									
Client sampling date / time				09-Jul-2024 09:37	09-Jul-2024 10:15	09-Jul-2024 09:37	09-Jul-2024 09:24	09-Jul-2024 00:00	
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6483-001	VA24B6483-002	VA24B6483-003	VA24B6483-004	VA24B6483-005
					Result	Result	Result	Result	Result
Field Tests									
Conductivity, field	---	EF001/VA	0.10	µS/cm	23.000	26.000	---	---	---
pH, field	---	EF001/VA	0.10	pH units	6.59	6.67	---	---	---
Temperature, field	---	EF001/VA	0.10	°C	16.2	17.8	---	---	---
Physical Tests									
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	7.20	8.31	7.17	<0.60	---
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	7.89	9.20	7.92	<0.60	<0.60
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	30	38	27	<10	<10
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	<3.0	<3.0	<3.0	<3.0	<3.0
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	7.6	8.4	7.4	<2.0	<2.0
Anions and Nutrients									
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	0.0057	<0.0050	0.0136	<0.0050	<0.0050
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	<0.050	<0.050	<0.050	<0.050
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	0.58	0.59	0.59	<0.50	<0.50
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	<0.020	0.022	<0.020	<0.020	<0.020
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	0.0237	0.0189	0.0231	<0.0050	<0.0050
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	<0.0010	<0.0010	<0.0010	<0.0010
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.112	0.098	0.116	<0.030	<0.030
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.0053	0.0047	0.0053	<0.0020	<0.0020
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	2.10	2.34	2.07	<0.30	<0.30
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	1.77	1.68	1.93	<0.50	---
Total Sulfides									
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	<0.0015	---	---	---
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	<0.0016	<0.0016	<0.0016	<0.0016
Total Metals									
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.0802	0.0601	0.0812	<0.0030	<0.0030
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNG US 1	WLNG DS 1	Duplicate	Field Blank	Trip Blank
(Matrix: Water)					Client sampling date / time	09-Jul-2024 09:37	09-Jul-2024 10:15	09-Jul-2024 09:37	09-Jul-2024 09:24	09-Jul-2024 00:00
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6483-001	VA24B6483-002	VA24B6483-003	VA24B6483-004	VA24B6483-005	
					Result	Result	Result	Result	Result	
Total Metals										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00014	0.00012	0.00011	<0.00010	<0.00010	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.00415	0.00482	0.00414	<0.00010	<0.00010	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	<0.000100	<0.000100	<0.000100	<0.000100	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	<0.010	<0.010	<0.010	<0.010	<0.010	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0000075	0.0000067	0.0000063	<0.0000050	<0.0000050	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	2.72	3.23	2.74	<0.050	<0.050	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	<0.000010	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00058	<0.00050	0.00058	<0.00050	<0.00050	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	0.055	0.051	0.056	<0.010	<0.010	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	<0.0010	<0.0010	<0.0010	<0.0010	<0.0010	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	0.266	0.276	0.261	<0.0050	<0.0050	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.00208	0.00252	0.00206	<0.00010	<0.00010	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	<0.0000050	<0.0000050	<0.0000050	<0.0000050	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.000432	0.000913	0.000445	<0.000050	<0.000050	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	<0.050	<0.050	<0.050	<0.050	<0.050	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	0.180	0.184	0.181	<0.050	<0.050	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00040	0.00043	0.00042	<0.00020	<0.00020	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	4.81	4.95	4.78	<0.10	<0.10	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	<0.000010	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	1.64	1.76	1.65	<0.050	<0.050	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0147	0.0140	0.0145	<0.00020	<0.00020	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	0.62	0.57	0.50	<0.50	<0.50	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	<0.000010	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	



Analytical Results

Sub-Matrix: Water					Client sample ID	WLNG US 1	WLNG DS 1	Duplicate	Field Blank	Trip Blank
(Matrix: Water)					Client sampling date / time	09-Jul-2024 09:37	09-Jul-2024 10:15	09-Jul-2024 09:37	09-Jul-2024 09:24	09-Jul-2024 00:00
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6483-001	VA24B6483-002	VA24B6483-003	VA24B6483-004	VA24B6483-005	
					Result	Result	Result	Result	Result	
Total Metals										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.00091	0.00062	0.00093	<0.00030	<0.00030	<0.00030
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.000075	0.000094	0.000073	<0.000010	<0.000010	<0.000010
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030	<0.0030
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020
Dissolved Metals										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0499	0.0449	0.0504	<0.0010	----	----
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	----
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00011	0.00012	0.00011	<0.00010	<0.00010	----
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00417	0.00508	0.00406	<0.00010	<0.00010	----
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	<0.000100	<0.000100	<0.000100	<0.000100	----
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	----
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	<0.010	<0.010	<0.010	<0.010	<0.010	----
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000064	0.0000060	0.0000077	<0.0000050	<0.0000050	----
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	2.44	2.86	2.43	<0.050	<0.050	----
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	<0.000010	----
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	----
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	<0.00010	----
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00057	0.00044	0.00057	<0.00020	<0.00020	----
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.033	0.032	0.033	<0.010	<0.010	----
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	<0.000050	----
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	<0.0010	<0.0010	<0.0010	<0.0010	<0.0010	----
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	0.269	0.284	0.267	<0.0050	<0.0050	----
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00156	0.00241	0.00158	<0.00010	<0.00010	----
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	<0.0000050	<0.0000050	<0.0000050	<0.0000050	----
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.000417	0.000904	0.000417	<0.000050	<0.000050	----
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	<0.050	<0.050	<0.050	<0.050	----
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	0.201	0.196	0.189	<0.050	<0.050	----



Analytical Results

Sub-Matrix: Water (Matrix: Water)					Client sample ID	WLNG US 1	WLNG DS 1	Duplicate	Field Blank	Trip Blank
Client sampling date / time					09-Jul-2024 09:37	09-Jul-2024 10:15	09-Jul-2024 09:37	09-Jul-2024 09:24	09-Jul-2024 00:00	
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B6483-001	VA24B6483-002	VA24B6483-003	VA24B6483-004	VA24B6483-005	
					Result	Result	Result	Result	Result	
Dissolved Metals										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00049	0.00042	0.00046	<0.00020	----	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	<0.000050	<0.000050	<0.000050	<0.000050	----	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	4.87	5.01	4.76	<0.050	----	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	----	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	1.75	1.84	1.76	<0.050	----	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0144	0.0149	0.0142	<0.00020	----	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	0.56	0.60	0.61	<0.50	----	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	----	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	<0.000010	<0.000010	<0.000010	----	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	0.00030	<0.00030	<0.00030	<0.00030	----	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	<0.00010	<0.00010	<0.00010	----	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.000065	0.000090	0.000066	<0.000010	----	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	----	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0015	0.0019	0.0013	<0.0010	----	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	----	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	Field	Field	Field	----	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	Field	Field	Field	----	
Speciated Metals										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/WT	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	
Chromium, trivalent [Cr III], total	16065-83-1	EC535/WT	0.00050	mg/L	<0.00050	<0.00050	<0.00050	<0.00050	<0.00050	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

QUALITY CONTROL INTERPRETIVE REPORT

<p>Work Order : VA24B6483</p> <p>Client : Triton Environmental Consultants Ltd.</p> <p>Contact : Miranda Lewis</p> <p>Address : Suite 1730, 1111 West Georgia St Vancouver BC Canada V6E 4M3</p> <p>Telephone : 604 631 2213</p> <p>Project : 11964</p> <p>PO : 11964 - Task 20 - Phase 3C-4C</p> <p>C-O-C number : ----</p> <p>Sampler : ----</p> <p>Site : Water Analysis</p> <p>Quote number : VA23-TRIT100-012_V2</p> <p>No. of samples received : 5</p> <p>No. of samples analysed : 5</p>	<p>Page : 1 of 20</p> <p>Laboratory : ALS Environmental - Vancouver</p> <p>Account Manager : Can Dang</p> <p>Address : 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9</p> <p>Telephone : +1 604 253 4188</p> <p>Date Samples Received : 09-Jul-2024 17:00</p> <p>Issue Date : 17-Jul-2024 15:32</p>
--	--

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- No Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.



Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) Duplicate	E298	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	15-Jul-2024	28 days	6 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) Field Blank	E298	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	15-Jul-2024	28 days	6 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) WLNG DS 1	E298	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	15-Jul-2024	28 days	6 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (sulfuric acid) WLNG US 1	E298	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	15-Jul-2024	28 days	6 days	✔	
Anions and Nutrients : Ammonia by Fluorescence											
Amber glass total (lab preserved) Trip Blank	E298	09-Jul-2024	12-Jul-2024	3 days	3 days	✔	15-Jul-2024	28 days	4 days	✔	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE Duplicate	E235.Br-L	09-Jul-2024	11-Jul-2024	28 days	2 days	✔	11-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Bromide in Water by IC (Low Level)											
HDPE WLNG DS 1	E235.Br-L	09-Jul-2024	11-Jul-2024	28 days	2 days	✔	11-Jul-2024	28 days	2 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Anions and Nutrients : Bromide in Water by IC (Low Level)										
HDPE WLNG US 1	E235.Br-L	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Bromide in Water by IC (Low Level)										
HDPE Field Blank	E235.Br-L	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Bromide in Water by IC (Low Level)										
HDPE Trip Blank	E235.Br-L	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Chloride in Water by IC										
HDPE Duplicate	E235.Cl	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Chloride in Water by IC										
HDPE WLNG DS 1	E235.Cl	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Chloride in Water by IC										
HDPE WLNG US 1	E235.Cl	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Chloride in Water by IC										
HDPE Field Blank	E235.Cl	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Chloride in Water by IC										
HDPE Trip Blank	E235.Cl	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Fluoride in Water by IC										
HDPE Duplicate	E235.F	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Anions and Nutrients : Fluoride in Water by IC										
HDPE WLNG DS 1	E235.F	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Fluoride in Water by IC										
HDPE WLNG US 1	E235.F	09-Jul-2024	11-Jul-2024	28 days	2 days	✓	11-Jul-2024	28 days	2 days	✓
Anions and Nutrients : Fluoride in Water by IC										
HDPE Field Blank	E235.F	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Fluoride in Water by IC										
HDPE Trip Blank	E235.F	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Nitrate in Water by IC (Low Level)										
HDPE Duplicate	E235.NO3-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✓	11-Jul-2024	3 days	2 days	✓
Anions and Nutrients : Nitrate in Water by IC (Low Level)										
HDPE WLNG DS 1	E235.NO3-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✓	11-Jul-2024	3 days	2 days	✓
Anions and Nutrients : Nitrate in Water by IC (Low Level)										
HDPE WLNG US 1	E235.NO3-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✓	11-Jul-2024	3 days	2 days	✓
Anions and Nutrients : Nitrate in Water by IC (Low Level)										
HDPE Field Blank	E235.NO3-L	09-Jul-2024	11-Jul-2024	3 days	3 days	✓	11-Jul-2024	3 days	3 days	✓
Anions and Nutrients : Nitrate in Water by IC (Low Level)										
HDPE Trip Blank	E235.NO3-L	09-Jul-2024	11-Jul-2024	3 days	3 days	✓	11-Jul-2024	3 days	3 days	✓



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Duplicate	E235.NO2-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✔	11-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE WLNG DS 1	E235.NO2-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✔	11-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE WLNG US 1	E235.NO2-L	09-Jul-2024	11-Jul-2024	3 days	2 days	✔	11-Jul-2024	3 days	2 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Field Blank	E235.NO2-L	09-Jul-2024	11-Jul-2024	3 days	3 days	✔	11-Jul-2024	3 days	3 days	✔	
Anions and Nutrients : Nitrite in Water by IC (Low Level)											
HDPE Trip Blank	E235.NO2-L	09-Jul-2024	11-Jul-2024	3 days	3 days	✔	11-Jul-2024	3 days	3 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE Duplicate	E235.SO4	09-Jul-2024	11-Jul-2024	28 days	2 days	✔	11-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE WLNG DS 1	E235.SO4	09-Jul-2024	11-Jul-2024	28 days	2 days	✔	11-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE WLNG US 1	E235.SO4	09-Jul-2024	11-Jul-2024	28 days	2 days	✔	11-Jul-2024	28 days	2 days	✔	
Anions and Nutrients : Sulfate in Water by IC											
HDPE Field Blank	E235.SO4	09-Jul-2024	11-Jul-2024	28 days	3 days	✔	11-Jul-2024	28 days	3 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Anions and Nutrients : Sulfate in Water by IC										
HDPE Trip Blank	E235.SO4	09-Jul-2024	11-Jul-2024	28 days	3 days	✓	11-Jul-2024	28 days	3 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (sulfuric acid) Duplicate	E366	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (sulfuric acid) Field Blank	E366	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (sulfuric acid) WLNG DS 1	E366	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (sulfuric acid) WLNG US 1	E366	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Nitrogen by Colourimetry										
Amber glass total (lab preserved) Trip Blank	E366	09-Jul-2024	12-Jul-2024	3 days	3 days	✓	16-Jul-2024	28 days	5 days	✓
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) Duplicate	E372-U	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) Field Blank	E372-U	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)										
Amber glass total (sulfuric acid) WLNG DS 1	E372-U	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)											
Amber glass total (sulfuric acid) WLNG US 1	E372-U	09-Jul-2024	12-Jul-2024	28 days	3 days	✓	16-Jul-2024	28 days	7 days	✓	
Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)											
Amber glass total (lab preserved) Trip Blank	E372-U	09-Jul-2024	12-Jul-2024	3 days	3 days	✓	16-Jul-2024	28 days	5 days	✓	
Dissolved Metals : Dissolved Mercury in Water by CVAAS											
Glass vial - dissolved (lab preserved) Duplicate	E509	09-Jul-2024	15-Jul-2024	28 days	6 days	✓	15-Jul-2024	28 days	6 days	✓	
Dissolved Metals : Dissolved Mercury in Water by CVAAS											
Glass vial - dissolved (lab preserved) Field Blank	E509	09-Jul-2024	15-Jul-2024	28 days	6 days	✓	15-Jul-2024	28 days	6 days	✓	
Dissolved Metals : Dissolved Mercury in Water by CVAAS											
Glass vial - dissolved (lab preserved) WLNG DS 1	E509	09-Jul-2024	15-Jul-2024	28 days	6 days	✓	15-Jul-2024	28 days	6 days	✓	
Dissolved Metals : Dissolved Mercury in Water by CVAAS											
Glass vial - dissolved (lab preserved) WLNG US 1	E509	09-Jul-2024	15-Jul-2024	28 days	6 days	✓	15-Jul-2024	28 days	6 days	✓	
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS											
HDPE - dissolved (lab preserved) Duplicate	E421	09-Jul-2024	13-Jul-2024	180 days	4 days	✓	15-Jul-2024	180 days	6 days	✓	
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS											
HDPE - dissolved (lab preserved) Field Blank	E421	09-Jul-2024	13-Jul-2024	180 days	4 days	✓	15-Jul-2024	180 days	6 days	✓	
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS											
HDPE - dissolved (lab preserved) WLNG DS 1	E421	09-Jul-2024	13-Jul-2024	180 days	4 days	✓	15-Jul-2024	180 days	6 days	✓	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Dissolved Metals : Dissolved Metals in Water by CRC ICPMS											
HDPE - dissolved (lab preserved) WLNG US 1	E421	09-Jul-2024	13-Jul-2024	180 days	4 days	✔	15-Jul-2024	180 days	6 days	✔	
Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine											
Glass vial - total (lab preserved) WLNG DS 1	EF001	09-Jul-2024	----	----	----		11-Jul-2024	----	2 days		
Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine											
Glass vial - total (lab preserved) WLNG US 1	EF001	09-Jul-2024	----	----	----		11-Jul-2024	----	2 days		
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) Duplicate	E358-L	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	12-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) Field Blank	E358-L	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	12-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) WLNG DS 1	E358-L	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	12-Jul-2024	28 days	3 days	✔	
Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)											
Amber glass dissolved (sulfuric acid) WLNG US 1	E358-L	09-Jul-2024	12-Jul-2024	28 days	3 days	✔	12-Jul-2024	28 days	3 days	✔	
Physical Tests : Alkalinity Species by Titration											
HDPE Duplicate	E290	09-Jul-2024	11-Jul-2024	14 days	2 days	✔	13-Jul-2024	14 days	4 days	✔	
Physical Tests : Alkalinity Species by Titration											
HDPE WLNG DS 1	E290	09-Jul-2024	11-Jul-2024	14 days	2 days	✔	13-Jul-2024	14 days	4 days	✔	



Matrix: **Water** Evaluation: * = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Physical Tests : Alkalinity Species by Titration										
HDPE WLNG US 1	E290	09-Jul-2024	11-Jul-2024	14 days	2 days	✓	13-Jul-2024	14 days	4 days	✓
Physical Tests : Alkalinity Species by Titration										
HDPE Field Blank	E290	09-Jul-2024	11-Jul-2024	14 days	3 days	✓	16-Jul-2024	14 days	7 days	✓
Physical Tests : Alkalinity Species by Titration										
HDPE Trip Blank	E290	09-Jul-2024	11-Jul-2024	14 days	3 days	✓	16-Jul-2024	14 days	7 days	✓
Physical Tests : TDS by Gravimetry										
HDPE Duplicate	E162	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓
Physical Tests : TDS by Gravimetry										
HDPE Field Blank	E162	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓
Physical Tests : TDS by Gravimetry										
HDPE Trip Blank	E162	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓
Physical Tests : TDS by Gravimetry										
HDPE WLNG DS 1	E162	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓
Physical Tests : TDS by Gravimetry										
HDPE WLNG US 1	E162	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓
Physical Tests : TSS by Gravimetry										
HDPE Duplicate	E160	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✓



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Physical Tests : TSS by Gravimetry										
HDPE Field Blank	E160	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔
Physical Tests : TSS by Gravimetry										
HDPE Trip Blank	E160	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔
Physical Tests : TSS by Gravimetry										
HDPE WLNG DS 1	E160	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔
Physical Tests : TSS by Gravimetry										
HDPE WLNG US 1	E160	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Duplicate	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✔
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Field Blank	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✔
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) Trip Blank	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✔
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) WLNG DS 1	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✔
Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC										
UV-inhibited HDPE - total (sodium hydroxide) WLNG US 1	E532	09-Jul-2024	----	----	----		11-Jul-2024	28 days	2 days	✔



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) Duplicate	E508	09-Jul-2024	15-Jul-2024	28 days	6 days	✔	15-Jul-2024	28 days	6 days	✔
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) Field Blank	E508	09-Jul-2024	15-Jul-2024	28 days	6 days	✔	15-Jul-2024	28 days	6 days	✔
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) WLNG DS 1	E508	09-Jul-2024	15-Jul-2024	28 days	6 days	✔	15-Jul-2024	28 days	6 days	✔
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) WLNG US 1	E508	09-Jul-2024	15-Jul-2024	28 days	6 days	✔	15-Jul-2024	28 days	6 days	✔
Total Metals : Total Mercury in Water by CVAAS										
Glass vial - total (lab preserved) Trip Blank	E508	09-Jul-2024	15-Jul-2024	28 days	7 days	✔	15-Jul-2024	28 days	7 days	✔
Total Metals : Total Metals in Water by CRC ICPMS										
HDPE - total (lab preserved) Duplicate	E420	09-Jul-2024	11-Jul-2024	180 days	2 days	✔	12-Jul-2024	180 days	3 days	✔
Total Metals : Total Metals in Water by CRC ICPMS										
HDPE - total (lab preserved) Field Blank	E420	09-Jul-2024	11-Jul-2024	180 days	2 days	✔	12-Jul-2024	180 days	3 days	✔
Total Metals : Total Metals in Water by CRC ICPMS										
HDPE - total (lab preserved) WLNG DS 1	E420	09-Jul-2024	11-Jul-2024	180 days	2 days	✔	12-Jul-2024	180 days	3 days	✔
Total Metals : Total Metals in Water by CRC ICPMS										
HDPE - total (lab preserved) WLNG US 1	E420	09-Jul-2024	11-Jul-2024	180 days	2 days	✔	12-Jul-2024	180 days	3 days	✔



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
Total Metals : Total Metals in Water by CRC ICPMS											
HDPE - total (lab preserved) Trip Blank	E420	09-Jul-2024	11-Jul-2024	180 days	3 days	✔	12-Jul-2024	180 days	3 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Duplicate	E395	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Field Blank	E395	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) WLNG DS 1	E395	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) WLNG US 1	E395	09-Jul-2024	----	----	----		15-Jul-2024	7 days	6 days	✔	
Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)											
HDPE total (zinc acetate+sodium hydroxide) Trip Blank	E395	09-Jul-2024	----	----	----		15-Jul-2024	7 days	7 days	✔	

Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Duplicates (DUP)							
Alkalinity Species by Titration	E290	1540335	2	32	6.2	5.0	✔
Ammonia by Fluorescence	E298	1540817	1	15	6.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1540342	2	20	10.0	5.0	✔
Chloride in Water by IC	E235.Cl	1540338	2	38	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1545892	2	40	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1539533	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1540815	1	12	8.3	5.0	✔
Fluoride in Water by IC	E235.F	1540341	2	21	9.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1540339	2	25	8.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1540340	2	25	8.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1540337	2	38	5.2	5.0	✔
TDS by Gravimetry	E162	1545239	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1545993	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538116	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1540818	1	10	10.0	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1540812	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1545790	1	11	9.0	5.0	✔
TSS by Gravimetry	E160	1545229	1	20	5.0	5.0	✔
Laboratory Control Samples (LCS)							
Alkalinity Species by Titration	E290	1540335	2	32	6.2	5.0	✔
Ammonia by Fluorescence	E298	1540817	1	15	6.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1540342	2	20	10.0	5.0	✔
Chloride in Water by IC	E235.Cl	1540338	2	38	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1545892	2	40	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1539533	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1540815	1	12	8.3	5.0	✔
Fluoride in Water by IC	E235.F	1540341	2	21	9.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1540339	2	25	8.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1540340	2	25	8.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1540337	2	38	5.2	5.0	✔
TDS by Gravimetry	E162	1545239	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1545993	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538116	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1540818	1	10	10.0	5.0	✔



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
Analytical Methods							
Laboratory Control Samples (LCS) - Continued							
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1540812	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1545790	1	11	9.0	5.0	✔
TSS by Gravimetry	E160	1545229	1	20	5.0	5.0	✔
Method Blanks (MB)							
Alkalinity Species by Titration	E290	1540335	2	32	6.2	5.0	✔
Ammonia by Fluorescence	E298	1540817	1	15	6.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1540342	2	20	10.0	5.0	✔
Chloride in Water by IC	E235.Cl	1540338	2	38	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1545892	2	40	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1539533	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1540815	1	12	8.3	5.0	✔
Fluoride in Water by IC	E235.F	1540341	2	21	9.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1540339	2	25	8.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1540340	2	25	8.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1540337	2	38	5.2	5.0	✔
TDS by Gravimetry	E162	1545239	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1545993	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538116	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1540818	1	10	10.0	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1540812	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1545790	1	11	9.0	5.0	✔
TSS by Gravimetry	E160	1545229	1	20	5.0	5.0	✔
Matrix Spikes (MS)							
Ammonia by Fluorescence	E298	1540817	1	15	6.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1540342	2	20	10.0	5.0	✔
Chloride in Water by IC	E235.Cl	1540338	2	38	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1545892	2	40	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1539533	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1540815	1	12	8.3	5.0	✔
Fluoride in Water by IC	E235.F	1540341	2	21	9.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1540339	2	25	8.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1540340	2	25	8.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1540337	2	38	5.2	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1539725	1	16	6.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1545993	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1538116	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1540818	1	10	10.0	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1540812	1	20	5.0	5.0	✔



Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
Matrix Spikes (MS) - Continued							
Total Sulfide by Colourimetry (Automated Flow)	E395	1545790	1	11	9.0	5.0	✔



Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$, with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO ₂ . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H ₂ S" if reported represent the maximum possible H ₂ S concentration based on the total sulfide concentration in the sample. The H ₂ S calculation converts Total Sulphide as (S ₂ ⁻) and reports it as Total Sulphide as (H ₂ S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS. Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Waterloo	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection. Results are based on an un-filtered, field-preserved sample.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO ₃), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO ₃ equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Waterloo	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl ₂ ,ClO ₂ ,ORP,DO, Turbidity,T,T-P,o-PO ₄ ,NH ₃ or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.

Page : 20 of 20
Work Order : VA24B6483
Client : Triton Environmental Consultants Ltd.
Project : 11964



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.

QUALITY CONTROL REPORT

<p>Work Order : VA24B6483</p> <p>Client : Triton Environmental Consultants Ltd.</p> <p>Contact : Miranda Lewis</p> <p>Address : Suite 1730, 1111 West Georgia St Vancouver BC Canada V6E 4M3</p> <p>Telephone : 604 631 2213</p> <p>Project : 11964</p> <p>PO : 11964 - Task 20 - Phase 3C-4C</p> <p>C-O-C number : ----</p> <p>Sampler : ----</p> <p>Site : Water Analysis</p> <p>Quote number : VA23-TRIT100-012_V2</p> <p>No. of samples received : 5</p> <p>No. of samples analysed : 5</p>	<p>Page : 1 of 18</p> <p>Laboratory : ALS Environmental - Vancouver</p> <p>Account Manager : Can Dang</p> <p>Address : 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9</p> <p>Telephone : +1 604 253 4188</p> <p>Date Samples Received : 09-Jul-2024 17:00</p> <p>Date Analysis Commenced : 11-Jul-2024</p> <p>Issue Date : 17-Jul-2024 15:32</p>
---	--

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Daniel Shabestani	Lab Assistant	Vancouver Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Vancouver Metals, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Vancouver Inorganics, Burnaby, British Columbia
Nik Perkio	Senior Analyst	Waterloo Inorganics, Waterloo, Ontario
Nik Perkio	Senior Analyst	Waterloo Metals, Waterloo, Ontario
Owen Cheng		Vancouver Metals, Burnaby, British Columbia
Paolo Obillo	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
Raymond Lin	Analyst	Vancouver Metals, Burnaby, British Columbia
Tracy Harley	Supervisor - Water Quality Instrumentation	Vancouver Inorganics, Burnaby, British Columbia

Page : 2 of 18
Work Order : VA24B6483
Client : Triton Environmental Consultants Ltd.
Project : 11964



General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

= Indicates a QC result that did not meet the ALS DQO.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.



Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Physical Tests (QC Lot: 1540335)											
VA24B6254-001	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	180	180	0.334%	20%	----
Physical Tests (QC Lot: 1540675)											
VA24B6571-029	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	138	140	1.16%	20%	----
Physical Tests (QC Lot: 1545229)											
FJ2402009-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	3.1	3.3	0.2	Diff <2x LOR	----
Physical Tests (QC Lot: 1545239)											
FJ2402009-001	Anonymous	Solids, total dissolved [TDS]	----	E162	20	mg/L	1290	1270	1.99%	20%	----
Anions and Nutrients (QC Lot: 1540337)											
VA24B6254-001	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	0.30	mg/L	47.8	48.5	1.46%	20%	----
Anions and Nutrients (QC Lot: 1540338)											
VA24B6254-001	Anonymous	Chloride	16887-00-6	E235.Cl	0.50	mg/L	0.68	0.67	0.007	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540339)											
VA24B6254-001	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0050	mg/L	0.179	0.182	1.39%	20%	----
Anions and Nutrients (QC Lot: 1540340)											
VA24B6254-001	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540341)											
VA24B6254-001	Anonymous	Fluoride	16984-48-8	E235.F	0.020	mg/L	0.079	0.076	0.003	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540342)											
VA24B6254-001	Anonymous	Bromide	24959-67-9	E235.Br-L	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540677)											
VA24B6483-004	Field Blank	Fluoride	16984-48-8	E235.F	0.020	mg/L	<0.020	<0.020	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540678)											
VA24B6483-004	Field Blank	Chloride	16887-00-6	E235.Cl	0.50	mg/L	<0.50	<0.50	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540679)											
VA24B6483-004	Field Blank	Bromide	24959-67-9	E235.Br-L	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540680)											
VA24B6483-004	Field Blank	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540681)											
VA24B6483-004	Field Blank	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540682)											



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Anions and Nutrients (QC Lot: 1540682) - continued											
VA24B6483-004	Field Blank	Sulfate (as SO4)	14808-79-8	E235.S04	0.30	mg/L	<0.30	<0.30	0	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540812)											
VA24B6483-001	WLNG US 1	Phosphorus, total	7723-14-0	E372-U	0.0020	mg/L	0.0053	0.0053	0.00003	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540817)											
VA24B6483-001	WLNG US 1	Ammonia, total (as N)	7664-41-7	E298	0.0050	mg/L	0.0057	<0.0050	0.0007	Diff <2x LOR	----
Anions and Nutrients (QC Lot: 1540818)											
VA24B6483-001	WLNG US 1	Nitrogen, total	7727-37-9	E366	0.030	mg/L	0.112	0.110	0.002	Diff <2x LOR	----
Organic / Inorganic Carbon (QC Lot: 1540815)											
VA24B6483-001	WLNG US 1	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	1.77	1.96	0.19	Diff <2x LOR	----
Total Sulfides (QC Lot: 1545790)											
CG2409472-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	<0.0015	0	Diff <2x LOR	----
Total Metals (QC Lot: 1538116)											
VA24B6252-021	Anonymous	Aluminum, total	7429-90-5	E420	0.0030	mg/L	0.0488	0.0442	9.79%	20%	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	0.00013	0.00013	0.000002	Diff <2x LOR	----
		Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00192	0.00194	1.53%	20%	----
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.0727	0.0722	0.586%	20%	----
		Beryllium, total	7440-41-7	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	0.0000165	0.0000186	0.0000021	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.050	mg/L	13.9	14.0	0.673%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	0.000033	0.000034	0.000001	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	0.00038	0.00039	0.000009	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00050	mg/L	0.00162	0.00161	0.000005	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.010	mg/L	1.74	1.76	1.20%	20%	----
		Lead, total	7439-92-1	E420	0.000050	mg/L	0.000051	0.000052	0.000001	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.0012	0.0012	0.00006	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	4.43	4.49	1.46%	20%	----
		Manganese, total	7439-96-5	E420	0.00010	mg/L	0.141	0.142	0.870%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.000299	0.000301	0.000002	Diff <2x LOR	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	0.00146	0.00144	0.00002	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.050	mg/L	0.850	0.855	0.609%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Total Metals (QC Lot: 1538116) - continued											
VA24B6252-021	Anonymous	Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00084	0.00083	0.00001	Diff <2x LOR	----
		Selenium, total	7782-49-2	E420	0.000050	mg/L	0.000080	0.000108	0.000028	Diff <2x LOR	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	8.47	7.96	6.15%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, total	7440-23-5	E420	0.050	mg/L	2.53	2.55	0.944%	20%	----
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.0786	0.0771	1.91%	20%	----
		Sulfur, total	7704-34-9	E420	0.50	mg/L	2.10	1.72	0.39	Diff <2x LOR	----
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, total	7440-32-6	E420	0.00030	mg/L	0.00078	0.00081	0.00002	Diff <2x LOR	----
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.000164	0.000162	0.845%	20%	----
		Vanadium, total	7440-62-2	E420	0.00050	mg/L	0.00097	0.00099	0.00002	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0030	mg/L	<0.0030	<0.0030	0	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
Total Metals (QC Lot: 1545993)											
FJ2401978-001	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1539533)											
FJ2401974-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0020	mg/L	0.0170	0.0163	0.0006	Diff <2x LOR	----
		Antimony, dissolved	7440-36-0	E421	0.00020	mg/L	0.00068	0.00070	0.00001	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00020	mg/L	0.00022	0.00024	0.00002	Diff <2x LOR	----
		Barium, dissolved	7440-39-3	E421	0.00020	mg/L	0.0189	0.0188	0.698%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000040	mg/L	<0.000040	<0.000040	0	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.020	mg/L	<0.020	<0.020	0	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000100	mg/L	0.000414	0.000402	3.07%	20%	----
		Calcium, dissolved	7440-70-2	E421	0.100	mg/L	292	267	9.02%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000020	mg/L	0.000023	0.000025	0.000002	Diff <2x LOR	----
		Chromium, dissolved	7440-47-3	E421	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00020	mg/L	0.00036	0.00037	0.0000004	Diff <2x LOR	----
		Copper, dissolved	7440-50-8	E421	0.00040	mg/L	0.00082	0.00080	0.00002	Diff <2x LOR	----
		Iron, dissolved	7439-89-6	E421	0.020	mg/L	<0.020	<0.020	0	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
Dissolved Metals (QC Lot: 1539533) - continued											
FJ2401974-001	Anonymous	Lead, dissolved	7439-92-1	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Lithium, dissolved	7439-93-2	E421	0.0020	mg/L	0.0302	0.0268	11.8%	20%	----
		Magnesium, dissolved	7439-95-4	E421	0.0100	mg/L	217	214	1.42%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00020	mg/L	0.00760	0.00737	3.14%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000100	mg/L	0.00339	0.00346	1.82%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.00100	mg/L	0.0224	0.0223	0.582%	20%	----
		Phosphorus, dissolved	7723-14-0	E421	0.100	mg/L	<0.100	<0.100	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.100	mg/L	3.48	3.39	2.69%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00040	mg/L	0.00302	0.00291	0.00011	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000100	mg/L	0.107	0.117	9.07%	20%	----
		Silicon, dissolved	7440-21-3	E421	0.100	mg/L	1.01	1.07	5.82%	20%	----
		Silver, dissolved	7440-22-4	E421	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.100	mg/L	2.96	2.94	0.648%	20%	----
		Strontium, dissolved	7440-24-6	E421	0.00040	mg/L	0.215	0.214	0.270%	20%	----
		Sulfur, dissolved	7704-34-9	E421	1.00	mg/L	441	474	7.19%	20%	----
		Tellurium, dissolved	13494-80-9	E421	0.00040	mg/L	<0.00040	<0.00040	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00060	mg/L	<0.00060	<0.00060	0	Diff <2x LOR	----
		Tungsten, dissolved	7440-33-7	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000020	mg/L	0.0125	0.0125	0.673%	20%	----
		Vanadium, dissolved	7440-62-2	E421	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	----
		Zinc, dissolved	7440-66-6	E421	0.0020	mg/L	0.0234	0.0243	3.95%	20%	----
		Zirconium, dissolved	7440-67-7	E421	0.00040	mg/L	<0.00040	<0.00040	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1545892)											
VA24B6434-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Dissolved Metals (QC Lot: 1545893)											
VA24B6483-003	Duplicate	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
Speciated Metals (QC Lot: 1539725)											
VA24B6482-001	Anonymous	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----



Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Water

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Physical Tests (QCLot: 1540335)						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
Physical Tests (QCLot: 1540675)						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
Physical Tests (QCLot: 1545229)						
Solids, total suspended [TSS]	----	E160	3	mg/L	<3.0	----
Physical Tests (QCLot: 1545239)						
Solids, total dissolved [TDS]	----	E162	10	mg/L	<10	----
Anions and Nutrients (QCLot: 1540337)						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----
Anions and Nutrients (QCLot: 1540338)						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
Anions and Nutrients (QCLot: 1540339)						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
Anions and Nutrients (QCLot: 1540340)						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
Anions and Nutrients (QCLot: 1540341)						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
Anions and Nutrients (QCLot: 1540342)						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
Anions and Nutrients (QCLot: 1540677)						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
Anions and Nutrients (QCLot: 1540678)						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
Anions and Nutrients (QCLot: 1540679)						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
Anions and Nutrients (QCLot: 1540680)						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
Anions and Nutrients (QCLot: 1540681)						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
Anions and Nutrients (QCLot: 1540682)						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Anions and Nutrients (QCLot: 1540812)						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	---
Anions and Nutrients (QCLot: 1540817)						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	---
Anions and Nutrients (QCLot: 1540818)						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	---
Organic / Inorganic Carbon (QCLot: 1540815)						
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	<0.50	---
Total Sulfides (QCLot: 1545790)						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	---
Total Metals (QCLot: 1538116)						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	---
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	---
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	---
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	---
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	---
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	---
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	---
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	---
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	---
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	---



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Total Metals (QCLot: 1538116) - continued						
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----
Total Metals (QCLot: 1545993)						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
Dissolved Metals (QCLot: 1539533)						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
Dissolved Metals (QCLot: 1539533) - continued						
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
Dissolved Metals (QCLot: 1545892)						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
Dissolved Metals (QCLot: 1545893)						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
Speciated Metals (QCLot: 1539725)						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----



Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Physical Tests (QCLot: 1540335)									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	106	85.0	115	----
Physical Tests (QCLot: 1540675)									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	107	85.0	115	----
Physical Tests (QCLot: 1545229)									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	89.5	85.0	115	----
Physical Tests (QCLot: 1545239)									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	99.9	85.0	115	----
Anions and Nutrients (QCLot: 1540337)									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	102	90.0	110	----
Anions and Nutrients (QCLot: 1540338)									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	98.1	90.0	110	----
Anions and Nutrients (QCLot: 1540339)									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	100.0	90.0	110	----
Anions and Nutrients (QCLot: 1540340)									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	103	90.0	110	----
Anions and Nutrients (QCLot: 1540341)									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	97.9	90.0	110	----
Anions and Nutrients (QCLot: 1540342)									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	97.9	85.0	115	----
Anions and Nutrients (QCLot: 1540677)									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	101	90.0	110	----
Anions and Nutrients (QCLot: 1540678)									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	99.8	90.0	110	----
Anions and Nutrients (QCLot: 1540679)									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	99.0	85.0	115	----
Anions and Nutrients (QCLot: 1540680)									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	99.7	90.0	110	----
Anions and Nutrients (QCLot: 1540681)									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	100	90.0	110	----
Anions and Nutrients (QCLot: 1540682)									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	100	90.0	110	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Anions and Nutrients (QCLot: 1540812)									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	0.05 mg/L	97.9	80.0	120	----
Anions and Nutrients (QCLot: 1540817)									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	106	85.0	115	----
Anions and Nutrients (QCLot: 1540818)									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	116	75.0	125	----
Organic / Inorganic Carbon (QCLot: 1540815)									
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	8.57 mg/L	109	80.0	120	----
Total Sulfides (QCLot: 1545790)									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	101	80.0	120	----
Total Metals (QCLot: 1538116)									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	100.0	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	100	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	108	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	99.7	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	111	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	106	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	117	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	103	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	110	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	101	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	104	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	102	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	100	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	103	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	110	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	103	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	103	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	102	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	102	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	112	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	101	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	102	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Total Metals (QCLot: 1538116) - continued									
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	107	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	111	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	94.6	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	109	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	99.8	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	98.6	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	97.6	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	102	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	101	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	99.9	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	101	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	101	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	105	80.0	120	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	104	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	102	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	96.7	80.0	120	----
Total Metals (QCLot: 1545993)									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	98.6	80.0	120	----
Dissolved Metals (QCLot: 1539533)									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	105	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	99.1	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	108	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	102	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	101	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	99.0	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	100	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	107	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	96.6	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	97.9	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	102	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	101	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	91.9	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	95.1	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	99.4	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
Dissolved Metals (QCLot: 1539533) - continued									
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	106	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	103	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	100	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	101	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	105	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	98.9	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	100	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	98.6	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	106	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	92.2	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	103	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	99.7	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	94.9	80.0	120	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	95.7	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	96.3	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	94.2	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	98.2	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	100	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	97.4	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	94.9	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	103	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	102	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	95.7	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	101	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	101	80.0	120	----
Speciated Metals (QCLot: 1539725)									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.025 mg/L	102	80.0	120	----



Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Anions and Nutrients (QCLot: 1540337)										
VA24B6483-001	WLNG US 1	Sulfate (as SO4)	14808-79-8	E235.SO4	105 mg/L	100 mg/L	105	75.0	125	----
Anions and Nutrients (QCLot: 1540338)										
VA24B6483-001	WLNG US 1	Chloride	16887-00-6	E235.Cl	101 mg/L	100 mg/L	101	75.0	125	----
Anions and Nutrients (QCLot: 1540339)										
VA24B6483-001	WLNG US 1	Nitrate (as N)	14797-55-8	E235.NO3-L	2.58 mg/L	2.5 mg/L	103	75.0	125	----
Anions and Nutrients (QCLot: 1540340)										
VA24B6483-001	WLNG US 1	Nitrite (as N)	14797-65-0	E235.NO2-L	0.506 mg/L	0.5 mg/L	101	75.0	125	----
Anions and Nutrients (QCLot: 1540341)										
VA24B6483-001	WLNG US 1	Fluoride	16984-48-8	E235.F	1.00 mg/L	1 mg/L	100	75.0	125	----
Anions and Nutrients (QCLot: 1540342)										
VA24B6483-001	WLNG US 1	Bromide	24959-67-9	E235.Br-L	0.512 mg/L	0.5 mg/L	102	75.0	125	----
Anions and Nutrients (QCLot: 1540677)										
VA24B6483-005	Trip Blank	Fluoride	16984-48-8	E235.F	1.02 mg/L	1 mg/L	102	75.0	125	----
Anions and Nutrients (QCLot: 1540678)										
VA24B6483-005	Trip Blank	Chloride	16887-00-6	E235.Cl	101 mg/L	100 mg/L	101	75.0	125	----
Anions and Nutrients (QCLot: 1540679)										
VA24B6483-005	Trip Blank	Bromide	24959-67-9	E235.Br-L	0.498 mg/L	0.5 mg/L	99.6	75.0	125	----
Anions and Nutrients (QCLot: 1540680)										
VA24B6483-005	Trip Blank	Nitrate (as N)	14797-55-8	E235.NO3-L	2.53 mg/L	2.5 mg/L	101	75.0	125	----
Anions and Nutrients (QCLot: 1540681)										
VA24B6483-005	Trip Blank	Nitrite (as N)	14797-65-0	E235.NO2-L	0.508 mg/L	0.5 mg/L	102	75.0	125	----
Anions and Nutrients (QCLot: 1540682)										
VA24B6483-005	Trip Blank	Sulfate (as SO4)	14808-79-8	E235.SO4	102 mg/L	100 mg/L	102	75.0	125	----
Anions and Nutrients (QCLot: 1540812)										
VA24B6483-002	WLNG DS 1	Phosphorus, total	7723-14-0	E372-U	0.0491 mg/L	0.05 mg/L	98.2	70.0	130	----
Anions and Nutrients (QCLot: 1540817)										
VA24B6483-002	WLNG DS 1	Ammonia, total (as N)	7664-41-7	E298	0.103 mg/L	0.1 mg/L	103	75.0	125	----
Anions and Nutrients (QCLot: 1540818)										
VA24B6483-002	WLNG DS 1	Nitrogen, total	7727-37-9	E366	0.458 mg/L	0.4 mg/L	114	70.0	130	----
Organic / Inorganic Carbon (QCLot: 1540815)										



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Organic / Inorganic Carbon (QCLot: 1540815) - continued										
VA24B6483-002	W LNG DS 1	Carbon, dissolved organic [DOC]	---	E358-L	5.23 mg/L	5 mg/L	104	70.0	130	---
Total Sulfides (QCLot: 1545790)										
CG2409472-002	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.208 mg/L	0.2 mg/L	104	75.0	125	---
Total Metals (QCLot: 1538116)										
VA24B6252-022	Anonymous	Aluminum, total	7429-90-5	E420	0.187 mg/L	0.2 mg/L	93.5	70.0	130	---
		Antimony, total	7440-36-0	E420	0.0192 mg/L	0.02 mg/L	96.2	70.0	130	---
		Arsenic, total	7440-38-2	E420	0.0207 mg/L	0.02 mg/L	103	70.0	130	---
		Barium, total	7440-39-3	E420	ND mg/L	---	ND	70.0	130	---
		Beryllium, total	7440-41-7	E420	0.0408 mg/L	0.04 mg/L	102	70.0	130	---
		Bismuth, total	7440-69-9	E420	0.00953 mg/L	0.01 mg/L	95.3	70.0	130	---
		Boron, total	7440-42-8	E420	0.097 mg/L	0.1 mg/L	97.5	70.0	130	---
		Cadmium, total	7440-43-9	E420	0.00403 mg/L	0.004 mg/L	101	70.0	130	---
		Calcium, total	7440-70-2	E420	ND mg/L	---	ND	70.0	130	---
		Cesium, total	7440-46-2	E420	0.00989 mg/L	0.01 mg/L	98.9	70.0	130	---
		Chromium, total	7440-47-3	E420	0.0401 mg/L	0.04 mg/L	100	70.0	130	---
		Cobalt, total	7440-48-4	E420	0.0198 mg/L	0.02 mg/L	98.8	70.0	130	---
		Copper, total	7440-50-8	E420	0.0196 mg/L	0.02 mg/L	98.0	70.0	130	---
		Iron, total	7439-89-6	E420	1.96 mg/L	2 mg/L	97.8	70.0	130	---
		Lead, total	7439-92-1	E420	0.0192 mg/L	0.02 mg/L	95.9	70.0	130	---
		Lithium, total	7439-93-2	E420	0.103 mg/L	0.1 mg/L	103	70.0	130	---
		Magnesium, total	7439-95-4	E420	ND mg/L	---	ND	70.0	130	---
		Manganese, total	7439-96-5	E420	ND mg/L	---	ND	70.0	130	---
		Molybdenum, total	7439-98-7	E420	0.0198 mg/L	0.02 mg/L	99.2	70.0	130	---
		Nickel, total	7440-02-0	E420	0.0393 mg/L	0.04 mg/L	98.2	70.0	130	---
		Phosphorus, total	7723-14-0	E420	10.1 mg/L	10 mg/L	101	70.0	130	---
		Potassium, total	7440-09-7	E420	4.16 mg/L	4 mg/L	104	70.0	130	---
		Rubidium, total	7440-17-7	E420	0.0196 mg/L	0.02 mg/L	98.0	70.0	130	---
		Selenium, total	7782-49-2	E420	0.0413 mg/L	0.04 mg/L	103	70.0	130	---
		Silicon, total	7440-21-3	E420	9.52 mg/L	10 mg/L	95.2	70.0	130	---
		Silver, total	7440-22-4	E420	0.00386 mg/L	0.004 mg/L	96.6	70.0	130	---
		Sodium, total	7440-23-5	E420	ND mg/L	---	ND	70.0	130	---
		Strontium, total	7440-24-6	E420	ND mg/L	---	ND	70.0	130	---
		Sulfur, total	7704-34-9	E420	ND mg/L	---	ND	70.0	130	---
		Tellurium, total	13494-80-9	E420	0.0393 mg/L	0.04 mg/L	98.4	70.0	130	---
		Thallium, total	7440-28-0	E420	0.00369 mg/L	0.004 mg/L	92.3	70.0	130	---
		Thorium, total	7440-29-1	E420	0.0206 mg/L	0.02 mg/L	103	70.0	130	---
		Tin, total	7440-31-5	E420	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	---
		Titanium, total	7440-32-6	E420	0.0384 mg/L	0.04 mg/L	95.9	70.0	130	---
		Tungsten, total	7440-33-7	E420	0.0188 mg/L	0.02 mg/L	94.0	70.0	130	---
		Uranium, total	7440-61-1	E420	0.00389 mg/L	0.004 mg/L	97.3	70.0	130	---
		Vanadium, total	7440-62-2	E420	0.1000 mg/L	0.1 mg/L	100.0	70.0	130	---
		Zinc, total	7440-66-6	E420	0.386 mg/L	0.4 mg/L	96.4	70.0	130	---
		Zirconium, total	7440-67-7	E420	0.0399 mg/L	0.04 mg/L	99.8	70.0	130	---



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Total Metals (QCLot: 1545993)										
KS2402608-001	Anonymous	Mercury, total	7439-97-6	E508	0.0000976 mg/L	0 mg/L	97.6	70.0	130	---
Dissolved Metals (QCLot: 1539533)										
FJ2401974-002	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.388 mg/L	0.4 mg/L	97.0	70.0	130	---
		Antimony, dissolved	7440-36-0	E421	0.0400 mg/L	0.04 mg/L	99.9	70.0	130	---
		Arsenic, dissolved	7440-38-2	E421	0.0425 mg/L	0.04 mg/L	106	70.0	130	---
		Barium, dissolved	7440-39-3	E421	0.0390 mg/L	0.04 mg/L	97.6	70.0	130	---
		Beryllium, dissolved	7440-41-7	E421	0.0697 mg/L	0.08 mg/L	87.1	70.0	130	---
		Bismuth, dissolved	7440-69-9	E421	0.0186 mg/L	0.02 mg/L	93.0	70.0	130	---
		Boron, dissolved	7440-42-8	E421	0.175 mg/L	0.2 mg/L	87.6	70.0	130	---
		Cadmium, dissolved	7440-43-9	E421	0.00806 mg/L	0.008 mg/L	101	70.0	130	---
		Calcium, dissolved	7440-70-2	E421	ND mg/L	---	ND	70.0	130	---
		Cesium, dissolved	7440-46-2	E421	0.0200 mg/L	0.02 mg/L	99.9	70.0	130	---
		Chromium, dissolved	7440-47-3	E421	0.0796 mg/L	0.08 mg/L	99.6	70.0	130	---
		Cobalt, dissolved	7440-48-4	E421	0.0390 mg/L	0.04 mg/L	97.4	70.0	130	---
		Copper, dissolved	7440-50-8	E421	0.0381 mg/L	0.04 mg/L	95.2	70.0	130	---
		Iron, dissolved	7439-89-6	E421	3.94 mg/L	4 mg/L	98.5	70.0	130	---
		Lead, dissolved	7439-92-1	E421	0.0358 mg/L	0.04 mg/L	89.4	70.0	130	---
		Lithium, dissolved	7439-93-2	E421	0.173 mg/L	0.2 mg/L	86.4	70.0	130	---
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	---	ND	70.0	130	---
		Manganese, dissolved	7439-96-5	E421	0.0384 mg/L	0.04 mg/L	96.0	70.0	130	---
		Molybdenum, dissolved	7439-98-7	E421	0.0413 mg/L	0.04 mg/L	103	70.0	130	---
		Nickel, dissolved	7440-02-0	E421	0.0757 mg/L	0.08 mg/L	94.6	70.0	130	---
		Phosphorus, dissolved	7723-14-0	E421	20.5 mg/L	20 mg/L	102	70.0	130	---
		Potassium, dissolved	7440-09-7	E421	7.90 mg/L	8 mg/L	98.7	70.0	130	---
		Rubidium, dissolved	7440-17-7	E421	0.0390 mg/L	0.04 mg/L	97.6	70.0	130	---
		Selenium, dissolved	7782-49-2	E421	ND mg/L	---	ND	70.0	130	---
		Silicon, dissolved	7440-21-3	E421	19.0 mg/L	20 mg/L	95.2	70.0	130	---
		Silver, dissolved	7440-22-4	E421	0.00637 mg/L	0.008 mg/L	79.6	70.0	130	---
		Sodium, dissolved	7440-23-5	E421	4.18 mg/L	4 mg/L	104	70.0	130	---
		Strontium, dissolved	7440-24-6	E421	ND mg/L	---	ND	70.0	130	---
		Sulfur, dissolved	7704-34-9	E421	ND mg/L	---	ND	70.0	130	---
		Tellurium, dissolved	13494-80-9	E421	0.0828 mg/L	0.08 mg/L	104	70.0	130	---
		Thallium, dissolved	7440-28-0	E421	0.00730 mg/L	0.008 mg/L	91.3	70.0	130	---
		Thorium, dissolved	7440-29-1	E421	0.0390 mg/L	0.04 mg/L	97.5	70.0	130	---
		Tin, dissolved	7440-31-5	E421	0.0405 mg/L	0.04 mg/L	101	70.0	130	---
		Titanium, dissolved	7440-32-6	E421	0.0803 mg/L	0.08 mg/L	100	70.0	130	---
		Tungsten, dissolved	7440-33-7	E421	0.0384 mg/L	0.04 mg/L	96.0	70.0	130	---
		Uranium, dissolved	7440-61-1	E421	ND mg/L	---	ND	70.0	130	---
		Vanadium, dissolved	7440-62-2	E421	0.201 mg/L	0.2 mg/L	100	70.0	130	---
		Zinc, dissolved	7440-66-6	E421	0.774 mg/L	0.8 mg/L	96.7	70.0	130	---
		Zirconium, dissolved	7440-67-7	E421	0.0804 mg/L	0.08 mg/L	100	70.0	130	---
Dissolved Metals (QCLot: 1545892)										
VA24B6434-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000982 mg/L	0 mg/L	98.2	70.0	130	---



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
Dissolved Metals (QCLot: 1545893)										
VA24B6483-004	Field Blank	Mercury, dissolved	7439-97-6	E509	0.0000990 mg/L	0 mg/L	99.0	70.0	130	----
Speciated Metals (QCLot: 1539725)										
VA24B6482-001	Anonymous	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0398 mg/L	0.04 mg/L	99.4	70.0	130	----



Report To Contact and company name below will appear on the final report Triton Environmental Miranda Lewis 604-356-9218 Company address below will appear on the final report 1730-1111 West Georgia Street Vancouver/BC Postal Code: V6E 4M3		Report Format / Distribution Select Report Format: <input type="checkbox"/> EXCEL <input type="checkbox"/> EDD (DIGITAL) Quality Control (QC) Report with Report <input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked Select Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax: mlewis@triton-env.com Email 2: acham@triton-env.com; sblanchard@triton-env.com Email 3: ESdat_CA@tritonenv@ESdatLabSync.net		Select Service Level Below - Contact your AM to confirm all E&P TATs (surcharges may apply) Regular [R] <input checked="" type="checkbox"/> Standard TAT if received by 3 pm - business days - no surcharges apply 1 Business day [E1 - 100%] Same Day, Weekend* 200% (Laboratory)	
Invoice To Same as Report To <input type="checkbox"/> YES <input type="checkbox"/> NO Copy of Invoice with Report <input type="checkbox"/> YES <input type="checkbox"/> NO		Invoice Distribution Select Invoice Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax: mlewis@triton-env.com Email 2: smuminovic@triton-env.com		Date and Time Required for all E&P TATs: For tests that can not be performed according to the service level selected, you indicate filtered (F), Preserved (P) or Filtered and Preserved (F/P)	
Company: Contact:		Project Information Project Information Job #: 11964 PO / AFE: 11964 - Task 20 - Phase 3C-4C L&D:		Environmental Division Vancouver Work Order Reference VA24B6483	
ALS Account # / Quote #: VA23-TRIT100-012 Job #: 11964 PO / AFE: 11964 - Task 20 - Phase 3C-4C LSD:		Oil and Gas Required Fields (client use) PO#: _____ Routing Code: _____ Requisitioner: _____ Location: _____		Telephone: +1 604 253 4188	
ALS Lab Work Order # (lab use only):		ALS Contact: Can Dang Date: 09-Jul-24 Time: 09:37 Sample Type: Water		Total metals + mercury Dissolved metals + mercury Total hexavalent chromium Total trivalent chromium TSS TDS Nitrogen (ammonia, ammonium, total) Nitrogen, total phosphorus Total sulfide (low) (as H2S) Unfiltered sulfide (low) General parameters (alkalinity) Anions scan (Br, Cl, F, NO2, NO3, SO4) DOC	
ALS Sample # (lab use only) WLNG US 1 pH: 6.59 cond: 23 µS/cm temp: 16.2 °C WLNG DS 1 pH: 6.67 cond: 26 µS/cm temp: 17.8 °C pH: 6.67 cond: 26 µS/cm temp: 17.8 °C Duplicate Field Blank Trip Blank		Date: 09-Jul-24 Time: 10:15 Sample Type: Water Date: 09-Jul-24 Time: 09:37 Sample Type: Water Date: 09-Jul-24 Time: 09:24 Sample Type: Water Date: 09-Jul-24 Time: _____ Sample Type: Water		SAMPLES ON HOLD Sample is hazardous NUMBER OF CONTAINERS	
Drinking Water (DW) Samples (client use) Are samples taken from a Regulated DW System? <input type="checkbox"/> YES <input type="checkbox"/> NO Are samples for human consumption/ use? <input type="checkbox"/> YES <input type="checkbox"/> NO		Special Instructions / Specify Criteria to add on report by clicking on the drop-down list below (electronic COC only) Duplicate and field blanks taken at WLNG US 1		SAMPLE CONDITION AS RECEIVED (lab use only) Frozen <input type="checkbox"/> Ice Packs <input checked="" type="checkbox"/> Ice Cubes <input type="checkbox"/> Custody seal intact Yes <input type="checkbox"/> No <input type="checkbox"/> Cooling Initiated <input type="checkbox"/>	
SHIPMENT RELEASE (client use) Released by: Kelly Chyoski Date: 9 July 24 Time: 16:57		INITIAL SHIPMENT RECEPTION (lab use only) Received by: _____ Date: _____ Time: _____		FINAL SHIPMENT RECEPTION (lab use only) Received by: _____ Date: 5 Jul 19 Time: _____	
Triton project # 11964 INITIAL COOLER TEMPERATURES °C: _____ FINAL COOLER TEMPERATURES °C: _____					

WHITE - LABORATORY COPY YELLOW - CLIENT COPY
 Failure to complete all portions of this form may delay analysis. Please fill in this form LEGIBLY. By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.
 1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.

 Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	July 8 th to July 14 th , 2024
	Report #	16
	Appendix D	D-4

Woodfibre Site Receiving Environment Field Notes and Logs



FortisBC Eagle Mountain-Woodfibre Gas Pipeline

Water Discharge Authorization Water Quality Monitoring

2024-7-9-Chycoski-80AC7

Project Component:	Tunnel	Site Name:	Receiving Environment - Downstream of Discharge
Inspection Date:	07/09/2024	Location:	WLNG
Triton QP:	Lily Chycoski	Latitude/Longitude:	49.6683 -123.247958
Temperature(c):	Low 18 High 32	Permit:	PE 110136
Weather Conditions:	Clear	Ground Conditions:	Dry

Observations

Time: 10:15:00 **Flow Volume (visual):** low

Notes: Conductivity: 26 micro Siemens per cm

Odour Detected?: No **Notes:**

Unusual Colour?: No **Notes:**

Unusual Observations?: No **Notes:**

Sheen on Water?: No **Notes:**

Samples Collected - Parameters

Total Metals + Mercury	Yes	General Parameters (Alkalinity)	Yes	Other Sample: Total hexavalent chromium and total trivalent chromium
Dissolved Metals + Mercury	Yes	Total Sulfide, Unionized Sulfide	Yes	
TSS	Yes	Anions	Yes	QA Samples: No Total hexavalent chromium and total trivalent chromium
TDS	Yes	VOC/VPH	N/A	
Nutrients	Yes	EPH, PAH, LEPH/HEPH	N/A	
DOC	Yes	Trout LC50	N/A	

Logger Maintenance

Logger Maintenance Performed?	No	Photo of COC with Lab Signature?	Yes
--------------------------------------	----	---	-----

Describe Logger Maintenance

Photos



Photo: 1
Location: EAS DS 1
Description: US view



Photo: 2
Location: EAS DS 1
Description: Across view



2024-7-9-Chycoski-80AC7

Sign Off

Report Prepared By: Lily Chycoski

Report Reviewed:

Report Reviewer:

Professional(s) of Record:

Name:

Designation:

Designation Number:



FortisBC Eagle Mountain-Woodfibre Gas Pipeline

Water Discharge Authorization Water Quality Monitoring

2024-7-9-Chycoski-81256

Project Component:	Tunnel	Site Name:	Receiving Environment - Upstream of Discharge
Inspection Date:	07/09/2024	Location:	WLNG
Triton QP:	Lily Chycoski	Latitude/Longitude:	49.669455 -123.25087
Temperature(c):	Low 18 High 32	Permit:	PE 110136
Weather Conditions:	Clear	Ground Conditions:	Dry

Observations

Time: 09:37:00 **Flow Volume (visual):** low
Notes: Conductivity: 23 micro Siemens per cm
Odour Detected?: No **Notes:**
Unusual Colour? No **Notes:**
Unusual Observations? No **Notes:**
Sheen on Water? No **Notes:**

Samples Collected - Parameters

Total Metals + Mercury	Yes	General Parameters (Alkalinity)	Yes	Other Sample:
Dissolved Metals + Mercury	Yes	Total Sulfide, Unionized Sulfide	Yes	Total hexavalent chromium and total trivalent chromium
TSS	Yes	Anions	Yes	
TDS	Yes	VOC/VPH	N/A	QA Samples: Yes
Nutrients	Yes	EPH, PAH, LEPH/HEPH	N/A	Total hexavalent chromium and total trivalent chromium
DOC	Yes	Trout LC50	N/A	

Logger Maintenance

Logger Maintenance Performed? No **Photo of COC with Lab Signature?** Yes
Describe Logger Maintenance

Photos



Photo: 1
Location: EAS US 1
Description: US view



Photo: 2
Location: EAS US 1
Description: Across view

Photos



Photo: 3
Location: EAS US 1
Description: DS view

Chain of Custody (COC) / Analytical Request Form

ALS Environmental Canada Toll Free: 1 800 568 9478

ALS Barcode label here (ALS use only)

COC Number: 17- Page: 1 of 4

Project To: [Blank] **Project From:** [Blank] **Distribution:** [Blank]

Client: [Blank] **Requester:** [Blank] **Requester Contact:** [Blank]

Address: [Blank] **City:** [Blank] **Province:** [Blank] **Country:** [Blank]

Sample Location: [Blank] **Sample Date:** [Blank] **Sample Time:** [Blank]

Sample To: [Blank] **Sample From:** [Blank] **Distribution:** [Blank]

Project Information: [Blank] **ALS Contact:** [Blank] **ALS Email:** [Blank]

ALS Lab Work Order # (200 and only): [Blank]

Sample Identification and/or Coordinates: [Blank]

ALS Sample #	Sample Description	Date	Time	Sample Type	PH	PC	PD	PE	PF	PG	PH	PI	PJ	PK	PL	PM	PN	PO	PP	PQ	PR	PS	PT	PV	PW	PX	PY	PZ
PH 4.57	COND 23 µS/cm	07-09-24	09:37	Water																								
	PH 6.67	07-09-24	09:37	Water																								
	COND 23 µS/cm	07-09-24	09:37	Water																								
	Temp 16.2 °C	07-09-24	09:37	Water																								
	COND 23 µS/cm	07-09-24	09:37	Water																								
	Temp 16.2 °C	07-09-24	09:37	Water																								
	COND 23 µS/cm	07-09-24	09:37	Water																								
	Temp 16.2 °C	07-09-24	09:37	Water																								

Special Instructions / Specify Column to add an entry by clicking on the strip down bar below (Standard COC only)

SHIPMENT RELEASE (Client use) [Blank] **SHIPMENT RECEIPT (ALS use only)** [Blank]

Signature: [Blank] **Date:** [Blank]

ALS Lab Work Order # (200 and only): [Blank]

ALS Barcode label here (ALS use only): [Blank]

Photo: 4
Location: EAS US 1
Description: Lab COC



Sign Off

Report Prepared By: Lily Chycoski

Report Reviewed:

Report Reviewer:

Professional(s) of Record:

Name:

Designation:

Designation Number:

Received	Temperature C	Specific Conductivity $\mu\text{S/cm}$	Salinity PSU	pH	ORP mV	Dissolved Oxygen Concentration mg/L	Turbidity NTU	Discharge Open/Closed
7/8/2024 0:00	21.03	93	0.04	7.35	322.23	7.07	0	Open
7/8/2024 0:10	20.66	87.35	0.04	7.35	326.41	7.25	0	Open
7/8/2024 0:20	21.02	92.61	0.04	7.34	324.44	7.08	0	Open
7/8/2024 0:30	20.63	86.78	0.04	7.35	327.79	7.26	0	Open
7/8/2024 0:40	20.96	92.01	0.04	7.35	325.78	7.09	0	Open
7/8/2024 0:50	20.52	85.79	0.04	7.32	331.26	7.29	0	Open
7/8/2024 1:00	20.89	91.22	0.04	7.35	326.91	7.11	0	Open
7/8/2024 1:10	20.49	85.76	0.04	7.35	330.71	7.29	0	Open
7/8/2024 1:20	20.84	91.61	0.04	7.35	328.16	7.11	0	Open
7/8/2024 1:30	20.43	85.73	0.04	7.35	331.65	7.28	0	Open
7/8/2024 1:40	20.75	90.92	0.04	7.35	329.95	7.12	0	Open
7/8/2024 1:50	20.34	85.12	0.04	7.32	334.45	7.31	0	Open
7/8/2024 2:00	20.66	90.77	0.04	7.35	331.78	7.13	0	Open
7/8/2024 2:10	20.25	84.71	0.04	7.34	335.14	7.32	0	Open
7/8/2024 2:20	20.56	90.59	0.04	7.36	332.51	7.16	0	Open
7/8/2024 2:30	20.15	84.22	0.04	7.35	335.75	7.35	0	Open
7/8/2024 2:40	20.46	90.12	0.04	7.34	334.25	7.17	0	Open
7/8/2024 2:50	19.58	76.95	0.04	7.31	339.76	7.65	0	Open
7/8/2024 3:00	20.28	88.93	0.04	7.35	335.27	7.2	0.14	Open
7/8/2024 3:10	19.92	83.9	0.04	7.35	337.87	7.36	0	Open
7/8/2024 3:20	20.24	88.73	0.04	7.35	336.72	7.2	0	Open
7/8/2024 3:30	19.86	83.52	0.04	7.36	338.42	7.39	0	Open
7/8/2024 3:40	20.16	88.22	0.04	7.37	336.79	7.23	0	Open
7/8/2024 3:50	19.75	82.99	0.04	7.35	340.13	7.41	0	Open
7/8/2024 4:00	20.07	87.94	0.04	7.35	338.39	7.25	0	Open
7/8/2024 4:10	19.68	82.75	0.04	7.36	339.78	7.43	0	Open
7/8/2024 4:20	19.98	87.63	0.04	7.35	338.61	7.28	0	Open
7/8/2024 4:30	19.57	82.59	0.04	7.36	340.24	7.46	0	Open
7/8/2024 4:40	19.86	87.25	0.04	7.37	338.42	7.32	0	Open
7/8/2024 4:50	19.42	81.66	0.04	7.36	340.83	7.5	0	Open
7/8/2024 5:00	19.76	86.56	0.04	7.37	338.7	7.34	0	Open
7/8/2024 5:10	19.37	81.27	0.04	7.37	340.96	7.5	0	Open
7/8/2024 5:20	19.35	73.08	0.03	7.33	340.39	7.61	0	Open
7/8/2024 5:30	18.13	44.98	0.02	7.26	348.84	8.26	0	Open
7/8/2024 5:40	17.3	36.73	0.02	7.21	356.24	8.48	0	Closed
7/8/2024 5:50	16.84	33.69	0.01	7.22	359.79	8.62	0	Closed
7/8/2024 6:00	16.53	32.26	0.01	7.21	363.76	8.69	0	Closed
7/8/2024 6:10	16.33	31.55	0.01	7.24	364.98	8.72	0	Closed
7/8/2024 6:20	16.19	31.1	0.01	7.24	367.04	8.75	0	Closed
7/8/2024 6:30	16.06	30.61	0.01	7.24	369	8.77	0	Closed
7/8/2024 6:40	15.96	30.34	0.01	7.23	370.6	8.8	0	Closed
7/8/2024 6:50	16.88	69.83	0.03	7.36	369.5	8.07	0	Closed

7/8/2024 7:00	17.52	60.46	0.03	7.35	348.44	8.07	0 Closed
7/8/2024 7:10	17.88	72.95	0.03	7.4	351.87	7.87	0 Open
7/8/2024 7:20	17.87	60.41	0.03	7.36	347.6	8.03	0 Open
7/8/2024 7:30	17.94	69.6	0.03	7.4	351.49	7.95	0 Open
7/8/2024 7:40	17.96	61.22	0.03	7.37	347.88	8.03	0 Open
7/8/2024 7:50	17.85	68.94	0.03	7.39	353.15	8	0 Open
7/8/2024 8:00	17.97	74.65	0.03	7.34	348.69	8.03	0 Open
7/8/2024 8:10	17.79	87.85	0.04	7.34	353.97	8.06	0 Open
7/8/2024 8:20	17.99	69.09	0.03	7.3	347.42	8.03	0 Open
7/8/2024 8:30	17.73	69.93	0.03	7.29	353.41	8.11	0 Open
7/8/2024 8:40	18.02	64.72	0.03	7.27	348.96	8.04	0 Open
7/8/2024 8:50	18.09	71.75	0.03	7.31	351.98	7.97	0 Open
7/8/2024 9:00	18.62	75.43	0.03	7.33	345.8	7.79	0.92 Open
7/8/2024 9:10	18.32	70.3	0.03	7.35	348.52	7.97	0 Open
7/8/2024 9:20	18.56	67.95	0.03	7.33	343.71	7.89	0.31 Open
7/8/2024 9:30	18.52	72.69	0.03	7.35	348.74	7.91	0 Open
7/8/2024 9:40	18.6	65.47	0.03	7.33	344.35	7.92	0 Open
7/8/2024 9:50	18.91	73.84	0.03	7.38	346.02	7.79	0 Open
7/8/2024 10:00	18.68	63.53	0.03	7.31	345.29	7.92	0 Open
7/8/2024 10:10	18.98	74.57	0.03	7.4	345.79	7.83	0 Open
7/8/2024 10:20	19	66.58	0.03	7.36	342.1	7.84	0 Open
7/8/2024 10:30	18.68	65.67	0.03	7.36	348.5	8.04	0 Open
7/8/2024 10:40	19.07	63.69	0.03	7.35	342.79	7.88	0 Open
7/8/2024 10:50	19.38	76.03	0.04	7.41	345.97	7.78	0 Open
7/8/2024 11:00	19.4	66.07	0.03	7.36	341.89	7.81	0 Open
7/8/2024 11:10	19.64	73.41	0.03	7.42	340.47	7.77	0 Open
7/8/2024 11:20	19.79	67.48	0.03	7.35	336.32	7.73	0 Open
7/8/2024 11:30	20.01	73.31	0.03	7.41	331.44	7.73	0 Open
7/8/2024 11:40	20.08	76.95	0.04	7.38	325.64	7.68	0 Open
7/8/2024 11:50	20.15	89.16	0.04	7.37	335.12	7.73	0 Open
7/8/2024 12:00	20.3	74.39	0.03	7.32	330.61	7.67	0 Open
7/8/2024 12:10	20.63	80.96	0.04	7.33	334.39	7.61	0 Open
7/8/2024 12:20	20.65	71.11	0.03	7.31	332.97	7.61	0 Open
7/8/2024 12:30	20.85	75.92	0.04	7.31	339.88	7.61	0 Open
7/8/2024 12:40	20.89	68.31	0.03	7.26	338.9	7.58	0 Open
7/8/2024 12:50	21.14	75.41	0.03	7.33	341.56	7.57	0 Open
7/8/2024 13:00	21.15	68.95	0.03	7.31	338.15	7.53	0 Open
7/8/2024 13:10	20.49	40.14	0.02	7.22	347.36	7.87	0 Open
7/8/2024 13:20	20.19	34.59	0.02	7.21	353.35	7.95	0 Open
7/8/2024 13:30	20.06	32.53	0.01	7.22	356.01	7.98	0 Open
7/8/2024 13:40	21.37	70.26	0.03	7.36	352.05	7.55	0 Open
7/8/2024 13:50	21.86	85.69	0.04	7.3	343.82	7.49	0.05 Open
7/8/2024 14:00	21.54	68.05	0.03	7.24	346.52	7.53	0 Open
7/8/2024 14:10	22.02	88.12	0.04	7.24	350.8	7.44	0 Open
7/8/2024 14:20	21.95	74.61	0.03	7.25	347.34	7.41	0 Open
7/8/2024 14:30	22.18	77.88	0.04	7.25	348.92	7.42	0 Open
7/8/2024 14:40	22.09	71.19	0.03	7.26	346.86	7.4	0 Open

7/8/2024 14:50	22.15	74.34	0.03	7.29	346.67	7.47	0	Open
7/8/2024 15:00	22.24	71.43	0.03	7.26	345.14	7.36	0	Open
7/8/2024 15:10	21.98	72.32	0.03	7.3	347.54	7.54	0	Open
7/8/2024 15:20	22.08	61	0.03	7.28	342.81	7.46	0	Closed
7/8/2024 15:30	21.42	38.97	0.02	7.48	348.19	7.75	0	Closed
7/8/2024 15:40	21.04	33.89	0.01	7.47	350.11	7.85	0	Closed
7/8/2024 15:50	20.82	32.09	0.01	7.41	351.42	7.91	0	Closed
7/8/2024 16:00	20.63	31.09	0.01	7.5	353.56	7.96	0	Closed
7/8/2024 16:10	20.5	29.58	0.01	7.45	352.23	7.98	0	Closed
7/8/2024 16:20	20.38	29.92	0.01	7.46	355.09	8.04	0	Closed
7/8/2024 16:30	20.28	28.97	0.01	7.37	353.46	8.03	0	Closed
7/8/2024 16:40	20.17	27.88	0.01	7.52	356.28	8.1	0	Closed
7/8/2024 16:50	20.07	27.43	0.01	7.24	353.09	8.1	0	Closed
7/8/2024 17:00	19.97	26.79	0.01	7.32	353.14	8.16	0	Closed
7/8/2024 17:10	19.87	26.42	0.01	7.13	352.12	8.17	0	Closed
7/8/2024 17:20	19.74	26.14	0.01	7.18	349.74	8.21	0	Closed
7/8/2024 17:30	19.63	25.43	0.01	7.02	353.34	8.23	0	Closed
7/8/2024 17:40	19.5	25.3	0.01	7.35	347.77	8.27	0	Closed
7/8/2024 17:50	19.38	24.83	0.01	7.05	352.37	8.29	0	Closed
7/8/2024 18:00	19.26	24.37	0.01	7.22	347.13	8.32	0.39	Closed
7/8/2024 18:10	19.15	24.75	0.01	7.07	352.64	8.34	0	Closed
7/8/2024 18:20	19.04	24.46	0.01	6.99	352.33	8.36	0	Closed
7/8/2024 18:30	18.94	24.13	0.01	6.96	352.5	8.38	0	Closed
7/8/2024 18:40	18.83	23.35	0.01	7.21	346.6	8.4	0	Closed
7/8/2024 18:50	18.75	23.23	0.01	7.13	352.55	8.42	0	Closed
7/8/2024 19:00	18.67	23.18	0.01	7.09	350.35	8.44	0.02	Closed
7/8/2024 19:10	18.56	24.36	0.01	7.06	349.3	8.44	0	Closed
7/8/2024 19:20	18.48	22.36	0.01	7.04	348.4	8.47	0	Closed
7/8/2024 19:30	18.39	22.96	0.01	7.05	347.62	8.48	0	Closed
7/8/2024 19:40	18.32	22.56	0.01	7.08	347.14	8.49	0	Closed
7/8/2024 19:50	18.25	22.81	0.01	7.06	346.19	8.51	0	Closed
7/8/2024 20:00	18.18	22.46	0.01	7.07	345.59	8.52	0	Open
7/8/2024 20:10	18.12	23.42	0.01	7.06	345.17	8.53	0	Open
7/8/2024 20:20	18.05	23.24	0.01	7.05	344.93	8.54	0	Open
7/8/2024 20:30	20.39	78.87	0.04	7.34	351.36	7.67	0.07	Open
7/8/2024 20:40	20.21	72.84	0.03	7.33	325.93	7.63	0	Open
7/8/2024 20:50	20.48	89.3	0.04	7.36	334.57	7.5	0	Open
7/8/2024 21:00	20.15	68.29	0.03	7.31	338.65	7.72	0	Open
7/8/2024 21:10	19.62	57.71	0.03	7.36	347.44	7.92	0	Open
7/8/2024 21:20	19.3	55.47	0.03	7.38	352.63	8	0	Open
7/8/2024 21:30	19.11	54.6	0.02	7.38	356.24	8.04	0	Open
7/8/2024 21:40	20.15	93.16	0.04	7.36	352.03	7.42	0	Open
7/8/2024 21:50	19.83	71.01	0.03	7.31	342.81	7.74	0	Open
7/8/2024 22:00	20.7	98.96	0.05	7.35	342.09	7.21	0	Open
7/8/2024 22:10	20.07	72.04	0.03	7.29	340.59	7.69	0	Open
7/8/2024 22:20	20.82	98.19	0.05	7.34	340.1	7.17	0	Open
7/8/2024 22:30	20.13	63.83	0.03	7.34	336.4	7.68	0	Open

7/8/2024 22:40	20.35	92.56	0.04	7.33	341.95	7.3	0 Open
7/8/2024 22:50	20.23	69.06	0.03	7.35	330.76	7.58	0 Open
7/8/2024 23:00	20.41	89.55	0.04	7.33	338.1	7.32	0 Open
7/8/2024 23:10	20.4	76.43	0.04	7.31	327.4	7.51	0 Open
7/8/2024 23:20	20.82	91.05	0.04	7.34	334.04	7.25	0 Open
7/8/2024 23:30	20.73	78.91	0.04	7.29	331.55	7.38	0 Open
7/8/2024 23:40	20.85	90.43	0.04	7.33	339.63	7.24	0 Open
7/8/2024 23:50	20.93	84.98	0.04	7.28	333.99	7.29	0 Open
7/9/2024 0:00	20.95	90.77	0.04	7.33	336.94	7.22	0 Open
7/9/2024 0:10	21.14	88.18	0.04	7.32	329.52	7.18	0 Open
7/9/2024 0:20	20.95	89.89	0.04	7.32	335.73	7.23	0 Open
7/9/2024 0:30	21.3	90.71	0.04	7.31	329.28	7.09	0 Open
7/9/2024 0:40	21.01	90.31	0.04	7.33	334.59	7.19	0 Open
7/9/2024 0:50	21.42	93.78	0.04	7.33	328.03	7.01	0 Open
7/9/2024 1:00	21.04	90.09	0.04	7.33	333.65	7.2	0 Open
7/9/2024 1:10	21.42	94.18	0.04	7.33	328.68	7.01	0 Open
7/9/2024 1:20	21.05	89.29	0.04	7.33	333.38	7.19	0 Open
7/9/2024 1:30	21.39	93.63	0.04	7.33	329.42	7.02	0 Open
7/9/2024 1:40	21.1	89.73	0.04	7.34	332.6	7.16	0 Open
7/9/2024 1:50	21.4	93.24	0.04	7.34	329.51	7.02	0 Open
7/9/2024 2:00	21.02	88.68	0.04	7.34	333.53	7.2	0 Open
7/9/2024 2:10	21.35	92.82	0.04	7.34	330.75	7.02	0 Open
7/9/2024 2:20	20.99	88.35	0.04	7.34	333.93	7.18	0 Open
7/9/2024 2:30	21.29	92.5	0.04	7.35	330.79	7.03	0 Open
7/9/2024 2:40	20.87	87.28	0.04	7.34	334.97	7.2	0 Open
7/9/2024 2:50	21.21	91.91	0.04	7.35	331.7	7.03	0 Open
7/9/2024 3:00	20.87	87.63	0.04	7.36	334.97	7.19	0 Open
7/9/2024 3:10	21.16	91.55	0.04	7.36	332.18	7.06	0 Open
7/9/2024 3:20	20.77	87.01	0.04	7.35	336.18	7.23	0 Open
7/9/2024 3:30	21.08	90.94	0.04	7.36	333.2	7.07	0 Open
7/9/2024 3:40	20.72	86.7	0.04	7.36	336.8	7.22	0 Open
7/9/2024 3:50	21.01	90.9	0.04	7.36	334.21	7.11	0 Open
7/9/2024 4:00	20.64	86.33	0.04	7.37	336.44	7.28	0 Open
7/9/2024 4:10	20.94	90.51	0.04	7.37	333.63	7.12	0 Open
7/9/2024 4:20	20.56	85.71	0.04	7.36	337.1	7.3	0 Open
7/9/2024 4:30	20.86	89.89	0.04	7.36	335.31	7.14	0 Open
7/9/2024 4:40	20.49	85.6	0.04	7.36	338.1	7.3	0.11 Open
7/9/2024 4:50	20.8	89.89	0.04	7.38	334.59	7.15	0 Open
7/9/2024 5:00	20.5	80.67	0.04	7.35	336.13	7.38	0 Open
7/9/2024 5:10	19.46	51.55	0.02	7.25	346.25	7.93	0 Open
7/9/2024 5:20	18.41	42.04	0.02	7.25	352.43	8.25	0 Open
7/9/2024 5:30	17.81	36.56	0.02	7.27	357.01	8.41	0 Open
7/9/2024 5:40	17.41	34.44	0.01	7.22	362.84	8.5	0 Open
7/9/2024 5:50	17.14	33.25	0.01	7.22	365.5	8.54	0 Open
7/9/2024 6:00	16.94	32.41	0.01	7.23	367.38	8.58	0 Open
7/9/2024 6:10	16.78	31.86	0.01	7.25	367.44	8.62	0 Open
7/9/2024 6:20	16.66	31.33	0.01	7.24	369.61	8.64	0 Open

7/9/2024 6:30	16.55	29.91	0.01	7.23	371.28	8.66	0 Open
7/9/2024 6:40	17.61	73.74	0.03	7.36	371.02	7.93	0 Open
7/9/2024 6:50	18.34	65.05	0.03	7.37	338.79	7.84	0 Open
7/9/2024 7:00	18.44	75.78	0.04	7.36	349.08	7.76	0 Open
7/9/2024 7:10	18.77	66.61	0.03	7.36	342.6	7.78	0 Open
7/9/2024 7:20	18.64	71.62	0.03	7.38	349.53	7.75	0 Open
7/9/2024 7:30	18.84	62.76	0.03	7.34	345.92	7.81	0 Open
7/9/2024 7:40	18.67	70.84	0.03	7.38	352.28	7.81	0 Open
7/9/2024 7:50	18.89	65.29	0.03	7.33	347.32	7.81	0 Open
7/9/2024 8:00	18.46	68.02	0.03	7.37	352.52	7.95	0 Open
7/9/2024 8:10	18.48	64.14	0.03	7.28	349.85	8.02	0 Open
7/9/2024 8:20	18.58	93.54	0.04	7.25	356.54	7.91	0 Open
7/9/2024 8:30	18.86	72.1	0.03	7.24	347.55	7.83	0 Open
7/9/2024 8:40	18.66	74.29	0.03	7.21	355.71	7.92	0 Open
7/9/2024 8:50	19.04	69.18	0.03	7.23	349.49	7.78	0 Open
7/9/2024 9:00	19.02	73.51	0.03	7.28	352.03	7.79	0 Open
7/9/2024 9:10	19.25	72.27	0.03	7.25	348.08	7.73	0 Open
7/9/2024 9:20	19.04	73.64	0.03	7.31	350.97	7.85	0 Open
7/9/2024 9:30	19.38	71.73	0.03	7.3	344.44	7.71	0 Open
7/9/2024 9:40	19.11	72.38	0.03	7.31	350.42	7.91	0 Open
7/9/2024 9:50	19.58	70.71	0.03	7.29	344.22	7.68	0 Open
7/9/2024 10:00	19.57	75.51	0.03	7.34	347.84	7.74	0 Open
7/9/2024 10:10	19.63	60.68	0.03	7.33	345.17	7.76	0.62 Open
7/9/2024 10:20	19.82	77.15	0.04	7.37	343.77	7.71	0 Open
7/9/2024 10:30	19.76	59.48	0.03	7.34	333.95	7.81	9.6 Open
7/9/2024 10:40	20.17	77.83	0.04	7.39	337.96	7.64	0 Open
7/9/2024 10:50	20.05	60.68	0.03	7.37	330.63	7.76	6.68 Open
7/9/2024 11:00	20.19	73.56	0.03	7.39	336.1	7.71	0 Open
7/9/2024 11:10	20.33	62.49	0.03	7.36	325.11	7.72	4.51 Open
7/9/2024 11:20	21.77	89.11	0.04	7.45	317.26	7.21	0 Open
7/9/2024 11:30	20.17	44.48	0.02	7.33	309.84	7.94	7.22 Open
7/9/2024 11:40	21.03	75.86	0.04	7.4	316.27	7.58	0 Open
7/9/2024 11:50	21.02	60.29	0.03	7.39	312.13	7.61	2.96 Open
7/9/2024 12:00	21.21	74.32	0.03	7.4	319.59	7.58	0 Open
7/9/2024 12:10	21.35	63.3	0.03	7.37	313.79	7.53	2.83 Open
7/9/2024 12:20	21.69	77.72	0.04	7.42	316.23	7.47	0 Open
7/9/2024 12:30	21.59	60.98	0.03	7.39	308.82	7.51	1.6 Open
7/9/2024 12:40	22.02	80.66	0.04	7.42	315.76	7.41	0 Open
7/9/2024 12:50	21.93	64.03	0.03	7.4	309.73	7.43	2.18 Open
7/9/2024 13:00	22.66	88.39	0.04	7.46	313.26	7.23	0 Open
7/9/2024 13:10	22.19	79.11	0.04	7.33	312.37	7.41	0.34 Open
7/9/2024 13:20	22.78	113.14	0.05	7.35	319.48	7.23	0 Open
7/9/2024 13:30	22.46	75.13	0.03	7.29	313.88	7.33	0 Open
7/9/2024 13:40	22.96	93.28	0.04	7.31	322.01	7.18	0 Open
7/9/2024 13:50	22.7	69.43	0.03	7.31	317.25	7.31	0 Open
7/9/2024 14:00	23.55	97.18	0.05	7.36	319.94	7.07	0 Open
7/9/2024 14:10	22.95	72.01	0.03	7.32	317.12	7.24	0 Open

7/9/2024 14:20	23.84	102.01	0.05	7.4	317.25	7.03	0	Open
7/9/2024 14:30	23.02	71.02	0.03	7.32	316.47	7.29	0	Open
7/9/2024 14:40	23.88	100.99	0.05	7.41	320.06	7.06	0	Open
7/9/2024 14:50	23.1	69.1	0.03	7.33	316.11	7.28	0	Open
7/9/2024 15:00	21.92	38.2	0.02	7.24	325.39	7.71	0	Open
7/9/2024 15:10	21.48	33.3	0.01	7.24	330.95	7.8	0	Closed
7/9/2024 15:20	21.25	31.75	0.01	7.23	333.41	7.84	0	Closed
7/9/2024 15:30	21.11	30.85	0.01	7.25	334.43	7.85	0	Closed
7/9/2024 15:40	21	30.41	0.01	7.26	334.01	7.87	0	Closed
7/9/2024 15:50	20.93	30.22	0.01	7.25	337.34	7.87	0	Closed
7/9/2024 16:00	20.86	29.98	0.01	7.26	337.03	7.88	0	Closed
7/9/2024 16:10	20.79	29.76	0.01	7.25	340.03	7.89	0	Closed
7/9/2024 16:20	20.71	29.74	0.01	7.27	339.06	7.9	0	Closed
7/9/2024 16:30	20.64	29.59	0.01	7.24	342.81	7.91	0	Closed
7/9/2024 16:40	20.57	29.56	0.01	7.26	341.44	7.93	0	Closed
7/9/2024 16:50	20.49	29.59	0.01	7.29	342.09	7.93	0	Closed
7/9/2024 17:00	20.4	29.54	0.01	7.28	342.28	7.94	0	Closed
7/9/2024 17:10	20.3	29.55	0.01	7.3	343.47	7.95	0	Closed
7/9/2024 17:20	20.18	29.57	0.01	7.28	346.41	7.98	0	Closed
7/9/2024 17:30	20.04	29.6	0.01	7.28	348.16	8.01	0	Closed
7/9/2024 17:40	19.89	29.6	0.01	7.29	345.56	8.03	0	Closed
7/9/2024 17:50	19.75	29.65	0.01	7.26	350.14	8.06	0	Closed
7/9/2024 18:00	19.62	29.66	0.01	7.28	347.34	8.08	0	Closed
7/9/2024 18:10	19.46	29.76	0.01	7.27	350.44	8.11	0	Closed
7/9/2024 18:20	19.33	29.82	0.01	7.29	348.03	8.12	0	Closed
7/9/2024 18:30	19.21	29.88	0.01	7.31	349.9	8.15	0	Closed
7/9/2024 18:40	19.09	29.93	0.01	7.28	349.74	8.17	0	Closed
7/9/2024 18:50	18.98	29.98	0.01	7.25	354.27	8.18	0	Closed
7/9/2024 19:00	18.88	29.96	0.01	7.27	354.29	8.2	0	Closed
7/9/2024 19:10	18.79	30.03	0.01	7.24	357.81	8.22	0	Closed
7/9/2024 19:20	18.69	30.06	0.01	7.27	356.5	8.23	0	Closed
7/9/2024 19:30	18.59	30.11	0.01	7.24	359.67	8.24	0	Closed
7/9/2024 19:40	18.52	30.15	0.01	7.23	360.18	8.26	0	Closed
7/9/2024 19:50	18.44	30.19	0.01	7.24	361.35	8.27	0	Closed
7/9/2024 20:00	18.36	30.2	0.01	7.25	360.56	8.28	0	Closed
7/9/2024 20:10	18.28	30.19	0.01	7.21	363.9	8.29	0	Closed
7/9/2024 20:20	18.22	30.23	0.01	7.26	361.24	8.3	0	Closed
7/9/2024 20:30	18.16	30.22	0.01	7.22	364.64	8.31	0	Closed
7/9/2024 20:40	18.1	30.25	0.01	7.26	362.6	8.32	0	Open
7/9/2024 20:50	18.04	30.21	0.01	7.26	363.79	8.33	0	Open
7/9/2024 21:00	21.26	89.57	0.04	7.4	358.42	7.47	0.08	Open
7/9/2024 21:10	20.04	66.93	0.03	7.37	325.77	7.78	0	Open
7/9/2024 21:20	21.74	119.19	0.06	7.35	328.59	7.05	0	Open
7/9/2024 21:30	20.46	76.27	0.04	7.31	328.18	7.69	0	Open
7/9/2024 21:40	21.52	112.35	0.05	7.33	329.57	7.12	0	Open
7/9/2024 21:50	20.68	76.72	0.04	7.32	328.56	7.57	0	Open
7/9/2024 22:00	21.86	113.81	0.05	7.29	326.96	7	0	Open

7/9/2024 22:10	20.8	84.8	0.04	7.28	327.11	7.58	0	Open
7/9/2024 22:20	21.86	110.11	0.05	7.28	325.65	7.01	0	Open
7/9/2024 22:30	20.63	75.25	0.03	7.29	323.2	7.61	0	Open
7/9/2024 22:40	21.58	106.09	0.05	7.28	327.54	7.08	0	Open
7/9/2024 22:50	21.06	78.5	0.04	7.27	293.42	7.48	0	Open
7/9/2024 23:00	22.5	120.82	0.06	7.31	306.39	6.62	0	Open
7/9/2024 23:10	20.75	67.94	0.03	7.26	314.43	7.64	0	Open
7/9/2024 23:20	21.51	102.87	0.05	7.3	323.6	7.15	0	Open
7/9/2024 23:30	20.51	67.13	0.03	7.27	319.81	7.69	0	Open
7/9/2024 23:40	21.35	100.84	0.05	7.3	325.87	7.12	0	Open
7/9/2024 23:50	20.67	70.47	0.03	7.27	319.35	7.61	0	Open
7/10/2024 0:00	21.31	100.67	0.05	7.29	326.67	7.14	0	Open
7/10/2024 0:10	20.77	72.4	0.03	7.28	317.88	7.53	0	Open
7/10/2024 0:20	21.28	100.66	0.05	7.29	325.78	7.16	0	Open
7/10/2024 0:30	21.05	76.8	0.04	7.29	315.42	7.35	0	Open
7/10/2024 0:40	21.25	100.2	0.05	7.3	324.69	7.14	0	Open
7/10/2024 0:50	21.17	87.82	0.04	7.31	313.34	7.17	0	Open
7/10/2024 1:00	21.19	97.89	0.05	7.3	323.82	7.13	0.89	Open
7/10/2024 1:10	21.62	96.8	0.05	7.33	311.42	6.95	0	Open
7/10/2024 1:20	21.14	98.47	0.05	7.33	322.1	7.15	0	Open
7/10/2024 1:30	21.78	104.62	0.05	7.3	312.58	6.94	0	Open
7/10/2024 1:40	21.28	98.77	0.05	7.32	320.88	7.13	0	Open
7/10/2024 1:50	21.77	104.49	0.05	7.3	313.43	6.92	0	Open
7/10/2024 2:00	21.29	99.33	0.05	7.33	320.21	7.09	0	Open
7/10/2024 2:10	21.74	103.99	0.05	7.32	313.57	6.96	0	Open
7/10/2024 2:20	21.33	98.87	0.05	7.32	320.39	7.13	0	Open
7/10/2024 2:30	21.71	103.66	0.05	7.31	314.84	6.95	0	Open
7/10/2024 2:40	21.21	97.17	0.05	7.33	320.47	7.16	0	Open
7/10/2024 2:50	21.65	103.51	0.05	7.33	314.65	6.97	0	Open
7/10/2024 3:00	21.15	97.73	0.05	7.33	321.41	7.18	0	Open
7/10/2024 3:10	21.6	103.2	0.05	7.33	315.23	6.96	0	Open
7/10/2024 3:20	21.07	97.49	0.05	7.33	322.01	7.2	0	Open
7/10/2024 3:30	21.5	101.52	0.05	7.33	315.6	6.99	0	Open
7/10/2024 3:40	21.07	96.98	0.05	7.34	321.12	7.11	0	Open
7/10/2024 3:50	21.48	102.39	0.05	7.33	316.67	6.96	0	Open
7/10/2024 4:00	20.99	95.84	0.04	7.34	321.98	7.13	0	Open
7/10/2024 4:10	21.38	100.29	0.05	7.33	316.86	7.02	0	Open
7/10/2024 4:20	20.92	95.55	0.04	7.35	322.1	7.13	0	Open
7/10/2024 4:30	21.31	99.92	0.05	7.34	317.29	7.02	0	Open
7/10/2024 4:40	20.81	93.86	0.04	7.34	323.18	7.23	0.13	Open
7/10/2024 4:50	21.23	98.63	0.05	7.34	318.04	7.04	0	Open
7/10/2024 5:00	21.26	99.69	0.05	7.34	318.55	7.01	0	Open
7/10/2024 5:10	19.71	54.05	0.02	7.26	326.92	7.92	0	Open
7/10/2024 5:20	18.36	40.06	0.02	7.23	335.6	8.33	0	Open
7/10/2024 5:30	17.72	35.64	0.02	7.24	339.83	8.46	0	Closed
7/10/2024 5:40	17.29	33.37	0.01	7.22	344.53	8.55	0	Closed
7/10/2024 5:50	17.04	32.37	0.01	7.23	348.05	8.59	0	Closed

7/10/2024 6:00	16.87	31.84	0.01	7.22	350.8	8.62	0	Closed
7/10/2024 6:10	16.5	30.6	0.01	7.22	342.22	8.7	0.66	Closed
7/10/2024 6:20	16.41	30.19	0.01	7.23	340.4	8.71	0.25	Closed
7/10/2024 6:30	16.36	30.04	0.01	7.25	339.17	8.73	0	Open
7/10/2024 6:40	17.81	80.28	0.04	7.37	341.55	7.88	0	Open
7/10/2024 6:50	18.35	48.32	0.02	7.35	305.63	8.08	0	Open
7/10/2024 7:00	19.01	81.18	0.04	7.38	322.66	7.64	0	Open
7/10/2024 7:10	17.84	39.54	0.02	7.27	323.72	8.42	0	Open
7/10/2024 7:20	18.62	74.55	0.03	7.37	331.61	7.88	0	Open
7/10/2024 7:30	18.66	48.37	0.02	7.37	322.62	8.11	0	Open
7/10/2024 7:40	17.88	55.79	0.03	7.27	336.42	8.42	0	Open
7/10/2024 7:50	18.71	53.01	0.02	7.39	323.68	8.07	0	Open
7/10/2024 8:00	19.06	77.43	0.04	7.4	332.03	7.75	0	Open
7/10/2024 8:10	18.78	48.59	0.02	7.41	323.67	8.07	0	Open
7/10/2024 8:20	19.31	78.48	0.04	7.42	331.27	7.69	0	Open
7/10/2024 8:30	18.89	47.71	0.02	7.36	325.41	8.08	0	Open
7/10/2024 8:40	19.28	77.48	0.04	7.42	331.74	7.75	0	Open
7/10/2024 8:50	19.55	60.25	0.03	7.44	322.62	7.76	0	Open
7/10/2024 9:00	19.66	79.75	0.04	7.43	330.01	7.65	0	Open
7/10/2024 9:10	17.9	33.64	0.01	7.28	332.08	8.49	0	Open
7/10/2024 9:20	19.38	76.41	0.04	7.44	332.73	7.75	0	Open
7/10/2024 9:30	19.17	46.02	0.02	7.38	323.12	8.06	0	Open
7/10/2024 9:40	20.01	79	0.04	7.45	327.78	7.54	0	Open
7/10/2024 9:50	19.65	48.39	0.02	7.4	321.63	7.96	0	Open
7/10/2024 10:00	19.95	76.6	0.04	7.45	327.42	7.67	0	Open
7/10/2024 10:10	19.7	49.3	0.02	7.41	320.47	7.98	0	Open
7/10/2024 10:20	19.98	75.18	0.03	7.44	328.38	7.73	0	Open
7/10/2024 10:30	19.36	39.14	0.02	7.35	323.76	8.16	0	Open
7/10/2024 10:40	20.26	75.82	0.04	7.45	327.06	7.66	0	Open
7/10/2024 10:50	20.21	53.76	0.02	7.38	322.04	7.89	0	Open
7/10/2024 11:00	18.79	32.9	0.01	7.3	326.87	8.34	0	Open
7/10/2024 11:10	18.53	29.47	0.01	7.31	327.29	8.39	0	Open
7/10/2024 11:20	20.42	86.31	0.04	7.41	325.21	7.68	0	Open
7/10/2024 11:30	20.32	42.2	0.02	7.38	305.24	7.97	0	Open
7/10/2024 11:40	20.56	68.14	0.03	7.36	313.86	7.79	0	Open
7/10/2024 11:50	21.35	60.43	0.03	7.43	306.59	7.6	0	Open
7/10/2024 12:00	21.31	74.42	0.03	7.41	314.6	7.58	0	Open
7/10/2024 12:10	20.59	37.1	0.02	7.33	313.76	8	0	Open
7/10/2024 12:20	20.03	32.26	0.01	7.32	311.96	8.13	0	Open
7/10/2024 12:30	19.85	29.49	0.01	7.32	313.14	8.15	0	Closed
7/10/2024 12:40	19.81	30.16	0.01	7.33	312.73	8.15	0	Closed
7/10/2024 12:50	19.82	28.49	0.01	7.31	314.5	8.15	0	Closed
7/10/2024 13:00	19.86	29.2	0.01	7.3	314.4	8.13	0	Closed
7/10/2024 13:10	20.96	45.27	0.02	7.35	318.98	7.9	0	Closed
7/10/2024 13:20	22.48	78.8	0.04	7.44	312.04	7.39	0	Closed
7/10/2024 13:30	22.52	75.31	0.03	7.42	313.24	7.4	0	Open
7/10/2024 13:40	22.7	78.62	0.04	7.41	315.49	7.36	0	Open

7/10/2024 13:50	22.07	43.71	0.02	7.36	315.83	7.68	0	Open
7/10/2024 14:00	21.29	34.21	0.01	7.32	317.66	7.86	0	Closed
7/10/2024 14:10	21	30.64	0.01	7.28	320.86	7.91	0	Closed
7/10/2024 14:20	20.87	30.9	0.01	7.3	318.79	7.93	0	Closed
7/10/2024 14:30	20.8	29.36	0.01	7.27	324.66	7.94	0	Closed
7/10/2024 14:40	20.77	30.12	0.01	7.3	323.25	7.94	0	Closed
7/10/2024 14:50	20.74	28.84	0.01	7.28	326.91	7.94	0	Closed
7/10/2024 15:00	20.72	29.77	0.01	7.29	327.62	7.94	0	Closed
7/10/2024 15:10	20.72	28.72	0.01	7.3	329.26	7.94	0	Closed
7/10/2024 15:20	20.7	29.64	0.01	7.32	327.73	7.94	0	Closed
7/10/2024 15:30	20.69	28.58	0.01	7.28	331.56	7.94	0	Closed
7/10/2024 15:40	20.64	29.63	0.01	7.31	329.17	7.95	0.07	Closed
7/10/2024 15:50	20.62	28.76	0.01	7.25	332.75	7.94	0	Closed
7/10/2024 16:00	20.56	29.68	0.01	7.31	329.39	7.95	0	Closed
7/10/2024 16:10	20.5	28.73	0.01	7.27	331.38	7.96	0	Closed
7/10/2024 16:20	20.45	29.66	0.01	7.29	329.91	7.97	0	Closed
7/10/2024 16:30	20.4	28.74	0.01	7.32	328.78	7.96	0	Closed
7/10/2024 16:40	20.35	29.72	0.01	7.31	329.06	7.97	0	Closed
7/10/2024 16:50	20.26	27.98	0.01	7.26	333.16	8.04	0	Closed
7/10/2024 17:00	20.14	28.64	0.01	7.26	334.89	8.06	0	Closed
7/10/2024 17:10	20.06	28.77	0.01	7.31	334.79	8.02	0.23	Closed
7/10/2024 17:20	19.97	29.18	0.01	7.17	331.49	8.25	0.76	Closed
7/10/2024 17:30	19.87	20.5	0.01	7.2	328.44	8.29	0.1	Closed
7/10/2024 17:40	19.7	30.48	0.01	7.33	334.87	8.15	0	Closed
7/10/2024 17:50	19.58	29.23	0.01	7.27	339.06	8.11	0	Closed
7/10/2024 18:00	19.45	30.14	0.01	7.26	340.39	8.14	0	Closed
7/10/2024 18:10	19.32	29.29	0.01	7.31	339.42	8.15	0	Closed
7/10/2024 18:20	19.21	30.35	0.01	7.25	342.4	8.16	0	Closed
7/10/2024 18:30	19.09	29.47	0.01	7.3	341.85	8.18	0	Closed
7/10/2024 18:40	18.99	30.47	0.01	7.25	343.61	8.2	0	Closed
7/10/2024 18:50	18.89	29.6	0.01	7.28	343.95	8.23	0	Closed
7/10/2024 19:00	18.79	30.58	0.01	7.25	345.45	8.24	0	Closed
7/10/2024 19:10	18.7	29.65	0.01	7.28	344.2	8.27	0	Closed
7/10/2024 19:20	18.6	30.66	0.01	7.27	344.6	8.28	0	Closed
7/10/2024 19:30	18.51	29.75	0.01	7.29	345.26	8.3	0	Closed
7/10/2024 19:40	18.41	30.73	0.01	7.26	345.64	8.31	0	Closed
7/10/2024 19:50	18.34	29.91	0.01	7.3	346.28	8.31	0	Closed
7/10/2024 20:00	18.25	30.83	0.01	7.25	348	8.33	0	Closed
7/10/2024 20:10	18.18	30.01	0.01	7.29	347.7	8.35	0	Closed
7/10/2024 20:20	18.1	30.89	0.01	7.24	348.15	8.35	0	Closed
7/10/2024 20:30	18.04	29.87	0.01	7.29	347.61	8.37	0	Closed
7/10/2024 20:40	17.97	30.9	0.01	7.24	349.74	8.39	0	Closed
7/10/2024 20:50	17.92	29.9	0.01	7.29	348.58	8.4	0	Closed
7/10/2024 21:00	17.86	30.99	0.01	7.25	350.89	8.4	0	Closed
7/10/2024 21:10	18.08	48.63	0.02	7.24	357	8.31	2.43	Closed
7/10/2024 21:20	19	41.47	0.02	7.28	345.86	8.17	0	Open
7/10/2024 21:30	19.5	67.19	0.03	7.35	345.01	7.95	0.06	Open

7/10/2024 21:40	19.13	44.36	0.02	7.3	337.02	8.13	0 Open
7/10/2024 21:50	19.91	78.47	0.04	7.39	338.31	7.74	0 Open
7/10/2024 22:00	19.17	46.34	0.02	7.29	334.68	8.13	0 Open
7/10/2024 22:10	19.88	80.33	0.04	7.4	336.46	7.76	0 Open
7/10/2024 22:20	19.15	46.65	0.02	7.3	333.19	8.12	0 Open
7/10/2024 22:30	19.96	81.68	0.04	7.4	334.28	7.68	0 Open
7/10/2024 22:40	19.14	48.73	0.02	7.29	332.43	8.11	0 Open
7/10/2024 22:50	19.94	80.68	0.04	7.4	332.75	7.66	0 Open
7/10/2024 23:00	19.05	47.11	0.02	7.31	330.35	8.14	0 Open
7/10/2024 23:10	19.91	81.42	0.04	7.39	333.85	7.67	0 Open
7/10/2024 23:20	18.99	47.99	0.02	7.3	330.45	8.15	0 Open
7/10/2024 23:30	19.78	82.74	0.04	7.38	333.16	7.69	0 Open
7/10/2024 23:40	18.9	46.56	0.02	7.3	329.68	8.18	0 Open
7/10/2024 23:50	19.71	82.38	0.04	7.38	332.84	7.75	0 Open
7/11/2024 13:00	20.61	70.52	0.03	7.38	315.58	7.85	0 Open
7/11/2024 12:40	20.4	45.15	0.02	7.39	305.75	7.95	0 Open
7/11/2024 12:20	20.2	45.46	0.02	7.4	306.5	7.99	0 Open
7/11/2024 12:00	20.07	47.79	0.02	7.38	307.29	8.01	0 Open
7/11/2024 12:50	19.97	34.16	0.01	7.31	310.07	8.09	0 Open
7/11/2024 0:10	19.86	83.21	0.04	7.38	330.03	7.59	0 Open
7/11/2024 0:50	19.83	83.42	0.04	7.36	328.78	7.68	0 Open
7/11/2024 11:20	19.8	56.52	0.03	7.45	312.98	7.92	0 Open
7/11/2024 1:30	19.77	80.62	0.04	7.37	323.24	7.65	0 Open
7/11/2024 1:10	19.76	80.91	0.04	7.35	326.76	7.72	0 Open
7/11/2024 12:30	19.73	34.11	0.01	7.34	309.27	8.15	0 Open
7/11/2024 0:30	19.72	80.66	0.04	7.38	329.03	7.72	0 Open
7/11/2024 1:20	19.67	60.92	0.03	7.33	310.47	7.8	0 Open
7/11/2024 1:50	19.67	77.64	0.04	7.36	323.13	7.76	0 Open
7/11/2024 1:40	19.63	59.75	0.03	7.34	308.46	7.81	0 Open
7/11/2024 2:10	19.62	77.47	0.04	7.35	324.13	7.72	0 Open
7/11/2024 2:00	19.53	58.81	0.03	7.33	309.19	7.83	0 Open
7/11/2024 23:50	19.5	61.42	0.03	7.36	297.42	7.96	0 Open
7/11/2024 1:00	19.49	55.61	0.03	7.31	315.13	7.95	0 Open
7/11/2024 12:10	19.45	33.86	0.01	7.33	314.72	8.22	0 Open
7/11/2024 2:20	19.41	59.28	0.03	7.33	309.1	7.86	0 Open
7/11/2024 23:40	19.34	84.89	0.04	7.41	317.43	7.76	0 Open
7/11/2024 2:40	19.33	57.4	0.03	7.35	309.21	7.89	0 Open
7/11/2024 2:30	19.32	72.8	0.03	7.35	324.39	7.92	0 Open
7/11/2024 23:30	19.32	58.29	0.03	7.36	310.42	8.03	0 Open
7/11/2024 3:30	19.29	75.57	0.03	7.34	323.8	7.87	0 Open
7/11/2024 23:00	19.27	81.18	0.04	7.45	314.12	7.76	0 Open
7/11/2024 0:40	19.25	52.18	0.02	7.32	318.67	8.04	0 Open
7/11/2024 3:00	19.25	58.38	0.03	7.33	310.61	7.86	0 Open
7/11/2024 11:00	19.23	49.68	0.02	7.39	316.9	8.08	0 Open
7/11/2024 2:50	19.21	70.12	0.03	7.32	326.13	7.99	0 Open
7/11/2024 23:20	19.21	81.28	0.04	7.45	315.74	7.78	0 Open
7/11/2024 23:10	19.2	56.31	0.03	7.33	310.87	8.05	0 Open

7/11/2024 5:10	19.15	77.16	0.04	7.39	318.42	7.64	0	Open
7/11/2024 13:10	20.62	39.9	0.02	7.34	311.44	7.94	0	Closed
7/11/2024 18:50	20.39	0.06	0	6.55	314.02	8.19	0	Closed
7/11/2024 19:00	20.37	0.06	0	6.78	320.9	8.19	0	Closed
7/11/2024 16:20	20.34	0.06	0	6.97	303.16	8.22	0	Closed
7/11/2024 18:40	20.33	0.06	0	6.71	317.09	8.21	0	Closed
7/11/2024 3:20	19.11	55.13	0.02	7.35	308.74	7.92	0	Open
7/11/2024 11:50	19.11	56.72	0.03	7.4	315.94	8.12	0	Open
7/11/2024 3:40	19.1	56.05	0.03	7.34	308.69	7.91	0	Open
7/11/2024 0:20	19.08	49.76	0.02	7.32	321.57	8.1	0	Open
7/11/2024 19:10	20.29	0.06	0	6.55	316.8	8.21	0	Closed
7/11/2024 18:30	20.26	0.06	0	6.72	307.56	8.22	0	Closed
7/11/2024 3:50	19.08	71.8	0.03	7.32	323.51	7.94	0	Open
7/11/2024 3:10	19.07	69.23	0.03	7.32	325.28	8.04	0	Open
7/11/2024 11:30	19.05	36.31	0.02	7.32	315.57	8.26	0	Open
7/11/2024 0:00	19.03	49.49	0.02	7.29	328.2	8.13	0	Open
7/11/2024 15:20	20.24	30.11	0.01	7.29	314.67	8.07	0	Closed
7/11/2024 15:30	20.24	29.24	0.01	7.31	316.03	8.08	0	Closed
7/11/2024 15:10	20.23	29.3	0.01	7.33	316.48	8.05	0	Closed
7/11/2024 22:20	19.02	71.53	0.03	7.44	321.55	7.92	0.59	Open
7/11/2024 4:10	19.01	71.77	0.03	7.33	323.47	7.9	0	Open
7/11/2024 22:50	19	54.23	0.02	7.33	310.43	8.1	0	Open
7/11/2024 4:00	18.99	55.9	0.03	7.32	308.77	7.94	0	Open
7/11/2024 15:00	20.22	30.18	0.01	7.29	314.33	8.05	0	Closed
7/11/2024 15:40	20.22	30.07	0.01	7.31	314.43	8.11	0	Closed
7/11/2024 22:40	18.95	75.19	0.03	7.45	317.66	7.95	0	Open
7/11/2024 4:20	18.93	54.88	0.02	7.33	309.22	7.95	0	Open
7/11/2024 22:30	18.87	51.47	0.02	7.34	312.93	8.15	0	Open
7/11/2024 13:20	20.2	33.92	0.01	7.36	310.25	8.05	0	Closed
7/11/2024 14:50	20.2	29.41	0.01	7.34	317.59	8.04	0	Closed
7/11/2024 15:50	20.2	29.16	0.01	7.27	320.26	8.14	0	Closed
7/11/2024 17:30	20.2	0.06	0	6.85	310.79	8.23	0	Closed
7/11/2024 18:20	20.19	0.06	0	7.12	312.38	8.22	0	Closed
7/11/2024 4:40	18.8	54.78	0.02	7.33	310.02	7.96	0	Open
7/11/2024 11:40	18.79	33.01	0.01	7.32	306.02	8.33	0	Open
7/11/2024 8:40	18.78	82.64	0.04	7.43	325.16	7.7	0	Open
7/11/2024 7:00	18.77	83.06	0.04	7.37	315.72	7.51	0	Open
7/11/2024 9:00	18.74	79.76	0.04	7.42	325.22	7.77	0	Open
7/11/2024 4:30	18.72	63.51	0.03	7.29	325.25	8.07	0	Open
7/11/2024 5:00	18.69	53.68	0.02	7.32	310.49	7.98	0	Open
7/11/2024 4:50	18.6	62.66	0.03	7.32	324.6	8.13	0	Open
7/11/2024 8:00	18.59	81.72	0.04	7.4	328.12	7.71	0	Open
7/11/2024 5:20	18.58	51.98	0.02	7.33	307.57	8.06	0	Open
7/11/2024 22:10	18.55	47.06	0.02	7.34	323.43	8.22	0	Open
7/11/2024 11:10	18.53	35.57	0.02	7.32	321.45	8.37	0	Open
7/11/2024 8:50	18.44	46.61	0.02	7.36	317.38	8.23	0	Open
7/11/2024 16:00	20.18	29.27	0.01	7.14	324.68	8.23	0	Closed

7/11/2024 14:40	20.17	30.21	0.01	7.28	315.35	8.04	0	Closed
7/11/2024 16:10	20.17	18.28	0.01	6.9	318.59	8.26	0	Closed
7/11/2024 14:30	20.15	29.55	0.01	7.35	315.19	8.04	0	Closed
7/11/2024 14:20	20.12	30.32	0.01	7.27	316.9	8.05	0	Closed
7/11/2024 16:30	20.12	21.37	0.01	6.68	323.26	8.29	0.63	Closed
7/11/2024 14:10	20.1	29.66	0.01	7.34	316.63	8.06	0	Closed
7/11/2024 14:00	20.07	30.64	0.01	7.32	315.9	8.05	0	Closed
7/11/2024 13:30	20.05	31.04	0.01	7.28	314.51	8.08	0	Closed
7/11/2024 19:20	20.05	0.06	0	6.21	326.6	8.25	0	Closed
7/11/2024 13:50	20.04	30.12	0.01	7.28	318.06	8.07	0	Closed
7/11/2024 19:30	20.04	0.06	0	6.28	316.79	8.25	0	Closed
7/11/2024 13:40	20.03	31.43	0.01	7.3	314.42	8.07	0.46	Closed
7/11/2024 16:40	20.02	30.18	0.01	7.26	334.22	8.22	0	Closed
7/11/2024 18:10	20.02	0.06	0	7.33	312.96	8.26	0	Closed
7/11/2024 17:20	19.97	0.06	0	7.04	321.6	8.28	0	Closed
7/11/2024 16:50	19.95	30.1	0.01	7.4	325.67	8.24	0	Closed
7/11/2024 17:00	19.9	29.39	0.01	7.47	317.52	8.28	0	Closed
7/11/2024 17:10	19.83	20.22	0.01	7.11	322.45	8.31	0	Closed
7/11/2024 20:00	19.82	0.06	0	6.18	328.35	8.27	0	Closed
7/11/2024 19:40	19.81	0.06	0	6.35	331.81	8.28	0	Closed
7/11/2024 18:00	19.8	0.06	0	7.57	245.24	8.32	0	Closed
7/11/2024 19:50	19.79	0.06	0	6.21	320.57	8.27	0	Closed
7/11/2024 20:10	19.63	0.06	0	5.95	334.7	8.28	0	Closed
7/11/2024 20:30	19.6	0.06	0	6.34	334.25	8.3	0	Closed
7/11/2024 20:20	19.54	0.06	0	6.37	331.89	8.32	0	Closed
7/11/2024 17:40	19.53	21.45	0.01	7.26	324.24	8.38	0	Closed
7/11/2024 17:50	19.5	6.67	0	7.35	315.65	8.37	0.25	Closed
7/11/2024 20:40	19.45	0.06	0	6.44	336.57	8.32	0	Closed
7/11/2024 21:00	19.41	0.06	0	6.05	333.61	8.34	0	Closed
7/11/2024 21:10	19.37	0.06	0	6.01	332.28	8.35	0	Closed
7/11/2024 20:50	19.36	0.06	0	6.2	337.87	8.35	0	Closed
7/11/2024 21:20	19.22	0.06	0	6.04	335.88	8.37	0	Closed
7/11/2024 21:30	19.19	0.06	0	6.17	334.42	8.38	0	Closed
7/11/2024 10:30	19	48.78	0.02	7.38	318.91	8.12	0	Closed
7/11/2024 8:20	18.69	81.5	0.04	7.4	327.07	7.7	0	Closed
7/11/2024 9:30	18.69	48.84	0.02	7.4	316.66	8.18	0	Closed
7/11/2024 10:10	18.5	44.98	0.02	7.35	323.92	8.29	0	Closed
7/11/2024 7:10	18.44	48.48	0.02	7.32	307.54	8.15	0	Closed
7/11/2024 7:20	18.42	78.2	0.04	7.36	322.62	7.81	0	Closed
7/11/2024 8:30	18.31	47.15	0.02	7.36	317.95	8.24	0	Closed
7/11/2024 8:10	18.28	47.31	0.02	7.35	319.05	8.24	0	Closed
7/11/2024 9:20	18.27	71.55	0.03	7.39	328.09	8.06	0	Closed
7/11/2024 10:40	18.2	37.15	0.02	7.27	325.19	8.42	0	Closed
7/11/2024 10:20	18.13	52.21	0.02	7.31	328.11	8.36	0	Closed
7/11/2024 10:50	18.09	45.08	0.02	7.32	326.95	8.37	0	Closed
7/11/2024 21:40	17.8	31.87	0.01	7.22	316.37	8.67	0.38	Closed
7/11/2024 21:50	17.7	31.95	0.01	7.32	322.89	8.55	0	Closed

7/11/2024 5:40	17.24	36.69	0.02	7.24	330.35	8.58	0	Closed
7/11/2024 5:50	16.88	33.23	0.01	7.25	334.93	8.66	0	Closed
7/11/2024 6:00	16.59	32.91	0.01	7.25	337.03	8.74	0	Closed
7/11/2024 6:10	16.36	30.92	0.01	7.23	340.95	8.78	0	Closed
7/11/2024 6:20	16.24	31.32	0.01	7.24	342.12	8.8	0	Closed
7/11/2024 9:10	18.44	45.45	0.02	7.36	317.69	8.27	0	Open
7/11/2024 7:30	18.36	47.54	0.02	7.34	313.94	8.19	0	Open
7/11/2024 9:40	18.33	69.71	0.03	7.39	328.3	8.04	0	Open
7/11/2024 9:50	18.17	39.59	0.02	7.33	322.87	8.41	0	Open
7/11/2024 6:50	18.09	47.68	0.02	7.33	292.73	8.15	0	Open
7/11/2024 10:00	17.91	56.29	0.03	7.37	329.36	8.36	0	Open
7/11/2024 7:50	17.9	45.37	0.02	7.33	321.14	8.28	0	Open
7/11/2024 22:00	17.6	35.71	0.02	7.22	333.33	8.46	9.94	Open
7/11/2024 5:30	17.57	40.32	0.02	7.3	322	8.47	0	Open
7/11/2024 6:40	17.49	80.91	0.04	7.36	344.15	7.74	0	Open
7/11/2024 7:40	17.14	35.85	0.02	7.25	326.9	8.65	0	Open
7/11/2024 6:30	16.14	30.19	0.01	7.24	344.64	8.82	0	Open
7/12/2024 13:00	21.53	84.47	0.04	7.5	288.38	7.44	0	Open
7/12/2024 13:10	20.92	47.16	0.02	7.41	289.98	7.85	0	Open
7/12/2024 21:30	20.6	87.98	0.04	7.5	302.04	7.58	0	Open
7/12/2024 12:40	20.54	67.71	0.03	7.45	296.22	7.8	0	Open
7/12/2024 12:50	20.53	43.8	0.02	7.37	290.93	7.92	0	Open
7/12/2024 12:10	20.5	55.62	0.03	7.39	296.08	7.87	0	Open
7/12/2024 13:20	20.44	36.55	0.02	7.29	301.74	8.01	0	Open
7/12/2024 21:00	20.42	92.51	0.04	7.44	315.58	7.63	0.24	Open
7/12/2024 22:10	20.38	90.88	0.04	7.52	274.77	7.68	0	Open
7/12/2024 12:30	20.3	44.98	0.02	7.39	291.91	7.96	0	Open
7/12/2024 23:30	20.28	96.98	0.05	7.56	274.99	7.65	23.24	Open
7/12/2024 12:00	20.27	72.74	0.03	7.49	297.18	7.8	0	Open
7/12/2024 11:50	20.23	55.76	0.03	7.41	287.75	7.91	0	Open
7/12/2024 12:20	20.15	64.12	0.03	7.47	297.15	7.92	0	Open
7/12/2024 11:40	20.05	76.39	0.04	7.48	295.97	7.83	0	Open
7/12/2024 4:50	20.01	94.71	0.04	7.49	302.1	7.23	0	Open
7/12/2024 11:30	19.98	57.52	0.03	7.39	299.07	7.96	0	Open
7/12/2024 0:30	19.93	70.87	0.03	7.4	292.53	7.72	0	Open
7/12/2024 0:50	19.91	71.7	0.03	7.4	297.48	7.71	0	Open
7/12/2024 21:10	19.88	54.02	0.02	7.34	274.49	7.97	0	Open
7/12/2024 21:40	19.88	56.43	0.03	7.34	297.16	7.99	0	Open
7/12/2024 1:10	19.87	70.32	0.03	7.41	298.43	7.72	0	Open
7/12/2024 1:30	19.84	71.55	0.03	7.4	300.06	7.73	0	Open
7/12/2024 22:20	19.82	57.79	0.03	7.35	289	7.99	0	Open
7/12/2024 1:50	19.78	72.26	0.03	7.41	300.23	7.75	0	Open
7/12/2024 0:10	19.76	66.39	0.03	7.37	304.19	7.83	0	Open
7/12/2024 2:10	19.66	69.82	0.03	7.41	292.29	7.77	0	Open
7/12/2024 2:30	19.65	70.28	0.03	7.41	298.83	7.74	0	Open
7/12/2024 4:30	19.65	85.77	0.04	7.49	302.07	7.39	0	Open
7/12/2024 11:10	19.64	58.71	0.03	7.43	300.1	8.01	0	Open

7/12/2024 11:20	19.64	76.55	0.04	7.51	303.66	7.87	0	Open
7/12/2024 2:50	19.58	70.02	0.03	7.4	299.27	7.77	0	Open
7/12/2024 16:20	21.86	0.06	0	6.55	323.15	7.9	0	Closed
7/12/2024 16:10	21.85	0.06	0	6.18	321.05	7.9	0	Closed
7/12/2024 16:30	21.79	0.06	0	6.32	328.73	7.93	0	Closed
7/12/2024 16:40	21.79	0.06	0	6.26	327.87	7.91	0	Closed
7/12/2024 16:00	21.77	0.06	0	6.26	316.61	7.93	0	Closed
7/12/2024 16:50	21.76	0.06	0	6.4	326.8	7.93	0	Closed
7/12/2024 17:10	21.75	0.06	0	6.45	327.49	7.93	0	Closed
7/12/2024 3:10	19.49	69.83	0.03	7.42	299.97	7.77	0	Open
7/12/2024 4:10	19.47	77.24	0.04	7.44	304.06	7.6	0	Open
7/12/2024 1:00	19.37	83.61	0.04	7.44	309.71	7.71	0	Open
7/12/2024 10:50	19.37	59.15	0.03	7.41	303.94	8.04	0	Open
7/12/2024 3:30	19.34	68.54	0.03	7.4	304.35	7.82	0	Open
7/12/2024 11:00	19.27	74.95	0.03	7.51	310.65	7.9	0	Open
7/12/2024 23:40	19.26	52.82	0.02	7.37	293.4	8.11	0	Open
7/12/2024 3:50	19.24	67.87	0.03	7.42	304.96	7.84	0	Open
7/12/2024 5:10	19.24	69.32	0.03	7.4	298.51	7.78	0	Open
7/12/2024 0:00	19.23	81.21	0.04	7.45	310.79	7.78	0	Open
7/12/2024 0:20	19.15	79.33	0.04	7.41	315.29	7.83	0	Open
7/12/2024 1:20	19.11	80.71	0.04	7.42	310.38	7.8	0	Open
7/12/2024 1:40	19.11	76.89	0.04	7.44	312.06	7.82	0	Open
7/12/2024 0:40	19.09	76.26	0.04	7.43	308.13	7.88	0	Open
7/12/2024 10:10	19.05	64.5	0.03	7.43	300.42	8.03	0	Open
7/12/2024 21:50	19.04	42.34	0.02	7.4	302.29	8.35	0	Open
7/12/2024 21:20	19.02	40.64	0.02	7.31	304.74	8.32	0	Open
7/12/2024 5:00	19	83.1	0.04	7.42	313.65	7.81	0	Open
7/12/2024 10:30	18.99	55.48	0.03	7.4	302.83	8.13	0	Open
7/12/2024 2:20	18.96	77.54	0.04	7.44	308.81	7.81	0	Open
7/12/2024 2:00	18.92	77.79	0.04	7.4	312.49	7.91	0	Open
7/12/2024 2:40	18.86	77.82	0.04	7.42	311.24	7.86	0	Open
7/12/2024 10:40	18.79	72.99	0.03	7.48	312.84	8.06	0	Open
7/12/2024 3:00	18.78	76.15	0.04	7.42	312	7.93	0	Open
7/12/2024 22:00	18.65	39.37	0.02	7.59	301.52	8.44	0	Open
7/12/2024 10:20	18.57	70.14	0.03	7.47	312.24	8.09	0	Open
7/12/2024 4:40	18.55	76.35	0.04	7.42	314.71	7.98	0	Open
7/12/2024 4:00	18.47	76.5	0.04	7.43	315.56	7.98	0	Open
7/12/2024 9:40	18.47	78.23	0.04	7.44	315.13	7.99	0	Open
7/12/2024 4:20	18.46	77.34	0.04	7.4	315.78	8.01	0	Open
7/12/2024 9:50	18.43	55.06	0.02	7.35	301.39	8.25	0	Open
7/12/2024 23:50	18.43	39.94	0.02	7.39	306.31	8.47	23.95	Open
7/12/2024 3:20	18.4	66.27	0.03	7.37	312.89	8.14	0	Open
7/12/2024 3:40	18.24	62.9	0.03	7.4	314.44	8.21	0	Open
7/12/2024 9:30	18.17	55.17	0.03	7.33	308.78	8.29	0	Open
7/12/2024 8:20	18.13	78.98	0.04	7.54	313.99	7.91	0	Open
7/12/2024 10:00	18.12	71.18	0.03	7.41	313.89	8.22	0	Open
7/12/2024 20:40	18.12	31.01	0.01	6.77	311.16	8.58	0	Open

7/12/2024 20:50	18.05	30.82	0.01	6.74	311.9	8.6	0 Open
7/12/2024 9:10	18.03	56.96	0.03	7.36	309.92	8.31	0 Open
7/12/2024 8:40	17.92	75.36	0.03	7.51	315.66	8.05	0 Open
7/12/2024 7:50	17.84	53.71	0.02	7.38	305.42	8.33	0 Open
7/12/2024 17:00	21.73	0.06	0	7.09	327.9	7.94	0 Closed
7/12/2024 17:20	21.73	0.06	0	6.64	327.98	7.94	0 Closed
7/12/2024 15:50	21.7	0.06	0	6.33	313.69	7.94	0 Closed
7/12/2024 17:30	21.64	0.06	0	6.56	325.93	7.94	0 Closed
7/12/2024 15:40	21.46	0.06	0	6.2	312.93	7.97	0 Closed
7/12/2024 15:30	21.17	0.06	0	6.83	311.49	8.04	0 Closed
7/12/2024 14:40	21.13	0.06	0	6.46	318.81	8.05	0 Closed
7/12/2024 15:20	20.58	0.06	0	7.37	305.65	8.18	4.66 Closed
7/12/2024 17:40	20.57	4.75	0	7.41	284.46	8.21	6.31 Closed
7/12/2024 15:10	20.43	21.19	0.01	7.3	317.57	8.18	0 Closed
7/12/2024 14:30	20.41	5.55	0	6.92	303.69	8.21	4.16 Closed
7/12/2024 15:00	20.41	30.69	0.01	7.51	314.8	8.15	0 Closed
7/12/2024 14:50	20.38	25.25	0.01	6.36	323.17	8.23	0 Closed
7/12/2024 14:20	20.29	27.94	0.01	7.28	312.49	8.23	0 Closed
7/12/2024 13:30	20.27	34.08	0.01	7.23	302.12	8.06	0 Closed
7/12/2024 14:10	20.23	31.09	0.01	7.19	317.39	8.17	0 Closed
7/12/2024 13:50	20.2	20.7	0.01	6.89	314.52	8.25	0 Closed
7/12/2024 13:40	20.19	32.36	0.01	7.04	323.47	8.2	0 Closed
7/12/2024 14:00	20.18	24.35	0.01	7.31	321.96	8.26	0 Closed
7/12/2024 17:50	19.83	29.49	0.01	7.02	321.6	8.29	0 Closed
7/12/2024 18:00	19.72	30.69	0.01	7.55	305.56	8.3	0 Closed
7/12/2024 18:10	19.59	30.71	0.01	7.47	301.53	8.31	0 Closed
7/12/2024 18:20	19.46	30.38	0.01	7.19	299.65	8.32	0 Closed
7/12/2024 18:30	19.35	29.87	0.01	7.28	299.91	8.36	0 Closed
7/12/2024 18:40	19.22	30.66	0.01	7.71	301.01	8.38	0 Closed
7/12/2024 18:50	19.11	30.4	0.01	7.58	290.68	8.38	0.19 Closed
7/12/2024 19:00	19	30.97	0.01	7.85	299.28	8.42	0 Closed
7/12/2024 19:10	18.89	30.71	0.01	7.55	300.74	8.43	0 Closed
7/12/2024 22:30	18.85	39.98	0.02	7.49	294.87	8.4	0 Closed
7/12/2024 19:20	18.77	29.39	0.01	7.06	299.63	8.43	0 Closed
7/12/2024 19:30	18.69	30.5	0.01	7.4	302.05	8.46	0 Closed
7/12/2024 19:40	18.59	31.02	0.01	7.91	297.84	8.48	0 Closed
7/12/2024 19:50	18.51	30.73	0.01	7.65	300.86	8.5	0 Closed
7/12/2024 22:40	18.43	36.6	0.02	7.33	307.1	8.52	0 Closed
7/12/2024 20:00	18.41	30.95	0.01	7.68	299.57	8.51	0 Closed
7/12/2024 20:10	18.33	30.92	0.01	7.02	297.97	8.53	0 Closed
7/12/2024 20:20	18.26	30.94	0.01	6.78	305.41	8.55	0 Closed
7/12/2024 20:30	18.19	30.8	0.01	6.77	306.58	8.56	0 Closed
7/12/2024 22:50	18.15	35.14	0.02	7.29	309.07	8.56	14.87 Closed
7/12/2024 23:00	17.95	34	0.01	7.32	316.7	8.61	0.25 Closed
7/12/2024 5:20	17.81	43.03	0.02	7.28	313.98	8.45	0 Closed
7/12/2024 23:10	17.78	33.48	0.01	7.39	320.77	8.63	22.22 Closed
7/12/2024 23:20	17.62	36.7	0.02	7.38	330.33	8.51	0 Closed

7/12/2024 7:30	17.79	55.68	0.03	7.41	310.26	8.31	0	Open
7/12/2024 9:00	17.78	88.59	0.04	7.47	318.4	8.12	0	Open
7/12/2024 8:10	17.72	53.06	0.02	7.38	310.24	8.37	0	Open
7/12/2024 7:10	17.68	51.48	0.02	7.36	306.72	8.35	0	Open
7/12/2024 8:50	17.68	53.78	0.02	7.38	310.42	8.43	0	Open
7/12/2024 7:20	17.6	78.24	0.04	7.48	316.04	8.01	0	Open
7/12/2024 7:40	17.58	74.61	0.03	7.48	317.92	8.11	0	Open
7/12/2024 8:30	17.39	43.48	0.02	7.38	309.18	8.53	0	Open
7/12/2024 7:00	17.34	77.2	0.04	7.47	309.51	8.07	0	Open
7/12/2024 6:50	17.29	57.36	0.03	7.4	300.02	8.26	0	Open
7/12/2024 9:20	17.26	55.73	0.03	7.31	321.88	8.52	0	Open
7/12/2024 5:30	17.18	37.8	0.02	7.28	321.38	8.58	0	Closed
7/12/2024 5:40	16.8	35.51	0.02	7.2	330.95	8.68	0	Closed
7/12/2024 5:50	16.54	34.39	0.01	7.3	325.34	8.72	0	Closed
7/12/2024 6:00	16.37	33.15	0.01	7.22	332.64	8.75	0	Closed
7/12/2024 6:10	16.24	33.2	0.01	7.29	330.54	8.78	0	Closed
7/12/2024 6:20	16.14	32.7	0.01	7.2	337.45	8.8	0	Closed
7/12/2024 8:00	17.2	67.71	0.03	7.44	318.74	8.36	0	Open
7/12/2024 6:30	16.07	32.56	0.01	7.29	330.7	8.82	0	Open
7/12/2024 6:40	16	32.41	0.01	7.26	335.18	8.83	0	Open
7/13/2024 12:30	20.99	54.82	0.02	7.42	292.69	7.8	21.18	Closed
7/13/2024 15:30	20.7	30.34	0.01	7.26	340.54	8.12	4.35	Closed
7/13/2024 15:10	20.69	30.63	0.01	7.2	335.16	8.1	5.39	Closed
7/13/2024 15:20	20.69	30.26	0.01	7.15	339.62	8.12	0	Closed
7/13/2024 15:40	20.69	29.66	0.01	7.04	338.57	8.12	0	Closed
7/13/2024 15:40	20.69	29.66	0.01	7.04	338.57	8.12	0	Closed
7/13/2024 15:50	20.67	29.47	0.01	6.78	338.79	8.13	6.33	Closed
7/13/2024 15:00	20.66	30.56	0.01	7.15	332.2	8.12	0	Closed
7/13/2024 16:00	20.65	29.07	0.01	6.63	339.74	8.14	0	Closed
7/13/2024 14:50	20.64	30.72	0.01	7.15	332.61	8.11	5.44	Closed
7/13/2024 16:10	20.63	28.51	0.01	7.22	339.85	8.14	0	Closed
7/13/2024 14:40	20.61	30.6	0.01	7.22	332.61	8.11	0	Closed
7/13/2024 16:20	20.59	26.24	0.01	6.89	338.28	8.15	0	Closed
7/13/2024 14:30	20.58	30.91	0.01	7.21	331.97	8.1	8.66	Closed
7/13/2024 16:30	20.54	25.83	0.01	7.22	334.82	8.15	0	Closed
7/13/2024 14:20	20.53	30.77	0.01	7.21	328.27	8.1	0	Closed
7/13/2024 16:40	20.51	23.33	0.01	6.83	340.22	8.16	0	Closed
7/13/2024 14:10	20.49	31.07	0.01	7.29	322.34	8.1	13.34	Closed
7/13/2024 16:50	20.46	23.69	0.01	6.89	331.9	8.17	0	Closed
7/13/2024 14:00	20.43	30.92	0.01	7.3	318.15	8.1	0	Closed
7/13/2024 12:40	20.41	37.76	0.02	7.29	299.88	7.99	0	Closed
7/13/2024 17:00	20.38	22.12	0.01	7.5	330.05	8.19	0	Closed
7/13/2024 13:50	20.35	31.19	0.01	7.27	318.56	8.1	17.74	Closed
7/13/2024 17:10	20.31	20.92	0.01	7.35	330.2	8.21	24.58	Closed
7/13/2024 13:40	20.26	31.12	0.01	7.21	316.63	8.1	0	Closed
7/13/2024 13:30	20.2	31.27	0.01	7.22	314.61	8.09	6.97	Closed
7/13/2024 17:20	20.2	23.2	0.01	6.98	335.38	8.22	0	Closed

7/13/2024 12:50	20.17	33.71	0.01	7.26	302.82	8.05	14.56	Closed
7/13/2024 13:20	20.15	31.43	0.01	7.21	312.58	8.09	0	Closed
7/13/2024 13:10	20.1	31.89	0.01	7.23	309.4	8.08	7.35	Closed
7/13/2024 17:30	20.1	19.79	0.01	6.89	326	8.23	0	Closed
7/13/2024 13:00	20.09	32.24	0.01	7.23	305.77	8.08	0	Closed
7/13/2024 17:40	20	20.98	0.01	6.7	334.93	8.26	0	Closed
7/13/2024 17:50	19.89	21.23	0.01	6.45	337.52	8.28	0	Closed
7/13/2024 18:00	19.78	20.57	0.01	6.49	338.84	8.3	0	Closed
7/13/2024 18:10	19.68	20.49	0.01	6.54	325.5	8.32	0	Closed
7/13/2024 18:20	19.57	20.1	0.01	6.5	339.57	8.34	4.6	Closed
7/13/2024 18:30	19.47	18.18	0.01	6.82	328.86	8.35	0	Closed
7/13/2024 18:40	19.36	16.77	0.01	6.59	339.83	8.38	12.26	Closed
7/13/2024 18:50	19.27	16.3	0.01	7.25	326.39	8.36	0	Closed
7/13/2024 19:00	19.18	17.45	0.01	7.03	340.14	8.4	0	Closed
7/13/2024 20:30	21.65	88.29	0.04	7.45	316.89	7.37	0.17	Open
7/13/2024 23:10	20.93	95.14	0.04	7.49	299.82	7.59	0	Open
7/13/2024 21:20	20.9	104.13	0.05	7.43	307.63	7.33	0.5	Open
7/13/2024 23:50	20.88	91.27	0.04	7.48	305.98	7.61	0	Open
7/13/2024 10:50	20.85	104.11	0.05	7.51	305.29	7.96	12.96	Open
7/13/2024 22:10	20.79	105.9	0.05	7.53	293.37	7.53	0.02	Open
7/13/2024 23:30	20.78	92.72	0.04	7.48	302.21	7.63	0	Open
7/13/2024 22:50	20.76	89.59	0.04	7.48	297.07	7.64	1.05	Open
7/13/2024 21:10	20.7	88.69	0.04	7.43	299.05	7.5	0	Open
7/13/2024 22:20	20.63	81.84	0.04	7.44	296.76	7.69	0	Open
7/13/2024 22:00	20.53	80.56	0.04	7.41	292.81	7.7	0	Open
7/13/2024 22:00	20.53	80.56	0.04	7.41	292.81	7.7	0	Open
7/13/2024 12:10	20.37	45.15	0.02	7.35	306.88	7.98	12.39	Open
7/13/2024 23:20	20.34	97.6	0.05	7.55	308.74	7.73	0	Open
7/13/2024 11:50	20.33	49.54	0.02	7.33	301.07	7.96	16.61	Open
7/13/2024 22:40	20.33	98.22	0.05	7.55	310.79	7.73	0	Open
7/13/2024 11:40	20.27	73.64	0.03	7.46	303.26	7.92	0	Open
7/13/2024 20:40	20.24	73.53	0.03	7.39	320.48	7.82	0	Open
7/13/2024 23:00	20.24	95.37	0.04	7.54	308.03	7.75	0	Open
7/13/2024 11:00	20.21	90.83	0.04	7.5	308.83	7.83	2.24	Open
7/13/2024 12:00	20.16	64.61	0.03	7.4	305.81	8.01	0	Open
7/13/2024 21:50	20.14	97.37	0.05	7.52	301.71	7.71	0	Open
7/13/2024 10:30	20.1	89.96	0.04	7.44	306.91	7.78	7.98	Open
7/13/2024 11:10	20.09	57.85	0.03	7.35	305.97	7.98	17.02	Open
7/13/2024 11:30	20	50.59	0.02	7.36	310.77	8.02	16.95	Open
7/13/2024 12:20	19.99	35.48	0.02	7.37	299.68	8.08	0	Open
7/13/2024 11:20	19.83	71.49	0.03	7.43	309.69	8	0	Open
7/13/2024 23:40	19.81	87.58	0.04	7.53	313.1	7.92	0	Open
7/13/2024 20:50	19.72	30.21	0.01	7.32	316.74	8.29	0	Open
7/13/2024 21:30	19.66	40.25	0.02	7.56	313.8	8.29	0	Open
7/13/2024 22:30	19.62	33.59	0.01	7.35	303.3	8.31	0	Open
7/13/2024 10:40	19.6	93.99	0.04	7.45	315.28	7.91	0.71	Open
7/13/2024 10:10	19.52	73.84	0.03	7.36	309.65	7.96	8.38	Open

7/13/2024 21:00	19.31	27.19	0.01	7.01	321.39	8.39	0	Open
7/13/2024 19:10	19.1	8.95	0	7.33	327.72	8.43	0	Closed
7/13/2024 19:20	19.01	8.95	0	7.6	317.15	8.43	0	Closed
7/13/2024 19:30	18.93	23.04	0.01	7.24	330.92	8.45	0	Closed
7/13/2024 19:40	18.84	8.12	0	7.7	315.17	8.46	0	Closed
7/13/2024 19:50	18.79	8.41	0	7.39	327.81	8.47	0	Closed
7/13/2024 20:00	18.7	6.79	0	7.68	319.96	8.5	0	Closed
7/13/2024 20:10	18.62	8.72	0	7.42	326.36	8.5	0	Closed
7/13/2024 20:20	18.54	8.32	0	7.61	322.17	8.52	0	Closed
7/13/2024 0:00	18.06	37.67	0.02	7.39	315.26	8.54	0	Closed
7/13/2024 0:10	17.77	35.47	0.02	7.35	320.59	8.61	23.75	Closed
7/13/2024 0:20	17.58	34.13	0.01	7.42	324.02	8.65	0	Closed
7/13/2024 0:30	17.44	33.52	0.01	7.38	328.22	8.68	22.01	Closed
7/13/2024 0:40	17.34	33.18	0.01	7.46	328.97	8.69	0	Closed
7/13/2024 0:50	17.26	33.13	0.01	7.48	330.49	8.7	23.67	Closed
7/13/2024 1:00	17.19	32.92	0.01	7.5	332.47	8.71	0	Closed
7/13/2024 1:10	17.12	32.86	0.01	7.5	333.58	8.71	20.91	Closed
7/13/2024 1:20	17.07	32.69	0.01	7.48	338.37	8.72	0	Closed
7/13/2024 1:30	17.01	32.64	0.01	7.5	337.57	8.72	18.63	Closed
7/13/2024 1:40	16.97	32.52	0.01	7.48	340.89	8.72	0	Closed
7/13/2024 1:50	16.92	32.59	0.01	7.48	341.21	8.72	17.94	Closed
7/13/2024 2:00	16.88	32.53	0.01	7.47	340.28	8.71	0	Closed
7/13/2024 2:10	16.84	32.56	0.01	7.47	339.9	8.72	17.43	Closed
7/13/2024 2:20	16.8	32.48	0.01	7.46	339.71	8.71	0	Closed
7/13/2024 2:30	16.76	32.49	0.01	7.43	341.44	8.72	17.43	Closed
7/13/2024 2:40	16.72	32.4	0.01	7.42	341.67	8.71	0	Closed
7/13/2024 2:50	16.68	32.4	0.01	7.42	342.46	8.73	19.55	Closed
7/13/2024 3:00	16.64	32.31	0.01	7.41	342.72	8.72	0	Closed
7/13/2024 3:10	16.61	32.33	0.01	7.42	343.21	8.72	18.82	Closed
7/13/2024 3:20	16.58	32.19	0.01	7.39	344.08	8.72	0	Closed
7/13/2024 3:30	16.54	32.26	0.01	7.4	344.33	8.71	18.55	Closed
7/13/2024 3:40	16.52	32.14	0.01	7.38	344.9	8.71	0	Closed
7/13/2024 3:50	16.49	32.19	0.01	7.38	345.37	8.71	16.72	Closed
7/13/2024 4:00	16.46	32.05	0.01	7.36	346.06	8.71	0	Closed
7/13/2024 4:10	16.43	32.14	0.01	7.36	346.45	8.71	18.14	Closed
7/13/2024 4:20	16.41	32.01	0.01	7.35	347.09	8.72	0	Closed
7/13/2024 4:30	16.37	32.09	0.01	7.36	347.49	8.71	14.66	Closed
7/13/2024 4:40	16.35	31.92	0.01	7.33	348.26	8.72	0	Closed
7/13/2024 4:50	16.33	32.02	0.01	7.34	348.18	8.73	15.87	Closed
7/13/2024 5:00	16.3	31.94	0.01	7.31	348.58	8.73	0	Closed
7/13/2024 5:10	16.28	32.02	0.01	7.3	349.22	8.74	14.7	Closed
7/13/2024 5:20	16.26	31.86	0.01	7.29	349.63	8.74	0	Closed
7/13/2024 5:30	16.23	31.89	0.01	7.28	350.55	8.74	13.88	Closed
7/13/2024 5:40	16.21	31.86	0.01	7.27	350.97	8.74	0	Closed
7/13/2024 5:50	16.19	31.85	0.01	7.27	351.55	8.74	13.6	Closed
7/13/2024 6:00	16.17	31.73	0.01	7.28	351.4	8.75	0	Closed
7/13/2024 6:10	16.15	31.73	0.01	7.28	351.3	8.76	13.88	Closed

7/13/2024 6:20	16.14	31.67	0.01	7.28	351.29	8.76	0	Closed
7/13/2024 6:30	16.12	31.73	0.01	7.27	352.21	8.77	12.15	Closed
7/13/2024 6:40	16.1	31.61	0.01	7.26	351.84	8.77	0	Closed
7/13/2024 21:40	19.22	36.75	0.02	7.73	311.13	8.38	0	Open
7/13/2024 9:50	19.07	63.98	0.03	7.33	311.56	8.12	7.47	Open
7/13/2024 9:30	19.03	69.29	0.03	7.32	311.32	8.09	8.91	Open
7/13/2024 10:20	19.01	80.28	0.04	7.41	318.26	8.1	0	Open
7/13/2024 10:00	18.99	82.99	0.04	7.39	320.49	8.07	0	Open
7/13/2024 9:10	18.78	71.98	0.03	7.32	308.87	8.16	21.63	Open
7/13/2024 9:20	18.77	88.41	0.04	7.37	319.67	8.08	0	Open
7/13/2024 9:40	18.72	81.39	0.04	7.36	321.81	8.14	0	Open
7/13/2024 8:50	18.47	73.86	0.03	7.39	311.09	8.24	16.06	Open
7/13/2024 8:10	18.46	63.6	0.03	7.42	313.83	8.23	11.88	Open
7/13/2024 7:50	18.27	60.57	0.03	7.41	313.64	8.25	13.31	Open
7/13/2024 8:30	18.21	58.6	0.03	7.43	312.9	8.36	11.68	Open
7/13/2024 8:00	18.17	82.33	0.04	7.51	320.73	8.19	0	Open
7/13/2024 8:40	18.1	93.37	0.04	7.53	322.28	8.27	0	Open
7/13/2024 8:20	18.08	78.31	0.04	7.5	322.37	8.26	0	Open
7/13/2024 7:30	18.04	59.93	0.03	7.41	307.69	8.29	13.07	Open
7/13/2024 9:00	17.9	85.43	0.04	7.4	323.18	8.38	0	Open
7/13/2024 7:40	17.71	73.26	0.03	7.49	319.85	8.37	0	Open
7/13/2024 7:20	17.5	78.37	0.04	7.49	311.58	8.36	0.05	Open
7/13/2024 7:10	17.33	60.37	0.03	7.38	285.78	8.38	19.44	Open
7/13/2024 7:00	16.47	73	0.03	7.45	349.12	8.54	0.29	Open
7/13/2024 6:50	16.08	31.7	0.01	7.26	352.53	8.78	12.63	Open
7/14/2024 20:30	22.17	124.53	0.06	7.53	279.63	7.02	0.16	Open
7/14/2024 1:20	21.53	123.98	0.06	7.59	307.31	7.13	0	Open
7/14/2024 20:20	21.16	93.98	0.04	7.63	272.58	7.52	0.41	Open
7/14/2024 12:20	20.95	62.53	0.03	7.5	312.63	7.79	0	Open
7/14/2024 0:10	20.85	97.61	0.05	7.5	307.38	7.54	0	Open
7/14/2024 1:30	20.85	85.58	0.04	7.46	304.94	7.59	0	Open
7/14/2024 11:50	20.84	86.25	0.04	7.59	313.31	7.71	0	Open
7/14/2024 0:30	20.76	89.71	0.04	7.49	306.2	7.62	0	Open
7/14/2024 12:30	20.59	66.28	0.03	7.56	311.23	7.92	0	Open
7/14/2024 11:40	20.57	64.57	0.03	7.46	316.93	7.83	0	Open
7/14/2024 1:50	20.53	81.97	0.04	7.5	305.45	7.68	0	Open
7/14/2024 0:20	20.49	102.28	0.05	7.58	309.63	7.59	0	Open
7/14/2024 12:00	20.46	51.88	0.02	7.47	314.02	7.93	0	Open
7/14/2024 0:50	20.37	98.5	0.05	7.53	313.48	7.57	0	Open
7/14/2024 1:10	20.28	79.43	0.04	7.48	307.37	7.74	0	Open
7/14/2024 11:20	20.27	65.69	0.03	7.51	317.87	7.88	0	Open
7/14/2024 11:30	20.17	76.3	0.04	7.56	326.37	7.92	0	Open
7/14/2024 4:10	20.16	77.78	0.04	7.54	315.78	7.74	0	Open
7/14/2024 0:00	20.1	97.33	0.05	7.57	314.03	7.71	0	Open
7/14/2024 3:20	20.02	78.78	0.04	7.51	313.48	7.74	0	Open
7/14/2024 1:00	19.99	100.01	0.05	7.55	317.12	7.71	0.84	Open
7/14/2024 1:40	19.96	92.97	0.04	7.58	312.28	7.83	0	Open

7/14/2024 12:10	19.91	37.52	0.02	7.32	332.08	8.22	0 Open
7/14/2024 3:50	19.75	69.58	0.03	7.47	319.75	7.93	0 Open
7/14/2024 20:10	19.71	0.06	0	6.6	285.25	8.29	0 Open
7/14/2024 4:00	19.68	94.42	0.04	7.56	328.7	7.83	0 Open
7/14/2024 11:00	19.64	59.51	0.03	7.46	330.14	8.01	0 Open
7/14/2024 16:50	20.92	0.06	0	6.38	284.48	8.1	4.76 Closed
7/14/2024 16:40	20.9	0.06	0	6.38	306.2	8.11	37.51 Closed
7/14/2024 16:30	20.87	1	0	6.31	311.29	8.12	72.09 Closed
7/14/2024 17:00	20.87	0.06	0	6.39	299.05	8.11	1.28 Closed
7/14/2024 15:40	20.85	6.32	0	6.26	330.95	8.15	0 Closed
7/14/2024 15:30	20.84	7.4	0	6.3	334.29	8.14	0 Closed
7/14/2024 15:50	20.84	4.77	0	6.31	325.77	8.15	7.51 Closed
7/14/2024 16:00	20.84	4.08	0	6.17	322.56	8.12	21.75 Closed
7/14/2024 16:20	20.84	1.56	0	6.32	314.87	8.13	85.18 Closed
7/14/2024 16:10	20.82	3.73	0	6.24	317.8	8.13	75.6 Closed
7/14/2024 17:10	20.82	0.06	0	6.3	299.89	8.12	0.14 Closed
7/14/2024 15:20	20.81	9.67	0	6.32	333.48	8.14	0 Closed
7/14/2024 15:10	20.78	12.15	0	6.26	333.04	8.16	0 Closed
7/14/2024 3:40	19.62	97.43	0.05	7.58	327.82	7.78	0 Open
7/14/2024 11:10	19.62	69.95	0.03	7.55	330.87	8.01	0 Open
7/14/2024 10:40	19.39	59.9	0.03	7.47	330.64	8.06	0 Open
7/14/2024 22:00	19.28	108	0.05	7.58	293.64	7.75	0.18 Open
7/14/2024 21:40	19.27	0.06	0	6.69	287.01	8.37	0 Open
7/14/2024 10:50	19.26	71.47	0.03	7.54	336.06	8.06	0 Open
7/14/2024 10:20	19.17	59.93	0.03	7.48	332.14	8.1	0 Open
7/14/2024 10:00	19.13	60.72	0.03	7.45	333.1	8.1	0 Open
7/14/2024 21:50	19.11	0.06	0	6.59	287.19	8.41	0 Open
7/14/2024 2:00	19.03	49.6	0.02	7.28	314.28	8.39	0 Open
7/14/2024 0:40	19	50.18	0.02	7.41	312.29	8.32	0 Open
7/14/2024 9:40	18.9	59.96	0.03	7.47	333.05	8.15	0 Open
7/14/2024 9:20	18.77	58.52	0.03	7.47	332.11	8.18	0 Open
7/14/2024 9:20	18.77	58.52	0.03	7.47	332.11	8.18	0 Open
7/14/2024 10:30	18.71	66.77	0.03	7.48	337.99	8.22	0 Open
7/14/2024 9:00	18.68	59.46	0.03	7.47	332.42	8.19	0 Open
7/14/2024 4:20	18.54	46.55	0.02	7.42	328.16	8.35	0 Open
7/14/2024 2:10	18.52	44.38	0.02	7.2	323.44	8.5	0 Open
7/14/2024 8:20	18.43	59.21	0.03	7.47	331.8	8.26	0 Open
7/14/2024 9:50	18.41	66.46	0.03	7.51	338.88	8.26	0 Open
7/14/2024 3:30	18.39	47.53	0.02	7.4	328.63	8.41	0 Open
7/14/2024 3:10	18.35	90.82	0.04	7.6	344.39	8.06	0 Open
7/14/2024 8:00	18.35	59.07	0.03	7.43	334.28	8.25	0 Open
7/14/2024 8:40	18.35	57.96	0.03	7.47	333.62	8.29	0 Open
7/14/2024 8:50	18.29	76.88	0.04	7.51	340.37	8.21	0 Open
7/14/2024 2:20	18.19	37.38	0.02	6.93	326.32	8.58	0 Open
7/14/2024 10:10	18.18	46.59	0.02	7.41	338.12	8.41	0.01 Open
7/14/2024 7:40	18.11	56.3	0.03	7.46	330.68	8.31	0 Open
7/14/2024 9:10	17.97	63.09	0.03	7.47	340.49	8.4	0 Open

7/14/2024 2:30	17.86	31.79	0.01	7.02	330.07	8.64	0	Open
7/14/2024 8:30	17.84	66.37	0.03	7.46	341.84	8.39	0	Open
7/14/2024 8:10	17.82	67.94	0.03	7.49	339.79	8.38	0	Open
7/14/2024 9:30	17.72	41.45	0.02	7.32	343.83	8.5	0	Open
7/14/2024 7:30	17.64	68.58	0.03	7.52	337.98	8.33	0	Open
7/14/2024 2:40	17.59	30.39	0.01	6.83	331.66	8.69	0	Open
7/14/2024 7:50	17.59	64.69	0.03	7.46	341.19	8.44	0	Open
7/14/2024 7:20	17.43	53.88	0.02	7.45	328.2	8.43	0	Open
7/14/2024 17:20	20.77	0.06	0	6.31	300.82	8.12	0	Closed
7/14/2024 20:40	20.76	10.82	0	7.05	284.75	8.13	1.56	Closed
7/14/2024 15:00	20.75	20.12	0.01	6.27	333.48	8.16	0	Closed
7/14/2024 17:30	20.73	0.06	0	6.36	298.91	8.13	0	Closed
7/14/2024 14:50	20.7	22.1	0.01	6.27	333.16	8.16	0	Closed
7/14/2024 17:40	20.66	0.06	0	6.32	298.41	8.14	0	Closed
7/14/2024 14:40	20.65	21.09	0.01	6.27	332.34	8.18	0	Closed
7/14/2024 22:10	20.65	102.87	0.05	7.52	265.21	7.56	0	Closed
7/14/2024 12:40	20.64	44.5	0.02	7.41	313.52	7.98	0	Closed
7/14/2024 17:50	20.61	0.06	0	6.39	297.72	8.16	0	Closed
7/14/2024 14:30	20.6	20.68	0.01	6.26	332.04	8.18	0	Closed
7/14/2024 14:20	20.55	20.98	0.01	6.25	331.32	8.18	0	Closed
7/14/2024 18:00	20.55	0.06	0	6.43	297.84	8.17	0	Closed
7/14/2024 18:10	20.5	0.06	0	6.43	298.39	8.18	0	Closed
7/14/2024 18:30	20.49	0.06	0	6.38	298.5	8.16	0	Closed
7/14/2024 14:10	20.48	22.92	0.01	6.27	330.46	8.22	0	Closed
7/14/2024 18:40	20.48	0.06	0	6.47	298.66	8.17	0	Closed
7/14/2024 18:20	20.46	0.06	0	6.35	298.22	8.19	0	Closed
7/14/2024 18:50	20.45	0.06	0	6.35	299.13	8.16	0	Closed
7/14/2024 14:00	20.41	23.29	0.01	6.26	329.91	8.22	0	Closed
7/14/2024 19:00	20.37	0.06	0	6.68	297.82	8.18	0	Closed
7/14/2024 13:50	20.33	24.51	0.01	6.28	327.54	8.23	0	Closed
7/14/2024 12:50	20.3	36.23	0.02	6.88	341.59	8.23	0	Closed
7/14/2024 20:50	20.28	2.79	0	6.63	284.34	8.22	79.47	Closed
7/14/2024 19:10	20.27	0.06	0	6.74	290.65	8.2	0	Closed
7/14/2024 13:40	20.26	25.01	0.01	6.25	324.52	8.26	0	Closed
7/14/2024 13:30	20.23	26.88	0.01	6.11	327.59	8.29	0	Closed
7/14/2024 13:00	20.2	33.53	0.01	6.28	327.62	8.27	0	Closed
7/14/2024 13:20	20.17	29.25	0.01	6.06	332.33	8.28	0	Closed
7/14/2024 19:20	20.17	0.06	0	6.63	286.33	8.21	0	Closed
7/14/2024 13:10	20.16	31.36	0.01	6.09	333.18	8.29	0	Closed
7/14/2024 21:00	20.11	0.06	0	6.6	286.8	8.23	1.08	Closed
7/14/2024 19:30	20.09	0.06	0	6.64	284.89	8.23	0	Closed
7/14/2024 19:40	20.01	0.06	0	6.58	283.63	8.23	0	Closed
7/14/2024 19:50	19.92	0.06	0	6.65	283.47	8.26	0	Closed
7/14/2024 20:00	19.85	0.06	0	6.58	283.88	8.27	0	Closed
7/14/2024 21:10	19.85	0.06	0	6.59	286.85	8.28	0	Closed
7/14/2024 22:20	19.67	8.04	0	7.18	279.36	8.33	11.65	Closed
7/14/2024 21:20	19.63	0.06	0	6.58	286.15	8.31	0	Closed

7/14/2024 21:30	19.44	0.06	0	6.55	286.82	8.35	0 Closed
7/14/2024 22:30	19.36	1.29	0	7	281.16	8.37	79.1 Closed
7/14/2024 22:40	19.19	0.06	0	6.84	284.86	8.39	2.88 Closed
7/14/2024 22:50	18.98	0.06	0	6.57	286.36	8.44	0.54 Closed
7/14/2024 23:00	18.75	0.06	0	6.39	289.03	8.47	1.22 Closed
7/14/2024 23:10	18.59	0.06	0	6.62	286.7	8.51	1.12 Closed
7/14/2024 2:50	17.41	30.58	0.01	6.99	333.14	8.72	0 Open
7/14/2024 3:00	17.26	30.14	0.01	7.06	334.77	8.75	0 Open
7/14/2024 7:10	16.62	66.76	0.03	7.45	361.79	8.61	0.59 Open
7/14/2024 23:20	18.46	0.06	0	6.74	288.78	8.53	3.6 Closed
7/14/2024 23:30	18.3	0.06	0	6.87	287.41	8.54	12.33 Closed
7/14/2024 23:40	18.19	0.06	0	7	288.13	8.58	18.91 Closed
7/14/2024 23:50	18.06	0.4	0	6.81	288.55	8.61	56.24 Closed
7/14/2024 4:30	17.88	41.12	0.02	7.39	335.07	8.54	0 Closed
7/14/2024 4:40	17.44	37.62	0.02	7.39	333.76	8.7	0 Closed
7/14/2024 6:40	16.18	33.01	0.01	7.64	356.34	8.89	0 Open
7/14/2024 6:50	16.14	32.86	0.01	7.62	358.96	8.89	0 Open
7/14/2024 7:00	16.11	32.82	0.01	7.61	358.16	8.89	0 Open
7/14/2024 4:50	17.14	35.55	0.02	7.38	340.81	8.75	0 Closed
7/14/2024 5:00	16.95	34.79	0.02	7.45	343.87	8.78	0 Closed
7/14/2024 5:10	16.77	34.22	0.01	7.47	347.9	8.82	0 Closed
7/14/2024 5:20	16.66	34.01	0.01	7.55	350.32	8.84	0 Closed
7/14/2024 5:30	16.56	33.67	0.01	7.55	353.43	8.85	0 Closed
7/14/2024 5:40	16.48	33.53	0.01	7.55	354.64	8.86	0 Closed
7/14/2024 5:50	16.41	33.46	0.01	7.57	355.56	8.87	0 Closed
7/14/2024 6:00	16.35	33.33	0.01	7.6	353.79	8.88	0 Closed
7/14/2024 6:10	16.31	33.22	0.01	7.62	355.95	8.87	0 Closed
7/14/2024 6:20	16.25	33.13	0.01	7.65	354.8	8.89	0 Closed
7/14/2024 6:30	16.21	32.99	0.01	7.63	358.11	8.9	0 Closed

W LNG Upstream 2024-07-08 to 2024-07-14

Received	Temperature C	Specific Conductivity $\mu\text{S/cm}$	Salinity PSU	pH	ORP mV	Dissolved Oxygen Concentration mg/L	Turbidity NTU	Discharge Open/Closed
7/8/2024 0:00	15.82	17.61	0.01	6.97	300.27	8.75	0.43	Open
7/8/2024 0:10	15.8	17.79	0.01	7.06	296.13	8.74	0.43	Open
7/8/2024 0:20	15.77	17.59	0.01	6.97	300.65	8.75	0.43	Open
7/8/2024 0:30	15.75	17.66	0.01	7.01	299.52	8.76	0.44	Open
7/8/2024 0:40	15.73	17.57	0.01	6.98	299.6	8.79	0.41	Open
7/8/2024 0:50	15.7	17.54	0.01	6.99	299.64	8.78	0.53	Open
7/8/2024 1:00	15.67	17.55	0.01	6.96	299.27	8.79	0.4	Open
7/8/2024 1:10	15.65	17.74	0.01	7.04	297.13	8.8	0.41	Open
7/8/2024 1:20	15.62	17.57	0.01	6.95	300.06	8.79	0.43	Open
7/8/2024 1:30	15.6	17.54	0.01	7.01	299.06	8.79	0.42	Open
7/8/2024 1:40	15.57	17.49	0.01	6.96	299.24	8.81	0.43	Open
7/8/2024 1:50	15.55	17.47	0.01	7.04	296.33	8.81	0.39	Open
7/8/2024 1:50	15.55	17.47	0.01	7.04	296.33	8.81	0.39	Open
7/8/2024 2:00	15.52	17.53	0.01	6.98	299.64	8.81	0.43	Open
7/8/2024 2:10	15.5	17.43	0.01	7.04	296.11	8.82	0.41	Open
7/8/2024 2:20	15.47	17.48	0.01	6.96	299.53	8.85	0.41	Open
7/8/2024 2:30	15.45	17.41	0.01	7	299.56	8.83	0.43	Open
7/8/2024 2:40	15.43	17.46	0.01	6.96	300.8	8.83	0.42	Open
7/8/2024 2:50	15.41	17.47	0.01	7.01	299.76	8.85	0.42	Open
7/8/2024 3:00	15.39	17.46	0.01	6.97	300.82	8.83	0.42	Open
7/8/2024 3:10	15.37	17.37	0.01	7.07	294.71	8.86	0.39	Open
7/8/2024 3:20	15.35	17.48	0.01	6.98	298.86	8.86	0.43	Open
7/8/2024 3:30	15.34	17.48	0.01	7.04	297.99	8.86	0.42	Open
7/8/2024 3:40	15.31	17.43	0.01	6.96	299.5	8.87	0.4	Open
7/8/2024 3:50	15.29	17.31	0.01	7.04	297.03	8.87	0.39	Open
7/8/2024 4:00	15.27	17.46	0.01	6.96	299.53	8.89	0.41	Open
7/8/2024 4:10	15.24	17.44	0.01	7.04	295.33	8.89	0.42	Open
7/8/2024 4:20	15.22	17.39	0.01	6.96	298.34	8.9	0.41	Open
7/8/2024 4:30	15.2	17.39	0.01	7	299.12	8.89	0.39	Open
7/8/2024 4:40	15.18	17.37	0.01	6.97	299.42	8.89	0.38	Open
7/8/2024 4:50	15.16	17.29	0.01	6.99	298.02	8.91	0.4	Open
7/8/2024 5:00	15.15	17.32	0.01	6.95	297.66	8.91	0.4	Open
7/8/2024 5:10	15.13	17.3	0.01	7.03	297.7	8.93	0.4	Open
7/8/2024 5:20	15.11	17.41	0.01	6.97	298.53	8.92	0.38	Open
7/8/2024 5:30	15.09	17.3	0.01	7	296.37	8.93	0.4	Closed
7/8/2024 5:40	15.07	17.26	0.01	6.97	296.9	8.92	0.39	Closed
7/8/2024 5:50	15.06	17.26	0.01	7	298.11	8.92	0.4	Closed
7/8/2024 6:00	15.04	17.28	0.01	6.98	299.85	8.93	0.38	Closed
7/8/2024 6:10	15.03	17.19	0.01	7.04	295.41	8.95	0.37	Closed
7/8/2024 6:20	15.01	17.26	0.01	6.96	299.64	8.94	0.39	Closed
7/8/2024 6:30	14.99	17.26	0.01	7.04	294.43	8.97	0.38	Closed
7/8/2024 6:40	14.98	17.23	0.01	6.98	297.51	8.97	0.41	Closed
7/8/2024 6:50	14.97	17.17	0.01	7.02	293.68	8.97	0.38	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/8/2024 7:00	14.96	17.27	0.01	6.98	295.88	8.98	0.41	Open
7/8/2024 7:10	14.95	17.09	0.01	7.02	293.61	8.98	0.39	Open
7/8/2024 7:20	14.95	17.19	0.01	6.98	297.07	8.98	0.42	Open
7/8/2024 7:30	14.94	17.11	0.01	7.04	296.19	9	0.4	Open
7/8/2024 7:40	14.93	17.2	0.01	6.99	298.91	8.98	0.41	Open
7/8/2024 7:50	14.93	17.09	0.01	7.01	295.67	9	0.38	Open
7/8/2024 8:00	14.94	17.21	0.01	6.97	297.94	8.99	0.38	Open
7/8/2024 8:10	14.94	17.12	0.01	7.06	293.2	9.01	0.39	Open
7/8/2024 8:20	14.94	17.19	0.01	6.99	298.03	8.99	4.48	Open
7/8/2024 8:30	14.95	17.04	0.01	7.03	296.15	8.99	0.39	Open
7/8/2024 8:40	14.98	17.23	0.01	6.95	297.99	9.02	0.39	Open
7/8/2024 8:50	15.01	17.16	0.01	7.07	294.46	9.01	0.39	Open
7/8/2024 9:00	15.05	17.17	0.01	6.96	299.14	9.01	0.41	Open
7/8/2024 9:10	15.09	17.11	0.01	7.05	296.43	8.99	0.41	Open
7/8/2024 9:20	15.12	17.26	0.01	6.99	299.71	9.01	0.41	Open
7/8/2024 9:30	15.15	17.31	0.01	7.04	299.92	9.01	0.4	Open
7/8/2024 9:40	15.16	17.3	0.01	6.99	300.69	9.01	0.4	Open
7/8/2024 9:50	15.18	17.3	0.01	7.08	294.21	9.01	0.41	Open
7/8/2024 10:00	15.21	17.2	0.01	7.02	297.48	9.01	0.4	Open
7/8/2024 10:10	15.24	17.29	0.01	7.07	293.15	9	0.39	Open
7/8/2024 10:20	15.29	17.1	0.01	7	294.36	9.02	0.41	Open
7/8/2024 10:30	15.34	17.32	0.01	7.09	293.53	9	0.39	Open
7/8/2024 10:40	15.43	17.09	0.01	7.02	295.72	8.99	0.39	Open
7/8/2024 10:50	15.54	16.99	0.01	7.13	292.57	9	0.4	Open
7/8/2024 11:00	15.63	17.1	0.01	7.06	295.76	8.97	0.45	Open
7/8/2024 11:10	15.73	17.18	0.01	7.16	291.21	9.01	0.54	Open
7/8/2024 11:20	15.81	17.16	0.01	7.09	294.07	8.98	0.43	Open
7/8/2024 11:30	15.91	17.03	0.01	7.15	291.55	9	0.44	Open
7/8/2024 11:40	16	17.18	0.01	7.1	294.81	8.99	0.48	Open
7/8/2024 11:50	16.09	17.16	0.01	7.11	296.86	8.99	0.41	Open
7/8/2024 12:00	16.17	17.1	0.01	7.08	296.04	8.97	0.45	Open
7/8/2024 12:10	16.23	17.15	0.01	7.13	295.61	8.95	0.42	Open
7/8/2024 12:20	16.27	17.02	0.01	7.11	296.58	8.94	0.47	Open
7/8/2024 12:30	16.31	17.16	0.01	7.12	295.4	8.94	0.48	Open
7/8/2024 12:40	16.36	17.01	0.01	7.1	295.56	8.93	0.43	Open
7/8/2024 12:50	16.38	17.3	0.01	7.15	292.58	8.91	0.42	Open
7/8/2024 13:00	16.4	16.94	0.01	7.09	294.23	8.88	0.46	Open
7/8/2024 13:10	16.42	17.21	0.01	7.15	292.74	8.84	0.44	Open
7/8/2024 13:20	16.45	17	0.01	7.1	295.38	8.81	0.48	Open
7/8/2024 13:30	16.5	17.03	0.01	7.13	294.08	8.81	0.43	Open
7/8/2024 13:40	16.56	16.98	0.01	7.09	295.43	8.8	0.44	Open
7/8/2024 13:50	16.59	17.03	0.01	7.14	293.65	8.77	0.48	Open
7/8/2024 14:00	16.65	17.01	0.01	7.06	295.4	8.77	0.47	Open
7/8/2024 14:10	16.68	17.19	0.01	7.13	294.54	8.72	0.48	Open
7/8/2024 14:20	16.69	17.06	0.01	7.07	294.38	8.73	0.46	Open
7/8/2024 14:30	16.7	17.18	0.01	7.09	293.76	8.69	0.47	Open
7/8/2024 14:40	16.74	17.13	0.01	7.06	294.71	8.68	0.48	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/8/2024 14:50	16.78	17.03	0.01	7.12	293.84	8.66	0.48	Open
7/8/2024 15:00	16.81	16.97	0.01	7.08	295.39	8.66	0.46	Open
7/8/2024 15:10	16.86	17.25	0.01	7.12	294.09	8.65	0.5	Closed
7/8/2024 15:20	16.92	17.02	0.01	7.07	296.71	8.65	0.68	Closed
7/8/2024 15:30	16.98	17.4	0.01	7.08	297.64	8.61	0.49	Closed
7/8/2024 15:40	17.05	17.12	0.01	7.06	295.66	8.63	0.48	Closed
7/8/2024 15:50	17.08	17.08	0.01	7.1	296.06	8.59	0.49	Closed
7/8/2024 16:00	17.12	17.13	0.01	7.04	295.93	8.62	0.48	Closed
7/8/2024 16:10	17.16	17.22	0.01	7.12	294.89	8.59	0.46	Closed
7/8/2024 16:20	17.19	17.19	0.01	7.04	295.74	8.57	0.48	Closed
7/8/2024 16:30	17.22	17.51	0.01	7.08	296.69	8.54	0.49	Closed
7/8/2024 16:40	17.26	17.29	0.01	7.03	297.09	8.55	0.5	Closed
7/8/2024 16:50	17.25	17.52	0.01	7.05	298.19	8.51	0.49	Closed
7/8/2024 17:00	17.24	17.41	0.01	7	297.39	8.52	0.5	Closed
7/8/2024 17:10	17.24	17.6	0.01	7.08	296.52	8.51	0.52	Closed
7/8/2024 17:20	17.23	17.36	0.01	7.02	297.59	8.53	0.48	Closed
7/8/2024 17:30	17.21	17.49	0.01	7.06	298.41	8.5	0.53	Closed
7/8/2024 17:40	17.2	17.38	0.01	7.01	298.38	8.52	0.52	Closed
7/8/2024 17:50	17.19	17.62	0.01	7.07	297.64	8.5	0.5	Closed
7/8/2024 18:00	17.18	17.46	0.01	7.01	299.04	8.52	0.5	Closed
7/8/2024 18:10	17.18	17.72	0.01	7.05	296.76	8.46	0.52	Closed
7/8/2024 18:20	17.16	17.56	0.01	7	297.99	8.52	0.49	Closed
7/8/2024 18:30	17.14	17.47	0.01	7.03	299	8.47	0.5	Closed
7/8/2024 18:40	17.11	17.76	0.01	6.97	299.06	8.5	0.5	Closed
7/8/2024 18:50	17.1	17.79	0.01	7.02	299.59	8.46	0.52	Closed
7/8/2024 19:00	17.08	17.66	0.01	6.97	299.72	8.46	0.54	Closed
7/8/2024 19:10	17.07	17.98	0.01	6.98	302.36	8.4	0.5	Closed
7/8/2024 19:20	17.05	17.71	0.01	6.93	301.42	8.46	0.49	Closed
7/8/2024 19:30	17.03	18.08	0.01	7	301.17	8.44	0.5	Closed
7/8/2024 19:40	17	17.85	0.01	6.94	301.2	8.45	0.49	Closed
7/8/2024 19:50	16.98	17.82	0.01	7.01	301.51	8.46	0.5	Open
7/8/2024 20:00	16.95	17.86	0.01	6.97	301.79	8.49	0.49	Open
7/8/2024 20:10	16.93	17.96	0.01	7.04	298.93	8.47	0.51	Open
7/8/2024 20:20	16.9	18.81	0.01	6.92	301.09	8.49	6.91	Open
7/8/2024 20:30	16.87	18.19	0.01	7	301.01	8.44	0.75	Open
7/8/2024 20:40	16.83	18.03	0.01	6.96	298.38	8.48	1.43	Open
7/8/2024 20:50	16.8	18.04	0.01	7.01	298.61	8.44	4.37	Open
7/8/2024 21:00	16.77	17.99	0.01	6.95	299.14	8.49	0.47	Open
7/8/2024 21:10	16.75	18.11	0.01	7.03	297.76	8.46	0.47	Open
7/8/2024 21:10	16.75	18.11	0.01	7.03	297.76	8.46	0.47	Open
7/8/2024 21:20	16.7	18.03	0.01	6.96	299.73	8.5	0.5	Open
7/8/2024 21:30	16.67	18.09	0.01	7	299.46	8.48	0.49	Open
7/8/2024 21:40	16.64	18.08	0.01	6.94	299.36	8.52	0.51	Open
7/8/2024 21:50	16.61	18.13	0.01	7.02	298.36	8.49	0.48	Open
7/8/2024 22:00	16.57	18.05	0.01	6.94	300.2	8.54	0.47	Open
7/8/2024 22:10	16.54	18.05	0.01	7.02	297.04	8.53	0.49	Open
7/8/2024 22:20	16.51	18.03	0.01	6.95	299.92	8.56	0.48	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/8/2024 22:30	16.48	18.16	0.01	6.96	300.73	8.57	0.48	Open
7/8/2024 22:40	16.45	18.1	0.01	6.92	300.32	8.57	0.46	Open
7/8/2024 22:50	16.42	18.24	0.01	7.03	299.04	8.57	0.45	Open
7/8/2024 23:00	16.39	18.01	0.01	6.92	301.61	8.59	0.48	Open
7/8/2024 23:10	16.36	18.01	0.01	7.03	300.71	8.58	0.46	Open
7/8/2024 23:20	16.33	18.05	0.01	6.95	301.88	8.61	0.45	Open
7/8/2024 23:30	16.31	18.09	0.01	6.99	298.94	8.59	0.47	Open
7/8/2024 23:40	16.28	18.04	0.01	6.96	300.52	8.63	0.46	Open
7/8/2024 23:50	16.25	18.08	0.01	7.05	296.65	8.61	0.45	Open
7/9/2024 0:00	16.22	18.03	0.01	6.94	300.65	8.64	0.53	Open
7/9/2024 0:10	16.2	17.91	0.01	7.02	298.97	8.63	0.45	Open
7/9/2024 0:20	16.17	17.92	0.01	6.94	301.06	8.65	0.47	Open
7/9/2024 0:30	16.15	18.09	0.01	6.96	302.97	8.63	0.85	Open
7/9/2024 0:40	16.13	17.97	0.01	6.93	301.5	8.66	0.45	Open
7/9/2024 0:50	16.1	18.04	0.01	6.98	301.62	8.67	0.47	Open
7/9/2024 1:00	16.08	17.95	0.01	6.95	299.46	8.67	0.46	Open
7/9/2024 1:10	16.06	18	0.01	7.04	298.83	8.68	0.44	Open
7/9/2024 1:20	16.04	17.9	0.01	6.95	300.06	8.68	0.44	Open
7/9/2024 1:30	16.02	17.98	0.01	6.99	302.86	8.67	0.44	Open
7/9/2024 1:40	15.99	17.88	0.01	6.95	301.51	8.7	0.45	Open
7/9/2024 1:50	15.97	18.06	0.01	6.98	303.04	8.7	0.43	Open
7/9/2024 2:00	15.96	17.85	0.01	6.97	301.53	8.69	0.46	Open
7/9/2024 2:10	15.94	17.99	0.01	7.03	298.93	8.69	0.66	Open
7/9/2024 2:20	15.92	17.85	0.01	6.94	300.43	8.69	0.42	Open
7/9/2024 2:30	15.9	17.8	0.01	7.01	300.79	8.73	0.43	Open
7/9/2024 2:40	15.88	17.81	0.01	6.95	302.25	8.72	0.43	Open
7/9/2024 2:50	15.86	17.96	0.01	6.99	303.19	8.72	0.46	Open
7/9/2024 3:00	15.84	17.84	0.01	6.96	301.78	8.73	0.44	Open
7/9/2024 3:10	15.82	17.88	0.01	7.02	300.41	8.72	0.45	Open
7/9/2024 3:20	15.8	17.81	0.01	6.96	301.58	8.74	0.44	Open
7/9/2024 3:30	15.78	17.73	0.01	6.97	302.26	8.72	0.43	Open
7/9/2024 3:40	15.76	17.8	0.01	6.95	296.85	8.74	0.41	Open
7/9/2024 3:50	15.74	17.83	0.01	7.01	296.14	8.74	0.44	Open
7/9/2024 4:00	15.72	17.81	0.01	6.95	295.54	8.74	0.44	Open
7/9/2024 4:10	15.7	17.87	0.01	6.98	296.02	8.75	0.44	Open
7/9/2024 4:20	15.69	17.73	0.01	6.97	294.46	8.76	0.42	Open
7/9/2024 4:30	15.67	17.77	0.01	7	294.44	8.76	0.41	Open
7/9/2024 4:40	15.66	17.74	0.01	6.96	295.64	8.78	0.42	Open
7/9/2024 4:50	15.64	17.66	0.01	7.07	288.72	8.76	0.41	Open
7/9/2024 5:00	15.62	17.68	0.01	6.97	293.14	8.8	0.42	Open
7/9/2024 5:10	15.6	17.68	0.01	7	294.76	8.78	0.43	Open
7/9/2024 5:20	15.58	17.65	0.01	6.96	296.88	8.77	0.46	Open
7/9/2024 5:30	15.57	17.77	0.01	6.99	295.8	8.77	0.39	Open
7/9/2024 5:40	15.55	17.68	0.01	6.95	295.18	8.8	0.42	Open
7/9/2024 5:50	15.53	17.74	0.01	7.03	296.19	8.78	0.41	Open
7/9/2024 6:00	15.52	17.56	0.01	6.95	296.73	8.82	0.42	Open
7/9/2024 6:10	15.5	17.6	0.01	7.04	294.67	8.79	0.42	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/9/2024 6:20	15.49	17.52	0.01	6.96	296.78	8.82	0.51	Open
7/9/2024 6:30	15.47	17.54	0.01	7	297.25	8.83	0.43	Open
7/9/2024 6:40	15.46	17.68	0.01	6.95	297.25	8.84	0.42	Open
7/9/2024 6:50	15.45	17.56	0.01	7.01	294.73	8.85	0.4	Open
7/9/2024 7:00	15.44	17.62	0.01	6.96	295.31	8.84	0.42	Open
7/9/2024 7:10	15.43	17.48	0.01	7.05	292.25	8.84	0.42	Open
7/9/2024 7:20	15.43	17.6	0.01	6.98	295.11	8.85	0.66	Open
7/9/2024 7:30	15.42	17.56	0.01	7.04	293.84	8.85	0.4	Open
7/9/2024 7:40	15.42	17.46	0.01	6.98	296.64	8.85	0.45	Open
7/9/2024 7:50	15.42	17.48	0.01	7.01	297.54	8.84	0.42	Open
7/9/2024 8:00	15.42	17.58	0.01	6.95	297.27	8.88	0.41	Open
7/9/2024 8:10	15.42	17.66	0.01	7.03	296.81	8.87	0.41	Open
7/9/2024 8:20	15.43	17.52	0.01	6.96	296.8	8.87	0.41	Open
7/9/2024 8:30	15.44	17.36	0.01	7.02	295.88	8.88	0.42	Open
7/9/2024 8:40	15.46	17.63	0.01	6.97	297.97	8.88	0.41	Open
7/9/2024 8:50	15.5	17.63	0.01	7.03	297.23	8.87	0.41	Open
7/9/2024 9:00	15.53	17.54	0.01	6.98	297.43	8.88	0.41	Open
7/9/2024 9:10	15.56	17.62	0.01	7.03	296.78	8.88	0.4	Open
7/9/2024 9:20	15.6	17.6	0.01	7	295.9	8.9	0.42	Open
7/9/2024 9:30	15.62	17.47	0.01	7.05	295.04	8.89	0.43	Open
7/9/2024 9:40	15.63	17.66	0.01	7	296.4	8.89	0.4	Open
7/9/2024 9:50	15.65	17.67	0.01	7.04	297.62	8.88	0.43	Open
7/9/2024 10:00	15.67	17.73	0.01	7	296.18	8.88	0.42	Open
7/9/2024 10:10	15.69	17.49	0.01	7.07	296.36	8.88	0.42	Open
7/9/2024 10:20	15.73	17.55	0.01	7.02	295.96	8.88	0.44	Open
7/9/2024 10:30	15.79	17.51	0.01	7.08	295.35	8.88	0.43	Open
7/9/2024 10:40	15.87	17.49	0.01	7.04	294.76	8.89	0.45	Open
7/9/2024 10:50	15.99	17.47	0.01	7.15	291.35	8.9	0.43	Open
7/9/2024 11:00	16.09	17.35	0.01	7.03	293.98	8.89	0.45	Open
7/9/2024 11:10	16.18	17.41	0.01	7.14	293.47	8.87	0.46	Open
7/9/2024 11:20	16.28	17.4	0.01	7.08	293.48	8.89	0.45	Open
7/9/2024 11:30	16.35	17.41	0.01	7.15	293.22	8.87	0.48	Open
7/9/2024 11:40	16.47	17.37	0.01	7.07	292.72	8.88	0.48	Open
7/9/2024 11:50	16.55	17.4	0.01	7.13	294.85	8.84	0.47	Open
7/9/2024 12:00	16.63	17.26	0.01	7.04	293.5	8.86	0.47	Open
7/9/2024 12:10	16.71	17.5	0.01	7.16	294.42	8.83	0.46	Open
7/9/2024 12:20	16.75	17.33	0.01	7.08	292.27	8.84	0.51	Open
7/9/2024 12:30	16.77	17.14	0.01	7.19	290.24	8.8	0.49	Open
7/9/2024 12:40	16.79	17.37	0.01	7.08	293.31	8.82	0.44	Open
7/9/2024 12:50	16.8	17.52	0.01	7.12	294.3	8.78	0.49	Open
7/9/2024 13:00	16.84	17.36	0.01	7.05	293.21	8.77	0.48	Open
7/9/2024 13:10	16.86	17.43	0.01	7.12	292.92	8.71	0.49	Open
7/9/2024 13:20	16.91	17.28	0.01	7.08	292.26	8.71	0.51	Open
7/9/2024 13:30	16.95	17.21	0.01	7.14	292.36	8.71	0.46	Open
7/9/2024 13:40	17	17.37	0.01	7.04	292.07	8.71	0.51	Open
7/9/2024 13:50	17.02	17.45	0.01	7.14	292.76	8.66	0.52	Open
7/9/2024 14:00	17.05	17.33	0.01	7.07	294.05	8.66	0.52	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/9/2024 14:10	17.08	17.36	0.01	7.12	292.73	8.62	0.52	Open
7/9/2024 14:20	17.1	17.4	0.01	7.07	293.41	8.62	0.5	Open
7/9/2024 14:30	17.12	17.46	0.01	7.1	294.65	8.56	0.52	Open
7/9/2024 14:40	17.16	17.35	0.01	7.03	294.2	8.56	0.51	Open
7/9/2024 14:50	17.21	17.39	0.01	7.12	291.98	8.54	0.5	Closed
7/9/2024 15:00	17.26	17.34	0.01	7.03	293.56	8.56	0.52	Closed
7/9/2024 15:10	17.3	17.46	0.01	7.1	293.28	8.55	0.51	Closed
7/9/2024 15:20	17.34	17.28	0.01	7.05	292.73	8.56	0.52	Closed
7/9/2024 15:30	17.38	17.41	0.01	7.13	289.32	8.52	0.51	Closed
7/9/2024 15:40	17.46	17.34	0.01	6.97	291.71	8.52	0.51	Closed
7/9/2024 15:50	17.47	17.48	0.01	7.12	290.2	8.51	0.52	Closed
7/9/2024 16:00	17.51	17.47	0.01	7.05	293.36	8.5	0.53	Closed
7/9/2024 16:10	17.56	17.56	0.01	7.08	294.37	8.45	0.49	Closed
7/9/2024 16:20	17.61	17.43	0.01	6.98	292.48	8.48	0.52	Closed
7/9/2024 16:30	17.62	17.64	0.01	7.12	291.93	8.45	0.52	Closed
7/9/2024 16:40	17.66	17.5	0.01	7.01	294.14	8.44	0.53	Closed
7/9/2024 16:50	17.65	17.39	0.01	7.09	294.38	8.43	0.56	Closed
7/9/2024 17:00	17.64	17.48	0.01	7.02	294.42	8.42	0.51	Closed
7/9/2024 17:10	17.65	17.59	0.01	7.08	293.88	8.4	0.52	Closed
7/9/2024 17:20	17.65	17.57	0.01	6.94	296.13	8.42	0.54	Closed
7/9/2024 17:30	17.62	17.79	0.01	7.04	295.67	8.41	0.5	Closed
7/9/2024 17:40	17.61	17.62	0.01	7.02	295.48	8.41	0.52	Closed
7/9/2024 17:50	17.6	17.81	0.01	7.06	294.74	8.4	0.55	Closed
7/9/2024 18:00	17.58	17.72	0.01	7.01	295.44	8.41	0.53	Closed
7/9/2024 18:10	17.56	17.71	0.01	7.07	292.7	8.4	0.53	Closed
7/9/2024 18:20	17.53	17.82	0.01	7	293.74	8.43	0.53	Closed
7/9/2024 18:30	17.5	17.89	0.01	7.03	295.02	8.4	0.54	Closed
7/9/2024 18:40	17.48	17.79	0.01	6.97	295.63	8.43	0.5	Closed
7/9/2024 18:50	17.45	17.91	0.01	7.03	294.93	8.4	0.54	Closed
7/9/2024 19:00	17.43	17.8	0.01	7	296.42	8.41	0.54	Closed
7/9/2024 19:10	17.4	18.02	0.01	7.04	295.98	8.42	0.53	Closed
7/9/2024 19:20	17.38	17.93	0.01	6.98	297.49	8.41	0.52	Closed
7/9/2024 19:30	17.36	17.97	0.01	7.04	296.85	8.42	0.52	Closed
7/9/2024 19:40	17.34	18.06	0.01	6.97	299.4	8.42	0.52	Closed
7/9/2024 19:50	17.31	17.9	0.01	7.06	296.15	8.39	0.53	Closed
7/9/2024 20:00	17.28	18.12	0.01	6.96	299.21	8.43	0.5	Closed
7/9/2024 20:10	17.25	18.17	0.01	6.98	299.61	8.41	0.52	Closed
7/9/2024 20:20	17.23	18.24	0.01	6.94	298.67	8.43	0.5	Open
7/9/2024 20:30	17.2	18.16	0.01	7.01	298.48	8.41	0.49	Open
7/9/2024 20:40	17.17	18.34	0.01	6.96	296.89	8.45	0.5	Open
7/9/2024 20:50	17.14	18.23	0.01	7	297.58	8.41	0.51	Open
7/9/2024 21:00	17.11	18.25	0.01	6.95	297.36	8.43	0.5	Open
7/9/2024 21:10	17.07	18.38	0.01	7.03	295.15	8.44	0.49	Open
7/9/2024 21:20	17.04	18.33	0.01	6.96	297.37	8.45	0.51	Open
7/9/2024 21:30	17.01	18.35	0.01	7.01	298.38	8.43	0.49	Open
7/9/2024 21:40	16.97	18.21	0.01	6.98	298.1	8.46	0.49	Open
7/9/2024 21:50	16.94	18.31	0.01	7.01	298.53	8.46	0.49	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/9/2024 22:00	16.92	18.23	0.01	6.98	299.09	8.46	0.49	Open
7/9/2024 22:10	16.88	18.45	0.01	6.99	299.17	8.45	0.47	Open
7/9/2024 22:20	16.85	18.23	0.01	6.98	298.57	8.48	0.48	Open
7/9/2024 22:30	16.82	18.28	0.01	7.02	297.57	8.48	0.51	Open
7/9/2024 22:40	16.78	18.18	0.01	6.98	297.89	8.5	0.49	Open
7/9/2024 22:50	16.76	18.18	0.01	7.01	296.75	8.49	0.49	Open
7/9/2024 23:00	16.72	18.14	0.01	6.97	298.96	8.52	0.49	Open
7/9/2024 23:10	16.68	18.14	0.01	6.98	301.18	8.51	0.49	Open
7/9/2024 23:20	16.65	18.16	0.01	6.97	299.31	8.54	0.48	Open
7/9/2024 23:30	16.63	18.13	0.01	7.01	298.4	8.52	0.5	Open
7/9/2024 23:40	16.6	18.17	0.01	6.98	298.72	8.56	0.47	Open
7/9/2024 23:50	16.58	18.19	0.01	7.02	297.18	8.56	0.48	Open
7/10/2024 0:00	16.55	18.12	0.01	6.98	297.84	8.55	0.47	Open
7/10/2024 0:10	16.52	18.2	0.01	7.01	298.31	8.54	0.5	Open
7/10/2024 0:20	16.5	18.14	0.01	6.98	298.39	8.56	0.49	Open
7/10/2024 0:30	16.47	18.19	0.01	7.03	298.33	8.56	0.48	Open
7/10/2024 0:40	16.44	18.17	0.01	6.99	298.68	8.59	0.48	Open
7/10/2024 0:50	16.41	18.13	0.01	7.02	296.3	8.58	0.48	Open
7/10/2024 1:00	16.38	18.11	0.01	6.98	297.34	8.59	0.47	Open
7/10/2024 1:10	16.35	18.13	0.01	7.05	296.31	8.6	0.48	Open
7/10/2024 1:20	16.33	18.11	0.01	6.99	298.03	8.59	0.47	Open
7/10/2024 1:30	16.31	18.13	0.01	7.03	299.07	8.6	0.48	Open
7/10/2024 1:40	16.28	18.13	0.01	6.98	300	8.62	0.45	Open
7/10/2024 1:50	16.26	18.12	0.01	7	301.26	8.61	1.1	Open
7/10/2024 2:00	16.23	18.1	0.01	6.98	300.02	8.62	0.46	Open
7/10/2024 2:10	16.22	18.21	0.01	7.01	300.56	8.61	0.46	Open
7/10/2024 2:20	16.19	18.15	0.01	6.98	298.74	8.63	0.96	Open
7/10/2024 2:30	16.17	18.16	0.01	7.01	299.83	8.61	0.49	Open
7/10/2024 2:40	16.14	18.12	0.01	6.98	300.02	8.65	0.46	Open
7/10/2024 2:50	16.12	18.16	0.01	7	300.74	8.63	0.46	Open
7/10/2024 3:00	16.09	18.06	0.01	6.98	299.81	8.63	0.46	Open
7/10/2024 3:10	16.07	18.11	0.01	7.01	300.3	8.64	0.56	Open
7/10/2024 3:20	16.05	18.02	0.01	6.98	300.89	8.66	0.46	Open
7/10/2024 3:30	16.03	18.05	0.01	7.06	297.96	8.65	0.45	Open
7/10/2024 3:40	16.01	18.07	0.01	6.98	301.16	8.67	0.46	Open
7/10/2024 3:50	15.98	18.05	0.01	7.02	300.04	8.65	0.46	Open
7/10/2024 4:00	15.96	18.08	0.01	6.99	299.85	8.7	0.46	Open
7/10/2024 4:10	15.93	18.04	0.01	7	300.68	8.69	0.46	Open
7/10/2024 4:20	15.91	17.97	0.01	6.99	298.77	8.69	0.46	Open
7/10/2024 4:30	15.9	17.98	0.01	7.01	300.35	8.69	0.46	Open
7/10/2024 4:40	15.88	17.95	0.01	6.99	300.45	8.71	0.45	Open
7/10/2024 4:50	15.86	17.98	0.01	7.05	298.32	8.7	0.46	Open
7/10/2024 5:00	15.84	17.95	0.01	6.98	299.26	8.72	0.45	Open
7/10/2024 5:10	15.82	18.08	0.01	7.04	299.54	8.71	0.45	Closed
7/10/2024 5:20	15.8	17.95	0.01	6.98	300.09	8.71	0.44	Closed
7/10/2024 5:30	15.79	18.03	0.01	6.99	302.26	8.71	0.45	Closed
7/10/2024 5:40	15.77	17.98	0.01	6.99	300.68	8.73	0.44	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/10/2024 5:50	15.75	17.89	0.01	7.01	301.5	8.75	0.42	Closed
7/10/2024 6:00	15.73	17.81	0.01	7	299.87	8.76	0.44	Closed
7/10/2024 6:10	15.71	17.81	0.01	7.04	300.43	8.73	0.45	Open
7/10/2024 6:20	15.7	17.83	0.01	6.99	300.68	8.76	0.42	Open
7/10/2024 6:30	15.68	17.87	0.01	7.04	299.18	8.77	0.44	Open
7/10/2024 6:40	15.67	17.79	0.01	6.99	300.65	8.78	0.45	Open
7/10/2024 6:50	15.65	17.85	0.01	7.05	298.65	8.76	0.46	Open
7/10/2024 7:00	15.65	17.7	0.01	7	300.4	8.8	0.43	Open
7/10/2024 7:10	15.64	17.79	0.01	7.07	295.76	8.78	0.45	Open
7/10/2024 7:20	15.63	17.7	0.01	7.01	297.81	8.82	0.42	Open
7/10/2024 7:30	15.62	17.82	0.01	7.1	295.61	8.81	0.45	Open
7/10/2024 7:40	15.62	17.66	0.01	7.03	298.9	8.84	0.43	Open
7/10/2024 7:50	15.62	17.73	0.01	7.07	298.2	8.82	0.42	Open
7/10/2024 8:00	15.63	17.7	0.01	7	299.31	8.85	0.44	Open
7/10/2024 8:10	15.63	17.61	0.01	7.06	299.13	8.81	0.45	Open
7/10/2024 8:20	15.63	17.62	0.01	7.01	299.67	8.84	0.43	Open
7/10/2024 8:30	15.63	17.74	0.01	7.07	299.2	8.83	0.43	Open
7/10/2024 8:40	15.65	17.65	0.01	7.02	298.89	8.87	0.44	Open
7/10/2024 8:50	15.68	17.67	0.01	7.03	299.37	8.85	0.44	Open
7/10/2024 9:00	15.71	17.66	0.01	7.02	299.29	8.86	0.43	Open
7/10/2024 9:10	15.74	17.75	0.01	7.05	299.98	8.83	0.42	Open
7/10/2024 9:20	15.77	17.59	0.01	7.05	297.8	8.85	0.44	Open
7/10/2024 9:30	15.79	17.66	0.01	7.1	298.08	8.86	0.42	Open
7/10/2024 9:40	15.8	17.65	0.01	7.04	298	8.86	0.44	Open
7/10/2024 9:50	15.8	17.71	0.01	7.07	299.45	8.86	0.43	Open
7/10/2024 10:00	15.82	17.57	0.01	7.04	298.24	8.86	0.43	Open
7/10/2024 10:10	15.84	17.68	0.01	7.11	297.04	8.84	0.42	Open
7/10/2024 10:20	15.88	17.76	0.01	7.09	296.39	8.84	0.46	Open
7/10/2024 10:30	15.92	17.72	0.01	7.11	296.39	8.85	0.42	Open
7/10/2024 10:40	16.01	17.6	0.01	7.06	295.49	8.88	0.46	Open
7/10/2024 10:50	16.12	17.73	0.01	7.11	296.2	8.82	0.44	Open
7/10/2024 11:00	16.26	17.53	0.01	7.13	293.44	8.87	0.46	Open
7/10/2024 11:10	16.36	17.71	0.01	7.15	294.19	8.86	0.43	Open
7/10/2024 11:20	16.47	17.57	0.01	7.12	293.63	8.86	0.5	Open
7/10/2024 11:30	16.55	17.57	0.01	7.16	293.26	8.84	0.47	Open
7/10/2024 11:40	16.66	17.48	0.01	7.14	293.96	8.83	0.5	Open
7/10/2024 11:50	16.75	17.48	0.01	7.2	291.33	8.84	0.48	Open
7/10/2024 12:00	16.83	17.35	0.01	7.12	293.78	8.84	0.51	Open
7/10/2024 12:10	16.89	17.47	0.01	7.16	294.65	8.8	0.88	Closed
7/10/2024 12:20	16.94	17.46	0.01	7.07	295.03	8.81	0.53	Closed
7/10/2024 12:30	16.96	17.46	0.01	7.13	296.58	8.79	0.57	Closed
7/10/2024 12:40	16.98	17.36	0.01	7.1	293.74	8.77	0.5	Closed
7/10/2024 12:50	16.98	17.32	0.01	7.12	294.81	8.73	0.57	Closed
7/10/2024 13:00	17.02	17.42	0.01	7.1	294.48	8.75	0.5	Closed
7/10/2024 13:00	17.02	17.42	0.01	7.1	294.48	8.75	0.5	Open
7/10/2024 13:10	17.06	17.39	0.01	7.22	291.25	8.71	0.49	Open
7/10/2024 13:20	17.1	17.38	0.01	7.09	294.59	8.7	0.52	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/10/2024 13:30	17.12	17.52	0.01	7.16	294.07	8.69	0.5	Closed
7/10/2024 13:40	17.16	17.34	0.01	7.12	294.25	8.68	0.54	Closed
7/10/2024 13:50	17.18	17.33	0.01	7.18	294.14	8.67	0.52	Closed
7/10/2024 14:00	17.21	17.39	0.01	7.1	293.84	8.67	0.51	Closed
7/10/2024 14:10	17.22	17.43	0.01	7.13	293.91	8.63	0.66	Closed
7/10/2024 14:20	17.24	17.38	0.01	7.06	294.09	8.63	0.49	Closed
7/10/2024 14:30	17.25	17.32	0.01	7.16	291.93	8.6	0.51	Closed
7/10/2024 14:40	17.29	17.44	0.01	7.06	294.52	8.61	0.51	Closed
7/10/2024 14:50	17.32	17.31	0.01	7.14	294.28	8.58	0.51	Closed
7/10/2024 15:00	17.35	17.47	0.01	7.1	295.5	8.6	0.55	Closed
7/10/2024 15:10	17.37	17.68	0.01	7.14	294.88	8.59	0.52	Closed
7/10/2024 15:20	17.39	17.5	0.01	7.1	295.04	8.61	0.54	Closed
7/10/2024 15:30	17.43	17.56	0.01	7.13	295.59	8.57	0.54	Closed
7/10/2024 15:40	17.47	17.55	0.01	7.09	293.76	8.57	0.54	Closed
7/10/2024 15:50	17.49	17.54	0.01	7.19	288.89	8.54	0.55	Closed
7/10/2024 16:00	17.51	17.46	0.01	7.11	293.2	8.55	0.54	Closed
7/10/2024 16:10	17.53	17.48	0.01	7.15	292.24	8.54	0.55	Closed
7/10/2024 16:20	17.54	17.52	0.01	7.07	294.01	8.53	0.54	Closed
7/10/2024 16:30	17.56	17.57	0.01	7.14	292.89	8.51	0.54	Closed
7/10/2024 16:40	17.59	17.63	0.01	7.05	295.46	8.49	0.54	Closed
7/10/2024 16:50	17.58	17.98	0.01	7.15	294.54	8.39	0.54	Closed
7/10/2024 17:00	17.57	17.7	0.01	7	297.19	8.35	0.61	Closed
7/10/2024 17:10	17.56	17.86	0.01	7.07	296.44	8.26	0.56	Closed
7/10/2024 17:20	17.55	17.94	0.01	6.99	296.94	8.36	0.55	Closed
7/10/2024 17:30	17.52	18.1	0.01	7.13	297.07	8.32	0.56	Closed
7/10/2024 17:40	17.51	17.79	0.01	6.98	297.76	8.32	0.57	Closed
7/10/2024 17:50	17.5	17.88	0.01	7.06	298.19	8.3	0.6	Closed
7/10/2024 18:00	17.49	17.93	0.01	7	299.14	8.38	0.57	Closed
7/10/2024 18:10	17.47	18.21	0.01	7.07	298.9	8.26	0.58	Closed
7/10/2024 18:20	17.46	18.12	0.01	6.97	300.71	8.31	0.54	Closed
7/10/2024 18:30	17.43	18.06	0.01	7.08	301.67	8.37	0.53	Closed
7/10/2024 18:40	17.4	18.13	0.01	6.97	300.92	8.31	0.53	Closed
7/10/2024 18:50	17.37	18.15	0.01	7.05	298.9	8.21	0.54	Closed
7/10/2024 19:00	17.35	18.19	0.01	6.96	301.45	8.33	0.53	Closed
7/10/2024 19:10	17.32	18.26	0.01	6.96	303.84	8.32	0.52	Closed
7/10/2024 19:20	17.3	18.18	0.01	6.94	303.46	8.32	0.52	Closed
7/10/2024 19:30	17.26	18.43	0.01	6.99	300.88	8.34	0.52	Closed
7/10/2024 19:40	17.24	18.14	0.01	6.95	301.27	8.3	0.54	Closed
7/10/2024 19:50	17.2	18.3	0.01	6.99	301.77	8.28	0.54	Closed
7/10/2024 20:00	17.17	18.39	0.01	6.97	301.55	8.3	0.52	Closed
7/10/2024 20:10	17.13	18.33	0.01	7.05	301.26	8.33	0.52	Closed
7/10/2024 20:20	17.1	18.35	0.01	6.89	300.66	8.25	0.52	Closed
7/10/2024 20:30	17.05	18.41	0.01	7.02	302.47	8.26	0.5	Closed
7/10/2024 20:40	17.02	18.41	0.01	6.94	301.65	8.34	0.53	Closed
7/10/2024 20:50	16.97	18.54	0.01	7.02	302.22	8.24	0.5	Open
7/10/2024 21:00	16.94	18.41	0.01	6.92	302.22	8.37	0.52	Open
7/10/2024 21:10	16.9	18.3	0.01	7.03	302.25	8.42	0.5	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/10/2024 21:20	16.86	18.48	0.01	6.95	301.43	8.42	0.51	Open
7/10/2024 21:30	16.83	18.33	0.01	7.04	301.54	8.45	0.5	Open
7/10/2024 21:40	16.79	18.63	0.01	6.99	302.56	8.42	0.5	Open
7/10/2024 21:50	16.75	18.32	0.01	7.05	301.61	8.49	0.5	Open
7/10/2024 22:00	16.72	18.57	0.01	6.96	302.52	8.42	0.49	Open
7/10/2024 22:10	16.68	18.46	0.01	7.02	303.27	8.41	0.51	Open
7/10/2024 22:20	16.65	18.68	0.01	6.97	303.4	8.43	0.48	Open
7/10/2024 22:30	16.61	18.71	0.01	7.07	298.35	8.39	0.49	Open
7/10/2024 22:40	16.57	18.49	0.01	6.93	299.01	8.4	0.47	Open
7/10/2024 22:50	16.53	18.41	0.01	7.05	298.58	8.39	0.47	Open
7/10/2024 23:00	16.5	18.51	0.01	6.96	301.68	8.42	0.48	Open
7/10/2024 23:10	16.45	18.52	0.01	7.01	300.28	8.45	0.47	Open
7/10/2024 23:20	16.43	18.45	0.01	6.91	302.19	8.4	0.49	Open
7/10/2024 23:30	16.38	18.51	0.01	7.06	301.04	8.47	0.47	Open
7/10/2024 23:40	16.35	18.46	0.01	6.97	301.03	8.49	0.47	Open
7/10/2024 23:50	16.31	18.53	0.01	7	302.06	8.4	0.48	Open
7/11/2024 0:00	16.29	18.47	0.01	6.97	302.56	8.47	0.48	Open
7/11/2024 0:10	16.26	18.4	0.01	7.08	302.23	8.48	0.46	Open
7/11/2024 0:20	16.23	18.42	0.01	6.96	302.64	8.57	0.47	Open
7/11/2024 0:30	16.19	18.44	0.01	7.1	298.25	8.56	0.47	Open
7/11/2024 0:40	16.15	18.41	0.01	6.96	300.32	8.55	0.48	Open
7/11/2024 0:50	16.12	18.65	0.01	7.01	300.25	8.62	0.49	Open
7/11/2024 1:00	16.09	18.35	0.01	6.95	299.68	8.66	0.48	Open
7/11/2024 1:10	16.06	18.37	0.01	7.12	296.57	8.66	0.47	Open
7/11/2024 1:20	16.03	18.38	0.01	6.98	301.46	8.67	0.51	Open
7/11/2024 1:30	16	18.41	0.01	7.03	300.92	8.69	0.44	Open
7/11/2024 1:40	15.97	18.28	0.01	7	300.57	8.72	0.45	Open
7/11/2024 1:50	15.94	18.33	0.01	7.05	301.88	8.7	0.43	Open
7/11/2024 2:00	15.91	18.27	0.01	6.97	301.91	8.73	0.47	Open
7/11/2024 2:10	15.89	18.34	0.01	7.06	301.48	8.67	0.48	Open
7/11/2024 2:20	15.86	18.3	0.01	6.99	302.62	8.71	0.47	Open
7/11/2024 2:30	15.84	18.36	0.01	7.02	302.7	8.67	0.45	Open
7/11/2024 2:40	15.81	18.4	0.01	7	302.44	8.69	0.45	Open
7/11/2024 2:50	15.78	18.32	0.01	7.1	297.91	8.67	0.44	Open
7/11/2024 3:00	15.76	18.31	0.01	7	301.83	8.73	0.45	Open
7/11/2024 3:10	15.73	18.3	0.01	7.08	299.35	8.69	0.44	Open
7/11/2024 3:20	15.71	18.35	0.01	6.99	302.04	8.73	0.45	Open
7/11/2024 3:30	15.68	18.27	0.01	7.02	303.44	8.73	0.46	Open
7/11/2024 3:40	15.66	18.28	0.01	7	302.35	8.74	0.43	Open
7/11/2024 3:50	15.63	18.23	0.01	7.05	301.55	8.7	0.42	Open
7/11/2024 4:00	15.61	18.29	0.01	6.98	301.97	8.75	0.44	Open
7/11/2024 4:10	15.58	18.11	0.01	7.05	300.8	8.73	0.43	Open
7/11/2024 4:20	15.57	18.2	0.01	7	300.05	8.77	0.43	Open
7/11/2024 4:30	15.53	18.16	0.01	7.1	296.55	8.75	0.44	Open
7/11/2024 4:40	15.51	18.2	0.01	7.02	300.87	8.79	0.44	Open
7/11/2024 4:50	15.49	18.15	0.01	7.07	299.84	8.78	0.42	Open
7/11/2024 5:00	15.46	18.16	0.01	7.01	301.58	8.79	0.43	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/11/2024 5:10	15.44	18.16	0.01	7.07	300.98	8.79	0.42	Closed
7/11/2024 5:20	15.42	18.16	0.01	7.01	301.97	8.81	0.41	Closed
7/11/2024 5:30	15.4	18.17	0.01	7.05	301.85	8.8	0.55	Closed
7/11/2024 5:40	15.38	18.11	0.01	7.01	303.35	8.83	0.42	Closed
7/11/2024 5:50	15.36	18.07	0.01	7.07	300.69	8.82	0.42	Closed
7/11/2024 6:00	15.35	18.09	0.01	7.01	302.78	8.85	0.4	Open
7/11/2024 6:10	15.33	18.02	0.01	7.06	301.29	8.85	0.4	Open
7/11/2024 6:20	15.31	17.99	0.01	7.02	303	8.87	0.42	Open
7/11/2024 6:30	15.29	17.91	0.01	7.06	303.91	8.86	0.43	Open
7/11/2024 6:40	15.28	17.97	0.01	7.02	303.3	8.88	0.43	Closed
7/11/2024 6:50	15.26	18.04	0.01	7.07	303.19	8.88	0.42	Closed
7/11/2024 7:00	15.26	17.89	0.01	7.04	303.56	8.91	0.43	Open
7/11/2024 7:10	15.25	18.09	0.01	7.08	304.14	8.89	0.44	Open
7/11/2024 7:20	15.24	17.87	0.01	7.02	304.16	8.92	0.43	Open
7/11/2024 7:30	15.24	17.85	0.01	7.07	303.63	8.9	0.42	Open
7/11/2024 7:40	15.24	17.87	0.01	7.01	303.21	8.92	0.41	Closed
7/11/2024 7:50	15.24	17.86	0.01	7.08	302.09	8.92	0.4	Closed
7/11/2024 8:00	15.24	17.79	0.01	7.01	302.69	8.9	0.4	Closed
7/11/2024 8:10	15.25	17.84	0.01	7.08	303.65	8.92	0.41	Open
7/11/2024 8:20	15.26	17.82	0.01	7.02	303.89	8.94	0.42	Open
7/11/2024 8:30	15.27	17.97	0.01	7.04	305.11	8.91	0.43	Open
7/11/2024 8:40	15.29	17.85	0.01	7	302.27	8.95	0.41	Open
7/11/2024 8:50	15.31	17.93	0.01	7.12	296.01	8.95	0.42	Closed
7/11/2024 9:00	15.34	17.77	0.01	7.04	297.61	8.96	0.41	Closed
7/11/2024 9:10	15.37	17.92	0.01	7.11	297.93	8.95	0.42	Open
7/11/2024 9:20	15.41	17.8	0.01	7.04	299.24	8.89	0.41	Open
7/11/2024 9:30	15.42	18.04	0.01	7.12	299.48	8.85	0.44	Open
7/11/2024 9:40	15.45	17.83	0.01	7.03	298.95	8.91	1.42	Closed
7/11/2024 9:50	15.45	17.91	0.01	7.11	300.13	8.86	0.43	Closed
7/11/2024 10:00	15.46	17.91	0.01	7.04	301.26	8.81	0.44	Closed
7/11/2024 10:10	15.49	17.94	0.01	7.1	303.52	8.76	0.48	Closed
7/11/2024 10:20	15.53	17.74	0.01	7	300.08	8.77	0.45	Closed
7/11/2024 10:30	15.58	17.73	0.01	7.11	301.61	8.76	0.45	Open
7/11/2024 10:40	15.63	17.67	0.01	7.03	301.59	8.84	0.41	Open
7/11/2024 10:50	15.76	17.8	0.01	7.09	300.95	8.72	0.42	Open
7/11/2024 11:00	15.87	17.48	0.01	7.03	299.18	8.83	0.48	Open
7/11/2024 11:10	15.97	17.54	0.01	7.12	298.73	8.8	0.42	Open
7/11/2024 11:20	16.07	17.55	0.01	7.06	298.89	8.81	0.45	Open
7/11/2024 11:30	16.17	17.34	0.01	7.15	298.38	8.77	0.46	Open
7/11/2024 11:40	16.26	17.51	0.01	7.01	298.86	8.88	0.46	Open
7/11/2024 11:50	16.4	17.39	0.01	7.13	298.58	8.77	0.49	Open
7/11/2024 12:00	16.49	17.43	0.01	6.99	298.11	8.84	0.45	Open
7/11/2024 12:10	16.57	17.33	0.01	7.12	301.03	8.76	0.5	Open
7/11/2024 12:20	16.62	17.49	0.01	7.12	298.13	8.85	0.48	Open
7/11/2024 12:30	16.63	17.43	0.01	7.21	300.91	8.82	0.5	Open
7/11/2024 12:40	16.65	17.32	0.01	7.08	301.46	8.77	0.54	Closed
7/11/2024 12:50	16.67	17.43	0.01	7.23	298.74	8.77	0.5	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/11/2024 13:00	16.7	17.35	0.01	7.1	302.29	8.75	0.5	Closed
7/11/2024 13:10	16.72	17.4	0.01	7.18	301.25	8.72	0.48	Closed
7/11/2024 13:20	16.76	17.31	0.01	7.04	301.21	8.75	0.49	Closed
7/11/2024 13:30	16.79	17.41	0.01	7.23	300.44	8.72	0.48	Closed
7/11/2024 13:40	16.83	17.21	0.01	7.07	304.03	8.68	0.52	Closed
7/11/2024 13:50	16.83	17.67	0.01	7.19	303.06	8.67	0.5	Closed
7/11/2024 14:00	16.86	17.26	0.01	7.07	302.36	8.7	0.5	Closed
7/11/2024 14:10	16.89	17.38	0.01	7.2	301.15	8.57	0.51	Closed
7/11/2024 14:20	16.89	17.44	0.01	7.07	301.91	8.62	0.5	Closed
7/11/2024 14:30	16.91	17.43	0.01	7.19	299.78	8.51	0.47	Closed
7/11/2024 14:40	16.94	17.39	0.01	7.03	303.05	8.51	0.5	Closed
7/11/2024 14:50	16.98	17.4	0.01	7.17	301.61	8.43	0.51	Closed
7/11/2024 15:00	17.02	17.31	0.01	7.01	302.18	8.53	0.51	Closed
7/11/2024 15:10	17.05	17.37	0.01	7.12	304.68	8.4	0.51	Closed
7/11/2024 15:20	17.06	17.3	0.01	7.08	303.84	8.55	0.54	Closed
7/11/2024 15:30	17.08	17.41	0.01	7.11	307.21	8.4	0.51	Closed
7/11/2024 15:40	17.13	17.34	0.01	7.02	302.03	8.43	0.53	Closed
7/11/2024 15:50	17.17	17.47	0.01	7.1	303.08	8.41	0.53	Closed
7/11/2024 16:00	17.2	17.48	0.01	7.01	303.26	8.48	0.53	Closed
7/11/2024 16:10	17.2	17.36	0.01	7.16	305.21	8.27	0.54	Closed
7/11/2024 16:20	17.22	17.38	0.01	7.04	306.12	8.35	0.52	Closed
7/11/2024 16:30	17.26	17.42	0.01	7.13	304.02	8.24	0.52	Closed
7/11/2024 16:40	17.3	17.34	0.01	6.98	304.98	8.32	0.53	Closed
7/11/2024 16:50	17.3	17.49	0.01	7.07	306.84	8.3	0.65	Closed
7/11/2024 17:00	17.3	17.61	0.01	7.01	305.76	8.31	1.44	Closed
7/11/2024 17:10	17.29	17.9	0.01	7.16	306.3	8.34	2.53	Closed
7/11/2024 17:20	17.28	18.1	0.01	7.06	305.92	8.4	3.62	Closed
7/11/2024 17:30	17.28	18.07	0.01	7.1	306.99	8.33	3.88	Closed
7/11/2024 17:40	17.28	18.2	0.01	7.04	306.32	8.35	3.99	Closed
7/11/2024 17:50	17.27	18.22	0.01	7.1	305.44	8.21	3.08	Closed
7/11/2024 18:00	17.26	18.37	0.01	6.98	306.65	8.19	2.77	Closed
7/11/2024 18:10	17.25	18.39	0.01	7.01	309.25	8.05	2.07	Closed
7/11/2024 18:20	17.24	18.57	0.01	7.01	308.16	8	1.9	Closed
7/11/2024 18:30	17.22	18.63	0.01	6.99	309.23	7.87	1.58	Closed
7/11/2024 18:40	17.21	18.43	0.01	6.95	309.03	7.83	1.26	Closed
7/11/2024 18:50	17.18	18.33	0.01	7.02	308.2	7.8	0.99	Closed
7/11/2024 19:00	17.18	18.22	0.01	6.95	307.81	7.86	0.78	Closed
7/11/2024 19:10	17.15	18.18	0.01	7.03	307.73	7.79	0.76	Closed
7/11/2024 19:20	17.13	18.32	0.01	6.97	308.2	8.02	0.9	Closed
7/11/2024 19:30	17.1	18.51	0.01	7.04	309.52	8.03	0.78	Closed
7/11/2024 19:40	17.09	18.47	0.01	7	308.11	8.12	0.81	Closed
7/11/2024 19:50	17.06	18.64	0.01	7.05	307.78	8.03	0.85	Closed
7/11/2024 20:00	17.05	18.71	0.01	6.98	307.53	8.15	0.88	Closed
7/11/2024 20:10	17.02	18.6	0.01	7.07	304.01	8.08	0.85	Closed
7/11/2024 20:20	17.01	18.8	0.01	6.98	305.86	8.17	0.86	Closed
7/11/2024 20:30	16.97	18.96	0.01	7.06	305.44	8.13	0.78	Closed
7/11/2024 20:40	16.95	18.97	0.01	6.97	306.03	8.2	0.78	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/11/2024 20:50	16.92	19.01	0.01	7.06	306.63	8.2	0.69 Closed
7/11/2024 21:00	16.9	19.04	0.01	6.85	308.25	8.23	0.7 Closed
7/11/2024 21:10	16.84	19.17	0.01	6.95	309.43	8.15	0.74 Closed
7/11/2024 21:20	16.79	19.28	0.01	6.71	308.85	8	0.63 Closed
7/11/2024 21:30	16.74	19.35	0.01	6.9	311	8.15	0.62 Open
7/11/2024 21:40	16.71	19.55	0.01	6.78	308.31	8.16	0.63 Open
7/11/2024 21:50	16.66	19.68	0.01	6.99	308.2	8.26	0.66 Open
7/11/2024 22:00	16.62	19.79	0.01	6.94	306.06	8.35	0.66 Open
7/11/2024 22:10	16.58	20.02	0.01	6.94	304.47	8.35	0.63 Open
7/11/2024 22:20	16.55	19.97	0.01	6.96	305.74	8.33	0.68 Open
7/11/2024 22:30	16.5	20.09	0.01	6.95	304.9	8.35	0.66 Open
7/11/2024 22:40	16.47	20.19	0.01	6.91	304.07	8.32	0.66 Open
7/11/2024 22:50	16.42	20.07	0.01	7.17	303.27	8.38	0.77 Open
7/11/2024 23:00	16.39	20.26	0.01	7	302.13	8.41	0.65 Open
7/11/2024 23:10	16.34	20.2	0.01	7.17	300.51	8.4	0.64 Open
7/11/2024 23:20	16.31	20.32	0.01	6.97	301.63	8.43	0.63 Open
7/11/2024 23:30	16.27	20.31	0.01	7.08	299.63	8.37	0.63 Open
7/11/2024 23:40	16.24	20.33	0.01	6.95	299.2	8.4	0.64 Open
7/11/2024 23:50	16.21	20.22	0.01	7.05	296.42	8.42	0.65 Open
7/12/2024 0:00	16.18	20.41	0.01	6.99	297.69	8.48	0.65 Open
7/12/2024 0:10	16.15	20.47	0.01	7.07	295.36	8.37	0.58 Open
7/12/2024 0:20	16.12	20.37	0.01	6.95	296.69	8.47	0.65 Open
7/12/2024 0:30	16.09	20.39	0.01	7.12	291.3	8.54	1.58 Open
7/12/2024 0:40	16.07	20.45	0.01	7.02	296.72	8.54	5.17 Open
7/12/2024 0:50	16.03	20.57	0.01	7.11	296.62	8.53	0.72 Open
7/12/2024 1:00	16.02	20.63	0.01	7.03	296.97	8.55	0.64 Open
7/12/2024 1:10	15.98	20.62	0.01	7.11	296.47	8.55	0.68 Open
7/12/2024 1:20	15.96	20.63	0.01	7.02	298.27	8.58	0.57 Open
7/12/2024 1:30	15.93	20.36	0.01	7.09	298.76	8.55	0.55 Open
7/12/2024 1:40	15.9	20.45	0.01	7.05	297.9	8.6	0.58 Open
7/12/2024 1:50	15.87	20.61	0.01	7.1	299.51	8.58	0.73 Open
7/12/2024 2:00	15.85	20.5	0.01	7.05	300.77	8.6	0.6 Open
7/12/2024 2:10	15.81	20.53	0.01	7.07	301.78	8.58	0.62 Open
7/12/2024 2:20	15.8	20.52	0.01	7.05	301.5	8.58	0.56 Open
7/12/2024 2:30	15.76	20.48	0.01	7.07	298.71	8.58	0.52 Open
7/12/2024 2:40	15.75	20.54	0.01	7.02	301.39	8.58	0.61 Open
7/12/2024 2:50	15.71	20.49	0.01	7.09	298.38	8.56	3.8 Open
7/12/2024 3:00	15.69	20.45	0.01	6.94	301.88	8.58	0.56 Open
7/12/2024 3:10	15.66	20.45	0.01	7.09	301.06	8.54	0.53 Open
7/12/2024 3:20	15.64	20.45	0.01	7.02	302.34	8.58	5.89 Open
7/12/2024 3:30	15.61	20.73	0.01	7.03	302.54	8.55	0.56 Open
7/12/2024 3:40	15.6	20.56	0.01	7.01	301.91	8.57	0.92 Open
7/12/2024 3:50	15.57	20.67	0.01	7.09	300.25	8.55	0.54 Open
7/12/2024 4:00	15.55	20.43	0.01	7	302.45	8.55	0.54 Open
7/12/2024 4:10	15.52	20.46	0.01	7.06	301.54	8.5	0.5 Open
7/12/2024 4:20	15.5	20.32	0.01	7.01	303.33	8.5	0.52 Open
7/12/2024 4:30	15.48	20.47	0.01	7.05	302.86	8.48	0.51 Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/12/2024 4:40	15.46	20.3	0.01	7.02	301.28	8.55	0.54	Open
7/12/2024 4:50	15.43	20.29	0.01	7.03	301.95	8.48	0.49	Closed
7/12/2024 5:00	15.42	20.28	0.01	7	302.56	8.49	0.49	Closed
7/12/2024 5:10	15.39	20.36	0.01	7.08	299.66	8.55	0.5	Closed
7/12/2024 5:20	15.37	20.34	0.01	7.03	302.94	8.51	0.48	Closed
7/12/2024 5:30	15.35	20.25	0.01	7.04	301.73	8.55	0.5	Closed
7/12/2024 5:40	15.34	20.38	0.01	7.04	302.35	8.52	0.52	Closed
7/12/2024 5:50	15.31	20.21	0.01	7.07	298.28	8.53	0.51	Closed
7/12/2024 6:00	15.3	20.38	0.01	7.03	301.28	8.59	0.49	Open
7/12/2024 6:10	15.28	20.34	0.01	7.1	298.58	8.61	0.51	Open
7/12/2024 6:20	15.26	20.21	0.01	7.06	300.86	8.7	0.49	Open
7/12/2024 6:30	15.24	20.19	0.01	7.09	298.14	8.75	0.5	Open
7/12/2024 6:40	15.23	20.12	0.01	7.05	300.6	8.8	0.49	Open
7/12/2024 6:50	15.22	20.2	0.01	7.08	300.53	8.78	0.49	Open
7/12/2024 7:00	15.21	20.14	0.01	7.06	302.02	8.76	0.5	Open
7/12/2024 7:10	15.2	20.07	0.01	7.07	301.9	8.78	0.48	Open
7/12/2024 7:20	15.19	19.99	0.01	7.04	302.6	8.78	0.52	Open
7/12/2024 7:30	15.18	20.1	0.01	7.07	301.52	8.76	0.48	Open
7/12/2024 7:40	15.18	20	0.01	7.05	302.48	8.8	0.48	Open
7/12/2024 7:50	15.17	19.99	0.01	7.09	301.22	8.81	0.5	Open
7/12/2024 8:00	15.18	19.88	0.01	7.07	303.56	8.86	0.48	Open
7/12/2024 8:10	15.18	19.97	0.01	7.11	300.64	8.94	0.8	Open
7/12/2024 8:20	15.18	19.87	0.01	7.09	301.47	8.95	0.55	Open
7/12/2024 8:30	15.19	20	0.01	7.13	299.32	8.92	0.62	Open
7/12/2024 8:40	15.2	20.04	0.01	7.03	303.28	8.91	0.6	Open
7/12/2024 8:50	15.22	20.04	0.01	7.09	302.19	8.92	0.63	Open
7/12/2024 9:00	15.26	20.07	0.01	7.04	300.57	8.9	0.63	Open
7/12/2024 9:10	15.29	19.68	0.01	7.12	300.76	8.87	0.64	Open
7/12/2024 9:20	15.32	19.73	0.01	7.06	302.96	8.89	0.52	Open
7/12/2024 9:30	15.34	19.6	0.01	7.14	301.49	8.87	0.49	Open
7/12/2024 9:40	15.37	19.39	0.01	7.08	302.27	8.89	0.48	Open
7/12/2024 9:50	15.37	19.33	0.01	7.2	298.95	8.89	0.46	Open
7/12/2024 10:00	15.39	19.1	0.01	7.08	302.16	8.88	0.46	Open
7/12/2024 10:10	15.41	19.14	0.01	7.1	303.05	8.88	0.45	Open
7/12/2024 10:20	15.44	18.9	0.01	7.11	304.47	8.88	0.44	Open
7/12/2024 10:30	15.48	18.83	0.01	7.13	303.6	8.87	0.44	Open
7/12/2024 10:40	15.55	18.8	0.01	7.09	302.97	8.87	0.43	Open
7/12/2024 10:50	15.65	18.79	0.01	7.18	300.92	8.86	0.49	Open
7/12/2024 11:00	15.78	18.48	0.01	7.08	303.47	8.87	0.43	Open
7/12/2024 11:10	15.87	18.44	0.01	7.18	301.42	8.89	0.45	Open
7/12/2024 11:20	15.98	18.41	0.01	7.11	301.4	8.86	0.46	Open
7/12/2024 11:30	16.07	18.33	0.01	7.17	299.68	8.86	0.46	Open
7/12/2024 11:40	16.18	18.32	0.01	7.12	299.96	8.85	0.49	Open
7/12/2024 11:40	16.18	18.32	0.01	7.12	299.96	8.85	0.49	Open
7/12/2024 11:50	16.28	18.36	0.01	7.19	298.7	8.86	0.47	Open
7/12/2024 12:00	16.38	18.21	0.01	7.13	299.32	8.85	0.47	Open
7/12/2024 12:10	16.44	18.29	0.01	7.19	299.21	8.84	0.45	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/12/2024 12:20	16.5	18.22	0.01	7.09	299.56	8.85	0.47	Open
7/12/2024 12:30	16.52	18.35	0.01	7.16	299.88	8.83	0.49	Open
7/12/2024 12:40	16.56	18.2	0.01	7.12	299.64	8.78	0.48	Open
7/12/2024 12:50	16.55	18.33	0.01	7.22	297.47	8.81	0.48	Closed
7/12/2024 13:00	16.58	18.09	0.01	7.11	299.89	8.78	0.49	Closed
7/12/2024 13:10	16.61	17.94	0.01	7.21	299.13	8.75	0.51	Closed
7/12/2024 13:20	16.67	18.19	0.01	7.08	301.12	8.74	0.49	Closed
7/12/2024 13:30	16.74	18.06	0.01	7.17	300.78	8.71	0.5	Closed
7/12/2024 13:40	16.79	18.12	0.01	7.11	298.87	8.72	0.51	Closed
7/12/2024 13:50	16.78	18.09	0.01	7.16	302.48	8.7	0.5	Closed
7/12/2024 14:00	16.83	17.93	0.01	7.04	302.95	8.65	0.5	Closed
7/12/2024 14:10	16.89	18.37	0.01	7.13	303.8	8.66	0.5	Closed
7/12/2024 14:20	16.92	18.03	0.01	7.08	302.81	8.65	0.5	Closed
7/12/2024 14:30	16.9	18.01	0.01	7.13	305.19	8.63	0.5	Closed
7/12/2024 14:40	16.94	17.81	0.01	7.06	304.37	8.61	0.51	Closed
7/12/2024 14:50	16.98	17.82	0.01	7.17	302.05	8.53	0.51	Closed
7/12/2024 15:00	17.04	17.77	0.01	7.07	303.54	8.55	0.52	Closed
7/12/2024 15:10	17.07	17.86	0.01	7.14	303.58	8.58	0.52	Closed
7/12/2024 15:20	17.12	18.03	0.01	7.08	303.09	8.54	0.53	Closed
7/12/2024 15:30	17.14	18.11	0.01	7.16	302.39	8.55	0.54	Closed
7/12/2024 15:40	17.21	18.1	0.01	7.03	303.6	8.52	0.56	Closed
7/12/2024 15:50	17.21	18.41	0.01	7.15	302.15	8.48	0.55	Closed
7/12/2024 16:00	17.22	18.04	0.01	7.06	304.89	8.4	0.57	Closed
7/12/2024 16:10	17.23	17.56	0.01	7.16	298.84	8.58	1.07	Closed
7/12/2024 16:20	17.24	17.99	0.01	7.21	300.99	8.55	0.61	Closed
7/12/2024 16:30	17.27	17.93	0.01	7.26	298.3	8.55	0.53	Closed
7/12/2024 16:40	17.28	18.11	0.01	7.23	299.02	8.53	0.53	Closed
7/12/2024 16:50	17.26	18.29	0.01	7.16	299.65	8.52	0.57	Closed
7/12/2024 17:00	17.27	18.32	0.01	7.18	299.63	8.52	0.57	Closed
7/12/2024 17:10	17.28	18.49	0.01	7.19	296.58	8.51	0.59	Closed
7/12/2024 17:20	17.29	18.52	0.01	7.11	298.02	8.53	0.63	Closed
7/12/2024 17:30	17.3	18.66	0.01	7.14	297.69	8.52	0.58	Closed
7/12/2024 17:40	17.31	19.02	0.01	7.12	297.65	8.52	0.63	Closed
7/12/2024 17:50	17.31	19.29	0.01	7.13	297.94	8.51	0.65	Closed
7/12/2024 18:00	17.32	19.46	0.01	7.12	297.74	8.52	0.62	Closed
7/12/2024 18:10	17.32	19.56	0.01	7.14	296.43	8.53	7.76	Closed
7/12/2024 18:20	17.3	19.67	0.01	7.11	298.05	8.5	0.67	Closed
7/12/2024 18:30	17.27	19.73	0.01	7.12	298	8.51	0.65	Closed
7/12/2024 18:40	17.24	19.87	0.01	7.14	297.75	8.49	1.07	Closed
7/12/2024 18:50	17.22	20.08	0.01	7.15	298.61	8.52	1.45	Closed
7/12/2024 19:00	17.19	20.01	0.01	7.14	298.69	8.51	0.71	Closed
7/12/2024 19:10	17.17	20.01	0.01	7.12	297.03	8.52	0.6	Closed
7/12/2024 19:20	17.14	20.08	0.01	7.07	299.03	8.51	0.64	Closed
7/12/2024 19:30	17.12	20.12	0.01	7.18	298.08	8.53	0.66	Closed
7/12/2024 19:40	17.09	20.25	0.01	7.1	299.34	8.53	0.66	Closed
7/12/2024 19:50	17.06	20.26	0.01	7.15	294.99	8.53	0.63	Closed
7/12/2024 20:00	17.04	20.27	0.01	7.09	297.8	8.55	0.62	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/12/2024 20:10	17	20.35	0.01	7.09	298.16	8.54	0.63	Open
7/12/2024 20:20	16.97	20.49	0.01	7.07	297.67	8.54	0.62	Open
7/12/2024 20:30	16.94	20.53	0.01	7.1	299.3	8.54	0.65	Open
7/12/2024 20:40	16.9	20.66	0.01	7.11	297.11	8.55	0.62	Open
7/12/2024 20:50	16.87	20.61	0.01	7.24	292.13	8.56	0.63	Open
7/12/2024 21:00	16.84	20.68	0.01	7.09	294.53	8.56	0.61	Open
7/12/2024 21:10	16.81	20.63	0.01	7.16	292.69	8.56	0.65	Open
7/12/2024 21:20	16.78	20.76	0.01	7.09	295.14	8.57	0.61	Open
7/12/2024 21:30	16.75	20.74	0.01	7.16	294.27	8.57	0.63	Open
7/12/2024 21:40	16.71	20.69	0.01	7.1	295.5	8.59	0.6	Open
7/12/2024 21:50	16.68	20.71	0.01	7.14	293.56	8.6	0.63	Closed
7/12/2024 22:00	16.65	20.72	0.01	7.08	294.51	8.6	0.61	Closed
7/12/2024 22:10	16.62	20.59	0.01	7.14	292.64	8.6	0.62	Closed
7/12/2024 22:20	16.59	20.64	0.01	7.08	294.49	8.59	0.63	Closed
7/12/2024 22:30	16.56	20.62	0.01	7.13	293.45	8.6	0.6	Closed
7/12/2024 22:40	16.54	20.71	0.01	7.08	294.48	8.62	0.59	Closed
7/12/2024 22:50	16.51	20.67	0.01	7.12	292.67	8.63	0.64	Open
7/12/2024 23:00	16.48	20.79	0.01	7.08	293.6	8.63	0.59	Open
7/12/2024 23:10	16.46	20.35	0.01	7.11	293.55	8.64	0.58	Open
7/12/2024 23:20	16.43	20.66	0.01	7.08	292.48	8.64	0.59	Closed
7/12/2024 23:30	16.41	20.43	0.01	7.18	290.18	8.65	0.65	Closed
7/12/2024 23:40	16.38	20.65	0.01	7.09	293.29	8.66	0.58	Closed
7/12/2024 23:50	16.36	20.61	0.01	7.11	292.16	8.66	0.59	Closed
7/13/2024 0:00	16.34	20.61	0.01	7.09	292.55	8.68	0.63	Closed
7/13/2024 0:10	16.31	20.49	0.01	7.13	292.29	8.68	0.61	Closed
7/13/2024 0:20	16.29	20.57	0.01	7.09	292.8	8.67	0.59	Closed
7/13/2024 0:30	16.27	20.25	0.01	7.14	290.91	8.68	0.6	Closed
7/13/2024 0:40	16.25	20.58	0.01	7.12	294.08	8.68	0.61	Closed
7/13/2024 0:50	16.22	20.53	0.01	7.16	291.51	8.71	0.57	Closed
7/13/2024 1:00	16.2	20.63	0.01	7.09	294.88	8.7	0.56	Closed
7/13/2024 1:10	16.18	20.38	0.01	7.14	293.89	8.72	0.58	Closed
7/13/2024 1:20	16.16	20.6	0.01	7.1	294.51	8.73	0.58	Closed
7/13/2024 1:30	16.14	20.56	0.01	7.12	294.15	8.7	0.59	Closed
7/13/2024 1:40	16.12	20.58	0.01	7.1	294.42	8.71	0.58	Closed
7/13/2024 1:50	16.09	20.47	0.01	7.1	294.78	8.72	0.61	Closed
7/13/2024 2:00	16.07	20.53	0.01	7.09	293.99	8.73	1.19	Closed
7/13/2024 2:10	16.04	20.47	0.01	7.12	292.32	8.74	0.57	Closed
7/13/2024 2:20	16.02	20.52	0.01	7.09	292.52	8.73	0.59	Closed
7/13/2024 2:30	16	20.44	0.01	7.12	291.42	8.74	0.61	Closed
7/13/2024 2:40	15.98	20.45	0.01	7.07	292.35	8.74	0.63	Closed
7/13/2024 2:50	15.96	20.48	0.01	7.1	291.63	8.75	0.6	Closed
7/13/2024 3:00	15.94	20.53	0.01	7.08	291.61	8.74	0.58	Closed
7/13/2024 3:10	15.92	20.42	0.01	7.12	291.14	8.76	0.6	Closed
7/13/2024 3:20	15.9	20.43	0.01	7.08	292.4	8.77	0.62	Closed
7/13/2024 3:30	15.88	20.45	0.01	7.1	292.26	8.76	0.57	Closed
7/13/2024 3:40	15.86	20.39	0.01	7.09	292.87	8.75	0.57	Closed
7/13/2024 3:50	15.84	20.39	0.01	7.1	293.41	8.77	0.58	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/13/2024 4:00	15.82	20.41	0.01	7.09	292.32	8.77	0.57	Closed
7/13/2024 4:10	15.8	20.33	0.01	7.15	289.76	8.79	0.56	Closed
7/13/2024 4:20	15.78	20.34	0.01	7.09	291.89	8.79	0.59	Closed
7/13/2024 4:30	15.76	20.41	0.01	7.09	293.81	8.8	0.6	Closed
7/13/2024 4:40	15.74	20.33	0.01	7.09	293.26	8.81	0.61	Closed
7/13/2024 4:50	15.73	20.25	0.01	7.11	293.19	8.81	0.57	Closed
7/13/2024 5:00	15.71	20.33	0.01	7.1	292.45	8.8	0.52	Closed
7/13/2024 5:10	15.69	20.11	0.01	7.15	290.3	8.81	0.99	Closed
7/13/2024 5:20	15.68	20.3	0.01	7.1	292.08	8.85	0.55	Closed
7/13/2024 5:30	15.66	20.28	0.01	7.12	290.73	8.81	0.54	Closed
7/13/2024 5:40	15.65	20.27	0.01	7.1	292.23	8.81	0.57	Closed
7/13/2024 5:50	15.63	20.25	0.01	7.12	290.23	8.81	0.54	Closed
7/13/2024 6:00	15.62	20.23	0.01	7.1	291.12	8.85	0.56	Closed
7/13/2024 6:10	15.6	20.03	0.01	7.15	288.92	8.85	0.54	Open
7/13/2024 6:20	15.6	20.18	0.01	7.11	290.21	8.85	0.56	Open
7/13/2024 6:30	15.58	19.99	0.01	7.16	287.8	8.85	0.63	Open
7/13/2024 6:40	15.57	20.17	0.01	7.11	290.49	8.86	0.55	Open
7/13/2024 6:50	15.56	20.01	0.01	7.11	290.91	8.87	0.57	Open
7/13/2024 7:00	15.55	20.08	0.01	7.11	290.18	8.88	0.54	Open
7/13/2024 7:10	15.54	19.91	0.01	7.17	288	8.87	0.55	Open
7/13/2024 7:20	15.54	20.05	0.01	7.11	290.26	8.89	0.56	Open
7/13/2024 7:30	15.53	19.99	0.01	7.13	289.89	8.9	0.6	Open
7/13/2024 7:40	15.53	19.99	0.01	7.1	291.17	8.9	0.53	Open
7/13/2024 7:50	15.53	20.02	0.01	7.09	292.29	8.9	0.56	Open
7/13/2024 8:00	15.53	20.11	0.01	7.11	290.21	8.88	0.54	Open
7/13/2024 8:10	15.53	19.93	0.01	7.11	290.46	8.9	0.59	Open
7/13/2024 8:20	15.54	20.06	0.01	7.11	291.63	8.9	0.65	Open
7/13/2024 8:30	15.54	20.05	0.01	7.13	292.86	8.92	0.59	Open
7/13/2024 8:40	15.56	20.24	0.01	7.11	293.41	8.91	0.57	Open
7/13/2024 8:50	15.59	20.11	0.01	7.16	291.42	8.89	0.62	Open
7/13/2024 9:00	15.62	20.18	0.01	7.17	291.98	8.9	0.59	Open
7/13/2024 9:10	15.67	19.88	0.01	7.19	290.39	8.91	0.55	Open
7/13/2024 9:20	15.69	19.77	0.01	7.13	291.83	8.89	0.64	Open
7/13/2024 9:30	15.71	19.52	0.01	7.16	292.56	8.92	0.5	Open
7/13/2024 9:40	15.72	19.57	0.01	7.28	292.43	8.9	0.47	Open
7/13/2024 9:50	15.74	19.44	0.01	7.3	293.4	8.88	0.51	Open
7/13/2024 10:00	15.77	19.51	0.01	7.13	294.88	8.85	0.47	Open
7/13/2024 10:10	15.79	19.3	0.01	7.19	292.12	8.84	0.48	Open
7/13/2024 10:20	15.84	19.31	0.01	7.17	293.9	8.83	0.49	Open
7/13/2024 10:30	15.91	19.14	0.01	7.15	295.79	8.82	0.48	Open
7/13/2024 10:40	16	18.63	0.01	7.16	292.15	8.9	0.49	Open
7/13/2024 10:50	16.12	18.29	0.01	7.22	290.56	8.87	0.48	Open
7/13/2024 11:00	16.24	18.76	0.01	7.19	290.5	8.91	0.57	Open
7/13/2024 11:10	16.32	19	0.01	7.26	288.03	8.92	0.63	Open
7/13/2024 11:20	16.38	19.31	0.01	7.21	289.44	8.89	1.27	Open
7/13/2024 11:30	16.44	19.43	0.01	7.27	287.47	8.91	1.43	Open
7/13/2024 11:40	16.52	19.66	0.01	7.23	288.04	8.9	4.97	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/13/2024 11:50	16.6	19.77	0.01	7.27	285.67	8.89	8.93	Closed
7/13/2024 12:00	16.67	20.35	0.01	7.26	284.97	8.88	6.39	Closed
7/13/2024 12:10	16.75	20.51	0.01	7.29	286.2	8.86	3.44	Closed
7/13/2024 12:20	16.75	20.4	0.01	7.27	285.15	8.85	2.47	Closed
7/13/2024 12:30	16.76	20.21	0.01	7.31	283.99	8.85	1.39	Closed
7/13/2024 12:40	16.78	20.5	0.01	7.27	284.05	8.82	1.26	Closed
7/13/2024 12:50	16.82	20.4	0.01	7.32	283.63	8.82	1.04	Closed
7/13/2024 13:00	16.84	20.42	0.01	7.28	283.63	8.79	1.04	Closed
7/13/2024 13:10	16.89	20.46	0.01	7.3	283.63	8.75	1.15	Closed
7/13/2024 13:20	16.93	20.38	0.01	7.3	283.24	8.75	1.01	Closed
7/13/2024 13:30	17	20.15	0.01	7.33	281.53	8.73	0.96	Closed
7/13/2024 13:40	17.04	20.36	0.01	7.3	281.35	8.72	0.99	Closed
7/13/2024 13:50	17.08	20.37	0.01	7.39	280.91	8.7	1	Closed
7/13/2024 14:00	17.11	20.4	0.01	7.26	282.08	8.68	0.97	Closed
7/13/2024 14:10	17.17	20.42	0.01	7.27	282.51	8.66	0.93	Closed
7/13/2024 14:20	17.19	20.48	0.01	7.26	281.38	8.65	0.89	Closed
7/13/2024 14:30	17.23	20.09	0.01	7.32	281.23	8.64	0.9	Closed
7/13/2024 14:40	17.27	20.33	0.01	7.34	281.58	8.62	0.87	Closed
7/13/2024 14:50	17.31	20.12	0.01	7.33	280.2	8.62	0.86	Closed
7/13/2024 15:00	17.35	20.4	0.01	7.32	281.91	8.6	0.84	Closed
7/13/2024 15:10	17.38	20.41	0.01	7.29	283.15	8.61	0.88	Closed
7/13/2024 15:20	17.4	20.42	0.01	7.31	283.68	8.6	0.84	Closed
7/13/2024 15:30	17.44	20.18	0.01	7.37	282.85	8.59	0.94	Closed
7/13/2024 15:40	17.48	20.53	0.01	7.36	282.31	8.6	0.81	Closed
7/13/2024 15:40	17.48	20.53	0.01	7.36	282.31	8.6	0.81	Closed
7/13/2024 15:50	17.49	20.4	0.01	7.41	281.57	8.58	0.86	Closed
7/13/2024 16:00	17.52	20.51	0.01	7.36	283.18	8.57	0.91	Closed
7/13/2024 16:10	17.52	20.43	0.01	7.35	283.82	8.58	0.93	Closed
7/13/2024 16:20	17.55	20.49	0.01	7.33	283.68	8.53	0.87	Closed
7/13/2024 16:30	17.58	20.52	0.01	7.36	283.7	8.52	0.75	Closed
7/13/2024 16:40	17.59	20.65	0.01	7.3	284.55	8.5	0.8	Closed
7/13/2024 16:50	17.59	20.63	0.01	7.31	285.61	8.48	0.89	Closed
7/13/2024 17:00	17.58	20.74	0.01	7.32	284.38	8.49	0.82	Closed
7/13/2024 17:10	17.58	20.68	0.01	7.32	285.88	8.48	0.81	Closed
7/13/2024 17:20	17.58	20.73	0.01	7.2	286.06	8.49	0.91	Closed
7/13/2024 17:30	17.55	20.91	0.01	7.19	286.3	8.47	0.82	Closed
7/13/2024 17:40	17.54	20.84	0.01	7.24	286.35	8.47	0.82	Closed
7/13/2024 17:50	17.53	20.74	0.01	7.22	288.18	8.47	0.84	Closed
7/13/2024 18:00	17.52	20.92	0.01	7.23	287.82	8.47	0.85	Closed
7/13/2024 18:10	17.5	20.89	0.01	7.24	287.91	8.48	0.85	Closed
7/13/2024 18:20	17.48	21.02	0.01	7.21	287.62	8.45	0.83	Closed
7/13/2024 18:30	17.45	20.96	0.01	7.19	290.25	8.46	0.79	Closed
7/13/2024 18:40	17.42	21.1	0.01	7.2	287.83	8.46	0.79	Closed
7/13/2024 18:50	17.39	21.04	0.01	7.26	285.07	8.47	0.8	Closed
7/13/2024 19:00	17.37	21.15	0.01	7.17	287.87	8.48	0.77	Closed
7/13/2024 19:10	17.35	21.11	0.01	7.21	289.17	8.47	0.75	Closed
7/13/2024 19:20	17.33	21.24	0.01	7.19	287.99	8.46	0.75	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/13/2024 19:30	17.31	21.14	0.01	7.23	288.17	8.48	0.74	Closed
7/13/2024 19:40	17.28	21.32	0.01	7.2	288.75	8.48	0.73	Closed
7/13/2024 19:50	17.25	21	0.01	7.2	288.52	8.48	0.71	Open
7/13/2024 20:00	17.22	21.27	0.01	7.19	289.41	8.48	0.72	Open
7/13/2024 20:10	17.18	20.92	0.01	7.22	288.06	8.49	0.83	Open
7/13/2024 20:20	17.15	21.33	0.01	7.21	288.19	8.5	0.71	Open
7/13/2024 20:30	17.11	21.39	0.01	7.17	288.74	8.52	0.71	Open
7/13/2024 20:40	17.08	21.4	0.01	7.17	288.1	8.52	0.79	Open
7/13/2024 20:50	17.04	21.26	0.01	7.21	287.63	8.51	0.73	Open
7/13/2024 21:00	17.01	21.51	0.01	7.21	288.85	8.51	0.66	Open
7/13/2024 21:10	16.97	21.2	0.01	7.18	289.69	8.53	0.69	Open
7/13/2024 21:20	16.94	21.55	0.01	7.22	289.05	8.52	0.73	Open
7/13/2024 21:30	16.91	21.19	0.01	7.23	287.78	8.53	0.68	Open
7/13/2024 21:40	16.87	21.52	0.01	7.2	289.43	8.55	0.68	Open
7/13/2024 21:50	16.84	21.44	0.01	7.26	287.92	8.56	0.76	Open
7/13/2024 22:00	16.81	21.63	0.01	7.2	288.43	8.55	0.71	Open
7/13/2024 22:10	16.77	21.48	0.01	7.22	287.33	8.56	0.7	Open
7/13/2024 22:20	16.74	21.51	0.01	7.17	287.77	8.56	0.83	Open
7/13/2024 22:30	16.7	21.46	0.01	7.23	286.57	8.58	0.72	Open
7/13/2024 22:40	16.67	21.6	0.01	7.14	287.49	8.57	0.74	Open
7/13/2024 22:50	16.64	21.49	0.01	7.24	286.16	8.58	0.83	Open
7/13/2024 23:00	16.61	21.53	0.01	7.17	287.07	8.59	0.69	Open
7/13/2024 23:10	16.58	21.12	0.01	7.24	285.75	8.6	0.67	Open
7/13/2024 23:20	16.54	21.41	0.01	7.2	288.37	8.61	0.71	Open
7/13/2024 23:30	16.51	21.33	0.01	7.26	284.18	8.62	0.76	Open
7/13/2024 23:40	16.48	21.46	0.01	7.18	289.01	8.61	0.66	Open
7/13/2024 23:50	16.45	21.34	0.01	7.2	288.63	8.64	0.68	Open
7/14/2024 0:00	16.42	21.34	0.01	7.17	288.11	8.63	0.76	Open
7/14/2024 0:10	16.39	21.31	0.01	7.19	287.97	8.63	0.7	Open
7/14/2024 0:20	16.36	21.38	0.01	7.18	288.33	8.62	0.67	Open
7/14/2024 0:30	16.32	21.37	0.01	7.2	287.13	8.65	0.73	Open
7/14/2024 0:40	16.3	21.33	0.01	7.15	288.41	8.65	0.67	Open
7/14/2024 0:50	16.27	21.22	0.01	7.17	287.5	8.67	0.7	Open
7/14/2024 1:00	16.24	21.34	0.01	7.16	288.12	8.67	0.66	Open
7/14/2024 1:10	16.21	21.21	0.01	7.23	285.92	8.68	0.67	Open
7/14/2024 1:20	16.18	21.43	0.01	7.14	288.94	8.69	0.63	Open
7/14/2024 1:30	16.15	21.12	0.01	7.2	287.96	8.69	0.63	Open
7/14/2024 1:40	16.13	21.27	0.01	7.17	286.8	8.7	0.69	Open
7/14/2024 1:50	16.1	21.2	0.01	7.11	289.05	8.71	0.65	Open
7/14/2024 2:00	16.07	21.27	0.01	7.13	287.12	8.72	0.63	Open
7/14/2024 2:10	16.05	21.18	0.01	7.17	286.61	8.72	0.63	Open
7/14/2024 2:20	16.02	21.24	0.01	7.16	286.47	8.72	0.63	Open
7/14/2024 2:30	16	21.17	0.01	7.17	284.59	8.73	0.65	Open
7/14/2024 2:40	15.97	21.24	0.01	7.16	287.12	8.72	0.62	Open
7/14/2024 2:50	15.95	21.09	0.01	7.21	287.28	8.74	0.64	Open
7/14/2024 3:00	15.93	21.14	0.01	7.16	287.73	8.75	0.64	Open
7/14/2024 3:10	15.9	20.85	0.01	7.17	286.02	8.74	0.69	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/14/2024 3:20	15.88	21.07	0.01	7.18	287.7	8.74	0.72	Open
7/14/2024 3:30	15.86	21.05	0.01	7.14	286.52	8.76	0.59	Open
7/14/2024 3:40	15.84	21.05	0.01	7.17	287.8	8.77	0.65	Open
7/14/2024 3:50	15.81	21.08	0.01	7.14	285.89	8.78	0.65	Open
7/14/2024 4:00	15.79	21.06	0.01	7.16	286.31	8.78	0.65	Closed
7/14/2024 4:10	15.77	20.98	0.01	7.18	283.23	8.78	0.63	Closed
7/14/2024 4:20	15.74	21.03	0.01	7.19	287.31	8.78	0.67	Closed
7/14/2024 4:30	15.71	20.94	0.01	7.15	287.76	8.79	0.62	Closed
7/14/2024 4:40	15.69	21.05	0.01	7.17	287.02	8.77	0.64	Closed
7/14/2024 4:50	15.67	21.01	0.01	7.13	287.96	8.82	0.58	Closed
7/14/2024 5:00	15.64	20.91	0.01	7.17	285.9	8.81	0.61	Closed
7/14/2024 5:10	15.62	20.85	0.01	7.18	285.19	8.82	0.57	Closed
7/14/2024 5:20	15.6	20.95	0.01	7.16	286.14	8.81	0.6	Closed
7/14/2024 5:30	15.57	20.71	0.01	7.14	287.19	8.81	0.59	Closed
7/14/2024 5:40	15.55	20.87	0.01	7.18	286.26	8.83	0.58	Closed
7/14/2024 5:50	15.53	20.63	0.01	7.18	285.87	8.84	0.58	Closed
7/14/2024 6:00	15.51	20.85	0.01	7.19	286.38	8.84	0.59	Closed
7/14/2024 6:10	15.5	20.61	0.01	7.13	288.19	8.86	0.62	Open
7/14/2024 6:20	15.48	20.72	0.01	7.19	285.21	8.87	0.62	Open
7/14/2024 6:30	15.47	20.74	0.01	7.14	286.76	8.87	0.55	Open
7/14/2024 6:40	15.45	20.67	0.01	7.16	284.34	8.89	0.64	Open
7/14/2024 6:50	15.43	20.69	0.01	7.13	287.65	8.88	0.63	Open
7/14/2024 7:00	15.42	20.65	0.01	7.16	284.6	8.88	0.62	Open
7/14/2024 7:10	15.41	20.7	0.01	7.15	286.01	8.88	0.56	Open
7/14/2024 7:20	15.41	20.68	0.01	7.16	285.16	8.89	0.64	Open
7/14/2024 7:30	15.41	20.57	0.01	7.23	286.26	8.9	0.79	Open
7/14/2024 7:40	15.42	20.53	0.01	7.2	288.55	8.9	0.63	Open
7/14/2024 7:50	15.41	20.58	0.01	7.19	288.76	8.89	0.62	Open
7/14/2024 8:00	15.42	20.53	0.01	7.23	288.38	8.9	0.57	Open
7/14/2024 8:10	15.42	20.37	0.01	7.25	285.6	8.92	0.62	Open
7/14/2024 8:20	15.42	20.61	0.01	7.26	288.18	8.91	3.5	Open
7/14/2024 8:30	15.43	20.42	0.01	7.24	284.59	8.9	0.52	Open
7/14/2024 8:40	15.45	20.53	0.01	7.24	287.41	8.93	0.62	Open
7/14/2024 8:50	15.48	20.36	0.01	7.26	285.54	8.94	0.55	Open
7/14/2024 9:00	15.51	20.51	0.01	7.23	287.09	8.92	0.57	Open
7/14/2024 9:10	15.55	20.31	0.01	7.25	286.35	8.92	0.6	Open
7/14/2024 9:20	15.57	20.45	0.01	7.27	285.68	8.92	0.59	Open
7/14/2024 9:30	15.6	20.46	0.01	7.22	285.15	8.93	0.55	Open
7/14/2024 9:40	15.61	20.54	0.01	7.21	286.26	8.92	0.61	Open
7/14/2024 9:50	15.62	20.42	0.01	7.27	284.84	8.94	1.9	Open
7/14/2024 10:00	15.65	20.52	0.01	7.25	284.96	8.92	0.58	Open
7/14/2024 10:10	15.68	20.45	0.01	7.24	285.31	8.91	0.67	Open
7/14/2024 10:20	15.73	20.41	0.01	7.23	284.64	8.91	0.6	Open
7/14/2024 10:30	15.8	20.35	0.01	7.25	281.15	8.92	0.57	Open
7/14/2024 10:40	15.89	20.37	0.01	7.21	282.16	8.92	0.6	Open
7/14/2024 10:50	16	20.39	0.01	7.28	280.19	8.93	0.57	Open
7/14/2024 11:00	16.13	20.41	0.01	7.26	281.12	8.92	0.61	Open

WLNG Upstream 2024-07-08 to 2024-07-14

7/14/2024 11:10	16.25	20.37	0.01	7.29	280.58	8.92	0.57	Open
7/14/2024 11:20	16.33	20.38	0.01	7.27	280.26	8.9	0.58	Open
7/14/2024 11:30	16.41	20.07	0.01	7.33	279.8	8.9	0.59	Open
7/14/2024 11:40	16.5	20.35	0.01	7.28	280.36	8.9	0.63	Open
7/14/2024 11:50	16.59	20.17	0.01	7.36	278.91	8.9	0.61	Open
7/14/2024 12:00	16.67	20.28	0.01	7.3	279.72	8.88	0.65	Open
7/14/2024 12:00	16.67	20.28	0.01	7.3	279.72	8.88	0.65	Open
7/14/2024 12:10	16.73	20.3	0.01	7.35	280.55	8.86	0.62	Closed
7/14/2024 12:20	16.72	20.25	0.01	7.31	280.98	8.87	0.61	Closed
7/14/2024 12:30	16.74	20.22	0.01	7.37	281.45	8.85	0.62	Closed
7/14/2024 12:40	16.77	20.21	0.01	7.35	280.51	8.83	0.64	Closed
7/14/2024 12:50	16.79	20.19	0.01	7.42	279.31	8.81	0.65	Closed
7/14/2024 13:00	16.81	20.21	0.01	7.33	280.61	8.79	0.63	Closed
7/14/2024 13:10	16.85	20.13	0.01	7.35	280.94	8.79	0.61	Closed
7/14/2024 13:20	16.9	20.17	0.01	7.32	281.66	8.75	0.61	Closed
7/14/2024 13:30	16.97	19.88	0.01	7.38	280.81	8.74	0.67	Closed
7/14/2024 13:40	17.01	20.19	0.01	7.28	280.23	8.74	0.65	Closed
7/14/2024 13:50	17.06	19.9	0.01	7.33	281.97	8.71	0.68	Closed
7/14/2024 14:00	17.11	20.21	0.01	7.29	280.96	8.7	0.67	Closed
7/14/2024 14:10	17.15	20.28	0.01	7.32	279.98	8.67	0.62	Closed
7/14/2024 14:20	17.17	20.17	0.01	7.29	280.52	8.66	0.64	Closed
7/14/2024 14:30	17.21	20.07	0.01	7.34	280.26	8.63	0.69	Closed
7/14/2024 14:40	17.25	20.2	0.01	7.27	281.62	8.64	0.65	Closed
7/14/2024 14:50	17.3	20.2	0.01	7.27	283.97	8.64	0.69	Closed
7/14/2024 15:00	17.34	20.25	0.01	7.31	281.68	8.63	0.66	Closed
7/14/2024 15:10	17.37	20.3	0.01	7.32	283.39	8.61	0.68	Closed
7/14/2024 15:20	17.39	20.25	0.01	7.25	283.6	8.63	0.69	Closed
7/14/2024 15:30	17.43	20.17	0.01	7.31	282.63	8.6	0.82	Closed
7/14/2024 15:40	17.48	20.34	0.01	7.28	283.02	8.61	0.7	Closed
7/14/2024 15:50	17.49	20.3	0.01	7.3	282.7	8.6	0.69	Closed
7/14/2024 16:00	17.52	20.34	0.01	7.28	282.23	8.58	0.65	Closed
7/14/2024 16:10	17.52	20.38	0.01	7.36	279.31	8.56	0.67	Closed
7/14/2024 16:20	17.54	20.38	0.01	7.27	282.95	8.55	0.69	Closed
7/14/2024 16:30	17.57	20.41	0.01	7.28	284.08	8.53	0.7	Closed
7/14/2024 16:40	17.58	20.49	0.01	7.25	283.94	8.5	0.67	Closed
7/14/2024 16:50	17.58	20.45	0.01	7.28	284.41	8.51	0.68	Closed
7/14/2024 17:00	17.57	20.57	0.01	7.24	285.19	8.49	0.7	Closed
7/14/2024 17:10	17.56	20.42	0.01	7.22	286.74	8.48	0.69	Closed
7/14/2024 17:20	17.54	20.52	0.01	7.26	285.98	8.49	0.67	Closed
7/14/2024 17:30	17.53	20.56	0.01	7.25	287.81	8.47	0.67	Closed
7/14/2024 17:40	17.51	20.63	0.01	7.24	287.15	8.48	0.65	Closed
7/14/2024 17:50	17.49	20.6	0.01	7.32	284.38	8.48	0.83	Closed
7/14/2024 18:00	17.48	20.8	0.01	7.25	287.62	8.48	0.67	Closed
7/14/2024 18:10	17.47	20.67	0.01	7.2	288.4	8.48	0.65	Closed
7/14/2024 18:20	17.45	20.82	0.01	7.25	289.98	8.48	0.64	Closed
7/14/2024 18:30	17.42	20.72	0.01	7.24	291	8.47	0.65	Closed
7/14/2024 18:40	17.39	20.79	0.01	7.26	289.74	8.49	0.67	Closed

WLNG Upstream 2024-07-08 to 2024-07-14

7/14/2024 18:50	17.37	20.57	0.01	7.23	290.28	8.48	0.65	Closed
7/14/2024 19:00	17.35	20.91	0.01	7.22	291.6	8.49	0.62	Closed
7/14/2024 19:10	17.32	20.82	0.01	7.26	290.32	8.48	0.62	Closed
7/14/2024 19:20	17.3	20.96	0.01	7.26	290.21	8.48	0.64	Closed
7/14/2024 19:30	17.27	20.92	0.01	7.22	291.21	8.47	0.62	Closed
7/14/2024 19:40	17.24	21.01	0.01	7.23	290.39	8.49	0.64	Open
7/14/2024 19:50	17.21	20.93	0.01	7.26	287.79	8.51	0.65	Open
7/14/2024 20:00	17.18	21.04	0.01	7.22	288.74	8.51	0.63	Open
7/14/2024 20:10	17.15	21.05	0.01	7.19	286.98	8.49	0.65	Closed
7/14/2024 20:20	17.11	21.11	0.01	7.15	288.89	8.52	0.84	Closed
7/14/2024 20:30	17.08	20.94	0.01	7.17	287.96	8.51	0.62	Closed
7/14/2024 20:40	17.05	21.14	0.01	7.16	289.06	8.52	0.63	Closed
7/14/2024 20:50	17.01	21.16	0.01	7.2	286.75	8.52	0.73	Closed
7/14/2024 21:00	16.98	21.22	0.01	7.13	290.71	8.53	0.61	Closed
7/14/2024 21:10	16.94	21.18	0.01	7.19	287.36	8.54	0.65	Open
7/14/2024 21:20	16.91	21.22	0.01	7.13	289.89	8.53	0.6	Open
7/14/2024 21:30	16.87	21.22	0.01	7.17	287.6	8.55	0.64	Open
7/14/2024 21:40	16.84	21.36	0.01	7.16	289.77	8.55	0.6	Closed
7/14/2024 21:50	16.8	21.18	0.01	7.15	290.51	8.57	0.59	Closed
7/14/2024 22:00	16.77	21.36	0.01	7.11	290.14	8.56	0.6	Closed
7/14/2024 22:10	16.74	21.11	0.01	7.18	288.32	8.57	0.63	Closed
7/14/2024 22:20	16.71	21.29	0.01	7.11	290.9	8.57	0.64	Closed
7/14/2024 22:30	16.68	21.28	0.01	7.14	290.92	8.59	0.61	Closed
7/14/2024 22:40	16.65	21.31	0.01	7.11	291.43	8.58	0.57	Closed
7/14/2024 22:50	16.61	21.29	0.01	7.13	291.31	8.59	0.6	Closed
7/14/2024 23:00	16.59	21.2	0.01	7.11	291.37	8.6	0.62	Closed
7/14/2024 23:10	16.55	21.19	0.01	7.18	285.89	8.62	0.59	Closed
7/14/2024 23:20	16.53	21.16	0.01	7.1	288.8	8.61	0.62	Closed
7/14/2024 23:30	16.49	21.15	0.01	7.11	290.14	8.63	0.56	Closed
7/14/2024 23:40	16.47	21.22	0.01	7.1	288.89	8.63	0.6	Closed
7/14/2024 23:50	16.43	21.16	0.01	7.12	287.21	8.64	0.59	Closed