



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Page	1 of 7

# **Eagle Mountain - Woodfibre Gas Pipeline Project**

## **BCER Waste Discharge Permit Weekly Report**



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Page	2 of 7

## Contents


Preamble .....	3
Introduction .....	3
Sampling Methodology .....	3
Summary-BC Rail Site .....	4
Site Activities .....	4
Point of Discharge from Water Treatment System Monitoring .....	4
Exceedances .....	5
Receiving Environment Monitoring .....	5
Receiving Environment Monitoring Details .....	5
Summary-Woodfibre .....	6
Site Activities .....	6
Point of Discharge from Water Treatment System Monitoring .....	6
Exceedance details .....	6
Receiving Environment Monitoring .....	7
Receiving Environment Monitoring Details .....	7

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Page	3 of 7

## Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environment (upstream and downstream) and point of discharge.

FortisBC has retained Triton Environmental Consultants Ltd. as the Qualified Professional to implement and oversee the monitoring and sampling program in the receiving environments. The data represented below, including laboratory reported exceedances, represent background conditions from the receiving environment sampling as shown on the Waste Discharge Permit.

## Introduction

The results provided in this document are submitted to BC Energy Regulator (BCER) by FortisBC as per the requirements listed in the Waste Discharge Permit PE-110163 Section 4.2:


The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to [Waste.Management@bc-er.ca](mailto:Waste.Management@bc-er.ca). A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

## Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and lab samples to meet daily and real time requirements for the Waste Discharge Permit.

At the receiving environments, real time and daily readings are being monitored at the same time with one piece of equipment, allowing all the daily readings real time. Visible sheen will be monitored with visual inspections during times of discharge or sampling.

At the point of discharge from the WTP, the parameters are being monitored using field equipment and sondes/real time meters make and models to be confirmed by the contractor. Table 1 and Table 2 below show how each parameter is being monitored.

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Page	4 of 7

**Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre**

Permit Frequency	Parameters	Details
Daily	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real Time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observer NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples

**Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre**

Permit Frequency	Parameters	Details
Daily	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real Time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples

## Summary-BC Rail Site

### Site Activities


- No discharges during this reporting period.

### Point of Discharge from Water Treatment System Monitoring

Table 3 below includes information on water quality and lab sampling during discharges. Appendix A includes a full set of lab results with real time/field samples from discharges.

**Table 3: Discharge from Water Treatment System Information**

Location	Date of Discharge	Date of Lab Sample (for the discharge)	Real Time Monitored	Discharge Rate (batch)	Discharge Volume (batch)	Results
BC Rail- No discharges						

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Page	5 of 7

\*Max discharge is 515 m3/day

### Exceedances

No exceedances this reporting period.

### Receiving Environment Monitoring

The receiving environment is being monitored as outlined in the permit.

**Table 4: Upstream Monitoring Information**

Location	Date of Lab Sample	Real Time Monitored	Results
Squamish River Upstream	2024-07-15	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix B.

**Table 5: Downstream Monitoring Information**

Location	Date of Lab Sample	Real Time Monitored	Results
Squamish River Downstream	2023-07-15	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix B.

\* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 10 minute intervals.

### Receiving Environment Monitoring Details

- Visual sheen checks conducted for days of discharge.
- All receiving environment lab results are in Appendix B.
- Any recorded exceedances in the laboratory and field samples collected from the receiving environment (upstream and downstream) are indicative of the existing background water quality in the Squamish River, and are not related to the EGP Project activities.



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Page	6 of 7

## Summary-Woodfibre

### Site Activities

- The Woodfibre Portal has moved to continuous discharge, all information on discharge is in Appendix C.
- The downstream sonde/data logger was removed July 16<sup>th</sup> as there was not enough water in the watercourse to log data. BCER was notified.
- During this reporting period, Woodfibre Portal discharged a small volume each day from their water treatment plant, they discharged alternating each 10 min while monitoring the downstream sonde. The discharge rate was brought down as low as possible to prevent overwhelming the watercourse.

### Point of Discharge from Water Treatment System Monitoring

Table 3 below includes information on the continuous discharge water. Appendix C includes real time/field samples from the discharge.

**Table 3: Discharges from Water Treatment System**

Location	Date of Discharge	Real Time Monitored	Discharge Volume	Results
Woodfibre	2024-07-15	Yes	12.8 m <sup>3</sup>	Yes-Appendix C
Woodfibre	2024-07-16	Yes	16.3 m <sup>3</sup>	Yes-Appendix C
Woodfibre	2024-07-17	N/A	0	Yes-Appendix C
Woodfibre	2024-07-18	N/A	0	Yes-Appendix C
Woodfibre	2024-07-19	N/A	0	Yes-Appendix C
Woodfibre	2024-07-20	N/A	0	Yes-Appendix C
Woodfibre	2024-07-21	N/A	0	Yes-Appendix C

\*Max discharge is 1500m<sup>3</sup>/day

### Exceedance details

- During this reporting period, it was noted that there were instances where the temperature of the discharge water from the water treatment plant at Woodfibre fluctuated higher than the background temperature measured in the upstream of WC 309-R2.
- The QP reviewed the data from the receiving environment data logs, the water treatment plant data log, field information, and concluded that there were times of temperature exceedances for the 15<sup>th</sup> and 16<sup>th</sup>, as well as between the 8<sup>th</sup>-14<sup>th</sup> of the previous report. The report from the previous week stated that the exceedance was inconclusive, but upon further investigation from the QP (field information, field photos, data logs,) it was determined there was a temperature exceedance.
- The maximum daily temperature observed on 10 min intervals were 22.24 (7/08/2024 15:00), 23.88 (7/09/2024 14:40), 22.7 (7/10/2024 13:40), 20.62 (7/11/2024 13:10), 21.86 (7/12/2024



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Page	7 of 7

16:20), 21.65 (7/13/2024 20:30), 22.17 (7/14/2024 20:30), 21.49 (7/15/2024 20:30) and 23.11 (7/16/2024 13:20) which resulted in Mean Weekly Maximum Temperature (MWMT) of 22.19 which is above the BCWQG for FAL & MAL for temperature at 18 °C (MWMT) and 19 °C (Maximum Daily Temperature).

- The channel at the downstream monitoring location where the data logger was placed had little to no flow, which limited the representativeness of the data collected, making it difficult to initially assess the data to determine if there was an exceedance.
- FortisBC is working with the contractor to find solutions to reduce the temperature of the water/prevent water from heating up in tanks at the water treatment plant, notably during times of high ambient temperature.
- Sonde data upstream, downstream and from the water treatment plant has been included in Appendix C.

### Receiving Environment Monitoring

The receiving environment is being monitored as outlined in the permit.

**Table 4: Upstream Monitoring Information**

Location	Date of Lab Sample	Real Time Monitored	Results
Woodfibre Upstream	2024-07-16	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix D.

**Table 5: Downstream Monitoring Information**

	Date of Lab Sample	Real Time Monitored	Results
Woodfibre Downstream	2024-07-16	Yes *	Full set of lab sample results, photo and documentation are provided in Appendix D.

\* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 10 minute intervals.

### Receiving Environment Monitoring Details

- Visual sheen checks are conducted during discharges.
- Any recorded exceedances (other than temperature) in the laboratory and field samples collected from the receiving environment (upstream and downstream) are indicative of the existing background water quality in the East Creek and are not related to the EGP Project activities.



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix A	A-1

## Appendix A: BCR Site Point of Discharge from Water Treatment Plant Documentation





**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix A	A-2

**BCR Site Sample Analysis  
-No discharge**



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix A	A-3


## BCR Site Sample Lab Documentation No Discharge



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix A	A-4

## BCR Site WTP Discharge Field Notes and Logs No Discharge

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix B	B-1

## Appendix B: BCR Site Receiving Environment Documentation



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix B	B-2

## BCR Site Receiving Environment Sample Analysis

TRITON		Sample ID	Revised and signed off by:							Sample or value notes	BCWQ FAL - Short Term	BCWQ FAL - Long Term	BCWQ MAL - Short Term	BCWQ MAL - Long Term
Analysis	Units	SCAWQW-FAL-LT	SCAWQW-FAL-ST	SCAWQW-MAL-ST	SCAWQW-MAL-LT	SCWQW-101	SCWQW-102	SCWQW-103	SCWQW-104					
<b>In Situ Parameters</b>														
pH (6-8)	pH units	6.5-8.0	6.5-8.0	7.0-8.7	7.0-8.7	6.5	6.5			If natural pH < 6.5, no statistically significant decrease from background. No reduction in toxicity except in those with values less than 6.5. Unintentional change permitted within range of 6.5 to 8.0. If natural pH < 6.5, statistically significant increase from background. Refer to SC Water Quality Guidelines for more information.				Unintentional change within this range for protection of natural and aesthetic uses.
Temperature (6-8)	°C		Max. 4°C from 6-10°C hourly rate of change < 0.5°C	Max. 4°C from 6-10°C hourly rate of change < 0.5°C		15.4	15.8			Guideline is species-dependent. Short-term only temperature guidelines to 10°C to diversify with relevant fish. Refer to Section 4 for background temperature range for the Sacramento River. Refer to SC Water Quality Guidelines for more information. Toxicity of change not assessed. Calculation: US value = 1 + guideline range				Guideline for marine values is based on natural ambient conditions. Max and min 1°C change from natural conditions. Natural temperature cycle characteristic of the area should be allowed to proceed. If temperature 10°C is exceeded, the maximum of any human-induced temperature change will not exceed 1°C daily. Values with reference for guidelines. Refer to Section 4 for background temperature range for the Sacramento River. Calculation: US value = 1 + guideline range
Conductivity (6-8)	µS/cm					16	16			Change from background of 2 µS/cm at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline				Change from background of 2 µS/cm at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline
Turbidity (6-8)	NTU	Values with background, see note. Lowest value for guideline is 0 NTU	Values with background, see note. Lowest value for guideline is 0 NTU	Values with background, see note. Lowest value for guideline is 0 NTU	Values with background, see note. Lowest value for guideline is 0 NTU	175.0	157.0			Change from background of 2 NTU at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline				Change from background of 2 NTU at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline
Dissolved Oxygen (6-8)	mg/L	Values with this range, see note	Values with this range, see note	Values with this range, see note	Values with this range, see note	10.30				Refer to background minimum 5 mg/L, all other stages 5 mg/L. Refer to SC Water Quality Guidelines for more information.				Refer to background minimum 5 mg/L, all other stages 5 mg/L. Refer to SC Water Quality Guidelines for more information.
<b>General Parameters</b>														
Total Suspended Solids (6-8)	mg/L	Values with background, see note. Lowest value for guideline is 0 mg/L	Values with background, see note. Lowest value for guideline is 0 mg/L	Values with background, see note. Lowest value for guideline is 0 mg/L	Values with background, see note. Lowest value for guideline is 0 mg/L	150	114			Change from background of 20 mg/L at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline				Change from background of 20 mg/L at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline
Dissolved Organic Carbon (DOC) (6-8)	mg/L					0.57	0.55			Change from background of 20 mg/L at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline				Change from background of 20 mg/L at any one time for a duration of 24 h in all waters during clear flow or in clear waters. Calculation: US value = 1 + guideline
Total Alkalinity (CaCO <sub>3</sub> ) (6-8)	mg/L	Calcium				8.5	7.5			The upstream and downstream locations have high sensitivity to acid inputs (i.e. the buffering capacity). Calculation: US value = 1 + guideline				Guideline is for acidity (as CaCO <sub>3</sub> ) and categorizes the sensitivity of water body to acid inputs. 10 - 20 mg/L is considered moderate sensitivity. 10 - 20 mg/L is considered moderate sensitivity.
Total Sulfate (as S) (6-8)	mg/L					+ 0.0015	+ 0.0015			Working guideline				Working guideline
Total Sulfate (as SO <sub>4</sub> ) (6-8)	mg/L					+ 0.0015	+ 0.0015			Working guideline				Working guideline
<b>Anions and Nutrients</b>														
Ammonia (6-8)	mg/L ammonia-N	Values with pH and temperature. See note.	Values with pH and temperature. See note.	Values with pH, temperature and salinity. See note.	Values with pH, temperature and salinity. See note.	0.076	0.040			Guideline for ammonia as N and pH and temperature dependent. Refer to Table 270 in SC WQW for guideline values.				Guideline for ammonia as N and pH and temperature dependent. Refer to Table 270 in SC WQW for guideline values.
Nitrate (6-8)	mg/L					+ 0.001	+ 0.001			Guideline for nitrate as N. Calculation: US value = 1 + guideline				Guideline for nitrate as N. Calculation: US value = 1 + guideline
Chloride (6-8)	mg/L	150	600	+ 10% of background	+ 90% of background	0.76	0.68			Refer to background minimum 15 mg/L, all other stages 5 mg/L. Refer to SC Water Quality Guidelines for more information.				Refer to background minimum 15 mg/L, all other stages 5 mg/L. Refer to SC Water Quality Guidelines for more information.
Fluoride (6-8)	mg/L		Values with hardness. 7.5			+ 0.001	+ 0.001			Guideline is for fluoride as F <sup>-</sup> . Calculation: US value = 1 + guideline				Guideline is for fluoride as F <sup>-</sup> . Calculation: US value = 1 + guideline
Iron (6-8)	mg/L	Values with nitrate. See note.	Values with nitrate. See note.			0.7	0.7			Values with nitrate. Refer to Table 270 in SC WQW for guideline values.				Values with nitrate. Refer to Table 270 in SC WQW for guideline values.
Total Phosphorus (6-8)	mg/L	0.001 to 0.015				0.007	0.106			Guideline is for total phosphorus. Refer to Table 270 in SC WQW for guideline values.				Guideline is for total phosphorus. Refer to Table 270 in SC WQW for guideline values.
Sulfate (as SO <sub>4</sub> ) (6-8)	mg/L	Values with hardness. See note.				2.51	2.25			Guideline for hardness ranges below: Hardness = 20 - 25 mg/L Hardness = 25 - 30 mg/L Hardness = 30 - 35 mg/L Hardness = 35 - 40 mg/L				Guideline for hardness ranges below: Hardness = 20 - 25 mg/L Hardness = 25 - 30 mg/L Hardness = 30 - 35 mg/L Hardness = 35 - 40 mg/L
<b>Total Metals</b>														
Aluminum (As Total) (6-8)	mg/L	Values with pH, DOC, hardness				8.0	8.2			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Guideline values with pH, hardness and Dissolved Organic Carbon (DOC). Guideline is calculated using the following formula: $Al_{max} = 0.001(100 - DOC) + 0.001(100 - DOC) + 0.001(100 - DOC)$ . If hardness is DOC is below the hardness or DOC range, the minimum hardness will be applied in the calculation.
Antimony (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for antimony. Refer to Table 270 in SC WQW for guideline values.				Guideline is for antimony. Refer to Table 270 in SC WQW for guideline values.
Barium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for barium. Refer to Table 270 in SC WQW for guideline values.				Guideline is for barium. Refer to Table 270 in SC WQW for guideline values.
Beryllium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for beryllium. Refer to Table 270 in SC WQW for guideline values.				Guideline is for beryllium. Refer to Table 270 in SC WQW for guideline values.
Bismuth (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for bismuth. Refer to Table 270 in SC WQW for guideline values.				Guideline is for bismuth. Refer to Table 270 in SC WQW for guideline values.
Boron (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for boron. Refer to Table 270 in SC WQW for guideline values.				Guideline is for boron. Refer to Table 270 in SC WQW for guideline values.
Calcium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for calcium. Refer to Table 270 in SC WQW for guideline values.				Guideline is for calcium. Refer to Table 270 in SC WQW for guideline values.
Cadmium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for cadmium. Refer to Table 270 in SC WQW for guideline values.				Guideline is for cadmium. Refer to Table 270 in SC WQW for guideline values.
Chromium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Guideline is for chromium. Refer to Table 270 in SC WQW for guideline values.				Guideline is for chromium. Refer to Table 270 in SC WQW for guideline values.
Copper (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Cobalt (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Iron (As Total) (6-8)	mg/L	0.001	0.001			2.0	2.0			Total Fe exceed the long term 5-week average BCRWQ for Fe. Fe is both upstream and downstream locations. This there is a risk for chronic effects to fish.				Total Fe exceed the long term 5-week average BCRWQ for Fe. Fe is both upstream and downstream locations. This there is a risk for chronic effects to fish.
Lead (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Lithium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Manganese (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Mercury (Hg) Total (6-8)	mg/L	Values with methyl mercury				+ 0.000001	+ 0.000001			Guideline is for mercury. Refer to Table 270 in SC WQW for guideline values.				Guideline is for mercury. Refer to Table 270 in SC WQW for guideline values.
Molybdenum (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Nickel (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Phosphorus (P) Total (6-8)	mg/L	0.001 to 0.015				0.007	0.279			Guideline is for phosphorus. Refer to Table 270 in SC WQW for guideline values.				Guideline is for phosphorus. Refer to Table 270 in SC WQW for guideline values.
Platinum (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Secalonic Acid (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Selenium (Se) Total (6-8)	mg/L	0.001	0.001			+ 0.00001	+ 0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Silver (Ag) Total (6-8)	mg/L	Values with hardness, see note	Values with hardness, see note	0.001	0.001	0.00001	0.00001			Values with hardness. Hardness = 100 - 1,000 mg/L Hardness = 1,000 - 2,000 mg/L				Values with hardness. Hardness = 100 - 1,000 mg/L Hardness = 1,000 - 2,000 mg/L
Sodium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Strontium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Thallium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Vanadium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Zinc (As Total) (6-8)	mg/L	0.001	0.001			0.001	0.001			Total Zn has not exceeded LT BCRWQ for Zn. Guideline based on 70 weeks average. This there is no risk for chronic effects to fish.				Total Zn has not exceeded LT BCRWQ for Zn. Guideline based on 70 weeks average. This there is no risk for chronic effects to fish.
<b>Trace Metals</b>														
Antimony (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Barium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Beryllium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Bismuth (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Boron (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Calcium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Cadmium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Chromium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Copper (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Cobalt (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Iron (As Total) (6-8)	mg/L	0.001	0.001			2.0	2.0			Total Fe exceed the long term 5-week average BCRWQ for Fe. Fe is both upstream and downstream locations. This there is a risk for chronic effects to fish.				Total Fe exceed the long term 5-week average BCRWQ for Fe. Fe is both upstream and downstream locations. This there is a risk for chronic effects to fish.
Lead (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Lithium (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Manganese (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Mercury (Hg) Total (6-8)	mg/L	Values with methyl mercury				+ 0.000001	+ 0.000001			Guideline is for mercury. Refer to Table 270 in SC WQW for guideline values.				Guideline is for mercury. Refer to Table 270 in SC WQW for guideline values.
Molybdenum (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Nickel (As Total) (6-8)	mg/L	0.001	0.001			0.00001	0.00001			Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.				Change from BCR has not begun fall from. These metals are not applicable to BCR. Construction activities and may be characteristic of the Sacramento River and the local geology.
Phosphorus (P) Total (6-8)	mg/L	0.001 to 0.015												



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix B	B-3

## BCR Site Receiving Environment Lab Documentation

## CERTIFICATE OF ANALYSIS

**Work Order** : VA24B7085  
**Amendment** : 1  
**Client** : Triton Environmental Consultants Ltd.  
**Contact** :   
**Address** :   
  
**Telephone** :   
**Project** : 11964  
**PO** : 11964-Task 20-Phase 3C-4C  
**C-O-C number** : ----  
**Sampler** : ----  
**Site** : Water Analysis  
**Quote number** : VA23-TRIT100-012\_V2  
**No. of samples received** : 2  
**No. of samples analysed** : 2

**Page** : 1 of 6  
  
**Laboratory** : ALS Environmental - Vancouver  
**Account Manager** :   
**Address** :   
  
**Telephone** :   
**Date Samples Received** : 15-Jul-2024 13:55  
**Date Analysis Commenced** : 16-Jul-2024  
**Issue Date** : 26-Jul-2024 15:00

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
	Analyst	Metals, Burnaby, British Columbia
	Production Manager, Environmental	Metals, Waterloo, Ontario
	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
	Supervisor - Water Chemistry	Inorganics, Burnaby, British Columbia
	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
	Account Manager Assistant	Metals, Burnaby, British Columbia
	Team Leader - Metals	Administration, Burnaby, British Columbia
	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
	Supervisor - Inorganic	Inorganics, Waterloo, Ontario
	Supervisor - Inorganic	Metals, Waterloo, Ontario





## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Workorder Comments

**Amendment (26/07/2024): This report has been amended to allow the distribution of reports not previously provided. All analysis results are as per the previous report.**

Amendment:

## Qualifiers

<i>Qualifier</i>	<i>Description</i>
DLM	Detection Limit Adjusted due to sample matrix effects (e.g. chemical interference, colour, turbidity).



## Analytical Results

Sub-Matrix: Water					Client sample ID		SQU US 1	SQU DS 1	----	----	----
(Matrix: Water)					Client sampling date / time		15-Jul-2024 09:30	15-Jul-2024 10:38	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7085-001	VA24B7085-002	-----	-----	-----		
					Result	Result	---	---	---		
<b>Field Tests</b>											
Conductivity, field	---	EF001/VA	0.10	µS/cm	24.000	22.000	----	----	----		
pH, field	---	EF001/VA	0.10	pH units	6.96	6.96	----	----	----		
Temperature, field	---	EF001/VA	0.10	°C	15.4	15.8	----	----	----		
<b>Physical Tests</b>											
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	9.46	8.69	----	----	----		
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	23.1	23.6	----	----	----		
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	43	33	----	----	----		
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	158	114	----	----	----		
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	8.6	7.9	----	----	----		
<b>Anions and Nutrients</b>											
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	0.0766	0.0442	----	----	----		
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	<0.050	----	----	----		
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	0.76	0.68	----	----	----		
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	<0.020	<0.020	----	----	----		
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	0.0188	0.0166	----	----	----		
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	<0.0010	----	----	----		
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.151	0.107	----	----	----		
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.207	0.126	----	----	----		
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	2.51	2.25	----	----	----		
<b>Organic / Inorganic Carbon</b>											
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	0.57	0.55	----	----	----		
<b>Total Sulfides</b>											
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	<0.0015	----	----	----		
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	<0.0015	----	----	----		
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	<0.0016	----	----	----		
<b>Total Metals</b>											
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	8.06	8.20	----	----	----		
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----		



## Analytical Results

Sub-Matrix: Water					Client sample ID	SQU US 1	SQU DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	15-Jul-2024 09:30	15-Jul-2024 10:38	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7085-001	VA24B7085-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Total Metals</b>										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00049	0.00051	----	----	----	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.0773	0.0796	----	----	----	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	0.000101	0.000109	----	----	----	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	<0.010	<0.010	----	----	----	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0000268	0.0000235	----	----	----	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	6.51	6.09	----	----	----	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000197	0.000221	----	----	----	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	0.00162	0.00218	----	----	----	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	0.00138	0.00180	----	----	----	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00824	0.00875	----	----	----	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	2.89	3.69	----	----	----	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.00101	0.000916	----	----	----	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0029	0.0032	----	----	----	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	1.66	2.04	----	----	----	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.0757	0.0985	----	----	----	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	<0.0000050	----	----	----	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.000455	0.000437	----	----	----	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	0.00194	0.00225	----	----	----	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	0.283	0.278	----	----	----	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	2.03	2.18	----	----	----	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00463	0.00555	----	----	----	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	13.1	13.0	----	----	----	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	0.000097	0.000018	----	----	----	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	3.26	2.99	----	----	----	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0831	0.0749	----	----	----	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	0.74	0.62	----	----	----	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000028	0.000034	----	----	----	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00030 <sup>DLM</sup>	<0.00030 <sup>DLM</sup>	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	SQU US 1	SQU DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	15-Jul-2024 09:30	15-Jul-2024 10:38	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7085-001	VA24B7085-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Total Metals</b>										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.182	0.244	----	----	----	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.000117	0.000149	----	----	----	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	0.00788	0.00969	----	----	----	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	0.0104	0.0161	----	----	----	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00060 <sup>DLM</sup>	0.00041 <sup>DLM</sup>	----	----	----	
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0321	0.0371	----	----	----	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00217	0.00256	----	----	----	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	<0.000100	----	----	----	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	<0.010	<0.010	----	----	----	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	<0.0000050	<0.0000050	----	----	----	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	3.21	2.97	----	----	----	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00033	0.00031	----	----	----	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.028	0.026	----	----	----	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	<0.0010	<0.0010	----	----	----	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	0.351	0.310	----	----	----	
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00460	0.00474	----	----	----	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	<0.0000050	----	----	----	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.000395	0.000386	----	----	----	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	<0.050	----	----	----	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	0.495	0.482	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	SQU US 1	SQU DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	15-Jul-2024 09:30	15-Jul-2024 10:38	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7085-001	VA24B7085-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Dissolved Metals</b>										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00068	0.00068	----	----	----	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	2.66	2.24	----	----	----	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	1.19	1.02	----	----	----	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0194	0.0174	----	----	----	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	<0.50	<0.50	----	----	----	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	0.00084	0.00103	----	----	----	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.000016	0.000017	----	----	----	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	0.00090	0.00074	----	----	----	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0024	0.0015	----	----	----	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	Field	----	----	----	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	Field	----	----	----	
<b>Speciated Metals</b>										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/WT	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Chromium, trivalent [Cr III], total	16065-83-1	EC535/WT	0.00050	mg/L	0.00162	0.00218	----	----	----	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : VA24B7085</p> <p><b>Amendment</b> : 1</p> <p><b>Client</b> : Triton Environmental Consultants Ltd.</p> <p><b>Contact</b> : [REDACTED]</p> <p><b>Address</b> : [REDACTED]</p> <p><b>Telephone</b> : [REDACTED]</p> <p><b>Project</b> : 11964</p> <p><b>PO</b> : 11964-Task 20-Phase 3C-4C</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : ----</p> <p><b>Site</b> : Water Analysis</p> <p><b>Quote number</b> : VA23-TRIT100-012 _V2</p> <p><b>No. of samples received</b> : 2</p> <p><b>No. of samples analysed</b> : 2</p>	<p><b>Page</b> : 1 of 14</p> <p><b>Laboratory</b> : ALS Environmental - Vancouver</p> <p><b>Account Manager</b> : [REDACTED]</p> <p><b>Address</b> : [REDACTED]</p> <p><b>Telephone</b> : [REDACTED]</p> <p><b>Date Samples Received</b> : 15-Jul-2024 13:55</p> <p><b>Issue Date</b> : 26-Jul-2024 15:01</p>
--	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- No Analysis Holding Time Outliers exist.

### ***Outliers : Frequency of Quality Control Samples***

- No Quality Control Sample Frequency Outliers occur.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Ammonia by Fluorescence</b>											
Amber glass total (sulfuric acid) SQU DS 1	E298	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	24-Jul-2024	28 days	9 days	✔	
<b>Anions and Nutrients : Ammonia by Fluorescence</b>											
Amber glass total (sulfuric acid) SQU US 1	E298	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	24-Jul-2024	28 days	9 days	✔	
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>											
HDPE SQU DS 1	E235.Br-L	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>											
HDPE SQU US 1	E235.Br-L	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Chloride in Water by IC</b>											
HDPE SQU DS 1	E235.Cl	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Chloride in Water by IC</b>											
HDPE SQU US 1	E235.Cl	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE SQU DS 1	E235.F	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	





Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE SQU US 1	E235.F	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE SQU DS 1	E235.NO3-L	15-Jul-2024	16-Jul-2024	3 days	1 days	✔	16-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE SQU US 1	E235.NO3-L	15-Jul-2024	16-Jul-2024	3 days	1 days	✔	16-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE SQU DS 1	E235.NO2-L	15-Jul-2024	16-Jul-2024	3 days	1 days	✔	16-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE SQU US 1	E235.NO2-L	15-Jul-2024	16-Jul-2024	3 days	1 days	✔	16-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE SQU DS 1	E235.SO4	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE SQU US 1	E235.SO4	15-Jul-2024	16-Jul-2024	28 days	1 days	✔	16-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Total Nitrogen by Colourimetry</b>											
Amber glass total (sulfuric acid) SQU DS 1	E366	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	24-Jul-2024	28 days	9 days	✔	
<b>Anions and Nutrients : Total Nitrogen by Colourimetry</b>											
Amber glass total (sulfuric acid) SQU US 1	E366	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	24-Jul-2024	28 days	9 days	✔	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)</b>										
Amber glass total (sulfuric acid) SQU DS 1	E372-U	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	25-Jul-2024	28 days	10 days	✔
<b>Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)</b>										
Amber glass total (sulfuric acid) SQU US 1	E372-U	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	25-Jul-2024	28 days	10 days	✔
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
Glass vial - dissolved (lab preserved) SQU DS 1	E509	15-Jul-2024	20-Jul-2024	28 days	5 days	✔	20-Jul-2024	28 days	5 days	✔
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
Glass vial - dissolved (lab preserved) SQU US 1	E509	15-Jul-2024	20-Jul-2024	28 days	5 days	✔	20-Jul-2024	28 days	5 days	✔
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
HDPE - dissolved (lab preserved) SQU DS 1	E421	15-Jul-2024	20-Jul-2024	180 days	5 days	✔	22-Jul-2024	180 days	7 days	✔
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
HDPE - dissolved (lab preserved) SQU US 1	E421	15-Jul-2024	20-Jul-2024	180 days	5 days	✔	22-Jul-2024	180 days	7 days	✔
<b>Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine</b>										
Glass vial - total (lab preserved) SQU DS 1	EF001	15-Jul-2024	----	----	----		16-Jul-2024	----	1 days	
<b>Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine</b>										
Glass vial - total (lab preserved) SQU US 1	EF001	15-Jul-2024	----	----	----		16-Jul-2024	----	1 days	
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>										
Amber glass dissolved (sulfuric acid) SQU DS 1	E358-L	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	23-Jul-2024	28 days	8 days	✔



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>											
<b>Amber glass dissolved (sulfuric acid)</b> SQU US 1	E358-L	15-Jul-2024	23-Jul-2024	28 days	8 days	✓	23-Jul-2024	28 days	8 days	✓	
<b>Physical Tests : Alkalinity Species by Titration</b>											
<b>HDPE</b> SQU DS 1	E290	15-Jul-2024	16-Jul-2024	14 days	1 days	✓	16-Jul-2024	14 days	1 days	✓	
<b>Physical Tests : Alkalinity Species by Titration</b>											
<b>HDPE</b> SQU US 1	E290	15-Jul-2024	16-Jul-2024	14 days	1 days	✓	16-Jul-2024	14 days	1 days	✓	
<b>Physical Tests : TDS by Gravimetry</b>											
<b>HDPE</b> SQU DS 1	E162	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✓	
<b>Physical Tests : TDS by Gravimetry</b>											
<b>HDPE</b> SQU US 1	E162	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✓	
<b>Physical Tests : TSS by Gravimetry</b>											
<b>HDPE</b> SQU DS 1	E160	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✓	
<b>Physical Tests : TSS by Gravimetry</b>											
<b>HDPE</b> SQU US 1	E160	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✓	
<b>Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC</b>											
<b>UV-inhibited HDPE - total (sodium hydroxide)</b> SQU DS 1	E532	15-Jul-2024	----	----	----		18-Jul-2024	28 days	3 days	✓	
<b>Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC</b>											
<b>UV-inhibited HDPE - total (sodium hydroxide)</b> SQU US 1	E532	15-Jul-2024	----	----	----		18-Jul-2024	28 days	3 days	✓	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Total Metals : Total Mercury in Water by CVAAS</b>											
Glass vial - total (lab preserved) SQU DS 1	E508	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	23-Jul-2024	28 days	8 days	✔	
<b>Total Metals : Total Mercury in Water by CVAAS</b>											
Glass vial - total (lab preserved) SQU US 1	E508	15-Jul-2024	23-Jul-2024	28 days	8 days	✔	23-Jul-2024	28 days	8 days	✔	
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>											
HDPE - total (lab preserved) SQU DS 1	E420	15-Jul-2024	20-Jul-2024	180 days	5 days	✔	22-Jul-2024	180 days	7 days	✔	
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>											
HDPE - total (lab preserved) SQU US 1	E420	15-Jul-2024	20-Jul-2024	180 days	5 days	✔	22-Jul-2024	180 days	7 days	✔	
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>											
HDPE total (zinc acetate+sodium hydroxide) SQU DS 1	E395	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✔	
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>											
HDPE total (zinc acetate+sodium hydroxide) SQU US 1	E395	15-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✔	

Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1547120	1	12	8.3	5.0	✔
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1547119	1	2	50.0	5.0	✔
Chloride in Water by IC	E235.Cl	1547118	1	8	12.5	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1555622	1	19	5.2	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	2	19	10.5	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1547117	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1547113	1	12	8.3	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1547115	1	12	8.3	5.0	✔
Sulfate in Water by IC	E235.SO4	1547116	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1557705	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1550906	1	19	5.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1558855	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550673	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1557733	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1557695	1	20	5.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1547120	1	12	8.3	5.0	✔
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1547119	1	2	50.0	5.0	✔
Chloride in Water by IC	E235.Cl	1547118	1	8	12.5	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1555622	1	19	5.2	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1547117	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1547113	1	12	8.3	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1547115	1	12	8.3	5.0	✔
Sulfate in Water by IC	E235.SO4	1547116	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1557705	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1550906	1	19	5.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1558855	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550673	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1557733	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1557695	1	20	5.0	5.0	✔
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1547120	1	12	8.3	5.0	✔
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1547119	1	2	50.0	5.0	✔
Chloride in Water by IC	E235.Cl	1547118	1	8	12.5	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1555622	1	19	5.2	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1547117	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1547113	1	12	8.3	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1547115	1	12	8.3	5.0	✔
Sulfate in Water by IC	E235.SO4	1547116	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1557705	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1550906	1	19	5.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1558855	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550673	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1557733	1	17	5.8	5.0	✔
TSS by Gravimetry	E160	1557695	1	20	5.0	5.0	✔
<b>Matrix Spikes (MS)</b>							
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1547119	1	2	50.0	5.0	✔
Chloride in Water by IC	E235.Cl	1547118	1	8	12.5	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1555622	1	19	5.2	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	2	19	10.5	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1547117	1	8	12.5	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1547113	1	12	8.3	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1547115	1	12	8.3	5.0	✔
Sulfate in Water by IC	E235.SO4	1547116	1	16	6.2	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1550906	1	19	5.2	5.0	✔
Total Mercury in Water by CVAAS	E508	1558855	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550673	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔



Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS) - Continued</b>							
Total Sulfide by Colourimetry (Automated Flow)	E395	1557733	1	17	5.8	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$ , with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.





Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> <sup>-</sup> ) and reports it as Total Sulphide as (H <sub>2</sub> S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.






Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Waterloo	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection.  Results are based on an un-filtered, field-preserved sample.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Waterloo	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.




Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.

## QUALITY CONTROL REPORT

**Work Order** : **VA24B7085**  
**Amendment** : **1**  
**Client** : Triton Environmental Consultants Ltd.  
**Contact** :   
**Address** :   
**Telephone** :   
**Project** : 11964  
**PO** : 11964-Task 20-Phase 3C-4C  
**C-O-C number** : ----  
**Sampler** : ----  
**Site** : Water Analysis  
**Quote number** : VA23-TRIT100-012\_V2  
**No. of samples received** : 2  
**No. of samples analysed** : 2

**Page** : 1 of 17  
**Laboratory** : ALS Environmental - Vancouver  
**Account Manager** :   
**Address** :   
**Telephone** :   
**Date Samples Received** : 15-Jul-2024 13:55  
**Date Analysis Commenced** : 16-Jul-2024  
**Issue Date** : 26-Jul-2024 15:01


This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
	Analyst	Vancouver Metals, Burnaby, British Columbia
	Production Manager, Environmental	Waterloo Metals, Waterloo, Ontario
	Supervisor - Metals ICP Instrumentation	Vancouver Metals, Burnaby, British Columbia
	Supervisor - Water Chemistry	Vancouver Inorganics, Burnaby, British Columbia
	Department Manager - Inorganics	Vancouver Inorganics, Burnaby, British Columbia
		Vancouver Metals, Burnaby, British Columbia
	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
	Team Leader - Metals	Vancouver Inorganics, Burnaby, British Columbia
	Supervisor - Inorganic	Waterloo Inorganics, Waterloo, Ontario
	Supervisor - Inorganic	Waterloo Metals, Waterloo, Ontario



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1547120)</b>											
VA24B7089-001	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	26.7	26.6	0.375%	20%	----
<b>Physical Tests (QC Lot: 1557695)</b>											
FJ2402042-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	12.8	11.6	1.2	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1557705)</b>											
FJ2402042-001	Anonymous	Solids, total dissolved [TDS]	----	E162	10	mg/L	452	450	0.444%	20%	----
<b>Anions and Nutrients (QC Lot: 1547113)</b>											
FJ2402036-001	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	0.100	mg/L	33.2	32.8	1.42%	20%	----
<b>Anions and Nutrients (QC Lot: 1547115)</b>											
FJ2402036-001	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0200	mg/L	0.113	0.112	0.0013	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1547116)</b>											
VA24B7085-001	SQU US 1	Sulfate (as SO4)	14808-79-8	E235.SO4	0.30	mg/L	2.51	2.50	0.01	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1547117)</b>											
VA24B7085-001	SQU US 1	Fluoride	16984-48-8	E235.F	0.020	mg/L	<0.020	<0.020	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1547118)</b>											
VA24B7085-001	SQU US 1	Chloride	16887-00-6	E235.Cl	0.50	mg/L	0.76	0.75	0.006	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1547119)</b>											
VA24B7085-001	SQU US 1	Bromide	24959-67-9	E235.Br-L	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1560536)</b>											
FJ2402036-001	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.0050	mg/L	0.0189	0.0188	0.00008	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1560539)</b>											
FJ2402036-001	Anonymous	Nitrogen, total	7727-37-9	E366	3.00	mg/L	36.3	41.3	12.8%	20%	----
<b>Anions and Nutrients (QC Lot: 1560540)</b>											
FJ2402036-001	Anonymous	Phosphorus, total	7723-14-0	E372-U	0.0020	mg/L	0.0056	0.0053	0.0003	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1560541)</b>											
VA24B7085-001	SQU US 1	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	0.57	0.59	0.02	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1557733)</b>											
CG2409859-002	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.0112	0.0091	0.0021	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1550673)</b>											
FJ2402033-001	Anonymous	Aluminum, total	7429-90-5	E420	0.0030	mg/L	0.0070	0.0063	0.0007	Diff <2x LOR	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550673) - continued</b>											
FJ2402033-001	Anonymous	Arsenic, total	7440-38-2	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.122	0.125	1.82%	20%	----
		Beryllium, total	7440-41-7	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	0.0000218	0.0000216	0.0000002	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.050	mg/L	32.0	31.0	2.99%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Lead, total	7439-92-1	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.0048	0.0048	0.00002	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	8.38	8.44	0.766%	20%	----
		Manganese, total	7439-96-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.000300	0.000314	0.000014	Diff <2x LOR	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.050	mg/L	0.391	0.398	0.006	Diff <2x LOR	----
		Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00023	0.00024	0.00001	Diff <2x LOR	----
		Selenium, total	7782-49-2	E420	0.000050	mg/L	0.00115	0.00119	3.92%	20%	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	1.83	1.82	0.491%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, total	7440-23-5	E420	0.050	mg/L	1.54	1.54	0.162%	20%	----
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.0656	0.0656	0.0661%	20%	----
		Sulfur, total	7704-34-9	E420	0.50	mg/L	2.90	2.79	0.11	Diff <2x LOR	----
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, total	7440-32-6	E420	0.00030	mg/L	<0.00030	<0.00030	0	Diff <2x LOR	----
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.000168	0.000167	0.650%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550673) - continued</b>											
FJ2402033-001	Anonymous	Vanadium, total	7440-62-2	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0030	mg/L	<0.0030	<0.0030	0	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1558855)</b>											
VA24B7085-001	SQU US 1	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Dissolved Metals (QC Lot: 1550798)</b>											
VA24B7134-001	Anonymous	Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0354	0.0360	1.53%	20%	----
VA24B7134-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.0079	0.0082	0.0003	Diff <2x LOR	----
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.00515	0.00504	2.24%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	2.85	2.88	1.11%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00027	0.00028	0.000009	Diff <2x LOR	----
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	0.040	0.040	0.0008	Diff <2x LOR	----
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	0.000090	0.000091	0.000001	Diff <2x LOR	----
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	0.844	0.834	1.20%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.00167	0.00171	2.60%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.000056	0.000054	0.000002	Diff <2x LOR	----
		Nickel, dissolved	7440-02-0	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	0.603	0.609	0.942%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00073	0.00074	0.00002	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Silicon, dissolved	7440-21-3	E421	0.050	mg/L	0.331	0.326	0.005	Diff <2x LOR	----
		Silver, dissolved	7440-22-4	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.050	mg/L	1.09	1.10	0.669%	20%	----





Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1550798) - continued</b>											
VA24B7134-001	Anonymous	Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.0147	0.0149	1.30%	20%	----
		Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	0.73	0.62	0.11	Diff <2x LOR	----
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	<0.00030	<0.00030	0	Diff <2x LOR	----
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.00010	mg/L	0.000034	0.000033	0.0000009	Diff <2x LOR	----
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Zirconium, dissolved	7440-67-7	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
<b>Dissolved Metals (QC Lot: 1555622)</b>											
FJ2402022-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Speciated Metals (QC Lot: 1550906)</b>											
VA24B7085-001	SQU US 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1547120)</b>						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
<b>Physical Tests (QCLot: 1557695)</b>						
Solids, total suspended [TSS]	----	E160	3	mg/L	<3.0	----
<b>Physical Tests (QCLot: 1557705)</b>						
Solids, total dissolved [TDS]	----	E162	10	mg/L	<10	----
<b>Anions and Nutrients (QCLot: 1547113)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
<b>Anions and Nutrients (QCLot: 1547115)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
<b>Anions and Nutrients (QCLot: 1547116)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----
<b>Anions and Nutrients (QCLot: 1547117)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
<b>Anions and Nutrients (QCLot: 1547118)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
<b>Anions and Nutrients (QCLot: 1547119)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
<b>Anions and Nutrients (QCLot: 1560536)</b>						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	----
<b>Anions and Nutrients (QCLot: 1560539)</b>						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	----
<b>Anions and Nutrients (QCLot: 1560540)</b>						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>						
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	<0.50	----
<b>Total Sulfides (QCLot: 1557733)</b>						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	----
<b>Total Metals (QCLot: 1550673)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	----
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1550673) - continued</b>						
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	----
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	----
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	----
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	----
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	----
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	----
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	----
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	----
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	----
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1558855)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1550798)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Result</i>	<i>Qualifier</i>
<b>Dissolved Metals (QCLot: 1550798) - continued</b>						
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1555622)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
<b>Speciated Metals (QCLot: 1550906)</b>						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1547120)</b>									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	91.4	85.0	115	----
<b>Physical Tests (QCLot: 1557695)</b>									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	95.7	85.0	115	----
<b>Physical Tests (QCLot: 1557705)</b>									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	87.6	85.0	115	----
<b>Anions and Nutrients (QCLot: 1547113)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	99.6	90.0	110	----
<b>Anions and Nutrients (QCLot: 1547115)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	96.7	90.0	110	----
<b>Anions and Nutrients (QCLot: 1547116)</b>									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	101	90.0	110	----
<b>Anions and Nutrients (QCLot: 1547117)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	97.8	90.0	110	----
<b>Anions and Nutrients (QCLot: 1547118)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	100	90.0	110	----
<b>Anions and Nutrients (QCLot: 1547119)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	103	85.0	115	----
<b>Anions and Nutrients (QCLot: 1560536)</b>									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	103	85.0	115	----
<b>Anions and Nutrients (QCLot: 1560539)</b>									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	101	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560540)</b>									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	----		80.0	120	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>									
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	8.57 mg/L	99.1	80.0	120	----
<b>Total Sulfides (QCLot: 1557733)</b>									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	114	80.0	120	----
<b>Total Metals (QCLot: 1550673)</b>									



Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550673) - continued</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	105	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	105	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	104	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	101	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	96.4	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	99.9	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	98.6	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	100	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	98.2	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	101	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	102	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	101	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	101	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	105	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	101	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	100	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	102	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	100	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	102	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	104	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	110	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	109	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	96.6	80.0	120	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	103	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	102	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	96.1	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	107	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	104	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	104	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	96.7	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	96.8	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	99.2	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	102	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	98.0	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	96.8	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	104	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550673) - continued</b>									
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	102	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	106	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	97.7	80.0	120	----
<b>Total Metals (QCLot: 1558855)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	100	80.0	120	----
<b>Dissolved Metals (QCLot: 1550798)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	99.4	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	99.6	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	104	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	103	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	96.0	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	97.9	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	103	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	99.8	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	101	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	97.8	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	99.9	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	97.7	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	99.4	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	102	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	98.4	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	102	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	98.9	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	98.5	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	103	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	97.3	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	100	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	106	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	101	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	99.7	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	105	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	91.8	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	101	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	97.5	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	88.7	80.0	120	----





Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1550798) - continued</b>									
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	101	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	98.5	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	94.1	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	96.3	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	98.6	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	95.4	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	98.8	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	101	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	95.5	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	96.8	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	95.9	80.0	120	----
<b>Speciated Metals (QCLot: 1550906)</b>									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.025 mg/L	101	80.0	120	----



## Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1547113)</b>										
FJ2402036-002	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	48.6 mg/L	50 mg/L	97.2	75.0	125	----
<b>Anions and Nutrients (QCLot: 1547115)</b>										
FJ2402036-002	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	9.40 mg/L	10 mg/L	94.0	75.0	125	----
<b>Anions and Nutrients (QCLot: 1547116)</b>										
VA24B7085-002	SQU DS 1	Sulfate (as SO4)	14808-79-8	E235.SO4	104 mg/L	100 mg/L	104	75.0	125	----
<b>Anions and Nutrients (QCLot: 1547117)</b>										
VA24B7085-002	SQU DS 1	Fluoride	16984-48-8	E235.F	1.04 mg/L	1 mg/L	104	75.0	125	----
<b>Anions and Nutrients (QCLot: 1547118)</b>										
VA24B7085-002	SQU DS 1	Chloride	16887-00-6	E235.Cl	104 mg/L	100 mg/L	104	75.0	125	----
<b>Anions and Nutrients (QCLot: 1547119)</b>										
VA24B7085-002	SQU DS 1	Bromide	24959-67-9	E235.Br-L	0.533 mg/L	0.5 mg/L	107	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560536)</b>										
FJ2402036-002	Anonymous	Ammonia, total (as N)	7664-41-7	E298	ND mg/L	----	ND	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560539)</b>										
FJ2402036-002	Anonymous	Nitrogen, total	7727-37-9	E366	3.82 mg/L	4 mg/L	95.6	70.0	130	----
<b>Anions and Nutrients (QCLot: 1560540)</b>										
FJ2402036-002	Anonymous	Phosphorus, total	7723-14-0	E372-U	ND mg/L	----	ND	70.0	130	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>										
VA24B7085-002	SQU DS 1	Carbon, dissolved organic [DOC]	----	E358-L	5.24 mg/L	5 mg/L	105	70.0	130	----
<b>Total Sulfides (QCLot: 1557733)</b>										
CG2409859-003	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.238 mg/L	0.2 mg/L	119	75.0	125	----
<b>Total Metals (QCLot: 1550673)</b>										
FJ2402033-002	Anonymous	Aluminum, total	7429-90-5	E420	0.207 mg/L	0.2 mg/L	104	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0198 mg/L	0.02 mg/L	99.0	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0202 mg/L	0.02 mg/L	101	70.0	130	----
		Barium, total	7440-39-3	E420	0.0189 mg/L	0.02 mg/L	94.6	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0398 mg/L	0.04 mg/L	99.5	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00995 mg/L	0.01 mg/L	99.5	70.0	130	----
		Boron, total	7440-42-8	E420	0.109 mg/L	0.1 mg/L	109	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00399 mg/L	0.004 mg/L	99.7	70.0	130	----
		Calcium, total	7440-70-2	E420	4.06 mg/L	4 mg/L	101	70.0	130	----
		Cesium, total	7440-46-2	E420	0.0100 mg/L	0.01 mg/L	100	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0407 mg/L	0.04 mg/L	102	70.0	130	----



Sub-Matrix: **Water**


					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550673) - continued</b>										
FJ2402033-002	Anonymous	Cobalt, total	7440-48-4	E420	0.0206 mg/L	0.02 mg/L	103	70.0	130	----
		Copper, total	7440-50-8	E420	0.0202 mg/L	0.02 mg/L	101	70.0	130	----
		Iron, total	7439-89-6	E420	1.93 mg/L	2 mg/L	96.6	70.0	130	----
		Lead, total	7439-92-1	E420	0.0197 mg/L	0.02 mg/L	98.5	70.0	130	----
		Lithium, total	7439-93-2	E420	0.101 mg/L	0.1 mg/L	101	70.0	130	----
		Magnesium, total	7439-95-4	E420	1.03 mg/L	1 mg/L	103	70.0	130	----
		Manganese, total	7439-96-5	E420	0.0208 mg/L	0.02 mg/L	104	70.0	130	----
		Molybdenum, total	7439-98-7	E420	0.0198 mg/L	0.02 mg/L	99.0	70.0	130	----
		Nickel, total	7440-02-0	E420	0.0418 mg/L	0.04 mg/L	104	70.0	130	----
		Phosphorus, total	7723-14-0	E420	9.37 mg/L	10 mg/L	93.7	70.0	130	----
		Potassium, total	7440-09-7	E420	4.33 mg/L	4 mg/L	108	70.0	130	----
		Rubidium, total	7440-17-7	E420	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Selenium, total	7782-49-2	E420	0.0382 mg/L	0.04 mg/L	95.4	70.0	130	----
		Silicon, total	7440-21-3	E420	9.47 mg/L	10 mg/L	94.7	70.0	130	----
		Silver, total	7440-22-4	E420	0.00406 mg/L	0.004 mg/L	101	70.0	130	----
		Sodium, total	7440-23-5	E420	2.05 mg/L	2 mg/L	102	70.0	130	----
		Strontium, total	7440-24-6	E420	0.0200 mg/L	0.02 mg/L	100.0	70.0	130	----
		Sulfur, total	7704-34-9	E420	19.8 mg/L	20 mg/L	99.1	70.0	130	----
		Tellurium, total	13494-80-9	E420	0.0384 mg/L	0.04 mg/L	96.0	70.0	130	----
		Thallium, total	7440-28-0	E420	0.00379 mg/L	0.004 mg/L	94.8	70.0	130	----
		Thorium, total	7440-29-1	E420	0.0203 mg/L	0.02 mg/L	101	70.0	130	----
		Tin, total	7440-31-5	E420	0.0198 mg/L	0.02 mg/L	99.2	70.0	130	----
		Titanium, total	7440-32-6	E420	0.0380 mg/L	0.04 mg/L	95.1	70.0	130	----
		Tungsten, total	7440-33-7	E420	0.0189 mg/L	0.02 mg/L	94.3	70.0	130	----
		Uranium, total	7440-61-1	E420	0.00388 mg/L	0.004 mg/L	97.1	70.0	130	----
		Vanadium, total	7440-62-2	E420	0.101 mg/L	0.1 mg/L	101	70.0	130	----
		Zinc, total	7440-66-6	E420	0.381 mg/L	0.4 mg/L	95.2	70.0	130	----
		Zirconium, total	7440-67-7	E420	0.0395 mg/L	0.04 mg/L	98.8	70.0	130	----
<b>Total Metals (QCLot: 1558855)</b>										
VA24B7085-002	SQU DS 1	Mercury, total	7439-97-6	E508	0.000101 mg/L	0 mg/L	101	70.0	130	----
<b>Dissolved Metals (QCLot: 1550798)</b>										
VA24B7134-002	Anonymous	Lead, dissolved	7439-92-1	E421	0.0198 mg/L	0.02 mg/L	99.1	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.384 mg/L	0.4 mg/L	96.1	70.0	130	----
VA24B7134-002	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.192 mg/L	0.2 mg/L	95.8	70.0	130	----
		Antimony, dissolved	7440-36-0	E421	0.0187 mg/L	0.02 mg/L	93.7	70.0	130	----
		Arsenic, dissolved	7440-38-2	E421	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Barium, dissolved	7440-39-3	E421	0.0202 mg/L	0.02 mg/L	101	70.0	130	----
		Beryllium, dissolved	7440-41-7	E421	0.0375 mg/L	0.04 mg/L	93.7	70.0	130	----
		Bismuth, dissolved	7440-69-9	E421	0.00893 mg/L	0.01 mg/L	89.3	70.0	130	----
		Boron, dissolved	7440-42-8	E421	0.101 mg/L	0.1 mg/L	101	70.0	130	----
		Cadmium, dissolved	7440-43-9	E421	0.00392 mg/L	0.004 mg/L	97.9	70.0	130	----
		Calcium, dissolved	7440-70-2	E421	3.85 mg/L	4 mg/L	96.3	70.0	130	----
		Cesium, dissolved	7440-46-2	E421	0.00959 mg/L	0.01 mg/L	95.9	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1550798) - continued</b>										
VA24B7134-002	Anonymous	Chromium, dissolved	7440-47-3	E421	0.0389 mg/L	0.04 mg/L	97.2	70.0	130	----
		Cobalt, dissolved	7440-48-4	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Copper, dissolved	7440-50-8	E421	0.0194 mg/L	0.02 mg/L	97.3	70.0	130	----
		Iron, dissolved	7439-89-6	E421	1.91 mg/L	2 mg/L	95.6	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0965 mg/L	0.1 mg/L	96.5	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	0.961 mg/L	1 mg/L	96.1	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0199 mg/L	0.02 mg/L	99.5	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0383 mg/L	0.04 mg/L	95.8	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	9.70 mg/L	10 mg/L	97.0	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	4.02 mg/L	4 mg/L	100	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0198 mg/L	0.02 mg/L	99.2	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0390 mg/L	0.04 mg/L	97.6	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	9.76 mg/L	10 mg/L	97.6	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00391 mg/L	0.004 mg/L	97.7	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	1.94 mg/L	2 mg/L	97.3	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	0.0188 mg/L	0.02 mg/L	94.1	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	19.5 mg/L	20 mg/L	97.4	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0405 mg/L	0.04 mg/L	101	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00362 mg/L	0.004 mg/L	90.4	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0193 mg/L	0.02 mg/L	96.4	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0187 mg/L	0.02 mg/L	93.6	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0392 mg/L	0.04 mg/L	98.0	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0183 mg/L	0.02 mg/L	91.3	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00374 mg/L	0.004 mg/L	93.5	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0982 mg/L	0.1 mg/L	98.2	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0396 mg/L	0.04 mg/L	99.1	70.0	130	----
<b>Dissolved Metals (QCLot: 1555622)</b>										
FJ2402022-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000987 mg/L	0 mg/L	98.7	70.0	130	----
<b>Speciated Metals (QCLot: 1550906)</b>										
VA24B7085-001	SQU US 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0398 mg/L	0.04 mg/L	99.4	70.0	130	----



 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix B	B-4

## BCR Site Receiving Environment Field Notes and Logs



# FortisBC Eagle Mountain-Woodfibre Gas Pipeline

## Water Discharge Authorization Water Quality Monitoring

2024-7-15-Chycoski-E4022

<b>Project Component:</b>	Tunnel	<b>Site Name:</b>	Receiving Environment - Downstream of Discharge
<b>Inspection Date:</b>	07/15/2024	<b>Location:</b>	BC Rail Site
<b>Triton QP:</b>	Lily Chycoski	<b>Latitude/Longitude:</b>	49.725282 -123.165175
<b>Temperature(c):</b>	Low 18 High 25	<b>Permit:</b>	AE 111824
<b>Weather Conditions:</b>	Clear	<b>Ground Conditions:</b>	Dry

### Observations

**Time:** 10:38:00    **Flow Volume (visual):** high  
**Notes:** Conductivity is 22 micro Siemens per cm  
Turbidity is 157 FNRU  
**Odour Detected?:** No    **Notes:**  
**Unusual Colour?** Yes    **Notes:** Brown and very turbid  
**Unusual Observations?** No    **Notes:**  
**Seen on Water?** No    **Notes:**

### Samples Collected - Parameters

<b>Total Metals + Mercury</b>	Yes	<b>General Parameters (Alkalinity)</b>	Yes	<b>Other Sample:</b>	Total hexavalent chromium and total trivalent chromium
<b>Dissolved Metals + Mercury</b>	Yes	<b>Total Sulfide, Unionized Sulfide</b>	Yes	<b>QA Samples:</b>	No Total hexavalent chromium and total trivalent chromium
<b>TSS</b>	Yes	<b>Anions</b>	Yes		
<b>TDS</b>	Yes	<b>VOC/VPH</b>	No		
<b>Nutrients</b>	Yes	<b>EPH, PAH, LEPH/HEPH</b>	No		
<b>DOC</b>	Yes	<b>Trout LC50</b>	No		

### Logger Maintenance

<b>Logger Maintenance Performed?</b>	Yes	<b>Photo of COC with Lab Signature?</b>	Yes
--------------------------------------	-----	---	-----

#### Describe Logger Maintenance

Logger switched for working one and weight added

Photos



**Photo:** 1  
**Location:** SQU DS 1  
**Description:** US view




**Photo:** 2  
**Location:** SQU DS 1  
**Description:** Across view



**Photos**



**Photo:** 3  
**Location:** SQU DS 1  
**Description:** DS view

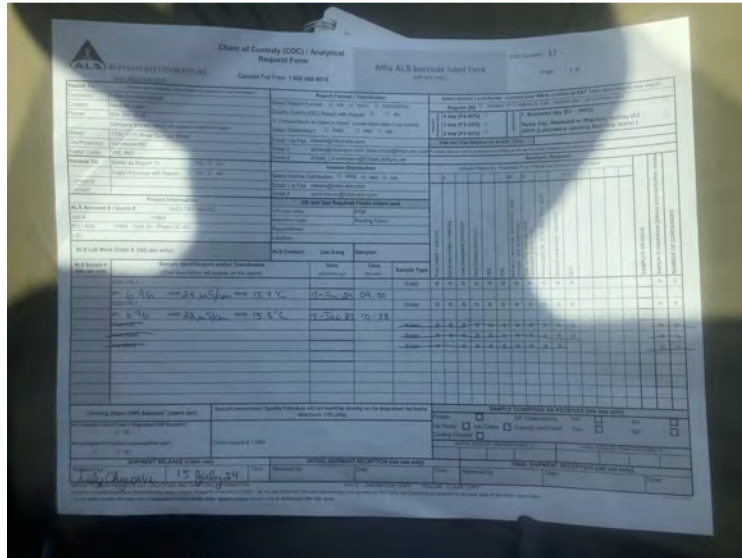

**Photo:** 4  
**Location:** SQU DS 1  
**Description:** Lab COC



2024-7-15-Chycoski-E4022

**Sign Off**

**Report Prepared By:** Lily Chycoski

**Report Reviewed:**

**Report Reviewer:**

**Professional(s) of Record:**

**Name:**

**Designation:**

**Designation Number:**



# FortisBC Eagle Mountain-Woodfibre Gas Pipeline

## Water Discharge Authorization Water Quality Monitoring

2024-7-15-Chycoski-D2E80

<b>Project Component:</b>	Tunnel	<b>Site Name:</b>	Receiving Environment - Upstream of Discharge
<b>Inspection Date:</b>	07/15/2024	<b>Location:</b>	BC Rail Site
<b>Triton QP:</b>	Lily Chycoski	<b>Latitude/Longitude:</b>	49.726866 -123.163912
<b>Temperature(c):</b>	Low 18 High 25	<b>Permit:</b>	AE 111824
<b>Weather Conditions:</b>	Clear	<b>Ground Conditions:</b>	Dry

### Observations

**Time:** 09:30:00    **Flow Volume (visual):** high  
**Notes:** Conductivity 24 micro Siemens per cm  
Turbidity is 175 FNRU  
**Odour Detected?:** No    **Notes:**  
**Unusual Colour?** No    **Notes:** Water is brown and very turbid  
**Unusual Observations?** Yes    **Notes:**  
**Sheen on Water?** No    **Notes:**

### Samples Collected - Parameters

<b>Total Metals + Mercury</b>	Yes	<b>General Parameters (Alkalinity)</b>	Yes	<b>Other Sample:</b>
<b>Dissolved Metals + Mercury</b>	Yes	<b>Total Sulfide, Unionized Sulfide</b>	Yes	Total hexavalent chromium and total trivalent chromium
<b>TSS</b>	Yes	<b>Anions</b>	Yes	
<b>TDS</b>	Yes	<b>VOC/VPH</b>	No	<b>QA Samples:</b> No
<b>Nutrients</b>	Yes	<b>EPH, PAH, LEPH/HEPH</b>	No	Total hexavalent chromium and total trivalent chromium
<b>DOC</b>	Yes	<b>Trout LC50</b>	No	

### Logger Maintenance

**Logger Maintenance Performed?** Yes    **Photo of COC with Lab Signature?** Yes  
**Describe Logger Maintenance**  
Logger cleaned and recalibrated for pH.

Photos



**Photo:** 1  
**Location:** SQU US 1  
**Description:** US view




**Photo:** 2  
**Location:** SQU US 1  
**Description:** Across view

**Photos**



**Photo:** 3  
**Location:** SQU US 1  
**Description:** DS view

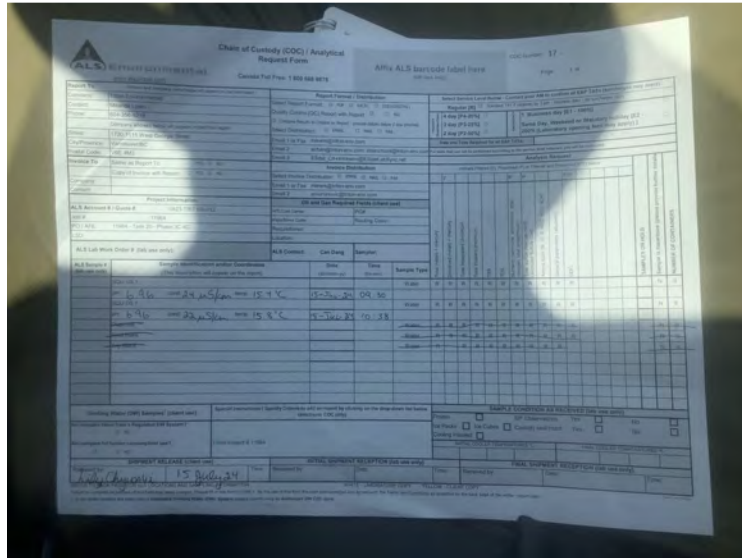

**Photo:** 4  
**Location:** SQU US 1  
**Description:** Lab COC



2024-7-15-Chycoski-D2E80

**Sign Off**

**Report Prepared By:** Lily Chycoski

**Report Reviewed:**


**Report Reviewer:**

**Professional(s) of Record:**

**Name:**

**Designation:**

**Designation Number:**

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix C	C-1

## Appendix C: Woodfibre Site Point of Discharge from Water Treatment Plant Documentation



**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix C	C-2

## Woodfibre Site Sample Analysis







**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix C	C-3

## Woodfibre Site Sample Lab Documentation

## CERTIFICATE OF ANALYSIS

**Work Order** : VA24B7231  
**Amendment** : 1  
**Client** : Triton Environmental Consultants Ltd.  
**Contact** :   
**Address** :   
  
**Telephone** :   
**Project** : 11964  
**PO** : 11964 - Task 30 - Phase 3C-4C  
**C-O-C number** : ----  
**Sampler** : ----  
**Site** : Water Analysis  
**Quote number** : VA23-TRIT100-012\_V2  
**No. of samples received** : 1  
**No. of samples analysed** : 1

**Page** : 1 of 9  
  
**Laboratory** : ALS Environmental - Vancouver  
**Account Manager** :   
**Address** :   
  
**Telephone** :   
**Date Samples Received** : 16-Jul-2024 17:30  
**Date Analysis Commenced** : 17-Jul-2024  
**Issue Date** : 26-Jul-2024 14:55

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
	Laboratory Analyst	Inorganics, Edmonton, Alberta
	Analyst	Metals, Burnaby, British Columbia
	Supervisor - Organics Instrumentation	Organics, Burnaby, British Columbia
	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
	Lab Analyst	Metals, Burnaby, British Columbia
	Lab Assistant	Inorganics, Burnaby, British Columbia
	Senior Analyst	Inorganics, Waterloo, Ontario
	Senior Analyst	Metals, Waterloo, Ontario
	Account Manager Assistant	Administration, Burnaby, British Columbia
	Analyst	Metals, Burnaby, British Columbia



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µg/L	micrograms per litre
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Workorder Comments

**Amendment (26/07/2024): This report has been amended to allow the distribution of reports not previously provided. All analysis results are as per the previous report.**



## Analytical Results

Sub-Matrix: Water					Client sample ID	W LNG EOP	---	---	---	---
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Field Tests</b>										
Conductivity, field	---	EF001/VA	0.10	µS/cm	158.00	---	---	---	---	
pH, field	---	EF001/VA	0.10	pH units	7.34	---	---	---	---	
Temperature, field	---	EF001/VA	0.10	°C	19.1	---	---	---	---	
<b>Physical Tests</b>										
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	57.6	---	---	---	---	
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	57.3	---	---	---	---	
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	85	---	---	---	---	
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	11.4	---	---	---	---	
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	67.3	---	---	---	---	
<b>Anions and Nutrients</b>										
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	<0.0050	---	---	---	---	
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	---	---	---	---	
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	2.59	---	---	---	---	
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	0.330	---	---	---	---	
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	<0.0050	---	---	---	---	
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	---	---	---	---	
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.094	---	---	---	---	
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.0081	---	---	---	---	
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	7.21	---	---	---	---	
<b>Organic / Inorganic Carbon</b>										
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	1.80	---	---	---	---	
<b>Total Sulfides</b>										
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	---	---	---	---	
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	---	---	---	---	
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	---	---	---	---	
<b>Total Metals</b>										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.214	---	---	---	---	
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	0.00080	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	W LNG EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	----	----	----	----	
<b>Total Metals</b>										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00145	----	----	----	----	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.00753	----	----	----	----	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	----	----	----	----	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	0.019	----	----	----	----	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0000122	----	----	----	----	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	21.1	----	----	----	----	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000053	----	----	----	----	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00050	----	----	----	----	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	0.163	----	----	----	----	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.000211	----	----	----	----	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0183	----	----	----	----	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	1.12	----	----	----	----	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.00745	----	----	----	----	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.0234	----	----	----	----	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	<0.050	----	----	----	----	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	5.72	----	----	----	----	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00828	----	----	----	----	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	0.000125	----	----	----	----	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	6.94	----	----	----	----	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	<0.000010	----	----	----	----	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	6.70	----	----	----	----	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0649	----	----	----	----	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	2.66	----	----	----	----	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	----	----	----	----	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000031	----	----	----	----	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	----	----	----	----	
<b>Total Metals</b>										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.00674	----	----	----	----	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	0.00071	----	----	----	----	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.00355	----	----	----	----	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	0.0036	----	----	----	----	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00020	----	----	----	----	
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0185	----	----	----	----	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	0.00075	----	----	----	----	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00150	----	----	----	----	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00585	----	----	----	----	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	----	----	----	----	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	0.017	----	----	----	----	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000104	----	----	----	----	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	21.3	----	----	----	----	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000026	----	----	----	----	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00024	----	----	----	----	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	<0.010	----	----	----	----	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	----	----	----	----	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	0.0163	----	----	----	----	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	1.06	----	----	----	----	
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00647	----	----	----	----	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.0244	----	----	----	----	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	----	----	----	----	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	5.21	----	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	-----
					Result	----	----	----	----	----
<b>Dissolved Metals</b>										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00803	----	----	----	----	----
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	0.000141	----	----	----	----	----
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	5.97	----	----	----	----	----
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	----	----	----	----	----
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	6.66	----	----	----	----	----
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0642	----	----	----	----	----
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	1.95	----	----	----	----	----
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	----	----	----	----	----
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	0.000023	----	----	----	----	----
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	----
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	----	----	----	----	----
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	<0.00030	----	----	----	----	----
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	0.00074	----	----	----	----	----
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.00460	----	----	----	----	----
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	<0.00050	----	----	----	----	----
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0024	----	----	----	----	----
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	----	----	----	----	----
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	----	----	----	----	----
Dissolved metals filtration location	----	EP421/VA	-	-	Field	----	----	----	----	----
<b>Speciated Metals</b>										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/WT	0.00050	mg/L	<0.00050	----	----	----	----	----
Chromium, trivalent [Cr III], total	16065-83-1	EC535/WT	0.00050	mg/L	<0.00050	----	----	----	----	----
<b>Aggregate Organics</b>										
Phenols, total (4AAP)	----	E562/EO	0.0010	mg/L	<0.0010	----	----	----	----	----
<b>Volatile Organic Compounds</b>										
Chlorobenzene	108-90-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	----
Chloromethane	74-87-3	E611C/VA	5.0	µg/L	<5.0	----	----	----	----	----
Dichlorobenzene, 1,2-	95-50-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	----
Dichlorobenzene, 1,3-	541-73-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	----
Dichlorobenzene, 1,4-	106-46-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	----
Dichloropropane, 1,2-	78-87-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	----





## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	----	----	----	----	
<b>Volatile Organic Compounds</b>										
Dichloropropylene, cis+trans-1,3-	542-75-6	E611C/VA	0.75	µg/L	<0.75	----	----	----	----	
Dichloropropylene, cis-1,3-	10061-01-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C/VA	0.20	µg/L	<0.20	----	----	----	----	
Trichloroethane, 1,1,2-	79-00-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Trichlorofluoromethane	75-69-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
<b>Volatile Organic Compounds [Drycleaning]</b>										
Carbon tetrachloride	56-23-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Chloroethane	75-00-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethane, 1,1-	75-34-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethane, 1,2-	107-06-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, 1,1-	75-35-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, cis-1,2-	156-59-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloroethylene, trans-1,2-	156-60-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dichloromethane	75-09-2	E611C/VA	1.0	µg/L	<1.0	----	----	----	----	
Dichloropropylene, trans-1,3-	10061-02-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Tetrachloroethylene	127-18-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Trichloroethane, 1,1,1-	71-55-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Trichloroethylene	79-01-6	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Vinyl chloride	75-01-4	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
<b>Volatile Organic Compounds [Fuels]</b>										
Benzene	71-43-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Ethylbenzene	100-41-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Styrene	100-42-5	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Toluene	108-88-3	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
Xylene, m+p-	179601-23-1	E611C/VA	0.40	µg/L	<0.40	----	----	----	----	
Xylene, o-	95-47-6	E611C/VA	0.30	µg/L	<0.30	----	----	----	----	
Xylenes, total	1330-20-7	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
<b>Volatile Organic Compounds [THMs]</b>										
Bromodichloromethane	75-27-4	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	----	----	----	----	
<b>Volatile Organic Compounds [THMs]</b>										
Bromoform	75-25-2	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Chloroform	67-66-3	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
Dibromochloromethane	124-48-1	E611C/VA	0.50	µg/L	<0.50	----	----	----	----	
<b>Hydrocarbons</b>										
EPH (C10-C19)	----	E601A/VA	250	µg/L	<250	----	----	----	----	
EPH (C19-C32)	----	E601A/VA	250	µg/L	<250	----	----	----	----	
VHw (C6-C10)	----	E581.VH+F1/ VA	100	µg/L	<100	----	----	----	----	
HEPHw	----	EC600A/VA	250	µg/L	<250	----	----	----	----	
LEPHw	----	EC600A/VA	250	µg/L	<250	----	----	----	----	
VPHw	----	EC580A/VA	100	µg/L	<100	----	----	----	----	
<b>Hydrocarbons Surrogates</b>										
Bromobenzotrifluoride, 2- (EPH surrogate)	392-83-6	E601A/VA	1.0	%	82.0	----	----	----	----	
Dichlorotoluene, 3,4-	95-75-0	E581.VH+F1/ VA	1.0	%	81.9	----	----	----	----	
<b>Volatile Organic Compounds Surrogates</b>										
Bromofluorobenzene, 4-	460-00-4	E611C/VA	1.0	%	92.0	----	----	----	----	
Difluorobenzene, 1,4-	540-36-3	E611C/VA	1.0	%	101	----	----	----	----	
<b>Polycyclic Aromatic Hydrocarbons</b>										
Acenaphthene	83-32-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Acenaphthylene	208-96-8	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Acridine	260-94-6	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Anthracene	120-12-7	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benz(a)anthracene	56-55-3	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(a)pyrene	50-32-8	E641A/VA	0.0050	µg/L	<0.0050	----	----	----	----	
Benzo(b+j)fluoranthene	n/a	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(b+j+k)fluoranthene	n/a	E641A/VA	0.015	µg/L	<0.015	----	----	----	----	
Benzo(g,h,i)perylene	191-24-2	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Benzo(k)fluoranthene	207-08-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Chrysene	218-01-9	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Dibenz(a,h)anthracene	53-70-3	E641A/VA	0.0050	µg/L	<0.0050	----	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNQ EOP	----	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 10:26	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7231-001	-----	-----	-----	-----	
					Result	----	----	----	----	
<b>Polycyclic Aromatic Hydrocarbons</b>										
Fluoranthene	206-44-0	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Fluorene	86-73-7	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Methylnaphthalene, 1-	90-12-0	E641A/VA	0.010	µg/L	0.014	----	----	----	----	
Methylnaphthalene, 2-	91-57-6	E641A/VA	0.010	µg/L	0.015	----	----	----	----	
Naphthalene	91-20-3	E641A/VA	0.050	µg/L	<0.050	----	----	----	----	
Phenanthrene	85-01-8	E641A/VA	0.020	µg/L	<0.020	----	----	----	----	
Pyrene	129-00-0	E641A/VA	0.010	µg/L	<0.010	----	----	----	----	
Quinoline	91-22-5	E641A/VA	0.050	µg/L	<0.050	----	----	----	----	
<b>Polycyclic Aromatic Hydrocarbons Surrogates</b>										
Chrysene-d12	1719-03-5	E641A/VA	0.1	%	91.6	----	----	----	----	
Naphthalene-d8	1146-65-2	E641A/VA	0.1	%	92.5	----	----	----	----	
Phenanthrene-d10	1517-22-2	E641A/VA	0.1	%	94.4	----	----	----	----	
<b>Glycols</b>										
Diethylene glycol	111-46-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Ethylene glycol	107-21-1	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Propylene glycol, 1,2-	57-55-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Triethylene glycol	112-27-6	E680E/VA	5.0	mg/L	<5.0	----	----	----	----	
Glycols, total (EG+DEG+PG)	----	E680E/VA	10	mg/L	<10	----	----	----	----	
<b>Glycols Surrogates</b>										
Propanediol, 1,3-	504-63-2	E680E/VA	1.0	%	98.2	----	----	----	----	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : VA24B7231</p> <p><b>Amendment</b> : 1</p> <p><b>Client</b> : Triton Environmental Consultants Ltd.</p> <p><b>Contact</b> : [REDACTED]</p> <p><b>Address</b> : [REDACTED]</p> <p><b>Telephone</b> : [REDACTED]</p> <p><b>Project</b> : 11964</p> <p><b>PO</b> : 11964 - Task 30 - Phase 3C-4C</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : ----</p> <p><b>Site</b> : Water Analysis</p> <p><b>Quote number</b> : VA23-TRIT100-012 _V2</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 14</p> <p><b>Laboratory</b> : ALS Environmental - Vancouver</p> <p><b>Account Manager</b> : [REDACTED]</p> <p><b>Address</b> : [REDACTED]</p> <p><b>Telephone</b> : [REDACTED]</p> <p><b>Date Samples Received</b> : 16-Jul-2024 17:30</p> <p><b>Issue Date</b> : 26-Jul-2024 14:55</p>
--	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- No Analysis Holding Time Outliers exist.

### ***Outliers : Frequency of Quality Control Samples***

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Aggregate Organics : Phenols (4AAP) in Water by Colorimetry</b>										
Amber glass total (sulfuric acid) WLNG EOP	E562	16-Jul-2024	19-Jul-2024	28 days	3 days	✔	19-Jul-2024	28 days	3 days	✔
<b>Anions and Nutrients : Ammonia by Fluorescence</b>										
Amber glass total (sulfuric acid) WLNG EOP	E298	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	24-Jul-2024	28 days	8 days	✔
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>										
HDPE WLNG EOP	E235.Br-L	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Chloride in Water by IC</b>										
HDPE WLNG EOP	E235.Cl	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Fluoride in Water by IC</b>										
HDPE WLNG EOP	E235.F	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>										
HDPE WLNG EOP	E235.NO3-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>										
HDPE WLNG EOP	E235.NO2-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Anions and Nutrients : Sulfate in Water by IC</b>										
HDPE WLNG EOP	E235.SO4	16-Jul-2024	17-Jul-2024	28 days	1 days	✓	17-Jul-2024	28 days	1 days	✓
<b>Anions and Nutrients : Total Nitrogen by Colourimetry</b>										
Amber glass total (sulfuric acid) WLNG EOP	E366	16-Jul-2024	23-Jul-2024	28 days	7 days	✓	24-Jul-2024	28 days	8 days	✓
<b>Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)</b>										
Amber glass total (sulfuric acid) WLNG EOP	E372-U	16-Jul-2024	23-Jul-2024	28 days	7 days	✓	25-Jul-2024	28 days	9 days	✓
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
Glass vial - dissolved (lab preserved) WLNG EOP	E509	16-Jul-2024	23-Jul-2024	28 days	7 days	✓	23-Jul-2024	28 days	7 days	✓
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
HDPE - dissolved (lab preserved) WLNG EOP	E421	16-Jul-2024	20-Jul-2024	180 days	4 days	✓	22-Jul-2024	180 days	6 days	✓
<b>Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine</b>										
Glass vial - total (lab preserved) WLNG EOP	EF001	16-Jul-2024	----	----	----		18-Jul-2024	----	2 days	
<b>Glycols : Glycols (4 analytes) by GC-FID</b>										
Glass vial WLNG EOP	E680E	16-Jul-2024	19-Jul-2024	7 days	3 days	✓	19-Jul-2024	40 days	0 days	✓
<b>Hydrocarbons : BC PHCs - EPH by GC-FID</b>										
Amber glass/Teflon lined cap (sodium bisulfate) WLNG EOP	E601A	16-Jul-2024	23-Jul-2024	14 days	7 days	✓	24-Jul-2024	40 days	1 days	✓
<b>Hydrocarbons : VH and F1 by Headspace GC-FID</b>										
Glass vial (sodium bisulfate) WLNG EOP	E581.VH+F1	16-Jul-2024	17-Jul-2024	14 days	1 days	✓	18-Jul-2024	14 days	2 days	✓



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>											
Amber glass dissolved (sulfuric acid) WLNG EOP	E358-L	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔	
<b>Physical Tests : Alkalinity Species by Titration</b>											
HDPE WLNG EOP	E290	16-Jul-2024	17-Jul-2024	14 days	1 days	✔	17-Jul-2024	14 days	1 days	✔	
<b>Physical Tests : TDS by Gravimetry</b>											
HDPE WLNG EOP	E162	16-Jul-2024	----	----	----		22-Jul-2024	7 days	6 days	✔	
<b>Physical Tests : TSS by Gravimetry</b>											
HDPE WLNG EOP	E160	16-Jul-2024	----	----	----		22-Jul-2024	7 days	6 days	✔	
<b>Polycyclic Aromatic Hydrocarbons : PAHs in Water by Hexane LVI GC-MS</b>											
Amber glass/Teflon lined cap (sodium bisulfate) WLNG EOP	E641A	16-Jul-2024	23-Jul-2024	14 days	7 days	✔	23-Jul-2024	40 days	0 days	✔	
<b>Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC</b>											
UV-inhibited HDPE - total (sodium hydroxide) WLNG EOP	E532	16-Jul-2024	----	----	----		22-Jul-2024	28 days	6 days	✔	
<b>Total Metals : Total Mercury in Water by CVAAS</b>											
Glass vial - total (lab preserved) WLNG EOP	E508	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔	
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>											
HDPE - total (lab preserved) WLNG EOP	E420	16-Jul-2024	20-Jul-2024	180 days	4 days	✔	22-Jul-2024	180 days	6 days	✔	
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>											
HDPE total (zinc acetate+sodium hydroxide) WLNG EOP	E395	16-Jul-2024	----	----	----		23-Jul-2024	7 days	7 days	✔	





Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Volatile Organic Compounds : VOCs (BC List) by Headspace GC-MS</b>										
<b>Glass vial (sodium bisulfate)</b> WLNG EOP	E611C	16-Jul-2024	17-Jul-2024	14 days	1 days	✔	18-Jul-2024	14 days	2 days	✔

**Legend & Qualifier Definitions**

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1549104	1	20	5.0	5.0	✔
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549109	1	19	5.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549108	1	19	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	2	19	10.5	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1549107	1	19	5.2	5.0	✔
Glycols (4 analytes) by GC-FID	E680E	1554903	1	3	33.3	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549110	1	17	5.8	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549111	1	19	5.2	5.0	✔
Phenols (4AAP) in Water by Colorimetry	E562	1554060	1	10	10.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1549112	1	20	5.0	5.0	✔
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1554917	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550676	1	19	5.2	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1549030	1	1	100.0	5.0	✔
VOCs (BC List) by Headspace GC-MS	E611C	1549029	1	17	5.8	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1549104	1	20	5.0	5.0	✔
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
BC PHCs - EPH by GC-FID	E601A	1559686	1	15	6.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549109	1	19	5.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549108	1	19	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	1	19	5.2	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1549107	1	19	5.2	5.0	✔
Glycols (4 analytes) by GC-FID	E680E	1554903	1	3	33.3	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549110	1	17	5.8	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549111	1	19	5.2	5.0	✔



Matrix: **Water**

Evaluation: \* = QC frequency outside specification; ✓ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
PAHs in Water by Hexane LVI GC-MS	E641A	1559687	1	16	6.2	5.0	✓
Phenols (4AAP) in Water by Colorimetry	E562	1554060	1	10	10.0	5.0	✓
Sulfate in Water by IC	E235.SO4	1549112	1	20	5.0	5.0	✓
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✓
Total Hexavalent Chromium (Cr VI) by IC	E532	1554917	1	20	5.0	5.0	✓
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✓
Total Metals in Water by CRC ICPMS	E420	1550676	1	19	5.2	5.0	✓
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✓
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✓
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✓
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✓
VH and F1 by Headspace GC-FID	E581.VH+F1	1549030	1	1	100.0	5.0	✓
VOCs (BC List) by Headspace GC-MS	E611C	1549029	1	17	5.8	5.0	✓
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1549104	1	20	5.0	5.0	✓
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✓
BC PHCs - EPH by GC-FID	E601A	1559686	1	15	6.6	5.0	✓
Bromide in Water by IC (Low Level)	E235.Br-L	1549109	1	19	5.2	5.0	✓
Chloride in Water by IC	E235.Cl	1549108	1	19	5.2	5.0	✓
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✓
Dissolved Metals in Water by CRC ICPMS	E421	1550798	1	19	5.2	5.0	✓
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✓
Fluoride in Water by IC	E235.F	1549107	1	19	5.2	5.0	✓
Glycols (4 analytes) by GC-FID	E680E	1554903	1	3	33.3	5.0	✓
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549110	1	17	5.8	5.0	✓
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549111	1	19	5.2	5.0	✓
PAHs in Water by Hexane LVI GC-MS	E641A	1559687	1	16	6.2	5.0	✓
Phenols (4AAP) in Water by Colorimetry	E562	1554060	1	10	10.0	5.0	✓
Sulfate in Water by IC	E235.SO4	1549112	1	20	5.0	5.0	✓
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✓
Total Hexavalent Chromium (Cr VI) by IC	E532	1554917	1	20	5.0	5.0	✓
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✓
Total Metals in Water by CRC ICPMS	E420	1550676	1	19	5.2	5.0	✓
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✓
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✓
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✓
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✓
VH and F1 by Headspace GC-FID	E581.VH+F1	1549030	1	1	100.0	5.0	✓
VOCs (BC List) by Headspace GC-MS	E611C	1549029	1	17	5.8	5.0	✓



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS)</b>							
Ammonia by Fluorescence	E298	1560536	1	19	5.2	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549109	1	19	5.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549108	1	19	5.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1550798	2	19	10.5	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1560541	1	5	20.0	5.0	✔
Fluoride in Water by IC	E235.F	1549107	1	19	5.2	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549110	1	17	5.8	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549111	1	19	5.2	5.0	✔
Phenols (4AAP) in Water by Colorimetry	E562	1554060	1	10	10.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1549112	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1554917	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550676	1	19	5.2	5.0	✔
Total Nitrogen by Colourimetry	E366	1560539	1	18	5.5	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1560540	1	19	5.2	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1549030	0	1	0.0	5.0	✖
VOCs (BC List) by Headspace GC-MS	E611C	1549029	1	17	5.8	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$ , with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> <sup>-</sup> ) and reports it as Total Sulphide as (H <sub>2</sub> S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Waterloo	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection.  Results are based on an un-filtered, field-preserved sample.
Phenols (4AAP) in Water by Colorimetry	E562 ALS Environmental - Edmonton	Water	EPA 9066	This automated method is based on the distillation of phenol and subsequent reaction of the distillate with alkaline ferricyanide (K <sub>3</sub> Fe(CN) <sub>6</sub> ) and 4-amino-antipyrine (4-AAP) to form a red complex which is measured colorimetrically.
VH and F1 by Headspace GC-FID	E581.VH+F1 ALS Environmental - Vancouver	Water	BC MOE Lab Manual / CCME PHC in Soil - Tier 1 (mod)	Volatile Hydrocarbons (VH and F1) is analyzed by static headspace GC-FID. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law.  Analytical methods for CCME Petroleum Hydrocarbons (PHCs) are validated to comply fully with the Reference Method for the Canada-Wide Standard for PHC. Unless qualified, all required quality control criteria of the CCME PHC method have been met, including response factor and linearity requirements.
BC PHCs - EPH by GC-FID	E601A ALS Environmental - Vancouver	Water	BC MOE Lab Manual	Sample extracts are analyzed by GC-FID for BC hydrocarbon fractions.
VOCs (BC List) by Headspace GC-MS	E611C ALS Environmental - Vancouver	Water	EPA 8260D (mod)	Volatile Organic Compounds (VOCs) are analyzed by static headspace GC-MS. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law.  Total Xylenes is the sum of m,p-Xylene & o-Xylene. Total BTEX is the sum of Benzene, Toluene, Ethylbenzene, & Total Xylenes. Total BTEX+Styrene is the sum of Total BTEX & Styrene. Total Trihalomethanes [THMs] is the sum of Bromodichloromethane, Bromoform, Chloroform, & Dibromochloromethane.
PAHs in Water by Hexane LVI GC-MS	E641A ALS Environmental - Vancouver	Water	EPA 8270E (mod)	Polycyclic Aromatic Hydrocarbons (PAHs) are analyzed by large volume injection (LVI) GC-MS.
Glycols (4 analytes) by GC-FID	E680E ALS Environmental - Vancouver	Water	EPA 8015D (mod)	Derivatized glycols are analyzed by GC-FID.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Waterloo	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
VPH: VH-BTEX-Styrene	EC580A ALS Environmental - Vancouver	Water	BC MOE Lab Manual (VPH in Water and Solids) (mod)	Volatile Petroleum Hydrocarbons (VPH) is calculated as follows: VPHw = Volatile Hydrocarbons (VH C6-C10) minus benzene, toluene, ethylbenzene, xylenes (BTEX) and styrene.
LEPH and HEPH: EPH-PAH	EC600A ALS Environmental - Vancouver	Water	BC MOE Lab Manual (LEPH and HEPH)	Light Extractable Petroleum Hydrocarbons (LEPH) and Heavy Extractable Petroleum Hydrocarbons (HEPH) are calculated as follows: LEPH = Extractable Petroleum Hydrocarbons (EPH10-19) minus Acenaphthene, Acridine, Anthracene, Fluorene, Naphthalene and Phenanthrene; HEPH = Extractable Petroleum Hydrocarbons (EPH19-32) minus Benz(a)anthracene, Benzo(a)pyrene, Fluoranthene, and Pyrene.
Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.





<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO <sub>3</sub> .
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.
VOCs Preparation for Headspace Analysis	EP581 ALS Environmental - Vancouver	Water	EPA 5021A (mod)	Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler. An aliquot of the headspace is then injected into the GC/MS-FID system.
PHCs and PAHs Hexane Extraction	EP601 ALS Environmental - Vancouver	Water	EPA 3511 (mod)	Petroleum Hydrocarbons (PHCs) and Polycyclic Aromatic Hydrocarbons (PAHs) are extracted using a hexane liquid-liquid extraction.
Glycols Extraction and Derivatization (BC Only)	EP680E ALS Environmental - Vancouver	Water	EPA 8015D (mod)	Aqueous sample is derivatized and extracted with organic solvent.

## QUALITY CONTROL REPORT

<b>Work Order</b>	: <b>VA24B7231</b>	<b>Page</b>	: 1 of 23
<b>Amendment</b>	: <b>1</b>	<b>Laboratory</b>	: ALS Environmental - Vancouver
<b>Client</b>	: Triton Environmental Consultants Ltd.	<b>Account Manager</b>	
<b>Contact</b>		<b>Address</b>	
<b>Address</b>		<b>Telephone</b>	
<b>Telephone</b>		<b>Date Samples Received</b>	: 16-Jul-2024 17:30
<b>Project</b>	: 11964	<b>Date Analysis Commenced</b>	: 17-Jul-2024
<b>PO</b>	: 11964 - Task 30 - Phase 3C-4C	<b>Issue Date</b>	: 26-Jul-2024 14:55
<b>C-O-C number</b>	: ---		
<b>Sampler</b>	: ---		
<b>Site</b>	: Water Analysis		
<b>Quote number</b>	: VA23-TRIT100-012_V2		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
	Laboratory Analyst	Edmonton Inorganics, Edmonton, Alberta
	Analyst	Vancouver Metals, Burnaby, British Columbia
	Supervisor - Organics Instrumentation	Vancouver Organics, Burnaby, British Columbia
	Supervisor - Metals ICP Instrumentation	Vancouver Metals, Burnaby, British Columbia
	Lab Analyst	Vancouver Metals, Burnaby, British Columbia
	Lab Assistant	Vancouver Inorganics, Burnaby, British Columbia
	Senior Analyst	Waterloo Inorganics, Waterloo, Ontario
	Senior Analyst	Waterloo Metals, Waterloo, Ontario
	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
	Analyst	Vancouver Metals, Burnaby, British Columbia



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1549104)</b>											
VA24B7228-001	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	23.0	22.8	0.873%	20%	----
<b>Physical Tests (QC Lot: 1558750)</b>											
FJ2402074-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	<3.0	<3.0	0	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1558760)</b>											
FJ2402074-001	Anonymous	Solids, total dissolved [TDS]	----	E162	20	mg/L	117	119	2	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549107)</b>											
FJ2402027-001	Anonymous	Fluoride	16984-48-8	E235.F	0.100	mg/L	0.819	0.779	0.039	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549108)</b>											
FJ2402027-001	Anonymous	Chloride	16887-00-6	E235.Cl	2.50	mg/L	3.10	3.04	0.05	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549109)</b>											
FJ2402027-001	Anonymous	Bromide	24959-67-9	E235.Br-L	0.250	mg/L	<0.250	<0.250	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549110)</b>											
FJ2402027-001	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0250	mg/L	<0.0250	<0.0250	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549111)</b>											
FJ2402027-001	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549112)</b>											
FJ2402027-001	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	1.50	mg/L	2.98	2.78	0.20	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1560536)</b>											
FJ2402036-001	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.0050	mg/L	0.0189	0.0188	0.00008	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1560539)</b>											
FJ2402036-001	Anonymous	Nitrogen, total	7727-37-9	E366	3.00	mg/L	36.3	41.3	12.8%	20%	----
<b>Anions and Nutrients (QC Lot: 1560540)</b>											
FJ2402036-001	Anonymous	Phosphorus, total	7723-14-0	E372-U	0.0020	mg/L	0.0056	0.0053	0.0003	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1560541)</b>											
VA24B7085-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	0.57	0.59	0.02	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1559690)</b>											
CG2409956-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	<0.0015	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1550676)</b>											
VA24B7231-001	WLNG EOP	Aluminum, total	7429-90-5	E420	0.0030	mg/L	0.214	0.203	5.25%	20%	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	0.00080	0.00080	0.000004	Diff <2x LOR	----



Sub-Matrix: **Water**

Laboratory Duplicate (DUP) Report

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550676) - continued</b>											
VA24B7231-001	WLNG EOP	Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00145	0.00148	1.93%	20%	---
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.00753	0.00696	7.86%	20%	---
		Beryllium, total	7440-41-7	E420	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	---
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Boron, total	7440-42-8	E420	0.010	mg/L	0.019	0.019	0.00005	Diff <2x LOR	---
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	0.0000122	0.0000115	0.0000007	Diff <2x LOR	---
		Calcium, total	7440-70-2	E420	0.050	mg/L	21.1	20.9	1.03%	20%	---
		Cesium, total	7440-46-2	E420	0.000010	mg/L	0.000053	0.000052	0.000001	Diff <2x LOR	---
		Chromium, total	7440-47-3	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Copper, total	7440-50-8	E420	0.000050	mg/L	0.000050	<0.000050	0.000005	Diff <2x LOR	---
		Iron, total	7439-89-6	E420	0.010	mg/L	0.163	0.163	0.448%	20%	---
		Lead, total	7439-92-1	E420	0.000050	mg/L	0.000211	0.000203	0.000008	Diff <2x LOR	---
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.0183	0.0180	1.40%	20%	---
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	1.12	1.13	0.821%	20%	---
		Manganese, total	7439-96-5	E420	0.00010	mg/L	0.00745	0.00772	3.52%	20%	---
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.0234	0.0229	2.06%	20%	---
		Nickel, total	7440-02-0	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	---
		Potassium, total	7440-09-7	E420	0.050	mg/L	5.72	5.60	2.10%	20%	---
		Rubidium, total	7440-17-7	E420	0.000020	mg/L	0.00828	0.00835	0.851%	20%	---
		Selenium, total	7782-49-2	E420	0.000050	mg/L	0.000125	0.000117	0.000008	Diff <2x LOR	---
		Silicon, total	7440-21-3	E420	0.10	mg/L	6.94	6.64	4.35%	20%	---
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	---
		Sodium, total	7440-23-5	E420	0.050	mg/L	6.70	6.73	0.468%	20%	---
		Strontium, total	7440-24-6	E420	0.000020	mg/L	0.0649	0.0625	3.73%	20%	---
		Sulfur, total	7704-34-9	E420	0.50	mg/L	2.66	2.61	0.04	Diff <2x LOR	---
		Tellurium, total	13494-80-9	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	---
		Thallium, total	7440-28-0	E420	0.000010	mg/L	0.000031	0.000033	0.000002	Diff <2x LOR	---
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	0.00018	0.00008	Diff <2x LOR	---
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Titanium, total	7440-32-6	E420	0.00030	mg/L	0.00674	0.00666	1.08%	20%	---
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	0.00071	0.00072	0.000007	Diff <2x LOR	---
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.00355	0.00355	0.00877%	20%	---



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550676) - continued</b>											
VA24B7231-001	WLNG EOP	Vanadium, total	7440-62-2	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0030	mg/L	0.0036	0.0038	0.0002	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1560070)</b>											
VA24B7077-001	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Dissolved Metals (QC Lot: 1550798)</b>											
VA24B7134-001	Anonymous	Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0354	0.0360	1.53%	20%	----
VA24B7134-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.0079	0.0082	0.0003	Diff <2x LOR	----
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.00515	0.00504	2.24%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	2.85	2.88	1.11%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00027	0.00028	0.000009	Diff <2x LOR	----
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	0.040	0.040	0.0008	Diff <2x LOR	----
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	0.000090	0.000091	0.000001	Diff <2x LOR	----
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	----
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	0.844	0.834	1.20%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.00167	0.00171	2.60%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.000056	0.000054	0.000002	Diff <2x LOR	----
		Nickel, dissolved	7440-02-0	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	0.603	0.609	0.942%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00073	0.00074	0.00002	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Silicon, dissolved	7440-21-3	E421	0.050	mg/L	0.331	0.326	0.005	Diff <2x LOR	----
		Silver, dissolved	7440-22-4	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.050	mg/L	1.09	1.10	0.669%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1550798) - continued</b>											
VA24B7134-001	Anonymous	Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.0147	0.0149	1.30%	20%	---
		Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	0.73	0.62	0.11	Diff <2x LOR	---
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
		Thallium, dissolved	7440-28-0	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Thorium, dissolved	7440-29-1	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	<0.00030	<0.00030	0	Diff <2x LOR	---
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Uranium, dissolved	7440-61-1	E421	0.00010	mg/L	0.000034	0.000033	0.0000009	Diff <2x LOR	---
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Zirconium, dissolved	7440-67-7	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
<b>Dissolved Metals (QC Lot: 1559792)</b>											
FJ2402033-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	---
<b>Speciated Metals (QC Lot: 1554917)</b>											
HA2401704-001	Anonymous	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
<b>Aggregate Organics (QC Lot: 1554060)</b>											
CG2410011-002	Anonymous	Phenols, total (4AAP)	----	E562	0.0010	mg/L	<0.0010	<0.0010	0	Diff <2x LOR	---
<b>Volatile Organic Compounds (QC Lot: 1549029)</b>											
VA24B7074-001	Anonymous	Benzene	71-43-2	E611C	0.50	µg/L	2.46	2.52	0.06	Diff <2x LOR	---
		Bromodichloromethane	75-27-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Bromoform	75-25-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Carbon tetrachloride	56-23-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Chlorobenzene	108-90-7	E611C	0.50	µg/L	12.1	12.5	2.76%	30%	---
		Chloroethane	75-00-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Chloroform	67-66-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Chloromethane	74-87-3	E611C	5.0	µg/L	<5.0	<5.0	0	Diff <2x LOR	---
		Dibromochloromethane	124-48-1	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Dichlorobenzene, 1,2-	95-50-1	E611C	0.50	µg/L	<0.50	0.70	0.20	Diff <2x LOR	---
		Dichlorobenzene, 1,3-	541-73-1	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Dichlorobenzene, 1,4-	106-46-7	E611C	0.50	µg/L	3.14	3.11	0.03	Diff <2x LOR	---
		Dichloroethane, 1,1-	75-34-3	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Dichloroethane, 1,2-	107-06-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Dichloroethylene, 1,1-	75-35-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---
		Dichloroethylene, cis-1,2-	156-59-2	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	---



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Volatile Organic Compounds (QC Lot: 1549029) - continued</b>											
VA24B7074-001	Anonymous	Dichloroethylene, trans-1,2-	156-60-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloromethane	75-09-2	E611C	1.0	µg/L	<1.0	<1.0	0	Diff <2x LOR	----
		Dichloropropane, 1,2-	78-87-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Ethylbenzene	100-41-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Styrene	100-42-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.20	µg/L	<0.20	<0.20	0	Diff <2x LOR	----
		Tetrachloroethylene	127-18-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Toluene	108-88-3	E611C	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
		Trichloroethane, 1,1,1-	71-55-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichloroethane, 1,1,2-	79-00-5	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichloroethylene	79-01-6	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Trichlorofluoromethane	75-69-4	E611C	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Vinyl chloride	75-01-4	E611C	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
		Xylene, m+p-	179601-23-1	E611C	0.40	µg/L	0.44	0.54	0.09	Diff <2x LOR	----
		Xylene, o-	95-47-6	E611C	0.30	µg/L	<0.30	<0.30	0	Diff <2x LOR	----
<b>Hydrocarbons (QC Lot: 1549030)</b>											
VA24B7231-001	WLNG EOP	VHw (C6-C10)	----	E581.VH+F1	100	µg/L	<100	<100	0.0%	30%	----
<b>Glycols (QC Lot: 1554903)</b>											
VA24B7231-001	WLNG EOP	Diethylene glycol	111-46-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Ethylene glycol	107-21-1	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Propylene glycol, 1,2-	57-55-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----
		Triethylene glycol	112-27-6	E680E	5.0	mg/L	<5.0	<5.0	0	Diff <2x LOR	----





## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1549104)</b>						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
<b>Physical Tests (QCLot: 1558750)</b>						
Solids, total suspended [TSS]	----	E160	3	mg/L	<3.0	----
<b>Physical Tests (QCLot: 1558760)</b>						
Solids, total dissolved [TDS]	----	E162	10	mg/L	<10	----
<b>Anions and Nutrients (QCLot: 1549107)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
<b>Anions and Nutrients (QCLot: 1549108)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
<b>Anions and Nutrients (QCLot: 1549109)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
<b>Anions and Nutrients (QCLot: 1549110)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
<b>Anions and Nutrients (QCLot: 1549111)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
<b>Anions and Nutrients (QCLot: 1549112)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----
<b>Anions and Nutrients (QCLot: 1560536)</b>						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	----
<b>Anions and Nutrients (QCLot: 1560539)</b>						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	----
<b>Anions and Nutrients (QCLot: 1560540)</b>						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>						
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	<0.50	----
<b>Total Sulfides (QCLot: 1559690)</b>						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	----
<b>Total Metals (QCLot: 1550676)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	----
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1550676) - continued</b>						
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	----
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	----
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	----
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	----
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	----
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	----
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	----
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	----
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	----
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1560070)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1550798)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Dissolved Metals (QCLot: 1550798) - continued</b>						
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1559792)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
<b>Speciated Metals (QCLot: 1554917)</b>						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----
<b>Aggregate Organics (QCLot: 1554060)</b>						
Phenols, total (4AAP)	----	E562	0.001	mg/L	<0.0010	----
<b>Volatile Organic Compounds (QCLot: 1549029)</b>						
Benzene	71-43-2	E611C	0.5	µg/L	<0.50	----
Bromodichloromethane	75-27-4	E611C	0.5	µg/L	<0.50	----
Bromoform	75-25-2	E611C	0.5	µg/L	<0.50	----
Carbon tetrachloride	56-23-5	E611C	0.5	µg/L	<0.50	----
Chlorobenzene	108-90-7	E611C	0.5	µg/L	<0.50	----
Chloroethane	75-00-3	E611C	0.5	µg/L	<0.50	----
Chloroform	67-66-3	E611C	0.5	µg/L	<0.50	----
Chloromethane	74-87-3	E611C	5	µg/L	<5.0	----
Dibromochloromethane	124-48-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,2-	95-50-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,3-	541-73-1	E611C	0.5	µg/L	<0.50	----
Dichlorobenzene, 1,4-	106-46-7	E611C	0.5	µg/L	<0.50	----
Dichloroethane, 1,1-	75-34-3	E611C	0.5	µg/L	<0.50	----
Dichloroethane, 1,2-	107-06-2	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, 1,1-	75-35-4	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, cis-1,2-	156-59-2	E611C	0.5	µg/L	<0.50	----
Dichloroethylene, trans-1,2-	156-60-5	E611C	0.5	µg/L	<0.50	----
Dichloromethane	75-09-2	E611C	1	µg/L	<1.0	----
Dichloropropane, 1,2-	78-87-5	E611C	0.5	µg/L	<0.50	----
Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.5	µg/L	<0.50	----
Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.5	µg/L	<0.50	----
Ethylbenzene	100-41-4	E611C	0.5	µg/L	<0.50	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Volatile Organic Compounds (QCLot: 1549029) - continued</b>						
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.5	µg/L	<0.50	----
Styrene	100-42-5	E611C	0.5	µg/L	<0.50	----
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.5	µg/L	<0.50	----
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.2	µg/L	<0.20	----
Tetrachloroethylene	127-18-4	E611C	0.5	µg/L	<0.50	----
Toluene	108-88-3	E611C	0.4	µg/L	<0.40	----
Trichloroethane, 1,1,1-	71-55-6	E611C	0.5	µg/L	<0.50	----
Trichloroethane, 1,1,2-	79-00-5	E611C	0.5	µg/L	<0.50	----
Trichloroethylene	79-01-6	E611C	0.5	µg/L	<0.50	----
Trichlorofluoromethane	75-69-4	E611C	0.5	µg/L	<0.50	----
Vinyl chloride	75-01-4	E611C	0.4	µg/L	<0.40	----
Xylene, m+p-	179601-23-1	E611C	0.4	µg/L	<0.40	----
Xylene, o-	95-47-6	E611C	0.3	µg/L	<0.30	----
<b>Hydrocarbons (QCLot: 1549030)</b>						
VHw (C6-C10)	---	E581.VH+F1	100	µg/L	<100	----
<b>Hydrocarbons (QCLot: 1559686)</b>						
EPH (C10-C19)	---	E601A	250	µg/L	<250	----
EPH (C19-C32)	---	E601A	250	µg/L	<250	----
<b>Polycyclic Aromatic Hydrocarbons (QCLot: 1559687)</b>						
Acenaphthene	83-32-9	E641A	0.01	µg/L	<0.010	----
Acenaphthylene	208-96-8	E641A	0.01	µg/L	<0.010	----
Acridine	260-94-6	E641A	0.01	µg/L	<0.010	----
Anthracene	120-12-7	E641A	0.01	µg/L	<0.010	----
Benz(a)anthracene	56-55-3	E641A	0.01	µg/L	<0.010	----
Benzo(a)pyrene	50-32-8	E641A	0.005	µg/L	<0.0050	----
Benzo(b+j)fluoranthene	n/a	E641A	0.01	µg/L	<0.010	----
Benzo(g,h,i)perylene	191-24-2	E641A	0.01	µg/L	<0.010	----
Benzo(k)fluoranthene	207-08-9	E641A	0.01	µg/L	<0.010	----
Chrysene	218-01-9	E641A	0.01	µg/L	<0.010	----
Dibenz(a,h)anthracene	53-70-3	E641A	0.005	µg/L	<0.0050	----
Fluoranthene	206-44-0	E641A	0.01	µg/L	<0.010	----
Fluorene	86-73-7	E641A	0.01	µg/L	<0.010	----
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A	0.01	µg/L	<0.010	----
Methylnaphthalene, 1-	90-12-0	E641A	0.01	µg/L	<0.010	----
Methylnaphthalene, 2-	91-57-6	E641A	0.01	µg/L	<0.010	----



Sub-Matrix: **Water**

<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Result</i>	<i>Qualifier</i>
<b>Polycyclic Aromatic Hydrocarbons (QCLot: 1559687) - continued</b>						
Naphthalene	91-20-3	E641A	0.05	µg/L	<0.050	----
Phenanthrene	85-01-8	E641A	0.02	µg/L	<0.020	----
Pyrene	129-00-0	E641A	0.01	µg/L	<0.010	----
Quinoline	91-22-5	E641A	0.05	µg/L	<0.050	----
<b>Glycols (QCLot: 1554903)</b>						
Diethylene glycol	111-46-6	E680E	5	mg/L	<5.0	----
Ethylene glycol	107-21-1	E680E	5	mg/L	<5.0	----
Propylene glycol, 1,2-	57-55-6	E680E	5	mg/L	<5.0	----
Triethylene glycol	112-27-6	E680E	5	mg/L	<5.0	----



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1549104)</b>									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	93.3	85.0	115	----
<b>Physical Tests (QCLot: 1558750)</b>									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	97.1	85.0	115	----
<b>Physical Tests (QCLot: 1558760)</b>									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	102	85.0	115	----
<b>Anions and Nutrients (QCLot: 1549107)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	101	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549108)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	99.2	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549109)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	91.8	85.0	115	----
<b>Anions and Nutrients (QCLot: 1549110)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	98.7	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549111)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	99.8	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549112)</b>									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	100	90.0	110	----
<b>Anions and Nutrients (QCLot: 1560536)</b>									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	103	85.0	115	----
<b>Anions and Nutrients (QCLot: 1560539)</b>									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	101	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560540)</b>									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	----		80.0	120	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>									
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	8.57 mg/L	99.1	80.0	120	----
<b>Total Sulfides (QCLot: 1559690)</b>									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	106	80.0	120	----
<b>Total Metals (QCLot: 1550676)</b>									



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550676) - continued</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	105	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	110	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	106	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	102	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	104	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	103	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	103	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	104	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	105	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	107	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	104	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	107	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	104	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	113	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	104	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	102	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	106	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	106	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	108	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	111	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	105	80.0	120	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	106	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	110	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	100	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	108	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	108	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	105	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	102	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	102	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	105	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	105	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	101	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	102	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	106	80.0	120	----





Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550676) - continued</b>									
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	104	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	108	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	106	80.0	120	----
<b>Total Metals (QCLot: 1560070)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	98.4	80.0	120	----
<b>Dissolved Metals (QCLot: 1550798)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	99.4	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	99.6	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	104	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	103	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	96.0	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	97.9	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	103	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	99.8	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	101	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	97.8	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	99.9	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	97.7	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	99.4	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	102	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	98.4	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	102	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	98.9	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	98.5	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	103	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	97.3	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	100	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	106	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	101	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	99.7	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	105	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	91.8	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	101	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	97.5	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	88.7	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1550798) - continued</b>									
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	101	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	98.5	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	94.1	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	96.3	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	98.6	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	95.4	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	98.8	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	101	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	95.5	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	96.8	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	97.6	80.0	120	----
<b>Speciated Metals (QCLot: 1554917)</b>									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.025 mg/L	101	80.0	120	----
<b>Aggregate Organics (QCLot: 1554060)</b>									
Phenols, total (4AAP)	----	E562	0.001	mg/L	0.02 mg/L	100	85.0	115	----
<b>Volatile Organic Compounds (QCLot: 1549029)</b>									
Benzene	71-43-2	E611C	0.5	µg/L	100 µg/L	85.6	70.0	130	----
Bromodichloromethane	75-27-4	E611C	0.5	µg/L	100 µg/L	89.1	70.0	130	----
Bromoform	75-25-2	E611C	0.5	µg/L	100 µg/L	95.4	70.0	130	----
Carbon tetrachloride	56-23-5	E611C	0.5	µg/L	100 µg/L	88.0	70.0	130	----
Chlorobenzene	108-90-7	E611C	0.5	µg/L	100 µg/L	88.3	70.0	130	----
Chloroethane	75-00-3	E611C	0.5	µg/L	100 µg/L	94.8	60.0	140	----
Chloroform	67-66-3	E611C	0.5	µg/L	100 µg/L	88.2	70.0	130	----
Chloromethane	74-87-3	E611C	5	µg/L	100 µg/L	86.2	60.0	140	----
Dibromochloromethane	124-48-1	E611C	0.5	µg/L	100 µg/L	91.9	70.0	130	----
Dichlorobenzene, 1,2-	95-50-1	E611C	0.5	µg/L	100 µg/L	89.0	70.0	130	----
Dichlorobenzene, 1,3-	541-73-1	E611C	0.5	µg/L	100 µg/L	92.7	70.0	130	----
Dichlorobenzene, 1,4-	106-46-7	E611C	0.5	µg/L	100 µg/L	93.8	70.0	130	----
Dichloroethane, 1,1-	75-34-3	E611C	0.5	µg/L	100 µg/L	88.8	70.0	130	----
Dichloroethane, 1,2-	107-06-2	E611C	0.5	µg/L	100 µg/L	86.8	70.0	130	----
Dichloroethylene, 1,1-	75-35-4	E611C	0.5	µg/L	100 µg/L	82.4	70.0	130	----
Dichloroethylene, cis-1,2-	156-59-2	E611C	0.5	µg/L	100 µg/L	83.0	70.0	130	----
Dichloroethylene, trans-1,2-	156-60-5	E611C	0.5	µg/L	100 µg/L	86.5	70.0	130	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Volatile Organic Compounds (QCLot: 1549029) - continued</b>									
Dichloromethane	75-09-2	E611C	1	µg/L	100 µg/L	90.3	70.0	130	----
Dichloropropane, 1,2-	78-87-5	E611C	0.5	µg/L	100 µg/L	89.3	70.0	130	----
Dichloropropylene, cis-1,3-	10061-01-5	E611C	0.5	µg/L	100 µg/L	90.4	70.0	130	----
Dichloropropylene, trans-1,3-	10061-02-6	E611C	0.5	µg/L	100 µg/L	94.9	70.0	130	----
Ethylbenzene	100-41-4	E611C	0.5	µg/L	100 µg/L	78.3	70.0	130	----
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	0.5	µg/L	100 µg/L	95.7	70.0	130	----
Styrene	100-42-5	E611C	0.5	µg/L	100 µg/L	86.4	70.0	130	----
Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	0.5	µg/L	100 µg/L	88.3	70.0	130	----
Tetrachloroethane, 1,1,2,2-	79-34-5	E611C	0.2	µg/L	100 µg/L	85.7	70.0	130	----
Tetrachloroethylene	127-18-4	E611C	0.5	µg/L	100 µg/L	82.9	70.0	130	----
Toluene	108-88-3	E611C	0.4	µg/L	100 µg/L	84.3	70.0	130	----
Trichloroethane, 1,1,1-	71-55-6	E611C	0.5	µg/L	100 µg/L	89.9	70.0	130	----
Trichloroethane, 1,1,2-	79-00-5	E611C	0.5	µg/L	100 µg/L	86.9	70.0	130	----
Trichloroethylene	79-01-6	E611C	0.5	µg/L	100 µg/L	85.0	70.0	130	----
Trichlorofluoromethane	75-69-4	E611C	0.5	µg/L	100 µg/L	95.9	60.0	140	----
Vinyl chloride	75-01-4	E611C	0.4	µg/L	100 µg/L	89.1	60.0	140	----
Xylene, m+p-	179601-23-1	E611C	0.4	µg/L	200 µg/L	92.9	70.0	130	----
Xylene, o-	95-47-6	E611C	0.3	µg/L	100 µg/L	88.1	70.0	130	----
<b>Hydrocarbons (QCLot: 1549030)</b>									
VHw (C6-C10)	---	E581.VH+F1	100	µg/L	6310 µg/L	78.6	70.0	130	----
<b>Hydrocarbons (QCLot: 1559686)</b>									
EPH (C10-C19)	---	E601A	250	µg/L	6490 µg/L	107	70.0	130	----
EPH (C19-C32)	---	E601A	250	µg/L	3360 µg/L	109	70.0	130	----
<b>Polycyclic Aromatic Hydrocarbons (QCLot: 1559687)</b>									
Acenaphthene	83-32-9	E641A	0.01	µg/L	0.5 µg/L	98.2	60.0	130	----
Acenaphthylene	208-96-8	E641A	0.01	µg/L	0.5 µg/L	109	60.0	130	----
Acridine	260-94-6	E641A	0.01	µg/L	0.5 µg/L	112	60.0	130	----
Anthracene	120-12-7	E641A	0.01	µg/L	0.5 µg/L	113	60.0	130	----
Benz(a)anthracene	56-55-3	E641A	0.01	µg/L	0.5 µg/L	108	60.0	130	----
Benzo(a)pyrene	50-32-8	E641A	0.005	µg/L	0.5 µg/L	108	60.0	130	----
Benzo(b+j)fluoranthene	n/a	E641A	0.01	µg/L	0.5 µg/L	102	60.0	130	----
Benzo(g,h,i)perylene	191-24-2	E641A	0.01	µg/L	0.5 µg/L	118	60.0	130	----
Benzo(k)fluoranthene	207-08-9	E641A	0.01	µg/L	0.5 µg/L	100	60.0	130	----
Chrysene	218-01-9	E641A	0.01	µg/L	0.5 µg/L	112	60.0	130	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Polycyclic Aromatic Hydrocarbons (QCLot: 1559687) - continued</b>									
Dibenz(a,h)anthracene	53-70-3	E641A	0.005	µg/L	0.5 µg/L	111	60.0	130	----
Fluoranthene	206-44-0	E641A	0.01	µg/L	0.5 µg/L	111	60.0	130	----
Fluorene	86-73-7	E641A	0.01	µg/L	0.5 µg/L	102	60.0	130	----
Indeno(1,2,3-c,d)pyrene	193-39-5	E641A	0.01	µg/L	0.5 µg/L	118	60.0	130	----
Methylnaphthalene, 1-	90-12-0	E641A	0.01	µg/L	0.5 µg/L	88.3	60.0	130	----
Methylnaphthalene, 2-	91-57-6	E641A	0.01	µg/L	0.5 µg/L	92.7	60.0	130	----
Naphthalene	91-20-3	E641A	0.05	µg/L	0.5 µg/L	92.6	50.0	130	----
Phenanthrene	85-01-8	E641A	0.02	µg/L	0.5 µg/L	110	60.0	130	----
Pyrene	129-00-0	E641A	0.01	µg/L	0.5 µg/L	110	60.0	130	----
Quinoline	91-22-5	E641A	0.05	µg/L	0.5 µg/L	118	60.0	130	----
<b>Glycols (QCLot: 1554903)</b>									
Diethylene glycol	111-46-6	E680E	5	mg/L	25 mg/L	102	70.0	130	----
Ethylene glycol	107-21-1	E680E	5	mg/L	25 mg/L	102	70.0	130	----
Propylene glycol, 1,2-	57-55-6	E680E	5	mg/L	25 mg/L	100	70.0	130	----
Triethylene glycol	112-27-6	E680E	5	mg/L	25 mg/L	102	70.0	130	----



### Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1549107)</b>										
FJ2402027-002	Anonymous	Fluoride	16984-48-8	E235.F	0.901 mg/L	1 mg/L	90.1	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549108)</b>										
FJ2402027-002	Anonymous	Chloride	16887-00-6	E235.Cl	94.4 mg/L	100 mg/L	94.4	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549109)</b>										
FJ2402027-002	Anonymous	Bromide	24959-67-9	E235.Br-L	0.482 mg/L	0.5 mg/L	96.5	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549110)</b>										
FJ2402027-002	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	2.35 mg/L	2.5 mg/L	93.9	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549111)</b>										
FJ2402027-002	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.465 mg/L	0.5 mg/L	93.0	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549112)</b>										
FJ2402027-002	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	89.7 mg/L	100 mg/L	89.7	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560536)</b>										
FJ2402036-002	Anonymous	Ammonia, total (as N)	7664-41-7	E298	ND mg/L	----	ND	75.0	125	----
<b>Anions and Nutrients (QCLot: 1560539)</b>										
FJ2402036-002	Anonymous	Nitrogen, total	7727-37-9	E366	3.82 mg/L	4 mg/L	95.6	70.0	130	----
<b>Anions and Nutrients (QCLot: 1560540)</b>										
FJ2402036-002	Anonymous	Phosphorus, total	7723-14-0	E372-U	ND mg/L	----	ND	70.0	130	----
<b>Organic / Inorganic Carbon (QCLot: 1560541)</b>										
VA24B7085-002	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	5.24 mg/L	5 mg/L	105	70.0	130	----
<b>Total Sulfides (QCLot: 1559690)</b>										
CG2410035-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.232 mg/L	0.2 mg/L	116	75.0	125	----
<b>Total Metals (QCLot: 1550676)</b>										
VA24B7327-001	Anonymous	Aluminum, total	7429-90-5	E420	0.197 mg/L	0.2 mg/L	98.3	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Barium, total	7440-39-3	E420	0.0184 mg/L	0.02 mg/L	92.2	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0397 mg/L	0.04 mg/L	99.3	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00918 mg/L	0.01 mg/L	91.8	70.0	130	----
		Boron, total	7440-42-8	E420	0.101 mg/L	0.1 mg/L	101	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00390 mg/L	0.004 mg/L	97.5	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.0100 mg/L	0.01 mg/L	100	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0395 mg/L	0.04 mg/L	98.8	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550676) - continued</b>										
VA24B7327-001	Anonymous	Cobalt, total	7440-48-4	E420	0.0195 mg/L	0.02 mg/L	97.5	70.0	130	----
		Copper, total	7440-50-8	E420	0.0188 mg/L	0.02 mg/L	94.0	70.0	130	----
		Iron, total	7439-89-6	E420	1.89 mg/L	2 mg/L	94.6	70.0	130	----
		Lead, total	7439-92-1	E420	0.0185 mg/L	0.02 mg/L	92.3	70.0	130	----
		Lithium, total	7439-93-2	E420	0.1000 mg/L	0.1 mg/L	100.0	70.0	130	----
		Magnesium, total	7439-95-4	E420	ND mg/L	----	ND	70.0	130	----
		Manganese, total	7439-96-5	E420	0.0191 mg/L	0.02 mg/L	95.3	70.0	130	----
		Molybdenum, total	7439-98-7	E420	0.0198 mg/L	0.02 mg/L	99.1	70.0	130	----
		Nickel, total	7440-02-0	E420	0.0391 mg/L	0.04 mg/L	97.7	70.0	130	----
		Phosphorus, total	7723-14-0	E420	10.1 mg/L	10 mg/L	101	70.0	130	----
		Potassium, total	7440-09-7	E420	3.98 mg/L	4 mg/L	99.5	70.0	130	----
		Rubidium, total	7440-17-7	E420	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	----
		Selenium, total	7782-49-2	E420	0.0404 mg/L	0.04 mg/L	101	70.0	130	----
		Silicon, total	7440-21-3	E420	ND mg/L	----	ND	70.0	130	----
		Silver, total	7440-22-4	E420	0.00394 mg/L	0.004 mg/L	98.5	70.0	130	----
		Sodium, total	7440-23-5	E420	ND mg/L	----	ND	70.0	130	----
		Strontium, total	7440-24-6	E420	ND mg/L	----	ND	70.0	130	----
		Sulfur, total	7704-34-9	E420	20.3 mg/L	20 mg/L	102	70.0	130	----
		Tellurium, total	13494-80-9	E420	0.0389 mg/L	0.04 mg/L	97.2	70.0	130	----
		Thallium, total	7440-28-0	E420	0.00362 mg/L	0.004 mg/L	90.4	70.0	130	----
		Thorium, total	7440-29-1	E420	0.0194 mg/L	0.02 mg/L	97.1	70.0	130	----
		Tin, total	7440-31-5	E420	0.0196 mg/L	0.02 mg/L	98.3	70.0	130	----
		Titanium, total	7440-32-6	E420	0.0394 mg/L	0.04 mg/L	98.5	70.0	130	----
		Tungsten, total	7440-33-7	E420	0.0183 mg/L	0.02 mg/L	91.6	70.0	130	----
		Uranium, total	7440-61-1	E420	0.00370 mg/L	0.004 mg/L	92.6	70.0	130	----
		Vanadium, total	7440-62-2	E420	0.0991 mg/L	0.1 mg/L	99.1	70.0	130	----
		Zinc, total	7440-66-6	E420	0.390 mg/L	0.4 mg/L	97.5	70.0	130	----
		Zirconium, total	7440-67-7	E420	0.0398 mg/L	0.04 mg/L	99.4	70.0	130	----
<b>Total Metals (QCLot: 1560070)</b>										
VA24B7077-002	Anonymous	Mercury, total	7439-97-6	E508	0.0000955 mg/L	0 mg/L	95.5	70.0	130	----
<b>Dissolved Metals (QCLot: 1550798)</b>										
VA24B7134-002	Anonymous	Lead, dissolved	7439-92-1	E421	0.0198 mg/L	0.02 mg/L	99.1	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.384 mg/L	0.4 mg/L	96.1	70.0	130	----
VA24B7134-002	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.192 mg/L	0.2 mg/L	95.8	70.0	130	----
		Antimony, dissolved	7440-36-0	E421	0.0187 mg/L	0.02 mg/L	93.7	70.0	130	----
		Arsenic, dissolved	7440-38-2	E421	0.0200 mg/L	0.02 mg/L	100	70.0	130	----
		Barium, dissolved	7440-39-3	E421	0.0202 mg/L	0.02 mg/L	101	70.0	130	----
		Beryllium, dissolved	7440-41-7	E421	0.0375 mg/L	0.04 mg/L	93.7	70.0	130	----
		Bismuth, dissolved	7440-69-9	E421	0.00893 mg/L	0.01 mg/L	89.3	70.0	130	----
		Boron, dissolved	7440-42-8	E421	0.101 mg/L	0.1 mg/L	101	70.0	130	----
		Cadmium, dissolved	7440-43-9	E421	0.00392 mg/L	0.004 mg/L	97.9	70.0	130	----
		Calcium, dissolved	7440-70-2	E421	3.85 mg/L	4 mg/L	96.3	70.0	130	----
		Cesium, dissolved	7440-46-2	E421	0.00959 mg/L	0.01 mg/L	95.9	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1550798) - continued</b>										
VA24B7134-002	Anonymous	Chromium, dissolved	7440-47-3	E421	0.0389 mg/L	0.04 mg/L	97.2	70.0	130	----
		Cobalt, dissolved	7440-48-4	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Copper, dissolved	7440-50-8	E421	0.0194 mg/L	0.02 mg/L	97.3	70.0	130	----
		Iron, dissolved	7439-89-6	E421	1.91 mg/L	2 mg/L	95.6	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0965 mg/L	0.1 mg/L	96.5	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	0.961 mg/L	1 mg/L	96.1	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0199 mg/L	0.02 mg/L	99.5	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0383 mg/L	0.04 mg/L	95.8	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	9.70 mg/L	10 mg/L	97.0	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	4.02 mg/L	4 mg/L	100	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0198 mg/L	0.02 mg/L	99.2	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0390 mg/L	0.04 mg/L	97.6	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	9.76 mg/L	10 mg/L	97.6	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00391 mg/L	0.004 mg/L	97.7	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	1.94 mg/L	2 mg/L	97.3	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	0.0188 mg/L	0.02 mg/L	94.1	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	19.5 mg/L	20 mg/L	97.4	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0405 mg/L	0.04 mg/L	101	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00362 mg/L	0.004 mg/L	90.4	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0193 mg/L	0.02 mg/L	96.4	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0187 mg/L	0.02 mg/L	93.6	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0392 mg/L	0.04 mg/L	98.0	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0183 mg/L	0.02 mg/L	91.3	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00374 mg/L	0.004 mg/L	93.5	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0982 mg/L	0.1 mg/L	98.2	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0396 mg/L	0.04 mg/L	99.1	70.0	130	----
<b>Dissolved Metals (QCLot: 1559792)</b>										
FJ2402033-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.000106 mg/L	0 mg/L	106	70.0	130	----
<b>Speciated Metals (QCLot: 1554917)</b>										
HA2401704-001	Anonymous	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0389 mg/L	0.04 mg/L	97.3	70.0	130	----
<b>Aggregate Organics (QCLot: 1554060)</b>										
CG2410011-002	Anonymous	Phenols, total (4AAP)	----	E562	0.0215 mg/L	0.02 mg/L	108	75.0	125	----
<b>Volatile Organic Compounds (QCLot: 1549029)</b>										
VA24B7074-001	Anonymous	Benzene	71-43-2	E611C	99.4 µg/L	100 µg/L	99.4	60.0	140	----
		Bromodichloromethane	75-27-4	E611C	98.7 µg/L	100 µg/L	98.7	60.0	140	----
		Bromoform	75-25-2	E611C	100 µg/L	100 µg/L	100	60.0	140	----
		Carbon tetrachloride	56-23-5	E611C	105 µg/L	100 µg/L	105	60.0	140	----
		Chlorobenzene	108-90-7	E611C	104 µg/L	100 µg/L	104	60.0	140	----
		Chloroethane	75-00-3	E611C	107 µg/L	100 µg/L	107	50.0	150	----
		Chloroform	67-66-3	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Chloromethane	74-87-3	E611C	92.7 µg/L	100 µg/L	92.7	50.0	150	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		Qualifier
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	
<b>Volatile Organic Compounds (QCLot: 1549029) - continued</b>										
VA24B7074-001	Anonymous	Dibromochloromethane	124-48-1	E611C	100 µg/L	100 µg/L	100	60.0	140	----
		Dichlorobenzene, 1,2-	95-50-1	E611C	104 µg/L	100 µg/L	104	60.0	140	----
		Dichlorobenzene, 1,3-	541-73-1	E611C	116 µg/L	100 µg/L	116	60.0	140	----
		Dichlorobenzene, 1,4-	106-46-7	E611C	116 µg/L	100 µg/L	116	60.0	140	----
		Dichloroethane, 1,1-	75-34-3	E611C	101 µg/L	100 µg/L	101	60.0	140	----
		Dichloroethane, 1,2-	107-06-2	E611C	95.9 µg/L	100 µg/L	95.9	60.0	140	----
		Dichloroethylene, 1,1-	75-35-4	E611C	94.8 µg/L	100 µg/L	94.8	60.0	140	----
		Dichloroethylene, cis-1,2-	156-59-2	E611C	97.3 µg/L	100 µg/L	97.3	60.0	140	----
		Dichloroethylene, trans-1,2-	156-60-5	E611C	99.7 µg/L	100 µg/L	99.7	60.0	140	----
		Dichloromethane	75-09-2	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Dichloropropane, 1,2-	78-87-5	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Dichloropropylene, cis-1,3-	10061-01-5	E611C	100 µg/L	100 µg/L	100	60.0	140	----
		Dichloropropylene, trans-1,3-	10061-02-6	E611C	106 µg/L	100 µg/L	106	60.0	140	----
		Ethylbenzene	100-41-4	E611C	97.1 µg/L	100 µg/L	97.1	60.0	140	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611C	109 µg/L	100 µg/L	109	60.0	140	----
		Styrene	100-42-5	E611C	97.5 µg/L	100 µg/L	97.5	60.0	140	----
		Tetrachloroethane, 1,1,1,2-	630-20-6	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Tetrachloroethane, 1,1,1,2,2-	79-34-5	E611C	92.9 µg/L	100 µg/L	92.9	60.0	140	----
		Tetrachloroethylene	127-18-4	E611C	107 µg/L	100 µg/L	107	60.0	140	----
		Toluene	108-88-3	E611C	104 µg/L	100 µg/L	104	60.0	140	----
		Trichloroethane, 1,1,1-	71-55-6	E611C	107 µg/L	100 µg/L	107	60.0	140	----
		Trichloroethane, 1,1,2-	79-00-5	E611C	96.4 µg/L	100 µg/L	96.4	60.0	140	----
		Trichloroethylene	79-01-6	E611C	102 µg/L	100 µg/L	102	60.0	140	----
		Trichlorofluoromethane	75-69-4	E611C	108 µg/L	100 µg/L	108	50.0	150	----
		Vinyl chloride	75-01-4	E611C	98.4 µg/L	100 µg/L	98.4	50.0	150	----
		Xylene, m+p-	179601-23-1	E611C	236 µg/L	200 µg/L	118	60.0	140	----
		Xylene, o-	95-47-6	E611C	106 µg/L	100 µg/L	106	60.0	140	----



Affix ALS barcode label here (lab use only)

Canada Toll Free: 1 800 668 9878



www.alsglobal.com

Report To: Triton Environmental  
 Company: Triton Environmental  
 Contact: [Redacted]  
 Phone: [Redacted]  
 Street: [Redacted]  
 City/Province: [Redacted]  
 Postal Code: [Redacted]

Select Service Level Below - Contact your AM to confirm all E&P TATs (surcharges may apply)  
 Regular [R] Standard TAT if received by 3 pm - business days - no surcharges apply  
 4 day [P4-20%]  
 3 day [P3-25%]  
 2 day [P2-50%]  
 1 Business Day [E-100%]  
 Same Day, Weekend or Statutory holiday [E2-200% (Laboratory opening fees may apply)]

Date and Time Required for all E&P TATs: [Redacted]

For tests that can not be performed according to the service level selected, you will be contacted.

Report Format / Distribution: Select Report Format:  PDF  EXCEL  EDD (DIGITAL)  
 Quality Control (QC) Report with Report  YES  NO  
 Compare Results to Criteria on Report - provide details below if box checked  
 Select Distribution:  EMAIL  MAIL  FAX

Invoice Distribution:  FAX

ALS Account # / Quote #: VA23-TRIT100-012  
 Job #: 11964  
 PO / AFE: 11964 - Task 30 - Phase 3C-4C  
 LSD: [Redacted]

ALS Lab Work Order # (lab use only): [Redacted]

Sample Identification and/or Coordinates (This description will appear on the report):  
 BCR EOF  
 pH: 7.34 cond: 158 µs/cm temp: 19.1 °C  
 W/LNG EOF  
 Duplicate  
 Field Blank  
 Trip Blank

ALS Contact: [Redacted]  
 Date: 16-Jul-24  
 Time: 10:26  
 Sample Type: Water

Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below

F	P	P	P	P	P	SAMPLER			F/P								
						Total metals + mercury	Dissolved metals + mercury	Total hexavalent chromium									

SAMPLES ON HOLD  
 Sample is hazardous (please provide further details)

General parameters (alkalinity)  
 DOC  
 EPH, PAH, LEPP/HEPH  
 VOC/MPH  
 Nutrients (ammonia, ammonium, total nitrogen, total phosphorus, phenols)  
 Total sulfide (low) (as H2S)  
 Unionized Sulfide (low)  
 TSS, TDS, T-Alkalinity, Anions scan (Br, Cl, F)  
 Total trivalent chromium  
 Total hexavalent chromium

Environmental Division  
 Vancouver  
 Work Order Reference  
**VA24B7231**

Telephone: +1 604 263 4168

Special Instructions / Specify Criteria to add (elect):

Drinking Water (DW) Samples (client use)  
 Are samples taken from a Regulated DW System?  
 YES  NO  
 Are samples for human consumption / use?  
 YES  NO


SHIPMENT RELEASE (client use)  
 Received by: [Redacted]  
 Date: 16 July 24  
 Time: 17:17

SHIPMENT RECESSION (lab use only)  
 Received by: [Redacted]  
 Date: 16 July  
 Time: 2:30 PM

Sample Condition AS RECEIVED (lab use only)  
 Frozen  SIF Observations Yes  No   
 Ice Packs  Ice Cubes  Custody seal intact Yes  No   
 Cooling initiated   
 INITIAL COOLER TEMPERATURES °C [Redacted]  
 FINAL COOLER TEMPERATURES °C 10

1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.

WHITE - LABORATORY COPY YELLOW - CLIENT COPY

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix C	C-4

## Woodfibre Site WTP Discharge Field Notes and Logs



# FortisBC Eagle Mountain-Woodfibre Gas Pipeline

## Water Discharge Authorization Water Quality Monitoring

2024-7-16-Chycoski-9B3A0

<b>Project Component:</b>	Tunnel	<b>Site Name:</b>	WLNG Treatment Discharge
<b>Inspection Date:</b>	07/16/2024	<b>Location:</b>	WLNG
<b>Triton QP:</b>	Lily Chycoski	<b>Latitude/Longitude:</b>	49.669351 -123.248439
<b>Temperature(c):</b>	Low 18 High 31	<b>Permit:</b>	PE 110136
<b>Weather Conditions:</b>	Clear	<b>Ground Conditions:</b>	Dry

### Observations

**Time:** 10:26:00      **Flow Volume (visual):** low

**Notes:** Conductivity: 158 micro Siemens per cm

**Odour Detected?:** No      **Notes:**

**Unusual Colour?:** No      **Notes:**

**Unusual Observations?:** No      **Notes:**

**Sheen on Water?:** No      **Notes:**

### Samples Collected - Parameters

<b>Total Metals + Mercury</b>	Yes	<b>General Parameters (Alkalinity)</b>	Yes	<b>Other Sample:</b> Total hexavalent chromium and total trivalent chromium
<b>Dissolved Metals + Mercury</b>	Yes	<b>Total Sulfide, Unionized Sulfide</b>	Yes	
<b>TSS</b>	Yes	<b>Anions</b>	Yes	<b>QA Samples:</b> No Total hexavalent chromium and total trivalent chromium
<b>TDS</b>	Yes	<b>VOC/VPH</b>	No	
<b>Nutrients</b>	Yes	<b>EPH, PAH, LEPH/HEPH</b>	No	
<b>DOC</b>	Yes	<b>Trout LC50</b>	No	

### Logger Maintenance

<b>Logger Maintenance Performed?</b>	No	<b>Photo of COC with Lab Signature?</b>	Yes
<b>Describe Logger Maintenance</b>			

Photos



**Photo:** 1  
**Location:** WLNG EOP  
**Description:** US view




**Photo:** 2  
**Location:** WLNG EOP  
**Description:** Across view

Photos



**Photo:** 3  
**Location:** WLNG EOP  
**Description:** DS view

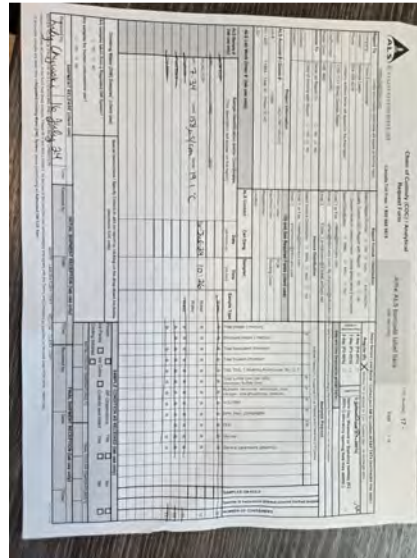

**Photo:** 4  
**Location:** WLNG EOP  
**Description:** Lab COC



2024-7-16-Chycoski-9B3A0

**Sign Off**

**Report Prepared By:** Lily Chycoski

**Report Reviewed:**

**Report Reviewer:**

**Professional(s) of Record:**

**Name:**

**Designation:**

**Designation Number:**

7/15/2024: 12.796 M3

Date	Time	Discharge pH	Discharge Flow Rate (USGPM)	Discharge NTU	Flow Total (G)	Discharge Valve Status	Discharge Temperature (°C)	Discharge Conductivity (µS/cm)
7/15/2024	0:00:00	7.2	126	0	293,210	Closed	24.2	267
7/15/2024	0:15:00	7.2	187	0	293,210	Closed	24.2	267
7/15/2024	0:30:00	7.2	224	0	293,210	Closed	24.1	267
7/15/2024	0:45:00	7.2	198	0	293,210	Closed	24.1	271
7/15/2024	1:00:00	7.2	222	0	293,210	Closed	24.1	273
7/15/2024	1:15:00	7.2	217	0	293,210	Closed	24	272
7/15/2024	1:30:00	7.2	214	0	293,210	Closed	24	272
7/15/2024	1:45:00	7.2	215	0	293,210	Closed	23.9	272
7/15/2024	2:00:00	7.2	171	0	293,210	Closed	23.9	272
7/15/2024	2:15:00	7.2	206	0	293,210	Closed	23.8	272
7/15/2024	2:30:00	7.2	172	0	293,210	Closed	23.8	272
7/15/2024	2:45:00	7.2	202	0	293,210	Closed	23.7	273
7/15/2024	3:00:00	7.2	199	0	293,210	Closed	23.7	273
7/15/2024	3:15:00	7.2	192	0	293,210	Closed	23.7	273
7/15/2024	3:30:00	7.2	188	0	293,210	Closed	23.6	273
7/15/2024	3:45:00	7.2	179	0	293,210	Closed	23.6	274
7/15/2024	4:00:00	7.2	175	0	293,210	Closed	23.5	274
7/15/2024	4:15:00	7.2	137	0	293,210	Closed	23.5	276
7/15/2024	4:30:00	7.2	128	0	293,210	Closed	23.4	276
7/15/2024	4:45:00	7.2	154	0	293,210	Closed	23.4	276

7/15/2024	5:00:00	7.2	154	0	293,210	Closed	23.3	276
7/15/2024	5:15:00	7.2	0	0	293,210	Closed	23.3	276
7/15/2024	5:30:00	7.1	0	0	293,210	Closed	23.3	276
7/15/2024	5:45:00	7.1	0	0	293,210	Closed	23.3	276
7/15/2024	6:00:00	7	0	0	293,210	Closed	23.2	276
7/15/2024	6:15:00	7	0	0	293,210	Closed	23.1	275
7/15/2024	6:30:00	7	0	0	293,210	Closed	23	277
7/15/2024	6:45:00	7	0	0	293,210	Closed	22.8	277
7/15/2024	7:00:00	7	0	0	293,210	Closed	22.7	277
7/15/2024	7:15:00	7	0	0	293,210	Closed	22.6	277
7/15/2024	7:30:00	7	0	0	293,210	Closed	22.5	279
7/15/2024	7:45:00	7.1	29	0.5	293,403	Open	23	287
7/15/2024	8:00:00	7.1	28	0	293,637	Open	23	282
7/15/2024	8:15:00	7.2	0	0	293,743	Closed	23	282
7/15/2024	8:30:00	7.1	0	0	293,743	Closed	23	282
7/15/2024	8:45:00	7.1	120	0	293,743	Closed	23.1	282
7/15/2024	9:00:00	7.2	144	0	294,117	Closed	23.1	282
7/15/2024	9:15:00	7.2	139	0	294,117	Closed	23.2	282
7/15/2024	9:30:00	7.2	133	0	294,500	Closed	23.2	281
7/15/2024	9:45:00	7.2	31	0	294,741	Open	23.3	281
7/15/2024	10:00:00	7.2	32	0	294,886	Open	23.4	281
7/15/2024	10:15:00	7.2	127	0	295,075	Closed	23.4	281
7/15/2024	10:30:00	7.2	109	0	295,370	Closed	23.5	281
7/15/2024	10:45:00	7.2	32	0	295,709	Closed	23.6	281
7/15/2024	11:00:00	7.2	32	0	295,857	Open	23.7	281



7/15/2024	11:15:00	7.2	111	0	296,020	Open	23.8	281
7/15/2024	11:30:00	7.2	124	0	297,094	Closed	23.8	283
7/15/2024	11:45:00	7.2	172	0	297,310	Closed	23.9	283
7/15/2024	12:00:00	7.1	0	0	297,310	Closed	24	281
7/15/2024	12:15:00	7.1	0	0	297,310	Closed	24.2	281
7/15/2024	12:30:00	7.1	0	0	297,310	Closed	24.3	282
7/15/2024	12:45:00	7	0	0	297,310	Closed	24.4	283
7/15/2024	13:00:00	7	0	0	297,310	Closed	24.5	283
7/15/2024	13:15:00	7	0	0	297,310	Closed	24.6	283
7/15/2024	13:30:00	7	0	0	297,310	Closed	24.7	283
7/15/2024	13:45:00	7	0	0	297,310	Closed	24.9	281
7/15/2024	14:00:00	7	0	0	297,310	Closed	25.1	283
7/15/2024	14:15:00	7	0	0	297,310	Closed	25.3	283
7/15/2024	14:30:00	7	0	0	297,310	Closed	25.4	282
7/15/2024	14:45:00	7	0	0	297,310	Closed	25.6	282
7/15/2024	15:00:00	7	0	0	297,310	Closed	25.8	282
7/15/2024	15:15:00	7	0	0	297,310	Closed	26	282
7/15/2024	15:30:00	7	0	0	297,310	Closed	26.2	282
7/15/2024	15:45:00	7	0	0	297,310	Closed	26.3	282
7/15/2024	16:00:00	7	0	0	297,310	Closed	26.5	282
7/15/2024	16:15:00	7	0	0	297,310	Closed	26.7	284
7/15/2024	16:30:00	7	0	0	297,310	Closed	26.8	284
7/15/2024	16:45:00	7	0	0	297,310	Closed	26.9	284
7/15/2024	17:00:00	7	0	0	297,310	Closed	27.1	284
7/15/2024	17:15:00	7	0	0	297,310	Closed	27.2	284

7/15/2024	17:30:00	7	0	0	297,310	Closed	27.3	284
7/15/2024	17:45:00	7	0	0	297,310	Closed	27.4	284
7/15/2024	18:00:00	7	0	0	297,310	Closed	27.4	286
7/15/2024	18:15:00	7	0	0	297,310	Closed	27.5	286
7/15/2024	18:30:00	7	0	0	297,310	Closed	27.5	286
7/15/2024	18:45:00	7	0	0	297,310	Closed	27.6	286
7/15/2024	19:00:00	7	0	0	297,310	Closed	27.6	284
7/15/2024	19:15:00	7	0	0	297,310	Closed	27.6	284
7/15/2024	19:30:00	7	0	0	297,310	Closed	27.6	284
7/15/2024	19:45:00	7	0	0	297,310	Closed	27.5	284
7/15/2024	20:00:00	7	0	0	297,310	Closed	27.5	284
<b>7/15/2024</b>	<b>20:15:00</b>	<b>7</b>	<b>227</b>	<b>0</b>	<b>297,310</b>	<b>Closed</b>	<b>27.4</b>	<b>283</b>
<b>7/15/2024</b>	<b>20:30:00</b>	<b>7</b>	<b>159</b>	<b>0</b>	<b>297,604</b>	<b>Closed</b>	<b>25.1</b>	<b>313</b>
<b>7/15/2024</b>	<b>20:45:00</b>	<b>7.1</b>	<b>127</b>	<b>0</b>	<b>297,604</b>	<b>Closed</b>	<b>24.2</b>	<b>283</b>
<b>7/15/2024</b>	<b>21:00:00</b>	<b>7.1</b>	<b>114</b>	<b>0</b>	<b>297,604</b>	<b>Closed</b>	<b>23.7</b>	<b>277</b>
<b>7/15/2024</b>	<b>21:15:00</b>	<b>7.1</b>	<b>124</b>	<b>0</b>	<b>297,604</b>	<b>Closed</b>	<b>23.3</b>	<b>277</b>
<b>7/15/2024</b>	<b>21:30:00</b>	<b>7.1</b>	<b>36</b>	<b>0</b>	<b>297,824</b>	<b>Open</b>	<b>23.2</b>	<b>277</b>
<b>7/15/2024</b>	<b>21:45:00</b>	<b>7.1</b>	<b>142</b>	<b>0</b>	<b>298,040</b>	<b>Open</b>	<b>23</b>	<b>277</b>
<b>7/15/2024</b>	<b>22:00:00</b>	<b>7.1</b>	<b>139</b>	<b>0</b>	<b>298,469</b>	<b>Closed</b>	<b>22.8</b>	<b>279</b>
7/15/2024	22:15:00	7.1	116	0	298,469	Closed	22.5	276
7/15/2024	22:30:00	7.1	119	0	298,469	Closed	22.2	276
7/15/2024	22:45:00	7.1	110	0	298,469	Closed	22.1	276
7/15/2024	23:00:00	7.2	126	0	298,469	Closed	21.9	276
7/15/2024	23:15:00	7.2	126	0	298,469	Closed	21.7	274
7/15/2024	23:30:00	7.2	124	0	298,469	Closed	21.6	274

7/15/2024	23:45:00	7.2	42	0	298,968	Open	21.5	276
-----------	----------	-----	----	---	---------	------	------	-----

Picture 1: 7/15/2024, 08:55 AM



7/16/2024: 16.326 M3

Date	Time	Discharge pH	Discharge Flow Rate (USGPM)	Discharge NTU	Flow Total (G)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
7/16/2024	0:00:00	7.2	107	0	299,000	Closed	21.5	276
7/16/2024	0:15:00	7.2	105	0	299,000	Closed	21.5	274
7/16/2024	0:30:00	7.2	97	0	299,000	Closed	21.5	274
7/16/2024	0:45:00	7.2	115	0	299,000	Closed	21.5	274
7/16/2024	1:00:00	7.2	117	0	299,000	Closed	21.4	274
7/16/2024	1:15:00	7.2	143	0	299,498	Closed	21.3	274
7/16/2024	1:30:00	7.2	114	0	299,498	Closed	21.3	274
7/16/2024	1:45:00	7.2	113	0	299,498	Closed	21.3	274
<b>7/16/2024</b>	<b>2:00:00</b>	<b>7.2</b>	<b>111</b>	<b>0</b>	<b>299,498</b>	<b>Closed</b>	<b>21.2</b>	<b>274</b>
7/16/2024	2:15:00	7.2	37	0	299,904	Open	21.2	274
7/16/2024	2:30:00	7.2	33	0	300,166	Open	21.2	274
7/16/2024	2:45:00	7.2	92	0	300,411	Open	21.1	274
<b>7/16/2024</b>	<b>3:00:00</b>	<b>7.2</b>	<b>114</b>	<b>0</b>	<b>300,725</b>	<b>Closed</b>	<b>21.2</b>	<b>273</b>
7/16/2024	3:15:00	7.2	111	0	300,725	Closed	21.1	272
7/16/2024	3:30:00	7.2	106	0	300,725	Closed	21.1	272
7/16/2024	3:45:00	7.2	107	0	300,725	Closed	21.1	272
<b>7/16/2024</b>	<b>4:00:00</b>	<b>7.2</b>	<b>88</b>	<b>0</b>	<b>300,725</b>	<b>Closed</b>	<b>21.1</b>	<b>272</b>
7/16/2024	4:15:00	7.2	34	0	301,015	Open	21.1	272
<b>7/16/2024</b>	<b>4:30:00</b>	<b>7.2</b>	<b>102</b>	<b>0</b>	<b>301,045</b>	<b>Closed</b>	<b>21.1</b>	<b>272</b>
7/16/2024	4:45:00	7.2	0	0	301,045	Closed	21.1	272
7/16/2024	5:00:00	7.1	0	0	301,045	Closed	21.2	272

7/16/2024	5:15:00	7.1	0	0	301,045	Closed	21.2	272
7/16/2024	5:30:00	7.1	0	0	301,045	Closed	21.1	273
7/16/2024	5:45:00	7	0	0	301,045	Closed	21.1	273
7/16/2024	6:00:00	7	0	0	301,045	Closed	21.2	273
7/16/2024	6:15:00	7	0	0	301,045	Closed	21.1	277
7/16/2024	6:30:00	7	0	0	301,045	Closed	21.1	276
7/16/2024	6:45:00	7	0	0	301,045	Closed	21	276
7/16/2024	7:00:00	7	0	0	301,045	Closed	20.9	276
7/16/2024	7:15:00	7	0	0	301,045	Closed	20.9	277
7/16/2024	7:30:00	7	0	0	301,045	Closed	20.8	277
7/16/2024	7:45:00	7	0	0	301,045	Closed	20.8	277
7/16/2024	8:00:00	7	0	0	301,045	Closed	20.8	273
7/16/2024	8:15:00	7	0	0	301,045	Closed	20.7	277
7/16/2024	8:30:00	7	0	0	301,045	Closed	20.7	277
7/16/2024	8:45:00	7	0	0	301,045	Closed	20.7	277
7/16/2024	9:00:00	7	0	0	301,045	Closed	20.8	277
7/16/2024	9:15:00	7	0	0	301,045	Closed	20.8	277
7/16/2024	<b>9:30:00</b>	7	<b>95</b>	<b>0</b>	<b>301,045</b>	<b>Closed</b>	<b>21.2</b>	<b>292</b>
7/16/2024	<b>9:45:00</b>	<b>7.1</b>	<b>21</b>	<b>0</b>	<b>301,182</b>	<b>Closed</b>	<b>21</b>	<b>278</b>
7/16/2024	<b>10:00:00</b>	<b>7.1</b>	<b>112</b>	<b>0</b>	<b>301,453</b>	<b>Closed</b>	<b>20.8</b>	<b>278</b>
7/16/2024	<b>10:15:00</b>	<b>7.2</b>	<b>143</b>	<b>2.1</b>	<b>301,669</b>	<b>Closed</b>	<b>20.5</b>	<b>272</b>
7/16/2024	<b>10:30:00</b>	<b>7.2</b>	<b>29</b>	<b>0.3</b>	<b>301,885</b>	<b>Open</b>	<b>20.5</b>	<b>272</b>
7/16/2024	<b>10:45:00</b>	<b>7.2</b>	<b>102</b>	<b>2.1</b>	<b>302,015</b>	<b>Closed</b>	<b>20.5</b>	<b>272</b>
7/16/2024	<b>11:00:00</b>	<b>7.2</b>	<b>37</b>	<b>0</b>	<b>302,092</b>	<b>Open</b>	<b>20.6</b>	<b>274</b>
7/16/2024	<b>11:15:00</b>	<b>7.2</b>	<b>91</b>	<b>0</b>	<b>302,287</b>	<b>Closed</b>	<b>20.7</b>	<b>296</b>


7/16/2024	11:30:00	7.1	108	0	302,525	Closed	20.8	318
7/16/2024	11:45:00	7	125	0	302,732	Closed	21	314
7/16/2024	12:00:00	7	37	0	302,862	Open	21.1	298
7/16/2024	12:15:00	7	0	0	302,991	Open	21.2	284
7/16/2024	12:30:00	7	101	0	303,122	Closed	21.3	283
7/16/2024	12:45:00	7	99	0	303,281	Closed	21.5	283
7/16/2024	13:00:00	7	0	0	303,281	Closed	21.9	281
7/16/2024	13:15:00	7	0	0	303,281	Closed	22.3	281
7/16/2024	13:30:00	7	0	11.5	303,281	Closed	22.1	278
7/16/2024	13:45:00	7	0	8.6	303,281	Closed	22.6	278
7/16/2024	14:00:00	7.1	145	48.1	303,281	Closed	22.1	282
7/16/2024	14:15:00	7.1	279	7.8	303,281	Closed	22.1	285
7/16/2024	14:30:00	7.1	0	0	303,281	Closed	22.4	285
7/16/2024	14:45:00	7.1	0	0	303,281	Closed	22.9	283
7/16/2024	15:00:00	7	0	0	303,281	Closed	23.4	283
7/16/2024	15:15:00	7	0	0	303,281	Closed	23.9	283
7/16/2024	15:30:00	7	0	0	303,281	Closed	24.4	283
7/16/2024	15:45:00	7	0	0	303,281	Closed	24.9	285
7/16/2024	16:00:00	7	0	0	303,281	Closed	25.3	285
7/16/2024	16:15:00	7	0	0	303,281	Closed	25.6	286
7/16/2024	16:30:00	7	0	0	303,281	Closed	25.9	286
7/16/2024	16:45:00	7	0	0	303,281	Closed	26.2	286
7/16/2024	17:00:00	7	0	0	303,281	Closed	26.5	286
7/16/2024	17:15:00	7	0	0	303,281	Closed	26.7	286
7/16/2024	17:30:00	7	0	0	303,281	Closed	26.9	288

7/16/2024	17:45:00	7	0	0	303,281	Closed	27.1	288
7/16/2024	18:00:00	7	0	0	303,281	Closed	27.2	288
7/16/2024	18:15:00	6.9	0	0	303,281	Closed	27.3	288
7/16/2024	18:30:00	6.9	0	0	303,281	Closed	27.4	288
7/16/2024	18:45:00	6.9	0	0	303,281	Closed	27.5	288
7/16/2024	19:00:00	6.9	0	0	303,281	Closed	27.6	288
7/16/2024	19:15:00	6.9	0	0	303,281	Closed	27.6	288
7/16/2024	19:30:00	6.9	0	0	303,281	Closed	27.6	288
7/16/2024	19:45:00	6.9	0	0	303,281	Closed	27.6	287
7/16/2024	20:00:00	6.9	0	0	303,281	Closed	27.6	286
7/16/2024	20:15:00	6.9	0	0	303,281	Closed	27.6	285
7/16/2024	20:30:00	6.9	262	0	303,281	Closed	23.5	297
7/16/2024	20:45:00	7	258	0	303,281	Closed	23.3	284
7/16/2024	21:00:00	7.1	225	0	303,281	Closed	23.1	284
7/16/2024	21:15:00	7.1	248	0	303,281	Closed	23	283
7/16/2024	21:30:00	7.1	195	0	303,281	Closed	22.9	283
7/16/2024	21:45:00	7.2	237	0	303,281	Closed	22.7	281
7/16/2024	22:00:00	7.2	235	0	303,281	Closed	22.6	281
7/16/2024	22:15:00	7.2	234	0	303,281	Closed	22.5	279
7/16/2024	22:30:00	7.2	228	0	303,281	Closed	22.5	279
7/16/2024	22:45:00	7.2	231	0	303,281	Closed	22.5	279
7/16/2024	23:00:00	7.2	225	0	303,281	Closed	22.4	279
7/16/2024	23:15:00	7.2	177	0	303,281	Closed	22.4	279
7/16/2024	23:30:00	7.2	217	0	303,281	Closed	22.4	279
7/16/2024	23:45:00	7.2	211	0	303,281	Closed	22.4	279


Picture 2: 7/16/2024, 10:35 AM





 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix D	D-1

## Appendix D: Woodfibre Site Receiving Environment Documentation

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix D	D-2

## Woodfibre Site Receiving Environment Sample Analysis











**Eagle Mountain - Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
Report #	17
Appendix D	D-3

## Woodfibre Site Receiving Environment Lab Documentation

## CERTIFICATE OF ANALYSIS

**Work Order** : VA24B7247  
**Client** : Triton Environmental Consultants Ltd.  
**Contact** :   
**Address** :   
**Telephone** :   
**Project** : 11964  
**PO** : 11964 - Task 30 - Phase 3C-4C  
**C-O-C number** : ----  
**Sampler** : ----  
**Site** : Water Analysis  
**Quote number** : VA23-TRIT100-012\_V2  
**No. of samples received** : 2  
**No. of samples analysed** : 2

**Page** : 1 of 6  
**Laboratory** : ALS Environmental - Vancouver  
**Account Manager** :   
**Address** :   
**Telephone** :   
**Date Samples Received** : 16-Jul-2024 17:30  
**Date Analysis Commenced** : 17-Jul-2024  
**Issue Date** : 27-Jul-2024 13:47

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
	Lab Assistant	Metals, Burnaby, British Columbia
	Team Leader - Inorganics	Inorganics, Burnaby, British Columbia
	Analyst	Metals, Burnaby, British Columbia
	Manager - Inorganics	Inorganics, Waterloo, Ontario
	Manager - Inorganics	Metals, Waterloo, Ontario
	Department Manager - Metals	Metals, Burnaby, British Columbia
	Analyst- General	Inorganics, Burnaby, British Columbia
	Lab Analyst	Metals, Burnaby, British Columbia
	Senior Analyst	Metals, Waterloo, Ontario
	Account Manager Assistant	Administration, Burnaby, British Columbia
	Analyst	Metals, Burnaby, British Columbia



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
°C	degrees celsius
µS/cm	microsiemens per centimetre
mg/L	milligrams per litre
pH units	pH units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.



## Analytical Results

Sub-Matrix: Water				Client sample ID	WLNG US 1	WLNG DS 1	----	----	----
(Matrix: Water)				Client sampling date / time	16-Jul-2024 11:09	16-Jul-2024 10:14	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7247-001	VA24B7247-002	-----	-----	-----
					Result	Result	---	---	---
<b>Field Tests</b>									
Conductivity, field	---	EF001/VA	0.10	µS/cm	26.000	53.000	----	----	----
pH, field	---	EF001/VA	0.10	pH units	7.58	6.95	----	----	----
Temperature, field	---	EF001/VA	0.10	°C	17.5	17.8	----	----	----
<b>Physical Tests</b>									
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	8.47	9.97	----	----	----
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	9.19	11.4	----	----	----
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	21	20	----	----	----
Solids, total suspended [TSS]	---	E160/VA	3.0	mg/L	<3.0	<3.0	----	----	----
Alkalinity, total (as CaCO3)	---	E290/VA	2.0	mg/L	9.7	10.8	----	----	----
<b>Anions and Nutrients</b>									
Ammonia, total (as N)	7664-41-7	E298/VA	0.0050	mg/L	<0.0050	<0.0050	----	----	----
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.050	<0.050	----	----	----
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	0.63	0.63	----	----	----
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	0.025	0.030	----	----	----
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	0.0186	0.0166	----	----	----
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0010	<0.0010	----	----	----
Nitrogen, total	7727-37-9	E366/VA	0.030	mg/L	0.076	0.073	----	----	----
Phosphorus, total	7723-14-0	E372-U/VA	0.0020	mg/L	0.0051	0.0040	----	----	----
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	2.26	2.63	----	----	----
<b>Organic / Inorganic Carbon</b>									
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	2.33	2.25	----	----	----
<b>Total Sulfides</b>									
Sulfide, total (as S)	18496-25-8	E395/VA	0.0015	mg/L	<0.0015	<0.0015	----	----	----
Sulfide, un-ionized (as H2S), from total	7783-06-4	EC395/VA	0.0015	mg/L	<0.0015	<0.0015	----	----	----
Sulfide, total (as H2S)	7783-06-4	E395/VA	0.0016	mg/L	<0.0016	<0.0016	----	----	----
<b>Total Metals</b>									
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.104	0.0757	----	----	----
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNG US 1	WLNG DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 11:09	16-Jul-2024 10:14	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7247-001	VA24B7247-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Total Metals</b>										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00015	0.00013	----	----	----	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.00562	0.00675	----	----	----	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	<0.000100	----	----	----	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	<0.010	<0.010	----	----	----	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0000077	0.0000076	----	----	----	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	3.16	3.99	----	----	----	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000012	0.000011	----	----	----	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00066	0.00051	----	----	----	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	0.074	0.056	----	----	----	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.000070	<0.000050	----	----	----	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	<0.0010	<0.0010	----	----	----	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	0.316	0.344	----	----	----	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.00272	0.00227	----	----	----	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	<0.0000050	----	----	----	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.000537	0.00140	----	----	----	
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	<0.050	<0.050	----	----	----	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	0.352	0.293	----	----	----	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00097	0.00068	----	----	----	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	5.00	5.29	----	----	----	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	0.000012	<0.000010	----	----	----	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	1.94	1.94	----	----	----	
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.0188	0.0195	----	----	----	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	0.61	0.69	----	----	----	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	





## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNG US 1	WLNG DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 11:09	16-Jul-2024 10:14	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7247-001	VA24B7247-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Total Metals</b>										
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.00161	0.00106	----	----	----	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.000079	0.000127	----	----	----	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	<0.0030	<0.0030	----	----	----	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0482	0.0440	----	----	----	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00014	0.00012	----	----	----	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.00431	0.00546	----	----	----	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	<0.000100	----	----	----	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	<0.010	<0.010	----	----	----	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000075	0.0000068	----	----	----	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	2.94	3.50	----	----	----	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000010	<0.000010	----	----	----	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00060	0.00044	----	----	----	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.043	0.034	----	----	----	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	<0.0010	<0.0010	----	----	----	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	0.274	0.298	----	----	----	
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.00178	0.00155	----	----	----	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	<0.0000050	----	----	----	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.000502	0.00120	----	----	----	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	<0.050	----	----	----	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	0.341	0.301	----	----	----	



## Analytical Results

Sub-Matrix: Water					Client sample ID	WLNG US 1	WLNG DS 1	----	----	----
(Matrix: Water)					Client sampling date / time	16-Jul-2024 11:09	16-Jul-2024 10:14	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	VA24B7247-001	VA24B7247-002	-----	-----	-----	
					Result	Result	----	----	----	
<b>Dissolved Metals</b>										
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00098	0.00067	----	----	----	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	<0.000050	<0.000050	----	----	----	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	4.68	4.98	----	----	----	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	1.94	1.94	----	----	----	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.0160	0.0163	----	----	----	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	0.53	0.69	----	----	----	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	<0.000010	----	----	----	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	0.00041	0.00035	----	----	----	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	<0.00010	----	----	----	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.000068	0.000107	----	----	----	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0010	0.0015	----	----	----	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	<0.00020	----	----	----	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	Field	----	----	----	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	Field	----	----	----	
<b>Speciated Metals</b>										
Chromium, hexavalent [Cr VI], total	18540-29-9	E532/WT	0.00050	mg/L	<0.00050	<0.00050	----	----	----	
Chromium, trivalent [Cr III], total	16065-83-1	EC535/WT	0.00050	mg/L	<0.00050	<0.00050	----	----	----	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : <b>VA24B7247</b></p> <p><b>Client</b> : <b>Triton Environmental Consultants Ltd.</b></p> <p><b>Contact</b> : [Redacted]</p> <p><b>Address</b> : [Redacted]</p> <p><b>Telephone</b> : [Redacted]</p> <p><b>Project</b> : 11964</p> <p><b>PO</b> : 11964 - Task 30 - Phase 3C-4C</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : ----</p> <p><b>Site</b> : Water Analysis</p> <p><b>Quote number</b> : VA23-TRIT100-012_V2</p> <p><b>No. of samples received</b> : 2</p> <p><b>No. of samples analysed</b> : 2</p>	<p><b>Page</b> : 1 of 14</p> <p><b>Laboratory</b> : ALS Environmental - Vancouver</p> <p><b>Account Manager</b> : [Redacted]</p> <p><b>Address</b> : [Redacted]</p> <p><b>Telephone</b> : [Redacted]</p> <p><b>Date Samples Received</b> : 16-Jul-2024 17:30</p> <p><b>Issue Date</b> : 27-Jul-2024 13:48</p>
---	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- No Analysis Holding Time Outliers exist.

### ***Outliers : Frequency of Quality Control Samples***

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Anions and Nutrients : Ammonia by Fluorescence</b>										
<b>Amber glass total (sulfuric acid)</b> WLNG DS 1	E298	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	25-Jul-2024	28 days	9 days	✔
<b>Anions and Nutrients : Ammonia by Fluorescence</b>										
<b>Amber glass total (sulfuric acid)</b> WLNG US 1	E298	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	25-Jul-2024	28 days	9 days	✔
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>										
<b>HDPE</b> WLNG DS 1	E235.Br-L	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>										
<b>HDPE</b> WLNG US 1	E235.Br-L	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Chloride in Water by IC</b>										
<b>HDPE</b> WLNG DS 1	E235.Cl	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Chloride in Water by IC</b>										
<b>HDPE</b> WLNG US 1	E235.Cl	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔
<b>Anions and Nutrients : Fluoride in Water by IC</b>										
<b>HDPE</b> WLNG DS 1	E235.F	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE WLNG US 1	E235.F	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE WLNG DS 1	E235.NO3-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE WLNG US 1	E235.NO3-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE WLNG DS 1	E235.NO2-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE WLNG US 1	E235.NO2-L	16-Jul-2024	17-Jul-2024	3 days	1 days	✔	17-Jul-2024	3 days	1 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE WLNG DS 1	E235.SO4	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE WLNG US 1	E235.SO4	16-Jul-2024	17-Jul-2024	28 days	1 days	✔	17-Jul-2024	28 days	1 days	✔	
<b>Anions and Nutrients : Total Nitrogen by Colourimetry</b>											
Amber glass total (sulfuric acid) WLNG DS 1	E366	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	26-Jul-2024	28 days	10 days	✔	
<b>Anions and Nutrients : Total Nitrogen by Colourimetry</b>											
Amber glass total (sulfuric acid) WLNG US 1	E366	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	26-Jul-2024	28 days	10 days	✔	



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)</b>										
<b>Amber glass total (sulfuric acid)</b> WLNK DS 1	E372-U	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	27-Jul-2024	28 days	11 days	✔
<b>Anions and Nutrients : Total Phosphorus by Colourimetry (0.002 mg/L)</b>										
<b>Amber glass total (sulfuric acid)</b> WLNK US 1	E372-U	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	27-Jul-2024	28 days	11 days	✔
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
<b>Glass vial - dissolved (lab preserved)</b> WLNK DS 1	E509	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
<b>Glass vial - dissolved (lab preserved)</b> WLNK US 1	E509	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
<b>HDPE - dissolved (lab preserved)</b> WLNK DS 1	E421	16-Jul-2024	22-Jul-2024	180 days	6 days	✔	24-Jul-2024	180 days	8 days	✔
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
<b>HDPE - dissolved (lab preserved)</b> WLNK US 1	E421	16-Jul-2024	22-Jul-2024	180 days	6 days	✔	24-Jul-2024	180 days	8 days	✔
<b>Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine</b>										
<b>Glass vial - total (lab preserved)</b> WLNK DS 1	EF001	16-Jul-2024	----	----	----		18-Jul-2024	----	2 days	
<b>Field Tests : Field pH,EC,Salinity, TDS, Cl2,CIO2,ORP,DO, Turbidity,T,T-P,o-PO4,NH3,Chloramine</b>										
<b>Glass vial - total (lab preserved)</b> WLNK US 1	EF001	16-Jul-2024	----	----	----		18-Jul-2024	----	2 days	
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>										
<b>Amber glass dissolved (sulfuric acid)</b> WLNK DS 1	E358-L	16-Jul-2024	25-Jul-2024	28 days	9 days	✔	25-Jul-2024	28 days	9 days	✔



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>											
<b>Amber glass dissolved (sulfuric acid)</b> WLNG US 1	E358-L	16-Jul-2024	25-Jul-2024	28 days	9 days	✓	25-Jul-2024	28 days	9 days	✓	
<b>Physical Tests : Alkalinity Species by Titration</b>											
<b>HDPE</b> WLNG DS 1	E290	16-Jul-2024	17-Jul-2024	14 days	1 days	✓	17-Jul-2024	14 days	1 days	✓	
<b>Physical Tests : Alkalinity Species by Titration</b>											
<b>HDPE</b> WLNG US 1	E290	16-Jul-2024	17-Jul-2024	14 days	1 days	✓	17-Jul-2024	14 days	1 days	✓	
<b>Physical Tests : TDS by Gravimetry</b>											
<b>HDPE</b> WLNG US 1	E162	16-Jul-2024	----	----	----		22-Jul-2024	7 days	6 days	✓	
<b>Physical Tests : TDS by Gravimetry</b>											
<b>HDPE</b> WLNG DS 1	E162	16-Jul-2024	----	----	----		22-Jul-2024	7 days	7 days	✓	
<b>Physical Tests : TSS by Gravimetry</b>											
<b>HDPE</b> WLNG DS 1	E160	16-Jul-2024	----	----	----		22-Jul-2024	7 days	6 days	✓	
<b>Physical Tests : TSS by Gravimetry</b>											
<b>HDPE</b> WLNG US 1	E160	16-Jul-2024	----	----	----		22-Jul-2024	7 days	6 days	✓	
<b>Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC</b>											
<b>UV-inhibited HDPE - total (sodium hydroxide)</b> WLNG DS 1	E532	16-Jul-2024	----	----	----		22-Jul-2024	28 days	6 days	✓	
<b>Speciated Metals : Total Hexavalent Chromium (Cr VI) by IC</b>											
<b>UV-inhibited HDPE - total (sodium hydroxide)</b> WLNG US 1	E532	16-Jul-2024	----	----	----		22-Jul-2024	28 days	6 days	✓	





Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Total Metals : Total Mercury in Water by CVAAS</b>										
Glass vial - total (lab preserved) WLNG DS 1	E508	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔
<b>Total Metals : Total Mercury in Water by CVAAS</b>										
Glass vial - total (lab preserved) WLNG US 1	E508	16-Jul-2024	23-Jul-2024	28 days	7 days	✔	23-Jul-2024	28 days	7 days	✔
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>										
HDPE - total (lab preserved) WLNG DS 1	E420	16-Jul-2024	22-Jul-2024	180 days	6 days	✔	25-Jul-2024	180 days	9 days	✔
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>										
HDPE - total (lab preserved) WLNG US 1	E420	16-Jul-2024	22-Jul-2024	180 days	6 days	✔	25-Jul-2024	180 days	9 days	✔
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>										
HDPE total (zinc acetate+sodium hydroxide) WLNG DS 1	E395	16-Jul-2024	----	----	----		23-Jul-2024	7 days	7 days	✔
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>										
HDPE total (zinc acetate+sodium hydroxide) WLNG US 1	E395	16-Jul-2024	----	----	----		23-Jul-2024	7 days	7 days	✔

Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1549558	1	16	6.2	5.0	✔
Ammonia by Fluorescence	E298	1563691	1	20	5.0	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549562	1	16	6.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549561	1	16	6.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1554918	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1563688	1	17	5.8	5.0	✔
Fluoride in Water by IC	E235.F	1549560	1	20	5.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549563	1	19	5.2	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549564	1	16	6.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1549565	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1557486	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550696	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1563689	1	3	33.3	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1563690	1	11	9.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1549558	1	16	6.2	5.0	✔
Ammonia by Fluorescence	E298	1563691	1	20	5.0	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549562	1	16	6.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549561	1	16	6.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1554918	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1563688	1	17	5.8	5.0	✔
Fluoride in Water by IC	E235.F	1549560	1	20	5.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549563	1	19	5.2	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549564	1	16	6.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1549565	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1557486	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550696	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1563689	1	3	33.3	5.0	✔



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1563690	1	11	9.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✔
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1549558	1	16	6.2	5.0	✔
Ammonia by Fluorescence	E298	1563691	1	20	5.0	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549562	1	16	6.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549561	1	16	6.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1554918	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1563688	1	17	5.8	5.0	✔
Fluoride in Water by IC	E235.F	1549560	1	20	5.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549563	1	19	5.2	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549564	1	16	6.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1549565	1	16	6.2	5.0	✔
TDS by Gravimetry	E162	1558760	1	20	5.0	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1557486	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550696	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1563689	1	3	33.3	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1563690	1	11	9.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔
TSS by Gravimetry	E160	1558750	1	20	5.0	5.0	✔
<b>Matrix Spikes (MS)</b>							
Ammonia by Fluorescence	E298	1563691	1	20	5.0	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1549562	1	16	6.2	5.0	✔
Chloride in Water by IC	E235.Cl	1549561	1	16	6.2	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1559792	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1554918	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1563688	1	17	5.8	5.0	✔
Fluoride in Water by IC	E235.F	1549560	1	20	5.0	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1549563	1	19	5.2	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1549564	1	16	6.2	5.0	✔
Sulfate in Water by IC	E235.SO4	1549565	1	16	6.2	5.0	✔
Total Hexavalent Chromium (Cr VI) by IC	E532	1557486	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1560070	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1550696	1	20	5.0	5.0	✔
Total Nitrogen by Colourimetry	E366	1563689	1	3	33.3	5.0	✔
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U	1563690	0	11	0.0	5.0	✖



Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS) - Continued</b>							
Total Sulfide by Colourimetry (Automated Flow)	E395	1559690	1	15	6.6	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
TSS by Gravimetry	E160 ALS Environmental - Vancouver	Water	APHA 2540 D (mod)	Total Suspended Solids (TSS) are determined by filtering a sample through a glass fibre filter, following by drying of the filter at $104 \pm 1^\circ\text{C}$ , with gravimetric measurement of the filtered solids. Samples containing very high dissolved solid content (i.e. seawaters, brackish waters) may produce a positive bias by this method. Alternate analysis methods are available for these types of samples.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at $180 \pm 2^\circ\text{C}$ for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Ammonia by Fluorescence	E298 ALS Environmental - Vancouver	Water	Method Fialab 100, 2018	Ammonia in water is determined by automated continuous flow analysis with membrane diffusion and fluorescence detection, after reaction with OPA (ortho-phthalaldehyde). This method is approved under US EPA 40 CFR Part 136 (May 2021)
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Nitrogen by Colourimetry	E366 ALS Environmental - Vancouver	Water	Chinchilla Scientific Nitrate Method, 2011	Following digestion, total nitrogen is determined colourimetrically using a discrete analyzer utilizing the vanadium chloride reduction method. This method of analysis is approved under US EPA 40 CFR Part 136 (May 2021).
Total Phosphorus by Colourimetry (0.002 mg/L)	E372-U ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Total Phosphorus is determined colourimetrically using a discrete analyzer after heated persulfate digestion of the sample.
Total Sulfide by Colourimetry (Automated Flow)	E395 ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> <sup>-</sup> ) and reports it as Total Sulphide as (H <sub>2</sub> S)
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Total Hexavalent Chromium (Cr VI) by IC	E532 ALS Environmental - Waterloo	Water	APHA 3500-Cr C (Ion Chromatography)	Hexavalent Chromium is measured by Ion chromatography-Post column reaction and UV detection.  Results are based on an un-filtered, field-preserved sample.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Un-ionized Total Hydrogen Sulfide (calculated)	EC395 ALS Environmental - Vancouver	Water	APHA 4500 -S H	Un-ionized sulfide is calculated using results from total sulfide analysis, pH, temperature, and ionic strength of the sample. Calculation of un-ionized sulfide using total sulfide concentrations may be biased high due to particulate forms of sulfide measured during total sulfide testing.
Total Trivalent Chromium (Cr III) by Calculation	EC535 ALS Environmental - Waterloo	Water	APHA 3030B/6020A/EPA 7196A (mod)	Chromium (III)-Total is calculated as the difference between the total chromium and the total hexavalent chromium (Cr(VI)) results. The Limit of Reporting for Chromium (III) varies as a function of the test results.
Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> ,Chloramine	EF001 ALS Environmental - Vancouver	Water	Field Measurement (Client Supplied)	Field pH,EC,Salinity, TDS, Cl <sub>2</sub> ,ClO <sub>2</sub> ,ORP,DO, Turbidity,T,T-P,o-PO <sub>4</sub> ,NH <sub>3</sub> or Chloramine measurements provided by client and recorded on ALS report may affect the validity of results.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Ammonia	EP298 ALS Environmental - Vancouver	Water		Sample preparation for Preserved Nutrients Water Quality Analysis.
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Digestion for Total Nitrogen in water	EP366 ALS Environmental - Vancouver	Water	APHA 4500-P J (mod)	Samples for total nitrogen analysis are digested using a heated persulfate digestion. Nitrogen compounds are converted to nitrate in this digestion.
Digestion for Total Phosphorus in water	EP372 ALS Environmental - Vancouver	Water	APHA 4500-P E (mod).	Samples are heated with a persulfate digestion reagent.

Page : 14 of 14  
Work Order : VA24B7247  
Client : Triton Environmental Consultants Ltd.  
Project : 11964



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.



## QUALITY CONTROL REPORT

**Work Order** : **VA24B7247**  
**Client** : Triton Environmental Consultants Ltd.  
**Contact** :   
**Address** :   
  
**Telephone** :   
**Project** : 11964  
**PO** : 11964 - Task 30 - Phase 3C-4C  
**C-O-C number** : ----  
**Sampler** : ----  
**Site** : Water Analysis  
**Quote number** : VA23-TRIT100-012\_V2  
**No. of samples received** : 2  
**No. of samples analysed** : 2

**Page** : 1 of 17  
**Laboratory** : ALS Environmental - Vancouver  
**Account Manager** :   
**Address** :   
  
**Telephone** :   
**Date Samples Received** : 16-Jul-2024 17:30  
**Date Analysis Commenced** : 17-Jul-2024  
**Issue Date** : 27-Jul-2024 13:47

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
	Lab Assistant	Vancouver Metals, Burnaby, British Columbia
	Team Leader - Inorganics	Vancouver Inorganics, Burnaby, British Columbia
	Analyst	Vancouver Metals, Burnaby, British Columbia
	Manager - Inorganics	Waterloo Inorganics, Waterloo, Ontario
	Manager - Inorganics	Waterloo Metals, Waterloo, Ontario
	Department Manager - Metals	Vancouver Metals, Burnaby, British Columbia
	Analyst- General	Vancouver Inorganics, Burnaby, British Columbia
	Lab Analyst	Vancouver Metals, Burnaby, British Columbia
	Senior Analyst	Waterloo Metals, Waterloo, Ontario
	Account Manager Assistant	Vancouver Administration, Burnaby, British Columbia
	Analyst	Vancouver Metals, Burnaby, British Columbia

Page : 2 of 17  
Work Order : VA24B7247  
Client : Triton Environmental Consultants Ltd.  
Project : 11964



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

## Workorder Comments

---

Holding times are displayed as "--" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1549558)</b>											
VA24B6713-002	Anonymous	Alkalinity, total (as CaCO3)	----	E290	1.0	mg/L	105	105	0.00%	20%	----
<b>Physical Tests (QC Lot: 1558750)</b>											
FJ2402074-001	Anonymous	Solids, total suspended [TSS]	----	E160	3.0	mg/L	<3.0	<3.0	0	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1558760)</b>											
FJ2402074-001	Anonymous	Solids, total dissolved [TDS]	----	E162	20	mg/L	117	119	2	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549560)</b>											
FJ2402029-001	Anonymous	Fluoride	16984-48-8	E235.F	0.200	mg/L	0.499	0.487	0.011	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549561)</b>											
FJ2402029-001	Anonymous	Chloride	16887-00-6	E235.Cl	5.00	mg/L	11.2	11.2	0.06	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549562)</b>											
FJ2402029-001	Anonymous	Bromide	24959-67-9	E235.Br-L	0.500	mg/L	<0.500	<0.500	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1549563)</b>											
FJ2402029-001	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0500	mg/L	1.62	1.64	1.00%	20%	----
<b>Anions and Nutrients (QC Lot: 1549564)</b>											
FJ2402029-001	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0100	mg/L	0.215	0.216	0.190%	20%	----
<b>Anions and Nutrients (QC Lot: 1549565)</b>											
FJ2402029-001	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	3.00	mg/L	242	240	0.667%	20%	----
<b>Anions and Nutrients (QC Lot: 1563689)</b>											
VA24B7247-001	WLNG US 1	Nitrogen, total	7727-37-9	E366	0.030	mg/L	0.076	0.076	0.0000007	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1563690)</b>											
VA24B7275-001	Anonymous	Phosphorus, total	7723-14-0	E372-U	0.0020	mg/L	0.269	0.268	0.708%	20%	----
<b>Anions and Nutrients (QC Lot: 1563691)</b>											
VA24B7265-001	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.0050	mg/L	0.0094	0.0096	0.0002	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1563688)</b>											
VA24B7247-001	WLNG US 1	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	2.33	2.28	0.05	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1559690)</b>											
CG2409956-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	<0.0015	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1550696)</b>											
VA24B7240-001	Anonymous	Aluminum, total	7429-90-5	E420	0.0030	mg/L	0.0039	0.0041	0.0002	Diff <2x LOR	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550696) - continued</b>											
VA24B7240-001	Anonymous	Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00050	0.00049	0.00002	Diff <2x LOR	----
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.0272	0.0287	5.12%	20%	----
		Beryllium, total	7440-41-7	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.010	mg/L	0.010	0.011	0.0003	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	<0.0000050	0.0000055	0.0000005	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.050	mg/L	32.7	33.9	3.57%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	0.000012	0.000012	0.00000001	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00050	mg/L	0.338	0.348	2.81%	20%	----
		Iron, total	7439-89-6	E420	0.010	mg/L	0.138	0.132	4.64%	20%	----
		Lead, total	7439-92-1	E420	0.000050	mg/L	0.000418	0.000424	0.000006	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.0031	0.0032	0.00005	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	10.6	10.8	1.02%	20%	----
		Manganese, total	7439-96-5	E420	0.00010	mg/L	0.00328	0.00326	0.373%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.00366	0.00381	3.97%	20%	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	0.00056	0.00057	0.000008	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.050	mg/L	2.55	2.61	2.08%	20%	----
		Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00176	0.00164	0.00012	Diff <2x LOR	----
		Selenium, total	7782-49-2	E420	0.000050	mg/L	0.000392	0.000464	0.000072	Diff <2x LOR	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	3.79	3.78	0.110%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	0.000015	0.000015	0.00000006	Diff <2x LOR	----
		Sodium, total	7440-23-5	E420	0.050	mg/L	12.6	12.6	0.0397%	20%	----
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.326	0.335	2.95%	20%	----
		Sulfur, total	7704-34-9	E420	0.50	mg/L	10.2	10.5	3.32%	20%	----
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, total	7440-32-6	E420	0.00030	mg/L	<0.00030	<0.00030	0	Diff <2x LOR	----
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.00259	0.00262	1.10%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1550696) - continued</b>											
VA24B7240-001	Anonymous	Vanadium, total	7440-62-2	E420	0.00050	mg/L	0.00082	0.00085	0.00002	Diff <2x LOR	----
		Zinc, total	7440-66-6	E420	0.0030	mg/L	0.0044	0.0048	0.0004	Diff <2x LOR	----
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1560070)</b>											
VA24B7077-001	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Dissolved Metals (QC Lot: 1554918)</b>											
KS2402787-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	1.42	1.39	1.64%	20%	----
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	0.00021	0.00020	0.00001	Diff <2x LOR	----
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	0.00281	0.00276	1.53%	20%	----
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.106	0.109	3.32%	20%	----
		Beryllium, dissolved	7440-41-7	E421	0.000020	mg/L	0.000050	0.000049	0.00001	Diff <2x LOR	----
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	0.023	0.021	0.001	Diff <2x LOR	----
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	0.0000609	0.0000703	14.4%	20%	----
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	80.3	77.2	3.91%	20%	----
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	0.000166	0.000173	3.88%	20%	----
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	0.00204	0.00201	0.00003	Diff <2x LOR	----
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	0.00172	0.00172	0.0993%	20%	----
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00991	0.00990	0.103%	20%	----
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	1.85	1.80	2.72%	20%	----
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	0.000729	0.000712	2.23%	20%	----
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	0.0023	0.0022	0.0002	Diff <2x LOR	----
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	39.4	41.1	4.13%	20%	----
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.227	0.233	2.96%	20%	----
		Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.0375	0.0365	2.64%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.00050	mg/L	0.00325	0.00319	0.00006	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	0.595	0.660	10.4%	20%	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	4.28	4.56	6.29%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00196	0.00216	9.45%	20%	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	0.000493	0.000571	14.6%	20%	----
Silicon, dissolved	7440-21-3	E421	0.050	mg/L	14.1	14.5	3.27%	20%	----		
Silver, dissolved	7440-22-4	E421	0.000010	mg/L	0.000014	0.000018	0.000003	Diff <2x LOR	----		
Sodium, dissolved	7440-23-5	E421	0.050	mg/L	22.8	23.3	2.24%	20%	----		
Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.540	0.529	1.98%	20%	----		



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1554918) - continued</b>											
KS2402787-001	Anonymous	Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	48.2	50.7	5.13%	20%	----
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000010	mg/L	0.000010	<0.000010	0.0000004	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00040	mg/L	<0.00040	<0.00040	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	0.0495	0.0470	5.05%	20%	----
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	0.00034	0.00032	0.00002	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000010	mg/L	0.00397	0.00387	2.60%	20%	----
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	0.00780	0.00758	2.90%	20%	----
		Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0063	0.0061	0.0002	Diff <2x LOR	----
Zirconium, dissolved	7440-67-7	E421	0.00030	mg/L	0.00042	0.00040	0.00002	Diff <2x LOR	----		
<b>Dissolved Metals (QC Lot: 1559792)</b>											
FJ2402033-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Speciated Metals (QC Lot: 1557486)</b>											
VA24B7247-001	WLNG US 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1549558)</b>						
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	<1.0	----
<b>Physical Tests (QCLot: 1558750)</b>						
Solids, total suspended [TSS]	----	E160	3	mg/L	<3.0	----
<b>Physical Tests (QCLot: 1558760)</b>						
Solids, total dissolved [TDS]	----	E162	10	mg/L	<10	----
<b>Anions and Nutrients (QCLot: 1549560)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	----
<b>Anions and Nutrients (QCLot: 1549561)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	----
<b>Anions and Nutrients (QCLot: 1549562)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	----
<b>Anions and Nutrients (QCLot: 1549563)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	----
<b>Anions and Nutrients (QCLot: 1549564)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	----
<b>Anions and Nutrients (QCLot: 1549565)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	----
<b>Anions and Nutrients (QCLot: 1563689)</b>						
Nitrogen, total	7727-37-9	E366	0.03	mg/L	<0.030	----
<b>Anions and Nutrients (QCLot: 1563690)</b>						
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	<0.0020	----
<b>Anions and Nutrients (QCLot: 1563691)</b>						
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	<0.0050	----
<b>Organic / Inorganic Carbon (QCLot: 1563688)</b>						
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	<0.50	----
<b>Total Sulfides (QCLot: 1559690)</b>						
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	<0.0015	----
<b>Total Metals (QCLot: 1550696)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	----
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1550696) - continued</b>						
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	----
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	----
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	----
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	----
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	----
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	----
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	----
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	----
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	----
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	----
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----





Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1560070)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1554918)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----



Sub-Matrix: **Water**

<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Result</i>	<i>Qualifier</i>
<b>Dissolved Metals (QCLot: 1554918) - continued</b>						
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1559792)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
<b>Speciated Metals (QCLot: 1557486)</b>						
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	<0.00050	----



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1549558)</b>									
Alkalinity, total (as CaCO3)	----	E290	1	mg/L	500 mg/L	90.7	85.0	115	----
<b>Physical Tests (QCLot: 1558750)</b>									
Solids, total suspended [TSS]	----	E160	3	mg/L	150 mg/L	97.1	85.0	115	----
<b>Physical Tests (QCLot: 1558760)</b>									
Solids, total dissolved [TDS]	----	E162	10	mg/L	1000 mg/L	102	85.0	115	----
<b>Anions and Nutrients (QCLot: 1549560)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	101	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549561)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	99.2	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549562)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	93.4	85.0	115	----
<b>Anions and Nutrients (QCLot: 1549563)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	99.4	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549564)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	100	90.0	110	----
<b>Anions and Nutrients (QCLot: 1549565)</b>									
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	101	90.0	110	----
<b>Anions and Nutrients (QCLot: 1563689)</b>									
Nitrogen, total	7727-37-9	E366	0.03	mg/L	0.5 mg/L	106	75.0	125	----
<b>Anions and Nutrients (QCLot: 1563690)</b>									
Phosphorus, total	7723-14-0	E372-U	0.002	mg/L	0.05 mg/L	92.7	80.0	120	----
<b>Anions and Nutrients (QCLot: 1563691)</b>									
Ammonia, total (as N)	7664-41-7	E298	0.005	mg/L	0.2 mg/L	102	85.0	115	----
<b>Organic / Inorganic Carbon (QCLot: 1563688)</b>									
Carbon, dissolved organic [DOC]	----	E358-L	0.5	mg/L	8.57 mg/L	107	80.0	120	----
<b>Total Sulfides (QCLot: 1559690)</b>									
Sulfide, total (as S)	18496-25-8	E395	0.0015	mg/L	0.08 mg/L	106	80.0	120	----
<b>Total Metals (QCLot: 1550696)</b>									



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550696) - continued</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	110	80.0	120	----
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	114	80.0	120	----
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	110	80.0	120	----
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	114	80.0	120	----
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	107	80.0	120	----
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	111	80.0	120	----
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	109	80.0	120	----
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	108	80.0	120	----
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	110	80.0	120	----
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	113	80.0	120	----
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	108	80.0	120	----
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	107	80.0	120	----
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	----
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	96.8	80.0	120	----
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	112	80.0	120	----
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	105	80.0	120	----
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	108	80.0	120	----
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	106	80.0	120	----
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	114	80.0	120	----
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	107	80.0	120	----
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	89.4	80.0	120	----
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	106	80.0	120	----
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	112	80.0	120	----
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	102	80.0	120	----
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	114	80.0	120	----
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	108	80.0	120	----
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	107	80.0	120	----
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	117	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	96.2	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	107	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	106	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	110	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	108	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	102	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	111	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	112	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550696) - continued</b>									
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	109	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	102	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	108	80.0	120	----
<b>Total Metals (QCLot: 1560070)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	98.4	80.0	120	----
<b>Dissolved Metals (QCLot: 1554918)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	97.7	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	112	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	101	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	97.9	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	106	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	109	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	101	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	98.0	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	108	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	105	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	97.2	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	97.2	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	96.6	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	98.0	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	110	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	101	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	94.2	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	96.9	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	110	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	96.8	80.0	120	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	103	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	102	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	99.7	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	107	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	104	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	96.6	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	96.1	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	103	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	96.0	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1554918) - continued</b>									
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	112	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	109	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	100	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	99.3	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	93.1	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	104	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	106	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	99.5	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	99.5	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	105	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	97.6	80.0	120	----
<b>Speciated Metals (QCLot: 1557486)</b>									
Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0005	mg/L	0.025 mg/L	98.9	80.0	120	----



### Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1549560)</b>										
FJ2402029-002	Anonymous	Fluoride	16984-48-8	E235.F	5.11 mg/L	5 mg/L	102	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549561)</b>										
FJ2402029-002	Anonymous	Chloride	16887-00-6	E235.Cl	514 mg/L	500 mg/L	103	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549562)</b>										
FJ2402029-002	Anonymous	Bromide	24959-67-9	E235.Br-L	2.48 mg/L	2.5 mg/L	99.2	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549563)</b>										
FJ2402029-002	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	12.8 mg/L	12.5 mg/L	103	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549564)</b>										
FJ2402029-002	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	2.58 mg/L	2.5 mg/L	103	75.0	125	----
<b>Anions and Nutrients (QCLot: 1549565)</b>										
FJ2402029-002	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	ND mg/L	----	ND	75.0	125	----
<b>Anions and Nutrients (QCLot: 1563689)</b>										
VA24B7247-002	WLNG DS 1	Nitrogen, total	7727-37-9	E366	0.422 mg/L	0.4 mg/L	106	70.0	130	----
<b>Anions and Nutrients (QCLot: 1563691)</b>										
VA24B7265-002	Anonymous	Ammonia, total (as N)	7664-41-7	E298	0.102 mg/L	0.1 mg/L	102	75.0	125	----
<b>Organic / Inorganic Carbon (QCLot: 1563688)</b>										
VA24B7247-002	WLNG DS 1	Carbon, dissolved organic [DOC]	----	E358-L	4.56 mg/L	5 mg/L	91.2	70.0	130	----
<b>Total Sulfides (QCLot: 1559690)</b>										
CG2410035-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395	0.232 mg/L	0.2 mg/L	116	75.0	125	----
<b>Total Metals (QCLot: 1550696)</b>										
VA24B7240-002	Anonymous	Aluminum, total	7429-90-5	E420	0.210 mg/L	0.2 mg/L	105	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0212 mg/L	0.02 mg/L	106	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0218 mg/L	0.02 mg/L	109	70.0	130	----
		Barium, total	7440-39-3	E420	ND mg/L	----	ND	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0414 mg/L	0.04 mg/L	103	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.0103 mg/L	0.01 mg/L	103	70.0	130	----
		Boron, total	7440-42-8	E420	0.105 mg/L	0.1 mg/L	105	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00404 mg/L	0.004 mg/L	101	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.0108 mg/L	0.01 mg/L	108	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0419 mg/L	0.04 mg/L	105	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0209 mg/L	0.02 mg/L	104	70.0	130	----
		Copper, total	7440-50-8	E420	ND mg/L	----	ND	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1550696) - continued</b>										
VA24B7240-002	Anonymous	Iron, total	7439-89-6	E420	1.94 mg/L	2 mg/L	97.1	70.0	130	---
		Lead, total	7439-92-1	E420	0.0216 mg/L	0.02 mg/L	108	70.0	130	---
		Lithium, total	7439-93-2	E420	0.0930 mg/L	0.1 mg/L	93.0	70.0	130	---
		Magnesium, total	7439-95-4	E420	ND mg/L	---	ND	70.0	130	---
		Manganese, total	7439-96-5	E420	0.0210 mg/L	0.02 mg/L	105	70.0	130	---
		Molybdenum, total	7439-98-7	E420	0.0223 mg/L	0.02 mg/L	112	70.0	130	---
		Nickel, total	7440-02-0	E420	0.0407 mg/L	0.04 mg/L	102	70.0	130	---
		Phosphorus, total	7723-14-0	E420	11.4 mg/L	10 mg/L	114	70.0	130	---
		Potassium, total	7440-09-7	E420	4.45 mg/L	4 mg/L	111	70.0	130	---
		Rubidium, total	7440-17-7	E420	0.0211 mg/L	0.02 mg/L	106	70.0	130	---
		Selenium, total	7782-49-2	E420	0.0400 mg/L	0.04 mg/L	100	70.0	130	---
		Silicon, total	7440-21-3	E420	9.95 mg/L	10 mg/L	99.5	70.0	130	---
		Silver, total	7440-22-4	E420	0.00437 mg/L	0.004 mg/L	109	70.0	130	---
		Sodium, total	7440-23-5	E420	ND mg/L	---	ND	70.0	130	---
		Strontium, total	7440-24-6	E420	ND mg/L	---	ND	70.0	130	---
		Sulfur, total	7704-34-9	E420	20.8 mg/L	20 mg/L	104	70.0	130	---
		Tellurium, total	13494-80-9	E420	0.0438 mg/L	0.04 mg/L	109	70.0	130	---
		Thallium, total	7440-28-0	E420	0.00408 mg/L	0.004 mg/L	102	70.0	130	---
		Thorium, total	7440-29-1	E420	0.0223 mg/L	0.02 mg/L	112	70.0	130	---
		Tin, total	7440-31-5	E420	0.0212 mg/L	0.02 mg/L	106	70.0	130	---
		Titanium, total	7440-32-6	E420	0.0409 mg/L	0.04 mg/L	102	70.0	130	---
		Tungsten, total	7440-33-7	E420	0.0217 mg/L	0.02 mg/L	109	70.0	130	---
		Uranium, total	7440-61-1	E420	0.00442 mg/L	0.004 mg/L	110	70.0	130	---
		Vanadium, total	7440-62-2	E420	0.107 mg/L	0.1 mg/L	107	70.0	130	---
		Zinc, total	7440-66-6	E420	0.405 mg/L	0.4 mg/L	101	70.0	130	---
		Zirconium, total	7440-67-7	E420	0.0454 mg/L	0.04 mg/L	113	70.0	130	---
<b>Total Metals (QCLot: 1560070)</b>										
VA24B7077-002	Anonymous	Mercury, total	7439-97-6	E508	0.0000955 mg/L	0 mg/L	95.5	70.0	130	---
<b>Dissolved Metals (QCLot: 1554918)</b>										
KS2402801-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.381 mg/L	0.4 mg/L	95.2	70.0	130	---
		Antimony, dissolved	7440-36-0	E421	0.0362 mg/L	0.04 mg/L	90.5	70.0	130	---
		Arsenic, dissolved	7440-38-2	E421	0.0418 mg/L	0.04 mg/L	104	70.0	130	---
		Barium, dissolved	7440-39-3	E421	ND mg/L	---	ND	70.0	130	---
		Beryllium, dissolved	7440-41-7	E421	0.0732 mg/L	0.08 mg/L	91.5	70.0	130	---
		Bismuth, dissolved	7440-69-9	E421	0.0189 mg/L	0.02 mg/L	94.3	70.0	130	---
		Boron, dissolved	7440-42-8	E421	0.175 mg/L	0.2 mg/L	87.7	70.0	130	---
		Cadmium, dissolved	7440-43-9	E421	0.00775 mg/L	0.008 mg/L	96.8	70.0	130	---
		Calcium, dissolved	7440-70-2	E421	ND mg/L	---	ND	70.0	130	---
		Cesium, dissolved	7440-46-2	E421	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	---
		Chromium, dissolved	7440-47-3	E421	0.0780 mg/L	0.08 mg/L	97.5	70.0	130	---
		Cobalt, dissolved	7440-48-4	E421	0.0384 mg/L	0.04 mg/L	95.9	70.0	130	---
		Copper, dissolved	7440-50-8	E421	0.0363 mg/L	0.04 mg/L	90.9	70.0	130	---
		Iron, dissolved	7439-89-6	E421	3.76 mg/L	4 mg/L	94.0	70.0	130	---





Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1554918) - continued</b>										
KS2402801-001	Anonymous	Lead, dissolved	7439-92-1	E421	0.0380 mg/L	0.04 mg/L	94.9	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.182 mg/L	0.2 mg/L	90.9	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	----	ND	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0378 mg/L	0.04 mg/L	94.4	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	ND mg/L	----	ND	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0764 mg/L	0.08 mg/L	95.5	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	19.6 mg/L	20 mg/L	97.8	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	ND mg/L	----	ND	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0378 mg/L	0.04 mg/L	94.4	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0865 mg/L	0.08 mg/L	108	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	19.0 mg/L	20 mg/L	94.8	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00722 mg/L	0.008 mg/L	90.2	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	ND mg/L	----	ND	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	ND mg/L	----	ND	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	ND mg/L	----	ND	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0732 mg/L	0.08 mg/L	91.6	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00757 mg/L	0.008 mg/L	94.6	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0405 mg/L	0.04 mg/L	101	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0375 mg/L	0.04 mg/L	93.8	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0833 mg/L	0.08 mg/L	104	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0392 mg/L	0.04 mg/L	97.9	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00787 mg/L	0.008 mg/L	98.4	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.204 mg/L	0.2 mg/L	102	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.789 mg/L	0.8 mg/L	98.6	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0733 mg/L	0.08 mg/L	91.6	70.0	130	----
<b>Dissolved Metals (QCLot: 1559792)</b>										
FJ2402033-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.000106 mg/L	0 mg/L	106	70.0	130	----
<b>Speciated Metals (QCLot: 1557486)</b>										
VA24B7247-001	WLNG US 1	Chromium, hexavalent [Cr VI], total	18540-29-9	E532	0.0399 mg/L	0.04 mg/L	99.8	70.0	130	----



Chain of Custody (COC) / Analytical Request Form

Affix ALS barcode label here (lab use only)

COC Number: 17 -

Page 1 of 1

Canada Toll Free: 1 800 668 9878

www.alsglobal.com

Contact and company name below will appear on the final report

**Report To**  
Company: Triton Environmental  
Contact: [Redacted]  
Phone: [Redacted]  
Street: [Redacted]  
City/Province: [Redacted]  
Postal Code: [Redacted]

**Report Format / Distribution**  
Select Report Format:  EXCEL  EDD (DIGITAL)  
Quality Control (QC) Report with Report  YES  NO  
 Compare Results to Criteria on Report - provide details below if box checked  
Select Distribution:  EMAIL  MAIL  FAX

**Invoice To**  
Same as Report To  YES  NO  
Copy of Invoice with Report  YES  NO

**Company:**  
Contact: [Redacted]

**Project Information**  
ALC Account # / Quote #: VA23-TRIT100-012  
Job #: 11964  
PO / AFE: 11964 - Task 20 - Phase 3C-4C  
LSD: [Redacted]

**ALS Lab Work Order # (lab use only):** [Redacted]

**ALS Sample # (lab use only)**  
Sample Identification and/or Coordinates (This description will appear on the report)  
W/LNG US 1  
pH: 7.58 cond: 26 µS/cm temp: 17.5°C  
W/LNG DS 1  
pH: 6.95 cond: 53 µS/cm temp: 17.8°C  
Duplicator: [Redacted]  
Field Blank: [Redacted]  
Trip Blank: [Redacted]

**ALS Contact:** [Redacted] **Sampler:** [Redacted]

**Date:** 16-JUL-24 11:09 **Time:** 11:09 **Sample Type:** Water  
**Date:** 16-JUL-24 10:14 **Time:** 10:14 **Sample Type:** Water  
**Date:** [Redacted] **Time:** [Redacted] **Sample Type:** Water  
**Date:** [Redacted] **Time:** [Redacted] **Sample Type:** Water  
**Date:** [Redacted] **Time:** [Redacted] **Sample Type:** Water

**Special Instructions / Specify Criteria to add (electro)**  
Triton project # 11964

**Drinking Water (DW) Samples (client use)**  
Are samples taken from a Regulated DW System?  YES  NO  
Are samples for human consumption/use?  YES  NO

**SHIPMENT RELEASE (client use)**  
Received by: [Redacted] Time: 16 July 24 17:17  
INITIALS: [Redacted]

**SHIPPING INFORMATION**  
Telephone: +1 804 253 4188  
WHITE - LABORATORY COPY YELLOW - CLIENT COPY

**Environmental Division**  
Vancouver  
Work Order Reference  
**VA24B7247**

**Barcode:** [Barcode]

**Sample Analysis Request**

SAMPLERS ON HOLD	Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below													
	F	T	D	T	N	P	P	P	P	F/P				
	R	R	R	R	R	R	R	R	R	R	R	R	R	R
	R	R	R	R	R	R	R	R	R	R	R	R	R	R
	R	R	R	R	R	R	R	R	R	R	R	R	R	R
	R	R	R	R	R	R	R	R	R	R	R	R	R	R
	R	R	R	R	R	R	R	R	R	R	R	R	R	R


**SAMPLE CONDITION AS RECEIVED (lab use only)**  
Frozen  SIF Observations Yes  No   
Ice Packs  Ice Cubes  Custody seal intact Yes  No   
Cooling Initiated

**INITIAL COOLER TEMPERATURES °C:** [Redacted] **FINAL COOLER TEMPERATURES °C:** [Redacted]

**FINAL SHIPMENT RECEPTION (lab use only)**  
Received by: [Redacted] Time: [Redacted]  
Date: [Redacted]

1. If any water samples are taken from a Regulated Drinking Water (DW) system, please submit using an Authorized DW COC form.

By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.

 <b>Eagle Mountain - Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report</b>	Reporting Week	July 15 <sup>th</sup> to July 21 <sup>th</sup> , 2024
	Report #	17
	Appendix D	D-4

## Woodfibre Site Receiving Environment Field Notes and Logs



# FortisBC Eagle Mountain-Woodfibre Gas Pipeline

## Water Discharge Authorization Water Quality Monitoring

2024-7-16-Chycoski-35C4C

<b>Project Component:</b>	Tunnel	<b>Site Name:</b>	Receiving Environment - Downstream of Discharge
<b>Inspection Date:</b>	07/16/2024	<b>Location:</b>	WLNG
<b>Triton QP:</b>	Lily Chycoski	<b>Latitude/Longitude:</b>	49.6683 -123.247958
<b>Temperature(c):</b>	Low 18 High 31	<b>Permit:</b>	PE 110136
<b>Weather Conditions:</b>	Clear	<b>Ground Conditions:</b>	Dry

### Observations

**Time:** 10:14:00      **Flow Volume (visual):** low

**Notes:** Conductivity: 53 micro Siemens per cm

**Odour Detected?:** No      **Notes:**

**Unusual Colour?:** No      **Notes:**

**Unusual Observations?:** No      **Notes:**

**Sheen on Water?:** No      **Notes:**

### Samples Collected - Parameters

<b>Total Metals + Mercury</b>	Yes	<b>General Parameters (Alkalinity)</b>	Yes	<b>Other Sample:</b> Total trivalent chromium and total hexavalent chromium
<b>Dissolved Metals + Mercury</b>	Yes	<b>Total Sulfide, Unionized Sulfide</b>	Yes	
<b>TSS</b>	Yes	<b>Anions</b>	Yes	<b>QA Samples:</b> No Total trivalent chromium and total hexavalent chromium
<b>TDS</b>	Yes	<b>VOC/VPH</b>	No	
<b>Nutrients</b>	Yes	<b>EPH, PAH, LEPH/HEPH</b>	No	
<b>DOC</b>	Yes	<b>Trout LC50</b>	No	

### Logger Maintenance

<b>Logger Maintenance Performed?</b>	Yes	<b>Photo of COC with Lab Signature?</b>	Yes
--------------------------------------	-----	---	-----

**Describe Logger Maintenance**

Removed logger due to lack of water

Photos



**Photo:** 1  
**Location:** EAS DS 1  
**Description:** US view




**Photo:** 2  
**Location:** EAS DS 1  
**Description:** Across view

Photos



**Photo:** 3  
**Location:** EAS DS 1  
**Description:** DS view

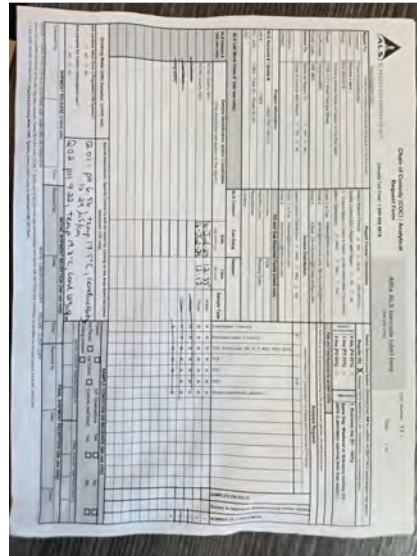

**Photo:** 4  
**Location:** EAS DS 1  
**Description:** Lab COC



2024-7-16-Chycoski-35C4C

**Sign Off**

**Report Prepared By:** Lily Chycoski

**Report Reviewed:**

**Report Reviewer:**

**Professional(s) of Record:**

**Name:**

**Designation:**

**Designation Number:**



# FortisBC Eagle Mountain-Woodfibre Gas Pipeline

## Water Discharge Authorization Water Quality Monitoring

2024-7-16-Chycoski-79058

<b>Project Component:</b>	Tunnel	<b>Site Name:</b>	Receiving Environment - Upstream of Discharge
<b>Inspection Date:</b>	07/16/2024	<b>Location:</b>	WLNG
<b>Triton QP:</b>	Lily Chycoski	<b>Latitude/Longitude:</b>	49.669455 -123.25087
<b>Temperature(c):</b>	Low 18 High 31	<b>Permit:</b>	PE 110136
<b>Weather Conditions:</b>	Clear	<b>Ground Conditions:</b>	Dry

### Observations

**Time:** 11:09:00      **Flow Volume (visual):** low

**Notes:** Conductivity: 26 micro Siemens per cm

**Odour Detected?:** No      **Notes:**

**Unusual Colour?:** No      **Notes:**

**Unusual Observations?:** No      **Notes:**

**Sheen on Water?:** No      **Notes:**

### Samples Collected - Parameters

<b>Total Metals + Mercury</b>	Yes	<b>General Parameters (Alkalinity)</b>	Yes	<b>Other Sample:</b> Total hexavalent chromium and total trivalent chromium
<b>Dissolved Metals + Mercury</b>	Yes	<b>Total Sulfide, Unionized Sulfide</b>	Yes	
<b>TSS</b>	Yes	<b>Anions</b>	Yes	<b>QA Samples:</b> No Total hexavalent chromium and total trivalent chromium
<b>TDS</b>	Yes	<b>VOC/VPH</b>	No	
<b>Nutrients</b>	Yes	<b>EPH, PAH, LEPH/HEPH</b>	No	
<b>DOC</b>	Yes	<b>Trout LC50</b>	No	

### Logger Maintenance

<b>Logger Maintenance Performed?</b>	No	<b>Photo of COC with Lab Signature?</b>	Yes
<b>Describe Logger Maintenance</b>			



Photos



**Photo:** 1  
**Location:** EAS US 1  
**Description:** US view




**Photo:** 2  
**Location:** EAS US 1  
**Description:** Across view

**Photos**



**Photo:** 3  
**Location:** EAS US 1  
**Description:** DS view

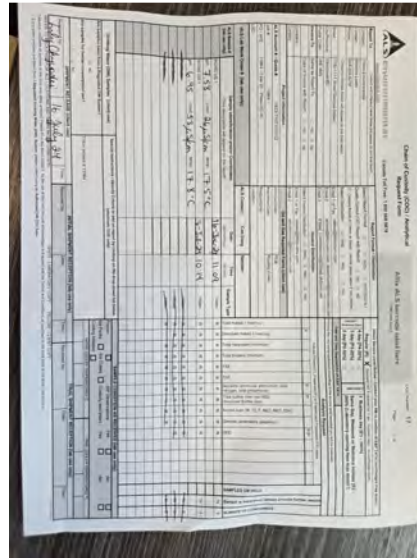

**Photo:** 4  
**Location:** EAS US 1  
**Description:** Lab COC



2024-7-16-Chycoski-79058

**Sign Off**

**Report Prepared By:** Lily Chycoski

**Report Reviewed:**

**Report Reviewer:**

**Professional(s) of Record:**

**Name:**

**Designation:**

**Designation Number:**

## EGP-STU-004 (WLNG DS)

Received	Temperature C	Specific Conductivity $\mu\text{S}/\text{cm}$	Salinity PSU	pH	ORP mV	Dissolved Oxygen Concentration mg/L	Turbidity NTU	Open/Closed
7/15/2024 0:00	17.96	1.25	0	6.56	289.87	8.63	74.23	Closed
7/15/2024 0:10	17.86	1.87	0	6.71	288.06	8.65	68.23	Closed
7/15/2024 0:20	17.71	3.01	0	6.76	288.22	8.69	62.61	Closed
7/15/2024 0:30	17.6	3.68	0	6.99	286.98	8.72	59.7	Closed
7/15/2024 0:40	17.52	3.56	0	7.08	288.1	8.72	39.32	Closed
7/15/2024 0:50	17.47	3.65	0	7.14	288.18	8.73	24.54	Closed
7/15/2024 1:00	17.39	4.28	0	7.01	289.25	8.75	7.05	Closed
7/15/2024 1:10	17.34	4.98	0	7.17	288.92	8.76	1.48	Closed
7/15/2024 1:20	17.26	6.66	0	7.05	290.32	8.78	0	Closed
7/15/2024 1:30	17.18	10.04	0	7.14	290.42	8.79	0	Closed
7/15/2024 1:40	17.12	12.19	0	7.1	291.69	8.79	0	Closed
7/15/2024 1:50	17.08	11.33	0	7.17	290.78	8.8	0	Closed
7/15/2024 2:00	17.04	10.37	0	7.17	291.42	8.81	0	Closed
7/15/2024 2:10	17	10.09	0	7.17	291.55	8.81	0	Closed
7/15/2024 2:20	16.97	10.15	0	7.13	291.91	8.83	0	Closed
7/15/2024 2:30	16.93	11.39	0	7.16	292.4	8.83	0	Closed
7/15/2024 2:40	16.86	23.1	0.01	7.12	294.18	8.85	0	Closed
7/15/2024 2:50	16.78	43.11	0.02	7.1	297.01	8.85	212.43	Closed
7/15/2024 3:00	16.75	39.51	0.02	7.25	298.22	8.85	147.88	Closed
7/15/2024 3:10	16.71	35.45	0.02	7.29	298.59	8.87	83.63	Closed
7/15/2024 3:20	16.66	30.63	0.01	7.12	298.77	8.87	37.21	Closed
7/15/2024 3:30	16.62	25.78	0.01	7.08	299.77	8.88	8.5	Closed
7/15/2024 3:40	16.59	23.36	0.01	7.12	299.37	8.89	2.02	Closed
7/15/2024 3:50	16.57	22.15	0.01	7.11	299.68	8.9	0.67	Closed
7/15/2024 4:00	16.54	21.74	0.01	7.06	300.8	8.9	0.08	Closed
7/15/2024 4:10	16.52	21.65	0.01	7.12	301.08	8.91	0	Closed
7/15/2024 4:20	16.49	21.41	0.01	7.09	302.29	8.91	0	Closed
7/15/2024 4:30	16.46	21.4	0.01	7.05	303.38	8.92	0	Closed
7/15/2024 4:40	16.43	21.39	0.01	7.08	303.93	8.92	0	Closed
7/15/2024 4:50	16.4	21.15	0.01	7.07	304.44	8.94	0	Closed
7/15/2024 5:00	16.37	21.79	0.01	7.05	305.19	8.94	0	Closed
7/15/2024 5:10	16.34	22.04	0.01	7.12	306.06	8.93	0	Closed
7/15/2024 5:20	16.31	23	0.01	7.07	306.47	8.95	0	Closed
7/15/2024 5:30	16.28	23.59	0.01	7.07	307.83	8.95	0	Closed
7/15/2024 5:40	16.25	23.71	0.01	7.06	308.58	8.96	0	Closed
7/15/2024 5:50	16.22	25.37	0.01	7.06	309.34	8.96	0	Closed
7/15/2024 6:00	16.2	26.49	0.01	7.11	310.36	8.97	0	Closed
7/15/2024 6:10	16.16	26.28	0.01	7.05	312.43	8.98	0	Closed
7/15/2024 6:20	16.15	26.86	0.01	6.97	313.17	8.98	0	Closed
7/15/2024 6:30	16.12	27.42	0.01	6.96	314.45	8.99	0	Closed
7/15/2024 6:40	16.1	27.82	0.01	7	314.48	8.99	0	Closed
7/15/2024 6:50	16.08	27.55	0.01	7.03	315.48	9	0	Closed
7/15/2024 7:00	16.06	29.01	0.01	7.03	316.82	9	0	Closed

## EGP-STU-004 (WLNG DS)

7/15/2024 7:10	16.05	29.35	0.01	6.98	317.8	9	0 Closed
7/15/2024 7:20	16.03	29.69	0.01	6.95	320.12	9.01	0 Closed
7/15/2024 7:30	16.02	29.73	0.01	7	320.44	9.01	0 Closed
7/15/2024 7:40	16	29.72	0.01	7.05	320.94	9.01	0 Open
7/15/2024 7:50	16.53	72.92	0.03	7.49	323.54	8.51	0 Open
7/15/2024 8:00	16.76	87.63	0.04	7.55	307.34	8.39	0.02 Open
7/15/2024 8:10	17.48	71.22	0.03	7.48	300.06	8.32	0 Open
7/15/2024 8:20	16.82	42.28	0.02	7.43	317.29	8.84	0 Closed
7/15/2024 8:30	16.52	36.92	0.02	7.39	329.75	8.91	0 Closed
7/15/2024 8:40	16.35	34.6	0.02	7.43	335.35	8.94	0 Closed
7/15/2024 8:50	17.03	80.92	0.04	7.53	339.6	8.45	0.87 Closed
7/15/2024 9:00	18.25	79.45	0.04	7.49	314.9	8.17	0 Closed
7/15/2024 9:10	17.26	41.66	0.02	7.41	324.17	8.74	0 Open
7/15/2024 9:20	17.87	90.73	0.04	7.55	331.67	8.24	2.24 Open
7/15/2024 9:30	18.88	83.75	0.04	7.51	313.16	8	2.81 Open
7/15/2024 9:40	17.76	44.15	0.02	7.35	327.97	8.64	2.83 Open
7/15/2024 9:50	18.79	76.52	0.04	7.49	321.2	8.09	1.2 Open
7/15/2024 10:00	18.47	86.44	0.04	7.54	328.82	8.18	0.21 Open
7/15/2024 10:10	19.13	77.24	0.04	7.5	319.45	8.03	0.18 Open
7/15/2024 10:20	18.65	83.3	0.04	7.53	328.44	8.17	0 Open
7/15/2024 10:30	19.24	74.77	0.03	7.51	320.3	8.04	0 Open
7/15/2024 10:40	18.62	74.7	0.03	7.5	330.93	8.24	0 Open
7/15/2024 10:50	19.56	78.47	0.04	7.52	316.73	7.93	0 Open
7/15/2024 11:00	19.27	89.24	0.04	7.56	323.55	8.02	0 Open
7/15/2024 11:10	19.91	77	0.04	7.52	311.58	7.88	0 Open
7/15/2024 11:20	19.84	90.62	0.04	7.56	317.02	7.9	0 Open
7/15/2024 11:30	20.48	83.32	0.04	7.52	310.59	7.76	0 Open
7/15/2024 11:40	20.05	83.16	0.04	7.56	317.38	7.92	0 Open
7/15/2024 11:50	20.74	82.17	0.04	7.52	298.51	7.71	0 Open
7/15/2024 12:00	19.99	42.12	0.02	6.93	321.72	8.31	0 Closed
7/15/2024 12:10	19.71	29.15	0.01	6.45	323.49	8.34	0 Closed
7/15/2024 12:20	19.61	25.46	0.01	6.44	325.1	8.45	0 Closed
7/15/2024 12:30	19.59	24.07	0.01	6.23	316.65	8.48	0 Closed
7/15/2024 12:40	19.6	22.14	0.01	6.35	296.25	8.49	0 Closed
7/15/2024 12:50	19.67	21.5	0.01	6.31	283.72	8.5	0 Closed
7/15/2024 13:00	19.73	21.92	0.01	6.42	282.46	8.5	0 Closed
7/15/2024 13:10	19.79	22.46	0.01	6.35	272.55	8.47	0 Closed
7/15/2024 13:20	19.88	22.1	0.01	6.32	267.02	8.46	0 Closed
7/15/2024 13:30	19.95	20.53	0.01	6.32	267.51	8.46	0 Closed
7/15/2024 13:40	20.01	15.01	0.01	6.34	273.85	8.42	0 Closed
7/15/2024 13:50	20.08	10.02	0	6.37	276.18	8.36	0 Closed
7/15/2024 14:00	20.19	7.37	0	6.33	275.48	8.31	0 Closed
7/15/2024 14:10	20.28	6.61	0	6.32	278.44	8.3	0 Closed
7/15/2024 14:20	20.37	5.91	0	6.33	283.62	8.27	0 Closed
7/15/2024 14:30	20.44	4.56	0	6.33	288.47	8.26	7.34 Closed
7/15/2024 14:40	20.49	3.73	0	6.27	292.22	8.25	36.96 Closed
7/15/2024 14:50	20.57	3.37	0	6.33	293.63	8.24	70.78 Closed

## EGP-STU-004 (WLNG DS)

7/15/2024 15:00	20.65	2.54	0	6.28	295.95	8.21	83.55	Closed
7/15/2024 15:10	20.78	0.26	0	6.32	296.64	8.16	41.58	Closed
7/15/2024 15:20	20.97	0.06	0	6.29	298.7	8.12	5.69	Closed
7/15/2024 15:30	20.99	0.06	0	6.31	300.45	8.11	2.02	Closed
7/15/2024 15:40	21.03	0.06	0	6.28	301.44	8.11	0.11	Closed
7/15/2024 15:50	21.04	0.06	0	6.35	301.94	8.1	0	Closed
7/15/2024 16:00	21.06	0.06	0	6.32	303.15	8.1	0	Closed
7/15/2024 16:10	21.03	0.06	0	6.38	304.22	8.1	0	Closed
7/15/2024 16:20	21.02	0.06	0	6.33	305.19	8.1	0	Closed
7/15/2024 16:30	21.03	0.06	0	6.33	305.08	8.1	0	Closed
7/15/2024 16:40	21.12	0.06	0	6.32	305.41	8.07	0	Closed
7/15/2024 16:50	21.15	0.06	0	6.4	305.91	8.06	0	Closed
7/15/2024 17:00	21.16	0.06	0	6.35	306.75	8.07	0	Closed
7/15/2024 17:10	21.15	0.06	0	6.38	306.57	8.07	0	Closed
7/15/2024 17:20	21.18	0.06	0	6.41	306.34	8.06	0	Closed
7/15/2024 17:30	21.19	0.06	0	6.44	306.68	8.06	0	Closed
7/15/2024 17:40	21.19	0.06	0	6.42	308.17	8.05	0	Closed
7/15/2024 17:50	21.18	0.06	0	6.36	308.29	8.05	0	Closed
7/15/2024 18:00	21.13	0.06	0	6.38	308.61	8.05	0	Closed
7/15/2024 18:10	21.07	0.06	0	6.35	309.41	8.08	0	Closed
7/15/2024 18:20	21.04	0.06	0	6.48	307.78	8.07	0	Closed
7/15/2024 18:30	20.96	0.06	0	6.47	308.79	8.09	0	Closed
7/15/2024 18:40	20.89	0.06	0	6.47	310	8.1	0	Closed
7/15/2024 18:50	20.88	0.06	0	6.43	309.59	8.09	0	Closed
7/15/2024 19:00	20.78	0.06	0	6.42	311.2	8.12	0	Closed
7/15/2024 19:10	20.7	0.06	0	6.44	311.71	8.13	0	Closed
7/15/2024 19:20	20.65	0.06	0	6.41	311.93	8.14	0	Closed
7/15/2024 19:30	20.55	0.06	0	6.41	312.5	8.15	0	Closed
7/15/2024 19:40	20.46	0.06	0	6.41	312.48	8.17	0	Closed
7/15/2024 19:50	20.38	0.06	0	6.5	312.29	8.18	0	Closed
7/15/2024 20:00	20.24	0.06	0	6.48	315.01	8.21	0	Closed
7/15/2024 20:10	20.18	0.06	0	6.51	313.61	8.22	0	Open
7/15/2024 20:20	20.11	0.06	0	6.47	313.17	8.22	0	Open
7/15/2024 20:30	21.49	108.65	0.05	7.58	293.91	7.4	0	Open
7/15/2024 20:40	20.61	0.06	0	6.96	297.83	8.12	0	Open
7/15/2024 20:50	20.33	0.06	0	6.88	304.05	8.19	0	Open
7/15/2024 21:00	20.18	0.06	0	6.59	308.11	8.21	0	Open
7/15/2024 21:10	20.01	0.06	0	6.64	312.02	8.24	0	Open
7/15/2024 21:20	19.87	0.06	0	6.71	313.75	8.26	0	Open
7/15/2024 21:30	19.62	143.11	0.07	7.6	321.32	7.59	0.22	Open
7/15/2024 21:40	20.55	122.03	0.06	7.5	287.02	7.43	0	Open
7/15/2024 21:50	19.84	109	0.05	7.53	307.06	7.74	0	Open
7/15/2024 22:00	20.55	123.66	0.06	7.53	300.74	7.39	0	Open
7/15/2024 22:10	20.06	0.06	0	7.38	303.39	8.23	4.29	Closed
7/15/2024 22:20	19.71	0.06	0	7.32	310.12	8.3	0	Closed
7/15/2024 22:30	19.46	0.06	0	7.21	313.47	8.35	0	Closed
7/15/2024 22:40	19.28	0.06	0	6.92	317.74	8.38	0	Closed

## EGP-STU-004 (WLNG DS)

7/15/2024 22:50	19.09	0.06	0	6.84	319.55	8.41	0 Closed
7/15/2024 23:00	18.9	0.06	0	6.87	320.87	8.43	0 Closed
7/15/2024 23:10	18.73	0.06	0	7.04	321.37	8.47	0 Closed
7/15/2024 23:20	18.59	0.06	0	7.09	322.84	8.52	0 Closed
7/15/2024 23:30	18.46	0.06	0	7.04	323.2	8.53	0 Closed
7/15/2024 23:40	18.45	106.44	0.05	7.59	330.12	7.95	0 Closed
7/15/2024 23:50	19.34	108.42	0.05	7.57	298.31	7.77	0 Closed
7/16/2024 0:00	18.69	8.92	0	7.43	308.21	8.49	14.93 Closed
7/16/2024 0:10	18.48	0.06	0	7.05	312.89	8.53	11.38 Closed
7/16/2024 0:20	18.32	0.06	0	7.13	316.8	8.57	0 Closed
7/16/2024 0:30	18.17	0.06	0	7.12	318.85	8.59	0 Closed
7/16/2024 0:40	18.04	0.06	0	7.09	322.28	8.61	0 Closed
7/16/2024 0:50	17.91	0.06	0	7.14	321.36	8.64	1.23 Closed
7/16/2024 1:00	17.38	24.76	0.01	7.15	324.99	8.77	0 Closed
7/16/2024 1:10	18.24	116.57	0.05	7.64	333.23	7.89	0 Closed
7/16/2024 1:20	18.88	104.47	0.05	7.56	305.66	7.91	0 Closed
7/16/2024 1:30	18.18	13.39	0	7.46	308.53	8.6	0.42 Closed
7/16/2024 1:40	17.88	5.66	0	7.41	314.08	8.65	76.65 Closed
7/16/2024 1:50	17.69	3.01	0	7.41	315.21	8.68	82.92 Closed
7/16/2024 2:00	17.58	1.56	0	7.41	320.84	8.7	66.88 Open
7/16/2024 2:10	17.93	106.92	0.05	7.63	334.2	8.08	0.12 Open
7/16/2024 2:20	18.62	103.56	0.05	7.58	309.09	7.97	0 Open
7/16/2024 2:30	18.45	107.44	0.05	7.62	317.28	7.96	0 Open
7/16/2024 2:40	18.8	106.57	0.05	7.57	310.78	7.92	0 Open
7/16/2024 2:50	18.52	111.43	0.05	7.64	317.47	7.95	0 Open
7/16/2024 3:00	18.54	81.55	0.04	7.59	314.36	8.41	0 Open
7/16/2024 3:10	18.03	13.64	0.01	7.56	313.84	8.62	0 Closed
7/16/2024 3:20	17.7	8.21	0	7.43	318.47	8.68	4.58 Closed
7/16/2024 3:30	17.47	5.67	0	7.29	320.7	8.73	14.9 Closed
7/16/2024 3:40	17.29	6.39	0	7.33	323.49	8.76	10.61 Closed
7/16/2024 3:50	17.16	6.54	0	7.21	325.66	8.78	3.16 Open
7/16/2024 4:00	17.05	6.7	0	7.46	328.83	8.8	0 Open
7/16/2024 4:10	16.78	28.53	0.01	7.38	332.29	8.87	0.56 Open
7/16/2024 4:20	17.91	94.55	0.04	7.59	309.69	8.12	0 Open
7/16/2024 4:30	17.41	33.47	0.01	7.6	314.77	8.73	0 Closed
7/16/2024 4:40	17.13	20.27	0.01	7.47	321.02	8.79	0 Closed
7/16/2024 4:50	16.95	17.51	0.01	7.49	322.08	8.83	0 Closed
7/16/2024 5:00	16.8	19.47	0.01	7.46	327.93	8.85	0 Closed
7/16/2024 5:10	16.7	21.16	0.01	7.49	328.81	8.88	0 Closed
7/16/2024 5:20	16.62	23.75	0.01	7.5	333.17	8.88	0 Closed
7/16/2024 5:30	16.55	23.87	0.01	7.51	333.31	8.89	0 Closed
7/16/2024 5:40	16.48	24.09	0.01	7.53	338.2	8.91	0 Closed
7/16/2024 5:50	16.43	23.43	0.01	7.53	337.56	8.92	0 Closed
7/16/2024 6:00	16.37	21.97	0.01	7.52	339.46	8.93	0 Closed
7/16/2024 6:10	16.33	21.81	0.01	7.5	339.76	8.94	0 Closed
7/16/2024 6:20	16.29	21.57	0.01	7.46	342.1	8.94	0 Closed
7/16/2024 6:30	16.25	22.14	0.01	7.43	341.59	8.95	0 Closed





7/16/2024 14:20  
7/16/2024 14:30  
7/16/2024 14:40  
7/16/2024 14:50  
7/16/2024 15:00  
7/16/2024 15:10  
7/16/2024 15:20  
7/16/2024 15:30  
7/16/2024 15:40  
7/16/2024 15:50  
7/16/2024 16:00  
7/16/2024 16:10  
7/16/2024 16:20  
7/16/2024 16:30  
7/16/2024 16:40  
7/16/2024 16:50  
7/16/2024 17:00  
7/16/2024 17:10  
7/16/2024 17:20  
7/16/2024 17:30  
7/16/2024 17:40  
7/16/2024 17:50  
7/16/2024 18:00  
7/16/2024 18:10  
7/16/2024 18:20  
7/16/2024 18:30  
7/16/2024 18:40  
7/16/2024 18:50  
7/16/2024 19:00  
7/16/2024 19:10  
7/16/2024 19:20  
7/16/2024 19:30  
7/16/2024 19:40  
7/16/2024 19:50  
7/16/2024 20:00  
7/16/2024 20:10  
7/16/2024 20:20  
7/16/2024 20:30  
7/16/2024 20:40  
7/16/2024 20:50  
7/16/2024 21:00  
7/16/2024 21:10  
7/16/2024 21:20  
7/16/2024 21:30  
7/16/2024 21:40  
7/16/2024 21:50  
7/16/2024 22:00

7/16/2024 22:10  
7/16/2024 22:20  
7/16/2024 22:30  
7/16/2024 22:40  
7/16/2024 22:50  
7/16/2024 23:00  
7/16/2024 23:10  
7/16/2024 23:20  
7/16/2024 23:30  
7/16/2024 23:40  
7/16/2024 23:50  
7/17/2024 0:00  
7/17/2024 0:10  
7/17/2024 0:20  
7/17/2024 0:30  
7/17/2024 0:40  
7/17/2024 0:50  
7/17/2024 1:00  
7/17/2024 1:10  
7/17/2024 1:20  
7/17/2024 1:30  
7/17/2024 1:40  
7/17/2024 1:50  
7/17/2024 2:00  
7/17/2024 2:10  
7/17/2024 2:20  
7/17/2024 2:30  
7/17/2024 2:40  
7/17/2024 2:50  
7/17/2024 3:00  
7/17/2024 3:10  
7/17/2024 3:20  
7/17/2024 3:30  
7/17/2024 3:40  
7/17/2024 3:50  
7/17/2024 4:00  
7/17/2024 4:10  
7/17/2024 4:20  
7/17/2024 4:30  
7/17/2024 4:40  
7/17/2024 4:50  
7/17/2024 5:00  
7/17/2024 5:10  
7/17/2024 5:20  
7/17/2024 5:30  
7/17/2024 5:40  
7/17/2024 5:50

EGP-STU-004 (WLNG DS)

7/17/2024 6:00  
7/17/2024 6:10  
7/17/2024 6:20  
7/17/2024 6:30  
7/17/2024 6:40  
7/17/2024 6:50  
7/17/2024 7:00  
7/17/2024 7:10  
7/17/2024 7:20  
7/17/2024 7:30  
7/17/2024 7:40  
7/17/2024 7:50  
7/17/2024 8:00  
7/17/2024 8:10  
7/17/2024 8:20  
7/17/2024 8:30  
7/17/2024 8:40  
7/17/2024 8:50  
7/17/2024 9:00  
7/17/2024 9:10  
7/17/2024 9:20  
7/17/2024 9:30  
7/17/2024 9:40  
7/17/2024 9:50  
7/17/2024 10:00  
7/17/2024 10:10  
7/17/2024 10:20  
7/17/2024 10:30  
7/17/2024 10:40  
7/17/2024 10:50  
7/17/2024 11:00  
7/17/2024 11:10  
7/17/2024 11:20  
7/17/2024 11:30  
7/17/2024 11:40  
7/17/2024 11:50  
7/17/2024 12:00  
7/17/2024 12:10  
7/17/2024 12:20  
7/17/2024 12:30  
7/17/2024 12:40  
7/17/2024 12:50  
7/17/2024 13:00  
7/17/2024 13:10  
7/17/2024 13:20  
7/17/2024 13:30  
7/17/2024 13:40

EGP-STU-004 (WLNG DS)

7/17/2024 13:50  
7/17/2024 14:00  
7/17/2024 14:10  
7/17/2024 14:20  
7/17/2024 14:30  
7/17/2024 14:30  
7/17/2024 14:40  
7/17/2024 14:50  
7/17/2024 15:00  
7/17/2024 15:10  
7/17/2024 15:20  
7/17/2024 15:30  
7/17/2024 15:40  
7/17/2024 15:50  
7/17/2024 16:00  
7/17/2024 16:10  
7/17/2024 16:20  
7/17/2024 16:30  
7/17/2024 16:40  
7/17/2024 16:50  
7/17/2024 17:00  
7/17/2024 17:10  
7/17/2024 17:20  
7/17/2024 17:30  
7/17/2024 17:40  
7/17/2024 17:50  
7/17/2024 18:00  
7/17/2024 18:10  
7/17/2024 18:20  
7/17/2024 18:30  
7/17/2024 18:40  
7/17/2024 18:50  
7/17/2024 19:00  
7/17/2024 19:10  
7/17/2024 19:20  
7/17/2024 19:30  
7/17/2024 19:40  
7/17/2024 19:50  
7/17/2024 20:00  
7/17/2024 20:10  
7/17/2024 20:20  
7/17/2024 20:30  
7/17/2024 20:40  
7/17/2024 20:50  
7/17/2024 21:00  
7/17/2024 21:10  
7/17/2024 21:20

EGP-STU-004 (WLNG DS)

7/17/2024 21:30

7/17/2024 21:40

7/17/2024 21:50

7/17/2024 22:00

7/17/2024 22:10

7/17/2024 22:20

7/17/2024 22:30

7/17/2024 22:40

7/17/2024 22:50

7/17/2024 23:00

7/17/2024 23:10

7/17/2024 23:20

7/17/2024 23:30

7/17/2024 23:40

7/17/2024 23:50

## EGP-STU-003 (WLNG US)

Received	Temperature C	Specific Conductivity $\mu\text{S}/\text{cm}$	Salinity PSU	pH	ORP mV	Dissolved Oxygen Concentration mg/L	Turbidity NTU	Open/Closed
7/15/2024 0:00	16.41	21.14	0.01	7.11	286.42	8.64	0.66	Closed
7/15/2024 0:10	16.38	21.2	0.01	7.16	285.04	8.66	0.6	Closed
7/15/2024 0:20	16.36	21.14	0.01	7.12	287.69	8.66	0.58	Closed
7/15/2024 0:30	16.32	21.16	0.01	7.13	287.45	8.67	0.56	Closed
7/15/2024 0:40	16.3	21.15	0.01	7.11	287.03	8.68	0.62	Closed
7/15/2024 0:50	16.27	21.15	0.01	7.17	285.37	8.68	0.57	Closed
7/15/2024 1:00	16.25	21.11	0.01	7.13	286.78	8.69	0.58	Closed
7/15/2024 1:10	16.22	21.13	0.01	7.11	289.53	8.68	0.6	Closed
7/15/2024 1:20	16.19	21.1	0.01	7.11	289.18	8.7	0.59	Closed
7/15/2024 1:30	16.17	21.01	0.01	7.1	289.67	8.71	0.59	Closed
7/15/2024 1:40	16.14	21.1	0.01	7.13	288.25	8.71	0.57	Closed
7/15/2024 1:50	16.11	21.07	0.01	7.14	288.68	8.69	0.59	Closed
7/15/2024 2:00	16.09	21.2	0.01	7.1	288.78	8.71	0.57	Closed
7/15/2024 2:10	16.07	21.09	0.01	7.15	288.54	8.72	0.55	Closed
7/15/2024 2:20	16.04	21.16	0.01	7.11	289.74	8.72	0.58	Closed
7/15/2024 2:30	16.02	21.12	0.01	7.16	289.04	8.74	2.14	Closed
7/15/2024 2:40	16	21.13	0.01	7.11	289.51	8.73	0.57	Closed
7/15/2024 2:50	15.97	21.03	0.01	7.14	290.34	8.74	0.66	Closed
7/15/2024 3:00	15.95	21.13	0.01	7.16	289.39	8.74	0.59	Closed
7/15/2024 3:10	15.92	21.08	0.01	7.15	290.65	8.75	0.53	Closed
7/15/2024 3:20	15.9	21.1	0.01	7.15	290.12	8.75	0.57	Closed
7/15/2024 3:30	15.88	21.05	0.01	7.16	289.64	8.75	0.56	Closed
7/15/2024 3:40	15.86	21	0.01	7.12	289.78	8.76	0.58	Closed
7/15/2024 3:50	15.83	20.86	0.01	7.14	289.71	8.78	0.54	Closed
7/15/2024 4:00	15.81	21.04	0.01	7.11	290.08	8.77	0.56	Closed
7/15/2024 4:10	15.79	20.93	0.01	7.11	292.47	8.78	0.55	Closed
7/15/2024 4:20	15.77	21.08	0.01	7.12	290.47	8.79	0.55	Closed
7/15/2024 4:30	15.75	20.82	0.01	7.18	288.31	8.8	0.54	Closed
7/15/2024 4:40	15.73	20.88	0.01	7.12	290.05	8.79	0.64	Closed
7/15/2024 4:50	15.7	20.71	0.01	7.12	291.82	8.8	0.51	Closed
7/15/2024 5:00	15.69	20.85	0.01	7.12	291.08	8.8	0.55	Closed
7/15/2024 5:10	15.67	20.77	0.01	7.14	291.18	8.8	0.51	Closed
7/15/2024 5:20	15.64	20.91	0.01	7.12	290.37	8.82	0.53	Closed
7/15/2024 5:30	15.62	20.74	0.01	7.17	290.23	8.82	0.55	Closed
7/15/2024 5:40	15.6	20.87	0.01	7.13	291.5	8.83	0.52	Closed
7/15/2024 5:50	15.58	20.74	0.01	7.18	290.43	8.85	0.53	Closed
7/15/2024 6:00	15.57	20.79	0.01	7.13	291.76	8.85	0.54	Closed
7/15/2024 6:10	15.54	20.57	0.01	7.15	292.5	8.85	0.52	Closed
7/15/2024 6:20	15.53	20.78	0.01	7.13	292.46	8.86	0.55	Closed
7/15/2024 6:30	15.52	20.73	0.01	7.16	293.64	8.87	0.49	Closed
7/15/2024 6:40	15.5	20.78	0.01	7.13	292.47	8.88	0.5	Closed
7/15/2024 6:50	15.49	20.58	0.01	7.18	290.66	8.87	0.53	Closed
7/15/2024 7:00	15.48	20.59	0.01	7.13	292.79	8.87	0.53	Closed

## EGP-STU-003 (WLNG US)

7/15/2024 7:10	15.48	20.56	0.01	7.13	293.44	8.9	0.51	Closed
7/15/2024 7:20	15.47	20.59	0.01	7.14	292.39	8.9	0.52	Closed
7/15/2024 7:30	15.47	20.67	0.01	7.14	293.87	8.9	0.53	Closed
7/15/2024 7:40	15.47	20.6	0.01	7.13	293.39	8.9	0.56	Open
7/15/2024 7:50	15.47	20.53	0.01	7.16	293.4	8.9	0.53	Open
7/15/2024 8:00	15.47	20.47	0.01	7.13	293.68	8.91	0.54	Open
7/15/2024 8:10	15.48	20.39	0.01	7.19	291.78	8.92	0.51	Open
7/15/2024 8:20	15.49	20.5	0.01	7.15	292.69	8.92	0.52	Closed
7/15/2024 8:30	15.5	20.35	0.01	7.19	292.28	8.93	0.5	Closed
7/15/2024 8:40	15.53	20.49	0.01	7.17	292.09	8.93	0.54	Closed
7/15/2024 8:50	15.56	20.34	0.01	7.2	291.52	8.94	0.51	Closed
7/15/2024 9:00	15.58	20.43	0.01	7.17	290.56	8.93	0.53	Closed
7/15/2024 9:10	15.63	20.37	0.01	7.22	289.8	8.93	0.54	Open
7/15/2024 9:20	15.66	20.34	0.01	7.18	290.72	8.92	0.54	Open
7/15/2024 9:30	15.68	20.28	0.01	7.22	290.19	8.95	0.52	Open
7/15/2024 9:40	15.69	20.35	0.01	7.2	290.54	8.94	0.6	Open
7/15/2024 9:50	15.71	20.22	0.01	7.2	290.97	8.93	0.49	Open
7/15/2024 10:00	15.73	20.39	0.01	7.2	290.73	8.93	0.51	Open
7/15/2024 10:10	15.76	20.29	0.01	7.27	287.16	8.94	0.54	Open
7/15/2024 10:20	15.8	20.31	0.01	7.21	289.42	8.92	0.51	Open
7/15/2024 10:30	15.86	20.25	0.01	7.22	290.89	8.95	0.54	Open
7/15/2024 10:40	15.94	20.21	0.01	7.23	288.38	8.96	0.56	Open
7/15/2024 10:50	16.05	20.14	0.01	7.28	287.42	8.93	0.52	Open
7/15/2024 11:00	16.18	20.23	0.01	7.24	288.12	8.92	0.57	Open
7/15/2024 11:10	16.28	20.2	0.01	7.28	287.4	8.9	0.56	Open
7/15/2024 11:20	16.34	20.16	0.01	7.24	287.01	8.92	0.57	Open
7/15/2024 11:30	16.4	20.07	0.01	7.29	287.26	8.93	0.57	Open
7/15/2024 11:40	16.5	20.24	0.01	7.26	288.49	8.93	0.58	Open
7/15/2024 11:50	16.59	19.97	0.01	7.28	287.55	8.92	0.56	Open
7/15/2024 12:00	16.65	20.09	0.01	7.27	285.44	8.9	0.59	Closed
7/15/2024 12:10	16.7	20.03	0.01	7.29	287.02	8.88	0.58	Closed
7/15/2024 12:20	16.71	20.09	0.01	7.27	287.48	8.88	0.59	Closed
7/15/2024 12:30	16.71	19.68	0.01	7.3	285.4	8.87	0.55	Closed
7/15/2024 12:40	16.73	20	0.01	7.27	284.94	8.86	0.57	Closed
7/15/2024 12:50	16.73	19.93	0.01	7.3	283.9	8.85	0.58	Closed
7/15/2024 13:00	16.75	20.04	0.01	7.26	285.42	8.84	0.57	Closed
7/15/2024 13:10	16.78	20.03	0.01	7.3	283.45	8.8	0.57	Closed
7/15/2024 13:20	16.82	19.98	0.01	7.26	285.14	8.81	0.59	Closed
7/15/2024 13:30	16.87	19.94	0.01	7.32	282.15	8.79	0.56	Closed
7/15/2024 13:40	16.9	20.06	0.01	7.26	284.59	8.77	0.6	Closed
7/15/2024 13:50	16.94	20	0.01	7.31	283.4	8.76	0.6	Closed
7/15/2024 14:00	16.96	20.07	0.01	7.25	285.33	8.72	0.61	Closed
7/15/2024 14:10	17	20.12	0.01	7.25	285.02	8.72	0.6	Closed
7/15/2024 14:20	17.01	20.07	0.01	7.24	284.96	8.68	0.59	Closed
7/15/2024 14:30	17.06	19.87	0.01	7.3	281.6	8.68	0.6	Closed
7/15/2024 14:40	17.1	20.02	0.01	7.24	284.41	8.67	0.62	Closed
7/15/2024 14:50	17.14	20.09	0.01	7.26	284.99	8.68	0.59	Closed

## EGP-STU-003 (WLNG US)

7/15/2024 15:00	17.17	20.1	0.01	7.24	285.1	8.66	0.63	Closed
7/15/2024 15:10	17.2	20.03	0.01	7.29	284.95	8.65	0.59	Closed
7/15/2024 15:20	17.21	20.08	0.01	7.24	287.04	8.66	0.62	Closed
7/15/2024 15:30	17.25	20.12	0.01	7.25	286.71	8.67	0.66	Closed
7/15/2024 15:40	17.3	20.19	0.01	7.23	286.32	8.63	0.62	Closed
7/15/2024 15:50	17.3	20.15	0.01	7.25	287.12	8.64	0.67	Closed
7/15/2024 16:00	17.34	20.14	0.01	7.23	285.3	8.62	0.62	Closed
7/15/2024 16:10	17.34	20.1	0.01	7.24	287.82	8.62	0.62	Closed
7/15/2024 16:20	17.36	20.21	0.01	7.24	286.93	8.61	0.63	Closed
7/15/2024 16:30	17.39	20.15	0.01	7.27	286.34	8.57	0.66	Closed
7/15/2024 16:40	17.41	20.28	0.01	7.2	288.21	8.55	0.6	Closed
7/15/2024 16:50	17.4	20.33	0.01	7.26	286.69	8.55	0.6	Closed
7/15/2024 17:00	17.4	20.21	0.01	7.2	288.67	8.55	0.64	Closed
7/15/2024 17:10	17.39	20.42	0.01	7.2	290.64	8.54	0.61	Closed
7/15/2024 17:20	17.38	20.47	0.01	7.2	288.87	8.53	0.6	Closed
7/15/2024 17:30	17.37	20.37	0.01	7.21	290.28	8.54	0.64	Closed
7/15/2024 17:40	17.36	20.45	0.01	7.19	289.56	8.53	0.63	Closed
7/15/2024 17:50	17.34	20.13	0.01	7.24	287.84	8.52	0.6	Closed
7/15/2024 18:00	17.34	20.45	0.01	7.19	289.96	8.52	0.62	Closed
7/15/2024 18:10	17.32	20.43	0.01	7.2	291.45	8.53	0.62	Closed
7/15/2024 18:20	17.29	20.63	0.01	7.16	292.05	8.53	0.65	Closed
7/15/2024 18:30	17.26	20.51	0.01	7.21	290.07	8.52	0.6	Closed
7/15/2024 18:40	17.24	20.49	0.01	7.15	292.58	8.53	0.61	Closed
7/15/2024 18:50	17.21	20.57	0.01	7.18	291.85	8.52	0.6	Closed
7/15/2024 19:00	17.19	20.65	0.01	7.13	293.46	8.52	0.6	Closed
7/15/2024 19:10	17.16	20.67	0.01	7.14	293.85	8.51	0.59	Closed
7/15/2024 19:20	17.14	20.63	0.01	7.12	293.2	8.52	0.6	Closed
7/15/2024 19:30	17.11	20.79	0.01	7.13	293.78	8.53	0.62	Closed
7/15/2024 19:40	17.08	20.94	0.01	7.12	292.35	8.53	0.65	Closed
7/15/2024 19:50	17.06	20.75	0.01	7.12	294.07	8.53	0.58	Closed
7/15/2024 20:00	17.03	20.79	0.01	7.12	292.42	8.56	0.6	Closed
7/15/2024 20:10	17	20.83	0.01	7.14	291.6	8.54	0.59	Open
7/15/2024 20:20	16.97	20.85	0.01	7.11	292.59	8.58	0.59	Open
7/15/2024 20:30	16.93	20.91	0.01	7.16	290.28	8.56	0.58	Open
7/15/2024 20:40	16.9	20.9	0.01	7.11	291.56	8.57	0.59	Open
7/15/2024 20:50	16.87	20.96	0.01	7.17	289.96	8.55	0.66	Open
7/15/2024 21:00	16.84	21.11	0.01	7.11	291.31	8.56	0.58	Open
7/15/2024 21:10	16.81	21.05	0.01	7.12	293.26	8.56	0.57	Open
7/15/2024 21:20	16.78	21.08	0.01	7.11	291.59	8.57	0.57	Open
7/15/2024 21:30	16.75	21	0.01	7.18	289.16	8.58	0.54	Open
7/15/2024 21:40	16.72	21.14	0.01	7.09	292.21	8.58	0.57	Open
7/15/2024 21:50	16.69	21.07	0.01	7.15	290.94	8.59	0.55	Open
7/15/2024 22:00	16.66	21.16	0.01	7.1	292.11	8.59	0.57	Open
7/15/2024 22:10	16.63	21.1	0.01	7.13	292.42	8.6	0.57	Closed
7/15/2024 22:20	16.6	21.1	0.01	7.13	291.48	8.61	0.58	Closed
7/15/2024 22:30	16.57	21.19	0.01	7.13	292.2	8.59	0.54	Closed
7/15/2024 22:40	16.55	21.06	0.01	7.12	292.2	8.62	0.57	Closed



## EGP-STU-003 (WLNG US)

7/15/2024 22:50	16.52	21.08	0.01	7.15	289.36	8.65	0.59	Closed
7/15/2024 23:00	16.49	21.2	0.01	7.11	291.04	8.63	0.56	Closed
7/15/2024 23:10	16.47	20.95	0.01	7.16	288.42	8.63	0.58	Closed
7/15/2024 23:20	16.44	21.07	0.01	7.11	290.52	8.64	0.6	Closed
7/15/2024 23:30	16.41	21.02	0.01	7.1	292.34	8.65	0.53	Closed
7/15/2024 23:40	16.39	21.09	0.01	7.11	290.45	8.65	0.55	Closed
7/15/2024 23:50	16.36	21	0.01	7.18	287.28	8.65	0.52	Closed
7/16/2024 0:00	16.34	21.07	0.01	7.11	290.94	8.66	0.52	Closed
7/16/2024 0:10	16.31	20.94	0.01	7.2	286.25	8.66	0.54	Closed
7/16/2024 0:20	16.29	20.91	0.01	7.11	290.86	8.69	1.53	Closed
7/16/2024 0:30	16.27	20.96	0.01	7.12	293.51	8.66	0.53	Closed
7/16/2024 0:40	16.25	21.02	0.01	7.12	290.78	8.68	0.56	Closed
7/16/2024 0:50	16.22	20.79	0.01	7.12	292.96	8.69	0.54	Closed
7/16/2024 1:00	16.2	20.97	0.01	7.12	290.88	8.68	0.53	Closed
7/16/2024 1:10	16.18	20.63	0.01	7.13	291.69	8.7	0.53	Closed
7/16/2024 1:20	16.16	21.04	0.01	7.11	292.98	8.7	0.52	Closed
7/16/2024 1:30	16.13	20.77	0.01	7.16	289.33	8.71	0.52	Closed
7/16/2024 1:40	16.12	20.97	0.01	7.11	290.98	8.72	0.52	Closed
7/16/2024 1:50	16.09	20.89	0.01	7.12	291.99	8.72	0.54	Closed
7/16/2024 2:00	16.07	20.98	0.01	7.11	291.85	8.71	0.56	Open
7/16/2024 2:10	16.05	20.66	0.01	7.13	292.05	8.72	0.61	Open
7/16/2024 2:20	16.03	20.95	0.01	7.12	291.84	8.73	0.54	Open
7/16/2024 2:30	16.01	20.86	0.01	7.16	290.92	8.71	0.74	Open
7/16/2024 2:40	15.99	20.83	0.01	7.11	293.84	8.74	0.53	Open
7/16/2024 2:50	15.97	20.73	0.01	7.15	294	8.74	0.54	Open
7/16/2024 3:00	15.95	20.84	0.01	7.12	294.18	8.74	0.66	Open
7/16/2024 3:10	15.92	20.68	0.01	7.13	295.04	8.74	0.52	Closed
7/16/2024 3:20	15.9	20.85	0.01	7.12	295.31	8.77	1.04	Closed
7/16/2024 3:30	15.88	20.8	0.01	7.13	294.87	8.76	0.5	Closed
7/16/2024 3:40	15.87	20.74	0.01	7.12	296.15	8.77	0.52	Closed
7/16/2024 3:50	15.84	20.52	0.01	7.12	298.72	8.77	0.52	Open
7/16/2024 4:00	15.82	20.69	0.01	7.12	297.25	8.78	0.53	Open
7/16/2024 4:10	15.8	20.75	0.01	7.1	299.86	8.78	0.51	Open
7/16/2024 4:20	15.79	20.78	0.01	7.1	299.17	8.76	0.51	Open
7/16/2024 4:30	15.77	20.63	0.01	7.12	298.73	8.78	0.52	Closed
7/16/2024 4:40	15.75	20.75	0.01	7.11	298.87	8.77	0.54	Closed
7/16/2024 4:50	15.73	20.66	0.01	7.12	298.09	8.79	0.51	Closed
7/16/2024 5:00	15.72	20.72	0.01	7.11	297.45	8.79	0.52	Closed
7/16/2024 5:10	15.69	20.47	0.01	7.14	294.71	8.8	0.53	Closed
7/16/2024 5:20	15.67	20.65	0.01	7.13	296.49	8.8	0.56	Closed
7/16/2024 5:30	15.65	20.56	0.01	7.18	295.34	8.81	0.51	Closed
7/16/2024 5:40	15.63	20.64	0.01	7.12	297.64	8.81	0.51	Closed
7/16/2024 5:50	15.61	20.43	0.01	7.13	296.61	8.83	0.56	Closed
7/16/2024 6:00	15.59	20.52	0.01	7.13	295.19	8.82	0.49	Closed
7/16/2024 6:10	15.56	20.35	0.01	7.15	295.83	8.85	0.52	Closed
7/16/2024 6:20	15.55	20.42	0.01	7.13	295.79	8.83	0.52	Closed
7/16/2024 6:30	15.53	20.46	0.01	7.14	296.38	8.84	0.56	Closed

## EGP-STU-003 (WLNG US)

7/16/2024 6:40	15.52	20.5	0.01	7.12	296.17	8.85	0.54	Closed
7/16/2024 6:50	15.51	20.47	0.01	7.12	295.74	8.85	0.52	Closed
7/16/2024 7:00	15.5	20.49	0.01	7.13	292.97	8.85	0.55	Closed
7/16/2024 7:10	15.5	20.35	0.01	7.13	294.35	8.87	1.61	Closed
7/16/2024 7:10	15.5	20.35	0.01	7.13	294.35	8.87	1.61	Closed
7/16/2024 7:20	15.49	20.43	0.01	7.14	292.32	8.88	0.53	Closed
7/16/2024 7:30	15.48	20.35	0.01	7.16	293.67	8.86	0.53	Closed
7/16/2024 7:40	15.48	20.28	0.01	7.14	291.93	8.88	0.53	Closed
7/16/2024 7:50	15.48	20.38	0.01	7.17	292.47	8.89	0.51	Closed
7/16/2024 8:00	15.49	20.34	0.01	7.14	291.7	8.9	0.84	Closed
7/16/2024 8:10	15.49	20.36	0.01	7.19	291.67	8.89	0.51	Closed
7/16/2024 8:20	15.5	20.29	0.01	7.12	293.76	8.89	0.52	Closed
7/16/2024 8:30	15.52	20.22	0.01	7.15	293.72	8.9	0.5	Closed
7/16/2024 8:40	15.54	20.39	0.01	7.14	292.69	8.89	0.5	Closed
7/16/2024 8:50	15.56	20.28	0.01	7.12	298.31	8.89	0.5	Closed
7/16/2024 9:00	15.6	20.34	0.01	7.13	294.14	8.88	0.49	Closed
7/16/2024 9:10	15.64	20.18	0.01	7.13	295.58	8.88	0.51	Closed
7/16/2024 9:20	15.66	20.31	0.01	7.14	293.65	8.89	0.49	Open
7/16/2024 9:30	15.69	20.35	0.01	7.16	294.53	8.89	0.59	Open
7/16/2024 9:40	15.72	20.39	0.01	7.14	293.95	8.89	0.52	Open
7/16/2024 9:50	15.74	20.46	0.01	7.2	292.85	8.87	0.49	Open
7/16/2024 10:00	15.76	20.4	0.01	7.15	293.96	8.88	0.56	Open
7/16/2024 10:10	15.8	20.44	0.01	7.22	290.22	8.87	0.5	Open
7/16/2024 10:20	15.85	20.56	0.01	7.17	290.06	8.89	0.5	Open
7/16/2024 10:30	15.91	20.51	0.01	7.21	289.14	8.88	0.52	Open
7/16/2024 10:40	16.01	20.53	0.01	7.2	289.41	8.9	0.54	Open
7/16/2024 10:50	16.12	20.39	0.01	7.23	290.2	8.88	0.53	Open
7/16/2024 11:00	16.25	20.32	0.01	7.23	288.68	8.88	0.53	Open
7/16/2024 11:10	16.35	20.29	0.01	7.26	288.73	8.88	0.54	Open
7/16/2024 11:20	16.42	20.44	0.01	7.24	289.01	8.85	0.55	Open
7/16/2024 11:30	16.48	20.35	0.01	7.28	289.24	8.87	0.53	Open
7/16/2024 11:40	16.58	20.42	0.01	7.27	289.28	8.88	0.61	Open
7/16/2024 11:50	16.68	20.42	0.01	7.26	292.61	8.86	0.55	Open
7/16/2024 12:00	16.78	20.43	0.01	7.27	290.11	8.85	0.58	Open
7/16/2024 12:10	16.85	20.19	0.01	7.31	289.66	8.84	0.55	Open
7/16/2024 12:20	16.86	20.46	0.01	7.27	291.42	8.83	0.59	Open
7/16/2024 12:30	16.86	20.5	0.01	7.27	293.08	8.8	0.57	Open
7/16/2024 12:40	16.87	20.55	0.01	7.26	292.12	8.8	0.56	Open
7/16/2024 12:50	16.88	20.47	0.01	7.28	292.31	8.78	0.57	Closed
7/16/2024 13:00	16.91	20.56	0.01	7.25	292.8	8.74	0.59	Closed
7/16/2024 13:10	16.96	20.29	0.01	7.29	292.38	8.75	0.54	Closed
7/16/2024 13:20	17.01	20.6	0.01	7.25	291.36	8.71	0.59	Closed
7/16/2024 13:30	17.07	20.24	0.01	7.3	291.31	8.71	0.59	Closed

Downstre  
am Sonde

7/16/2024 13:40 17.12 20.56 0.01 7.24 291.12 8.68 0.57 Removed

## EGP-STU-003 (WLNG US)

7/16/2024 13:50	17.17	20.55	0.01	7.32	288.28	8.68	0.59
7/16/2024 14:00	17.21	20.63	0.01	7.23	291.35	8.63	0.59
7/16/2024 14:10	17.26	20.64	0.01	7.26	291.19	8.63	0.61
7/16/2024 14:20	17.29	20.64	0.01	7.22	291.6	8.61	0.56
7/16/2024 14:30	17.34	20.64	0.01	7.24	291.85	8.58	0.59
7/16/2024 14:40	17.4	20.62	0.01	7.23	291.52	8.58	0.57
7/16/2024 14:50	17.44	20.65	0.01	7.29	289.13	8.59	0.59
7/16/2024 15:00	17.49	20.64	0.01	7.23	290.26	8.56	2.02
7/16/2024 15:10	17.53	20.62	0.01	7.29	289.44	8.56	0.63
7/16/2024 15:20	17.54	20.6	0.01	7.23	291.09	8.55	0.62
7/16/2024 15:30	17.57	20.2	0.01	7.25	291.77	8.56	0.62
7/16/2024 15:40	17.61	20.34	0.01	7.23	292.11	8.55	0.59
7/16/2024 15:50	17.63	20.25	0.01	7.25	292.32	8.53	0.61
7/16/2024 16:00	17.66	20.17	0.01	7.23	291.19	8.54	0.62
7/16/2024 16:10	17.67	20.24	0.01	7.23	293.19	8.53	0.62
7/16/2024 16:20	17.69	20.16	0.01	7.21	291.86	8.5	0.6
7/16/2024 16:30	17.72	19.93	0.01	7.23	292.56	8.47	0.61
7/16/2024 16:40	17.75	20.18	0.01	7.2	292.01	8.48	0.6
7/16/2024 16:50	17.75	19.92	0.01	7.22	292.89	8.43	0.64
7/16/2024 17:00	17.74	20.22	0.01	7.18	294.28	8.45	0.64
7/16/2024 17:10	17.73	20.03	0.01	7.2	295.18	8.46	0.64
7/16/2024 17:20	17.73	20.24	0.01	7.18	293.84	8.42	0.64
7/16/2024 17:30	17.71	20.2	0.01	7.21	293.67	8.42	0.73
7/16/2024 17:40	17.7	20.3	0.01	7.17	294.48	8.43	0.65
7/16/2024 17:50	17.68	20.05	0.01	7.22	292.84	8.41	0.63
7/16/2024 18:00	17.66	20.43	0.01	7.14	295.71	8.42	0.66
7/16/2024 18:10	17.65	20.44	0.01	7.17	295.42	8.42	0.62
7/16/2024 18:20	17.63	20.37	0.01	7.14	294.09	8.42	0.64
7/16/2024 18:30	17.6	20.15	0.01	7.16	294.34	8.42	0.68
7/16/2024 18:40	17.57	20.5	0.01	7.1	295.76	8.41	0.63
7/16/2024 18:50	17.55	20.49	0.01	7.16	294.93	8.41	0.62
7/16/2024 19:00	17.52	20.63	0.01	7.1	296.19	8.41	0.64
7/16/2024 19:10	17.5	20.6	0.01	7.1	298.41	8.41	0.64
7/16/2024 19:20	17.47	20.67	0.01	7.08	297.85	8.41	0.67
7/16/2024 19:30	17.45	20.63	0.01	7.11	297.89	8.42	0.62
7/16/2024 19:40	17.43	20.76	0.01	7.08	299.03	8.43	0.61
7/16/2024 19:50	17.41	20.75	0.01	7.17	295.68	8.43	0.63
7/16/2024 20:00	17.39	20.79	0.01	7.08	298.9	8.42	0.65
7/16/2024 20:10	17.36	20.66	0.01	7.11	299.18	8.43	0.62
7/16/2024 20:20	17.34	20.92	0.01	7.09	300.07	8.44	0.62
7/16/2024 20:30	17.32	20.92	0.01	7.11	300.68	8.44	0.63
7/16/2024 20:40	17.29	21.06	0.01	7.09	300.31	8.43	0.63
7/16/2024 20:50	17.26	20.94	0.01	7.14	299.34	8.45	0.62
7/16/2024 21:00	17.23	21.11	0.01	7.07	301.27	8.44	0.63
7/16/2024 21:10	17.2	21.18	0.01	7.09	301.3	8.45	0.68
7/16/2024 21:20	17.18	21.18	0.01	7.07	299.58	8.44	0.6
7/16/2024 21:30	17.14	21.12	0.01	7.1	300.24	8.45	0.64

## EGP-STU-003 (WLNG US)

7/16/2024 21:40	17.12	21.21	0.01	7.08	299.93	8.44	0.59
7/16/2024 21:50	17.09	21.21	0.01	7.1	302.02	8.46	0.61
7/16/2024 22:00	17.06	21.21	0.01	7.07	301.18	8.46	0.61
7/16/2024 22:10	17.03	21.2	0.01	7.13	299.68	8.47	0.59
7/16/2024 22:20	17	21.25	0.01	7.07	300.94	8.48	0.63
7/16/2024 22:30	16.98	21.15	0.01	7.13	298.8	8.48	0.59
7/16/2024 22:40	16.95	21.22	0.01	7.08	299.45	8.49	0.61
7/16/2024 22:50	16.92	21.12	0.01	7.11	299.84	8.49	0.61
7/16/2024 23:00	16.9	21.22	0.01	7.08	299.14	8.51	0.6
7/16/2024 23:10	16.87	21.13	0.01	7.11	299.88	8.5	0.6
7/16/2024 23:20	16.85	21.15	0.01	7.09	298.93	8.52	0.58
7/16/2024 23:30	16.83	21.2	0.01	7.09	301.63	8.49	0.59
7/16/2024 23:40	16.8	21.25	0.01	7.08	300.17	8.51	0.59
7/16/2024 23:50	16.78	21.11	0.01	7.12	300.57	8.51	0.66
7/17/2024 0:00	16.76	21.16	0.01	7.08	301.08	8.51	0.64
7/17/2024 0:10	16.74	21.23	0.01	7.09	302.47	8.52	0.6
7/17/2024 0:20	16.72	21.14	0.01	7.09	301.11	8.53	0.61
7/17/2024 0:30	16.69	21.21	0.01	7.1	302.36	8.54	0.59
7/17/2024 0:40	16.67	21.24	0.01	7.09	300.78	8.54	0.61
7/17/2024 0:50	16.64	21.14	0.01	7.1	303.75	8.56	0.58
7/17/2024 1:00	16.62	21.1	0.01	7.09	302.72	8.55	0.6
7/17/2024 1:10	16.6	21.08	0.01	7.11	302.22	8.56	0.6
7/17/2024 1:20	16.58	21.15	0.01	7.09	302.44	8.57	0.58
7/17/2024 1:30	16.56	21.12	0.01	7.12	301.71	8.57	0.57
7/17/2024 1:40	16.54	21.19	0.01	7.09	301.95	8.59	0.57
7/17/2024 1:50	16.52	21.1	0.01	7.12	302.94	8.58	0.58
7/17/2024 2:00	16.5	21.12	0.01	7.07	304.14	8.58	0.6
7/17/2024 2:10	16.48	21.15	0.01	7.12	302.81	8.59	0.59
7/17/2024 2:20	16.46	21.07	0.01	7.08	304.09	8.61	0.55
7/17/2024 2:30	16.44	21.06	0.01	7.12	304.28	8.58	0.6
7/17/2024 2:40	16.43	21.07	0.01	7.08	304.56	8.6	0.57
7/17/2024 2:50	16.41	20.86	0.01	7.11	305.34	8.61	0.57
7/17/2024 3:00	16.39	20.98	0.01	7.09	304.49	8.62	0.56
7/17/2024 3:10	16.37	21.05	0.01	7.16	301.57	8.61	0.56
7/17/2024 3:20	16.35	21.09	0.01	7.07	305.54	8.61	0.57
7/17/2024 3:30	16.33	20.97	0.01	7.12	304.52	8.61	0.55
7/17/2024 3:40	16.31	21.06	0.01	7.09	303	8.63	0.55
7/17/2024 3:50	16.29	21	0.01	7.13	304.28	8.63	0.55
7/17/2024 4:00	16.28	20.95	0.01	7.09	304.62	8.64	0.56
7/17/2024 4:10	16.26	20.98	0.01	7.12	303.52	8.64	0.55
7/17/2024 4:20	16.24	21.01	0.01	7.09	304.23	8.64	0.55
7/17/2024 4:30	16.22	20.66	0.01	7.09	307.05	8.66	0.56
7/17/2024 4:40	16.21	20.98	0.01	7.08	305.77	8.66	0.55
7/17/2024 4:50	16.19	20.93	0.01	7.12	305.67	8.65	0.59
7/17/2024 5:00	16.17	20.9	0.01	7.09	306.31	8.66	0.59
7/17/2024 5:10	16.15	21.03	0.01	7.1	307.12	8.68	0.56
7/17/2024 5:20	16.13	20.86	0.01	7.1	307.25	8.68	0.54

## EGP-STU-003 (WLNG US)

7/17/2024 5:30	16.11	20.88	0.01	7.15	305.57	8.68	0.55
7/17/2024 5:40	16.1	20.93	0.01	7.08	308.09	8.69	0.55
7/17/2024 5:50	16.08	20.73	0.01	7.16	305.55	8.68	0.55
7/17/2024 6:00	16.07	20.88	0.01	7.1	308.61	8.71	0.55
7/17/2024 6:10	16.05	20.85	0.01	7.14	307.5	8.71	0.56
7/17/2024 6:20	16.04	20.79	0.01	7.09	309.31	8.73	0.56
7/17/2024 6:30	16.03	20.83	0.01	7.11	309.02	8.71	0.61
7/17/2024 6:40	16.02	20.76	0.01	7.1	309.24	8.73	0.54
7/17/2024 6:50	16.01	20.77	0.01	7.12	308.67	8.72	0.54
7/17/2024 7:00	16	20.81	0.01	7.09	308.92	8.74	0.55
7/17/2024 7:10	15.99	20.68	0.01	7.16	306.22	8.75	0.54
7/17/2024 7:20	15.99	20.76	0.01	7.1	308.67	8.75	0.61
7/17/2024 7:30	15.98	20.68	0.01	7.12	309.73	8.75	0.53
7/17/2024 7:40	15.98	20.72	0.01	7.09	309.82	8.76	0.56
7/17/2024 7:50	15.98	20.69	0.01	7.12	310.78	8.77	0.55
7/17/2024 8:00	15.99	20.72	0.01	7.1	310.35	8.77	0.57
7/17/2024 8:10	15.99	20.58	0.01	7.14	308.36	8.76	0.54
7/17/2024 8:20	16	20.7	0.01	7.11	308.78	8.78	0.56
7/17/2024 8:30	16.01	20.77	0.01	7.13	309.02	8.78	0.53
7/17/2024 8:30	16.01	20.77	0.01	7.13	309.02	8.78	0.53
7/17/2024 8:40	16.03	20.56	0.01	7.1	309.01	8.77	0.54
7/17/2024 8:50	16.06	20.69	0.01	7.13	308.4	8.77	0.57
7/17/2024 9:00	16.09	20.57	0.01	7.11	308.27	8.77	0.55
7/17/2024 9:10	16.13	20.57	0.01	7.15	307.84	8.77	0.55
7/17/2024 9:20	16.15	20.71	0.01	7.1	309.3	8.8	0.57
7/17/2024 9:30	16.18	20.66	0.01	7.18	305.99	8.78	0.56
7/17/2024 9:40	16.2	20.7	0.01	7.12	308.37	8.76	0.56
7/17/2024 9:50	16.22	20.69	0.01	7.18	306.51	8.78	0.54
7/17/2024 10:00	16.24	20.67	0.01	7.15	306.65	8.76	0.55
7/17/2024 10:10	16.27	20.69	0.01	7.16	307.5	8.78	0.58
7/17/2024 10:20	16.31	20.66	0.01	7.15	306.96	8.77	0.55
7/17/2024 10:30	16.37	20.63	0.01	7.21	305.21	8.76	0.55
7/17/2024 10:40	16.46	20.56	0.01	7.18	305.8	8.79	0.58
7/17/2024 10:50	16.57	20.53	0.01	7.19	306.03	8.77	0.58
7/17/2024 11:00	16.72	20.42	0.01	7.2	304.83	8.79	0.59
7/17/2024 11:10	16.84	20.32	0.01	7.24	303.41	8.79	0.59
7/17/2024 11:20	16.91	20.41	0.01	7.22	303.55	8.79	0.6
7/17/2024 11:30	16.99	20.5	0.01	7.27	301.67	8.76	0.59
7/17/2024 11:40	17.08	20.42	0.01	7.24	303.03	8.76	0.62
7/17/2024 11:50	17.17	20.15	0.01	7.28	301.81	8.77	0.61
7/17/2024 12:00	17.26	20.33	0.01	7.25	301.96	8.75	0.62
7/17/2024 12:10	17.31	20.44	0.01	7.3	300.47	8.73	0.62
7/17/2024 12:20	17.33	20.31	0.01	7.25	301.99	8.74	0.64
7/17/2024 12:30	17.33	20.36	0.01	7.27	301.79	8.73	0.7
7/17/2024 12:40	17.35	20.31	0.01	7.24	302.28	8.72	0.6
7/17/2024 12:50	17.36	20.31	0.01	7.26	301.98	8.68	0.77
7/17/2024 13:00	17.41	20.29	0.01	7.24	301.12	8.68	0.62

## EGP-STU-003 (WLNG US)

7/17/2024 13:10	17.42	20.38	0.01	7.27	300.93	8.65	0.64
7/17/2024 13:20	17.49	20.24	0.01	7.23	301.01	8.63	0.62
7/17/2024 13:30	17.54	20.21	0.01	7.28	297.54	8.62	0.64
7/17/2024 13:40	17.57	20.24	0.01	7.23	299.72	8.6	0.63
7/17/2024 13:50	17.61	20.42	0.01	7.27	298.86	8.58	0.63
7/17/2024 14:00	17.66	20.25	0.01	7.22	300.1	8.56	0.65
7/17/2024 14:10	17.7	20.32	0.01	7.25	298.97	8.54	0.61
7/17/2024 14:20	17.74	20.3	0.01	7.21	298.79	8.55	0.62
7/17/2024 14:30	17.79	20.29	0.01	7.25	298.2	8.49	0.63
7/17/2024 14:40	17.85	20.4	0.01	7.21	299.94	8.5	0.68
7/17/2024 14:50	17.9	20.33	0.01	7.27	298.46	8.5	0.68
7/17/2024 15:00	17.95	20.29	0.01	7.21	300.8	8.49	0.64
7/17/2024 15:10	17.99	20.31	0.01	7.24	300.12	8.48	0.67
7/17/2024 15:20	18.02	20.37	0.01	7.21	299.89	8.47	0.65
7/17/2024 15:30	18.04	20.41	0.01	7.28	297.47	8.47	0.68
7/17/2024 15:40	18.1	20.3	0.01	7.21	299.44	8.45	0.69
7/17/2024 15:50	18.11	20.39	0.01	7.27	297.99	8.46	0.65
7/17/2024 16:00	18.09	20.29	0.01	7.22	299.74	8.45	0.65
7/17/2024 16:10	18.1	20.29	0.01	7.29	296.87	8.44	0.72
7/17/2024 16:20	18.14	20.34	0.01	7.22	299.32	8.44	0.67
7/17/2024 16:30	18.17	20.4	0.01	7.22	301.33	8.43	0.68
7/17/2024 16:40	18.2	20.35	0.01	7.2	301.29	8.42	0.7
7/17/2024 16:50	18.21	20.57	0.01	7.24	299.96	8.41	0.66
7/17/2024 17:00	18.21	20.46	0.01	7.18	301.37	8.4	0.66
7/17/2024 17:10	18.21	20.59	0.01	7.2	300.62	8.38	0.65
7/17/2024 17:20	18.19	20.63	0.01	7.17	302.25	8.37	0.68
7/17/2024 17:30	18.18	20.64	0.01	7.19	301.98	8.35	0.64
7/17/2024 17:40	18.17	20.68	0.01	7.14	304.3	8.36	0.67
7/17/2024 17:50	18.15	20.7	0.01	7.23	299.96	8.35	0.68
7/17/2024 18:00	18.13	20.61	0.01	7.21	298.04	8.36	0.65
7/17/2024 18:10	18.11	20.75	0.01	7.14	301.07	8.35	0.67
7/17/2024 18:20	18.09	20.51	0.01	7.16	300.65	8.34	0.64
7/17/2024 18:30	18.07	20.88	0.01	7.12	302.32	8.32	0.65
7/17/2024 18:40	18.05	20.88	0.01	7.16	301.49	8.34	0.67
7/17/2024 18:50	18.02	21.07	0.01	7.13	302.94	8.34	0.69
7/17/2024 19:00	17.99	20.91	0.01	7.17	301.22	8.31	0.65
7/17/2024 19:10	17.97	20.95	0.01	7.12	303.16	8.33	0.64
7/17/2024 19:20	17.94	20.96	0.01	7.1	304.79	8.32	0.63
7/17/2024 19:30	17.92	21	0.01	7.1	303.35	8.35	0.67
7/17/2024 19:40	17.89	21.15	0.01	7.09	305.64	8.33	0.65
7/17/2024 19:50	17.86	21.11	0.01	7.08	305.24	8.32	0.64
7/17/2024 20:00	17.83	21.2	0.01	7.1	305.37	8.33	0.64
7/17/2024 20:10	17.8	21.19	0.01	7.08	305.46	8.36	0.62
7/17/2024 20:20	17.77	21.35	0.01	7.11	304.77	8.35	0.63
7/17/2024 20:30	17.74	21.32	0.01	7.1	304.21	8.36	0.64
7/17/2024 20:40	17.7	21.32	0.01	7.15	303.61	8.36	0.65
7/17/2024 20:50	17.68	21.33	0.01	7.1	304.98	8.36	0.6

## EGP-STU-003 (WLNG US)

7/17/2024 21:00	17.65	21.34	0.01	7.14	302.34	8.35	0.63
7/17/2024 21:10	17.62	21.33	0.01	7.09	305.14	8.36	0.63
7/17/2024 21:20	17.59	21.43	0.01	7.09	306.35	8.36	0.63
7/17/2024 21:20	17.59	21.43	0.01	7.09	306.35	8.36	0.63
7/17/2024 21:30	17.56	21.39	0.01	7.09	306.1	8.35	0.63
7/17/2024 21:40	17.53	21.45	0.01	7.11	305.11	8.37	0.62
7/17/2024 21:50	17.51	21.4	0.01	7.09	306.46	8.38	0.63
7/17/2024 22:00	17.48	21.4	0.01	7.14	303.56	8.37	0.61
7/17/2024 22:10	17.46	21.47	0.01	7.1	305.5	8.39	0.62
7/17/2024 22:20	17.43	21.39	0.01	7.14	304.39	8.4	0.63
7/17/2024 22:30	17.4	21.44	0.01	7.09	306.6	8.4	0.62
7/17/2024 22:40	17.37	21.38	0.01	7.1	308.47	8.4	0.62
7/17/2024 22:50	17.35	21.38	0.01	7.1	307.13	8.42	0.62
7/17/2024 23:00	17.33	21.1	0.01	7.12	306.58	8.4	0.64
7/17/2024 23:10	17.31	21.36	0.01	7.1	307.25	8.41	0.62
7/17/2024 23:20	17.28	21.1	0.01	7.14	306.03	8.42	0.61
7/17/2024 23:30	17.26	21.42	0.01	7.1	307.44	8.43	0.85
7/17/2024 23:40	17.24	21.37	0.01	7.13	306.74	8.43	0.61
7/17/2024 23:50	17.21	21.34	0.01	7.09	308.42	8.44	0.62