



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week

Feb 9, 2026 to
Feb 15, 2026

Report #

99

Page

1 of 7

Eagle Mountain – Woodfibre Gas Pipeline Project

BCER Waste Discharge Permit Weekly Report



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Page	2 of 7

Contents

Preamble	3
Introduction	3
Sampling Methodology	3
Summary-BC Rail Site	5
Site Activities	5
Discharge from Water Treatment Plant.....	5
Receiving Environment Monitoring-Squamish River	5
Summary-Woodfibre	6
Site Activities	6
Exceedances.....	6
Discharge from Water Treatment Plant.....	6
Receiving Environment Monitoring-East Creek.....	6

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

Appendix E: Lab Documentation



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Page	3 of 7

Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environments (upstream and downstream) and points of discharge.

FortisBC has retained Hatfield Consultants as the Qualified Professional to implement and oversee the monitoring and sampling programs. The data represented below, including reported exceedances, represent conditions measured from final discharge points and the associated receiving environments, as required under the Waste Discharge Permit.

Introduction

The results provided in this document have been submitted to BCER by FortisBC as per the requirements listed in Section 4.2 of the Waste Discharge Permit PE-110163, which states:

The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to Waste.Management@bc-er.ca. A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and laboratory samples to meet daily and real-time requirements for the Waste Discharge Permit.

In the receiving environments, real-time and daily readings were monitored at the same time with one piece of equipment, allowing real-time daily readings. Visible sheen was monitored through visual inspections during times of discharge or sampling.

At the point of discharges, parameters are monitored using field equipment and water quality sondes, as well as discrete weekly water quality sampling events for laboratory analyses. Table 1 and Table 2 below describe this monitoring.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Page	4 of 7

Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real-time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observator NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples*

*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.

Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real-time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples*

*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week

Feb 9, 2026 to
Feb 15, 2026

Report #

99

Page

5 of 7

Summary-BC Rail Site

Site Activities

- Water produced by the water treatment plant is being recirculated for tunneling and to create grout for tunneling.

Discharge from Water Treatment Plant

- There was no discharges this week from the BC Rail Site.

Receiving Environment Monitoring-Squamish River

Tables 3 and 4 below provide information on water quality sampling performed. Lab Sampling has been put on hold with permission from BCER as there are no discharges. Appendix B includes a full set of real-time data. The receiving environment is being monitored as outlined in the permit and confirmed by BCER, with additional oversight by the QP.

Table 3. Upstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Upstream	N/A	Yes *	Tabulated real-time monitoring results are provided in Appendix B. **

Table 4. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Downstream	N/A	Yes *	Tabulated real-time monitoring results are provided in Appendix B.

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

**Data gaps in available in-situ continuous monitoring data, included:

- SQU US
 - 2026-02-09: Temperature, conductivity, ORP, pH, DO, turbidity and salinity data were missing at 00:00.
 - 2026-02-11: Temperature, conductivity, ORP, pH, DO, turbidity and salinity data were missing at 14:45.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Page	6 of 7

Summary-Woodfibre

Site Activities

- Weekly upstream, downstream, and end of pipe water quality sampling performed by the QP.
- On-going tunnelling at WLNG and grouting works to mitigate water ingress.

Exceedances

The following exceedances were reported during the February 9 to February 15, 2026, reporting period:

Turbidity

- Turbidity at EAS DS was measured to exceed the short-term guideline (Change from background of 8 NTU) for a period of more than 24 hours from February 11 at 5:15 to February 13 at 13:15, at which time the water logger was cleaned and turbidity was reduced, with turbidity ranging from 10 to 494 NTU, with an average of 88 NTU. Of note is that the upstream EAS US location reported 170 of 225 sampling events with turbidity values of 0.00 during the exceedance event resulting in low guideline values.
- A review of continuous EOP turbidity monitoring indicated that EOP turbidity values remained below the EAS DS turbidity values for most of the exceedance event. Although there was some misalignment between the EAS DS and WLNG EOP results, WLNG EOP turbidity results did exceed BC acute WQGs at times during the downstream exceedance event.

Discharge from Water Treatment Plant

Appendix C includes volume information and real-time/field samples from the discharge.

Receiving Environment Monitoring-East Creek

Tables 5 and 6 below provide information on water quality and lab sampling. Appendix D includes a full set of lab results with real-time data. The receiving environment is being monitored as outlined in the permit with additional oversight by the QP.

Table 5. Upstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Upstream	2026-02-10	Yes *	Full set of lab sample results, photo, and documentation are provided in Appendix D.**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Page	7 of 7

Table 6. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Downstream	2026-02-10	Yes *	Full set of lab sample results, photo, and documentation are provided in Appendix D.**

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute interval

**Data gaps in available in-situ continuous monitoring data, included:

■ EAS US

- 2026-02-09: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 2:00, 3:00, 4:00, 5:00, 9:00, 11:00, 17:00, 18:00 and 20:00.
- 2026-02-09: Temperature, conductivity, and salinity data were missing at 13:00.
- 2026-02-10: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 00:00, 1:00, 2:00, 4:00, 6:00, 9:00 and 23:00.
- 2026-02-11: Temperature, conductivity, and salinity data were missing at 1:00, 7:00 and 18:00.
- 2026-02-11: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 2:00, 2:15, 3:00, 4:00, 6:00, 6:15, 9:00, 9:15 and 10:00.
- 2026-02-12: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 4:00, 4:15, 7:00, 8:00, 9:00, 10:00, 19:00, 21:00, 21:15 and 22:00.
- 2026-02-12: Temperature, conductivity, and salinity data were missing at 14:00.
- 2026-02-13: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 4:00, 4:15, 5:00, 8:00, 10:00, 12:00, 13:00, 14:00, 14:15, 17:00, 18:00, 18:15, 20:00, 23:00 and 23:15.
- 2026-02-13: Temperature, conductivity, and salinity data were missing at 22:00.
- 2026-02-14: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 2:00, 2:15, 6:00, 6:15, 7:00, 8:00, 9:00, 10:00, 13:00, 17:00, 17:15, 18:00, 19:00, 20:00, 21:00, 22:00 and 23:00.
- 2026-02-14: Temperature, conductivity, and salinity data were missing at 5:00.
- 2026-02-15: Temperature, conductivity, ORP, PH, DO, turbidity and salinity data were missing at 00:00, 1:00, 3:00, 3:15, 4:00, 5:00, 6:00, 7:00, 8:00 and 22:00.

■ EAS DS

- 2026-02-09: Temperature and ORP data were missing at 15:00.
- 2026-02-14: Temperature, ORP, PH, DO and turbidity data were missing at 1:00 and 20:00.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix A	A-1

**Appendix A:
BCR Site Point of Discharge from Water
Treatment Plant Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix A	A-2

**BCR Site Batch Sample Analysis
No Discharge**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix A	A-3

BCR Site WTP Discharge Field Notes and Logs

No Discharge



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix B	B-1

**Appendix B:
BCR Site Receiving Environment Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix B	B-2

**BCR Site Receiving Environment Sample Analysis
No Lab Sample**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix B	B-3

**BCR Site Receiving Environment
Field Notes and Logs**

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-09 00:00:00	4.19	34.17	0.57	7.22	11.62	4.50	0.01
SQU-DS	2026-02-09 00:15:00	4.16	34.15	0.57	7.22	11.66	5.32	0.01
SQU-DS	2026-02-09 00:30:00	4.14	34.27	0.57	7.22	11.65	6.27	0.01
SQU-DS	2026-02-09 00:45:00	4.12	34.27	0.57	7.23	11.65	5.56	0.01
SQU-DS	2026-02-09 01:00:00	4.10	34.31	0.57	7.23	11.68	5.63	0.01
SQU-DS	2026-02-09 01:15:00	4.09	34.36	0.57	7.24	11.68	5.66	0.01
SQU-DS	2026-02-09 01:30:00	4.07	34.60	0.57	7.24	11.67	6.16	0.01
SQU-DS	2026-02-09 01:45:00	4.05	34.57	0.57	7.23	11.67	5.34	0.01
SQU-DS	2026-02-09 02:00:00	4.04	34.59	0.57	7.24	11.68	5.14	0.01
SQU-DS	2026-02-09 02:15:00	4.02	34.56	0.57	7.23	11.71	5.20	0.01
SQU-DS	2026-02-09 02:30:00	4.00	34.64	0.57	7.21	11.70	5.26	0.01
SQU-DS	2026-02-09 02:45:00	3.99	34.43	0.57	7.23	11.71	5.78	0.01
SQU-DS	2026-02-09 03:00:00	3.97	34.71	0.57	7.23	11.70	5.55	0.01
SQU-DS	2026-02-09 03:15:00	3.96	34.86	0.57	7.23	11.73	5.28	0.01
SQU-DS	2026-02-09 03:30:00	3.94	34.73	0.57	7.22	11.74	5.13	0.01
SQU-DS	2026-02-09 03:45:00	3.93	34.93	0.57	7.22	11.74	6.32	0.01
SQU-DS	2026-02-09 04:00:00	3.92	35.02	0.57	7.22	11.74	6.09	0.01
SQU-DS	2026-02-09 04:15:00	3.91	35.06	0.57	7.23	11.74	5.57	0.01
SQU-DS	2026-02-09 04:30:00	3.90	35.01	0.57	7.21	11.74	5.46	0.01
SQU-DS	2026-02-09 04:45:00	3.90	35.14	0.57	7.21	11.74	5.01	0.01
SQU-DS	2026-02-09 05:00:00	3.89	35.34	0.57	7.23	11.74	4.75	0.01
SQU-DS	2026-02-09 05:15:00	3.89	35.30	0.57	7.23	11.75	5.22	0.01
SQU-DS	2026-02-09 05:30:00	3.88	35.25	0.57	7.21	11.76	5.33	0.01
SQU-DS	2026-02-09 05:45:00	3.89	35.67	0.57	7.24	11.74	5.37	0.02
SQU-DS	2026-02-09 06:00:00	3.89	35.76	0.57	7.22	11.74	5.28	0.02
SQU-DS	2026-02-09 06:15:00	3.88	35.82	0.57	7.25	11.74	4.95	0.02
SQU-DS	2026-02-09 06:30:00	3.88	35.77	0.57	7.20	11.75	6.23	0.02
SQU-DS	2026-02-09 06:45:00	3.88	35.75	0.57	7.24	11.75	4.98	0.02
SQU-DS	2026-02-09 07:00:00	3.88	35.93	0.57	7.24	11.75	4.68	0.02
SQU-DS	2026-02-09 07:15:00	3.88	36.04	0.57	7.24	11.75	5.30	0.02
SQU-DS	2026-02-09 07:30:00	3.88	36.21	0.57	7.23	11.76	5.14	0.02
SQU-DS	2026-02-09 07:45:00	3.88	36.35	0.57	7.25	11.74	6.21	0.02
SQU-DS	2026-02-09 08:00:00	3.88	36.29	0.57	7.24	11.74	5.61	0.02
SQU-DS	2026-02-09 08:15:00	3.89	36.23	0.57	7.25	11.72	4.80	0.02
SQU-DS	2026-02-09 08:30:00	3.89	36.45	0.57	7.25	11.72	4.92	0.02
SQU-DS	2026-02-09 08:45:00	3.90	36.72	0.57	7.24	11.71	4.56	0.02
SQU-DS	2026-02-09 09:00:00	3.92	36.83	0.57	7.26	11.70	4.84	0.02
SQU-DS	2026-02-09 09:15:00	3.94	37.08	0.57	7.27	11.70	4.73	0.02
SQU-DS	2026-02-09 09:30:00	3.96	37.29	0.57	7.27	11.69	4.82	0.02
SQU-DS	2026-02-09 09:45:00	3.98	37.53	0.57	7.26	11.69	5.10	0.02
SQU-DS	2026-02-09 10:00:00	4.00	37.80	0.57	7.26	11.68	4.91	0.02
SQU-DS	2026-02-09 10:15:00	4.02	37.88	0.57	7.25	11.68	4.95	0.02
SQU-DS	2026-02-09 10:30:00	4.05	38.25	0.57	7.25	11.68	4.78	0.02
SQU-DS	2026-02-09 10:45:00	4.07	38.23	0.57	7.28	11.67	4.68	0.02
SQU-DS	2026-02-09 11:00:00	4.09	38.36	0.57	7.26	11.66	5.08	0.02
SQU-DS	2026-02-09 11:15:00	4.10	38.50	0.57	7.26	11.66	4.82	0.02
SQU-DS	2026-02-09 11:30:00	4.12	38.36	0.57	7.25	11.66	5.37	0.02
SQU-DS	2026-02-09 11:45:00	4.14	38.35	0.57	7.24	11.64	5.81	0.02
SQU-DS	2026-02-09 12:00:00	4.16	38.54	0.57	7.25	11.65	5.09	0.02
SQU-DS	2026-02-09 12:15:00	4.19	38.50	0.57	7.23	11.64	6.40	0.02
SQU-DS	2026-02-09 12:30:00	4.22	38.68	0.57	7.25	11.65	4.96	0.02
SQU-DS	2026-02-09 12:45:00	4.25	38.71	0.57	7.25	11.61	5.28	0.02
SQU-DS	2026-02-09 13:00:00	4.27	38.50	0.57	7.24	11.62	4.84	0.02
SQU-DS	2026-02-09 13:15:00	4.30	38.67	0.57	7.23	11.60	5.34	0.02
SQU-DS	2026-02-09 13:30:00	4.33	38.62	0.57	7.23	11.61	6.23	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-09 13:45:00	4.34	38.66	0.56	7.25	11.62	6.40	0.02
SQU-DS	2026-02-09 14:00:00	4.36	38.77	0.57	7.23	11.61	4.83	0.02
SQU-DS	2026-02-09 14:15:00	4.38	38.63	0.57	7.23	11.61	4.91	0.02
SQU-DS	2026-02-09 14:30:00	4.40	38.62	0.57	7.23	11.59	4.61	0.02
SQU-DS	2026-02-09 14:45:00	4.44	38.93	0.56	7.24	11.61	4.82	0.02
SQU-DS	2026-02-09 15:00:00	4.46	39.01	0.57	7.21	11.59	5.06	0.02
SQU-DS	2026-02-09 15:15:00	4.48	39.14	0.56	7.22	11.59	5.20	0.02
SQU-DS	2026-02-09 15:30:00	4.50	39.30	0.56	7.22	11.56	5.36	0.02
SQU-DS	2026-02-09 15:45:00	4.51	39.25	0.56	7.24	11.56	5.35	0.02
SQU-DS	2026-02-09 16:00:00	4.52	39.35	0.56	7.23	11.55	4.98	0.02
SQU-DS	2026-02-09 16:15:00	4.52	39.39	0.56	7.26	11.54	4.97	0.02
SQU-DS	2026-02-09 16:30:00	4.52	39.42	0.57	7.23	11.54	4.94	0.02
SQU-DS	2026-02-09 16:45:00	4.52	39.42	0.56	7.28	11.54	5.14	0.02
SQU-DS	2026-02-09 17:00:00	4.52	39.53	0.57	7.25	11.54	5.30	0.02
SQU-DS	2026-02-09 17:15:00	4.52	39.83	0.57	7.24	11.53	5.34	0.02
SQU-DS	2026-02-09 17:30:00	4.51	39.82	0.57	7.25	11.51	5.30	0.02
SQU-DS	2026-02-09 17:45:00	4.53	40.12	0.57	7.24	11.50	4.15	0.02
SQU-DS	2026-02-09 18:00:00	4.52	39.98	0.57	7.24	11.49	5.36	0.02
SQU-DS	2026-02-09 18:15:00	4.52	40.12	0.57	7.25	11.49	5.02	0.02
SQU-DS	2026-02-09 18:30:00	4.52	40.15	0.57	7.23	11.46	6.36	0.02
SQU-DS	2026-02-09 18:45:00	4.53	40.34	0.57	7.25	11.47	4.90	0.02
SQU-DS	2026-02-09 19:00:00	4.53	40.27	0.57	7.24	11.47	5.20	0.02
SQU-DS	2026-02-09 19:15:00	4.54	40.39	0.57	7.24	11.47	5.15	0.02
SQU-DS	2026-02-09 19:30:00	4.54	40.38	0.57	7.22	11.45	5.78	0.02
SQU-DS	2026-02-09 19:45:00	4.55	40.58	0.57	7.24	11.44	7.22	0.02
SQU-DS	2026-02-09 20:00:00	4.55	40.70	0.57	7.23	11.43	5.12	0.02
SQU-DS	2026-02-09 20:15:00	4.55	40.76	0.57	7.25	11.44	5.43	0.02
SQU-DS	2026-02-09 20:30:00	4.55	40.85	0.57	7.21	11.43	5.28	0.02
SQU-DS	2026-02-09 20:45:00	4.55	41.06	0.57	7.23	11.41	5.01	0.02
SQU-DS	2026-02-09 21:00:00	4.56	41.06	0.57	7.26	11.41	5.08	0.02
SQU-DS	2026-02-09 21:15:00	4.55	40.92	0.57	7.25	11.40	4.84	0.02
SQU-DS	2026-02-09 21:30:00	4.55	41.00	0.57	7.22	11.40	5.29	0.02
SQU-DS	2026-02-09 21:45:00	4.55	41.03	0.57	7.25	11.41	4.90	0.02
SQU-DS	2026-02-09 22:00:00	4.55	41.00	0.57	7.25	11.42	5.24	0.02
SQU-DS	2026-02-09 22:15:00	4.55	41.11	0.57	7.23	11.42	4.63	0.02
SQU-DS	2026-02-09 22:30:00	4.54	41.05	0.57	7.23	11.42	5.35	0.02
SQU-DS	2026-02-09 22:45:00	4.55	41.53	0.57	7.25	11.40	5.11	0.02
SQU-DS	2026-02-09 23:00:00	4.54	41.26	0.57	7.24	11.38	5.01	0.02
SQU-DS	2026-02-09 23:15:00	4.54	41.22	0.57	7.22	11.39	5.44	0.02
SQU-DS	2026-02-09 23:30:00	4.53	41.08	0.57	7.24	11.40	5.24	0.02
SQU-DS	2026-02-09 23:45:00	4.53	41.10	0.57	7.27	11.39	5.36	0.02
SQU-DS	2026-02-10 00:00:00	4.52	41.22	0.57	7.24	11.39	4.61	0.02
SQU-DS	2026-02-10 00:15:00	4.52	41.32	0.57	7.27	11.42	6.24	0.02
SQU-DS	2026-02-10 00:30:00	4.51	41.19	0.57	7.27	11.40	5.37	0.02
SQU-DS	2026-02-10 00:45:00	4.50	41.01	0.57	7.27	11.41	4.88	0.02
SQU-DS	2026-02-10 01:00:00	4.49	40.92	0.57	7.26	11.42	5.22	0.02
SQU-DS	2026-02-10 01:15:00	4.49	41.13	0.57	7.27	11.42	5.39	0.02
SQU-DS	2026-02-10 01:30:00	4.48	41.05	0.57	7.29	11.41	5.46	0.02
SQU-DS	2026-02-10 01:45:00	4.48	40.95	0.57	7.27	11.43	5.45	0.02
SQU-DS	2026-02-10 02:00:00	4.47	41.04	0.57	7.27	11.44	6.34	0.02
SQU-DS	2026-02-10 02:15:00	4.46	40.91	0.57	7.28	11.45	5.02	0.02
SQU-DS	2026-02-10 02:30:00	4.46	40.65	0.57	7.27	11.44	5.61	0.02
SQU-DS	2026-02-10 02:45:00	4.46	40.96	0.57	7.28	11.44	5.02	0.02
SQU-DS	2026-02-10 03:00:00	4.45	40.88	0.57	7.28	11.46	5.04	0.02
SQU-DS	2026-02-10 03:15:00	4.44	40.64	0.57	7.26	11.46	5.09	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-10 03:30:00	4.44	40.81	0.57	7.28	11.47	4.98	0.02
SQU-DS	2026-02-10 03:45:00	4.44	40.99	0.57	7.27	11.46	4.77	0.02
SQU-DS	2026-02-10 04:00:00	4.42	40.79	0.57	7.27	11.45	4.72	0.02
SQU-DS	2026-02-10 04:15:00	4.42	40.72	0.57	7.27	11.45	4.57	0.02
SQU-DS	2026-02-10 04:30:00	4.42	40.81	0.57	7.27	11.46	5.17	0.02
SQU-DS	2026-02-10 04:45:00	4.41	40.78	0.57	7.29	11.46	4.85	0.02
SQU-DS	2026-02-10 05:00:00	4.41	40.96	0.57	7.29	11.45	6.45	0.02
SQU-DS	2026-02-10 05:15:00	4.40	40.78	0.57	7.27	11.45	4.51	0.02
SQU-DS	2026-02-10 05:30:00	4.40	40.88	0.57	7.24	11.47	4.80	0.02
SQU-DS	2026-02-10 05:45:00	4.39	40.94	0.57	7.27	11.46	4.98	0.02
SQU-DS	2026-02-10 06:00:00	4.38	41.16	0.57	7.27	11.46	4.74	0.02
SQU-DS	2026-02-10 06:15:00	4.38	41.03	0.57	7.28	11.46	5.06	0.02
SQU-DS	2026-02-10 06:30:00	4.37	41.01	0.57	7.25	11.48	4.49	0.02
SQU-DS	2026-02-10 06:45:00	4.36	40.97	0.57	7.27	11.46	4.87	0.02
SQU-DS	2026-02-10 07:00:00	4.36	41.00	0.57	7.27	11.47	5.05	0.02
SQU-DS	2026-02-10 07:15:00	4.35	41.08	0.57	7.25	11.49	5.04	0.02
SQU-DS	2026-02-10 07:30:00	4.35	41.22	0.57	7.25	11.48	4.87	0.02
SQU-DS	2026-02-10 07:45:00	4.34	41.23	0.57	7.27	11.48	5.43	0.02
SQU-DS	2026-02-10 08:00:00	4.34	41.25	0.57	7.29	11.48	4.81	0.02
SQU-DS	2026-02-10 08:15:00	4.34	41.12	0.57	7.27	11.48	5.15	0.02
SQU-DS	2026-02-10 08:30:00	4.34	41.18	0.57	7.28	11.50	4.72	0.02
SQU-DS	2026-02-10 08:45:00	4.34	41.46	0.57	7.29	11.47	4.53	0.02
SQU-DS	2026-02-10 09:00:00	4.35	41.46	0.56	7.30	11.49	4.82	0.02
SQU-DS	2026-02-10 09:15:00	4.36	41.52	0.56	7.30	11.49	4.70	0.02
SQU-DS	2026-02-10 09:30:00	4.38	41.62	0.56	7.29	11.50	4.88	0.02
SQU-DS	2026-02-10 09:45:00	4.42	41.80	0.56	7.29	11.49	4.90	0.02
SQU-DS	2026-02-10 10:00:00	4.45	41.83	0.56	7.31	11.51	4.68	0.02
SQU-DS	2026-02-10 10:15:00	4.50	41.78	0.56	7.29	11.50	5.89	0.02
SQU-DS	2026-02-10 10:30:00	4.54	41.87	0.56	7.28	11.51	6.73	0.02
SQU-DS	2026-02-10 10:45:00	4.58	42.09	0.56	7.31	11.48	5.36	0.02
SQU-DS	2026-02-10 11:00:00	4.61	42.10	0.56	7.27	11.45	5.06	0.02
SQU-DS	2026-02-10 11:15:00	4.66	42.19	0.56	7.29	11.43	5.07	0.02
SQU-DS	2026-02-10 11:30:00	4.70	42.40	0.56	7.30	11.44	5.12	0.02
SQU-DS	2026-02-10 11:45:00	4.75	42.35	0.56	7.31	11.43	4.99	0.02
SQU-DS	2026-02-10 12:00:00	4.83	42.40	0.56	7.30	11.42	5.02	0.02
SQU-DS	2026-02-10 12:15:00	4.90	42.12	0.56	7.29	11.42	5.15	0.02
SQU-DS	2026-02-10 12:30:00	4.96	42.19	0.56	7.27	11.42	5.14	0.02
SQU-DS	2026-02-10 12:45:00	4.96	42.24	0.56	7.28	11.41	5.37	0.02
SQU-DS	2026-02-10 13:00:00	4.90	42.29	0.56	7.27	11.39	5.05	0.02
SQU-DS	2026-02-10 13:15:00	4.87	42.31	0.56	7.30	11.41	5.03	0.02
SQU-DS	2026-02-10 13:30:00	4.87	42.26	0.56	7.28	11.42	5.60	0.02
SQU-DS	2026-02-10 13:45:00	4.92	42.32	0.56	7.28	11.39	5.18	0.02
SQU-DS	2026-02-10 14:00:00	4.95	42.22	0.56	7.26	11.39	5.21	0.02
SQU-DS	2026-02-10 14:15:00	4.96	42.29	0.56	7.30	11.39	7.78	0.02
SQU-DS	2026-02-10 14:30:00	4.93	42.11	0.56	7.27	11.40	7.20	0.02
SQU-DS	2026-02-10 14:45:00	4.91	42.26	0.56	7.26	11.38	5.75	0.02
SQU-DS	2026-02-10 15:00:00	4.87	42.08	0.56	7.25	11.38	6.39	0.02
SQU-DS	2026-02-10 15:15:00	4.84	41.88	0.56	7.25	11.41	5.76	0.02
SQU-DS	2026-02-10 15:30:00	4.82	42.00	0.56	7.26	11.41	18.04	0.02
SQU-DS	2026-02-10 15:45:00	4.80	42.13	0.56	7.28	11.41	5.49	0.02
SQU-DS	2026-02-10 16:00:00	4.78	42.05	0.56	7.28	11.39	5.66	0.02
SQU-DS	2026-02-10 16:15:00	4.77	42.15	0.56	7.29	11.38	5.61	0.02
SQU-DS	2026-02-10 16:30:00	4.77	42.11	0.56	7.29	11.38	5.39	0.02
SQU-DS	2026-02-10 16:45:00	4.77	42.23	0.56	7.29	11.38	5.45	0.02
SQU-DS	2026-02-10 17:00:00	4.74	42.04	0.56	7.28	11.36	5.28	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-10 17:15:00	4.74	42.37	0.56	7.28	11.36	5.39	0.02
SQU-DS	2026-02-10 17:30:00	4.73	42.38	0.56	7.29	11.35	5.29	0.02
SQU-DS	2026-02-10 17:45:00	4.71	42.33	0.56	7.27	11.33	5.33	0.02
SQU-DS	2026-02-10 18:00:00	4.70	42.48	0.56	7.27	11.32	5.08	0.02
SQU-DS	2026-02-10 18:15:00	4.69	42.60	0.56	7.27	11.34	5.26	0.02
SQU-DS	2026-02-10 18:30:00	4.68	42.51	0.56	7.28	11.32	5.48	0.02
SQU-DS	2026-02-10 18:45:00	4.68	42.58	0.56	7.29	11.33	5.50	0.02
SQU-DS	2026-02-10 19:00:00	4.68	42.65	0.56	7.29	11.30	5.41	0.02
SQU-DS	2026-02-10 19:15:00	4.67	42.71	0.56	7.26	11.30	5.34	0.02
SQU-DS	2026-02-10 19:30:00	4.67	42.78	0.56	7.26	11.30	8.31	0.02
SQU-DS	2026-02-10 19:45:00	4.67	42.95	0.56	7.27	11.30	5.38	0.02
SQU-DS	2026-02-10 20:00:00	4.67	42.87	0.56	7.26	11.30	5.45	0.02
SQU-DS	2026-02-10 20:15:00	4.67	43.16	0.57	7.25	11.28	6.76	0.02
SQU-DS	2026-02-10 20:30:00	4.66	42.98	0.56	7.27	11.29	5.48	0.02
SQU-DS	2026-02-10 20:45:00	4.65	43.23	0.56	7.28	11.30	5.42	0.02
SQU-DS	2026-02-10 21:00:00	4.64	43.20	0.56	7.27	11.29	5.28	0.02
SQU-DS	2026-02-10 21:15:00	4.64	43.10	0.56	7.26	11.27	5.42	0.02
SQU-DS	2026-02-10 21:30:00	4.63	43.37	0.56	7.26	11.28	6.33	0.02
SQU-DS	2026-02-10 21:45:00	4.61	43.47	0.57	7.23	11.28	5.91	0.02
SQU-DS	2026-02-10 22:00:00	4.59	43.36	0.56	7.28	11.28	5.42	0.02
SQU-DS	2026-02-10 22:15:00	4.58	43.45	0.56	7.27	11.29	5.29	0.02
SQU-DS	2026-02-10 22:30:00	4.56	43.50	0.56	7.28	11.29	5.51	0.02
SQU-DS	2026-02-10 22:45:00	4.54	43.39	0.57	7.25	11.27	5.29	0.02
SQU-DS	2026-02-10 23:00:00	4.52	43.58	0.56	7.29	11.29	5.56	0.02
SQU-DS	2026-02-10 23:15:00	4.50	43.76	0.56	7.29	11.30	5.90	0.02
SQU-DS	2026-02-10 23:30:00	4.47	43.67	0.56	7.27	11.29	5.93	0.02
SQU-DS	2026-02-10 23:45:00	4.45	43.65	0.56	7.28	11.31	5.70	0.02
SQU-DS	2026-02-11 00:00:00	4.41	43.61	0.56	7.27	11.29	7.17	0.02
SQU-DS	2026-02-11 00:15:00	4.39	43.56	0.56	7.28	11.29	6.82	0.02
SQU-DS	2026-02-11 00:30:00	4.37	43.42	0.56	7.29	11.32	6.02	0.02
SQU-DS	2026-02-11 00:45:00	4.33	43.55	0.56	7.30	11.32	5.83	0.02
SQU-DS	2026-02-11 01:00:00	4.30	43.53	0.56	7.29	11.34	6.25	0.02
SQU-DS	2026-02-11 01:15:00	4.27	43.49	0.56	7.30	11.33	5.32	0.02
SQU-DS	2026-02-11 01:30:00	4.24	43.45	0.56	7.31	11.35	4.93	0.02
SQU-DS	2026-02-11 01:45:00	4.21	43.41	0.56	7.30	11.37	6.31	0.02
SQU-DS	2026-02-11 02:00:00	4.18	43.50	0.56	7.30	11.38	6.07	0.02
SQU-DS	2026-02-11 02:15:00	4.16	43.40	0.57	7.29	11.39	5.88	0.02
SQU-DS	2026-02-11 02:30:00	4.14	43.35	0.56	7.32	11.40	6.06	0.02
SQU-DS	2026-02-11 02:45:00	4.11	43.46	0.57	7.30	11.40	5.79	0.02
SQU-DS	2026-02-11 03:00:00	4.08	43.59	0.57	7.30	11.41	6.42	0.02
SQU-DS	2026-02-11 03:15:00	4.07	43.70	0.56	7.31	11.42	5.81	0.02
SQU-DS	2026-02-11 03:30:00	4.05	43.63	0.56	7.31	11.45	6.01	0.02
SQU-DS	2026-02-11 03:45:00	4.02	43.69	0.56	7.33	11.42	6.08	0.02
SQU-DS	2026-02-11 04:00:00	4.00	43.56	0.56	7.31	11.43	6.25	0.02
SQU-DS	2026-02-11 04:15:00	3.98	43.82	0.57	7.30	11.45	5.62	0.02
SQU-DS	2026-02-11 04:30:00	3.96	43.87	0.57	7.29	11.45	5.70	0.02
SQU-DS	2026-02-11 04:45:00	3.95	43.78	0.57	7.29	11.45	5.92	0.02
SQU-DS	2026-02-11 05:00:00	3.92	43.66	0.56	7.32	11.45	6.30	0.02
SQU-DS	2026-02-11 05:15:00	3.90	43.64	0.57	7.29	11.47	5.86	0.02
SQU-DS	2026-02-11 05:30:00	3.89	43.99	0.57	7.30	11.47	5.70	0.02
SQU-DS	2026-02-11 05:45:00	3.87	43.78	0.56	7.31	11.46	6.16	0.02
SQU-DS	2026-02-11 06:00:00	3.86	43.77	0.56	7.30	11.48	15.34	0.02
SQU-DS	2026-02-11 06:15:00	3.83	43.84	0.57	7.28	11.49	309.64	0.02
SQU-DS	2026-02-11 06:30:00	3.82	43.87	0.56	7.31	11.49	45.01	0.02
SQU-DS	2026-02-11 06:45:00	3.80	41.66	0.57	7.28	11.48	2.09	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-11 07:00:00	3.77	43.86	0.57	7.27	11.50	1.81	0.02
SQU-DS	2026-02-11 07:15:00	3.76	43.97	0.57	7.27	11.52	2.29	0.02
SQU-DS	2026-02-11 07:30:00	3.75	43.98	0.57	7.26	11.51	2.94	0.02
SQU-DS	2026-02-11 07:45:00	3.72	43.94	0.57	7.26	11.52	2.71	0.02
SQU-DS	2026-02-11 08:00:00	3.70	44.04	0.57	7.28	11.54	2.31	0.02
SQU-DS	2026-02-11 08:15:00	3.70	44.20	0.57	7.29	11.53	2.07	0.02
SQU-DS	2026-02-11 08:30:00	3.69	44.22	0.57	7.27	11.55	2.59	0.02
SQU-DS	2026-02-11 08:45:00	3.67	44.44	0.57	7.26	11.57	3.24	0.02
SQU-DS	2026-02-11 09:00:00	3.69	44.48	0.57	7.27	11.58	2.04	0.02
SQU-DS	2026-02-11 09:15:00	3.68	44.60	0.56	7.28	11.58	1.82	0.02
SQU-DS	2026-02-11 09:30:00	3.70	44.89	0.56	7.28	11.57	2.57	0.02
SQU-DS	2026-02-11 09:45:00	3.73	44.99	0.56	7.31	11.56	2.11	0.02
SQU-DS	2026-02-11 10:00:00	3.75	45.22	0.56	7.30	11.58	2.07	0.02
SQU-DS	2026-02-11 10:15:00	3.78	45.18	0.56	7.31	11.56	2.26	0.02
SQU-DS	2026-02-11 10:30:00	3.80	45.44	0.56	7.29	11.57	2.85	0.02
SQU-DS	2026-02-11 10:45:00	3.84	45.37	0.56	7.31	11.56	3.40	0.02
SQU-DS	2026-02-11 11:00:00	3.89	45.37	0.56	7.28	11.57	2.01	0.02
SQU-DS	2026-02-11 11:15:00	3.93	45.33	0.56	7.30	11.55	2.34	0.02
SQU-DS	2026-02-11 11:30:00	3.98	45.46	0.56	7.28	11.54	2.11	0.02
SQU-DS	2026-02-11 11:45:00	4.03	45.39	0.56	7.31	11.56	2.16	0.02
SQU-DS	2026-02-11 12:00:00	4.08	45.82	0.56	7.28	11.55	2.08	0.02
SQU-DS	2026-02-11 12:15:00	4.14	45.64	0.56	7.28	11.54	2.73	0.02
SQU-DS	2026-02-11 12:30:00	4.19	45.71	0.56	7.28	11.52	2.09	0.02
SQU-DS	2026-02-11 12:45:00	4.24	45.71	0.56	7.28	11.54	2.28	0.02
SQU-DS	2026-02-11 13:00:00	4.28	45.89	0.56	7.27	11.54	2.15	0.02
SQU-DS	2026-02-11 13:15:00	4.31	45.91	0.56	7.30	11.51	2.47	0.02
SQU-DS	2026-02-11 13:30:00	4.34	45.95	0.56	7.28	11.49	2.12	0.02
SQU-DS	2026-02-11 13:45:00	4.36	45.63	0.56	7.28	11.47	1.99	0.02
SQU-DS	2026-02-11 14:00:00	4.38	45.54	0.56	7.28	11.48	2.04	0.02
SQU-DS	2026-02-11 14:15:00	4.40	45.55	0.56	7.28	11.48	2.08	0.02
SQU-DS	2026-02-11 14:30:00	4.41	45.34	0.56	7.26	11.49	2.10	0.02
SQU-DS	2026-02-11 14:45:00	4.43	45.53	0.56	7.29	11.49	3.45	0.02
SQU-DS	2026-02-11 15:00:00	4.45	45.70	0.56	7.26	11.49	2.38	0.02
SQU-DS	2026-02-11 15:15:00	4.45	45.95	0.56	7.27	11.47	2.64	0.02
SQU-DS	2026-02-11 15:30:00	4.44	45.77	0.56	7.28	11.47	2.21	0.02
SQU-DS	2026-02-11 15:45:00	4.42	45.76	0.56	7.30	11.48	2.34	0.02
SQU-DS	2026-02-11 16:00:00	4.39	45.82	0.56	7.31	11.48	2.24	0.02
SQU-DS	2026-02-11 16:15:00	4.35	46.05	0.56	7.27	11.48	2.30	0.02
SQU-DS	2026-02-11 16:30:00	4.30	45.88	0.56	7.27	11.47	2.35	0.02
SQU-DS	2026-02-11 16:45:00	4.27	45.72	0.56	7.28	11.47	2.44	0.02
SQU-DS	2026-02-11 17:00:00	4.24	45.86	0.56	7.27	11.48	2.24	0.02
SQU-DS	2026-02-11 17:15:00	4.22	45.89	0.56	7.31	11.48	2.31	0.02
SQU-DS	2026-02-11 17:30:00	4.20	45.83	0.56	7.26	11.47	2.52	0.02
SQU-DS	2026-02-11 17:45:00	4.18	46.37	0.56	7.27	11.49	2.65	0.02
SQU-DS	2026-02-11 18:00:00	4.18	46.02	0.56	7.28	11.48	2.78	0.02
SQU-DS	2026-02-11 18:15:00	4.17	45.95	0.56	7.28	11.46	2.67	0.02
SQU-DS	2026-02-11 18:30:00	4.16	46.04	0.56	7.27	11.43	2.75	0.02
SQU-DS	2026-02-11 18:45:00	4.16	46.13	0.56	7.28	11.44	3.56	0.02
SQU-DS	2026-02-11 19:00:00	4.16	46.19	0.56	7.26	11.42	2.44	0.02
SQU-DS	2026-02-11 19:15:00	4.15	46.39	0.56	7.30	11.42	2.28	0.02
SQU-DS	2026-02-11 19:30:00	4.15	46.43	0.56	7.29	11.41	2.71	0.02
SQU-DS	2026-02-11 19:45:00	4.15	46.51	0.56	7.30	11.39	2.33	0.02
SQU-DS	2026-02-11 20:00:00	4.15	46.63	0.56	7.26	11.39	2.35	0.02
SQU-DS	2026-02-11 20:15:00	4.16	46.62	0.56	7.29	11.38	2.52	0.02
SQU-DS	2026-02-11 20:30:00	4.15	46.74	0.56	7.25	11.38	2.61	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-11 20:45:00	4.15	46.81	0.56	7.28	11.36	2.14	0.02
SQU-DS	2026-02-11 21:00:00	4.16	46.76	0.56	7.28	11.36	2.48	0.02
SQU-DS	2026-02-11 21:15:00	4.15	47.26	0.56	7.28	11.36	2.32	0.02
SQU-DS	2026-02-11 21:30:00	4.14	46.97	0.56	7.28	11.36	2.85	0.02
SQU-DS	2026-02-11 21:45:00	4.14	46.96	0.56	7.28	11.36	3.16	0.02
SQU-DS	2026-02-11 22:00:00	4.13	46.97	0.56	7.26	11.38	2.22	0.02
SQU-DS	2026-02-11 22:15:00	4.13	47.11	0.56	7.25	11.37	3.92	0.02
SQU-DS	2026-02-11 22:30:00	4.12	46.96	0.56	7.25	11.37	3.76	0.02
SQU-DS	2026-02-11 22:45:00	4.11	47.10	0.56	7.28	11.38	3.74	0.02
SQU-DS	2026-02-11 23:00:00	4.12	47.15	0.56	7.26	11.36	3.35	0.02
SQU-DS	2026-02-11 23:15:00	4.11	47.17	0.56	7.30	11.37	2.56	0.02
SQU-DS	2026-02-11 23:30:00	4.11	47.27	0.56	7.29	11.37	2.39	0.02
SQU-DS	2026-02-11 23:45:00	4.11	47.17	0.56	7.29	11.37	2.28	0.02
SQU-DS	2026-02-12 00:00:00	4.11	47.23	0.56	7.28	11.38	2.08	0.02
SQU-DS	2026-02-12 00:15:00	4.10	47.22	0.56	7.26	11.36	3.84	0.02
SQU-DS	2026-02-12 00:30:00	4.10	47.21	0.56	7.27	11.36	4.91	0.02
SQU-DS	2026-02-12 00:45:00	4.09	47.11	0.56	7.28	11.36	2.91	0.02
SQU-DS	2026-02-12 01:00:00	4.08	47.10	0.56	7.25	11.35	2.39	0.02
SQU-DS	2026-02-12 01:15:00	4.07	47.04	0.56	7.25	11.37	2.27	0.02
SQU-DS	2026-02-12 01:30:00	4.05	46.97	0.56	7.26	11.38	4.12	0.02
SQU-DS	2026-02-12 01:45:00	4.05	46.95	0.56	7.31	11.38	2.18	0.02
SQU-DS	2026-02-12 02:00:00	4.03	46.94	0.56	7.30	11.37	2.33	0.02
SQU-DS	2026-02-12 02:15:00	4.01	46.86	0.56	7.26	11.38	2.27	0.02
SQU-DS	2026-02-12 02:30:00	3.99	46.82	0.56	7.31	11.39	2.15	0.02
SQU-DS	2026-02-12 02:45:00	3.98	46.81	0.56	7.33	11.39	2.74	0.02
SQU-DS	2026-02-12 03:00:00	3.97	46.72	0.56	7.34	11.39	5.08	0.02
SQU-DS	2026-02-12 03:15:00	3.96	46.99	0.56	7.32	11.39	2.21	0.02
SQU-DS	2026-02-12 03:30:00	3.96	46.95	0.56	7.32	11.39	2.38	0.02
SQU-DS	2026-02-12 03:45:00	3.94	47.13	0.56	7.34	11.39	2.91	0.02
SQU-DS	2026-02-12 04:00:00	3.93	47.34	0.56	7.34	11.40	2.45	0.02
SQU-DS	2026-02-12 04:15:00	3.92	47.47	0.56	7.32	11.41	2.24	0.02
SQU-DS	2026-02-12 04:30:00	3.91	47.43	0.56	7.33	11.41	2.14	0.02
SQU-DS	2026-02-12 04:45:00	3.90	47.86	0.56	7.32	11.42	2.26	0.02
SQU-DS	2026-02-12 05:00:00	3.91	48.21	0.56	7.35	11.39	2.28	0.02
SQU-DS	2026-02-12 05:15:00	3.90	48.49	0.56	7.33	11.38	2.34	0.02
SQU-DS	2026-02-12 05:30:00	3.90	48.17	0.57	7.31	11.37	2.85	0.02
SQU-DS	2026-02-12 05:45:00	3.89	48.19	0.56	7.34	11.38	2.20	0.02
SQU-DS	2026-02-12 06:00:00	3.89	48.62	0.56	7.32	11.38	2.60	0.02
SQU-DS	2026-02-12 06:15:00	3.88	48.56	0.56	7.31	11.39	2.20	0.02
SQU-DS	2026-02-12 06:30:00	3.89	48.67	0.56	7.31	11.39	2.29	0.02
SQU-DS	2026-02-12 06:45:00	3.88	48.63	0.56	7.30	11.39	2.22	0.02
SQU-DS	2026-02-12 07:00:00	3.89	48.73	0.56	7.32	11.34	3.06	0.02
SQU-DS	2026-02-12 07:15:00	3.88	48.82	0.56	7.29	11.36	2.46	0.02
SQU-DS	2026-02-12 07:30:00	3.88	48.67	0.57	7.28	11.34	2.42	0.02
SQU-DS	2026-02-12 07:45:00	3.88	48.69	0.57	7.28	11.35	2.39	0.02
SQU-DS	2026-02-12 08:00:00	3.88	48.74	0.56	7.29	11.33	3.29	0.02
SQU-DS	2026-02-12 08:15:00	3.88	48.75	0.57	7.27	11.35	2.75	0.02
SQU-DS	2026-02-12 08:30:00	3.89	48.64	0.56	7.27	11.34	2.66	0.02
SQU-DS	2026-02-12 08:45:00	3.89	48.70	0.56	7.27	11.34	2.60	0.02
SQU-DS	2026-02-12 09:00:00	3.90	49.00	0.57	7.25	11.34	2.54	0.02
SQU-DS	2026-02-12 09:15:00	3.91	49.22	0.56	7.28	11.34	2.87	0.02
SQU-DS	2026-02-12 09:30:00	3.93	49.40	0.56	7.27	11.35	2.47	0.02
SQU-DS	2026-02-12 09:45:00	3.93	49.43	0.56	7.28	11.33	2.58	0.02
SQU-DS	2026-02-12 10:00:00	3.95	49.45	0.56	7.27	11.33	3.08	0.02
SQU-DS	2026-02-12 10:15:00	3.96	49.36	0.56	7.24	11.33	2.59	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-12 10:30:00	3.97	49.69	0.56	7.28	11.34	2.64	0.02
SQU-DS	2026-02-12 10:45:00	3.99	49.45	0.56	7.27	11.34	3.15	0.02
SQU-DS	2026-02-12 11:00:00	4.01	49.38	0.56	7.26	11.32	2.33	0.02
SQU-DS	2026-02-12 11:15:00	4.03	49.47	0.56	7.27	11.34	2.45	0.02
SQU-DS	2026-02-12 11:30:00	4.05	49.64	0.56	7.30	11.33	3.95	0.02
SQU-DS	2026-02-12 11:45:00	4.09	49.79	0.56	7.26	11.36	2.69	0.02
SQU-DS	2026-02-12 12:00:00	4.12	49.72	0.56	7.29	11.36	3.09	0.02
SQU-DS	2026-02-12 12:15:00	4.15	49.57	0.56	7.28	11.34	3.19	0.02
SQU-DS	2026-02-12 12:30:00	4.20	49.68	0.56	7.27	11.33	3.43	0.02
SQU-DS	2026-02-12 12:45:00	4.24	49.87	0.56	7.31	11.32	2.38	0.02
SQU-DS	2026-02-12 13:00:00	4.28	49.90	0.56	7.30	11.30	2.54	0.02
SQU-DS	2026-02-12 13:15:00	4.30	49.64	0.56	7.30	11.29	2.70	0.02
SQU-DS	2026-02-12 13:30:00	4.32	49.79	0.56	7.28	11.27	2.86	0.02
SQU-DS	2026-02-12 13:45:00	4.33	49.70	0.56	7.26	11.31	2.88	0.02
SQU-DS	2026-02-12 14:00:00	4.35	49.86	0.56	7.29	11.31	3.92	0.02
SQU-DS	2026-02-12 14:15:00	4.36	49.94	0.56	7.28	11.31	5.27	0.02
SQU-DS	2026-02-12 14:30:00	4.38	49.94	0.56	7.26	11.29	4.72	0.02
SQU-DS	2026-02-12 14:45:00	4.38	49.83	0.56	7.27	11.27	3.46	0.02
SQU-DS	2026-02-12 15:00:00	4.39	49.80	0.56	7.30	11.25	3.11	0.02
SQU-DS	2026-02-12 15:15:00	4.41	49.94	0.56	7.28	11.23	3.56	0.02
SQU-DS	2026-02-12 15:30:00	4.43	49.85	0.56	7.25	11.25	3.07	0.02
SQU-DS	2026-02-12 15:45:00	4.43	49.69	0.56	7.21	11.25	3.93	0.02
SQU-DS	2026-02-12 16:00:00	4.44	49.69	0.56	7.24	11.24	3.08	0.02
SQU-DS	2026-02-12 16:15:00	4.47	50.19	0.56	7.27	11.22	3.34	0.02
SQU-DS	2026-02-12 16:30:00	4.47	50.01	0.56	7.22	11.20	3.78	0.02
SQU-DS	2026-02-12 16:45:00	4.51	50.58	0.56	7.23	11.19	5.48	0.02
SQU-DS	2026-02-12 17:00:00	4.51	50.50	0.56	7.25	11.19	3.06	0.02
SQU-DS	2026-02-12 17:15:00	4.51	50.38	0.56	7.24	11.17	3.05	0.02
SQU-DS	2026-02-12 17:30:00	4.49	50.27	0.56	7.21	11.18	9.46	0.02
SQU-DS	2026-02-12 17:45:00	4.49	49.91	0.56	7.22	11.17	3.11	0.02
SQU-DS	2026-02-12 18:00:00	4.49	50.05	0.56	7.24	11.18	4.08	0.02
SQU-DS	2026-02-12 18:15:00	4.52	50.46	0.56	7.24	11.17	3.52	0.02
SQU-DS	2026-02-12 18:30:00	4.51	50.22	0.56	7.22	11.13	2.87	0.02
SQU-DS	2026-02-12 18:45:00	4.52	50.28	0.56	7.22	11.15	3.33	0.02
SQU-DS	2026-02-12 19:00:00	4.53	50.44	0.56	7.26	11.11	2.56	0.02
SQU-DS	2026-02-12 19:15:00	4.58	51.00	0.56	7.24	11.11	7.30	0.02
SQU-DS	2026-02-12 19:30:00	4.55	50.53	0.56	7.21	11.09	2.93	0.02
SQU-DS	2026-02-12 19:45:00	4.56	50.53	0.56	7.23	11.08	6.47	0.02
SQU-DS	2026-02-12 20:00:00	4.56	50.65	0.56	7.23	11.08	6.41	0.02
SQU-DS	2026-02-12 20:15:00	4.59	51.21	0.56	7.23	11.07	4.31	0.02
SQU-DS	2026-02-12 20:30:00	4.57	50.77	0.56	7.23	11.08	3.11	0.02
SQU-DS	2026-02-12 20:45:00	4.59	51.04	0.56	7.23	11.06	2.97	0.02
SQU-DS	2026-02-12 21:00:00	4.59	50.94	0.56	7.21	11.05	2.79	0.02
SQU-DS	2026-02-12 21:15:00	4.62	51.52	0.56	7.24	11.02	8.62	0.02
SQU-DS	2026-02-12 21:30:00	4.60	50.83	0.56	7.24	11.03	4.66	0.02
SQU-DS	2026-02-12 21:45:00	4.61	51.14	0.56	7.22	11.05	3.39	0.02
SQU-DS	2026-02-12 22:00:00	4.61	51.13	0.56	7.22	11.05	3.39	0.02
SQU-DS	2026-02-12 22:15:00	4.62	51.25	0.56	7.24	11.04	6.96	0.02
SQU-DS	2026-02-12 22:30:00	4.63	51.15	0.56	7.20	11.01	5.17	0.02
SQU-DS	2026-02-12 22:45:00	4.64	51.52	0.56	7.21	10.99	3.93	0.02
SQU-DS	2026-02-12 23:00:00	4.64	51.24	0.56	7.24	11.02	4.37	0.02
SQU-DS	2026-02-12 23:15:00	4.63	51.36	0.56	7.22	11.01	4.38	0.02
SQU-DS	2026-02-12 23:30:00	4.63	51.32	0.56	7.24	11.02	3.27	0.02
SQU-DS	2026-02-12 23:45:00	4.64	51.34	0.56	7.23	11.03	3.41	0.02
SQU-DS	2026-02-13 00:00:00	4.67	51.68	0.56	7.23	11.03	3.41	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-13 00:15:00	4.68	51.70	0.56	7.23	11.00	5.30	0.02
SQU-DS	2026-02-13 00:30:00	4.65	51.54	0.56	7.22	11.01	4.31	0.02
SQU-DS	2026-02-13 00:45:00	4.65	51.14	0.56	7.23	11.00	4.43	0.02
SQU-DS	2026-02-13 01:00:00	4.65	51.25	0.56	7.24	11.01	3.40	0.02
SQU-DS	2026-02-13 01:15:00	4.64	50.98	0.56	7.25	11.01	5.86	0.02
SQU-DS	2026-02-13 01:30:00	4.63	50.88	0.56	7.25	11.00	4.08	0.02
SQU-DS	2026-02-13 01:45:00	4.63	50.71	0.56	7.23	11.00	4.22	0.02
SQU-DS	2026-02-13 02:00:00	4.62	50.29	0.56	7.25	11.02	3.50	0.02
SQU-DS	2026-02-13 02:15:00	4.61	49.98	0.56	7.26	11.04	3.39	0.02
SQU-DS	2026-02-13 02:30:00	4.61	49.90	0.56	7.30	11.05	3.06	0.02
SQU-DS	2026-02-13 02:45:00	4.61	49.76	0.56	7.33	11.04	3.83	0.02
SQU-DS	2026-02-13 03:00:00	4.60	49.70	0.56	7.32	11.02	3.60	0.02
SQU-DS	2026-02-13 03:15:00	4.60	49.57	0.56	7.31	11.05	7.97	0.02
SQU-DS	2026-02-13 03:30:00	4.60	49.59	0.56	7.32	11.03	3.62	0.02
SQU-DS	2026-02-13 03:45:00	4.59	49.31	0.56	7.30	11.05	4.94	0.02
SQU-DS	2026-02-13 04:00:00	4.59	49.31	0.56	7.33	11.06	12.30	0.02
SQU-DS	2026-02-13 04:15:00	4.59	49.32	0.56	7.33	11.06	5.07	0.02
SQU-DS	2026-02-13 04:30:00	4.59	49.26	0.56	7.35	11.04	4.38	0.02
SQU-DS	2026-02-13 04:45:00	4.58	49.23	0.56	7.35	11.03	6.00	0.02
SQU-DS	2026-02-13 05:00:00	4.58	49.46	0.56	7.33	11.02	4.37	0.02
SQU-DS	2026-02-13 05:15:00	4.59	50.57	0.56	7.32	10.98	5.63	0.02
SQU-DS	2026-02-13 05:30:00	4.60	50.21	0.56	7.35	10.97	4.29	0.02
SQU-DS	2026-02-13 05:45:00	4.60	50.54	0.56	7.35	10.97	4.12	0.02
SQU-DS	2026-02-13 06:00:00	4.60	50.85	0.56	7.35	10.97	4.84	0.02
SQU-DS	2026-02-13 06:15:00	4.60	50.90	0.56	7.35	10.95	4.46	0.02
SQU-DS	2026-02-13 06:30:00	4.60	51.13	0.56	7.34	10.94	4.61	0.02
SQU-DS	2026-02-13 06:45:00	4.60	51.60	0.56	7.35	10.94	4.31	0.02
SQU-DS	2026-02-13 07:00:00	4.60	52.06	0.56	7.34	10.93	4.12	0.02
SQU-DS	2026-02-13 07:15:00	4.60	51.55	0.56	7.34	10.92	4.32	0.02
SQU-DS	2026-02-13 07:30:00	4.60	51.61	0.56	7.34	10.91	4.57	0.02
SQU-DS	2026-02-13 07:45:00	4.59	51.46	0.56	7.33	10.90	4.31	0.02
SQU-DS	2026-02-13 08:00:00	4.59	51.76	0.56	7.31	10.91	3.86	0.02
SQU-DS	2026-02-13 08:15:00	4.58	51.37	0.56	7.30	10.94	3.79	0.02
SQU-DS	2026-02-13 08:30:00	4.58	51.33	0.56	7.32	10.94	4.18	0.02
SQU-DS	2026-02-13 08:45:00	4.59	51.33	0.56	7.29	10.95	4.39	0.02
SQU-DS	2026-02-13 09:00:00	4.59	51.24	0.56	7.32	10.93	4.35	0.02
SQU-DS	2026-02-13 09:15:00	4.59	51.23	0.56	7.32	10.92	4.33	0.02
SQU-DS	2026-02-13 09:30:00	4.61	51.40	0.56	7.30	10.95	4.72	0.02
SQU-DS	2026-02-13 09:45:00	4.61	51.36	0.56	7.31	10.96	4.43	0.02
SQU-DS	2026-02-13 10:00:00	4.62	51.69	0.56	7.30	10.97	4.20	0.02
SQU-DS	2026-02-13 10:15:00	4.63	51.62	0.56	7.29	10.98	4.09	0.02
SQU-DS	2026-02-13 10:30:00	4.64	51.76	0.56	7.30	11.02	3.76	0.02
SQU-DS	2026-02-13 10:45:00	4.66	51.81	0.56	7.29	11.01	3.67	0.02
SQU-DS	2026-02-13 11:00:00	4.67	51.76	0.56	7.33	11.00	3.71	0.02
SQU-DS	2026-02-13 11:15:00	4.68	51.72	0.56	7.31	10.99	3.63	0.02
SQU-DS	2026-02-13 11:30:00	4.70	51.71	0.56	7.28	11.00	3.62	0.02
SQU-DS	2026-02-13 11:45:00	4.72	51.64	0.56	7.33	11.00	3.78	0.02
SQU-DS	2026-02-13 12:00:00	4.73	51.47	0.56	7.31	11.01	3.59	0.02
SQU-DS	2026-02-13 12:15:00	4.75	51.80	0.56	7.32	11.00	3.49	0.02
SQU-DS	2026-02-13 12:30:00	4.75	51.57	0.56	7.33	11.01	3.65	0.02
SQU-DS	2026-02-13 12:45:00	4.77	51.57	0.56	7.32	11.02	3.50	0.02
SQU-DS	2026-02-13 13:00:00	4.78	51.81	0.56	7.34	10.99	3.73	0.02
SQU-DS	2026-02-13 13:15:00	4.78	51.92	0.56	7.32	10.98	3.62	0.02
SQU-DS	2026-02-13 13:30:00	4.80	51.88	0.56	7.34	10.97	3.95	0.02
SQU-DS	2026-02-13 13:45:00	4.79	51.77	0.56	7.32	10.97	4.26	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-13 14:00:00	4.80	51.78	0.56	7.33	10.99	4.68	0.02
SQU-DS	2026-02-13 14:15:00	4.81	52.42	0.56	7.31	10.97	3.44	0.02
SQU-DS	2026-02-13 14:30:00	4.80	52.35	0.56	7.30	10.96	3.73	0.02
SQU-DS	2026-02-13 14:45:00	4.81	52.52	0.56	7.33	10.93	3.91	0.02
SQU-DS	2026-02-13 15:00:00	4.81	52.56	0.56	7.34	10.94	6.51	0.02
SQU-DS	2026-02-13 15:15:00	4.81	52.65	0.56	7.33	10.92	3.62	0.02
SQU-DS	2026-02-13 15:30:00	4.81	52.59	0.56	7.28	10.92	3.65	0.02
SQU-DS	2026-02-13 15:45:00	4.82	52.44	0.56	7.27	10.94	3.76	0.02
SQU-DS	2026-02-13 16:00:00	4.83	52.45	0.56	7.29	10.93	4.17	0.02
SQU-DS	2026-02-13 16:15:00	4.84	52.54	0.56	7.32	10.90	4.63	0.02
SQU-DS	2026-02-13 16:30:00	4.83	52.32	0.56	7.27	10.89	4.43	0.02
SQU-DS	2026-02-13 16:45:00	4.85	52.35	0.56	7.28	10.91	4.50	0.02
SQU-DS	2026-02-13 17:00:00	4.86	52.37	0.56	7.24	10.85	4.17	0.02
SQU-DS	2026-02-13 17:15:00	4.86	52.82	0.57	7.22	10.90	7.40	0.02
SQU-DS	2026-02-13 17:30:00	4.89	53.10	0.56	7.23	10.87	12.02	0.02
SQU-DS	2026-02-13 17:45:00	4.88	52.86	0.56	7.23	10.86	3.92	0.02
SQU-DS	2026-02-13 18:00:00	4.87	52.60	0.56	7.21	10.85	4.01	0.02
SQU-DS	2026-02-13 18:15:00	4.87	53.10	0.56	7.21	10.86	3.90	0.02
SQU-DS	2026-02-13 18:30:00	4.82	52.24	0.56	7.24	10.89	3.58	0.02
SQU-DS	2026-02-13 18:45:00	4.82	52.20	0.56	7.22	10.86	16.41	0.02
SQU-DS	2026-02-13 19:00:00	4.81	52.26	0.56	7.22	10.86	4.10	0.02
SQU-DS	2026-02-13 19:15:00	4.83	52.50	0.56	7.21	10.86	10.22	0.02
SQU-DS	2026-02-13 19:30:00	4.82	52.51	0.56	7.22	10.84	4.23	0.02
SQU-DS	2026-02-13 19:45:00	4.80	52.31	0.56	7.23	10.84	4.87	0.02
SQU-DS	2026-02-13 20:00:00	4.81	52.40	0.56	7.23	10.87	12.07	0.02
SQU-DS	2026-02-13 20:15:00	4.81	52.19	0.56	7.23	10.87	4.91	0.02
SQU-DS	2026-02-13 20:30:00	4.83	52.42	0.56	7.25	10.86	4.69	0.02
SQU-DS	2026-02-13 20:45:00	4.81	51.98	0.56	7.26	10.85	3.81	0.02
SQU-DS	2026-02-13 21:00:00	4.80	51.79	0.56	7.25	10.87	4.45	0.02
SQU-DS	2026-02-13 21:15:00	4.80	51.80	0.56	7.24	10.86	3.88	0.02
SQU-DS	2026-02-13 21:30:00	4.79	51.70	0.56	7.28	10.87	4.38	0.02
SQU-DS	2026-02-13 21:45:00	4.79	51.79	0.56	7.28	10.87	4.28	0.02
SQU-DS	2026-02-13 22:00:00	4.79	51.48	0.56	7.28	10.87	5.02	0.02
SQU-DS	2026-02-13 22:15:00	4.79	51.52	0.56	7.25	10.85	4.28	0.02
SQU-DS	2026-02-13 22:30:00	4.78	51.23	0.56	7.27	10.86	4.39	0.02
SQU-DS	2026-02-13 22:45:00	4.78	51.27	0.56	7.28	10.85	4.79	0.02
SQU-DS	2026-02-13 23:00:00	4.78	51.17	0.56	7.29	10.85	4.21	0.02
SQU-DS	2026-02-13 23:15:00	4.78	51.15	0.56	7.28	10.85	4.01	0.02
SQU-DS	2026-02-13 23:30:00	4.77	50.89	0.56	7.29	10.86	6.15	0.02
SQU-DS	2026-02-13 23:45:00	4.76	50.90	0.56	7.28	10.87	5.15	0.02
SQU-DS	2026-02-14 00:00:00	4.76	50.71	0.56	7.27	10.88	4.86	0.02
SQU-DS	2026-02-14 00:15:00	4.76	50.73	0.56	7.23	10.87	4.30	0.02
SQU-DS	2026-02-14 00:30:00	4.75	50.49	0.56	7.24	10.90	9.16	0.02
SQU-DS	2026-02-14 00:45:00	4.74	50.17	0.56	7.30	10.91	4.25	0.02
SQU-DS	2026-02-14 01:00:00	4.73	50.08	0.56	7.27	10.91	5.05	0.02
SQU-DS	2026-02-14 01:15:00	4.71	50.01	0.56	7.30	10.93	4.99	0.02
SQU-DS	2026-02-14 01:30:00	4.71	50.07	0.56	7.29	10.91	4.70	0.02
SQU-DS	2026-02-14 01:45:00	4.70	50.00	0.56	7.29	10.92	4.95	0.02
SQU-DS	2026-02-14 02:00:00	4.69	49.94	0.56	7.29	10.93	5.29	0.02
SQU-DS	2026-02-14 02:15:00	4.68	49.99	0.56	7.33	10.96	4.87	0.02
SQU-DS	2026-02-14 02:30:00	4.66	49.84	0.56	7.31	10.97	4.10	0.02
SQU-DS	2026-02-14 02:45:00	4.63	49.88	0.56	7.34	10.97	4.83	0.02
SQU-DS	2026-02-14 03:00:00	4.61	49.90	0.56	7.36	10.97	4.64	0.02
SQU-DS	2026-02-14 03:15:00	4.60	49.89	0.56	7.36	10.99	5.72	0.02
SQU-DS	2026-02-14 03:30:00	4.57	49.99	0.56	7.35	10.96	4.39	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-14 03:45:00	4.56	50.12	0.56	7.36	10.95	5.25	0.02
SQU-DS	2026-02-14 04:00:00	4.55	50.20	0.56	7.38	10.95	4.59	0.02
SQU-DS	2026-02-14 04:15:00	4.54	50.34	0.56	7.37	10.97	4.87	0.02
SQU-DS	2026-02-14 04:30:00	4.53	50.44	0.56	7.37	10.97	5.44	0.02
SQU-DS	2026-02-14 04:45:00	4.51	50.40	0.56	7.37	10.99	7.78	0.02
SQU-DS	2026-02-14 05:00:00	4.50	50.43	0.56	7.38	10.99	7.37	0.02
SQU-DS	2026-02-14 05:15:00	4.48	50.30	0.56	7.38	11.00	7.17	0.02
SQU-DS	2026-02-14 05:30:00	4.47	50.15	0.56	7.38	11.01	9.05	0.02
SQU-DS	2026-02-14 05:45:00	4.46	50.10	0.56	7.37	11.03	7.12	0.02
SQU-DS	2026-02-14 06:00:00	4.46	50.44	0.56	7.39	11.04	7.33	0.02
SQU-DS	2026-02-14 06:15:00	4.46	51.04	0.56	7.36	11.05	7.45	0.02
SQU-DS	2026-02-14 06:30:00	4.46	51.45	0.56	7.39	11.04	10.58	0.02
SQU-DS	2026-02-14 06:45:00	4.46	51.85	0.56	7.38	11.01	10.24	0.02
SQU-DS	2026-02-14 07:00:00	4.46	52.33	0.56	7.37	10.99	6.10	0.02
SQU-DS	2026-02-14 07:15:00	4.46	52.37	0.56	7.37	10.99	5.97	0.02
SQU-DS	2026-02-14 07:30:00	4.45	52.78	0.56	7.36	10.97	6.14	0.02
SQU-DS	2026-02-14 07:45:00	4.45	52.78	0.57	7.32	10.98	6.13	0.02
SQU-DS	2026-02-14 08:00:00	4.44	52.48	0.56	7.34	10.99	5.91	0.02
SQU-DS	2026-02-14 08:15:00	4.44	52.08	0.56	7.34	10.99	11.32	0.02
SQU-DS	2026-02-14 08:30:00	4.43	51.96	0.56	7.37	10.97	6.31	0.02
SQU-DS	2026-02-14 08:45:00	4.43	51.37	0.57	7.33	10.98	5.90	0.02
SQU-DS	2026-02-14 09:00:00	4.41	51.05	0.56	7.33	11.01	5.54	0.02
SQU-DS	2026-02-14 09:15:00	4.41	50.99	0.56	7.36	11.01	6.34	0.02
SQU-DS	2026-02-14 09:30:00	4.43	50.98	0.56	7.37	11.03	5.53	0.02
SQU-DS	2026-02-14 09:45:00	4.43	50.79	0.56	7.33	11.04	9.36	0.02
SQU-DS	2026-02-14 10:00:00	4.44	50.74	0.56	7.35	11.08	5.62	0.02
SQU-DS	2026-02-14 10:15:00	4.45	50.83	0.56	7.33	11.10	5.36	0.02
SQU-DS	2026-02-14 10:30:00	4.49	50.93	0.56	7.37	11.10	5.40	0.02
SQU-DS	2026-02-14 10:45:00	4.53	51.22	0.56	7.31	11.12	5.64	0.02
SQU-DS	2026-02-14 11:00:00	4.55	51.29	0.56	7.34	11.13	5.58	0.02
SQU-DS	2026-02-14 11:15:00	4.56	51.47	0.56	7.36	11.12	4.98	0.02
SQU-DS	2026-02-14 11:30:00	4.62	51.62	0.56	7.37	11.04	5.27	0.02
SQU-DS	2026-02-14 11:45:00	4.69	51.47	0.56	7.33	11.02	5.42	0.02
SQU-DS	2026-02-14 12:00:00	4.76	51.52	0.56	7.37	10.91	5.08	0.02
SQU-DS	2026-02-14 12:15:00	4.78	51.66	0.56	7.32	10.71	5.28	0.02
SQU-DS	2026-02-14 12:30:00	4.78	51.72	0.56	7.37	10.75	5.83	0.02
SQU-DS	2026-02-14 12:45:00	4.76	51.74	0.56	7.34	10.74	5.99	0.02
SQU-DS	2026-02-14 13:00:00	4.72	51.74	0.56	7.33	10.73	5.57	0.02
SQU-DS	2026-02-14 13:15:00	4.71	51.63	0.56	7.34	10.92	5.50	0.02
SQU-DS	2026-02-14 13:30:00	4.72	51.82	0.56	7.34	10.99	5.97	0.02
SQU-DS	2026-02-14 13:45:00	4.75	51.63	0.56	7.34	11.01	7.52	0.02
SQU-DS	2026-02-14 14:00:00	4.82	51.87	0.56	7.35	11.03	8.12	0.02
SQU-DS	2026-02-14 14:15:00	4.87	51.86	0.56	7.37	11.03	7.26	0.02
SQU-DS	2026-02-14 14:30:00	4.93	51.94	0.56	7.36	11.02	10.82	0.02
SQU-DS	2026-02-14 14:45:00	4.98	52.21	0.56	7.34	10.98	9.09	0.02
SQU-DS	2026-02-14 15:00:00	5.03	52.55	0.56	7.36	10.99	6.12	0.02
SQU-DS	2026-02-14 15:15:00	5.09	52.71	0.56	7.36	11.00	5.31	0.02
SQU-DS	2026-02-14 15:30:00	5.10	52.82	0.56	7.33	10.87	5.85	0.02
SQU-DS	2026-02-14 15:45:00	5.08	53.09	0.56	7.33	10.96	5.38	0.02
SQU-DS	2026-02-14 16:00:00	5.04	53.16	0.56	7.36	10.97	5.50	0.02
SQU-DS	2026-02-14 16:15:00	4.97	53.29	0.56	7.33	10.97	12.83	0.02
SQU-DS	2026-02-14 16:30:00	4.90	53.26	0.56	7.34	10.99	4.82	0.02
SQU-DS	2026-02-14 16:45:00	4.83	53.06	0.56	7.33	11.01	10.00	0.02
SQU-DS	2026-02-14 17:00:00	4.78	53.08	0.56	7.34	11.04	5.45	0.02
SQU-DS	2026-02-14 17:15:00	4.74	52.69	0.56	7.33	11.05	5.67	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-14 17:30:00	4.70	52.69	0.56	7.34	11.07	9.45	0.02
SQU-DS	2026-02-14 17:45:00	4.67	52.59	0.56	7.33	11.06	14.76	0.02
SQU-DS	2026-02-14 18:00:00	4.66	52.47	0.56	7.32	11.00	14.86	0.02
SQU-DS	2026-02-14 18:15:00	4.64	52.57	0.57	7.30	10.92	7.21	0.02
SQU-DS	2026-02-14 18:30:00	4.60	52.47	0.56	7.31	10.91	10.67	0.02
SQU-DS	2026-02-14 18:45:00	4.59	52.51	0.56	7.31	10.96	6.84	0.02
SQU-DS	2026-02-14 19:00:00	4.58	52.55	0.56	7.32	10.98	7.65	0.02
SQU-DS	2026-02-14 19:15:00	4.56	52.47	0.57	7.30	10.99	6.22	0.02
SQU-DS	2026-02-14 19:30:00	4.54	52.54	0.57	7.31	10.99	6.34	0.02
SQU-DS	2026-02-14 19:45:00	4.52	52.78	0.56	7.31	10.98	6.63	0.02
SQU-DS	2026-02-14 20:00:00	4.50	52.63	0.57	7.29	11.00	15.28	0.02
SQU-DS	2026-02-14 20:15:00	4.47	52.50	0.57	7.29	11.01	5.85	0.02
SQU-DS	2026-02-14 20:30:00	4.48	52.92	0.56	7.31	11.03	9.91	0.02
SQU-DS	2026-02-14 20:45:00	4.48	52.79	0.56	7.32	11.02	7.50	0.02
SQU-DS	2026-02-14 21:00:00	4.45	52.75	0.57	7.30	11.04	11.73	0.02
SQU-DS	2026-02-14 21:15:00	4.45	52.64	0.56	7.31	11.05	5.75	0.02
SQU-DS	2026-02-14 21:30:00	4.43	52.75	0.57	7.30	11.04	10.77	0.02
SQU-DS	2026-02-14 21:45:00	4.41	52.64	0.57	7.29	11.03	5.82	0.02
SQU-DS	2026-02-14 22:00:00	4.39	52.80	0.57	7.30	11.08	7.95	0.02
SQU-DS	2026-02-14 22:15:00	4.39	52.77	0.56	7.32	11.03	14.58	0.02
SQU-DS	2026-02-14 22:30:00	4.38	52.74	0.57	7.29	11.03	6.80	0.02
SQU-DS	2026-02-14 22:45:00	4.35	52.78	0.56	7.32	11.08	5.20	0.02
SQU-DS	2026-02-14 23:00:00	4.35	53.04	0.57	7.30	11.08	12.49	0.02
SQU-DS	2026-02-14 23:15:00	4.32	52.76	0.57	7.29	11.06	14.97	0.02
SQU-DS	2026-02-14 23:30:00	4.29	52.78	0.57	7.29	11.07	16.55	0.02
SQU-DS	2026-02-14 23:45:00	4.28	52.88	0.56	7.32	11.09	5.59	0.02
SQU-DS	2026-02-15 00:00:00	4.25	52.59	0.56	7.31	11.08	4.92	0.02
SQU-DS	2026-02-15 00:15:00	4.22	52.70	0.57	7.30	11.14	5.19	0.02
SQU-DS	2026-02-15 00:30:00	4.22	53.03	0.56	7.30	11.09	12.82	0.02
SQU-DS	2026-02-15 00:45:00	4.19	52.79	0.56	7.32	11.12	7.29	0.02
SQU-DS	2026-02-15 01:00:00	4.17	52.80	0.57	7.28	11.11	10.04	0.02
SQU-DS	2026-02-15 01:15:00	4.15	52.75	0.57	7.30	11.12	37.01	0.02
SQU-DS	2026-02-15 01:30:00	4.16	52.89	0.56	7.31	11.10	6.26	0.02
SQU-DS	2026-02-15 01:45:00	4.13	52.73	0.57	7.30	11.05	16.99	0.02
SQU-DS	2026-02-15 02:00:00	4.10	52.73	0.57	7.29	11.09	5.23	0.02
SQU-DS	2026-02-15 02:15:00	4.09	52.75	0.56	7.33	11.08	6.27	0.02
SQU-DS	2026-02-15 02:30:00	4.05	52.37	0.56	7.32	11.08	16.65	0.02
SQU-DS	2026-02-15 02:45:00	4.01	52.29	0.56	7.32	11.09	11.86	0.02
SQU-DS	2026-02-15 03:00:00	3.99	52.09	0.56	7.35	11.08	6.60	0.02
SQU-DS	2026-02-15 03:15:00	3.95	51.87	0.56	7.32	11.08	5.38	0.02
SQU-DS	2026-02-15 03:30:00	3.92	51.65	0.56	7.35	11.12	5.85	0.02
SQU-DS	2026-02-15 03:45:00	3.89	51.51	0.56	7.36	11.09	6.15	0.02
SQU-DS	2026-02-15 04:00:00	3.87	51.33	0.56	7.37	11.10	12.42	0.02
SQU-DS	2026-02-15 04:15:00	3.85	51.16	0.56	7.38	11.11	6.97	0.02
SQU-DS	2026-02-15 04:30:00	3.82	51.06	0.56	7.39	11.09	6.11	0.02
SQU-DS	2026-02-15 04:45:00	3.79	51.03	0.56	7.38	11.09	5.86	0.02
SQU-DS	2026-02-15 05:00:00	3.75	50.97	0.56	7.38	11.08	5.84	0.02
SQU-DS	2026-02-15 05:15:00	3.72	50.89	0.56	7.37	11.08	5.73	0.02
SQU-DS	2026-02-15 05:30:00	3.68	50.89	0.56	7.38	11.09	5.51	0.02
SQU-DS	2026-02-15 05:45:00	3.63	50.90	0.56	7.38	11.10	6.13	0.02
SQU-DS	2026-02-15 06:00:00	3.60	50.98	0.56	7.39	11.15	6.05	0.02
SQU-DS	2026-02-15 06:15:00	3.60	51.05	0.56	7.39	11.19	5.87	0.02
SQU-DS	2026-02-15 06:30:00	3.58	51.33	0.56	7.39	11.23	6.24	0.02
SQU-DS	2026-02-15 06:45:00	3.56	51.93	0.56	7.39	11.26	6.57	0.02
SQU-DS	2026-02-15 07:00:00	3.54	53.06	0.56	7.37	11.28	6.69	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-15 07:15:00	3.54	53.33	0.56	7.38	11.27	7.46	0.02
SQU-DS	2026-02-15 07:30:00	3.52	53.09	0.56	7.38	11.26	7.41	0.02
SQU-DS	2026-02-15 07:45:00	3.51	53.01	0.56	7.38	11.28	6.54	0.02
SQU-DS	2026-02-15 08:00:00	3.50	54.02	0.57	7.35	11.28	7.37	0.02
SQU-DS	2026-02-15 08:15:00	3.49	54.03	0.56	7.37	11.26	6.84	0.02
SQU-DS	2026-02-15 08:30:00	3.48	53.97	0.56	7.37	11.24	7.39	0.02
SQU-DS	2026-02-15 08:45:00	3.47	53.68	0.56	7.38	11.22	6.09	0.02
SQU-DS	2026-02-15 09:00:00	3.46	53.55	0.56	7.37	11.12	6.11	0.02
SQU-DS	2026-02-15 09:15:00	3.48	53.62	0.56	7.38	11.03	6.22	0.02
SQU-DS	2026-02-15 09:30:00	3.50	53.86	0.56	7.36	11.16	6.14	0.02
SQU-DS	2026-02-15 09:45:00	3.52	53.92	0.57	7.33	11.28	6.31	0.02
SQU-DS	2026-02-15 10:00:00	3.56	53.61	0.56	7.35	11.26	5.81	0.02
SQU-DS	2026-02-15 10:15:00	3.59	53.51	0.56	7.34	11.30	5.41	0.02
SQU-DS	2026-02-15 10:30:00	3.62	53.43	0.56	7.38	11.31	5.24	0.02
SQU-DS	2026-02-15 10:45:00	3.70	53.62	0.56	7.35	11.30	5.22	0.02
SQU-DS	2026-02-15 11:00:00	3.76	53.83	0.56	7.32	11.36	5.47	0.02
SQU-DS	2026-02-15 11:15:00	3.80	53.98	0.56	7.36	11.36	5.71	0.02
SQU-DS	2026-02-15 11:30:00	3.85	53.97	0.56	7.38	11.33	7.24	0.02
SQU-DS	2026-02-15 11:45:00	3.92	53.81	0.56	7.32	11.33	7.35	0.02
SQU-DS	2026-02-15 12:00:00	3.96	53.94	0.56	7.35	11.28	5.28	0.02
SQU-DS	2026-02-15 12:15:00	4.02	54.15	0.56	7.32	11.25	8.10	0.02
SQU-DS	2026-02-15 12:30:00	4.06	54.04	0.56	7.37	11.26	7.02	0.02
SQU-DS	2026-02-15 12:45:00	4.11	53.93	0.56	7.32	11.24	6.23	0.02
SQU-DS	2026-02-15 13:00:00	4.15	53.99	0.56	7.33	11.21	5.61	0.02
SQU-DS	2026-02-15 13:15:00	4.19	53.98	0.56	7.33	11.19	5.35	0.02
SQU-DS	2026-02-15 13:30:00	4.24	54.09	0.56	7.33	11.17	5.15	0.02
SQU-DS	2026-02-15 13:45:00	4.27	54.03	0.56	7.34	11.15	5.94	0.02
SQU-DS	2026-02-15 14:00:00	4.29	53.95	0.56	7.37	11.14	6.26	0.02
SQU-DS	2026-02-15 14:15:00	4.28	54.00	0.56	7.34	11.16	6.21	0.02
SQU-DS	2026-02-15 14:30:00	4.28	53.99	0.56	7.37	11.16	6.09	0.02
SQU-DS	2026-02-15 14:45:00	4.24	53.78	0.56	7.37	11.13	6.02	0.02
SQU-DS	2026-02-15 15:00:00	4.22	53.72	0.56	7.37	11.15	5.91	0.02
SQU-DS	2026-02-15 15:15:00	4.19	53.73	0.56	7.36	11.16	6.00	0.02
SQU-DS	2026-02-15 15:30:00	4.16	53.78	0.56	7.38	11.18	6.55	0.02
SQU-DS	2026-02-15 15:45:00	4.15	53.99	0.56	7.39	11.17	6.43	0.02
SQU-DS	2026-02-15 16:00:00	4.12	54.46	0.56	7.36	11.16	6.50	0.02
SQU-DS	2026-02-15 16:15:00	4.11	54.81	0.56	7.37	11.17	5.94	0.02
SQU-DS	2026-02-15 16:30:00	4.10	55.72	0.56	7.35	11.17	6.33	0.02
SQU-DS	2026-02-15 16:45:00	4.09	56.28	0.56	7.36	11.21	5.99	0.02
SQU-DS	2026-02-15 17:00:00	4.07	56.35	0.57	7.34	11.17	7.46	0.02
SQU-DS	2026-02-15 17:15:00	4.06	56.14	0.56	7.35	11.17	6.20	0.02
SQU-DS	2026-02-15 17:30:00	4.04	56.09	0.56	7.36	11.15	6.03	0.02
SQU-DS	2026-02-15 17:45:00	4.03	56.00	0.57	7.33	11.15	6.06	0.02
SQU-DS	2026-02-15 18:00:00	4.02	55.80	0.57	7.34	11.17	7.07	0.02
SQU-DS	2026-02-15 18:15:00	4.01	55.60	0.57	7.33	11.21	6.47	0.02
SQU-DS	2026-02-15 18:30:00	4.01	55.33	0.56	7.34	11.19	6.20	0.02
SQU-DS	2026-02-15 18:45:00	4.01	55.31	0.57	7.30	11.22	6.07	0.02
SQU-DS	2026-02-15 19:00:00	4.03	55.54	0.57	7.30	11.21	7.24	0.02
SQU-DS	2026-02-15 19:15:00	4.00	55.30	0.56	7.30	11.23	6.54	0.02
SQU-DS	2026-02-15 19:30:00	4.01	55.72	0.57	7.27	11.18	6.91	0.02
SQU-DS	2026-02-15 19:45:00	3.98	55.09	0.56	7.28	11.24	6.17	0.02
SQU-DS	2026-02-15 20:00:00	3.98	55.10	0.56	7.29	11.23	5.89	0.02
SQU-DS	2026-02-15 20:15:00	3.99	55.40	0.56	7.27	11.25	6.25	0.02
SQU-DS	2026-02-15 20:30:00	4.00	55.40	0.56	7.30	11.20	6.29	0.02
SQU-DS	2026-02-15 20:45:00	4.02	55.48	0.56	7.28	11.20	6.68	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-15 21:00:00	4.00	55.50	0.56	7.28	11.18	6.24	0.02
SQU-DS	2026-02-15 21:15:00	4.01	55.59	0.56	7.28	11.18	6.91	0.02
SQU-DS	2026-02-15 21:30:00	4.01	55.44	0.56	7.29	11.19	7.11	0.02
SQU-DS	2026-02-15 21:45:00	4.01	55.35	0.56	7.27	11.18	6.48	0.02
SQU-DS	2026-02-15 22:00:00	4.01	55.48	0.56	7.28	11.17	5.93	0.02
SQU-DS	2026-02-15 22:15:00	4.01	55.45	0.56	7.28	11.18	6.29	0.02
SQU-DS	2026-02-15 22:30:00	4.02	55.55	0.56	7.29	11.18	6.96	0.02
SQU-DS	2026-02-15 22:45:00	4.02	55.41	0.56	7.28	11.18	5.80	0.02
SQU-DS	2026-02-15 23:00:00	4.03	55.64	0.56	7.29	11.17	6.62	0.02
SQU-DS	2026-02-15 23:15:00	4.06	55.79	0.56	7.28	11.14	6.17	0.02
SQU-DS	2026-02-15 23:30:00	4.10	55.97	0.56	7.27	11.11	6.20	0.02
SQU-DS	2026-02-15 23:45:00	4.04	55.51	0.56	7.28	11.14	6.11	0.02
SQU-US	2026-02-09 00:00:00							
SQU-US	2026-02-09 00:15:00	4.29	33.43	282.02	7.09	12.83	65.45	0.01
SQU-US	2026-02-09 00:30:00	4.27	35.11	286.99	7.09	12.85	65.24	0.01
SQU-US	2026-02-09 00:45:00	4.25	35.22	289.88	7.09	12.86	67.25	0.01
SQU-US	2026-02-09 01:00:00	4.23	35.09	292.13	7.11	12.86	67.23	0.01
SQU-US	2026-02-09 01:15:00	4.22	35.54	294.73	7.11	12.87	66.47	0.02
SQU-US	2026-02-09 01:30:00	4.20	33.99	297.62	7.11	12.87	68.71	0.01
SQU-US	2026-02-09 01:45:00	4.18	34.02	299.18	7.12	12.87	68.49	0.01
SQU-US	2026-02-09 02:00:00	4.16	33.80	302.15	7.10	12.90	67.72	0.01
SQU-US	2026-02-09 02:15:00	4.14	33.80	303.43	7.12	12.90	66.21	0.01
SQU-US	2026-02-09 02:30:00	4.12	36.89	309.54	7.07	12.90	70.47	0.02
SQU-US	2026-02-09 02:45:00	4.11	36.76	308.42	7.10	12.91	63.29	0.02
SQU-US	2026-02-09 03:00:00	4.10	37.42	309.49	7.11	12.91	62.54	0.02
SQU-US	2026-02-09 03:15:00	4.08	37.16	310.89	7.11	12.91	66.99	0.02
SQU-US	2026-02-09 03:30:00	4.07	33.90	310.15	7.12	12.93	68.67	0.01
SQU-US	2026-02-09 03:45:00	4.05	33.96	316.31	7.11	12.92	70.17	0.01
SQU-US	2026-02-09 04:00:00	4.04	34.03	312.14	7.11	12.94	70.49	0.01
SQU-US	2026-02-09 04:15:00	4.03	34.05	310.00	7.11	12.93	69.35	0.01
SQU-US	2026-02-09 04:30:00	4.03	37.51	313.37	7.07	12.93	69.12	0.02
SQU-US	2026-02-09 04:45:00	4.02	37.43	309.52	7.12	12.94	66.60	0.02
SQU-US	2026-02-09 05:00:00	4.01	37.63	311.09	7.10	12.95	69.46	0.02
SQU-US	2026-02-09 05:15:00	4.01	37.56	312.00	7.12	12.93	64.60	0.02
SQU-US	2026-02-09 05:30:00	4.01	34.22	311.09	7.11	12.94	66.51	0.01
SQU-US	2026-02-09 05:45:00	4.02	34.82	297.91	7.13	12.94	68.79	0.01
SQU-US	2026-02-09 06:00:00	4.02	35.00	291.40	7.13	12.93	69.67	0.01
SQU-US	2026-02-09 06:15:00	4.02	34.78	290.64	7.12	12.93	70.20	0.01
SQU-US	2026-02-09 06:30:00	4.01	34.76	291.46	7.12	12.94	68.55	0.01
SQU-US	2026-02-09 06:45:00	4.01	34.75	292.73	7.12	12.95	67.08	0.01
SQU-US	2026-02-09 07:00:00	4.01	34.86	294.44	7.14	12.94	70.01	0.01
SQU-US	2026-02-09 07:15:00	4.02	35.21	297.91	7.13	12.94	66.90	0.01
SQU-US	2026-02-09 07:30:00	4.03	35.53	301.33	7.14	12.95	73.86	0.02
SQU-US	2026-02-09 07:45:00	4.03	35.43	301.74	7.14	12.92	68.44	0.02
SQU-US	2026-02-09 08:00:00	4.03	35.42	303.29	7.15	12.93	65.32	0.02
SQU-US	2026-02-09 08:15:00	4.03	35.18	305.55	7.15	12.93	71.02	0.01
SQU-US	2026-02-09 08:30:00	4.05	35.67	305.97	7.12	12.93	72.08	0.02
SQU-US	2026-02-09 08:45:00	4.06	35.92	289.48	7.15	12.92	68.15	0.02
SQU-US	2026-02-09 09:00:00	4.08	36.05	287.71	7.15	12.92	67.92	0.02
SQU-US	2026-02-09 09:15:00	4.10	36.25	289.84	7.14	12.92	67.12	0.02
SQU-US	2026-02-09 09:30:00	4.14	36.61	291.28	7.14	12.92	69.02	0.02
SQU-US	2026-02-09 09:45:00	4.16	37.05	297.78	7.15	12.91	66.72	0.02
SQU-US	2026-02-09 10:00:00	4.19	37.11	294.44	7.14	12.91	67.10	0.02
SQU-US	2026-02-09 10:15:00	4.22	37.41	292.96	7.14	12.89	62.79	0.02
SQU-US	2026-02-09 10:30:00	4.25	37.72	296.75	7.09	12.88	69.57	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-09 10:45:00	4.27	37.91	294.83	7.15	12.88	69.61	0.02
SQU-US	2026-02-09 11:00:00	4.29	38.05	297.17	7.14	12.87	63.42	0.02
SQU-US	2026-02-09 11:15:00	4.30	37.76	299.94	7.13	12.87	70.95	0.02
SQU-US	2026-02-09 11:30:00	4.32	37.93	302.79	7.13	12.88	70.99	0.02
SQU-US	2026-02-09 11:45:00	4.34	37.79	303.64	7.14	12.88	64.66	0.02
SQU-US	2026-02-09 12:00:00	4.36	37.68	305.87	7.13	12.87	67.40	0.02
SQU-US	2026-02-09 12:15:00	4.39	38.12	307.36	7.14	12.86	68.90	0.02
SQU-US	2026-02-09 12:30:00	4.42	37.90	309.76	7.11	12.84	68.70	0.02
SQU-US	2026-02-09 12:45:00	4.45	37.88	304.06	7.14	12.85	69.82	0.02
SQU-US	2026-02-09 13:00:00	4.48	37.83	303.65	7.13	12.85	67.98	0.02
SQU-US	2026-02-09 13:15:00	4.51	37.91	303.57	7.14	12.82	70.04	0.02
SQU-US	2026-02-09 13:30:00	4.54	37.91	306.87	7.11	12.82	74.94	0.02
SQU-US	2026-02-09 13:45:00	4.57	38.16	307.27	7.13	12.81	70.99	0.02
SQU-US	2026-02-09 14:00:00	4.58	38.05	308.64	7.14	12.82	72.24	0.02
SQU-US	2026-02-09 14:15:00	4.61	38.24	310.07	7.14	12.81	69.03	0.02
SQU-US	2026-02-09 14:30:00	4.63	37.68	313.75	7.12	12.81	70.35	0.02
SQU-US	2026-02-09 14:45:00	4.68	38.09	311.14	7.15	12.80	69.66	0.02
SQU-US	2026-02-09 15:00:00	4.70	38.06	312.09	7.14	12.79	68.85	0.02
SQU-US	2026-02-09 15:15:00	4.72	38.06	312.90	7.15	12.77	68.59	0.02
SQU-US	2026-02-09 15:30:00	4.74	38.64	314.09	7.12	12.77	73.16	0.02
SQU-US	2026-02-09 15:45:00	4.74	38.42	313.58	7.15	12.77	71.34	0.02
SQU-US	2026-02-09 16:00:00	4.74	38.36	314.44	7.14	12.77	67.98	0.02
SQU-US	2026-02-09 16:15:00	4.76	38.70	313.23	7.16	12.75	71.81	0.02
SQU-US	2026-02-09 16:30:00	4.76	38.29	315.42	7.12	12.74	72.14	0.02
SQU-US	2026-02-09 16:45:00	4.75	38.27	310.29	7.15	12.75	72.61	0.02
SQU-US	2026-02-09 17:00:00	4.76	38.59	308.68	7.15	12.73	72.32	0.02
SQU-US	2026-02-09 17:15:00	4.75	38.80	308.13	7.15	12.72	67.31	0.02
SQU-US	2026-02-09 17:30:00	4.75	39.18	309.11	7.14	12.70	72.76	0.02
SQU-US	2026-02-09 17:45:00	4.75	39.16	309.42	7.15	12.70	74.09	0.02
SQU-US	2026-02-09 18:00:00	4.75	39.12	309.91	7.16	12.70	70.01	0.02
SQU-US	2026-02-09 18:15:00	4.76	39.44	311.66	7.14	12.69	71.12	0.02
SQU-US	2026-02-09 18:30:00	4.75	39.40	314.30	7.11	12.68	72.02	0.02
SQU-US	2026-02-09 18:45:00	4.77	39.54	312.86	7.14	12.66	72.20	0.02
SQU-US	2026-02-09 19:00:00	4.77	39.51	313.63	7.14	12.67	72.19	0.02
SQU-US	2026-02-09 19:15:00	4.78	39.76	314.04	7.15	12.66	72.52	0.02
SQU-US	2026-02-09 19:30:00	4.78	39.66	315.69	7.14	12.65	73.21	0.02
SQU-US	2026-02-09 19:45:00	4.78	39.83	316.78	7.12	12.66	72.30	0.02
SQU-US	2026-02-09 20:00:00	4.78	39.97	316.16	7.15	12.64	71.41	0.02
SQU-US	2026-02-09 20:15:00	4.79	40.10	317.08	7.14	12.65	71.61	0.02
SQU-US	2026-02-09 20:30:00	4.80	40.22	319.12	7.11	12.64	69.81	0.02
SQU-US	2026-02-09 20:45:00	4.80	40.53	317.60	7.14	12.63	72.22	0.02
SQU-US	2026-02-09 21:00:00	4.79	40.22	317.74	7.14	12.63	72.61	0.02
SQU-US	2026-02-09 21:15:00	4.78	39.98	317.75	7.16	12.64	70.58	0.02
SQU-US	2026-02-09 21:30:00	4.79	40.37	320.25	7.13	12.64	76.46	0.02
SQU-US	2026-02-09 21:45:00	4.79	40.68	320.28	7.13	12.64	70.55	0.02
SQU-US	2026-02-09 22:00:00	4.78	40.44	319.69	7.14	12.65	72.88	0.02
SQU-US	2026-02-09 22:15:00	4.78	40.50	320.21	7.15	12.64	73.00	0.02
SQU-US	2026-02-09 22:30:00	4.77	44.35	322.99	7.12	12.64	72.75	0.02
SQU-US	2026-02-09 22:45:00	4.77	44.59	321.11	7.14	12.63	68.70	0.02
SQU-US	2026-02-09 23:00:00	4.76	44.15	321.74	7.12	12.65	73.23	0.02
SQU-US	2026-02-09 23:15:00	4.75	44.34	319.82	7.16	12.64	72.89	0.02
SQU-US	2026-02-09 23:30:00	4.75	40.24	313.44	7.14	12.66	76.97	0.02
SQU-US	2026-02-09 23:45:00	4.73	40.01	296.58	7.17	12.66	74.46	0.02
SQU-US	2026-02-10 00:00:00	4.73	40.51	289.75	7.14	12.66	75.29	0.02
SQU-US	2026-02-10 00:15:00	4.72	40.34	285.33	7.17	12.66	74.50	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-10 00:30:00	4.71	40.15	286.41	7.15	12.66	72.97	0.02
SQU-US	2026-02-10 00:45:00	4.70	39.78	286.21	7.18	12.68	72.68	0.02
SQU-US	2026-02-10 01:00:00	4.70	40.20	288.60	7.17	12.69	72.15	0.02
SQU-US	2026-02-10 01:15:00	4.68	39.97	290.80	7.17	12.68	74.26	0.02
SQU-US	2026-02-10 01:30:00	4.68	40.00	294.94	7.17	12.68	77.21	0.02
SQU-US	2026-02-10 01:45:00	4.67	39.76	295.64	7.17	12.69	70.92	0.02
SQU-US	2026-02-10 02:00:00	4.66	40.02	297.33	7.18	12.70	70.72	0.02
SQU-US	2026-02-10 02:15:00	4.65	39.41	300.63	7.16	12.70	73.75	0.02
SQU-US	2026-02-10 02:30:00	4.65	39.74	304.45	7.15	12.69	75.61	0.02
SQU-US	2026-02-10 02:45:00	4.64	39.83	303.38	7.18	12.70	73.71	0.02
SQU-US	2026-02-10 03:00:00	4.63	39.43	305.25	7.17	12.70	73.27	0.02
SQU-US	2026-02-10 03:15:00	4.62	39.28	306.60	7.18	12.70	71.25	0.02
SQU-US	2026-02-10 03:30:00	4.62	39.69	309.83	7.17	12.70	73.53	0.02
SQU-US	2026-02-10 03:45:00	4.61	39.94	311.26	7.16	12.69	73.60	0.02
SQU-US	2026-02-10 04:00:00	4.60	39.46	311.06	7.17	12.72	73.90	0.02
SQU-US	2026-02-10 04:15:00	4.60	39.53	312.22	7.18	12.72	73.88	0.02
SQU-US	2026-02-10 04:30:00	4.59	43.23	315.59	7.14	12.70	75.33	0.02
SQU-US	2026-02-10 04:45:00	4.59	43.63	314.96	7.15	12.70	74.19	0.02
SQU-US	2026-02-10 05:00:00	4.58	43.51	315.34	7.15	12.70	75.22	0.02
SQU-US	2026-02-10 05:15:00	4.57	43.13	314.56	7.17	12.70	75.66	0.02
SQU-US	2026-02-10 05:30:00	4.56	39.49	305.21	7.17	12.70	78.64	0.02
SQU-US	2026-02-10 05:45:00	4.56	39.64	286.36	7.18	12.69	78.05	0.02
SQU-US	2026-02-10 06:00:00	4.55	39.66	278.29	7.18	12.71	75.98	0.02
SQU-US	2026-02-10 06:15:00	4.54	39.52	276.64	7.16	12.71	79.15	0.02
SQU-US	2026-02-10 06:30:00	4.53	39.59	277.07	7.15	12.71	77.73	0.02
SQU-US	2026-02-10 06:45:00	4.53	39.62	274.13	7.16	12.72	73.98	0.02
SQU-US	2026-02-10 07:00:00	4.51	39.50	276.24	7.17	12.73	76.59	0.02
SQU-US	2026-02-10 07:15:00	4.51	39.93	277.87	7.18	12.73	77.26	0.02
SQU-US	2026-02-10 07:30:00	4.51	40.13	280.96	7.17	12.72	79.16	0.02
SQU-US	2026-02-10 07:45:00	4.50	39.83	283.42	7.17	12.73	78.39	0.02
SQU-US	2026-02-10 08:00:00	4.50	40.02	285.84	7.19	12.72	77.06	0.02
SQU-US	2026-02-10 08:15:00	4.49	39.60	289.11	7.18	12.74	76.30	0.02
SQU-US	2026-02-10 08:30:00	4.50	43.97	296.22	7.13	12.75	76.76	0.02
SQU-US	2026-02-10 08:45:00	4.51	44.35	294.29	7.19	12.74	76.64	0.02
SQU-US	2026-02-10 09:00:00	4.51	44.20	297.39	7.18	12.75	75.27	0.02
SQU-US	2026-02-10 09:15:00	4.53	44.35	299.22	7.19	12.77	70.89	0.02
SQU-US	2026-02-10 09:30:00	4.57	40.44	295.59	7.17	12.76	74.59	0.02
SQU-US	2026-02-10 09:45:00	4.61	40.81	286.48	7.18	12.75	73.37	0.02
SQU-US	2026-02-10 10:00:00	4.65	40.75	279.57	7.19	12.77	70.44	0.02
SQU-US	2026-02-10 10:15:00	4.70	40.82	278.12	7.18	12.76	70.98	0.02
SQU-US	2026-02-10 10:30:00	4.75	40.94	275.58	7.17	12.77	73.85	0.02
SQU-US	2026-02-10 10:45:00	4.80	41.00	265.47	7.19	12.75	74.62	0.02
SQU-US	2026-02-10 11:00:00	4.83	40.88	262.79	7.19	12.77	73.43	0.02
SQU-US	2026-02-10 11:15:00	4.90	41.18	262.57	7.18	12.74	73.66	0.02
SQU-US	2026-02-10 11:30:00	4.94	41.29	264.68	7.18	12.73	77.62	0.02
SQU-US	2026-02-10 11:45:00	5.00	41.23	265.62	7.17	12.73	72.43	0.02
SQU-US	2026-02-10 12:00:00	5.07	41.11	268.04	7.18	12.73	74.17	0.02
SQU-US	2026-02-10 12:15:00	5.16	40.96	270.93	7.16	12.72	74.13	0.02
SQU-US	2026-02-10 12:30:00	5.21	40.70	274.59	7.15	12.70	74.29	0.02
SQU-US	2026-02-10 12:45:00	5.19	40.89	277.04	7.17	12.69	77.16	0.02
SQU-US	2026-02-10 13:00:00	5.13	40.99	280.17	7.16	12.68	76.67	0.02
SQU-US	2026-02-10 13:15:00	5.09	40.81	282.74	7.17	12.70	75.78	0.02
SQU-US	2026-02-10 13:30:00	5.12	41.41	285.23	7.17	12.67	78.76	0.02
SQU-US	2026-02-10 13:45:00	5.16	41.18	287.16	7.17	12.66	75.44	0.02
SQU-US	2026-02-10 14:00:00	5.19	41.37	290.56	7.15	12.64	74.86	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-10 14:15:00	5.16	41.18	292.93	7.16	12.65	74.41	0.02
SQU-US	2026-02-10 14:30:00	5.12	40.52	295.18	7.14	12.64	75.85	0.02
SQU-US	2026-02-10 14:45:00	5.07	40.41	292.76	7.16	12.64	78.63	0.02
SQU-US	2026-02-10 15:00:00	5.02	40.24	292.51	7.17	12.65	77.60	0.02
SQU-US	2026-02-10 15:15:00	4.99	40.38	293.18	7.17	12.65	75.91	0.02
SQU-US	2026-02-10 15:30:00	4.96	40.78	293.45	7.16	12.65	84.09	0.02
SQU-US	2026-02-10 15:45:00	4.93	41.01	294.48	7.17	12.65	75.93	0.02
SQU-US	2026-02-10 16:00:00	4.91	40.78	294.56	7.16	12.64	75.55	0.02
SQU-US	2026-02-10 16:15:00	4.90	41.02	294.08	7.18	12.63	76.79	0.02
SQU-US	2026-02-10 16:30:00	4.89	41.04	297.64	7.13	12.63	77.95	0.02
SQU-US	2026-02-10 16:45:00	4.87	40.74	295.16	7.17	12.63	75.85	0.02
SQU-US	2026-02-10 17:00:00	4.85	40.78	295.74	7.18	12.61	76.93	0.02
SQU-US	2026-02-10 17:15:00	4.85	41.01	296.30	7.18	12.62	76.97	0.02
SQU-US	2026-02-10 17:30:00	4.83	41.36	298.55	7.16	12.61	80.93	0.02
SQU-US	2026-02-10 17:45:00	4.81	41.10	298.69	7.17	12.61	78.30	0.02
SQU-US	2026-02-10 18:00:00	4.80	41.23	299.29	7.18	12.59	77.08	0.02
SQU-US	2026-02-10 18:15:00	4.79	41.43	300.26	7.17	12.60	77.48	0.02
SQU-US	2026-02-10 18:30:00	4.78	41.17	302.63	7.14	12.59	80.01	0.02
SQU-US	2026-02-10 18:45:00	4.77	41.22	297.28	7.18	12.59	77.89	0.02
SQU-US	2026-02-10 19:00:00	4.77	41.13	297.21	7.18	12.57	75.73	0.02
SQU-US	2026-02-10 19:15:00	4.77	41.43	298.18	7.17	12.58	75.98	0.02
SQU-US	2026-02-10 19:30:00	4.77	41.57	300.10	7.15	12.58	83.73	0.02
SQU-US	2026-02-10 19:45:00	4.78	41.63	301.66	7.16	12.58	80.86	0.02
SQU-US	2026-02-10 20:00:00	4.78	41.89	302.59	7.17	12.57	79.78	0.02
SQU-US	2026-02-10 20:15:00	4.78	41.96	304.29	7.17	12.56	80.34	0.02
SQU-US	2026-02-10 20:30:00	4.76	42.06	307.86	7.13	12.56	80.61	0.02
SQU-US	2026-02-10 20:45:00	4.76	42.14	304.75	7.16	12.56	80.09	0.02
SQU-US	2026-02-10 21:00:00	4.75	42.09	304.42	7.17	12.57	80.09	0.02
SQU-US	2026-02-10 21:15:00	4.74	42.17	305.04	7.17	12.55	79.53	0.02
SQU-US	2026-02-10 21:30:00	4.73	42.85	306.31	7.14	12.56	81.41	0.02
SQU-US	2026-02-10 21:45:00	4.71	42.58	306.97	7.16	12.57	81.00	0.02
SQU-US	2026-02-10 22:00:00	4.69	42.52	307.18	7.17	12.57	80.74	0.02
SQU-US	2026-02-10 22:15:00	4.67	42.58	308.41	7.17	12.58	80.88	0.02
SQU-US	2026-02-10 22:30:00	4.65	42.43	311.68	7.12	12.58	81.55	0.02
SQU-US	2026-02-10 22:45:00	4.63	42.20	308.87	7.17	12.59	81.27	0.02
SQU-US	2026-02-10 23:00:00	4.60	42.41	310.44	7.15	12.59	81.54	0.02
SQU-US	2026-02-10 23:15:00	4.58	42.68	310.40	7.17	12.61	81.13	0.02
SQU-US	2026-02-10 23:30:00	4.55	42.74	309.65	7.16	12.62	84.04	0.02
SQU-US	2026-02-10 23:45:00	4.52	42.50	309.84	7.17	12.63	84.60	0.02
SQU-US	2026-02-11 00:00:00	4.49	42.65	308.12	7.18	12.63	82.74	0.02
SQU-US	2026-02-11 00:15:00	4.45	42.31	308.22	7.17	12.66	82.97	0.02
SQU-US	2026-02-11 00:30:00	4.42	42.21	309.28	7.16	12.67	82.94	0.02
SQU-US	2026-02-11 00:45:00	4.39	42.38	305.94	7.19	12.68	80.07	0.02
SQU-US	2026-02-11 01:00:00	4.35	42.21	305.24	7.20	12.70	82.57	0.02
SQU-US	2026-02-11 01:15:00	4.32	42.11	306.69	7.18	12.72	79.84	0.02
SQU-US	2026-02-11 01:30:00	4.29	42.09	307.26	7.19	12.72	87.67	0.02
SQU-US	2026-02-11 01:45:00	4.26	42.14	306.81	7.21	12.72	82.45	0.02
SQU-US	2026-02-11 02:00:00	4.23	42.10	307.44	7.21	12.74	82.64	0.02
SQU-US	2026-02-11 02:15:00	4.20	41.98	308.51	7.19	12.76	82.30	0.02
SQU-US	2026-02-11 02:30:00	4.17	41.85	309.61	7.18	12.77	82.99	0.02
SQU-US	2026-02-11 02:45:00	4.15	42.08	308.74	7.21	12.77	82.14	0.02
SQU-US	2026-02-11 03:00:00	4.12	42.46	309.69	7.20	12.77	81.10	0.02
SQU-US	2026-02-11 03:15:00	4.11	42.36	310.34	7.19	12.77	80.16	0.02
SQU-US	2026-02-11 03:30:00	4.08	42.48	311.26	7.19	12.78	85.13	0.02
SQU-US	2026-02-11 03:45:00	4.05	42.21	311.60	7.19	12.79	82.39	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-11 04:00:00	4.03	42.44	311.39	7.21	12.80	82.53	0.02
SQU-US	2026-02-11 04:15:00	4.02	42.60	312.35	7.20	12.78	81.06	0.02
SQU-US	2026-02-11 04:30:00	3.99	46.84	315.41	7.15	12.80	82.14	0.02
SQU-US	2026-02-11 04:45:00	3.97	46.41	312.50	7.19	12.80	82.65	0.02
SQU-US	2026-02-11 05:00:00	3.95	46.47	312.58	7.18	12.81	82.77	0.02
SQU-US	2026-02-11 05:15:00	3.94	46.62	312.44	7.18	12.81	84.60	0.02
SQU-US	2026-02-11 05:30:00	3.92	42.34	310.10	7.17	12.81	89.27	0.02
SQU-US	2026-02-11 05:45:00	3.90	42.12	298.32	7.19	12.83	86.78	0.02
SQU-US	2026-02-11 06:00:00	3.89	42.30	294.98	7.18	12.84	85.53	0.02
SQU-US	2026-02-11 06:15:00	3.87	42.19	293.14	7.19	12.84	86.45	0.02
SQU-US	2026-02-11 06:30:00	3.85	42.26	295.59	7.15	12.85	87.40	0.02
SQU-US	2026-02-11 06:45:00	3.83	42.10	291.55	7.16	12.85	86.46	0.02
SQU-US	2026-02-11 07:00:00	3.81	42.34	291.19	7.18	12.85	87.91	0.02
SQU-US	2026-02-11 07:15:00	3.80	42.41	292.24	7.18	12.85	88.34	0.02
SQU-US	2026-02-11 07:30:00	3.78	42.54	296.22	7.16	12.86	88.90	0.02
SQU-US	2026-02-11 07:45:00	3.76	42.34	297.27	7.18	12.88	89.18	0.02
SQU-US	2026-02-11 08:00:00	3.75	42.71	299.62	7.17	12.87	88.66	0.02
SQU-US	2026-02-11 08:15:00	3.74	42.81	300.47	7.19	12.88	87.01	0.02
SQU-US	2026-02-11 08:30:00	3.73	42.56	300.62	7.16	12.90	87.93	0.02
SQU-US	2026-02-11 08:45:00	3.75	42.91	286.98	7.18	12.89	88.10	0.02
SQU-US	2026-02-11 09:00:00	3.75	42.95	283.33	7.18	12.91	88.58	0.02
SQU-US	2026-02-11 09:15:00	3.77	43.45	282.34	7.19	12.90	88.64	0.02
SQU-US	2026-02-11 09:30:00	3.80	44.10	284.56	7.15	12.92	92.27	0.02
SQU-US	2026-02-11 09:45:00	3.82	44.50	284.51	7.18	12.91	87.82	0.02
SQU-US	2026-02-11 10:00:00	3.86	44.35	287.43	7.14	12.93	90.40	0.02
SQU-US	2026-02-11 10:15:00	3.89	44.62	287.02	7.20	12.92	88.29	0.02
SQU-US	2026-02-11 10:30:00	3.92	44.38	290.82	7.17	12.93	86.85	0.02
SQU-US	2026-02-11 10:45:00	3.97	44.37	290.89	7.20	12.92	87.86	0.02
SQU-US	2026-02-11 11:00:00	4.03	44.43	293.06	7.19	12.92	89.46	0.02
SQU-US	2026-02-11 11:15:00	4.08	44.07	295.45	7.19	12.93	88.37	0.02
SQU-US	2026-02-11 11:30:00	4.15	44.50	297.92	7.18	12.91	93.33	0.02
SQU-US	2026-02-11 11:45:00	4.20	44.53	299.02	7.18	12.91	89.86	0.02
SQU-US	2026-02-11 12:00:00	4.26	45.27	299.85	7.19	12.90	89.31	0.02
SQU-US	2026-02-11 12:15:00	4.32	45.20	301.03	7.19	12.88	88.77	0.02
SQU-US	2026-02-11 12:30:00	4.38	44.76	304.68	7.16	12.89	90.33	0.02
SQU-US	2026-02-11 12:45:00	4.42	44.74	303.15	7.19	12.89	90.39	0.02
SQU-US	2026-02-11 13:00:00	4.46	44.84	304.73	7.18	12.85	88.57	0.02
SQU-US	2026-02-11 13:15:00	4.49	45.07	306.44	7.18	12.84	91.97	0.02
SQU-US	2026-02-11 13:30:00	4.52	45.22	308.65	7.14	12.84	98.64	0.02
SQU-US	2026-02-11 13:45:00	4.53	44.49	308.93	7.16	12.84	94.83	0.02
SQU-US	2026-02-11 14:00:00	4.55	44.50	310.00	7.15	12.83	92.71	0.02
SQU-US	2026-02-11 14:15:00	4.57	44.78	310.90	7.15	12.82	94.44	0.02
SQU-US	2026-02-11 14:30:00	4.79	0.00	311.05	7.26	12.98	25.14	0.00
SQU-US	2026-02-11 14:45:00							
SQU-US	2026-02-11 15:00:00	6.66	0.00	165.58	6.65	12.37	15.42	0.00
SQU-US	2026-02-11 15:15:00	6.71	0.00	213.53	7.18	12.37	15.44	0.00
SQU-US	2026-02-11 15:30:00	4.66	44.23	238.57	7.04	12.67	15.64	0.02
SQU-US	2026-02-11 15:45:00	4.61	44.23	258.94	7.04	12.67	15.54	0.02
SQU-US	2026-02-11 16:00:00	4.56	44.29	270.31	7.04	12.68	16.04	0.02
SQU-US	2026-02-11 16:15:00	4.51	45.38	279.17	6.97	12.67	18.23	0.02
SQU-US	2026-02-11 16:30:00	4.46	44.96	280.65	7.03	12.66	16.55	0.02
SQU-US	2026-02-11 16:45:00	4.42	44.94	283.60	7.05	12.67	16.61	0.02
SQU-US	2026-02-11 17:00:00	4.39	44.94	286.36	7.05	12.67	16.66	0.02
SQU-US	2026-02-11 17:15:00	4.36	44.69	290.14	7.02	12.67	17.07	0.02
SQU-US	2026-02-11 17:30:00	4.34	44.84	287.79	7.04	12.66	16.49	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-11 17:45:00	4.32	45.13	288.51	7.04	12.65	20.13	0.02
SQU-US	2026-02-11 18:00:00	4.30	45.17	290.89	7.05	12.66	16.98	0.02
SQU-US	2026-02-11 18:15:00	4.28	45.23	292.74	7.05	12.65	18.66	0.02
SQU-US	2026-02-11 18:30:00	4.28	45.22	294.68	7.04	12.64	17.22	0.02
SQU-US	2026-02-11 18:45:00	4.28	45.50	296.30	7.05	12.64	16.97	0.02
SQU-US	2026-02-11 19:00:00	4.27	45.58	297.06	7.04	12.63	17.76	0.02
SQU-US	2026-02-11 19:15:00	4.27	45.69	299.71	7.03	12.63	16.50	0.02
SQU-US	2026-02-11 19:30:00	4.27	45.73	299.01	7.06	12.62	16.97	0.02
SQU-US	2026-02-11 19:45:00	4.26	45.90	299.94	7.07	12.63	16.79	0.02
SQU-US	2026-02-11 20:00:00	4.27	45.90	301.34	7.06	12.62	16.58	0.02
SQU-US	2026-02-11 20:15:00	4.26	46.43	303.69	7.06	12.62	17.77	0.02
SQU-US	2026-02-11 20:30:00	4.27	46.50	303.94	7.06	12.61	16.30	0.02
SQU-US	2026-02-11 20:45:00	4.26	46.55	305.58	7.06	12.62	16.63	0.02
SQU-US	2026-02-11 21:00:00	4.26	46.83	306.68	7.07	12.62	16.24	0.02
SQU-US	2026-02-11 21:15:00	4.26	50.83	309.13	7.04	12.62	15.78	0.02
SQU-US	2026-02-11 21:30:00	4.25	50.72	307.52	7.06	12.61	15.92	0.02
SQU-US	2026-02-11 21:45:00	4.25	50.79	307.20	7.07	12.63	16.03	0.02
SQU-US	2026-02-11 22:00:00	4.24	50.79	308.03	7.07	12.62	15.74	0.02
SQU-US	2026-02-11 22:15:00	4.23	46.33	297.62	7.07	12.61	18.52	0.02
SQU-US	2026-02-11 22:30:00	4.23	46.34	280.13	7.07	12.63	16.14	0.02
SQU-US	2026-02-11 22:45:00	4.23	46.40	271.92	7.07	12.63	16.28	0.02
SQU-US	2026-02-11 23:00:00	4.22	46.42	268.48	7.08	12.64	16.19	0.02
SQU-US	2026-02-11 23:15:00	4.22	51.18	270.13	7.03	12.66	19.31	0.02
SQU-US	2026-02-11 23:30:00	4.21	51.08	259.24	7.08	12.64	15.87	0.02
SQU-US	2026-02-11 23:45:00	4.21	51.06	261.32	7.08	12.65	15.74	0.02
SQU-US	2026-02-12 00:00:00	4.21	51.20	264.66	7.07	12.64	15.69	0.02
SQU-US	2026-02-12 00:15:00	4.21	46.53	261.70	7.05	12.64	16.80	0.02
SQU-US	2026-02-12 00:30:00	4.21	46.46	250.52	7.07	12.64	15.93	0.02
SQU-US	2026-02-12 00:45:00	4.18	46.25	253.46	7.09	12.66	16.00	0.02
SQU-US	2026-02-12 01:00:00	4.15	46.24	254.19	7.16	12.73	15.90	0.02
SQU-US	2026-02-12 01:15:00	4.13	45.80	254.64	7.15	12.74	15.94	0.02
SQU-US	2026-02-12 01:30:00	4.10	45.72	255.74	7.18	12.77	16.05	0.02
SQU-US	2026-02-12 01:45:00	4.09	45.51	256.55	7.20	12.78	15.89	0.02
SQU-US	2026-02-12 02:00:00	4.07	45.30	259.03	7.22	12.79	16.00	0.02
SQU-US	2026-02-12 02:15:00	4.06	45.40	262.99	7.21	12.80	19.35	0.02
SQU-US	2026-02-12 02:30:00	4.04	45.43	264.24	7.23	12.80	15.97	0.02
SQU-US	2026-02-12 02:45:00	4.03	45.15	267.29	7.25	12.83	15.72	0.02
SQU-US	2026-02-12 03:00:00	4.03	45.56	270.35	7.23	12.83	15.91	0.02
SQU-US	2026-02-12 03:15:00	4.02	45.10	274.96	7.20	12.83	17.22	0.02
SQU-US	2026-02-12 03:30:00	4.01	45.10	275.02	7.24	12.83	15.23	0.02
SQU-US	2026-02-12 03:45:00	4.00	45.40	277.32	7.23	12.82	15.28	0.02
SQU-US	2026-02-12 04:00:00	3.99	45.70	279.00	7.23	12.83	15.40	0.02
SQU-US	2026-02-12 04:15:00	3.98	45.66	281.35	7.23	12.83	17.17	0.02
SQU-US	2026-02-12 04:30:00	3.98	45.91	282.12	7.22	12.83	15.77	0.02
SQU-US	2026-02-12 04:45:00	3.99	46.94	281.13	7.22	12.79	15.74	0.02
SQU-US	2026-02-12 05:00:00	3.99	47.32	281.67	7.21	12.78	15.44	0.02
SQU-US	2026-02-12 05:15:00	3.98	46.50	284.11	7.19	12.81	17.60	0.02
SQU-US	2026-02-12 05:30:00	3.98	46.38	282.75	7.22	12.79	16.17	0.02
SQU-US	2026-02-12 05:45:00	3.98	46.89	283.16	7.22	12.79	15.54	0.02
SQU-US	2026-02-12 06:00:00	3.97	46.90	283.94	7.20	12.79	15.66	0.02
SQU-US	2026-02-12 06:15:00	3.98	47.29	284.75	7.20	12.78	18.58	0.02
SQU-US	2026-02-12 06:30:00	3.98	47.13	284.00	7.20	12.78	15.40	0.02
SQU-US	2026-02-12 06:45:00	3.98	47.15	284.28	7.19	12.78	15.56	0.02
SQU-US	2026-02-12 07:00:00	3.99	47.30	284.57	7.18	12.77	15.62	0.02
SQU-US	2026-02-12 07:15:00	3.99	46.86	286.49	7.15	12.76	16.35	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-12 07:30:00	3.99	46.79	285.64	7.18	12.76	15.71	0.02
SQU-US	2026-02-12 07:45:00	3.99	46.86	286.42	7.16	12.76	16.05	0.02
SQU-US	2026-02-12 08:00:00	4.00	47.06	286.62	7.16	12.75	16.79	0.02
SQU-US	2026-02-12 08:15:00	4.01	46.98	287.71	7.15	12.75	19.50	0.02
SQU-US	2026-02-12 08:30:00	4.02	46.94	287.59	7.14	12.76	16.14	0.02
SQU-US	2026-02-12 08:45:00	4.04	47.27	287.55	7.14	12.74	15.62	0.02
SQU-US	2026-02-12 09:00:00	4.06	47.69	288.46	7.15	12.73	15.96	0.02
SQU-US	2026-02-12 09:15:00	4.08	52.65	291.64	7.10	12.72	16.10	0.02
SQU-US	2026-02-12 09:30:00	4.10	53.02	291.41	7.13	12.71	15.91	0.02
SQU-US	2026-02-12 09:45:00	4.11	52.88	293.20	7.14	12.74	15.83	0.02
SQU-US	2026-02-12 10:00:00	4.13	53.15	293.79	7.15	12.73	15.73	0.02
SQU-US	2026-02-12 10:15:00	4.16	48.50	295.01	7.14	12.73	17.22	0.02
SQU-US	2026-02-12 10:30:00	4.17	48.36	295.73	7.14	12.73	15.75	0.02
SQU-US	2026-02-12 10:45:00	4.18	47.82	294.83	7.16	12.77	15.73	0.02
SQU-US	2026-02-12 11:00:00	4.20	48.00	294.18	7.17	12.78	15.68	0.02
SQU-US	2026-02-12 11:15:00	4.25	48.69	295.15	7.14	12.76	16.71	0.02
SQU-US	2026-02-12 11:30:00	4.29	48.90	293.27	7.16	12.76	15.52	0.02
SQU-US	2026-02-12 11:45:00	4.32	49.07	294.38	7.15	12.74	15.62	0.02
SQU-US	2026-02-12 12:00:00	4.36	48.64	294.19	7.15	12.76	15.71	0.02
SQU-US	2026-02-12 12:15:00	4.41	48.70	294.08	7.17	12.74	16.59	0.02
SQU-US	2026-02-12 12:30:00	4.46	48.76	294.18	7.15	12.73	16.08	0.02
SQU-US	2026-02-12 12:45:00	4.51	48.92	295.14	7.16	12.71	15.57	0.02
SQU-US	2026-02-12 13:00:00	4.54	48.51	296.05	7.16	12.71	15.69	0.02
SQU-US	2026-02-12 13:15:00	4.57	48.73	298.94	7.12	12.70	15.99	0.02
SQU-US	2026-02-12 13:30:00	4.59	48.61	297.58	7.15	12.68	15.66	0.02
SQU-US	2026-02-12 13:45:00	4.60	48.76	297.72	7.15	12.67	15.82	0.02
SQU-US	2026-02-12 14:00:00	4.63	48.99	298.87	7.13	12.66	16.07	0.02
SQU-US	2026-02-12 14:15:00	4.66	49.32	301.39	7.08	12.60	19.73	0.02
SQU-US	2026-02-12 14:30:00	4.67	49.12	301.93	7.08	12.59	15.88	0.02
SQU-US	2026-02-12 14:45:00	4.66	48.96	303.06	7.09	12.60	16.40	0.02
SQU-US	2026-02-12 15:00:00	4.69	48.99	302.64	7.07	12.58	16.25	0.02
SQU-US	2026-02-12 15:15:00	4.77	49.32	306.32	6.96	12.47	17.89	0.02
SQU-US	2026-02-12 15:30:00	4.79	49.23	307.37	7.00	12.46	17.07	0.02
SQU-US	2026-02-12 15:45:00	4.75	48.94	307.89	7.03	12.51	16.44	0.02
SQU-US	2026-02-12 16:00:00	4.74	48.87	307.47	7.06	12.52	16.04	0.02
SQU-US	2026-02-12 16:15:00	4.73	48.94	307.83	7.05	12.54	24.68	0.02
SQU-US	2026-02-12 16:30:00	4.72	48.95	306.33	7.09	12.54	16.47	0.02
SQU-US	2026-02-12 16:45:00	4.73	49.14	305.70	7.09	12.55	16.97	0.02
SQU-US	2026-02-12 17:00:00	4.73	49.29	305.12	7.10	12.53	16.39	0.02
SQU-US	2026-02-12 17:15:00	4.72	49.04	305.90	7.07	12.52	17.46	0.02
SQU-US	2026-02-12 17:30:00	4.72	48.93	303.87	7.10	12.51	16.37	0.02
SQU-US	2026-02-12 17:45:00	4.72	49.06	302.89	7.11	12.51	45.30	0.02
SQU-US	2026-02-12 18:00:00	4.72	49.14	303.22	7.10	12.49	16.16	0.02
SQU-US	2026-02-12 18:15:00	4.71	49.10	303.28	7.10	12.48	19.35	0.02
SQU-US	2026-02-12 18:30:00	4.72	49.14	302.26	7.12	12.48	15.71	0.02
SQU-US	2026-02-12 18:45:00	4.73	49.21	302.38	7.12	12.47	15.77	0.02
SQU-US	2026-02-12 19:00:00	4.74	49.39	301.59	7.12	12.47	16.19	0.02
SQU-US	2026-02-12 19:15:00	4.75	54.38	305.07	7.06	12.45	19.55	0.02
SQU-US	2026-02-12 19:30:00	4.75	54.58	301.50	7.11	12.43	16.32	0.02
SQU-US	2026-02-12 19:45:00	4.75	54.61	301.81	7.11	12.46	16.49	0.02
SQU-US	2026-02-12 20:00:00	4.77	55.04	301.22	7.11	12.43	16.38	0.02
SQU-US	2026-02-12 20:15:00	4.77	50.15	300.25	7.12	12.44	17.08	0.02
SQU-US	2026-02-12 20:30:00	4.79	50.24	298.26	7.12	12.43	15.90	0.02
SQU-US	2026-02-12 20:45:00	4.80	50.50	298.90	7.11	12.42	16.26	0.02
SQU-US	2026-02-12 21:00:00	4.80	50.66	298.51	7.12	12.43	16.38	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-12 21:15:00	4.81	50.60	301.08	7.09	12.42	17.43	0.02
SQU-US	2026-02-12 21:30:00	4.81	50.46	299.71	7.11	12.42	16.04	0.02
SQU-US	2026-02-12 21:45:00	4.82	50.76	299.93	7.11	12.41	15.88	0.02
SQU-US	2026-02-12 22:00:00	4.82	50.56	299.47	7.11	12.42	16.03	0.02
SQU-US	2026-02-12 22:15:00	4.82	50.68	299.96	7.10	12.42	18.57	0.02
SQU-US	2026-02-12 22:30:00	4.83	50.89	299.36	7.12	12.40	15.93	0.02
SQU-US	2026-02-12 22:45:00	4.83	50.99	299.80	7.11	12.41	16.34	0.02
SQU-US	2026-02-12 23:00:00	4.83	51.02	299.20	7.12	12.42	16.36	0.02
SQU-US	2026-02-12 23:15:00	4.83	50.85	301.35	7.09	12.40	17.87	0.02
SQU-US	2026-02-12 23:30:00	4.84	50.77	299.11	7.12	12.40	16.11	0.02
SQU-US	2026-02-12 23:45:00	4.84	50.67	300.08	7.12	12.40	16.12	0.02
SQU-US	2026-02-13 00:00:00	4.84	51.09	299.54	7.13	12.40	16.10	0.02
SQU-US	2026-02-13 00:15:00	4.84	50.74	300.42	7.12	12.41	16.34	0.02
SQU-US	2026-02-13 00:30:00	4.84	50.49	300.10	7.14	12.41	16.13	0.02
SQU-US	2026-02-13 00:45:00	4.83	50.33	300.39	7.13	12.41	16.06	0.02
SQU-US	2026-02-13 01:00:00	4.84	50.24	301.19	7.12	12.40	16.60	0.02
SQU-US	2026-02-13 01:15:00	4.91	55.44	306.29	6.98	12.30	16.64	0.02
SQU-US	2026-02-13 01:30:00	4.84	54.54	306.67	7.09	12.35	17.02	0.02
SQU-US	2026-02-13 01:45:00	4.81	53.81	306.80	7.14	12.44	16.62	0.02
SQU-US	2026-02-13 02:00:00	4.77	52.91	307.77	7.19	12.46	16.50	0.02
SQU-US	2026-02-13 02:15:00	4.76	47.99	308.85	7.21	12.50	17.26	0.02
SQU-US	2026-02-13 02:30:00	4.74	47.66	307.10	7.24	12.54	16.71	0.02
SQU-US	2026-02-13 02:45:00	4.74	47.61	308.22	7.24	12.55	16.57	0.02
SQU-US	2026-02-13 03:00:00	4.73	47.49	309.38	7.24	12.55	16.39	0.02
SQU-US	2026-02-13 03:15:00	4.73	47.64	312.92	7.21	12.56	18.73	0.02
SQU-US	2026-02-13 03:30:00	4.73	47.34	311.38	7.25	12.57	16.56	0.02
SQU-US	2026-02-13 03:45:00	4.72	47.53	311.84	7.25	12.54	17.08	0.02
SQU-US	2026-02-13 04:00:00	4.72	47.46	311.57	7.26	12.56	17.04	0.02
SQU-US	2026-02-13 04:15:00	4.72	47.61	313.24	7.25	12.57	17.62	0.02
SQU-US	2026-02-13 04:30:00	4.72	47.33	312.12	7.26	12.57	17.28	0.02
SQU-US	2026-02-13 04:45:00	4.72	47.77	312.65	7.25	12.56	17.02	0.02
SQU-US	2026-02-13 05:00:00	4.74	48.75	312.46	7.25	12.54	17.17	0.02
SQU-US	2026-02-13 05:15:00	4.75	54.25	315.70	7.18	12.52	21.92	0.02
SQU-US	2026-02-13 05:30:00	4.75	54.36	312.20	7.24	12.51	17.86	0.02
SQU-US	2026-02-13 05:45:00	4.75	55.08	312.31	7.24	12.50	17.55	0.02
SQU-US	2026-02-13 06:00:00	4.75	54.88	312.63	7.24	12.49	17.49	0.02
SQU-US	2026-02-13 06:15:00	4.75	50.58	313.96	7.20	12.50	18.90	0.02
SQU-US	2026-02-13 06:30:00	4.76	51.26	307.42	7.24	12.47	17.57	0.02
SQU-US	2026-02-13 06:45:00	4.77	52.33	305.82	7.23	12.44	17.57	0.02
SQU-US	2026-02-13 07:00:00	4.76	51.54	304.94	7.23	12.45	18.42	0.02
SQU-US	2026-02-13 07:15:00	4.75	51.43	305.88	7.20	12.46	18.04	0.02
SQU-US	2026-02-13 07:30:00	4.75	51.07	303.37	7.23	12.46	17.79	0.02
SQU-US	2026-02-13 07:45:00	4.75	51.31	302.48	7.22	12.44	17.64	0.02
SQU-US	2026-02-13 08:00:00	4.74	50.69	302.29	7.21	12.45	18.11	0.02
SQU-US	2026-02-13 08:15:00	4.74	50.47	302.77	7.20	12.45	18.51	0.02
SQU-US	2026-02-13 08:30:00	4.74	50.56	301.84	7.20	12.44	18.17	0.02
SQU-US	2026-02-13 08:45:00	4.74	50.27	301.59	7.19	12.45	17.88	0.02
SQU-US	2026-02-13 09:00:00	4.75	50.22	301.59	7.17	12.46	18.33	0.02
SQU-US	2026-02-13 09:15:00	4.76	55.39	303.72	7.13	12.46	18.26	0.02
SQU-US	2026-02-13 09:30:00	4.77	55.21	302.63	7.19	12.47	17.84	0.02
SQU-US	2026-02-13 09:45:00	4.80	55.81	304.87	7.17	12.45	18.08	0.02
SQU-US	2026-02-13 10:00:00	4.80	55.55	306.31	7.18	12.47	17.94	0.02
SQU-US	2026-02-13 10:15:00	4.82	51.07	308.40	7.14	12.45	18.84	0.02
SQU-US	2026-02-13 10:30:00	4.83	51.03	300.97	7.17	12.46	17.92	0.02
SQU-US	2026-02-13 10:45:00	4.85	50.98	297.99	7.17	12.48	17.90	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-13 11:00:00	4.86	50.62	297.17	7.17	12.49	18.24	0.02
SQU-US	2026-02-13 11:15:00	4.88	50.41	297.91	7.16	12.51	19.89	0.02
SQU-US	2026-02-13 11:30:00	4.90	50.45	297.44	7.20	12.49	18.00	0.02
SQU-US	2026-02-13 11:45:00	4.91	49.88	299.90	7.20	12.51	17.86	0.02
SQU-US	2026-02-13 12:00:00	4.94	50.68	300.91	7.21	12.51	18.07	0.02
SQU-US	2026-02-13 12:15:00	4.95	50.36	301.96	7.21	12.51	18.37	0.02
SQU-US	2026-02-13 12:30:00	4.96	50.54	302.96	7.22	12.51	17.28	0.02
SQU-US	2026-02-13 12:45:00	4.97	50.83	304.69	7.20	12.51	17.22	0.02
SQU-US	2026-02-13 13:00:00	4.98	51.01	304.81	7.22	12.49	17.59	0.02
SQU-US	2026-02-13 13:15:00	4.99	51.08	308.12	7.18	12.48	18.79	0.02
SQU-US	2026-02-13 13:30:00	4.99	50.68	306.75	7.22	12.49	18.18	0.02
SQU-US	2026-02-13 13:45:00	5.00	50.99	307.67	7.22	12.49	17.90	0.02
SQU-US	2026-02-13 14:00:00	5.01	51.84	308.19	7.21	12.45	17.97	0.02
SQU-US	2026-02-13 14:15:00	5.01	52.01	308.82	7.20	12.45	18.38	0.02
SQU-US	2026-02-13 14:30:00	5.00	52.18	308.60	7.18	12.43	17.87	0.02
SQU-US	2026-02-13 14:45:00	5.01	52.56	307.10	7.18	12.40	17.66	0.02
SQU-US	2026-02-13 15:00:00	5.01	52.54	309.06	7.15	12.38	17.57	0.02
SQU-US	2026-02-13 15:15:00	5.02	57.28	313.74	7.09	12.37	22.62	0.03
SQU-US	2026-02-13 15:30:00	5.04	57.26	311.71	7.11	12.34	17.72	0.03
SQU-US	2026-02-13 15:45:00	5.07	57.26	315.09	7.03	12.27	17.90	0.03
SQU-US	2026-02-13 16:00:00	5.07	57.21	318.49	7.03	12.26	18.30	0.03
SQU-US	2026-02-13 16:15:00	5.13	52.03	320.82	6.92	12.15	18.93	0.02
SQU-US	2026-02-13 16:30:00	5.20	52.12	323.20	6.92	12.01	18.75	0.02
SQU-US	2026-02-13 16:45:00	5.16	51.80	326.10	6.94	12.05	18.04	0.02
SQU-US	2026-02-13 17:00:00	5.06	51.56	325.71	7.07	12.25	18.70	0.02
SQU-US	2026-02-13 17:15:00	5.02	51.27	325.56	7.10	12.32	18.94	0.02
SQU-US	2026-02-13 17:30:00	5.01	51.16	322.71	7.15	12.33	18.26	0.02
SQU-US	2026-02-13 17:45:00	4.99	50.96	321.99	7.15	12.31	18.04	0.02
SQU-US	2026-02-13 18:00:00	4.98	50.98	322.03	7.15	12.30	17.87	0.02
SQU-US	2026-02-13 18:15:00	4.97	51.38	323.37	7.14	12.31	18.51	0.02
SQU-US	2026-02-13 18:30:00	4.96	51.30	322.12	7.16	12.29	17.85	0.02
SQU-US	2026-02-13 18:45:00	4.94	51.23	322.31	7.15	12.28	18.31	0.02
SQU-US	2026-02-13 19:00:00	4.94	51.49	321.77	7.16	12.28	17.91	0.02
SQU-US	2026-02-13 19:15:00	4.94	51.52	323.99	7.12	12.28	18.06	0.02
SQU-US	2026-02-13 19:30:00	4.94	51.47	321.83	7.15	12.28	18.06	0.02
SQU-US	2026-02-13 19:45:00	4.94	51.32	322.17	7.14	12.26	18.11	0.02
SQU-US	2026-02-13 20:00:00	4.95	51.36	322.67	7.11	12.26	17.98	0.02
SQU-US	2026-02-13 20:15:00	4.97	51.50	324.35	7.07	12.20	21.11	0.02
SQU-US	2026-02-13 20:30:00	5.02	51.43	325.78	7.02	12.10	18.21	0.02
SQU-US	2026-02-13 20:45:00	5.04	51.63	327.53	7.01	12.10	18.28	0.02
SQU-US	2026-02-13 21:00:00	5.05	51.34	329.00	6.99	12.06	18.20	0.02
SQU-US	2026-02-13 21:15:00	5.05	51.42	332.32	6.93	11.99	18.50	0.02
SQU-US	2026-02-13 21:30:00	5.04	51.43	330.98	6.98	12.08	18.15	0.02
SQU-US	2026-02-13 21:45:00	5.03	51.18	331.45	6.99	12.08	18.99	0.02
SQU-US	2026-02-13 22:00:00	5.01	51.08	331.91	7.02	12.09	18.08	0.02
SQU-US	2026-02-13 22:15:00	5.00	50.98	334.19	6.98	12.17	19.29	0.02
SQU-US	2026-02-13 22:30:00	5.00	50.77	332.47	7.02	12.13	18.22	0.02
SQU-US	2026-02-13 22:45:00	5.00	50.77	332.56	7.02	12.15	18.71	0.02
SQU-US	2026-02-13 23:00:00	4.99	50.66	332.70	7.03	12.17	18.34	0.02
SQU-US	2026-02-13 23:15:00	4.99	55.56	336.18	6.96	12.16	18.17	0.02
SQU-US	2026-02-13 23:30:00	4.98	55.47	334.18	7.01	12.16	18.25	0.02
SQU-US	2026-02-13 23:45:00	4.98	55.53	334.65	7.02	12.18	18.14	0.02
SQU-US	2026-02-14 00:00:00	4.96	55.33	335.40	7.03	12.18	18.17	0.02
SQU-US	2026-02-14 00:15:00	4.96	50.21	329.35	6.99	12.17	19.65	0.02
SQU-US	2026-02-14 00:30:00	4.94	49.89	315.07	7.04	12.21	18.48	0.02


Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-14 00:45:00	4.93	49.58	306.04	7.02	12.21	18.91	0.02
SQU-US	2026-02-14 01:00:00	4.91	49.56	300.66	7.03	12.23	18.61	0.02
SQU-US	2026-02-14 01:15:00	4.89	49.68	300.82	7.00	12.23	19.01	0.02
SQU-US	2026-02-14 01:30:00	4.88	49.43	297.58	7.05	12.24	18.77	0.02
SQU-US	2026-02-14 01:45:00	4.83	49.24	296.77	7.12	12.33	18.42	0.02
SQU-US	2026-02-14 02:00:00	4.80	49.00	298.22	7.15	12.36	18.51	0.02
SQU-US	2026-02-14 02:15:00	4.75	48.55	302.29	7.18	12.41	19.51	0.02
SQU-US	2026-02-14 02:30:00	4.71	48.05	300.66	7.24	12.47	18.69	0.02
SQU-US	2026-02-14 02:45:00	4.69	48.00	299.93	7.26	12.49	19.45	0.02
SQU-US	2026-02-14 03:00:00	4.67	47.80	301.89	7.26	12.51	18.71	0.02
SQU-US	2026-02-14 03:15:00	4.65	48.00	306.45	7.23	12.53	18.80	0.02
SQU-US	2026-02-14 03:30:00	4.64	47.92	306.79	7.27	12.53	18.54	0.02
SQU-US	2026-02-14 03:45:00	4.63	47.99	309.02	7.27	12.53	18.58	0.02
SQU-US	2026-02-14 04:00:00	4.61	47.92	310.96	7.28	12.54	18.49	0.02
SQU-US	2026-02-14 04:15:00	4.60	47.95	314.15	7.27	12.56	23.85	0.02
SQU-US	2026-02-14 04:30:00	4.59	47.76	315.44	7.28	12.57	19.27	0.02
SQU-US	2026-02-14 04:45:00	4.57	47.72	317.83	7.29	12.60	18.69	0.02
SQU-US	2026-02-14 05:00:00	4.55	47.77	319.76	7.29	12.61	19.03	0.02
SQU-US	2026-02-14 05:15:00	4.54	52.13	323.88	7.25	12.62	24.16	0.02
SQU-US	2026-02-14 05:30:00	4.53	52.13	324.59	7.27	12.61	18.85	0.02
SQU-US	2026-02-14 05:45:00	4.53	52.98	322.83	7.29	12.60	18.64	0.02
SQU-US	2026-02-14 06:00:00	4.56	54.74	320.21	7.26	12.54	19.01	0.02
SQU-US	2026-02-14 06:15:00	4.57	50.98	316.14	7.24	12.53	29.70	0.02
SQU-US	2026-02-14 06:30:00	4.58	51.41	311.05	7.24	12.49	19.22	0.02
SQU-US	2026-02-14 06:45:00	4.57	52.00	308.63	7.24	12.50	19.03	0.02
SQU-US	2026-02-14 07:00:00	4.57	52.32	307.20	7.24	12.51	19.64	0.02
SQU-US	2026-02-14 07:15:00	4.56	52.56	308.73	7.21	12.52	19.37	0.02
SQU-US	2026-02-14 07:30:00	4.57	53.20	306.77	7.24	12.48	19.19	0.02
SQU-US	2026-02-14 07:45:00	4.55	52.38	306.97	7.25	12.52	19.08	0.02
SQU-US	2026-02-14 08:00:00	4.54	51.90	307.31	7.25	12.51	19.62	0.02
SQU-US	2026-02-14 08:15:00	4.53	51.42	309.75	7.24	12.53	23.35	0.02
SQU-US	2026-02-14 08:30:00	4.52	50.93	309.33	7.24	12.53	19.05	0.02
SQU-US	2026-02-14 08:45:00	4.50	50.13	310.11	7.25	12.56	19.35	0.02
SQU-US	2026-02-14 09:00:00	4.50	49.77	311.22	7.25	12.57	19.25	0.02
SQU-US	2026-02-14 09:15:00	4.51	49.88	314.06	7.21	12.56	22.31	0.02
SQU-US	2026-02-14 09:30:00	4.51	49.76	312.40	7.24	12.58	19.31	0.02
SQU-US	2026-02-14 09:45:00	4.51	49.61	313.52	7.21	12.58	19.35	0.02
SQU-US	2026-02-14 10:00:00	4.53	49.51	312.93	7.23	12.59	19.52	0.02
SQU-US	2026-02-14 10:15:00	4.57	49.75	315.50	7.19	12.58	28.86	0.02
SQU-US	2026-02-14 10:30:00	4.62	49.91	314.23	7.22	12.60	19.33	0.02
SQU-US	2026-02-14 10:45:00	4.66	50.12	314.78	7.22	12.60	19.53	0.02
SQU-US	2026-02-14 11:00:00	4.67	50.37	315.71	7.22	12.59	19.24	0.02
SQU-US	2026-02-14 11:15:00	4.72	50.93	318.43	7.18	12.59	20.45	0.02
SQU-US	2026-02-14 11:30:00	4.77	50.77	317.20	7.21	12.60	19.42	0.02
SQU-US	2026-02-14 11:45:00	4.86	50.60	317.12	7.23	12.61	19.08	0.02
SQU-US	2026-02-14 12:00:00	4.92	50.97	318.32	7.20	12.61	19.65	0.02
SQU-US	2026-02-14 12:15:00	4.92	50.75	317.75	7.22	12.60	25.90	0.02
SQU-US	2026-02-14 12:30:00	4.90	50.99	317.37	7.23	12.61	19.68	0.02
SQU-US	2026-02-14 12:45:00	4.86	50.89	317.11	7.25	12.61	19.54	0.02
SQU-US	2026-02-14 13:00:00	4.83	50.59	318.06	7.25	12.62	19.68	0.02
SQU-US	2026-02-14 13:15:00	4.83	51.22	320.53	7.22	12.62	20.44	0.02
SQU-US	2026-02-14 13:30:00	4.86	50.96	318.89	7.25	12.64	19.41	0.02
SQU-US	2026-02-14 13:45:00	4.94	50.91	319.23	7.25	12.64	19.49	0.02
SQU-US	2026-02-14 14:00:00	5.02	50.92	319.71	7.25	12.63	19.18	0.02
SQU-US	2026-02-14 14:15:00	5.10	50.87	321.74	7.22	12.62	34.59	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-14 14:30:00	5.14	51.40	320.70	7.25	12.60	18.99	0.02
SQU-US	2026-02-14 14:45:00	5.19	51.67	320.91	7.24	12.59	19.19	0.02
SQU-US	2026-02-14 15:00:00	5.26	52.09	321.54	7.24	12.59	19.49	0.02
SQU-US	2026-02-14 15:15:00	5.30	57.28	324.85	7.18	12.57	25.18	0.03
SQU-US	2026-02-14 15:30:00	5.29	57.65	321.87	7.23	12.57	20.18	0.03
SQU-US	2026-02-14 15:45:00	5.26	58.06	321.77	7.22	12.53	19.79	0.03
SQU-US	2026-02-14 16:00:00	5.18	58.13	321.83	7.21	12.53	20.55	0.03
SQU-US	2026-02-14 16:15:00	5.11	53.40	324.25	7.16	12.50	25.18	0.02
SQU-US	2026-02-14 16:30:00	5.03	53.27	324.35	7.16	12.49	20.41	0.02
SQU-US	2026-02-14 16:45:00	4.95	52.79	325.31	7.14	12.47	20.60	0.02
SQU-US	2026-02-14 17:00:00	4.93	52.83	327.78	7.06	12.40	20.50	0.02
SQU-US	2026-02-14 17:15:00	4.86	57.41	332.32	7.03	12.44	33.31	0.03
SQU-US	2026-02-14 17:30:00	4.81	57.06	329.47	7.09	12.43	21.73	0.03
SQU-US	2026-02-14 17:45:00	4.78	57.09	329.21	7.08	12.39	22.11	0.03
SQU-US	2026-02-14 18:00:00	4.73	57.02	328.45	7.10	12.39	23.61	0.03
SQU-US	2026-02-14 18:15:00	4.73	52.10	328.60	7.04	12.38	23.36	0.02
SQU-US	2026-02-14 18:30:00	4.73	52.42	329.82	6.99	12.35	21.97	0.02
SQU-US	2026-02-14 18:45:00	4.70	52.12	329.51	7.02	12.36	22.39	0.02
SQU-US	2026-02-14 19:00:00	4.69	52.10	330.15	6.98	12.34	21.98	0.02
SQU-US	2026-02-14 19:15:00	4.68	57.42	331.53	6.95	12.34	36.03	0.03
SQU-US	2026-02-14 19:30:00	4.64	57.48	328.57	7.03	12.32	22.34	0.03
SQU-US	2026-02-14 19:45:00	4.62	57.31	329.12	7.01	12.31	22.85	0.03
SQU-US	2026-02-14 20:00:00	4.61	57.00	329.18	7.01	12.31	22.82	0.03
SQU-US	2026-02-14 20:15:00	4.58	52.27	328.42	7.03	12.32	30.85	0.02
SQU-US	2026-02-14 20:30:00	4.58	52.16	324.35	7.01	12.36	22.86	0.02
SQU-US	2026-02-14 20:45:00	4.57	52.29	321.30	7.01	12.39	22.64	0.02
SQU-US	2026-02-14 21:00:00	4.58	52.32	321.02	7.00	12.35	22.54	0.02
SQU-US	2026-02-14 21:15:00	4.57	52.49	321.87	6.95	12.35	23.38	0.02
SQU-US	2026-02-14 21:30:00	4.54	52.41	321.10	7.00	12.39	22.49	0.02
SQU-US	2026-02-14 21:45:00	4.53	52.44	321.90	6.98	12.39	22.41	0.02
SQU-US	2026-02-14 22:00:00	4.55	52.40	323.49	6.96	12.34	23.00	0.02
SQU-US	2026-02-14 22:15:00	4.51	52.23	324.07	7.00	12.39	29.91	0.02
SQU-US	2026-02-14 22:30:00	4.52	52.37	325.77	6.95	12.38	23.92	0.02
SQU-US	2026-02-14 22:45:00	4.49	52.52	324.94	7.01	12.39	23.10	0.02
SQU-US	2026-02-14 23:00:00	4.48	52.40	326.68	6.97	12.41	23.44	0.02
SQU-US	2026-02-14 23:15:00	4.46	52.58	327.97	6.96	12.39	24.25	0.02
SQU-US	2026-02-14 23:30:00	4.41	52.46	328.47	6.98	12.44	24.08	0.02
SQU-US	2026-02-14 23:45:00	4.37	52.26	329.84	7.00	12.43	23.21	0.02
SQU-US	2026-02-15 00:00:00	4.37	52.51	329.22	6.99	12.44	23.33	0.02
SQU-US	2026-02-15 00:15:00	4.35	52.11	330.41	6.98	12.43	24.70	0.02
SQU-US	2026-02-15 00:30:00	4.32	51.96	330.81	7.00	12.44	23.44	0.02
SQU-US	2026-02-15 00:45:00	4.30	51.97	330.96	7.01	12.44	23.72	0.02
SQU-US	2026-02-15 01:00:00	4.29	51.83	331.51	7.00	12.45	23.40	0.02
SQU-US	2026-02-15 01:15:00	4.25	52.33	333.21	6.97	12.47	25.32	0.02
SQU-US	2026-02-15 01:30:00	4.25	52.17	333.09	6.97	12.44	23.96	0.02
SQU-US	2026-02-15 01:45:00	4.22	52.00	332.93	6.99	12.47	23.86	0.02
SQU-US	2026-02-15 02:00:00	4.20	51.73	333.92	6.98	12.45	23.86	0.02
SQU-US	2026-02-15 02:15:00	4.14	51.68	333.10	7.02	12.52	25.93	0.02
SQU-US	2026-02-15 02:30:00	4.07	51.17	331.58	7.10	12.58	23.89	0.02
SQU-US	2026-02-15 02:45:00	4.02	50.75	330.31	7.15	12.62	23.43	0.02
SQU-US	2026-02-15 03:00:00	3.97	50.30	331.19	7.19	12.70	23.83	0.02
SQU-US	2026-02-15 03:15:00	3.92	54.60	333.56	7.18	12.74	24.20	0.02
SQU-US	2026-02-15 03:30:00	3.89	54.31	330.00	7.26	12.76	23.44	0.02
SQU-US	2026-02-15 03:45:00	3.87	54.10	330.39	7.27	12.78	23.92	0.02
SQU-US	2026-02-15 04:00:00	3.85	53.53	331.09	7.27	12.79	23.59	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-15 04:15:00	3.82	48.76	331.85	7.23	12.81	24.26	0.02
SQU-US	2026-02-15 04:30:00	3.79	48.61	328.37	7.28	12.83	23.67	0.02
SQU-US	2026-02-15 04:45:00	3.76	48.51	327.98	7.28	12.84	23.35	0.02
SQU-US	2026-02-15 05:00:00	3.72	48.38	328.59	7.28	12.86	23.64	0.02
SQU-US	2026-02-15 05:15:00	3.68	48.53	332.07	7.25	12.87	24.20	0.02
SQU-US	2026-02-15 05:30:00	3.64	48.44	331.02	7.30	12.89	23.54	0.02
SQU-US	2026-02-15 05:45:00	3.60	48.51	332.14	7.30	12.91	23.99	0.02
SQU-US	2026-02-15 06:00:00	3.60	48.72	332.76	7.29	12.90	23.66	0.02
SQU-US	2026-02-15 06:15:00	3.58	49.05	334.73	7.26	12.90	24.39	0.02
SQU-US	2026-02-15 06:30:00	3.56	50.23	333.60	7.27	12.86	23.76	0.02
SQU-US	2026-02-15 06:45:00	3.57	51.63	331.67	7.25	12.81	23.44	0.02
SQU-US	2026-02-15 07:00:00	3.57	52.56	329.47	7.25	12.78	23.62	0.02
SQU-US	2026-02-15 07:15:00	3.54	57.16	329.64	7.23	12.81	25.17	0.03
SQU-US	2026-02-15 07:30:00	3.52	57.05	327.70	7.25	12.81	23.81	0.03
SQU-US	2026-02-15 07:45:00	3.54	59.01	327.03	7.24	12.80	23.66	0.03
SQU-US	2026-02-15 08:00:00	3.51	58.74	326.21	7.25	12.77	23.87	0.03
SQU-US	2026-02-15 08:15:00	3.51	53.27	323.74	7.20	12.78	25.46	0.02
SQU-US	2026-02-15 08:30:00	3.49	52.57	310.68	7.25	12.82	24.50	0.02
SQU-US	2026-02-15 08:45:00	3.49	52.25	304.07	7.24	12.83	24.12	0.02
SQU-US	2026-02-15 09:00:00	3.51	52.29	299.62	7.23	12.84	24.14	0.02
SQU-US	2026-02-15 09:15:00	3.54	53.11	297.28	7.20	12.84	24.00	0.02
SQU-US	2026-02-15 09:30:00	3.57	53.01	296.31	7.22	12.83	23.94	0.02
SQU-US	2026-02-15 09:45:00	3.61	52.79	299.53	7.20	12.82	23.92	0.02
SQU-US	2026-02-15 10:00:00	3.65	52.61	302.84	7.18	12.82	23.90	0.02
SQU-US	2026-02-15 10:15:00	3.71	52.22	306.45	7.17	12.84	24.66	0.02
SQU-US	2026-02-15 10:30:00	3.77	52.26	308.11	7.17	12.84	23.91	0.02
SQU-US	2026-02-15 10:45:00	3.87	52.91	311.78	7.09	12.74	23.78	0.02
SQU-US	2026-02-15 11:00:00	3.94	53.16	314.91	7.10	12.73	24.05	0.02
SQU-US	2026-02-15 11:15:00	4.01	58.49	319.20	7.05	12.75	25.10	0.03
SQU-US	2026-02-15 11:30:00	4.06	58.00	319.64	7.10	12.73	24.38	0.03
SQU-US	2026-02-15 11:45:00	4.13	58.54	321.55	7.09	12.73	24.21	0.03
SQU-US	2026-02-15 12:00:00	4.19	58.56	323.09	7.10	12.72	24.36	0.03
SQU-US	2026-02-15 12:15:00	4.22	52.86	316.42	7.14	12.75	24.55	0.02
SQU-US	2026-02-15 12:30:00	4.27	52.59	316.47	7.18	12.82	24.57	0.02
SQU-US	2026-02-15 12:45:00	4.31	52.54	315.77	7.18	12.82	24.54	0.02
SQU-US	2026-02-15 13:00:00	4.35	52.51	315.02	7.20	12.80	24.35	0.02
SQU-US	2026-02-15 13:15:00	4.41	53.23	314.94	7.19	12.81	24.80	0.02
SQU-US	2026-02-15 13:30:00	4.45	52.86	311.26	7.22	12.82	24.35	0.02
SQU-US	2026-02-15 13:45:00	4.46	52.70	308.19	7.25	12.83	24.68	0.02
SQU-US	2026-02-15 14:00:00	4.47	52.65	307.70	7.25	12.82	24.75	0.02
SQU-US	2026-02-15 14:15:00	4.45	52.64	308.87	7.25	12.84	29.23	0.02
SQU-US	2026-02-15 14:30:00	4.42	52.30	309.25	7.26	12.84	25.58	0.02
SQU-US	2026-02-15 14:45:00	4.37	52.17	309.96	7.26	12.84	25.18	0.02
SQU-US	2026-02-15 15:00:00	4.34	52.17	310.38	7.26	12.85	25.22	0.02
SQU-US	2026-02-15 15:15:00	4.30	57.81	312.94	7.23	12.85	34.69	0.03
SQU-US	2026-02-15 15:30:00	4.27	57.96	310.23	7.27	12.82	25.25	0.03
SQU-US	2026-02-15 15:45:00	4.26	58.92	309.72	7.26	12.80	24.97	0.03
SQU-US	2026-02-15 16:00:00	4.23	59.42	309.65	7.26	12.80	25.96	0.03
SQU-US	2026-02-15 16:15:00	4.21	55.49	310.60	7.23	12.78	33.72	0.02
SQU-US	2026-02-15 16:30:00	4.20	56.14	309.79	7.23	12.75	25.90	0.02
SQU-US	2026-02-15 16:45:00	4.18	56.38	307.62	7.23	12.72	25.41	0.02
SQU-US	2026-02-15 17:00:00	4.16	56.31	307.51	7.20	12.70	25.49	0.02
SQU-US	2026-02-15 17:15:00	4.14	55.92	311.18	7.14	12.67	28.09	0.02
SQU-US	2026-02-15 17:30:00	4.13	55.84	311.54	7.15	12.65	25.42	0.02
SQU-US	2026-02-15 17:45:00	4.14	55.81	314.68	7.05	12.54	25.42	0.02

Squamish River

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-15 18:00:00	4.11	55.45	314.99	7.08	12.57	25.57	0.02
SQU-US	2026-02-15 18:15:00	4.14	55.41	313.71	7.02	12.52	27.42	0.02
SQU-US	2026-02-15 18:30:00	4.16	55.35	314.61	6.94	12.45	26.93	0.02
SQU-US	2026-02-15 18:45:00	4.06	54.86	306.27	7.07	12.57	26.04	0.02
SQU-US	2026-02-15 19:00:00	4.04	54.57	299.02	7.10	12.60	25.43	0.02
SQU-US	2026-02-15 19:15:00	4.03	59.72	295.77	7.08	12.61	36.68	0.03
SQU-US	2026-02-15 19:30:00	4.01	59.97	291.98	7.12	12.61	27.64	0.03
SQU-US	2026-02-15 19:45:00	4.01	59.77	290.37	7.11	12.61	24.42	0.03
SQU-US	2026-02-15 20:00:00	4.01	59.67	289.08	7.12	12.61	24.46	0.03
SQU-US	2026-02-15 20:15:00	4.01	54.35	284.81	7.12	12.60	25.92	0.02
SQU-US	2026-02-15 20:30:00	4.02	54.48	266.58	7.11	12.60	24.07	0.02
SQU-US	2026-02-15 20:45:00	4.02	54.57	266.81	7.13	12.59	26.05	0.02
SQU-US	2026-02-15 21:00:00	4.03	54.58	272.04	7.10	12.58	25.31	0.02
SQU-US	2026-02-15 21:15:00	4.02	54.77	276.28	7.10	12.60	24.84	0.02
SQU-US	2026-02-15 21:30:00	4.03	54.43	279.07	7.11	12.58	24.19	0.02
SQU-US	2026-02-15 21:45:00	4.03	54.56	284.00	7.08	12.58	23.81	0.02
SQU-US	2026-02-15 22:00:00	4.03	54.61	283.10	7.13	12.58	24.46	0.02
SQU-US	2026-02-15 22:15:00	4.03	54.77	287.90	7.09	12.58	30.66	0.02
SQU-US	2026-02-15 22:30:00	4.04	54.69	287.21	7.13	12.58	24.46	0.02
SQU-US	2026-02-15 22:45:00	4.05	54.65	289.31	7.10	12.58	24.58	0.02
SQU-US	2026-02-15 23:00:00	4.05	55.11	289.81	7.12	12.57	24.47	0.02
SQU-US	2026-02-15 23:15:00	4.05	54.50	290.56	7.13	12.58	25.61	0.02
SQU-US	2026-02-15 23:30:00	4.06	54.54	291.38	7.12	12.58	24.36	0.02
SQU-US	2026-02-15 23:45:00	4.06	54.63	292.10	7.13	12.56	24.73	0.02

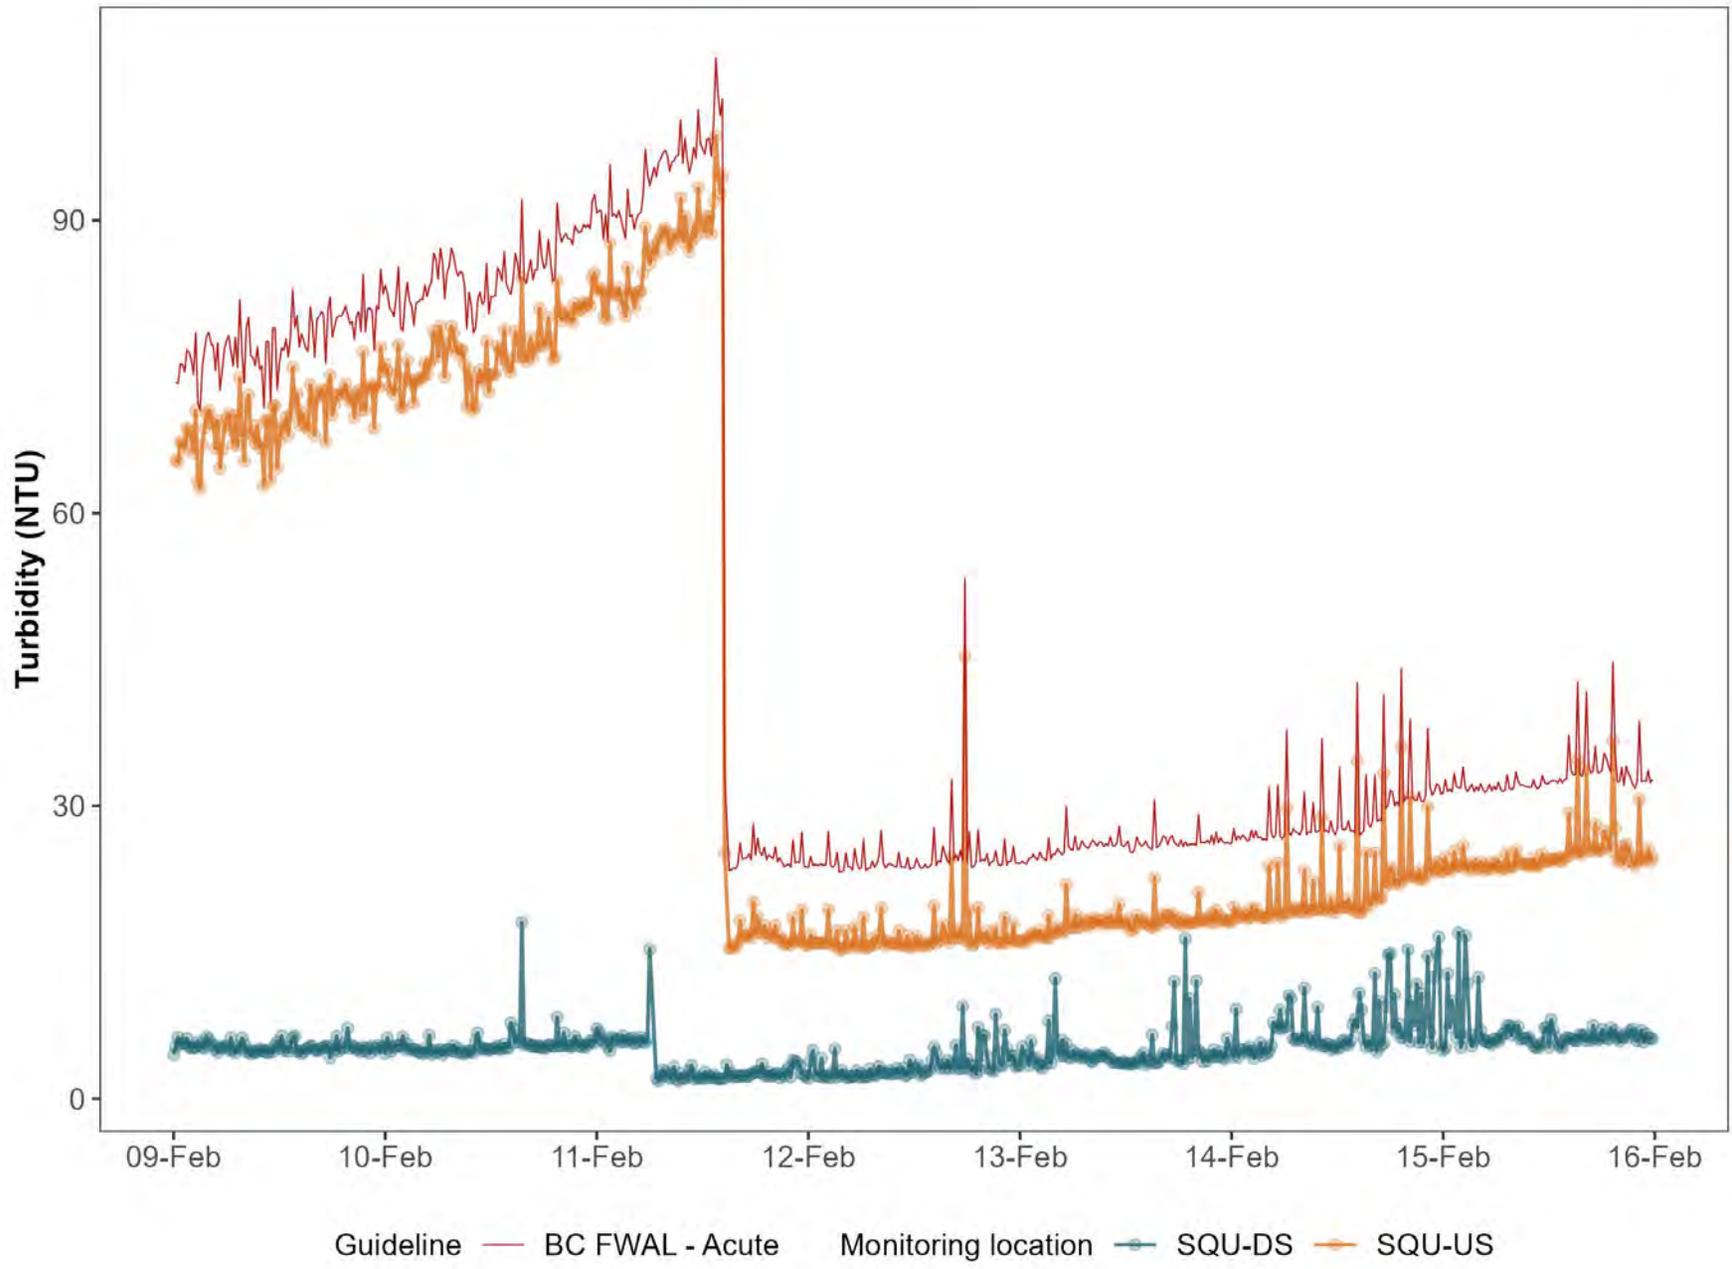



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix C	C-1

**Appendix C:
Woodfibre Site Point of Discharge from Water
Treatment Plant Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week

Feb 9, 2026 to
Feb 15, 2026

Report #

99

Appendix C

C-2

Woodfibre Site Sample Analysis



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-02-10 09:12:00
In situ Parameters								
Field pH	pH Units		6.5 - 9			7 - 8.7		7.38
Field Temperature	°C	18	19					10.7
General Parameters								
pH	pH Units							6.99
Alkalinity (Total as CaCO ₃)	mg/L							43
Alkalinity (PP as CaCO ₃)	mg/L							<1
Hardness (CaCO ₃)-Total	mg/L							50.9
Hardness (CaCO ₃)-Dissolved	mg/L							53.6
Sulphide-Total	mg/L							<0.0018
Sulphide (as H ₂ S)	mg/L			0.002				<0.002
Un-ionized Hydrogen Sulfide as H ₂ S-Total	mg/L							<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018
Anions and Nutrients								
Ammonia (N)-Total	mg/L	1.83	14.2		12	83		<0.015
Bicarbonate (HCO ₃)	mg/L							52
Carbonate (CO ₃)	mg/L							<1
Hydroxide (OH)	mg/L							<1
Nitrate (N)	mg/L	3	32.8		3.7			<0.02
Nitrite (N)	mg/L	0.2	0.6					<0.005
Nitrate plus Nitrite (N)	mg/L							<0.02
Nitrogen (N)-Total	mg/L							0.233
Phosphorus (P)-Total (4500-P)	mg/L							0.0041
Bromide (Br)	mg/L							<0.01
Chloride (Cl)	mg/L	150	600					11
Fluoride (F)	mg/L		1.062609			1.5		0.29
Sulphate (SO ₄)-Dissolved	mg/L	218						13

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-02-10 09:12:00
Total Metals								
Aluminum (Al)-Total	mg/L	0.1576307						0.549
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000162
Arsenic (As)-Total	mg/L	0.005			0.0125			0.00123
Barium (Ba)-Total	mg/L			1				0.00588
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001
Bismuth (Bi)-Total	mg/L							<0.00001
Boron (B)-Total	mg/L	1.2			1.2			0.011
Cadmium (Cd)-Total	mg/L						0.00012	0.0000091
Calcium (Ca)-Total	mg/L							18.9
Cesium (Cs)-Total	mg/L							0.000111
Chromium (Cr)-Total	mg/L							0.00061
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099
Cobalt (Co)-Total	mg/L							0.00004
Copper (Cu)-Total	mg/L				0.002	0.003		0.00117
Iron (Fe)-Total	mg/L		1					0.103
Lead (Pb)-Total	mg/L				0.002	0.14		0.000057
Lithium (Li)-Total	mg/L							0.00326
Magnesium (Mg)-Total	mg/L							0.9
Manganese (Mn)-Total	mg/L	0.82896	1.100918				0.1	0.0103
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.0358
Nickel (Ni)-Total	mg/L						0.0083	0.00018
Phosphorus (P)-Total (ICPMS)	mg/L							0.0064
Potassium (K)-Total	mg/L							2.17
Rubidium (Rb)-Total	mg/L							0.00573
Selenium (Se)-Total	mg/L	0.002			0.002			0.000067
Silicon (Si)-Total	mg/L							6.3
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.00001
Sodium (Na)-Total	mg/L							5.79
Strontium (Sr)-Total	mg/L							0.0597
Sulphur (S)-Total	mg/L							4.4
Tellurium (Te)-Total	mg/L							<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000062
Thorium (Th)-Total	mg/L							<0.00005

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-02-10 09:12:00
Total Metals (cont'd.)								
Tin (Sn)-Total	mg/L							<0.0002
Titanium (Ti)-Total	mg/L							0.0024
Uranium (U)-Total	mg/L		0.0165	0.0075				0.00131
Vanadium (V)-Total	mg/L			0.06			0.005	0.0003
Zinc (Zn)-Total	mg/L				0.01	0.055		0.0026
Zirconium (Zr)-Total	mg/L							<0.0001
Dissolved Metals								
Aluminum (Al)-Dissolved	mg/L							0.268
Antimony (Sb)-Dissolved	mg/L							0.000162
Arsenic (As)-Dissolved	mg/L							0.00113
Barium (Ba)-Dissolved	mg/L							0.00539
Beryllium (Be)-Dissolved	mg/L							<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005
Boron (B)-Dissolved	mg/L							0.013
Cadmium (Cd)-Dissolved	mg/L	0.0001287	0.0002934					0.0000072
Calcium (Ca)-Dissolved	mg/L							19.9
Cesium (Cs)-Dissolved	mg/L							0.00011
Chromium (Cr)-Dissolved	mg/L							0.00058
Cobalt (Co)-Dissolved	mg/L	0.0003889						0.0000277
Copper (Cu)-Dissolved	mg/L	0.00077	0.00464					0.00132
Iron (Fe)-Dissolved	mg/L		0.35					0.0058
Lead (Pb)-Dissolved	mg/L	0.0031517						<0.000005
Lithium (Li)-Dissolved	mg/L							0.00316
Manganese (Mn)-Dissolved	mg/L							0.00775
Magnesium (Mg)-Dissolved	mg/L							0.946
Mercury (Hg)-Dissolved	mg/L							<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.0389
Nickel (Ni)-Dissolved	mg/L	0.0013	0.0208					0.000148
Phosphorus (P)-Dissolved	mg/L							0.0053
Potassium (K)-Dissolved	mg/L							2.29
Rubidium (Rb)-Dissolved	mg/L							0.00592
Selenium (Se)-Dissolved	mg/L							0.000046
Silicon (Si)-Dissolved	mg/L							6.67
Silver (Ag)-Dissolved	mg/L							<0.000005
Sodium (Na)-Dissolved	mg/L							6.16

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-02-10 09:12:00
Dissolved Metals (cont'd.)								
Strontium (Sr)-Dissolved	mg/L			1.25				0.0628
Sulphur (S)-Dissolved	mg/L							4.7
Tellurium (Te)-Dissolved	mg/L							<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000071
Thorium (Th)-Dissolved	mg/L							<0.000005
Tin (Sn)-Dissolved	mg/L							<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005
Uranium (U)-Dissolved	mg/L							0.00138
Vanadium (V)-Dissolved	mg/L							0.00027
Zinc (Zn)-Dissolved	mg/L	0.0079724	0.0290813					0.00181
Zirconium (Zr)-Dissolved	mg/L							<0.0001
Inorganics								
Organic Carbon (C)-Total	mg/L							3.7
Organic Carbon (C)-Dissolved	mg/L							3
Solids-Total Dissolved	mg/L							48
Solids-Total Suspended	mg/L	6	26					10
Organics								
HEPH (C19-C32 less PAH)	mg/L							<0.2
LEPH (C10-C19 less PAH)	mg/L							0.27
EPH (C10-C19)	mg/L							0.27
EPH (C19-C32)	mg/L							<0.2
Ethylene Glycol	mg/L							<3
Diethylene Glycol	mg/L							<5
Triethylene Glycol	mg/L							<5
Propylene Glycol	mg/L							<5
Acenaphthene	mg/L	0.006			0.006			<0.00005
Acenaphthylene	mg/L							<0.00005
Acridine	mg/L	0.003						<0.00005
Anthracene	mg/L	0.004						<0.00001
Benzo(a)anthracene	mg/L	0.0001						<0.00001
Benzo(a)pyrene	mg/L	0.00001			0.00001			<0.000005
Benzo(b&j)fluoranthene	mg/L							<0.00003
Benzo(g,h,i)perylene	mg/L							<0.00005
Benzo(k)fluoranthene	mg/L							<0.00005
Chrysene	mg/L				0.0001			<0.00002

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-02-10 09:12:00
Organics (cont'd.)								
Dibenz(a,h)anthracene	mg/L							<0.000003
Fluoranthene	mg/L	0.004						<0.00002
Fluorene	mg/L	0.012			0.012			<0.00005
Indeno(1,2,3-cd)pyrene	mg/L							<0.00005
1-Methylnaphthalene	mg/L				0.001			<0.00005
2-Methylnaphthalene	mg/L				0.001			<0.0001
Naphthalene	mg/L	0.001	0.001		0.001			<0.0001
Phenanthrene	mg/L	0.0003						<0.00005
Pyrene	mg/L							<0.00002
Quinoline	mg/L							<0.00002
Low Molecular Weight PAH's	mg/L							<0.0001
High Molecular Weight PAH's	mg/L							<0.00005
Total PAH	mg/L							<0.0001
VH C6-C10	mg/L							<0.3
1,1,1,2-Tetrachloroethane	mg/L							<0.0005
1,1,1-Trichloroethane	mg/L							<0.0005
1,1,2,2-Tetrachloroethane	mg/L							<0.0005
1,1,2Trichloro-1,2,2Trifluoroethane	mg/L							<0.002
1,1,2-Trichloroethane	mg/L							<0.0005
1,1-Dichloroethane	mg/L							<0.0005
1,1-Dichloroethene	mg/L							<0.0005
1,2,3-trichlorobenzene	mg/L			0.008				<0.002
1,2,4-trichlorobenzene	mg/L			0.024			0.0054	<0.002
1,2-dibromoethane	mg/L							<0.0002
1,2-Dichlorobenzene	mg/L			0.0007			0.042	<0.0005
1,2-Dichloroethane	mg/L			0.1				<0.0005
1,2-Dichloropropane	mg/L							<0.0005
1,3,5-trimethylbenzene	mg/L							<0.002
1,3-Butadiene	mg/L							<0.0005
1,3-Dichlorobenzene	mg/L			0.15				<0.0005
1,3-dichloropropane	mg/L							<0.001
1,4-Dichlorobenzene	mg/L			0.026				<0.0005
Benzene	mg/L	0.04			0.11			<0.0004
Bromobenzene	mg/L							<0.002
Bromodichloromethane	mg/L							<0.001

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-02-10 09:12:00
Organics (cont'd.)								
Bromoform	mg/L							<0.001
Bromomethane	mg/L							<0.001
Carbon tetrachloride	mg/L							<0.0005
Chlorobenzene	mg/L			0.0013			0.025	<0.0005
Chloroethane	mg/L							<0.001
Chloroform	mg/L							<0.001
Chloromethane	mg/L							<0.001
cis-1,2-Dichloroethene	mg/L							<0.001
cis-1,3-Dichloropropene	mg/L							<0.001
Dibromochloromethane	mg/L							<0.001
Dichlorodifluoromethane	mg/L							<0.002
Dichloromethane	mg/L			0.0981				<0.002
Ethylbenzene	mg/L	0.2			0.25			<0.0004
Hexachlorobutadiene	mg/L							<0.0005
Isopropylbenzene	mg/L							<0.002
Methyl-tert-butylether (MTBE)	mg/L		3.4			0.44		<0.004
Styrene	mg/L			0.072				<0.0005
Tetrachloroethene	mg/L							<0.0005
Toluene	mg/L	0.0005						<0.0004
trans-1,2-dichloroethene	mg/L							<0.001
trans-1,3-dichloropropene	mg/L							<0.001
Trichloroethene	mg/L							<0.0005
Trichlorofluoromethane	mg/L							<0.004
Vinyl chloride	mg/L							<0.0005
VPH (VH6 to 10 - BTEX)	mg/L							<0.3
Xylenes (Total)	mg/L	0.03						<0.0004
m & p-Xylene	mg/L							<0.0004
o-Xylene	mg/L							<0.0004
Phenols	mg/L		0.05					<0.0015
Rainbow Trout								
LC50	% vol/vol							>100%

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Water Quality Field Data Sheet



Hatfield

Project: FORTIS11234

Location Information

Site ID: WLNG EOP Date: February 10, 2026
Site Name: East Creek Time: 9:12
Crew: BHC
Weather: Sunny

In Situ Parameters

pH: 7.38 DO: 17.66 (mg/L)
Temp: 10.7 (°C) Cond: 199.2 (uS/cm)
Turbidity: 10.03 NTU Salinity: 0.1 (ppt)
ORP: 60.3 (mV)

Visible Sheen: NA

Water Surface Condition: Clear

Photo Record



Observations

DUP taken here.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix C	C-3

Woodfibre Site WTP Discharge Field Notes and Logs

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Table of Contents:

1. Executive Summary and Notes
2. Discharge Parameter Summary
3. WTP Calibration Log

Appendices:

- Appendix A- WTP Data Log
- Appendix B- YSI Data Log
- Appendix C- Photos

1. Executive Summary and Field Notes:

The discharged water consistently remained within regulatory guidelines. Key parameters, including temperature, NTU, pH, DO, salinity, conductivity, and oxidation-reduction potential (ORP), were monitored throughout the discharge process and remained within prescribed limits.

There were some intermittent short term NTU spikes as a result of changing influent water quality and adjusting coagulant and flocculant injection rates to compensate. A few isolated pH readings were observed during the monitoring period. On February 11th, a reading of 6.2pH at 10:00 was recorded while the probe was being calibrated (this was not the pH of water being discharged). Another reading of 4.1pH at 21:00 was recorded on February 11th and this was associated with the probe being tested in 4pH standard pH calibration solution. On February 15th a reading of 6.4pH at 22:00 was logged while the system was operating in recirculation (not discharging).

No visible sheen was observed on the surface of the WTP tanks or in the discharged water. All relevant parameters were measured using YSI instruments and WTP probes. The total discharge volume up to February 15th was 1,123,359m³.

Daily Volume Summary:

Table 1: Discharge Volumes Daily Summary

Date	Location	Volume (m3)	Comments
February 09	Woodfibre (WF)	2,977	Exceeded discharge volume limit
February 10	WF	3,113	Exceeded discharge volume limit



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

February 11	WF	2,825	Exceeded discharge volume limit
February 12	WF	2,971	Exceeded discharge volume limit
February 13	WF	2,910	Exceeded discharge volume limit
February 14	WF	2,823	Exceeded discharge volume limit
February 15	WF	2,757	Exceeded discharge volume limit
Total		20,376	None

1. Discharge Parameter Summary:

Table 2: Discharge Parameter Summary

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/9/2026	0:00:00	7.3	0.027633721	3.2	1099162.5	12.4	286
2/9/2026	0:15:00	7.3	0.027633721	1.6	1099202.8	12.3	288
2/9/2026	0:30:00	7.3	0.027633721	3.5	1099246.6	12.4	288
2/9/2026	0:45:00	7.2	0.027255177	2.2	1099289.3	12.4	287
2/9/2026	1:00:00	7.3	0.027633721	24.9	1099333.4	12.4	288
2/9/2026	1:15:00	7.5	0.028390809	4.5	1099373.2	12.4	287
2/9/2026	1:30:00	7.5	0.028390809	7.7	1099416.9	12.3	287
2/9/2026	1:45:00	7.5	0.028390809	0	1099460.4	12.4	287
2/9/2026	2:00:00	7.4	0.028012265	6.1	1099485.2	12.8	288
2/9/2026	2:15:00	7.3	0.027633721	0	1099519.4	12.6	287
2/9/2026	2:30:00	7.2	0.027255177	7.2	1099560.2	12.5	283
2/9/2026	2:45:00	7.3	0.027633721	7.8	1099592.6	12.9	287
2/9/2026	3:00:00	7.3	0.027633721	7	1099636.8	12.5	283
2/9/2026	3:15:00	7.2	0.027255177	9.9	1099672.4	13	287
2/9/2026	3:30:00	7	0.026498088	18.3	1099714.4	12.5	283
2/9/2026	3:45:00	6.9	0.026119544	1.3	1099745.2	12.5	282
2/9/2026	4:00:00	7.1	0.026876632	3.4	1099776.5	12.5	284
2/9/2026	4:15:00	7.3	0.027633721	3.2	1099819.8	12.5	287



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/9/2026	4:30:00	7.4	0.028012265	0	1099849.5	13.4	288
2/9/2026	4:45:00	7.3	0.027633721	0	1099878.9	13.3	287
2/9/2026	5:00:00	7.3	0.027633721	0.5	1099919.4	12.6	287
2/9/2026	5:15:00	7.2	0.027255177	0	1099949.4	12.6	285
2/9/2026	5:30:00	7.1	0.026876632	0	1099991.6	12.6	287
2/9/2026	5:45:00	7.2	0.027255177	0	1100032.9	12.5	284
2/9/2026	6:00:00	7.2	0.027255177	0	1100066.8	12.5	288
2/9/2026	6:15:00	7.2	0.027255177	0	1100098.5	12.6	287
2/9/2026	6:30:00	7.3	0.027633721	0	1100143.1	12.4	288
2/9/2026	6:45:00	7.2	0.027255177	0	1100174.6	12.2	287
2/9/2026	7:00:00	7.3	0.027633721	0	1100204.7	12.3	287
2/9/2026	7:15:00	7.3	0.027633721	0.2	1100247.3	11.9	290
2/9/2026	7:30:00	7.3	0.027633721	1	1100281.3	11.8	290
2/9/2026	7:45:00	7.3	0.027633721	0.3	1100310.9	11.9	292
2/9/2026	8:00:00	7.2	0.027255177	0	1100354.3	11.8	290
2/9/2026	8:15:00	7.3	0.027633721	0	1100384.2	12.1	292
2/9/2026	8:30:00	7.2	0.027255177	0	1100427.2	11.9	292
2/9/2026	8:45:00	7.3	0.027633721	0	1100456.2	11.9	290
2/9/2026	9:00:00	7.3	0.027633721	2.8	1100499.6	11.8	290
2/9/2026	9:15:00	7.3	0.027633721	11	1100531.7	11.8	290
2/9/2026	9:30:00	7.2	0.027255177	9.1	1100575.7	11.8	292
2/9/2026	9:45:00	7.2	0.027255177	16.1	1100602.2	12	292
2/9/2026	10:00:00	7.2	0.027255177	12.4	1100644.6	11.8	292
2/9/2026	10:15:00	7.3	0.027633721	13.9	1100677.9	11.9	292
2/9/2026	10:30:00	7.6	0.028769353	53.8	1100701.1	11.9	292
2/9/2026	10:45:00	7.6	0.028769353	6.5	1100728.5	12	292
2/9/2026	11:00:00	7.3	0.027633721	2.6	1100772.9	11.8	292
2/9/2026	11:15:00	7	0.026498088	4.8	1100817.7	11.8	292
2/9/2026	11:30:00	6.9	0.026119544	5	1100844.1	11.7	292
2/9/2026	11:45:00	6.8	0.025741	12.2	1100883	11.8	292
2/9/2026	12:00:00	7	0.026498088	7.7	1100925.4	11.8	292
2/9/2026	12:15:00	7.1	0.026876632	28.1	1100953	11.9	294
2/9/2026	12:30:00	7.2	0.027255177	4.8	1100996.2	11.8	293
2/9/2026	12:45:00	7.2	0.027255177	32	1101040.3	11.8	294



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/9/2026	13:15:00	7.2	0.027255177	32.7	1101100.5	11.8	292
2/9/2026	13:30:00	7.1	0.026876632	18	1101134.3	11.7	292
2/9/2026	14:00:00	7.1	0.026876632	21.9	1101216.7	11.7	290
2/9/2026	14:15:00	7.3	0.027633721	0	1101259.4	11.7	292
2/9/2026	14:30:00	7.6	0.028769353	0	1101298.2	12	293
2/9/2026	14:45:00	7.6	0.028769353	0	1101335.6	12.3	295
2/9/2026	15:00:00	7.2	0.027255177	16.8	1101378.2	11.9	290
2/9/2026	15:15:00	7.1	0.026876632	7.7	1101404.8	11.8	292
2/9/2026	15:30:00	7.1	0.026876632	20	1101452.5	11.7	292
2/9/2026	15:45:00	7.2	0.027255177	5.3	1101475.6	11.8	288
2/9/2026	16:00:00	7.1	0.026876632	12.6	1101523.7	11.6	290
2/9/2026	16:15:00	7.1	0.026876632	19.6	1101563.7	11.6	290
2/9/2026	16:30:00	7.2	0.027255177	67.1	1101595.7	11.8	292
2/9/2026	16:45:00	7.1	0.026876632	14.3	1101635.4	11.7	292
2/9/2026	17:00:00	7.2	0.027255177	18.6	1101665	11.8	292
2/9/2026	17:15:00	7.4	0.028012265	0	1101699.1	11.7	292
2/9/2026	17:30:00	7.4	0.028012265	0	1101740.9	11.7	292
2/9/2026	17:45:00	7.6	0.028769353	0	1101766.9	11.9	290
2/9/2026	18:00:00	7.6	0.028769353	0	1101811	12.2	292
2/9/2026	18:15:00	7.6	0.028769353	0	1101847.5	12.6	292
2/9/2026	18:30:00	7.1	0.026876632	12.4	1101891.2	11.7	289
2/9/2026	18:45:00	7.3	0.027633721	28.7	1101930	11.7	287
2/9/2026	19:00:00	7.1	0.026876632	10.7	1101966.2	11.6	291
2/9/2026	19:15:00	7.4	0.028012265	0	1102007.4	11.6	291
2/9/2026	19:30:00	7.2	0.027255177	3.5	1102047.6	11.5	291
2/9/2026	19:45:00	7.2	0.027255177	11.1	1102073.4	11.5	289
2/9/2026	20:00:00	7.2	0.027255177	5.6	1102117	11.5	290
2/9/2026	20:15:00	7.2	0.027255177	18.3	1102139.3	11.9	288
2/9/2026	20:30:00	7.2	0.027255177	8.2	1102182.3	11.8	287
2/9/2026	20:45:00	7.3	0.027633721	4.9	1102212.7	12.1	286
2/9/2026	21:00:00	7.2	0.027255177	3.8	1102247.9	12	285
2/9/2026	21:15:00	7.2	0.027255177	5.8	1102286.7	12	284
2/9/2026	21:30:00	7.2	0.027255177	11.3	1102324.4	11.9	285
2/9/2026	21:45:00	7.4	0.028012265	14.4	1102364.6	11.9	285



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/9/2026	22:00:00	7.4	0.028012265	15.1	1102408.4	11.8	284
2/9/2026	22:15:00	7.5	0.028390809	27.1	1102446.4	11.8	286
2/9/2026	22:30:00	7.4	0.028012265	10	1102479	11.8	284
2/9/2026	22:45:00	7.4	0.028012265	6.9	1102523.1	11.8	284
2/9/2026	23:00:00	7.4	0.028012265	6.1	1102565.3	11.9	283
2/9/2026	23:15:00	7.6	0.028769353	10.4	1102611.1	12	282
2/9/2026	23:30:00	7.6	0.028769353	7.1	1102653	12.1	282
2/9/2026	23:45:00	7.4	0.028012265	3.2	1102681	12.3	280
2/10/2026	0:00:00	7.5	0.028390809	8.1	1102724.4	12.3	280
2/10/2026	0:15:00	7.5	0.028390809	1.6	1102766.7	12.4	280
2/10/2026	0:30:00	7.5	0.028390809	1.8	1102806.5	12.4	280
2/10/2026	0:45:00	7.5	0.028390809	6	1102840.3	12.5	278
2/10/2026	1:00:00	7.4	0.028012265	7.7	1102882.8	12.5	278
2/10/2026	1:15:00	7.4	0.028012265	13.1	1102925.3	12.6	278
2/10/2026	1:30:00	7.5	0.028390809	6.8	1102951.8	12.6	274
2/10/2026	1:45:00	7.5	0.028390809	6.6	1102996.3	12.4	277
2/10/2026	2:00:00	7.5	0.028390809	5.1	1103020.1	12.7	275
2/10/2026	2:15:00	7.4	0.028012265	6.9	1103064.8	12.3	277
2/10/2026	2:30:00	7.1	0.026876632	15.6	1103111.8	12.3	275
2/10/2026	2:45:00	7.1	0.026876632	14.9	1103156.8	12.2	275
2/10/2026	3:00:00	7.1	0.026876632	13.9	1103201.1	12.1	275
2/10/2026	3:15:00	7	0.026498088	10.7	1103230.8	12.1	278
2/10/2026	3:30:00	7.2	0.027255177	8.3	1103275.3	12.2	275
2/10/2026	3:45:00	7.3	0.027633721	9	1103309.3	12.3	274
2/10/2026	4:00:00	7.1	0.026876632	2.5	1103354.9	12.3	273
2/10/2026	4:15:00	7.2	0.027255177	2.1	1103401	13.1	277
2/10/2026	4:30:00	7.2	0.027255177	6.4	1103444.5	12.5	273
2/10/2026	4:45:00	7.4	0.028012265	16.2	1103491.2	12.5	273
2/10/2026	5:00:00	7.3	0.027633721	19.3	1103511.6	13	277
2/10/2026	5:15:00	6.9	0.026119544	19.6	1103556.9	12.6	274
2/10/2026	5:30:00	7	0.026498088	20.3	1103600.4	12.5	273
2/10/2026	5:45:00	7.2	0.027255177	9.4	1103629.5	12.5	276
2/10/2026	6:00:00	7.3	0.027633721	9.1	1103674.6	12.4	274
2/10/2026	6:15:00	7.4	0.028012265	11.8	1103721.6	12.4	274



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/10/2026	6:30:00	7.4	0.028012265	10.7	1103765.9	12.4	273
2/10/2026	6:45:00	7.4	0.028012265	9.1	1103797	12.2	275
2/10/2026	7:00:00	7.4	0.028012265	7.3	1103842.6	12	273
2/10/2026	7:15:00	7.3	0.027633721	8	1103888.4	11.9	273
2/10/2026	7:30:00	7.2	0.027255177	8.7	1103931.3	11.7	275
2/10/2026	7:45:00	7.2	0.027255177	13	1103976.5	11.6	277
2/10/2026	8:00:00	7.2	0.027255177	12.9	1104004.1	11.5	275
2/10/2026	8:15:00	7.1	0.026876632	11.9	1104048.1	11.5	276
2/10/2026	8:30:00	7.1	0.026876632	8.5	1104091.3	11.5	277
2/10/2026	8:45:00	7.2	0.027255177	10.9	1104119.3	11.5	274
2/10/2026	9:00:00	7.3	0.027633721	10.7	1104161.7	11.5	274
2/10/2026	9:15:00	7.4	0.028012265	27.9	1104192.9	11.6	274
2/10/2026	9:30:00	7.2	0.027255177	7.1	1104233.6	11.6	274
2/10/2026	9:45:00	7.2	0.027255177	15.2	1104277.7	11.6	274
2/10/2026	10:00:00	7.2	0.027255177	18.2	1104322.5	11.7	274
2/10/2026	10:15:00	7.3	0.027633721	23.5	1104366.7	11.6	274
2/10/2026	10:30:00	7.3	0.027633721	15.8	1104409	11.7	274
2/10/2026	10:45:00	7.2	0.027255177	17.8	1104438.9	11.7	274
2/10/2026	11:00:00	7.3	0.027633721	15.2	1104482.7	11.7	272
2/10/2026	11:15:00	7.5	0.028390809	6.9	1104514.5	11.9	273
2/10/2026	11:30:00	7.4	0.028012265	33.5	1104523.2	11.9	274
2/10/2026	11:45:00	7.4	0.028012265	7.9	1104567.1	11.7	272
2/10/2026	12:00:00	7.5	0.028390809	4.3	1104607.1	11.7	272
2/10/2026	12:15:00	7.5	0.028390809	6.8	1104654.8	11.7	272
2/10/2026	12:30:00	7.5	0.028390809	9.8	1104694.6	11.6	272
2/10/2026	12:45:00	7.5	0.028390809	7.9	1104744.1	11.6	274
2/10/2026	13:00:00	7.4	0.028012265	4.5	1104773.3	11.7	274
2/10/2026	13:15:00	7.5	0.028390809	6.1	1104823.9	11.7	274
2/10/2026	13:30:00	7.4	0.028012265	4.8	1104862	11.7	276
2/10/2026	13:45:00	7.4	0.028012265	6.5	1104911.5	11.8	276
2/10/2026	14:00:00	7.3	0.027633721	2.7	1104940.8	11.8	272
2/10/2026	14:15:00	7.3	0.027633721	6.4	1104988.7	11.8	272
2/10/2026	14:30:00	7.3	0.027633721	9.7	1105028.2	11.8	271
2/10/2026	14:45:00	7.3	0.027633721	7	1105062.9	11.8	271



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/10/2026	15:00:00	7.3	0.027633721	8.7	1105104.4	11.9	274
2/10/2026	15:15:00	7.3	0.027633721	9.9	1105137.7	11.9	274
2/10/2026	15:30:00	7.3	0.027633721	7.6	1105176.8	11.9	274
2/10/2026	15:45:00	7.4	0.028012265	8.1	1105217.2	12	274
2/10/2026	16:00:00	7.3	0.027633721	5.9	1105253.2	11.9	274
2/10/2026	16:15:00	7.3	0.027633721	8.7	1105302.3	11.9	274
2/10/2026	16:30:00	7.3	0.027633721	5.2	1105329.9	11.9	273
2/10/2026	16:45:00	7.3	0.027633721	8.3	1105370.2	11.9	271
2/10/2026	17:00:00	7.2	0.027255177	6.4	1105404.3	11.7	272
2/10/2026	17:15:00	7.4	0.028012265	5.8	1105435.9	11.9	274
2/10/2026	17:30:00	7.5	0.028390809	13.5	1105473.9	11.8	274
2/10/2026	17:45:00	8.2	0.031040618	56	1105511	11.8	272
2/10/2026	18:00:00	8.5	0.03217625	3.9	1105547.7	11.8	276
2/10/2026	18:15:00	8.3	0.031419162	3.9	1105575.8	12.1	282
2/10/2026	18:30:00	7.8	0.029526441	0.5	1105623	11.8	291
2/10/2026	18:45:00	7.4	0.028012265	15.2	1105659.3	11.7	297
2/10/2026	19:00:00	7.4	0.028012265	13.7	1105695.8	11.6	298
2/10/2026	19:15:00	7.2	0.027255177	7.1	1105727.1	11.6	302
2/10/2026	19:30:00	6.8	0.025741	8.5	1105769.9	11.5	302
2/10/2026	19:45:00	6.8	0.025741	6.5	1105800.7	11.5	305
2/10/2026	20:00:00	6.8	0.025741	5.1	1105840.5	11.5	305
2/10/2026	20:15:00	7.1	0.026876632	6.6	1105870.9	11.5	305
2/10/2026	20:30:00	7.1	0.026876632	4.5	1105909.6	11.4	305
2/10/2026	20:45:00	7.1	0.026876632	4.8	1105942.9	11.4	305
2/10/2026	21:00:00	7.1	0.026876632	9.6	1105981.2	11.4	305
2/10/2026	21:15:00	7.3	0.027633721	14	1106011.3	11.5	305
2/10/2026	21:30:00	6.9	0.026119544	5.4	1106056.1	11.4	303
2/10/2026	21:45:00	6.8	0.025741	4.6	1106081.9	11.5	303
2/10/2026	22:00:00	7	0.026498088	7	1106129.7	11.5	303
2/10/2026	22:15:00	7.2	0.027255177	7.8	1106158.7	11.7	302
2/10/2026	22:30:00	7.1	0.026876632	6.4	1106200.3	11.6	303
2/10/2026	22:45:00	7.1	0.026876632	7.3	1106238.1	11.6	302
2/10/2026	23:00:00	7.1	0.026876632	10	1106274.7	11.7	302
2/10/2026	23:15:00	7.2	0.027255177	20.1	1106304.2	11.9	302



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/10/2026	23:30:00	7.2	0.027255177	9.5	1106344.8	11.9	302
2/10/2026	23:45:00	7.2	0.027255177	6.5	1106377.8	12	302
2/11/2026	0:00:00	7.1	0.026876632	8.7	1106414.8	11.9	299
2/11/2026	0:15:00	7.2	0.027255177	10.3	1106435.5	12.3	303
2/11/2026	0:30:00	7	0.026498088	7.9	1106484.5	12.1	301
2/11/2026	0:45:00	7.1	0.026876632	4.3	1106511	12.7	303
2/11/2026	1:00:00	7.1	0.026876632	3.3	1106560.5	13.7	304
2/11/2026	1:15:00	7.1	0.026876632	2.1	1106591	14.7	307
2/11/2026	1:30:00	7.1	0.026876632	1.4	1106641.6	15.4	308
2/11/2026	1:45:00	7.1	0.026876632	1.4	1106666.9	16.3	311
2/11/2026	2:00:00	7.1	0.026876632	4.6	1106715.3	12.9	299
2/11/2026	2:15:00	7.1	0.026876632	6.6	1106741.2	12.7	305
2/11/2026	2:30:00	7.1	0.026876632	7.6	1106789.6	12.5	305
2/11/2026	2:45:00	7.1	0.026876632	16.4	1106814.1	12.7	307
2/11/2026	3:00:00	7.4	0.028012265	22.6	1106861	12.4	303
2/11/2026	3:15:00	7.9	0.029904985	44.4	1106879.5	12.4	305
2/11/2026	4:45:00	7.1	0.026876632	52.5	1106932.2	11.5	434
2/11/2026	5:15:00	7.2	0.027255177	48.1	1106994.1	11.4	455
2/11/2026	5:30:00	7.4	0.028012265	22.9	1107040.7	11.4	460
2/11/2026	5:45:00	7.7	0.029147897	24.6	1107066	11.4	465
2/11/2026	6:00:00	7.2	0.027255177	29.9	1107109.7	11.4	467
2/11/2026	6:30:00	7.4	0.028012265	58.2	1107176.8	11.3	470
2/11/2026	6:45:00	7.2	0.027255177	23.2	1107209.5	11.3	472
2/11/2026	7:00:00	6.9	0.026119544	23.8	1107248.4	11.3	472
2/11/2026	7:15:00	6.8	0.025741	12.1	1107272.1	11.2	468
2/11/2026	7:30:00	7.2	0.027255177	54.4	1107319.7	11.3	465
2/11/2026	7:45:00	7	0.026498088	4.4	1107362.9	11.2	451
2/11/2026	8:00:00	7.2	0.027255177	5.3	1107392	11.1	454
2/11/2026	8:15:00	6.9	0.026119544	7.8	1107435.5	11.2	446
2/11/2026	8:30:00	7.1	0.026876632	9.5	1107470.3	11.2	446
2/11/2026	8:45:00	7.1	0.026876632	7.7	1107521	11.2	442
2/11/2026	9:00:00	7.1	0.026876632	5	1107552.7	11.3	439
2/11/2026	9:15:00	7.3	0.027633721	0	1107584.3	11.3	439
2/11/2026	9:30:00	7.5	0.028390809	1.7	1107621.7	11.3	426



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/11/2026	9:45:00	7.2	0.027255177	1.1	1107654.5	11.3	422
2/11/2026	10:00:00	6.2	0.023469735	28.7	1107696	11.5	413
2/11/2026	10:15:00	6.9	0.026119544	0	1107741.4	11.7	419
2/11/2026	10:30:00	6.9	0.026119544	0	1107786.4	12.3	421
2/11/2026	10:45:00	6.9	0.026119544	0	1107828.8	12.9	423
2/11/2026	11:00:00	6.6	0.024983912	0	1107864.3	12.1	420
2/11/2026	11:15:00	6.8	0.025741	27.8	1107914.9	11.7	413
2/11/2026	11:30:00	7.6	0.028769353	1.7	1107955.8	11.8	410
2/11/2026	11:45:00	7	0.026498088	18.1	1107973.4	11.8	411
2/11/2026	12:15:00	7.6	0.028769353	15.3	1108056.7	11.7	409
2/11/2026	12:30:00	7.8	0.029526441	6.1	1108088.5	11.7	411
2/11/2026	12:45:00	7.3	0.027633721	1.6	1108133.1	11.7	408
2/11/2026	13:00:00	6.9	0.026119544	2.2	1108163.2	12	410
2/11/2026	13:15:00	7.1	0.026876632	0	1108195.3	12.4	411
2/11/2026	13:30:00	6.9	0.026119544	0	1108232.8	12.8	413
2/11/2026	13:45:00	7.1	0.026876632	2.6	1108274	11.8	406
2/11/2026	14:00:00	7.3	0.027633721	1.7	1108318.2	11.8	405
2/11/2026	14:15:00	7.4	0.028012265	1.8	1108360.6	11.8	402
2/11/2026	14:30:00	7.5	0.028390809	11.9	1108404.7	11.8	398
2/11/2026	14:45:00	7.7	0.029147897	4.2	1108449.6	11.9	399
2/11/2026	15:00:00	7.8	0.029526441	5	1108484.8	11.9	397
2/11/2026	15:15:00	7.8	0.029526441	2.9	1108529.3	11.9	395
2/11/2026	15:30:00	7.8	0.029526441	4.5	1108560.9	11.9	394
2/11/2026	15:45:00	7.7	0.029147897	6.7	1108604.3	11.9	392
2/11/2026	16:00:00	7.7	0.029147897	8.6	1108635.4	11.9	394
2/11/2026	16:15:00	7.6	0.028769353	11.3	1108680.8	11.8	390
2/11/2026	16:30:00	7.7	0.029147897	9.8	1108712.1	11.8	390
2/11/2026	16:45:00	7.7	0.029147897	19.1	1108753.3	11.8	389
2/11/2026	17:00:00	7.7	0.029147897	10.5	1108785.1	11.7	387
2/11/2026	17:15:00	7.7	0.029147897	17.6	1108810.2	11.9	389
2/11/2026	17:30:00	7.9	0.029904985	38.5	1108850.5	11.7	385
2/11/2026	17:45:00	7.9	0.029904985	0	1108879.4	11.8	359
2/11/2026	18:00:00	7.8	0.029526441	0	1108913.3	11.8	362
2/11/2026	18:15:00	7.7	0.029147897	0.3	1108954.6	11.6	364



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/11/2026	18:30:00	7.7	0.029147897	0	1108986.3	11.6	365
2/11/2026	18:45:00	7.6	0.028769353	0	1109030.1	11.6	364
2/11/2026	19:00:00	7.6	0.028769353	0	1109060.5	11.6	364
2/11/2026	19:15:00	7.7	0.029147897	0	1109103.4	11.5	363
2/11/2026	19:30:00	7.7	0.029147897	0	1109131.8	11.5	364
2/11/2026	19:45:00	7.7	0.029147897	2.4	1109170.6	11.5	364
2/11/2026	20:00:00	7.7	0.029147897	0	1109203.2	11.4	362
2/11/2026	20:15:00	7.8	0.029526441	0	1109230	11.4	363
2/11/2026	20:30:00	7.8	0.029526441	3	1109268	11.4	361
2/11/2026	20:45:00	7.8	0.029526441	2.8	1109300.4	11.4	359
2/11/2026	21:00:00	4.1	0.015520309	27	1109332.9	11.8	359
2/11/2026	21:15:00	7.3	0.027633721	0	1109375.3	11.6	358
2/11/2026	21:30:00	7.3	0.027633721	0	1109409.5	11.6	356
2/11/2026	21:45:00	7.3	0.027633721	0	1109455	11.7	353
2/11/2026	22:00:00	7.3	0.027633721	0	1109487.9	11.7	353
2/11/2026	22:15:00	7.3	0.027633721	1	1109534.7	11.8	351
2/11/2026	22:30:00	7.4	0.028012265	1.9	1109566.8	11.9	353
2/11/2026	22:45:00	7.4	0.028012265	5.4	1109598.8	11.9	354
2/11/2026	23:00:00	7.1	0.026876632	13.7	1109645.6	11.9	354
2/11/2026	23:15:00	6.9	0.026119544	12.1	1109674.8	12	353
2/11/2026	23:30:00	7	0.026498088	29.8	1109711.8	12.1	350
2/11/2026	23:45:00	7.3	0.027633721	0	1109750.4	12.3	350
2/12/2026	0:00:00	7.2	0.027255177	5.8	1109785.3	12.5	350
2/12/2026	0:15:00	7.1	0.026876632	0	1109829.9	12.2	346
2/12/2026	0:30:00	7.2	0.027255177	1.4	1109865.4	12.4	347
2/12/2026	0:45:00	7.4	0.028012265	0.2	1109895.4	12.7	345
2/12/2026	1:00:00	7.4	0.028012265	0	1109941.6	12.4	344
2/12/2026	1:15:00	7.4	0.028012265	0	1109974	12.5	344
2/12/2026	1:30:00	7.5	0.028390809	1	1110012.3	12.6	344
2/12/2026	1:45:00	7.3	0.027633721	7.9	1110054.5	12.4	344
2/12/2026	2:00:00	7.3	0.027633721	15.3	1110090.9	12.6	344
2/12/2026	2:15:00	7.3	0.027633721	6.1	1110135.4	12.4	341
2/12/2026	2:30:00	7.4	0.028012265	8.5	1110169.2	12.5	340
2/12/2026	2:45:00	7.2	0.027255177	2.4	1110213.9	12.4	339



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/12/2026	3:00:00	7	0.026498088	0	1110243.5	12.4	341
2/12/2026	3:15:00	7.2	0.027255177	0.1	1110279.1	12.3	339
2/12/2026	3:30:00	7	0.026498088	0	1110319	12.2	342
2/12/2026	3:45:00	7	0.026498088	1.8	1110366.9	12.1	340
2/12/2026	4:00:00	6.9	0.026119544	3.5	1110404.3	12.2	341
2/12/2026	4:15:00	6.7	0.025362456	7	1110452.4	12.2	341
2/12/2026	4:30:00	6.6	0.024983912	10.1	1110497.9	12.2	336
2/12/2026	4:45:00	6.8	0.025741	7.9	1110526	12.3	336
2/12/2026	5:00:00	6.9	0.026119544	4.6	1110571.9	12.3	338
2/12/2026	5:15:00	6.7	0.025362456	5.4	1110599.5	12.4	336
2/12/2026	5:30:00	6.5	0.024605368	11.1	1110647.7	12.3	336
2/12/2026	5:45:00	6.8	0.025741	12.4	1110677.5	12.2	336
2/12/2026	6:00:00	7.2	0.027255177	1.5	1110723.6	12.4	334
2/12/2026	6:15:00	7.2	0.027255177	0	1110758.9	13.1	338
2/12/2026	6:30:00	7.2	0.027255177	0	1110807.5	13.8	338
2/12/2026	6:45:00	7.4	0.028012265	3.9	1110846.7	12.3	329
2/12/2026	7:00:00	7	0.026498088	0	1110885.6	12	334
2/12/2026	7:15:00	7.3	0.027633721	0.9	1110931.4	11.8	334
2/12/2026	7:30:00	7.5	0.028390809	0.2	1110967.7	11.8	334
2/12/2026	7:45:00	7.4	0.028012265	4.4	1111006	11.6	334
2/12/2026	8:00:00	7.5	0.028390809	9.3	1111039.1	11.6	336
2/12/2026	8:15:00	7.4	0.028012265	4	1111077.5	11.5	336
2/12/2026	8:30:00	7.5	0.028390809	25.9	1111120.1	11.4	334
2/12/2026	8:45:00	8	0.03028353	32.1	1111147.4	11.4	334
2/12/2026	9:00:00	8.3	0.031419162	6.6	1111186.1	11.5	334
2/12/2026	9:15:00	7.4	0.028012265	7.3	1111220.1	11.4	331
2/12/2026	9:30:00	7.7	0.029147897	4.7	1111253.4	11.4	332
2/12/2026	9:45:00	7.5	0.028390809	4.1	1111292.9	11.3	333
2/12/2026	10:00:00	7.2	0.027255177	6.1	1111325.5	11.4	333
2/12/2026	10:15:00	6.5	0.024605368	0.9	1111368	11.3	333
2/12/2026	10:30:00	6.5	0.024605368	0.4	1111400.6	11.3	335
2/12/2026	10:45:00	6.7	0.025362456	0.7	1111444.6	11.3	336
2/12/2026	11:00:00	6.9	0.026119544	0.1	1111479.3	11.3	336
2/12/2026	11:15:00	6.8	0.025741	0.7	1111523.8	11.4	334



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/12/2026	11:30:00	6.9	0.026119544	1.1	1111557.9	11.5	336
2/12/2026	11:45:00	6.9	0.026119544	1.2	1111602	11.5	336
2/12/2026	12:00:00	7.1	0.026876632	2.5	1111631.8	11.6	338
2/12/2026	12:15:00	7.1	0.026876632	3.8	1111675.4	11.5	339
2/12/2026	12:30:00	7.2	0.027255177	16.9	1111709	11.6	339
2/12/2026	12:45:00	7.2	0.027255177	5.1	1111751.7	11.5	339
2/12/2026	13:00:00	7.2	0.027255177	5.1	1111783.8	11.6	339
2/12/2026	13:15:00	7.2	0.027255177	7.4	1111823.6	11.5	339
2/12/2026	13:30:00	7.3	0.027633721	14	1111856.3	11.6	343
2/12/2026	13:45:00	7.2	0.027255177	8.1	1111893.4	11.5	339
2/12/2026	14:00:00	7.5	0.028390809	19	1111924.2	11.5	339
2/12/2026	14:15:00	7.5	0.028390809	8.8	1111964.4	11.5	339
2/12/2026	14:30:00	7.5	0.028390809	10.8	1112007	11.5	339
2/12/2026	14:45:00	7.5	0.028390809	9.1	1112037.7	11.5	339
2/12/2026	15:00:00	7.6	0.028769353	0	1112081.2	11.6	336
2/12/2026	15:15:00	7.5	0.028390809	5.8	1112111.9	11.5	338
2/12/2026	15:30:00	7.5	0.028390809	12	1112156	11.5	336
2/12/2026	15:45:00	7.4	0.028012265	13.6	1112185.2	11.5	336
2/12/2026	16:00:00	7.5	0.028390809	10.2	1112225.2	11.4	338
2/12/2026	16:15:00	7.2	0.027255177	9.3	1112257.1	11.4	338
2/12/2026	16:30:00	7.2	0.027255177	11.6	1112287.5	11.5	338
2/12/2026	16:45:00	7.3	0.027633721	11.6	1112331.1	11.4	336
2/12/2026	17:00:00	7.2	0.027255177	7.9	1112365.4	11.4	336
2/12/2026	17:15:00	7.4	0.028012265	7.8	1112396.3	11.5	336
2/12/2026	17:30:00	7.3	0.027633721	7.9	1112433.8	11.4	336
2/12/2026	17:45:00	7.4	0.028012265	13.6	1112465.6	11.4	338
2/12/2026	18:00:00	7.2	0.027255177	6	1112502.4	11.4	330
2/12/2026	18:15:00	7.2	0.027255177	4.5	1112533.2	11.4	332
2/12/2026	18:30:00	7.4	0.028012265	3.2	1112575.3	11.4	332
2/12/2026	18:45:00	7.2	0.027255177	9.8	1112604.3	11.3	333
2/12/2026	19:00:00	7.2	0.027255177	16.2	1112636.5	11.4	331
2/12/2026	19:15:00	7	0.026498088	2.4	1112675.7	11.3	328
2/12/2026	19:30:00	7.3	0.027633721	3.1	1112704	11.4	331
2/12/2026	19:45:00	7.3	0.027633721	0.8	1112744.6	11.3	331



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/12/2026	20:00:00	7.4	0.028012265	4.3	1112774.6	11.3	331
2/12/2026	20:15:00	7.3	0.027633721	1.9	1112815.2	11.3	331
2/12/2026	20:30:00	7.3	0.027633721	2.9	1112849.8	11.3	331
2/12/2026	20:45:00	7.4	0.028012265	1.6	1112881.5	11.5	331
2/12/2026	21:00:00	7.5	0.028390809	3.8	1112913	11.4	331
2/12/2026	21:15:00	7.4	0.028012265	3.6	1112952.5	11.4	331
2/12/2026	21:30:00	7.3	0.027633721	2.9	1112985.5	11.3	331
2/12/2026	21:45:00	7.3	0.027633721	0.6	1113022.9	11.5	329
2/12/2026	22:00:00	7.1	0.026876632	3.1	1113056.1	11.7	327
2/12/2026	22:15:00	7.4	0.028012265	2.1	1113096.1	11.9	325
2/12/2026	22:30:00	7.4	0.028012265	3.2	1113135.9	11.9	328
2/12/2026	22:45:00	7.4	0.028012265	2.1	1113170.2	12.1	324
2/12/2026	23:00:00	7.5	0.028390809	9.4	1113195.9	12.4	326
2/12/2026	23:15:00	7.5	0.028390809	3.5	1113226.1	12.3	326
2/12/2026	23:30:00	7.3	0.027633721	2.2	1113262.3	12.2	326
2/12/2026	23:45:00	7.3	0.027633721	3.2	1113287.7	12.1	323
2/13/2026	0:00:00	7.1	0.026876632	5.2	1113319.6	12.1	324
2/13/2026	0:15:00	6.6	0.024983912	0.2	1113362.5	12.1	323
2/13/2026	0:30:00	6.6	0.024983912	0	1113391.9	12.2	322
2/13/2026	0:45:00	7	0.026498088	0	1113424.4	12.6	322
2/13/2026	1:00:00	7.1	0.026876632	0	1113471	12.4	322
2/13/2026	1:15:00	7.2	0.027255177	0	1113502.9	12.5	323
2/13/2026	1:30:00	7.3	0.027633721	0	1113534.2	12.9	323
2/13/2026	1:45:00	7.6	0.028769353	0	1113576.4	12.5	323
2/13/2026	2:00:00	7.5	0.028390809	4.5	1113611.8	12.5	323
2/13/2026	2:15:00	7.5	0.028390809	1.6	1113645.8	12.5	322
2/13/2026	2:30:00	7.6	0.028769353	0	1113676.6	12.9	322
2/13/2026	2:45:00	7.5	0.028390809	0	1113719.4	12.6	318
2/13/2026	3:00:00	7.4	0.028012265	0.1	1113753.9	12.5	320
2/13/2026	3:15:00	7.4	0.028012265	0	1113781.3	12.5	320
2/13/2026	3:30:00	7.4	0.028012265	1.1	1113813.6	12.7	318
2/13/2026	3:45:00	7.5	0.028390809	0.5	1113848.7	12.8	318
2/13/2026	4:00:00	7.4	0.028012265	1.4	1113891.4	12.6	318
2/13/2026	4:15:00	7.4	0.028012265	1	1113924.2	12.6	318



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/13/2026	4:30:00	7.4	0.028012265	0	1113971.7	12.5	316
2/13/2026	4:45:00	7.4	0.028012265	0	1113994.2	13.1	320
2/13/2026	5:00:00	7.4	0.028012265	4.7	1114042.1	12.6	317
2/13/2026	5:15:00	7.4	0.028012265	0	1114073.6	12.6	315
2/13/2026	5:30:00	7.4	0.028012265	0	1114105.9	12.7	315
2/13/2026	5:45:00	7.5	0.028390809	0	1114149	12.6	315
2/13/2026	6:00:00	7.4	0.028012265	1.1	1114184.5	12.5	313
2/13/2026	6:15:00	7.5	0.028390809	1.4	1114218.7	12.4	314
2/13/2026	6:30:00	7.7	0.029147897	0	1114253.8	12.5	313
2/13/2026	6:45:00	7.3	0.027633721	0	1114292.4	12.2	313
2/13/2026	7:00:00	7.2	0.027255177	0	1114326.2	12.1	314
2/13/2026	7:15:00	7.4	0.028012265	0	1114361.3	12.1	314
2/13/2026	7:30:00	7.3	0.027633721	0	1114399.7	11.8	313
2/13/2026	7:45:00	7.3	0.027633721	0	1114429.7	11.8	316
2/13/2026	8:00:00	7.3	0.027633721	0.7	1114474.4	11.6	316
2/13/2026	8:15:00	7.4	0.028012265	0	1114505.2	11.6	318
2/13/2026	8:30:00	7.5	0.028390809	2.2	1114531.1	12	318
2/13/2026	8:45:00	7.3	0.027633721	4.1	1114573.8	11.8	316
2/13/2026	9:00:00	7.3	0.027633721	0.8	1114606.9	11.9	316
2/13/2026	9:15:00	7.4	0.028012265	0.3	1114635.3	12.1	317
2/13/2026	9:30:00	7.3	0.027633721	6.5	1114679.7	11.9	314
2/13/2026	9:45:00	7.4	0.028012265	2.9	1114708.2	12.1	317
2/13/2026	10:00:00	7.3	0.027633721	8.9	1114753.3	11.9	315
2/13/2026	10:15:00	7.3	0.027633721	10.3	1114786.1	12	314
2/13/2026	10:30:00	7.4	0.028012265	12.1	1114832.6	11.9	316
2/13/2026	10:45:00	7.3	0.027633721	3.8	1114862.1	11.8	310
2/13/2026	11:00:00	7.4	0.028012265	0.8	1114891.6	11.9	314
2/13/2026	11:15:00	7.3	0.027633721	0.4	1114933.3	11.7	308
2/13/2026	11:30:00	7.3	0.027633721	2.2	1114976.8	11.6	309
2/13/2026	11:45:00	7.5	0.028390809	1.1	1115000	11.8	315
2/13/2026	12:00:00	7.2	0.027255177	9.1	1115036.8	11.6	313
2/13/2026	12:15:00	7.2	0.027255177	5.3	1115065.1	11.8	317
2/13/2026	12:30:00	7.4	0.028012265	0	1115103.5	11.7	315
2/13/2026	12:45:00	7.3	0.027633721	7.1	1115132.7	11.7	315



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/13/2026	13:00:00	7.4	0.028012265	16.8	1115177.8	11.8	315
2/13/2026	13:15:00	7.4	0.028012265	11.7	1115221	11.8	315
2/13/2026	13:30:00	7.4	0.028012265	10.6	1115265.4	11.9	315
2/13/2026	13:45:00	7.4	0.028012265	0	1115296.1	12	310
2/13/2026	14:00:00	7.4	0.028012265	0	1115341.5	11.9	310
2/13/2026	14:15:00	7.4	0.028012265	0	1115374.2	12	312
2/13/2026	14:30:00	7.3	0.027633721	0	1115418.7	11.9	312
2/13/2026	14:45:00	7.4	0.028012265	0	1115461.7	11.8	312
2/13/2026	15:00:00	7.4	0.028012265	0	1115493.7	11.8	312
2/13/2026	15:15:00	7.5	0.028390809	0	1115529.4	11.8	312
2/13/2026	15:30:00	7.4	0.028012265	0	1115568.5	11.7	315
2/13/2026	15:45:00	7.4	0.028012265	0	1115598.3	11.9	315
2/13/2026	16:00:00	7.4	0.028012265	2	1115644.2	11.8	315
2/13/2026	16:15:00	7.4	0.028012265	9.1	1115687.4	11.8	315
2/13/2026	16:30:00	7.3	0.027633721	6	1115722.4	12	315
2/13/2026	16:45:00	7.5	0.028390809	0.3	1115758.2	12	313
2/13/2026	17:00:00	7.4	0.028012265	4.6	1115793.9	11.8	313
2/13/2026	17:15:00	7.3	0.027633721	3	1115820.7	11.9	313
2/13/2026	17:30:00	7.4	0.028012265	9.2	1115865.6	11.8	315
2/13/2026	17:45:00	7.5	0.028390809	9.6	1115907.1	11.7	310
2/13/2026	18:00:00	7.4	0.028012265	6	1115949.9	11.6	312
2/13/2026	18:15:00	7.4	0.028012265	5.6	1115990.4	11.6	312
2/13/2026	18:30:00	7.3	0.027633721	8.7	1116011.9	11.6	312
2/13/2026	18:45:00	7.3	0.027633721	20.9	1116055	11.6	313
2/13/2026	19:00:00	7.5	0.028390809	0	1116086.5	11.7	284
2/13/2026	19:15:00	7.4	0.028012265	0	1116129.4	11.5	298
2/13/2026	19:30:00	7.2	0.027255177	0	1116162.6	11.5	303
2/13/2026	19:45:00	7.2	0.027255177	1.2	1116208.2	11.4	307
2/13/2026	20:00:00	7.2	0.027255177	5.1	1116242.3	11.4	307
2/13/2026	20:15:00	7.4	0.028012265	2.2	1116272.5	11.6	305
2/13/2026	20:30:00	7.5	0.028390809	13.7	1116311.4	11.5	305
2/13/2026	20:45:00	7.4	0.028012265	11.2	1116323.7	11.5	307
2/13/2026	21:00:00	7.4	0.028012265	0	1116374.1	11.5	305
2/13/2026	21:15:00	7.4	0.028012265	0.7	1116400.1	11.6	307



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/13/2026	21:30:00	7.4	0.028012265	0.7	1116446.6	11.4	307
2/13/2026	21:45:00	7.3	0.027633721	1	1116475.6	11.4	305
2/13/2026	22:00:00	7.5	0.028390809	21.5	1116517.3	11.3	305
2/13/2026	22:15:00	7.5	0.028390809	18.9	1116551.3	11.3	307
2/13/2026	22:30:00	7.4	0.028012265	0	1116595.8	11.4	305
2/13/2026	22:45:00	7.3	0.027633721	1.9	1116627.1	11.4	305
2/13/2026	23:00:00	7.4	0.028012265	11.1	1116672.3	11.4	306
2/13/2026	23:15:00	7.1	0.026876632	0	1116705.4	11.5	307
2/13/2026	23:30:00	7.1	0.026876632	0	1116735.9	11.6	304
2/13/2026	23:45:00	7.1	0.026876632	1.2	1116774.5	11.6	303
2/14/2026	0:00:00	7.1	0.026876632	14.5	1116821.3	11.7	303
2/14/2026	0:15:00	7.2	0.027255177	1.7	1116855.5	11.9	303
2/14/2026	0:30:00	7.2	0.027255177	1.8	1116887.4	11.9	301
2/14/2026	0:45:00	7.2	0.027255177	7.8	1116930.8	11.9	303
2/14/2026	1:00:00	7.3	0.027633721	20.9	1116964.1	12	303
2/14/2026	1:15:00	9	0.034068971	44.4	1116999.2	12.1	299
2/14/2026	1:30:00	8.8	0.033311882	145.5	1117027.7	12.2	288
2/14/2026	1:45:00	8.7	0.032933338	78.1	1117066.3	12.2	328
2/14/2026	3:00:00	7.7	0.029147897	0	1117164.9	11.9	369
2/14/2026	3:15:00	7.7	0.029147897	0	1117192.2	12.2	375
2/14/2026	3:30:00	7.7	0.029147897	0	1117220.3	12.5	376
2/14/2026	3:45:00	7.8	0.029526441	0	1117256.9	12.6	380
2/14/2026	4:00:00	7	0.026498088	3.6	1117297.6	11.7	377
2/14/2026	4:15:00	6.8	0.025741	12.2	1117325.2	11.7	379
2/14/2026	4:30:00	7	0.026498088	7.2	1117374.7	11.6	378
2/14/2026	4:45:00	7.3	0.027633721	30.8	1117417.4	11.8	377
2/14/2026	5:00:00	7.4	0.028012265	5.9	1117453.9	11.9	374
2/14/2026	5:15:00	7.5	0.028390809	10.9	1117494.2	12	374
2/14/2026	5:30:00	7.5	0.028390809	8.1	1117531.9	11.9	375
2/14/2026	5:45:00	7.3	0.027633721	1.8	1117570.4	12	376
2/14/2026	6:00:00	7.1	0.026876632	4.6	1117611.3	11.9	375
2/14/2026	6:15:00	7.3	0.027633721	10.2	1117650.9	12	371
2/14/2026	6:30:00	7.3	0.027633721	4.2	1117684.9	11.8	374
2/14/2026	6:45:00	7.4	0.028012265	22.8	1117723.7	11.8	371



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/14/2026	7:00:00	7.3	0.027633721	6.1	1117770.1	11.7	372
2/14/2026	7:15:00	7.3	0.027633721	6	1117804.6	11.7	372
2/14/2026	7:30:00	7.1	0.026876632	5.4	1117855	11.6	369
2/14/2026	7:45:00	6.9	0.026119544	10.8	1117889.7	11.7	371
2/14/2026	8:00:00	7	0.026498088	20.6	1117938.9	11.5	367
2/14/2026	8:15:00	7.1	0.026876632	0.8	1117964.7	11.6	355
2/14/2026	8:30:00	7.2	0.027255177	15.4	1118013.2	11.3	359
2/14/2026	8:45:00	7.2	0.027255177	11.8	1118053.4	11.3	360
2/14/2026	9:00:00	7.3	0.027633721	4.5	1118097.6	11.3	359
2/14/2026	9:15:00	7.2	0.027255177	9.5	1118137.7	11.4	359
2/14/2026	9:30:00	7.3	0.027633721	9.9	1118179.6	11.4	359
2/14/2026	9:45:00	7.4	0.028012265	7.9	1118218	11.5	359
2/14/2026	10:00:00	7.4	0.028012265	19	1118258.8	11.5	359
2/14/2026	10:15:00	7.5	0.028390809	4.6	1118301.2	11.6	357
2/14/2026	10:30:00	7.4	0.028012265	16.6	1118348.9	11.8	352
2/14/2026	10:45:00	7.4	0.028012265	52.2	1118373.9	12	353
2/14/2026	11:00:00	7.6	0.028769353	2.8	1118407.7	12.2	353
2/14/2026	11:15:00	7.5	0.028390809	7.3	1118451.9	12	352
2/14/2026	11:30:00	7.6	0.028769353	27	1118481.9	12.1	353
2/14/2026	11:45:00	7.4	0.028012265	7.3	1118502.4	11.9	348
2/14/2026	12:00:00	7.5	0.028390809	11	1118547.1	11.8	348
2/14/2026	12:15:00	7.5	0.028390809	11.1	1118581.2	11.8	351
2/14/2026	12:45:00	7.6	0.028769353	19.3	1118654.3	11.7	350
2/14/2026	13:15:00	7.5	0.028390809	5.1	1118700.5	11.7	344
2/14/2026	13:45:00	7.5	0.028390809	21.6	1118777.5	11.7	338
2/14/2026	14:00:00	7.5	0.028390809	31.5	1118817.9	11.7	328
2/14/2026	14:15:00	7.5	0.028390809	18.3	1118856.9	11.7	328
2/14/2026	14:30:00	7.6	0.028769353	11.5	1118894.9	11.8	332
2/14/2026	15:00:00	7.4	0.028012265	9.2	1118937.8	11.8	331
2/14/2026	15:30:00	7.5	0.028390809	20	1119004.3	11.9	333
2/14/2026	15:45:00	7.5	0.028390809	15.5	1119043.9	12	328
2/14/2026	16:00:00	7.4	0.028012265	20.6	1119092.2	12	320
2/14/2026	16:15:00	7.4	0.028012265	11.3	1119127.1	12	320
2/14/2026	16:30:00	7.4	0.028012265	20.7	1119167.4	11.9	322



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/14/2026	16:45:00	7.4	0.028012265	17.4	1119200.6	11.9	313
2/14/2026	17:00:00	7.4	0.028012265	18.1	1119240	11.9	315
2/14/2026	17:15:00	7.4	0.028012265	21.1	1119275.2	11.9	315
2/14/2026	17:30:00	7.4	0.028012265	11.8	1119291.7	11.9	317
2/14/2026	17:45:00	7.5	0.028390809	6.3	1119333.9	11.8	315
2/14/2026	18:00:00	7.4	0.028012265	13.6	1119376.5	11.8	317
2/14/2026	18:15:00	7.4	0.028012265	5.6	1119413.1	11.8	320
2/14/2026	18:30:00	7.4	0.028012265	17.4	1119453.8	11.8	318
2/14/2026	18:45:00	7.4	0.028012265	19	1119475.1	11.8	317
2/14/2026	19:00:00	7.3	0.027633721	4.9	1119516.7	11.7	317
2/14/2026	19:15:00	7.3	0.027633721	13.3	1119558.7	11.7	318
2/14/2026	19:30:00	7.4	0.028012265	25	1119604.8	11.7	318
2/14/2026	19:45:00	7.3	0.027633721	0	1119646.7	11.7	318
2/14/2026	20:00:00	7.4	0.028012265	0	1119683	11.8	318
2/14/2026	20:30:00	7.4	0.028012265	0	1119734.3	11.9	317
2/14/2026	20:45:00	7.4	0.028012265	0	1119769.6	11.9	317
2/14/2026	21:00:00	7.5	0.028390809	0	1119800.1	12	313
2/14/2026	21:15:00	7.5	0.028390809	0	1119828.8	11.9	313
2/14/2026	21:30:00	7.5	0.028390809	1.6	1119865.3	11.9	316
2/14/2026	21:45:00	7.5	0.028390809	1.6	1119893.7	11.9	315
2/14/2026	22:00:00	7.5	0.028390809	4.8	1119933.6	11.9	312
2/14/2026	22:15:00	7.4	0.028012265	0.4	1119960.3	12	315
2/14/2026	22:30:00	7.5	0.028390809	0	1119998.2	11.7	315
2/14/2026	22:45:00	7.6	0.028769353	0	1120033.8	11.6	315
2/14/2026	23:00:00	7.6	0.028769353	2.2	1120069.7	11.7	318
2/14/2026	23:15:00	7.6	0.028769353	0	1120109.4	11.8	315
2/14/2026	23:30:00	7.4	0.028012265	0	1120147.1	12	313
2/14/2026	23:45:00	7.3	0.027633721	0	1120184.5	12	315
2/15/2026	0:00:00	7	0.026498088	0	1120216.7	12.1	313
2/15/2026	0:15:00	7	0.026498088	0	1120251.6	12.2	312
2/15/2026	0:30:00	7.1	0.026876632	0	1120279.8	12.1	313
2/15/2026	0:45:00	7.1	0.026876632	0.1	1120318.1	12.1	313
2/15/2026	1:00:00	7	0.026498088	1.3	1120348.8	12.2	313
2/15/2026	1:15:00	7	0.026498088	3.2	1120393.6	12	312



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/15/2026	1:30:00	7.1	0.026876632	0	1120423	12	313
2/15/2026	1:45:00	7.2	0.027255177	0	1120449.8	12.1	315
2/15/2026	2:00:00	7.3	0.027633721	15.2	1120483.1	12	315
2/15/2026	2:15:00	7.3	0.027633721	0	1120511.8	11.9	313
2/15/2026	2:30:00	7.3	0.027633721	2.3	1120549.5	11.9	313
2/15/2026	2:45:00	7.4	0.028012265	0.1	1120587.1	11.8	313
2/15/2026	3:00:00	7.4	0.028012265	0.3	1120624.6	12	313
2/15/2026	3:15:00	7.4	0.028012265	0	1120662.3	11.9	313
2/15/2026	3:30:00	7.4	0.028012265	0.2	1120699.3	11.9	310
2/15/2026	3:45:00	7.3	0.027633721	2.8	1120726.9	11.9	312
2/15/2026	4:00:00	7.4	0.028012265	1.1	1120765.6	11.8	310
2/15/2026	4:15:00	7.4	0.028012265	2.8	1120796.3	12	313
2/15/2026	4:30:00	7.4	0.028012265	6.6	1120830.2	11.9	312
2/15/2026	4:45:00	7.5	0.028390809	2.6	1120864.8	11.9	312
2/15/2026	5:00:00	7.4	0.028012265	4.2	1120901.9	11.8	308
2/15/2026	5:15:00	7.5	0.028390809	5.2	1120933.1	11.9	310
2/15/2026	5:30:00	7.5	0.028390809	7.3	1120962.9	11.9	310
2/15/2026	5:45:00	7.5	0.028390809	8	1121001.6	11.8	310
2/15/2026	6:00:00	7.6	0.028769353	9.8	1121039	11.8	310
2/15/2026	6:15:00	7.5	0.028390809	9.9	1121077.7	11.7	304
2/15/2026	6:30:00	7.5	0.028390809	13.4	1121116.6	11.6	308
2/15/2026	6:45:00	7.5	0.028390809	26.2	1121163.6	11.6	310
2/15/2026	7:00:00	7.4	0.028012265	23.4	1121192.5	11.6	308
2/15/2026	7:15:00	7.4	0.028012265	35.4	1121239	11.4	310
2/15/2026	7:30:00	7.4	0.028012265	10.7	1121281.1	11.3	306
2/15/2026	7:45:00	7.4	0.028012265	10.3	1121315.4	11.2	308
2/15/2026	8:00:00	7.4	0.028012265	30.7	1121355.9	11.1	309
2/15/2026	8:15:00	7.4	0.028012265	16.8	1121388.4	11.2	308
2/15/2026	8:30:00	7.3	0.027633721	15.5	1121414.6	11.2	309
2/15/2026	8:45:00	7.4	0.028012265	16.7	1121437.8	11.1	308
2/15/2026	9:00:00	7.4	0.028012265	5.4	1121477.7	11.1	300
2/15/2026	9:15:00	7.5	0.028390809	38.7	1121508.2	11.1	304
2/15/2026	9:30:00	7.5	0.028390809	5.1	1121554.3	11	303
2/15/2026	9:45:00	7.5	0.028390809	3.2	1121593.4	11	307



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/15/2026	10:00:00	7.5	0.028390809	2.1	1121633.2	11.1	307
2/15/2026	10:15:00	7.4	0.028012265	1.3	1121672	11.1	307
2/15/2026	10:30:00	7.3	0.027633721	5.9	1121711.5	11.1	307
2/15/2026	10:45:00	7.4	0.028012265	9.2	1121746.1	11.2	307
2/15/2026	11:00:00	7.4	0.028012265	4.7	1121772.7	11.3	300
2/15/2026	11:15:00	7.3	0.027633721	6.8	1121810.6	11.3	302
2/15/2026	11:30:00	7.4	0.028012265	10.8	1121847.6	11.3	302
2/15/2026	11:45:00	7.4	0.028012265	6.2	1121886.2	11.3	302
2/15/2026	12:00:00	7.4	0.028012265	8.6	1121921	11.4	302
2/15/2026	12:15:00	7.3	0.027633721	6.8	1121962.2	11.4	302
2/15/2026	12:30:00	7.3	0.027633721	6.7	1121991.5	11.4	302
2/15/2026	12:45:00	7.4	0.028012265	16.5	1122032.5	11.5	302
2/15/2026	13:00:00	7.4	0.028012265	13.6	1122069.8	11.5	302
2/15/2026	13:15:00	7.6	0.028769353	29.6	1122101.5	11.6	302
2/15/2026	13:30:00	7.8	0.029526441	26.1	1122134.3	11.7	282
2/15/2026	13:45:00	7.9	0.029904985	28.9	1122171.2	11.6	282
2/15/2026	14:00:00	7.9	0.029904985	26.2	1122197.3	11.6	286
2/15/2026	14:15:00	7.8	0.029526441	112.2	1122230.6	11.6	286
2/15/2026	14:30:00	8	0.03028353	0	1122262.6	11.7	266
2/15/2026	14:45:00	8	0.03028353	0	1122285.1	12.3	253
2/15/2026	15:00:00	7.9	0.029904985	50.3	1122297.7	11.7	294
2/15/2026	15:15:00	7.8	0.029526441	52.3	1122318.5	11.6	300
2/15/2026	15:30:00	7.8	0.029526441	38	1122354.1	11.3	305
2/15/2026	15:45:00	7.8	0.029526441	0.7	1122399	11.4	303
2/15/2026	16:00:00	7.7	0.029147897	36.4	1122421.8	11.4	307
2/15/2026	16:15:00	7.7	0.029147897	16.6	1122454.4	11.4	307
2/15/2026	16:30:00	7.6	0.028769353	0	1122489.3	11.4	310
2/15/2026	16:45:00	7.2	0.027255177	16.9	1122520	11.4	313
2/15/2026	17:00:00	7.4	0.028012265	0	1122563	11.4	312
2/15/2026	17:15:00	7.6	0.028769353	0	1122601.8	12.5	274
2/15/2026	17:30:00	7.3	0.027633721	10.7	1122645.9	11.7	303
2/15/2026	17:45:00	7.6	0.028769353	0	1122682.6	11.6	303
2/15/2026	18:00:00	7.8	0.029526441	0	1122714.7	11.6	300
2/15/2026	18:15:00	7.9	0.029904985	0	1122754.8	11.8	307



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/15/2026	18:30:00	7.9	0.029904985	0	1122791.1	12.1	310
2/15/2026	18:45:00	7.9	0.029904985	0	1122825.4	12.5	312
2/15/2026	19:00:00	7.9	0.029904985	0	1122855.4	12.9	313
2/15/2026	19:15:00	7.8	0.029526441	0	1122891	13.2	317
2/15/2026	19:30:00	7.8	0.029526441	0	1122917.5	13.5	318
2/15/2026	19:45:00	7.8	0.029526441	0	1122940.4	13.8	322
2/15/2026	20:00:00	7.8	0.029526441	0	1122970.5	14	322
2/15/2026	20:15:00	7.7	0.029147897	0	1123007.3	14.2	322
2/15/2026	20:30:00	7.8	0.029526441	18.8	1123040	11.9	320
2/15/2026	20:45:00	7.6	0.028769353	12.6	1123081.3	11.4	323
2/15/2026	21:00:00	7.6	0.028769353	11.7	1123119.3	11.3	324
2/15/2026	21:15:00	7.5	0.028390809	21.8	1123153.2	11.4	323
2/15/2026	21:30:00	7.4	0.028012265	18	1123192.1	11.5	326
2/15/2026	21:45:00	7	0.026498088	19.4	1123229.1	11.7	326
2/15/2026	22:15:00	6.9	0.026119544	0	1123273	12.1	302
2/15/2026	22:30:00	7	0.026498088	26.7	1123319.4	11.8	323
2/15/2026	22:45:00	7.2	0.027255177	12	1123354.5	11.9	334
2/15/2026	23:00:00	7.4	0.028012265	25.2	1123388.9	12.1	338
2/15/2026	23:15:00	7.5	0.028390809	14.9	1123423	12	336
2/15/2026	23:30:00	7.5	0.028390809	12.5	1123453.8	11.9	337
2/15/2026	23:45:00	7.5	0.028390809	41.4	1123490.1	11.9	336

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Table 3. In-Situ Parameters

Date	Temperature °C	DO mg/L	Conductivity SPC-uS/cm	SAL-ppt	pH	ORP (mV)	NTU
02/09/2026	15.3	10.24	200.9	0.10	7.31	238.9	5.79
02/10/2026	12.1	10.73	159.9	0.08	7.26	232.4	11.91
02/11/2026	10.6	11.46	241.0	0.12	7.08	212.8	7.19
02/12/2026	11.7	10.38	168.0	0.08	7.41	213.6	6.01
02/13/2026	11.5	11.13	180.3	0.09	7.25	247.7	7.40
02/14/2026	11.1	10.77	203.5	0.10	7.00	200.5	10.08
02/15/2026	10.8	9.91	182.8	0.09	7.43	150.7	6.82

1. Calibration Log:

Table 4. Calibration Log

Date	Unit	pH	Conductivity/Temp.	Salinity	NTU
2/11/2025	YSI	✓	✓	✓	✓
2/11/2025	WTP	✓	N/A	N/A	✓

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

APPENDIX A: WTP Log



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/9/2026	0:00:00	7.3	2.92202	3.2	1,099,038	Open	12.4	286
2/9/2026	0:15:00	7.3	2.925805	1.6	1,099,078	Open	12.3	288
2/9/2026	0:30:00	7.3	3.2551	3.5	1,099,122	Open	12.4	288
2/9/2026	0:45:00	7.2	3.334585	2.2	1,099,164	Open	12.4	287
2/9/2026	1:00:00	7.3	3.07342	24.9	1,099,209	Open	12.4	288
2/9/2026	1:15:00	7.5	3.221035	4.5	1,099,248	Open	12.4	287
2/9/2026	1:30:00	7.5	3.30052	7.7	1,099,292	Open	12.3	287
2/9/2026	1:45:00	7.5	3.2551	0	1,099,336	Open	12.4	287
2/9/2026	2:00:00	7.4	3.228605	6.1	1,099,360	Open	12.8	288
2/9/2026	2:15:00	7.3	0.541255	0	1,099,395	Open	12.6	287
2/9/2026	2:30:00	7.2	3.274025	7.2	1,099,435	Open	12.5	283
2/9/2026	2:45:00	7.3	3.16426	7.8	1,099,468	Open	12.9	287
2/9/2026	3:00:00	7.3	3.327015	7	1,099,512	Open	12.5	283
2/9/2026	3:15:00	7.2	2.963655	9.9	1,099,547	Open	13	287
2/9/2026	3:30:00	7	3.228605	18.3	1,099,590	Open	12.5	283
2/9/2026	3:45:00	6.9	2.615435	1.3	1,099,620	Open	12.5	282
2/9/2026	4:00:00	7.1	3.198325	3.4	1,099,652	Open	12.5	284
2/9/2026	4:15:00	7.3	2.36941	3.2	1,099,695	Open	12.5	287
2/9/2026	4:30:00	7.4	3.2551	0	1,099,725	Open	13.4	288
2/9/2026	4:45:00	7.3	0.48448	0	1,099,754	Open	13.3	287
2/9/2026	5:00:00	7.3	3.221035	0.5	1,099,794	Open	12.6	287
2/9/2026	5:15:00	7.2	2.161235	0	1,099,824	Open	12.6	285
2/9/2026	5:30:00	7.1	3.14155	0	1,099,867	Open	12.6	287
2/9/2026	5:45:00	7.2	2.365625	0	1,099,908	Open	12.5	284
2/9/2026	6:00:00	7.2	3.21725	0	1,099,942	Open	12.5	288
2/9/2026	6:15:00	7.2	2.509455	0	1,099,974	Open	12.6	287
2/9/2026	6:30:00	7.3	3.19454	0	1,100,018	Open	12.4	288
2/9/2026	6:45:00	7.2	2.448895	0	1,100,050	Open	12.2	287
2/9/2026	7:00:00	7.3	2.95987	0	1,100,080	Open	12.3	287
2/9/2026	7:15:00	7.3	2.380765	0.2	1,100,122	Open	11.9	290
2/9/2026	7:30:00	7.3	3.20968	1	1,100,156	Open	11.8	290
2/9/2026	7:45:00	7.3	0.49962	0.3	1,100,186	Open	11.9	292
2/9/2026	8:00:00	7.2	3.258885	0	1,100,229	Open	11.8	290



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/9/2026	8:15:00	7.3	0.495835	0	1,100,259	Open	12.1	292
2/9/2026	8:30:00	7.2	3.243745	0	1,100,302	Open	11.9	292
2/9/2026	8:45:00	7.3	2.09689	0	1,100,331	Open	11.9	290
2/9/2026	9:00:00	7.3	3.190755	2.8	1,100,375	Open	11.8	290
2/9/2026	9:15:00	7.3	2.09689	11	1,100,407	Open	11.8	290
2/9/2026	9:30:00	7.2	3.23239	9.1	1,100,451	Open	11.8	292
2/9/2026	9:45:00	7.2	0.47691	16.1	1,100,477	Open	12	292
2/9/2026	10:00:00	7.2	3.258885	12.4	1,100,520	Open	11.8	292
2/9/2026	10:15:00	7.3	0.435275	13.9	1,100,553	Open	11.9	292
2/9/2026	10:30:00	7.6	3.14155	53.8	1,100,576	Open	11.9	292
2/9/2026	10:45:00	7.6	3.251315	6.5	1,100,604	Open	12	292
2/9/2026	11:00:00	7.3	3.236175	2.6	1,100,648	Open	11.8	292
2/9/2026	11:15:00	7	3.21725	4.8	1,100,693	Open	11.8	292
2/9/2026	11:30:00	6.9	3.251315	5	1,100,719	Open	11.7	292
2/9/2026	11:45:00	6.8	3.213465	12.2	1,100,758	Open	11.8	292
2/9/2026	12:00:00	7	2.99772	7.7	1,100,800	Open	11.8	292
2/9/2026	12:15:00	7.1	3.289165	28.1	1,100,828	Open	11.9	294
2/9/2026	12:30:00	7.2	3.19454	4.8	1,100,871	Open	11.8	293
2/9/2026	12:45:00	7.2	3.274025	32	1,100,915	Open	11.8	294
2/9/2026	13:00:00	7.2	0.488265	13.3	1,100,947	Closed	11.9	293
2/9/2026	13:15:00	7.2	0.90083	32.7	1,100,975	Open	11.8	292
2/9/2026	13:30:00	7.1	3.08099	18	1,101,009	Open	11.7	292
2/9/2026	13:45:00	7.2	3.34594	15.9	1,101,051	Open	11.7	290
2/9/2026	14:00:00	7.1	3.05071	21.9	1,101,092	Open	11.7	290
2/9/2026	14:15:00	7.3	3.29295	0	1,101,134	Open	11.7	292
2/9/2026	14:30:00	7.6	3.29295	0	1,101,173	Open	12	293
2/9/2026	14:45:00	7.6	3.175615	0	1,101,211	Open	12.3	295
2/9/2026	15:00:00	7.2	0.579105	16.8	1,101,253	Open	11.9	290
2/9/2026	15:15:00	7.1	3.190755	7.7	1,101,280	Open	11.8	292
2/9/2026	15:30:00	7.1	3.17183	20	1,101,327	Open	11.7	292
2/9/2026	15:45:00	7.2	0.52233	5.3	1,101,351	Open	11.8	288
2/9/2026	16:00:00	7.1	3.30052	12.6	1,101,399	Open	11.6	290
2/9/2026	16:15:00	7.1	3.20968	19.6	1,101,439	Open	11.6	290



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/9/2026	16:30:00	7.2	3.221035	67.1	1,101,471	Open	11.8	292
2/9/2026	16:45:00	7.1	3.289165	14.3	1,101,510	Open	11.7	292
2/9/2026	17:00:00	7.2	1.8925	18.6	1,101,540	Open	11.8	292
2/9/2026	17:15:00	7.4	3.27781	0	1,101,574	Open	11.7	292
2/9/2026	17:30:00	7.4	3.198325	0	1,101,616	Open	11.7	292
2/9/2026	17:45:00	7.6	3.31566	0	1,101,642	Open	11.9	290
2/9/2026	18:00:00	7.6	3.30052	0	1,101,686	Open	12.2	292
2/9/2026	18:15:00	7.6	3.198325	0	1,101,722	Open	12.6	292
2/9/2026	18:30:00	7.1	3.27024	12.4	1,101,766	Open	11.7	289
2/9/2026	18:45:00	7.3	0.435275	28.7	1,101,805	Open	11.7	287
2/9/2026	19:00:00	7.1	3.1794	10.7	1,101,841	Open	11.6	291
2/9/2026	19:15:00	7.4	3.16426	0	1,101,882	Open	11.6	291
2/9/2026	19:30:00	7.2	0.66616	3.5	1,101,922	Open	11.5	291
2/9/2026	19:45:00	7.2	3.16426	11.1	1,101,948	Open	11.5	289
2/9/2026	20:00:00	7.2	3.152905	5.6	1,101,992	Open	11.5	290
2/9/2026	20:15:00	7.2	3.145335	18.3	1,102,014	Open	11.9	288
2/9/2026	20:30:00	7.2	3.23239	8.2	1,102,057	Open	11.8	287
2/9/2026	20:45:00	7.3	3.092345	4.9	1,102,088	Open	12.1	286
2/9/2026	21:00:00	7.2	3.016645	3.8	1,102,123	Open	12	285
2/9/2026	21:15:00	7.2	2.857675	5.8	1,102,161	Open	12	284
2/9/2026	21:30:00	7.2	2.97501	11.3	1,102,199	Open	11.9	285
2/9/2026	21:45:00	7.4	2.963655	14.4	1,102,239	Open	11.9	285
2/9/2026	22:00:00	7.4	3.152905	15.1	1,102,283	Open	11.8	284
2/9/2026	22:15:00	7.5	0.563965	27.1	1,102,321	Open	11.8	286
2/9/2026	22:30:00	7.4	3.266455	10	1,102,354	Open	11.8	284
2/9/2026	22:45:00	7.4	3.30809	6.9	1,102,398	Open	11.8	284
2/9/2026	23:00:00	7.4	3.31566	6.1	1,102,440	Open	11.9	283
2/9/2026	23:15:00	7.6	3.29295	10.4	1,102,486	Open	12	282
2/9/2026	23:30:00	7.6	3.30052	7.1	1,102,528	Open	12.1	282
2/9/2026	23:45:00	7.4	3.402715	3.2	1,102,556	Open	12.3	280
2/10/2026	0:00:00	7.5	3.34594	8.1	1,102,599	Open	12.3	280
2/10/2026	0:15:00	7.5	3.228605	1.6	1,102,641	Open	12.4	280
2/10/2026	0:30:00	7.5	0.71915	1.8	1,102,681	Open	12.4	280



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/10/2026	0:45:00	7.5	3.319445	6	1,102,715	Open	12.5	278
2/10/2026	1:00:00	7.4	3.296735	7.7	1,102,758	Open	12.5	278
2/10/2026	1:15:00	7.4	3.296735	13.1	1,102,800	Open	12.6	278
2/10/2026	1:30:00	7.5	3.342155	6.8	1,102,827	Open	12.6	274
2/10/2026	1:45:00	7.5	3.28538	6.6	1,102,871	Open	12.4	277
2/10/2026	2:00:00	7.5	3.30809	5.1	1,102,895	Open	12.7	275
2/10/2026	2:15:00	7.4	3.432995	6.9	1,102,940	Open	12.3	277
2/10/2026	2:30:00	7.1	3.42921	15.6	1,102,987	Open	12.3	275
2/10/2026	2:45:00	7.1	3.432995	14.9	1,103,032	Open	12.2	275
2/10/2026	3:00:00	7.1	3.425425	13.9	1,103,076	Open	12.1	275
2/10/2026	3:15:00	7	3.4065	10.7	1,103,106	Open	12.1	278
2/10/2026	3:30:00	7.2	3.364865	8.3	1,103,150	Open	12.2	275
2/10/2026	3:45:00	7.3	3.485985	9	1,103,184	Open	12.3	274
2/10/2026	4:00:00	7.1	3.51248	2.5	1,103,230	Open	12.3	273
2/10/2026	4:15:00	7.2	3.198325	2.1	1,103,276	Open	13.1	277
2/10/2026	4:30:00	7.2	3.395145	6.4	1,103,319	Open	12.5	273
2/10/2026	4:45:00	7.4	3.36865	16.2	1,103,366	Open	12.5	273
2/10/2026	5:00:00	7.3	3.425425	19.3	1,103,386	Open	13	277
2/10/2026	5:15:00	6.9	3.37622	19.6	1,103,432	Open	12.6	274
2/10/2026	5:30:00	7	3.380005	20.3	1,103,475	Open	12.5	273
2/10/2026	5:45:00	7.2	3.45949	9.4	1,103,504	Open	12.5	276
2/10/2026	6:00:00	7.3	3.402715	9.1	1,103,549	Open	12.4	274
2/10/2026	6:15:00	7.4	3.410285	11.8	1,103,596	Open	12.4	274
2/10/2026	6:30:00	7.4	3.38379	10.7	1,103,641	Open	12.4	273
2/10/2026	6:45:00	7.4	3.349725	9.1	1,103,672	Open	12.2	275
2/10/2026	7:00:00	7.4	3.342155	7.3	1,103,717	Open	12	273
2/10/2026	7:15:00	7.3	3.327015	8	1,103,763	Open	11.9	273
2/10/2026	7:30:00	7.2	3.266455	8.7	1,103,806	Open	11.7	275
2/10/2026	7:45:00	7.2	3.26267	13	1,103,851	Open	11.6	277
2/10/2026	8:00:00	7.2	3.42921	12.9	1,103,879	Open	11.5	275
2/10/2026	8:15:00	7.1	3.27024	11.9	1,103,923	Open	11.5	276
2/10/2026	8:30:00	7.1	3.107485	8.5	1,103,966	Open	11.5	277
2/10/2026	8:45:00	7.2	3.35351	10.9	1,103,994	Open	11.5	274



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/10/2026	9:00:00	7.3	2.887955	10.7	1,104,036	Open	11.5	274
2/10/2026	9:15:00	7.4	0.50719	27.9	1,104,068	Open	11.6	274
2/10/2026	9:30:00	7.2	2.62679	7.1	1,104,108	Open	11.6	274
2/10/2026	9:45:00	7.2	3.24753	15.2	1,104,152	Open	11.6	274
2/10/2026	10:00:00	7.2	2.35427	18.2	1,104,197	Open	11.7	274
2/10/2026	10:15:00	7.3	3.26267	23.5	1,104,241	Open	11.6	274
2/10/2026	10:30:00	7.3	2.36184	15.8	1,104,284	Open	11.7	274
2/10/2026	10:45:00	7.2	3.30052	17.8	1,104,314	Open	11.7	274
2/10/2026	11:00:00	7.3	2.411045	15.2	1,104,357	Open	11.7	272
2/10/2026	11:15:00	7.5	0.31794	6.9	1,104,389	Open	11.9	273
2/10/2026	11:30:00	7.4	0.745645	33.5	1,104,398	Open	11.9	274
2/10/2026	11:45:00	7.4	3.13398	7.9	1,104,442	Open	11.7	272
2/10/2026	12:00:00	7.5	3.364865	4.3	1,104,482	Open	11.7	272
2/10/2026	12:15:00	7.5	2.630575	6.8	1,104,529	Open	11.7	272
2/10/2026	12:30:00	7.5	3.3308	9.8	1,104,569	Open	11.6	272
2/10/2026	12:45:00	7.5	2.32399	7.9	1,104,619	Open	11.6	274
2/10/2026	13:00:00	7.4	3.37622	4.5	1,104,648	Open	11.7	274
2/10/2026	13:15:00	7.5	2.45268	6.1	1,104,698	Open	11.7	274
2/10/2026	13:30:00	7.4	3.228605	4.8	1,104,737	Open	11.7	276
2/10/2026	13:45:00	7.4	2.30128	6.5	1,104,786	Open	11.8	276
2/10/2026	14:00:00	7.3	3.205895	2.7	1,104,815	Open	11.8	272
2/10/2026	14:15:00	7.3	2.108245	6.4	1,104,863	Open	11.8	272
2/10/2026	14:30:00	7.3	3.281595	9.7	1,104,903	Open	11.8	271
2/10/2026	14:45:00	7.3	2.365625	7	1,104,937	Open	11.8	271
2/10/2026	15:00:00	7.3	3.28538	8.7	1,104,979	Open	11.9	274
2/10/2026	15:15:00	7.3	1.888715	9.9	1,105,012	Open	11.9	274
2/10/2026	15:30:00	7.3	3.28538	7.6	1,105,051	Open	11.9	274
2/10/2026	15:45:00	7.4	0.495835	8.1	1,105,092	Open	12	274
2/10/2026	16:00:00	7.3	3.319445	5.9	1,105,128	Open	11.9	274
2/10/2026	16:15:00	7.3	1.7411	8.7	1,105,177	Open	11.9	274
2/10/2026	16:30:00	7.3	3.31566	5.2	1,105,204	Open	11.9	273
2/10/2026	16:45:00	7.3	0.46177	8.3	1,105,245	Open	11.9	271
2/10/2026	17:00:00	7.2	3.23239	6.4	1,105,279	Open	11.7	272



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/10/2026	17:15:00	7.4	0.47691	5.8	1,105,310	Open	11.9	274
2/10/2026	17:30:00	7.5	3.30809	13.5	1,105,348	Open	11.8	274
2/10/2026	17:45:00	8.2	0.51476	56	1,105,385	Open	11.8	272
2/10/2026	18:00:00	8.5	3.29295	3.9	1,105,422	Open	11.8	276
2/10/2026	18:15:00	8.3	0.43149	3.9	1,105,450	Open	12.1	282
2/10/2026	18:30:00	7.8	3.281595	0.5	1,105,497	Open	11.8	291
2/10/2026	18:45:00	7.4	0.791065	15.2	1,105,534	Open	11.7	297
2/10/2026	19:00:00	7.4	3.36865	13.7	1,105,570	Open	11.6	298
2/10/2026	19:15:00	7.2	0.563965	7.1	1,105,602	Open	11.6	302
2/10/2026	19:30:00	6.8	3.349725	8.5	1,105,644	Open	11.5	302
2/10/2026	19:45:00	6.8	0.49205	6.5	1,105,675	Open	11.5	305
2/10/2026	20:00:00	6.8	3.296735	5.1	1,105,715	Open	11.5	305
2/10/2026	20:15:00	7.1	0.4542	6.6	1,105,745	Open	11.5	305
2/10/2026	20:30:00	7.1	3.20211	4.5	1,105,784	Open	11.4	305
2/10/2026	20:45:00	7.1	0.62831	4.8	1,105,817	Open	11.4	305
2/10/2026	21:00:00	7.1	3.28538	9.6	1,105,856	Open	11.4	305
2/10/2026	21:15:00	7.3	0.510975	14	1,105,886	Open	11.5	305
2/10/2026	21:30:00	6.9	0.70401	5.4	1,105,930	Open	11.4	303
2/10/2026	21:45:00	6.8	3.190755	4.6	1,105,956	Open	11.5	303
2/10/2026	22:00:00	7	3.18697	7	1,106,004	Open	11.5	303
2/10/2026	22:15:00	7.2	0.457985	7.8	1,106,033	Open	11.7	302
2/10/2026	22:30:00	7.1	3.2551	6.4	1,106,075	Open	11.6	303
2/10/2026	22:45:00	7.1	0.67373	7.3	1,106,112	Open	11.6	302
2/10/2026	23:00:00	7.1	3.24753	10	1,106,149	Open	11.7	302
2/10/2026	23:15:00	7.2	0.457985	20.1	1,106,179	Open	11.9	302
2/10/2026	23:30:00	7.2	3.190755	9.5	1,106,219	Open	11.9	302
2/10/2026	23:45:00	7.2	0.79485	6.5	1,106,252	Open	12	302
2/11/2026	0:00:00	7.1	3.221035	8.7	1,106,289	Open	11.9	299
2/11/2026	0:15:00	7.2	3.18697	10.3	1,106,310	Open	12.3	303
2/11/2026	0:30:00	7	3.266455	7.9	1,106,359	Open	12.1	301
2/11/2026	0:45:00	7.1	0.5299	4.3	1,106,385	Open	12.7	303
2/11/2026	1:00:00	7.1	3.38379	3.3	1,106,435	Open	13.7	304
2/11/2026	1:15:00	7.1	3.387575	2.1	1,106,465	Open	14.7	307



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/11/2026	1:30:00	7.1	3.364865	1.4	1,106,516	Open	15.4	308
2/11/2026	1:45:00	7.1	3.228605	1.4	1,106,541	Open	16.3	311
2/11/2026	2:00:00	7.1	3.20968	4.6	1,106,590	Open	12.9	299
2/11/2026	2:15:00	7.1	3.2551	6.6	1,106,616	Open	12.7	305
2/11/2026	2:30:00	7.1	3.221035	7.6	1,106,664	Open	12.5	305
2/11/2026	2:45:00	7.1	3.33837	16.4	1,106,688	Open	12.7	307
2/11/2026	3:00:00	7.4	0.68887	22.6	1,106,735	Open	12.4	303
2/11/2026	3:15:00	7.9	3.33837	44.4	1,106,754	Open	12.4	305
2/11/2026	3:30:00	9	1.75624	141.9	1,106,769	Closed	12.4	314
2/11/2026	3:45:00	9.5	1.09008	177.1	1,106,769	Closed	12.4	339
2/11/2026	4:00:00	9.2	2.524595	0	1,106,769	Closed	12.5	377
2/11/2026	4:15:00	8.9	0	0	1,106,769	Closed	13	371
2/11/2026	4:30:00	8.3	0	81.7	1,106,769	Closed	11.5	422
2/11/2026	4:45:00	7.1	3.160475	52.5	1,106,807	Open	11.5	434
2/11/2026	5:00:00	7.3	1.419375	78.7	1,106,827	Open	11.7	447
2/11/2026	5:15:00	7.2	3.51248	48.1	1,106,868	Open	11.4	455
2/11/2026	5:30:00	7.4	1.64269	22.9	1,106,915	Open	11.4	460
2/11/2026	5:45:00	7.7	0.495835	24.6	1,106,940	Open	11.4	465
2/11/2026	6:00:00	7.2	1.631335	29.9	1,106,984	Open	11.4	467
2/11/2026	6:15:00	7.3	0	33.3	1,107,021	Closed	11.3	467
2/11/2026	6:30:00	7.4	1.65026	58.2	1,107,051	Open	11.3	470
2/11/2026	6:45:00	7.2	0.473125	23.2	1,107,084	Open	11.3	472
2/11/2026	7:00:00	6.9	1.956845	23.8	1,107,123	Open	11.3	472
2/11/2026	7:15:00	6.8	3.289165	12.1	1,107,146	Open	11.2	468
2/11/2026	7:30:00	7.2	2.872815	54.4	1,107,194	Open	11.3	465
2/11/2026	7:45:00	7	3.311875	4.4	1,107,237	Open	11.2	451
2/11/2026	8:00:00	7.2	2.24829	5.3	1,107,266	Open	11.1	454
2/11/2026	8:15:00	6.9	3.372435	7.8	1,107,310	Open	11.2	446
2/11/2026	8:30:00	7.1	3.387575	9.5	1,107,345	Open	11.2	446
2/11/2026	8:45:00	7.1	3.357295	7.7	1,107,395	Open	11.2	442
2/11/2026	9:00:00	7.1	3.334585	5	1,107,427	Open	11.3	439
2/11/2026	9:15:00	7.3	2.857675	0	1,107,459	Open	11.3	439
2/11/2026	9:30:00	7.5	0.715365	1.7	1,107,496	Open	11.3	426



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/11/2026	9:45:00	7.2	3.319445	1.1	1,107,529	Open	11.3	422
2/11/2026	10:00:00	6.2	2.90688	28.7	1,107,570	Open	11.5	413
2/11/2026	10:15:00	6.9	3.32323	0	1,107,616	Open	11.7	419
2/11/2026	10:30:00	6.9	2.03633	0	1,107,661	Open	12.3	421
2/11/2026	10:45:00	6.9	0.50719	0	1,107,703	Open	12.9	423
2/11/2026	11:00:00	6.6	3.425425	0	1,107,739	Open	12.1	420
2/11/2026	11:15:00	6.8	3.432995	27.8	1,107,789	Open	11.7	413
2/11/2026	11:30:00	7.6	0.692655	1.7	1,107,830	Open	11.8	410
2/11/2026	11:45:00	7	3.493555	18.1	1,107,848	Open	11.8	411
2/11/2026	12:00:00	7.2	3.470845	36.1	1,107,893	Closed	11.7	406
2/11/2026	12:15:00	7.6	0.61317	15.3	1,107,931	Open	11.7	409
2/11/2026	12:30:00	7.8	3.296735	6.1	1,107,963	Open	11.7	411
2/11/2026	12:45:00	7.3	3.311875	1.6	1,108,007	Open	11.7	408
2/11/2026	13:00:00	6.9	2.403475	2.2	1,108,037	Open	12	410
2/11/2026	13:15:00	7.1	2.45268	0	1,108,069	Open	12.4	411
2/11/2026	13:30:00	6.9	2.63436	0	1,108,107	Open	12.8	413
2/11/2026	13:45:00	7.1	3.243745	2.6	1,108,148	Open	11.8	406
2/11/2026	14:00:00	7.3	3.213465	1.7	1,108,192	Open	11.8	405
2/11/2026	14:15:00	7.4	3.3308	1.8	1,108,235	Open	11.8	402
2/11/2026	14:30:00	7.5	3.4822	11.9	1,108,279	Open	11.8	398
2/11/2026	14:45:00	7.7	3.36108	4.2	1,108,324	Open	11.9	399
2/11/2026	15:00:00	7.8	3.432995	5	1,108,359	Open	11.9	397
2/11/2026	15:15:00	7.8	3.334585	2.9	1,108,403	Open	11.9	395
2/11/2026	15:30:00	7.8	3.2551	4.5	1,108,435	Open	11.9	394
2/11/2026	15:45:00	7.7	3.387575	6.7	1,108,478	Open	11.9	392
2/11/2026	16:00:00	7.7	3.41407	8.6	1,108,510	Open	11.9	394
2/11/2026	16:15:00	7.6	3.28538	11.3	1,108,555	Open	11.8	390
2/11/2026	16:30:00	7.7	3.296735	9.8	1,108,586	Open	11.8	390
2/11/2026	16:45:00	7.7	0.77214	19.1	1,108,627	Open	11.8	389
2/11/2026	17:00:00	7.7	3.311875	10.5	1,108,659	Open	11.7	387
2/11/2026	17:15:00	7.7	0.488265	17.6	1,108,684	Open	11.9	389
2/11/2026	17:30:00	7.9	1.45344	38.5	1,108,725	Open	11.7	385
2/11/2026	17:45:00	7.9	3.304305	0	1,108,753	Open	11.8	359



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/11/2026	18:00:00	7.8	0.503405	0	1,108,787	Open	11.8	362
2/11/2026	18:15:00	7.7	3.2551	0.3	1,108,829	Open	11.6	364
2/11/2026	18:30:00	7.7	3.258885	0	1,108,860	Open	11.6	365
2/11/2026	18:45:00	7.6	3.3308	0	1,108,904	Open	11.6	364
2/11/2026	19:00:00	7.6	3.34594	0	1,108,935	Open	11.6	364
2/11/2026	19:15:00	7.7	0.77214	0	1,108,977	Open	11.5	363
2/11/2026	19:30:00	7.7	3.372435	0	1,109,006	Open	11.5	364
2/11/2026	19:45:00	7.7	0.579105	2.4	1,109,045	Open	11.5	364
2/11/2026	20:00:00	7.7	3.23239	0	1,109,077	Open	11.4	362
2/11/2026	20:15:00	7.8	3.35351	0	1,109,104	Open	11.4	363
2/11/2026	20:30:00	7.8	0.548825	3	1,109,142	Open	11.4	361
2/11/2026	20:45:00	7.8	3.296735	2.8	1,109,174	Open	11.4	359
2/11/2026	21:00:00	4.1	3.205895	27	1,109,207	Open	11.8	359
2/11/2026	21:15:00	7.3	3.327015	0	1,109,249	Open	11.6	358
2/11/2026	21:30:00	7.3	3.33837	0	1,109,284	Open	11.6	356
2/11/2026	21:45:00	7.3	3.31566	0	1,109,329	Open	11.7	353
2/11/2026	22:00:00	7.3	3.349725	0	1,109,362	Open	11.7	353
2/11/2026	22:15:00	7.3	3.41407	1	1,109,409	Open	11.8	351
2/11/2026	22:30:00	7.4	3.410285	1.9	1,109,441	Open	11.9	353
2/11/2026	22:45:00	7.4	3.43678	5.4	1,109,473	Open	11.9	354
2/11/2026	23:00:00	7.1	0.90083	13.7	1,109,520	Open	11.9	354
2/11/2026	23:15:00	6.9	3.485985	12.1	1,109,549	Open	12	353
2/11/2026	23:30:00	7	0.586675	29.8	1,109,586	Open	12.1	350
2/11/2026	23:45:00	7.3	3.45192	0	1,109,624	Open	12.3	350
2/12/2026	0:00:00	7.2	3.432995	5.8	1,109,659	Open	12.5	350
2/12/2026	0:15:00	7.1	3.4822	0	1,109,704	Open	12.2	346
2/12/2026	0:30:00	7.2	3.48977	1.4	1,109,739	Open	12.4	347
2/12/2026	0:45:00	7.4	2.50567	0.2	1,109,769	Open	12.7	345
2/12/2026	1:00:00	7.4	3.478415	0	1,109,816	Open	12.4	344
2/12/2026	1:15:00	7.4	3.493555	0	1,109,848	Open	12.5	344
2/12/2026	1:30:00	7.5	0.510975	1	1,109,886	Open	12.6	344
2/12/2026	1:45:00	7.3	3.47463	7.9	1,109,928	Open	12.4	344
2/12/2026	2:00:00	7.3	3.4822	15.3	1,109,965	Open	12.6	344



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/12/2026	2:15:00	7.3	3.470845	6.1	1,110,009	Open	12.4	341
2/12/2026	2:30:00	7.4	3.463275	8.5	1,110,043	Open	12.5	340
2/12/2026	2:45:00	7.2	3.46706	2.4	1,110,088	Open	12.4	339
2/12/2026	3:00:00	7	3.47463	0	1,110,117	Open	12.4	341
2/12/2026	3:15:00	7.2	0.510975	0.1	1,110,153	Open	12.3	339
2/12/2026	3:30:00	7	3.4822	0	1,110,193	Open	12.2	342
2/12/2026	3:45:00	7	3.470845	1.8	1,110,241	Open	12.1	340
2/12/2026	4:00:00	6.9	3.485985	3.5	1,110,278	Open	12.2	341
2/12/2026	4:15:00	6.7	3.478415	7	1,110,326	Open	12.2	341
2/12/2026	4:30:00	6.6	3.448135	10.1	1,110,372	Open	12.2	336
2/12/2026	4:45:00	6.8	3.470845	7.9	1,110,400	Open	12.3	336
2/12/2026	5:00:00	6.9	3.470845	4.6	1,110,446	Open	12.3	338
2/12/2026	5:15:00	6.7	3.48977	5.4	1,110,473	Open	12.4	336
2/12/2026	5:30:00	6.5	3.470845	11.1	1,110,522	Open	12.3	336
2/12/2026	5:45:00	6.8	3.493555	12.4	1,110,551	Open	12.2	336
2/12/2026	6:00:00	7.2	3.455705	1.5	1,110,598	Open	12.4	334
2/12/2026	6:15:00	7.2	3.493555	0	1,110,633	Open	13.1	338
2/12/2026	6:30:00	7.2	3.463275	0	1,110,681	Open	13.8	338
2/12/2026	6:45:00	7.4	0.63588	3.9	1,110,721	Open	12.3	329
2/12/2026	7:00:00	7	3.470845	0	1,110,759	Open	12	334
2/12/2026	7:15:00	7.3	3.319445	0.9	1,110,805	Open	11.8	334
2/12/2026	7:30:00	7.5	0.488265	0.2	1,110,842	Open	11.8	334
2/12/2026	7:45:00	7.4	3.37622	4.4	1,110,880	Open	11.6	334
2/12/2026	8:00:00	7.5	0.457985	9.3	1,110,913	Open	11.6	336
2/12/2026	8:15:00	7.4	3.311875	4	1,110,951	Open	11.5	336
2/12/2026	8:30:00	7.5	0.67373	25.9	1,110,994	Open	11.4	334
2/12/2026	8:45:00	8	3.296735	32.1	1,111,021	Open	11.4	334
2/12/2026	9:00:00	8.3	0.51476	6.6	1,111,060	Open	11.5	334
2/12/2026	9:15:00	7.4	3.296735	7.3	1,111,094	Open	11.4	331
2/12/2026	9:30:00	7.7	0.503405	4.7	1,111,127	Open	11.4	332
2/12/2026	9:45:00	7.5	3.342155	4.1	1,111,167	Open	11.3	333
2/12/2026	10:00:00	7.2	3.33837	6.1	1,111,199	Open	11.4	333
2/12/2026	10:15:00	6.5	3.289165	0.9	1,111,242	Open	11.3	333



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/12/2026	10:30:00	6.5	3.266455	0.4	1,111,274	Open	11.3	335
2/12/2026	10:45:00	6.7	3.33837	0.7	1,111,318	Open	11.3	336
2/12/2026	11:00:00	6.9	3.342155	0.1	1,111,353	Open	11.3	336
2/12/2026	11:15:00	6.8	3.304305	0.7	1,111,398	Open	11.4	334
2/12/2026	11:30:00	6.9	3.327015	1.1	1,111,432	Open	11.5	336
2/12/2026	11:45:00	6.9	3.19454	1.2	1,111,476	Open	11.5	336
2/12/2026	12:00:00	7.1	3.334585	2.5	1,111,506	Open	11.6	338
2/12/2026	12:15:00	7.1	3.29295	3.8	1,111,549	Open	11.5	339
2/12/2026	12:30:00	7.2	3.30809	16.9	1,111,583	Open	11.6	339
2/12/2026	12:45:00	7.2	3.311875	5.1	1,111,625	Open	11.5	339
2/12/2026	13:00:00	7.2	0.49962	5.1	1,111,658	Open	11.6	339
2/12/2026	13:15:00	7.2	3.327015	7.4	1,111,697	Open	11.5	339
2/12/2026	13:30:00	7.3	0.510975	14	1,111,730	Open	11.6	343
2/12/2026	13:45:00	7.2	3.28538	8.1	1,111,767	Open	11.5	339
2/12/2026	14:00:00	7.5	0.457985	19	1,111,798	Open	11.5	339
2/12/2026	14:15:00	7.5	2.71763	8.8	1,111,838	Open	11.5	339
2/12/2026	14:30:00	7.5	3.221035	10.8	1,111,881	Open	11.5	339
2/12/2026	14:45:00	7.5	3.18697	9.1	1,111,911	Open	11.5	339
2/12/2026	15:00:00	7.6	3.29295	0	1,111,955	Open	11.6	336
2/12/2026	15:15:00	7.5	3.243745	5.8	1,111,986	Open	11.5	338
2/12/2026	15:30:00	7.5	3.228605	12	1,112,030	Open	11.5	336
2/12/2026	15:45:00	7.4	3.23996	13.6	1,112,059	Open	11.5	336
2/12/2026	16:00:00	7.5	0.579105	10.2	1,112,099	Open	11.4	338
2/12/2026	16:15:00	7.2	3.334585	9.3	1,112,131	Open	11.4	338
2/12/2026	16:30:00	7.2	3.228605	11.6	1,112,161	Open	11.5	338
2/12/2026	16:45:00	7.3	3.342155	11.6	1,112,205	Open	11.4	336
2/12/2026	17:00:00	7.2	3.349725	7.9	1,112,239	Open	11.4	336
2/12/2026	17:15:00	7.4	0.49205	7.8	1,112,270	Open	11.5	336
2/12/2026	17:30:00	7.3	3.289165	7.9	1,112,307	Open	11.4	336
2/12/2026	17:45:00	7.4	0.46177	13.6	1,112,339	Open	11.4	338
2/12/2026	18:00:00	7.2	3.34594	6	1,112,376	Open	11.4	330
2/12/2026	18:15:00	7.2	3.35351	4.5	1,112,407	Open	11.4	332
2/12/2026	18:30:00	7.4	0.6813	3.2	1,112,449	Open	11.4	332



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/12/2026	18:45:00	7.2	3.31566	9.8	1,112,478	Open	11.3	333
2/12/2026	19:00:00	7.2	0.503405	16.2	1,112,510	Open	11.4	331
2/12/2026	19:15:00	7	3.304305	2.4	1,112,549	Open	11.3	328
2/12/2026	19:30:00	7.3	0.51476	3.1	1,112,578	Open	11.4	331
2/12/2026	19:45:00	7.3	3.304305	0.8	1,112,618	Open	11.3	331
2/12/2026	20:00:00	7.4	0.53747	4.3	1,112,648	Open	11.3	331
2/12/2026	20:15:00	7.3	3.410285	1.9	1,112,689	Open	11.3	331
2/12/2026	20:30:00	7.3	3.425425	2.9	1,112,723	Open	11.3	331
2/12/2026	20:45:00	7.4	0.510975	1.6	1,112,755	Open	11.5	331
2/12/2026	21:00:00	7.5	0.49205	3.8	1,112,787	Open	11.4	331
2/12/2026	21:15:00	7.4	3.41407	3.6	1,112,826	Open	11.4	331
2/12/2026	21:30:00	7.3	3.417855	2.9	1,112,859	Open	11.3	331
2/12/2026	21:45:00	7.3	0.47691	0.6	1,112,897	Open	11.5	329
2/12/2026	22:00:00	7.1	3.432995	3.1	1,112,930	Open	11.7	327
2/12/2026	22:15:00	7.4	0.55261	2.1	1,112,970	Open	11.9	325
2/12/2026	22:30:00	7.4	3.425425	3.2	1,113,010	Open	11.9	328
2/12/2026	22:45:00	7.4	3.43678	2.1	1,113,044	Open	12.1	324
2/12/2026	23:00:00	7.5	3.236175	9.4	1,113,070	Open	12.4	326
2/12/2026	23:15:00	7.5	0.526115	3.5	1,113,100	Open	12.3	326
2/12/2026	23:30:00	7.3	0.442845	2.2	1,113,136	Open	12.2	326
2/12/2026	23:45:00	7.3	0.72672	3.2	1,113,161	Open	12.1	323
2/13/2026	0:00:00	7.1	3.417855	5.2	1,113,193	Open	12.1	324
2/13/2026	0:15:00	6.6	0.72672	0.2	1,113,236	Open	12.1	323
2/13/2026	0:30:00	6.6	3.46706	0	1,113,266	Open	12.2	322
2/13/2026	0:45:00	7	0.54504	0	1,113,298	Open	12.6	322
2/13/2026	1:00:00	7.1	3.440565	0	1,113,345	Open	12.4	322
2/13/2026	1:15:00	7.2	3.455705	0	1,113,376	Open	12.5	323
2/13/2026	1:30:00	7.3	3.130195	0	1,113,408	Open	12.9	323
2/13/2026	1:45:00	7.6	0.62831	0	1,113,450	Open	12.5	323
2/13/2026	2:00:00	7.5	3.440565	4.5	1,113,485	Open	12.5	323
2/13/2026	2:15:00	7.5	3.46706	1.6	1,113,519	Open	12.5	322
2/13/2026	2:30:00	7.6	2.61922	0	1,113,550	Open	12.9	322
2/13/2026	2:45:00	7.5	0.692655	0	1,113,593	Open	12.6	318



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/13/2026	3:00:00	7.4	0.897045	0.1	1,113,627	Open	12.5	320
2/13/2026	3:15:00	7.4	3.463275	0	1,113,655	Open	12.5	320
2/13/2026	3:30:00	7.4	3.463275	1.1	1,113,687	Open	12.7	318
2/13/2026	3:45:00	7.5	0.52233	0.5	1,113,722	Open	12.8	318
2/13/2026	4:00:00	7.4	3.42921	1.4	1,113,765	Open	12.6	318
2/13/2026	4:15:00	7.4	3.45192	1	1,113,798	Open	12.6	318
2/13/2026	4:30:00	7.4	3.4065	0	1,113,845	Open	12.5	316
2/13/2026	4:45:00	7.4	3.266455	0	1,113,868	Open	13.1	320
2/13/2026	5:00:00	7.4	3.41407	4.7	1,113,916	Open	12.6	317
2/13/2026	5:15:00	7.4	3.448135	0	1,113,947	Open	12.6	315
2/13/2026	5:30:00	7.4	3.45949	0	1,113,979	Open	12.7	315
2/13/2026	5:45:00	7.5	0.730505	0	1,114,023	Open	12.6	315
2/13/2026	6:00:00	7.4	3.455705	1.1	1,114,058	Open	12.5	313
2/13/2026	6:15:00	7.5	3.45949	1.4	1,114,092	Open	12.4	314
2/13/2026	6:30:00	7.7	0.41635	0	1,114,127	Open	12.5	313
2/13/2026	6:45:00	7.3	3.30809	0	1,114,166	Open	12.2	313
2/13/2026	7:00:00	7.2	3.31566	0	1,114,200	Open	12.1	314
2/13/2026	7:15:00	7.4	0.46177	0	1,114,235	Open	12.1	314
2/13/2026	7:30:00	7.3	3.205895	0	1,114,273	Open	11.8	313
2/13/2026	7:45:00	7.3	3.213465	0	1,114,303	Open	11.8	316
2/13/2026	8:00:00	7.3	3.1794	0.7	1,114,348	Open	11.6	316
2/13/2026	8:15:00	7.4	3.205895	0	1,114,379	Open	11.6	318
2/13/2026	8:30:00	7.5	0.495835	2.2	1,114,405	Open	12	318
2/13/2026	8:45:00	7.3	3.304305	4.1	1,114,447	Open	11.8	316
2/13/2026	9:00:00	7.3	3.296735	0.8	1,114,480	Open	11.9	316
2/13/2026	9:15:00	7.4	1.328535	0.3	1,114,509	Open	12.1	317
2/13/2026	9:30:00	7.3	3.327015	6.5	1,114,553	Open	11.9	314
2/13/2026	9:45:00	7.4	0.50719	2.9	1,114,582	Open	12.1	317
2/13/2026	10:00:00	7.3	3.319445	8.9	1,114,627	Open	11.9	315
2/13/2026	10:15:00	7.3	3.34594	10.3	1,114,660	Open	12	314
2/13/2026	10:30:00	7.4	3.319445	12.1	1,114,706	Open	11.9	316
2/13/2026	10:45:00	7.3	3.24753	3.8	1,114,735	Open	11.8	310
2/13/2026	11:00:00	7.4	0.48448	0.8	1,114,765	Open	11.9	314



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/13/2026	11:15:00	7.3	3.281595	0.4	1,114,807	Open	11.7	308
2/13/2026	11:30:00	7.3	3.243745	2.2	1,114,850	Open	11.6	309
2/13/2026	11:45:00	7.5	0.329295	1.1	1,114,873	Open	11.8	315
2/13/2026	12:00:00	7.2	3.266455	9.1	1,114,910	Open	11.6	313
2/13/2026	12:15:00	7.2	3.26267	5.3	1,114,938	Open	11.8	317
2/13/2026	12:30:00	7.4	0.48448	0	1,114,977	Open	11.7	315
2/13/2026	12:45:00	7.3	3.258885	7.1	1,115,006	Open	11.7	315
2/13/2026	13:00:00	7.4	3.243745	16.8	1,115,051	Open	11.8	315
2/13/2026	13:15:00	7.4	3.32323	11.7	1,115,094	Open	11.8	315
2/13/2026	13:30:00	7.4	3.266455	10.6	1,115,139	Open	11.9	315
2/13/2026	13:45:00	7.4	3.349725	0	1,115,169	Open	12	310
2/13/2026	14:00:00	7.4	3.304305	0	1,115,215	Open	11.9	310
2/13/2026	14:15:00	7.4	0.510975	0	1,115,248	Open	12	312
2/13/2026	14:30:00	7.3	3.334585	0	1,115,292	Open	11.9	312
2/13/2026	14:45:00	7.4	0.806205	0	1,115,335	Open	11.8	312
2/13/2026	15:00:00	7.4	3.27024	0	1,115,367	Open	11.8	312
2/13/2026	15:15:00	7.5	0.4542	0	1,115,403	Open	11.8	312
2/13/2026	15:30:00	7.4	3.380005	0	1,115,442	Open	11.7	315
2/13/2026	15:45:00	7.4	3.4065	0	1,115,472	Open	11.9	315
2/13/2026	16:00:00	7.4	3.266455	2	1,115,518	Open	11.8	315
2/13/2026	16:15:00	7.4	3.2551	9.1	1,115,561	Open	11.8	315
2/13/2026	16:30:00	7.3	3.266455	6	1,115,596	Open	12	315
2/13/2026	16:45:00	7.5	0.41635	0.3	1,115,631	Open	12	313
2/13/2026	17:00:00	7.4	3.213465	4.6	1,115,667	Open	11.8	313
2/13/2026	17:15:00	7.3	3.21725	3	1,115,694	Open	11.9	313
2/13/2026	17:30:00	7.4	3.28538	9.2	1,115,739	Open	11.8	315
2/13/2026	17:45:00	7.5	2.55866	9.6	1,115,780	Open	11.7	310
2/13/2026	18:00:00	7.4	3.22482	6	1,115,823	Open	11.6	312
2/13/2026	18:15:00	7.4	3.16426	5.6	1,115,864	Open	11.6	312
2/13/2026	18:30:00	7.3	3.19454	8.7	1,115,885	Open	11.6	312
2/13/2026	18:45:00	7.3	3.228605	20.9	1,115,928	Open	11.6	313
2/13/2026	19:00:00	7.5	3.236175	0	1,115,960	Open	11.7	284
2/13/2026	19:15:00	7.4	3.319445	0	1,116,003	Open	11.5	298



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/13/2026	19:30:00	7.2	3.334585	0	1,116,036	Open	11.5	303
2/13/2026	19:45:00	7.2	3.30809	1.2	1,116,081	Open	11.4	307
2/13/2026	20:00:00	7.2	3.319445	5.1	1,116,116	Open	11.4	307
2/13/2026	20:15:00	7.4	0.49205	2.2	1,116,146	Open	11.6	305
2/13/2026	20:30:00	7.5	0.715365	13.7	1,116,185	Open	11.5	305
2/13/2026	20:45:00	7.4	3.33837	11.2	1,116,197	Open	11.5	307
2/13/2026	21:00:00	7.4	3.32323	0	1,116,247	Open	11.5	305
2/13/2026	21:15:00	7.4	3.33837	0.7	1,116,273	Open	11.6	307
2/13/2026	21:30:00	7.4	3.31566	0.7	1,116,320	Open	11.4	307
2/13/2026	21:45:00	7.3	3.319445	1	1,116,349	Open	11.4	305
2/13/2026	22:00:00	7.5	3.29295	21.5	1,116,390	Open	11.3	305
2/13/2026	22:15:00	7.5	3.319445	18.9	1,116,425	Open	11.3	307
2/13/2026	22:30:00	7.4	0.874335	0	1,116,469	Open	11.4	305
2/13/2026	22:45:00	7.3	3.31566	1.9	1,116,500	Open	11.4	305
2/13/2026	23:00:00	7.4	0.66616	11.1	1,116,545	Open	11.4	306
2/13/2026	23:15:00	7.1	3.327015	0	1,116,579	Open	11.5	307
2/13/2026	23:30:00	7.1	3.334585	0	1,116,609	Open	11.6	304
2/13/2026	23:45:00	7.1	3.36108	1.2	1,116,648	Open	11.6	303
2/14/2026	0:00:00	7.1	3.3308	14.5	1,116,695	Open	11.7	303
2/14/2026	0:15:00	7.2	3.334585	1.7	1,116,729	Open	11.9	303
2/14/2026	0:30:00	7.2	3.33837	1.8	1,116,761	Open	11.9	301
2/14/2026	0:45:00	7.2	1.09765	7.8	1,116,804	Open	11.9	303
2/14/2026	1:00:00	7.3	3.342155	20.9	1,116,837	Open	12	303
2/14/2026	1:15:00	9	0.457985	44.4	1,116,872	Open	12.1	299
2/14/2026	1:30:00	8.8	3.364865	145.5	1,116,901	Open	12.2	288
2/14/2026	1:45:00	8.7	3.281595	78.1	1,116,939	Open	12.2	328
2/14/2026	2:00:00	7.1	0.8327	0	1,116,944	Closed	12	334
2/14/2026	2:15:00	7.2	0.435275	0	1,116,966	Closed	12.1	345
2/14/2026	2:30:00	7.1	2.85389	19.6	1,116,997	Closed	11.7	351
2/14/2026	2:45:00	7.2	0.404995	13.3	1,116,997	Closed	12	365
2/14/2026	3:00:00	7.7	3.23996	0	1,117,038	Open	11.9	369
2/14/2026	3:15:00	7.7	3.26267	0	1,117,065	Open	12.2	375
2/14/2026	3:30:00	7.7	0.47691	0	1,117,093	Open	12.5	376



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/14/2026	3:45:00	7.8	0.48448	0	1,117,130	Open	12.6	380
2/14/2026	4:00:00	7	3.27781	3.6	1,117,171	Open	11.7	377
2/14/2026	4:15:00	6.8	3.30052	12.2	1,117,198	Open	11.7	379
2/14/2026	4:30:00	7	3.281595	7.2	1,117,248	Open	11.6	378
2/14/2026	4:45:00	7.3	0.624525	30.8	1,117,290	Open	11.8	377
2/14/2026	5:00:00	7.4	3.281595	5.9	1,117,327	Open	11.9	374
2/14/2026	5:15:00	7.5	0.40878	10.9	1,117,367	Open	12	374
2/14/2026	5:30:00	7.5	2.297495	8.1	1,117,405	Open	11.9	375
2/14/2026	5:45:00	7.3	0.42392	1.8	1,117,444	Open	12	376
2/14/2026	6:00:00	7.1	3.27024	4.6	1,117,484	Open	11.9	375
2/14/2026	6:15:00	7.3	0.669945	10.2	1,117,524	Open	12	371
2/14/2026	6:30:00	7.3	3.28538	4.2	1,117,558	Open	11.8	374
2/14/2026	6:45:00	7.4	3.36865	22.8	1,117,597	Open	11.8	371
2/14/2026	7:00:00	7.3	3.372435	6.1	1,117,643	Open	11.7	372
2/14/2026	7:15:00	7.3	3.38379	6	1,117,678	Open	11.7	372
2/14/2026	7:30:00	7.1	3.36108	5.4	1,117,728	Open	11.6	369
2/14/2026	7:45:00	6.9	3.372435	10.8	1,117,763	Open	11.7	371
2/14/2026	8:00:00	7	2.206655	20.6	1,117,812	Open	11.5	367
2/14/2026	8:15:00	7.1	3.24753	0.8	1,117,838	Open	11.6	355
2/14/2026	8:30:00	7.2	2.191515	15.4	1,117,886	Open	11.3	359
2/14/2026	8:45:00	7.2	2.562445	11.8	1,117,926	Open	11.3	360
2/14/2026	9:00:00	7.3	0.488265	4.5	1,117,971	Open	11.3	359
2/14/2026	9:15:00	7.2	3.28538	9.5	1,118,011	Open	11.4	359
2/14/2026	9:30:00	7.3	2.49053	9.9	1,118,053	Open	11.4	359
2/14/2026	9:45:00	7.4	0.427705	7.9	1,118,091	Open	11.5	359
2/14/2026	10:00:00	7.4	2.24072	19	1,118,132	Open	11.5	359
2/14/2026	10:15:00	7.5	3.2551	4.6	1,118,174	Open	11.6	357
2/14/2026	10:30:00	7.4	2.297495	16.6	1,118,222	Open	11.8	352
2/14/2026	10:45:00	7.4	3.327015	52.2	1,118,247	Open	12	353
2/14/2026	11:00:00	7.6	0.488265	2.8	1,118,281	Open	12.2	353
2/14/2026	11:15:00	7.5	3.27781	7.3	1,118,325	Open	12	352
2/14/2026	11:30:00	7.6	0.480695	27	1,118,355	Open	12.1	353
2/14/2026	11:45:00	7.4	2.74034	7.3	1,118,375	Open	11.9	348



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/14/2026	12:00:00	7.5	0.488265	11	1,118,420	Open	11.8	348
2/14/2026	12:15:00	7.5	3.36108	11.1	1,118,454	Open	11.8	351
2/14/2026	12:30:00	7.5	1.146855	52.5	1,118,494	Closed	11.7	350
2/14/2026	12:45:00	7.6	0.321725	19.3	1,118,527	Open	11.7	350
2/14/2026	13:00:00	7.4	2.055255	57.7	1,118,528	Open	12.1	349
2/14/2026	13:15:00	7.5	3.319445	5.1	1,118,573	Open	11.7	344
2/14/2026	13:30:00	7.5	2.479175	32.8	1,118,617	Closed	11.8	336
2/14/2026	13:45:00	7.5	3.28538	21.6	1,118,650	Open	11.7	338
2/14/2026	14:00:00	7.5	2.09689	31.5	1,118,691	Open	11.7	328
2/14/2026	14:15:00	7.5	3.266455	18.3	1,118,730	Open	11.7	328
2/14/2026	14:30:00	7.6	0.548825	11.5	1,118,768	Open	11.8	332
2/14/2026	14:45:00	7.5	0.950035	19.7	1,118,796	Closed	11.8	333
2/14/2026	15:00:00	7.4	2.320205	9.2	1,118,811	Open	11.8	331
2/14/2026	15:15:00	7.4	3.160475	16.1	1,118,853	Closed	11.8	331
2/14/2026	15:30:00	7.5	0.68887	20	1,118,877	Open	11.9	333
2/14/2026	15:45:00	7.5	2.827395	15.5	1,118,917	Open	12	328
2/14/2026	16:00:00	7.4	2.21044	20.6	1,118,965	Open	12	320
2/14/2026	16:15:00	7.4	3.289165	11.3	1,119,000	Open	12	320
2/14/2026	16:30:00	7.4	2.214225	20.7	1,119,040	Open	11.9	322
2/14/2026	16:45:00	7.4	3.1794	17.4	1,119,074	Open	11.9	313
2/14/2026	17:00:00	7.4	2.24072	18.1	1,119,113	Open	11.9	315
2/14/2026	17:15:00	7.4	0.6056	21.1	1,119,148	Open	11.9	315
2/14/2026	17:30:00	7.4	2.11203	11.8	1,119,165	Open	11.9	317
2/14/2026	17:45:00	7.5	0.6056	6.3	1,119,207	Open	11.8	315
2/14/2026	18:00:00	7.4	1.987125	13.6	1,119,249	Open	11.8	317
2/14/2026	18:15:00	7.4	3.289165	5.6	1,119,286	Open	11.8	320
2/14/2026	18:30:00	7.4	2.494315	17.4	1,119,327	Open	11.8	318
2/14/2026	18:45:00	7.4	3.24753	19	1,119,348	Open	11.8	317
2/14/2026	19:00:00	7.3	3.24753	4.9	1,119,390	Open	11.7	317
2/14/2026	19:15:00	7.3	3.243745	13.3	1,119,432	Open	11.7	318
2/14/2026	19:30:00	7.4	3.22482	25	1,119,478	Open	11.7	318
2/14/2026	19:45:00	7.3	3.205895	0	1,119,520	Open	11.7	318
2/14/2026	20:00:00	7.4	3.24753	0	1,119,556	Open	11.8	318



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/14/2026	20:15:00	7.4	3.13398	0	1,119,574	Closed	11.8	318
2/14/2026	20:30:00	7.4	2.45268	0	1,119,607	Open	11.9	317
2/14/2026	20:45:00	7.4	3.221035	0	1,119,642	Open	11.9	317
2/14/2026	21:00:00	7.5	0.329295	0	1,119,673	Open	12	313
2/14/2026	21:15:00	7.5	0.47691	0	1,119,702	Open	11.9	313
2/14/2026	21:30:00	7.5	2.75548	1.6	1,119,738	Open	11.9	316
2/14/2026	21:45:00	7.5	0.594245	1.6	1,119,767	Open	11.9	315
2/14/2026	22:00:00	7.5	0.56018	4.8	1,119,806	Open	11.9	312
2/14/2026	22:15:00	7.4	3.198325	0.4	1,119,833	Open	12	315
2/14/2026	22:30:00	7.5	0.685085	0	1,119,871	Open	11.7	315
2/14/2026	22:45:00	7.6	0.601815	0	1,119,907	Open	11.6	315
2/14/2026	23:00:00	7.6	0.420135	2.2	1,119,942	Open	11.7	318
2/14/2026	23:15:00	7.6	0.404995	0	1,119,982	Open	11.8	315
2/14/2026	23:30:00	7.4	3.1794	0	1,120,020	Open	12	313
2/14/2026	23:45:00	7.3	2.35427	0	1,120,057	Open	12	315
2/15/2026	0:00:00	7	3.213465	0	1,120,090	Open	12.1	313
2/15/2026	0:15:00	7	0.34065	0	1,120,124	Open	12.2	312
2/15/2026	0:30:00	7.1	3.18697	0	1,120,153	Open	12.1	313
2/15/2026	0:45:00	7.1	3.20211	0.1	1,120,191	Open	12.1	313
2/15/2026	1:00:00	7	3.22482	1.3	1,120,222	Open	12.2	313
2/15/2026	1:15:00	7	0.53747	3.2	1,120,266	Open	12	312
2/15/2026	1:30:00	7.1	3.213465	0	1,120,296	Open	12	313
2/15/2026	1:45:00	7.2	3.19454	0	1,120,323	Open	12.1	315
2/15/2026	2:00:00	7.3	0.40878	15.2	1,120,356	Open	12	315
2/15/2026	2:15:00	7.3	3.221035	0	1,120,385	Open	11.9	313
2/15/2026	2:30:00	7.3	3.175615	2.3	1,120,422	Open	11.9	313
2/15/2026	2:45:00	7.4	3.18697	0.1	1,120,460	Open	11.8	313
2/15/2026	3:00:00	7.4	3.228605	0.3	1,120,497	Open	12	313
2/15/2026	3:15:00	7.4	3.21725	0	1,120,535	Open	11.9	313
2/15/2026	3:30:00	7.4	0.541255	0.2	1,120,572	Open	11.9	310
2/15/2026	3:45:00	7.3	3.198325	2.8	1,120,600	Open	11.9	312
2/15/2026	4:00:00	7.4	0.70401	1.1	1,120,638	Open	11.8	310
2/15/2026	4:15:00	7.4	3.016645	2.8	1,120,669	Open	12	313



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/15/2026	4:30:00	7.4	3.190755	6.6	1,120,703	Open	11.9	312
2/15/2026	4:45:00	7.5	2.46025	2.6	1,120,738	Open	11.9	312
2/15/2026	5:00:00	7.4	3.175615	4.2	1,120,775	Open	11.8	308
2/15/2026	5:15:00	7.5	0.28009	5.2	1,120,806	Open	11.9	310
2/15/2026	5:30:00	7.5	3.13398	7.3	1,120,836	Open	11.9	310
2/15/2026	5:45:00	7.5	3.11884	8	1,120,874	Open	11.8	310
2/15/2026	6:00:00	7.6	2.123385	9.8	1,120,912	Open	11.8	310
2/15/2026	6:15:00	7.5	3.145335	9.9	1,120,950	Open	11.7	304
2/15/2026	6:30:00	7.5	3.152905	13.4	1,120,989	Open	11.6	308
2/15/2026	6:45:00	7.5	3.099915	26.2	1,121,036	Open	11.6	310
2/15/2026	7:00:00	7.4	3.130195	23.4	1,121,065	Open	11.6	308
2/15/2026	7:15:00	7.4	3.09613	35.4	1,121,112	Open	11.4	310
2/15/2026	7:30:00	7.4	1.843295	10.7	1,121,154	Open	11.3	306
2/15/2026	7:45:00	7.4	1.34746	10.3	1,121,188	Open	11.2	308
2/15/2026	8:00:00	7.4	1.858435	30.7	1,121,229	Open	11.1	309
2/15/2026	8:15:00	7.4	3.251315	16.8	1,121,261	Open	11.2	308
2/15/2026	8:30:00	7.3	3.28538	15.5	1,121,287	Open	11.2	309
2/15/2026	8:45:00	7.4	0.314155	16.7	1,121,310	Open	11.1	308
2/15/2026	9:00:00	7.4	0.791065	5.4	1,121,350	Open	11.1	300
2/15/2026	9:15:00	7.5	3.183185	38.7	1,121,381	Open	11.1	304
2/15/2026	9:30:00	7.5	0.632095	5.1	1,121,427	Open	11	303
2/15/2026	9:45:00	7.5	3.1794	3.2	1,121,466	Open	11	307
2/15/2026	10:00:00	7.5	0.579105	2.1	1,121,506	Open	11.1	307
2/15/2026	10:15:00	7.4	2.168805	1.3	1,121,545	Open	11.1	307
2/15/2026	10:30:00	7.3	3.236175	5.9	1,121,584	Open	11.1	307
2/15/2026	10:45:00	7.4	1.6654	9.2	1,121,619	Open	11.2	307
2/15/2026	11:00:00	7.4	0.404995	4.7	1,121,645	Open	11.3	300
2/15/2026	11:15:00	7.3	3.30052	6.8	1,121,683	Open	11.3	302
2/15/2026	11:30:00	7.4	2.06661	10.8	1,121,720	Open	11.3	302
2/15/2026	11:45:00	7.4	3.23996	6.2	1,121,759	Open	11.3	302
2/15/2026	12:00:00	7.4	0.62831	8.6	1,121,794	Open	11.4	302
2/15/2026	12:15:00	7.3	3.16426	6.8	1,121,835	Open	11.4	302
2/15/2026	12:30:00	7.3	3.281595	6.7	1,121,864	Open	11.4	302



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/15/2026	12:45:00	7.4	0.72672	16.5	1,121,905	Open	11.5	302
2/15/2026	13:00:00	7.4	1.956845	13.6	1,121,942	Open	11.5	302
2/15/2026	13:15:00	7.6	0.624525	29.6	1,121,974	Open	11.6	302
2/15/2026	13:30:00	7.8	2.305065	26.1	1,122,007	Open	11.7	282
2/15/2026	13:45:00	7.9	3.20211	28.9	1,122,044	Open	11.6	282
2/15/2026	14:00:00	7.9	3.266455	26.2	1,122,070	Open	11.6	286
2/15/2026	14:15:00	7.8	2.05147	112.2	1,122,103	Open	11.6	286
2/15/2026	14:30:00	8	1.903855	0	1,122,135	Open	11.7	266
2/15/2026	14:45:00	8	0.367145	0	1,122,158	Open	12.3	253
2/15/2026	15:00:00	7.9	0.37093	50.3	1,122,170	Open	11.7	294
2/15/2026	15:15:00	7.8	3.304305	52.3	1,122,191	Open	11.6	300
2/15/2026	15:30:00	7.8	3.448135	38	1,122,227	Open	11.3	305
2/15/2026	15:45:00	7.8	1.623765	0.7	1,122,272	Open	11.4	303
2/15/2026	16:00:00	7.7	2.592725	36.4	1,122,294	Open	11.4	307
2/15/2026	16:15:00	7.7	0.359575	16.6	1,122,327	Open	11.4	307
2/15/2026	16:30:00	7.6	3.51248	0	1,122,362	Open	11.4	310
2/15/2026	16:45:00	7.2	2.539735	16.9	1,122,393	Open	11.4	313
2/15/2026	17:00:00	7.4	1.911425	0	1,122,436	Open	11.4	312
2/15/2026	17:15:00	7.6	3.470845	0	1,122,474	Open	12.5	274
2/15/2026	17:30:00	7.3	3.319445	10.7	1,122,518	Open	11.7	303
2/15/2026	17:45:00	7.6	2.380765	0	1,122,555	Open	11.6	303
2/15/2026	18:00:00	7.8	1.96063	0	1,122,587	Open	11.6	300
2/15/2026	18:15:00	7.9	2.48296	0	1,122,627	Open	11.8	307
2/15/2026	18:30:00	7.9	3.29295	0	1,122,664	Open	12.1	310
2/15/2026	18:45:00	7.9	3.28538	0	1,122,698	Open	12.5	312
2/15/2026	19:00:00	7.9	3.30809	0	1,122,728	Open	12.9	313
2/15/2026	19:15:00	7.8	1.40802	0	1,122,763	Open	13.2	317
2/15/2026	19:30:00	7.8	1.7411	0	1,122,790	Open	13.5	318
2/15/2026	19:45:00	7.8	0.427705	0	1,122,813	Open	13.8	322
2/15/2026	20:00:00	7.8	0.40121	0	1,122,843	Open	14	322
2/15/2026	20:15:00	7.7	3.342155	0	1,122,880	Open	14.2	322
2/15/2026	20:30:00	7.8	1.722175	18.8	1,122,912	Open	11.9	320
2/15/2026	20:45:00	7.6	3.29295	12.6	1,122,954	Open	11.4	323



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/15/2026	21:00:00	7.6	2.464035	11.7	1,122,992	Open	11.3	324
2/15/2026	21:15:00	7.5	2.28614	21.8	1,123,026	Open	11.4	323
2/15/2026	21:30:00	7.4	3.28538	18	1,123,065	Open	11.5	326
2/15/2026	21:45:00	7	3.29295	19.4	1,123,102	Open	11.7	326
2/15/2026	22:00:00	6.4	3.18697	16	1,123,114	Open	11.7	334
2/15/2026	22:15:00	6.9	0.4542	0	1,123,145	Open	12.1	302
2/15/2026	22:30:00	7	2.289925	26.7	1,123,192	Open	11.8	323
2/15/2026	22:45:00	7.2	0.54504	12	1,123,227	Open	11.9	334
2/15/2026	23:00:00	7.4	3.27024	25.2	1,123,261	Open	12.1	338
2/15/2026	23:15:00	7.5	2.675995	14.9	1,123,295	Open	12	336
2/15/2026	23:30:00	7.5	2.115815	12.5	1,123,326	Open	11.9	337
2/15/2026	23:45:00	7.5	2.047685	41.4	1,123,362	Open	11.9	336



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Appendix B: Photos

Photo 1: No visible sheen observed in the WTP water, February 09

2026-02-09, 10:46 AM





Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Photo 2: No visible sheen observed in the WTP water, February 10

2026-02-10, 7:49 AM





Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by:	BC1
		Approved by:	BC2
		Date:	March 13, 2026

Photo 3: No visible sheen observed in the WTP water, February 11

2026-02-11, 7:56 AM





Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Photo 4: No visible sheen observed in the WTP water, February 12

2026-02-12, 7:45 AM






Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Photo 5: No visible sheen observed in the WTP water, February 13

2026-02-13, 7:34 AM

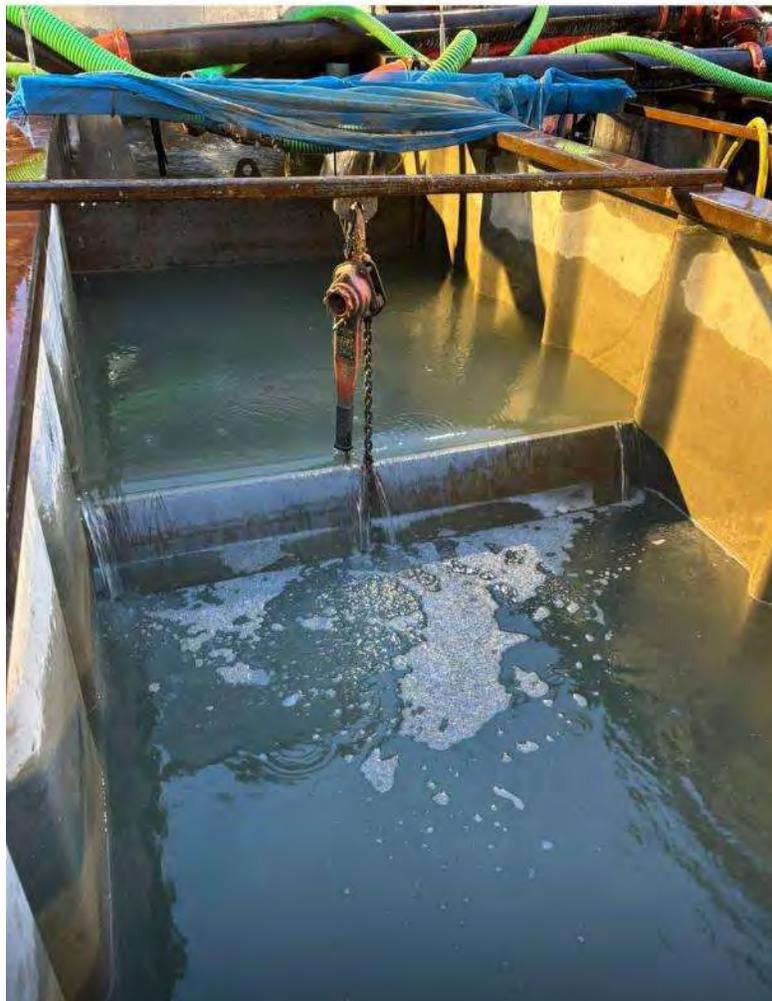



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Photo 6: No visible sheen observed in the WTP water, February 14





Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Wood Fibre Weekly Water Discharge Report	Revision:	0
Data Range	February 09, 2026 to February 15, 2026	Prepared by: Approved by: Date:	BC1 BC2 March 13, 2026

Photo 7: No visible sheen observed in the WTP water, February 15

2026-02-15, 7:59 AM





**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix C	D-1

**Appendix D:
Woodfibre Site Receiving Environment
Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix C	D-2

Woodfibre Site Receiving Environment Sample Analysis



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-02-10 09:43:00	WLNG DS 2026-02-10 08:50:00
In situ Parameters									
Field pH	pH Units		6.5 - 9			7 - 8.7		8.11	7.43
Field Temperature	°C	18	19					7	8.1
General Parameters									
pH	pH Units							6.27	6.53
Alkalinity (Total as CaCO ₃)	mg/L							5.2	16
Alkalinity (PP as CaCO ₃)	mg/L							<1	<1
Hardness (CaCO ₃)-Total	mg/L							5.61	16.3
Hardness (CaCO ₃)-Dissolved	mg/L							6.01	16
Sulphide-Total	mg/L							<0.0018	<0.0018
Sulphide (as H ₂ S)	mg/L			0.002				<0.002	<0.002
Un-ionized Hydrogen Sulfide as H ₂ S-Total	mg/L							<0.0019	<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018	<0.0018
Anions and Nutrients									
Ammonia (N)-Total	mg/L	0.736	12.9		12	19		<0.015	<0.015
Bicarbonate (HCO ₃)	mg/L							6.4	19
Carbonate (CO ₃)	mg/L							<1	<1
Hydroxide (OH)	mg/L							<1	<1
Nitrate (N)	mg/L	3	32.8		3.7			<0.02	<0.02
Nitrite (N)	mg/L	0.02	0.06					<0.005	<0.005
Nitrate plus Nitrite (N)	mg/L							<0.02	<0.02
Nitrogen (N)-Total	mg/L							0.096	0.154
Phosphorus (P)-Total (4500-P)	mg/L							0.1	0.067
Bromide (Br)	mg/L							<0.01	<0.01
Chloride (Cl)	mg/L	150	600					<1	2.7
Fluoride (F)	mg/L		0.4			1.5		<0.05	0.081
Sulphate (SO ₄)-Dissolved	mg/L	128						<1	4.4

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-02-10 09:43:00	WLNG DS 2026-02-10 08:50:00
Total Metals									
Aluminum (Al)-Total	mg/L	0.1335834						0.104	0.371
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000032	0.000066
Arsenic (As)-Total	mg/L	0.005			0.0125			0.000228	0.000456
Barium (Ba)-Total	mg/L			1				0.0021	0.00382
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001	<0.00001
Bismuth (Bi)-Total	mg/L							<0.00001	<0.00001
Boron (B)-Total	mg/L	1.2			1.2			<0.01	<0.01
Cadmium (Cd)-Total	mg/L						0.00012	0.0000076	0.0000083
Calcium (Ca)-Total	mg/L							1.77	5.81
Cesium (Cs)-Total	mg/L							<0.00005	<0.00005
Chromium (Cr)-Total	mg/L							<0.0001	0.00033
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099	<0.00099
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099	<0.00099
Cobalt (Co)-Total	mg/L							0.000036	0.000047
Copper (Cu)-Total	mg/L				0.002	0.003		0.001	0.00103
Iron (Fe)-Total	mg/L		1					0.0323	0.125
Lead (Pb)-Total	mg/L				0.002	0.14		0.000032	0.0003
Lithium (Li)-Total	mg/L							<0.0005	0.00082
Magnesium (Mg)-Total	mg/L							0.29	0.43
Manganese (Mn)-Total	mg/L	0.629684	0.6018222				0.1	0.00099	0.00447
Mercury (Hg)-Total	mg/L	0.00002			0.0001			0.0000027	0.0000023
Molybdenum (Mo)-Total	mg/L	7.6	46					0.000397	0.00746
Nickel (Ni)-Total	mg/L						0.0083	0.00028	0.00032
Phosphorus (P)-Total (ICPMS)	mg/L							0.0879	0.0635
Potassium (K)-Total	mg/L							<0.25	0.65
Rubidium (Rb)-Total	mg/L							0.000236	0.00147
Selenium (Se)-Total	mg/L	0.002			0.002			<0.00004	<0.00004
Silicon (Si)-Total	mg/L							2.94	3.92
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.00001	<0.00001
Sodium (Na)-Total	mg/L							1	1.98
Strontium (Sr)-Total	mg/L							0.00759	0.0181
Sulphur (S)-Total	mg/L							<3	<3
Tellurium (Te)-Total	mg/L							<0.00002	<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000022	0.0000034
Thorium (Th)-Total	mg/L							<0.00005	<0.00005

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-02-10 09:43:00	WLNG DS 2026-02-10 08:50:00
Total Metals (cont'd.)									
Tin (Sn)-Total	mg/L							<0.0002	<0.0002
Titanium (Ti)-Total	mg/L							<0.002	0.003
Uranium (U)-Total	mg/L		0.0165	0.0075				0.000134	0.000574
Vanadium (V)-Total	mg/L			0.06			0.005	<0.0002	<0.0002
Zinc (Zn)-Total	mg/L				0.01	0.055		0.0014	0.0022
Zirconium (Zr)-Total	mg/L							<0.0001	<0.0001
Dissolved Metals									
Aluminum (Al)-Dissolved	mg/L							0.0915	0.175
Antimony (Sb)-Dissolved	mg/L							0.000035	0.000061
Arsenic (As)-Dissolved	mg/L							0.00024	0.000395
Barium (Ba)-Dissolved	mg/L							0.00207	0.00309
Beryllium (Be)-Dissolved	mg/L							<0.00001	<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005	<0.000005
Boron (B)-Dissolved	mg/L							<0.01	<0.01
Cadmium (Cd)-Dissolved	mg/L	0.0000254	0.000038					0.0000071	0.0000076
Calcium (Ca)-Dissolved	mg/L							1.89	5.68
Cesium (Cs)-Dissolved	mg/L							<0.00005	<0.00005
Chromium (Cr)-Dissolved	mg/L							<0.0001	0.00018
Cobalt (Co)-Dissolved	mg/L	0.0003889						0.0000326	0.0000317
Copper (Cu)-Dissolved	mg/L	0.0006	0.00362					0.00106	0.000704
Iron (Fe)-Dissolved	mg/L		0.35					0.018	0.0147
Lead (Pb)-Dissolved	mg/L	0.001966						0.0000175	0.0000101
Lithium (Li)-Dissolved	mg/L							<0.0005	0.00079
Manganese (Mn)-Dissolved	mg/L							0.00058	0.00184
Magnesium (Mg)-Dissolved	mg/L							0.313	0.43
Mercury (Hg)-Dissolved	mg/L							0.0000021	0.0000022
Molybdenum (Mo)-Dissolved	mg/L							0.00037	0.00798
Nickel (Ni)-Dissolved	mg/L	0.0009	0.0126					0.000294	0.000249
Phosphorus (P)-Dissolved	mg/L							0.0964	0.0494
Potassium (K)-Dissolved	mg/L							0.212	0.658
Rubidium (Rb)-Dissolved	mg/L							0.000236	0.00145
Selenium (Se)-Dissolved	mg/L							<0.00004	<0.00004
Silicon (Si)-Dissolved	mg/L							3.22	3.86
Silver (Ag)-Dissolved	mg/L							<0.000005	<0.000005
Sodium (Na)-Dissolved	mg/L							1.09	2.01

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-02-10 09:43:00	WLNG DS 2026-02-10 08:50:00
Dissolved Metals (cont'd.)									
Strontium (Sr)-Dissolved	mg/L			1.25				0.00793	0.0187
Sulphur (S)-Dissolved	mg/L							<3	<3
Tellurium (Te)-Dissolved	mg/L							<0.00002	<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000022	0.000003
Thorium (Th)-Dissolved	mg/L							0.000012	0.0000094
Tin (Sn)-Dissolved	mg/L							<0.0002	<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005	<0.0005
Uranium (U)-Dissolved	mg/L							0.000121	0.000532
Vanadium (V)-Dissolved	mg/L							<0.0002	<0.0002
Zinc (Zn)-Dissolved	mg/L	0.0021066	0.0098048					0.00133	0.00139
Zirconium (Zr)-Dissolved	mg/L							<0.0001	<0.0001
Inorganics									
Organic Carbon (C)-Total	mg/L							2.9	3.4
Organic Carbon (C)-Dissolved	mg/L							3	2.8
Solids-Total Dissolved	mg/L							12	24
Solids-Total Suspended	mg/L	6	26					<1	4

¹ Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix C	D-3

Woodfibre Site Receiving Environment Field Notes and Logs

Water Quality Field Data Sheet



Project: FORTIS11234

Location Information

Site ID:	<u>WLNG (EAS) DS</u>	Date:	<u>February 10, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>8:50</u>
Site UTM:	Zone: 10U E: <u>481522</u>	Crew:	<u>BHC</u>
(NAD83)	N: <u>5501349</u>	Weather:	<u>Sunny</u>

In Situ Parameters

pH:	<u>7.43</u>	DO:	<u>17.78</u> (mg/L)
Temp:	<u>8.1</u> (°C)	Cond:	<u>102.9</u> (uS/cm)
Turbidity:	<u>4.38</u> NTU	Salinity:	<u>0.05</u> (ppt)
Visible Sheen:	<u>N</u>	ORP:	<u>45.6</u> (mV)
Water Surface Condition:	<u>Clear</u>		

Photo Record



Observations

No issues observed.

Water Quality Field Data Sheet



Project: FORTIS11234

Location Information

Site ID:	<u>WLNG (EAS) US</u>	Date:	<u>February 10, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>9:43</u>
Site UTM:	Zone:10U E: <u>481450</u>	Crew:	<u>BHC</u>
(NAD83)	N: <u>5501273</u>	Weather:	<u>Sunny</u>

In Situ Parameters

pH:	<u>8.11</u>	DO:	<u>20.93</u> (mg/L)
Temp.:	<u>7</u> (°C)	Cond:	<u>67.5</u> (uS/cm)
Turbidity:	<u>0.61</u> NTU	Salinity:	<u>0.03</u> (ppt)
Visible Sheen:	<u>None</u>	ORP:	<u>33.5</u> (mV)
Water Surface Condition:	<u>Clear</u>		

Photo Record



Observations

No issues observed.

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-09 00:00:00	8.05	49.44	0.37	7.57	11.12	0.00	0.02
EAS-DS	2026-02-09 00:15:00	7.89	46.06	0.37	7.57	11.08	0.00	0.02
EAS-DS	2026-02-09 00:30:00	8.10	51.60	0.37	7.58	11.12	0.00	0.02
EAS-DS	2026-02-09 00:45:00	7.82	44.72	0.37	7.56	11.11	1.74	0.02
EAS-DS	2026-02-09 01:00:00	8.09	51.35	0.37	7.59	11.09	0.12	0.02
EAS-DS	2026-02-09 01:15:00	7.85	46.96	0.37	7.63	11.00	0.00	0.02
EAS-DS	2026-02-09 01:30:00	8.12	51.77	0.37	7.67	11.06	0.00	0.02
EAS-DS	2026-02-09 01:45:00	7.92	46.09	0.37	7.63	10.98	2.93	0.02
EAS-DS	2026-02-09 02:00:00	7.76	39.45	0.37	7.57	11.05	0.00	0.02
EAS-DS	2026-02-09 02:15:00	7.73	42.00	0.38	7.53	11.10	0.00	0.02
EAS-DS	2026-02-09 02:30:00	8.05	49.36	0.38	7.52	11.10	0.00	0.02
EAS-DS	2026-02-09 02:45:00	7.83	39.88	0.37	7.53	10.88	2.82	0.02
EAS-DS	2026-02-09 03:00:00	8.03	47.96	0.37	7.51	11.03	0.00	0.02
EAS-DS	2026-02-09 03:15:00	7.55	38.37	0.37	7.48	10.89	0.00	0.02
EAS-DS	2026-02-09 03:30:00	8.00	50.72	0.37	7.50	10.90	0.00	0.02
EAS-DS	2026-02-09 03:45:00	7.63	54.21	0.37	7.46	10.90	9.78	0.02
EAS-DS	2026-02-09 04:00:00	7.45	39.38	0.37	7.56	10.90	0.00	0.02
EAS-DS	2026-02-09 04:15:00	7.85	55.91	0.37	7.64	10.90	0.28	0.03
EAS-DS	2026-02-09 04:30:00	7.40	45.02	0.37	7.59	10.94	0.00	0.02
EAS-DS	2026-02-09 04:45:00	7.68	46.02	0.37	7.63	10.86	1.77	0.02
EAS-DS	2026-02-09 05:00:00	7.94	54.14	0.37	7.65	11.04	0.00	0.02
EAS-DS	2026-02-09 05:15:00	7.55	46.15	0.37	7.58	11.20	0.00	0.02
EAS-DS	2026-02-09 05:30:00	7.99	56.18	0.37	7.61	10.99	0.00	0.03
EAS-DS	2026-02-09 05:45:00	7.81	53.52	0.37	7.60	10.99	4.99	0.02
EAS-DS	2026-02-09 06:00:00	7.84	54.08	0.37	7.59	11.08	0.00	0.02
EAS-DS	2026-02-09 06:15:00	7.67	44.19	0.37	7.63	11.00	0.88	0.02
EAS-DS	2026-02-09 06:30:00	8.01	56.19	0.37	7.65	11.10	0.00	0.03
EAS-DS	2026-02-09 06:45:00	7.56	48.98	0.37	7.57	11.17	2.30	0.02
EAS-DS	2026-02-09 07:00:00	7.93	53.51	0.37	7.66	11.00	0.00	0.02
EAS-DS	2026-02-09 07:15:00	7.78	52.36	0.37	7.62	10.96	0.15	0.02
EAS-DS	2026-02-09 07:30:00	7.80	53.53	0.37	7.62	11.03	0.09	0.02
EAS-DS	2026-02-09 07:45:00	7.71	48.27	0.37	7.63	10.97	2.47	0.02
EAS-DS	2026-02-09 08:00:00	7.94	55.14	0.37	7.64	11.09	0.00	0.02
EAS-DS	2026-02-09 08:15:00	7.70	47.06	0.37	7.64	11.04	0.24	0.02
EAS-DS	2026-02-09 08:30:00	7.93	53.29	0.37	7.64	11.19	0.00	0.02
EAS-DS	2026-02-09 08:45:00	7.50	44.50	0.37	7.55	11.30	4.90	0.02
EAS-DS	2026-02-09 09:00:00	7.98	52.69	0.37	7.64	11.19	0.00	0.02
EAS-DS	2026-02-09 09:15:00	7.43	40.13	0.36	7.60	11.07	0.33	0.02
EAS-DS	2026-02-09 09:30:00	8.01	54.96	0.37	7.64	11.04	0.35	0.02
EAS-DS	2026-02-09 09:45:00	7.71	46.89	0.36	7.61	11.01	8.30	0.02
EAS-DS	2026-02-09 10:00:00	7.96	55.04	0.37	7.63	11.12	0.43	0.02
EAS-DS	2026-02-09 10:15:00	7.76	49.23	0.37	7.63	11.06	0.72	0.02
EAS-DS	2026-02-09 10:30:00	7.35	34.49	0.37	7.58	11.26	1.44	0.01
EAS-DS	2026-02-09 10:45:00	7.57	43.23	0.36	7.72	11.11	2.87	0.02
EAS-DS	2026-02-09 11:00:00	7.98	54.05	0.36	7.69	10.93	1.32	0.02
EAS-DS	2026-02-09 11:15:00	8.00	58.05	0.36	7.63	11.01	1.78	0.03
EAS-DS	2026-02-09 11:30:00	7.78	48.85	0.37	7.58	11.08	1.21	0.02
EAS-DS	2026-02-09 11:45:00	7.95	58.80	0.37	7.55	11.04	14.09	0.03
EAS-DS	2026-02-09 12:00:00	8.10	59.31	0.37	7.60	10.93	1.66	0.03
EAS-DS	2026-02-09 12:15:00	7.67	44.44	0.37	7.61	11.00	2.47	0.02
EAS-DS	2026-02-09 12:30:00	8.07	55.34	0.37	7.65	11.00	1.43	0.02
EAS-DS	2026-02-09 12:45:00	8.06	55.00	0.37	7.60	11.03	13.72	0.02
EAS-DS	2026-02-09 13:00:00	7.89	49.42	0.36	7.61	10.88	5.50	0.02
EAS-DS	2026-02-09 13:15:00	7.78	42.06	0.37	7.55	11.23	1.47	0.02
EAS-DS	2026-02-09 13:30:00	7.77	44.02	0.37	7.59	11.09	1.74	0.02

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-09 13:45:00	8.07	51.24	0.37	7.62	10.91	16.41	0.02
EAS-DS	2026-02-09 14:00:00	7.90	47.04	0.37	7.61	10.97	1.81	0.02
EAS-DS	2026-02-09 14:15:00	7.95	49.35	0.37	7.60	10.98	1.47	0.02
EAS-DS	2026-02-09 14:30:00	7.92	47.23	0.37	7.60	10.98	1.35	0.02
EAS-DS	2026-02-09 14:45:00	7.98	46.61	0.37	7.59	10.95	10.84	0.02
EAS-DS	2026-02-09 15:00:00		50.80		7.61	11.00	1.16	0.02
EAS-DS	2026-02-09 15:15:00	7.90	42.90	0.37	7.55	11.19	0.64	0.02
EAS-DS	2026-02-09 15:30:00	8.19	49.28	0.37	7.59	11.06	0.60	0.02
EAS-DS	2026-02-09 15:45:00	7.83	39.65	0.37	7.54	11.13	13.74	0.02
EAS-DS	2026-02-09 16:00:00	8.18	48.03	0.37	7.56	11.06	0.24	0.02
EAS-DS	2026-02-09 16:15:00	8.02	46.09	0.37	7.56	10.96	0.23	0.02
EAS-DS	2026-02-09 16:30:00	7.99	43.46	0.37	7.58	10.99	2.21	0.02
EAS-DS	2026-02-09 16:45:00	7.99	45.94	0.37	7.52	11.11	6.63	0.02
EAS-DS	2026-02-09 17:00:00	8.00	44.83	0.37	7.57	10.96	2.68	0.02
EAS-DS	2026-02-09 17:15:00	7.85	39.59	0.37	7.53	11.19	0.00	0.02
EAS-DS	2026-02-09 17:30:00	8.07	44.32	0.37	7.55	11.15	0.39	0.02
EAS-DS	2026-02-09 17:45:00	7.52	29.97	0.37	7.50	11.18	12.36	0.01
EAS-DS	2026-02-09 18:00:00	8.14	46.78	0.37	7.56	11.01	0.58	0.02
EAS-DS	2026-02-09 18:15:00	8.06	45.73	0.37	7.55	11.01	0.46	0.02
EAS-DS	2026-02-09 18:30:00	8.06	46.05	0.37	7.55	11.05	0.40	0.02
EAS-DS	2026-02-09 18:45:00	8.11	46.36	0.37	7.58	11.00	7.86	0.02
EAS-DS	2026-02-09 19:00:00	7.88	39.50	0.37	7.52	11.31	0.53	0.02
EAS-DS	2026-02-09 19:15:00	8.01	44.32	0.37	7.57	11.14	0.90	0.02
EAS-DS	2026-02-09 19:30:00	7.89	42.30	0.37	7.55	11.26	0.98	0.02
EAS-DS	2026-02-09 19:45:00	7.73	39.79	0.38	7.50	11.32	12.82	0.02
EAS-DS	2026-02-09 20:00:00	7.87	42.93	0.37	7.53	11.12	1.75	0.02
EAS-DS	2026-02-09 20:15:00	7.30	31.31	0.37	7.53	11.13	2.18	0.01
EAS-DS	2026-02-09 20:30:00	7.79	41.91	0.38	7.52	11.19	0.92	0.02
EAS-DS	2026-02-09 20:45:00	7.48	31.37	0.37	7.52	11.06	20.58	0.01
EAS-DS	2026-02-09 21:00:00	7.63	36.39	0.38	7.49	11.39	0.80	0.02
EAS-DS	2026-02-09 21:15:00	7.75	39.77	0.38	7.53	11.29	0.50	0.02
EAS-DS	2026-02-09 21:30:00	7.74	39.60	0.38	7.53	11.31	0.33	0.02
EAS-DS	2026-02-09 21:45:00	7.80	41.91	0.38	7.55	11.24	5.87	0.02
EAS-DS	2026-02-09 22:00:00	7.87	42.36	0.38	7.58	11.17	0.41	0.02
EAS-DS	2026-02-09 22:15:00	7.85	41.77	0.38	7.58	11.13	0.40	0.02
EAS-DS	2026-02-09 22:30:00	7.62	37.40	0.38	7.51	11.19	0.17	0.02
EAS-DS	2026-02-09 22:45:00	7.88	42.96	0.38	7.54	11.10	2.43	0.02
EAS-DS	2026-02-09 23:00:00	7.86	41.48	0.37	7.54	11.16	0.22	0.02
EAS-DS	2026-02-09 23:15:00	7.92	42.01	0.38	7.56	11.13	0.16	0.02
EAS-DS	2026-02-09 23:30:00	7.89	40.13	0.38	7.55	11.15	0.06	0.02
EAS-DS	2026-02-09 23:45:00	7.32	24.29	0.38	7.44	11.22	8.17	0.01
EAS-DS	2026-02-10 00:00:00	7.90	39.07	0.38	7.50	11.12	0.00	0.02
EAS-DS	2026-02-10 00:15:00	7.91	40.16	0.38	7.53	11.09	0.00	0.02
EAS-DS	2026-02-10 00:30:00	7.91	40.08	0.38	7.52	11.11	0.00	0.02
EAS-DS	2026-02-10 00:45:00	7.85	40.02	0.38	7.49	11.23	1.87	0.02
EAS-DS	2026-02-10 01:00:00	7.90	39.25	0.38	7.52	11.24	0.00	0.02
EAS-DS	2026-02-10 01:15:00	7.93	39.46	0.38	7.53	11.22	0.14	0.02
EAS-DS	2026-02-10 01:30:00	7.44	30.34	0.38	7.49	11.22	0.06	0.01
EAS-DS	2026-02-10 01:45:00	7.95	40.52	0.38	7.53	11.20	31.81	0.02
EAS-DS	2026-02-10 02:00:00	7.47	28.75	0.38	7.50	11.17	0.03	0.01
EAS-DS	2026-02-10 02:15:00	7.92	38.51	0.38	7.51	11.20	0.20	0.02
EAS-DS	2026-02-10 02:30:00	7.97	38.88	0.38	7.48	11.08	0.29	0.02
EAS-DS	2026-02-10 02:45:00	7.96	40.07	0.38	7.45	10.90	5.06	0.02
EAS-DS	2026-02-10 03:00:00	7.93	39.92	0.37	7.46	10.97	0.75	0.02
EAS-DS	2026-02-10 03:15:00	7.44	30.77	0.38	7.45	11.03	0.84	0.01

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-10 03:30:00	7.88	38.62	0.38	7.46	11.02	0.46	0.02
EAS-DS	2026-02-10 03:45:00	7.69	38.79	0.38	7.45	11.13	5.70	0.02
EAS-DS	2026-02-10 04:00:00	7.90	40.66	0.38	7.48	10.85	0.36	0.02
EAS-DS	2026-02-10 04:15:00	7.91	41.46	0.38	7.48	10.80	0.12	0.02
EAS-DS	2026-02-10 04:30:00	7.91	40.38	0.38	7.49	10.83	0.15	0.02
EAS-DS	2026-02-10 04:45:00	7.94	41.33	0.38	7.50	10.84	5.05	0.02
EAS-DS	2026-02-10 05:00:00	7.44	32.12	0.37	7.46	11.13	0.40	0.01
EAS-DS	2026-02-10 05:15:00	7.84	33.52	0.38	7.43	11.22	0.00	0.01
EAS-DS	2026-02-10 05:30:00	7.90	35.94	0.38	7.44	11.15	0.34	0.02
EAS-DS	2026-02-10 05:45:00	7.48	28.55	0.38	7.39	11.20	3.73	0.01
EAS-DS	2026-02-10 06:00:00	7.95	38.39	0.38	7.47	11.04	0.00	0.02
EAS-DS	2026-02-10 06:15:00	7.99	40.04	0.38	7.49	10.90	0.00	0.02
EAS-DS	2026-02-10 06:30:00	7.96	39.19	0.38	7.49	10.87	0.00	0.02
EAS-DS	2026-02-10 06:45:00	7.45	25.87	0.38	7.42	10.89	0.97	0.01
EAS-DS	2026-02-10 07:00:00	7.90	31.23	0.38	7.45	11.07	0.00	0.01
EAS-DS	2026-02-10 07:15:00	7.95	35.23	0.38	7.47	11.04	0.00	0.02
EAS-DS	2026-02-10 07:30:00	7.92	36.19	0.38	7.46	11.06	0.00	0.02
EAS-DS	2026-02-10 07:45:00	7.94	38.43	0.39	7.44	11.00	3.13	0.02
EAS-DS	2026-02-10 08:00:00	7.40	26.74	0.38	7.40	10.84	0.00	0.01
EAS-DS	2026-02-10 08:15:00	7.90	36.40	0.39	7.42	10.89	0.00	0.02
EAS-DS	2026-02-10 08:30:00	7.92	37.09	0.39	7.43	10.79	0.00	0.02
EAS-DS	2026-02-10 08:45:00	7.53	31.38	0.38	7.35	10.93	2.17	0.01
EAS-DS	2026-02-10 09:00:00	8.04	57.11	0.34	7.37	11.40	21.68	0.03
EAS-DS	2026-02-10 09:15:00	7.45	32.10	0.33	7.23	11.54	4.24	0.01
EAS-DS	2026-02-10 09:30:00	7.96	51.27	0.33	7.37	11.44	11.09	0.02
EAS-DS	2026-02-10 09:45:00	8.12	55.46	0.33	7.40	11.40	19.42	0.02
EAS-DS	2026-02-10 10:00:00	8.17	57.17	0.32	7.42	11.37	18.81	0.03
EAS-DS	2026-02-10 10:15:00	8.18	56.91	0.32	7.45	11.35	27.51	0.03
EAS-DS	2026-02-10 10:30:00	8.19	56.40	0.32	7.45	11.35	13.26	0.03
EAS-DS	2026-02-10 10:45:00	8.04	53.20	0.33	7.32	11.45	27.86	0.02
EAS-DS	2026-02-10 11:00:00	8.29	57.69	0.33	7.47	11.33	13.11	0.03
EAS-DS	2026-02-10 11:15:00	7.93	35.97	0.33	7.32	11.38	7.97	0.02
EAS-DS	2026-02-10 11:30:00	7.45	19.93	0.35	6.96	11.56	1.14	0.01
EAS-DS	2026-02-10 11:45:00	8.41	59.86	0.33	7.50	11.30	18.83	0.03
EAS-DS	2026-02-10 12:00:00	8.38	57.56	0.32	7.46	11.31	15.53	0.03
EAS-DS	2026-02-10 12:15:00	8.42	57.20	0.32	7.48	11.26	21.51	0.03
EAS-DS	2026-02-10 12:30:00	8.40	56.37	0.33	7.45	11.29	12.82	0.03
EAS-DS	2026-02-10 12:45:00	8.44	56.76	0.33	7.47	11.28	14.51	0.03
EAS-DS	2026-02-10 13:00:00	8.39	56.72	0.34	7.40	11.29	8.25	0.03
EAS-DS	2026-02-10 13:15:00	8.47	57.27	0.33	7.46	11.28	12.50	0.03
EAS-DS	2026-02-10 13:30:00	8.44	54.76	0.34	7.41	11.29	9.00	0.02
EAS-DS	2026-02-10 13:45:00	8.52	56.35	0.33	7.44	11.25	12.07	0.03
EAS-DS	2026-02-10 14:00:00	8.46	53.88	0.34	7.33	11.30	20.49	0.02
EAS-DS	2026-02-10 14:15:00	8.62	56.16	0.33	7.43	11.21	20.30	0.03
EAS-DS	2026-02-10 14:30:00	8.64	58.60	0.33	7.44	11.20	17.90	0.03
EAS-DS	2026-02-10 14:45:00	8.68	59.34	0.33	7.45	11.19	18.16	0.03
EAS-DS	2026-02-10 15:00:00	8.70	58.03	0.33	7.44	11.18	17.69	0.03
EAS-DS	2026-02-10 15:15:00	7.95	25.16	0.34	7.10	11.40	3.01	0.01
EAS-DS	2026-02-10 15:30:00	8.72	56.94	0.34	7.44	11.20	12.03	0.03
EAS-DS	2026-02-10 15:45:00	8.69	56.19	0.34	7.46	11.17	16.54	0.03
EAS-DS	2026-02-10 16:00:00	8.67	56.86	0.33	7.43	11.20	11.84	0.03
EAS-DS	2026-02-10 16:15:00	8.68	60.91	0.33	7.49	11.19	17.38	0.03
EAS-DS	2026-02-10 16:30:00	8.51	60.18	0.34	7.41	11.27	22.75	0.03
EAS-DS	2026-02-10 16:45:00	8.55	65.67	0.33	7.53	11.17	16.02	0.03
EAS-DS	2026-02-10 17:00:00	8.56	71.82	0.33	7.54	11.22	14.00	0.03

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-10 17:15:00	7.87	33.30	0.33	7.37	11.39	5.56	0.01
EAS-DS	2026-02-10 17:30:00	8.53	68.65	0.33	7.59	11.24	16.12	0.03
EAS-DS	2026-02-10 17:45:00	8.04	55.66	0.32	7.94	11.29	13.95	0.02
EAS-DS	2026-02-10 18:00:00	8.48	129.24	0.29	9.03	11.24	54.00	0.06
EAS-DS	2026-02-10 18:15:00	7.85	70.90	0.31	7.85	11.34	29.98	0.03
EAS-DS	2026-02-10 18:30:00	8.45	124.05	0.33	7.69	11.25	47.42	0.06
EAS-DS	2026-02-10 18:45:00	8.02	78.19	0.33	7.58	11.34	25.73	0.04
EAS-DS	2026-02-10 19:00:00	8.40	96.72	0.33	7.68	11.27	27.70	0.04
EAS-DS	2026-02-10 19:15:00	8.02	65.51	0.34	7.45	11.36	21.99	0.03
EAS-DS	2026-02-10 19:30:00	8.36	79.93	0.34	7.40	11.28	34.46	0.04
EAS-DS	2026-02-10 19:45:00	7.96	55.98	0.35	7.24	11.40	17.19	0.03
EAS-DS	2026-02-10 20:00:00	8.31	72.24	0.34	7.38	11.30	20.38	0.03
EAS-DS	2026-02-10 20:15:00	7.93	55.16	0.34	7.38	11.40	21.79	0.02
EAS-DS	2026-02-10 20:30:00	8.24	69.03	0.34	7.50	11.32	20.15	0.03
EAS-DS	2026-02-10 20:45:00	7.90	54.10	0.34	7.41	11.41	17.84	0.02
EAS-DS	2026-02-10 21:00:00	8.21	67.73	0.34	7.50	11.32	20.56	0.03
EAS-DS	2026-02-10 21:15:00	7.60	44.62	0.33	7.45	11.44	20.30	0.02
EAS-DS	2026-02-10 21:30:00	8.19	80.93	0.34	7.48	11.33	26.87	0.04
EAS-DS	2026-02-10 21:45:00	7.83	62.23	0.34	7.34	11.44	21.41	0.03
EAS-DS	2026-02-10 22:00:00	8.16	75.31	0.33	7.51	11.34	19.21	0.03
EAS-DS	2026-02-10 22:15:00	7.81	63.19	0.32	7.49	11.41	24.05	0.03
EAS-DS	2026-02-10 22:30:00	8.13	84.73	0.32	7.60	11.34	15.23	0.04
EAS-DS	2026-02-10 22:45:00	7.90	76.05	0.33	7.57	11.41	19.76	0.03
EAS-DS	2026-02-10 23:00:00	8.10	90.88	0.33	7.63	11.36	32.55	0.04
EAS-DS	2026-02-10 23:15:00	7.72	69.80	0.33	7.55	11.47	20.13	0.03
EAS-DS	2026-02-10 23:30:00	8.07	88.88	0.33	7.64	11.38	19.32	0.04
EAS-DS	2026-02-10 23:45:00	7.67	66.54	0.33	7.54	11.46	16.71	0.03
EAS-DS	2026-02-11 00:00:00	8.06	87.14	0.33	7.61	11.37	21.32	0.04
EAS-DS	2026-02-11 00:15:00	7.00	32.47	0.33	7.27	11.63	19.53	0.01
EAS-DS	2026-02-11 00:30:00	8.05	89.73	0.33	7.56	11.37	14.33	0.04
EAS-DS	2026-02-11 00:45:00	7.33	49.19	0.33	7.44	11.48	28.96	0.02
EAS-DS	2026-02-11 01:00:00	8.08	89.81	0.33	7.60	11.36	21.53	0.04
EAS-DS	2026-02-11 01:15:00	7.02	35.41	0.33	7.34	11.65	21.26	0.02
EAS-DS	2026-02-11 01:30:00	8.06	99.32	0.33	7.59	11.38	24.38	0.05
EAS-DS	2026-02-11 01:45:00	6.93	35.70	0.34	7.32	11.69	25.70	0.02
EAS-DS	2026-02-11 02:00:00	7.99	90.61	0.33	7.67	11.40	24.14	0.04
EAS-DS	2026-02-11 02:15:00	6.88	32.84	0.33	7.31	11.68	15.88	0.01
EAS-DS	2026-02-11 02:30:00	7.96	87.49	0.32	7.65	11.40	20.96	0.04
EAS-DS	2026-02-11 02:45:00	6.84	32.26	0.33	7.29	11.71	33.25	0.01
EAS-DS	2026-02-11 03:00:00	7.96	93.53	0.33	7.71	11.39	31.73	0.04
EAS-DS	2026-02-11 03:15:00	7.45	95.08	0.33	7.88	11.63	31.43	0.04
EAS-DS	2026-02-11 03:30:00	6.47	19.01	0.33	7.41	11.82	7.93	0.01
EAS-DS	2026-02-11 03:45:00	6.36	15.55	0.35	7.08	11.87	3.51	0.01
EAS-DS	2026-02-11 04:00:00	6.32	15.17	0.35	6.94	11.90	5.18	0.01
EAS-DS	2026-02-11 04:15:00	6.29	14.87	0.35	6.86	11.89	4.66	0.01
EAS-DS	2026-02-11 04:30:00	6.26	14.77	0.36	6.81	11.90	5.19	0.01
EAS-DS	2026-02-11 04:45:00	7.69	190.26	0.36	7.11	11.45	37.12	0.09
EAS-DS	2026-02-11 05:00:00	6.39	23.73	0.34	7.17	11.84	7.15	0.01
EAS-DS	2026-02-11 05:15:00	7.89	187.26	0.34	7.61	11.43	41.58	0.09
EAS-DS	2026-02-11 05:30:00	7.91	159.65	0.34	7.74	11.42	57.98	0.07
EAS-DS	2026-02-11 05:45:00	7.43	110.61	0.33	7.82	11.44	26.61	0.05
EAS-DS	2026-02-11 06:00:00	7.84	147.90	0.34	7.57	11.43	50.81	0.07
EAS-DS	2026-02-11 06:15:00	7.86	154.13	0.33	7.70	11.45	37.92	0.07
EAS-DS	2026-02-11 06:30:00	7.84	171.75	0.33	7.80	11.43	58.36	0.08
EAS-DS	2026-02-11 06:45:00	7.81	154.38	0.34	7.67	11.41	37.56	0.07

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-11 07:00:00	7.85	137.93	0.34	7.59	11.43	50.81	0.06
EAS-DS	2026-02-11 07:15:00	6.58	43.21	0.34	7.30	11.79	31.68	0.02
EAS-DS	2026-02-11 07:30:00	7.78	109.33	0.34	7.45	11.46	28.86	0.05
EAS-DS	2026-02-11 07:45:00	7.77	106.01	0.34	7.60	11.46	25.50	0.05
EAS-DS	2026-02-11 08:00:00	7.61	102.89	0.34	7.64	11.54	35.99	0.05
EAS-DS	2026-02-11 08:15:00	7.80	117.61	0.34	7.42	11.43	53.39	0.05
EAS-DS	2026-02-11 08:30:00	6.64	39.12	0.33	7.46	11.78	38.50	0.02
EAS-DS	2026-02-11 08:45:00	7.83	100.62	0.33	7.71	11.44	42.23	0.05
EAS-DS	2026-02-11 09:00:00	7.51	90.83	0.34	7.60	11.64	40.69	0.04
EAS-DS	2026-02-11 09:15:00	7.74	99.56	0.34	7.68	11.51	80.43	0.05
EAS-DS	2026-02-11 09:30:00	7.53	83.90	0.33	7.74	11.55	34.07	0.04
EAS-DS	2026-02-11 09:45:00	7.88	100.27	0.33	7.70	11.44	32.02	0.05
EAS-DS	2026-02-11 10:00:00	7.63	125.26	0.34	7.45	11.50	48.04	0.06
EAS-DS	2026-02-11 10:15:00	7.97	98.70	0.32	7.68	11.40	57.03	0.05
EAS-DS	2026-02-11 10:30:00	7.97	98.22	0.32	7.73	11.36	38.57	0.05
EAS-DS	2026-02-11 10:45:00	8.08	97.85	0.32	7.75	11.37	38.84	0.05
EAS-DS	2026-02-11 11:00:00	7.89	87.09	0.32	7.71	11.42	48.52	0.04
EAS-DS	2026-02-11 11:15:00	8.21	110.69	0.32	7.71	11.34	52.78	0.05
EAS-DS	2026-02-11 11:30:00	7.77	74.27	0.32	7.67	11.43	46.04	0.03
EAS-DS	2026-02-11 11:45:00	7.11	45.35	0.33	7.41	11.62	43.52	0.02
EAS-DS	2026-02-11 12:00:00	7.96	105.16	0.32	7.64	11.39	92.99	0.05
EAS-DS	2026-02-11 12:15:00	7.89	78.94	0.31	7.75	11.40	114.34	0.04
EAS-DS	2026-02-11 12:30:00	8.09	82.35	0.32	7.76	11.38	61.83	0.04
EAS-DS	2026-02-11 12:45:00	8.18	81.20	0.31	7.77	11.33	70.22	0.04
EAS-DS	2026-02-11 13:00:00	7.47	39.00	0.32	7.29	11.53	26.53	0.02
EAS-DS	2026-02-11 13:15:00	7.98	61.25	0.32	7.11	11.37	39.00	0.03
EAS-DS	2026-02-11 13:30:00	8.13	67.75	0.31	7.38	11.30	136.99	0.03
EAS-DS	2026-02-11 13:45:00	8.24	73.49	0.31	7.56	11.28	174.28	0.03
EAS-DS	2026-02-11 14:00:00	8.28	76.68	0.31	7.63	11.27	493.91	0.04
EAS-DS	2026-02-11 14:15:00	8.20	70.54	0.31	7.65	11.28	13.75	0.03
EAS-DS	2026-02-11 14:30:00	8.26	73.36	0.31	7.68	11.27	20.26	0.03
EAS-DS	2026-02-11 14:45:00	8.26	70.80	0.31	7.71	11.27	61.08	0.03
EAS-DS	2026-02-11 15:00:00	7.66	39.57	0.32	7.52	11.44	15.72	0.02
EAS-DS	2026-02-11 15:15:00	8.28	72.91	0.32	7.71	11.27	30.75	0.03
EAS-DS	2026-02-11 15:30:00	8.24	76.51	0.32	7.66	11.35	28.24	0.03
EAS-DS	2026-02-11 15:45:00	8.28	73.22	0.32	7.71	11.27	27.19	0.03
EAS-DS	2026-02-11 16:00:00	8.41	83.63	0.32	7.74	11.24	38.54	0.04
EAS-DS	2026-02-11 16:15:00	8.24	73.01	0.31	7.73	11.28	58.55	0.03
EAS-DS	2026-02-11 16:30:00	8.18	75.67	0.32	7.66	11.35	41.51	0.03
EAS-DS	2026-02-11 16:45:00	8.20	70.91	0.32	7.73	11.30	43.87	0.03
EAS-DS	2026-02-11 17:00:00	8.21	72.30	0.32	7.69	11.32	68.67	0.03
EAS-DS	2026-02-11 17:15:00	7.46	34.33	0.32	7.42	11.50	39.14	0.01
EAS-DS	2026-02-11 17:30:00	8.17	72.45	0.32	7.69	11.32	27.89	0.03
EAS-DS	2026-02-11 17:45:00	8.09	71.41	0.32	7.71	11.34	33.61	0.03
EAS-DS	2026-02-11 18:00:00	7.79	52.08	0.32	7.66	11.37	69.46	0.02
EAS-DS	2026-02-11 18:15:00	8.00	66.65	0.32	7.69	11.35	45.04	0.03
EAS-DS	2026-02-11 18:30:00	7.58	50.39	0.33	7.46	11.57	54.23	0.02
EAS-DS	2026-02-11 18:45:00	8.02	68.59	0.32	7.67	11.36	32.36	0.03
EAS-DS	2026-02-11 19:00:00	8.11	75.24	0.33	7.65	11.35	29.13	0.03
EAS-DS	2026-02-11 19:15:00	7.92	64.73	0.32	7.69	11.37	36.51	0.03
EAS-DS	2026-02-11 19:30:00	8.08	75.12	0.33	7.66	11.37	30.02	0.03
EAS-DS	2026-02-11 19:45:00	7.95	68.53	0.33	7.68	11.40	33.27	0.03
EAS-DS	2026-02-11 20:00:00	7.89	66.57	0.32	7.66	11.41	39.70	0.03
EAS-DS	2026-02-11 20:15:00	7.59	59.76	0.33	7.55	11.54	26.55	0.03
EAS-DS	2026-02-11 20:30:00	7.83	65.46	0.32	7.69	11.42	40.22	0.03

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-11 20:45:00	7.68	59.83	0.33	7.66	11.45	30.08	0.03
EAS-DS	2026-02-11 21:00:00	7.35	42.76	0.33	7.57	11.52	34.82	0.02
EAS-DS	2026-02-11 21:15:00	7.66	59.56	0.33	7.68	11.48	28.15	0.03
EAS-DS	2026-02-11 21:30:00	7.05	34.73	0.34	7.43	11.64	27.09	0.01
EAS-DS	2026-02-11 21:45:00	7.90	71.43	0.33	7.71	11.41	30.92	0.03
EAS-DS	2026-02-11 22:00:00	7.75	70.21	0.33	7.61	11.52	43.37	0.03
EAS-DS	2026-02-11 22:15:00	7.92	72.89	0.32	7.73	11.40	51.73	0.03
EAS-DS	2026-02-11 22:30:00	7.92	75.17	0.33	7.68	11.41	36.37	0.03
EAS-DS	2026-02-11 22:45:00	7.47	61.83	0.34	7.55	11.63	36.68	0.03
EAS-DS	2026-02-11 23:00:00	7.95	78.28	0.33	7.72	11.40	36.10	0.04
EAS-DS	2026-02-11 23:15:00	7.52	62.28	0.33	7.63	11.51	35.36	0.03
EAS-DS	2026-02-11 23:30:00	7.68	66.24	0.33	7.64	11.46	78.67	0.03
EAS-DS	2026-02-11 23:45:00	7.71	67.71	0.33	7.66	11.44	37.60	0.03
EAS-DS	2026-02-12 00:00:00	7.24	46.05	0.33	7.57	11.55	47.47	0.02
EAS-DS	2026-02-12 00:15:00	7.64	65.40	0.33	7.64	11.47	50.63	0.03
EAS-DS	2026-02-12 00:30:00	7.22	49.34	0.34	7.44	11.72	47.03	0.02
EAS-DS	2026-02-12 00:45:00	6.98	38.45	0.33	7.50	11.63	34.60	0.02
EAS-DS	2026-02-12 01:00:00	7.77	72.40	0.33	7.67	11.46	43.81	0.03
EAS-DS	2026-02-12 01:15:00	7.70	74.23	0.34	7.62	11.49	39.91	0.03
EAS-DS	2026-02-12 01:30:00	7.84	76.06	0.33	7.71	11.39	50.40	0.03
EAS-DS	2026-02-12 01:45:00	7.83	76.28	0.33	7.69	11.45	44.63	0.03
EAS-DS	2026-02-12 02:00:00	6.92	37.97	0.33	7.49	11.66	64.28	0.02
EAS-DS	2026-02-12 02:15:00	7.50	62.06	0.33	7.67	11.50	100.66	0.03
EAS-DS	2026-02-12 02:30:00	7.74	75.47	0.34	7.66	11.51	73.14	0.03
EAS-DS	2026-02-12 02:45:00	7.60	64.47	0.33	7.70	11.47	107.79	0.03
EAS-DS	2026-02-12 03:00:00	7.91	76.20	0.34	7.62	11.44	47.81	0.03
EAS-DS	2026-02-12 03:15:00	7.50	57.60	0.33	7.61	11.51	62.27	0.03
EAS-DS	2026-02-12 03:30:00	7.95	76.52	0.34	7.60	11.40	44.33	0.03
EAS-DS	2026-02-12 03:45:00	7.85	74.48	0.33	7.62	11.42	40.54	0.03
EAS-DS	2026-02-12 04:00:00	6.91	38.91	0.33	7.40	11.65	61.68	0.02
EAS-DS	2026-02-12 04:15:00	7.85	72.97	0.33	7.51	11.41	54.94	0.03
EAS-DS	2026-02-12 04:30:00	7.74	65.53	0.33	7.43	11.48	57.02	0.03
EAS-DS	2026-02-12 04:45:00	7.61	67.45	0.34	7.41	11.54	82.57	0.03
EAS-DS	2026-02-12 05:00:00	7.79	70.85	0.33	7.55	11.49	60.00	0.03
EAS-DS	2026-02-12 05:15:00	7.58	69.94	0.34	7.47	11.56	62.75	0.03
EAS-DS	2026-02-12 05:30:00	7.93	75.54	0.34	7.48	11.41	49.91	0.03
EAS-DS	2026-02-12 05:45:00	7.45	59.69	0.34	7.45	11.55	64.16	0.03
EAS-DS	2026-02-12 06:00:00	7.79	71.22	0.33	7.60	11.47	52.23	0.03
EAS-DS	2026-02-12 06:15:00	6.77	29.25	0.32	7.54	11.66	71.86	0.01
EAS-DS	2026-02-12 06:30:00	7.98	89.99	0.30	8.71	11.40	68.52	0.04
EAS-DS	2026-02-12 06:45:00	7.62	80.59	0.32	7.89	11.50	100.57	0.04
EAS-DS	2026-02-12 07:00:00	7.98	90.09	0.33	7.67	11.42	62.17	0.04
EAS-DS	2026-02-12 07:15:00	7.75	74.42	0.33	7.65	11.45	42.61	0.03
EAS-DS	2026-02-12 07:30:00	7.83	73.97	0.34	7.65	11.40	55.76	0.03
EAS-DS	2026-02-12 07:45:00	7.71	68.64	0.34	7.62	11.48	42.82	0.03
EAS-DS	2026-02-12 08:00:00	7.54	60.34	0.33	7.58	11.48	76.53	0.03
EAS-DS	2026-02-12 08:15:00	7.66	64.09	0.34	7.56	11.51	62.79	0.03
EAS-DS	2026-02-12 08:30:00	7.95	73.84	0.33	7.63	11.43	57.52	0.03
EAS-DS	2026-02-12 08:45:00	7.68	68.11	0.34	7.62	11.52	68.41	0.03
EAS-DS	2026-02-12 09:00:00	7.90	85.50	0.33	7.91	11.45	68.40	0.04
EAS-DS	2026-02-12 09:15:00	7.76	91.84	0.34	7.71	11.49	52.09	0.04
EAS-DS	2026-02-12 09:30:00	7.60	95.25	0.34	7.74	11.47	71.44	0.04
EAS-DS	2026-02-12 09:45:00	7.83	110.53	0.34	7.77	11.47	70.51	0.05
EAS-DS	2026-02-12 10:00:00	7.10	57.45	0.33	7.52	11.58	61.35	0.03
EAS-DS	2026-02-12 10:15:00	7.89	99.53	0.34	7.52	11.47	76.83	0.05

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-12 10:30:00	7.07	58.34	0.34	7.39	11.71	75.04	0.03
EAS-DS	2026-02-12 10:45:00	7.99	106.22	0.34	7.62	11.43	57.50	0.05
EAS-DS	2026-02-12 11:00:00	7.42	76.07	0.34	7.54	11.69	63.57	0.03
EAS-DS	2026-02-12 11:15:00	8.01	100.65	0.34	7.68	11.43	58.65	0.05
EAS-DS	2026-02-12 11:30:00	7.48	74.80	0.34	7.51	11.69	62.67	0.03
EAS-DS	2026-02-12 11:45:00	8.06	98.75	0.34	7.70	11.41	54.80	0.05
EAS-DS	2026-02-12 12:00:00	8.15	102.69	0.34	7.70	11.40	64.41	0.05
EAS-DS	2026-02-12 12:15:00	8.13	93.42	0.33	7.73	11.39	69.79	0.04
EAS-DS	2026-02-12 12:30:00	7.47	53.97	0.33	7.63	11.45	63.57	0.02
EAS-DS	2026-02-12 12:45:00	8.11	90.38	0.33	7.72	11.39	90.59	0.04
EAS-DS	2026-02-12 13:00:00	7.84	73.81	0.33	7.69	11.30	100.40	0.03
EAS-DS	2026-02-12 13:15:00	8.18	96.09	0.33	7.72	11.36	64.75	0.04
EAS-DS	2026-02-12 13:30:00	7.99	79.42	0.33	7.70	11.29	90.48	0.04
EAS-DS	2026-02-12 13:45:00	8.15	86.05	0.33	7.69	11.38	75.45	0.04
EAS-DS	2026-02-12 14:00:00	7.83	66.78	0.33	7.70	11.34	69.46	0.03
EAS-DS	2026-02-12 14:15:00	8.24	90.31	0.33	7.76	11.32	101.78	0.04
EAS-DS	2026-02-12 14:30:00	8.36	94.98	0.33	7.81	11.28	113.96	0.04
EAS-DS	2026-02-12 14:45:00	8.22	91.53	0.33	7.75	11.35	107.82	0.04
EAS-DS	2026-02-12 15:00:00	8.39	93.70	0.33	7.78	11.28	77.13	0.04
EAS-DS	2026-02-12 15:15:00	8.21	89.05	0.33	7.71	11.37	76.96	0.04
EAS-DS	2026-02-12 15:30:00	8.39	96.41	0.33	7.80	11.28	78.24	0.04
EAS-DS	2026-02-12 15:45:00	8.26	96.80	0.34	7.73	11.35	75.96	0.04
EAS-DS	2026-02-12 16:00:00	8.43	103.94	0.32	7.80	11.26	89.25	0.05
EAS-DS	2026-02-12 16:15:00	8.33	102.32	0.32	7.73	11.31	108.51	0.05
EAS-DS	2026-02-12 16:30:00	7.56	57.84	0.32	7.63	11.41	84.05	0.03
EAS-DS	2026-02-12 16:45:00	8.38	110.67	0.33	7.80	11.28	111.16	0.05
EAS-DS	2026-02-12 17:00:00	7.80	82.85	0.33	7.63	11.54	81.03	0.04
EAS-DS	2026-02-12 17:15:00	7.86	73.95	0.33	7.72	11.31	90.99	0.03
EAS-DS	2026-02-12 17:30:00	8.39	99.77	0.33	7.77	11.27	82.40	0.05
EAS-DS	2026-02-12 17:45:00	8.09	82.17	0.34	7.74	11.27	101.06	0.04
EAS-DS	2026-02-12 18:00:00	8.43	98.62	0.33	7.75	11.25	108.62	0.05
EAS-DS	2026-02-12 18:15:00	7.26	40.47	0.33	7.50	11.54	87.94	0.02
EAS-DS	2026-02-12 18:30:00	8.40	92.20	0.33	7.76	11.26	97.41	0.04
EAS-DS	2026-02-12 18:45:00	8.19	84.21	0.33	7.72	11.30	145.82	0.04
EAS-DS	2026-02-12 19:00:00	7.99	75.04	0.33	7.69	11.24	107.53	0.03
EAS-DS	2026-02-12 19:15:00	8.35	96.64	0.34	7.68	11.27	100.97	0.04
EAS-DS	2026-02-12 19:30:00	7.60	52.93	0.33	7.61	11.39	108.12	0.02
EAS-DS	2026-02-12 19:45:00	8.33	90.49	0.34	7.75	11.29	126.18	0.04
EAS-DS	2026-02-12 20:00:00	7.84	62.04	0.33	7.70	11.32	130.45	0.03
EAS-DS	2026-02-12 20:15:00	8.40	90.56	0.33	7.77	11.27	106.12	0.04
EAS-DS	2026-02-12 20:30:00	7.67	58.57	0.33	7.55	11.58	157.83	0.03
EAS-DS	2026-02-12 20:45:00	7.75	56.08	0.33	7.69	11.32	106.49	0.03
EAS-DS	2026-02-12 21:00:00	8.44	91.01	0.33	7.80	11.18	119.63	0.04
EAS-DS	2026-02-12 21:15:00	8.47	91.94	0.33	7.78	11.23	107.14	0.04
EAS-DS	2026-02-12 21:30:00	8.37	90.32	0.34	7.72	11.27	99.99	0.04
EAS-DS	2026-02-12 21:45:00	8.40	88.24	0.33	7.73	11.26	103.71	0.04
EAS-DS	2026-02-12 22:00:00	8.49	92.63	0.32	7.72	11.21	160.98	0.04
EAS-DS	2026-02-12 22:15:00	8.50	95.69	0.32	7.78	11.21	138.25	0.04
EAS-DS	2026-02-12 22:30:00	8.51	97.33	0.32	7.81	11.19	119.46	0.04
EAS-DS	2026-02-12 22:45:00	7.34	41.25	0.33	7.57	11.49	204.84	0.02
EAS-DS	2026-02-12 23:00:00	7.27	38.29	0.33	7.54	11.51	103.22	0.02
EAS-DS	2026-02-12 23:15:00	7.59	49.29	0.33	7.64	11.37	107.17	0.02
EAS-DS	2026-02-12 23:30:00	8.49	91.96	0.33	7.75	11.17	147.97	0.04
EAS-DS	2026-02-12 23:45:00	8.43	91.39	0.34	7.70	11.23	104.78	0.04
EAS-DS	2026-02-13 00:00:00	8.48	97.25	0.33	7.75	11.19	141.71	0.04

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-13 00:15:00	8.46	99.95	0.33	7.55	11.20	141.79	0.05
EAS-DS	2026-02-13 00:30:00	8.48	99.39	0.33	7.55	11.20	167.76	0.05
EAS-DS	2026-02-13 00:45:00	7.85	63.38	0.33	7.63	11.25	99.13	0.03
EAS-DS	2026-02-13 01:00:00	8.56	98.20	0.33	7.77	11.17	177.30	0.05
EAS-DS	2026-02-13 01:15:00	8.29	92.18	0.33	7.68	11.31	144.37	0.04
EAS-DS	2026-02-13 01:30:00	7.63	53.04	0.33	7.65	11.35	105.58	0.02
EAS-DS	2026-02-13 01:45:00	8.53	98.98	0.33	7.84	11.15	97.78	0.05
EAS-DS	2026-02-13 02:00:00	8.53	100.15	0.32	7.84	11.15	173.34	0.05
EAS-DS	2026-02-13 02:15:00	7.91	77.07	0.33	7.66	11.46	159.99	0.04
EAS-DS	2026-02-13 02:30:00	7.60	52.23	0.32	7.69	11.33	111.51	0.02
EAS-DS	2026-02-13 02:45:00	8.48	93.45	0.32	7.83	11.20	151.09	0.04
EAS-DS	2026-02-13 03:00:00	8.46	92.67	0.33	7.81	11.19	116.31	0.04
EAS-DS	2026-02-13 03:15:00	8.34	91.40	0.33	7.73	11.25	117.57	0.04
EAS-DS	2026-02-13 03:30:00	7.24	39.76	0.33	7.53	11.51	152.03	0.02
EAS-DS	2026-02-13 03:45:00	8.14	77.24	0.33	7.78	11.16	134.20	0.04
EAS-DS	2026-02-13 04:00:00	8.41	90.45	0.33	7.79	11.20	137.93	0.04
EAS-DS	2026-02-13 04:15:00	8.33	89.44	0.33	7.76	11.26	170.28	0.04
EAS-DS	2026-02-13 04:30:00	8.40	89.95	0.33	7.81	11.21	160.83	0.04
EAS-DS	2026-02-13 04:45:00	7.08	36.50	0.34	7.46	11.57	117.51	0.02
EAS-DS	2026-02-13 05:00:00	8.37	90.20	0.33	7.80	11.21	132.35	0.04
EAS-DS	2026-02-13 05:15:00	8.29	90.37	0.34	7.76	11.23	115.51	0.04
EAS-DS	2026-02-13 05:30:00	7.16	41.48	0.34	7.54	11.50	136.48	0.02
EAS-DS	2026-02-13 05:45:00	8.26	89.54	0.34	7.77	11.22	132.26	0.04
EAS-DS	2026-02-13 06:00:00	8.25	90.54	0.33	7.78	11.21	173.01	0.04
EAS-DS	2026-02-13 06:15:00	7.34	55.94	0.33	7.57	11.61	162.56	0.03
EAS-DS	2026-02-13 06:30:00	8.17	90.34	0.33	7.81	11.24	147.10	0.04
EAS-DS	2026-02-13 06:45:00	8.15	91.71	0.33	7.76	11.25	188.57	0.04
EAS-DS	2026-02-13 07:00:00	7.85	84.79	0.34	7.67	11.44	171.80	0.04
EAS-DS	2026-02-13 07:15:00	8.03	85.52	0.34	7.75	11.23	151.05	0.04
EAS-DS	2026-02-13 07:30:00	8.05	85.88	0.34	7.74	11.29	162.15	0.04
EAS-DS	2026-02-13 07:45:00	6.91	41.31	0.35	7.52	11.61	115.06	0.02
EAS-DS	2026-02-13 08:00:00	8.06	84.98	0.34	7.75	11.30	186.76	0.04
EAS-DS	2026-02-13 08:15:00	7.97	85.01	0.34	7.71	11.35	172.40	0.04
EAS-DS	2026-02-13 08:30:00	7.06	45.87	0.34	7.60	11.52	178.01	0.02
EAS-DS	2026-02-13 08:45:00	8.07	87.99	0.34	7.75	11.28	218.81	0.04
EAS-DS	2026-02-13 09:00:00	8.03	87.65	0.34	7.72	11.31	159.88	0.04
EAS-DS	2026-02-13 09:15:00	7.29	52.82	0.34	7.65	11.43	160.59	0.02
EAS-DS	2026-02-13 09:30:00	8.13	87.41	0.34	7.74	11.25	136.83	0.04
EAS-DS	2026-02-13 09:45:00	7.23	49.25	0.34	7.65	11.44	143.68	0.02
EAS-DS	2026-02-13 10:00:00	8.13	86.01	0.34	7.75	11.25	163.74	0.04
EAS-DS	2026-02-13 10:15:00	7.22	49.07	0.34	7.53	11.61	141.53	0.02
EAS-DS	2026-02-13 10:30:00	8.17	84.88	0.34	7.78	11.23	217.15	0.04
EAS-DS	2026-02-13 10:45:00	8.10	82.36	0.34	7.72	11.28	210.12	0.04
EAS-DS	2026-02-13 11:00:00	7.61	56.19	0.34	7.69	11.26	177.17	0.03
EAS-DS	2026-02-13 11:15:00	8.20	80.80	0.34	7.74	11.22	157.34	0.04
EAS-DS	2026-02-13 11:30:00	8.24	80.15	0.34	7.75	11.19	140.47	0.04
EAS-DS	2026-02-13 11:45:00	7.14	34.05	0.34	7.51	11.46	157.72	0.01
EAS-DS	2026-02-13 12:00:00	8.25	81.78	0.34	7.72	11.19	169.27	0.04
EAS-DS	2026-02-13 12:15:00	7.43	45.02	0.34	7.60	11.32	191.58	0.02
EAS-DS	2026-02-13 12:30:00	8.30	80.45	0.34	7.72	11.17	151.82	0.04
EAS-DS	2026-02-13 12:45:00	8.26	79.86	0.34	7.69	11.18	163.36	0.04
EAS-DS	2026-02-13 13:00:00	8.12	0.08	0.26	8.49	11.20	158.15	0.00
EAS-DS	2026-02-13 13:15:00	8.36	81.66	0.31	7.74	11.26	10.63	0.04
EAS-DS	2026-02-13 13:30:00	8.36	81.08	0.31	7.75	11.23	6.96	0.04
EAS-DS	2026-02-13 13:45:00	7.61	42.84	0.31	7.60	11.36	1.76	0.02

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-13 14:00:00	8.38	82.61	0.29	7.74	11.18	4.10	0.04
EAS-DS	2026-02-13 14:15:00	8.24	74.17	0.31	7.75	11.12	2.67	0.03
EAS-DS	2026-02-13 14:30:00	8.40	85.86	0.32	7.75	11.05	1.95	0.04
EAS-DS	2026-02-13 14:45:00	8.37	83.98	0.32	7.75	11.11	1.24	0.04
EAS-DS	2026-02-13 15:00:00	8.36	87.36	0.32	7.72	11.13	13.51	0.04
EAS-DS	2026-02-13 15:15:00	8.41	81.86	0.31	7.74	11.16	1.42	0.04
EAS-DS	2026-02-13 15:30:00	8.43	84.46	0.32	7.74	11.13	0.00	0.04
EAS-DS	2026-02-13 15:45:00	7.53	0.08	0.30	7.48	11.35	12.08	0.00
EAS-DS	2026-02-13 16:00:00	8.41	87.35	0.30	7.76	11.13	3.51	0.04
EAS-DS	2026-02-13 16:15:00	8.37	80.10	0.31	7.77	11.11	1.94	0.04
EAS-DS	2026-02-13 16:30:00	8.27	87.83	0.33	7.70	11.20	5.17	0.04
EAS-DS	2026-02-13 16:45:00	8.36	80.07	0.33	7.76	11.12	1.30	0.04
EAS-DS	2026-02-13 17:00:00	8.37	87.05	0.32	7.75	11.13	3.18	0.04
EAS-DS	2026-02-13 17:15:00	7.37	42.75	0.33	7.40	11.51	2.24	0.02
EAS-DS	2026-02-13 17:30:00	8.39	79.92	0.33	7.74	11.15	9.24	0.04
EAS-DS	2026-02-13 17:45:00	8.36	76.55	0.33	7.75	11.14	0.97	0.03
EAS-DS	2026-02-13 18:00:00	8.37	83.46	0.32	7.75	11.12	7.40	0.04
EAS-DS	2026-02-13 18:15:00	8.18	67.87	0.32	7.74	11.15	1.43	0.03
EAS-DS	2026-02-13 18:30:00	7.85	74.53	0.34	7.54	11.45	8.12	0.03
EAS-DS	2026-02-13 18:45:00	8.30	77.83	0.33	7.72	11.12	4.00	0.04
EAS-DS	2026-02-13 19:00:00	7.57	46.95	0.30	7.60	11.34	3.35	0.02
EAS-DS	2026-02-13 19:15:00	8.30	75.23	0.32	7.73	11.17	0.42	0.03
EAS-DS	2026-02-13 19:30:00	7.61	59.15	0.33	7.52	11.53	13.98	0.03
EAS-DS	2026-02-13 19:45:00	8.32	75.80	0.33	7.69	11.17	19.03	0.03
EAS-DS	2026-02-13 20:00:00	8.25	81.56	0.33	7.67	11.18	3.38	0.04
EAS-DS	2026-02-13 20:15:00	7.99	0.08	0.30	7.64	11.16	491.49	0.00
EAS-DS	2026-02-13 20:30:00	8.30	79.66	0.32	7.75	11.16	1.20	0.04
EAS-DS	2026-02-13 20:45:00	8.18	75.73	0.33	7.69	11.21	2.36	0.03
EAS-DS	2026-02-13 21:00:00	7.42	52.17	0.34	7.43	11.54	0.91	0.02
EAS-DS	2026-02-13 21:15:00	7.62	0.08	0.32	7.53	11.29	876.31	0.00
EAS-DS	2026-02-13 21:30:00	8.30	80.53	0.33	7.73	11.16	7.50	0.04
EAS-DS	2026-02-13 21:45:00	8.07	80.66	0.34	7.59	11.33	4.12	0.04
EAS-DS	2026-02-13 22:00:00	8.10	75.31	0.32	7.73	11.19	9.56	0.03
EAS-DS	2026-02-13 22:15:00	8.21	79.58	0.33	7.70	11.21	2.14	0.04
EAS-DS	2026-02-13 22:30:00	8.34	80.07	0.33	7.75	11.14	2.07	0.04
EAS-DS	2026-02-13 22:45:00	8.20	78.25	0.34	7.66	11.21	8.72	0.04
EAS-DS	2026-02-13 23:00:00	8.32	87.26	0.33	7.74	11.15	8.47	0.04
EAS-DS	2026-02-13 23:15:00	8.27	86.11	0.33	7.66	11.18	6.60	0.04
EAS-DS	2026-02-13 23:30:00	7.62	0.08	0.33	7.60	11.29	0.00	0.00
EAS-DS	2026-02-13 23:45:00	7.89	75.70	0.34	7.53	11.39	1.81	0.03
EAS-DS	2026-02-14 00:00:00	8.31	84.26	0.33	7.66	11.14	10.64	0.04
EAS-DS	2026-02-14 00:15:00	8.20	87.65	0.34	7.64	11.20	5.81	0.04
EAS-DS	2026-02-14 00:30:00	7.70	77.02	0.34	7.50	11.51	8.83	0.04
EAS-DS	2026-02-14 00:45:00	8.11	83.70	0.34	7.70	11.21	3.60	0.04
EAS-DS	2026-02-14 01:00:00		87.36					0.04
EAS-DS	2026-02-14 01:15:00	8.22	0.08	0.25	9.45	11.17	3579.68	0.00
EAS-DS	2026-02-14 01:30:00	8.18	5.60	0.25	8.94	11.16		0.00
EAS-DS	2026-02-14 01:45:00	8.13	196.38	0.30	8.19	11.11	42.97	0.09
EAS-DS	2026-02-14 02:00:00	7.14	0.08	0.30	8.08	11.52	0.00	0.00
EAS-DS	2026-02-14 02:15:00	8.02	5.25	0.32	7.62	11.19	3919.81	0.00
EAS-DS	2026-02-14 02:30:00	8.10	154.19	0.33	7.79	11.16	13.09	0.07
EAS-DS	2026-02-14 02:45:00	7.14	0.08	0.32	8.07	11.50	0.00	0.00
EAS-DS	2026-02-14 03:00:00	8.20	160.85	0.32	7.85	11.19	18.03	0.08
EAS-DS	2026-02-14 03:15:00	7.97	133.06	0.33	7.76	11.24	12.41	0.06
EAS-DS	2026-02-14 03:30:00	7.80	0.08	0.33	7.75	11.24	0.00	0.00

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-14 03:45:00	8.12	105.96	0.34	7.53	11.16	4.62	0.05
EAS-DS	2026-02-14 04:00:00	8.27	117.19	0.33	7.67	11.11	4.92	0.05
EAS-DS	2026-02-14 04:15:00	7.28	0.08	0.30	7.48	11.50	15.80	0.00
EAS-DS	2026-02-14 04:30:00	8.29	107.39	0.32	7.70	11.16	5.03	0.05
EAS-DS	2026-02-14 04:45:00	8.18	101.96	0.33	7.78	11.15	8.03	0.05
EAS-DS	2026-02-14 05:00:00	8.25	112.35	0.33	7.82	11.17	4.96	0.05
EAS-DS	2026-02-14 05:15:00	8.15	100.25	0.33	7.85	11.13	3.93	0.05
EAS-DS	2026-02-14 05:30:00	8.25	109.79	0.33	7.87	11.16	2.75	0.05
EAS-DS	2026-02-14 05:45:00	8.12	100.85	0.33	7.83	11.16	4.72	0.05
EAS-DS	2026-02-14 06:00:00	8.22	105.76	0.33	7.79	11.16	2.70	0.05
EAS-DS	2026-02-14 06:15:00	7.87	85.02	0.33	7.78	11.25	6.68	0.04
EAS-DS	2026-02-14 06:30:00	8.15	108.25	0.33	7.80	11.23	2.66	0.05
EAS-DS	2026-02-14 06:45:00	8.10	0.08	0.30	7.78	11.11	92.49	0.00
EAS-DS	2026-02-14 07:00:00	8.21	107.73	0.32	7.83	11.16	12.04	0.05
EAS-DS	2026-02-14 07:15:00	7.55	0.08	0.31	7.70	11.28	0.00	0.00
EAS-DS	2026-02-14 07:30:00	8.19	99.97	0.33	7.77	11.12	2.55	0.05
EAS-DS	2026-02-14 07:45:00	7.78	0.08	0.33	7.67	11.18	0.00	0.00
EAS-DS	2026-02-14 08:00:00	8.19	103.38	0.33	7.73	11.13	5.12	0.05
EAS-DS	2026-02-14 08:15:00	7.80	0.08	0.32	7.65	11.19	0.00	0.00
EAS-DS	2026-02-14 08:30:00	8.11	102.99	0.33	7.77	11.24	3.74	0.05
EAS-DS	2026-02-14 08:45:00	8.11	95.90	0.33	7.79	11.18	5.76	0.04
EAS-DS	2026-02-14 09:00:00	8.17	105.28	0.33	7.80	11.20	6.55	0.05
EAS-DS	2026-02-14 09:15:00	8.18	103.00	0.33	7.79	11.19	5.60	0.05
EAS-DS	2026-02-14 09:30:00	8.05	94.53	0.33	7.76	11.27	5.31	0.04
EAS-DS	2026-02-14 09:45:00	8.33	100.67	0.33	7.83	11.13	3.51	0.05
EAS-DS	2026-02-14 10:00:00	8.38	102.89	0.32	7.84	11.12	8.54	0.05
EAS-DS	2026-02-14 10:15:00	8.48	101.39	0.32	7.87	11.12	1.77	0.05
EAS-DS	2026-02-14 10:30:00	8.59	107.37	0.32	7.86	11.08	3.35	0.05
EAS-DS	2026-02-14 10:45:00	8.23	94.40	0.33	7.70	11.26	3.36	0.04
EAS-DS	2026-02-14 11:00:00	8.53	0.08	0.31	7.74	11.00	0.00	0.00
EAS-DS	2026-02-14 11:15:00	8.75	106.99	0.32	7.84	11.01	3.97	0.05
EAS-DS	2026-02-14 11:30:00	8.43	0.08	0.32	7.80	11.10	0.00	0.00
EAS-DS	2026-02-14 11:45:00	7.63	64.07	0.32	7.49	11.53	10.29	0.03
EAS-DS	2026-02-14 12:00:00	8.61	99.25	0.30	7.79	11.03	8.69	0.05
EAS-DS	2026-02-14 12:15:00	7.86	56.01	0.31	7.66	11.20	0.36	0.03
EAS-DS	2026-02-14 12:30:00	8.31	90.98	0.32	7.73	11.24	4.88	0.04
EAS-DS	2026-02-14 12:45:00	8.30	64.28	0.32	7.80	11.15	74.38	0.03
EAS-DS	2026-02-14 13:00:00	7.15	0.08	0.33	7.89	11.58	0.00	0.00
EAS-DS	2026-02-14 13:15:00	8.40	91.84	0.33	7.78	11.11	2.06	0.04
EAS-DS	2026-02-14 13:30:00	8.33	90.38	0.33	7.77	11.18	14.56	0.04
EAS-DS	2026-02-14 13:45:00	8.49	95.51	0.32	7.79	11.20	14.96	0.04
EAS-DS	2026-02-14 14:00:00	8.59	96.72	0.31	7.83	11.18	15.96	0.04
EAS-DS	2026-02-14 14:15:00	8.61	97.32	0.31	7.82	11.17	12.14	0.04
EAS-DS	2026-02-14 14:30:00	8.59	96.70	0.31	7.83	11.16	16.62	0.04
EAS-DS	2026-02-14 14:45:00	8.19	82.50	0.31	7.76	11.24	12.02	0.04
EAS-DS	2026-02-14 15:00:00	7.97	83.88	0.32	7.60	11.51	16.49	0.04
EAS-DS	2026-02-14 15:15:00	8.55	94.49	0.31	7.80	11.17	18.88	0.04
EAS-DS	2026-02-14 15:30:00	8.39	91.84	0.31	7.74	11.26	33.91	0.04
EAS-DS	2026-02-14 15:45:00	8.51	93.82	0.31	7.81	11.18	19.22	0.04
EAS-DS	2026-02-14 16:00:00	8.50	95.64	0.30	7.82	11.19	20.69	0.04
EAS-DS	2026-02-14 16:15:00	8.38	94.91	0.30	7.79	11.26	12.57	0.04
EAS-DS	2026-02-14 16:30:00	7.65	59.84	0.30	7.75	11.34	6.77	0.03
EAS-DS	2026-02-14 16:45:00	7.71	71.72	0.31	7.72	11.49	17.44	0.03
EAS-DS	2026-02-14 17:00:00	7.51	58.33	0.30	7.73	11.36	6.58	0.03
EAS-DS	2026-02-14 17:15:00	8.22	96.38	0.31	7.77	11.28	14.30	0.04

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-14 17:30:00	7.55	66.06	0.31	7.72	11.35	8.84	0.03
EAS-DS	2026-02-14 17:45:00	8.30	97.92	0.31	7.83	11.23	10.69	0.05
EAS-DS	2026-02-14 18:00:00	8.27	97.14	0.30	7.82	11.23	12.48	0.04
EAS-DS	2026-02-14 18:15:00	8.23	96.38	0.30	7.79	11.28	11.14	0.04
EAS-DS	2026-02-14 18:30:00	8.23	96.43	0.30	7.81	11.28	14.47	0.04
EAS-DS	2026-02-14 18:45:00	7.46	76.00	0.31	7.66	11.59	22.34	0.03
EAS-DS	2026-02-14 19:00:00	8.14	96.57	0.30	7.78	11.29	12.09	0.04
EAS-DS	2026-02-14 19:15:00	7.46	68.82	0.30	7.69	11.55	6.94	0.03
EAS-DS	2026-02-14 19:30:00	8.12	98.86	0.29	7.85	11.29	13.38	0.05
EAS-DS	2026-02-14 19:45:00	8.06	98.45	0.29	7.82	11.29	9.03	0.05
EAS-DS	2026-02-14 20:00:00		74.46					0.03
EAS-DS	2026-02-14 20:15:00	6.23	22.26	0.29	7.36	11.83	3.55	0.01
EAS-DS	2026-02-14 20:30:00	7.95	95.68	0.29	7.77	11.35	10.83	0.04
EAS-DS	2026-02-14 20:45:00	7.71	90.14	0.29	7.75	11.49	9.04	0.04
EAS-DS	2026-02-14 21:00:00	7.95	94.60	0.28	7.81	11.32	4.18	0.04
EAS-DS	2026-02-14 21:15:00	7.85	93.74	0.29	7.77	11.39	7.86	0.04
EAS-DS	2026-02-14 21:30:00	7.68	85.27	0.30	7.77	11.45	8.09	0.04
EAS-DS	2026-02-14 21:45:00	7.85	95.57	0.30	7.79	11.36	8.69	0.04
EAS-DS	2026-02-14 22:00:00	7.94	97.71	0.29	7.85	11.32	10.87	0.05
EAS-DS	2026-02-14 22:15:00	6.61	41.28	0.29	7.63	11.63	4.32	0.02
EAS-DS	2026-02-14 22:30:00	7.93	95.06	0.29	7.83	11.33	11.31	0.04
EAS-DS	2026-02-14 22:45:00	7.72	85.48	0.29	7.83	11.37	12.26	0.04
EAS-DS	2026-02-14 23:00:00	7.94	93.72	0.29	7.86	11.33	8.68	0.04
EAS-DS	2026-02-14 23:15:00	7.96	92.97	0.30	7.84	11.35	11.00	0.04
EAS-DS	2026-02-14 23:30:00	7.87	88.98	0.30	7.81	11.31	8.55	0.04
EAS-DS	2026-02-14 23:45:00	7.02	60.03	0.31	7.62	11.70	3.21	0.03
EAS-DS	2026-02-15 00:00:00	7.67	90.32	0.30	7.68	11.50	15.77	0.04
EAS-DS	2026-02-15 00:15:00	7.85	94.14	0.29	7.71	11.40	4.99	0.04
EAS-DS	2026-02-15 00:30:00	7.60	94.12	0.30	7.70	11.51	7.59	0.04
EAS-DS	2026-02-15 00:45:00	7.85	98.23	0.29	7.75	11.34	8.62	0.05
EAS-DS	2026-02-15 01:00:00	7.51	81.02	0.29	7.70	11.38	6.71	0.04
EAS-DS	2026-02-15 01:15:00	7.89	95.38	0.30	7.72	11.34	10.65	0.04
EAS-DS	2026-02-15 01:30:00	6.69	49.85	0.30	7.64	11.57	3.24	0.02
EAS-DS	2026-02-15 01:45:00	6.87	56.84	0.30	7.69	11.50	4.53	0.03
EAS-DS	2026-02-15 02:00:00	7.72	94.49	0.29	7.79	11.40	6.33	0.04
EAS-DS	2026-02-15 02:15:00	6.68	49.44	0.29	7.69	11.57	4.03	0.02
EAS-DS	2026-02-15 02:30:00	7.70	90.06	0.29	7.82	11.35	5.35	0.04
EAS-DS	2026-02-15 02:45:00	7.23	69.85	0.29	7.77	11.43	5.79	0.03
EAS-DS	2026-02-15 03:00:00	7.50	84.64	0.29	7.78	11.49	8.70	0.04
EAS-DS	2026-02-15 03:15:00	7.30	83.81	0.30	7.72	11.67	7.35	0.04
EAS-DS	2026-02-15 03:30:00	7.72	92.81	0.30	7.80	11.41	22.99	0.04
EAS-DS	2026-02-15 03:45:00	6.36	43.19	0.30	7.61	11.71	8.31	0.02
EAS-DS	2026-02-15 04:00:00	7.66	92.52	0.30	7.80	11.43	12.68	0.04
EAS-DS	2026-02-15 04:15:00	7.27	77.12	0.29	7.79	11.44	16.04	0.04
EAS-DS	2026-02-15 04:30:00	7.34	86.25	0.30	7.79	11.51	14.62	0.04
EAS-DS	2026-02-15 04:45:00	7.36	85.30	0.29	7.81	11.50	16.51	0.04
EAS-DS	2026-02-15 05:00:00	7.58	93.85	0.29	7.84	11.45	24.04	0.04
EAS-DS	2026-02-15 05:15:00	7.54	93.03	0.29	7.84	11.44	17.58	0.04
EAS-DS	2026-02-15 05:30:00	6.92	66.54	0.29	7.78	11.49	15.32	0.03
EAS-DS	2026-02-15 05:45:00	7.18	86.55	0.30	7.79	11.68	21.14	0.04
EAS-DS	2026-02-15 06:00:00	7.50	91.63	0.29	7.84	11.48	17.50	0.04
EAS-DS	2026-02-15 06:15:00	7.55	92.55	0.29	7.85	11.47	17.46	0.04
EAS-DS	2026-02-15 06:30:00	7.41	90.70	0.30	7.83	11.55	10.32	0.04
EAS-DS	2026-02-15 06:45:00	7.58	92.43	0.30	7.86	11.43	12.00	0.04
EAS-DS	2026-02-15 07:00:00	6.89	73.44	0.30	7.74	11.66	12.37	0.03

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-15 07:15:00	7.61	92.20	0.30	7.84	11.47	13.61	0.04
EAS-DS	2026-02-15 07:30:00	7.62	91.88	0.30	7.84	11.45	16.83	0.04
EAS-DS	2026-02-15 07:45:00	7.59	93.74	0.31	7.82	11.48	18.74	0.04
EAS-DS	2026-02-15 08:00:00	7.64	94.15	0.29	7.84	11.45	16.06	0.04
EAS-DS	2026-02-15 08:15:00	7.53	93.74	0.30	7.81	11.52	16.51	0.04
EAS-DS	2026-02-15 08:30:00	7.02	75.14	0.30	7.77	11.57	15.24	0.03
EAS-DS	2026-02-15 08:45:00	6.23	42.76	0.29	7.65	11.75	19.32	0.02
EAS-DS	2026-02-15 09:00:00	7.65	92.98	0.29	7.83	11.46	17.98	0.04
EAS-DS	2026-02-15 09:15:00	6.90	68.79	0.30	7.74	11.66	18.21	0.03
EAS-DS	2026-02-15 09:30:00	7.74	92.39	0.30	7.85	11.41	21.48	0.04
EAS-DS	2026-02-15 09:45:00	7.48	83.31	0.30	7.83	11.47	26.39	0.04
EAS-DS	2026-02-15 10:00:00	7.41	77.79	0.29	7.81	11.47	31.18	0.04
EAS-DS	2026-02-15 10:15:00	7.84	92.26	0.30	7.84	11.40	20.99	0.04
EAS-DS	2026-02-15 10:30:00	7.91	92.36	0.30	7.83	11.40	20.24	0.04
EAS-DS	2026-02-15 10:45:00	7.82	87.24	0.29	7.82	11.41	16.63	0.04
EAS-DS	2026-02-15 11:00:00	7.72	85.76	0.30	7.79	11.45	14.33	0.04
EAS-DS	2026-02-15 11:15:00	7.48	67.25	0.29	7.81	11.34	21.76	0.03
EAS-DS	2026-02-15 11:30:00	7.96	92.14	0.30	7.81	11.40	18.88	0.04
EAS-DS	2026-02-15 11:45:00	8.13	92.94	0.30	7.84	11.29	17.50	0.04
EAS-DS	2026-02-15 12:00:00	8.06	90.91	0.30	7.82	11.33	15.54	0.04
EAS-DS	2026-02-15 12:15:00	8.21	91.75	0.29	7.83	11.28	14.32	0.04
EAS-DS	2026-02-15 12:30:00	7.77	81.16	0.30	7.75	11.45	35.39	0.04
EAS-DS	2026-02-15 12:45:00	8.33	94.36	0.29	7.85	11.21	30.47	0.04
EAS-DS	2026-02-15 13:00:00	8.35	92.97	0.29	7.86	11.18	21.73	0.04
EAS-DS	2026-02-15 13:15:00	8.33	92.06	0.29	7.85	11.20	21.61	0.04
EAS-DS	2026-02-15 13:30:00	7.99	74.02	0.29	7.94	11.15	27.66	0.03
EAS-DS	2026-02-15 13:45:00	8.35	103.53	0.30	7.92	11.15	31.69	0.05
EAS-DS	2026-02-15 14:00:00	7.46	70.73	0.30	7.81	11.28	28.40	0.03
EAS-DS	2026-02-15 14:15:00	7.17	71.64	0.30	7.73	11.51	23.53	0.03
EAS-DS	2026-02-15 14:30:00	8.30	159.07	0.30	8.03	11.12	61.81	0.07
EAS-DS	2026-02-15 14:45:00	7.59	113.64	0.30	7.88	11.25	48.02	0.05
EAS-DS	2026-02-15 15:00:00	7.84	156.82	0.31	7.84	11.29	62.67	0.07
EAS-DS	2026-02-15 15:15:00	6.80	64.94	0.31	7.73	11.51	25.20	0.03
EAS-DS	2026-02-15 15:30:00	8.21	160.23	0.31	7.90	11.12	59.51	0.07
EAS-DS	2026-02-15 15:45:00	8.30	155.63	0.31	7.92	11.03	56.14	0.07
EAS-DS	2026-02-15 16:00:00	7.95	151.46	0.30	7.85	11.31	61.56	0.07
EAS-DS	2026-02-15 16:15:00	8.25	147.62	0.30	7.84	11.13	38.92	0.07
EAS-DS	2026-02-15 16:30:00	8.09	131.01	0.31	7.78	11.14	37.80	0.06
EAS-DS	2026-02-15 16:45:00	6.94	59.71	0.31	7.68	11.39	35.10	0.03
EAS-DS	2026-02-15 17:00:00	8.33	129.57	0.31	7.71	11.08	37.54	0.06
EAS-DS	2026-02-15 17:15:00	8.01	112.73	0.31	7.76	11.11	41.71	0.05
EAS-DS	2026-02-15 17:30:00	8.00	111.80	0.31	7.82	11.17	38.75	0.05
EAS-DS	2026-02-15 17:45:00	8.26	125.28	0.31	7.96	11.09	47.06	0.06
EAS-DS	2026-02-15 18:00:00	7.96	137.42	0.31	7.86	11.28	49.90	0.06
EAS-DS	2026-02-15 18:15:00	7.93	117.04	0.31	7.82	11.06	53.03	0.05
EAS-DS	2026-02-15 18:30:00	7.69	143.28	0.25	9.44	11.31	101.98	0.07
EAS-DS	2026-02-15 18:45:00	7.24	153.18	0.21	9.90	11.59	101.02	0.07
EAS-DS	2026-02-15 19:00:00	8.01	209.58	0.23	9.14	11.10	98.77	0.10
EAS-DS	2026-02-15 19:15:00	7.41	167.66	0.24	8.91	11.20	85.08	0.08
EAS-DS	2026-02-15 19:30:00	7.60	215.37	0.28	8.13	11.27	97.73	0.10
EAS-DS	2026-02-15 19:45:00	7.74	211.89	0.29	8.00	11.23	74.21	0.10
EAS-DS	2026-02-15 20:00:00	7.87	196.51	0.29	7.87	11.18	57.21	0.09
EAS-DS	2026-02-15 20:15:00	7.54	151.87	0.29	7.85	11.40	39.79	0.07
EAS-DS	2026-02-15 20:30:00	7.53	130.44	0.29	7.94	11.28	43.44	0.06
EAS-DS	2026-02-15 20:45:00	8.12	157.00	0.30	7.97	11.15	33.52	0.07

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-02-15 21:00:00	7.39	106.05	0.30	7.89	11.39	31.40	0.05
EAS-DS	2026-02-15 21:15:00	7.15	76.02	0.30	7.88	11.31	32.24	0.03
EAS-DS	2026-02-15 21:30:00	7.96	119.02	0.30	7.94	11.05	35.80	0.06
EAS-DS	2026-02-15 21:45:00	7.74	103.47	0.30	7.90	11.12	43.43	0.05
EAS-DS	2026-02-15 22:00:00	6.08	25.81	0.28	7.62	11.66	28.86	0.01
EAS-DS	2026-02-15 22:15:00	8.06	148.69	0.31	7.50	11.15	56.10	0.07
EAS-DS	2026-02-15 22:30:00	8.25	153.73	0.30	7.76	11.02	52.32	0.07
EAS-DS	2026-02-15 22:45:00	7.97	135.79	0.30	7.85	11.11	48.40	0.06
EAS-DS	2026-02-15 23:00:00	7.92	129.07	0.30	7.91	11.13	64.12	0.06
EAS-DS	2026-02-15 23:15:00	7.17	79.14	0.30	7.88	11.27	63.83	0.04
EAS-DS	2026-02-15 23:30:00	7.86	124.00	0.31	7.91	11.17	41.70	0.06
EAS-DS	2026-02-15 23:45:00	7.98	119.40	0.30	7.97	11.03	40.20	0.06
EAS-US	2026-02-09 00:00:00	6.63	16.20	0.40	6.91	11.84	0.00	0.01
EAS-US	2026-02-09 00:15:00	6.62	16.18	0.41	6.93	11.84	0.00	0.01
EAS-US	2026-02-09 00:30:00	6.61	16.17	0.42	6.93	11.84	0.00	0.01
EAS-US	2026-02-09 00:45:00	6.60	16.19	0.39	6.81	11.84	0.00	0.01
EAS-US	2026-02-09 01:00:00	6.60	16.17	0.41	6.81	11.84	0.00	0.01
EAS-US	2026-02-09 01:15:00	6.59	16.17	0.41	6.84	11.86	0.00	0.01
EAS-US	2026-02-09 01:30:00	6.59	16.15	0.42	6.86	11.86	0.00	0.01
EAS-US	2026-02-09 01:45:00	6.58	16.13	0.38	6.91	11.85	0.00	0.01
EAS-US	2026-02-09 02:00:00							
EAS-US	2026-02-09 02:15:00	6.55	16.11	0.39	6.92	11.87	0.00	0.01
EAS-US	2026-02-09 02:30:00	6.54	16.12	0.40	6.92	11.88	0.00	0.01
EAS-US	2026-02-09 02:45:00	6.52	16.09	0.38	6.80	11.89	0.00	0.01
EAS-US	2026-02-09 03:00:00							
EAS-US	2026-02-09 03:15:00	6.51	16.07	0.39	6.83	11.87	0.00	0.01
EAS-US	2026-02-09 03:30:00	6.49	16.06	0.41	6.83	11.89	0.00	0.01
EAS-US	2026-02-09 03:45:00	6.47	16.09	0.37	6.91	11.89	0.00	0.01
EAS-US	2026-02-09 04:00:00							
EAS-US	2026-02-09 04:15:00							
EAS-US	2026-02-09 04:30:00	6.47	16.04	0.39	6.87	11.89	0.00	0.01
EAS-US	2026-02-09 04:45:00	6.46	16.03	0.37	6.82	11.90	0.00	0.01
EAS-US	2026-02-09 05:00:00							
EAS-US	2026-02-09 05:15:00	6.44	16.01	0.39	6.83	11.89	0.00	0.01
EAS-US	2026-02-09 05:30:00	6.43	15.98	0.41	6.80	11.91	0.00	0.01
EAS-US	2026-02-09 05:45:00	6.42	16.04	0.37	6.94	11.91	0.00	0.01
EAS-US	2026-02-09 06:00:00	6.43	16.07	0.40	6.94	11.92	0.00	0.01
EAS-US	2026-02-09 06:15:00	6.43	16.13	0.41	6.93	11.92	0.00	0.01
EAS-US	2026-02-09 06:30:00	6.44	16.17	0.41	6.96	11.92	0.00	0.01
EAS-US	2026-02-09 06:45:00	6.45	16.12	0.39	6.85	11.90	0.00	0.01
EAS-US	2026-02-09 07:00:00	6.44	16.12	0.41	6.85	11.93	0.00	0.01
EAS-US	2026-02-09 07:15:00	6.42	16.26	0.42	6.81	11.93	0.00	0.01
EAS-US	2026-02-09 07:30:00	6.41	16.56	0.42	6.85	11.93	0.00	0.01
EAS-US	2026-02-09 07:45:00	6.40	16.89	0.38	6.95	11.92	0.00	0.01
EAS-US	2026-02-09 08:00:00	6.41	17.56	0.40	6.88	11.95	0.00	0.01
EAS-US	2026-02-09 08:15:00	6.44	18.86	0.41	6.95	11.94	2.88	0.01
EAS-US	2026-02-09 08:30:00	6.45	19.72	0.41	7.02	11.95	3.04	0.01
EAS-US	2026-02-09 08:45:00	6.47	19.46	0.38	6.95	11.93	0.70	0.01
EAS-US	2026-02-09 09:00:00							
EAS-US	2026-02-09 09:15:00	6.52	19.84	0.39	6.96	11.94	2.66	0.01
EAS-US	2026-02-09 09:30:00	6.54	20.68	0.38	6.99	11.92	3.01	0.01
EAS-US	2026-02-09 09:45:00	6.54	21.72	0.36	7.12	11.92	3.31	0.01
EAS-US	2026-02-09 10:00:00	6.54	22.30	0.39	7.04	11.93	3.28	0.01
EAS-US	2026-02-09 10:15:00	6.54	23.16	0.40	7.11	11.93	6.17	0.01
EAS-US	2026-02-09 10:30:00	6.56	24.19	0.40	7.17	11.92	5.01	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-09 10:45:00	6.59	24.93	0.38	7.10	11.91	3.07	0.01
EAS-US	2026-02-09 11:00:00							
EAS-US	2026-02-09 11:15:00	6.66	25.72	0.38	7.13	11.89	4.31	0.01
EAS-US	2026-02-09 11:30:00	6.69	25.94	0.39	7.18	11.90	4.23	0.01
EAS-US	2026-02-09 11:45:00	6.71	25.81	0.36	7.26	11.87	3.43	0.01
EAS-US	2026-02-09 12:00:00	6.72	25.63	0.38	7.24	11.88	4.01	0.01
EAS-US	2026-02-09 12:15:00	6.73	25.57	0.39	7.22	11.88	2.17	0.01
EAS-US	2026-02-09 12:30:00	6.75	25.99	0.40	7.26	11.87	1.72	0.01
EAS-US	2026-02-09 12:45:00	6.78	26.64	0.37	7.20	11.86	4.68	0.01
EAS-US	2026-02-09 13:00:00			0.39	7.19	11.85	4.08	
EAS-US	2026-02-09 13:15:00	6.84	27.73	0.40	7.20	11.83	4.62	0.01
EAS-US	2026-02-09 13:30:00	6.85	28.58	0.40	7.24	11.83	7.14	0.01
EAS-US	2026-02-09 13:45:00	6.88	29.02	0.37	7.32	11.81	4.58	0.01
EAS-US	2026-02-09 14:00:00	6.90	29.39	0.38	7.34	11.82	4.53	0.01
EAS-US	2026-02-09 14:15:00	6.93	29.08	0.39	7.29	11.82	4.04	0.01
EAS-US	2026-02-09 14:30:00	6.94	28.77	0.40	7.27	11.80	6.44	0.01
EAS-US	2026-02-09 14:45:00	6.96	28.35	0.38	7.19	11.80	7.33	0.01
EAS-US	2026-02-09 15:00:00	6.97	27.65	0.39	7.23	11.80	3.03	0.01
EAS-US	2026-02-09 15:15:00	6.97	26.99	0.40	7.17	11.77	1.46	0.01
EAS-US	2026-02-09 15:30:00	6.96	26.21	0.40	7.14	11.79	1.43	0.01
EAS-US	2026-02-09 15:45:00	6.96	25.33	0.37	7.20	11.78	1.87	0.01
EAS-US	2026-02-09 16:00:00	6.96	24.50	0.39	7.18	11.79	1.78	0.01
EAS-US	2026-02-09 16:15:00	6.96	23.78	0.40	7.16	11.78	0.28	0.01
EAS-US	2026-02-09 16:30:00	6.95	23.25	0.40	7.19	11.77	0.00	0.01
EAS-US	2026-02-09 16:45:00	6.94	22.71	0.38	7.08	11.78	1.29	0.01
EAS-US	2026-02-09 17:00:00							
EAS-US	2026-02-09 17:15:00	6.92	21.82	0.38	7.05	11.78	0.20	0.01
EAS-US	2026-02-09 17:30:00	6.91	21.65	0.39	7.07	11.77	0.00	0.01
EAS-US	2026-02-09 17:45:00	6.90	21.68	0.37	7.10	11.78	0.00	0.01
EAS-US	2026-02-09 18:00:00							
EAS-US	2026-02-09 18:15:00	6.89	21.78	0.38	7.10	11.79	0.94	0.01
EAS-US	2026-02-09 18:30:00	6.88	22.32	0.39	7.13	11.79	3.47	0.01
EAS-US	2026-02-09 18:45:00	6.87	24.05	0.37	7.09	11.78	1.06	0.01
EAS-US	2026-02-09 19:00:00	6.84	25.96	0.39	7.17	11.81	4.83	0.01
EAS-US	2026-02-09 19:15:00	6.82	27.50	0.40	7.19	11.80	7.65	0.01
EAS-US	2026-02-09 19:30:00	6.80	30.06	0.40	7.21	11.80	8.29	0.01
EAS-US	2026-02-09 19:45:00	6.78	32.08	0.37	7.31	11.82	5.70	0.01
EAS-US	2026-02-09 20:00:00							
EAS-US	2026-02-09 20:15:00	6.74	33.53	0.37	7.33	11.82	5.40	0.01
EAS-US	2026-02-09 20:30:00	6.74	33.15	0.38	7.34	11.81	3.79	0.01
EAS-US	2026-02-09 20:45:00	6.73	33.45	0.37	7.28	11.83	3.03	0.01
EAS-US	2026-02-09 21:00:00	6.74	32.30	0.38	7.30	11.82	2.61	0.01
EAS-US	2026-02-09 21:15:00	6.74	31.27	0.39	7.27	11.81	1.49	0.01
EAS-US	2026-02-09 21:30:00	6.75	30.62	0.40	7.26	11.82	0.96	0.01
EAS-US	2026-02-09 21:45:00	6.76	29.84	0.37	7.27	11.81	0.88	0.01
EAS-US	2026-02-09 22:00:00	6.76	28.84	0.38	7.29	11.82	1.19	0.01
EAS-US	2026-02-09 22:15:00	6.77	27.75	0.39	7.27	11.81	0.00	0.01
EAS-US	2026-02-09 22:30:00	6.76	26.50	0.40	7.26	11.81	1.25	0.01
EAS-US	2026-02-09 22:45:00	6.76	25.67	0.37	7.18	11.81	0.07	0.01
EAS-US	2026-02-09 23:00:00	6.77	24.96	0.39	7.14	11.81	0.00	0.01
EAS-US	2026-02-09 23:15:00	6.78	24.18	0.40	7.12	11.80	0.00	0.01
EAS-US	2026-02-09 23:30:00	6.80	23.67	0.41	7.09	11.81	0.00	0.01
EAS-US	2026-02-09 23:45:00	6.81	23.06	0.37	7.06	11.80	2.87	0.01
EAS-US	2026-02-10 00:00:00							
EAS-US	2026-02-10 00:15:00	6.82	22.12	0.38	7.10	11.78	0.05	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-10 00:30:00	6.83	21.68	0.39	7.12	11.79	0.60	0.01
EAS-US	2026-02-10 00:45:00	6.83	21.27	0.37	7.02	11.79	0.00	0.01
EAS-US	2026-02-10 01:00:00							
EAS-US	2026-02-10 01:15:00	6.86	20.94	0.38	7.02	11.77	0.00	0.01
EAS-US	2026-02-10 01:30:00	6.87	21.02	0.40	6.97	11.76	0.00	0.01
EAS-US	2026-02-10 01:45:00	6.90	20.77	0.36	7.09	11.76	0.00	0.01
EAS-US	2026-02-10 02:00:00							
EAS-US	2026-02-10 02:15:00	6.89	21.29	0.38	7.06	11.76	0.00	0.01
EAS-US	2026-02-10 02:30:00	6.88	22.14	0.39	7.13	11.76	3.52	0.01
EAS-US	2026-02-10 02:45:00	6.88	23.68	0.37	7.09	11.78	1.16	0.01
EAS-US	2026-02-10 03:00:00	6.85	24.61	0.39	7.09	11.79	1.49	0.01
EAS-US	2026-02-10 03:15:00	6.84	25.88	0.40	7.09	11.78	3.98	0.01
EAS-US	2026-02-10 03:30:00	6.82	27.06	0.40	7.16	11.79	0.46	0.01
EAS-US	2026-02-10 03:45:00	6.81	27.44	0.37	7.19	11.78	0.00	0.01
EAS-US	2026-02-10 04:00:00							
EAS-US	2026-02-10 04:15:00	6.81	26.12	0.37	7.24	11.78	0.77	0.01
EAS-US	2026-02-10 04:30:00	6.82	25.10	0.39	7.21	11.78	0.00	0.01
EAS-US	2026-02-10 04:45:00	6.82	24.59	0.37	7.11	11.78	0.00	0.01
EAS-US	2026-02-10 05:00:00	6.85	23.85	0.39	7.12	11.77	0.00	0.01
EAS-US	2026-02-10 05:15:00	6.86	23.45	0.40	7.06	11.76	0.77	0.01
EAS-US	2026-02-10 05:30:00	6.88	23.10	0.40	7.10	11.76	1.08	0.01
EAS-US	2026-02-10 05:45:00	6.88	22.81	0.37	7.14	11.76	2.58	0.01
EAS-US	2026-02-10 06:00:00							
EAS-US	2026-02-10 06:15:00	6.89	22.43	0.38	7.12	11.76	0.00	0.01
EAS-US	2026-02-10 06:30:00	6.89	22.04	0.39	7.10	11.75	0.47	0.01
EAS-US	2026-02-10 06:45:00	6.88	21.63	0.37	7.04	11.75	0.00	0.01
EAS-US	2026-02-10 07:00:00	6.87	21.24	0.39	7.00	11.75	0.00	0.01
EAS-US	2026-02-10 07:15:00	6.88	20.89	0.40	6.98	11.75	0.45	0.01
EAS-US	2026-02-10 07:30:00	6.86	20.59	0.41	6.98	11.77	0.00	0.01
EAS-US	2026-02-10 07:45:00	6.87	20.28	0.37	7.08	11.75	0.00	0.01
EAS-US	2026-02-10 08:00:00	6.87	19.94	0.39	7.00	11.76	0.00	0.01
EAS-US	2026-02-10 08:15:00	6.86	19.69	0.40	7.07	11.77	0.28	0.01
EAS-US	2026-02-10 08:30:00	6.87	19.40	0.41	7.04	11.78	0.00	0.01
EAS-US	2026-02-10 08:45:00	6.87	19.18	0.38	6.97	11.77	0.00	0.01
EAS-US	2026-02-10 09:00:00							
EAS-US	2026-02-10 09:15:00	6.89	18.71	0.39	6.90	11.77	0.00	0.01
EAS-US	2026-02-10 09:30:00	6.93	18.50	0.40	6.93	11.79	0.00	0.01
EAS-US	2026-02-10 09:45:00	6.95	18.29	0.37	7.02	11.75	0.00	0.01
EAS-US	2026-02-10 10:00:00	7.00	18.08	0.39	6.98	11.77	0.00	0.01
EAS-US	2026-02-10 10:15:00	7.00	17.93	0.40	6.99	11.75	0.00	0.01
EAS-US	2026-02-10 10:30:00	7.03	17.75	0.41	6.99	11.74	0.00	0.01
EAS-US	2026-02-10 10:45:00	7.06	17.62	0.38	6.89	11.72	0.00	0.01
EAS-US	2026-02-10 11:00:00	7.14	17.47	0.40	6.89	11.71	0.00	0.01
EAS-US	2026-02-10 11:15:00	7.21	17.36	0.40	6.92	11.69	0.00	0.01
EAS-US	2026-02-10 11:30:00	7.21	17.21	0.41	6.87	11.67	0.00	0.01
EAS-US	2026-02-10 11:45:00	7.21	17.10	0.36	6.96	11.68	0.00	0.01
EAS-US	2026-02-10 12:00:00	7.22	16.99	0.39	6.96	11.66	0.00	0.01
EAS-US	2026-02-10 12:15:00	7.25	16.93	0.40	6.94	11.67	0.00	0.01
EAS-US	2026-02-10 12:30:00	7.26	16.84	0.41	6.94	11.65	0.00	0.01
EAS-US	2026-02-10 12:45:00	7.26	16.79	0.37	6.87	11.64	0.00	0.01
EAS-US	2026-02-10 13:00:00	7.27	16.72	0.40	6.85	11.65	0.00	0.01
EAS-US	2026-02-10 13:15:00	7.29	16.70	0.41	6.87	11.66	0.00	0.01
EAS-US	2026-02-10 13:30:00	7.32	16.68	0.41	6.85	11.63	0.00	0.01
EAS-US	2026-02-10 13:45:00	7.34	16.61	0.36	6.95	11.62	0.00	0.01
EAS-US	2026-02-10 14:00:00	7.42	16.56	0.39	6.94	11.59	0.00	0.01

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-10 14:15:00	7.44	16.53	0.40	6.93	11.59	0.00	0.01
EAS-US	2026-02-10 14:30:00	7.48	16.52	0.41	6.96	11.58	0.16	0.01
EAS-US	2026-02-10 14:45:00	7.53	16.46	0.37	6.85	11.55	0.00	0.01
EAS-US	2026-02-10 15:00:00	7.56	16.41	0.40	6.85	11.54	0.00	0.01
EAS-US	2026-02-10 15:15:00	7.60	16.37	0.40	6.88	11.53	0.00	0.01
EAS-US	2026-02-10 15:30:00	7.61	16.32	0.41	6.86	11.54	0.00	0.01
EAS-US	2026-02-10 15:45:00	7.57	16.30	0.36	6.96	11.54	0.00	0.01
EAS-US	2026-02-10 16:00:00	7.56	16.29	0.39	6.96	11.55	0.11	0.01
EAS-US	2026-02-10 16:15:00	7.55	16.26	0.40	6.96	11.53	0.00	0.01
EAS-US	2026-02-10 16:30:00	7.53	16.24	0.41	6.95	11.55	0.20	0.01
EAS-US	2026-02-10 16:45:00	7.50	16.22	0.37	6.85	11.56	0.00	0.01
EAS-US	2026-02-10 17:00:00	7.46	16.24	0.39	6.87	11.56	0.00	0.01
EAS-US	2026-02-10 17:15:00	7.42	16.21	0.41	6.85	11.58	10.64	0.01
EAS-US	2026-02-10 17:30:00	7.37	16.26	0.41	6.83	11.60	0.00	0.01
EAS-US	2026-02-10 17:45:00	7.32	16.25	0.36	6.95	11.61	0.00	0.01
EAS-US	2026-02-10 18:00:00	7.27	16.22	0.39	6.96	11.64	0.00	0.01
EAS-US	2026-02-10 18:15:00	7.23	16.22	0.40	6.92	11.63	0.78	0.01
EAS-US	2026-02-10 18:30:00	7.19	16.24	0.41	6.96	11.64	0.00	0.01
EAS-US	2026-02-10 18:45:00	7.15	16.23	0.37	6.86	11.67	0.00	0.01
EAS-US	2026-02-10 19:00:00	7.11	16.22	0.40	6.86	11.69	0.00	0.01
EAS-US	2026-02-10 19:15:00	7.07	16.21	0.41	6.84	11.69	2.51	0.01
EAS-US	2026-02-10 19:30:00	7.03	16.22	0.41	6.84	11.71	0.00	0.01
EAS-US	2026-02-10 19:45:00	6.99	16.22	0.37	6.83	11.70	0.00	0.01
EAS-US	2026-02-10 20:00:00	6.95	16.20	0.39	6.95	11.72	0.00	0.01
EAS-US	2026-02-10 20:15:00	6.93	16.21	0.41	6.90	11.73	0.00	0.01
EAS-US	2026-02-10 20:30:00	6.89	16.16	0.41	6.93	11.75	0.00	0.01
EAS-US	2026-02-10 20:45:00	6.83	16.18	0.37	6.86	11.75	0.00	0.01
EAS-US	2026-02-10 21:00:00	6.82	16.16	0.40	6.83	11.76	0.00	0.01
EAS-US	2026-02-10 21:15:00	6.81	16.16	0.41	6.84	11.77	0.00	0.01
EAS-US	2026-02-10 21:30:00	6.79	16.14	0.41	6.84	11.79	0.00	0.01
EAS-US	2026-02-10 21:45:00	6.76	16.13	0.37	6.93	11.77	0.00	0.01
EAS-US	2026-02-10 22:00:00	6.73	16.13	0.40	6.87	11.80	0.00	0.01
EAS-US	2026-02-10 22:15:00	6.71	16.13	0.41	6.89	11.79	0.18	0.01
EAS-US	2026-02-10 22:30:00	6.69	16.10	0.41	6.88	11.82	0.00	0.01
EAS-US	2026-02-10 22:45:00	6.65	16.08	0.37	6.85	11.82	0.00	0.01
EAS-US	2026-02-10 23:00:00							
EAS-US	2026-02-10 23:15:00	6.61	16.05	0.39	6.81	11.84	0.00	0.01
EAS-US	2026-02-10 23:30:00	6.59	16.04	0.40	6.81	11.84	0.00	0.01
EAS-US	2026-02-10 23:45:00	6.57	16.03	0.36	6.97	11.84	0.00	0.01
EAS-US	2026-02-11 00:00:00	6.56	16.01	0.39	6.89	11.87	0.00	0.01
EAS-US	2026-02-11 00:15:00	6.53	16.02	0.40	6.89	11.87	1.63	0.01
EAS-US	2026-02-11 00:30:00	6.51	15.99	0.41	6.93	11.88	0.00	0.01
EAS-US	2026-02-11 00:45:00	6.50	15.98	0.37	6.85	11.87	0.00	0.01
EAS-US	2026-02-11 01:00:00			0.40	6.83	11.88	0.00	
EAS-US	2026-02-11 01:15:00	6.47	15.97	0.41	6.84	11.86	0.00	0.01
EAS-US	2026-02-11 01:30:00	6.44	15.98	0.42	6.81	11.90	0.00	0.01
EAS-US	2026-02-11 01:45:00	6.42	15.94	0.38	6.79	11.89	0.00	0.01
EAS-US	2026-02-11 02:00:00							
EAS-US	2026-02-11 02:15:00							
EAS-US	2026-02-11 02:30:00	6.35	15.92	0.39	6.87	11.92	0.00	0.01
EAS-US	2026-02-11 02:45:00	6.33	15.90	0.37	6.80	11.93	0.00	0.01
EAS-US	2026-02-11 03:00:00							
EAS-US	2026-02-11 03:15:00	6.29	15.90	0.39	6.83	11.93	0.00	0.01
EAS-US	2026-02-11 03:30:00	6.27	15.89	0.40	6.83	11.93	0.00	0.01
EAS-US	2026-02-11 03:45:00	6.26	15.88	0.37	6.82	11.95	0.00	0.01

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-11 04:00:00							
EAS-US	2026-02-11 04:15:00	6.20	15.86	0.38	6.90	11.96	0.00	0.01
EAS-US	2026-02-11 04:30:00	6.17	15.84	0.40	6.93	11.97	0.00	0.01
EAS-US	2026-02-11 04:45:00	6.16	15.84	0.37	6.82	11.97	0.00	0.01
EAS-US	2026-02-11 05:00:00	6.15	15.80	0.40	6.81	11.98	0.00	0.01
EAS-US	2026-02-11 05:15:00	6.13	15.80	0.41	6.83	11.99	0.00	0.01
EAS-US	2026-02-11 05:30:00	6.14	15.80	0.41	6.83	11.98	0.00	0.01
EAS-US	2026-02-11 05:45:00	6.13	15.77	0.37	6.90	11.98	0.00	0.01
EAS-US	2026-02-11 06:00:00							
EAS-US	2026-02-11 06:15:00							
EAS-US	2026-02-11 06:30:00	6.08	15.78	0.38	6.86	12.01	0.00	0.01
EAS-US	2026-02-11 06:45:00	6.07	15.78	0.37	6.80	12.02	0.00	0.01
EAS-US	2026-02-11 07:00:00			0.39	6.85	12.01	0.00	
EAS-US	2026-02-11 07:15:00	6.01	15.77	0.41	6.77	12.02	0.00	0.01
EAS-US	2026-02-11 07:30:00	6.00	15.74	0.41	6.81	12.04	0.00	0.01
EAS-US	2026-02-11 07:45:00	6.00	15.74	0.37	6.89	12.04	0.00	0.01
EAS-US	2026-02-11 08:00:00	6.00	15.79	0.40	6.86	12.03	0.15	0.01
EAS-US	2026-02-11 08:15:00	6.00	15.70	0.41	6.87	12.05	0.00	0.01
EAS-US	2026-02-11 08:30:00	6.01	15.67	0.41	6.92	12.04	0.00	0.01
EAS-US	2026-02-11 08:45:00	6.02	15.69	0.38	6.85	12.05	0.00	0.01
EAS-US	2026-02-11 09:00:00							
EAS-US	2026-02-11 09:15:00							
EAS-US	2026-02-11 09:30:00	6.13	15.69	0.38	6.83	12.03	0.00	0.01
EAS-US	2026-02-11 09:45:00	6.16	15.69	0.36	6.87	12.02	0.00	0.01
EAS-US	2026-02-11 10:00:00							
EAS-US	2026-02-11 10:15:00	6.23	15.71	0.38	6.91	11.99	0.00	0.01
EAS-US	2026-02-11 10:30:00	6.32	15.74	0.40	6.94	11.97	0.00	0.01
EAS-US	2026-02-11 10:45:00	6.35	15.73	0.37	6.87	11.95	0.00	0.01
EAS-US	2026-02-11 11:00:00	6.39	15.70	0.40	6.85	11.95	0.00	0.01
EAS-US	2026-02-11 11:15:00	6.44	15.72	0.40	6.87	11.94	0.00	0.01
EAS-US	2026-02-11 11:30:00	6.48	15.70	0.41	6.84	11.92	0.00	0.01
EAS-US	2026-02-11 11:45:00	6.55	15.68	0.37	6.88	11.91	0.00	0.01
EAS-US	2026-02-11 12:00:00	6.59	15.65	0.39	6.90	11.88	0.00	0.01
EAS-US	2026-02-11 12:15:00	6.66	15.61	0.40	6.91	11.88	0.00	0.01
EAS-US	2026-02-11 12:30:00	6.71	15.57	0.41	6.94	11.86	0.00	0.01
EAS-US	2026-02-11 12:45:00	6.75	15.56	0.37	6.84	11.84	0.00	0.01
EAS-US	2026-02-11 13:00:00	6.78	15.57	0.40	6.85	11.82	0.00	0.01
EAS-US	2026-02-11 13:15:00	6.82	15.54	0.40	6.86	11.82	0.00	0.01
EAS-US	2026-02-11 13:30:00	6.86	15.50	0.41	6.84	11.80	0.00	0.01
EAS-US	2026-02-11 13:45:00	6.90	15.50	0.36	6.94	11.78	0.00	0.01
EAS-US	2026-02-11 14:00:00	6.93	15.49	0.39	6.89	11.77	0.00	0.01
EAS-US	2026-02-11 14:15:00	6.97	15.50	0.40	6.94	11.74	0.00	0.01
EAS-US	2026-02-11 14:30:00	7.00	15.50	0.41	6.92	11.74	0.00	0.01
EAS-US	2026-02-11 14:45:00	7.01	15.46	0.37	6.87	11.73	0.00	0.01
EAS-US	2026-02-11 15:00:00	7.05	15.48	0.39	6.86	11.72	0.00	0.01
EAS-US	2026-02-11 15:15:00	7.07	15.46	0.41	6.81	11.72	0.00	0.01
EAS-US	2026-02-11 15:30:00	7.10	15.44	0.41	6.84	11.71	0.00	0.01
EAS-US	2026-02-11 15:45:00	7.07	15.45	0.36	6.88	11.69	1.10	0.01
EAS-US	2026-02-11 16:00:00	7.05	15.45	0.39	6.94	11.72	0.00	0.01
EAS-US	2026-02-11 16:15:00	7.03	15.45	0.40	6.93	11.72	0.00	0.01
EAS-US	2026-02-11 16:30:00	7.02	15.44	0.41	6.95	11.72	0.00	0.01
EAS-US	2026-02-11 16:45:00	7.00	15.44	0.37	6.84	11.72	0.00	0.01
EAS-US	2026-02-11 17:00:00	6.99	15.46	0.40	6.82	11.71	0.00	0.01
EAS-US	2026-02-11 17:15:00	6.96	15.51	0.41	6.81	11.74	0.00	0.01
EAS-US	2026-02-11 17:30:00	6.92	15.51	0.41	6.85	11.75	0.00	0.01

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-11 17:45:00	6.88	15.52	0.37	6.92	11.76	0.00	0.01
EAS-US	2026-02-11 18:00:00			0.40	6.90	11.77	0.00	
EAS-US	2026-02-11 18:15:00	6.81	15.58	0.41	6.87	11.77	0.00	0.01
EAS-US	2026-02-11 18:30:00	6.78	15.59	0.41	6.92	11.79	0.00	0.01
EAS-US	2026-02-11 18:45:00	6.74	15.60	0.38	6.83	11.79	1.34	0.01
EAS-US	2026-02-11 19:00:00	6.70	15.61	0.40	6.83	11.81	0.00	0.01
EAS-US	2026-02-11 19:15:00	6.67	15.62	0.41	6.82	11.82	0.00	0.01
EAS-US	2026-02-11 19:30:00	6.64	15.64	0.42	6.83	11.83	0.00	0.01
EAS-US	2026-02-11 19:45:00	6.60	15.67	0.37	6.91	11.83	0.00	0.01
EAS-US	2026-02-11 20:00:00	6.59	15.66	0.40	6.91	11.85	0.00	0.01
EAS-US	2026-02-11 20:15:00	6.55	15.67	0.41	6.89	11.86	1.01	0.01
EAS-US	2026-02-11 20:30:00	6.52	15.67	0.41	6.92	11.86	0.00	0.01
EAS-US	2026-02-11 20:45:00	6.50	15.70	0.39	6.82	11.87	0.00	0.01
EAS-US	2026-02-11 21:00:00	6.47	15.69	0.41	6.80	11.89	0.00	0.01
EAS-US	2026-02-11 21:15:00	6.45	15.69	0.41	6.83	11.90	0.00	0.01
EAS-US	2026-02-11 21:30:00	6.42	15.70	0.42	6.81	11.91	0.00	0.01
EAS-US	2026-02-11 21:45:00	6.41	15.70	0.38	6.92	11.90	0.00	0.01
EAS-US	2026-02-11 22:00:00	6.38	15.68	0.40	6.91	11.92	0.00	0.01
EAS-US	2026-02-11 22:15:00	6.35	15.72	0.41	6.89	11.93	0.00	0.01
EAS-US	2026-02-11 22:30:00	6.32	15.73	0.41	6.95	11.93	0.00	0.01
EAS-US	2026-02-11 22:45:00	6.30	15.75	0.39	6.79	11.94	0.00	0.01
EAS-US	2026-02-11 23:00:00	6.28	15.71	0.40	6.86	11.94	0.00	0.01
EAS-US	2026-02-11 23:15:00	6.28	15.69	0.41	6.83	11.96	0.00	0.01
EAS-US	2026-02-11 23:30:00	6.27	15.71	0.42	6.81	11.95	0.00	0.01
EAS-US	2026-02-11 23:45:00	6.26	15.73	0.37	6.90	11.96	0.00	0.01
EAS-US	2026-02-12 00:00:00	6.25	15.74	0.40	6.86	11.97	0.00	0.01
EAS-US	2026-02-12 00:15:00	6.23	15.72	0.41	6.93	11.98	0.00	0.01
EAS-US	2026-02-12 00:30:00	6.21	15.73	0.41	6.95	11.97	0.00	0.01
EAS-US	2026-02-12 00:45:00	6.19	15.71	0.38	6.86	11.97	0.00	0.01
EAS-US	2026-02-12 01:00:00	6.18	15.72	0.41	6.82	11.99	0.00	0.01
EAS-US	2026-02-12 01:15:00	6.17	15.71	0.41	6.82	12.00	0.00	0.01
EAS-US	2026-02-12 01:30:00	6.16	15.72	0.42	6.84	11.99	0.00	0.01
EAS-US	2026-02-12 01:45:00	6.16	15.74	0.38	6.90	11.99	0.00	0.01
EAS-US	2026-02-12 02:00:00	6.16	15.73	0.40	6.92	12.00	0.00	0.01
EAS-US	2026-02-12 02:15:00	6.16	15.73	0.41	6.90	12.01	0.00	0.01
EAS-US	2026-02-12 02:30:00	6.16	15.72	0.41	6.94	11.99	0.00	0.01
EAS-US	2026-02-12 02:45:00	6.16	15.69	0.39	6.83	11.99	0.00	0.01
EAS-US	2026-02-12 03:00:00	6.15	15.72	0.41	6.84	12.01	0.00	0.01
EAS-US	2026-02-12 03:15:00	6.14	15.74	0.42	6.82	12.01	0.00	0.01
EAS-US	2026-02-12 03:30:00	6.11	15.73	0.42	6.81	12.01	0.00	0.01
EAS-US	2026-02-12 03:45:00	6.09	15.72	0.38	6.93	12.01	0.00	0.01
EAS-US	2026-02-12 04:00:00							
EAS-US	2026-02-12 04:15:00							
EAS-US	2026-02-12 04:30:00	6.06	15.71	0.38	6.91	12.03	0.00	0.01
EAS-US	2026-02-12 04:45:00	6.06	15.73	0.37	6.84	12.03	0.00	0.01
EAS-US	2026-02-12 05:00:00	6.05	15.71	0.40	6.82	12.03	0.00	0.01
EAS-US	2026-02-12 05:15:00	6.05	15.73	0.41	6.86	12.05	0.00	0.01
EAS-US	2026-02-12 05:30:00	6.05	15.74	0.42	6.81	12.02	0.00	0.01
EAS-US	2026-02-12 05:45:00	6.06	15.72	0.38	6.92	12.03	0.00	0.01
EAS-US	2026-02-12 06:00:00	6.07	15.73	0.40	6.92	12.03	0.00	0.01
EAS-US	2026-02-12 06:15:00	6.07	15.72	0.41	6.92	12.03	0.00	0.01
EAS-US	2026-02-12 06:30:00	6.07	15.73	0.41	6.93	12.03	0.00	0.01
EAS-US	2026-02-12 06:45:00	6.08	15.73	0.39	6.81	12.02	0.00	0.01
EAS-US	2026-02-12 07:00:00							
EAS-US	2026-02-12 07:15:00	6.07	15.71	0.39	6.83	12.02	0.00	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-12 07:30:00	6.07	15.71	0.40	6.84	12.03	0.00	0.01
EAS-US	2026-02-12 07:45:00	6.09	15.71	0.37	6.90	12.02	0.00	0.01
EAS-US	2026-02-12 08:00:00							
EAS-US	2026-02-12 08:15:00	6.09	15.69	0.39	6.93	12.02	0.00	0.01
EAS-US	2026-02-12 08:30:00	6.09	15.68	0.40	6.95	12.04	0.00	0.01
EAS-US	2026-02-12 08:45:00	6.09	15.71	0.38	6.85	12.03	0.00	0.01
EAS-US	2026-02-12 09:00:00							
EAS-US	2026-02-12 09:15:00	6.12	15.72	0.39	6.85	12.04	0.00	0.01
EAS-US	2026-02-12 09:30:00	6.15	15.72	0.40	6.82	12.02	0.00	0.01
EAS-US	2026-02-12 09:45:00	6.18	15.72	0.37	6.92	12.02	0.00	0.01
EAS-US	2026-02-12 10:00:00							
EAS-US	2026-02-12 10:15:00	6.23	15.76	0.38	6.93	12.00	0.00	0.01
EAS-US	2026-02-12 10:30:00	6.25	15.75	0.40	6.94	12.00	0.00	0.01
EAS-US	2026-02-12 10:45:00	6.26	15.71	0.38	6.85	12.01	0.00	0.01
EAS-US	2026-02-12 11:00:00	6.28	15.70	0.40	6.86	12.01	0.00	0.01
EAS-US	2026-02-12 11:15:00	6.30	15.69	0.41	6.85	12.00	0.00	0.01
EAS-US	2026-02-12 11:30:00	6.32	15.68	0.42	6.84	11.99	0.00	0.01
EAS-US	2026-02-12 11:45:00	6.35	15.72	0.37	6.93	11.97	3.29	0.01
EAS-US	2026-02-12 12:00:00	6.40	15.71	0.39	6.97	11.97	0.00	0.01
EAS-US	2026-02-12 12:15:00	6.43	15.73	0.40	6.97	11.96	0.00	0.01
EAS-US	2026-02-12 12:30:00	6.49	15.69	0.41	6.97	11.94	0.00	0.01
EAS-US	2026-02-12 12:45:00	6.49	15.68	0.38	6.86	11.94	0.00	0.01
EAS-US	2026-02-12 13:00:00	6.52	15.68	0.40	6.89	11.92	0.00	0.01
EAS-US	2026-02-12 13:15:00	6.54	15.69	0.41	6.86	11.92	0.00	0.01
EAS-US	2026-02-12 13:30:00	6.57	15.71	0.42	6.82	11.89	0.00	0.01
EAS-US	2026-02-12 13:45:00	6.59	15.68	0.37	6.96	11.90	0.00	0.01
EAS-US	2026-02-12 14:00:00			0.40	6.95	11.90	0.00	
EAS-US	2026-02-12 14:15:00	6.57	15.69	0.41	6.93	11.89	0.00	0.01
EAS-US	2026-02-12 14:30:00	6.58	15.65	0.41	6.97	11.89	0.00	0.01
EAS-US	2026-02-12 14:45:00	6.60	15.67	0.38	6.85	11.87	0.00	0.01
EAS-US	2026-02-12 15:00:00	6.61	15.65	0.40	6.88	11.89	0.00	0.01
EAS-US	2026-02-12 15:15:00	6.62	15.66	0.41	6.85	11.88	0.00	0.01
EAS-US	2026-02-12 15:30:00	6.62	15.99	0.41	6.84	11.86	0.00	0.01
EAS-US	2026-02-12 15:45:00	6.63	15.68	0.36	6.93	11.85	0.00	0.01
EAS-US	2026-02-12 16:00:00	6.64	15.71	0.39	6.94	11.84	0.00	0.01
EAS-US	2026-02-12 16:15:00	6.65	15.66	0.40	6.95	11.84	0.00	0.01
EAS-US	2026-02-12 16:30:00	6.66	15.68	0.41	6.93	11.86	0.31	0.01
EAS-US	2026-02-12 16:45:00	6.67	15.67	0.38	6.84	11.85	0.00	0.01
EAS-US	2026-02-12 17:00:00	6.66	15.67	0.40	6.84	11.84	0.00	0.01
EAS-US	2026-02-12 17:15:00	6.65	15.68	0.41	6.84	11.83	0.00	0.01
EAS-US	2026-02-12 17:30:00	6.65	15.69	0.42	6.82	11.84	0.00	0.01
EAS-US	2026-02-12 17:45:00	6.64	15.73	0.37	6.95	11.84	0.00	0.01
EAS-US	2026-02-12 18:00:00	6.63	15.76	0.40	6.92	11.84	0.00	0.01
EAS-US	2026-02-12 18:15:00	6.63	15.77	0.40	6.95	11.84	0.00	0.01
EAS-US	2026-02-12 18:30:00	6.63	15.78	0.41	6.94	11.84	0.00	0.01
EAS-US	2026-02-12 18:45:00	6.63	15.77	0.38	6.84	11.83	0.00	0.01
EAS-US	2026-02-12 19:00:00							
EAS-US	2026-02-12 19:15:00	6.62	15.73	0.39	6.81	11.84	0.00	0.01
EAS-US	2026-02-12 19:30:00	6.63	15.73	0.40	6.83	11.84	0.00	0.01
EAS-US	2026-02-12 19:45:00	6.63	15.76	0.37	6.94	11.83	0.00	0.01
EAS-US	2026-02-12 20:00:00	6.63	15.77	0.39	6.93	11.84	0.00	0.01
EAS-US	2026-02-12 20:15:00	6.62	15.81	0.40	6.93	11.84	0.00	0.01
EAS-US	2026-02-12 20:30:00	6.62	15.78	0.41	6.91	11.84	0.00	0.01
EAS-US	2026-02-12 20:45:00	6.62	15.77	0.38	6.84	11.85	0.00	0.01
EAS-US	2026-02-12 21:00:00							

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-12 21:15:00							
EAS-US	2026-02-12 21:30:00	6.62	15.80	0.39	6.87	11.84	0.00	0.01
EAS-US	2026-02-12 21:45:00	6.62	15.79	0.36	6.92	11.84	0.00	0.01
EAS-US	2026-02-12 22:00:00							
EAS-US	2026-02-12 22:15:00	6.61	15.85	0.38	6.93	11.84	0.00	0.01
EAS-US	2026-02-12 22:30:00	6.62	15.82	0.40	6.96	11.82	0.00	0.01
EAS-US	2026-02-12 22:45:00	6.62	15.82	0.38	6.85	11.83	0.00	0.01
EAS-US	2026-02-12 23:00:00	6.62	15.81	0.40	6.86	11.83	0.00	0.01
EAS-US	2026-02-12 23:15:00	6.62	15.83	0.41	6.87	11.82	0.00	0.01
EAS-US	2026-02-12 23:30:00	6.62	15.82	0.42	6.86	11.82	0.00	0.01
EAS-US	2026-02-12 23:45:00	6.62	15.81	0.37	6.93	11.82	0.00	0.01
EAS-US	2026-02-13 00:00:00	6.63	15.87	0.40	6.94	11.81	0.00	0.01
EAS-US	2026-02-13 00:15:00	6.62	15.98	0.41	6.94	11.81	0.00	0.01
EAS-US	2026-02-13 00:30:00	6.63	16.06	0.41	6.97	11.82	0.00	0.01
EAS-US	2026-02-13 00:45:00	6.63	16.10	0.38	6.82	11.82	0.00	0.01
EAS-US	2026-02-13 01:00:00	6.63	16.09	0.40	6.87	11.81	0.00	0.01
EAS-US	2026-02-13 01:15:00	6.62	16.19	0.41	6.86	11.82	0.00	0.01
EAS-US	2026-02-13 01:30:00	6.62	16.29	0.42	6.85	11.82	0.00	0.01
EAS-US	2026-02-13 01:45:00	6.62	16.58	0.37	6.96	11.82	0.00	0.01
EAS-US	2026-02-13 02:00:00	6.61	17.40	0.40	6.93	11.83	0.00	0.01
EAS-US	2026-02-13 02:15:00	6.61	17.57	0.41	7.00	11.82	0.00	0.01
EAS-US	2026-02-13 02:30:00	6.60	18.11	0.41	7.03	11.82	0.00	0.01
EAS-US	2026-02-13 02:45:00	6.58	19.46	0.38	6.98	11.82	0.15	0.01
EAS-US	2026-02-13 03:00:00	6.56	20.43	0.40	7.02	11.84	0.30	0.01
EAS-US	2026-02-13 03:15:00	6.56	20.36	0.41	7.01	11.84	3.95	0.01
EAS-US	2026-02-13 03:30:00	6.55	20.83	0.41	7.03	11.84	1.49	0.01
EAS-US	2026-02-13 03:45:00	6.55	21.55	0.37	7.13	11.82	2.11	0.01
EAS-US	2026-02-13 04:00:00							
EAS-US	2026-02-13 04:15:00							
EAS-US	2026-02-13 04:30:00	6.52	24.27	0.37	7.19	11.85	5.50	0.01
EAS-US	2026-02-13 04:45:00	6.52	25.16	0.36	7.15	11.84	5.97	0.01
EAS-US	2026-02-13 05:00:00							
EAS-US	2026-02-13 05:15:00	6.50	26.97	0.37	7.16	11.86	7.54	0.01
EAS-US	2026-02-13 05:30:00	6.48	28.25	0.39	7.18	11.84	8.00	0.01
EAS-US	2026-02-13 05:45:00	6.47	29.52	0.35	7.31	11.86	7.29	0.01
EAS-US	2026-02-13 06:00:00	6.46	30.66	0.38	7.31	11.86	4.62	0.01
EAS-US	2026-02-13 06:15:00	6.46	31.48	0.39	7.34	11.85	3.25	0.01
EAS-US	2026-02-13 06:30:00	6.46	32.64	0.39	7.37	11.86	3.59	0.01
EAS-US	2026-02-13 06:45:00	6.45	32.94	0.36	7.31	11.86	3.99	0.01
EAS-US	2026-02-13 07:00:00	6.43	33.87	0.38	7.30	11.87	6.78	0.01
EAS-US	2026-02-13 07:15:00	6.42	34.72	0.39	7.32	11.88	4.68	0.01
EAS-US	2026-02-13 07:30:00	6.42	35.53	0.39	7.33	11.87	7.16	0.02
EAS-US	2026-02-13 07:45:00	6.42	36.13	0.35	7.40	11.87	18.29	0.02
EAS-US	2026-02-13 08:00:00							
EAS-US	2026-02-13 08:15:00	6.40	35.96	0.36	7.42	11.89	13.69	0.02
EAS-US	2026-02-13 08:30:00	6.40	34.79	0.37	7.43	11.87	10.56	0.01
EAS-US	2026-02-13 08:45:00	6.40	33.17	0.36	7.30	11.87	6.81	0.01
EAS-US	2026-02-13 09:00:00	6.41	31.48	0.38	7.26	11.87	4.90	0.01
EAS-US	2026-02-13 09:15:00	6.42	30.08	0.39	7.26	11.86	1.60	0.01
EAS-US	2026-02-13 09:30:00	6.43	28.72	0.39	7.24	11.86	0.69	0.01
EAS-US	2026-02-13 09:45:00	6.44	27.55	0.36	7.25	11.86	0.95	0.01
EAS-US	2026-02-13 10:00:00							
EAS-US	2026-02-13 10:15:00	6.44	25.87	0.37	7.23	11.86	0.13	0.01
EAS-US	2026-02-13 10:30:00	6.46	25.10	0.38	7.18	11.86	0.00	0.01
EAS-US	2026-02-13 10:45:00	6.47	24.38	0.36	7.13	11.87	0.00	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-13 11:00:00	6.48	23.86	0.38	7.14	11.86	0.61	0.01
EAS-US	2026-02-13 11:15:00	6.50	23.46	0.39	7.12	11.86	0.00	0.01
EAS-US	2026-02-13 11:30:00	6.54	23.03	0.40	7.08	11.84	0.00	0.01
EAS-US	2026-02-13 11:45:00	6.56	22.60	0.35	7.17	11.82	0.00	0.01
EAS-US	2026-02-13 12:00:00							
EAS-US	2026-02-13 12:15:00	6.60	21.78	0.37	7.16	11.82	0.00	0.01
EAS-US	2026-02-13 12:30:00	6.61	21.46	0.39	7.14	11.82	0.00	0.01
EAS-US	2026-02-13 12:45:00	6.62	21.11	0.36	7.07	11.80	0.00	0.01
EAS-US	2026-02-13 13:00:00							
EAS-US	2026-02-13 13:15:00	6.64	20.52	0.38	7.01	11.79	0.00	0.01
EAS-US	2026-02-13 13:30:00	6.63	20.28	0.39	7.03	11.78	0.00	0.01
EAS-US	2026-02-13 13:45:00	6.64	20.14	0.35	7.14	11.79	0.00	0.01
EAS-US	2026-02-13 14:00:00							
EAS-US	2026-02-13 14:15:00							
EAS-US	2026-02-13 14:30:00	6.67	19.53	0.37	7.10	11.77	0.00	0.01
EAS-US	2026-02-13 14:45:00	6.67	19.32	0.36	7.02	11.79	2.03	0.01
EAS-US	2026-02-13 15:00:00	6.68	19.18	0.39	7.00	11.79	0.00	0.01
EAS-US	2026-02-13 15:15:00	6.69	19.03	0.40	6.99	11.76	0.00	0.01
EAS-US	2026-02-13 15:30:00	6.70	18.88	0.40	6.97	11.76	0.00	0.01
EAS-US	2026-02-13 15:45:00	6.70	18.78	0.36	7.03	11.75	0.01	0.01
EAS-US	2026-02-13 16:00:00	6.70	18.61	0.39	6.99	11.74	9.34	0.01
EAS-US	2026-02-13 16:15:00	6.70	18.47	0.40	7.02	11.76	0.00	0.01
EAS-US	2026-02-13 16:30:00	6.69	18.40	0.40	7.02	11.74	0.00	0.01
EAS-US	2026-02-13 16:45:00	6.68	18.34	0.37	6.93	11.73	0.00	0.01
EAS-US	2026-02-13 17:00:00							
EAS-US	2026-02-13 17:15:00	6.66	18.18	0.38	6.95	11.73	0.00	0.01
EAS-US	2026-02-13 17:30:00	6.64	18.14	0.40	6.92	11.73	0.17	0.01
EAS-US	2026-02-13 17:45:00	6.63	18.13	0.36	7.03	11.73	0.00	0.01
EAS-US	2026-02-13 18:00:00							
EAS-US	2026-02-13 18:15:00							
EAS-US	2026-02-13 18:30:00	6.58	18.13	0.37	7.04	11.75	0.00	0.01
EAS-US	2026-02-13 18:45:00	6.56	18.20	0.36	6.92	11.76	0.00	0.01
EAS-US	2026-02-13 19:00:00	6.54	18.12	0.39	6.91	11.78	0.00	0.01
EAS-US	2026-02-13 19:15:00	6.52	18.05	0.40	6.88	11.77	0.00	0.01
EAS-US	2026-02-13 19:30:00	6.51	18.00	0.41	6.92	11.77	0.00	0.01
EAS-US	2026-02-13 19:45:00	6.50	17.97	0.36	7.02	11.78	0.00	0.01
EAS-US	2026-02-13 20:00:00							
EAS-US	2026-02-13 20:15:00	6.49	17.81	0.38	7.01	11.79	0.00	0.01
EAS-US	2026-02-13 20:30:00	6.49	17.77	0.40	6.96	11.79	0.00	0.01
EAS-US	2026-02-13 20:45:00	6.48	17.73	0.37	6.92	11.79	0.00	0.01
EAS-US	2026-02-13 21:00:00	6.48	17.69	0.40	6.93	11.79	0.00	0.01
EAS-US	2026-02-13 21:15:00	6.47	17.68	0.41	6.92	11.79	0.00	0.01
EAS-US	2026-02-13 21:30:00	6.47	17.62	0.41	6.89	11.79	0.00	0.01
EAS-US	2026-02-13 21:45:00	6.47	17.60	0.37	6.99	11.79	0.00	0.01
EAS-US	2026-02-13 22:00:00			0.39	7.00	11.79	0.00	
EAS-US	2026-02-13 22:15:00	6.46	17.54	0.40	6.96	11.79	0.00	0.01
EAS-US	2026-02-13 22:30:00	6.46	17.49	0.41	7.00	11.79	0.00	0.01
EAS-US	2026-02-13 22:45:00	6.45	17.48	0.38	6.88	11.79	0.00	0.01
EAS-US	2026-02-13 23:00:00							
EAS-US	2026-02-13 23:15:00							
EAS-US	2026-02-13 23:30:00	6.39	17.38	0.38	6.90	11.80	0.00	0.01
EAS-US	2026-02-13 23:45:00	6.38	17.33	0.36	6.98	11.80	0.00	0.01
EAS-US	2026-02-14 00:00:00	6.36	17.30	0.39	6.99	11.81	0.00	0.01
EAS-US	2026-02-14 00:15:00	6.34	17.28	0.40	6.98	11.83	0.00	0.01
EAS-US	2026-02-14 00:30:00	6.31	17.26	0.41	6.99	11.84	0.00	0.01


Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-14 00:45:00	6.29	17.24	0.38	6.92	11.84	0.00	0.01
EAS-US	2026-02-14 01:00:00	6.27	17.18	0.40	6.86	11.85	0.00	0.01
EAS-US	2026-02-14 01:15:00	6.26	17.15	0.41	6.86	11.86	0.00	0.01
EAS-US	2026-02-14 01:30:00	6.24	17.14	0.42	6.86	11.87	0.00	0.01
EAS-US	2026-02-14 01:45:00	6.24	17.12	0.38	6.95	11.86	0.00	0.01
EAS-US	2026-02-14 02:00:00							
EAS-US	2026-02-14 02:15:00							
EAS-US	2026-02-14 02:30:00	6.23	17.07	0.38	7.00	11.86	0.00	0.01
EAS-US	2026-02-14 02:45:00	6.23	17.04	0.37	6.87	11.87	0.00	0.01
EAS-US	2026-02-14 03:00:00	6.22	17.01	0.40	6.89	11.87	0.00	0.01
EAS-US	2026-02-14 03:15:00	6.21	17.00	0.41	6.86	11.88	0.00	0.01
EAS-US	2026-02-14 03:30:00	6.20	17.01	0.41	6.88	11.87	0.00	0.01
EAS-US	2026-02-14 03:45:00	6.21	17.05	0.37	6.96	11.86	0.00	0.01
EAS-US	2026-02-14 04:00:00	6.21	17.11	0.40	6.97	11.88	0.00	0.01
EAS-US	2026-02-14 04:15:00	6.20	17.20	0.41	6.93	11.88	0.00	0.01
EAS-US	2026-02-14 04:30:00	6.20	17.22	0.41	6.97	11.88	0.00	0.01
EAS-US	2026-02-14 04:45:00	6.19	17.27	0.38	6.91	11.88	0.00	0.01
EAS-US	2026-02-14 05:00:00			0.40	6.91	11.88	0.00	
EAS-US	2026-02-14 05:15:00	6.19	17.58	0.41	6.90	11.87	0.00	0.01
EAS-US	2026-02-14 05:30:00	6.19	17.76	0.41	6.91	11.90	0.00	0.01
EAS-US	2026-02-14 05:45:00	6.18	17.97	0.37	7.00	11.89	0.00	0.01
EAS-US	2026-02-14 06:00:00							
EAS-US	2026-02-14 06:15:00							
EAS-US	2026-02-14 06:30:00	6.15	20.47	0.38	7.09	11.90	0.00	0.01
EAS-US	2026-02-14 06:45:00	6.14	20.68	0.37	6.99	11.90	0.00	0.01
EAS-US	2026-02-14 07:00:00							
EAS-US	2026-02-14 07:15:00	6.12	21.74	0.38	7.03	11.90	0.15	0.01
EAS-US	2026-02-14 07:30:00	6.12	23.13	0.39	7.07	11.92	2.62	0.01
EAS-US	2026-02-14 07:45:00	6.11	24.00	0.37	7.16	11.92	2.49	0.01
EAS-US	2026-02-14 08:00:00							
EAS-US	2026-02-14 08:15:00	6.14	25.11	0.37	7.21	11.93	3.04	0.01
EAS-US	2026-02-14 08:30:00	6.15	26.06	0.39	7.21	11.93	3.54	0.01
EAS-US	2026-02-14 08:45:00	6.15	26.13	0.37	7.15	11.93	4.21	0.01
EAS-US	2026-02-14 09:00:00							
EAS-US	2026-02-14 09:15:00	6.25	25.73	0.37	7.16	11.91	1.59	0.01
EAS-US	2026-02-14 09:30:00	6.32	25.29	0.39	7.18	11.93	1.38	0.01
EAS-US	2026-02-14 09:45:00	6.39	24.64	0.36	7.21	11.90	1.29	0.01
EAS-US	2026-02-14 10:00:00							
EAS-US	2026-02-14 10:15:00	6.60	23.39	0.37	7.22	11.86	0.14	0.01
EAS-US	2026-02-14 10:30:00	6.65	22.76	0.38	7.20	11.83	0.54	0.01
EAS-US	2026-02-14 10:45:00	6.72	22.13	0.37	7.11	11.81	0.00	0.01
EAS-US	2026-02-14 11:00:00	6.79	21.61	0.39	7.10	11.80	0.00	0.01
EAS-US	2026-02-14 11:15:00	6.82	21.09	0.39	7.08	11.79	0.00	0.01
EAS-US	2026-02-14 11:30:00	6.77	20.61	0.40	7.05	11.77	0.00	0.01
EAS-US	2026-02-14 11:45:00	6.70	20.23	0.37	7.12	11.78	0.00	0.01
EAS-US	2026-02-14 12:00:00	6.64	19.97	0.39	7.09	11.82	0.00	0.01
EAS-US	2026-02-14 12:15:00	6.57	21.02	0.40	7.11	11.82	1.02	0.01
EAS-US	2026-02-14 12:30:00	6.54	23.17	0.40	7.17	11.84	0.74	0.01
EAS-US	2026-02-14 12:45:00	6.55	24.83	0.37	7.16	11.85	1.27	0.01
EAS-US	2026-02-14 13:00:00							
EAS-US	2026-02-14 13:15:00	6.56	24.10	0.37	7.13	11.85	2.78	0.01
EAS-US	2026-02-14 13:30:00	6.58	25.00	0.39	7.13	11.85	5.31	0.01
EAS-US	2026-02-14 13:45:00	6.63	25.66	0.36	7.25	11.84	4.18	0.01
EAS-US	2026-02-14 14:00:00	6.68	25.80	0.38	7.25	11.81	3.68	0.01
EAS-US	2026-02-14 14:15:00	6.69	25.86	0.39	7.28	11.81	6.04	0.01

Woodfibre LNG (East Creek)

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-14 14:30:00	6.67	25.93	0.39	7.27	11.81	2.88	0.01
EAS-US	2026-02-14 14:45:00	6.64	25.85	0.37	7.18	11.81	0.65	0.01
EAS-US	2026-02-14 15:00:00	6.61	25.62	0.39	7.20	11.83	1.74	0.01
EAS-US	2026-02-14 15:15:00	6.59	25.33	0.40	7.18	11.82	1.07	0.01
EAS-US	2026-02-14 15:30:00	6.56	24.73	0.40	7.14	11.82	0.00	0.01
EAS-US	2026-02-14 15:45:00	6.53	24.06	0.37	7.23	11.84	0.00	0.01
EAS-US	2026-02-14 16:00:00	6.50	23.53	0.39	7.22	11.84	4.55	0.01
EAS-US	2026-02-14 16:15:00	6.47	23.08	0.39	7.20	11.84	0.00	0.01
EAS-US	2026-02-14 16:30:00	6.44	22.69	0.40	7.17	11.86	0.00	0.01
EAS-US	2026-02-14 16:45:00	6.40	22.31	0.38	7.10	11.86	0.00	0.01
EAS-US	2026-02-14 17:00:00							
EAS-US	2026-02-14 17:15:00							
EAS-US	2026-02-14 17:30:00	6.28	21.43	0.38	7.08	11.91	0.00	0.01
EAS-US	2026-02-14 17:45:00	6.23	21.17	0.36	7.08	11.89	0.00	0.01
EAS-US	2026-02-14 18:00:00							
EAS-US	2026-02-14 18:15:00	6.14	20.75	0.37	7.13	11.93	0.00	0.01
EAS-US	2026-02-14 18:30:00	6.11	20.57	0.39	7.09	11.94	0.00	0.01
EAS-US	2026-02-14 18:45:00	6.07	20.41	0.38	7.02	11.95	0.00	0.01
EAS-US	2026-02-14 19:00:00							
EAS-US	2026-02-14 19:15:00	6.00	20.08	0.38	7.00	11.97	0.00	0.01
EAS-US	2026-02-14 19:30:00	5.97	19.92	0.40	6.97	11.99	0.00	0.01
EAS-US	2026-02-14 19:45:00	5.93	19.76	0.37	7.08	11.99	0.00	0.01
EAS-US	2026-02-14 20:00:00							
EAS-US	2026-02-14 20:15:00	5.87	19.51	0.38	7.04	12.04	0.00	0.01
EAS-US	2026-02-14 20:30:00	5.84	19.36	0.39	7.05	12.04	1.21	0.01
EAS-US	2026-02-14 20:45:00	5.82	19.25	0.38	6.96	12.02	0.00	0.01
EAS-US	2026-02-14 21:00:00							
EAS-US	2026-02-14 21:15:00	5.76	19.02	0.39	6.93	12.07	0.00	0.01
EAS-US	2026-02-14 21:30:00	5.73	18.91	0.40	6.94	12.07	0.00	0.01
EAS-US	2026-02-14 21:45:00	5.71	18.81	0.38	7.02	12.07	0.00	0.01
EAS-US	2026-02-14 22:00:00							
EAS-US	2026-02-14 22:15:00	5.69	18.61	0.38	7.01	12.08	0.00	0.01
EAS-US	2026-02-14 22:30:00	5.68	18.49	0.40	6.99	12.09	0.00	0.01
EAS-US	2026-02-14 22:45:00	5.65	18.42	0.38	6.94	12.09	0.00	0.01
EAS-US	2026-02-14 23:00:00							
EAS-US	2026-02-14 23:15:00	5.61	18.31	0.39	6.91	12.10	0.00	0.01
EAS-US	2026-02-14 23:30:00	5.59	18.25	0.40	6.93	12.10	0.00	0.01
EAS-US	2026-02-14 23:45:00	5.56	18.15	0.38	6.99	12.12	0.00	0.01
EAS-US	2026-02-15 00:00:00							
EAS-US	2026-02-15 00:15:00	5.53	17.97	0.38	6.98	12.12	0.00	0.01
EAS-US	2026-02-15 00:30:00	5.51	17.88	0.40	6.99	12.12	0.00	0.01
EAS-US	2026-02-15 00:45:00	5.48	17.77	0.38	6.92	12.13	0.00	0.01
EAS-US	2026-02-15 01:00:00							
EAS-US	2026-02-15 01:15:00	5.43	17.71	0.39	6.91	12.15	0.00	0.01
EAS-US	2026-02-15 01:30:00	5.40	17.70	0.40	6.91	12.15	0.00	0.01
EAS-US	2026-02-15 01:45:00	5.37	17.69	0.38	6.98	12.19	0.00	0.01
EAS-US	2026-02-15 02:00:00	5.35	17.66	0.40	6.99	12.18	0.00	0.01
EAS-US	2026-02-15 02:15:00	5.35	17.62	0.41	7.00	12.19	0.00	0.01
EAS-US	2026-02-15 02:30:00	5.33	17.55	0.41	6.98	12.19	0.00	0.01
EAS-US	2026-02-15 02:45:00	5.32	17.51	0.39	6.87	12.19	0.00	0.01
EAS-US	2026-02-15 03:00:00							
EAS-US	2026-02-15 03:15:00							
EAS-US	2026-02-15 03:30:00	5.24	17.40	0.39	6.88	12.20	0.00	0.01
EAS-US	2026-02-15 03:45:00	5.22	17.31	0.38	6.98	12.20	0.00	0.01
EAS-US	2026-02-15 04:00:00							

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-15 04:15:00	5.18	17.23	0.39	6.97	12.21	0.00	0.01
EAS-US	2026-02-15 04:30:00	5.16	17.23	0.40	6.99	12.24	0.00	0.01
EAS-US	2026-02-15 04:45:00	5.14	17.18	0.39	6.88	12.22	0.00	0.01
EAS-US	2026-02-15 05:00:00							
EAS-US	2026-02-15 05:15:00	5.12	17.11	0.39	6.87	12.23	2.26	0.01
EAS-US	2026-02-15 05:30:00	5.10	17.08	0.40	6.85	12.23	0.00	0.01
EAS-US	2026-02-15 05:45:00	5.08	17.04	0.38	6.96	12.23	0.00	0.01
EAS-US	2026-02-15 06:00:00							
EAS-US	2026-02-15 06:15:00	5.04	16.98	0.39	6.98	12.26	0.00	0.01
EAS-US	2026-02-15 06:30:00	5.02	16.95	0.40	6.99	12.26	0.00	0.01
EAS-US	2026-02-15 06:45:00	5.02	16.89	0.38	6.87	12.27	0.00	0.01
EAS-US	2026-02-15 07:00:00							
EAS-US	2026-02-15 07:15:00	4.99	16.86	0.39	6.86	12.27	0.00	0.01
EAS-US	2026-02-15 07:30:00	4.96	16.83	0.40	6.88	12.28	0.00	0.01
EAS-US	2026-02-15 07:45:00	4.94	16.78	0.38	6.94	12.29	0.00	0.01
EAS-US	2026-02-15 08:00:00							
EAS-US	2026-02-15 08:15:00	4.90	16.85	0.39	6.90	12.31	0.00	0.01
EAS-US	2026-02-15 08:30:00	4.94	16.75	0.40	6.94	12.33	0.00	0.01
EAS-US	2026-02-15 08:45:00	4.96	16.75	0.39	6.86	12.32	0.00	0.01
EAS-US	2026-02-15 09:00:00	5.00	16.79	0.40	6.89	12.30	0.00	0.01
EAS-US	2026-02-15 09:15:00	5.04	16.91	0.41	6.86	12.30	0.00	0.01
EAS-US	2026-02-15 09:30:00	5.07	16.92	0.41	6.89	12.31	0.00	0.01
EAS-US	2026-02-15 09:45:00	5.10	17.01	0.38	6.98	12.28	0.00	0.01
EAS-US	2026-02-15 10:00:00	5.15	17.12	0.40	6.97	12.28	0.00	0.01
EAS-US	2026-02-15 10:15:00	5.20	17.20	0.41	6.97	12.27	0.00	0.01
EAS-US	2026-02-15 10:30:00	5.25	17.26	0.41	7.01	12.24	0.00	0.01
EAS-US	2026-02-15 10:45:00	5.27	17.26	0.39	6.89	12.24	0.00	0.01
EAS-US	2026-02-15 11:00:00	5.33	17.23	0.40	6.93	12.20	0.72	0.01
EAS-US	2026-02-15 11:15:00	5.39	17.20	0.41	6.91	12.19	0.00	0.01
EAS-US	2026-02-15 11:30:00	5.45	17.26	0.41	6.90	12.19	0.00	0.01
EAS-US	2026-02-15 11:45:00	5.49	17.50	0.38	6.99	12.15	0.00	0.01
EAS-US	2026-02-15 12:00:00	5.55	17.68	0.40	7.00	12.14	0.00	0.01
EAS-US	2026-02-15 12:15:00	5.61	17.70	0.40	7.03	12.12	0.00	0.01
EAS-US	2026-02-15 12:30:00	5.66	17.56	0.41	7.02	12.10	0.00	0.01
EAS-US	2026-02-15 12:45:00	5.72	17.32	0.39	6.91	12.07	0.00	0.01
EAS-US	2026-02-15 13:00:00	5.75	17.14	0.40	6.93	12.06	0.00	0.01
EAS-US	2026-02-15 13:15:00	5.79	17.01	0.41	6.91	12.03	0.00	0.01
EAS-US	2026-02-15 13:30:00	5.84	16.86	0.42	6.89	12.03	0.00	0.01
EAS-US	2026-02-15 13:45:00	5.84	16.74	0.38	6.99	12.02	0.00	0.01
EAS-US	2026-02-15 14:00:00	5.84	16.66	0.40	6.98	12.02	0.00	0.01
EAS-US	2026-02-15 14:15:00	5.86	16.61	0.41	6.95	12.00	0.00	0.01
EAS-US	2026-02-15 14:30:00	5.86	16.59	0.41	6.98	12.00	0.00	0.01
EAS-US	2026-02-15 14:45:00	5.88	16.52	0.39	6.91	11.99	0.00	0.01
EAS-US	2026-02-15 15:00:00	5.90	16.49	0.41	6.85	11.99	0.00	0.01
EAS-US	2026-02-15 15:15:00	5.91	16.48	0.41	6.86	11.97	0.00	0.01
EAS-US	2026-02-15 15:30:00	5.92	16.46	0.41	6.90	11.96	0.00	0.01
EAS-US	2026-02-15 15:45:00	5.92	16.48	0.38	6.99	11.96	0.00	0.01
EAS-US	2026-02-15 16:00:00	5.92	16.46	0.40	6.97	11.94	0.00	0.01
EAS-US	2026-02-15 16:15:00	5.92	16.47	0.41	6.98	11.96	0.00	0.01
EAS-US	2026-02-15 16:30:00	5.91	16.48	0.41	6.96	11.95	0.00	0.01
EAS-US	2026-02-15 16:45:00	5.91	16.47	0.39	6.90	11.94	0.00	0.01
EAS-US	2026-02-15 17:00:00	5.90	16.51	0.41	6.86	11.93	0.00	0.01
EAS-US	2026-02-15 17:15:00	5.88	16.54	0.41	6.86	11.93	0.00	0.01
EAS-US	2026-02-15 17:30:00	5.86	16.54	0.41	6.91	11.93	0.00	0.01
EAS-US	2026-02-15 17:45:00	5.84	16.53	0.38	6.94	11.93	0.00	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-15 18:00:00	5.83	16.55	0.40	6.98	11.93	0.00	0.01
EAS-US	2026-02-15 18:15:00	5.81	16.57	0.41	6.92	11.93	0.00	0.01
EAS-US	2026-02-15 18:30:00	5.80	16.57	0.42	6.91	11.95	0.00	0.01
EAS-US	2026-02-15 18:45:00	5.79	16.58	0.39	6.84	11.95	0.00	0.01
EAS-US	2026-02-15 19:00:00	5.78	16.59	0.41	6.83	11.94	0.00	0.01
EAS-US	2026-02-15 19:15:00	5.77	16.61	0.42	6.83	11.94	0.00	0.01
EAS-US	2026-02-15 19:30:00	5.76	16.61	0.42	6.85	11.94	0.00	0.01
EAS-US	2026-02-15 19:45:00	5.75	16.62	0.38	6.96	11.95	0.00	0.01
EAS-US	2026-02-15 20:00:00	5.74	16.61	0.40	6.94	11.95	0.00	0.01
EAS-US	2026-02-15 20:15:00	5.74	16.65	0.41	6.97	11.96	0.00	0.01
EAS-US	2026-02-15 20:30:00	5.73	16.64	0.41	6.97	11.96	0.00	0.01
EAS-US	2026-02-15 20:45:00	5.72	16.64	0.40	6.87	11.96	0.00	0.01
EAS-US	2026-02-15 21:00:00	5.71	16.65	0.41	6.86	11.95	0.00	0.01
EAS-US	2026-02-15 21:15:00	5.71	16.67	0.42	6.83	11.96	0.00	0.01
EAS-US	2026-02-15 21:30:00	5.70	16.67	0.42	6.84	11.95	0.00	0.01
EAS-US	2026-02-15 21:45:00	5.70	16.68	0.38	6.94	11.94	0.00	0.01
EAS-US	2026-02-15 22:00:00							
EAS-US	2026-02-15 22:15:00	5.69	16.69	0.39	6.98	11.95	0.00	0.01
EAS-US	2026-02-15 22:30:00	5.69	16.69	0.40	6.91	11.95	0.00	0.01
EAS-US	2026-02-15 22:45:00	5.68	16.70	0.39	6.86	11.94	0.00	0.01
EAS-US	2026-02-15 23:00:00	5.67	16.72	0.41	6.85	11.95	0.00	0.01
EAS-US	2026-02-15 23:15:00	5.66	16.68	0.41	6.85	11.96	0.00	0.01
EAS-US	2026-02-15 23:30:00	5.65	16.68	0.42	6.88	11.96	0.00	0.01
EAS-US	2026-02-15 23:45:00	5.63	16.70	0.38	6.94	11.96	0.00	0.01

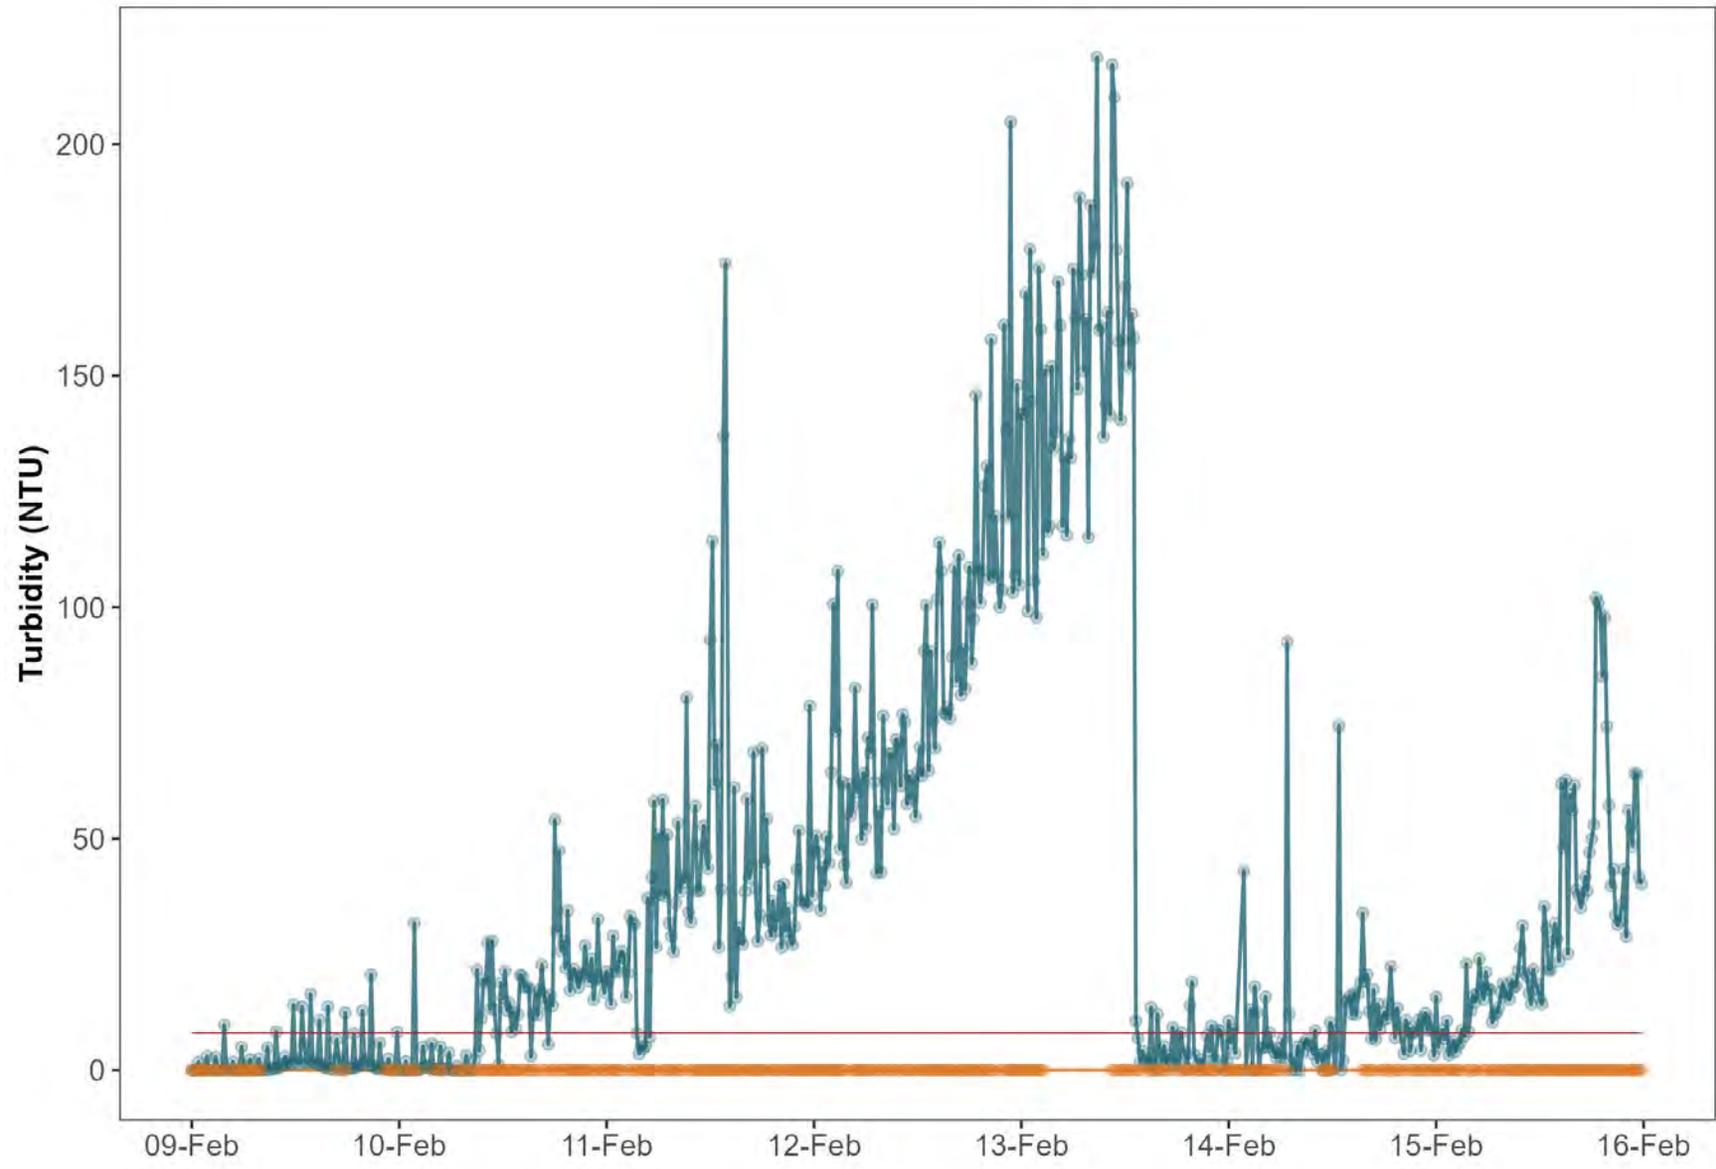

Monitoring location — EAS-DS — EAS-US Guideline — BC FWAL - Acute



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	Feb 9, 2026 to Feb 15, 2026
Report #	99
Appendix D	E-1

**Appendix E:
Lab Documentation**



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE-110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 123126

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/02/24
 Report #: R3760997
 Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C607390

Received: 2026/02/10, 13:55

Sample Matrix: Water
 # Samples Received: 6

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Alkalinity @25C (pp, total), CO3,HCO3,OH	6	N/A	2026/02/11	BBY6SOP-00026	SM 24 2320 B m
Chloride/Sulphate by Auto Colourimetry	6	N/A	2026/02/11	BBY6SOP-00011 / BBY6SOP-00017	SM24-4500-Cl/SO4-E m
Chromium III (Calc'd)	2	N/A	2026/02/17		
Chromium III (Calc'd)	4	N/A	2026/02/18		
Total Hexavalent Chromium	6	N/A	2026/02/17	BBY6SOP-00054	SM 24 3500-Cr B m
Carbon (DOC) -Lab Filtered (2)	6	N/A	2026/02/12	BBY6SOP-00053	SM 24 5310 B m
Fluoride	6	N/A	2026/02/11	BBY6SOP-00037	SM 24 4500-F C m
Glycols in Water by GC/FID (1)	2	N/A	2026/02/13	CAL SOP-00093	BCMOE Glycols 09/17
Sulphide (as H2S) (1)	3	N/A	2026/02/13		Auto Calc
Sulphide (as H2S) (1)	3	N/A	2026/02/14		Auto Calc
Un-ionized Hydrogen Sulphide as S Calc (1)	1	N/A	2026/02/13		
Un-ionized Hydrogen Sulphide as S Calc (1)	3	N/A	2026/02/14		
Hardness Total (calculated as CaCO3) (3)	2	N/A	2026/02/12	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO3) (3)	4	N/A	2026/02/18	BBY WI-00033	Auto Calc
Hardness (calculated as CaCO3)	6	N/A	2026/02/17	BBY WI-00033	Auto Calc
Mercury (Dissolved) by CV-Lab Filtered	6	2026/02/13	2026/02/13	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Mercury (Total) by CV	6	2026/02/11	2026/02/11	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Bromide as Bromine (Br) by ICPMS	6	N/A	2026/02/17	BBY7SOP-00002	EPA 6020B R2 m
EPH in Water when PAH required	2	2026/02/12	2026/02/13	BBY8SOP-00029	BCMOE BCLM Sep2017 m
Na, K, Ca, Mg, S by CRC ICPMS (diss.)	6	N/A	2026/02/17	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (lab filter) (4)	6	N/A	2026/02/13	BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	4	2026/02/13	2026/02/17	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Na, K, Ca, Mg, S by CRC ICPMS (total)	2	N/A	2026/02/12	BBY WI-00033	Auto Calc
Na, K, Ca, Mg, S by CRC ICPMS (total)	4	N/A	2026/02/18	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (total)	2	N/A	2026/02/11	BBY7SOP-00002	EPA 6020b R2 m
Nitrogen (Total)	6	N/A	2026/02/13	BBY6SOP-00016	SM 24 4500-N C m
Ammonia-N (Total)	6	N/A	2026/02/12	AB SOP-00007	SM 24 4500 NH3 A G m
Nitrate + Nitrite (N)	6	N/A	2026/02/11	BBY6SOP-00010	SM 24 4500-NO3- H m
Nitrite (N) Regular Level Water	6	N/A	2026/02/11	BBY6SOP-00010	SM 24 4500-NO2- m



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE-110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 123126

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/02/24
 Report #: R3760997
 Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C607390

Received: 2026/02/10, 13:55

Sample Matrix: Water
 # Samples Received: 6

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
Nitrogen - Nitrate (as N)	6	N/A	2026/02/12	BBY WI-00033	Auto Calc
PAH in Water by GC/MS (SIM)	2	2026/02/12	2026/02/12	BBY8SOP-00021	BCMOE BCLM Jul2017m
Total LMW, HMW, Total PAH Calc (5)	2	N/A	2026/02/13	BBY WI-00033	Auto Calc
pH @25°C (6)	6	N/A	2026/02/11	BBY6SOP-00026	SM 24 4500-H+ B m
Phenols (4-AAP) (1)	2	N/A	2026/02/13	AB SOP-00088	EPA 9066 R0 m
Rainbow Trout LC50 Multi-concentration	1	N/A	2026/02/12	BBY2SOP-00004	EPS1/RM/13(2nd)&RM/9
Total Sulphide (1)	3	2026/02/13	2026/02/13	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Sulphide (1)	3	2026/02/13	2026/02/14	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Dissolved Solids (Filt. Residue)	6	2026/02/13	2026/02/17	BBY6SOP-00033	SM 24 2540 C m
EPH less PAH in Water by GC/FID (7)	2	N/A	2026/02/17	BBY WI-00033	Auto Calc
Carbon (Total Organic) (8)	6	N/A	2026/02/12	BBY6SOP-00053	SM 24 5310 B m
Total Phosphorus Low Level Total	6	2026/02/11	2026/02/12	BBY6SOP-00013	SM 24 4500-P E m
Total Suspended Solids (NFR)	6	2026/02/11	2026/02/12	BBY6SOP-00034	SM 24 2540 D m
Field pH	4	N/A	2026/02/11	Field Test	Field Test
Field Temperature	4	N/A	2026/02/11	Field Test	Field Test
VOCs, VH, F1, LH in Water by HS GC/MS	2	N/A	2026/02/12	BBY8SOP-00009 / BBY8SOP-00011 / BBY8SOP-00012	BCMOE BCLM Jul2017 m
Volatile HC-BTEX (9)	2	N/A	2026/02/13	BBY WI-00033	Auto Calc

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, EPA, APHA or the Quebec Ministry of Environment.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless



Your P.O. #: 4800010213
Your Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your C.O.C. #: 123126

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
N. VANCOUVER
200-850 Harbourside Dr
North Vancouver, BC
Canada V7P 0A3

Report Date: 2026/02/24
Report #: R3760997
Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C607390

Received: 2026/02/10, 13:55

otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

- (1) This test was performed by Bureau Veritas Calgary, 4000 - 19 St. , Calgary, AB, T2E 6P8
- (2) DOC present in the sample should be considered as non-purgeable DOC. Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (3) "Total Hardness" was calculated from Total Ca and Mg concentrations and may be biased high (Hardness, or Dissolved Hardness, calculated from Dissolved Ca and Mg, should be used for compliance if available).
- (4) Samples were filtered and preserved at the lab. Values may not reflect concentrations at the time of sampling.
For Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (5) Total PAHs in Water include: Quinoline, Naphthalene, 1-Methylnaphthalene, 2-Methylnaphthalene, Acenaphthylene, Acenaphthene, Fluorene, Phenanthrene, Anthracene, Acridine, Fluoranthene, Pyrene, Benzo(a)anthracene, Chrysene, Benzo(b&j)fluoranthene, Benzo(k)fluoranthene, Benzo(a)pyrene, Indeno(1,2,3-cd)pyrene, Dibenz(a,h)anthracene, and Benzo(g,h,i)perylene.
- (6) The CCME method requires pH to be analysed within 15 minutes of sampling and therefore field analysis is required for compliance. All Laboratory pH analyses in this report are reported past the CCME holding time. Bureau Veritas endeavours to analyze samples as soon as possible after receipt.
- (7) LEPH = EPH (C10 to C19) - (Acenaphthene + Acridine + Anthracene + Fluorene + Naphthalene + Phenanthrene)
HEPH = EPH (C19 to C32) - (Benzo(a)anthracene + Benzo(a)pyrene + Fluoranthene + Pyrene)
- (8) TOC present in the sample should be considered as non-purgeable TOC.
- (9) VPH = VH - (Benzene + Toluene + Ethylbenzene + m & p-Xylene + o-Xylene + Styrene)

Encryption Key

Please direct all questions regarding this Certificate of Analysis to:

Levi Manchak, Project Manager SR
Email: Levi.MANCHAK@bureauveritas.com
Phone# (780)862-5634

=====

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



BUREAU
VERITAS

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP393			EAP393			EAP394		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch

ANIONS

Nitrite (N)	mg/L	ND	0.0050	C221617				ND	0.0050	C221617
-------------	------	----	--------	---------	--	--	--	----	--------	---------

Calculated Parameters

Total Chromium III	mg/L	ND	0.00099	C220652				ND	0.00099	C220652
Dissolved Hardness (CaCO3)	mg/L	16.0	0.50	C220093				53.6	0.50	C220093
Total Hardness (CaCO3)	mg/L	16.3	0.50	C220148				50.9	0.50	C220148
Nitrate (N)	mg/L	ND	0.020	C220151				ND	0.020	C220151
Sulphide (as H2S)	mg/L	ND	0.0020	C220731				ND	0.0020	C220731

Field Parameters

Field pH	pH	7.43	N/A	ONSITE				7.38	N/A	ONSITE
Field Temperature	°C	8.1	N/A	ONSITE				10.7	N/A	ONSITE

Misc. Inorganics

pH	pH	6.53	N/A	C221505				6.99	N/A	C221505
Total Organic Carbon (C)	mg/L	3.4	0.50	C221681				3.7	0.50	C221681
Total Dissolved Solids	mg/L	24	10	C223544				48	10	C223544
Total Suspended Solids	mg/L	4.0	1.0	C221802				10	1.0	C221802

Lab Filtered Inorganics

Dissolved Organic Carbon (C)	mg/L	2.8	0.50	C221679				3.0	0.50	C221679
------------------------------	------	-----	------	---------	--	--	--	-----	------	---------

Anions

Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C221501				ND	1.0	C221501
Alkalinity (Total as CaCO3)	mg/L	16	1.0	C221501				43	1.0	C221501
Bicarbonate (HCO3)	mg/L	19	1.0	C221501				52	1.0	C221501
Carbonate (CO3)	mg/L	ND	1.0	C221501				ND	1.0	C221501
Fluoride (F)	mg/L	0.081	0.050	C221623				0.29	0.050	C221619
Hydroxide (OH)	mg/L	ND	1.0	C221501				ND	1.0	C221501
Total Sulphide	mg/L	ND	0.0018	C223455				ND	0.0018	C223455
Chloride (Cl)	mg/L	2.7	1.0	C221720				11 (1)	1.0	C221720
Sulphate (SO4)	mg/L	4.4	1.0	C221720				13 (1)	1.0	C221720

RDL = Reportable Detection Limit

Lab-Dup = Laboratory Initiated Duplicate

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

N/A = Not Applicable

(1) Matrix Spike exceeds acceptance limits due to matrix interference. Reanalysis yields similar results.



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP393			EAP393			EAP394		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C224445	ND	0.00099	C224445	ND	0.00099	C224445
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C221974				ND	0.015	C221974
Total Phosphorus (P)	mg/L	0.067	0.0010	C221707				0.0041	0.0010	C221707
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C221616				ND	0.020	C221616
Total Nitrogen (N)	mg/L	0.154	0.020	C222202				0.233	0.020	C222202
Misc. Organics										
Phenols	mg/L							ND	0.0015	C223826
Rainbow Trout										
LC50	% vol/vol							ATTACHED	N/A	C222476
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable										



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP394			EAP395			EAP396		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L	ND	0.0050	C221617	ND	0.0050	C221617	ND	0.0050	C221617
Calculated Parameters										
Total Chromium III	mg/L				ND	0.00099	C220652	ND	0.00099	C220652
Dissolved Hardness (CaCO3)	mg/L				6.01	0.50	C220093	ND	0.50	C220093
Total Hardness (CaCO3)	mg/L				5.61	0.50	C220148	ND	0.50	C220148
Nitrate (N)	mg/L				ND	0.020	C220151	ND	0.020	C220151
Sulphide (as H2S)	mg/L				ND	0.0020	C220731	ND	0.0020	C220731
Field Parameters										
Field pH	pH				8.11	N/A	ONSITE			
Field Temperature	°C				7	N/A	ONSITE			
Misc. Inorganics										
pH	pH	6.95	N/A	C221505	6.27	N/A	C221505	5.73	N/A	C221505
Total Organic Carbon (C)	mg/L				2.9	0.50	C221681	ND	0.50	C221681
Total Dissolved Solids	mg/L				12	10	C223544	ND	10	C223544
Total Suspended Solids	mg/L				ND	1.0	C221807	ND	1.0	C221802
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L				3.0	0.50	C221679	ND	0.50	C221679
Anions										
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C221501	ND	1.0	C221501	ND	1.0	C221501
Alkalinity (Total as CaCO3)	mg/L	43	1.0	C221501	5.2	1.0	C221501	ND	1.0	C221501
Bicarbonate (HCO3)	mg/L	52	1.0	C221501	6.4	1.0	C221501	ND	1.0	C221501
Carbonate (CO3)	mg/L	ND	1.0	C221501	ND	1.0	C221501	ND	1.0	C221501
Fluoride (F)	mg/L				ND	0.050	C221623	ND	0.050	C221623
Hydroxide (OH)	mg/L	ND	1.0	C221501	ND	1.0	C221501	ND	1.0	C221501
Total Sulphide	mg/L				ND	0.0018	C223326	ND	0.0018	C223326
Chloride (Cl)	mg/L	12	1.0	C221720	ND	1.0	C221720	ND	1.0	C221720
Sulphate (SO4)	mg/L	13	1.0	C221720	ND	1.0	C221720	ND	1.0	C221720
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable										



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP394			EAP395			EAP396		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L				ND	0.00099	C224445	ND	0.00099	C224445
Nutrients										
Total Ammonia (N)	mg/L				ND	0.015	C221974	ND	0.015	C221974
Total Phosphorus (P)	mg/L				0.10	0.0010	C221707	ND	0.0010	C221707
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C221616	ND	0.020	C221616	ND	0.020	C221616
Total Nitrogen (N)	mg/L				0.096	0.020	C222202	ND	0.020	C222202
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP396			EAP397			EAP397		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch	Trip Blank Lab-Dup	RDL	QC Batch

ANIONS

Nitrite (N)	mg/L				ND	0.0050	C221617			
-------------	------	--	--	--	----	--------	---------	--	--	--

Calculated Parameters

Total Chromium III	mg/L				ND	0.00099	C220652			
Dissolved Hardness (CaCO3)	mg/L				ND	0.50	C220093			
Total Hardness (CaCO3)	mg/L				ND	0.50	C220148			
Nitrate (N)	mg/L				ND	0.020	C220151			
Sulphide (as H2S)	mg/L				ND	0.0020	C220731			

Misc. Inorganics

pH	pH				5.60	N/A	C221505			
Total Organic Carbon (C)	mg/L				ND	0.50	C221681			
Total Dissolved Solids	mg/L				ND	10	C223544			
Total Suspended Solids	mg/L				ND	1.0	C221802			

Lab Filtered Inorganics

Dissolved Organic Carbon (C)	mg/L				ND	0.50	C221679	ND	0.50	C221679
------------------------------	------	--	--	--	----	------	---------	----	------	---------

Anions

Alkalinity (PP as CaCO3)	mg/L				ND	1.0	C221501			
Alkalinity (Total as CaCO3)	mg/L				ND	1.0	C221501			
Bicarbonate (HCO3)	mg/L				ND	1.0	C221501			
Carbonate (CO3)	mg/L				ND	1.0	C221501			
Fluoride (F)	mg/L				ND	0.050	C221623			
Hydroxide (OH)	mg/L				ND	1.0	C221501			
Total Sulphide	mg/L				ND	0.0018	C223326			
Chloride (Cl)	mg/L				ND	1.0	C221720			
Sulphate (SO4)	mg/L				ND	1.0	C221720			

Metals

Total Hex. Chromium (Cr 6+)	mg/L				ND	0.00099	C224445			
-----------------------------	------	--	--	--	----	---------	---------	--	--	--

RDL = Reportable Detection Limit
 Lab-Dup = Laboratory Initiated Duplicate
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
 N/A = Not Applicable



BUREAU
VERITAS

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP396			EAP397			EAP397		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch	Trip Blank Lab-Dup	RDL	QC Batch

Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C221974	ND	0.015	C221974			
Total Phosphorus (P)	mg/L				ND	0.0010	C221707			
Nitrate plus Nitrite (N)	mg/L				ND	0.020	C221616			
Total Nitrogen (N)	mg/L	ND	0.020	C222202	ND	0.020	C222202			

RDL = Reportable Detection Limit
 Lab-Dup = Laboratory Initiated Duplicate
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP398		
Sampling Date		2026/02/10		
COC Number		123126		
	UNITS	DUP	RDL	QC Batch
ANIONS				
Nitrite (N)	mg/L	ND	0.0050	C221617
Calculated Parameters				
Total Chromium III	mg/L	ND	0.00099	C220652
Dissolved Hardness (CaCO3)	mg/L	53.4	0.50	C220093
Total Hardness (CaCO3)	mg/L	54.1	0.50	C220148
Nitrate (N)	mg/L	ND	0.020	C220151
Sulphide (as H2S)	mg/L	0.0032	0.0020	C220731
Field Parameters				
Field pH	pH	7.38	N/A	ONSITE
Field Temperature	°C	10.7	N/A	ONSITE
Misc. Inorganics				
pH	pH	6.93	N/A	C221505
Total Organic Carbon (C)	mg/L	3.5	0.50	C221681
Total Dissolved Solids	mg/L	68	10	C223544
Total Suspended Solids	mg/L	11	1.0	C221807
Lab Filtered Inorganics				
Dissolved Organic Carbon (C)	mg/L	3.2	0.50	C221679
Anions				
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C221501
Alkalinity (Total as CaCO3)	mg/L	42	1.0	C221501
Bicarbonate (HCO3)	mg/L	51	1.0	C221501
Carbonate (CO3)	mg/L	ND	1.0	C221501
Fluoride (F)	mg/L	0.29	0.050	C221623
Hydroxide (OH)	mg/L	ND	1.0	C221501
Total Sulphide	mg/L	0.0030	0.0018	C223455
Chloride (Cl)	mg/L	11	1.0	C221720
Sulphate (SO4)	mg/L	13	1.0	C221720
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable				



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EAP398		
Sampling Date		2026/02/10		
COC Number		123126		
	UNITS	DUP	RDL	QC Batch
Metals				
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C224445
Nutrients				
Total Ammonia (N)	mg/L	ND	0.015	C221974
Total Phosphorus (P)	mg/L	0.0033	0.0010	C221707
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C221616
Total Nitrogen (N)	mg/L	0.246	0.020	C222202
Misc. Organics				
Phenols	mg/L	ND	0.0015	C223826
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C607390
 Report Date: 2026/02/24

HATFIELD CONSULTANTS
 Client Project #: FORTIS11234/PE-110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your P.O. #: 4800010213

GLYCOLS BY GC-FID (WATER)

Bureau Veritas ID		EAP394	EAP398		
Sampling Date		2026/02/10	2026/02/10		
COC Number		123126	123126		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Glycols					
Ethylene Glycol	mg/L	ND	ND	3.0	C223536
Diethylene Glycol	mg/L	ND	ND	5.0	C223536
Triethylene Glycol	mg/L	ND	ND	5.0	C223536
Propylene Glycol	mg/L	ND	ND	5.0	C223536
Surrogate Recovery (%)					
Methyl Sulfone (sur.)	%	98	110		C223536
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



MERCURY BY COLD VAPOR (WATER)

Bureau Veritas ID		EAP393	EAP394	EAP395	EAP396	EAP397	EAP398		
Sampling Date		2026/02/10	2026/02/10	2026/02/10	2026/02/10	2026/02/10	2026/02/10		
COC Number		123126	123126	123126	123126	123126	123126		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	Field Blank	Trip Blank	DUP	RDL	QC Batch

Elements									
Total Mercury (Hg)	ug/L	0.0023	ND	0.0027	ND	ND	ND	0.0019	C221812

Lab Filtered Elements									
Dissolved Mercury (Hg)	ug/L	0.0022 (1)	ND (1)	0.0021 (1)	ND (1)	ND (1)	ND (1)	0.0019	C223999

RDL = Reportable Detection Limit
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
 (1) Sample received was not in compliance with BC CSR sampling requirements for Mercury in water.



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP393			EAP393			EAP394		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch

ANIONS

Bromide (Br)	mg/L	ND	0.010	C223496				ND	0.010	C223496
--------------	------	----	-------	---------	--	--	--	----	-------	---------

Dissolved Metals by ICPMS

Dissolved Calcium (Ca)	mg/L	5.68	0.050	C220094				19.9	0.050	C220094
Dissolved Magnesium (Mg)	mg/L	0.430	0.050	C220094				0.946	0.050	C220094
Dissolved Potassium (K)	mg/L	0.658	0.050	C220094				2.29	0.050	C220094
Dissolved Sodium (Na)	mg/L	2.01	0.050	C220094				6.16	0.050	C220094
Dissolved Sulphur (S)	mg/L	ND	3.0	C220094				4.7	3.0	C220094

Lab Filtered Metals

Dissolved Aluminum (Al)	ug/L	175	0.50	C223507	174	0.50	C223507	268	0.50	C223507
Dissolved Antimony (Sb)	ug/L	0.061	0.020	C223507	0.063	0.020	C223507	0.162	0.020	C223507
Dissolved Arsenic (As)	ug/L	0.395	0.020	C223507	0.401	0.020	C223507	1.13	0.020	C223507
Dissolved Barium (Ba)	ug/L	3.09	0.020	C223507	3.08	0.020	C223507	5.39	0.020	C223507
Dissolved Beryllium (Be)	ug/L	ND	0.010	C223507	ND	0.010	C223507	ND	0.010	C223507
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C223507	ND	0.0050	C223507	ND	0.0050	C223507
Dissolved Boron (B)	ug/L	ND	10	C223507	ND	10	C223507	13	10	C223507
Dissolved Cadmium (Cd)	ug/L	0.0076	0.0050	C223507	0.0076	0.0050	C223507	0.0072	0.0050	C223507
Dissolved Cesium (Cs)	ug/L	ND	0.050	C223507	ND	0.050	C223507	0.110	0.050	C223507
Dissolved Chromium (Cr)	ug/L	0.18	0.10	C223507	0.18	0.10	C223507	0.58	0.10	C223507
Dissolved Cobalt (Co)	ug/L	0.0317	0.0050	C223507	0.0240	0.0050	C223507	0.0277	0.0050	C223507
Dissolved Copper (Cu)	ug/L	0.704	0.050	C223507	0.704	0.050	C223507	1.32	0.050	C223507
Dissolved Iron (Fe)	ug/L	14.7	1.0	C223507	14.8	1.0	C223507	5.8	1.0	C223507
Dissolved Lead (Pb)	ug/L	0.0101	0.0050	C223507	0.0093	0.0050	C223507	ND	0.0050	C223507
Dissolved Lithium (Li)	ug/L	0.79	0.50	C223507	0.85	0.50	C223507	3.16	0.50	C223507
Dissolved Manganese (Mn)	ug/L	1.84	0.050	C223507	1.84	0.050	C223507	7.75	0.050	C223507
Dissolved Molybdenum (Mo)	ug/L	7.98	0.050	C223507	7.99	0.050	C223507	38.9	0.050	C223507
Dissolved Nickel (Ni)	ug/L	0.249	0.020	C223507	0.250	0.020	C223507	0.148	0.020	C223507
Dissolved Phosphorus (P)	ug/L	49.4	2.0	C223507	49.4	2.0	C223507	5.3	2.0	C223507
Dissolved Rubidium (Rb)	ug/L	1.45	0.050	C223507	1.44	0.050	C223507	5.92	0.050	C223507
Dissolved Selenium (Se)	ug/L	ND	0.040	C223507	ND	0.040	C223507	0.046	0.040	C223507

RDL = Reportable Detection Limit
 Lab-Dup = Laboratory Initiated Duplicate
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP393			EAP393			EAP394		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Dissolved Silicon (Si)	ug/L	3860	50	C223507	3900	50	C223507	6670	50	C223507
Dissolved Silver (Ag)	ug/L	ND	0.0050	C223507	ND	0.0050	C223507	ND	0.0050	C223507
Dissolved Strontium (Sr)	ug/L	18.7	0.050	C223507	18.7	0.050	C223507	62.8	0.050	C223507
Dissolved Tellurium (Te)	ug/L	ND	0.020	C223507	ND	0.020	C223507	ND	0.020	C223507
Dissolved Thallium (Tl)	ug/L	0.0030	0.0020	C223507	0.0031	0.0020	C223507	0.0071	0.0020	C223507
Dissolved Thorium (Th)	ug/L	0.0094	0.0050	C223507	0.0100	0.0050	C223507	ND	0.0050	C223507
Dissolved Tin (Sn)	ug/L	ND	0.20	C223507	ND	0.20	C223507	ND	0.20	C223507
Dissolved Titanium (Ti)	ug/L	ND	0.50	C223507	ND	0.50	C223507	ND	0.50	C223507
Dissolved Uranium (U)	ug/L	0.532	0.0020	C223507	0.526	0.0020	C223507	1.38	0.0020	C223507
Dissolved Vanadium (V)	ug/L	ND	0.20	C223507	ND	0.20	C223507	0.27	0.20	C223507
Dissolved Zinc (Zn)	ug/L	1.39	0.10	C223507	1.50	0.10	C223507	1.81	0.10	C223507
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C223507	ND	0.10	C223507	ND	0.10	C223507
Total Metals by ICPMS										
Total Aluminum (Al)	ug/L	371	3.0	C223665	381	3.0	C223665	549	3.0	C223665
Total Antimony (Sb)	ug/L	0.066	0.020	C223665	0.066	0.020	C223665	0.162	0.020	C223665
Total Arsenic (As)	ug/L	0.456	0.020	C223665	0.448	0.020	C223665	1.23	0.020	C223665
Total Barium (Ba)	ug/L	3.82	0.050	C223665	3.79	0.050	C223665	5.88	0.050	C223665
Total Beryllium (Be)	ug/L	ND	0.010	C223665	ND	0.010	C223665	ND	0.010	C223665
Total Bismuth (Bi)	ug/L	ND	0.010	C223665	ND	0.010	C223665	ND	0.010	C223665
Total Boron (B)	ug/L	ND	10	C223665	ND	10	C223665	11	10	C223665
Total Cadmium (Cd)	ug/L	0.0083	0.0050	C223665	0.0085	0.0050	C223665	0.0091	0.0050	C223665
Total Cesium (Cs)	ug/L	ND	0.050	C223665	ND	0.050	C223665	0.111	0.050	C223665
Total Chromium (Cr)	ug/L	0.33	0.10	C223665	0.31	0.10	C223665	0.61	0.10	C223665
Total Cobalt (Co)	ug/L	0.047	0.010	C223665	0.047	0.010	C223665	0.040	0.010	C223665
Total Copper (Cu)	ug/L	1.03	0.10	C223665	1.04	0.10	C223665	1.17	0.10	C223665
Total Iron (Fe)	ug/L	125	5.0	C223665	131	5.0	C223665	103	5.0	C223665
Total Lead (Pb)	ug/L	0.300	0.020	C223665	0.297	0.020	C223665	0.057	0.020	C223665
Total Lithium (Li)	ug/L	0.82	0.50	C223665	0.99	0.50	C223665	3.26	0.50	C223665
Total Manganese (Mn)	ug/L	4.47	0.10	C223665	4.50	0.10	C223665	10.3	0.10	C223665
Total Molybdenum (Mo)	ug/L	7.46	0.050	C223665	7.71	0.050	C223665	35.8	0.050	C223665
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP393			EAP393			EAP394		
Sampling Date		2026/02/10			2026/02/10			2026/02/10		
COC Number		123126			123126			123126		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Total Nickel (Ni)	ug/L	0.32	0.10	C223665	0.31	0.10	C223665	0.18	0.10	C223665
Total Phosphorus (P)	ug/L	63.5	5.0	C223665	64.0	5.0	C223665	6.4	5.0	C223665
Total Rubidium (Rb)	ug/L	1.47	0.050	C223665	1.49	0.050	C223665	5.73	0.050	C223665
Total Selenium (Se)	ug/L	ND	0.040	C223665	ND	0.040	C223665	0.067	0.040	C223665
Total Silicon (Si)	ug/L	3920	50	C223665	3920	50	C223665	6300	50	C223665
Total Silver (Ag)	ug/L	ND	0.010	C223665	ND	0.010	C223665	ND	0.010	C223665
Total Strontium (Sr)	ug/L	18.1	0.050	C223665	18.4	0.050	C223665	59.7	0.050	C223665
Total Tellurium (Te)	ug/L	ND	0.020	C223665	ND	0.020	C223665	ND	0.020	C223665
Total Thallium (Tl)	ug/L	0.0034	0.0020	C223665	0.0035	0.0020	C223665	0.0062	0.0020	C223665
Total Thorium (Th)	ug/L	ND	0.050	C223665	ND	0.050	C223665	ND	0.050	C223665
Total Tin (Sn)	ug/L	ND	0.20	C223665	ND	0.20	C223665	ND	0.20	C223665
Total Titanium (Ti)	ug/L	3.0	2.0	C223665	2.9	2.0	C223665	2.4	2.0	C223665
Total Uranium (U)	ug/L	0.574	0.0050	C223665	0.583	0.0050	C223665	1.31	0.0050	C223665
Total Vanadium (V)	ug/L	0.20	0.20	C223665	0.21	0.20	C223665	0.30	0.20	C223665
Total Zinc (Zn)	ug/L	2.2	1.0	C223665	2.3	1.0	C223665	2.6	1.0	C223665
Total Zirconium (Zr)	ug/L	ND	0.10	C223665	ND	0.10	C223665	ND	0.10	C223665
Total Calcium (Ca)	mg/L	5.81	0.25	C220401				18.9	0.25	C220401
Total Magnesium (Mg)	mg/L	0.43	0.25	C220401				0.90	0.25	C220401
Total Potassium (K)	mg/L	0.65	0.25	C220401				2.17	0.25	C220401
Total Sodium (Na)	mg/L	1.98	0.25	C220401				5.79	0.25	C220401
Total Sulphur (S)	mg/L	ND	3.0	C220401				4.4	3.0	C220401

RDL = Reportable Detection Limit
 Lab-Dup = Laboratory Initiated Duplicate
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP394			EAP395			EAP396	EAP397		
Sampling Date		2026/02/10			2026/02/10			2026/02/10	2026/02/10		
COC Number		123126			123126			123126	123126		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch

ANIONS

Bromide (Br)	mg/L	ND	0.010	C223496	ND	0.010	C223496	ND	ND	0.010	C223496
--------------	------	----	-------	---------	----	-------	---------	----	----	-------	---------

Dissolved Metals by ICPMS

Dissolved Calcium (Ca)	mg/L				1.89	0.050	C220094	ND	ND	0.050	C220094
Dissolved Magnesium (Mg)	mg/L				0.313	0.050	C220094	ND	ND	0.050	C220094
Dissolved Potassium (K)	mg/L				0.212	0.050	C220094	ND	ND	0.050	C220094
Dissolved Sodium (Na)	mg/L				1.09	0.050	C220094	ND	ND	0.050	C220094
Dissolved Sulphur (S)	mg/L				ND	3.0	C220094	ND	ND	3.0	C220094

Lab Filtered Metals

Dissolved Aluminum (Al)	ug/L				91.5	0.50	C223507	ND	ND	0.50	C223507
Dissolved Antimony (Sb)	ug/L				0.035	0.020	C223507	ND	ND	0.020	C223507
Dissolved Arsenic (As)	ug/L				0.240	0.020	C223507	ND	ND	0.020	C223507
Dissolved Barium (Ba)	ug/L				2.07	0.020	C223507	ND	ND	0.020	C223507
Dissolved Beryllium (Be)	ug/L				ND	0.010	C223507	ND	ND	0.010	C223507
Dissolved Bismuth (Bi)	ug/L				ND	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Boron (B)	ug/L				ND	10	C223507	ND	ND	10	C223507
Dissolved Cadmium (Cd)	ug/L				0.0071	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Cesium (Cs)	ug/L				ND	0.050	C223507	ND	ND	0.050	C223507
Dissolved Chromium (Cr)	ug/L				ND	0.10	C223507	ND	ND	0.10	C223507
Dissolved Cobalt (Co)	ug/L				0.0326	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Copper (Cu)	ug/L				1.06	0.050	C223507	ND	ND	0.050	C223507
Dissolved Iron (Fe)	ug/L				18.0	1.0	C223507	ND	ND	1.0	C223507
Dissolved Lead (Pb)	ug/L				0.0175	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Lithium (Li)	ug/L				ND	0.50	C223507	ND	ND	0.50	C223507
Dissolved Manganese (Mn)	ug/L				0.580	0.050	C223507	0.062	0.054	0.050	C223507
Dissolved Molybdenum (Mo)	ug/L				0.370	0.050	C223507	ND	ND	0.050	C223507
Dissolved Nickel (Ni)	ug/L				0.294	0.020	C223507	0.021	ND	0.020	C223507
Dissolved Phosphorus (P)	ug/L				96.4	2.0	C223507	3.3	ND	2.0	C223507
Dissolved Rubidium (Rb)	ug/L				0.236	0.050	C223507	ND	ND	0.050	C223507
Dissolved Selenium (Se)	ug/L				ND	0.040	C223507	ND	ND	0.040	C223507

RDL = Reportable Detection Limit
 Lab-Dup = Laboratory Initiated Duplicate
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP394			EAP395			EAP396	EAP397		
Sampling Date		2026/02/10			2026/02/10			2026/02/10	2026/02/10		
COC Number		123126			123126			123126	123126		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Dissolved Silicon (Si)	ug/L				3220	50	C223507	ND	ND	50	C223507
Dissolved Silver (Ag)	ug/L				ND	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Strontium (Sr)	ug/L				7.93	0.050	C223507	0.088	0.059	0.050	C223507
Dissolved Tellurium (Te)	ug/L				ND	0.020	C223507	ND	ND	0.020	C223507
Dissolved Thallium (Tl)	ug/L				0.0022	0.0020	C223507	ND	ND	0.0020	C223507
Dissolved Thorium (Th)	ug/L				0.0120	0.0050	C223507	ND	ND	0.0050	C223507
Dissolved Tin (Sn)	ug/L				ND	0.20	C223507	ND	ND	0.20	C223507
Dissolved Titanium (Ti)	ug/L				ND	0.50	C223507	ND	ND	0.50	C223507
Dissolved Uranium (U)	ug/L				0.121	0.0020	C223507	0.0028	ND	0.0020	C223507
Dissolved Vanadium (V)	ug/L				ND	0.20	C223507	ND	ND	0.20	C223507
Dissolved Zinc (Zn)	ug/L				1.33	0.10	C223507	ND	ND	0.10	C223507
Dissolved Zirconium (Zr)	ug/L				ND	0.10	C223507	ND	ND	0.10	C223507
Total Metals by ICPMS											
Total Aluminum (Al)	ug/L				104	3.0	C223665	ND	ND	0.50	C221371
Total Antimony (Sb)	ug/L				0.032	0.020	C223665	ND	ND	0.020	C221371
Total Arsenic (As)	ug/L				0.228	0.020	C223665	ND	ND	0.020	C221371
Total Barium (Ba)	ug/L				2.10	0.050	C223665	ND	ND	0.020	C221371
Total Beryllium (Be)	ug/L				ND	0.010	C223665	ND	ND	0.010	C221371
Total Bismuth (Bi)	ug/L				ND	0.010	C223665	ND	ND	0.0050	C221371
Total Boron (B)	ug/L				ND	10	C223665	ND	ND	10	C221371
Total Cadmium (Cd)	ug/L				0.0076	0.0050	C223665	ND	ND	0.0050	C221371
Total Cesium (Cs)	ug/L				ND	0.050	C223665	ND	ND	0.050	C221371
Total Chromium (Cr)	ug/L				ND	0.10	C223665	ND	ND	0.10	C221371
Total Cobalt (Co)	ug/L				0.036	0.010	C223665	ND	ND	0.0050	C221371
Total Copper (Cu)	ug/L				1.00	0.10	C223665	0.057	ND	0.050	C221371
Total Iron (Fe)	ug/L				32.3	5.0	C223665	ND	ND	1.0	C221371
Total Lead (Pb)	ug/L				0.032	0.020	C223665	ND	ND	0.0050	C221371
Total Lithium (Li)	ug/L				ND	0.50	C223665	ND	ND	0.50	C221371
Total Manganese (Mn)	ug/L				0.99	0.10	C223665	ND	ND	0.050	C221371
Total Molybdenum (Mo)	ug/L				0.397	0.050	C223665	ND	ND	0.050	C221371
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP394			EAP395			EAP396	EAP397		
Sampling Date		2026/02/10			2026/02/10			2026/02/10	2026/02/10		
COC Number		123126			123126			123126	123126		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Total Nickel (Ni)	ug/L				0.28	0.10	C223665	ND	ND	0.020	C221371
Total Phosphorus (P)	ug/L				87.9	5.0	C223665	ND	ND	2.0	C221371
Total Rubidium (Rb)	ug/L				0.236	0.050	C223665	ND	ND	0.050	C221371
Total Selenium (Se)	ug/L				ND	0.040	C223665	ND	ND	0.040	C221371
Total Silicon (Si)	ug/L				2940	50	C223665	ND	ND	50	C221371
Total Silver (Ag)	ug/L				ND	0.010	C223665	ND	ND	0.0050	C221371
Total Strontium (Sr)	ug/L				7.59	0.050	C223665	ND	ND	0.050	C221371
Total Tellurium (Te)	ug/L				ND	0.020	C223665	ND	ND	0.020	C221371
Total Thallium (Tl)	ug/L				0.0022	0.0020	C223665	ND	ND	0.0020	C221371
Total Thorium (Th)	ug/L				ND	0.050	C223665	ND	ND	0.050	C221371
Total Tin (Sn)	ug/L				ND	0.20	C223665	ND	ND	0.20	C221371
Total Titanium (Ti)	ug/L				ND	2.0	C223665	ND	ND	0.50	C221371
Total Uranium (U)	ug/L				0.134	0.0050	C223665	ND	ND	0.0020	C221371
Total Vanadium (V)	ug/L				ND	0.20	C223665	ND	ND	0.20	C221371
Total Zinc (Zn)	ug/L				1.4	1.0	C223665	0.13	ND	0.10	C221371
Total Zirconium (Zr)	ug/L				ND	0.10	C223665	ND	ND	0.10	C221371
Total Calcium (Ca)	mg/L				1.77	0.25	C220401	ND	ND	0.050	C220401
Total Magnesium (Mg)	mg/L				0.29	0.25	C220401	ND	ND	0.050	C220401
Total Potassium (K)	mg/L				ND	0.25	C220401	ND	ND	0.050	C220401
Total Sodium (Na)	mg/L				1.00	0.25	C220401	ND	ND	0.050	C220401
Total Sulphur (S)	mg/L				ND	3.0	C220401	ND	ND	3.0	C220401

RDL = Reportable Detection Limit

Lab-Dup = Laboratory Initiated Duplicate

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP398		
Sampling Date		2026/02/10		
COC Number		123126		
	UNITS	DUP	RDL	QC Batch
ANIONS				
Bromide (Br)	mg/L	ND	0.010	C223496
Dissolved Metals by ICPMS				
Dissolved Calcium (Ca)	mg/L	19.8	0.050	C220094
Dissolved Magnesium (Mg)	mg/L	0.957	0.050	C220094
Dissolved Potassium (K)	mg/L	2.22	0.050	C220094
Dissolved Sodium (Na)	mg/L	6.06	0.050	C220094
Dissolved Sulphur (S)	mg/L	4.5	3.0	C220094
Lab Filtered Metals				
Dissolved Aluminum (Al)	ug/L	266	0.50	C223507
Dissolved Antimony (Sb)	ug/L	0.153	0.020	C223507
Dissolved Arsenic (As)	ug/L	1.12	0.020	C223507
Dissolved Barium (Ba)	ug/L	5.26	0.020	C223507
Dissolved Beryllium (Be)	ug/L	ND	0.010	C223507
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C223507
Dissolved Boron (B)	ug/L	13	10	C223507
Dissolved Cadmium (Cd)	ug/L	0.0091	0.0050	C223507
Dissolved Cesium (Cs)	ug/L	0.106	0.050	C223507
Dissolved Chromium (Cr)	ug/L	0.55	0.10	C223507
Dissolved Cobalt (Co)	ug/L	0.0245	0.0050	C223507
Dissolved Copper (Cu)	ug/L	1.06	0.050	C223507
Dissolved Iron (Fe)	ug/L	5.6	1.0	C223507
Dissolved Lead (Pb)	ug/L	0.0050	0.0050	C223507
Dissolved Lithium (Li)	ug/L	3.25	0.50	C223507
Dissolved Manganese (Mn)	ug/L	7.77	0.050	C223507
Dissolved Molybdenum (Mo)	ug/L	38.2	0.050	C223507
Dissolved Nickel (Ni)	ug/L	0.140	0.020	C223507
Dissolved Phosphorus (P)	ug/L	5.2	2.0	C223507
Dissolved Rubidium (Rb)	ug/L	5.86	0.050	C223507
Dissolved Selenium (Se)	ug/L	ND	0.040	C223507
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP398		
Sampling Date		2026/02/10		
COC Number		123126		
	UNITS	DUP	RDL	QC Batch
Dissolved Silicon (Si)	ug/L	6670	50	C223507
Dissolved Silver (Ag)	ug/L	ND	0.0050	C223507
Dissolved Strontium (Sr)	ug/L	61.9	0.050	C223507
Dissolved Tellurium (Te)	ug/L	ND	0.020	C223507
Dissolved Thallium (Tl)	ug/L	0.0065	0.0020	C223507
Dissolved Thorium (Th)	ug/L	ND	0.0050	C223507
Dissolved Tin (Sn)	ug/L	ND	0.20	C223507
Dissolved Titanium (Ti)	ug/L	ND	0.50	C223507
Dissolved Uranium (U)	ug/L	1.20	0.0020	C223507
Dissolved Vanadium (V)	ug/L	0.25	0.20	C223507
Dissolved Zinc (Zn)	ug/L	1.77	0.10	C223507
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C223507
Total Metals by ICPMS				
Total Aluminum (Al)	ug/L	701	3.0	C223665
Total Antimony (Sb)	ug/L	0.179	0.020	C223665
Total Arsenic (As)	ug/L	1.32	0.020	C223665
Total Barium (Ba)	ug/L	7.10	0.050	C223665
Total Beryllium (Be)	ug/L	ND	0.010	C223665
Total Bismuth (Bi)	ug/L	ND	0.010	C223665
Total Boron (B)	ug/L	11	10	C223665
Total Cadmium (Cd)	ug/L	0.0101	0.0050	C223665
Total Cesium (Cs)	ug/L	0.120	0.050	C223665
Total Chromium (Cr)	ug/L	0.72	0.10	C223665
Total Cobalt (Co)	ug/L	0.053	0.010	C223665
Total Copper (Cu)	ug/L	2.06	0.10	C223665
Total Iron (Fe)	ug/L	221	5.0	C223665
Total Lead (Pb)	ug/L	0.121	0.020	C223665
Total Lithium (Li)	ug/L	3.33	0.50	C223665
Total Manganese (Mn)	ug/L	12.9	0.10	C223665
Total Molybdenum (Mo)	ug/L	37.6	0.050	C223665
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EAP398		
Sampling Date		2026/02/10		
COC Number		123126		
	UNITS	DUP	RDL	QC Batch
Total Nickel (Ni)	ug/L	0.26	0.10	C223665
Total Phosphorus (P)	ug/L	8.4	5.0	C223665
Total Rubidium (Rb)	ug/L	6.12	0.050	C223665
Total Selenium (Se)	ug/L	0.077	0.040	C223665
Total Silicon (Si)	ug/L	6740	50	C223665
Total Silver (Ag)	ug/L	ND	0.010	C223665
Total Strontium (Sr)	ug/L	62.9	0.050	C223665
Total Tellurium (Te)	ug/L	ND	0.020	C223665
Total Thallium (Tl)	ug/L	0.0092	0.0020	C223665
Total Thorium (Th)	ug/L	ND	0.050	C223665
Total Tin (Sn)	ug/L	ND	0.20	C223665
Total Titanium (Ti)	ug/L	6.3	2.0	C223665
Total Uranium (U)	ug/L	1.46	0.0050	C223665
Total Vanadium (V)	ug/L	0.37	0.20	C223665
Total Zinc (Zn)	ug/L	3.2	1.0	C223665
Total Zirconium (Zr)	ug/L	ND	0.10	C223665
Total Calcium (Ca)	mg/L	20.1	0.25	C220401
Total Magnesium (Mg)	mg/L	0.97	0.25	C220401
Total Potassium (K)	mg/L	2.31	0.25	C220401
Total Sodium (Na)	mg/L	6.22	0.25	C220401
Total Sulphur (S)	mg/L	4.7	3.0	C220401
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C607390
 Report Date: 2026/02/24

HATFIELD CONSULTANTS
 Client Project #: FORTIS11234/PE-110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your P.O. #: 4800010213

MISCELLANEOUS (WATER)

Bureau Veritas ID		EAP393	EAP394	EAP395	EAP398		
Sampling Date		2026/02/10	2026/02/10	2026/02/10	2026/02/10		
COC Number		123126	123126	123126	123126		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	DUP	RDL	QC Batch
Calculated Parameters							
Total Un-ionized Hydrogen Sulfide as S	mg/L	ND	ND	ND	ND	0.0018	C221007
Total Un-ionized Hydrogen Sulfide as H2S	mg/L	ND	ND	ND	ND	0.0019	C221007
RDL = Reportable Detection Limit							
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.							



LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EAP394	EAP398		
Sampling Date		2026/02/10	2026/02/10		
COC Number		123126	123126		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Calculated Parameters					
Low Molecular Weight PAH's	ug/L	ND	ND	0.10	C221014
High Molecular Weight PAH's	ug/L	ND	ND	0.050	C221014
Total PAH	ug/L	ND	ND	0.10	C221014
Polycyclic Aromatics					
Quinoline	ug/L	ND	ND	0.020	C222163
Naphthalene	ug/L	ND	ND	0.10	C222163
1-Methylnaphthalene	ug/L	ND	ND	0.050	C222163
2-Methylnaphthalene	ug/L	ND	ND	0.10	C222163
Acenaphthylene	ug/L	ND	ND	0.050	C222163
Acenaphthene	ug/L	ND	ND	0.050	C222163
Fluorene	ug/L	ND	ND	0.050	C222163
Phenanthrene	ug/L	ND	ND	0.050	C222163
Anthracene	ug/L	ND	ND	0.010	C222163
Acridine	ug/L	ND	ND	0.050	C222163
Fluoranthene	ug/L	ND	ND	0.020	C222163
Pyrene	ug/L	ND	ND	0.020	C222163
Benzo(a)anthracene	ug/L	ND	ND	0.010	C222163
Chrysene	ug/L	ND	ND	0.020	C222163
Benzo(b&j)fluoranthene	ug/L	ND	ND	0.030	C222163
Benzo(k)fluoranthene	ug/L	ND	ND	0.050	C222163
Benzo(a)pyrene	ug/L	ND	ND	0.0050	C222163
Indeno(1,2,3-cd)pyrene	ug/L	ND	ND	0.050	C222163
Dibenz(a,h)anthracene	ug/L	ND	ND	0.0030	C222163
Benzo(g,h,i)perylene	ug/L	ND	ND	0.050	C222163
Calculated Parameters					
LEPH (C10-C19 less PAH)	mg/L	0.27	0.27	0.20	C221015
HEPH (C19-C32 less PAH)	mg/L	ND	ND	0.20	C221015
Ext. Pet. Hydrocarbon					
EPH (C10-C19)	mg/L	0.27	0.27	0.20	C222169
EPH (C19-C32)	mg/L	ND	ND	0.20	C222169
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



Bureau Veritas Job #: C607390
 Report Date: 2026/02/24

HATFIELD CONSULTANTS
 Client Project #: FORTIS11234/PE-110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your P.O. #: 4800010213

LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EAP394	EAP398		
Sampling Date		2026/02/10	2026/02/10		
COC Number		123126	123126		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Surrogate Recovery (%)					
O-TERPHENYL (sur.)	%	102	112		C222169
D10-ANTHRACENE (sur.)	%	95	95		C222163
D8-ACENAPHTHYLENE (sur.)	%	94	93		C222163
D8-NAPHTHALENE (sur.)	%	88	82		C222163
TERPHENYL-D14 (sur.)	%	87	93		C222163
RDL = Reportable Detection Limit					



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EAP394	EAP398		
Sampling Date		2026/02/10	2026/02/10		
COC Number		123126	123126		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Calculated Parameters					
VPH (VH6 to 10 - BTEX)	ug/L	ND	ND	300	C221016
Volatiles					
VH C6-C10	ug/L	ND	ND	300	C221568
1,1,1,2-tetrachloroethane	ug/L	ND	ND	0.50	C221568
1,1,1-trichloroethane	ug/L	ND	ND	0.50	C221568
1,1,2,2-tetrachloroethane	ug/L	ND	ND	0.50	C221568
1,1,2Trichloro-1,2,2Trifluoroethane	ug/L	ND	ND	2.0	C221568
1,1,2-trichloroethane	ug/L	ND	ND	0.50	C221568
1,1-dichloroethane	ug/L	ND	ND	0.50	C221568
1,1-dichloroethene	ug/L	ND	ND	0.50	C221568
1,2,3-trichlorobenzene	ug/L	ND	ND	2.0	C221568
1,2,4-trichlorobenzene	ug/L	ND	ND	2.0	C221568
1,2-dibromoethane	ug/L	ND	ND	0.20	C221568
1,2-dichlorobenzene	ug/L	ND	ND	0.50	C221568
1,2-dichloroethane	ug/L	ND	ND	0.50	C221568
1,2-dichloropropane	ug/L	ND	ND	0.50	C221568
1,3,5-trimethylbenzene	ug/L	ND	ND	2.0	C221568
1,3-Butadiene	ug/L	ND	ND	0.50	C221568
1,3-dichlorobenzene	ug/L	ND	ND	0.50	C221568
1,3-dichloropropane	ug/L	ND	ND	1.0	C221568
1,4-dichlorobenzene	ug/L	ND	ND	0.50	C221568
Benzene	ug/L	ND	ND	0.40	C221568
Bromobenzene	ug/L	ND	ND	2.0	C221568
Bromodichloromethane	ug/L	ND	ND	1.0	C221568
Bromoform	ug/L	ND	ND	1.0	C221568
Bromomethane	ug/L	ND	ND	1.0	C221568
Carbon tetrachloride	ug/L	ND	ND	0.50	C221568
Chlorobenzene	ug/L	ND	ND	0.50	C221568
Dibromochloromethane	ug/L	ND	ND	1.0	C221568
Chloroethane	ug/L	ND	ND	1.0	C221568
Chloroform	ug/L	ND	ND	1.0	C221568
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EAP394	EAP398		
Sampling Date		2026/02/10	2026/02/10		
COC Number		123126	123126		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Chloromethane	ug/L	ND	ND	1.0	C221568
cis-1,2-dichloroethene	ug/L	ND	ND	1.0	C221568
cis-1,3-dichloropropene	ug/L	ND	ND	1.0	C221568
Dichlorodifluoromethane	ug/L	ND	ND	2.0	C221568
Dichloromethane	ug/L	ND	ND	2.0	C221568
Ethylbenzene	ug/L	ND	ND	0.40	C221568
Hexachlorobutadiene	ug/L	ND	ND	0.50	C221568
Isopropylbenzene	ug/L	ND	ND	2.0	C221568
Methyl-tert-butylether (MTBE)	ug/L	ND	ND	4.0	C221568
Styrene	ug/L	ND	ND	0.50	C221568
Tetrachloroethene	ug/L	ND	ND	0.50	C221568
Toluene	ug/L	ND	ND	0.40	C221568
trans-1,2-dichloroethene	ug/L	ND	ND	1.0	C221568
trans-1,3-dichloropropene	ug/L	ND	ND	1.0	C221568
Trichloroethene	ug/L	ND	ND	0.50	C221568
Trichlorofluoromethane	ug/L	ND	ND	4.0	C221568
Vinyl chloride	ug/L	ND	ND	0.50	C221568
m & p-Xylene	ug/L	ND	ND	0.40	C221568
o-Xylene	ug/L	ND	ND	0.40	C221568
Xylenes (Total)	ug/L	ND	ND	0.40	C221568
Surrogate Recovery (%)					
1,4-Difluorobenzene (sur.)	%	102	102		C221568
4-Bromofluorobenzene (sur.)	%	84	85		C221568
D4-1,2-Dichloroethane (sur.)	%	98	100		C221568
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



**BUREAU
VERITAS**

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

GENERAL COMMENTS

Results relate only to the items tested.



QUALITY ASSURANCE REPORT

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C221371	MEM	Matrix Spike	Total Aluminum (Al)	2026/02/11	103	%	80 - 120		
			Total Antimony (Sb)	2026/02/11	102	%	80 - 120		
			Total Arsenic (As)	2026/02/11	100	%	80 - 120		
			Total Barium (Ba)	2026/02/11	98	%	80 - 120		
			Total Beryllium (Be)	2026/02/11	99	%	80 - 120		
			Total Bismuth (Bi)	2026/02/11	102	%	80 - 120		
			Total Boron (B)	2026/02/11	103	%	80 - 120		
			Total Cadmium (Cd)	2026/02/11	98	%	80 - 120		
			Total Cesium (Cs)	2026/02/11	93	%	80 - 120		
			Total Chromium (Cr)	2026/02/11	95	%	80 - 120		
			Total Cobalt (Co)	2026/02/11	97	%	80 - 120		
			Total Copper (Cu)	2026/02/11	91	%	80 - 120		
			Total Iron (Fe)	2026/02/11	103	%	80 - 120		
			Total Lead (Pb)	2026/02/11	96	%	80 - 120		
			Total Lithium (Li)	2026/02/11	99	%	80 - 120		
			Total Manganese (Mn)	2026/02/11	93	%	80 - 120		
			Total Molybdenum (Mo)	2026/02/11	105	%	80 - 120		
			Total Nickel (Ni)	2026/02/11	96	%	80 - 120		
			Total Phosphorus (P)	2026/02/11	103	%	80 - 120		
			Total Rubidium (Rb)	2026/02/11	95	%	80 - 120		
			Total Selenium (Se)	2026/02/11	99	%	80 - 120		
			Total Silicon (Si)	2026/02/11	106	%	80 - 120		
			Total Silver (Ag)	2026/02/11	96	%	80 - 120		
			Total Strontium (Sr)	2026/02/11	93	%	80 - 120		
			Total Tellurium (Te)	2026/02/11	109	%	80 - 120		
			Total Thallium (Tl)	2026/02/11	102	%	80 - 120		
			Total Thorium (Th)	2026/02/11	100	%	80 - 120		
			Total Tin (Sn)	2026/02/11	101	%	80 - 120		
			Total Titanium (Ti)	2026/02/11	100	%	80 - 120		
			Total Uranium (U)	2026/02/11	99	%	80 - 120		
			Total Vanadium (V)	2026/02/11	95	%	80 - 120		
			Total Zinc (Zn)	2026/02/11	99	%	80 - 120		
			Total Zirconium (Zr)	2026/02/11	104	%	80 - 120		
C221371	MEM	Spiked Blank	Total Aluminum (Al)	2026/02/11	108	%	80 - 120		
			Total Antimony (Sb)	2026/02/11	108	%	80 - 120		
			Total Arsenic (As)	2026/02/11	106	%	80 - 120		
			Total Barium (Ba)	2026/02/11	104	%	80 - 120		
			Total Beryllium (Be)	2026/02/11	106	%	80 - 120		
			Total Bismuth (Bi)	2026/02/11	106	%	80 - 120		
			Total Boron (B)	2026/02/11	111	%	80 - 120		
			Total Cadmium (Cd)	2026/02/11	103	%	80 - 120		
			Total Cesium (Cs)	2026/02/11	98	%	80 - 120		
			Total Chromium (Cr)	2026/02/11	99	%	80 - 120		
			Total Cobalt (Co)	2026/02/11	104	%	80 - 120		
			Total Copper (Cu)	2026/02/11	97	%	80 - 120		
			Total Iron (Fe)	2026/02/11	108	%	80 - 120		
			Total Lead (Pb)	2026/02/11	103	%	80 - 120		
			Total Lithium (Li)	2026/02/11	107	%	80 - 120		
Total Manganese (Mn)	2026/02/11	98	%	80 - 120					
Total Molybdenum (Mo)	2026/02/11	112	%	80 - 120					
Total Nickel (Ni)	2026/02/11	102	%	80 - 120					
Total Phosphorus (P)	2026/02/11	102	%	80 - 120					
Total Rubidium (Rb)	2026/02/11	101	%	80 - 120					



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Selenium (Se)	2026/02/11		103	%	80 - 120
			Total Silicon (Si)	2026/02/11		105	%	80 - 120
			Total Silver (Ag)	2026/02/11		102	%	80 - 120
			Total Strontium (Sr)	2026/02/11		99	%	80 - 120
			Total Tellurium (Te)	2026/02/11		114	%	80 - 120
			Total Thallium (Tl)	2026/02/11		107	%	80 - 120
			Total Thorium (Th)	2026/02/11		104	%	80 - 120
			Total Tin (Sn)	2026/02/11		107	%	80 - 120
			Total Titanium (Ti)	2026/02/11		104	%	80 - 120
			Total Uranium (U)	2026/02/11		105	%	80 - 120
			Total Vanadium (V)	2026/02/11		100	%	80 - 120
			Total Zinc (Zn)	2026/02/11		104	%	80 - 120
			Total Zirconium (Zr)	2026/02/11		110	%	80 - 120
C221371	MEM	Method Blank	Total Aluminum (Al)	2026/02/11	ND, RDL=0.50		ug/L	
			Total Antimony (Sb)	2026/02/11	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/02/11	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/02/11	ND, RDL=0.020		ug/L	
			Total Beryllium (Be)	2026/02/11	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/02/11	ND, RDL=0.0050		ug/L	
			Total Boron (B)	2026/02/11	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/02/11	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/02/11	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/02/11	ND, RDL=0.0050		ug/L	
			Total Copper (Cu)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Iron (Fe)	2026/02/11	ND, RDL=1.0		ug/L	
			Total Lead (Pb)	2026/02/11	ND, RDL=0.0050		ug/L	
			Total Lithium (Li)	2026/02/11	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Molybdenum (Mo)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/02/11	ND, RDL=0.020		ug/L	
			Total Phosphorus (P)	2026/02/11	ND, RDL=2.0		ug/L	
			Total Rubidium (Rb)	2026/02/11	ND, RDL=0.050		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Selenium (Se)	2026/02/11	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/02/11	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/02/11	ND, RDL=0.0050		ug/L	
			Total Strontium (Sr)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/02/11	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/02/11	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/02/11	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/02/11	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/02/11	ND, RDL=0.50		ug/L	
			Total Uranium (U)	2026/02/11	ND, RDL=0.0020		ug/L	
			Total Vanadium (V)	2026/02/11	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/02/11	ND, RDL=0.10		ug/L	
			Total Zirconium (Zr)	2026/02/11	ND, RDL=0.10		ug/L	
C221371	MEM	RPD	Total Aluminum (Al)	2026/02/11	NC		%	20
			Total Antimony (Sb)	2026/02/11	NC		%	20
			Total Arsenic (As)	2026/02/11	NC		%	20
			Total Barium (Ba)	2026/02/11	15		%	20
			Total Beryllium (Be)	2026/02/11	NC		%	20
			Total Bismuth (Bi)	2026/02/11	NC		%	20
			Total Boron (B)	2026/02/11	NC		%	20
			Total Cadmium (Cd)	2026/02/11	NC		%	20
			Total Chromium (Cr)	2026/02/11	NC		%	20
			Total Cobalt (Co)	2026/02/11	NC		%	20
			Total Copper (Cu)	2026/02/11	0.075		%	20
			Total Iron (Fe)	2026/02/11	NC		%	20
			Total Lead (Pb)	2026/02/11	NC		%	20
			Total Lithium (Li)	2026/02/11	NC		%	20
			Total Manganese (Mn)	2026/02/11	4.7		%	20
			Total Molybdenum (Mo)	2026/02/11	NC		%	20
			Total Nickel (Ni)	2026/02/11	NC		%	20
			Total Selenium (Se)	2026/02/11	NC		%	20
			Total Silicon (Si)	2026/02/11	NC		%	20
			Total Silver (Ag)	2026/02/11	NC		%	20
			Total Strontium (Sr)	2026/02/11	NC		%	20
			Total Thallium (Tl)	2026/02/11	NC		%	20
			Total Tin (Sn)	2026/02/11	NC		%	20
			Total Titanium (Ti)	2026/02/11	NC		%	20
			Total Uranium (U)	2026/02/11	NC		%	20
			Total Vanadium (V)	2026/02/11	NC		%	20
			Total Zinc (Zn)	2026/02/11	4.3		%	20



BUREAU
VERITAS

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Zirconium (Zr)	2026/02/11	NC		%	20
C221501	JLP	Spiked Blank	Alkalinity (Total as CaCO3)	2026/02/11		97	%	80 - 120
C221501	JLP	Method Blank	Alkalinity (PP as CaCO3)	2026/02/11	ND, RDL=1.0		mg/L	
			Alkalinity (Total as CaCO3)	2026/02/11	ND, RDL=1.0		mg/L	
			Bicarbonate (HCO3)	2026/02/11	ND, RDL=1.0		mg/L	
			Carbonate (CO3)	2026/02/11	ND, RDL=1.0		mg/L	
			Hydroxide (OH)	2026/02/11	ND, RDL=1.0		mg/L	
C221501	JLP	RPD [EAP394-02]	Alkalinity (PP as CaCO3)	2026/02/11	NC		%	20
			Alkalinity (Total as CaCO3)	2026/02/11	0.13		%	20
			Bicarbonate (HCO3)	2026/02/11	0.13		%	20
			Carbonate (CO3)	2026/02/11	NC		%	20
			Hydroxide (OH)	2026/02/11	NC		%	20
C221505	JLP	Spiked Blank	pH	2026/02/11		100	%	97 - 103
C221505	JLP	RPD [EAP394-02]	pH	2026/02/11	0.55		%	N/A
C221568	NGU	Matrix Spike	1,4-Difluorobenzene (sur.)	2026/02/12		98	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/12		105	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/12		102	%	50 - 140
			1,1,1,2-tetrachloroethane	2026/02/12		105	%	50 - 140
			1,1,1-trichloroethane	2026/02/12		108	%	50 - 140
			1,1,2,2-tetrachloroethane	2026/02/12		99	%	50 - 140
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/12		105	%	50 - 140
			1,1,2-trichloroethane	2026/02/12		103	%	50 - 140
			1,1-dichloroethane	2026/02/12		116	%	50 - 140
			1,1-dichloroethene	2026/02/12		122	%	50 - 140
			1,2,3-trichlorobenzene	2026/02/12		117	%	50 - 140
			1,2,4-trichlorobenzene	2026/02/12		109	%	50 - 140
			1,2-dibromoethane	2026/02/12		101	%	50 - 140
			1,2-dichlorobenzene	2026/02/12		115	%	50 - 140
			1,2-dichloroethane	2026/02/12		100	%	50 - 140
			1,2-dichloropropane	2026/02/12		107	%	50 - 140
			1,3,5-trimethylbenzene	2026/02/12		136	%	50 - 140
			1,3-Butadiene	2026/02/12		63	%	50 - 140
			1,3-dichlorobenzene	2026/02/12		114	%	50 - 140
			1,3-dichloropropane	2026/02/12		107	%	50 - 140
			1,4-dichlorobenzene	2026/02/12		96	%	50 - 140
			Benzene	2026/02/12		112	%	50 - 140
			Bromobenzene	2026/02/12		112	%	50 - 140
			Bromodichloromethane	2026/02/12		102	%	50 - 140
			Bromoform	2026/02/12		101	%	50 - 140
			Bromomethane	2026/02/12		98	%	50 - 140
			Carbon tetrachloride	2026/02/12		107	%	50 - 140
			Chlorobenzene	2026/02/12		105	%	50 - 140
			Dibromochloromethane	2026/02/12		100	%	50 - 140
			Chloroethane	2026/02/12		128	%	50 - 140
			Chloroform	2026/02/12		102	%	50 - 140
			Chloromethane	2026/02/12		101	%	50 - 140
			cis-1,2-dichloroethene	2026/02/12		108	%	50 - 140
			cis-1,3-dichloropropene	2026/02/12		102	%	50 - 140



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dichlorodifluoromethane	2026/02/12		113	%	50 - 140
			Dichloromethane	2026/02/12		100	%	50 - 140
			Ethylbenzene	2026/02/12		125	%	50 - 140
			Hexachlorobutadiene	2026/02/12		108	%	50 - 140
			Isopropylbenzene	2026/02/12		110	%	50 - 140
			Methyl-tert-butylether (MTBE)	2026/02/12		94	%	50 - 140
			Styrene	2026/02/12		104	%	50 - 140
			Tetrachloroethene	2026/02/12		100	%	50 - 140
			Toluene	2026/02/12		110	%	50 - 140
			trans-1,2-dichloroethene	2026/02/12		113	%	50 - 140
			trans-1,3-dichloropropene	2026/02/12		100	%	50 - 140
			Trichloroethene	2026/02/12		100	%	50 - 140
			Trichlorofluoromethane	2026/02/12		104	%	50 - 140
			Vinyl chloride	2026/02/12		103	%	50 - 140
			m & p-Xylene	2026/02/12		125	%	50 - 140
			o-Xylene	2026/02/12		110	%	50 - 140
C221568	NGU	Spiked Blank	1,4-Difluorobenzene (sur.)	2026/02/12		98	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/12		105	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/12		102	%	50 - 140
			VH C6-C10	2026/02/12		86	%	70 - 130
			1,1,1,2-tetrachloroethane	2026/02/12		100	%	60 - 130
			1,1,1-trichloroethane	2026/02/12		105	%	60 - 130
			1,1,2,2-tetrachloroethane	2026/02/12		95	%	60 - 130
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/12		101	%	60 - 130
			1,1,2-trichloroethane	2026/02/12		98	%	60 - 130
			1,1-dichloroethane	2026/02/12		112	%	60 - 130
			1,1-dichloroethene	2026/02/12		116	%	60 - 130
			1,2,3-trichlorobenzene	2026/02/12		106	%	60 - 130
			1,2,4-trichlorobenzene	2026/02/12		92	%	60 - 130
			1,2-dibromoethane	2026/02/12		96	%	60 - 130
			1,2-dichlorobenzene	2026/02/12		107	%	60 - 130
			1,2-dichloroethane	2026/02/12		96	%	60 - 130
			1,2-dichloropropane	2026/02/12		104	%	60 - 130
			1,3,5-trimethylbenzene	2026/02/12		128	%	60 - 130
			1,3-Butadiene	2026/02/12		62	%	50 - 140
			1,3-dichlorobenzene	2026/02/12		102	%	60 - 130
			1,3-dichloropropane	2026/02/12		103	%	60 - 130
			1,4-dichlorobenzene	2026/02/12		84	%	60 - 130
			Benzene	2026/02/12		107	%	60 - 130
			Bromobenzene	2026/02/12		105	%	60 - 130
			Bromodichloromethane	2026/02/12		97	%	60 - 130
			Bromoform	2026/02/12		98	%	60 - 130
			Bromomethane	2026/02/12		92	%	50 - 140
			Carbon tetrachloride	2026/02/12		103	%	60 - 130
			Chlorobenzene	2026/02/12		97	%	60 - 130
			Dibromochloromethane	2026/02/12		96	%	60 - 130
			Chloroethane	2026/02/12		86	%	50 - 140
			Chloroform	2026/02/12		98	%	60 - 130
			Chloromethane	2026/02/12		99	%	50 - 140
			cis-1,2-dichloroethene	2026/02/12		102	%	60 - 130
			cis-1,3-dichloropropene	2026/02/12		103	%	50 - 140
			Dichlorodifluoromethane	2026/02/12		111	%	50 - 140
			Dichloromethane	2026/02/12		94	%	60 - 130



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Ethylbenzene	2026/02/12		116	%	60 - 130
			Hexachlorobutadiene	2026/02/12		98	%	60 - 130
			Isopropylbenzene	2026/02/12		104	%	60 - 130
			Methyl-tert-butylether (MTBE)	2026/02/12		91	%	60 - 130
			Styrene	2026/02/12		96	%	60 - 130
			Tetrachloroethene	2026/02/12		95	%	60 - 130
			Toluene	2026/02/12		104	%	60 - 130
			trans-1,2-dichloroethene	2026/02/12		100	%	60 - 130
			trans-1,3-dichloropropene	2026/02/12		100	%	50 - 140
			Trichloroethene	2026/02/12		92	%	60 - 130
			Trichlorofluoromethane	2026/02/12		99	%	60 - 130
			Vinyl chloride	2026/02/12		101	%	50 - 140
			m & p-Xylene	2026/02/12		114	%	60 - 130
			o-Xylene	2026/02/12		104	%	60 - 130
C221568	NGU	Method Blank	1,4-Difluorobenzene (sur.)	2026/02/12		101	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/12		85	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/12		97	%	50 - 140
			VH C6-C10	2026/02/12	ND, RDL=300		ug/L	
			1,1,1,2-tetrachloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,1,1-trichloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,1,2,2-tetrachloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/12	ND, RDL=2.0		ug/L	
			1,1,2-trichloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,1-dichloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,1-dichloroethene	2026/02/12	ND, RDL=0.50		ug/L	
			1,2,3-trichlorobenzene	2026/02/12	ND, RDL=2.0		ug/L	
			1,2,4-trichlorobenzene	2026/02/12	ND, RDL=2.0		ug/L	
			1,2-dibromoethane	2026/02/12	ND, RDL=0.20		ug/L	
			1,2-dichlorobenzene	2026/02/12	ND, RDL=0.50		ug/L	
			1,2-dichloroethane	2026/02/12	ND, RDL=0.50		ug/L	
			1,2-dichloropropane	2026/02/12	ND, RDL=0.50		ug/L	
			1,3,5-trimethylbenzene	2026/02/12	ND, RDL=2.0		ug/L	
			1,3-Butadiene	2026/02/12	ND, RDL=0.50		ug/L	
			1,3-dichlorobenzene	2026/02/12	ND, RDL=0.50		ug/L	
			1,3-dichloropropane	2026/02/12	ND, RDL=1.0		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,4-dichlorobenzene	2026/02/12	ND, RDL=0.50		ug/L	
			Benzene	2026/02/12	ND, RDL=0.40		ug/L	
			Bromobenzene	2026/02/12	ND, RDL=2.0		ug/L	
			Bromodichloromethane	2026/02/12	ND, RDL=1.0		ug/L	
			Bromoform	2026/02/12	ND, RDL=1.0		ug/L	
			Bromomethane	2026/02/12	ND, RDL=1.0		ug/L	
			Carbon tetrachloride	2026/02/12	ND, RDL=0.50		ug/L	
			Chlorobenzene	2026/02/12	ND, RDL=0.50		ug/L	
			Dibromochloromethane	2026/02/12	ND, RDL=1.0		ug/L	
			Chloroethane	2026/02/12	ND, RDL=1.0		ug/L	
			Chloroform	2026/02/12	ND, RDL=1.0		ug/L	
			Chloromethane	2026/02/12	ND, RDL=1.0		ug/L	
			cis-1,2-dichloroethene	2026/02/12	ND, RDL=1.0		ug/L	
			cis-1,3-dichloropropene	2026/02/12	ND, RDL=1.0		ug/L	
			Dichlorodifluoromethane	2026/02/12	ND, RDL=2.0		ug/L	
			Dichloromethane	2026/02/12	ND, RDL=2.0		ug/L	
			Ethylbenzene	2026/02/12	ND, RDL=0.40		ug/L	
			Hexachlorobutadiene	2026/02/12	ND, RDL=0.50		ug/L	
			Isopropylbenzene	2026/02/12	ND, RDL=2.0		ug/L	
			Methyl-tert-butylether (MTBE)	2026/02/12	ND, RDL=4.0		ug/L	
			Styrene	2026/02/12	ND, RDL=0.50		ug/L	
			Tetrachloroethene	2026/02/12	ND, RDL=0.50		ug/L	
			Toluene	2026/02/12	ND, RDL=0.40		ug/L	
			trans-1,2-dichloroethene	2026/02/12	ND, RDL=1.0		ug/L	
			trans-1,3-dichloropropene	2026/02/12	ND, RDL=1.0		ug/L	
			Trichloroethene	2026/02/12	ND, RDL=0.50		ug/L	
			Trichlorofluoromethane	2026/02/12	ND, RDL=4.0		ug/L	



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Vinyl chloride	2026/02/12	ND, RDL=0.50		ug/L	
			m & p-Xylene	2026/02/12	ND, RDL=0.40		ug/L	
			o-Xylene	2026/02/12	ND, RDL=0.40		ug/L	
			Xylenes (Total)	2026/02/12	ND, RDL=0.40		ug/L	
C221568	NGU	RPD	VH C6-C10	2026/02/12	NC		%	30
			1,2-dibromoethane	2026/02/12	NC		%	30
			1,2-dichloroethane	2026/02/12	NC		%	30
			1,3,5-trimethylbenzene	2026/02/12	NC		%	30
			1,3-Butadiene	2026/02/12	NC		%	30
			Benzene	2026/02/12	NC		%	30
			Dichloromethane	2026/02/12	NC		%	30
			Ethylbenzene	2026/02/12	NC		%	30
			Isopropylbenzene	2026/02/12	NC		%	30
			Methyl-tert-butylether (MTBE)	2026/02/12	NC		%	30
			Styrene	2026/02/12	NC		%	30
			Toluene	2026/02/12	NC		%	30
			m & p-Xylene	2026/02/12	NC		%	30
			o-Xylene	2026/02/12	NC		%	30
			Xylenes (Total)	2026/02/12	NC		%	30
C221616	TSO	Matrix Spike [EAP394-02]	Nitrate plus Nitrite (N)	2026/02/11		93	%	80 - 120
C221616	TSO	Spiked Blank	Nitrate plus Nitrite (N)	2026/02/11		108	%	80 - 120
C221616	TSO	Method Blank	Nitrate plus Nitrite (N)	2026/02/11	ND, RDL=0.020		mg/L	
C221616	TSO	RPD [EAP394-02]	Nitrate plus Nitrite (N)	2026/02/11	NC		%	25
C221617	TSO	Matrix Spike [EAP394-02]	Nitrite (N)	2026/02/11		103	%	80 - 120
C221617	TSO	Spiked Blank	Nitrite (N)	2026/02/11		109	%	80 - 120
C221617	TSO	Method Blank	Nitrite (N)	2026/02/11	ND, RDL=0.0050		mg/L	
C221617	TSO	RPD [EAP394-02]	Nitrite (N)	2026/02/11	NC		%	20
C221619	CJY	Matrix Spike	Dissolved Fluoride (F)	2026/02/11		91	%	80 - 120
C221619	CJY	Spiked Blank	Dissolved Fluoride (F)	2026/02/11		100	%	80 - 120
C221619	CJY	Method Blank	Dissolved Fluoride (F)	2026/02/11	ND, RDL=0.050		mg/L	
C221619	CJY	RPD	Fluoride (F)	2026/02/11	NC		%	20
C221623	CJY	Matrix Spike	Dissolved Fluoride (F)	2026/02/11		92	%	80 - 120
C221623	CJY	Spiked Blank	Dissolved Fluoride (F)	2026/02/11		107	%	80 - 120
C221623	CJY	Method Blank	Dissolved Fluoride (F)	2026/02/11	ND, RDL=0.050		mg/L	
C221623	CJY	RPD	Fluoride (F)	2026/02/11	NC		%	20
C221679	BTM	Matrix Spike [EAP397-05]	Dissolved Organic Carbon (C)	2026/02/12		106	%	80 - 120
C221679	BTM	Spiked Blank	Dissolved Organic Carbon (C)	2026/02/12		97	%	80 - 120
C221679	BTM	Method Blank	Dissolved Organic Carbon (C)	2026/02/12	ND, RDL=0.50		mg/L	
C221679	BTM	RPD [EAP397-05]	Dissolved Organic Carbon (C)	2026/02/12	NC		%	20
C221681	BTM	Spiked Blank	Total Organic Carbon (C)	2026/02/12		97	%	80 - 120
C221681	BTM	Method Blank	Total Organic Carbon (C)	2026/02/12	ND, RDL=0.50		mg/L	
C221707	KA5	Matrix Spike	Total Phosphorus (P)	2026/02/12		58	%	N/A
C221707	KA5	Spiked Blank	Total Phosphorus (P)	2026/02/12		109	%	80 - 120



BUREAU
VERITAS

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C221707	KA5	Method Blank	Total Phosphorus (P)	2026/02/12	ND, RDL=0.0010		mg/L	
C221707	KA5	RPD	Total Phosphorus (P)	2026/02/12	17		%	20
C221720	CBK	Matrix Spike [EAP394-02]	Chloride (Cl)	2026/02/11		67 (1)	%	80 - 120
			Sulphate (SO4)	2026/02/11		66 (1)	%	80 - 120
C221720	CBK	Spiked Blank	Chloride (Cl)	2026/02/11		96	%	80 - 120
			Sulphate (SO4)	2026/02/11		95	%	80 - 120
C221720	CBK	Method Blank	Chloride (Cl)	2026/02/11	ND, RDL=1.0		mg/L	
			Sulphate (SO4)	2026/02/11	ND, RDL=1.0		mg/L	
C221720	CBK	RPD [EAP394-02]	Chloride (Cl)	2026/02/11	8.0		%	20
			Sulphate (SO4)	2026/02/11	0.95		%	20
C221802	AG8	Matrix Spike [EAP396-01]	Total Suspended Solids	2026/02/12		97	%	80 - 120
C221802	AG8	Spiked Blank	Total Suspended Solids	2026/02/12		96	%	80 - 120
C221802	AG8	Method Blank	Total Suspended Solids	2026/02/12	ND, RDL=1.0		mg/L	
C221802	AG8	RPD	Total Suspended Solids	2026/02/12	NC		%	20
C221807	AG8	Matrix Spike	Total Suspended Solids	2026/02/12		98	%	80 - 120
C221807	AG8	Spiked Blank	Total Suspended Solids	2026/02/12		96	%	80 - 120
C221807	AG8	Method Blank	Total Suspended Solids	2026/02/12	ND, RDL=1.0		mg/L	
C221807	AG8	RPD	Total Suspended Solids	2026/02/12	8.7		%	20
C221812	C2L	Matrix Spike	Total Mercury (Hg)	2026/02/11		108	%	80 - 120
C221812	C2L	Spiked Blank	Total Mercury (Hg)	2026/02/11		100	%	80 - 120
C221812	C2L	Method Blank	Total Mercury (Hg)	2026/02/11	ND, RDL=0.0019		ug/L	
C221812	C2L	RPD	Total Mercury (Hg)	2026/02/11	NC		%	20
C221974	CBK	Matrix Spike [EAP396-12]	Total Ammonia (N)	2026/02/12		102	%	80 - 120
C221974	CBK	Spiked Blank	Total Ammonia (N)	2026/02/12		103	%	80 - 120
C221974	CBK	Method Blank	Total Ammonia (N)	2026/02/12	ND, RDL=0.015		mg/L	
C221974	CBK	RPD [EAP396-12]	Total Ammonia (N)	2026/02/12	NC		%	20
C222163	JP1	Spiked Blank	D10-ANTHRACENE (sur.)	2026/02/12		95	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/02/12		91	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/02/12		80	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/02/12		92	%	50 - 140
			Quinoline	2026/02/12		109	%	50 - 140
			Naphthalene	2026/02/12		91	%	50 - 140
			1-Methylnaphthalene	2026/02/12		94	%	50 - 140
			2-Methylnaphthalene	2026/02/12		92	%	50 - 140
			Acenaphthylene	2026/02/12		95	%	50 - 140
			Acenaphthene	2026/02/12		95	%	50 - 140
			Fluorene	2026/02/12		96	%	50 - 140
			Phenanthrene	2026/02/12		97	%	50 - 140
			Anthracene	2026/02/12		95	%	50 - 140
			Acridine	2026/02/12		100	%	50 - 140
			Fluoranthene	2026/02/12		101	%	50 - 140
			Pyrene	2026/02/12		101	%	50 - 140
			Benzo(a)anthracene	2026/02/12		93	%	50 - 140
			Chrysene	2026/02/12		97	%	50 - 140
			Benzo(b&j)fluoranthene	2026/02/12		98	%	50 - 140
			Benzo(k)fluoranthene	2026/02/12		109	%	50 - 140



BUREAU
VERITAS

Bureau Veritas Job #: C607390

Report Date: 2026/02/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits		
C222163	JP1	Method Blank	Benzo(a)pyrene	2026/02/12		95	%	50 - 140		
			Indeno(1,2,3-cd)pyrene	2026/02/12		96	%	50 - 140		
			Dibenz(a,h)anthracene	2026/02/12		98	%	50 - 140		
			Benzo(g,h,i)perylene	2026/02/12		99	%	50 - 140		
			D10-ANTHRACENE (sur.)	2026/02/12		85	%	50 - 140		
			D8-ACENAPHTHYLENE (sur.)	2026/02/12		82	%	50 - 140		
			D8-NAPHTHALENE (sur.)	2026/02/12		67	%	50 - 140		
			TERPHENYL-D14 (sur.)	2026/02/12		87	%	50 - 140		
			Quinoline	2026/02/12		ND, RDL=0.020			ug/L	
			Naphthalene	2026/02/12		ND, RDL=0.10			ug/L	
			1-Methylnaphthalene	2026/02/12		ND, RDL=0.050			ug/L	
			2-Methylnaphthalene	2026/02/12		ND, RDL=0.10			ug/L	
			Acenaphthylene	2026/02/12		ND, RDL=0.050			ug/L	
			Acenaphthene	2026/02/12		ND, RDL=0.050			ug/L	
			Fluorene	2026/02/12		ND, RDL=0.050			ug/L	
			Phenanthrene	2026/02/12		ND, RDL=0.050			ug/L	
			Anthracene	2026/02/12		ND, RDL=0.010			ug/L	
			Acridine	2026/02/12		ND, RDL=0.050			ug/L	
			Fluoranthene	2026/02/12		ND, RDL=0.020			ug/L	
			Pyrene	2026/02/12		ND, RDL=0.020			ug/L	
			Benzo(a)anthracene	2026/02/12		ND, RDL=0.010			ug/L	
			Chrysene	2026/02/12		ND, RDL=0.020			ug/L	
			Benzo(b&j)fluoranthene	2026/02/12		ND, RDL=0.030			ug/L	
Benzo(k)fluoranthene	2026/02/12		ND, RDL=0.050			ug/L				
Benzo(a)pyrene	2026/02/12		ND, RDL=0.0050			ug/L				
Indeno(1,2,3-cd)pyrene	2026/02/12		ND, RDL=0.050			ug/L				
Dibenz(a,h)anthracene	2026/02/12		ND, RDL=0.0030			ug/L				
Benzo(g,h,i)perylene	2026/02/12		ND, RDL=0.050			ug/L				
C222163	JP1	RPD	Quinoline	2026/02/12	NC		%	40		
			Naphthalene	2026/02/12	0.23		%	40		
			1-Methylnaphthalene	2026/02/12	0.57		%	40		
			2-Methylnaphthalene	2026/02/12	1.4		%	40		
			Acenaphthylene	2026/02/12	16		%	40		
			Acenaphthene	2026/02/12	0		%	40		



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Fluorene	2026/02/12	1.2		%	40
			Phenanthrene	2026/02/12	1.7		%	40
			Anthracene	2026/02/12	4.8		%	40
			Acridine	2026/02/12	8.3		%	40
			Fluoranthene	2026/02/12	13		%	40
			Pyrene	2026/02/12	14		%	40
			Benzo(a)anthracene	2026/02/12	17		%	40
			Chrysene	2026/02/12	9.0		%	40
			Benzo(b&j)fluoranthene	2026/02/12	NC		%	40
			Benzo(k)fluoranthene	2026/02/12	NC		%	40
			Benzo(a)pyrene	2026/02/12	15		%	40
			Indeno(1,2,3-cd)pyrene	2026/02/12	NC		%	40
			Dibenz(a,h)anthracene	2026/02/12	NC		%	40
			Benzo(g,h,i)perylene	2026/02/12	NC		%	40
C222169	IT1	Spiked Blank	O-TERPHENYL (sur.)	2026/02/13		109	%	60 - 140
			EPH (C10-C19)	2026/02/13		107	%	70 - 130
			EPH (C19-C32)	2026/02/13		112	%	70 - 130
C222169	IT1	Method Blank	O-TERPHENYL (sur.)	2026/02/13		88	%	60 - 140
			EPH (C10-C19)	2026/02/13	ND, RDL=0.20		mg/L	
			EPH (C19-C32)	2026/02/13	ND, RDL=0.20		mg/L	
C222202	BB3	Matrix Spike [EAP396-04]	Total Nitrogen (N)	2026/02/13		103	%	80 - 120
C222202	BB3	Spiked Blank	Total Nitrogen (N)	2026/02/13		93	%	80 - 120
C222202	BB3	Method Blank	Total Nitrogen (N)	2026/02/13	ND, RDL=0.020		mg/L	
C222202	BB3	RPD [EAP396-04]	Total Nitrogen (N)	2026/02/13	NC		%	20
C223326	CT6	Matrix Spike	Total Sulphide	2026/02/13		26 (1)	%	80 - 120
C223326	CT6	Spiked Blank	Total Sulphide	2026/02/13		87	%	80 - 120
C223326	CT6	Method Blank	Total Sulphide	2026/02/13	ND, RDL=0.0018		mg/L	
C223326	CT6	RPD	Total Sulphide	2026/02/13	2.6		%	20
C223455	IDV	Matrix Spike [EAP394-10]	Total Sulphide	2026/02/14		99	%	80 - 120
C223455	IDV	Spiked Blank	Total Sulphide	2026/02/14		93	%	80 - 120
C223455	IDV	Method Blank	Total Sulphide	2026/02/14	ND, RDL=0.0018		mg/L	
C223455	IDV	RPD	Total Sulphide	2026/02/14	0		%	20
C223496	SOM	Matrix Spike [EAP394-02]	Bromide (Br)	2026/02/17		92	%	78 - 120
C223496	SOM	Spiked Blank	Bromide (Br)	2026/02/17		106	%	80 - 120
C223496	SOM	Method Blank	Bromide (Br)	2026/02/17	ND, RDL=0.010		mg/L	
C223496	SOM	RPD [EAP394-02]	Bromide (Br)	2026/02/17	NC		%	20
C223507	AA1	Matrix Spike [EAP393-08]	Dissolved Aluminum (Al)	2026/02/13		96	%	80 - 120
			Dissolved Antimony (Sb)	2026/02/13		99	%	80 - 120
			Dissolved Arsenic (As)	2026/02/13		98	%	80 - 120
			Dissolved Barium (Ba)	2026/02/13		94	%	80 - 120
			Dissolved Beryllium (Be)	2026/02/13		100	%	80 - 120
			Dissolved Bismuth (Bi)	2026/02/13		96	%	80 - 120
			Dissolved Boron (B)	2026/02/13		99	%	80 - 120
			Dissolved Cadmium (Cd)	2026/02/13		94	%	80 - 120
			Dissolved Cesium (Cs)	2026/02/13		91	%	80 - 120
			Dissolved Chromium (Cr)	2026/02/13		91	%	80 - 120
			Dissolved Cobalt (Co)	2026/02/13		94	%	80 - 120



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Copper (Cu)	2026/02/13		89	%	80 - 120
			Dissolved Iron (Fe)	2026/02/13		100	%	80 - 120
			Dissolved Lead (Pb)	2026/02/13		92	%	80 - 120
			Dissolved Lithium (Li)	2026/02/13		97	%	80 - 120
			Dissolved Manganese (Mn)	2026/02/13		89	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/02/13		NC	%	80 - 120
			Dissolved Nickel (Ni)	2026/02/13		93	%	80 - 120
			Dissolved Phosphorus (P)	2026/02/13		100	%	80 - 120
			Dissolved Rubidium (Rb)	2026/02/13		96	%	80 - 120
			Dissolved Selenium (Se)	2026/02/13		94	%	80 - 120
			Dissolved Silicon (Si)	2026/02/13		98	%	80 - 120
			Dissolved Silver (Ag)	2026/02/13		95	%	80 - 120
			Dissolved Strontium (Sr)	2026/02/13		90	%	80 - 120
			Dissolved Tellurium (Te)	2026/02/13		100	%	80 - 120
			Dissolved Thallium (Tl)	2026/02/13		98	%	80 - 120
			Dissolved Thorium (Th)	2026/02/13		94	%	80 - 120
			Dissolved Tin (Sn)	2026/02/13		99	%	80 - 120
			Dissolved Titanium (Ti)	2026/02/13		96	%	80 - 120
			Dissolved Uranium (U)	2026/02/13		97	%	80 - 120
			Dissolved Vanadium (V)	2026/02/13		91	%	80 - 120
			Dissolved Zinc (Zn)	2026/02/13		96	%	80 - 120
			Dissolved Zirconium (Zr)	2026/02/13		101	%	80 - 120
C223507	AA1	Spiked Blank	Dissolved Aluminum (Al)	2026/02/13		101	%	80 - 120
			Dissolved Antimony (Sb)	2026/02/13		103	%	80 - 120
			Dissolved Arsenic (As)	2026/02/13		100	%	80 - 120
			Dissolved Barium (Ba)	2026/02/13		98	%	80 - 120
			Dissolved Beryllium (Be)	2026/02/13		102	%	80 - 120
			Dissolved Bismuth (Bi)	2026/02/13		98	%	80 - 120
			Dissolved Boron (B)	2026/02/13		102	%	80 - 120
			Dissolved Cadmium (Cd)	2026/02/13		98	%	80 - 120
			Dissolved Cesium (Cs)	2026/02/13		95	%	80 - 120
			Dissolved Chromium (Cr)	2026/02/13		94	%	80 - 120
			Dissolved Cobalt (Co)	2026/02/13		97	%	80 - 120
			Dissolved Copper (Cu)	2026/02/13		91	%	80 - 120
			Dissolved Iron (Fe)	2026/02/13		101	%	80 - 120
			Dissolved Lead (Pb)	2026/02/13		94	%	80 - 120
			Dissolved Lithium (Li)	2026/02/13		99	%	80 - 120
			Dissolved Manganese (Mn)	2026/02/13		91	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/02/13		105	%	80 - 120
			Dissolved Nickel (Ni)	2026/02/13		95	%	80 - 120
			Dissolved Phosphorus (P)	2026/02/13		102	%	80 - 120
			Dissolved Rubidium (Rb)	2026/02/13		100	%	80 - 120
			Dissolved Selenium (Se)	2026/02/13		95	%	80 - 120
			Dissolved Silicon (Si)	2026/02/13		103	%	80 - 120
			Dissolved Silver (Ag)	2026/02/13		97	%	80 - 120
			Dissolved Strontium (Sr)	2026/02/13		95	%	80 - 120
			Dissolved Tellurium (Te)	2026/02/13		106	%	80 - 120
			Dissolved Thallium (Tl)	2026/02/13		99	%	80 - 120
			Dissolved Thorium (Th)	2026/02/13		93	%	80 - 120
			Dissolved Tin (Sn)	2026/02/13		103	%	80 - 120
			Dissolved Titanium (Ti)	2026/02/13		97	%	80 - 120
			Dissolved Uranium (U)	2026/02/13		98	%	80 - 120
			Dissolved Vanadium (V)	2026/02/13		92	%	80 - 120



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C223507	AA1	Method Blank	Dissolved Zinc (Zn)	2026/02/13		99	%	80 - 120
			Dissolved Zirconium (Zr)	2026/02/13		104	%	80 - 120
			Dissolved Aluminum (Al)	2026/02/13	ND, RDL=0.50		ug/L	
			Dissolved Antimony (Sb)	2026/02/13	ND, RDL=0.020		ug/L	
			Dissolved Arsenic (As)	2026/02/13	ND, RDL=0.020		ug/L	
			Dissolved Barium (Ba)	2026/02/13	ND, RDL=0.020		ug/L	
			Dissolved Beryllium (Be)	2026/02/13	ND, RDL=0.010		ug/L	
			Dissolved Bismuth (Bi)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Boron (B)	2026/02/13	ND, RDL=10		ug/L	
			Dissolved Cadmium (Cd)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Cesium (Cs)	2026/02/13	ND, RDL=0.050		ug/L	
			Dissolved Chromium (Cr)	2026/02/13	ND, RDL=0.10		ug/L	
			Dissolved Cobalt (Co)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Copper (Cu)	2026/02/13	ND, RDL=0.050		ug/L	
			Dissolved Iron (Fe)	2026/02/13	ND, RDL=1.0		ug/L	
			Dissolved Lead (Pb)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Lithium (Li)	2026/02/13	ND, RDL=0.50		ug/L	
			Dissolved Manganese (Mn)	2026/02/13	0.052, RDL=0.050 (2)		ug/L	
			Dissolved Molybdenum (Mo)	2026/02/13	ND, RDL=0.050		ug/L	
			Dissolved Nickel (Ni)	2026/02/13	ND, RDL=0.020		ug/L	
			Dissolved Phosphorus (P)	2026/02/13	ND, RDL=2.0		ug/L	
			Dissolved Rubidium (Rb)	2026/02/13	ND, RDL=0.050		ug/L	
			Dissolved Selenium (Se)	2026/02/13	ND, RDL=0.040		ug/L	
			Dissolved Silicon (Si)	2026/02/13	ND, RDL=50		ug/L	
			Dissolved Silver (Ag)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Strontium (Sr)	2026/02/13	0.077, RDL=0.050 (2)		ug/L	
			Dissolved Tellurium (Te)	2026/02/13	ND, RDL=0.020		ug/L	
			Dissolved Thallium (Tl)	2026/02/13	ND, RDL=0.0020		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Thorium (Th)	2026/02/13	ND, RDL=0.0050		ug/L	
			Dissolved Tin (Sn)	2026/02/13	ND, RDL=0.20		ug/L	
			Dissolved Titanium (Ti)	2026/02/13	ND, RDL=0.50		ug/L	
			Dissolved Uranium (U)	2026/02/13	0.0026, RDL=0.0020 (2)		ug/L	
			Dissolved Vanadium (V)	2026/02/13	ND, RDL=0.20		ug/L	
			Dissolved Zinc (Zn)	2026/02/13	ND, RDL=0.10		ug/L	
			Dissolved Zirconium (Zr)	2026/02/13	ND, RDL=0.10		ug/L	
C223507	AA1	RPD [EAP393-08]	Dissolved Aluminum (Al)	2026/02/13	0.68		%	20
			Dissolved Antimony (Sb)	2026/02/13	3.2		%	20
			Dissolved Arsenic (As)	2026/02/13	1.5		%	20
			Dissolved Barium (Ba)	2026/02/13	0.42		%	20
			Dissolved Beryllium (Be)	2026/02/13	NC		%	20
			Dissolved Bismuth (Bi)	2026/02/13	NC		%	20
			Dissolved Boron (B)	2026/02/13	NC		%	20
			Dissolved Cadmium (Cd)	2026/02/13	0		%	20
			Dissolved Cesium (Cs)	2026/02/13	NC		%	20
			Dissolved Chromium (Cr)	2026/02/13	4.7		%	20
			Dissolved Cobalt (Co)	2026/02/13	NC		%	20
			Dissolved Copper (Cu)	2026/02/13	0.043		%	20
			Dissolved Iron (Fe)	2026/02/13	0.54		%	20
			Dissolved Lead (Pb)	2026/02/13	8.2		%	20
			Dissolved Lithium (Li)	2026/02/13	6.7		%	20
			Dissolved Manganese (Mn)	2026/02/13	0.071		%	20
			Dissolved Molybdenum (Mo)	2026/02/13	0.21		%	20
			Dissolved Nickel (Ni)	2026/02/13	0.36		%	20
			Dissolved Phosphorus (P)	2026/02/13	0.048		%	20
			Dissolved Rubidium (Rb)	2026/02/13	0.65		%	20
			Dissolved Selenium (Se)	2026/02/13	NC		%	20
			Dissolved Silicon (Si)	2026/02/13	0.93		%	20
			Dissolved Silver (Ag)	2026/02/13	NC		%	20
			Dissolved Strontium (Sr)	2026/02/13	0.20		%	20
			Dissolved Tellurium (Te)	2026/02/13	NC		%	20
			Dissolved Thallium (Tl)	2026/02/13	3.3		%	20
			Dissolved Thorium (Th)	2026/02/13	6.2		%	20
			Dissolved Tin (Sn)	2026/02/13	NC		%	20
			Dissolved Titanium (Ti)	2026/02/13	NC		%	20
			Dissolved Uranium (U)	2026/02/13	1.2		%	20
			Dissolved Vanadium (V)	2026/02/13	NC		%	20
			Dissolved Zinc (Zn)	2026/02/13	7.9		%	20
			Dissolved Zirconium (Zr)	2026/02/13	NC		%	20
C223536	AAX	Matrix Spike	Methyl Sulfone (sur.)	2026/02/13		91	%	50 - 140
			Ethylene Glycol	2026/02/13		80	%	60 - 140
			Diethylene Glycol	2026/02/13		103	%	60 - 140
			Triethylene Glycol	2026/02/13		90	%	60 - 140
			Propylene Glycol	2026/02/13		87	%	60 - 140
C223536	AAX	Spiked Blank	Methyl Sulfone (sur.)	2026/02/13		93	%	50 - 140



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C223536	AAX	Method Blank	Ethylene Glycol	2026/02/13		78	%	70 - 130
			Diethylene Glycol	2026/02/13		99	%	70 - 130
			Triethylene Glycol	2026/02/13		87	%	70 - 130
			Propylene Glycol	2026/02/13		86	%	70 - 130
			Methyl Sulfone (sur.)	2026/02/13		95	%	50 - 140
			Ethylene Glycol	2026/02/13	ND, RDL=3.0		mg/L	
			Diethylene Glycol	2026/02/13	ND, RDL=5.0		mg/L	
			Triethylene Glycol	2026/02/13	ND, RDL=5.0		mg/L	
C223536	AAX	RPD	Propylene Glycol	2026/02/13	ND, RDL=5.0		mg/L	
			Ethylene Glycol	2026/02/13	NC	%	30	
			Diethylene Glycol	2026/02/13	NC	%	30	
			Triethylene Glycol	2026/02/13	NC	%	30	
C223544	AG8	Matrix Spike	Total Dissolved Solids	2026/02/17		101	%	80 - 120
C223544	AG8	Spiked Blank	Total Dissolved Solids	2026/02/17		94	%	80 - 120
C223544	AG8	Method Blank	Total Dissolved Solids	2026/02/17	ND, RDL=10		mg/L	
C223544	AG8	RPD	Total Dissolved Solids	2026/02/17	NC		%	20
C223665	AA1	Matrix Spike [EAP395-06]	Total Aluminum (Al)	2026/02/17		103	%	80 - 120
			Total Antimony (Sb)	2026/02/17		103	%	80 - 120
			Total Arsenic (As)	2026/02/17		106	%	80 - 120
			Total Barium (Ba)	2026/02/17		103	%	80 - 120
			Total Beryllium (Be)	2026/02/17		107	%	80 - 120
			Total Bismuth (Bi)	2026/02/17		99	%	80 - 120
			Total Boron (B)	2026/02/17		101	%	80 - 120
			Total Cadmium (Cd)	2026/02/17		103	%	80 - 120
			Total Cesium (Cs)	2026/02/17		96	%	80 - 120
			Total Chromium (Cr)	2026/02/17		96	%	80 - 120
			Total Cobalt (Co)	2026/02/17		101	%	80 - 120
			Total Copper (Cu)	2026/02/17		94	%	80 - 120
			Total Iron (Fe)	2026/02/17		105	%	80 - 120
			Total Lead (Pb)	2026/02/17		100	%	80 - 120
			Total Lithium (Li)	2026/02/17		101	%	80 - 120
			Total Manganese (Mn)	2026/02/17		99	%	80 - 120
			Total Molybdenum (Mo)	2026/02/17		99	%	80 - 120
			Total Nickel (Ni)	2026/02/17		99	%	80 - 120
			Total Phosphorus (P)	2026/02/17		102	%	80 - 120
			Total Rubidium (Rb)	2026/02/17		103	%	80 - 120
			Total Selenium (Se)	2026/02/17		104	%	80 - 120
			Total Silicon (Si)	2026/02/17		102	%	80 - 120
			Total Silver (Ag)	2026/02/17		103	%	80 - 120
			Total Strontium (Sr)	2026/02/17		96	%	80 - 120
			Total Tellurium (Te)	2026/02/17		107	%	80 - 120
			Total Thallium (Tl)	2026/02/17		101	%	80 - 120
			Total Thorium (Th)	2026/02/17		104	%	80 - 120
			Total Tin (Sn)	2026/02/17		101	%	80 - 120
			Total Titanium (Ti)	2026/02/17		102	%	80 - 120
			Total Uranium (U)	2026/02/17		105	%	80 - 120
			Total Vanadium (V)	2026/02/17		96	%	80 - 120



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C223665	AA1	Spiked Blank	Total Zinc (Zn)	2026/02/17		101	%	80 - 120
			Total Zirconium (Zr)	2026/02/17		101	%	80 - 120
			Total Aluminum (Al)	2026/02/17		101	%	80 - 120
			Total Antimony (Sb)	2026/02/17		101	%	80 - 120
			Total Arsenic (As)	2026/02/17		104	%	80 - 120
			Total Barium (Ba)	2026/02/17		101	%	80 - 120
			Total Beryllium (Be)	2026/02/17		102	%	80 - 120
			Total Bismuth (Bi)	2026/02/17		97	%	80 - 120
			Total Boron (B)	2026/02/17		95	%	80 - 120
			Total Cadmium (Cd)	2026/02/17		101	%	80 - 120
			Total Cesium (Cs)	2026/02/17		92	%	80 - 120
			Total Chromium (Cr)	2026/02/17		96	%	80 - 120
			Total Cobalt (Co)	2026/02/17		95	%	80 - 120
			Total Copper (Cu)	2026/02/17		93	%	80 - 120
			Total Iron (Fe)	2026/02/17		103	%	80 - 120
			Total Lead (Pb)	2026/02/17		97	%	80 - 120
			Total Lithium (Li)	2026/02/17		99	%	80 - 120
			Total Manganese (Mn)	2026/02/17		98	%	80 - 120
			Total Molybdenum (Mo)	2026/02/17		100	%	80 - 120
			Total Nickel (Ni)	2026/02/17		97	%	80 - 120
			Total Phosphorus (P)	2026/02/17		102	%	80 - 120
			Total Rubidium (Rb)	2026/02/17		99	%	80 - 120
			Total Selenium (Se)	2026/02/17		103	%	80 - 120
			Total Silicon (Si)	2026/02/17		103	%	80 - 120
			Total Silver (Ag)	2026/02/17		100	%	80 - 120
			Total Strontium (Sr)	2026/02/17		93	%	80 - 120
			Total Tellurium (Te)	2026/02/17		101	%	80 - 120
			Total Thallium (Tl)	2026/02/17		98	%	80 - 120
Total Thorium (Th)	2026/02/17		100	%	80 - 120			
Total Tin (Sn)	2026/02/17		99	%	80 - 120			
Total Titanium (Ti)	2026/02/17		100	%	80 - 120			
Total Uranium (U)	2026/02/17		101	%	80 - 120			
Total Vanadium (V)	2026/02/17		93	%	80 - 120			
Total Zinc (Zn)	2026/02/17		99	%	80 - 120			
C223665	AA1	Method Blank	Total Zirconium (Zr)	2026/02/17		98	%	80 - 120
			Total Aluminum (Al)	2026/02/17	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/02/17	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/02/17	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/02/17	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/02/17	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/02/17	ND, RDL=0.010		ug/L	
			Total Boron (B)	2026/02/17	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/02/17	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/02/17	ND, RDL=0.050		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Chromium (Cr)	2026/02/17	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/02/17	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/02/17	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/02/17	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/02/17	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/02/17	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/02/17	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/02/17	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/02/17	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/02/17	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/02/17	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/02/17	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/02/17	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/02/17	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/02/17	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/02/17	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/02/17	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/02/17	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/02/17	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/02/17	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/02/17	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/02/17	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/02/17	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/02/17	ND, RDL=0.10		ug/L	
C223665	AA1	RPD [EAP393-06]	Total Aluminum (Al)	2026/02/17	2.8		%	20
			Total Antimony (Sb)	2026/02/17	1.2		%	20
			Total Arsenic (As)	2026/02/17	1.7		%	20
			Total Barium (Ba)	2026/02/17	0.82		%	20
			Total Beryllium (Be)	2026/02/17	NC		%	20
			Total Bismuth (Bi)	2026/02/17	NC		%	20



BUREAU
VERITAS

Bureau Veritas Job #: C607390
Report Date: 2026/02/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Boron (B)	2026/02/17	NC		%	20
			Total Cadmium (Cd)	2026/02/17	2.4		%	20
			Total Cesium (Cs)	2026/02/17	NC		%	20
			Total Chromium (Cr)	2026/02/17	5.4		%	20
			Total Cobalt (Co)	2026/02/17	0.21		%	20
			Total Copper (Cu)	2026/02/17	0.51		%	20
			Total Iron (Fe)	2026/02/17	5.3		%	20
			Total Lead (Pb)	2026/02/17	1.2		%	20
			Total Lithium (Li)	2026/02/17	19		%	20
			Total Manganese (Mn)	2026/02/17	0.57		%	20
			Total Molybdenum (Mo)	2026/02/17	3.3		%	20
			Total Nickel (Ni)	2026/02/17	2.4		%	20
			Total Phosphorus (P)	2026/02/17	0.83		%	20
			Total Rubidium (Rb)	2026/02/17	1.6		%	20
			Total Selenium (Se)	2026/02/17	NC		%	20
			Total Silicon (Si)	2026/02/17	0.048		%	20
			Total Silver (Ag)	2026/02/17	NC		%	20
			Total Strontium (Sr)	2026/02/17	1.5		%	20
			Total Tellurium (Te)	2026/02/17	NC		%	20
			Total Thallium (Tl)	2026/02/17	2.9		%	20
			Total Thorium (Th)	2026/02/17	NC		%	20
			Total Tin (Sn)	2026/02/17	NC		%	20
			Total Titanium (Ti)	2026/02/17	3.4		%	20
			Total Uranium (U)	2026/02/17	1.7		%	20
			Total Vanadium (V)	2026/02/17	5.0		%	20
			Total Zinc (Zn)	2026/02/17	4.4		%	20
			Total Zirconium (Zr)	2026/02/17	NC		%	20
C223826	MDO	Matrix Spike	Phenols	2026/02/13		100	%	80 - 120
C223826	MDO	Spiked Blank	Phenols	2026/02/13		99	%	80 - 120
C223826	MDO	Method Blank	Phenols	2026/02/13	ND, RDL=0.0015		mg/L	
C223826	MDO	RPD	Phenols	2026/02/13	3.9		%	20
C223999	C2L	Matrix Spike	Dissolved Mercury (Hg)	2026/02/13		96	%	80 - 120
C223999	C2L	Spiked Blank	Dissolved Mercury (Hg)	2026/02/13		85	%	80 - 120
C223999	C2L	Method Blank	Dissolved Mercury (Hg)	2026/02/13	ND, RDL=0.0019		ug/L	
C223999	C2L	RPD	Dissolved Mercury (Hg)	2026/02/13	7.4		%	20
C224445	JLP	Matrix Spike [EAP393-11]	Total Hex. Chromium (Cr 6+)	2026/02/17		83	%	80 - 120
C224445	JLP	Spiked Blank	Total Hex. Chromium (Cr 6+)	2026/02/17		104	%	80 - 120
C224445	JLP	Method Blank	Total Hex. Chromium (Cr 6+)	2026/02/17	ND, RDL=0.00099		mg/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
	C224445	JLP	RPD [EAP393-11]	Total Hex. Chromium (Cr 6+)	2026/02/17	NC		%	20
<p>N/A = Not Applicable</p> <p>Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.</p> <p>Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.</p> <p>Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.</p> <p>Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.</p> <p>Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.</p> <p>NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)</p> <p>NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference <= 2x RDL).</p> <p>(1) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.</p> <p>(2) Method blank exceeds acceptance limits- 2X RDL acceptable for low level metals determination.</p>									



VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

David Huang, M.Sc., P.Chem., QP, Scientific Services Manager

Levi Manchak, Project Manager SR

Melissa Thompson, Scientist

Sandy Yuan, M.Sc., QP, Scientific Specialist

Veronica Falk, B.Sc., P.Chem., QP, Scientific Specialist, Organics

Bureau Veritas Certified by Ghayasuddin Khan, M.Sc., P.Chem., QP, Scientific Specialist, Inorganics

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.

C607390

2026/02/10 13:55



Custody Tracking Form



W123126

Please use this form for custody tracking when submitting the work instructions via eCOC (electronic Chain of Custody). Please ensure your form has a barcode or a Bureau Veritas eCOC confirmation number in the top right hand side. This number links your electronic submission to your samples. This form should be placed in the cooler with your samples.

First Sample: WLN6-DS
Last Sample: DUP WLN6-45
Sample Count: 5
2x Standards, 1x EOP + DUP, 2x 50-FAF

Relinquished By				Received By			
Brian Hardy-Cooper	BVC	Date	2026/02/10	Maria Zamora	MA	Date	2026/02/10
		Time (24 HR)	13:55			Time (24 HR)	13:55
		Date				Date	
		Time (24 HR)				Time (24 HR)	
		Date				Date	
		Time (24 HR)				Time (24 HR)	

Unless otherwise agreed to, submissions and use of services are governed by Bureau Veritas' standard terms and conditions which can be found at www.bvna.com.

Triage Information

Sampled By (Print) # of Coolers/Pkgs:

Immediate Test
Rush
Micro

***** LABORATORY USE ONLY *****

Received At

Lab Comments:

Custody Seal		Cooling Media	Temperature °C		
Present (Y/N)	Intact (Y/N)	Present (Y/N)	1	2	3
N	N	N	ACTR		





MVAN-2026-02-683

COR FCD-00383/5



Page 1 of 1

EPH in Water when PAH required Chromatogram

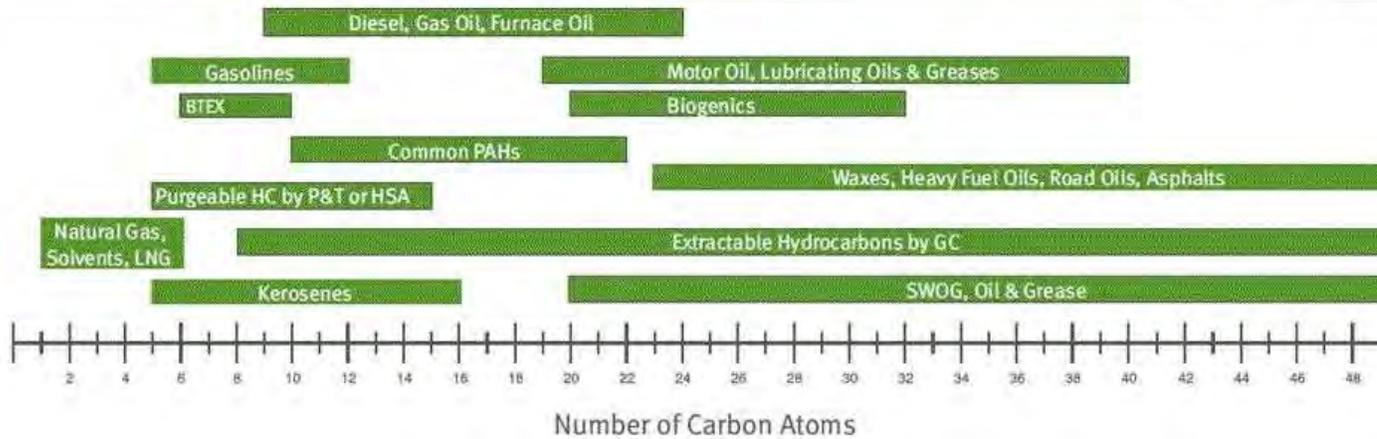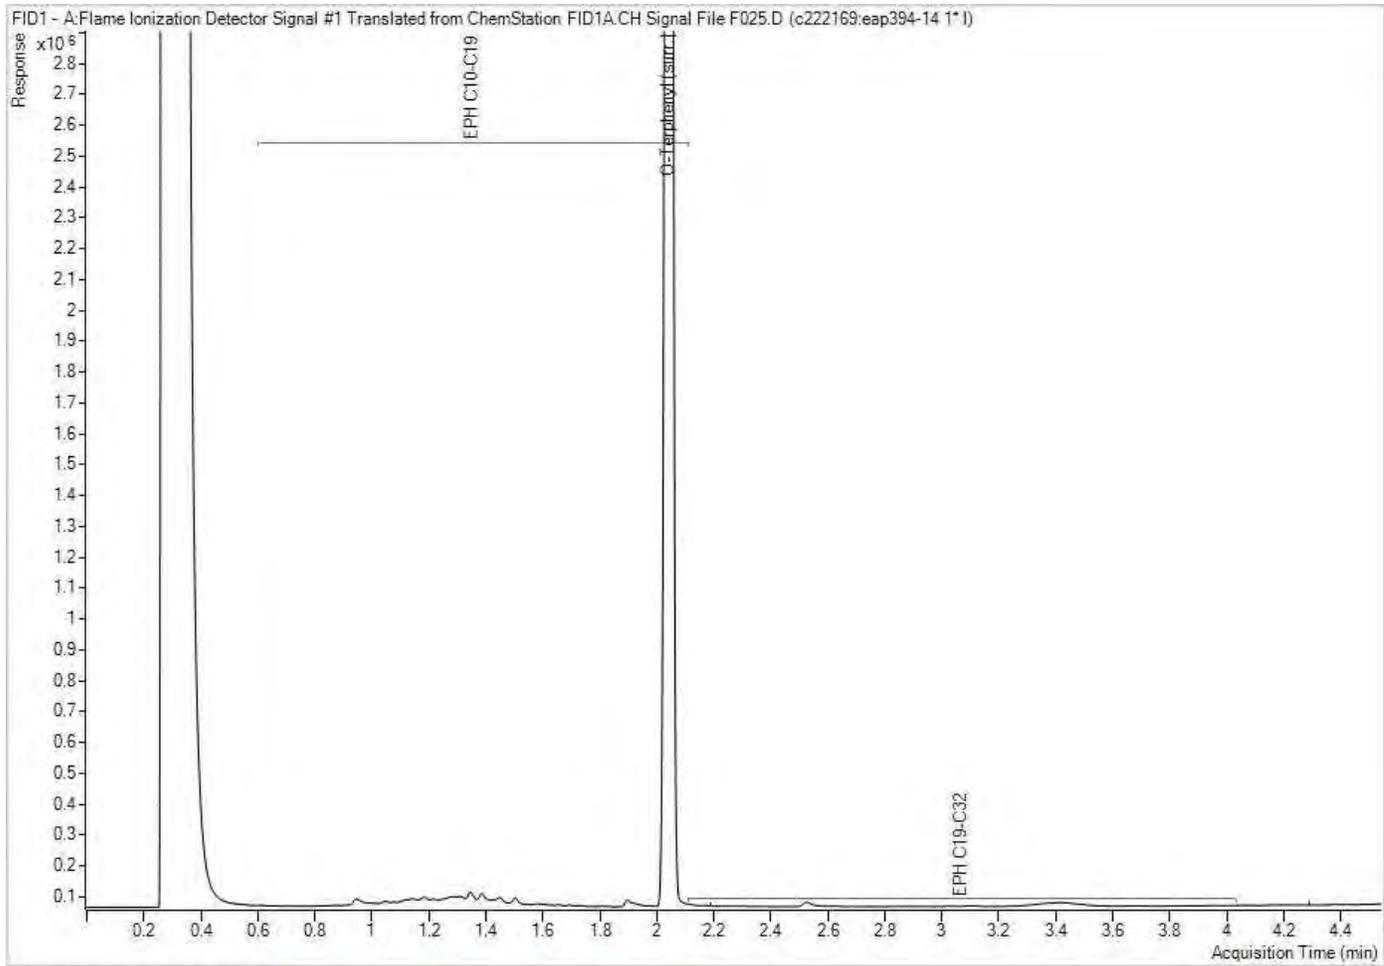

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.

EPH in Water when PAH required Chromatogram

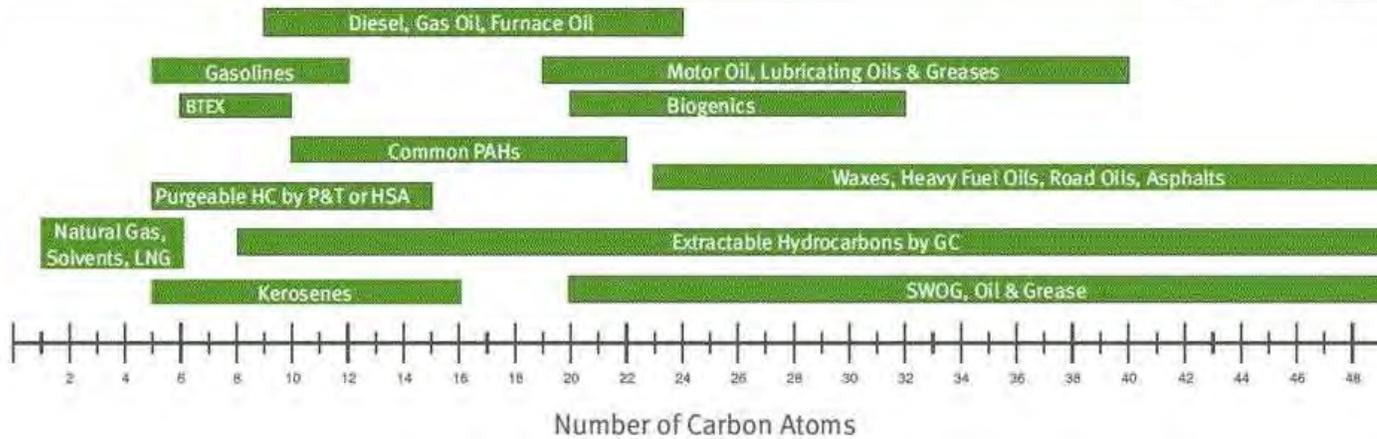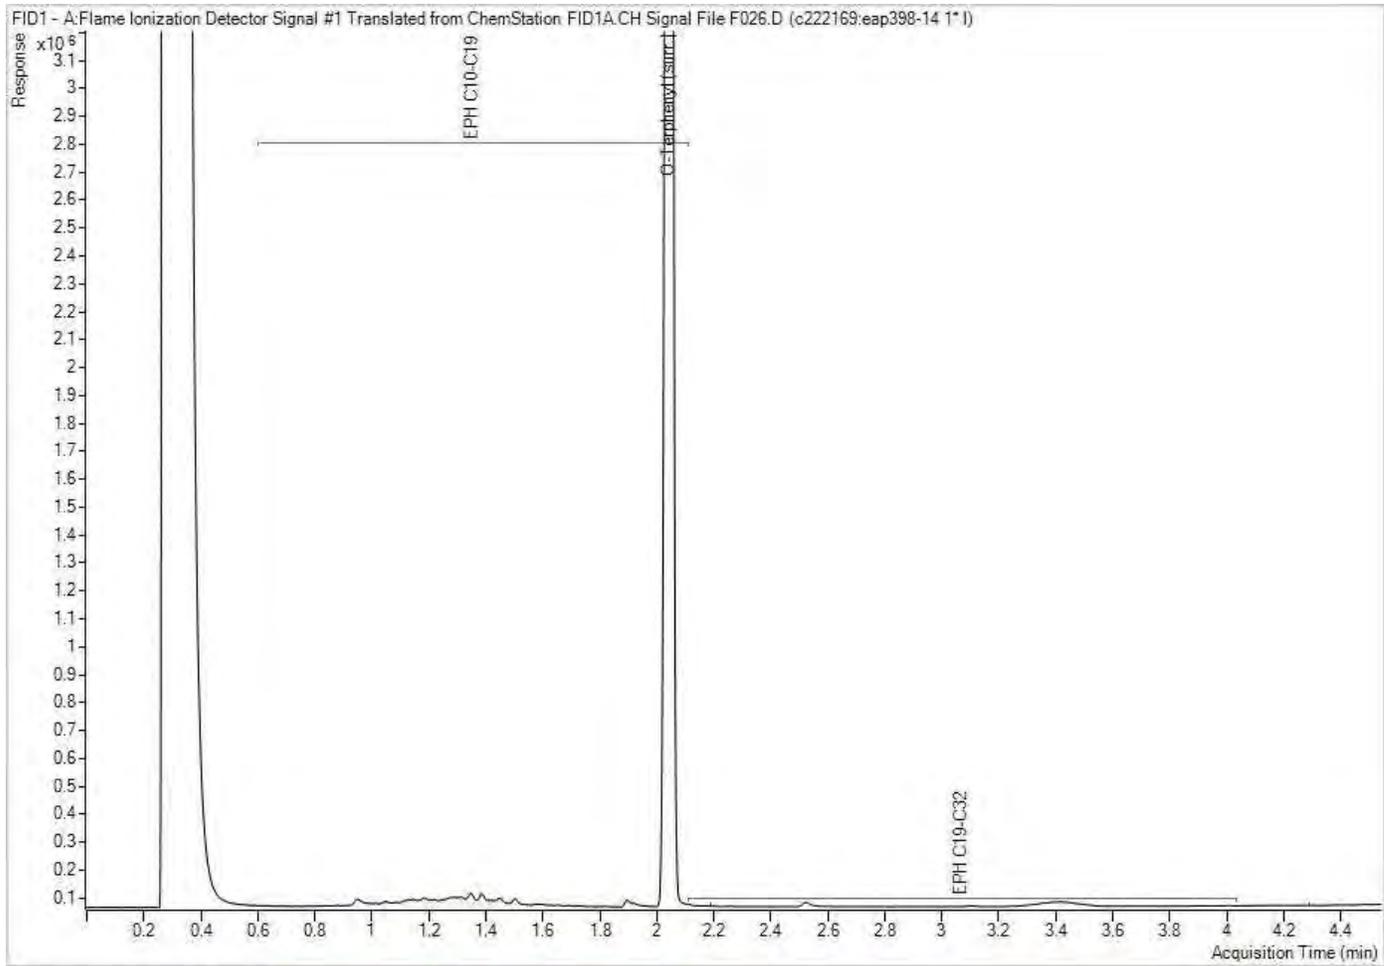

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.



eCOC: W123126



Project Information: C607390
 Job Received: 2026/02/10 13:55
 Expected TAT: Standard TAT
 Expected Arrival: 2026/02/10 17:00
 Submitted By: Jackson Macpherson
 Submitted To: Burnaby ENV: 4606 Canada Way

Invoice Information

Attn: Accounts Payable
 Fortis BC Energy Inc
 16705 Fraser Hwy
 Surrey, BC, V4N 0E8
 Email to:
 einvoices@fortisbc.com

Report Information

Attn: Brett Lucas
 HATFIELD CONSULTANTS
 200-850 Harbourside Dr
 North Vancouver, BC, V7P 0A3
 Email to:
 blucas@hatfieldgroup.com
 danielle.samels@fortisbc.com
 smangwani@hatfieldgroup.com
 jmacpherson@hatfieldgroup.com
 swolf@hatfieldgroup.com

Project Information

Quote #: C50083
 PO/AFE#: 4800010213
 Project #: Fortis11234/PE-110163
 Site Location: Woodfibre Pipeline Project

Analytical Summary

A: Standard TAT

Client Sample ID	Clnt Ref	Sampling Date/Time	Matrix	#Cont	Woodfibre	Woodfibre Additional	Woodfibre Blank	Rainbow Trout LC50 Multi-concentration	Set Number
WLNG-DS	1	2026/02/10	WATER	14	A				1
WLNG -EOP	2	2026/02/10	WATER	22	A	A		A	2
WLNG-US	3	2026/02/10	WATER	14	A				1
SQRI-US	4	2026/02/10	WATER	14	A				1
SQRI-DS	5	2026/02/10	WATER	14	A				1
BCR-EOP	6	2026/02/10	WATER	18	A	A			3
Field Blank	7	2026/02/10	WATER	14			A		4
Trip Blank	8	2026/02/10	WATER	14			A		4
DUP	9	2026/02/10	WATER	18	A	A			5

Deadlines are estimates only and are subject to change. Please refer to your Job Confirmation report for final due dates.

Submission Information

of Samples: 9

Sample Set Listing

Set 1 (4 samples)	Set 2 (1 sample)	Set 3 (1 sample)	Set 4 (2 samples)	Set 5 (1 sample)
WLNG-DS WLNG-US SQRI-US SQRI-DS	WLNG -EOP	BCR-EOP	Field Blank Trip Blank	DUP



RESULTS OF RAINBOW TROUT LC50 MULTI-CONCENTRATION

Client : 12239 Fortis BC Energy Inc, Surrey
Client Project Name & Number: WOODFIBRE PIPELINE PROJECT FORTIS11234/PE-110163

Job Number: C607390

Test Result:

96 hrs LC50 % vol/vol (95% CL): >100 (N/A) **Statistical Method:** Visual

Sample Name : WLNG -EOP

Description: Colourless, slightly cloudy **Sample Number:** EAP394-16
Sample Collected: Feb 10, 2026 **Sampling Method :** N/A **Site Collection:** N/A
Sample Collected By: N/A **Volume Received:** 8 x ECO10 **Avg Temp Arrival:** 11 °C **Storage:** 2-6°C
Sample Received: Feb 10, 2026 01:55 PM **pH:** 7.6 **Dissolved Oxygen:** 10.5 mg/L
Analysis Start : Feb 12, 2026 12:35 PM **Temperature :** 14 °C **Sample Conductance:** 144 µS/cm

Concentration	Temperature (°C)	Temperature (°C)	Dissolved Oxygen (mg/L)	Dissolved Oxygen (mg/L)	pH	pH	Conductivity (uS/cm)	Mortality (#)	Mortality (%)	Atypical Behaviour (#)
% vol/vol	Initial	96 hrs	Initial	96 hrs	Initial	96 hrs	Initial	96 hrs	96 hrs	96 hrs
0	14	14	10.3	10.2	7.6	7.6	47	0	0	0
6.25	14	14	10.3	9.8	7.7	7.7	53	0	0	0
12.5	14	14	10.3	9.8	7.7	7.7	60	0	0	0
25	14	14	10.3	9.9	7.7	7.7	71	0	0	0
50	14	14	10.3	9.8	7.7	7.8	98	0	0	0
100	14	14	10.4	9.9	7.7	7.8	143	0	0	0

Comments : All fish appeared and behaved normally at 24 hours, 48 hours, 72 hours, and 96 hours into testing.

Culture/Control/Dilution Water

Burnaby Municipal Dechlorinated Water

Hardness: 26 mg/L CaCO₃ Other parameters available on request.

Test Conditions

Test concentration : 0,6.25,12.5,25,50,100 (% vol/vol)

Organisms per Vessel : 10 **Test Temperature :** 15 ± 1 °C **Solution Depth :** >15 cm
Total # of Organisms Used : 60 **Pre-aeration Time :** 120 min. **Rate of Aeration** 6.5±1 mL/(min*L)
Test Volume : 15 L **Vessel Volume :** 20L **Test pH Adjusted:** No
Loading Density : 0.3 g/L **Photoperiod :** 16:8 (light: dark)

Test Organism :

Rainbow Trout (*Oncorhynchus mykiss*) **Source :** Aqua Farm

Culture Temperature : 15 ± 2 °C **Weight (Mean) +- SD :** 0.4 ± 0.2 g **Length (Mean) +- SD :** 3.62 ± 0.44 cm
Culture Water Renewal : ≥ 1L/min/kg fish **Weight (Range) :** 0.2 – 0.6 g **Length (Range) :** 3.00 – 4.10 cm
Culture Photoperiod : 16:8 (light: dark) **% Mortality within 7 days :** 0.35%
Feeding rate and frequency : daily: 1-5% biomass of trout. **Acclimation Time:** >14 days

Reference chemical:

Zinc **Test Date:** Feb 06, 2026

Test Endpoint 96 hrs LC50 (95% confidence interval) : 0.27 (0.20, 0.39)mg/L **Statistical Method :** Probit

Historical Mean LC50 (warning limits) : 0.24 (0.13, 0.46) mg/L **Concentration :** 0,0.04,0.08,0.16,0.32,0.64 mg/L

Test Method

BV Lab's BBY2SOP-00004 is based on the latest version of EPS 1/RM9 and EPS 1 /RM13.

Method Deviations : None.

Note: The results contained in this report refer only to the testing of the sample submitted. Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation, including the toxicity parameters reported herein. The conductivity, dissolved oxygen and pH data contained within the toxicity report are provided for information purposes and are not individually accredited parameters. This report may not be reproduced, except in its entirety, without the written approval of the laboratory.

Analyst : Melanie Mazziotti, Melissa Thompson, Navpreet Shergill, Nayshan Blassnitz

Verified By : Melissa Thompson, Scientist

Date: Feb 24, 2026 10:09 AM