Eagle Mountain – Woodfibre Gas Pipeline Project

BCER Waste Discharge Permit Weekly Report

Contents

Preamble 3
Introduction 3
Sampling Methodology 3
Summary-BC Rail Site 5
Site Activities 5
Discharge from Water Treatment Plant 5
Receiving Environment Monitoring-Squamish River 5
Summary-Woodfibre 6
Site Activities 6
Exceedances 6
Discharge from Water Treatment Plant 6
Receiving Environment Monitoring-East Creek 6
February 2026 BC Chronic Guideline Exceedances 7

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

Appendix E: Lab Documentation

Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environments (upstream and downstream) and points of discharge.

FortisBC has retained Hatfield Consultants as the Qualified Professional to implement and oversee the monitoring and sampling programs. The data represented below, including laboratory reported exceedances, represent conditions measured from final discharge points and the associated receiving environments, as required under the Waste Discharge Permit.

Introduction

The results provided in this document have been submitted to BCER by FortisBC as per the requirements listed in Section 4.2 of the Waste Discharge Permit PE-110163:

> The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to Waste.Management@bc-er.ca. A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and laboratory samples to meet daily and real-time requirements for the Waste Discharge Permit.

In the receiving environments, real-time and daily readings were monitored at the same time with one piece of equipment, allowing real-time daily readings. Visible sheen was monitored through visual inspections during times of discharge or sampling.

At the point of discharges, parameters are monitored using field equipment and water quality sondes, as well as discrete weekly water quality sampling events for laboratory analyses. Table 1 and Table 2 below describe this monitoring.

Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real-time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observator NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples*

*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.

Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real-time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples

*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.

Summary-BC Rail Site

Site Activities

- Water produced by the water treatment plant is being recirculated for tunneling and to create grout for tunneling.

Discharge from Water Treatment Plant

- There was no discharges this week from the BC Rail Site.

Receiving Environment Monitoring-Squamish River

Tables 3 and 4 below provide information on water quality and lab sampling. Lab Sampling has been put on hold with permission from BCER as there are no discharges. Appendix B includes a full set of lab results with real-time data. The receiving environment is being monitored as outlined in the permit and confirmed by BCER, with additional oversight by the QP.

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Upstream	N/A	Yes *	Full set of results are provided in Appendix B. **

Table 4. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Downstream	N/A	Yes *	Full set results are provided in Appendix B.

***** Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

**Data gaps in available in-situ continuous monitoring data, included:

- No data gaps were observed.

Summary-Woodfibre

Site Activities

- Weekly upstream, downstream, and end of pipe water quality sampling performed by the QP.
- On-going tunnelling at WLNG and grouting works to mitigate water ingress.
- Monthly summaries of data are included in this report.

Exceedances

The following exceedances were reported during the February 23 to March 1, 2026, reporting period:

- Turbidity at EAS DS exceeded the short-term guideline (change from background of 8 NTU) for more than 24 hours during two periods: February 23 at 00:00 to February 24 at 09:15 and February 26 at 10:15 to March 1 at 10:45. The water quality logger was cleaned on Feb 26th and March 1st, correlating to the drop in NTU.
- A review of continuous EOP turbidity monitoring indicated that EOP turbidity values remained below the EAS DS turbidity values for most of the reporting period, except for a few spike events. Although there was some misalignment between the EAS DS and WLNG EOP results, WLNG EOP turbidity results did exceed BC acute WQGs at times.

Discharge from Water Treatment Plant

Appendix C includes volume information and real-time/field samples from the discharge.

Receiving Environment Monitoring-East Creek

Tables 5 and 6 below provide information on water quality and lab sampling. Appendix D includes a full set of lab results with real-time data. The receiving environment is being monitored as outlined in the permit with additional oversight by the QP.

Table 5. Upstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Upstream	2026-02-24	Yes *	Full set of results are provided in Appendix D.**

Table 6. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Downstream	2026-02-24	Yes *	Full set of results are provided in Appendix D.**

***** Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

**Data gaps in available in-situ continuous monitoring data, included:

- EAS US
  - 2026-02-27: Temperature data was missing at 7:00.
- EAS DS
  - 2026-02-25: Temperature and ORP data were missing at 2:00, 18:00 and 19:00.
  - 2026-02-26: Temperature data was missing at 20:00.
  - 2026-02-27: Temperature and ORP data were missing at 11:00, 12:00 and 23:00.
  - 2026-03-01: Temperature and ORP data were missing at 14:00.

February 2026 BC Chronic Guideline Exceedances

Consistent with recommendations outlined in Hatfield (2024)[1], an assessment is provided below in figures detailing trends in concentrations of constituents determined to exceed BC chronic water quality guidelines for the protection of aquatic life during at least one weekly sampling event in December at the WLNG DS station. Given that chronic BC WQGPAL are designed to be applied over a monthly period and include conservative assumptions in their derivation (e.g., safety factors), the below interpretation is provided to put these identified exceedance events into context from an ecological risk perspective.

[1] Hatfield Consultants LLP. 2024. EGP Effluent Discharge Permit Condition Review, FORTIS11234. Dated December 18, 2024.

Figure 1: Total Aluminium

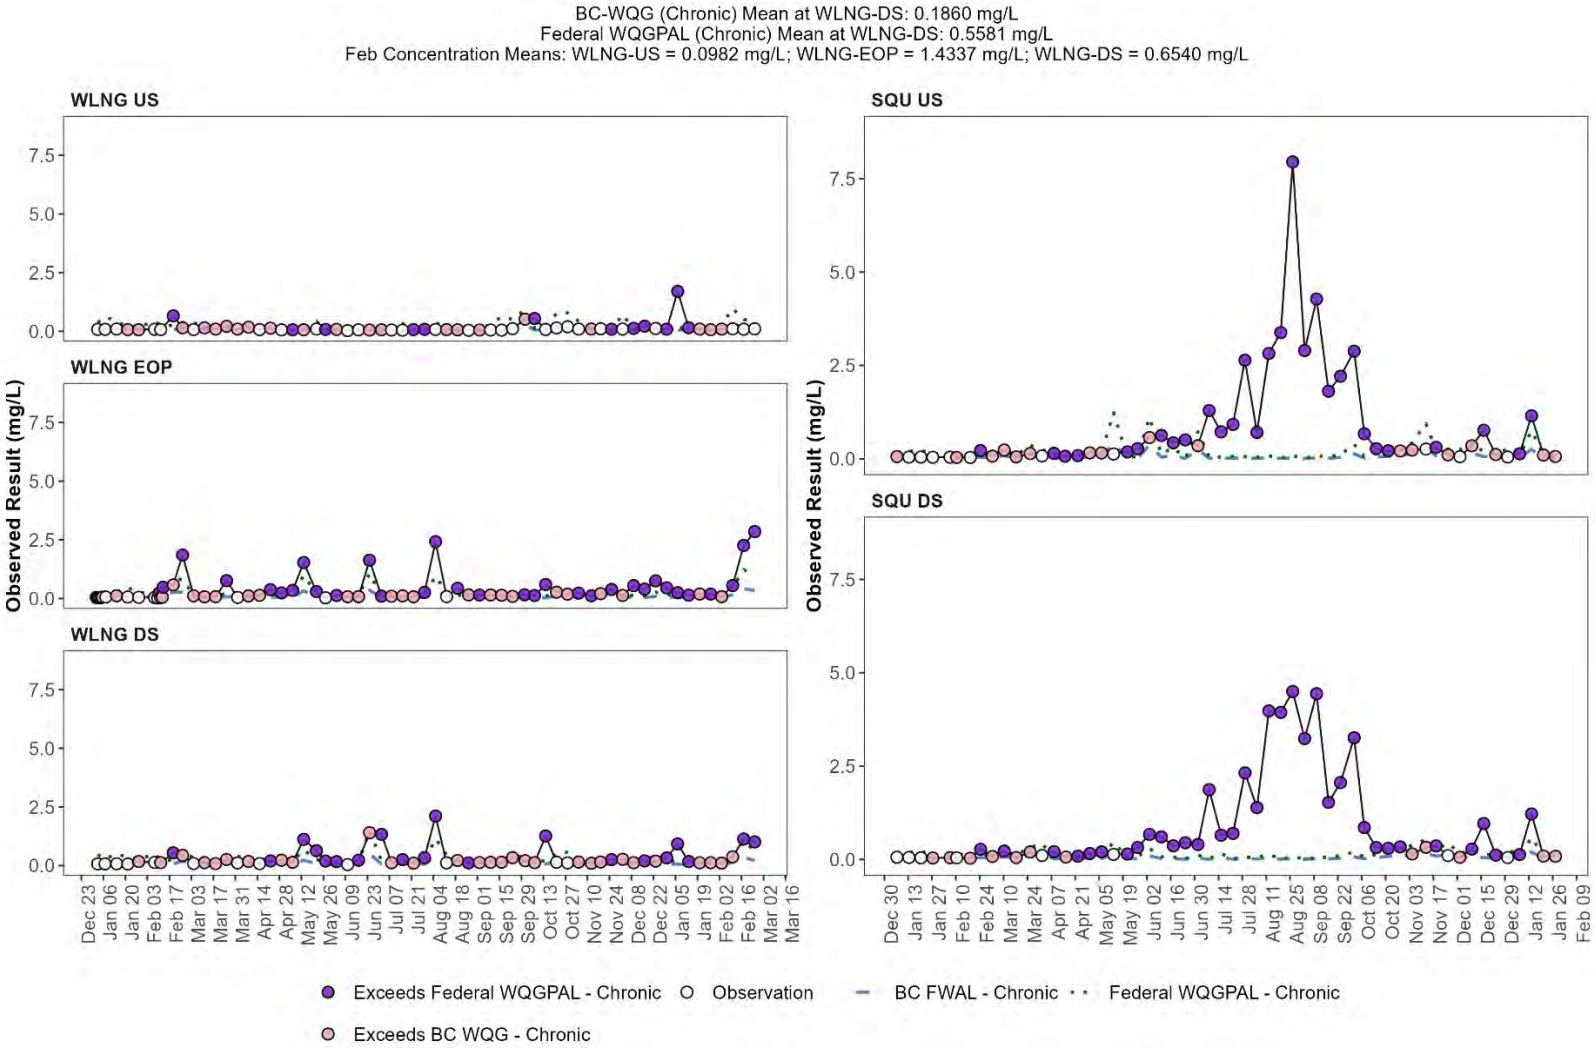

Figure 2: Dissolved Aluminum

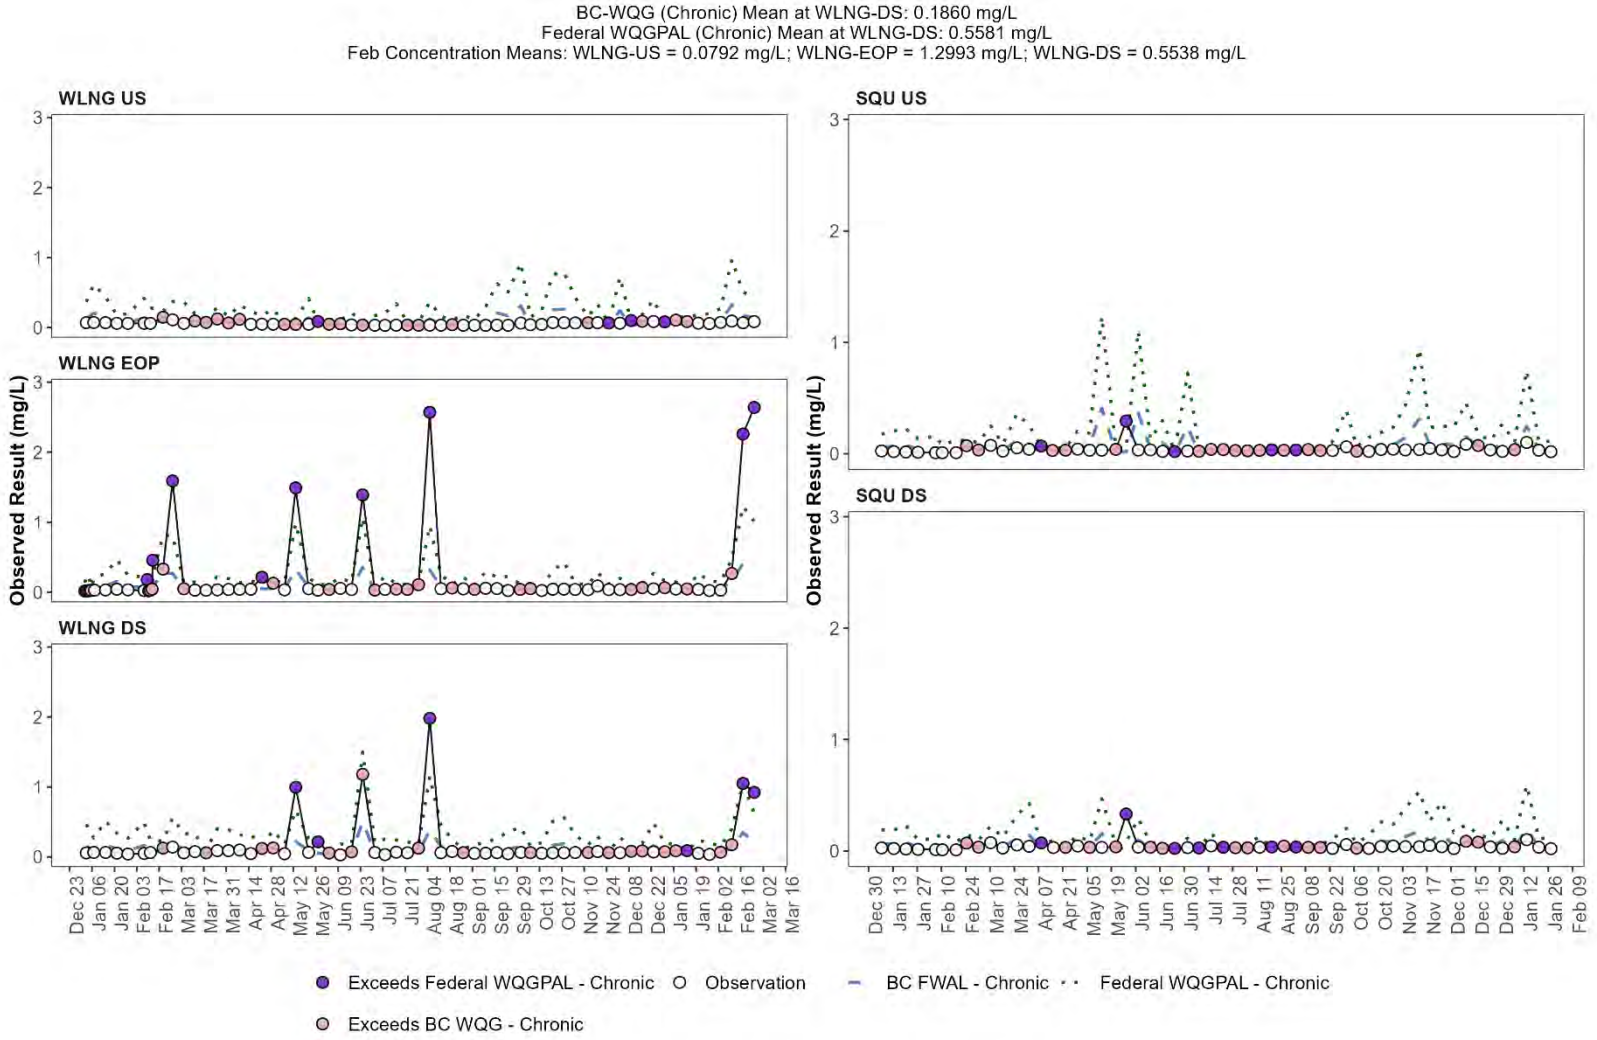

Figure 3: Dissolved Copper

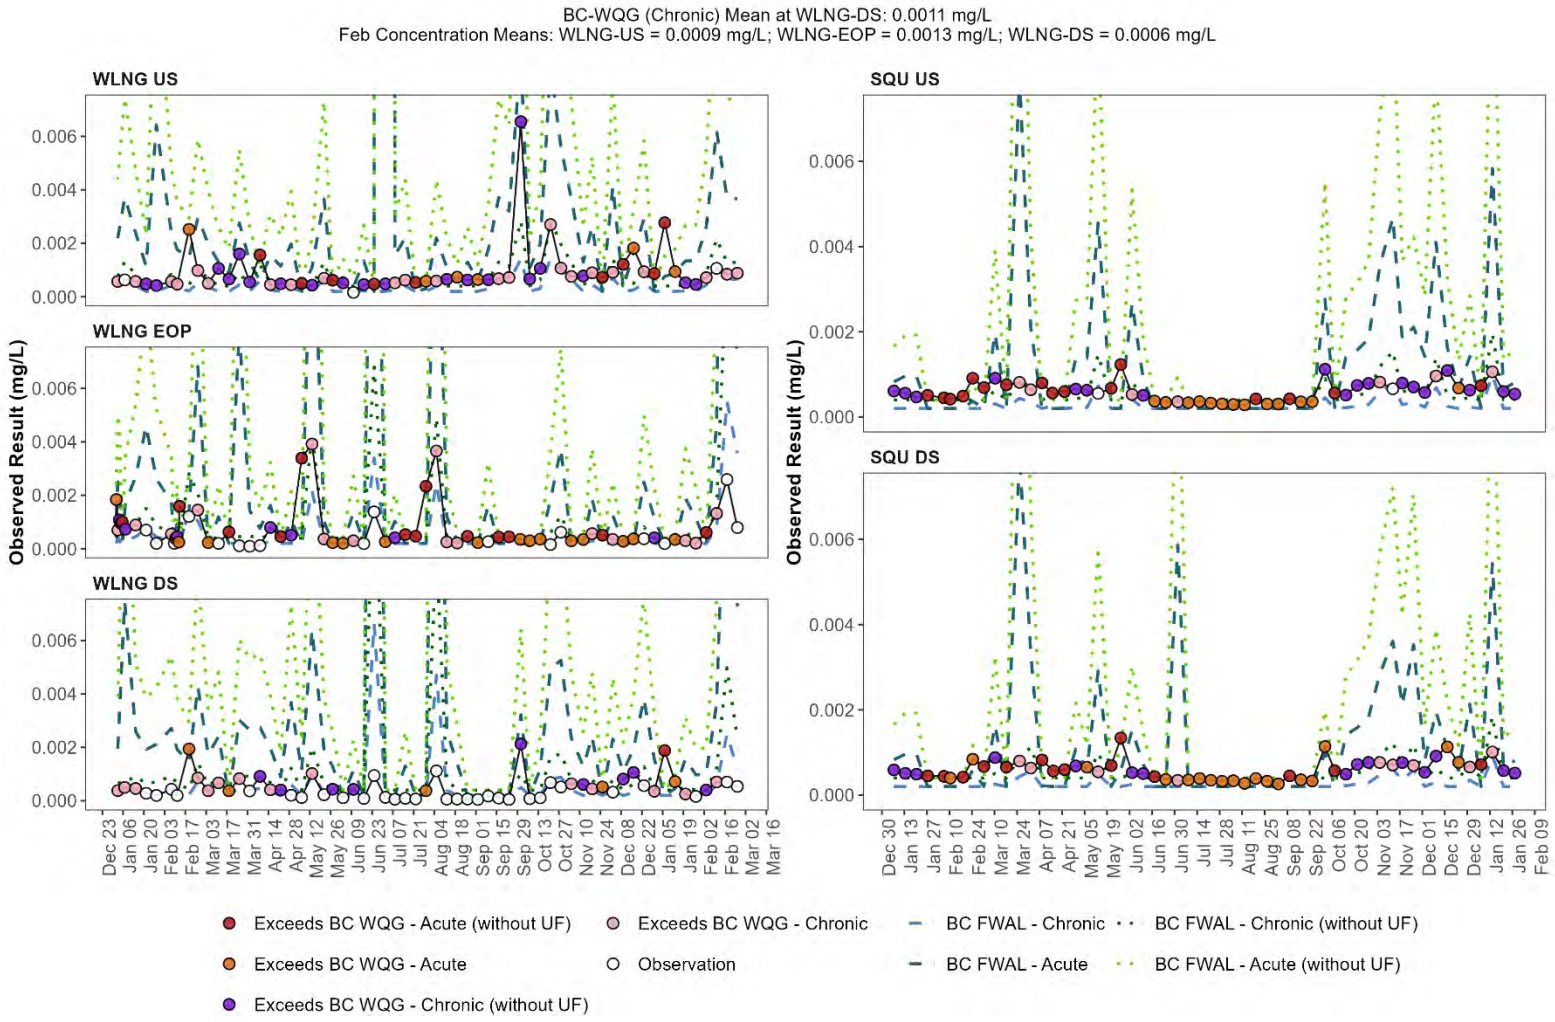

Figure 4 – Total Suspended Solids (TSS)

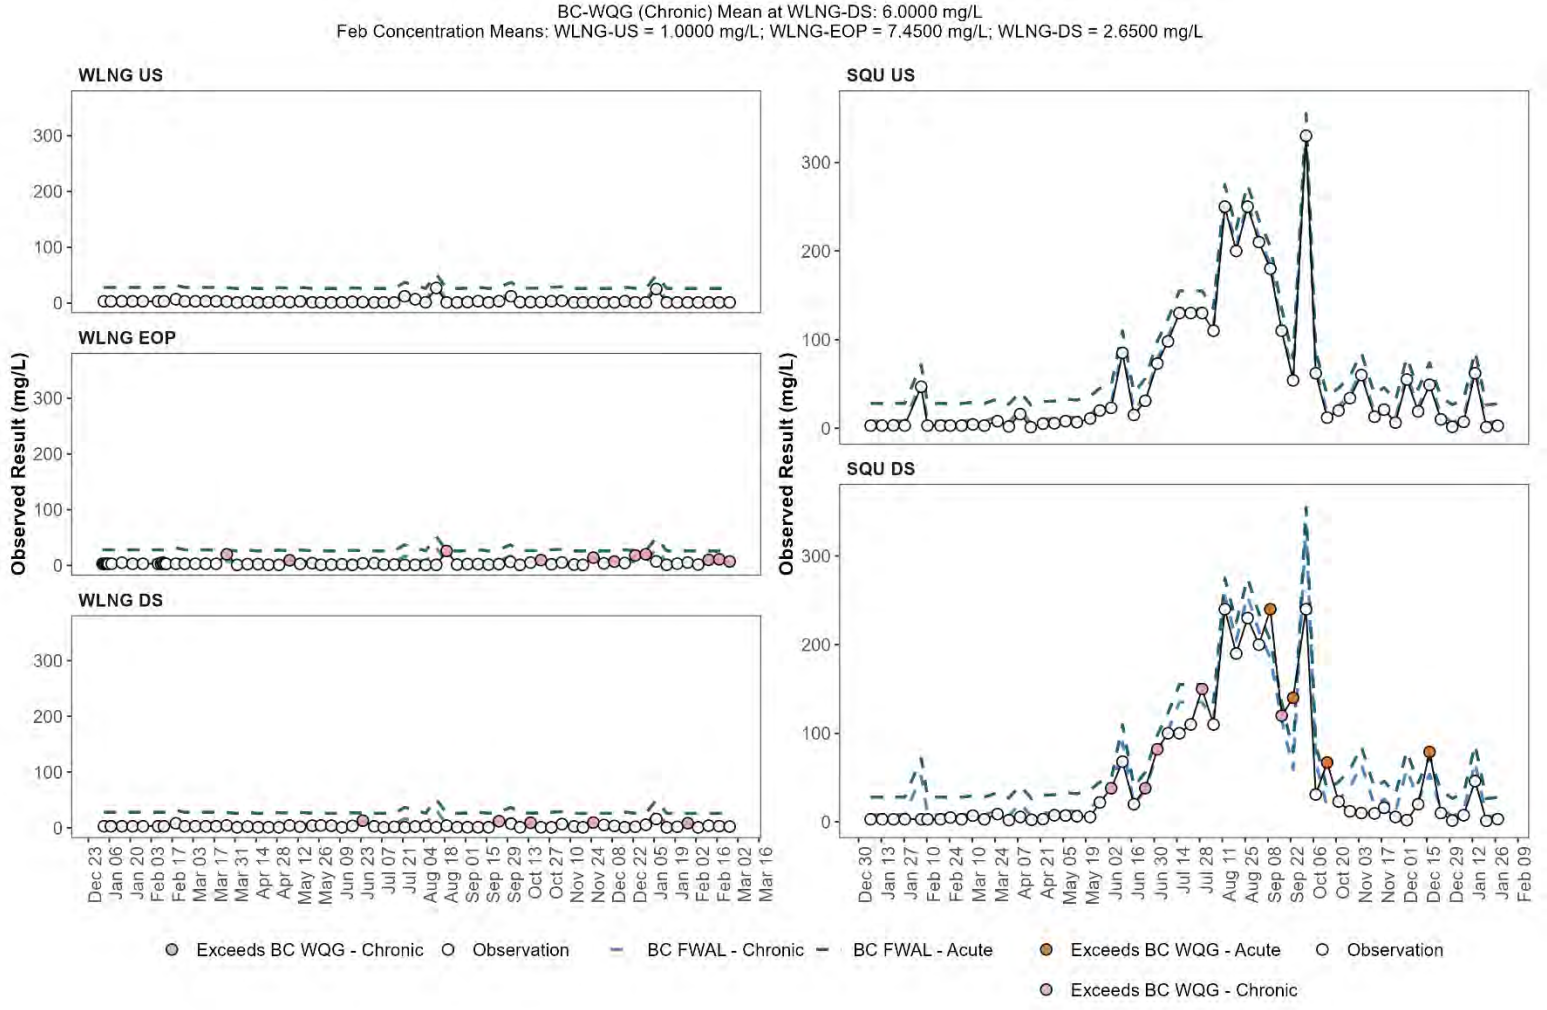

Figure 5 – Dissolved Zinc (D-Zn)

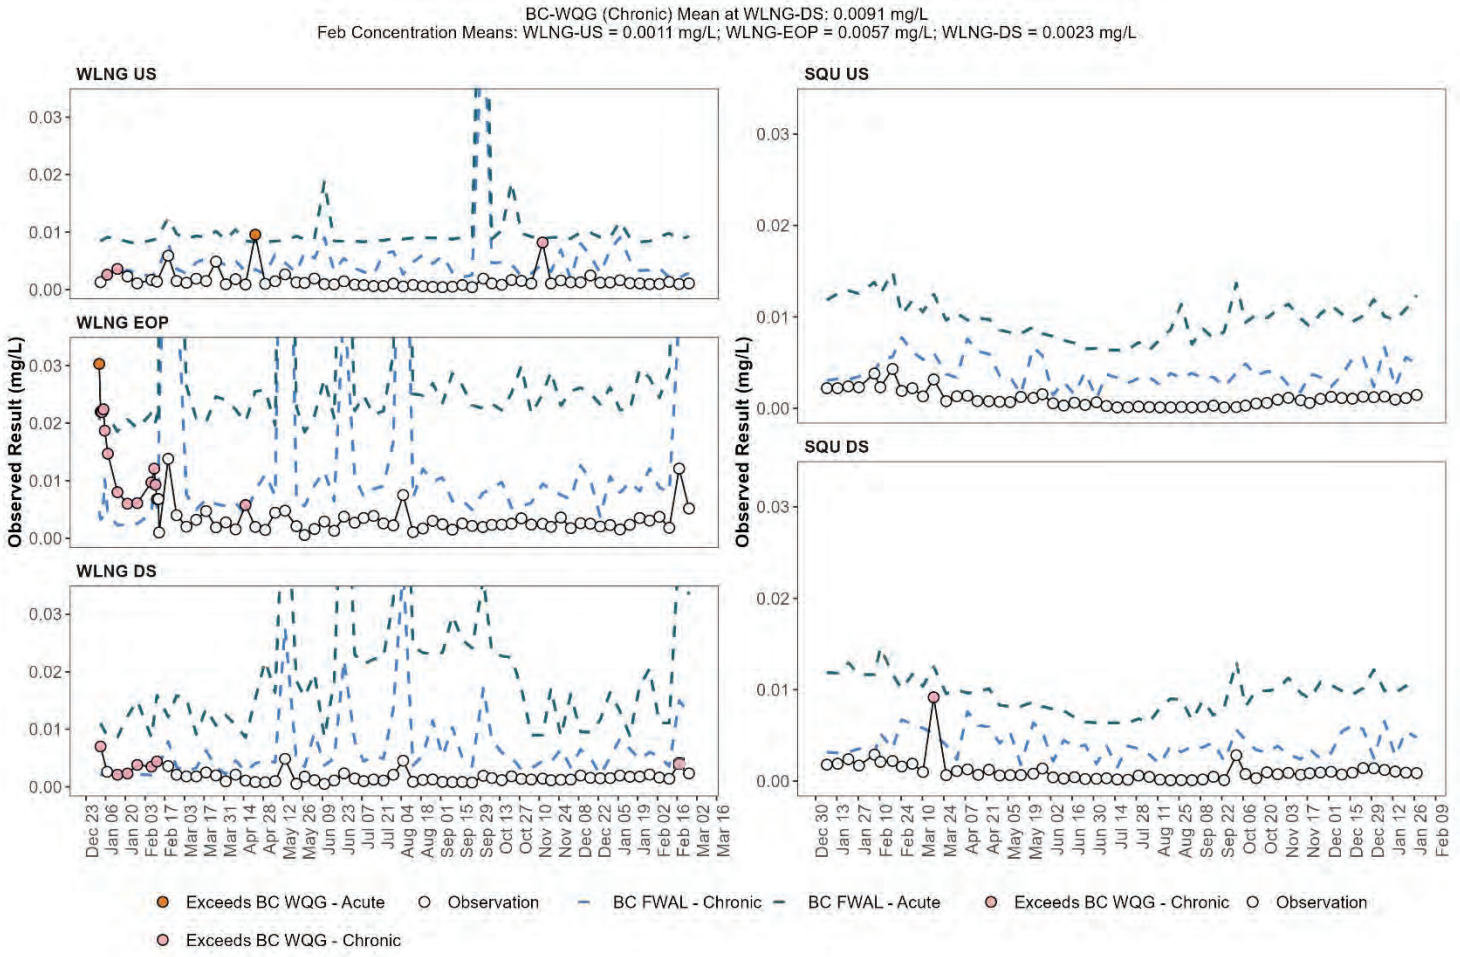

Appendix A:
BCR Site Point of Discharge from Water Treatment Plant Documentation

BCR Site Batch Sample Analysis

No Discharges

BCR Site WTP Discharge Field Notes and Logs

No Discharges

Appendix B:
BCR Site Receiving Environment Documentation

BCR Site Receiving Environment Sample Analysis

No Sampling

BCR Site Receiving Environment Field Notes and Logs

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-23 00:00:00	3.10	65.16	0.55	7.41	11.77	4.17	0.03
SQU-DS	2026-02-23 00:15:00	3.08	63.11	0.55	7.41	11.82	3.49	0.03
SQU-DS	2026-02-23 00:30:00	3.09	63.46	0.55	7.39	11.75	3.85	0.03
SQU-DS	2026-02-23 00:45:00	3.10	63.99	0.55	7.40	11.79	3.55	0.03
SQU-DS	2026-02-23 01:00:00	3.08	63.09	0.55	7.42	11.76	4.56	0.03
SQU-DS	2026-02-23 01:15:00	3.06	62.22	0.55	7.35	11.80	3.56	0.03
SQU-DS	2026-02-23 01:30:00	3.06	61.68	0.55	7.39	11.81	3.48	0.03
SQU-DS	2026-02-23 01:45:00	3.04	60.88	0.55	7.39	11.80	3.57	0.03
SQU-DS	2026-02-23 02:00:00	3.03	60.50	0.55	7.40	11.82	4.79	0.03
SQU-DS	2026-02-23 02:15:00	3.01	59.72	0.55	7.36	11.84	5.11	0.03
SQU-DS	2026-02-23 02:30:00	3.01	59.44	0.55	7.37	11.84	4.93	0.03
SQU-DS	2026-02-23 02:45:00	3.01	58.99	0.55	7.39	11.84	4.60	0.03
SQU-DS	2026-02-23 03:00:00	3.00	58.64	0.55	7.31	11.87	12.15	0.03
SQU-DS	2026-02-23 03:15:00	2.99	58.18	0.55	7.39	11.92	5.29	0.03
SQU-DS	2026-02-23 03:30:00	2.98	57.91	0.55	7.37	11.90	4.49	0.03
SQU-DS	2026-02-23 03:45:00	2.98	57.51	0.55	7.33	11.92	13.33	0.03
SQU-DS	2026-02-23 04:00:00	2.98	57.57	0.55	7.38	11.95	3.77	0.03
SQU-DS	2026-02-23 04:15:00	2.98	57.15	0.55	7.39	11.95	3.20	0.03
SQU-DS	2026-02-23 04:30:00	2.98	57.08	0.55	7.37	11.95	3.30	0.03
SQU-DS	2026-02-23 04:45:00	2.98	56.65	0.55	7.40	11.93	2.99	0.02
SQU-DS	2026-02-23 05:00:00	2.97	56.03	0.55	7.37	11.97	4.53	0.02
SQU-DS	2026-02-23 05:15:00	2.97	56.01	0.55	7.37	11.99	4.56	0.02
SQU-DS	2026-02-23 05:30:00	2.96	55.43	0.55	7.39	11.99	4.84	0.02
SQU-DS	2026-02-23 05:45:00	2.96	54.68	0.55	7.40	12.00	4.94	0.02
SQU-DS	2026-02-23 06:00:00	2.97	55.04	0.55	7.41	11.98	4.33	0.02
SQU-DS	2026-02-23 06:15:00	2.97	54.85	0.55	7.39	12.01	4.41	0.02
SQU-DS	2026-02-23 06:30:00	2.97	54.49	0.55	7.43	11.97	3.79	0.02
SQU-DS	2026-02-23 06:45:00	2.97	54.06	0.55	7.42	11.95	5.46	0.02
SQU-DS	2026-02-23 07:00:00	2.98	53.59	0.55	7.40	12.01	6.28	0.02
SQU-DS	2026-02-23 07:15:00	3.00	53.45	0.55	7.34	12.11	7.49	0.02
SQU-DS	2026-02-23 07:30:00	2.98	53.15	0.55	7.39	12.15	8.26	0.02
SQU-DS	2026-02-23 07:45:00	2.98	53.33	0.55	7.38	12.15	11.68	0.02
SQU-DS	2026-02-23 08:00:00	3.00	53.49	0.55	7.39	12.15	11.37	0.02
SQU-DS	2026-02-23 08:15:00	3.04	53.84	0.55	7.39	12.13	10.88	0.02
SQU-DS	2026-02-23 08:30:00	3.07	54.44	0.55	7.43	12.08	14.13	0.02
SQU-DS	2026-02-23 08:45:00	3.07	53.91	0.55	7.42	12.04	12.03	0.02
SQU-DS	2026-02-23 09:00:00	3.10	53.81	0.55	7.43	12.04	10.69	0.02
SQU-DS	2026-02-23 09:15:00	3.13	53.90	0.55	7.45	12.03	10.46	0.02
SQU-DS	2026-02-23 09:30:00	3.19	56.20	0.55	7.45	11.92	12.20	0.02
SQU-DS	2026-02-23 09:45:00	3.19	54.24	0.55	7.47	11.90	12.40	0.02
SQU-DS	2026-02-23 10:00:00	3.27	55.86	0.55	7.45	11.86	13.07	0.02
SQU-DS	2026-02-23 10:15:00	3.34	57.72	0.55	7.44	11.92	14.08	0.03
SQU-DS	2026-02-23 10:30:00	3.37	57.98	0.55	7.45	11.78	15.55	0.03
SQU-DS	2026-02-23 10:45:00	3.37	55.83	0.55	7.43	11.64	13.12	0.02
SQU-DS	2026-02-23 11:00:00	3.39	55.19	0.55	7.43	11.77	11.98	0.02
SQU-DS	2026-02-23 11:15:00	3.43	56.23	0.55	7.42	11.94	12.33	0.02
SQU-DS	2026-02-23 11:30:00	3.45	54.87	0.55	7.41	11.97	12.15	0.02
SQU-DS	2026-02-23 11:45:00	3.51	53.41	0.55	7.42	11.98	12.22	0.02
SQU-DS	2026-02-23 12:00:00	3.59	53.31	0.55	7.41	12.04	12.31	0.02
SQU-DS	2026-02-23 12:15:00	3.65	53.29	0.55	7.43	12.01	12.63	0.02
SQU-DS	2026-02-23 12:30:00	3.70	53.41	0.55	7.42	11.95	12.13	0.02
SQU-DS	2026-02-23 12:45:00	3.76	53.40	0.55	7.45	11.94	11.66	0.02
SQU-DS	2026-02-23 13:00:00	3.87	53.76	0.55	7.38	11.88	12.99	0.02
SQU-DS	2026-02-23 13:15:00	3.98	54.38	0.55	7.37	11.87	13.78	0.02
SQU-DS	2026-02-23 13:30:00	4.10	54.75	0.55	7.32	11.75	11.55	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-23 13:45:00	4.16	55.10	0.55	7.32	11.81	13.97	0.02
SQU-DS	2026-02-23 14:00:00	4.03	53.98	0.55	7.29	11.81	15.60	0.02
SQU-DS	2026-02-23 14:15:00	4.12	54.23	0.55	7.29	11.81	25.17	0.02
SQU-DS	2026-02-23 14:30:00	4.17	54.37	0.55	7.27	11.88	15.81	0.02
SQU-DS	2026-02-23 14:45:00	4.25	54.54	0.55	7.31	11.85	11.01	0.02
SQU-DS	2026-02-23 15:00:00	4.46	55.23	0.55	7.28	11.73	10.90	0.02
SQU-DS	2026-02-23 15:15:00	4.44	55.27	0.55	7.27	11.87	9.77	0.02
SQU-DS	2026-02-23 15:30:00	4.49	55.79	0.55	7.33	11.68	10.56	0.02
SQU-DS	2026-02-23 15:45:00	4.47	56.69	0.55	7.37	11.54	10.95	0.03
SQU-DS	2026-02-23 16:00:00	4.45	56.70	0.55	7.38	11.69	235.80	0.03
SQU-DS	2026-02-23 16:15:00	4.29	56.08	0.55	7.35	11.77	781.56	0.02
SQU-DS	2026-02-23 16:30:00	4.40	57.39	0.55	7.37	11.71	801.34	0.03
SQU-DS	2026-02-23 16:45:00	4.44	57.06	0.55	7.37	11.70	13.84	0.03
SQU-DS	2026-02-23 17:00:00	4.17	50.87	0.55	7.30	11.87	0.00	0.02
SQU-DS	2026-02-23 17:15:00	4.20	53.81	0.56	7.26	11.90	21.43	0.02
SQU-DS	2026-02-23 17:30:00	4.19	49.29	0.56	7.23	11.89	0.00	0.02
SQU-DS	2026-02-23 17:45:00	4.16	49.88	0.56	7.21	11.96	0.00	0.02
SQU-DS	2026-02-23 18:00:00	4.11	39.88	0.56	7.20	11.98	0.00	0.02
SQU-DS	2026-02-23 18:15:00	4.29	35.19	0.56	7.19	11.95	0.65	0.01
SQU-DS	2026-02-23 18:30:00	4.12	10.93	0.56	7.19	12.03	0.00	0.00
SQU-DS	2026-02-23 18:45:00	4.21	15.96	0.56	7.18	12.01	0.00	0.01
SQU-DS	2026-02-23 19:00:00	4.20	28.04	0.56	7.18	12.03	0.00	0.01
SQU-DS	2026-02-23 19:15:00	4.08	41.25	0.56	7.17	12.09	0.00	0.02
SQU-DS	2026-02-23 19:30:00	4.24	37.72	0.56	7.17	11.99	0.00	0.02
SQU-DS	2026-02-23 19:45:00	4.01	29.88	0.56	7.16	12.12	0.00	0.01
SQU-DS	2026-02-23 20:00:00	4.01	19.64	0.56	7.16	12.12	0.00	0.01
SQU-DS	2026-02-23 20:15:00	3.84	50.09	0.56	7.14	12.16	0.00	0.02
SQU-DS	2026-02-23 20:30:00	3.76	58.55	0.55	7.24	11.72	441.60	0.03
SQU-DS	2026-02-23 20:45:00	3.64	58.09	0.55	7.36	11.66	1.77	0.03
SQU-DS	2026-02-23 21:00:00	3.63	58.19	0.55	7.37	11.62	1.85	0.03
SQU-DS	2026-02-23 21:15:00	3.61	57.74	0.55	7.35	11.59	1.62	0.03
SQU-DS	2026-02-23 21:30:00	3.59	57.56	0.55	7.35	11.67	1.97	0.03
SQU-DS	2026-02-23 21:45:00	3.59	57.12	0.55	7.36	11.65	1.75	0.03
SQU-DS	2026-02-23 22:00:00	3.60	56.89	0.55	7.32	11.63	2.98	0.03
SQU-DS	2026-02-23 22:15:00	3.60	56.41	0.55	7.32	11.65	1.54	0.02
SQU-DS	2026-02-23 22:30:00	3.60	55.77	0.55	7.35	11.65	1.53	0.02
SQU-DS	2026-02-23 22:45:00	3.59	55.48	0.55	7.34	11.66	1.26	0.02
SQU-DS	2026-02-23 23:00:00	3.59	55.55	0.55	7.36	11.66	46.97	0.02
SQU-DS	2026-02-23 23:15:00	3.58	55.51	0.55	7.35	11.66	0.95	0.02
SQU-DS	2026-02-23 23:30:00	3.58	55.83	0.55	7.34	11.69	1.27	0.02
SQU-DS	2026-02-23 23:45:00	3.58	55.78	0.55	7.36	11.65	1.74	0.02
SQU-DS	2026-02-24 00:00:00	3.59	55.88	0.55	7.35	11.66	0.93	0.02
SQU-DS	2026-02-24 00:15:00	3.59	55.82	0.55	7.36	11.66	0.89	0.02
SQU-DS	2026-02-24 00:30:00	3.59	56.24	0.55	7.33	11.62	0.74	0.02
SQU-DS	2026-02-24 00:45:00	3.59	56.98	0.55	7.35	11.62	1.15	0.03
SQU-DS	2026-02-24 01:00:00	3.59	57.34	0.55	7.34	11.64	0.76	0.03
SQU-DS	2026-02-24 01:15:00	3.57	56.52	0.55	7.35	11.61	0.75	0.02
SQU-DS	2026-02-24 01:30:00	3.56	56.27	0.55	7.32	11.65	1.10	0.02
SQU-DS	2026-02-24 01:45:00	3.57	56.92	0.55	7.30	11.66	0.97	0.03
SQU-DS	2026-02-24 02:00:00	3.58	57.37	0.55	7.35	11.63	0.95	0.03
SQU-DS	2026-02-24 02:15:00	3.57	56.60	0.55	7.34	11.63	1.48	0.02
SQU-DS	2026-02-24 02:30:00	3.57	56.37	0.55	7.29	11.63	1.86	0.02
SQU-DS	2026-02-24 02:45:00	3.57	56.08	0.55	7.30	11.64	1.08	0.02
SQU-DS	2026-02-24 03:00:00	3.56	56.13	0.55	7.34	11.59	1.26	0.02
SQU-DS	2026-02-24 03:15:00	3.54	55.79	0.55	7.32	11.63	0.99	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-24 03:30:00	3.52	55.36	0.55	7.28	11.60	1.41	0.02
SQU-DS	2026-02-24 03:45:00	3.50	55.19	0.55	7.28	11.61	1.49	0.02
SQU-DS	2026-02-24 04:00:00	3.48	55.16	0.55	7.30	11.64	1.34	0.02
SQU-DS	2026-02-24 04:15:00	3.48	55.12	0.55	7.30	11.63	1.44	0.02
SQU-DS	2026-02-24 04:30:00	3.48	55.02	0.55	7.30	11.67	1.64	0.02
SQU-DS	2026-02-24 04:45:00	3.47	54.99	0.55	7.29	11.67	1.34	0.02
SQU-DS	2026-02-24 05:00:00	3.46	54.97	0.55	7.31	11.67	1.49	0.02
SQU-DS	2026-02-24 05:15:00	3.45	54.92	0.55	7.31	11.67	1.39	0.02
SQU-DS	2026-02-24 05:30:00	3.42	54.57	0.55	7.29	11.68	1.61	0.02
SQU-DS	2026-02-24 05:45:00	3.40	54.60	0.55	7.31	11.70	2.03	0.02
SQU-DS	2026-02-24 06:00:00	3.38	54.49	0.55	7.32	11.66	1.36	0.02
SQU-DS	2026-02-24 06:15:00	3.35	54.28	0.55	7.31	11.68	1.34	0.02
SQU-DS	2026-02-24 06:30:00	3.32	53.96	0.55	7.31	11.69	1.62	0.02
SQU-DS	2026-02-24 06:45:00	3.31	53.88	0.55	7.32	11.69	1.29	0.02
SQU-DS	2026-02-24 07:00:00	3.28	53.81	0.55	7.32	11.71	0.93	0.02
SQU-DS	2026-02-24 07:15:00	3.26	53.66	0.55	7.33	11.71	1.10	0.02
SQU-DS	2026-02-24 07:30:00	3.24	53.48	0.55	7.34	11.71	1.37	0.02
SQU-DS	2026-02-24 07:45:00	3.22	53.56	0.55	7.33	11.70	1.58	0.02
SQU-DS	2026-02-24 08:00:00	3.21	53.49	0.55	7.35	11.71	1.17	0.02
SQU-DS	2026-02-24 08:15:00	3.19	53.44	0.55	7.35	11.70	1.17	0.02
SQU-DS	2026-02-24 08:30:00	3.18	53.34	0.55	7.35	11.69	1.18	0.02
SQU-DS	2026-02-24 08:45:00	3.16	53.14	0.55	7.35	11.68	2.02	0.02
SQU-DS	2026-02-24 09:00:00	3.16	53.30	0.55	7.36	11.67	2.11	0.02
SQU-DS	2026-02-24 09:15:00	3.17	53.48	0.55	7.36	11.68	1.31	0.02
SQU-DS	2026-02-24 09:30:00	3.20	53.73	0.55	7.37	11.72	5.27	0.02
SQU-DS	2026-02-24 09:45:00	3.24	54.62	0.55	7.37	11.72	5.67	0.02
SQU-DS	2026-02-24 10:00:00	3.28	54.96	0.55	7.37	11.74	2.35	0.02
SQU-DS	2026-02-24 10:15:00	3.36	55.81	0.55	7.38	11.71	2.47	0.02
SQU-DS	2026-02-24 10:30:00	3.43	57.20	0.55	7.37	11.69	2.18	0.03
SQU-DS	2026-02-24 10:45:00	3.54	59.73	0.55	7.38	11.66	2.44	0.03
SQU-DS	2026-02-24 11:00:00	3.64	60.88	0.55	7.37	11.63	2.39	0.03
SQU-DS	2026-02-24 11:15:00	3.74	61.89	0.55	7.36	11.57	3.13	0.03
SQU-DS	2026-02-24 11:30:00	3.81	61.18	0.55	7.37	11.56	2.65	0.03
SQU-DS	2026-02-24 11:45:00	3.88	60.63	0.55	7.37	11.54	2.91	0.03
SQU-DS	2026-02-24 12:00:00	3.98	60.36	0.55	7.37	11.59	2.98	0.03
SQU-DS	2026-02-24 12:15:00	4.05	59.72	0.55	7.36	11.58	2.45	0.03
SQU-DS	2026-02-24 12:30:00	4.13	59.61	0.55	7.34	11.60	3.27	0.03
SQU-DS	2026-02-24 12:45:00	4.19	59.01	0.55	7.32	11.59	3.69	0.03
SQU-DS	2026-02-24 13:00:00	4.25	58.97	0.55	7.33	11.53	2.34	0.03
SQU-DS	2026-02-24 13:15:00	4.35	23.55	0.55	7.31	11.77	0.00	0.01
SQU-DS	2026-02-24 13:30:00	4.56	0.09	0.56	7.32	11.83	0.00	0.00
SQU-DS	2026-02-24 13:45:00	4.60	0.09	0.56	7.30	11.84	0.00	0.00
SQU-DS	2026-02-24 14:00:00	4.63	0.09	0.56	7.28	11.84	0.00	0.00
SQU-DS	2026-02-24 14:15:00	4.72	0.09	0.56	7.28	11.82	0.00	0.00
SQU-DS	2026-02-24 14:30:00	4.90	0.09	0.56	7.27	11.76	0.00	0.00
SQU-DS	2026-02-24 14:45:00	5.24	0.09	0.56	7.26	11.68	0.00	0.00
SQU-DS	2026-02-24 15:00:00	5.87	0.09	0.56	7.24	11.49	0.00	0.00
SQU-DS	2026-02-24 15:15:00	6.39	0.09	0.55	7.21	11.32	0.00	0.00
SQU-DS	2026-02-24 15:30:00	7.00	0.08	0.55	7.20	11.16	0.00	0.00
SQU-DS	2026-02-24 15:45:00	7.47	0.08	0.55	7.19	11.04	0.00	0.00
SQU-DS	2026-02-24 16:00:00	6.66	0.08	0.55	7.19	11.30	0.00	0.00
SQU-DS	2026-02-24 16:15:00	4.57	4.05	0.55	7.18	11.97	0.00	0.00
SQU-DS	2026-02-24 16:30:00	4.34	51.69	0.56	7.17	11.82	0.00	0.02
SQU-DS	2026-02-24 16:45:00	4.28	57.20	0.56	7.16	11.71	0.00	0.03
SQU-DS	2026-02-24 17:00:00	4.18	57.54	0.55	7.22	11.65	1209.67	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-24 17:15:00	4.07	57.43	0.54	7.37	11.65	7.90	0.03
SQU-DS	2026-02-24 17:30:00	4.02	57.49	0.54	7.39	11.64	2.38	0.03
SQU-DS	2026-02-24 17:45:00	3.95	57.22	0.54	7.38	11.64	1.50	0.03
SQU-DS	2026-02-24 18:00:00	3.90	57.17	0.54	7.35	11.63	7.31	0.03
SQU-DS	2026-02-24 18:15:00	3.88	57.35	0.54	7.33	11.62	2.18	0.03
SQU-DS	2026-02-24 18:30:00	3.84	57.04	0.54	7.31	11.58	1.42	0.03
SQU-DS	2026-02-24 18:45:00	3.79	56.82	0.55	7.30	11.58	1.82	0.03
SQU-DS	2026-02-24 19:00:00	3.77	56.81	0.55	7.28	11.62	2.73	0.03
SQU-DS	2026-02-24 19:15:00	3.79	57.46	0.55	7.26	11.55	3.09	0.03
SQU-DS	2026-02-24 19:30:00	3.77	57.21	0.55	7.28	11.54	1.64	0.03
SQU-DS	2026-02-24 19:45:00	3.74	57.07	0.55	7.26	11.57	5.17	0.03
SQU-DS	2026-02-24 20:00:00	3.72	56.80	0.55	7.23	11.59	2.16	0.03
SQU-DS	2026-02-24 20:15:00	3.71	56.73	0.55	7.25	11.60	2.62	0.03
SQU-DS	2026-02-24 20:30:00	3.73	56.89	0.55	7.25	11.59	2.52	0.03
SQU-DS	2026-02-24 20:45:00	3.71	56.77	0.55	7.26	11.60	7.62	0.03
SQU-DS	2026-02-24 21:00:00	3.71	56.73	0.55	7.25	11.59	2.81	0.03
SQU-DS	2026-02-24 21:15:00	3.76	57.13	0.55	7.23	11.52	4.14	0.03
SQU-DS	2026-02-24 21:30:00	3.72	56.71	0.55	7.24	11.59	3.18	0.03
SQU-DS	2026-02-24 21:45:00	3.71	56.58	0.55	7.27	11.61	3.91	0.03
SQU-DS	2026-02-24 22:00:00	3.72	56.69	0.55	7.27	11.60	3.31	0.03
SQU-DS	2026-02-24 22:15:00	3.72	56.80	0.55	7.30	11.55	3.44	0.03
SQU-DS	2026-02-24 22:30:00	3.72	56.71	0.55	7.29	11.56	3.76	0.03
SQU-DS	2026-02-24 22:45:00	3.72	56.53	0.55	7.32	11.60	3.07	0.02
SQU-DS	2026-02-24 23:00:00	3.70	56.19	0.55	7.33	11.58	3.89	0.02
SQU-DS	2026-02-24 23:15:00	3.69	56.12	0.55	7.30	11.61	4.04	0.02
SQU-DS	2026-02-24 23:30:00	3.68	56.24	0.55	7.34	11.56	3.62	0.02
SQU-DS	2026-02-24 23:45:00	3.67	56.62	0.55	7.34	11.58	3.45	0.03
SQU-DS	2026-02-25 00:00:00	3.65	56.57	0.55	7.36	11.59	3.99	0.02
SQU-DS	2026-02-25 00:15:00	3.63	56.46	0.55	7.37	11.54	3.75	0.02
SQU-DS	2026-02-25 00:30:00	3.61	56.41	0.55	7.36	11.56	3.46	0.02
SQU-DS	2026-02-25 00:45:00	3.59	56.41	0.55	7.37	11.56	3.47	0.02
SQU-DS	2026-02-25 01:00:00	3.58	56.41	0.55	7.38	11.53	3.82	0.02
SQU-DS	2026-02-25 01:15:00	3.56	56.64	0.55	7.38	11.53	3.92	0.03
SQU-DS	2026-02-25 01:30:00	3.55	57.01	0.55	7.38	11.52	3.80	0.03
SQU-DS	2026-02-25 01:45:00	3.55	57.37	0.55	7.37	11.53	4.08	0.03
SQU-DS	2026-02-25 02:00:00	3.54	57.52	0.55	7.39	11.52	4.12	0.03
SQU-DS	2026-02-25 02:15:00	3.54	58.31	0.55	7.37	11.53	3.93	0.03
SQU-DS	2026-02-25 02:30:00	3.56	59.93	0.55	7.38	11.51	3.82	0.03
SQU-DS	2026-02-25 02:45:00	3.55	59.68	0.55	7.37	11.46	4.49	0.03
SQU-DS	2026-02-25 03:00:00	3.53	59.13	0.55	7.38	11.42	4.06	0.03
SQU-DS	2026-02-25 03:15:00	3.53	59.81	0.55	7.38	11.44	3.96	0.03
SQU-DS	2026-02-25 03:30:00	3.53	60.36	0.55	7.37	11.53	4.32	0.03
SQU-DS	2026-02-25 03:45:00	3.53	60.60	0.55	7.39	11.47	5.66	0.03
SQU-DS	2026-02-25 04:00:00	3.50	59.60	0.55	7.37	11.54	3.66	0.03
SQU-DS	2026-02-25 04:15:00	3.48	59.16	0.55	7.36	11.50	4.25	0.03
SQU-DS	2026-02-25 04:30:00	3.48	59.85	0.55	7.39	11.52	4.11	0.03
SQU-DS	2026-02-25 04:45:00	3.46	59.87	0.55	7.37	11.52	4.02	0.03
SQU-DS	2026-02-25 05:00:00	3.44	59.49	0.55	7.38	11.50	4.10	0.03
SQU-DS	2026-02-25 05:15:00	3.42	58.81	0.55	7.36	11.56	4.09	0.03
SQU-DS	2026-02-25 05:30:00	3.41	59.20	0.55	7.36	11.58	4.18	0.03
SQU-DS	2026-02-25 05:45:00	3.41	58.92	0.55	7.39	11.60	3.81	0.03
SQU-DS	2026-02-25 06:00:00	3.39	58.85	0.55	7.36	11.55	4.76	0.03
SQU-DS	2026-02-25 06:15:00	3.38	58.45	0.55	7.36	11.57	5.51	0.03
SQU-DS	2026-02-25 06:30:00	3.38	58.33	0.55	7.37	11.61	4.06	0.03
SQU-DS	2026-02-25 06:45:00	3.38	58.37	0.55	7.37	11.60	3.91	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-25 07:00:00	3.38	58.25	0.55	7.37	11.54	4.49	0.03
SQU-DS	2026-02-25 07:15:00	3.38	58.14	0.55	7.35	11.62	4.55	0.03
SQU-DS	2026-02-25 07:30:00	3.38	58.23	0.55	7.35	11.63	4.64	0.03
SQU-DS	2026-02-25 07:45:00	3.39	58.02	0.55	7.39	11.60	4.30	0.03
SQU-DS	2026-02-25 08:00:00	3.39	57.88	0.55	7.37	11.58	4.09	0.03
SQU-DS	2026-02-25 08:15:00	3.40	57.89	0.55	7.38	11.57	4.38	0.03
SQU-DS	2026-02-25 08:30:00	3.42	58.08	0.55	7.38	11.60	9.22	0.03
SQU-DS	2026-02-25 08:45:00	3.43	58.16	0.55	7.37	11.63	5.89	0.03
SQU-DS	2026-02-25 09:00:00	3.45	58.14	0.55	7.38	11.63	5.16	0.03
SQU-DS	2026-02-25 09:15:00	3.46	58.11	0.55	7.39	11.60	4.60	0.03
SQU-DS	2026-02-25 09:30:00	3.49	58.22	0.55	7.37	11.59	5.42	0.03
SQU-DS	2026-02-25 09:45:00	3.52	58.52	0.55	7.37	11.66	4.94	0.03
SQU-DS	2026-02-25 10:00:00	3.56	58.95	0.55	7.35	11.74	6.00	0.03
SQU-DS	2026-02-25 10:15:00	3.60	59.13	0.55	7.35	11.79	5.05	0.03
SQU-DS	2026-02-25 10:30:00	3.65	59.02	0.55	7.35	11.84	4.87	0.03
SQU-DS	2026-02-25 10:45:00	3.72	60.23	0.55	7.37	11.80	4.69	0.03
SQU-DS	2026-02-25 11:00:00	3.76	60.67	0.55	7.37	11.77	5.06	0.03
SQU-DS	2026-02-25 11:15:00	3.81	60.83	0.55	7.39	11.74	5.70	0.03
SQU-DS	2026-02-25 11:30:00	3.87	61.68	0.55	7.39	11.73	4.47	0.03
SQU-DS	2026-02-25 11:45:00	3.94	62.87	0.55	7.40	11.67	6.52	0.03
SQU-DS	2026-02-25 12:00:00	3.99	63.57	0.55	7.38	11.64	5.15	0.03
SQU-DS	2026-02-25 12:15:00	4.01	63.22	0.55	7.40	11.62	9.36	0.03
SQU-DS	2026-02-25 12:30:00	4.04	63.66	0.55	7.38	11.61	5.34	0.03
SQU-DS	2026-02-25 12:45:00	4.06	63.23	0.55	7.36	11.61	7.62	0.03
SQU-DS	2026-02-25 13:00:00	4.05	63.12	0.55	7.40	11.57	5.88	0.03
SQU-DS	2026-02-25 13:15:00	4.03	62.72	0.55	7.37	11.55	6.22	0.03
SQU-DS	2026-02-25 13:30:00	4.01	62.88	0.55	7.37	11.46	8.32	0.03
SQU-DS	2026-02-25 13:45:00	4.02	62.40	0.55	7.37	11.48	4.85	0.03
SQU-DS	2026-02-25 14:00:00	4.01	62.04	0.55	7.34	11.47	5.36	0.03
SQU-DS	2026-02-25 14:15:00	4.04	62.23	0.55	7.26	11.46	6.63	0.03
SQU-DS	2026-02-25 14:30:00	3.99	61.61	0.55	7.32	11.61	7.59	0.03
SQU-DS	2026-02-25 14:45:00	4.11	62.58	0.55	7.34	11.81	312.62	0.03
SQU-DS	2026-02-25 15:00:00	4.00	56.71	0.55	7.37	12.01	0.00	0.03
SQU-DS	2026-02-25 15:15:00	4.01	50.61	0.56	7.33	12.06	1.04	0.02
SQU-DS	2026-02-25 15:30:00	4.09	47.30	0.56	7.28	12.07	42.28	0.02
SQU-DS	2026-02-25 15:45:00	4.00	13.77	0.56	7.26	12.12	0.00	0.00
SQU-DS	2026-02-25 16:00:00	4.03	46.56	0.56	7.23	12.10	0.24	0.02
SQU-DS	2026-02-25 16:15:00	4.07	60.11	0.56	7.22	12.08	94.52	0.03
SQU-DS	2026-02-25 16:30:00	4.32	57.34	0.56	7.21	12.00	9.43	0.03
SQU-DS	2026-02-25 16:45:00	4.04	47.01	0.56	7.21	12.07	0.00	0.02
SQU-DS	2026-02-25 17:00:00	4.00	47.82	0.56	7.20	12.11	817.44	0.02
SQU-DS	2026-02-25 17:15:00	4.18	55.56	0.56	7.19	12.00	180.10	0.02
SQU-DS	2026-02-25 17:30:00	4.15	25.82	0.56	7.19	12.05	0.00	0.01
SQU-DS	2026-02-25 17:45:00	4.08	45.44	0.56	7.18	12.07	236.09	0.02
SQU-DS	2026-02-25 18:00:00	4.68	62.13	0.56	7.17	11.82	696.57	0.03
SQU-DS	2026-02-25 18:15:00	4.11	56.25	0.56	7.16	12.05	370.35	0.02
SQU-DS	2026-02-25 18:30:00	4.05	41.00	0.56	7.16	12.09	0.00	0.02
SQU-DS	2026-02-25 18:45:00	4.01	51.69	0.56	7.15	12.11	0.00	0.02
SQU-DS	2026-02-25 19:00:00	4.12	62.10	0.56	7.15	12.04	0.00	0.03
SQU-DS	2026-02-25 19:15:00	4.41	54.61	0.56	7.13	11.80	5.59	0.02
SQU-DS	2026-02-25 19:30:00	4.14	49.68	0.56	7.13	12.01	0.00	0.02
SQU-DS	2026-02-25 19:45:00	4.09	55.77	0.56	7.11	12.03	328.85	0.02
SQU-DS	2026-02-25 20:00:00	4.46	51.68	0.56	7.10	11.83	0.00	0.02
SQU-DS	2026-02-25 20:15:00	4.07	27.07	0.56	7.09	12.03	1.23	0.01
SQU-DS	2026-02-25 20:30:00	4.19	24.40	0.56	7.08	11.97	1.85	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-25 20:45:00	4.17	52.82	0.56	7.07	12.03	0.25	0.02
SQU-DS	2026-02-25 21:00:00	4.75	51.28	0.56	7.05	11.62	0.00	0.02
SQU-DS	2026-02-25 21:15:00	4.21	56.91	0.56	7.03	11.96	70.96	0.03
SQU-DS	2026-02-25 21:30:00	4.52	42.57	0.56	7.03	11.84	0.00	0.02
SQU-DS	2026-02-25 21:45:00	4.11	54.41	0.56	7.01	12.05	1.01	0.02
SQU-DS	2026-02-25 22:00:00	4.13	47.62	0.56	7.00	12.04	0.89	0.02
SQU-DS	2026-02-25 22:15:00	4.15	46.66	0.56	6.99	12.01	1.67	0.02
SQU-DS	2026-02-25 22:30:00	4.15	54.93	0.56	6.98	11.99	102.89	0.02
SQU-DS	2026-02-25 22:45:00	4.19	61.07	0.54	7.29	11.59	4.06	0.03
SQU-DS	2026-02-25 23:00:00	4.11	59.40	0.54	7.31	11.49	3.81	0.03
SQU-DS	2026-02-25 23:15:00	4.09	61.78	0.54	7.36	11.45	3.02	0.03
SQU-DS	2026-02-25 23:30:00	4.08	61.23	0.54	7.35	11.41	2.53	0.03
SQU-DS	2026-02-25 23:45:00	4.07	60.18	0.55	7.33	11.44	2.98	0.03
SQU-DS	2026-02-26 00:00:00	4.06	59.80	0.54	7.37	11.51	2.65	0.03
SQU-DS	2026-02-26 00:15:00	4.05	59.02	0.54	7.36	11.55	3.07	0.03
SQU-DS	2026-02-26 00:30:00	4.05	58.70	0.54	7.37	11.50	2.78	0.03
SQU-DS	2026-02-26 00:45:00	4.05	58.34	0.54	7.38	11.51	2.77	0.03
SQU-DS	2026-02-26 01:00:00	4.05	58.24	0.55	7.38	11.50	2.61	0.03
SQU-DS	2026-02-26 01:15:00	4.06	58.16	0.55	7.39	11.58	2.63	0.03
SQU-DS	2026-02-26 01:30:00	4.07	57.77	0.55	7.34	11.67	4.27	0.03
SQU-DS	2026-02-26 01:45:00	4.08	57.20	0.55	7.36	11.70	3.98	0.03
SQU-DS	2026-02-26 02:00:00	4.08	56.91	0.54	7.38	11.70	4.37	0.03
SQU-DS	2026-02-26 02:15:00	4.08	56.94	0.54	7.39	11.67	4.29	0.03
SQU-DS	2026-02-26 02:30:00	4.09	56.83	0.54	7.37	11.70	4.30	0.03
SQU-DS	2026-02-26 02:45:00	4.10	56.64	0.54	7.37	11.70	5.66	0.03
SQU-DS	2026-02-26 03:00:00	4.10	56.66	0.54	7.40	11.70	6.52	0.03
SQU-DS	2026-02-26 03:15:00	4.11	56.73	0.54	7.39	11.68	6.66	0.03
SQU-DS	2026-02-26 03:30:00	4.14	57.38	0.54	7.39	11.66	6.37	0.03
SQU-DS	2026-02-26 03:45:00	4.15	58.20	0.54	7.38	11.66	7.22	0.03
SQU-DS	2026-02-26 04:00:00	4.16	59.13	0.54	7.38	11.61	7.04	0.03
SQU-DS	2026-02-26 04:15:00	4.15	58.82	0.54	7.37	11.59	7.18	0.03
SQU-DS	2026-02-26 04:30:00	4.16	59.42	0.54	7.38	11.57	6.46	0.03
SQU-DS	2026-02-26 04:45:00	4.18	60.42	0.54	7.40	11.56	6.55	0.03
SQU-DS	2026-02-26 05:00:00	4.19	61.53	0.54	7.37	11.54	6.80	0.03
SQU-DS	2026-02-26 05:15:00	4.18	60.44	0.54	7.37	11.54	7.58	0.03
SQU-DS	2026-02-26 05:30:00	4.20	61.16	0.54	7.39	11.45	6.79	0.03
SQU-DS	2026-02-26 05:45:00	4.21	62.19	0.54	7.40	11.35	7.36	0.03
SQU-DS	2026-02-26 06:00:00	4.19	61.08	0.54	7.41	11.33	7.36	0.03
SQU-DS	2026-02-26 06:15:00	4.20	61.47	0.54	7.41	11.29	6.98	0.03
SQU-DS	2026-02-26 06:30:00	4.20	60.96	0.54	7.40	11.34	8.37	0.03
SQU-DS	2026-02-26 06:45:00	4.20	62.21	0.54	7.40	11.26	7.71	0.03
SQU-DS	2026-02-26 07:00:00	4.17	60.14	0.54	7.41	11.19	8.23	0.03
SQU-DS	2026-02-26 07:15:00	4.17	61.04	0.54	7.40	11.27	20.29	0.03
SQU-DS	2026-02-26 07:30:00	4.17	60.07	0.55	7.36	11.37	14.51	0.03
SQU-DS	2026-02-26 07:45:00	4.17	60.03	0.55	7.39	11.36	15.26	0.03
SQU-DS	2026-02-26 08:00:00	4.16	59.62	0.55	7.39	11.38	15.11	0.03
SQU-DS	2026-02-26 08:15:00	4.17	59.30	0.55	7.40	11.36	16.92	0.03
SQU-DS	2026-02-26 08:30:00	4.17	59.06	0.55	7.39	11.37	16.47	0.03
SQU-DS	2026-02-26 08:45:00	4.18	59.19	0.55	7.39	11.37	16.45	0.03
SQU-DS	2026-02-26 09:00:00	4.18	58.92	0.55	7.37	11.47	16.23	0.03
SQU-DS	2026-02-26 09:15:00	4.18	58.74	0.55	7.39	11.38	16.20	0.03
SQU-DS	2026-02-26 09:30:00	4.19	58.54	0.55	7.38	11.41	15.97	0.03
SQU-DS	2026-02-26 09:45:00	4.20	58.35	0.55	7.41	11.42	16.42	0.03
SQU-DS	2026-02-26 10:00:00	4.22	58.07	0.55	7.40	11.45	16.22	0.03
SQU-DS	2026-02-26 10:15:00	4.24	58.10	0.55	7.41	11.47	15.59	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-26 10:30:00	4.27	58.24	0.55	7.40	11.49	16.57	0.03
SQU-DS	2026-02-26 10:45:00	4.30	58.07	0.55	7.41	11.49	16.34	0.03
SQU-DS	2026-02-26 11:00:00	4.33	57.91	0.55	7.41	11.53	15.05	0.03
SQU-DS	2026-02-26 11:15:00	4.37	58.13	0.55	7.38	11.55	18.25	0.03
SQU-DS	2026-02-26 11:30:00	4.42	58.81	0.55	7.40	11.60	15.72	0.03
SQU-DS	2026-02-26 11:45:00	4.45	59.26	0.55	7.39	11.60	15.37	0.03
SQU-DS	2026-02-26 12:00:00	4.47	59.35	0.55	7.42	11.54	15.09	0.03
SQU-DS	2026-02-26 12:15:00	4.50	59.14	0.54	7.42	11.61	15.50	0.03
SQU-DS	2026-02-26 12:30:00	4.54	59.32	0.54	7.42	11.57	15.70	0.03
SQU-DS	2026-02-26 12:45:00	4.59	59.94	0.54	7.42	11.55	15.72	0.03
SQU-DS	2026-02-26 13:00:00	4.64	60.33	0.55	7.40	11.50	15.98	0.03
SQU-DS	2026-02-26 13:15:00	4.66	65.52	0.54	7.41	11.51	13.76	0.03
SQU-DS	2026-02-26 13:30:00	4.68	57.85	0.54	7.42	11.51	5.98	0.03
SQU-DS	2026-02-26 13:45:00	4.70	58.22	0.54	7.41	11.53	5.89	0.03
SQU-DS	2026-02-26 14:00:00	4.71	58.28	0.54	7.42	11.51	6.15	0.03
SQU-DS	2026-02-26 14:15:00	4.72	57.95	0.55	7.38	11.47	7.23	0.03
SQU-DS	2026-02-26 14:30:00	4.73	57.33	0.55	7.39	11.46	7.48	0.03
SQU-DS	2026-02-26 14:45:00	4.77	57.39	0.55	7.39	11.38	6.73	0.03
SQU-DS	2026-02-26 15:00:00	4.77	57.82	0.55	7.37	11.42	9.40	0.03
SQU-DS	2026-02-26 15:15:00	4.78	57.56	0.55	7.36	11.43	9.24	0.03
SQU-DS	2026-02-26 15:30:00	5.21	60.07	0.55	7.28	11.19	8.66	0.03
SQU-DS	2026-02-26 15:45:00	4.96	59.50	0.55	7.21	11.21	11.33	0.03
SQU-DS	2026-02-26 16:00:00	5.12	59.99	0.55	7.15	10.42	6.01	0.03
SQU-DS	2026-02-26 16:15:00	4.81	58.05	0.56	7.13	11.40	7.54	0.03
SQU-DS	2026-02-26 16:30:00	4.91	58.52	0.56	7.12	11.29	5.56	0.03
SQU-DS	2026-02-26 16:45:00	4.99	59.17	0.56	7.12	11.15	5.51	0.03
SQU-DS	2026-02-26 17:00:00	5.09	60.15	0.56	7.12	11.08	6.31	0.03
SQU-DS	2026-02-26 17:15:00	5.19	60.60	0.56	7.19	10.82	12.94	0.03
SQU-DS	2026-02-26 17:30:00	4.99	59.81	0.56	7.25	11.27	8.81	0.03
SQU-DS	2026-02-26 17:45:00	5.02	59.03	0.56	7.29	10.93	6.81	0.03
SQU-DS	2026-02-26 18:00:00	5.23	61.22	0.55	7.35	10.64	7.85	0.03
SQU-DS	2026-02-26 18:15:00	4.82	58.32	0.55	7.39	11.52	5.61	0.03
SQU-DS	2026-02-26 18:30:00	5.16	60.48	0.55	7.39	10.91	5.02	0.03
SQU-DS	2026-02-26 18:45:00	4.97	59.61	0.55	7.42	11.33	5.25	0.03
SQU-DS	2026-02-26 19:00:00	4.87	58.56	0.55	7.45	11.40	3.23	0.03
SQU-DS	2026-02-26 19:15:00	4.91	59.24	0.54	7.46	11.39	5.46	0.03
SQU-DS	2026-02-26 19:30:00	4.75	57.67	0.54	7.48	11.48	4.32	0.03
SQU-DS	2026-02-26 19:45:00	4.73	57.65	0.54	7.48	11.50	5.42	0.03
SQU-DS	2026-02-26 20:00:00	4.71	57.61	0.54	7.49	11.51	6.22	0.03
SQU-DS	2026-02-26 20:15:00	4.80	57.76	0.54	7.49	11.22	5.71	0.03
SQU-DS	2026-02-26 20:30:00	4.76	58.04	0.54	7.49	11.48	4.80	0.03
SQU-DS	2026-02-26 20:45:00	4.92	59.40	0.54	7.50	11.29	8.57	0.03
SQU-DS	2026-02-26 21:00:00	4.86	59.44	0.54	7.50	11.36	5.49	0.03
SQU-DS	2026-02-26 21:15:00	4.73	58.17	0.54	7.48	11.46	9.08	0.03
SQU-DS	2026-02-26 21:30:00	4.91	59.61	0.54	7.45	11.27	3.09	0.03
SQU-DS	2026-02-26 21:45:00	4.77	57.98	0.54	7.47	11.34	3.22	0.03
SQU-DS	2026-02-26 22:00:00	4.82	58.54	0.54	7.47	11.33	4.86	0.03
SQU-DS	2026-02-26 22:15:00	5.28	61.97	0.54	7.45	10.62	3.85	0.03
SQU-DS	2026-02-26 22:30:00	4.95	59.05	0.54	7.44	10.99	3.56	0.03
SQU-DS	2026-02-26 22:45:00	4.79	57.83	0.54	7.43	11.34	5.54	0.03
SQU-DS	2026-02-26 23:00:00	4.72	57.58	0.54	7.45	11.45	4.69	0.03
SQU-DS	2026-02-26 23:15:00	4.81	58.12	0.55	7.41	11.36	8.13	0.03
SQU-DS	2026-02-26 23:30:00	4.74	57.22	0.55	7.37	11.36	3.44	0.03
SQU-DS	2026-02-26 23:45:00	4.74	57.20	0.55	7.36	11.39	3.62	0.03
SQU-DS	2026-02-27 00:00:00	4.70	56.80	0.55	7.33	11.34	3.09	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-27 00:15:00	4.72	56.63	0.54	7.36	11.22	3.52	0.03
SQU-DS	2026-02-27 00:30:00	4.67	56.03	0.55	7.34	11.27	3.49	0.02
SQU-DS	2026-02-27 00:45:00	4.68	55.69	0.55	7.37	11.27	3.76	0.02
SQU-DS	2026-02-27 01:00:00	4.65	54.71	0.55	7.34	11.39	3.26	0.02
SQU-DS	2026-02-27 01:15:00	4.64	53.87	0.55	7.38	11.41	3.92	0.02
SQU-DS	2026-02-27 01:30:00	4.62	53.28	0.55	7.37	11.47	3.54	0.02
SQU-DS	2026-02-27 01:45:00	4.61	52.84	0.55	7.36	11.51	3.87	0.02
SQU-DS	2026-02-27 02:00:00	4.59	52.40	0.55	7.33	11.60	3.72	0.02
SQU-DS	2026-02-27 02:15:00	4.59	52.26	0.55	7.34	11.61	3.84	0.02
SQU-DS	2026-02-27 02:30:00	4.58	51.89	0.55	7.39	11.62	3.74	0.02
SQU-DS	2026-02-27 02:45:00	4.56	51.45	0.54	7.41	11.58	4.46	0.02
SQU-DS	2026-02-27 03:00:00	4.55	51.15	0.54	7.43	11.54	4.24	0.02
SQU-DS	2026-02-27 03:15:00	4.55	51.17	0.54	7.42	11.49	4.14	0.02
SQU-DS	2026-02-27 03:30:00	4.53	50.88	0.55	7.39	11.51	4.53	0.02
SQU-DS	2026-02-27 03:45:00	4.52	50.67	0.55	7.42	11.51	4.98	0.02
SQU-DS	2026-02-27 04:00:00	4.51	50.57	0.55	7.42	11.51	4.97	0.02
SQU-DS	2026-02-27 04:15:00	4.51	50.86	0.55	7.42	11.50	5.03	0.02
SQU-DS	2026-02-27 04:30:00	4.52	51.56	0.55	7.38	11.57	5.28	0.02
SQU-DS	2026-02-27 04:45:00	4.52	52.70	0.55	7.38	11.61	6.26	0.02
SQU-DS	2026-02-27 05:00:00	4.53	53.42	0.55	7.43	11.52	6.27	0.02
SQU-DS	2026-02-27 05:15:00	4.54	54.61	0.55	7.41	11.41	7.14	0.02
SQU-DS	2026-02-27 05:30:00	4.54	56.95	0.55	7.42	11.29	6.64	0.03
SQU-DS	2026-02-27 05:45:00	4.51	53.59	0.55	7.39	11.36	6.86	0.02
SQU-DS	2026-02-27 06:00:00	4.52	54.34	0.55	7.35	11.49	6.32	0.02
SQU-DS	2026-02-27 06:15:00	4.53	55.63	0.55	7.41	11.39	6.58	0.02
SQU-DS	2026-02-27 06:30:00	4.52	54.59	0.55	7.37	11.34	6.64	0.02
SQU-DS	2026-02-27 06:45:00	4.49	53.34	0.55	7.37	11.41	9.06	0.02
SQU-DS	2026-02-27 07:00:00	4.50	53.56	0.55	7.39	11.43	8.85	0.02
SQU-DS	2026-02-27 07:15:00	4.49	53.07	0.55	7.39	11.46	8.73	0.02
SQU-DS	2026-02-27 07:30:00	4.48	52.99	0.55	7.39	11.46	8.84	0.02
SQU-DS	2026-02-27 07:45:00	4.48	52.44	0.55	7.35	11.49	8.94	0.02
SQU-DS	2026-02-27 08:00:00	4.48	52.79	0.55	7.37	11.50	9.54	0.02
SQU-DS	2026-02-27 08:15:00	4.49	52.99	0.55	7.38	11.48	9.03	0.02
SQU-DS	2026-02-27 08:30:00	4.49	53.12	0.55	7.38	11.47	9.07	0.02
SQU-DS	2026-02-27 08:45:00	4.49	53.16	0.55	7.38	11.52	8.89	0.02
SQU-DS	2026-02-27 09:00:00	4.51	53.68	0.55	7.32	11.45	8.89	0.02
SQU-DS	2026-02-27 09:15:00	4.53	53.92	0.55	7.37	11.48	9.05	0.02
SQU-DS	2026-02-27 09:30:00	4.55	53.99	0.55	7.36	11.51	9.20	0.02
SQU-DS	2026-02-27 09:45:00	4.57	54.02	0.55	7.35	11.52	9.48	0.02
SQU-DS	2026-02-27 10:00:00	4.59	53.98	0.55	7.39	11.50	9.34	0.02
SQU-DS	2026-02-27 10:15:00	4.62	54.02	0.55	7.39	11.50	9.31	0.02
SQU-DS	2026-02-27 10:30:00	4.65	54.00	0.55	7.38	11.55	9.07	0.02
SQU-DS	2026-02-27 10:45:00	4.69	53.95	0.55	7.36	11.55	9.38	0.02
SQU-DS	2026-02-27 11:00:00	4.73	54.07	0.55	7.38	11.54	9.32	0.02
SQU-DS	2026-02-27 11:15:00	4.76	53.65	0.55	7.35	11.53	9.25	0.02
SQU-DS	2026-02-27 11:30:00	4.79	53.35	0.55	7.38	11.59	9.22	0.02
SQU-DS	2026-02-27 11:45:00	4.85	53.87	0.55	7.41	11.57	9.23	0.02
SQU-DS	2026-02-27 12:00:00	4.90	54.34	0.55	7.41	11.56	9.65	0.02
SQU-DS	2026-02-27 12:15:00	4.95	54.10	0.55	7.40	11.52	9.77	0.02
SQU-DS	2026-02-27 12:30:00	5.03	53.14	0.55	7.36	11.58	10.06	0.02
SQU-DS	2026-02-27 12:45:00	5.09	53.05	0.55	7.40	11.56	9.64	0.02
SQU-DS	2026-02-27 13:00:00	5.16	54.32	0.55	7.38	11.57	9.56	0.02
SQU-DS	2026-02-27 13:15:00	5.18	54.02	0.55	7.36	11.59	9.89	0.02
SQU-DS	2026-02-27 13:30:00	5.20	54.10	0.55	7.38	11.58	12.19	0.02
SQU-DS	2026-02-27 13:45:00	5.21	53.36	0.55	7.39	11.53	9.38	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-27 14:00:00	5.26	54.30	0.55	7.41	11.56	9.20	0.02
SQU-DS	2026-02-27 14:15:00	5.29	55.52	0.55	7.40	11.54	9.56	0.02
SQU-DS	2026-02-27 14:30:00	5.29	55.20	0.55	7.38	11.50	9.81	0.02
SQU-DS	2026-02-27 14:45:00	5.29	54.72	0.55	7.41	11.51	10.10	0.02
SQU-DS	2026-02-27 15:00:00	5.29	54.93	0.55	7.41	11.51	9.64	0.02
SQU-DS	2026-02-27 15:15:00	5.29	55.20	0.55	7.40	11.46	10.22	0.02
SQU-DS	2026-02-27 15:30:00	5.27	54.82	0.55	7.39	11.47	9.65	0.02
SQU-DS	2026-02-27 15:45:00	5.25	54.40	0.55	7.36	11.47	9.97	0.02
SQU-DS	2026-02-27 16:00:00	5.26	54.37	0.55	7.38	11.39	11.20	0.02
SQU-DS	2026-02-27 16:15:00	5.22	53.90	0.55	7.37	11.48	10.17	0.02
SQU-DS	2026-02-27 16:30:00	5.22	53.93	0.55	7.35	11.31	10.74	0.02
SQU-DS	2026-02-27 16:45:00	5.18	53.48	0.55	7.33	11.16	11.03	0.02
SQU-DS	2026-02-27 17:00:00	5.15	53.39	0.55	7.33	11.48	11.78	0.02
SQU-DS	2026-02-27 17:15:00	5.15	53.58	0.55	7.34	11.43	18.86	0.02
SQU-DS	2026-02-27 17:30:00	5.11	53.38	0.55	7.33	11.42	13.81	0.02
SQU-DS	2026-02-27 17:45:00	5.09	53.23	0.55	7.34	11.45	10.59	0.02
SQU-DS	2026-02-27 18:00:00	5.07	53.16	0.55	7.32	11.44	14.48	0.02
SQU-DS	2026-02-27 18:15:00	5.05	53.18	0.55	7.34	11.42	11.11	0.02
SQU-DS	2026-02-27 18:30:00	5.03	53.12	0.55	7.34	11.42	11.30	0.02
SQU-DS	2026-02-27 18:45:00	5.01	53.22	0.55	7.35	11.40	11.48	0.02
SQU-DS	2026-02-27 19:00:00	4.99	53.10	0.55	7.34	11.42	11.09	0.02
SQU-DS	2026-02-27 19:15:00	4.96	53.25	0.55	7.33	11.44	11.38	0.02
SQU-DS	2026-02-27 19:30:00	4.96	53.70	0.55	7.30	11.41	11.61	0.02
SQU-DS	2026-02-27 19:45:00	4.94	53.55	0.55	7.31	11.36	16.87	0.02
SQU-DS	2026-02-27 20:00:00	4.94	53.80	0.55	7.31	11.36	11.69	0.02
SQU-DS	2026-02-27 20:15:00	4.91	53.97	0.55	7.30	11.40	12.26	0.02
SQU-DS	2026-02-27 20:30:00	4.90	54.13	0.55	7.29	11.35	13.86	0.02
SQU-DS	2026-02-27 20:45:00	4.88	54.33	0.55	7.32	11.30	10.13	0.02
SQU-DS	2026-02-27 21:00:00	4.88	54.76	0.55	7.29	11.33	10.48	0.02
SQU-DS	2026-02-27 21:15:00	4.86	54.99	0.55	7.29	11.21	12.03	0.02
SQU-DS	2026-02-27 21:30:00	4.84	55.16	0.55	7.27	11.41	10.69	0.02
SQU-DS	2026-02-27 21:45:00	4.91	56.16	0.55	7.28	11.27	11.36	0.02
SQU-DS	2026-02-27 22:00:00	4.89	55.82	0.55	7.25	11.16	10.94	0.02
SQU-DS	2026-02-27 22:15:00	4.80	55.58	0.55	7.27	11.40	10.71	0.02
SQU-DS	2026-02-27 22:30:00	4.84	56.27	0.55	7.26	11.32	13.40	0.02
SQU-DS	2026-02-27 22:45:00	4.78	56.25	0.55	7.27	11.40	13.90	0.02
SQU-DS	2026-02-27 23:00:00	4.79	56.46	0.55	7.28	11.37	11.56	0.03
SQU-DS	2026-02-27 23:15:00	4.74	56.18	0.55	7.25	11.43	11.42	0.02
SQU-DS	2026-02-27 23:30:00	4.73	56.31	0.55	7.28	11.39	11.30	0.02
SQU-DS	2026-02-27 23:45:00	4.76	56.98	0.55	7.25	11.33	51.84	0.03
SQU-DS	2026-02-28 00:00:00	4.72	56.64	0.55	7.25	11.40	13.29	0.03
SQU-DS	2026-02-28 00:15:00	4.71	56.67	0.55	7.23	11.32	11.76	0.03
SQU-DS	2026-02-28 00:30:00	4.70	56.91	0.55	7.23	11.32	12.78	0.03
SQU-DS	2026-02-28 00:45:00	4.66	56.42	0.55	7.23	11.36	12.73	0.03
SQU-DS	2026-02-28 01:00:00	4.63	56.42	0.55	7.21	11.40	11.65	0.03
SQU-DS	2026-02-28 01:15:00	4.66	56.63	0.55	7.26	11.08	11.11	0.03
SQU-DS	2026-02-28 01:30:00	4.60	56.23	0.55	7.29	10.98	10.58	0.02
SQU-DS	2026-02-28 01:45:00	4.57	55.85	0.55	7.31	10.83	10.53	0.02
SQU-DS	2026-02-28 02:00:00	4.55	55.26	0.55	7.31	11.03	10.55	0.02
SQU-DS	2026-02-28 02:15:00	4.53	54.76	0.55	7.34	11.01	11.36	0.02
SQU-DS	2026-02-28 02:30:00	4.53	54.45	0.55	7.36	10.79	10.61	0.02
SQU-DS	2026-02-28 02:45:00	4.51	54.16	0.55	7.37	10.78	10.51	0.02
SQU-DS	2026-02-28 03:00:00	4.51	54.01	0.55	7.36	10.83	10.47	0.02
SQU-DS	2026-02-28 03:15:00	4.50	53.79	0.55	7.37	10.80	10.86	0.02
SQU-DS	2026-02-28 03:30:00	4.50	53.59	0.55	7.38	10.72	11.07	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-28 03:45:00	4.50	53.34	0.55	7.38	10.76	11.48	0.02
SQU-DS	2026-02-28 04:00:00	4.49	52.99	0.55	7.38	10.92	19.07	0.02
SQU-DS	2026-02-28 04:15:00	4.49	52.83	0.55	7.38	11.04	21.18	0.02
SQU-DS	2026-02-28 04:30:00	4.48	52.55	0.55	7.40	11.15	22.19	0.02
SQU-DS	2026-02-28 04:45:00	4.48	52.37	0.55	7.39	11.26	21.83	0.02
SQU-DS	2026-02-28 05:00:00	4.47	52.34	0.55	7.41	11.27	21.67	0.02
SQU-DS	2026-02-28 05:15:00	4.48	52.72	0.55	7.41	11.32	22.26	0.02
SQU-DS	2026-02-28 05:30:00	4.50	53.75	0.55	7.40	11.30	22.36	0.02
SQU-DS	2026-02-28 05:45:00	4.50	54.60	0.55	7.40	11.31	16.10	0.02
SQU-DS	2026-02-28 06:00:00	4.52	55.85	0.55	7.39	11.22	16.19	0.02
SQU-DS	2026-02-28 06:15:00	4.52	56.91	0.55	7.39	11.16	15.74	0.03
SQU-DS	2026-02-28 06:30:00	4.52	57.26	0.55	7.38	11.08	16.48	0.03
SQU-DS	2026-02-28 06:45:00	4.49	56.27	0.55	7.38	11.03	15.19	0.02
SQU-DS	2026-02-28 07:00:00	4.49	56.86	0.55	7.38	10.97	29.15	0.03
SQU-DS	2026-02-28 07:15:00	4.48	57.34	0.55	7.38	10.94	14.60	0.03
SQU-DS	2026-02-28 07:30:00	4.47	57.16	0.55	7.36	11.11	14.98	0.03
SQU-DS	2026-02-28 07:45:00	4.45	56.24	0.55	7.35	11.27	17.86	0.02
SQU-DS	2026-02-28 08:00:00	4.44	56.03	0.55	7.35	11.23	18.30	0.02
SQU-DS	2026-02-28 08:15:00	4.42	55.56	0.55	7.36	11.32	17.29	0.02
SQU-DS	2026-02-28 08:30:00	4.41	55.37	0.55	7.32	11.34	18.09	0.02
SQU-DS	2026-02-28 08:45:00	4.41	55.33	0.55	7.34	11.40	17.78	0.02
SQU-DS	2026-02-28 09:00:00	4.40	55.18	0.55	7.37	11.39	17.62	0.02
SQU-DS	2026-02-28 09:15:00	4.39	55.60	0.55	7.36	11.40	17.72	0.02
SQU-DS	2026-02-28 09:30:00	4.40	55.90	0.55	7.33	11.40	19.02	0.02
SQU-DS	2026-02-28 09:45:00	4.42	55.82	0.55	7.36	11.44	17.99	0.02
SQU-DS	2026-02-28 10:00:00	4.47	55.95	0.55	7.34	11.35	18.61	0.02
SQU-DS	2026-02-28 10:15:00	4.52	55.91	0.55	7.36	11.37	18.53	0.02
SQU-DS	2026-02-28 10:30:00	4.58	55.99	0.55	7.36	11.41	18.74	0.02
SQU-DS	2026-02-28 10:45:00	4.64	56.20	0.55	7.35	11.42	18.28	0.02
SQU-DS	2026-02-28 11:00:00	4.71	56.42	0.55	7.36	11.46	18.30	0.03
SQU-DS	2026-02-28 11:15:00	4.78	56.67	0.55	7.36	11.48	21.01	0.03
SQU-DS	2026-02-28 11:30:00	4.84	56.59	0.55	7.38	11.43	18.60	0.03
SQU-DS	2026-02-28 11:45:00	4.90	56.45	0.55	7.33	11.43	19.91	0.03
SQU-DS	2026-02-28 12:00:00	4.98	56.27	0.55	7.37	11.49	31.77	0.02
SQU-DS	2026-02-28 12:15:00	5.03	56.19	0.55	7.36	11.46	22.75	0.02
SQU-DS	2026-02-28 12:30:00	5.09	56.00	0.55	7.37	11.46	20.53	0.02
SQU-DS	2026-02-28 12:45:00	5.15	56.28	0.55	7.35	11.44	20.11	0.03
SQU-DS	2026-02-28 13:00:00	5.21	56.31	0.55	7.37	11.44	20.51	0.03
SQU-DS	2026-02-28 13:15:00	5.25	55.93	0.55	7.39	11.33	19.99	0.02
SQU-DS	2026-02-28 13:30:00	5.30	55.46	0.55	7.36	11.40	20.34	0.02
SQU-DS	2026-02-28 13:45:00	5.35	55.82	0.55	7.40	11.39	20.18	0.02
SQU-DS	2026-02-28 14:00:00	5.40	56.55	0.55	7.40	11.37	20.69	0.03
SQU-DS	2026-02-28 14:15:00	5.43	56.88	0.55	7.39	11.40	19.60	0.03
SQU-DS	2026-02-28 14:30:00	5.44	56.30	0.55	7.40	11.37	20.84	0.03
SQU-DS	2026-02-28 14:45:00	5.47	56.75	0.55	7.36	11.38	20.47	0.03
SQU-DS	2026-02-28 15:00:00	5.49	57.43	0.55	7.39	11.40	20.48	0.03
SQU-DS	2026-02-28 15:15:00	5.50	58.22	0.55	7.37	11.38	20.04	0.03
SQU-DS	2026-02-28 15:30:00	5.51	58.60	0.55	7.39	11.35	20.33	0.03
SQU-DS	2026-02-28 15:45:00	5.50	58.86	0.55	7.41	11.30	21.20	0.03
SQU-DS	2026-02-28 16:00:00	5.47	58.83	0.55	7.37	11.33	20.39	0.03
SQU-DS	2026-02-28 16:15:00	5.44	58.84	0.55	7.39	11.28	20.64	0.03
SQU-DS	2026-02-28 16:30:00	5.40	58.81	0.55	7.35	11.26	20.74	0.03
SQU-DS	2026-02-28 16:45:00	5.35	58.78	0.55	7.37	11.22	20.69	0.03
SQU-DS	2026-02-28 17:00:00	5.29	58.58	0.55	7.33	11.17	20.62	0.03
SQU-DS	2026-02-28 17:15:00	5.24	59.49	0.55	7.29	11.22	21.82	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-02-28 17:30:00	5.72	64.52	0.55	7.30	10.25	440.97	0.03
SQU-DS	2026-02-28 17:45:00	6.79	48.05	0.56	7.35	11.00	3.94	0.02
SQU-DS	2026-02-28 18:00:00	6.78	0.10	0.56	7.30	11.18	3.33	0.00
SQU-DS	2026-02-28 18:15:00	6.86	0.08	0.56	7.27	11.17	3.28	0.00
SQU-DS	2026-02-28 18:30:00	6.55	0.08	0.56	7.25	11.29	2.77	0.00
SQU-DS	2026-02-28 18:45:00	6.39	0.09	0.56	7.24	11.36	2.72	0.00
SQU-DS	2026-02-28 19:00:00	6.26	0.09	0.56	7.23	11.40	2.71	0.00
SQU-DS	2026-02-28 19:15:00	6.16	0.09	0.56	7.22	11.43	2.65	0.00
SQU-DS	2026-02-28 19:30:00	6.00	0.09	0.56	7.21	11.49	2.62	0.00
SQU-DS	2026-02-28 19:45:00	5.84	0.09	0.56	7.20	11.53	2.56	0.00
SQU-DS	2026-02-28 20:00:00	5.68	0.09	0.56	7.19	11.59	2.56	0.00
SQU-DS	2026-02-28 20:15:00	5.58	0.09	0.56	7.18	11.63	2.54	0.00
SQU-DS	2026-02-28 20:30:00	5.50	0.09	0.56	7.18	11.65	2.54	0.00
SQU-DS	2026-02-28 20:45:00	5.41	0.09	0.56	7.17	11.69	2.52	0.00
SQU-DS	2026-02-28 21:00:00	5.33	0.09	0.56	7.16	11.70	2.49	0.00
SQU-DS	2026-02-28 21:15:00	5.25	0.09	0.56	7.15	11.73	2.47	0.00
SQU-DS	2026-02-28 21:30:00	5.09	0.09	0.56	7.14	11.78	2.47	0.00
SQU-DS	2026-02-28 21:45:00	4.99	0.09	0.56	7.13	11.81	2.43	0.00
SQU-DS	2026-02-28 22:00:00	4.85	0.09	0.56	7.12	11.86	2.48	0.00
SQU-DS	2026-02-28 22:15:00	4.80	0.09	0.56	7.11	11.88	2.44	0.00
SQU-DS	2026-02-28 22:30:00	4.65	0.09	0.56	7.10	11.92	2.39	0.00
SQU-DS	2026-02-28 22:45:00	4.58	0.09	0.56	7.09	11.95	2.45	0.00
SQU-DS	2026-02-28 23:00:00	4.45	0.09	0.56	7.08	11.99	2.41	0.00
SQU-DS	2026-02-28 23:15:00	4.37	0.09	0.56	7.07	12.00	2.36	0.00
SQU-DS	2026-02-28 23:30:00	4.34	0.09	0.56	7.06	12.03	2.37	0.00
SQU-DS	2026-02-28 23:45:00	4.27	0.09	0.56	7.05	12.05	2.32	0.00
SQU-DS	2026-03-01 00:00:00	4.16	0.09	0.56	7.04	12.08	2.28	0.00
SQU-DS	2026-03-01 00:15:00	4.09	0.09	0.56	7.03	12.10	2.41	0.00
SQU-DS	2026-03-01 00:30:00	4.01	0.09	0.56	7.02	12.13	2.32	0.00
SQU-DS	2026-03-01 00:45:00	3.93	0.09	0.56	7.01	12.16	2.37	0.00
SQU-DS	2026-03-01 01:00:00	3.89	0.09	0.56	7.00	12.16	2.34	0.00
SQU-DS	2026-03-01 01:15:00	3.78	0.09	0.56	6.99	12.21	2.28	0.00
SQU-DS	2026-03-01 01:30:00	3.71	0.09	0.56	6.98	12.24	2.42	0.00
SQU-DS	2026-03-01 01:45:00	3.60	0.09	0.56	6.97	12.27	2.32	0.00
SQU-DS	2026-03-01 02:00:00	3.53	0.09	0.56	6.97	12.28	2.27	0.00
SQU-DS	2026-03-01 02:15:00	4.50	62.90	0.54	7.32	11.16	3.21	0.03
SQU-DS	2026-03-01 02:30:00	4.42	61.71	0.54	7.32	11.25	3.07	0.03
SQU-DS	2026-03-01 02:45:00	4.40	61.03	0.54	7.32	11.28	3.12	0.03
SQU-DS	2026-03-01 03:00:00	4.37	60.45	0.54	7.33	11.30	3.01	0.03
SQU-DS	2026-03-01 03:15:00	4.33	59.97	0.54	7.34	11.29	2.92	0.03
SQU-DS	2026-03-01 03:30:00	4.32	59.81	0.54	7.34	11.26	3.24	0.03
SQU-DS	2026-03-01 03:45:00	4.28	59.67	0.55	7.34	11.22	3.37	0.03
SQU-DS	2026-03-01 04:00:00	4.24	59.31	0.54	7.35	11.22	3.35	0.03
SQU-DS	2026-03-01 04:15:00	4.20	59.05	0.55	7.36	11.22	3.67	0.03
SQU-DS	2026-03-01 04:30:00	4.16	58.67	0.55	7.36	11.28	4.19	0.03
SQU-DS	2026-03-01 04:45:00	4.13	58.35	0.55	7.37	11.30	3.66	0.03
SQU-DS	2026-03-01 05:00:00	4.10	58.00	0.55	7.37	11.34	3.79	0.03
SQU-DS	2026-03-01 05:15:00	4.05	57.56	0.55	7.38	11.37	3.83	0.03
SQU-DS	2026-03-01 05:30:00	4.00	57.32	0.55	7.38	11.39	4.02	0.03
SQU-DS	2026-03-01 05:45:00	3.96	57.16	0.55	7.38	11.44	4.35	0.03
SQU-DS	2026-03-01 06:00:00	3.93	57.48	0.55	7.38	11.46	4.47	0.03
SQU-DS	2026-03-01 06:15:00	3.91	58.25	0.55	7.38	11.47	4.50	0.03
SQU-DS	2026-03-01 06:30:00	3.92	59.70	0.55	7.38	11.41	4.68	0.03
SQU-DS	2026-03-01 06:45:00	3.91	60.39	0.55	7.38	11.36	4.74	0.03
SQU-DS	2026-03-01 07:00:00	3.91	61.19	0.55	7.38	11.29	5.20	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-01 07:15:00	3.91	61.50	0.55	7.37	11.26	5.02	0.03
SQU-DS	2026-03-01 07:30:00	3.90	62.07	0.55	7.36	11.29	5.00	0.03
SQU-DS	2026-03-01 07:45:00	3.90	62.38	0.55	7.35	11.31	5.10	0.03
SQU-DS	2026-03-01 08:00:00	3.92	63.02	0.55	7.34	11.36	7.53	0.03
SQU-DS	2026-03-01 08:15:00	3.92	63.02	0.55	7.35	11.31	4.23	0.03
SQU-DS	2026-03-01 08:30:00	3.93	62.14	0.55	7.36	11.28	4.06	0.03
SQU-DS	2026-03-01 08:45:00	3.95	61.62	0.55	7.35	11.29	4.38	0.03
SQU-DS	2026-03-01 09:00:00	3.99	61.77	0.55	7.32	11.33	3.16	0.03
SQU-DS	2026-03-01 09:15:00	4.05	62.11	0.55	7.31	11.30	3.06	0.03
SQU-DS	2026-03-01 09:30:00	4.09	62.07	0.55	7.32	11.37	3.20	0.03
SQU-DS	2026-03-01 09:45:00	4.23	62.45	0.55	7.29	11.24	8.80	0.03
SQU-DS	2026-03-01 10:00:00	4.76	10.02	0.55	7.28	11.69	1.65	0.00
SQU-DS	2026-03-01 10:15:00	4.70	0.09	0.55	7.22	11.88	0.60	0.00
SQU-DS	2026-03-01 10:30:00	4.72	0.09	0.55	7.19	11.91	0.49	0.00
SQU-DS	2026-03-01 10:45:00	4.78	0.09	0.55	7.17	11.90	0.49	0.00
SQU-DS	2026-03-01 11:00:00	4.78	0.09	0.55	7.16	11.92	0.51	0.00
SQU-DS	2026-03-01 11:15:00	4.93	0.09	0.55	7.15	11.86	0.46	0.00
SQU-DS	2026-03-01 11:30:00	5.10	0.09	0.55	7.15	11.80	0.47	0.00
SQU-DS	2026-03-01 11:45:00	4.87	2.96	0.55	7.14	11.93	1.16	0.00
SQU-DS	2026-03-01 12:00:00	4.85	62.86	0.55	7.29	11.52	1.98	0.03
SQU-DS	2026-03-01 12:15:00	4.92	62.60	0.54	7.32	11.41	1.08	0.03
SQU-DS	2026-03-01 12:30:00	5.01	62.74	0.54	7.32	11.37	1.21	0.03
SQU-DS	2026-03-01 12:45:00	5.07	62.61	0.54	7.33	11.23	1.35	0.03
SQU-DS	2026-03-01 13:00:00	5.15	62.46	0.55	7.32	11.26	1.62	0.03
SQU-DS	2026-03-01 13:15:00	5.19	62.40	0.55	7.32	11.19	1.12	0.03
SQU-DS	2026-03-01 13:30:00	5.26	62.11	0.55	7.33	11.31	1.29	0.03
SQU-DS	2026-03-01 13:45:00	5.31	61.93	0.55	7.34	11.23	1.22	0.03
SQU-DS	2026-03-01 14:00:00	5.37	61.44	0.55	7.34	11.21	1.65	0.03
SQU-DS	2026-03-01 14:15:00	5.41	61.17	0.54	7.36	11.29	1.00	0.03
SQU-DS	2026-03-01 14:30:00	5.44	61.19	0.55	7.35	11.23	1.33	0.03
SQU-DS	2026-03-01 14:45:00	5.47	60.98	0.54	7.36	11.26	1.27	0.03
SQU-DS	2026-03-01 15:00:00	5.50	60.84	0.54	7.37	11.31	1.29	0.03
SQU-DS	2026-03-01 15:15:00	5.51	60.67	0.54	7.37	11.30	1.44	0.03
SQU-DS	2026-03-01 15:30:00	5.53	60.77	0.55	7.37	11.28	0.99	0.03
SQU-DS	2026-03-01 15:45:00	5.54	60.91	0.55	7.37	11.26	1.00	0.03
SQU-DS	2026-03-01 16:00:00	5.52	61.82	0.55	7.37	11.28	1.34	0.03
SQU-DS	2026-03-01 16:15:00	5.48	62.28	0.54	7.39	11.25	1.36	0.03
SQU-DS	2026-03-01 16:30:00	5.44	63.62	0.55	7.38	11.21	1.01	0.03
SQU-DS	2026-03-01 16:45:00	5.39	65.49	0.55	7.37	11.16	1.28	0.03
SQU-DS	2026-03-01 17:00:00	5.32	66.91	0.55	7.35	11.14	1.80	0.03
SQU-DS	2026-03-01 17:15:00	5.29	67.52	0.55	7.36	11.05	1.35	0.03
SQU-DS	2026-03-01 17:30:00	5.18	67.60	0.55	7.35	10.96	1.42	0.03
SQU-DS	2026-03-01 17:45:00	5.10	67.49	0.55	7.30	10.83	3.53	0.03
SQU-DS	2026-03-01 18:00:00	5.03	66.97	0.55	7.29	11.04	6.84	0.03
SQU-DS	2026-03-01 18:15:00	5.23	0.09	0.55	7.31	11.58	0.09	0.00
SQU-DS	2026-03-01 18:30:00	5.16	0.09	0.55	7.27	11.67	0.05	0.00
SQU-DS	2026-03-01 18:45:00	5.08	0.09	0.55	7.26	11.70	0.05	0.00
SQU-DS	2026-03-01 19:00:00	5.00	0.09	0.55	7.25	11.75	0.00	0.00
SQU-DS	2026-03-01 19:15:00	4.95	0.09	0.55	7.24	11.78	0.01	0.00
SQU-DS	2026-03-01 19:30:00	4.83	0.09	0.55	7.24	11.81	0.02	0.00
SQU-DS	2026-03-01 19:45:00	4.72	0.09	0.55	7.23	11.86	0.00	0.00
SQU-DS	2026-03-01 20:00:00	4.66	0.09	0.56	7.22	11.88	0.00	0.00
SQU-DS	2026-03-01 20:15:00	4.57	0.09	0.56	7.21	11.91	0.00	0.00
SQU-DS	2026-03-01 20:30:00	4.47	0.09	0.56	7.21	11.95	0.00	0.00
SQU-DS	2026-03-01 20:45:00	4.38	0.09	0.56	7.20	11.98	0.00	0.00

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-01 21:00:00	4.28	0.09	0.56	7.19	12.01	0.00	0.00
SQU-DS	2026-03-01 21:15:00	4.21	0.09	0.56	7.19	12.03	0.00	0.00
SQU-DS	2026-03-01 21:30:00	4.16	0.09	0.56	7.18	12.06	0.00	0.00
SQU-DS	2026-03-01 21:45:00	4.11	0.09	0.56	7.17	12.08	0.00	0.00
SQU-DS	2026-03-01 22:00:00	4.02	0.09	0.56	7.16	12.09	0.00	0.00
SQU-DS	2026-03-01 22:15:00	3.97	0.09	0.56	7.15	12.13	0.00	0.00
SQU-DS	2026-03-01 22:30:00	3.94	0.09	0.56	7.15	12.15	0.01	0.00
SQU-DS	2026-03-01 22:45:00	3.88	0.09	0.56	7.14	12.16	0.00	0.00
SQU-DS	2026-03-01 23:00:00	3.88	0.09	0.56	7.13	12.17	0.00	0.00
SQU-DS	2026-03-01 23:15:00	3.89	0.09	0.56	7.12	12.15	0.00	0.00
SQU-DS	2026-03-01 23:30:00	3.90	0.09	0.56	7.11	12.16	0.00	0.00
SQU-DS	2026-03-01 23:45:00	3.88	0.09	0.56	7.10	12.16	0.00	0.00
SQU-US	2026-02-23 00:00:00	3.40	69.33	328.36	7.30	12.90	33.73	0.03
SQU-US	2026-02-23 00:15:00	3.40	69.26	328.27	7.30	12.96	22.70	0.03
SQU-US	2026-02-23 00:30:00	3.45	65.24	328.76	7.28	12.91	22.11	0.03
SQU-US	2026-02-23 00:45:00	3.46	66.64	329.21	7.28	12.89	20.98	0.03
SQU-US	2026-02-23 01:00:00	3.38	61.30	330.15	7.30	12.98	20.45	0.03
SQU-US	2026-02-23 01:15:00	3.41	62.30	331.28	7.29	12.94	19.06	0.03
SQU-US	2026-02-23 01:30:00	3.42	69.03	336.90	7.19	12.92	23.14	0.03
SQU-US	2026-02-23 01:45:00	3.42	69.10	333.24	7.27	12.91	18.21	0.03
SQU-US	2026-02-23 02:00:00	3.40	66.22	333.97	7.23	12.92	18.36	0.03
SQU-US	2026-02-23 02:15:00	3.41	65.79	335.93	7.18	12.89	23.31	0.03
SQU-US	2026-02-23 02:30:00	3.38	59.10	337.80	7.16	12.91	18.23	0.03
SQU-US	2026-02-23 02:45:00	3.38	58.62	338.48	7.17	12.90	18.10	0.03
SQU-US	2026-02-23 03:00:00	3.36	57.74	339.72	7.16	12.90	17.76	0.03
SQU-US	2026-02-23 03:15:00	3.37	57.28	341.11	7.15	12.89	19.16	0.03
SQU-US	2026-02-23 03:30:00	3.37	61.22	344.46	7.11	12.88	24.26	0.03
SQU-US	2026-02-23 03:45:00	3.39	60.97	344.57	7.08	12.84	27.03	0.03
SQU-US	2026-02-23 04:00:00	3.37	60.26	346.23	7.07	12.87	23.57	0.03
SQU-US	2026-02-23 04:15:00	3.34	59.74	346.15	7.13	12.91	22.07	0.03
SQU-US	2026-02-23 04:30:00	3.34	54.04	347.57	7.12	12.91	14.02	0.02
SQU-US	2026-02-23 04:45:00	3.33	53.92	347.62	7.15	12.93	13.38	0.02
SQU-US	2026-02-23 05:00:00	3.28	53.60	347.30	7.22	13.00	14.24	0.02
SQU-US	2026-02-23 05:15:00	3.27	53.22	347.17	7.24	13.04	14.11	0.02
SQU-US	2026-02-23 05:30:00	3.28	52.83	349.83	7.18	13.03	14.00	0.02
SQU-US	2026-02-23 05:45:00	3.23	52.09	347.87	7.29	13.10	14.54	0.02
SQU-US	2026-02-23 06:00:00	3.24	52.00	347.86	7.29	13.09	14.05	0.02
SQU-US	2026-02-23 06:15:00	3.22	51.29	347.85	7.31	13.13	15.84	0.02
SQU-US	2026-02-23 06:30:00	3.19	49.99	347.79	7.32	13.17	18.03	0.02
SQU-US	2026-02-23 06:45:00	3.20	50.63	347.23	7.33	13.17	15.54	0.02
SQU-US	2026-02-23 07:00:00	3.21	50.77	347.32	7.33	13.17	14.69	0.02
SQU-US	2026-02-23 07:15:00	3.20	50.14	347.26	7.34	13.19	14.55	0.02
SQU-US	2026-02-23 07:30:00	3.19	54.24	350.03	7.29	13.22	15.43	0.02
SQU-US	2026-02-23 07:45:00	3.20	53.59	347.30	7.35	13.22	13.51	0.02
SQU-US	2026-02-23 08:00:00	3.22	53.87	347.76	7.34	13.22	13.46	0.02
SQU-US	2026-02-23 08:15:00	3.22	53.16	348.04	7.35	13.23	14.03	0.02
SQU-US	2026-02-23 08:30:00	3.21	48.76	348.63	7.32	13.26	14.28	0.02
SQU-US	2026-02-23 08:45:00	3.24	49.47	348.53	7.35	13.27	14.94	0.02
SQU-US	2026-02-23 09:00:00	3.27	50.05	348.73	7.34	13.28	13.59	0.02
SQU-US	2026-02-23 09:15:00	3.31	51.01	349.20	7.34	13.27	15.01	0.02
SQU-US	2026-02-23 09:30:00	3.32	50.72	351.64	7.31	13.29	12.77	0.02
SQU-US	2026-02-23 09:45:00	3.34	50.94	349.56	7.34	13.30	12.80	0.02
SQU-US	2026-02-23 10:00:00	3.37	50.96	349.57	7.35	13.33	12.58	0.02
SQU-US	2026-02-23 10:15:00	3.46	54.16	350.02	7.33	13.27	12.18	0.02
SQU-US	2026-02-23 10:30:00	3.44	51.37	351.52	7.33	13.34	12.72	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-23 10:45:00	3.53	54.23	349.75	7.33	13.31	12.31	0.02
SQU-US	2026-02-23 11:00:00	3.64	57.02	349.49	7.31	13.25	12.69	0.03
SQU-US	2026-02-23 11:15:00	3.70	58.27	348.45	7.29	13.21	12.73	0.03
SQU-US	2026-02-23 11:30:00	3.67	53.61	348.76	7.29	13.27	38.41	0.02
SQU-US	2026-02-23 11:45:00	3.70	53.82	346.35	7.32	13.30	12.70	0.02
SQU-US	2026-02-23 12:00:00	3.73	52.92	345.79	7.33	13.33	12.49	0.02
SQU-US	2026-02-23 12:15:00	3.77	52.89	345.74	7.32	13.31	12.07	0.02
SQU-US	2026-02-23 12:30:00	3.81	50.42	346.31	7.32	13.33	13.23	0.02
SQU-US	2026-02-23 12:45:00	3.90	50.13	345.34	7.32	13.32	15.53	0.02
SQU-US	2026-02-23 13:00:00	3.99	49.89	345.59	7.31	13.28	11.80	0.02
SQU-US	2026-02-23 13:15:00	4.04	49.60	346.17	7.28	13.24	12.23	0.02
SQU-US	2026-02-23 13:30:00	4.14	49.68	349.04	7.22	13.22	14.29	0.02
SQU-US	2026-02-23 13:45:00	4.27	49.94	347.63	7.22	13.16	13.02	0.02
SQU-US	2026-02-23 14:00:00	4.36	50.63	348.14	7.18	13.09	12.11	0.02
SQU-US	2026-02-23 14:15:00	4.44	50.45	348.48	7.18	13.07	12.29	0.02
SQU-US	2026-02-23 14:30:00	4.46	50.50	349.42	7.18	13.04	14.61	0.02
SQU-US	2026-02-23 14:45:00	4.48	50.32	348.90	7.17	13.02	13.44	0.02
SQU-US	2026-02-23 15:00:00	4.50	50.34	348.58	7.17	13.01	12.09	0.02
SQU-US	2026-02-23 15:15:00	4.57	50.26	348.55	7.16	13.00	12.96	0.02
SQU-US	2026-02-23 15:30:00	4.65	50.46	350.54	7.13	12.96	12.77	0.02
SQU-US	2026-02-23 15:45:00	4.74	50.61	348.29	7.19	12.97	12.12	0.02
SQU-US	2026-02-23 16:00:00	4.80	50.83	347.55	7.19	12.98	12.52	0.02
SQU-US	2026-02-23 16:15:00	4.79	50.31	347.29	7.20	12.98	13.16	0.02
SQU-US	2026-02-23 16:30:00	4.73	56.27	348.16	7.20	12.96	13.06	0.02
SQU-US	2026-02-23 16:45:00	4.67	55.71	347.60	7.20	12.94	12.42	0.02
SQU-US	2026-02-23 17:00:00	4.63	56.72	347.73	7.20	12.96	12.43	0.03
SQU-US	2026-02-23 17:15:00	4.56	56.78	347.91	7.19	12.93	12.17	0.03
SQU-US	2026-02-23 17:30:00	4.52	51.48	348.80	7.16	12.88	13.81	0.02
SQU-US	2026-02-23 17:45:00	4.47	51.29	348.74	7.14	12.88	11.78	0.02
SQU-US	2026-02-23 18:00:00	4.41	50.71	348.97	7.14	12.88	11.34	0.02
SQU-US	2026-02-23 18:15:00	4.36	51.58	348.90	7.14	12.87	10.58	0.02
SQU-US	2026-02-23 18:30:00	4.29	51.37	349.30	7.15	12.85	14.24	0.02
SQU-US	2026-02-23 18:45:00	4.25	51.90	348.94	7.13	12.82	12.16	0.02
SQU-US	2026-02-23 19:00:00	4.20	51.49	348.57	7.14	12.81	11.87	0.02
SQU-US	2026-02-23 19:15:00	4.16	52.75	348.26	7.14	12.79	11.77	0.02
SQU-US	2026-02-23 19:30:00	4.12	56.89	353.16	7.07	12.78	13.20	0.03
SQU-US	2026-02-23 19:45:00	4.08	57.37	348.74	7.12	12.74	11.69	0.03
SQU-US	2026-02-23 20:00:00	4.07	58.59	349.10	7.12	12.73	12.21	0.03
SQU-US	2026-02-23 20:15:00	4.04	58.54	349.62	7.12	12.74	11.96	0.03
SQU-US	2026-02-23 20:30:00	4.04	54.45	343.47	7.11	12.70	12.83	0.02
SQU-US	2026-02-23 20:45:00	4.02	54.34	326.46	7.11	12.71	12.51	0.02
SQU-US	2026-02-23 21:00:00	3.99	54.40	314.93	7.12	12.71	11.49	0.02
SQU-US	2026-02-23 21:15:00	3.97	54.91	309.05	7.12	12.71	11.09	0.02
SQU-US	2026-02-23 21:30:00	3.96	53.97	309.99	7.10	12.69	13.25	0.02
SQU-US	2026-02-23 21:45:00	3.95	54.26	310.53	7.10	12.69	12.42	0.02
SQU-US	2026-02-23 22:00:00	3.93	53.83	313.72	7.10	12.67	12.11	0.02
SQU-US	2026-02-23 22:15:00	3.93	53.49	316.95	7.10	12.71	11.69	0.02
SQU-US	2026-02-23 22:30:00	3.88	53.44	322.22	7.16	12.72	13.22	0.02
SQU-US	2026-02-23 22:45:00	3.89	53.21	323.00	7.15	12.76	12.43	0.02
SQU-US	2026-02-23 23:00:00	3.85	52.73	324.47	7.23	12.82	11.88	0.02
SQU-US	2026-02-23 23:15:00	3.84	51.73	325.68	7.25	12.85	11.99	0.02
SQU-US	2026-02-23 23:30:00	3.83	51.19	329.52	7.22	12.88	12.68	0.02
SQU-US	2026-02-23 23:45:00	3.82	51.52	328.22	7.26	12.88	11.68	0.02
SQU-US	2026-02-24 00:00:00	3.81	51.64	328.43	7.26	12.89	12.18	0.02
SQU-US	2026-02-24 00:15:00	3.82	52.55	328.72	7.25	12.86	11.38	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-24 00:30:00	3.81	52.69	329.70	7.24	12.87	11.52	0.02
SQU-US	2026-02-24 00:45:00	3.82	53.06	329.22	7.25	12.87	11.59	0.02
SQU-US	2026-02-24 01:00:00	3.82	53.10	329.89	7.25	12.88	11.64	0.02
SQU-US	2026-02-24 01:15:00	3.82	53.92	330.74	7.25	12.86	11.86	0.02
SQU-US	2026-02-24 01:30:00	3.84	60.16	333.71	7.22	12.84	16.29	0.03
SQU-US	2026-02-24 01:45:00	3.83	60.63	333.25	7.23	12.82	14.38	0.03
SQU-US	2026-02-24 02:00:00	3.78	58.06	334.23	7.24	12.85	15.60	0.03
SQU-US	2026-02-24 02:15:00	3.77	58.27	335.21	7.24	12.86	15.19	0.03
SQU-US	2026-02-24 02:30:00	3.78	54.34	336.38	7.24	12.86	10.67	0.02
SQU-US	2026-02-24 02:45:00	3.79	55.41	337.00	7.22	12.82	12.01	0.02
SQU-US	2026-02-24 03:00:00	3.78	54.47	337.80	7.22	12.81	11.24	0.02
SQU-US	2026-02-24 03:15:00	3.77	53.59	338.53	7.22	12.82	11.16	0.02
SQU-US	2026-02-24 03:30:00	3.77	53.03	343.62	7.15	12.83	12.97	0.02
SQU-US	2026-02-24 03:45:00	3.76	52.95	340.86	7.21	12.80	10.89	0.02
SQU-US	2026-02-24 04:00:00	3.74	52.64	342.34	7.20	12.79	11.23	0.02
SQU-US	2026-02-24 04:15:00	3.71	51.91	343.29	7.19	12.79	11.71	0.02
SQU-US	2026-02-24 04:30:00	3.70	51.24	346.04	7.12	12.77	12.21	0.02
SQU-US	2026-02-24 04:45:00	3.71	51.33	347.00	7.05	12.69	11.17	0.02
SQU-US	2026-02-24 05:00:00	3.71	51.23	349.46	7.02	12.64	10.91	0.02
SQU-US	2026-02-24 05:15:00	3.67	51.10	350.06	7.11	12.72	11.55	0.02
SQU-US	2026-02-24 05:30:00	3.66	55.63	353.73	7.05	12.72	11.99	0.02
SQU-US	2026-02-24 05:45:00	3.62	55.32	351.48	7.17	12.76	11.87	0.02
SQU-US	2026-02-24 06:00:00	3.60	55.29	351.87	7.19	12.78	11.26	0.02
SQU-US	2026-02-24 06:15:00	3.57	54.58	352.14	7.21	12.83	11.18	0.02
SQU-US	2026-02-24 06:30:00	3.54	50.12	353.38	7.19	12.84	11.32	0.02
SQU-US	2026-02-24 06:45:00	3.51	49.70	352.41	7.23	12.86	11.20	0.02
SQU-US	2026-02-24 07:00:00	3.47	49.45	352.72	7.24	12.88	11.19	0.02
SQU-US	2026-02-24 07:15:00	3.43	48.95	352.72	7.25	12.92	11.25	0.02
SQU-US	2026-02-24 07:30:00	3.41	48.96	354.58	7.22	12.92	11.42	0.02
SQU-US	2026-02-24 07:45:00	3.38	48.56	350.31	7.27	12.93	10.94	0.02
SQU-US	2026-02-24 08:00:00	3.36	48.40	347.90	7.27	12.95	11.34	0.02
SQU-US	2026-02-24 08:15:00	3.34	48.13	346.55	7.27	12.97	11.03	0.02
SQU-US	2026-02-24 08:30:00	3.33	48.94	347.22	7.26	12.97	13.10	0.02
SQU-US	2026-02-24 08:45:00	3.31	48.70	344.70	7.28	12.98	11.02	0.02
SQU-US	2026-02-24 09:00:00	3.30	48.83	345.03	7.28	13.01	11.64	0.02
SQU-US	2026-02-24 09:15:00	3.29	48.60	345.87	7.28	13.03	11.28	0.02
SQU-US	2026-02-24 09:30:00	3.28	53.47	349.95	7.23	13.04	11.16	0.02
SQU-US	2026-02-24 09:45:00	3.28	53.48	347.85	7.29	13.06	10.60	0.02
SQU-US	2026-02-24 10:00:00	3.32	55.36	349.10	7.29	13.05	10.99	0.02
SQU-US	2026-02-24 10:15:00	3.34	54.48	349.94	7.30	13.09	10.90	0.02
SQU-US	2026-02-24 10:30:00	3.40	51.56	341.32	7.26	13.09	11.31	0.02
SQU-US	2026-02-24 10:45:00	3.45	51.99	337.06	7.30	13.10	10.65	0.02
SQU-US	2026-02-24 11:00:00	3.54	54.23	334.09	7.28	13.09	11.18	0.02
SQU-US	2026-02-24 11:15:00	3.65	56.22	327.04	7.27	13.03	10.81	0.02
SQU-US	2026-02-24 11:30:00	3.81	60.78	321.98	7.22	12.95	11.01	0.03
SQU-US	2026-02-24 11:45:00	3.91	61.76	311.89	7.25	12.93	10.70	0.03
SQU-US	2026-02-24 12:00:00	4.01	62.08	307.53	7.25	12.92	10.81	0.03
SQU-US	2026-02-24 12:15:00	4.09	60.94	306.31	7.25	12.92	11.39	0.03
SQU-US	2026-02-24 12:30:00	4.17	59.99	307.41	7.23	12.93	11.16	0.03
SQU-US	2026-02-24 12:45:00	4.26	59.81	308.94	7.25	12.90	11.04	0.03
SQU-US	2026-02-24 13:00:00	4.32	58.73	310.76	7.24	12.87	11.03	0.03
SQU-US	2026-02-24 13:15:00	4.42	58.14	311.84	7.15	12.82	10.54	0.03
SQU-US	2026-02-24 13:30:00	4.51	56.96	315.11	7.09	12.71	10.26	0.03
SQU-US	2026-02-24 13:45:00	4.63	56.58	314.20	7.04	12.64	9.98	0.03
SQU-US	2026-02-24 14:00:00	4.66	56.28	312.75	7.12	12.69	9.80	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-24 14:15:00	4.74	56.04	310.79	7.08	12.64	9.37	0.02
SQU-US	2026-02-24 14:30:00	4.78	55.28	308.07	7.12	12.66	10.52	0.02
SQU-US	2026-02-24 14:45:00	4.83	55.44	301.89	7.12	12.68	9.75	0.02
SQU-US	2026-02-24 15:00:00	4.87	55.44	297.06	7.11	12.65	10.18	0.02
SQU-US	2026-02-24 15:15:00	4.89	55.48	295.79	7.12	12.66	10.08	0.02
SQU-US	2026-02-24 15:30:00	4.92	55.30	297.43	7.11	12.65	10.51	0.02
SQU-US	2026-02-24 15:45:00	4.92	54.88	295.69	7.14	12.64	10.41	0.02
SQU-US	2026-02-24 16:00:00	4.92	54.85	297.95	7.15	12.66	10.21	0.02
SQU-US	2026-02-24 16:15:00	4.89	54.35	300.68	7.15	12.65	10.26	0.02
SQU-US	2026-02-24 16:30:00	4.85	54.47	305.34	7.14	12.66	13.14	0.02
SQU-US	2026-02-24 16:45:00	4.80	53.78	306.19	7.15	12.66	10.87	0.02
SQU-US	2026-02-24 17:00:00	4.71	53.66	309.29	7.14	12.67	14.63	0.02
SQU-US	2026-02-24 17:15:00	4.62	53.36	310.90	7.16	12.69	10.02	0.02
SQU-US	2026-02-24 17:30:00	4.53	53.56	314.71	7.15	12.70	10.91	0.02
SQU-US	2026-02-24 17:45:00	4.42	53.35	316.40	7.16	12.70	10.70	0.02
SQU-US	2026-02-24 18:00:00	4.33	53.73	318.74	7.16	12.70	10.93	0.02
SQU-US	2026-02-24 18:15:00	4.24	53.64	321.05	7.17	12.71	11.08	0.02
SQU-US	2026-02-24 18:30:00	4.17	53.98	323.16	7.18	12.70	11.45	0.02
SQU-US	2026-02-24 18:45:00	4.12	53.85	324.62	7.18	12.69	11.38	0.02
SQU-US	2026-02-24 19:00:00	4.07	53.97	326.15	7.18	12.71	11.80	0.02
SQU-US	2026-02-24 19:15:00	4.02	53.72	327.56	7.18	12.69	10.75	0.02
SQU-US	2026-02-24 19:30:00	3.99	53.75	331.02	7.15	12.67	21.32	0.02
SQU-US	2026-02-24 19:45:00	3.96	53.53	330.02	7.18	12.68	10.99	0.02
SQU-US	2026-02-24 20:00:00	3.94	54.02	331.02	7.18	12.67	10.65	0.02
SQU-US	2026-02-24 20:15:00	3.92	54.12	332.39	7.18	12.67	10.90	0.02
SQU-US	2026-02-24 20:30:00	3.92	54.45	334.54	7.16	12.65	12.23	0.02
SQU-US	2026-02-24 20:45:00	3.91	54.27	334.11	7.18	12.65	11.89	0.02
SQU-US	2026-02-24 21:00:00	3.90	54.17	334.91	7.18	12.66	11.74	0.02
SQU-US	2026-02-24 21:15:00	3.91	54.47	336.01	7.17	12.65	11.53	0.02
SQU-US	2026-02-24 21:30:00	3.91	54.58	339.06	7.15	12.64	12.04	0.02
SQU-US	2026-02-24 21:45:00	3.92	54.85	337.17	7.18	12.64	11.01	0.02
SQU-US	2026-02-24 22:00:00	3.92	54.72	338.08	7.18	12.65	11.58	0.02
SQU-US	2026-02-24 22:15:00	3.93	54.72	338.75	7.18	12.64	10.65	0.02
SQU-US	2026-02-24 22:30:00	3.93	54.75	340.41	7.19	12.66	12.08	0.02
SQU-US	2026-02-24 22:45:00	3.94	54.61	340.72	7.17	12.64	12.05	0.02
SQU-US	2026-02-24 23:00:00	3.96	54.81	342.25	7.14	12.63	10.99	0.02
SQU-US	2026-02-24 23:15:00	3.95	54.19	342.87	7.17	12.64	11.80	0.02
SQU-US	2026-02-24 23:30:00	3.92	53.49	346.08	7.16	12.69	11.74	0.02
SQU-US	2026-02-24 23:45:00	3.87	52.43	344.12	7.26	12.73	11.50	0.02
SQU-US	2026-02-25 00:00:00	3.85	51.89	344.37	7.28	12.78	14.99	0.02
SQU-US	2026-02-25 00:15:00	3.84	51.82	344.81	7.29	12.79	11.31	0.02
SQU-US	2026-02-25 00:30:00	3.83	52.72	346.74	7.25	12.78	12.81	0.02
SQU-US	2026-02-25 00:45:00	3.81	52.26	346.29	7.30	12.79	11.83	0.02
SQU-US	2026-02-25 01:00:00	3.79	51.79	346.57	7.31	12.82	12.79	0.02
SQU-US	2026-02-25 01:15:00	3.76	51.66	347.36	7.31	12.83	11.90	0.02
SQU-US	2026-02-25 01:30:00	3.75	51.81	350.49	7.27	12.84	12.13	0.02
SQU-US	2026-02-25 01:45:00	3.73	51.56	348.61	7.32	12.83	12.09	0.02
SQU-US	2026-02-25 02:00:00	3.72	52.09	349.70	7.31	12.84	11.98	0.02
SQU-US	2026-02-25 02:15:00	3.72	52.72	350.68	7.31	12.84	12.11	0.02
SQU-US	2026-02-25 02:30:00	3.71	53.50	352.12	7.28	12.82	14.49	0.02
SQU-US	2026-02-25 02:45:00	3.71	53.48	351.39	7.30	12.83	11.75	0.02
SQU-US	2026-02-25 03:00:00	3.73	55.21	351.53	7.29	12.80	11.98	0.02
SQU-US	2026-02-25 03:15:00	3.76	57.90	351.77	7.27	12.75	12.00	0.03
SQU-US	2026-02-25 03:30:00	3.75	62.52	355.70	7.22	12.75	11.78	0.03
SQU-US	2026-02-25 03:45:00	3.72	61.14	352.56	7.27	12.79	11.79	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-25 04:00:00	3.74	63.16	353.05	7.27	12.76	11.92	0.03
SQU-US	2026-02-25 04:15:00	3.75	64.14	353.51	7.27	12.73	12.14	0.03
SQU-US	2026-02-25 04:30:00	3.76	58.73	354.38	7.26	12.70	12.92	0.03
SQU-US	2026-02-25 04:45:00	3.72	57.32	353.68	7.28	12.74	12.17	0.03
SQU-US	2026-02-25 05:00:00	3.69	55.86	353.05	7.28	12.77	11.92	0.02
SQU-US	2026-02-25 05:15:00	3.71	57.56	352.50	7.26	12.73	11.85	0.03
SQU-US	2026-02-25 05:30:00	3.68	57.08	353.94	7.23	12.73	13.21	0.03
SQU-US	2026-02-25 05:45:00	3.65	56.08	351.10	7.27	12.75	11.82	0.02
SQU-US	2026-02-25 06:00:00	3.62	55.03	350.51	7.27	12.76	12.21	0.02
SQU-US	2026-02-25 06:15:00	3.63	55.67	350.26	7.27	12.76	11.96	0.02
SQU-US	2026-02-25 06:30:00	3.61	55.44	352.03	7.25	12.75	12.53	0.02
SQU-US	2026-02-25 06:45:00	3.60	55.39	350.18	7.26	12.75	11.69	0.02
SQU-US	2026-02-25 07:00:00	3.58	54.79	349.76	7.27	12.76	11.37	0.02
SQU-US	2026-02-25 07:15:00	3.57	54.37	350.06	7.27	12.78	11.57	0.02
SQU-US	2026-02-25 07:30:00	3.57	59.22	352.50	7.24	12.77	16.28	0.03
SQU-US	2026-02-25 07:45:00	3.56	58.59	350.93	7.27	12.80	15.66	0.03
SQU-US	2026-02-25 08:00:00	3.56	58.50	351.62	7.27	12.79	18.77	0.03
SQU-US	2026-02-25 08:15:00	3.56	58.76	352.36	7.27	12.78	15.82	0.03
SQU-US	2026-02-25 08:30:00	3.56	53.41	352.75	7.28	12.81	11.68	0.02
SQU-US	2026-02-25 08:45:00	3.56	53.35	353.23	7.29	12.83	11.79	0.02
SQU-US	2026-02-25 09:00:00	3.57	53.41	353.38	7.29	12.84	11.84	0.02
SQU-US	2026-02-25 09:15:00	3.59	53.75	353.34	7.29	12.85	11.86	0.02
SQU-US	2026-02-25 09:30:00	3.61	53.55	354.75	7.26	12.85	11.88	0.02
SQU-US	2026-02-25 09:45:00	3.63	53.45	348.84	7.30	12.87	11.88	0.02
SQU-US	2026-02-25 10:00:00	3.65	53.49	346.70	7.30	12.88	12.53	0.02
SQU-US	2026-02-25 10:15:00	3.67	53.59	345.41	7.31	12.91	11.93	0.02
SQU-US	2026-02-25 10:30:00	3.72	54.73	346.63	7.28	12.91	16.94	0.02
SQU-US	2026-02-25 10:45:00	3.76	55.18	344.89	7.31	12.93	11.72	0.02
SQU-US	2026-02-25 11:00:00	3.81	55.59	345.33	7.31	12.95	11.69	0.02
SQU-US	2026-02-25 11:15:00	3.86	55.33	345.88	7.32	12.97	11.64	0.02
SQU-US	2026-02-25 11:30:00	3.96	63.34	349.84	7.26	12.93	11.70	0.03
SQU-US	2026-02-25 11:45:00	4.02	63.46	347.12	7.31	12.92	11.68	0.03
SQU-US	2026-02-25 12:00:00	4.09	64.04	347.58	7.30	12.92	11.80	0.03
SQU-US	2026-02-25 12:15:00	4.17	65.18	348.32	7.30	12.91	11.94	0.03
SQU-US	2026-02-25 12:30:00	4.26	61.73	349.18	7.27	12.86	12.55	0.03
SQU-US	2026-02-25 12:45:00	4.32	62.14	348.21	7.27	12.83	11.97	0.03
SQU-US	2026-02-25 13:00:00	4.36	61.93	348.13	7.27	12.83	16.15	0.03
SQU-US	2026-02-25 13:15:00	4.40	62.10	348.07	7.25	12.81	12.21	0.03
SQU-US	2026-02-25 13:30:00	4.44	66.96	349.91	7.22	12.79	18.16	0.03
SQU-US	2026-02-25 13:45:00	4.44	66.55	348.58	7.23	12.77	16.92	0.03
SQU-US	2026-02-25 14:00:00	4.44	65.72	348.92	7.19	12.74	16.77	0.03
SQU-US	2026-02-25 14:15:00	4.44	65.12	351.01	7.12	12.65	16.69	0.03
SQU-US	2026-02-25 14:30:00	4.45	59.08	351.10	7.09	12.60	12.20	0.03
SQU-US	2026-02-25 14:45:00	4.47	58.52	352.00	7.03	12.56	12.28	0.03
SQU-US	2026-02-25 15:00:00	4.40	58.25	352.59	7.12	12.64	11.19	0.03
SQU-US	2026-02-25 15:15:00	4.36	57.56	352.27	7.17	12.71	11.84	0.03
SQU-US	2026-02-25 15:30:00	4.35	57.65	354.09	7.15	12.72	14.98	0.03
SQU-US	2026-02-25 15:45:00	4.34	57.19	351.43	7.18	12.71	11.25	0.03
SQU-US	2026-02-25 16:00:00	4.34	57.23	350.90	7.17	12.71	11.55	0.03
SQU-US	2026-02-25 16:15:00	4.33	57.20	350.38	7.17	12.70	10.71	0.03
SQU-US	2026-02-25 16:30:00	4.34	57.38	350.45	7.16	12.68	11.39	0.03
SQU-US	2026-02-25 16:45:00	4.33	57.41	349.54	7.17	12.68	12.19	0.03
SQU-US	2026-02-25 17:00:00	4.33	57.38	348.36	7.17	12.68	11.68	0.03
SQU-US	2026-02-25 17:15:00	4.32	57.45	347.42	7.18	12.67	11.52	0.03
SQU-US	2026-02-25 17:30:00	4.32	63.20	348.36	7.14	12.66	12.15	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-25 17:45:00	4.32	62.97	336.56	7.18	12.64	10.74	0.03
SQU-US	2026-02-25 18:00:00	4.32	63.13	333.78	7.19	12.63	10.32	0.03
SQU-US	2026-02-25 18:15:00	4.32	63.27	333.84	7.17	12.62	11.05	0.03
SQU-US	2026-02-25 18:30:00	4.33	57.97	328.64	7.17	12.61	11.63	0.03
SQU-US	2026-02-25 18:45:00	4.32	57.82	317.03	7.18	12.62	10.79	0.03
SQU-US	2026-02-25 19:00:00	4.32	57.83	312.48	7.19	12.58	11.93	0.03
SQU-US	2026-02-25 19:15:00	4.32	57.79	309.16	7.18	12.58	12.78	0.03
SQU-US	2026-02-25 19:30:00	4.33	58.01	309.31	7.16	12.56	14.53	0.03
SQU-US	2026-02-25 19:45:00	4.32	58.14	307.05	7.17	12.55	12.14	0.03
SQU-US	2026-02-25 20:00:00	4.34	58.48	306.60	7.17	12.53	12.49	0.03
SQU-US	2026-02-25 20:15:00	4.34	58.36	306.22	7.17	12.53	11.89	0.03
SQU-US	2026-02-25 20:30:00	4.35	58.69	307.63	7.16	12.52	13.01	0.03
SQU-US	2026-02-25 20:45:00	4.34	58.76	306.03	7.17	12.52	12.86	0.03
SQU-US	2026-02-25 21:00:00	4.35	59.00	306.39	7.17	12.51	12.96	0.03
SQU-US	2026-02-25 21:15:00	4.36	59.12	306.52	7.18	12.50	12.72	0.03
SQU-US	2026-02-25 21:30:00	4.37	59.30	308.73	7.15	12.50	11.95	0.03
SQU-US	2026-02-25 21:45:00	4.37	59.15	308.03	7.18	12.50	12.45	0.03
SQU-US	2026-02-25 22:00:00	4.38	59.68	309.06	7.18	12.50	12.60	0.03
SQU-US	2026-02-25 22:15:00	4.38	59.32	309.78	7.19	12.50	13.66	0.03
SQU-US	2026-02-25 22:30:00	4.39	59.87	311.63	7.17	12.49	14.01	0.03
SQU-US	2026-02-25 22:45:00	4.39	59.53	311.39	7.17	12.49	12.51	0.03
SQU-US	2026-02-25 23:00:00	4.39	59.74	312.14	7.17	12.50	13.16	0.03
SQU-US	2026-02-25 23:15:00	4.40	60.26	312.50	7.18	12.49	13.59	0.03
SQU-US	2026-02-25 23:30:00	4.40	60.00	314.22	7.16	12.50	12.21	0.03
SQU-US	2026-02-25 23:45:00	4.39	59.50	314.62	7.20	12.52	11.74	0.03
SQU-US	2026-02-26 00:00:00	4.40	59.70	317.55	7.18	12.51	12.33	0.03
SQU-US	2026-02-26 00:15:00	4.43	58.95	319.78	7.15	12.49	12.82	0.03
SQU-US	2026-02-26 00:30:00	4.40	57.38	324.34	7.15	12.50	13.28	0.03
SQU-US	2026-02-26 00:45:00	4.37	57.03	324.94	7.23	12.59	12.76	0.03
SQU-US	2026-02-26 01:00:00	4.31	55.86	326.18	7.29	12.65	13.37	0.02
SQU-US	2026-02-26 01:15:00	4.29	54.97	328.09	7.30	12.69	13.10	0.02
SQU-US	2026-02-26 01:30:00	4.28	54.34	332.58	7.28	12.69	14.08	0.02
SQU-US	2026-02-26 01:45:00	4.29	54.33	332.41	7.31	12.71	13.28	0.02
SQU-US	2026-02-26 02:00:00	4.29	54.05	333.88	7.32	12.72	12.88	0.02
SQU-US	2026-02-26 02:15:00	4.29	53.06	334.86	7.32	12.71	13.20	0.02
SQU-US	2026-02-26 02:30:00	4.29	53.34	337.79	7.29	12.74	15.15	0.02
SQU-US	2026-02-26 02:45:00	4.30	53.08	337.63	7.33	12.73	13.80	0.02
SQU-US	2026-02-26 03:00:00	4.30	53.68	339.21	7.33	12.76	14.29	0.02
SQU-US	2026-02-26 03:15:00	4.31	53.15	341.00	7.34	12.77	14.10	0.02
SQU-US	2026-02-26 03:30:00	4.33	53.06	344.80	7.30	12.76	13.84	0.02
SQU-US	2026-02-26 03:45:00	4.32	52.92	343.90	7.33	12.76	13.97	0.02
SQU-US	2026-02-26 04:00:00	4.33	53.17	344.98	7.34	12.77	13.88	0.02
SQU-US	2026-02-26 04:15:00	4.36	54.03	346.10	7.33	12.74	13.51	0.02
SQU-US	2026-02-26 04:30:00	4.40	56.27	348.46	7.29	12.70	14.94	0.02
SQU-US	2026-02-26 04:45:00	4.44	57.50	345.54	7.30	12.65	13.93	0.03
SQU-US	2026-02-26 05:00:00	4.40	56.85	344.24	7.31	12.68	14.02	0.03
SQU-US	2026-02-26 05:15:00	4.42	57.75	343.77	7.30	12.65	13.69	0.03
SQU-US	2026-02-26 05:30:00	4.45	59.26	345.30	7.26	12.64	13.85	0.03
SQU-US	2026-02-26 05:45:00	4.49	61.44	342.55	7.28	12.56	13.81	0.03
SQU-US	2026-02-26 06:00:00	4.44	59.29	342.26	7.29	12.62	14.28	0.03
SQU-US	2026-02-26 06:15:00	4.47	60.25	342.15	7.28	12.60	13.51	0.03
SQU-US	2026-02-26 06:30:00	4.51	62.97	342.17	7.27	12.54	15.03	0.03
SQU-US	2026-02-26 06:45:00	4.46	60.49	341.05	7.28	12.58	15.79	0.03
SQU-US	2026-02-26 07:00:00	4.46	59.89	340.46	7.28	12.58	13.96	0.03
SQU-US	2026-02-26 07:15:00	4.46	59.48	340.43	7.29	12.59	14.04	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-26 07:30:00	4.46	58.80	342.79	7.25	12.57	14.13	0.03
SQU-US	2026-02-26 07:45:00	4.43	57.31	341.14	7.29	12.61	13.94	0.03
SQU-US	2026-02-26 08:00:00	4.44	57.30	341.71	7.28	12.60	13.92	0.03
SQU-US	2026-02-26 08:15:00	4.42	56.56	341.78	7.29	12.61	14.17	0.03
SQU-US	2026-02-26 08:30:00	4.43	57.49	342.94	7.26	12.60	18.12	0.03
SQU-US	2026-02-26 08:45:00	4.41	56.58	342.01	7.28	12.62	14.54	0.03
SQU-US	2026-02-26 09:00:00	4.40	56.37	341.90	7.28	12.62	14.42	0.02
SQU-US	2026-02-26 09:15:00	4.40	55.90	341.91	7.29	12.64	14.25	0.02
SQU-US	2026-02-26 09:30:00	4.42	58.80	344.23	7.25	12.61	14.81	0.03
SQU-US	2026-02-26 09:45:00	4.42	58.21	342.38	7.29	12.65	15.52	0.03
SQU-US	2026-02-26 10:00:00	4.42	58.03	342.54	7.29	12.63	15.15	0.03
SQU-US	2026-02-26 10:15:00	4.43	57.65	342.95	7.30	12.70	15.07	0.03
SQU-US	2026-02-26 10:30:00	4.44	55.44	343.46	7.30	12.49	14.60	0.02
SQU-US	2026-02-26 10:45:00	4.45	54.54	343.74	7.31	12.68	14.40	0.02
SQU-US	2026-02-26 11:00:00	4.48	54.51	344.41	7.31	12.77	14.27	0.02
SQU-US	2026-02-26 11:15:00	4.51	54.90	344.76	7.31	12.73	14.34	0.02
SQU-US	2026-02-26 11:30:00	4.54	54.90	349.29	7.26	12.79	14.85	0.02
SQU-US	2026-02-26 11:45:00	4.56	54.68	346.31	7.31	12.80	14.99	0.02
SQU-US	2026-02-26 12:00:00	4.60	54.93	346.75	7.32	12.82	15.05	0.02
SQU-US	2026-02-26 12:15:00	4.67	56.47	347.63	7.30	12.79	14.33	0.03
SQU-US	2026-02-26 12:30:00	4.72	57.41	348.52	7.28	12.79	15.17	0.03
SQU-US	2026-02-26 12:45:00	4.74	57.42	348.14	7.30	12.78	14.51	0.03
SQU-US	2026-02-26 13:00:00	4.77	57.13	348.22	7.30	12.80	14.77	0.03
SQU-US	2026-02-26 13:15:00	4.81	57.05	348.63	7.30	12.81	15.52	0.03
SQU-US	2026-02-26 13:30:00	4.89	58.19	350.78	7.26	12.78	20.70	0.03
SQU-US	2026-02-26 13:45:00	4.93	58.78	348.54	7.28	12.75	15.46	0.03
SQU-US	2026-02-26 14:00:00	4.96	58.40	348.13	7.28	12.75	15.32	0.03
SQU-US	2026-02-26 14:15:00	4.96	57.81	347.78	7.27	12.75	16.04	0.03
SQU-US	2026-02-26 14:30:00	4.99	58.71	348.64	7.25	12.72	16.17	0.03
SQU-US	2026-02-26 14:45:00	5.00	58.69	348.64	7.25	12.70	16.22	0.03
SQU-US	2026-02-26 15:00:00	5.00	58.26	349.26	7.20	12.67	16.59	0.03
SQU-US	2026-02-26 15:15:00	5.02	57.45	351.52	7.13	12.59	16.00	0.03
SQU-US	2026-02-26 15:30:00	5.04	56.96	353.56	7.09	12.60	17.22	0.03
SQU-US	2026-02-26 15:45:00	5.04	56.38	352.78	7.12	12.60	17.45	0.03
SQU-US	2026-02-26 16:00:00	5.05	56.18	353.75	7.11	12.58	17.10	0.02
SQU-US	2026-02-26 16:15:00	5.03	55.83	353.74	7.15	12.61	17.04	0.02
SQU-US	2026-02-26 16:30:00	5.02	55.24	354.71	7.15	12.62	17.85	0.02
SQU-US	2026-02-26 16:45:00	5.02	55.45	354.49	7.17	12.63	17.27	0.02
SQU-US	2026-02-26 17:00:00	5.01	55.03	354.76	7.18	12.62	17.97	0.02
SQU-US	2026-02-26 17:15:00	4.99	54.44	355.11	7.19	12.64	15.71	0.02
SQU-US	2026-02-26 17:30:00	4.99	59.86	359.33	7.12	12.64	17.27	0.03
SQU-US	2026-02-26 17:45:00	4.98	59.70	355.90	7.19	12.63	16.44	0.03
SQU-US	2026-02-26 18:00:00	4.96	59.47	356.20	7.19	12.62	15.99	0.03
SQU-US	2026-02-26 18:15:00	4.96	59.73	356.62	7.19	12.60	15.99	0.03
SQU-US	2026-02-26 18:30:00	4.95	54.84	355.11	7.18	12.58	18.44	0.02
SQU-US	2026-02-26 18:45:00	4.94	54.49	349.08	7.19	12.58	17.13	0.02
SQU-US	2026-02-26 19:00:00	4.92	54.40	345.18	7.19	12.57	16.30	0.02
SQU-US	2026-02-26 19:15:00	4.92	54.79	342.49	7.19	12.55	16.58	0.02
SQU-US	2026-02-26 19:30:00	4.91	59.98	344.00	7.13	12.53	17.09	0.03
SQU-US	2026-02-26 19:45:00	4.90	59.42	339.34	7.19	12.52	15.99	0.03
SQU-US	2026-02-26 20:00:00	4.89	59.77	339.01	7.18	12.52	15.33	0.03
SQU-US	2026-02-26 20:15:00	4.88	59.59	339.61	7.18	12.53	16.37	0.03
SQU-US	2026-02-26 20:30:00	4.88	54.96	338.99	7.19	12.51	17.00	0.02
SQU-US	2026-02-26 20:45:00	4.87	54.89	335.05	7.19	12.50	16.00	0.02
SQU-US	2026-02-26 21:00:00	4.87	54.85	331.62	7.18	12.50	15.70	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-26 21:15:00	4.87	54.66	329.97	7.18	12.50	16.59	0.02
SQU-US	2026-02-26 21:30:00	4.88	54.51	331.44	7.15	12.50	16.81	0.02
SQU-US	2026-02-26 21:45:00	4.88	55.10	329.89	7.17	12.49	17.16	0.02
SQU-US	2026-02-26 22:00:00	4.89	55.23	330.79	7.18	12.48	16.45	0.02
SQU-US	2026-02-26 22:15:00	4.88	54.81	332.32	7.17	12.49	16.30	0.02
SQU-US	2026-02-26 22:30:00	4.88	54.99	334.43	7.18	12.49	16.45	0.02
SQU-US	2026-02-26 22:45:00	4.87	54.73	334.67	7.18	12.49	15.38	0.02
SQU-US	2026-02-26 23:00:00	4.88	54.84	336.00	7.18	12.49	16.52	0.02
SQU-US	2026-02-26 23:15:00	4.88	54.78	337.31	7.18	12.50	16.29	0.02
SQU-US	2026-02-26 23:30:00	4.88	54.38	340.60	7.15	12.50	17.31	0.02
SQU-US	2026-02-26 23:45:00	4.87	54.06	339.83	7.18	12.50	16.70	0.02
SQU-US	2026-02-27 00:00:00	4.87	54.34	341.06	7.18	12.50	17.23	0.02
SQU-US	2026-02-27 00:15:00	4.86	53.59	342.05	7.18	12.51	14.41	0.02
SQU-US	2026-02-27 00:30:00	4.86	57.10	344.30	7.17	12.50	20.63	0.03
SQU-US	2026-02-27 00:45:00	4.86	56.94	344.46	7.18	12.52	17.54	0.03
SQU-US	2026-02-27 01:00:00	4.86	56.54	345.74	7.17	12.49	17.99	0.03
SQU-US	2026-02-27 01:15:00	4.85	56.03	345.96	7.17	12.50	18.96	0.02
SQU-US	2026-02-27 01:30:00	4.88	52.35	348.94	7.12	12.50	18.01	0.02
SQU-US	2026-02-27 01:45:00	4.83	50.96	346.68	7.22	12.56	17.69	0.02
SQU-US	2026-02-27 02:00:00	4.77	49.45	346.93	7.29	12.66	17.73	0.02
SQU-US	2026-02-27 02:15:00	4.75	48.83	347.91	7.30	12.70	17.24	0.02
SQU-US	2026-02-27 02:30:00	4.74	48.42	350.16	7.29	12.71	19.07	0.02
SQU-US	2026-02-27 02:45:00	4.73	48.09	350.44	7.31	12.73	17.58	0.02
SQU-US	2026-02-27 03:00:00	4.72	47.92	352.05	7.31	12.74	17.39	0.02
SQU-US	2026-02-27 03:15:00	4.70	47.58	353.37	7.32	12.75	17.36	0.02
SQU-US	2026-02-27 03:30:00	4.70	47.09	356.99	7.28	12.77	18.64	0.02
SQU-US	2026-02-27 03:45:00	4.69	46.88	355.08	7.33	12.79	18.17	0.02
SQU-US	2026-02-27 04:00:00	4.68	46.75	355.89	7.33	12.78	16.87	0.02
SQU-US	2026-02-27 04:15:00	4.66	46.59	356.61	7.33	12.79	16.99	0.02
SQU-US	2026-02-27 04:30:00	4.65	46.77	359.02	7.31	12.80	19.15	0.02
SQU-US	2026-02-27 04:45:00	4.65	46.80	358.67	7.33	12.82	17.56	0.02
SQU-US	2026-02-27 05:00:00	4.66	47.26	359.57	7.32	12.79	17.39	0.02
SQU-US	2026-02-27 05:15:00	4.67	47.99	360.22	7.31	12.77	17.37	0.02
SQU-US	2026-02-27 05:30:00	4.68	49.36	348.22	7.27	12.75	17.13	0.02
SQU-US	2026-02-27 05:45:00	4.71	50.83	344.34	7.28	12.71	17.00	0.02
SQU-US	2026-02-27 06:00:00	4.75	52.88	337.71	7.26	12.62	17.70	0.02
SQU-US	2026-02-27 06:15:00	4.75	53.63	327.68	7.25	12.59	17.07	0.02
SQU-US	2026-02-27 06:30:00	4.70	51.79	321.58	7.24	12.65	17.90	0.02
SQU-US	2026-02-27 06:45:00	4.71	53.05	316.65	7.26	12.65	17.37	0.02
SQU-US	2026-02-27 07:00:00	4.72	53.63	313.38	7.26	12.61	17.99	0.02
SQU-US	2026-02-27 07:15:00	4.70	52.85	311.01	7.26	12.63	17.18	0.02
SQU-US	2026-02-27 07:30:00	4.66	50.55	310.80	7.24	12.69	17.68	0.02
SQU-US	2026-02-27 07:45:00	4.66	50.85	312.12	7.27	12.67	17.07	0.02
SQU-US	2026-02-27 08:00:00	4.64	49.95	313.32	7.28	12.67	17.23	0.02
SQU-US	2026-02-27 08:15:00	4.64	49.65	312.30	7.27	12.69	18.60	0.02
SQU-US	2026-02-27 08:30:00	4.62	48.95	312.24	7.27	12.70	17.96	0.02
SQU-US	2026-02-27 08:45:00	4.63	49.33	311.36	7.27	12.69	18.50	0.02
SQU-US	2026-02-27 09:00:00	4.64	49.71	311.68	7.27	12.66	18.07	0.02
SQU-US	2026-02-27 09:15:00	4.64	50.05	311.16	7.26	12.66	17.98	0.02
SQU-US	2026-02-27 09:30:00	4.64	49.34	311.17	7.22	12.68	17.61	0.02
SQU-US	2026-02-27 09:45:00	4.66	49.97	305.01	7.26	12.69	16.48	0.02
SQU-US	2026-02-27 10:00:00	4.69	50.80	302.25	7.25	12.67	17.18	0.02
SQU-US	2026-02-27 10:15:00	4.70	50.60	300.85	7.25	12.71	17.13	0.02
SQU-US	2026-02-27 10:30:00	4.73	51.36	300.67	7.23	12.71	20.82	0.02
SQU-US	2026-02-27 10:45:00	4.75	51.38	300.16	7.25	12.73	17.14	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-27 11:00:00	4.79	51.48	300.24	7.25	12.74	17.38	0.02
SQU-US	2026-02-27 11:15:00	4.83	51.47	302.45	7.25	12.76	18.09	0.02
SQU-US	2026-02-27 11:30:00	4.88	51.18	306.39	7.22	12.78	18.00	0.02
SQU-US	2026-02-27 11:45:00	4.92	51.35	302.54	7.26	12.79	18.11	0.02
SQU-US	2026-02-27 12:00:00	4.96	50.71	303.67	7.28	12.82	17.77	0.02
SQU-US	2026-02-27 12:15:00	4.99	50.23	305.58	7.29	12.84	17.38	0.02
SQU-US	2026-02-27 12:30:00	5.07	51.92	307.01	7.27	12.82	19.26	0.02
SQU-US	2026-02-27 12:45:00	5.13	52.20	305.05	7.27	12.79	18.72	0.02
SQU-US	2026-02-27 13:00:00	5.19	51.59	304.87	7.28	12.81	18.50	0.02
SQU-US	2026-02-27 13:15:00	5.23	50.57	306.43	7.30	12.84	18.92	0.02
SQU-US	2026-02-27 13:30:00	5.32	50.19	308.90	7.28	12.88	22.90	0.02
SQU-US	2026-02-27 13:45:00	5.41	51.69	308.25	7.29	12.82	17.62	0.02
SQU-US	2026-02-27 14:00:00	5.41	51.42	309.15	7.29	12.81	18.55	0.02
SQU-US	2026-02-27 14:15:00	5.43	51.74	310.37	7.29	12.81	18.58	0.02
SQU-US	2026-02-27 14:30:00	5.43	50.77	312.43	7.30	12.84	20.19	0.02
SQU-US	2026-02-27 14:45:00	5.51	52.07	312.85	7.29	12.82	17.81	0.02
SQU-US	2026-02-27 15:00:00	5.56	54.14	314.15	7.26	12.71	18.29	0.02
SQU-US	2026-02-27 15:15:00	5.55	54.11	314.30	7.26	12.73	18.45	0.02
SQU-US	2026-02-27 15:30:00	5.52	57.69	318.91	7.21	12.76	16.85	0.03
SQU-US	2026-02-27 15:45:00	5.52	58.24	317.60	7.25	12.73	17.06	0.03
SQU-US	2026-02-27 16:00:00	5.52	58.79	319.79	7.23	12.70	18.13	0.03
SQU-US	2026-02-27 16:15:00	5.52	58.03	321.28	7.10	12.63	19.59	0.03
SQU-US	2026-02-27 16:30:00	5.47	52.30	322.33	7.14	12.59	18.11	0.02
SQU-US	2026-02-27 16:45:00	5.44	51.83	318.26	7.16	12.66	19.51	0.02
SQU-US	2026-02-27 17:00:00	5.42	51.52	317.30	7.09	12.59	18.56	0.02
SQU-US	2026-02-27 17:15:00	5.38	51.32	314.89	7.10	12.62	19.86	0.02
SQU-US	2026-02-27 17:30:00	5.33	50.53	312.25	7.14	12.64	19.84	0.02
SQU-US	2026-02-27 17:45:00	5.31	50.65	306.07	7.16	12.63	18.32	0.02
SQU-US	2026-02-27 18:00:00	5.28	50.62	305.00	7.15	12.62	19.09	0.02
SQU-US	2026-02-27 18:15:00	5.26	50.82	304.36	7.13	12.60	19.02	0.02
SQU-US	2026-02-27 18:30:00	5.23	54.38	304.93	7.16	12.60	21.96	0.02
SQU-US	2026-02-27 18:45:00	5.21	53.97	304.84	7.17	12.59	21.43	0.02
SQU-US	2026-02-27 19:00:00	5.18	54.09	307.77	7.15	12.57	21.55	0.02
SQU-US	2026-02-27 19:15:00	5.16	54.41	309.44	7.15	12.55	21.24	0.02
SQU-US	2026-02-27 19:30:00	5.15	51.02	310.62	7.13	12.53	20.28	0.02
SQU-US	2026-02-27 19:45:00	5.15	51.43	309.73	7.13	12.50	19.22	0.02
SQU-US	2026-02-27 20:00:00	5.14	51.59	310.17	7.10	12.49	20.82	0.02
SQU-US	2026-02-27 20:15:00	5.14	51.71	311.73	7.10	12.44	20.70	0.02
SQU-US	2026-02-27 20:30:00	5.14	52.51	315.05	7.07	12.37	19.55	0.02
SQU-US	2026-02-27 20:45:00	5.12	52.60	316.73	7.10	12.40	21.06	0.02
SQU-US	2026-02-27 21:00:00	5.08	52.87	317.67	7.15	12.47	21.12	0.02
SQU-US	2026-02-27 21:15:00	5.06	52.98	318.18	7.17	12.46	18.66	0.02
SQU-US	2026-02-27 21:30:00	5.06	53.12	321.14	7.14	12.46	20.07	0.02
SQU-US	2026-02-27 21:45:00	5.04	53.17	321.62	7.15	12.46	19.32	0.02
SQU-US	2026-02-27 22:00:00	5.03	53.48	324.72	7.15	12.46	20.68	0.02
SQU-US	2026-02-27 22:15:00	5.01	53.53	325.82	7.16	12.46	19.76	0.02
SQU-US	2026-02-27 22:30:00	5.01	53.97	327.67	7.16	12.46	21.98	0.02
SQU-US	2026-02-27 22:45:00	4.99	53.77	328.91	7.17	12.47	19.01	0.02
SQU-US	2026-02-27 23:00:00	4.98	53.76	329.88	7.17	12.46	19.34	0.02
SQU-US	2026-02-27 23:15:00	4.97	53.77	331.24	7.17	12.48	20.95	0.02
SQU-US	2026-02-27 23:30:00	4.96	59.59	334.45	7.13	12.47	22.92	0.03
SQU-US	2026-02-27 23:45:00	4.95	59.40	334.70	7.16	12.47	22.14	0.03
SQU-US	2026-02-28 00:00:00	4.93	59.19	336.38	7.17	12.48	21.70	0.03
SQU-US	2026-02-28 00:15:00	4.91	59.41	338.18	7.17	12.48	18.79	0.03
SQU-US	2026-02-28 00:30:00	4.89	53.98	339.49	7.18	12.48	20.46	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-28 00:45:00	4.87	53.82	339.82	7.18	12.49	18.56	0.02
SQU-US	2026-02-28 01:00:00	4.86	53.83	339.88	7.16	12.47	20.32	0.02
SQU-US	2026-02-28 01:15:00	4.85	53.77	339.80	7.16	12.47	19.17	0.02
SQU-US	2026-02-28 01:30:00	4.83	53.77	341.02	7.13	12.46	17.74	0.02
SQU-US	2026-02-28 01:45:00	4.82	53.62	335.94	7.17	12.48	19.42	0.02
SQU-US	2026-02-28 02:00:00	4.81	53.66	335.78	7.18	12.49	19.47	0.02
SQU-US	2026-02-28 02:15:00	4.80	53.38	335.69	7.18	12.47	20.64	0.02
SQU-US	2026-02-28 02:30:00	4.79	56.64	337.01	7.12	12.47	24.51	0.03
SQU-US	2026-02-28 02:45:00	4.75	55.76	335.42	7.21	12.55	23.02	0.02
SQU-US	2026-02-28 03:00:00	4.70	54.66	336.51	7.27	12.61	23.28	0.02
SQU-US	2026-02-28 03:15:00	4.67	53.78	338.09	7.29	12.65	23.03	0.02
SQU-US	2026-02-28 03:30:00	4.66	49.63	341.97	7.25	12.67	21.26	0.02
SQU-US	2026-02-28 03:45:00	4.65	49.34	340.61	7.30	12.67	20.70	0.02
SQU-US	2026-02-28 04:00:00	4.64	49.13	341.95	7.30	12.68	20.53	0.02
SQU-US	2026-02-28 04:15:00	4.64	48.98	343.49	7.30	12.67	20.57	0.02
SQU-US	2026-02-28 04:30:00	4.63	49.38	346.27	7.28	12.68	30.31	0.02
SQU-US	2026-02-28 04:45:00	4.62	49.03	346.68	7.31	12.70	20.97	0.02
SQU-US	2026-02-28 05:00:00	4.61	48.85	348.32	7.31	12.71	20.81	0.02
SQU-US	2026-02-28 05:15:00	4.60	48.62	349.85	7.31	12.72	20.30	0.02
SQU-US	2026-02-28 05:30:00	4.59	48.40	353.31	7.28	12.72	21.53	0.02
SQU-US	2026-02-28 05:45:00	4.58	48.32	351.43	7.32	12.72	19.40	0.02
SQU-US	2026-02-28 06:00:00	4.60	48.86	352.16	7.31	12.71	19.39	0.02
SQU-US	2026-02-28 06:15:00	4.62	50.27	352.65	7.30	12.68	19.45	0.02
SQU-US	2026-02-28 06:30:00	4.64	52.45	353.10	7.26	12.63	20.42	0.02
SQU-US	2026-02-28 06:45:00	4.68	54.81	349.03	7.24	12.53	20.02	0.02
SQU-US	2026-02-28 07:00:00	4.69	55.77	344.65	7.23	12.49	19.97	0.02
SQU-US	2026-02-28 07:15:00	4.69	56.81	340.91	7.24	12.50	20.16	0.03
SQU-US	2026-02-28 07:30:00	4.64	55.14	341.54	7.22	12.55	20.43	0.02
SQU-US	2026-02-28 07:45:00	4.64	55.70	338.93	7.25	12.55	20.06	0.02
SQU-US	2026-02-28 08:00:00	4.64	56.89	339.04	7.24	12.51	20.02	0.03
SQU-US	2026-02-28 08:15:00	4.63	56.54	338.24	7.24	12.51	20.37	0.03
SQU-US	2026-02-28 08:30:00	4.59	54.55	338.05	7.24	12.56	22.58	0.02
SQU-US	2026-02-28 08:45:00	4.58	53.88	336.61	7.25	12.57	21.62	0.02
SQU-US	2026-02-28 09:00:00	4.56	53.09	337.10	7.25	12.59	21.42	0.02
SQU-US	2026-02-28 09:15:00	4.55	52.49	337.66	7.25	12.62	21.09	0.02
SQU-US	2026-02-28 09:30:00	4.55	52.43	340.02	7.21	12.64	21.48	0.02
SQU-US	2026-02-28 09:45:00	4.57	51.94	337.92	7.17	12.62	21.01	0.02
SQU-US	2026-02-28 10:00:00	4.57	52.51	338.84	7.17	12.61	21.13	0.02
SQU-US	2026-02-28 10:15:00	4.58	53.27	339.98	7.16	12.61	21.64	0.02
SQU-US	2026-02-28 10:30:00	4.64	53.54	341.72	7.08	12.56	22.68	0.02
SQU-US	2026-02-28 10:45:00	4.69	53.57	342.31	7.10	12.59	22.44	0.02
SQU-US	2026-02-28 11:00:00	4.77	53.45	343.33	7.09	12.59	22.67	0.02
SQU-US	2026-02-28 11:15:00	4.83	53.44	344.23	7.10	12.63	22.14	0.02
SQU-US	2026-02-28 11:30:00	4.92	54.00	346.64	7.07	12.61	22.03	0.02
SQU-US	2026-02-28 11:45:00	5.01	54.33	344.24	7.07	12.58	23.11	0.02
SQU-US	2026-02-28 12:00:00	5.07	54.89	344.60	7.10	12.60	22.01	0.02
SQU-US	2026-02-28 12:15:00	5.12	54.42	343.27	7.15	12.67	21.18	0.02
SQU-US	2026-02-28 12:30:00	5.18	54.01	343.24	7.17	12.68	29.14	0.02
SQU-US	2026-02-28 12:45:00	5.26	53.93	343.37	7.12	12.64	20.69	0.02
SQU-US	2026-02-28 13:00:00	5.30	53.80	343.55	7.19	12.70	22.54	0.02
SQU-US	2026-02-28 13:15:00	5.35	53.12	343.10	7.25	12.76	21.77	0.02
SQU-US	2026-02-28 13:30:00	5.44	53.99	345.57	7.22	12.75	21.22	0.02
SQU-US	2026-02-28 13:45:00	5.49	53.99	344.01	7.26	12.75	20.82	0.02
SQU-US	2026-02-28 14:00:00	5.54	53.34	344.14	7.29	12.77	21.71	0.02
SQU-US	2026-02-28 14:15:00	5.59	52.59	344.00	7.31	12.79	20.92	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-02-28 14:30:00	5.67	53.61	345.19	7.28	12.78	23.94	0.02
SQU-US	2026-02-28 14:45:00	5.72	54.49	345.09	7.29	12.74	21.36	0.02
SQU-US	2026-02-28 15:00:00	5.75	55.19	345.54	7.29	12.71	20.79	0.02
SQU-US	2026-02-28 15:15:00	5.74	54.23	345.64	7.31	12.74	21.36	0.02
SQU-US	2026-02-28 15:30:00	5.77	55.26	347.96	7.27	12.72	22.34	0.02
SQU-US	2026-02-28 15:45:00	5.80	55.75	346.41	7.29	12.71	21.49	0.02
SQU-US	2026-02-28 16:00:00	5.82	57.54	347.09	7.27	12.64	22.02	0.03
SQU-US	2026-02-28 16:15:00	5.82	57.94	346.72	7.26	12.62	21.59	0.03
SQU-US	2026-02-28 16:30:00	5.82	58.73	347.63	7.23	12.59	23.11	0.03
SQU-US	2026-02-28 16:45:00	5.79	58.65	347.10	7.22	12.57	21.97	0.03
SQU-US	2026-02-28 17:00:00	5.78	58.54	347.58	7.17	12.54	21.73	0.03
SQU-US	2026-02-28 17:15:00	5.74	58.27	350.81	7.03	12.36	21.80	0.03
SQU-US	2026-02-28 17:30:00	5.64	58.09	352.21	7.10	12.43	22.10	0.03
SQU-US	2026-02-28 17:45:00	5.60	57.60	350.79	7.04	12.39	24.11	0.03
SQU-US	2026-02-28 18:00:00	5.48	56.95	351.07	7.13	12.45	24.30	0.03
SQU-US	2026-02-28 18:15:00	5.38	56.54	351.19	7.15	12.49	21.29	0.03
SQU-US	2026-02-28 18:30:00	5.30	56.62	351.86	7.14	12.48	23.75	0.03
SQU-US	2026-02-28 18:45:00	5.25	56.34	350.62	7.12	12.45	20.98	0.03
SQU-US	2026-02-28 19:00:00	5.19	56.57	350.07	7.13	12.44	20.58	0.03
SQU-US	2026-02-28 19:15:00	5.14	56.99	349.47	7.12	12.43	18.99	0.03
SQU-US	2026-02-28 19:30:00	5.09	58.56	349.86	7.12	12.41	20.95	0.03
SQU-US	2026-02-28 19:45:00	5.05	59.03	348.43	7.13	12.38	20.90	0.03
SQU-US	2026-02-28 20:00:00	5.01	59.27	347.50	7.16	12.37	19.85	0.03
SQU-US	2026-02-28 20:15:00	4.98	59.61	347.41	7.15	12.36	23.00	0.03
SQU-US	2026-02-28 20:30:00	4.96	58.14	346.34	7.16	12.36	23.42	0.03
SQU-US	2026-02-28 20:45:00	4.93	58.37	346.02	7.15	12.34	24.03	0.03
SQU-US	2026-02-28 21:00:00	4.92	58.85	345.53	7.14	12.32	24.24	0.03
SQU-US	2026-02-28 21:15:00	4.90	59.22	342.36	7.16	12.30	21.38	0.03
SQU-US	2026-02-28 21:30:00	4.87	58.91	341.79	7.13	12.32	23.03	0.03
SQU-US	2026-02-28 21:45:00	4.87	58.97	338.75	7.14	12.29	22.99	0.03
SQU-US	2026-02-28 22:00:00	4.84	59.36	336.95	7.15	12.28	22.22	0.03
SQU-US	2026-02-28 22:15:00	4.82	59.06	335.23	7.14	12.30	21.97	0.03
SQU-US	2026-02-28 22:30:00	4.81	59.37	334.15	7.15	12.28	23.17	0.03
SQU-US	2026-02-28 22:45:00	4.80	59.79	333.51	7.14	12.29	22.65	0.03
SQU-US	2026-02-28 23:00:00	4.78	60.80	332.38	7.14	12.28	19.05	0.03
SQU-US	2026-02-28 23:15:00	4.76	59.91	331.64	7.13	12.29	28.93	0.03
SQU-US	2026-02-28 23:30:00	4.76	65.48	335.47	7.06	12.26	13.70	0.03
SQU-US	2026-02-28 23:45:00	4.76	65.69	330.63	7.12	12.27	14.45	0.03
SQU-US	2026-03-01 00:00:00	4.73	64.42	329.68	7.14	12.29	32.20	0.03
SQU-US	2026-03-01 00:15:00	4.72	65.69	329.00	7.13	12.29	27.63	0.03
SQU-US	2026-03-01 00:30:00	4.69	58.11	323.69	7.13	12.29	13.79	0.03
SQU-US	2026-03-01 00:45:00	4.66	50.49	293.47	7.11	12.29	23.46	0.02
SQU-US	2026-03-01 01:00:00	4.63	59.16	287.63	7.12	12.30	9.97	0.03
SQU-US	2026-03-01 01:15:00	4.63	59.01	290.37	7.09	12.29	8.37	0.03
SQU-US	2026-03-01 01:30:00	4.60	52.24	297.02	7.08	12.31	16.03	0.02
SQU-US	2026-03-01 01:45:00	4.58	47.94	297.22	7.10	12.32	15.15	0.02
SQU-US	2026-03-01 02:00:00	4.54	38.18	300.46	7.12	12.33	20.79	0.02
SQU-US	2026-03-01 02:15:00	4.52	52.54	304.00	7.11	12.33	6.91	0.02
SQU-US	2026-03-01 02:30:00	4.50	57.17	308.59	7.08	12.34	29.81	0.03
SQU-US	2026-03-01 02:45:00	4.49	59.94	309.23	7.13	12.34	9.76	0.03
SQU-US	2026-03-01 03:00:00	4.47	59.80	310.35	7.18	12.37	11.27	0.03
SQU-US	2026-03-01 03:15:00	4.45	59.16	314.77	7.17	12.38	11.89	0.03
SQU-US	2026-03-01 03:30:00	4.42	55.90	320.09	7.15	12.42	12.26	0.02
SQU-US	2026-03-01 03:45:00	4.34	54.85	319.44	7.22	12.48	12.28	0.02
SQU-US	2026-03-01 04:00:00	4.31	53.79	322.48	7.27	12.54	13.86	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-01 04:15:00	4.28	53.35	326.82	7.27	12.57	12.07	0.02
SQU-US	2026-03-01 04:30:00	4.27	53.45	331.44	7.26	12.59	12.28	0.02
SQU-US	2026-03-01 04:45:00	4.24	53.16	333.92	7.28	12.59	12.00	0.02
SQU-US	2026-03-01 05:00:00	4.20	52.93	336.69	7.29	12.61	11.89	0.02
SQU-US	2026-03-01 05:15:00	4.16	52.70	339.47	7.29	12.63	12.31	0.02
SQU-US	2026-03-01 05:30:00	4.14	52.47	344.21	7.25	12.63	11.80	0.02
SQU-US	2026-03-01 05:45:00	4.12	52.16	343.95	7.30	12.67	12.52	0.02
SQU-US	2026-03-01 06:00:00	4.06	51.79	345.81	7.31	12.70	11.76	0.02
SQU-US	2026-03-01 06:15:00	4.00	51.60	347.65	7.31	12.72	11.77	0.02
SQU-US	2026-03-01 06:30:00	3.97	51.97	350.35	7.30	12.73	12.27	0.02
SQU-US	2026-03-01 06:45:00	3.95	52.59	350.63	7.30	12.73	11.46	0.02
SQU-US	2026-03-01 07:00:00	3.93	53.96	350.45	7.28	12.68	11.35	0.02
SQU-US	2026-03-01 07:15:00	3.96	56.51	349.64	7.26	12.61	11.70	0.02
SQU-US	2026-03-01 07:30:00	3.94	58.06	350.51	7.22	12.60	11.30	0.03
SQU-US	2026-03-01 07:45:00	3.95	59.01	348.02	7.26	12.58	11.11	0.03
SQU-US	2026-03-01 08:00:00	3.92	58.61	347.58	7.26	12.58	11.10	0.03
SQU-US	2026-03-01 08:15:00	3.93	59.18	347.34	7.25	12.57	10.63	0.03
SQU-US	2026-03-01 08:30:00	3.92	60.33	347.44	7.24	12.54	15.82	0.03
SQU-US	2026-03-01 08:45:00	3.93	60.95	345.59	7.24	12.50	11.29	0.03
SQU-US	2026-03-01 09:00:00	3.94	60.59	346.97	7.20	12.52	9.89	0.03
SQU-US	2026-03-01 09:15:00	3.93	59.12	344.64	7.23	12.56	15.37	0.03
SQU-US	2026-03-01 09:30:00	3.95	57.46	346.37	7.15	12.56	12.56	0.03
SQU-US	2026-03-01 09:45:00	4.00	57.42	341.29	7.18	12.57	10.89	0.03
SQU-US	2026-03-01 10:00:00	4.09	58.13	340.81	7.14	12.50	9.26	0.03
SQU-US	2026-03-01 10:15:00	4.12	58.20	340.73	7.15	12.51	9.27	0.03
SQU-US	2026-03-01 10:30:00	4.18	58.09	340.88	7.15	12.56	11.01	0.03
SQU-US	2026-03-01 10:45:00	4.26	58.47	340.36	7.11	12.53	9.55	0.03
SQU-US	2026-03-01 11:00:00	4.35	58.90	341.95	7.12	12.54	10.27	0.03
SQU-US	2026-03-01 11:15:00	4.43	59.53	340.85	7.16	12.59	14.86	0.03
SQU-US	2026-03-01 11:30:00	4.55	59.97	341.14	7.13	12.59	12.81	0.03
SQU-US	2026-03-01 11:45:00	4.64	60.12	338.42	7.15	12.58	12.62	0.03
SQU-US	2026-03-01 12:00:00	4.74	57.63	336.13	7.16	12.60	16.02	0.03
SQU-US	2026-03-01 12:15:00	4.85	57.84	334.43	7.17	12.60	14.38	0.03
SQU-US	2026-03-01 12:30:00	4.96	60.29	335.56	7.16	12.58	21.49	0.03
SQU-US	2026-03-01 12:45:00	5.06	60.04	335.64	7.15	12.56	13.59	0.03
SQU-US	2026-03-01 13:00:00	5.16	59.60	337.68	7.14	12.56	13.23	0.03
SQU-US	2026-03-01 13:15:00	5.24	59.52	339.01	7.18	12.59	17.01	0.03
SQU-US	2026-03-01 13:30:00	5.35	62.12	342.31	7.14	12.55	17.02	0.03
SQU-US	2026-03-01 13:45:00	5.43	61.72	342.10	7.15	12.53	17.28	0.03
SQU-US	2026-03-01 14:00:00	5.49	61.48	343.65	7.17	12.54	17.41	0.03
SQU-US	2026-03-01 14:15:00	5.55	60.81	344.76	7.17	12.54	18.24	0.03
SQU-US	2026-03-01 14:30:00	5.58	57.60	345.28	7.20	12.57	17.42	0.03
SQU-US	2026-03-01 14:45:00	5.62	56.89	345.78	7.24	12.61	17.01	0.03
SQU-US	2026-03-01 15:00:00	5.66	56.26	346.25	7.28	12.63	18.20	0.03
SQU-US	2026-03-01 15:15:00	5.69	55.95	346.90	7.30	12.66	17.38	0.02
SQU-US	2026-03-01 15:30:00	5.74	56.12	349.33	7.27	12.67	18.31	0.02
SQU-US	2026-03-01 15:45:00	5.75	56.00	348.02	7.31	12.67	17.65	0.02
SQU-US	2026-03-01 16:00:00	5.76	55.74	348.93	7.32	12.68	17.49	0.02
SQU-US	2026-03-01 16:15:00	5.78	55.99	349.84	7.32	12.66	17.03	0.02
SQU-US	2026-03-01 16:30:00	5.80	57.00	352.36	7.30	12.65	19.30	0.03
SQU-US	2026-03-01 16:45:00	5.79	57.84	351.07	7.30	12.63	17.27	0.03
SQU-US	2026-03-01 17:00:00	5.76	59.09	351.36	7.29	12.59	17.30	0.03
SQU-US	2026-03-01 17:15:00	5.74	61.74	351.82	7.26	12.53	17.47	0.03
SQU-US	2026-03-01 17:30:00	5.70	65.10	354.19	7.21	12.43	18.02	0.03
SQU-US	2026-03-01 17:45:00	5.63	66.11	352.37	7.21	12.37	13.18	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-01 18:00:00	5.56	67.17	352.34	7.18	12.33	17.83	0.03
SQU-US	2026-03-01 18:15:00	5.47	67.30	354.11	7.13	12.22	17.34	0.03
SQU-US	2026-03-01 18:30:00	5.38	67.31	355.92	7.06	12.18	19.42	0.03
SQU-US	2026-03-01 18:45:00	5.25	66.02	354.64	7.09	12.18	17.57	0.03
SQU-US	2026-03-01 19:00:00	5.13	64.38	354.58	7.09	12.20	13.17	0.03
SQU-US	2026-03-01 19:15:00	5.02	63.59	353.13	7.13	12.27	17.10	0.03
SQU-US	2026-03-01 19:30:00	5.04	3.83	352.71	7.09	12.18	8.92	0.00
SQU-US	2026-03-01 19:45:00	5.10	0.09	349.24	7.14	12.66	9.65	0.00
SQU-US	2026-03-01 20:00:00	5.08	0.09	346.20	7.23	12.79	9.47	0.00
SQU-US	2026-03-01 20:15:00	5.12	0.09	344.26	7.29	12.83	9.24	0.00
SQU-US	2026-03-01 20:30:00	5.12	0.09	357.37	7.16	12.83	9.76	0.00
SQU-US	2026-03-01 20:45:00	5.01	0.09	358.06	7.20	12.87	9.34	0.00
SQU-US	2026-03-01 21:00:00	4.97	0.09	354.10	7.12	12.88	9.78	0.00
SQU-US	2026-03-01 21:15:00	4.91	0.09	351.72	7.06	12.89	9.69	0.00
SQU-US	2026-03-01 21:30:00	4.89	0.09	355.58	7.17	12.94	9.84	0.00
SQU-US	2026-03-01 21:45:00	4.81	0.09	348.53	7.29	12.99	9.49	0.00
SQU-US	2026-03-01 22:00:00	4.79	0.09	349.35	7.31	13.00	9.48	0.00
SQU-US	2026-03-01 22:15:00	4.76	0.09	350.23	7.30	13.00	9.37	0.00
SQU-US	2026-03-01 22:30:00	4.78	0.09	360.62	7.16	12.98	10.03	0.00
SQU-US	2026-03-01 22:45:00	4.63	0.09	362.01	7.28	13.04	9.53	0.00
SQU-US	2026-03-01 23:00:00	4.59	0.09	361.83	7.29	13.08	9.40	0.00
SQU-US	2026-03-01 23:15:00	4.57	0.09	359.13	7.23	13.08	9.46	0.00
SQU-US	2026-03-01 23:30:00	4.61	0.09	365.05	7.25	13.05	9.42	0.00
SQU-US	2026-03-01 23:45:00	4.56	0.00	360.27	7.28	13.07	9.40	0.00

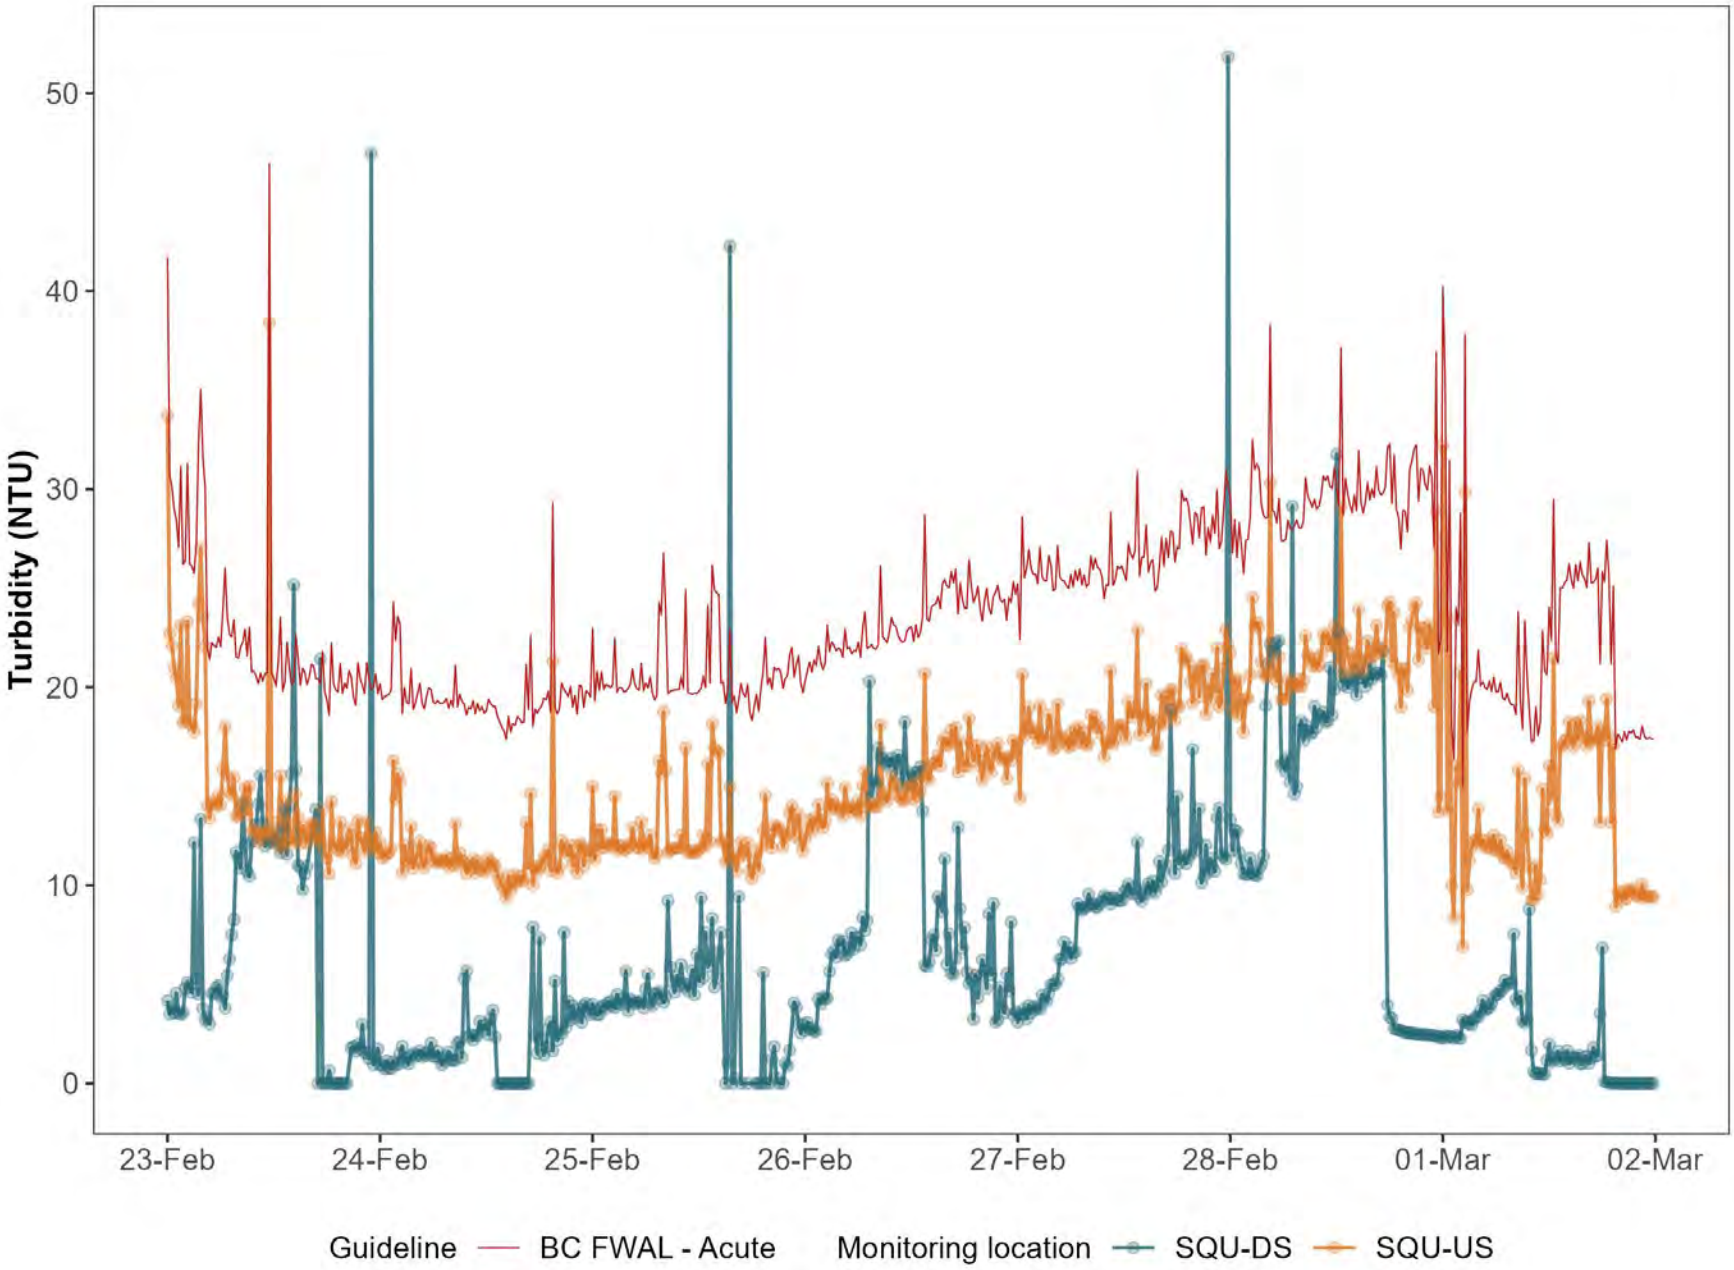
Turbidity (NTU)
50
40
30
20
10
0
23-Feb
24-Feb
25-Feb
26-Feb
27-Feb
28-Feb
01-Mar
02-Mar
Guideline
BC FWAL - Acute
Monitoring location
SQU-DS
SQU-US

Appendix C:
Woodfibre Site Point of Discharge from Water Treatment Plant Documentation

Woodfibre Site Sample Analysis

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
In situ Parameters								
Field pH	pH Units		6.5 - 9			7 - 8.7		7
Field Temperature	°C	18	19					10.2
General Parameters								
pH	pH Units							7.24
Alkalinity (Total as $CaCO_3$)	mg/L							62
Alkalinity (PP as $CaCO_3$)	mg/L							<1
Hardness ($CaCO_3$)-Total	mg/L							103
Hardness ($CaCO_3$)-Dissolved	mg/L							106
Sulphide-Total	mg/L							<0.0018
Sulphide (as H_2S)	mg/L			0.002				<0.002
Un-ionized Hydrogen Sulfide as H_2S-Total	mg/L							<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018
Anions and Nutrients								
Ammonia (N)-Total	mg/L	1.83	20.3		20	131		<0.015
Bicarbonate (HCO_3)	mg/L							76
Carbonate (CO_3)	mg/L							<1
Hydroxide (OH)	mg/L							<1
Nitrate (N)	mg/L	3	32.8		3.7			0.075
Nitrite (N)	mg/L	0.2	0.6					0.0314
Nitrate plus Nitrite (N)	mg/L							0.107
Nitrogen (N)-Total	mg/L							0.306
Phosphorus (P)-Total (4500-P)	mg/L							0.0035
Bromide (Br)	mg/L							<0.01
Chloride (Cl)	mg/L	150	600					18
Fluoride (F)	mg/L		1.345983			1.5		0.35
Sulphate (SO_4)-Dissolved	mg/L	309						17

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
Total Metals								
Aluminum (Al)-Total	mg/L	0.3385094						**2.85**
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000184
Arsenic (As)-Total	mg/L	0.005			0.0125			0.00147
Barium (Ba)-Total	mg/L			1				0.0121
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001
Bismuth (Bi)-Total	mg/L							<0.000005
Boron (B)-Total	mg/L	1.2			1.2			0.011
Cadmium (Cd)-Total	mg/L						0.00012	0.0000107
Calcium (Ca)-Total	mg/L							39.1
Cesium (Cs)-Total	mg/L							0.000118
Chromium (Cr)-Total	mg/L							0.00415
Chromium (Cr III)-Total	mg/L			0.0089			0.056	0.0042
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099
Cobalt (Co)-Total	mg/L							0.000103
Copper (Cu)-Total	mg/L				0.002	0.003		0.00132
Iron (Fe)-Total	mg/L		1					0.306
Lead (Pb)-Total	mg/L				0.002	0.14		0.0000644
Lithium (Li)-Total	mg/L							0.00347
Magnesium (Mg)-Total	mg/L							1.39
Manganese (Mn)-Total	mg/L	1.0582	1.67506				0.1	0.0355
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.0303
Nickel (Ni)-Total	mg/L						0.0083	0.000694
Phosphorus (P)-Total (ICPMS)	mg/L							0.0052
Potassium (K)-Total	mg/L							1.67
Rubidium (Rb)-Total	mg/L							0.00417
Selenium (Se)-Total	mg/L	0.002			0.002			0.000049
Silicon (Si)-Total	mg/L							9.67
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.000005
Sodium (Na)-Total	mg/L							7.05
Strontium (Sr)-Total	mg/L							0.0711
Sulphur (S)-Total	mg/L							5.5
Tellurium (Te)-Total	mg/L							<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000053
Thorium (Th)-Total	mg/L							<0.00005

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
Total Metals (cont'd.)								
Tin (Sn)-Total	mg/L							<0.0002
Titanium (Ti)-Total	mg/L							0.00396
Uranium (U)-Total	mg/L		0.0165	0.0075				0.00313
Vanadium (V)-Total	mg/L			0.06			0.005	0.00196
Zinc (Zn)-Total	mg/L				0.01	0.055		0.00705
Zirconium (Zr)-Total	mg/L							0.00011
Dissolved Metals								
Aluminum (Al)-Dissolved	mg/L							2.64
Antimony (Sb)-Dissolved	mg/L							0.000189
Arsenic (As)-Dissolved	mg/L							0.00149
Barium (Ba)-Dissolved	mg/L							0.0119
Beryllium (Be)-Dissolved	mg/L							<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005
Boron (B)-Dissolved	mg/L							0.013
Cadmium (Cd)-Dissolved	mg/L	0.0002161	0.0006064					0.0000155
Calcium (Ca)-Dissolved	mg/L							40
Cesium (Cs)-Dissolved	mg/L							0.00011
Chromium (Cr)-Dissolved	mg/L							0.00384
Cobalt (Co)-Dissolved	mg/L	0.0005161						0.0000804
Copper (Cu)-Dissolved	mg/L	0.00358	0.02201					0.000793
Iron (Fe)-Dissolved	mg/L		0.35					0.155
Lead (Pb)-Dissolved	mg/L	0.010205						0.0000241
Lithium (Li)-Dissolved	mg/L							0.00367
Manganese (Mn)-Dissolved	mg/L							0.0328
Magnesium (Mg)-Dissolved	mg/L							1.53
Mercury (Hg)-Dissolved	mg/L							<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.0311
Nickel (Ni)-Dissolved	mg/L	0.0039	0.067					0.0006
Phosphorus (P)-Dissolved	mg/L							0.0049
Potassium (K)-Dissolved	mg/L							1.76
Rubidium (Rb)-Dissolved	mg/L							0.00435
Selenium (Se)-Dissolved	mg/L							0.000046
Silicon (Si)-Dissolved	mg/L							9.57
Silver (Ag)-Dissolved	mg/L							<0.000005
Sodium (Na)-Dissolved	mg/L							7.57

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
Dissolved Metals (cont'd.)								
Strontium (Sr)-Dissolved	mg/L			1.25				0.0698
Sulphur (S)-Dissolved	mg/L							5.4
Tellurium (Te)-Dissolved	mg/L							<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000055
Thorium (Th)-Dissolved	mg/L							0.0000093
Tin (Sn)-Dissolved	mg/L							<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005
Uranium (U)-Dissolved	mg/L							0.00314
Vanadium (V)-Dissolved	mg/L							0.00171
Zinc (Zn)-Dissolved	mg/L	0.0468137	0.0796587					0.00517
Zirconium (Zr)-Dissolved	mg/L							<0.0001
Inorganics								
Organic Carbon (C)-Total	mg/L							24
Organic Carbon (C)-Dissolved	mg/L							22
Solids-Total Dissolved	mg/L							190
Solids-Total Suspended	mg/L	6	26					**7.2**
Organics								
HEPH (C19-C32 less PAH)	mg/L							<0.2
LEPH (C10-C19 less PAH)	mg/L							<0.2
EPH (C10-C19)	mg/L							<0.2
EPH (C19-C32)	mg/L							<0.2
Ethylene Glycol	mg/L							<3
Diethylene Glycol	mg/L							<5
Triethylene Glycol	mg/L							<5
Propylene Glycol	mg/L							<5
Acenaphthene	mg/L	0.006		0.006				<0.00005
Acenaphthylene	mg/L							<0.00005
Acridine	mg/L	0.003						<0.00005
Anthracene	mg/L	0.004						<0.00001
Benzo(a)anthracene	mg/L	0.0001						<0.00001
Benzo(a)pyrene	mg/L	0.00001		0.00001				<0.000005
Benzo(b&j)fluoranthene	mg/L							<0.00003
Benzo(g,h,i)perylene	mg/L							<0.00005
Benzo(k)fluoranthene	mg/L							<0.00005
Chrysene	mg/L			0.0001				<0.00002

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
Organics (cont'd.)								
Dibenz(a,h)anthracene	mg/L							<0.000003
Fluoranthene	mg/L	0.004						<0.00002
Fluorene	mg/L	0.012			0.012			<0.00005
Indeno(1,2,3-cd)pyrene	mg/L							<0.00005
1-Methylnaphthalene	mg/L				0.001			<0.00005
2-Methylnaphthalene	mg/L				0.001			<0.0001
Naphthalene	mg/L	0.001	0.001		0.001			<0.0001
Phenanthrene	mg/L	0.0003						<0.00005
Pyrene	mg/L							<0.00002
Quinoline	mg/L							<0.00002
Low Molecular Weight PAH`s	mg/L							<0.0001
High Molecular Weight PAH`s	mg/L							<0.00005
Total PAH	mg/L							<0.0001
VH C6-C10	mg/L							<0.3
1,1,1,2-Tetrachloroethane	mg/L							<0.0005
1,1,1-Trichloroethane	mg/L							<0.0005
1,1,2,2-Tetrachloroethane	mg/L							<0.0005
1,1,2Trichloro-1,2,2Trifluoroethane	mg/L							<0.002
1,1,2-Trichloroethane	mg/L							<0.0005
1,1-Dichloroethane	mg/L							<0.0005
1,1-Dichloroethene	mg/L							<0.0005
1,2,3-trichlorobenzene	mg/L			0.008				<0.002
1,2,4-trichlorobenzene	mg/L			0.024			0.0054	<0.002
1,2-dibromoethane	mg/L							<0.0002
1,2-Dichlorobenzene	mg/L			0.0007			0.042	<0.0005
1,2-Dichloroethane	mg/L			0.1				<0.0005
1,2-Dichloropropane	mg/L							<0.0005
1,3,5-trimethylbenzene	mg/L							<0.002
1,3-Butadiene	mg/L							<0.0005
1,3-Dichlorobenzene	mg/L			0.15				<0.0005
1,3-dichloropropane	mg/L							<0.001
1,4-Dichlorobenzene	mg/L			0.026				<0.0005
Benzene	mg/L	0.04			0.11			<0.0004
Bromobenzene	mg/L							<0.002
Bromodichloromethane	mg/L							<0.001

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG EOP 2026-02-24 10:00:00**
Organics (cont'd.)								
Bromoform	mg/L							<0.001
Bromomethane	mg/L							<0.001
Carbon tetrachloride	mg/L							<0.0005
Chlorobenzene	mg/L			0.0013			0.025	<0.0005
Chloroethane	mg/L							<0.001
Chloroform	mg/L							<0.001
Chloromethane	mg/L							<0.001
cis-1,2-Dichloroethene	mg/L							<0.001
cis-1,3-Dichloropropene	mg/L							<0.001
Dibromochloromethane	mg/L							<0.001
Dichlorodifluoromethane	mg/L							<0.002
Dichloromethane	mg/L			0.0981				<0.002
Ethylbenzene	mg/L	0.2			0.25			<0.0004
Hexachlorobutadiene	mg/L							<0.0005
Isopropylbenzene	mg/L							<0.002
Methyl-tert-butylether (MTBE)	mg/L		3.4			0.44		<0.004
Styrene	mg/L			0.072				<0.0005
Tetrachloroethene	mg/L							<0.0005
Toluene	mg/L	0.0005						<0.0004
trans-1,2-dichloroethene	mg/L							<0.001
trans-1,3-dichloropropene	mg/L							<0.001
Trichloroethene	mg/L							<0.0005
Trichlorofluoromethane	mg/L							<0.004
Vinyl chloride	mg/L							<0.0005
VPH (VH6 to 10 - BTEX)	mg/L							<0.3
Xylenes (Total)	mg/L	0.03						<0.0004
m & p-Xylene	mg/L							<0.0004
o-Xylene	mg/L							<0.0004
Phenols	mg/L			0.05				<0.0015
Rainbow Trout								
LC50	% vol/vol							>100%

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Water Quality Field Data Sheet

Project: FORTIS11234

Location Information

Site ID:	WLNG EOP	**Date:**	February 24, 2026
Site Name:	East Creek	**Time:**	10:00
Crew:	HM		
Weather:	Clear/sun		

In Situ Parameters

pH:	7		DO:	11.71	(mg/L)
Temp:	10.2	(°C)	Cond:	228.9	(us/cm)
Turbidity:	9.14	NTU	Salinity:	0.11	(ppt)
			ORP:	68.9	(mV)

Visible Sheen: N

Water Surface Condition: Clear

Photo Record

Observations

Duplicate collected

Woodfibre Site WTP Discharge Field Notes and Logs

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Table of Contents:

1. Executive Summary and Notes
2. Discharge Parameter Summary
3. WTP Calibration Log

Appendices:

Appendix A- WTP Data Log
Appendix B- YSI Data Log
Appendix C- Photos

1. Executive Summary and Field Notes:

Parameters, including temperature, NTU, pH, DO, salinity, conductivity, and oxidation-reduction potential (ORP), were monitored throughout the discharge process and remained within prescribed limits.

On Feb 23rd there was a misreading recorded at 23:45 from water siphoning through the NTU probe slip stream while not discharging. Another misreading was recorded on Feb 25th at 01:15. On Feb 26th there were some elevated NTU values recorded mainly between 10:30 and 22:45. There were some lower NTU values also recorded during this duration. The PLC probe seemed to be reading the lower NTU values correctly but once values were at ~25 NTU and higher the PLC probe seemed to be artificially reading higher NTU values based on comparisons to both the Hanna NTU meter and the YSI. For example, the PLC reading on Feb 26th at 11:00 was 31.6 NTU. The same water was tested with the Hanna NTU meter and was 18.7 NTU at 11:00. The PLC probe was calibrated on Feb 26th at 22:50. On Feb 27th there were a few elevated NTU readings recorded at ~ 11:00. The PLC recorded 25.3 NTU at 11:00. The same water was tested with the Hanna NTU meter and was 14.1 NTU. The NTU probe required calibration again on March 1st at 08:00.

No visible sheen was observed on the surface of the WTP tanks or in the discharged water. All relevant parameters were measured using YSI instruments and WTP probes. There were no in-situ readings taken on Feb 26th or March 1st since the YSI meter was used in the tunnel at the TBM dewatering box to monitor pH during citric acid injection since the Hanna meter at this location was damaged. A second YSI was delivered to WF on March 3rd and another Hanna pH meter and spare probes were ordered.

The total discharge volume up to March 1st was 1,172,038 m^3.

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Daily Volume Summary:

Table 1: Discharge Volumes Daily Summary

Date	Location	Volume (m3)	Comments
February 23	Woodfibre (WF)	2,978	Exceeded discharge volume limit
February 24	WF	2,828	Exceeded discharge volume limit
February 25	WF	2,842	Exceeded discharge volume limit
February 26	WF	2,801	Exceeded discharge volume limit
February 27	WF	2,841	Exceeded discharge volume limit
February 28	WF	2,901	Exceeded discharge volume limit
March 01	WF	2,844	Exceeded discharge volume limit
	Total	20,035	None

1. **Discharge Parameter Summary:**

Table 2: Discharge Parameter Summary

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/23/2026	0:00:00	7.2	0.3406869	0	1147239.988	12.5	374
2/23/2026	0:15:00	7.1	2.30531469	11.6	1147277.032	11.6	394
2/23/2026	0:30:00	7.2	3.35008785	0	1147305.502	11.5	393
2/23/2026	0:45:00	7.2	3.35387326	0	1147342.527	11.7	392
2/23/2026	1:00:00	7.2	0.67380298	3.6	1147389.099	11.5	351
2/23/2026	1:15:00	7.1	3.36144408	0	1147432.851	11.4	387
2/23/2026	1:30:00	7.1	3.36144408	0	1147478.416	11.4	390
2/23/2026	1:45:00	7.2	3.35008785	0	1147528.837	11.4	390
2/23/2026	2:00:00	7.2	2.29774387	5.2	1147572.544	11.4	394
2/23/2026	2:15:00	7.2	0.59430937	2.7	1147614.638	11.5	351
2/23/2026	2:30:00	7.3	3.32737539	0	1147652.844	11.5	382
2/23/2026	2:45:00	7.3	3.35008785	0	1147682.173	11.8	375

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/23/2026	3:00:00	7.3	3.32737539	0.8	1147732.368	11.6	375
2/23/2026	3:15:00	7.2	3.2933067	0.4	1147782.104	11.6	379
2/23/2026	3:30:00	7.3	3.3311608	0	1147814.893	11.8	370
2/23/2026	3:45:00	7.2	3.29709211	1.9	1147864.626	11.6	371
2/23/2026	4:00:00	7.2	0.40125346	3.3	1147901.704	12	339
2/23/2026	4:15:00	7.2	0.62837806	0	1147938.29	11.4	333
2/23/2026	4:30:00	7.2	3.32737539	3.9	1147968.888	11.3	370
2/23/2026	4:45:00	7.1	3.33494621	0	1148013.767	11.3	374
2/23/2026	5:00:00	7.1	0.59809478	4.9	1148032.07	12.7	334
2/23/2026	5:15:00	7.1	3.36144408	0	1148073.096	11.4	364
2/23/2026	5:30:00	7.2	3.35765867	0	1148118.737	11.4	368
2/23/2026	5:45:00	7.2	3.34251703	4.4	1148164.684	11.4	372
2/23/2026	6:00:00	7.1	2.39237912	5.5	1148212.21	11.4	373
2/23/2026	6:15:00	7.2	3.35008785	0	1148239.866	11.7	367
2/23/2026	6:30:00	7.1	0.54888445	5.9	1148283.936	11.7	331
2/23/2026	6:45:00	7.2	3.33873162	0	1148313.64	11.5	365
2/23/2026	7:00:00	7.2	2.55136634	1.8	1148363.395	11.4	370
2/23/2026	7:15:00	7.2	2.34316879	5.9	1148397.055	11.3	355
2/23/2026	7:30:00	7.2	3.34251703	3.9	1148439.918	11.2	362
2/23/2026	7:45:00	7.2	3.34630244	2.2	1148474.164	11.6	354
2/23/2026	8:00:00	7.2	1.97976943	1.4	1148514.191	11.1	355
2/23/2026	8:15:00	7.1	3.20624227	3.4	1148559.942	11.1	359
2/23/2026	8:30:00	7.1	0.3028328	18.6	1148593.794	11.3	333
2/23/2026	8:45:00	7.1	2.29017305	3.7	1148625.974	11	354
2/23/2026	9:00:00	7.1	3.21002768	2.8	1148673.818	11	356
2/23/2026	9:15:00	7.1	0.65487593	3.3	1148721.056	11.1	357
2/23/2026	9:30:00	7.1	1.7412886	2.2	1148751.339	11.2	348
2/23/2026	9:45:00	7.1	3.24788178	6.1	1148796.39	11.2	349
2/23/2026	10:00:00	7.3	2.22582108	9.1	1148842.155	11.3	355
2/23/2026	10:15:00	7.5	3.23652555	6.3	1148888.333	11.3	354
2/23/2026	10:30:00	7.5	3.25923801	3.6	1148920.498	11.3	354
2/23/2026	10:45:00	7.5	0.71544249	4.6	1148961.437	11.3	359
2/23/2026	11:00:00	7.6	3.38037113	2.6	1148996.967	11.4	356
2/23/2026	11:15:00	7.6	3.36522949	4	1149043.327	11.4	358

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/23/2026	11:30:00	7.4	3.35765867	4	1149088.839	11.5	359
2/23/2026	11:45:00	7.3	0.40503887	21.2	1149132.065	11.6	330
2/23/2026	12:00:00	7.4	2.33181256	3.2	1149167.231	11.5	361
2/23/2026	12:15:00	7.2	3.35765867	3.2	1149215.783	11.5	364
2/23/2026	12:30:00	7.1	0.60945101	4.9	1149262.612	11.5	335
2/23/2026	12:45:00	7.1	3.30466293	2.8	1149289.606	11.4	359
2/23/2026	13:00:00	7.1	3.29709211	6.9	1149339.289	11.4	363
2/23/2026	13:15:00	7.1	0.47317625	23.8	1149369.334	12	334
2/23/2026	13:30:00	7.1	3.2933067	5.7	1149405.189	11.5	358
2/23/2026	13:45:00	7.2	3.31223375	5.5	1149439.739	11.4	356
2/23/2026	14:00:00	7.2	2.31288551	5.5	1149486.133	11.5	359
2/23/2026	14:15:00	7.2	3.31980457	0	1149511.518	11.6	354
2/23/2026	14:30:00	7.2	3.2933067	8.9	1149561.254	11.6	358
2/23/2026	15:00:00	7.5	2.29017305	12.1	1149632.961	11.7	369
2/23/2026	15:15:00	7.6	3.28952129	0	1149681.452	11.7	374
2/23/2026	15:30:00	7.6	3.30087752	0	1149711.001	11.8	382
2/23/2026	15:45:00	7.6	2.36209584	5.7	1149759.583	11.8	384
2/23/2026	16:00:00	7.5	2.31288551	0	1149785.336	11.8	384
2/23/2026	16:15:00	7.4	3.3311608	0	1149816.27	12.4	382
2/23/2026	16:30:00	7.3	3.29709211	0	1149866.01	11.7	382
2/23/2026	16:45:00	7.2	3.32358998	0	1149893.144	12	382
2/23/2026	17:00:00	7.3	3.31980457	0	1149933.667	11.7	385
2/23/2026	17:15:00	7.3	0.35961395	0	1149962.534	12.3	346
2/23/2026	17:30:00	7.3	0.51860117	0	1149998.67	11.5	348
2/23/2026	17:45:00	7.2	3.31223375	0	1150034.741	11.5	387
2/23/2026	18:15:00	7.2	3.31223375	0	1150100.123	11.4	391
2/23/2026	18:30:00	7.2	0.47696166	0	1150145.525	11.3	354
2/23/2026	18:45:00	7.2	3.31223375	0	1150177.057	11.2	390
2/23/2026	19:00:00	7.2	0.40125346	0	1150209.778	11.4	350
2/23/2026	19:15:00	7.2	3.30466293	0	1150255.355	11.2	391
2/23/2026	19:30:00	7.1	3.31980457	0	1150278.851	11.3	395
2/23/2026	19:45:00	7.1	3.29709211	0	1150324.423	11.2	395
2/23/2026	20:00:00	7.1	2.69521192	0	1150354.529	11.2	393
2/23/2026	20:15:00	7.1	3.29709211	0	1150403.005	11.1	395

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/23/2026	20:30:00	7.1	3.24409637	4.2	1150433.61	11.3	390
2/23/2026	20:45:00	7.1	2.9147657	0	1150477.127	11.2	386
2/23/2026	21:00:00	7.1	3.2933067	0	1150508.33	11.2	382
2/23/2026	21:15:00	7.2	0.36718477	0	1150527.166	11.5	343
2/23/2026	21:30:00	7.2	3.28573588	0	1150569.566	11.4	374
2/23/2026	22:00:00	7.2	1.93434451	0	1150604.105	11.7	372
2/23/2026	22:15:00	7.2	3.2933067	0	1150649.545	11.8	372
2/23/2026	22:30:00	7.2	3.30844834	0	1150681.955	11.9	367
2/23/2026	22:45:00	7.3	3.28952129	0	1150726.691	12	370
2/23/2026	23:00:00	7.3	3.31601916	0	1150760.238	12	369
2/23/2026	23:15:00	7.4	3.28952129	2	1150809.963	12	367
2/23/2026	23:30:00	7.4	0.56024068	0	1150839.394	12.9	338
2/23/2026	23:45:00	7.5	0.38989723	114.1	1150876.715	12.3	339
2/24/2026	0:00:00	7.4	2.31667092	0	1150907.963	12.3	377
2/24/2026	0:15:00	7.2	0.38232641	0	1150949.508	12.4	343
2/24/2026	0:30:00	6.9	3.30087752	0	1150985.019	12.2	380
2/24/2026	0:45:00	6.6	3.28195047	0	1151028.494	12.2	385
2/24/2026	1:00:00	6.7	3.30844834	0	1151059.523	12.3	387
2/24/2026	1:15:00	6.7	0.31040362	0	1151094.338	12.8	361
2/24/2026	1:30:00	6.8	3.2933067	2	1151129.875	12.3	386
2/24/2026	1:45:00	6.7	2.41509158	1.8	1151177.715	12.3	389
2/24/2026	2:00:00	6.8	2.34316879	0	1151204.955	12.5	389
2/24/2026	2:15:00	7	0.38611182	2.3	1151240.084	12.9	361
2/24/2026	2:30:00	7.2	3.31980457	16.2	1151268.921	12.2	394
2/24/2026	2:45:00	7.3	2.31288551	0.8	1151308.017	12.2	402
2/24/2026	3:00:00	7.3	3.3690149	0	1151338.981	12.3	399
2/24/2026	3:15:00	7.3	3.36522949	0	1151385.171	12.2	397
2/24/2026	3:45:00	7.3	3.37280031	0	1151422.631	12.3	397
2/24/2026	4:00:00	7.3	2.3091001	1	1151468.908	12.2	398
2/24/2026	4:15:00	7.3	3.3690149	0	1151497.022	12.2	395
2/24/2026	4:30:00	7.3	3.34251703	7	1151541.262	12.2	397
2/24/2026	4:45:00	7.4	3.35765867	18.8	1151572.605	13.2	401
2/24/2026	5:00:00	7.5	3.35387326	12.1	1151618.488	12.2	402
2/24/2026	5:15:00	7.5	0.59809478	5.3	1151656.925	12.4	367

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/24/2026	5:30:00	7.6	2.53243929	0	1151692.452	12.2	411
2/24/2026	5:45:00	7.6	0.61323642	0	1151740.882	11.9	414
2/24/2026	6:00:00	7.5	2.37723748	0	1151768.712	12	410
2/24/2026	6:15:00	7.5	3.42579605	1.1	1151816.954	11.9	410
2/24/2026	6:30:00	7.4	3.41822523	0.5	1151851.817	12	403
2/24/2026	6:45:00	7.4	3.42958146	3.6	1151881.639	12.2	400
2/24/2026	7:00:00	7.4	3.39929818	7	1151932.863	11.9	403
2/24/2026	7:15:00	7.4	3.42201064	3.2	1151966.735	11.8	398
2/24/2026	7:30:00	7.3	0.67380298	0	1152003.703	11.5	362
2/24/2026	7:45:00	7.3	3.38037113	0	1152035.678	11.4	395
2/24/2026	8:00:00	7.3	2.3469542	0	1152081.8	11.4	398
2/24/2026	8:15:00	7.3	3.38415654	0	1152110.94	11.4	388
2/24/2026	8:30:00	7.3	3.35387326	0.7	1152161.543	11.3	395
2/24/2026	8:45:00	7.3	3.37658572	0	1152193.731	11.5	385
2/24/2026	9:00:00	7.3	2.36966666	3.6	1152241.385	11.4	388
2/24/2026	9:15:00	7.2	3.37658572	4.1	1152273.239	11.6	384
2/24/2026	9:30:00	7.3	3.37280031	4.8	1152319.346	11.4	384
2/24/2026	9:45:00	7.3	0.29904739	0	1152355.512	11.6	347
2/24/2026	10:00:00	7.3	2.35452502	0	1152396.258	11.4	380
2/24/2026	10:15:00	7.2	3.3690149	0	1152438.651	11.4	370
2/24/2026	10:30:00	7.2	3.35387326	0.2	1152464.584	11.3	359
2/24/2026	10:45:00	7.2	3.35765867	0	1152506.519	11.3	362
2/24/2026	11:00:00	7.2	3.37658572	1.2	1152540.27	11.6	357
2/24/2026	11:15:00	7.2	0.3028328	0.9	1152579.479	11.6	333
2/24/2026	11:30:00	7.2	3.35765867	0.4	1152615.528	11.5	356
2/24/2026	12:00:00	7.2	2.36966666	1.2	1152653.071	11.6	364
2/24/2026	12:15:00	7.2	0.38232641	0	1152684.982	12	332
2/24/2026	12:30:00	7.2	3.36522949	2.3	1152731.607	11.7	353
2/24/2026	12:45:00	7	3.38037113	6.5	1152757.848	11.9	354
2/24/2026	13:00:00	7.1	3.35008785	7.4	1152804.158	11.8	357
2/24/2026	13:15:00	7.1	3.29709211	10.8	1152836.38	11.9	360
2/24/2026	13:30:00	7.2	3.36144408	0	1152882.043	11.9	365
2/24/2026	13:45:00	7.1	3.3690149	0.2	1152904.43	12	370
2/24/2026	14:00:00	7.1	3.3690149	6.4	1152928.343	12.3	370

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/24/2026	14:15:00	7.1	0.38989723	1	1152961.446	12.4	333
2/24/2026	14:30:00	7.1	0.21955378	7.3	1152997.26	11.9	336
2/24/2026	14:45:00	7.1	3.3690149	1.9	1153013.249	11.9	375
2/24/2026	15:00:00	7	3.34630244	7.8	1153063.667	11.7	380
2/24/2026	15:15:00	7	1.55958892	0	1153094.768	11.8	375
2/24/2026	15:30:00	7	3.31980457	3	1153135.291	11.7	379
2/24/2026	15:45:00	6.9	3.30087752	19.9	1153185.02	11.6	382
2/24/2026	16:00:00	6.9	1.72614696	0	1153226.451	11.7	384
2/24/2026	16:15:00	6.9	3.19110063	21.7	1153238.716	12.4	341
2/24/2026	16:30:00	7	3.37280031	28.9	1153289.603	11.6	380
2/24/2026	16:45:00	6.9	0.31797444	13.9	1153320.401	11.7	383
2/24/2026	17:00:00	6.8	3.38415654	3	1153359.099	11.5	384
2/24/2026	17:15:00	6.8	2.44158945	2.6	1153391.071	11.9	382
2/24/2026	17:30:00	6.9	3.37658572	8.9	1153437.249	11.5	382
2/24/2026	17:45:00	7	3.39172736	6.5	1153469.38	11.6	387
2/24/2026	18:00:00	7	0.5299574	3.7	1153512.916	11.7	389
2/24/2026	18:15:00	7	3.36522949	2.8	1153548.131	11.6	390
2/24/2026	18:30:00	7.1	0.4163951	4.6	1153578.812	11.8	349
2/24/2026	18:45:00	7.1	3.37658572	6.7	1153621.841	11.6	391
2/24/2026	19:00:00	7.2	3.39929818	19.1	1153653.979	11.6	395
2/24/2026	19:15:00	7.2	0.68515921	14.7	1153699.4	11.6	400
2/24/2026	19:30:00	7.3	3.3311608	0	1153732.121	11.6	409
2/24/2026	19:45:00	7.2	0.81007774	0	1153781.093	11.7	408
2/24/2026	20:00:00	7	3.31601916	0	1153806.614	11.8	401
2/24/2026	20:15:00	6.9	3.31980457	0	1153826.787	11.7	396
2/24/2026	20:30:00	6.9	3.28573588	0	1153876.459	11.7	401
2/24/2026	20:45:00	6.9	2.34316879	0	1153904.335	11.9	391
2/24/2026	21:00:00	7.1	3.27816506	0	1153952.985	11.8	395
2/24/2026	21:15:00	7.1	2.31288551	0	1153978.048	12	386
2/24/2026	21:30:00	7.1	0.4921033	0	1154020.028	12	350
2/24/2026	21:45:00	7.2	3.30844834	0	1154058.677	12	384
2/24/2026	22:00:00	7.2	1.93434451	0	1154103.451	12.1	384
2/24/2026	22:15:00	7.3	3.30466293	0	1154125.637	12	377
2/24/2026	22:30:00	7.3	1.93812992	0	1154171.297	12.1	377

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/24/2026	22:45:00	7.4	3.31223375	0	1154189.304	12.2	374
2/24/2026	23:00:00	7.4	3.28952129	12.5	1154236.584	12.2	377
2/24/2026	23:15:00	7.5	1.12426677	65.4	1154265.001	12.2	380
2/24/2026	23:30:00	7.5	0.38611182	8.6	1154287.827	12.9	344
2/24/2026	23:45:00	7.6	3.24788178	24.9	1154332.101	12.2	388
2/25/2026	0:00:00	7.6	0.39368264	0	1154359.318	12.8	359
2/25/2026	0:15:00	7.3	3.31601916	0	1154406.852	12.1	395
2/25/2026	0:30:00	7.2	3.28573588	3	1154456.13	12.1	395
2/25/2026	0:45:00	7.3	3.30466293	0	1154488.174	12.2	387
2/25/2026	1:00:00	7.3	2.17282534	0	1154519.396	13.1	387
2/25/2026	1:15:00	7.4	2.3091001	112.5	1154566.562	12.3	387
2/25/2026	1:30:00	7.3	3.23274014	0	1154593.105	13.2	373
2/25/2026	1:45:00	7.3	3.29709211	1.7	1154642.83	12.3	385
2/25/2026	2:00:00	7.3	0.23469542	8	1154678.088	12.8	359
2/25/2026	2:15:00	7.3	0.35204313	0	1154693.763	12.7	349
2/25/2026	2:30:00	7.3	3.28195047	0.4	1154742.531	12.4	382
2/25/2026	3:00:00	7.3	2.3469542	0	1154783.14	12.5	382
2/25/2026	3:15:00	7.4	2.26746059	12.2	1154829.58	12.4	385
2/25/2026	3:30:00	7.3	3.31980457	0	1154851.626	12.5	379
2/25/2026	3:45:00	7.3	2.38859371	6.5	1154899.36	12.3	380
2/25/2026	4:00:00	7.3	3.32737539	0	1154934.5	12.4	371
2/25/2026	4:15:00	7.3	3.30087752	0	1154984.24	12.1	374
2/25/2026	4:30:00	7.3	3.27437965	12	1155032.781	12	379
2/25/2026	4:45:00	7.3	3.31223375	0	1155063.931	12.2	375
2/25/2026	5:00:00	7.3	3.30087752	0	1155112.861	12.2	375
2/25/2026	5:15:00	7.3	2.35073961	26.4	1155160.799	12.2	375
2/25/2026	5:30:00	7.3	3.28573588	6	1155203.082	12.2	380
2/25/2026	5:45:00	7.4	0.46182002	9.3	1155238.635	12.9	341
2/25/2026	6:00:00	7.4	2.82013045	0	1155275.755	12.2	374
2/25/2026	6:15:00	7.4	3.19110063	0	1155314.779	12.1	377
2/25/2026	6:30:00	7.4	3.19867145	0	1155338.229	12	380
2/25/2026	7:00:00	7.4	3.20245686	0	1155415.603	11.8	385
2/25/2026	7:15:00	7.4	3.17217358	0.3	1155463.363	11.7	385
2/25/2026	7:45:00	7.4	3.16081735	0	1155541.199	11.5	390

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/25/2026	8:00:00	7.4	3.09267997	0	1155556.011	11.5	393
2/25/2026	8:15:00	7.4	3.13053407	0	1155601.463	11.4	393
2/25/2026	8:30:00	7.3	3.20245686	0	1155624.69	11.7	377
2/25/2026	8:45:00	7.3	3.21381309	0	1155669.301	11.5	380
2/25/2026	9:00:00	7.3	3.21381309	0	1155713.518	11.5	383
2/25/2026	9:15:00	7.4	3.21002768	2.7	1155758.122	11.7	385
2/25/2026	9:30:00	7.5	3.22895473	12.8	1155785.714	11.9	375
2/25/2026	9:45:00	7.6	3.23652555	9.5	1155816.005	12.1	379
2/25/2026	10:00:00	7.7	3.22138391	11	1155859.968	12.1	380
2/25/2026	10:15:00	7.8	3.22895473	7.5	1155904.598	12.2	382
2/25/2026	10:30:00	7.8	3.22895473	16.4	1155948.782	12.3	384
2/25/2026	10:45:00	7.8	3.21381309	11	1155993.256	12.3	385
2/25/2026	11:00:00	7.8	3.22516932	6.3	1156022.938	12.5	379
2/25/2026	11:15:00	7.7	0.378541	3	1156062.007	12.6	341
2/25/2026	11:30:00	7.6	3.2175985	4	1156096.678	12.6	374
2/25/2026	11:45:00	7.6	3.22138391	6.5	1156141.092	12.5	378
2/25/2026	12:00:00	7.6	3.22895473	4.2	1156170.664	12.4	370
2/25/2026	12:15:00	7.5	3.19867145	4.5	1156215.142	12.2	375
2/25/2026	12:30:00	7.4	3.19488604	7.8	1156259.272	12.1	375
2/25/2026	12:45:00	7.3	0.46939084	5.4	1156286.83	12.6	382
2/25/2026	13:00:00	7.3	3.20624227	4.8	1156330.343	13.1	384
2/25/2026	13:15:00	7.2	3.19488604	3.6	1156374.455	13.7	387
2/25/2026	13:45:00	7.2	3.21381309	3.4	1156402.883	14.8	389
2/25/2026	14:00:00	7.1	3.19867145	3.3	1156447.173	15.3	390
2/25/2026	14:15:00	7.1	3.17595899	3.3	1156490.739	15.8	394
2/25/2026	14:30:00	7.1	3.19867145	3.1	1156521.06	16.1	395
2/25/2026	14:45:00	7.1	3.1797444	4.1	1156564.933	16.4	399
2/25/2026	15:00:00	7.1	3.19488604	3.2	1156593.763	16.7	399
2/25/2026	15:15:00	7.2	3.1797444	11.5	1156637.806	12.5	387
2/25/2026	15:30:00	7.2	3.17217358	14.1	1156681.626	12.2	394
2/25/2026	15:45:00	7.2	3.1797444	7.2	1156713.166	12.2	382
2/25/2026	16:00:00	7.2	3.16838817	10.8	1156757.027	12	385
2/25/2026	16:15:00	7.2	3.17595899	13.8	1156800.836	12	387
2/25/2026	16:30:00	7.2	3.19110063	25.5	1156841.783	12	387

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/25/2026	16:45:00	7.2	0.47317625	21.8	1156859.252	12.9	348
2/25/2026	17:00:00	7.2	3.22138391	21.2	1156902.849	11.9	382
2/25/2026	17:15:00	7.1	3.16081735	11	1156944.689	11.9	385
2/25/2026	17:30:00	7.1	3.15703194	11	1156988.172	11.9	385
2/25/2026	17:45:00	7.1	3.19110063	6.6	1157018.194	11.9	382
2/25/2026	18:00:00	7.1	3.16838817	10.6	1157061.844	11.8	380
2/25/2026	18:15:00	7.2	3.16838817	9.6	1157105.595	11.9	384
2/25/2026	18:30:00	7.2	3.17217358	4.7	1157134.857	11.9	377
2/25/2026	18:45:00	7.2	3.16838817	8.3	1157178.465	11.9	382
2/25/2026	19:00:00	7.2	3.16838817	5.7	1157207.067	12	374
2/25/2026	19:15:00	7.2	3.16460276	7.1	1157250.948	11.9	375
2/25/2026	19:30:00	7.1	0.41260969	7.5	1157264.704	12.7	342
2/25/2026	19:45:00	7.1	0.50345953	2.9	1157299.639	11.7	336
2/25/2026	20:00:00	7.1	3.14946112	2.6	1157322.219	11.7	369
2/25/2026	20:15:00	7.1	2.86555537	7.1	1157363.037	11.6	372
2/25/2026	20:30:00	7.1	3.17595899	7.3	1157406.536	11.9	355
2/25/2026	20:45:00	7.1	2.44158945	7.7	1157450.321	11.7	359
2/25/2026	21:00:00	7.2	3.17595899	4.9	1157493.937	11.8	365
2/25/2026	21:15:00	7.2	2.38102289	1.6	1157509.355	11.9	351
2/25/2026	21:30:00	7.3	3.18731522	0.1	1157553.398	11.9	357
2/25/2026	21:45:00	7.2	2.271246	0.8	1157596.945	11.9	365
2/25/2026	22:00:00	7.1	0.56402609	4.1	1157638.475	11.9	334
2/25/2026	22:15:00	7.1	2.30531469	2.5	1157659.779	11.9	347
2/25/2026	22:45:00	7.2	2.25610436	1.5	1157712.264	11.9	348
2/25/2026	23:00:00	7.2	3.17595899	2.2	1157756.364	11.9	351
2/25/2026	23:15:00	7.1	2.31667092	2.9	1157799.851	11.9	352
2/25/2026	23:30:00	7.1	3.19488604	2	1157843.97	12	357
2/25/2026	23:45:00	7.2	2.28638764	0.8	1157887.646	12.1	362
2/26/2026	0:00:00	7.2	3.17217358	0.3	1157931.625	12.2	366
2/26/2026	0:15:00	7.2	2.2333919	0.6	1157975.256	12.3	365
2/26/2026	0:45:00	7.2	2.25231895	2.4	1158020.143	12.3	369
2/26/2026	1:00:00	7.2	3.17595899	2.5	1158064.421	12.2	369
2/26/2026	1:15:00	7.2	2.34316879	1.7	1158107.972	12.3	371
2/26/2026	1:30:00	7.2	3.17217358	2	1158152.061	12.3	373

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/26/2026	1:45:00	7.2	2.25988977	2.5	1158195.619	12.3	373
2/26/2026	2:00:00	7.2	2.86176996	3.5	1158239.969	12.3	374
2/26/2026	2:15:00	7.2	2.24474813	14.8	1158283.081	12.3	374
2/26/2026	2:30:00	7.2	0.21955378	7.7	1158318.967	12.5	338
2/26/2026	2:45:00	7.2	2.22582108	16.4	1158346.188	12.3	353
2/26/2026	3:00:00	7.2	2.33559797	7.8	1158389.728	12.3	361
2/26/2026	3:15:00	7.2	2.3091001	2.4	1158420.234	12.3	344
2/26/2026	3:30:00	7.2	2.29395846	5.9	1158464.243	12.3	349
2/26/2026	3:45:00	7.2	2.22203567	1.1	1158506.841	12.4	354
2/26/2026	4:00:00	7.2	2.27503141	0.5	1158537.495	12.5	339
2/26/2026	4:15:00	7.1	2.21825026	2.1	1158580.565	12.5	343
2/26/2026	4:30:00	7.1	2.21446485	2	1158624.287	12.4	347
2/26/2026	4:45:00	7.1	2.1955378	5.4	1158666.827	12.2	349
2/26/2026	5:00:00	7.1	2.26367518	4.3	1158695.21	12.1	338
2/26/2026	5:15:00	7.1	2.31288551	11.5	1158738.508	12	344
2/26/2026	5:30:00	7.2	2.27881682	1.3	1158782.464	12.1	343
2/26/2026	5:45:00	7.2	2.2333919	2.8	1158825.629	12.6	346
2/26/2026	6:00:00	7.2	2.20689403	4	1158869.135	13.5	357
2/26/2026	6:15:00	7.2	2.25231895	1.1	1158897.794	12.4	338
2/26/2026	6:30:00	7.2	2.24474813	3.4	1158941.962	12.4	338
2/26/2026	6:45:00	7.3	2.271246	2.4	1158984.866	12.3	342
2/26/2026	7:00:00	7.3	1.10533972	4	1159028.266	12.1	346
2/26/2026	7:15:00	7.4	1.99491107	4.5	1159058.17	12	346
2/26/2026	7:30:00	7.4	2.29395846	8.1	1159100.987	11.9	349
2/26/2026	7:45:00	7.5	2.04033599	1	1159128.799	11.9	354
2/26/2026	8:00:00	7.5	1.86242172	3.3	1159172.323	11.9	354
2/26/2026	8:15:00	7.5	0.27633493	1.6	1159197.057	11.9	357
2/26/2026	8:30:00	7.4	2.22582108	5.7	1159239.147	11.7	359
2/26/2026	8:45:00	7.3	2.24096272	4.4	1159282.096	11.7	360
2/26/2026	9:00:00	7.3	2.22203567	7.1	1159312.232	11.8	351
2/26/2026	9:15:00	7.3	2.29017305	0.9	1159334.263	11.9	343
2/26/2026	9:30:00	7.3	2.25988977	4.2	1159378.299	11.8	348
2/26/2026	10:00:00	7.2	2.29017305	3.9	1159437.711	11.8	344
2/26/2026	10:15:00	7.1	2.23717731	13.3	1159482.114	11.8	348

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/26/2026	10:30:00	7.1	2.26746059	43.6	1159509.963	11.7	350
2/26/2026	10:45:00	7	1.73750319	19.1	1159552.871	11.7	353
2/26/2026	11:00:00	6.9	1.61258466	31.6	1159595.313	11.7	355
2/26/2026	11:15:00	6.9	1.95327156	1.4	1159627.383	11.9	356
2/26/2026	11:30:00	6.9	0.45046379	0.7	1159656.746	11.9	359
2/26/2026	12:00:00	6.9	0.30661821	50	1159720.583	11.8	365
2/26/2026	12:15:00	6.9	1.9684132	26.7	1159758.221	11.7	369
2/26/2026	12:45:00	6.9	2.36209584	28.8	1159829.501	11.6	374
2/26/2026	13:00:00	6.9	0.58673855	47.7	1159873.824	11.5	375
2/26/2026	13:15:00	6.9	0.6813738	40.5	1159897.089	11.5	378
2/26/2026	13:30:00	6.9	2.30531469	80.9	1159944.766	11.4	380
2/26/2026	13:45:00	6.9	3.27437965	30.3	1159977.12	11.4	381
2/26/2026	14:00:00	6.9	0.42018051	19.6	1160005.996	10.7	380
2/26/2026	14:15:00	6.9	3.27816506	4.8	1160050.675	11.3	383
2/26/2026	14:30:00	6.9	2.36966666	14.9	1160082.957	11.4	386
2/26/2026	14:45:00	6.9	0.36339936	14.4	1160115.5	11.5	385
2/26/2026	15:00:00	6.9	1.92298828	51.9	1160158.46	11.5	388
2/26/2026	15:15:00	6.8	2.33181256	14.5	1160182.119	11.5	386
2/26/2026	15:45:00	6.8	1.90027582	25.8	1160241.334	11.5	390
2/26/2026	16:00:00	6.8	2.3091001	29.4	1160278.064	11.5	391
2/26/2026	16:15:00	6.7	2.29017305	47.2	1160321.967	11.4	391
2/26/2026	16:30:00	6.7	2.29774387	47.8	1160342.553	11.5	395
2/26/2026	16:45:00	6.7	0.22333919	46.5	1160361.601	11.6	395
2/26/2026	17:00:00	6.7	0.13248935	34.3	1160363.713	11.7	398
2/26/2026	17:45:00	6.8	1.61258466	5.2	1160445.913	11.3	400
2/26/2026	18:00:00	6.8	1.56337433	10.7	1160487.825	11.2	400
2/26/2026	18:15:00	6.8	0.40125346	17.4	1160527.307	11.3	403
2/26/2026	18:30:00	6.9	3.26680883	18.5	1160561.773	11.3	403
2/26/2026	18:45:00	6.9	3.27437965	19.6	1160606.475	11.3	406
2/26/2026	19:00:00	6.9	3.11917784	16.8	1160648.959	11.4	406
2/26/2026	19:15:00	6.9	0.60188019	13	1160681.173	11.5	406
2/26/2026	19:30:00	6.9	2.31667092	44.6	1160720.382	11.4	405
2/26/2026	19:45:00	6.9	3.21381309	55.4	1160761.525	11.3	406
2/26/2026	20:00:00	6.8	0.35204313	46.6	1160774.82	11.4	408

FRONTIER-KEMPER MICHELS joint venture	Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope		
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/26/2026	20:15:00	6.9	3.22895473	2	1160804.94	11.4	410
2/26/2026	20:30:00	6.9	3.48636261	48.2	1160846.258	11.2	406
2/26/2026	20:45:00	6.8	0.33690149	44.2	1160875.406	11.3	410
2/26/2026	21:00:00	6.8	3.35765867	33.6	1160915.255	11.2	410
2/26/2026	21:15:00	6.8	0.36718477	20.5	1160956.962	11.2	410
2/26/2026	21:30:00	6.8	3.19110063	9.7	1160987.045	11.2	411
2/26/2026	21:45:00	6.8	2.74063684	15.3	1161034.234	11.2	413
2/26/2026	22:00:00	7	0.1892705	30.5	1161063.09	11.2	413
2/26/2026	22:15:00	7.2	2.93747816	42.8	1161082.922	11.2	416
2/26/2026	22:30:00	7.4	1.80564057	54.6	1161103.802	11.3	418
2/26/2026	22:45:00	7.6	3.028328	29.1	1161147.565	11.3	420
2/26/2026	23:00:00	7.7	2.91855111	6.6	1161191.291	11.3	420
2/26/2026	23:30:00	7.6	3.06996751	0.5	1161241.868	11.3	421
2/26/2026	23:45:00	7.5	3.05861128	0.6	1161288.004	11.3	421
2/27/2026	0:00:00	7.4	3.13810489	1	1161329.447	11.4	419
2/27/2026	0:15:00	7.4	0.64730511	2.6	1161373.728	11.4	421
2/27/2026	0:30:00	7.3	2.90340947	1.3	1161404.156	11.5	419
2/27/2026	0:45:00	7.3	3.20624227	0	1161427.78	11.7	417
2/27/2026	1:15:00	7.3	1.25297071	7.8	1161432.217	11.9	416
2/27/2026	1:30:00	7.3	3.2175985	8.6	1161466.744	11.9	416
2/27/2026	1:45:00	7.3	3.21002768	15.3	1161515.117	11.9	416
2/27/2026	2:00:00	7.4	0.53374281	4.9	1161545.461	11.8	418
2/27/2026	2:15:00	7.4	2.30152928	6.3	1161586.132	11.7	419
2/27/2026	2:30:00	7.4	3.19110063	6.2	1161632.128	11.7	417
2/27/2026	2:45:00	7.4	3.2175985	0.3	1161659.167	11.6	422
2/27/2026	3:00:00	7.4	3.18352981	0.3	1161707.053	11.5	419
2/27/2026	3:15:00	7.3	2.29395846	1.7	1161750.358	11.6	420
2/27/2026	3:30:00	7.3	0.39368264	0.7	1161781.909	11.8	420
2/27/2026	3:45:00	7.3	3.21381309	0.6	1161826.142	11.7	420
2/27/2026	4:00:00	7.3	3.19867145	2.9	1161874.432	11.8	421
2/27/2026	4:15:00	7.3	2.3469542	1.2	1161917.12	11.8	421
2/27/2026	4:30:00	7.3	3.19867145	0	1161959.426	11.8	420
2/27/2026	4:45:00	7.2	2.30152928	1.2	1161987.415	12.1	421
2/27/2026	5:00:00	7.2	3.21002768	0	1162031.508	12	416

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/27/2026	5:15:00	7.2	2.51351224	1	1162077.213	12	416
2/27/2026	5:45:00	7.2	3.22895473	0.6	1162146.686	12	418
2/27/2026	6:00:00	7.2	3.22138391	11.3	1162194.795	12	415
2/27/2026	6:15:00	7.3	2.45673109	24.9	1162241.083	12.1	415
2/27/2026	6:30:00	7.4	3.24409637	27.2	1162256.509	12.5	421
2/27/2026	6:45:00	7.4	0.42775133	10.7	1162280.202	12.3	416
2/27/2026	7:00:00	7.5	3.03968423	24.2	1162316.708	11.8	415
2/27/2026	7:15:00	7.5	3.21381309	13	1162361.281	11.7	418
2/27/2026	7:30:00	7.5	3.18352981	12.2	1162409.072	11.7	416
2/27/2026	7:45:00	7.5	3.22516932	4.4	1162452.04	11.7	416
2/27/2026	8:00:00	7.5	0.24605165	8.3	1162489.501	11.8	415
2/27/2026	8:15:00	7.4	3.2554526	1.7	1162513.436	11.8	415
2/27/2026	8:30:00	7.4	3.24788178	2.1	1162562.207	11.8	415
2/27/2026	8:45:00	7.3	3.15703194	0.9	1162601.996	11.8	415
2/27/2026	9:00:00	7.3	3.16081735	0.9	1162649.419	11.9	411
2/27/2026	9:15:00	7.3	3.15703194	1.4	1162697.006	12.1	411
2/27/2026	10:00:00	7.2	3.14946112	1.3	1162784.025	11.9	416
2/27/2026	10:15:00	7.2	3.17595899	4.4	1162823.726	12	415
2/27/2026	10:30:00	7.3	3.1797444	16.1	1162858.756	12	416
2/27/2026	10:45:00	7.3	3.30466293	28.2	1162893.29	12	413
2/27/2026	11:00:00	7.4	3.36144408	25.3	1162932.557	12	415
2/27/2026	11:15:00	7.5	3.34630244	25.9	1162966.932	12.1	411
2/27/2026	11:30:00	7.5	3.69834557	23.4	1163008.193	12.1	415
2/27/2026	11:45:00	7.5	3.69834557	20.6	1163050.075	12.1	415
2/27/2026	12:00:00	7.5	3.64156442	11.1	1163097.468	12.1	416
2/27/2026	12:15:00	7.5	3.31980457	5.6	1163135.106	12	415
2/27/2026	12:30:00	7.4	3.31223375	4.2	1163181.247	12	418
2/27/2026	12:45:00	7.4	3.22895473	8.1	1163218.105	12	416
2/27/2026	13:15:00	7.3	3.22895473	9.7	1163301.74	12	416
2/27/2026	13:30:00	7.3	3.4447231	8.9	1163338.19	12	417
2/27/2026	13:45:00	7.2	3.43715228	7.3	1163385.405	12	418
2/27/2026	14:15:00	7.2	3.54314376	12	1163437.432	12.1	418
2/27/2026	14:30:00	7.2	3.54692917	6.2	1163474.608	12	418
2/27/2026	14:45:00	7.2	3.53178753	1	1163524.087	12	416

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/27/2026	15:00:00	7.2	3.57721245	4.1	1163561.396	12	416
2/27/2026	15:15:00	7.1	3.56207081	10.5	1163611.398	12	416
2/27/2026	15:45:00	7.1	3.58099786	4	1163671.794	12	418
2/27/2026	16:00:00	7.1	3.49393343	5.2	1163699.431	12.1	420
2/27/2026	16:15:00	7.1	3.34251703	5.5	1163744.5	11.9	418
2/27/2026	16:30:00	7.1	3.33494621	5.7	1163790.118	11.8	418
2/27/2026	17:00:00	7.1	3.18352981	1.6	1163836.702	12.1	420
2/27/2026	17:15:00	7.1	3.32737539	1.4	1163882.982	11.9	418
2/27/2026	17:30:00	7.1	3.31223375	0.7	1163929.225	11.9	418
2/27/2026	17:45:00	7.1	3.31601916	0.1	1163975.392	11.8	418
2/27/2026	18:00:00	7.1	3.34251703	0	1163989.674	12.1	418
2/27/2026	18:15:00	7.1	3.32737539	0	1164036.057	11.9	416
2/27/2026	18:30:00	7.1	3.32358998	0	1164082.341	11.8	416
2/27/2026	18:45:00	7.1	3.18352981	0.4	1164127.13	11.8	418
2/27/2026	19:00:00	7.1	3.32358998	0.8	1164173.346	11.7	416
2/27/2026	19:15:00	7.1	3.30844834	2.7	1164219.551	11.7	417
2/27/2026	19:45:00	7.1	3.33494621	3.3	1164236.823	11.6	416
2/27/2026	20:00:00	7.1	3.32737539	0.8	1164283.354	11.5	419
2/27/2026	20:15:00	7.1	3.32737539	0	1164326.916	11.6	414
2/27/2026	20:30:00	7	0.38989723	0	1164341.346	11.9	414
2/27/2026	20:45:00	7	3.33494621	0	1164386.271	11.7	412
2/27/2026	21:00:00	7	2.70656815	0.3	1164432.275	11.7	413
2/27/2026	21:15:00	7	3.20245686	1	1164475.206	11.7	411
2/27/2026	21:30:00	7	3.24409637	0.4	1164501.719	11.9	413
2/27/2026	21:45:00	7.1	3.23652555	2.4	1164546.065	12	410
2/27/2026	22:00:00	7.1	3.22516932	4	1164590.593	12.2	405
2/27/2026	22:15:00	7.1	3.2175985	6.1	1164635.026	12.3	410
2/27/2026	22:30:00	7	3.2175985	9.8	1164679.455	12.3	408
2/27/2026	22:45:00	7	3.22516932	7.6	1164723.619	12.3	408
2/27/2026	23:00:00	7	3.24409637	3.8	1164741.551	12.2	410
2/27/2026	23:15:00	7	3.22516932	0.4	1164786.037	12.2	410
2/27/2026	23:30:00	7.1	3.2175985	0.3	1164830.209	12.3	408
2/27/2026	23:45:00	7.1	3.19488604	0.2	1164874.43	12.3	405
2/28/2026	0:00:00	7.1	0.32175985	0	1164892.895	12.6	408

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/28/2026	0:15:00	7.1	3.22516932	0	1164934.955	12.4	405
2/28/2026	0:30:00	7.1	3.2175985	0	1164979.445	12.4	404
2/28/2026	0:45:00	7.1	3.23652555	0	1164996.358	12.6	403
2/28/2026	1:00:00	7	3.24409637	0	1165041.079	12.6	403
2/28/2026	1:15:00	7	3.24788178	0	1165086.099	12.5	405
2/28/2026	1:30:00	7	3.25923801	0	1165131.373	12.4	405
2/28/2026	1:45:00	7	3.19488604	1.7	1165175.719	12.4	405
2/28/2026	2:15:00	7	3.2175985	4.6	1165214.901	12.4	405
2/28/2026	2:30:00	7	3.2175985	2.1	1165259.176	12.3	403
2/28/2026	2:45:00	7	3.20624227	1.8	1165303.586	12.3	405
2/28/2026	3:00:00	7	3.19488604	1.9	1165347.826	12.3	405
2/28/2026	3:30:00	7	3.23274014	1.3	1165405.966	12.3	404
2/28/2026	3:45:00	7	3.19867145	1.4	1165450.218	12.4	403
2/28/2026	4:15:00	7	3.22516932	1	1165486.493	12.4	403
2/28/2026	4:30:00	7	3.22516932	0.7	1165531.025	12.4	405
2/28/2026	4:45:00	7	3.2175985	0.7	1165574.928	12.5	403
2/28/2026	5:00:00	7	3.21002768	0.5	1165619.422	12.5	404
2/28/2026	5:15:00	7	3.19488604	2.5	1165663.692	12.5	404
2/28/2026	5:30:00	7	3.23652555	5.8	1165703.969	12.4	401
2/28/2026	5:45:00	7	3.23652555	7.2	1165748.341	12.4	404
2/28/2026	6:00:00	6.9	3.26680883	7.3	1165768.487	12.4	405
2/28/2026	6:15:00	7	3.15703194	9.2	1165806.735	12.2	405
2/28/2026	6:30:00	7	3.27816506	0.4	1165846.588	12.1	403
2/28/2026	6:45:00	7	3.25923801	1.1	1165891.649	12.2	402
2/28/2026	7:00:00	7	3.26302342	0.7	1165932.698	12.3	402
2/28/2026	7:30:00	6.9	3.19110063	1.5	1165992.054	12	406
2/28/2026	7:45:00	6.9	3.22516932	2.2	1166034.749	11.9	408
2/28/2026	8:00:00	6.9	3.2175985	2.2	1166079.322	11.8	406
2/28/2026	8:15:00	6.9	3.2554526	6.1	1166106.399	11.9	406
2/28/2026	8:30:00	6.9	3.24031096	4.1	1166151.31	11.9	406
2/28/2026	8:45:00	6.9	3.33494621	2.5	1166193.085	11.9	406
2/28/2026	9:00:00	6.9	3.34630244	2.4	1166239.669	11.9	406
2/28/2026	9:30:00	6.9	3.34630244	3.9	1166322.694	11.9	406
2/28/2026	10:00:00	7	3.3311608	2.2	1166405.428	11.9	406

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/28/2026	10:30:00	7	3.42579605	3.6	1166474.02	12	407
2/28/2026	10:45:00	7	3.38794195	3.1	1166521.038	12.1	405
2/28/2026	11:00:00	7	3.37658572	3.2	1166552.385	12.1	403
2/28/2026	11:30:00	7	3.41443982	1.1	1166625.11	12.2	404
2/28/2026	11:45:00	7	3.38794195	1	1166672.284	12.2	405
2/28/2026	12:00:00	7	3.38037113	0	1166709.983	12.1	403
2/28/2026	12:15:00	7	3.40308359	0.2	1166725.299	12.4	406
2/28/2026	12:30:00	7	3.41065441	2.2	1166772.579	12.2	404
2/28/2026	12:45:00	7	3.28952129	4.9	1166802.703	12.3	404
2/28/2026	13:00:00	7	3.41065441	9.8	1166849.752	12.4	402
2/28/2026	13:15:00	7	2.55515175	6.5	1166896.926	12.5	401
2/28/2026	13:45:00	7	2.35073961	38.9	1166948.998	12.5	402
2/28/2026	14:00:00	7	3.24409637	11.4	1166982.934	12.4	400
2/28/2026	14:15:00	7	2.34316879	10.9	1167027.522	12.3	402
2/28/2026	14:30:00	7	3.22138391	27.7	1167072.065	12.4	400
2/28/2026	14:45:00	7	2.35073961	13.6	1167116.517	12.4	400
2/28/2026	15:00:00	7	3.21002768	10.5	1167145.669	12.5	399
2/28/2026	15:15:00	7	1.69207827	14.3	1167189.451	12.5	399
2/28/2026	15:30:00	7	3.18352981	11.5	1167210.047	12.6	400
2/28/2026	15:45:00	7	2.29017305	1.9	1167250.967	12.6	399
2/28/2026	16:00:00	6.9	3.20245686	1.1	1167295.404	12.5	400
2/28/2026	16:15:00	6.9	2.36966666	2.8	1167340.379	12.4	401
2/28/2026	16:30:00	6.9	3.33873162	7.5	1167364.223	12.3	400
2/28/2026	16:45:00	7	2.36209584	20.6	1167409.546	12.3	400
2/28/2026	17:00:00	7	3.35765867	48.3	1167434.76	12.3	400
2/28/2026	17:15:00	6.9	1.59365761	21.3	1167467.277	12.2	399
2/28/2026	17:30:00	6.9	3.46743556	0.6	1167512.373	12.1	398
2/28/2026	17:45:00	6.9	2.52108306	0	1167559.819	12.1	400
2/28/2026	18:00:00	6.9	3.54314376	0	1167609.397	12.1	400
2/28/2026	18:15:00	7	2.55136634	0	1167651.441	12.2	397
2/28/2026	18:30:00	7	3.51286048	0	1167700.894	12.3	393
2/28/2026	18:45:00	7	1.63908253	3.7	1167735.754	12.4	394
2/28/2026	19:00:00	7	3.33494621	3	1167780.164	12.4	395
2/28/2026	19:15:00	7	2.40752076	4.2	1167825.907	12.2	396

FRONTIER-KEMPER MICHELS® joint venture	Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope		
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
2/28/2026	19:30:00	7	3.34251703	2.2	1167863.803	12.2	394
2/28/2026	19:45:00	7	2.36966666	5.4	1167909.277	12.3	393
2/28/2026	20:00:00	7	3.34630244	0	1167956.443	12.4	391
2/28/2026	20:30:00	7	3.32737539	0	1168022.953	12.4	388
2/28/2026	20:45:00	7	2.41130617	0	1168068.12	12.2	391
2/28/2026	21:00:00	7	3.28573588	0	1168114.514	12.1	393
2/28/2026	21:30:00	7	3.2933067	0	1168178.62	12.2	391
2/28/2026	21:45:00	7	2.27503141	6.2	1168222.913	12.3	389
2/28/2026	22:30:00	7	3.30087752	0.4	1168300.249	12.4	386
2/28/2026	22:45:00	6.9	2.38859371	0	1168344.962	12.4	389
2/28/2026	23:00:00	6.9	3.27437965	0	1168391.099	12.4	388
2/28/2026	23:15:00	6.9	2.88069701	10.9	1168435.218	12.5	389
2/28/2026	23:30:00	6.9	3.27437965	6.6	1168454.819	12.8	390
3/1/2026	0:00:00	6.9	3.24788178	0	1168536.035	12.4	389
3/1/2026	0:15:00	6.9	2.66492864	0	1168579.502	12.4	387
3/1/2026	0:30:00	7	3.20245686	0	1168625.12	12.4	389
3/1/2026	0:45:00	7	3.17595899	3.8	1168672.858	12.4	389
3/1/2026	1:00:00	7	2.50215601	0	1168702.736	12.5	389
3/1/2026	1:15:00	7	3.41443982	0	1168753.62	12.3	389
3/1/2026	1:30:00	7	3.35008785	0.5	1168804.394	12.1	388
3/1/2026	1:45:00	7	2.43401863	0.3	1168853.691	12	388
3/1/2026	2:15:00	7	3.3311608	0	1168910.385	11.7	391
3/1/2026	2:30:00	7.1	2.46430191	0	1168959.607	11.8	387
3/1/2026	3:00:00	7.1	3.36522949	0	1169021.184	11.9	386
3/1/2026	3:15:00	7	2.39994994	0.2	1169070.743	12	387
3/1/2026	3:30:00	7	3.45607933	4.3	1169094.867	12.2	385
3/1/2026	3:45:00	7	3.38794195	1.7	1169141.693	11.9	386
3/1/2026	4:00:00	7	2.44537486	0.8	1169188.571	11.9	387
3/1/2026	4:15:00	6.9	3.05104046	9.2	1169215.58	12	386
3/1/2026	4:30:00	6.9	3.32737539	3.7	1169266.1	11.7	390
3/1/2026	4:45:00	6.9	2.37345207	12.5	1169311.521	11.7	387
3/1/2026	5:00:00	6.9	3.41065441	11.5	1169346.983	11.5	385
3/1/2026	5:15:00	6.9	3.40308359	13.7	1169395.273	11.5	388
3/1/2026	5:30:00	6.9	2.39237912	32.9	1169442.315	11.4	388

FRONTIER-KEMPER MICHELS joint venture	Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope		
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
3/1/2026	6:00:00	7	3.2933067	8.8	1169505.19	11.5	387
3/1/2026	6:15:00	7	0.36718477	23.1	1169539.778	11.6	387
3/1/2026	8:00:00	8.2	3.25166719	2.7	1169614.445	11.2	391
3/1/2026	8:15:00	8.2	2.7254952	5.2	1169657.792	11.2	393
3/1/2026	8:30:00	8.1	3.29709211	8.3	1169703.485	11.2	398
3/1/2026	8:45:00	8	2.61950372	8.9	1169746.31	11.2	400
3/1/2026	9:00:00	7.9	3.16838817	0	1169788.903	11.3	398
3/1/2026	9:15:00	7.8	3.15324653	0	1169832.958	11.3	395
3/1/2026	9:30:00	7.7	3.14567571	0	1169876.339	11.3	395
3/1/2026	9:45:00	7.6	3.13053407	1.1	1169919.784	11.4	394
3/1/2026	10:00:00	7.6	3.19110063	0.2	1169963.221	11.4	394
3/1/2026	10:15:00	7.5	3.24788178	1.4	1170007.889	11.4	394
3/1/2026	10:30:00	7.5	3.23274014	1.2	1170052.466	11.4	392
3/1/2026	10:45:00	7.4	3.23652555	1.8	1170097.176	11.5	392
3/1/2026	11:00:00	7.4	3.25923801	1	1170141.893	11.5	390
3/1/2026	11:15:00	7.4	3.2554526	4.1	1170187.106	11.6	390
3/1/2026	11:30:00	7.3	3.24788178	1.3	1170232.247	11.7	391
3/1/2026	12:00:00	7.3	2.41887699	3.7	1170295.686	12	387
3/1/2026	12:15:00	7.3	3.24409637	4.4	1170338.673	12	387
3/1/2026	12:30:00	7.3	3.23274014	3.6	1170377.936	12.1	389
3/1/2026	12:45:00	7.3	3.22516932	5.8	1170426.442	12.2	385
3/1/2026	13:00:00	7.2	2.43023322	3.8	1170470.148	12.3	386
3/1/2026	13:15:00	7.2	3.28195047	2.9	1170498.459	12.4	387
3/1/2026	13:30:00	7.2	2.58543503	6.4	1170542.938	12.4	385
3/1/2026	13:45:00	7.2	3.2554526	4.1	1170589.188	12.4	387
3/1/2026	14:00:00	7.1	2.4605165	9.7	1170632.766	12.5	387
3/1/2026	14:15:00	7.1	3.25923801	17.7	1170654.093	12.7	386
3/1/2026	14:30:00	7.1	3.25166719	4.5	1170691.303	12.4	387
3/1/2026	14:45:00	7.1	3.24031096	6.6	1170735.661	12.4	387
3/1/2026	15:00:00	7.1	3.2175985	6.3	1170780.363	12.4	387
3/1/2026	15:15:00	7.1	3.22516932	6.1	1170824.966	12.5	387
3/1/2026	15:30:00	7.2	2.45673109	4.5	1170865.909	12.6	385
3/1/2026	15:45:00	7.2	3.27059424	7.6	1170907.893	12.7	385
3/1/2026	16:00:00	7.2	0.29904739	6.7	1170941.303	12.8	385

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
3/1/2026	16:15:00	7.2	3.31601916	7.8	1170978.006	12.9	382
3/1/2026	16:45:00	7.2	3.31223375	12.7	1171057.458	12.9	380
3/1/2026	17:00:00	7.2	3.27816506	1.5	1171087.348	12.9	385
3/1/2026	17:15:00	7.2	3.26680883	1.7	1171132.663	12.9	381
3/1/2026	17:30:00	7.2	3.25923801	3.5	1171177.986	12.9	381
3/1/2026	17:45:00	7.2	3.24409637	3.4	1171222.885	12.8	384
3/1/2026	18:00:00	7.2	3.2554526	9.1	1171237.897	13	385
3/1/2026	18:15:00	7.2	3.25166719	3.3	1171283.126	12.8	385
3/1/2026	18:30:00	7.1	3.24409637	3.8	1171327.869	12.8	385
3/1/2026	18:45:00	7.1	3.22516932	7.2	1171372.51	12.7	384
3/1/2026	19:30:00	7.2	3.25923801	17.3	1171472.926	12.4	385
3/1/2026	19:45:00	7.2	3.26302342	13.7	1171505.227	12.4	387
3/1/2026	20:00:00	7.2	3.11160702	2.9	1171549.157	12.3	384
3/1/2026	20:15:00	7.2	3.42201064	2.4	1171570.54	12.5	382
3/1/2026	20:45:00	7.2	2.50594142	7.5	1171633.193	12.1	387
3/1/2026	21:00:00	7.2	2.10847337	2.3	1171674.071	12	384
3/1/2026	21:15:00	7.2	3.12296325	8.2	1171716.968	12	384
3/1/2026	21:45:00	7.2	3.16081735	11.7	1171783.167	11.9	385
3/1/2026	22:00:00	7.2	3.16460276	19.3	1171830.519	11.9	385
3/1/2026	22:15:00	7.2	3.16838817	15	1171835.602	12.2	382
3/1/2026	22:30:00	7.2	3.3690149	3.1	1171879.172	12.1	385
3/1/2026	22:45:00	7.2	3.32358998	8.7	1171896.006	12.7	382
3/1/2026	23:00:00	7.2	3.34251703	1.6	1171940.659	12.2	381
3/1/2026	23:15:00	7.1	0.47317625	0.9	1171967.448	12.3	382
3/1/2026	23:30:00	7.1	3.23274014	1	1172011.802	12	385
3/1/2026	23:45:00	7.1	3.31980457	6.7	1172038.201	12.2	384

Table 3. In-Situ Parameters

FRONTIER-KEMPER MICHELS joint venture	Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope		
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Temperature °C	DO mg/L	Conductivity SPC-uS/cm	SAL-ppt	pH	ORP (mV)	NTU
02/23/2026	11.1	9.46	229.3	0.10	7.22	152.1	5.37
02/24/2026	10.6	9.89	215.3	0.11	7.15	184.2	7.55
02/25/2026	10.5	9.03	245.7	0.10	7.38	128.3	4.37
02/26/2026	-	-	-	-	-	-	-
02/27/2026	12.0	8.23	235.7	0.11	7.00	140.9	8.75
02/28/2026	10.7	9.50	196.4	0.11	7.58	185.7	6.78
03/01/2026	-	-	-	-	-	-	-

1. Calibration Log:

Table 4. Calibration Log

Date	Unit	pH	Conductivity/Temp.	Salinity	NTU
2/24/2025	YSI	✓	✓	✓	✓
2/26/2025	WTP	✓	N/A	N/A	✓
3/01/2025	WTP	-	N/A	N/A	✓

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

APPENDIX A: WTP Log

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/23/2026	0:00:00	7.2	0.3406869	0	1147240	Open	12.5	374
2/23/2026	0:15:00	7.1	2.30531469	11.6	1147277	Open	11.6	394
2/23/2026	0:30:00	7.2	3.35008785	0	1147305.5	Open	11.5	393
2/23/2026	0:45:00	7.2	3.35387326	0	1147342.5	Open	11.7	392
2/23/2026	1:00:00	7.2	0.67380298	3.6	1147389.1	Open	11.5	351
2/23/2026	1:15:00	7.1	3.36144408	0	1147432.9	Open	11.4	387
2/23/2026	1:30:00	7.1	3.36144408	0	1147478.4	Open	11.4	390
2/23/2026	1:45:00	7.2	3.35008785	0	1147528.8	Open	11.4	390
2/23/2026	2:00:00	7.2	2.29774387	5.2	1147572.5	Open	11.4	394
2/23/2026	2:15:00	7.2	0.59430937	2.7	1147614.6	Open	11.5	351
2/23/2026	2:30:00	7.3	3.32737539	0	1147652.8	Open	11.5	382
2/23/2026	2:45:00	7.3	3.35008785	0	1147682.2	Open	11.8	375
2/23/2026	3:00:00	7.3	3.32737539	0.8	1147732.4	Open	11.6	375
2/23/2026	3:15:00	7.2	3.2933067	0.4	1147782.1	Open	11.6	379
2/23/2026	3:30:00	7.3	3.3311608	0	1147814.9	Open	11.8	370
2/23/2026	3:45:00	7.2	3.29709211	1.9	1147864.6	Open	11.6	371
2/23/2026	4:00:00	7.2	0.40125346	3.3	1147901.7	Open	12	339
2/23/2026	4:15:00	7.2	0.62837806	0	1147938.3	Open	11.4	333
2/23/2026	4:30:00	7.2	3.32737539	3.9	1147968.9	Open	11.3	370
2/23/2026	4:45:00	7.1	3.33494621	0	1148013.8	Open	11.3	374
2/23/2026	5:00:00	7.1	0.59809478	4.9	1148032.1	Open	12.7	334
2/23/2026	5:15:00	7.1	3.36144408	0	1148073.1	Open	11.4	364
2/23/2026	5:30:00	7.2	3.35765867	0	1148118.7	Open	11.4	368
2/23/2026	5:45:00	7.2	3.34251703	4.4	1148164.7	Open	11.4	372
2/23/2026	6:00:00	7.1	2.39237912	5.5	1148212.2	Open	11.4	373
2/23/2026	6:15:00	7.2	3.35008785	0	1148239.9	Open	11.7	367
2/23/2026	6:30:00	7.1	0.54888445	5.9	1148283.9	Open	11.7	331
2/23/2026	6:45:00	7.2	3.33873162	0	1148313.6	Open	11.5	365
2/23/2026	7:00:00	7.2	2.55136634	1.8	1148363.4	Open	11.4	370
2/23/2026	7:15:00	7.2	2.34316879	5.9	1148397.1	Open	11.3	355
2/23/2026	7:30:00	7.2	3.34251703	3.9	1148439.9	Open	11.2	362
2/23/2026	7:45:00	7.2	3.34630244	2.2	1148474.2	Open	11.6	354

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/23/2026	8:00:00	7.2	1.97976943	1.4	1148514.2	Open	11.1	355
2/23/2026	8:15:00	7.1	3.20624227	3.4	1148559.9	Open	11.1	359
2/23/2026	8:30:00	7.1	0.3028328	18.6	1148593.8	Open	11.3	333
2/23/2026	8:45:00	7.1	2.29017305	3.7	1148626	Open	11	354
2/23/2026	9:00:00	7.1	3.21002768	2.8	1148673.8	Open	11	356
2/23/2026	9:15:00	7.1	0.65487593	3.3	1148721.1	Open	11.1	357
2/23/2026	9:30:00	7.1	1.7412886	2.2	1148751.3	Open	11.2	348
2/23/2026	9:45:00	7.1	3.24788178	6.1	1148796.4	Open	11.2	349
2/23/2026	10:00:00	7.3	2.22582108	9.1	1148842.2	Open	11.3	355
2/23/2026	10:15:00	7.5	3.23652555	6.3	1148888.3	Open	11.3	354
2/23/2026	10:30:00	7.5	3.25923801	3.6	1148920.5	Open	11.3	354
2/23/2026	10:45:00	7.5	0.71544249	4.6	1148961.4	Open	11.3	359
2/23/2026	11:00:00	7.6	3.38037113	2.6	1148997	Open	11.4	356
2/23/2026	11:15:00	7.6	3.36522949	4	1149043.3	Open	11.4	358
2/23/2026	11:30:00	7.4	3.35765867	4	1149088.8	Open	11.5	359
2/23/2026	11:45:00	7.3	0.40503887	21.2	1149132.1	Open	11.6	330
2/23/2026	12:00:00	7.4	2.33181256	3.2	1149167.2	Open	11.5	361
2/23/2026	12:15:00	7.2	3.35765867	3.2	1149215.8	Open	11.5	364
2/23/2026	12:30:00	7.1	0.60945101	4.9	1149262.6	Open	11.5	335
2/23/2026	12:45:00	7.1	3.30466293	2.8	1149289.6	Open	11.4	359
2/23/2026	13:00:00	7.1	3.29709211	6.9	1149339.3	Open	11.4	363
2/23/2026	13:15:00	7.1	0.47317625	23.8	1149369.3	Open	12	334
2/23/2026	13:30:00	7.1	3.2933067	5.7	1149405.2	Open	11.5	358
2/23/2026	13:45:00	7.2	3.31223375	5.5	1149439.7	Open	11.4	356
2/23/2026	14:00:00	7.2	2.31288551	5.5	1149486.1	Open	11.5	359
2/23/2026	14:15:00	7.2	3.31980457	0	1149511.5	Open	11.6	354
2/23/2026	14:30:00	7.2	3.2933067	8.9	1149561.3	Open	11.6	358
2/23/2026	14:45:00	7.3	0.3028328	6.5	1149588.7	Closed	11.9	328
2/23/2026	15:00:00	7.5	2.29017305	12.1	1149633	Open	11.7	369
2/23/2026	15:15:00	7.6	3.28952129	0	1149681.5	Open	11.7	374
2/23/2026	15:30:00	7.6	3.30087752	0	1149711	Open	11.8	382
2/23/2026	15:45:00	7.6	2.36209584	5.7	1149759.6	Open	11.8	384

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/23/2026	16:00:00	7.5	2.31288551	0	1149785.3	Open	11.8	384
2/23/2026	16:15:00	7.4	3.3311608	0	1149816.3	Open	12.4	382
2/23/2026	16:30:00	7.3	3.29709211	0	1149866	Open	11.7	382
2/23/2026	16:45:00	7.2	3.32358998	0	1149893.1	Open	12	382
2/23/2026	17:00:00	7.3	3.31980457	0	1149933.7	Open	11.7	385
2/23/2026	17:15:00	7.3	0.35961395	0	1149962.5	Open	12.3	346
2/23/2026	17:30:00	7.3	0.51860117	0	1149998.7	Open	11.5	348
2/23/2026	17:45:00	7.2	3.31223375	0	1150034.7	Open	11.5	387
2/23/2026	18:00:00	7.1	2.02519435	0.2	1150069.4	Closed	11.7	390
2/23/2026	18:15:00	7.2	3.31223375	0	1150100.1	Open	11.4	391
2/23/2026	18:30:00	7.2	0.47696166	0	1150145.5	Open	11.3	354
2/23/2026	18:45:00	7.2	3.31223375	0	1150177.1	Open	11.2	390
2/23/2026	19:00:00	7.2	0.40125346	0	1150209.8	Open	11.4	350
2/23/2026	19:15:00	7.2	3.30466293	0	1150255.4	Open	11.2	391
2/23/2026	19:30:00	7.1	3.31980457	0	1150278.9	Open	11.3	395
2/23/2026	19:45:00	7.1	3.29709211	0	1150324.4	Open	11.2	395
2/23/2026	20:00:00	7.1	2.69521192	0	1150354.5	Open	11.2	393
2/23/2026	20:15:00	7.1	3.29709211	0	1150403	Open	11.1	395
2/23/2026	20:30:00	7.1	3.24409637	4.2	1150433.6	Open	11.3	390
2/23/2026	20:45:00	7.1	2.9147657	0	1150477.1	Open	11.2	386
2/23/2026	21:00:00	7.1	3.2933067	0	1150508.3	Open	11.2	382
2/23/2026	21:15:00	7.2	0.36718477	0	1150527.2	Open	11.5	343
2/23/2026	21:30:00	7.2	3.28573588	0	1150569.6	Open	11.4	374
2/23/2026	21:45:00	7.2	3.25166719	0	1150588.8	Closed	11.5	369
2/23/2026	22:00:00	7.2	1.93434451	0	1150604.1	Open	11.7	372
2/23/2026	22:15:00	7.2	3.2933067	0	1150649.5	Open	11.8	372
2/23/2026	22:30:00	7.2	3.30844834	0	1150682	Open	11.9	367
2/23/2026	22:45:00	7.3	3.28952129	0	1150726.7	Open	12	370
2/23/2026	23:00:00	7.3	3.31601916	0	1150760.2	Open	12	369
2/23/2026	23:15:00	7.4	3.28952129	2	1150810	Open	12	367
2/23/2026	23:30:00	7.4	0.56024068	0	1150839.4	Open	12.9	338
2/23/2026	23:45:00	7.5	0.38989723	114.1	1150876.7	Open	12.3	339

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/24/2026	0:00:00	7.4	2.31667092	0	1150908	Open	12.3	377
2/24/2026	0:15:00	7.2	0.38232641	0	1150949.5	Open	12.4	343
2/24/2026	0:30:00	6.9	3.30087752	0	1150985	Open	12.2	380
2/24/2026	0:45:00	6.6	3.28195047	0	1151028.5	Open	12.2	385
2/24/2026	1:00:00	6.7	3.30844834	0	1151059.5	Open	12.3	387
2/24/2026	1:15:00	6.7	0.31040362	0	1151094.3	Open	12.8	361
2/24/2026	1:30:00	6.8	3.2933067	2	1151129.9	Open	12.3	386
2/24/2026	1:45:00	6.7	2.41509158	1.8	1151177.7	Open	12.3	389
2/24/2026	2:00:00	6.8	2.34316879	0	1151205	Open	12.5	389
2/24/2026	2:15:00	7	0.38611182	2.3	1151240.1	Open	12.9	361
2/24/2026	2:30:00	7.2	3.31980457	16.2	1151268.9	Open	12.2	394
2/24/2026	2:45:00	7.3	2.31288551	0.8	1151308	Open	12.2	402
2/24/2026	3:00:00	7.3	3.3690149	0	1151339	Open	12.3	399
2/24/2026	3:15:00	7.3	3.36522949	0	1151385.2	Open	12.2	397
2/24/2026	3:30:00	7.3	2.49079978	3.8	1151406.6	Closed	12.3	400
2/24/2026	3:45:00	7.3	3.37280031	0	1151422.6	Open	12.3	397
2/24/2026	4:00:00	7.3	2.3091001	1	1151468.9	Open	12.2	398
2/24/2026	4:15:00	7.3	3.3690149	0	1151497	Open	12.2	395
2/24/2026	4:30:00	7.3	3.34251703	7	1151541.3	Open	12.2	397
2/24/2026	4:45:00	7.4	3.35765867	18.8	1151572.6	Open	13.2	401
2/24/2026	5:00:00	7.5	3.35387326	12.1	1151618.5	Open	12.2	402
2/24/2026	5:15:00	7.5	0.59809478	5.3	1151656.9	Open	12.4	367
2/24/2026	5:30:00	7.6	2.53243929	0	1151692.5	Open	12.2	411
2/24/2026	5:45:00	7.6	0.61323642	0	1151740.9	Open	11.9	414
2/24/2026	6:00:00	7.5	2.37723748	0	1151768.7	Open	12	410
2/24/2026	6:15:00	7.5	3.42579605	1.1	1151817	Open	11.9	410
2/24/2026	6:30:00	7.4	3.41822523	0.5	1151851.8	Open	12	403
2/24/2026	6:45:00	7.4	3.42958146	3.6	1151881.6	Open	12.2	400
2/24/2026	7:00:00	7.4	3.39929818	7	1151932.9	Open	11.9	403
2/24/2026	7:15:00	7.4	3.42201064	3.2	1151966.7	Open	11.8	398
2/24/2026	7:30:00	7.3	0.67380298	0	1152003.7	Open	11.5	362
2/24/2026	7:45:00	7.3	3.38037113	0	1152035.7	Open	11.4	395

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/24/2026	8:00:00	7.3	2.3469542	0	1152081.8	Open	11.4	398
2/24/2026	8:15:00	7.3	3.38415654	0	1152110.9	Open	11.4	388
2/24/2026	8:30:00	7.3	3.35387326	0.7	1152161.5	Open	11.3	395
2/24/2026	8:45:00	7.3	3.37658572	0	1152193.7	Open	11.5	385
2/24/2026	9:00:00	7.3	2.36966666	3.6	1152241.4	Open	11.4	388
2/24/2026	9:15:00	7.2	3.37658572	4.1	1152273.2	Open	11.6	384
2/24/2026	9:30:00	7.3	3.37280031	4.8	1152319.3	Open	11.4	384
2/24/2026	9:45:00	7.3	0.29904739	0	1152355.5	Open	11.6	347
2/24/2026	10:00:00	7.3	2.35452502	0	1152396.3	Open	11.4	380
2/24/2026	10:15:00	7.2	3.3690149	0	1152438.7	Open	11.4	370
2/24/2026	10:30:00	7.2	3.35387326	0.2	1152464.6	Open	11.3	359
2/24/2026	10:45:00	7.2	3.35765867	0	1152506.5	Open	11.3	362
2/24/2026	11:00:00	7.2	3.37658572	1.2	1152540.3	Open	11.6	357
2/24/2026	11:15:00	7.2	0.3028328	0.9	1152579.5	Open	11.6	333
2/24/2026	11:30:00	7.2	3.35765867	0.4	1152615.5	Open	11.5	356
2/24/2026	11:45:00	7.2	0	13.4	1152617.5	Open	11.6	362
2/24/2026	12:00:00	7.2	2.36966666	1.2	1152653.1	Open	11.6	364
2/24/2026	12:15:00	7.2	0.38232641	0	1152685	Open	12	332
2/24/2026	12:30:00	7.2	3.36522949	2.3	1152731.6	Open	11.7	353
2/24/2026	12:45:00	7	3.38037113	6.5	1152757.8	Open	11.9	354
2/24/2026	13:00:00	7.1	3.35008785	7.4	1152804.2	Open	11.8	357
2/24/2026	13:15:00	7.1	3.29709211	10.8	1152836.4	Open	11.9	360
2/24/2026	13:30:00	7.2	3.36144408	0	1152882	Open	11.9	365
2/24/2026	13:45:00	7.1	3.3690149	0.2	1152904.4	Open	12	370
2/24/2026	14:00:00	7.1	3.3690149	6.4	1152928.3	Open	12.3	370
2/24/2026	14:15:00	7.1	0.38989723	1	1152961.4	Open	12.4	333
2/24/2026	14:30:00	7.1	0.21955378	7.3	1152997.3	Open	11.9	336
2/24/2026	14:45:00	7.1	3.3690149	1.9	1153013.2	Open	11.9	375
2/24/2026	15:00:00	7	3.34630244	7.8	1153063.7	Open	11.7	380
2/24/2026	15:15:00	7	1.55958892	0	1153094.8	Open	11.8	375
2/24/2026	15:30:00	7	3.31980457	3	1153135.3	Open	11.7	379
2/24/2026	15:45:00	6.9	3.30087752	19.9	1153185	Open	11.6	382

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/24/2026	16:00:00	6.9	1.72614696	0	1153226.5	Open	11.7	384
2/24/2026	16:15:00	6.9	3.19110063	21.7	1153238.7	Open	12.4	341
2/24/2026	16:30:00	7	3.37280031	28.9	1153289.6	Open	11.6	380
2/24/2026	16:45:00	6.9	0.31797444	13.9	1153320.4	Open	11.7	383
2/24/2026	17:00:00	6.8	3.38415654	3	1153359.1	Open	11.5	384
2/24/2026	17:15:00	6.8	2.44158945	2.6	1153391.1	Open	11.9	382
2/24/2026	17:30:00	6.9	3.37658572	8.9	1153437.2	Open	11.5	382
2/24/2026	17:45:00	7	3.39172736	6.5	1153469.4	Open	11.6	387
2/24/2026	18:00:00	7	0.5299574	3.7	1153512.9	Open	11.7	389
2/24/2026	18:15:00	7	3.36522949	2.8	1153548.1	Open	11.6	390
2/24/2026	18:30:00	7.1	0.4163951	4.6	1153578.8	Open	11.8	349
2/24/2026	18:45:00	7.1	3.37658572	6.7	1153621.8	Open	11.6	391
2/24/2026	19:00:00	7.2	3.39929818	19.1	1153654	Open	11.6	395
2/24/2026	19:15:00	7.2	0.68515921	14.7	1153699.4	Open	11.6	400
2/24/2026	19:30:00	7.3	3.3311608	0	1153732.1	Open	11.6	409
2/24/2026	19:45:00	7.2	0.81007774	0	1153781.1	Open	11.7	408
2/24/2026	20:00:00	7	3.31601916	0	1153806.6	Open	11.8	401
2/24/2026	20:15:00	6.9	3.31980457	0	1153826.8	Open	11.7	396
2/24/2026	20:30:00	6.9	3.28573588	0	1153876.5	Open	11.7	401
2/24/2026	20:45:00	6.9	2.34316879	0	1153904.3	Open	11.9	391
2/24/2026	21:00:00	7.1	3.27816506	0	1153953	Open	11.8	395
2/24/2026	21:15:00	7.1	2.31288551	0	1153978	Open	12	386
2/24/2026	21:30:00	7.1	0.4921033	0	1154020	Open	12	350
2/24/2026	21:45:00	7.2	3.30844834	0	1154058.7	Open	12	384
2/24/2026	22:00:00	7.2	1.93434451	0	1154103.5	Open	12.1	384
2/24/2026	22:15:00	7.3	3.30466293	0	1154125.6	Open	12	377
2/24/2026	22:30:00	7.3	1.93812992	0	1154171.3	Open	12.1	377
2/24/2026	22:45:00	7.4	3.31223375	0	1154189.3	Open	12.2	374
2/24/2026	23:00:00	7.4	3.28952129	12.5	1154236.6	Open	12.2	377
2/24/2026	23:15:00	7.5	1.12426677	65.4	1154265	Open	12.2	380
2/24/2026	23:30:00	7.5	0.38611182	8.6	1154287.8	Open	12.9	344
2/24/2026	23:45:00	7.6	3.24788178	24.9	1154332.1	Open	12.2	388

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/25/2026	0:00:00	7.6	0.39368264	0	1154359.3	Open	12.8	359
2/25/2026	0:15:00	7.3	3.31601916	0	1154406.9	Open	12.1	395
2/25/2026	0:30:00	7.2	3.28573588	3	1154456.1	Open	12.1	395
2/25/2026	0:45:00	7.3	3.30466293	0	1154488.2	Open	12.2	387
2/25/2026	1:00:00	7.3	2.17282534	0	1154519.4	Open	13.1	387
2/25/2026	1:15:00	7.4	2.3091001	112.5	1154566.6	Open	12.3	387
2/25/2026	1:30:00	7.3	3.23274014	0	1154593.1	Open	13.2	373
2/25/2026	1:45:00	7.3	3.29709211	1.7	1154642.8	Open	12.3	385
2/25/2026	2:00:00	7.3	0.23469542	8	1154678.1	Open	12.8	359
2/25/2026	2:15:00	7.3	0.35204313	0	1154693.8	Open	12.7	349
2/25/2026	2:30:00	7.3	3.28195047	0.4	1154742.5	Open	12.4	382
2/25/2026	2:45:00	7.3	3.13810489	0	1154771.1	Closed	13	380
2/25/2026	3:00:00	7.3	2.3469542	0	1154783.1	Open	12.5	382
2/25/2026	3:15:00	7.4	2.26746059	12.2	1154829.6	Open	12.4	385
2/25/2026	3:30:00	7.3	3.31980457	0	1154851.6	Open	12.5	379
2/25/2026	3:45:00	7.3	2.38859371	6.5	1154899.4	Open	12.3	380
2/25/2026	4:00:00	7.3	3.32737539	0	1154934.5	Open	12.4	371
2/25/2026	4:15:00	7.3	3.30087752	0	1154984.2	Open	12.1	374
2/25/2026	4:30:00	7.3	3.27437965	12	1155032.8	Open	12	379
2/25/2026	4:45:00	7.3	3.31223375	0	1155063.9	Open	12.2	375
2/25/2026	5:00:00	7.3	3.30087752	0	1155112.9	Open	12.2	375
2/25/2026	5:15:00	7.3	2.35073961	26.4	1155160.8	Open	12.2	375
2/25/2026	5:30:00	7.3	3.28573588	6	1155203.1	Open	12.2	380
2/25/2026	5:45:00	7.4	0.46182002	9.3	1155238.6	Open	12.9	341
2/25/2026	6:00:00	7.4	2.82013045	0	1155275.8	Open	12.2	374
2/25/2026	6:15:00	7.4	3.19110063	0	1155314.8	Open	12.1	377
2/25/2026	6:30:00	7.4	3.19867145	0	1155338.2	Open	12	380
2/25/2026	6:45:00	7.4	0	0	1155369.2	Closed	12	383
2/25/2026	7:00:00	7.4	3.20245686	0	1155415.6	Open	11.8	385
2/25/2026	7:15:00	7.4	3.17217358	0.3	1155463.4	Open	11.7	385
2/25/2026	7:30:00	7.4	0	0	1155507.3	Closed	11.6	389
2/25/2026	7:45:00	7.4	3.16081735	0	1155541.2	Open	11.5	390

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/25/2026	8:00:00	7.4	3.09267997	0	1155556	Open	11.5	393
2/25/2026	8:15:00	7.4	3.13053407	0	1155601.5	Open	11.4	393
2/25/2026	8:30:00	7.3	3.20245686	0	1155624.7	Open	11.7	377
2/25/2026	8:45:00	7.3	3.21381309	0	1155669.3	Open	11.5	380
2/25/2026	9:00:00	7.3	3.21381309	0	1155713.5	Open	11.5	383
2/25/2026	9:15:00	7.4	3.21002768	2.7	1155758.1	Open	11.7	385
2/25/2026	9:30:00	7.5	3.22895473	12.8	1155785.7	Open	11.9	375
2/25/2026	9:45:00	7.6	3.23652555	9.5	1155816	Open	12.1	379
2/25/2026	10:00:00	7.7	3.22138391	11	1155860	Open	12.1	380
2/25/2026	10:15:00	7.8	3.22895473	7.5	1155904.6	Open	12.2	382
2/25/2026	10:30:00	7.8	3.22895473	16.4	1155948.8	Open	12.3	384
2/25/2026	10:45:00	7.8	3.21381309	11	1155993.3	Open	12.3	385
2/25/2026	11:00:00	7.8	3.22516932	6.3	1156022.9	Open	12.5	379
2/25/2026	11:15:00	7.7	0.378541	3	1156062	Open	12.6	341
2/25/2026	11:30:00	7.6	3.2175985	4	1156096.7	Open	12.6	374
2/25/2026	11:45:00	7.6	3.22138391	6.5	1156141.1	Open	12.5	378
2/25/2026	12:00:00	7.6	3.22895473	4.2	1156170.7	Open	12.4	370
2/25/2026	12:15:00	7.5	3.19867145	4.5	1156215.1	Open	12.2	375
2/25/2026	12:30:00	7.4	3.19488604	7.8	1156259.3	Open	12.1	375
2/25/2026	12:45:00	7.3	0.46939084	5.4	1156286.8	Open	12.6	382
2/25/2026	13:00:00	7.3	3.20624227	4.8	1156330.3	Open	13.1	384
2/25/2026	13:15:00	7.2	3.19488604	3.6	1156374.5	Open	13.7	387
2/25/2026	13:30:00	7.2	3.11539243	3.5	1156392.2	Closed	14.3	387
2/25/2026	13:45:00	7.2	3.21381309	3.4	1156402.9	Open	14.8	389
2/25/2026	14:00:00	7.1	3.19867145	3.3	1156447.2	Open	15.3	390
2/25/2026	14:15:00	7.1	3.17595899	3.3	1156490.7	Open	15.8	394
2/25/2026	14:30:00	7.1	3.19867145	3.1	1156521.1	Open	16.1	395
2/25/2026	14:45:00	7.1	3.1797444	4.1	1156564.9	Open	16.4	399
2/25/2026	15:00:00	7.1	3.19488604	3.2	1156593.8	Open	16.7	399
2/25/2026	15:15:00	7.2	3.1797444	11.5	1156637.8	Open	12.5	387
2/25/2026	15:30:00	7.2	3.17217358	14.1	1156681.6	Open	12.2	394
2/25/2026	15:45:00	7.2	3.1797444	7.2	1156713.2	Open	12.2	382

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/25/2026	16:00:00	7.2	3.16838817	10.8	1156757	Open	12	385
2/25/2026	16:15:00	7.2	3.17595899	13.8	1156800.8	Open	12	387
2/25/2026	16:30:00	7.2	3.19110063	25.5	1156841.8	Open	12	387
2/25/2026	16:45:00	7.2	0.47317625	21.8	1156859.3	Open	12.9	348
2/25/2026	17:00:00	7.2	3.22138391	21.2	1156902.8	Open	11.9	382
2/25/2026	17:15:00	7.1	3.16081735	11	1156944.7	Open	11.9	385
2/25/2026	17:30:00	7.1	3.15703194	11	1156988.2	Open	11.9	385
2/25/2026	17:45:00	7.1	3.19110063	6.6	1157018.2	Open	11.9	382
2/25/2026	18:00:00	7.1	3.16838817	10.6	1157061.8	Open	11.8	380
2/25/2026	18:15:00	7.2	3.16838817	9.6	1157105.6	Open	11.9	384
2/25/2026	18:30:00	7.2	3.17217358	4.7	1157134.9	Open	11.9	377
2/25/2026	18:45:00	7.2	3.16838817	8.3	1157178.5	Open	11.9	382
2/25/2026	19:00:00	7.2	3.16838817	5.7	1157207.1	Open	12	374
2/25/2026	19:15:00	7.2	3.16460276	7.1	1157250.9	Open	11.9	375
2/25/2026	19:30:00	7.1	0.41260969	7.5	1157264.7	Open	12.7	342
2/25/2026	19:45:00	7.1	0.50345953	2.9	1157299.6	Open	11.7	336
2/25/2026	20:00:00	7.1	3.14946112	2.6	1157322.2	Open	11.7	369
2/25/2026	20:15:00	7.1	2.86555537	7.1	1157363	Open	11.6	372
2/25/2026	20:30:00	7.1	3.17595899	7.3	1157406.5	Open	11.9	355
2/25/2026	20:45:00	7.1	2.44158945	7.7	1157450.3	Open	11.7	359
2/25/2026	21:00:00	7.2	3.17595899	4.9	1157493.9	Open	11.8	365
2/25/2026	21:15:00	7.2	2.38102289	1.6	1157509.4	Open	11.9	351
2/25/2026	21:30:00	7.3	3.18731522	0.1	1157553.4	Open	11.9	357
2/25/2026	21:45:00	7.2	2.271246	0.8	1157596.9	Open	11.9	365
2/25/2026	22:00:00	7.1	0.56402609	4.1	1157638.5	Open	11.9	334
2/25/2026	22:15:00	7.1	2.30531469	2.5	1157659.8	Open	11.9	347
2/25/2026	22:30:00	7.1	3.14946112	3.1	1157681.9	Closed	11.9	354
2/25/2026	22:45:00	7.2	2.25610436	1.5	1157712.3	Open	11.9	348
2/25/2026	23:00:00	7.2	3.17595899	2.2	1157756.4	Open	11.9	351
2/25/2026	23:15:00	7.1	2.31667092	2.9	1157799.9	Open	11.9	352
2/25/2026	23:30:00	7.1	3.19488604	2	1157844	Open	12	357
2/25/2026	23:45:00	7.2	2.28638764	0.8	1157887.6	Open	12.1	362

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/26/2026	0:00:00	7.2	3.17217358	0.3	1157931.6	Open	12.2	366
2/26/2026	0:15:00	7.2	2.2333919	0.6	1157975.3	Open	12.3	365
2/26/2026	0:30:00	7.2	3.11160702	8.3	1157986.4	Closed	12.3	367
2/26/2026	0:45:00	7.2	2.25231895	2.4	1158020.1	Open	12.3	369
2/26/2026	1:00:00	7.2	3.17595899	2.5	1158064.4	Open	12.2	369
2/26/2026	1:15:00	7.2	2.34316879	1.7	1158108	Open	12.3	371
2/26/2026	1:30:00	7.2	3.17217358	2	1158152.1	Open	12.3	373
2/26/2026	1:45:00	7.2	2.25988977	2.5	1158195.6	Open	12.3	373
2/26/2026	2:00:00	7.2	2.86176996	3.5	1158240	Open	12.3	374
2/26/2026	2:15:00	7.2	2.24474813	14.8	1158283.1	Open	12.3	374
2/26/2026	2:30:00	7.2	0.21955378	7.7	1158319	Open	12.5	338
2/26/2026	2:45:00	7.2	2.22582108	16.4	1158346.2	Open	12.3	353
2/26/2026	3:00:00	7.2	2.33559797	7.8	1158389.7	Open	12.3	361
2/26/2026	3:15:00	7.2	2.3091001	2.4	1158420.2	Open	12.3	344
2/26/2026	3:30:00	7.2	2.29395846	5.9	1158464.2	Open	12.3	349
2/26/2026	3:45:00	7.2	2.22203567	1.1	1158506.8	Open	12.4	354
2/26/2026	4:00:00	7.2	2.27503141	0.5	1158537.5	Open	12.5	339
2/26/2026	4:15:00	7.1	2.21825026	2.1	1158580.6	Open	12.5	343
2/26/2026	4:30:00	7.1	2.21446485	2	1158624.3	Open	12.4	347
2/26/2026	4:45:00	7.1	2.1955378	5.4	1158666.8	Open	12.2	349
2/26/2026	5:00:00	7.1	2.26367518	4.3	1158695.2	Open	12.1	338
2/26/2026	5:15:00	7.1	2.31288551	11.5	1158738.5	Open	12	344
2/26/2026	5:30:00	7.2	2.27881682	1.3	1158782.5	Open	12.1	343
2/26/2026	5:45:00	7.2	2.2333919	2.8	1158825.6	Open	12.6	346
2/26/2026	6:00:00	7.2	2.20689403	4	1158869.1	Open	13.5	357
2/26/2026	6:15:00	7.2	2.25231895	1.1	1158897.8	Open	12.4	338
2/26/2026	6:30:00	7.2	2.24474813	3.4	1158942	Open	12.4	338
2/26/2026	6:45:00	7.3	2.271246	2.4	1158984.9	Open	12.3	342
2/26/2026	7:00:00	7.3	1.10533972	4	1159028.3	Open	12.1	346
2/26/2026	7:15:00	7.4	1.99491107	4.5	1159058.2	Open	12	346
2/26/2026	7:30:00	7.4	2.29395846	8.1	1159101	Open	11.9	349
2/26/2026	7:45:00	7.5	2.04033599	1	1159128.8	Open	11.9	354

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/26/2026	8:00:00	7.5	1.86242172	3.3	1159172.3	Open	11.9	354
2/26/2026	8:15:00	7.5	0.27633493	1.6	1159197.1	Open	11.9	357
2/26/2026	8:30:00	7.4	2.22582108	5.7	1159239.1	Open	11.7	359
2/26/2026	8:45:00	7.3	2.24096272	4.4	1159282.1	Open	11.7	360
2/26/2026	9:00:00	7.3	2.22203567	7.1	1159312.2	Open	11.8	351
2/26/2026	9:15:00	7.3	2.29017305	0.9	1159334.3	Open	11.9	343
2/26/2026	9:30:00	7.3	2.25988977	4.2	1159378.3	Open	11.8	348
2/26/2026	9:45:00	7.3	0.27633493	1.5	1159405.8	Closed	12.5	328
2/26/2026	10:00:00	7.2	2.29017305	3.9	1159437.7	Open	11.8	344
2/26/2026	10:15:00	7.1	2.23717731	13.3	1159482.1	Open	11.8	348
2/26/2026	10:30:00	7.1	2.26746059	43.6	1159510	Open	11.7	350
2/26/2026	10:45:00	7	1.73750319	19.1	1159552.9	Open	11.7	353
2/26/2026	11:00:00	6.9	1.61258466	31.6	1159595.3	Open	11.7	355
2/26/2026	11:15:00	6.9	1.95327156	1.4	1159627.4	Open	11.9	356
2/26/2026	11:30:00	6.9	0.45046379	0.7	1159656.7	Open	11.9	359
2/26/2026	11:45:00	7	2.06304845	83.5	1159696.8	Closed	11.8	362
2/26/2026	12:00:00	6.9	0.30661821	50	1159720.6	Open	11.8	365
2/26/2026	12:15:00	6.9	1.9684132	26.7	1159758.2	Open	11.7	369
2/26/2026	12:30:00	6.9	0.23848083	34.5	1159800.6	Closed	11.6	369
2/26/2026	12:45:00	6.9	2.36209584	28.8	1159829.5	Open	11.6	374
2/26/2026	13:00:00	6.9	0.58673855	47.7	1159873.8	Open	11.5	375
2/26/2026	13:15:00	6.9	0.6813738	40.5	1159897.1	Open	11.5	378
2/26/2026	13:30:00	6.9	2.30531469	80.9	1159944.8	Open	11.4	380
2/26/2026	13:45:00	6.9	3.27437965	30.3	1159977.1	Open	11.4	381
2/26/2026	14:00:00	6.9	0.42018051	19.6	1160006	Open	10.7	380
2/26/2026	14:15:00	6.9	3.27816506	4.8	1160050.7	Open	11.3	383
2/26/2026	14:30:00	6.9	2.36966666	14.9	1160083	Open	11.4	386
2/26/2026	14:45:00	6.9	0.36339936	14.4	1160115.5	Open	11.5	385
2/26/2026	15:00:00	6.9	1.92298828	51.9	1160158.5	Open	11.5	388
2/26/2026	15:15:00	6.8	2.33181256	14.5	1160182.1	Open	11.5	386
2/26/2026	15:30:00	6.8	2.25988977	29.1	1160207.7	Closed	11.6	390
2/26/2026	15:45:00	6.8	1.90027582	25.8	1160241.3	Open	11.5	390

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/26/2026	16:00:00	6.8	2.3091001	29.4	1160278.1	Open	11.5	391
2/26/2026	16:15:00	6.7	2.29017305	47.2	1160322	Open	11.4	391
2/26/2026	16:30:00	6.7	2.29774387	47.8	1160342.6	Open	11.5	395
2/26/2026	16:45:00	6.7	0.22333919	46.5	1160361.6	Open	11.6	395
2/26/2026	17:00:00	6.7	0.13248935	34.3	1160363.7	Open	11.7	398
2/26/2026	17:15:00	6.7	1.54823269	35.2	1160383.6	Closed	11.3	400
2/26/2026	17:30:00	6.8	1.63529712	33.5	1160405.1	Closed	11.3	400
2/26/2026	17:45:00	6.8	1.61258466	5.2	1160445.9	Open	11.3	400
2/26/2026	18:00:00	6.8	1.56337433	10.7	1160487.8	Open	11.2	400
2/26/2026	18:15:00	6.8	0.40125346	17.4	1160527.3	Open	11.3	403
2/26/2026	18:30:00	6.9	3.26680883	18.5	1160561.8	Open	11.3	403
2/26/2026	18:45:00	6.9	3.27437965	19.6	1160606.5	Open	11.3	406
2/26/2026	19:00:00	6.9	3.11917784	16.8	1160649	Open	11.4	406
2/26/2026	19:15:00	6.9	0.60188019	13	1160681.2	Open	11.5	406
2/26/2026	19:30:00	6.9	2.31667092	44.6	1160720.4	Open	11.4	405
2/26/2026	19:45:00	6.9	3.21381309	55.4	1160761.5	Open	11.3	406
2/26/2026	20:00:00	6.8	0.35204313	46.6	1160774.8	Open	11.4	408
2/26/2026	20:15:00	6.9	3.22895473	2	1160804.9	Open	11.4	410
2/26/2026	20:30:00	6.9	3.48636261	48.2	1160846.3	Open	11.2	406
2/26/2026	20:45:00	6.8	0.33690149	44.2	1160875.4	Open	11.3	410
2/26/2026	21:00:00	6.8	3.35765867	33.6	1160915.3	Open	11.2	410
2/26/2026	21:15:00	6.8	0.36718477	20.5	1160957	Open	11.2	410
2/26/2026	21:30:00	6.8	3.19110063	9.7	1160987	Open	11.2	411
2/26/2026	21:45:00	6.8	2.74063684	15.3	1161034.2	Open	11.2	413
2/26/2026	22:00:00	7	0.1892705	30.5	1161063.1	Open	11.2	413
2/26/2026	22:15:00	7.2	2.93747816	42.8	1161082.9	Open	11.2	416
2/26/2026	22:30:00	7.4	1.80564057	54.6	1161103.8	Open	11.3	418
2/26/2026	22:45:00	7.6	3.028328	29.1	1161147.6	Open	11.3	420
2/26/2026	23:00:00	7.7	2.91855111	6.6	1161191.3	Open	11.3	420
2/26/2026	23:15:00	7.6	2.00248189	0.7	1161218.4	Closed	11.3	420
2/26/2026	23:30:00	7.6	3.06996751	0.5	1161241.9	Open	11.3	421
2/26/2026	23:45:00	7.5	3.05861128	0.6	1161288	Open	11.3	421

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/27/2026	0:00:00	7.4	3.13810489	1	1161329.4	Open	11.4	419
2/27/2026	0:15:00	7.4	0.64730511	2.6	1161373.7	Open	11.4	421
2/27/2026	0:30:00	7.3	2.90340947	1.3	1161404.2	Open	11.5	419
2/27/2026	0:45:00	7.3	3.20624227	0	1161427.8	Open	11.7	417
2/27/2026	1:00:00	7.3	3.16081735	3.1	1161431.7	Closed	11.8	415
2/27/2026	1:15:00	7.3	1.25297071	7.8	1161432.2	Open	11.9	416
2/27/2026	1:30:00	7.3	3.2175985	8.6	1161466.7	Open	11.9	416
2/27/2026	1:45:00	7.3	3.21002768	15.3	1161515.1	Open	11.9	416
2/27/2026	2:00:00	7.4	0.53374281	4.9	1161545.5	Open	11.8	418
2/27/2026	2:15:00	7.4	2.30152928	6.3	1161586.1	Open	11.7	419
2/27/2026	2:30:00	7.4	3.19110063	6.2	1161632.1	Open	11.7	417
2/27/2026	2:45:00	7.4	3.2175985	0.3	1161659.2	Open	11.6	422
2/27/2026	3:00:00	7.4	3.18352981	0.3	1161707.1	Open	11.5	419
2/27/2026	3:15:00	7.3	2.29395846	1.7	1161750.4	Open	11.6	420
2/27/2026	3:30:00	7.3	0.39368264	0.7	1161781.9	Open	11.8	420
2/27/2026	3:45:00	7.3	3.21381309	0.6	1161826.1	Open	11.7	420
2/27/2026	4:00:00	7.3	3.19867145	2.9	1161874.4	Open	11.8	421
2/27/2026	4:15:00	7.3	2.3469542	1.2	1161917.1	Open	11.8	421
2/27/2026	4:30:00	7.3	3.19867145	0	1161959.4	Open	11.8	420
2/27/2026	4:45:00	7.2	2.30152928	1.2	1161987.4	Open	12.1	421
2/27/2026	5:00:00	7.2	3.21002768	0	1162031.5	Open	12	416
2/27/2026	5:15:00	7.2	2.51351224	1	1162077.2	Open	12	416
2/27/2026	5:30:00	7.2	0	0.2	1162114.2	Closed	12	418
2/27/2026	5:45:00	7.2	3.22895473	0.6	1162146.7	Open	12	418
2/27/2026	6:00:00	7.2	3.22138391	11.3	1162194.8	Open	12	415
2/27/2026	6:15:00	7.3	2.45673109	24.9	1162241.1	Open	12.1	415
2/27/2026	6:30:00	7.4	3.24409637	27.2	1162256.5	Open	12.5	421
2/27/2026	6:45:00	7.4	0.42775133	10.7	1162280.2	Open	12.3	416
2/27/2026	7:00:00	7.5	3.03968423	24.2	1162316.7	Open	11.8	415
2/27/2026	7:15:00	7.5	3.21381309	13	1162361.3	Open	11.7	418
2/27/2026	7:30:00	7.5	3.18352981	12.2	1162409.1	Open	11.7	416
2/27/2026	7:45:00	7.5	3.22516932	4.4	1162452	Open	11.7	416

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/27/2026	8:00:00	7.5	0.24605165	8.3	1162489.5	Open	11.8	415
2/27/2026	8:15:00	7.4	3.2554526	1.7	1162513.4	Open	11.8	415
2/27/2026	8:30:00	7.4	3.24788178	2.1	1162562.2	Open	11.8	415
2/27/2026	8:45:00	7.3	3.15703194	0.9	1162602	Open	11.8	415
2/27/2026	9:00:00	7.3	3.16081735	0.9	1162649.4	Open	11.9	411
2/27/2026	9:15:00	7.3	3.15703194	1.4	1162697	Open	12.1	411
2/27/2026	9:45:00	7.2	0.378541	5.7	1162749	Closed	12.1	413
2/27/2026	10:00:00	7.2	3.14946112	1.3	1162784	Open	11.9	416
2/27/2026	10:15:00	7.2	3.17595899	4.4	1162823.7	Open	12	415
2/27/2026	10:30:00	7.3	3.1797444	16.1	1162858.8	Open	12	416
2/27/2026	10:45:00	7.3	3.30466293	28.2	1162893.3	Open	12	413
2/27/2026	11:00:00	7.4	3.36144408	25.3	1162932.6	Open	12	415
2/27/2026	11:15:00	7.5	3.34630244	25.9	1162966.9	Open	12.1	411
2/27/2026	11:30:00	7.5	3.69834557	23.4	1163008.2	Open	12.1	415
2/27/2026	11:45:00	7.5	3.69834557	20.6	1163050.1	Open	12.1	415
2/27/2026	12:00:00	7.5	3.64156442	11.1	1163097.5	Open	12.1	416
2/27/2026	12:15:00	7.5	3.31980457	5.6	1163135.1	Open	12	415
2/27/2026	12:30:00	7.4	3.31223375	4.2	1163181.2	Open	12	418
2/27/2026	12:45:00	7.4	3.22895473	8.1	1163218.1	Open	12	416
2/27/2026	13:00:00	7.4	3.05104046	8.1	1163258.8	Closed	12	416
2/27/2026	13:15:00	7.3	3.22895473	9.7	1163301.7	Open	12	416
2/27/2026	13:30:00	7.3	3.4447231	8.9	1163338.2	Open	12	417
2/27/2026	13:45:00	7.2	3.43715228	7.3	1163385.4	Open	12	418
2/27/2026	14:00:00	7.2	0.06056656	6.3	1163430	Closed	12	418
2/27/2026	14:15:00	7.2	3.54314376	12	1163437.4	Open	12.1	418
2/27/2026	14:30:00	7.2	3.54692917	6.2	1163474.6	Open	12	418
2/27/2026	14:45:00	7.2	3.53178753	1	1163524.1	Open	12	416
2/27/2026	15:00:00	7.2	3.57721245	4.1	1163561.4	Open	12	416
2/27/2026	15:15:00	7.1	3.56207081	10.5	1163611.4	Open	12	416
2/27/2026	15:30:00	7.1	0	6.8	1163640.8	Closed	12.2	418
2/27/2026	15:45:00	7.1	3.58099786	4	1163671.8	Open	12	418
2/27/2026	16:00:00	7.1	3.49393343	5.2	1163699.4	Open	12.1	420

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/27/2026	16:15:00	7.1	3.34251703	5.5	1163744.5	Open	11.9	418
2/27/2026	16:30:00	7.1	3.33494621	5.7	1163790.1	Open	11.8	418
2/27/2026	16:45:00	7.1	3.65292065	3.8	1163835.8	Closed	11.8	418
2/27/2026	17:00:00	7.1	3.18352981	1.6	1163836.7	Open	12.1	420
2/27/2026	17:15:00	7.1	3.32737539	1.4	1163883	Open	11.9	418
2/27/2026	17:30:00	7.1	3.31223375	0.7	1163929.2	Open	11.9	418
2/27/2026	17:45:00	7.1	3.31601916	0.1	1163975.4	Open	11.8	418
2/27/2026	18:00:00	7.1	3.34251703	0	1163989.7	Open	12.1	418
2/27/2026	18:15:00	7.1	3.32737539	0	1164036.1	Open	11.9	416
2/27/2026	18:30:00	7.1	3.32358998	0	1164082.3	Open	11.8	416
2/27/2026	18:45:00	7.1	3.18352981	0.4	1164127.1	Open	11.8	418
2/27/2026	19:00:00	7.1	3.32358998	0.8	1164173.3	Open	11.7	416
2/27/2026	19:15:00	7.1	3.30844834	2.7	1164219.6	Open	11.7	417
2/27/2026	19:30:00	7.1	0.91228381	1.1	1164220.5	Closed	11.8	417
2/27/2026	19:45:00	7.1	3.33494621	3.3	1164236.8	Open	11.6	416
2/27/2026	20:00:00	7.1	3.32737539	0.8	1164283.4	Open	11.5	419
2/27/2026	20:15:00	7.1	3.32737539	0	1164326.9	Open	11.6	414
2/27/2026	20:30:00	7	0.38989723	0	1164341.3	Open	11.9	414
2/27/2026	20:45:00	7	3.33494621	0	1164386.3	Open	11.7	412
2/27/2026	21:00:00	7	2.70656815	0.3	1164432.3	Open	11.7	413
2/27/2026	21:15:00	7	3.20245686	1	1164475.2	Open	11.7	411
2/27/2026	21:30:00	7	3.24409637	0.4	1164501.7	Open	11.9	413
2/27/2026	21:45:00	7.1	3.23652555	2.4	1164546.1	Open	12	410
2/27/2026	22:00:00	7.1	3.22516932	4	1164590.6	Open	12.2	405
2/27/2026	22:15:00	7.1	3.2175985	6.1	1164635	Open	12.3	410
2/27/2026	22:30:00	7	3.2175985	9.8	1164679.5	Open	12.3	408
2/27/2026	22:45:00	7	3.22516932	7.6	1164723.6	Open	12.3	408
2/27/2026	23:00:00	7	3.24409637	3.8	1164741.6	Open	12.2	410
2/27/2026	23:15:00	7	3.22516932	0.4	1164786	Open	12.2	410
2/27/2026	23:30:00	7.1	3.2175985	0.3	1164830.2	Open	12.3	408
2/27/2026	23:45:00	7.1	3.19488604	0.2	1164874.4	Open	12.3	405
2/28/2026	0:00:00	7.1	0.32175985	0	1164892.9	Open	12.6	408

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/28/2026	0:15:00	7.1	3.22516932	0	1164935	Open	12.4	405
2/28/2026	0:30:00	7.1	3.2175985	0	1164979.4	Open	12.4	404
2/28/2026	0:45:00	7.1	3.23652555	0	1164996.4	Open	12.6	403
2/28/2026	1:00:00	7	3.24409637	0	1165041.1	Open	12.6	403
2/28/2026	1:15:00	7	3.24788178	0	1165086.1	Open	12.5	405
2/28/2026	1:30:00	7	3.25923801	0	1165131.4	Open	12.4	405
2/28/2026	1:45:00	7	3.19488604	1.7	1165175.7	Open	12.4	405
2/28/2026	2:00:00	7	3.11917784	1.6	1165183.4	Closed	12.5	405
2/28/2026	2:15:00	7	3.2175985	4.6	1165214.9	Open	12.4	405
2/28/2026	2:30:00	7	3.2175985	2.1	1165259.2	Open	12.3	403
2/28/2026	2:45:00	7	3.20624227	1.8	1165303.6	Open	12.3	405
2/28/2026	3:00:00	7	3.19488604	1.9	1165347.8	Open	12.3	405
2/28/2026	3:15:00	7	0.19684132	0	1165364.6	Closed	12.5	403
2/28/2026	3:30:00	7	3.23274014	1.3	1165406	Open	12.3	404
2/28/2026	3:45:00	7	3.19867145	1.4	1165450.2	Open	12.4	403
2/28/2026	4:00:00	7	3.18352981	0.3	1165461.4	Closed	12.4	403
2/28/2026	4:15:00	7	3.22516932	1	1165486.5	Open	12.4	403
2/28/2026	4:30:00	7	3.22516932	0.7	1165531	Open	12.4	405
2/28/2026	4:45:00	7	3.2175985	0.7	1165574.9	Open	12.5	403
2/28/2026	5:00:00	7	3.21002768	0.5	1165619.4	Open	12.5	404
2/28/2026	5:15:00	7	3.19488604	2.5	1165663.7	Open	12.5	404
2/28/2026	5:30:00	7	3.23652555	5.8	1165704	Open	12.4	401
2/28/2026	5:45:00	7	3.23652555	7.2	1165748.3	Open	12.4	404
2/28/2026	6:00:00	6.9	3.26680883	7.3	1165768.5	Open	12.4	405
2/28/2026	6:15:00	7	3.15703194	9.2	1165806.7	Open	12.2	405
2/28/2026	6:30:00	7	3.27816506	0.4	1165846.6	Open	12.1	403
2/28/2026	6:45:00	7	3.25923801	1.1	1165891.6	Open	12.2	402
2/28/2026	7:00:00	7	3.26302342	0.7	1165932.7	Open	12.3	402
2/28/2026	7:15:00	7	3.2175985	1	1165952.4	Closed	12.2	401
2/28/2026	7:30:00	6.9	3.19110063	1.5	1165992.1	Open	12	406
2/28/2026	7:45:00	6.9	3.22516932	2.2	1166034.7	Open	11.9	408
2/28/2026	8:00:00	6.9	3.2175985	2.2	1166079.3	Open	11.8	406

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/28/2026	8:15:00	6.9	3.2554526	6.1	1166106.4	Open	11.9	406
2/28/2026	8:30:00	6.9	3.24031096	4.1	1166151.3	Open	11.9	406
2/28/2026	8:45:00	6.9	3.33494621	2.5	1166193.1	Open	11.9	406
2/28/2026	9:00:00	6.9	3.34630244	2.4	1166239.7	Open	11.9	406
2/28/2026	9:15:00	6.9	3.20245686	4	1166284.6	Closed	11.9	407
2/28/2026	9:30:00	6.9	3.34630244	3.9	1166322.7	Open	11.9	406
2/28/2026	9:45:00	6.9	3.14946112	45.7	1166367.6	Closed	12	406
2/28/2026	10:00:00	7	3.3311608	2.2	1166405.4	Open	11.9	406
2/28/2026	10:15:00	7	3.14946112	4.8	1166429.9	Closed	12	406
2/28/2026	10:30:00	7	3.42579605	3.6	1166474	Open	12	407
2/28/2026	10:45:00	7	3.38794195	3.1	1166521	Open	12.1	405
2/28/2026	11:00:00	7	3.37658572	3.2	1166552.4	Open	12.1	403
2/28/2026	11:15:00	7	0	3.5	1166583.1	Closed	12.3	403
2/28/2026	11:30:00	7	3.41443982	1.1	1166625.1	Open	12.2	404
2/28/2026	11:45:00	7	3.38794195	1	1166672.3	Open	12.2	405
2/28/2026	12:00:00	7	3.38037113	0	1166710	Open	12.1	403
2/28/2026	12:15:00	7	3.40308359	0.2	1166725.3	Open	12.4	406
2/28/2026	12:30:00	7	3.41065441	2.2	1166772.6	Open	12.2	404
2/28/2026	12:45:00	7	3.28952129	4.9	1166802.7	Open	12.3	404
2/28/2026	13:00:00	7	3.41065441	9.8	1166849.8	Open	12.4	402
2/28/2026	13:15:00	7	2.55515175	6.5	1166896.9	Open	12.5	401
2/28/2026	13:30:00	7	0	6.6	1166922.6	Closed	12.7	402
2/28/2026	13:45:00	7	2.35073961	38.9	1166949	Open	12.5	402
2/28/2026	14:00:00	7	3.24409637	11.4	1166982.9	Open	12.4	400
2/28/2026	14:15:00	7	2.34316879	10.9	1167027.5	Open	12.3	402
2/28/2026	14:30:00	7	3.22138391	27.7	1167072.1	Open	12.4	400
2/28/2026	14:45:00	7	2.35073961	13.6	1167116.5	Open	12.4	400
2/28/2026	15:00:00	7	3.21002768	10.5	1167145.7	Open	12.5	399
2/28/2026	15:15:00	7	1.69207827	14.3	1167189.5	Open	12.5	399
2/28/2026	15:30:00	7	3.18352981	11.5	1167210	Open	12.6	400
2/28/2026	15:45:00	7	2.29017305	1.9	1167251	Open	12.6	399
2/28/2026	16:00:00	6.9	3.20245686	1.1	1167295.4	Open	12.5	400

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
2/28/2026	16:15:00	6.9	2.36966666	2.8	1167340.4	Open	12.4	401
2/28/2026	16:30:00	6.9	3.33873162	7.5	1167364.2	Open	12.3	400
2/28/2026	16:45:00	7	2.36209584	20.6	1167409.5	Open	12.3	400
2/28/2026	17:00:00	7	3.35765867	48.3	1167434.8	Open	12.3	400
2/28/2026	17:15:00	6.9	1.59365761	21.3	1167467.3	Open	12.2	399
2/28/2026	17:30:00	6.9	3.46743556	0.6	1167512.4	Open	12.1	398
2/28/2026	17:45:00	6.9	2.52108306	0	1167559.8	Open	12.1	400
2/28/2026	18:00:00	6.9	3.54314376	0	1167609.4	Open	12.1	400
2/28/2026	18:15:00	7	2.55136634	0	1167651.4	Open	12.2	397
2/28/2026	18:30:00	7	3.51286048	0	1167700.9	Open	12.3	393
2/28/2026	18:45:00	7	1.63908253	3.7	1167735.8	Open	12.4	394
2/28/2026	19:00:00	7	3.33494621	3	1167780.2	Open	12.4	395
2/28/2026	19:15:00	7	2.40752076	4.2	1167825.9	Open	12.2	396
2/28/2026	19:30:00	7	3.34251703	2.2	1167863.8	Open	12.2	394
2/28/2026	19:45:00	7	2.36966666	5.4	1167909.3	Open	12.3	393
2/28/2026	20:00:00	7	3.34630244	0	1167956.4	Open	12.4	391
2/28/2026	20:15:00	7	2.54379552	0	1167977.4	Closed	12.4	388
2/28/2026	20:30:00	7	3.32737539	0	1168023	Open	12.4	388
2/28/2026	20:45:00	7	2.41130617	0	1168068.1	Open	12.2	391
2/28/2026	21:00:00	7	3.28573588	0	1168114.5	Open	12.1	393
2/28/2026	21:15:00	7	0	0	1168135.5	Closed	12.3	393
2/28/2026	21:30:00	7	3.2933067	0	1168178.6	Open	12.2	391
2/28/2026	21:45:00	7	2.27503141	6.2	1168222.9	Open	12.3	389
2/28/2026	22:00:00	7	3.09646538	7.2	1168261.3	Closed	12.4	388
2/28/2026	22:15:00	7	0.85928807	15.4	1168261.8	Closed	12.7	390
2/28/2026	22:30:00	7	3.30087752	0.4	1168300.2	Open	12.4	386
2/28/2026	22:45:00	6.9	2.38859371	0	1168345	Open	12.4	389
2/28/2026	23:00:00	6.9	3.27437965	0	1168391.1	Open	12.4	388
2/28/2026	23:15:00	6.9	2.88069701	10.9	1168435.2	Open	12.5	389
2/28/2026	23:30:00	6.9	3.27437965	6.6	1168454.8	Open	12.8	390
2/28/2026	23:45:00	6.9	0	7.3	1168496.7	Closed	12.5	387
3/1/2026	0:00:00	6.9	3.24788178	0	1168536	Open	12.4	389

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
3/1/2026	0:15:00	6.9	2.66492864	0	1168579.5	Open	12.4	387
3/1/2026	0:30:00	7	3.20245686	0	1168625.1	Open	12.4	389
3/1/2026	0:45:00	7	3.17595899	3.8	1168672.9	Open	12.4	389
3/1/2026	1:00:00	7	2.50215601	0	1168702.7	Open	12.5	389
3/1/2026	1:15:00	7	3.41443982	0	1168753.6	Open	12.3	389
3/1/2026	1:30:00	7	3.35008785	0.5	1168804.4	Open	12.1	388
3/1/2026	1:45:00	7	2.43401863	0.3	1168853.7	Open	12	388
3/1/2026	2:00:00	7	1.07127103	0	1168862.7	Closed	12.1	391
3/1/2026	2:15:00	7	3.3311608	0	1168910.4	Open	11.7	391
3/1/2026	2:30:00	7.1	2.46430191	0	1168959.6	Open	11.8	387
3/1/2026	2:45:00	7.1	0	0	1168990.2	Closed	12	387
3/1/2026	3:00:00	7.1	3.36522949	0	1169021.2	Open	11.9	386
3/1/2026	3:15:00	7	2.39994994	0.2	1169070.7	Open	12	387
3/1/2026	3:30:00	7	3.45607933	4.3	1169094.9	Open	12.2	385
3/1/2026	3:45:00	7	3.38794195	1.7	1169141.7	Open	11.9	386
3/1/2026	4:00:00	7	2.44537486	0.8	1169188.6	Open	11.9	387
3/1/2026	4:15:00	6.9	3.05104046	9.2	1169215.6	Open	12	386
3/1/2026	4:30:00	6.9	3.32737539	3.7	1169266.1	Open	11.7	390
3/1/2026	4:45:00	6.9	2.37345207	12.5	1169311.5	Open	11.7	387
3/1/2026	5:00:00	6.9	3.41065441	11.5	1169347	Open	11.5	385
3/1/2026	5:15:00	6.9	3.40308359	13.7	1169395.3	Open	11.5	388
3/1/2026	5:30:00	6.9	2.39237912	32.9	1169442.3	Open	11.4	388
3/1/2026	5:45:00	6.9	0.32554526	8.3	1169469.5	Closed	11.5	388
3/1/2026	6:00:00	7	3.2933067	8.8	1169505.2	Open	11.5	387
3/1/2026	6:15:00	7	0.36718477	23.1	1169539.8	Open	11.6	387
3/1/2026	6:30:00	7.1	0	55.2	1169544.7	Closed	11.8	385
3/1/2026	6:45:00	7.3	0	131.5	1169544.7	Closed	11.3	385
3/1/2026	7:00:00	7.5	2.86555537	48.9	1169544.7	Closed	10.8	384
3/1/2026	7:15:00	7.8	2.54001011	68.7	1169545.5	Closed	11.2	383
3/1/2026	7:30:00	8	3.63020819	47	1169545.5	Closed	11.2	383
3/1/2026	7:45:00	8.2	2.28638764	50.4	1169586	Closed	11.2	388
3/1/2026	8:00:00	8.2	3.25166719	2.7	1169614.4	Open	11.2	391

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
3/1/2026	8:15:00	8.2	2.7254952	5.2	1169657.8	Open	11.2	393
3/1/2026	8:30:00	8.1	3.29709211	8.3	1169703.5	Open	11.2	398
3/1/2026	8:45:00	8	2.61950372	8.9	1169746.3	Open	11.2	400
3/1/2026	9:00:00	7.9	3.16838817	0	1169788.9	Open	11.3	398
3/1/2026	9:15:00	7.8	3.15324653	0	1169833	Open	11.3	395
3/1/2026	9:30:00	7.7	3.14567571	0	1169876.3	Open	11.3	395
3/1/2026	9:45:00	7.6	3.13053407	1.1	1169919.8	Open	11.4	394
3/1/2026	10:00:00	7.6	3.19110063	0.2	1169963.2	Open	11.4	394
3/1/2026	10:15:00	7.5	3.24788178	1.4	1170007.9	Open	11.4	394
3/1/2026	10:30:00	7.5	3.23274014	1.2	1170052.5	Open	11.4	392
3/1/2026	10:45:00	7.4	3.23652555	1.8	1170097.2	Open	11.5	392
3/1/2026	11:00:00	7.4	3.25923801	1	1170141.9	Open	11.5	390
3/1/2026	11:15:00	7.4	3.2554526	4.1	1170187.1	Open	11.6	390
3/1/2026	11:30:00	7.3	3.24788178	1.3	1170232.2	Open	11.7	391
3/1/2026	11:45:00	7.3	0	1.7	1170266.3	Closed	12	387
3/1/2026	12:00:00	7.3	2.41887699	3.7	1170295.7	Open	12	387
3/1/2026	12:15:00	7.3	3.24409637	4.4	1170338.7	Open	12	387
3/1/2026	12:30:00	7.3	3.23274014	3.6	1170377.9	Open	12.1	389
3/1/2026	12:45:00	7.3	3.22516932	5.8	1170426.4	Open	12.2	385
3/1/2026	13:00:00	7.2	2.43023322	3.8	1170470.1	Open	12.3	386
3/1/2026	13:15:00	7.2	3.28195047	2.9	1170498.5	Open	12.4	387
3/1/2026	13:30:00	7.2	2.58543503	6.4	1170542.9	Open	12.4	385
3/1/2026	13:45:00	7.2	3.2554526	4.1	1170589.2	Open	12.4	387
3/1/2026	14:00:00	7.1	2.4605165	9.7	1170632.8	Open	12.5	387
3/1/2026	14:15:00	7.1	3.25923801	17.7	1170654.1	Open	12.7	386
3/1/2026	14:30:00	7.1	3.25166719	4.5	1170691.3	Open	12.4	387
3/1/2026	14:45:00	7.1	3.24031096	6.6	1170735.7	Open	12.4	387
3/1/2026	15:00:00	7.1	3.2175985	6.3	1170780.4	Open	12.4	387
3/1/2026	15:15:00	7.1	3.22516932	6.1	1170825	Open	12.5	387
3/1/2026	15:30:00	7.2	2.45673109	4.5	1170865.9	Open	12.6	385
3/1/2026	15:45:00	7.2	3.27059424	7.6	1170907.9	Open	12.7	385
3/1/2026	16:00:00	7.2	0.29904739	6.7	1170941.3	Open	12.8	385

FRONTIER-KEMPER MICHELS joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
3/1/2026	16:15:00	7.2	3.31601916	7.8	1170978	Open	12.9	382
3/1/2026	16:30:00	7.2	3.11917784	9.2	1171017.6	Closed	13	380
3/1/2026	16:45:00	7.2	3.31223375	12.7	1171057.5	Open	12.9	380
3/1/2026	17:00:00	7.2	3.27816506	1.5	1171087.3	Open	12.9	385
3/1/2026	17:15:00	7.2	3.26680883	1.7	1171132.7	Open	12.9	381
3/1/2026	17:30:00	7.2	3.25923801	3.5	1171178	Open	12.9	381
3/1/2026	17:45:00	7.2	3.24409637	3.4	1171222.9	Open	12.8	384
3/1/2026	18:00:00	7.2	3.2554526	9.1	1171237.9	Open	13	385
3/1/2026	18:15:00	7.2	3.25166719	3.3	1171283.1	Open	12.8	385
3/1/2026	18:30:00	7.1	3.24409637	3.8	1171327.9	Open	12.8	385
3/1/2026	18:45:00	7.1	3.22516932	7.2	1171372.5	Open	12.7	384
3/1/2026	19:00:00	7.1	0	12.7	1171410.2	Closed	12.7	385
3/1/2026	19:15:00	7.1	3.1040362	31.5	1171439.6	Closed	12.6	384
3/1/2026	19:30:00	7.2	3.25923801	17.3	1171472.9	Open	12.4	385
3/1/2026	19:45:00	7.2	3.26302342	13.7	1171505.2	Open	12.4	387
3/1/2026	20:00:00	7.2	3.11160702	2.9	1171549.2	Open	12.3	384
3/1/2026	20:15:00	7.2	3.42201064	2.4	1171570.5	Open	12.5	382
3/1/2026	20:30:00	7.2	0	0.9	1171609.1	Closed	12.2	384
3/1/2026	20:45:00	7.2	2.50594142	7.5	1171633.2	Open	12.1	387
3/1/2026	21:00:00	7.2	2.10847337	2.3	1171674.1	Open	12	384
3/1/2026	21:15:00	7.2	3.12296325	8.2	1171717	Open	12	384
3/1/2026	21:30:00	7.2	0.14006017	7.7	1171741.6	Closed	12.2	384
3/1/2026	21:45:00	7.2	3.16081735	11.7	1171783.2	Open	11.9	385
3/1/2026	22:00:00	7.2	3.16460276	19.3	1171830.5	Open	11.9	385
3/1/2026	22:15:00	7.2	3.16838817	15	1171835.6	Open	12.2	382
3/1/2026	22:30:00	7.2	3.3690149	3.1	1171879.2	Open	12.1	385
3/1/2026	22:45:00	7.2	3.32358998	8.7	1171896	Open	12.7	382
3/1/2026	23:00:00	7.2	3.34251703	1.6	1171940.7	Open	12.2	381
3/1/2026	23:15:00	7.1	0.47317625	0.9	1171967.4	Open	12.3	382
3/1/2026	23:30:00	7.1	3.23274014	1	1172011.8	Open	12	385
3/1/2026	23:45:00	7.1	3.31980457	6.7	1172038.2	Open	12.2	384

Appendix B: Photos

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 1: No visible sheen observed in the WTP water, February 23

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 2: No visible sheen observed in the WTP water, February 24

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 3: No visible sheen observed in the WTP water, February 25

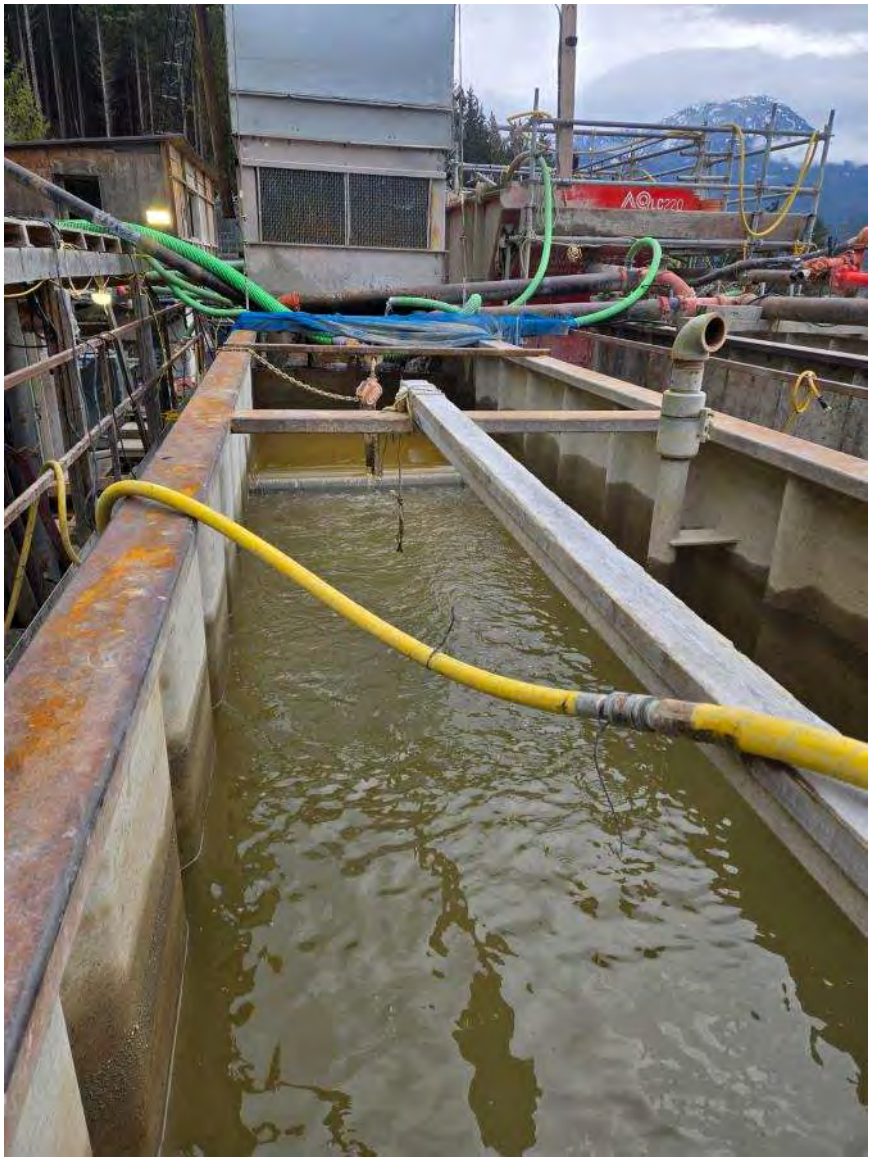

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 4: No visible sheen observed in the WTP water, February 26

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 5: No visible sheen observed in the WTP water, February 27

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 5: No visible sheen observed in the WTP water, February 28

FRONTIER-KEMPER MICHELS® joint venture		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	**Wood Fibre Weekly Water Discharge Report**	**Revision:**	**0**
Data Range	**February 23, 2026 to March 1, 2026**	**Prepared by:** **Approved by:** **Date:**	**BC1** **BC2** **March 29, 2026**

Photo 5: No visible sheen observed in the WTP water, March 1

Appendix D:
Woodfibre Site Receiving Environment Documentation

Woodfibre Site Receiving Environment Sample Analysis

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG US 2026-02-24 08:50:00**	**WLNG DS 2026-02-24 09:25:00**
In situ Parameters									
Field pH	pH Units		6.5 - 9			7 - 8.7		7.61	7.12
Field Temperature	°C	18	19					4.9	7.1
General Parameters									
pH	pH Units							6.35	6.95
Alkalinity (Total as $CaCO_3$)	mg/L							5.2	35
Alkalinity (PP as $CaCO_3$)	mg/L							<1	<1
Hardness ($CaCO_3$)-Total	mg/L							5.65	47.5
Hardness ($CaCO_3$)-Dissolved	mg/L							5.91	50.1
Sulphide-Total	mg/L							<0.0018	<0.0018
Sulphide (as H_2S)	mg/L			0.002				<0.002	<0.002
Un-ionized Hydrogen Sulfide as H_2S-Total	mg/L							<0.0019	<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018	<0.0018
Anions and Nutrients									
Ammonia (N)-Total	mg/L	1.88	10.1		10	191		<0.015	<0.015
Bicarbonate (HCO_3)	mg/L							6.3	42
Carbonate (CO_3)	mg/L							<1	<1
Hydroxide (OH)	mg/L							<1	<1
Nitrate (N)	mg/L	3	32.8		3.7			0.022	<0.02
Nitrite (N)	mg/L	0.02	0.06					<0.005	0.0053
Nitrate plus Nitrite (N)	mg/L							0.022	<0.02
Nitrogen (N)-Total	mg/L							0.097	0.159
Phosphorus (P)-Total (4500-P)	mg/L							0.039	0.012
Bromide (Br)	mg/L							<0.01	<0.01
Chloride (Cl)	mg/L	150	600					<1	8.5
Fluoride (F)	mg/L		0.4			1.5		<0.05	0.18
Sulphate (SO_4)-Dissolved	mg/L	128						<1	8.7

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG US 2026-02-24 08:50:00**	**WLNG DS 2026-02-24 09:25:00**
Total Metals									
Aluminum (Al)-Total	mg/L	0.1434384						0.105	**1.01**
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000037	0.00009
Arsenic (As)-Total	mg/L	0.005			0.0125			0.000164	0.000731
Barium (Ba)-Total	mg/L			1				0.00251	0.00715
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001	<0.00001
Bismuth (Bi)-Total	mg/L							<0.000005	<0.00001
Boron (B)-Total	mg/L	1.2			1.2			<0.01	<0.01
Cadmium (Cd)-Total	mg/L						0.00012	<0.000005	0.000009
Calcium (Ca)-Total	mg/L							1.85	17.7
Cesium (Cs)-Total	mg/L							<0.00005	0.00006
Chromium (Cr)-Total	mg/L							<0.0001	0.00209
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099	0.0021
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099	<0.00099
Cobalt (Co)-Total	mg/L							0.0000369	0.000084
Copper (Cu)-Total	mg/L				0.002	0.003		0.000904	0.00083
Iron (Fe)-Total	mg/L		1					0.0424	0.11
Lead (Pb)-Total	mg/L				0.002	0.14		0.0000237	0.000032
Lithium (Li)-Total	mg/L							<0.0005	0.00174
Magnesium (Mg)-Total	mg/L							0.251	0.82
Manganese (Mn)-Total	mg/L	0.62986	0.602263				0.1	0.00147	0.015
Mercury (Hg)-Total	mg/L	0.00002			0.0001			0.0000028	<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.000312	0.0165
Nickel (Ni)-Total	mg/L						0.0083	0.000742	0.0023
Phosphorus (P)-Total (ICPMS)	mg/L							0.0541	0.018
Potassium (K)-Total	mg/L							0.169	0.87
Rubidium (Rb)-Total	mg/L							0.000197	0.00222
Selenium (Se)-Total	mg/L	0.002			0.002			<0.00004	<0.00004
Silicon (Si)-Total	mg/L							3.34	5.53
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.000005	<0.00001
Sodium (Na)-Total	mg/L							1.08	4.06
Strontium (Sr)-Total	mg/L							0.00813	0.0381
Sulphur (S)-Total	mg/L							<3	<3
Tellurium (Te)-Total	mg/L							<0.00002	<0.00002
Thallium (Tl)-Total	mg/L			0.00003				<0.000002	0.0000044
Thorium (Th)-Total	mg/L							<0.00005	<0.00005

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG US 2026-02-24 08:50:00**	**WLNG DS 2026-02-24 09:25:00**
Total Metals (cont'd.)									
Tin (Sn)-Total	mg/L							<0.0002	<0.0002
Titanium (Ti)-Total	mg/L							0.00114	<0.002
Uranium (U)-Total	mg/L		0.0165	0.0075				0.000108	0.00144
Vanadium (V)-Total	mg/L			0.06			0.005	<0.0002	0.00082
Zinc (Zn)-Total	mg/L				0.01	0.055		0.00122	0.0035
Zirconium (Zr)-Total	mg/L							<0.0001	<0.0001
Dissolved Metals									
Aluminum (Al)-Dissolved	mg/L							0.0841	0.923
Antimony (Sb)-Dissolved	mg/L							0.000028	0.000091
Arsenic (As)-Dissolved	mg/L							0.00015	0.000715
Barium (Ba)-Dissolved	mg/L							0.00231	0.00661
Beryllium (Be)-Dissolved	mg/L							<0.00001	<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005	<0.000005
Boron (B)-Dissolved	mg/L							<0.01	<0.01
Cadmium (Cd)-Dissolved	mg/L	0.0000255	0.000038					0.0000069	0.0000079
Calcium (Ca)-Dissolved	mg/L							1.92	18.7
Cesium (Cs)-Dissolved	mg/L							<0.00005	<0.00005
Chromium (Cr)-Dissolved	mg/L							<0.0001	0.0017
Cobalt (Co)-Dissolved	mg/L	0.0003889						0.0000251	0.0000371
Copper (Cu)-Dissolved	mg/L	0.00064	0.00366					**0.000881**	**0.000539**
Iron (Fe)-Dissolved	mg/L		0.35					0.018	0.047
Lead (Pb)-Dissolved	mg/L	0.0017556						0.0000104	<0.000005
Lithium (Li)-Dissolved	mg/L							<0.0005	0.00183
Manganese (Mn)-Dissolved	mg/L							0.000663	0.0128
Magnesium (Mg)-Dissolved	mg/L							0.27	0.833
Mercury (Hg)-Dissolved	mg/L							<0.0000019	<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.000342	0.0165
Nickel (Ni)-Dissolved	mg/L	0.0009	0.0129					0.00025	0.000319
Phosphorus (P)-Dissolved	mg/L							0.06	0.0086
Potassium (K)-Dissolved	mg/L							0.177	0.919
Rubidium (Rb)-Dissolved	mg/L							0.000233	0.00221
Selenium (Se)-Dissolved	mg/L							<0.00004	<0.00004
Silicon (Si)-Dissolved	mg/L							3.33	6.01
Silver (Ag)-Dissolved	mg/L							<0.000005	<0.000005
Sodium (Na)-Dissolved	mg/L							1.12	4.05

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	**WLNG US 2026-02-24 08:50:00**	**WLNG DS 2026-02-24 09:25:00**
Dissolved Metals (cont'd.)									
Strontium (Sr)-Dissolved	mg/L			1.25				0.00802	0.0362
Sulphur (S)-Dissolved	mg/L							<3	<3
Tellurium (Te)-Dissolved	mg/L							<0.00002	<0.00002
Thallium (Tl)-Dissolved	mg/L							<0.000002	0.0000026
Thorium (Th)-Dissolved	mg/L							0.0000115	0.000008
Tin (Sn)-Dissolved	mg/L							<0.0002	<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005	<0.0005
Uranium (U)-Dissolved	mg/L							0.0000971	0.00148
Vanadium (V)-Dissolved	mg/L							<0.0002	0.00087
Zinc (Zn)-Dissolved	mg/L	0.0028973	0.0092935					0.00109	0.00232
Zirconium (Zr)-Dissolved	mg/L							<0.0001	<0.0001
Inorganics									
Organic Carbon (C)-Total	mg/L							<0.5	7.9
Organic Carbon (C)-Dissolved	mg/L							2.4	6.8
Solids-Total Dissolved	mg/L							16	76
Solids-Total Suspended	mg/L	6	26					<1	2.4

[1] Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as $CaCO_3$) – total, Dissolved Organic Carbon (DOC), Total Alkalinity ($CaCO_3$), and Chloride).

[2] Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

[3] **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per [1] and [2] above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

[4] **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Woodfibre Site Receiving Environment Field Notes and Logs

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-23 00:00:00	5.04	42.09	0.34	7.50	12.08	23.10	0.02
EAS-DS	2026-02-23 00:15:00	5.83	75.67	0.34	7.51	11.86	25.61	0.03
EAS-DS	2026-02-23 00:30:00	5.89	79.71	0.35	7.53	11.89	26.50	0.04
EAS-DS	2026-02-23 00:45:00	5.16	43.14	0.35	7.49	12.07	31.13	0.02
EAS-DS	2026-02-23 01:00:00	5.98	79.14	0.35	7.56	11.85	40.33	0.04
EAS-DS	2026-02-23 01:15:00	5.99	78.19	0.35	7.55	11.83	28.65	0.04
EAS-DS	2026-02-23 01:30:00	5.99	75.59	0.35	7.57	11.83	27.96	0.03
EAS-DS	2026-02-23 01:45:00	6.02	73.74	0.35	7.58	11.80	23.12	0.03
EAS-DS	2026-02-23 02:00:00	6.04	72.30	0.35	7.57	11.78	26.57	0.03
EAS-DS	2026-02-23 02:15:00	6.07	69.50	0.34	7.54	11.76	25.53	0.03
EAS-DS	2026-02-23 02:30:00	6.05	66.93	0.35	7.52	11.80	35.74	0.03
EAS-DS	2026-02-23 02:45:00	5.14	30.14	0.35	7.32	12.08	38.86	0.01
EAS-DS	2026-02-23 03:00:00	5.96	64.23	0.35	7.50	11.88	43.62	0.03
EAS-DS	2026-02-23 03:15:00	5.96	64.69	0.35	7.51	11.87	45.95	0.03
EAS-DS	2026-02-23 03:30:00	5.90	66.17	0.36	7.48	11.92	45.46	0.03
EAS-DS	2026-02-23 03:45:00	5.98	68.21	0.36	7.54	11.85	46.33	0.03
EAS-DS	2026-02-23 04:00:00	5.55	45.89	0.35	7.48	11.84	43.84	0.02
EAS-DS	2026-02-23 04:15:00	5.92	68.37	0.35	7.48	11.91	32.15	0.03
EAS-DS	2026-02-23 04:30:00	5.96	68.31	0.35	7.47	11.88	34.04	0.03
EAS-DS	2026-02-23 04:45:00	5.75	57.42	0.36	7.45	11.92	33.39	0.03
EAS-DS	2026-02-23 05:00:00	5.34	36.74	0.36	7.32	12.06	38.64	0.02
EAS-DS	2026-02-23 05:15:00	6.06	65.78	0.36	7.45	11.83	38.74	0.03
EAS-DS	2026-02-23 05:30:00	6.10	72.99	0.35	7.61	11.81	45.20	0.03
EAS-DS	2026-02-23 05:45:00	5.96	65.07	0.36	7.51	11.85	50.43	0.03
EAS-DS	2026-02-23 06:00:00	6.18	74.88	0.35	7.50	11.81	52.23	0.03
EAS-DS	2026-02-23 06:15:00	5.41	34.01	0.35	7.34	12.06	44.76	0.01
EAS-DS	2026-02-23 06:30:00	6.24	71.13	0.35	7.52	11.76	51.09	0.03
EAS-DS	2026-02-23 06:45:00	6.00	56.52	0.35	7.47	11.86	41.91	0.03
EAS-DS	2026-02-23 07:00:00	6.29	64.36	0.35	7.51	11.78	40.74	0.03
EAS-DS	2026-02-23 07:15:00	6.31	63.97	0.35	7.50	11.78	50.06	0.03
EAS-DS	2026-02-23 07:30:00	6.35	64.53	0.35	7.49	11.75	34.20	0.03
EAS-DS	2026-02-23 07:45:00	5.72	32.12	0.36	7.35	11.87	34.76	0.01
EAS-DS	2026-02-23 08:00:00	6.39	58.84	0.35	7.40	11.72	37.76	0.03
EAS-DS	2026-02-23 08:15:00	6.45	57.35	0.35	7.38	11.75	33.93	0.03
EAS-DS	2026-02-23 08:30:00	5.93	33.23	0.35	7.37	11.73	33.81	0.01
EAS-DS	2026-02-23 08:45:00	6.24	47.94	0.35	7.37	11.80	35.33	0.02
EAS-DS	2026-02-23 09:00:00	6.60	59.61	0.35	7.45	11.72	36.51	0.03
EAS-DS	2026-02-23 09:15:00	6.64	59.77	0.35	7.46	11.67	33.52	0.03
EAS-DS	2026-02-23 09:30:00	6.70	60.49	0.35	7.45	11.68	36.11	0.03
EAS-DS	2026-02-23 09:45:00	6.77	62.46	0.35	7.50	11.68	48.09	0.03
EAS-DS	2026-02-23 10:00:00	6.80	77.50	0.34	7.62	11.63	50.51	0.04
EAS-DS	2026-02-23 10:15:00	6.83	87.05	0.34	7.68	11.63	51.08	0.04
EAS-DS	2026-02-23 10:30:00	6.82	81.10	0.34	7.65	11.63	47.92	0.04
EAS-DS	2026-02-23 10:45:00	6.50	65.66	0.34	7.58	11.73	49.39	0.03
EAS-DS	2026-02-23 11:00:00	6.96	99.26	0.34	7.69	11.59	45.94	0.05
EAS-DS	2026-02-23 11:15:00	7.04	97.95	0.34	7.64	11.54	44.53	0.05
EAS-DS	2026-02-23 11:30:00	7.10	98.12	0.34	7.56	11.52	44.25	0.05
EAS-DS	2026-02-23 11:45:00	7.17	101.18	0.33	7.64	11.45	48.19	0.05
EAS-DS	2026-02-23 12:00:00	7.24	99.08	0.32	7.66	11.41	47.53	0.05
EAS-DS	2026-02-23 12:15:00	7.28	93.84	0.32	7.59	11.49	42.97	0.04
EAS-DS	2026-02-23 12:30:00	7.31	88.06	0.32	7.56	11.47	45.79	0.04
EAS-DS	2026-02-23 12:45:00	6.72	58.86	0.33	7.47	11.42	44.53	0.03
EAS-DS	2026-02-23 13:00:00	7.32	85.00	0.32	7.61	11.46	51.94	0.04
EAS-DS	2026-02-23 13:15:00	6.65	39.63	0.32	7.51	11.60	53.55	0.02
EAS-DS	2026-02-23 13:30:00	7.18	70.73	0.33	7.55	11.46	48.62	0.03

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-23 13:45:00	7.45	86.72	0.33	7.66	11.42	56.20	0.04
EAS-DS	2026-02-23 14:00:00	7.50	86.22	0.32	7.67	11.35	61.75	0.04
EAS-DS	2026-02-23 14:15:00	6.96	68.56	0.33	7.46	11.65	57.15	0.03
EAS-DS	2026-02-23 14:30:00	7.50	106.12	0.32	7.68	11.35	65.66	0.05
EAS-DS	2026-02-23 14:45:00	6.79	52.14	0.33	7.61	11.41	66.56	0.02
EAS-DS	2026-02-23 15:00:00	7.50	134.07	0.32	7.81	11.31	71.54	0.06
EAS-DS	2026-02-23 15:15:00	7.54	149.66	0.32	7.88	11.30	75.51	0.07
EAS-DS	2026-02-23 15:30:00	7.46	135.13	0.33	7.82	11.36	72.75	0.06
EAS-DS	2026-02-23 15:45:00	7.57	128.88	0.32	7.80	11.25	72.63	0.06
EAS-DS	2026-02-23 16:00:00	7.23	112.52	0.31	7.69	11.45	61.47	0.05
EAS-DS	2026-02-23 16:15:00	6.69	52.36	0.32	7.57	11.43	60.91	0.02
EAS-DS	2026-02-23 16:30:00	7.51	110.88	0.32	7.67	9.79	58.64	0.05
EAS-DS	2026-02-23 16:45:00	6.55	46.57	0.33	7.50	11.54	59.71	0.02
EAS-DS	2026-02-23 17:00:00	7.43	116.13	0.33	7.67	10.92	68.08	0.05
EAS-DS	2026-02-23 17:15:00	6.61	52.31	0.33	7.59	11.59	66.53	0.02
EAS-DS	2026-02-23 17:30:00	7.41	127.33	0.33	7.67	11.33	69.21	0.06
EAS-DS	2026-02-23 17:45:00	7.45	133.22	0.34	7.62	11.32	70.74	0.06
EAS-DS	2026-02-23 18:00:00	7.07	81.67	0.32	7.68	11.34	63.72	0.04
EAS-DS	2026-02-23 18:15:00	7.38	115.35	0.33	7.68	10.95	62.88	0.05
EAS-DS	2026-02-23 18:30:00	7.49	111.78	0.32	7.72	10.78	61.73	0.05
EAS-DS	2026-02-23 18:45:00	7.13	93.15	0.33	7.65	11.08	62.72	0.04
EAS-DS	2026-02-23 19:00:00	6.92	79.33	0.33	7.67	11.22	64.87	0.04
EAS-DS	2026-02-23 19:15:00	7.43	133.00	0.33	7.69	11.31	64.59	0.06
EAS-DS	2026-02-23 19:30:00	6.13	47.18	0.34	7.51	11.78	65.52	0.02
EAS-DS	2026-02-23 19:45:00	7.16	107.21	0.34	7.68	11.42	64.41	0.05
EAS-DS	2026-02-23 20:00:00	6.26	46.54	0.33	7.58	11.67	67.50	0.02
EAS-DS	2026-02-23 20:15:00	7.35	110.66	0.33	7.70	10.90	62.31	0.05
EAS-DS	2026-02-23 20:30:00	6.42	54.64	0.33	7.58	11.39	65.18	0.02
EAS-DS	2026-02-23 20:45:00	7.02	88.50	0.33	7.68	11.08	67.49	0.04
EAS-DS	2026-02-23 21:00:00	7.20	99.52	0.34	7.67	11.31	64.95	0.05
EAS-DS	2026-02-23 21:15:00	5.92	36.67	0.34	7.50	11.89	67.21	0.02
EAS-DS	2026-02-23 21:30:00	7.25	99.90	0.34	7.67	11.43	68.16	0.05
EAS-DS	2026-02-23 21:45:00	6.02	39.88	0.34	7.56	11.75	66.18	0.02
EAS-DS	2026-02-23 22:00:00	6.56	88.54	0.35	7.46	11.82	68.57	0.04
EAS-DS	2026-02-23 22:15:00	7.24	102.99	0.33	7.72	10.86	65.00	0.05
EAS-DS	2026-02-23 22:30:00	7.15	107.80	0.33	7.69	11.35	65.91	0.05
EAS-DS	2026-02-23 22:45:00	6.92	98.70	0.33	7.69	11.47	71.57	0.05
EAS-DS	2026-02-23 23:00:00	7.09	118.43	0.34	7.69	11.47	69.14	0.05
EAS-DS	2026-02-23 23:15:00	7.25	132.71	0.33	7.82	11.37	73.17	0.06
EAS-DS	2026-02-23 23:30:00	6.76	98.63	0.34	7.83	11.34	72.85	0.05
EAS-DS	2026-02-23 23:45:00	7.18	145.36	0.34	7.86	11.41	87.15	0.07
EAS-DS	2026-02-24 00:00:00	7.14	136.34	0.33	7.79	11.37	77.53	0.06
EAS-DS	2026-02-24 00:15:00	7.27	144.14	0.33	7.62	10.80	73.84	0.07
EAS-DS	2026-02-24 00:30:00	7.02	146.22	0.34	7.39	11.00	70.43	0.07
EAS-DS	2026-02-24 00:45:00	6.82	127.26	0.34	7.34	11.13	70.78	0.06
EAS-DS	2026-02-24 01:00:00	6.95	137.94	0.34	7.45	11.27	79.15	0.06
EAS-DS	2026-02-24 01:15:00	6.94	119.91	0.33	7.55	11.43	75.67	0.06
EAS-DS	2026-02-24 01:30:00	7.16	131.87	0.34	7.55	11.39	74.98	0.06
EAS-DS	2026-02-24 01:45:00	7.24	132.32	0.34	7.56	11.34	80.15	0.06
EAS-DS	2026-02-24 02:00:00	5.87	57.69	0.32	7.57	11.73	76.97	0.03
EAS-DS	2026-02-24 02:15:00	7.15	153.76	0.32	7.84	10.95	84.32	0.07
EAS-DS	2026-02-24 02:30:00	6.79	170.59	0.33	7.87	11.51	91.87	0.08
EAS-DS	2026-02-24 02:45:00	6.74	145.04	0.32	7.90	11.03	95.16	0.07
EAS-DS	2026-02-24 03:00:00	5.95	81.53	0.32	7.80	11.41	89.29	0.04
EAS-DS	2026-02-24 03:15:00	7.33	154.06	0.33	7.87	11.27	88.66	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-24 03:30:00	6.21	53.79	0.32	7.83	11.28	696.35	0.02
EAS-DS	2026-02-24 03:45:00	5.54	55.42	0.34	7.48	12.01	47.01	0.02
EAS-DS	2026-02-24 04:00:00	7.28	138.40	0.32	7.87	11.24	57.60	0.06
EAS-DS	2026-02-24 04:15:00	5.97	82.83	0.32	7.68	11.48	52.17	0.04
EAS-DS	2026-02-24 04:30:00	7.34	144.91	0.32	7.89	10.65	53.33	0.07
EAS-DS	2026-02-24 04:45:00	6.47	92.49	0.32	8.14	10.99	70.62	0.04
EAS-DS	2026-02-24 05:00:00	7.35	192.15	0.32	8.09	10.70	57.70	0.09
EAS-DS	2026-02-24 05:15:00	7.37	191.01	0.32	8.20	11.24	61.50	0.09
EAS-DS	2026-02-24 05:30:00	7.30	172.52	0.32	8.13	11.28	59.76	0.08
EAS-DS	2026-02-24 05:45:00	7.43	164.21	0.32	8.08	11.21	61.22	0.08
EAS-DS	2026-02-24 06:00:00	7.20	145.92	0.32	7.98	11.27	61.44	0.07
EAS-DS	2026-02-24 06:15:00	7.19	142.02	0.31	7.93	10.84	66.99	0.07
EAS-DS	2026-02-24 06:30:00	7.26	146.45	0.32	7.89	10.90	67.42	0.07
EAS-DS	2026-02-24 06:45:00	5.89	71.13	0.32	7.86	11.53	71.68	0.03
EAS-DS	2026-02-24 07:00:00	7.39	141.78	0.32	7.94	10.81	80.15	0.07
EAS-DS	2026-02-24 07:15:00	5.93	59.33	0.32	7.83	11.55	81.03	0.03
EAS-DS	2026-02-24 07:30:00	6.91	103.13	0.33	7.89	11.38	74.19	0.05
EAS-DS	2026-02-24 07:45:00	7.20	117.22	0.33	7.83	11.37	75.55	0.05
EAS-DS	2026-02-24 08:00:00	7.29	108.52	0.31	7.86	11.26	70.17	0.05
EAS-DS	2026-02-24 08:15:00	6.82	100.04	0.32	7.70	11.55	58.53	0.05
EAS-DS	2026-02-24 08:30:00	7.41	111.49	0.32	7.80	11.27	62.34	0.05
EAS-DS	2026-02-24 08:45:00	6.30	51.12	0.32	7.74	11.44	153.21	0.02
EAS-DS	2026-02-24 09:00:00	7.52	113.14	0.32	7.81	11.23	45.76	0.05
EAS-DS	2026-02-24 09:15:00	6.74	59.60	0.32	7.79	11.16	100.61	0.03
EAS-DS	2026-02-24 09:30:00	7.56	88.02	0.17	7.78	11.40	2.08	0.04
EAS-DS	2026-02-24 09:45:00	7.46	101.68	0.19	7.81	11.32	7.69	0.05
EAS-DS	2026-02-24 10:00:00	7.57	102.84	0.21	7.74	11.40	0.00	0.05
EAS-DS	2026-02-24 10:15:00	7.70	106.03	0.22	7.69	11.33	2.91	0.05
EAS-DS	2026-02-24 10:30:00	7.37	85.63	0.22	7.70	11.32	4.08	0.04
EAS-DS	2026-02-24 10:45:00	7.62	64.85	0.23	7.69	11.43	7.40	0.03
EAS-DS	2026-02-24 11:00:00	6.97	53.21	0.23	7.65	11.46	2.31	0.02
EAS-DS	2026-02-24 11:15:00	7.98	102.86	0.24	7.77	11.25	7.82	0.05
EAS-DS	2026-02-24 11:30:00	7.99	104.44	0.25	7.74	11.28	6.82	0.05
EAS-DS	2026-02-24 11:45:00	6.07	18.10	0.26	7.24	11.86	1.05	0.01
EAS-DS	2026-02-24 12:00:00	7.93	81.34	0.26	7.75	11.29	5.67	0.04
EAS-DS	2026-02-24 12:15:00	7.82	82.68	0.26	7.76	11.26	6.17	0.04
EAS-DS	2026-02-24 12:30:00	8.24	108.65	0.26	7.74	11.21	22.15	0.05
EAS-DS	2026-02-24 12:45:00	6.93	49.43	0.26	7.49	11.44	9.70	0.02
EAS-DS	2026-02-24 13:00:00	8.02	115.11	0.25	7.66	11.25	29.44	0.05
EAS-DS	2026-02-24 13:15:00	8.00	136.81	0.25	7.69	11.36	8.46	0.06
EAS-DS	2026-02-24 13:30:00	8.42	147.91	0.24	7.75	11.13	3.33	0.07
EAS-DS	2026-02-24 13:45:00	7.80	120.67	0.25	7.68	11.33	5.55	0.06
EAS-DS	2026-02-24 14:00:00	6.99	55.48	0.25	7.52	11.45	0.00	0.02
EAS-DS	2026-02-24 14:15:00	7.72	99.16	0.25	7.73	11.11	2.26	0.05
EAS-DS	2026-02-24 14:30:00	8.40	158.76	0.25	7.75	11.09	6.63	0.07
EAS-DS	2026-02-24 14:45:00	6.85	63.06	0.26	7.50	11.50	0.00	0.03
EAS-DS	2026-02-24 15:00:00	8.43	154.46	0.24	7.69	11.08	13.29	0.07
EAS-DS	2026-02-24 15:15:00	7.11	69.16	0.24	7.52	11.49	1.10	0.03
EAS-DS	2026-02-24 15:30:00	8.41	137.90	0.24	7.68	11.08	14.80	0.06
EAS-DS	2026-02-24 15:45:00	8.43	133.93	0.23	7.56	11.07	15.58	0.06
EAS-DS	2026-02-24 16:00:00	8.19	119.43	0.23	7.56	11.11	13.83	0.06
EAS-DS	2026-02-24 16:15:00	6.71	50.38	0.25	7.45	11.51	1.29	0.02
EAS-DS	2026-02-24 16:30:00	8.34	152.56	0.25	7.68	11.11	14.95	0.07
EAS-DS	2026-02-24 16:45:00	7.88	124.15	0.24	7.61	11.17	3.92	0.06
EAS-DS	2026-02-24 17:00:00	8.27	140.68	0.24	7.51	11.12	2.80	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-24 17:15:00	7.24	76.48	0.23	7.53	11.29	1.24	0.03
EAS-DS	2026-02-24 17:30:00	8.28	164.66	0.25	7.74	11.12	12.26	0.08
EAS-DS	2026-02-24 17:45:00	7.78	167.86	0.26	7.72	11.35	6.96	0.08
EAS-DS	2026-02-24 18:00:00	8.08	166.79	0.27	7.70	11.04	5.38	0.08
EAS-DS	2026-02-24 18:15:00	8.22	168.28	0.27	7.73	11.09	4.24	0.08
EAS-DS	2026-02-24 18:30:00	7.49	119.89	0.27	7.79	11.23	5.15	0.06
EAS-DS	2026-02-24 18:45:00	8.14	175.05	0.27	7.84	11.19	8.49	0.08
EAS-DS	2026-02-24 19:00:00	7.33	149.59	0.28	7.80	11.57	6.57	0.07
EAS-DS	2026-02-24 19:15:00	7.92	207.21	0.28	7.83	11.18	10.28	0.10
EAS-DS	2026-02-24 19:30:00	8.18	221.20	0.27	7.85	11.14	8.31	0.10
EAS-DS	2026-02-24 19:45:00	8.23	192.30	0.27	7.74	11.08	4.81	0.09
EAS-DS	2026-02-24 20:00:00	7.80	143.60	0.27	7.65	11.17	17.48	0.07
EAS-DS	2026-02-24 20:15:00	7.23	120.02	0.28	7.50	11.57	5.19	0.06
EAS-DS	2026-02-24 20:30:00	8.16	141.66	0.26	7.63	11.11	2.81	0.07
EAS-DS	2026-02-24 20:45:00	6.53	59.43	0.26	7.52	11.59	2.29	0.03
EAS-DS	2026-02-24 21:00:00	8.14	136.37	0.27	7.86	11.16	0.78	0.06
EAS-DS	2026-02-24 21:15:00	7.30	109.27	0.28	7.70	11.61	4.94	0.05
EAS-DS	2026-02-24 21:30:00	8.10	126.43	0.27	7.81	11.19	3.29	0.06
EAS-DS	2026-02-24 21:45:00	8.10	125.23	0.27	7.82	11.16	0.32	0.06
EAS-DS	2026-02-24 22:00:00	7.88	111.47	0.27	7.83	11.17	3.02	0.05
EAS-DS	2026-02-24 22:15:00	7.59	116.02	0.29	7.73	11.50	0.14	0.05
EAS-DS	2026-02-24 22:30:00	8.09	135.18	0.28	7.94	11.13	24.02	0.06
EAS-DS	2026-02-24 22:45:00	6.79	99.83	0.30	7.50	11.87	1.10	0.05
EAS-DS	2026-02-24 23:00:00	8.07	137.19	0.28	7.99	11.15	6.07	0.06
EAS-DS	2026-02-24 23:15:00	7.68	155.02	0.28	8.26	11.36	7.17	0.07
EAS-DS	2026-02-24 23:30:00	7.09	124.53	0.27	8.27	11.22	7.73	0.06
EAS-DS	2026-02-24 23:45:00	8.06	211.43	0.26	8.43	11.08	13.53	0.10
EAS-DS	2026-02-25 00:00:00	7.50	152.84	0.28	7.81	11.18	3.10	0.07
EAS-DS	2026-02-25 00:15:00	8.11	166.48	0.29	7.64	11.06	1.86	0.08
EAS-DS	2026-02-25 00:30:00	8.14	161.46	0.28	7.77	11.06	5.49	0.08
EAS-DS	2026-02-25 00:45:00	7.04	117.59	0.29	7.74	11.64	7.28	0.05
EAS-DS	2026-02-25 01:00:00	7.22	104.57	0.28	7.81	11.17	1.07	0.05
EAS-DS	2026-02-25 01:15:00	8.07	163.43	0.28	7.99	11.16	8.35	0.08
EAS-DS	2026-02-25 01:30:00	7.03	92.54	0.28	7.75	11.29	4.97	0.04
EAS-DS	2026-02-25 01:45:00	8.08	159.67	0.28	7.91	11.12	6.84	0.07
EAS-DS	2026-02-25 02:00:00		145.09		7.90	11.13	5.44	0.07
EAS-DS	2026-02-25 02:15:00	7.10	63.20	0.29	7.75	11.25	0.23	0.03
EAS-DS	2026-02-25 02:30:00	8.02	157.18	0.29	7.90	11.12	4.67	0.07
EAS-DS	2026-02-25 02:45:00	7.47	122.38	0.29	7.88	11.16	2.28	0.06
EAS-DS	2026-02-25 03:00:00	5.66	45.59	0.31	7.27	12.11	0.00	0.02
EAS-DS	2026-02-25 03:15:00	8.03	153.83	0.29	7.94	11.19	1.99	0.07
EAS-DS	2026-02-25 03:30:00	6.42	81.68	0.29	7.65	11.79	4.55	0.04
EAS-DS	2026-02-25 03:45:00	8.07	153.49	0.28	7.90	11.14	1.87	0.07
EAS-DS	2026-02-25 04:00:00	7.43	114.75	0.28	7.85	11.24	2.01	0.05
EAS-DS	2026-02-25 04:15:00	8.10	149.16	0.28	7.89	11.15	0.13	0.07
EAS-DS	2026-02-25 04:30:00	8.10	147.54	0.28	7.89	11.13	14.55	0.07
EAS-DS	2026-02-25 04:45:00	6.64	67.95	0.28	7.75	11.47	0.62	0.03
EAS-DS	2026-02-25 05:00:00	8.07	148.30	0.28	7.90	11.19	2.02	0.07
EAS-DS	2026-02-25 05:15:00	8.11	149.69	0.28	7.91	11.21	0.42	0.07
EAS-DS	2026-02-25 05:30:00	8.08	150.54	0.27	7.94	11.22	14.05	0.07
EAS-DS	2026-02-25 05:45:00	7.99	147.12	0.27	8.06	11.08	4.59	0.07
EAS-DS	2026-02-25 06:00:00	7.62	128.93	0.28	7.93	11.26	1.65	0.06
EAS-DS	2026-02-25 06:15:00	7.95	149.28	0.28	7.93	11.20	0.31	0.07
EAS-DS	2026-02-25 06:30:00	6.66	101.01	0.30	7.60	11.94	3.88	0.05
EAS-DS	2026-02-25 06:45:00	8.04	154.02	0.28	7.93	11.13	1.36	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-25 07:00:00	8.14	149.20	0.29	7.92	11.20	0.56	0.07
EAS-DS	2026-02-25 07:15:00	8.18	136.41	0.29	7.95	11.17	0.56	0.06
EAS-DS	2026-02-25 07:30:00	8.18	130.01	0.28	7.95	11.16	2.10	0.06
EAS-DS	2026-02-25 07:45:00	8.11	124.61	0.28	7.89	11.20	0.00	0.06
EAS-DS	2026-02-25 08:00:00	5.96	16.90	0.29	7.39	11.79	0.22	0.01
EAS-DS	2026-02-25 08:15:00	8.13	119.65	0.29	7.86	11.17	3.63	0.06
EAS-DS	2026-02-25 08:30:00	6.55	36.59	0.29	7.60	11.62	0.00	0.02
EAS-DS	2026-02-25 08:45:00	8.22	118.34	0.29	7.82	11.21	0.16	0.05
EAS-DS	2026-02-25 09:00:00	8.27	120.29	0.28	7.87	11.19	0.00	0.06
EAS-DS	2026-02-25 09:15:00	8.31	136.35	0.27	8.44	11.15	1.32	0.06
EAS-DS	2026-02-25 09:30:00	8.12	171.35	0.26	8.38	11.22	6.25	0.08
EAS-DS	2026-02-25 09:45:00	6.89	100.47	0.28	8.01	11.56	4.68	0.05
EAS-DS	2026-02-25 10:00:00	8.34	180.85	0.26	8.59	11.04	3.47	0.08
EAS-DS	2026-02-25 10:15:00	8.43	182.08	0.25	8.59	11.01	3.27	0.09
EAS-DS	2026-02-25 10:30:00	8.47	180.20	0.25	8.59	11.00	17.45	0.08
EAS-DS	2026-02-25 10:45:00	8.50	167.49	0.25	8.49	11.06	7.44	0.08
EAS-DS	2026-02-25 11:00:00	6.98	77.34	0.28	7.71	11.41	1.65	0.04
EAS-DS	2026-02-25 11:15:00	8.56	150.62	0.28	7.81	11.04	2.71	0.07
EAS-DS	2026-02-25 11:30:00	8.54	138.27	0.27	7.90	11.06	4.84	0.06
EAS-DS	2026-02-25 11:45:00	8.60	136.52	0.27	7.88	11.02	4.41	0.06
EAS-DS	2026-02-25 12:00:00	7.26	78.38	0.28	7.63	11.53	0.66	0.04
EAS-DS	2026-02-25 12:15:00	8.61	137.06	0.28	7.83	11.02	0.35	0.06
EAS-DS	2026-02-25 12:30:00	8.61	142.63	0.28	7.78	11.00	6.22	0.07
EAS-DS	2026-02-25 12:45:00	8.42	137.68	0.28	7.74	10.93	3.13	0.06
EAS-DS	2026-02-25 13:00:00	8.59	148.37	0.29	7.73	11.06	1.35	0.07
EAS-DS	2026-02-25 13:15:00	8.62	147.56	0.29	7.78	11.08	4.18	0.07
EAS-DS	2026-02-25 13:30:00	7.11	40.28	0.26	7.77	11.31	1.04	0.02
EAS-DS	2026-02-25 13:45:00	6.08	19.04	0.30	7.39	11.81	0.00	0.01
EAS-DS	2026-02-25 14:00:00	8.56	162.46	0.28	7.80	10.96	3.45	0.08
EAS-DS	2026-02-25 14:15:00	8.60	154.09	0.28	7.74	11.01	4.23	0.07
EAS-DS	2026-02-25 14:30:00	8.37	151.64	0.28	7.77	11.12	5.39	0.07
EAS-DS	2026-02-25 14:45:00	8.59	159.19	0.28	7.86	10.95	4.69	0.07
EAS-DS	2026-02-25 15:00:00	7.65	123.74	0.28	7.74	11.42	5.24	0.06
EAS-DS	2026-02-25 15:15:00	8.58	161.63	0.28	7.87	11.03	7.20	0.08
EAS-DS	2026-02-25 15:30:00	8.59	161.41	0.27	7.91	11.03	7.67	0.08
EAS-DS	2026-02-25 15:45:00	8.47	159.26	0.28	7.86	11.05	5.11	0.07
EAS-DS	2026-02-25 16:00:00	8.58	157.94	0.28	7.88	10.97	5.48	0.07
EAS-DS	2026-02-25 16:15:00	8.59	155.33	0.28	7.88	10.99	4.18	0.07
EAS-DS	2026-02-25 16:30:00	8.58	153.35	0.27	7.86	10.97	10.12	0.07
EAS-DS	2026-02-25 16:45:00	7.41	80.56	0.27	7.76	11.28	2.35	0.04
EAS-DS	2026-02-25 17:00:00	8.59	159.02	0.27	7.91	11.04	12.00	0.07
EAS-DS	2026-02-25 17:15:00	8.61	151.16	0.28	7.71	11.04	6.51	0.07
EAS-DS	2026-02-25 17:30:00	8.63	154.32	0.26	7.79	10.96	14.04	0.07
EAS-DS	2026-02-25 17:45:00	7.59	121.28	0.27	7.74	11.50	6.76	0.06
EAS-DS	2026-02-25 18:00:00		158.85		7.90	10.98	10.24	0.07
EAS-DS	2026-02-25 18:15:00	8.61	161.43	0.28	7.94	11.01	6.77	0.08
EAS-DS	2026-02-25 18:30:00	8.07	146.94	0.28	7.87	11.32	9.85	0.07
EAS-DS	2026-02-25 18:45:00	8.62	158.19	0.28	7.90	11.01	4.52	0.07
EAS-DS	2026-02-25 19:00:00		67.34		7.70	11.36	1.99	0.03
EAS-DS	2026-02-25 19:15:00	8.63	150.79	0.28	7.89	11.05	5.60	0.07
EAS-DS	2026-02-25 19:30:00	6.87	61.14	0.27	7.63	11.51	3.80	0.03
EAS-DS	2026-02-25 19:45:00	8.56	150.33	0.27	7.84	11.07	2.90	0.07
EAS-DS	2026-02-25 20:00:00	8.04	138.53	0.28	7.76	11.35	4.36	0.06
EAS-DS	2026-02-25 20:15:00	8.59	146.29	0.28	7.82	11.02	3.84	0.07
EAS-DS	2026-02-25 20:30:00	8.61	143.85	0.27	7.82	11.00	11.13	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-25 20:45:00	8.62	137.07	0.27	7.85	11.06	7.40	0.06
EAS-DS	2026-02-25 21:00:00	8.63	135.99	0.27	7.89	11.03	5.55	0.06
EAS-DS	2026-02-25 21:15:00	6.31	16.25	0.28	7.71	11.68	0.93	0.01
EAS-DS	2026-02-25 21:30:00	8.60	139.03	0.26	7.92	11.02	4.11	0.06
EAS-DS	2026-02-25 21:45:00	8.64	134.31	0.27	7.84	11.07	2.05	0.06
EAS-DS	2026-02-25 22:00:00	8.66	130.87	0.28	7.73	11.04	4.46	0.06
EAS-DS	2026-02-25 22:15:00	7.90	113.91	0.29	7.64	11.46	3.12	0.05
EAS-DS	2026-02-25 22:30:00	7.66	63.42	0.28	7.70	11.17	8.46	0.03
EAS-DS	2026-02-25 22:45:00	8.47	128.36	0.28	7.76	11.15	2.55	0.06
EAS-DS	2026-02-25 23:00:00	8.67	131.14	0.28	7.82	11.05	3.57	0.06
EAS-DS	2026-02-25 23:15:00	8.69	129.33	0.28	7.73	10.97	6.69	0.06
EAS-DS	2026-02-25 23:30:00	8.71	130.18	0.27	7.77	11.01	5.01	0.06
EAS-DS	2026-02-25 23:45:00	8.72	132.33	0.27	7.84	11.01	1.63	0.06
EAS-DS	2026-02-26 00:00:00	8.73	130.59	0.27	7.83	11.03	4.41	0.06
EAS-DS	2026-02-26 00:15:00	8.73	128.55	0.28	7.84	11.00	4.11	0.06
EAS-DS	2026-02-26 00:30:00	6.66	24.52	0.28	7.53	11.51	3.15	0.01
EAS-DS	2026-02-26 00:45:00	8.60	127.51	0.28	7.74	11.11	3.56	0.06
EAS-DS	2026-02-26 01:00:00	8.74	128.96	0.28	7.81	11.04	0.93	0.06
EAS-DS	2026-02-26 01:15:00	8.76	128.68	0.28	7.82	11.02	0.76	0.06
EAS-DS	2026-02-26 01:30:00	8.76	129.39	0.27	7.82	11.02	2.38	0.06
EAS-DS	2026-02-26 01:45:00	8.75	127.08	0.28	7.83	11.05	4.73	0.06
EAS-DS	2026-02-26 02:00:00	8.75	127.59	0.28	7.84	11.06	4.62	0.06
EAS-DS	2026-02-26 02:15:00	8.74	127.08	0.28	7.84	11.04	8.64	0.06
EAS-DS	2026-02-26 02:30:00	8.71	114.99	0.28	7.82	11.05	8.18	0.05
EAS-DS	2026-02-26 02:45:00	8.50	110.81	0.29	7.76	11.17	3.54	0.05
EAS-DS	2026-02-26 03:00:00	8.65	110.43	0.29	7.80	11.10	3.80	0.05
EAS-DS	2026-02-26 03:15:00	8.40	105.75	0.29	7.76	11.20	5.29	0.05
EAS-DS	2026-02-26 03:30:00	8.64	120.66	0.28	7.81	11.08	11.43	0.06
EAS-DS	2026-02-26 03:45:00	8.65	120.88	0.28	7.82	11.05	4.18	0.06
EAS-DS	2026-02-26 04:00:00	8.51	119.41	0.29	7.74	11.17	4.88	0.06
EAS-DS	2026-02-26 04:15:00	8.68	120.78	0.29	7.75	11.09	6.23	0.06
EAS-DS	2026-02-26 04:30:00	8.68	121.62	0.28	7.79	11.08	4.43	0.06
EAS-DS	2026-02-26 04:45:00	8.68	120.92	0.28	7.78	11.08	3.97	0.06
EAS-DS	2026-02-26 05:00:00	8.39	117.85	0.28	7.75	11.23	3.91	0.05
EAS-DS	2026-02-26 05:15:00	8.68	122.95	0.28	7.82	11.07	3.85	0.06
EAS-DS	2026-02-26 05:30:00	8.70	136.02	0.26	8.15	11.07	13.47	0.06
EAS-DS	2026-02-26 05:45:00	8.72	140.98	0.28	7.93	11.04	7.81	0.07
EAS-DS	2026-02-26 06:00:00	8.72	134.22	0.28	7.90	11.05	7.33	0.06
EAS-DS	2026-02-26 06:15:00	8.29	122.00	0.30	7.82	11.29	4.86	0.06
EAS-DS	2026-02-26 06:30:00	8.71	133.60	0.28	8.07	11.03	7.76	0.06
EAS-DS	2026-02-26 06:45:00	8.71	147.01	0.27	8.36	11.06	6.30	0.07
EAS-DS	2026-02-26 07:00:00	8.70	159.50	0.28	8.02	11.05	5.31	0.07
EAS-DS	2026-02-26 07:15:00	8.62	174.35	0.29	7.99	11.07	4.17	0.08
EAS-DS	2026-02-26 07:30:00	8.72	190.87	0.27	8.22	11.03	10.12	0.09
EAS-DS	2026-02-26 07:45:00	8.12	179.85	0.28	8.06	11.32	6.39	0.08
EAS-DS	2026-02-26 08:00:00	8.76	173.74	0.28	8.02	10.95	2.67	0.08
EAS-DS	2026-02-26 08:15:00	8.37	118.02	0.29	7.93	10.92	3.03	0.05
EAS-DS	2026-02-26 08:30:00	8.73	147.28	0.29	7.90	11.00	6.05	0.07
EAS-DS	2026-02-26 08:45:00	8.77	142.28	0.28	7.91	11.06	5.77	0.07
EAS-DS	2026-02-26 09:00:00	8.68	136.74	0.28	7.88	11.14	2.68	0.06
EAS-DS	2026-02-26 09:15:00	7.18	58.33	0.28	7.63	11.34	2.34	0.03
EAS-DS	2026-02-26 09:30:00	8.80	138.89	0.27	7.91	11.06	5.81	0.06
EAS-DS	2026-02-26 09:45:00	8.41	110.92	0.28	7.78	10.99	3.74	0.05
EAS-DS	2026-02-26 10:00:00	8.74	137.07	0.28	7.76	11.05	6.00	0.06
EAS-DS	2026-02-26 10:15:00	8.89	160.16	0.27	7.77	10.99	12.52	0.08

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-26 10:30:00	8.05	137.42	0.28	7.69	11.26	10.09	0.06
EAS-DS	2026-02-26 10:45:00	8.92	184.50	0.27	7.65	10.86	19.21	0.09
EAS-DS	2026-02-26 11:00:00	8.93	186.83	0.27	7.63	10.98	23.08	0.09
EAS-DS	2026-02-26 11:15:00	8.82	176.33	0.28	7.65	10.88	26.53	0.08
EAS-DS	2026-02-26 11:30:00	8.62	173.66	0.26	7.75	10.84	34.38	0.08
EAS-DS	2026-02-26 11:45:00	8.98	209.48	0.27	7.70	10.93	43.60	0.10
EAS-DS	2026-02-26 12:00:00	8.93	197.33	0.27	7.62	10.95	51.56	0.09
EAS-DS	2026-02-26 12:15:00	9.00	195.55	0.28	7.64	10.91	35.49	0.09
EAS-DS	2026-02-26 12:30:00	9.04	201.02	0.27	7.72	10.80	70.90	0.09
EAS-DS	2026-02-26 12:45:00	8.87	185.59	0.27	7.69	10.96	35.10	0.09
EAS-DS	2026-02-26 13:00:00	8.99	181.94	0.25	7.69	10.92	50.08	0.09
EAS-DS	2026-02-26 13:15:00	8.74	168.32	0.23	7.70	10.86	49.37	0.08
EAS-DS	2026-02-26 13:30:00	8.93	173.36	0.23	7.68	10.92	58.62	0.08
EAS-DS	2026-02-26 13:45:00	8.80	169.17	0.25	7.66	10.90	50.42	0.08
EAS-DS	2026-02-26 14:00:00	7.92	112.39	0.24	7.81	11.07	30.07	0.05
EAS-DS	2026-02-26 14:15:00	8.95	190.06	0.25	7.78	10.79	21.89	0.09
EAS-DS	2026-02-26 14:30:00	7.76	106.79	0.26	7.69	11.27	44.34	0.05
EAS-DS	2026-02-26 14:45:00	8.95	193.44	0.26	7.70	10.89	27.27	0.09
EAS-DS	2026-02-26 15:00:00	8.96	190.95	0.26	7.62	10.93	30.08	0.09
EAS-DS	2026-02-26 15:15:00	7.69	111.09	0.27	7.54	11.41	22.71	0.05
EAS-DS	2026-02-26 15:30:00	7.84	99.76	0.25	7.65	11.02	35.05	0.05
EAS-DS	2026-02-26 15:45:00	8.82	188.36	0.27	7.65	10.95	42.56	0.09
EAS-DS	2026-02-26 16:00:00	8.82	183.31	0.28	7.64	10.92	43.49	0.09
EAS-DS	2026-02-26 16:15:00	8.95	191.62	0.28	7.60	10.94	48.89	0.09
EAS-DS	2026-02-26 16:30:00	7.16	54.12	0.27	7.56	11.41	44.37	0.02
EAS-DS	2026-02-26 16:45:00	7.61	86.38	0.26	7.60	11.11	35.36	0.04
EAS-DS	2026-02-26 17:00:00	7.16	69.64	0.28	7.49	11.38	24.10	0.03
EAS-DS	2026-02-26 17:15:00	8.40	187.52	0.28	7.52	11.18	64.61	0.09
EAS-DS	2026-02-26 17:30:00	7.58	93.07	0.24	7.67	11.03	62.73	0.04
EAS-DS	2026-02-26 17:45:00	8.90	203.74	0.25	7.71	10.91	41.20	0.10
EAS-DS	2026-02-26 18:00:00	8.89	201.83	0.25	7.73	10.93	36.48	0.10
EAS-DS	2026-02-26 18:15:00	8.92	210.74	0.25	7.78	10.90	37.02	0.10
EAS-DS	2026-02-26 18:30:00	8.93	219.81	0.26	7.80	10.83	69.71	0.10
EAS-DS	2026-02-26 18:45:00	8.95	224.16	0.25	7.81	10.80	50.08	0.11
EAS-DS	2026-02-26 19:00:00	8.92	222.66	0.25	7.79	10.84	57.35	0.11
EAS-DS	2026-02-26 19:15:00	8.20	141.51	0.24	7.77	10.64	46.34	0.07
EAS-DS	2026-02-26 19:30:00	8.70	197.38	0.23	7.69	10.80	57.79	0.09
EAS-DS	2026-02-26 19:45:00	8.85	202.44	0.25	7.66	10.92	65.22	0.10
EAS-DS	2026-02-26 20:00:00		80.80	0.26	7.61	11.40	31.69	0.04
EAS-DS	2026-02-26 20:15:00	8.42	184.84	0.28	7.60	11.19	75.44	0.09
EAS-DS	2026-02-26 20:30:00	8.75	189.36	0.27	7.62	11.01	79.39	0.09
EAS-DS	2026-02-26 20:45:00	7.82	105.16	0.26	7.62	10.94	43.59	0.05
EAS-DS	2026-02-26 21:00:00	8.72	180.09	0.23	7.58	10.92	56.71	0.08
EAS-DS	2026-02-26 21:15:00	8.76	172.38	0.25	7.64	10.92	63.72	0.08
EAS-DS	2026-02-26 21:30:00	8.68	165.88	0.25	7.72	11.01	54.01	0.08
EAS-DS	2026-02-26 21:45:00	8.74	165.88	0.26	7.84	11.01	31.30	0.08
EAS-DS	2026-02-26 22:00:00	8.07	142.56	0.26	8.72	10.95	44.83	0.07
EAS-DS	2026-02-26 22:15:00	8.47	241.56	0.22	9.68	11.12	61.05	0.11
EAS-DS	2026-02-26 22:30:00	7.25	121.27	0.20	9.34	11.32	53.64	0.06
EAS-DS	2026-02-26 22:45:00	8.69	238.70	0.21	8.91	10.99	53.15	0.11
EAS-DS	2026-02-26 23:00:00	8.70	204.09	0.24	8.27	10.85	43.68	0.10
EAS-DS	2026-02-26 23:15:00	7.84	106.94	0.25	8.10	10.64	34.71	0.05
EAS-DS	2026-02-26 23:30:00	8.52	158.28	0.25	7.98	10.99	45.03	0.07
EAS-DS	2026-02-26 23:45:00	8.68	148.91	0.26	8.00	11.00	33.03	0.07
EAS-DS	2026-02-27 00:00:00	8.70	144.79	0.27	8.02	11.00	32.78	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-27 00:15:00	8.69	140.59	0.27	8.01	10.98	35.73	0.07
EAS-DS	2026-02-27 00:30:00	8.49	141.55	0.27	7.91	11.07	50.23	0.07
EAS-DS	2026-02-27 00:45:00	8.34	133.31	0.28	7.86	11.19	34.98	0.06
EAS-DS	2026-02-27 01:00:00	6.41	33.29	0.29	7.49	11.53	34.42	0.01
EAS-DS	2026-02-27 01:15:00	6.24	30.22	0.30	7.37	11.69	34.06	0.01
EAS-DS	2026-02-27 01:30:00	8.59	160.07	0.27	7.96	10.99	40.43	0.07
EAS-DS	2026-02-27 01:45:00	8.68	162.93	0.27	8.22	11.01	47.42	0.08
EAS-DS	2026-02-27 02:00:00	8.30	145.01	0.28	8.05	11.14	55.32	0.07
EAS-DS	2026-02-27 02:15:00	8.65	162.25	0.28	8.10	11.02	57.38	0.08
EAS-DS	2026-02-27 02:30:00	8.68	164.68	0.27	8.15	10.98	85.97	0.08
EAS-DS	2026-02-27 02:45:00	7.85	133.85	0.28	7.92	11.28	49.76	0.06
EAS-DS	2026-02-27 03:00:00	8.66	158.77	0.28	7.98	10.81	52.34	0.07
EAS-DS	2026-02-27 03:15:00	8.50	143.34	0.28	7.95	10.81	51.07	0.07
EAS-DS	2026-02-27 03:30:00	7.76	98.30	0.27	7.90	10.89	52.40	0.05
EAS-DS	2026-02-27 03:45:00	8.64	155.91	0.28	7.97	10.97	47.62	0.07
EAS-DS	2026-02-27 04:00:00	8.66	153.10	0.28	8.00	10.98	46.79	0.07
EAS-DS	2026-02-27 04:15:00	8.38	134.57	0.28	7.94	11.00	46.51	0.06
EAS-DS	2026-02-27 04:30:00	8.65	140.21	0.29	7.87	10.95	56.83	0.07
EAS-DS	2026-02-27 04:45:00	7.31	72.76	0.28	7.75	11.04	37.15	0.03
EAS-DS	2026-02-27 05:00:00	8.38	129.69	0.28	7.87	10.78	51.10	0.06
EAS-DS	2026-02-27 05:15:00	8.61	141.16	0.28	7.94	10.64	46.41	0.07
EAS-DS	2026-02-27 05:30:00	8.46	131.25	0.27	7.91	10.68	43.80	0.06
EAS-DS	2026-02-27 05:45:00	8.38	135.94	0.28	7.89	11.07	48.59	0.06
EAS-DS	2026-02-27 06:00:00	8.67	148.28	0.28	8.05	10.92	61.42	0.07
EAS-DS	2026-02-27 06:15:00	8.56	167.99	0.26	8.61	10.91	58.41	0.08
EAS-DS	2026-02-27 06:30:00	6.93	85.08	0.28	7.93	11.34	47.87	0.04
EAS-DS	2026-02-27 06:45:00	7.09	92.25	0.27	8.04	10.95	36.97	0.04
EAS-DS	2026-02-27 07:00:00	7.95	164.20	0.27	8.15	10.56	43.62	0.08
EAS-DS	2026-02-27 07:15:00	8.32	206.17	0.27	8.10	10.61	56.00	0.10
EAS-DS	2026-02-27 07:30:00	8.57	208.83	0.26	8.01	10.56	68.21	0.10
EAS-DS	2026-02-27 07:45:00	8.58	188.35	0.27	7.94	10.82	45.02	0.09
EAS-DS	2026-02-27 08:00:00	8.31	150.69	0.27	7.94	10.76	47.70	0.07
EAS-DS	2026-02-27 08:15:00	8.44	155.32	0.28	7.93	10.95	47.80	0.07
EAS-DS	2026-02-27 08:30:00	8.60	150.90	0.28	7.95	10.85	63.24	0.07
EAS-DS	2026-02-27 08:45:00	8.37	138.46	0.28	7.92	10.74	41.18	0.06
EAS-DS	2026-02-27 09:00:00	8.60	141.23	0.28	7.96	10.71	39.57	0.07
EAS-DS	2026-02-27 09:15:00	8.61	137.20	0.28	7.95	10.71	40.53	0.06
EAS-DS	2026-02-27 09:30:00	8.60	134.97	0.27	7.94	10.75	40.88	0.06
EAS-DS	2026-02-27 09:45:00	6.95	51.81	0.29	7.73	11.43	35.15	0.02
EAS-DS	2026-02-27 10:00:00	8.57	127.56	0.29	7.87	11.06	35.70	0.06
EAS-DS	2026-02-27 10:15:00	8.55	128.47	0.29	7.91	11.08	35.69	0.06
EAS-DS	2026-02-27 10:30:00	8.65	147.15	0.29	8.16	10.94	49.39	0.07
EAS-DS	2026-02-27 10:45:00	8.57	164.98	0.27	8.24	10.67	49.63	0.08
EAS-DS	2026-02-27 11:00:00		180.06		8.21	10.61	50.68	0.08
EAS-DS	2026-02-27 11:15:00	8.54	176.80	0.27	8.03	10.83	49.45	0.08
EAS-DS	2026-02-27 11:30:00	9.04	188.90	0.25	8.06	10.62	50.51	0.09
EAS-DS	2026-02-27 11:45:00	8.95	180.69	0.27	7.97	10.93	47.89	0.08
EAS-DS	2026-02-27 12:00:00		172.00		7.99	10.71	47.07	0.08
EAS-DS	2026-02-27 12:15:00	8.79	157.56	0.28	7.88	10.88	45.30	0.07
EAS-DS	2026-02-27 12:30:00	9.09	153.27	0.28	7.93	10.64	45.27	0.07
EAS-DS	2026-02-27 12:45:00	9.05	146.68	0.27	7.89	10.50	39.69	0.07
EAS-DS	2026-02-27 13:00:00	9.15	148.64	0.27	7.86	10.51	38.28	0.07
EAS-DS	2026-02-27 13:15:00	9.12	148.09	0.27	7.81	10.40	38.31	0.07
EAS-DS	2026-02-27 13:30:00	9.03	144.52	0.26	7.77	10.59	46.96	0.07
EAS-DS	2026-02-27 13:45:00	9.17	146.60	0.27	7.81	10.69	37.23	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-27 14:00:00	9.19	145.86	0.28	7.85	10.67	36.98	0.07
EAS-DS	2026-02-27 14:15:00	7.03	41.73	0.29	7.47	11.34	36.86	0.02
EAS-DS	2026-02-27 14:30:00	8.86	135.04	0.29	7.82	10.85	54.99	0.06
EAS-DS	2026-02-27 14:45:00	9.14	138.29	0.28	7.84	10.51	37.39	0.06
EAS-DS	2026-02-27 15:00:00	8.98	137.60	0.29	7.77	10.66	38.24	0.06
EAS-DS	2026-02-27 15:15:00	9.12	145.06	0.28	7.82	10.56	40.54	0.07
EAS-DS	2026-02-27 15:30:00	8.14	81.29	0.27	7.79	10.42	37.67	0.04
EAS-DS	2026-02-27 15:45:00	8.95	141.51	0.29	7.85	10.76	33.06	0.07
EAS-DS	2026-02-27 16:00:00	7.99	77.60	0.29	7.70	10.66	31.50	0.04
EAS-DS	2026-02-27 16:15:00	8.94	135.38	0.29	7.83	10.76	34.04	0.06
EAS-DS	2026-02-27 16:30:00	9.03	134.38	0.29	7.85	10.62	41.15	0.06
EAS-DS	2026-02-27 16:45:00	8.99	134.42	0.28	7.83	10.55	33.55	0.06
EAS-DS	2026-02-27 17:00:00	6.80	34.07	0.30	7.40	11.16	31.26	0.01
EAS-DS	2026-02-27 17:15:00	8.86	136.24	0.29	7.81	10.67	31.59	0.06
EAS-DS	2026-02-27 17:30:00	8.94	139.40	0.28	7.84	10.59	37.00	0.07
EAS-DS	2026-02-27 17:45:00	8.90	138.30	0.30	7.84	10.88	28.99	0.06
EAS-DS	2026-02-27 18:00:00	7.08	55.96	0.30	7.55	11.35	28.52	0.03
EAS-DS	2026-02-27 18:15:00	8.83	134.08	0.31	7.79	10.92	29.25	0.06
EAS-DS	2026-02-27 18:30:00	8.88	133.09	0.30	7.81	10.87	58.92	0.06
EAS-DS	2026-02-27 18:45:00	8.82	128.09	0.30	7.82	10.72	29.72	0.06
EAS-DS	2026-02-27 19:00:00	8.88	130.67	0.30	7.82	10.72	30.58	0.06
EAS-DS	2026-02-27 19:15:00	8.87	129.34	0.30	7.81	10.76	30.55	0.06
EAS-DS	2026-02-27 19:30:00	6.64	32.22	0.30	7.39	11.33	30.19	0.01
EAS-DS	2026-02-27 19:45:00	7.87	108.75	0.32	7.38	11.52	29.40	0.05
EAS-DS	2026-02-27 20:00:00	8.81	126.03	0.32	7.76	10.95	28.87	0.06
EAS-DS	2026-02-27 20:15:00	8.81	126.14	0.32	7.77	10.94	28.60	0.06
EAS-DS	2026-02-27 20:30:00	7.24	59.13	0.31	7.61	11.31	39.31	0.03
EAS-DS	2026-02-27 20:45:00	8.78	124.76	0.31	7.77	10.86	29.11	0.06
EAS-DS	2026-02-27 21:00:00	8.83	125.15	0.31	7.79	10.83	28.94	0.06
EAS-DS	2026-02-27 21:15:00	8.78	123.70	0.31	7.79	10.87	29.63	0.06
EAS-DS	2026-02-27 21:30:00	7.85	100.58	0.31	7.63	11.28	30.80	0.05
EAS-DS	2026-02-27 21:45:00	8.77	122.90	0.31	7.78	10.93	29.95	0.06
EAS-DS	2026-02-27 22:00:00	8.82	124.28	0.31	7.80	10.89	32.08	0.06
EAS-DS	2026-02-27 22:15:00	8.79	125.78	0.32	7.80	10.93	31.50	0.06
EAS-DS	2026-02-27 22:30:00	8.83	127.52	0.31	7.80	10.89	38.48	0.06
EAS-DS	2026-02-27 22:45:00	8.81	128.52	0.31	7.80	10.85	33.46	0.06
EAS-DS	2026-02-27 23:00:00		107.00		7.55	11.20	31.74	0.05
EAS-DS	2026-02-27 23:15:00	8.77	132.16	0.31	7.80	10.86	30.97	0.06
EAS-DS	2026-02-27 23:30:00	8.80	134.34	0.30	7.80	10.83	32.87	0.06
EAS-DS	2026-02-27 23:45:00	8.75	134.03	0.31	7.76	10.98	30.09	0.06
EAS-DS	2026-02-28 00:00:00	7.19	68.35	0.31	7.66	11.39	28.94	0.03
EAS-DS	2026-02-28 00:15:00	8.64	131.33	0.32	7.72	11.04	29.48	0.06
EAS-DS	2026-02-28 00:30:00	8.68	131.49	0.31	7.73	10.97	36.92	0.06
EAS-DS	2026-02-28 00:45:00	6.53	39.98	0.31	7.56	11.38	29.94	0.02
EAS-DS	2026-02-28 01:00:00	8.62	131.21	0.31	7.74	10.96	29.79	0.06
EAS-DS	2026-02-28 01:15:00	8.64	130.81	0.31	7.75	10.95	29.56	0.06
EAS-DS	2026-02-28 01:30:00	8.68	133.22	0.30	7.73	10.83	31.79	0.06
EAS-DS	2026-02-28 01:45:00	8.64	135.57	0.31	7.74	10.88	32.49	0.06
EAS-DS	2026-02-28 02:00:00	6.51	54.79	0.31	7.44	11.10	29.30	0.02
EAS-DS	2026-02-28 02:15:00	8.37	132.79	0.32	7.69	11.05	31.24	0.06
EAS-DS	2026-02-28 02:30:00	8.60	137.07	0.31	7.72	10.84	41.37	0.06
EAS-DS	2026-02-28 02:45:00	8.55	136.64	0.31	7.70	10.68	33.65	0.06
EAS-DS	2026-02-28 03:00:00	8.53	137.40	0.31	7.73	10.68	30.83	0.06
EAS-DS	2026-02-28 03:15:00	6.53	50.09	0.31	7.59	11.21	29.95	0.02
EAS-DS	2026-02-28 03:30:00	8.41	134.22	0.31	7.66	10.85	35.01	0.06

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-28 03:45:00	8.42	135.01	0.31	7.70	11.01	32.57	0.06
EAS-DS	2026-02-28 04:00:00	6.47	55.13	0.31	7.51	11.16	29.25	0.02
EAS-DS	2026-02-28 04:15:00	7.93	121.91	0.33	7.59	11.35	30.99	0.06
EAS-DS	2026-02-28 04:30:00	8.46	129.41	0.32	7.72	11.01	42.44	0.06
EAS-DS	2026-02-28 04:45:00	8.49	129.25	0.31	7.73	10.91	30.94	0.06
EAS-DS	2026-02-28 05:00:00	8.52	128.83	0.31	7.74	10.90	30.20	0.06
EAS-DS	2026-02-28 05:15:00	8.51	128.66	0.31	7.75	10.92	30.80	0.06
EAS-DS	2026-02-28 05:30:00	8.35	124.80	0.31	7.73	10.98	39.15	0.06
EAS-DS	2026-02-28 05:45:00	8.51	129.34	0.31	7.77	11.08	31.56	0.06
EAS-DS	2026-02-28 06:00:00	6.65	84.25	0.32	7.55	11.96	30.66	0.04
EAS-DS	2026-02-28 06:15:00	8.37	128.98	0.32	7.77	11.12	31.75	0.06
EAS-DS	2026-02-28 06:30:00	8.42	129.85	0.32	7.77	11.09	43.44	0.06
EAS-DS	2026-02-28 06:45:00	8.50	131.63	0.31	7.78	10.91	32.30	0.06
EAS-DS	2026-02-28 07:00:00	8.49	130.89	0.31	7.78	10.97	32.11	0.06
EAS-DS	2026-02-28 07:15:00	6.76	57.45	0.31	7.72	11.34	30.53	0.03
EAS-DS	2026-02-28 07:30:00	8.38	128.48	0.30	7.74	11.05	42.30	0.06
EAS-DS	2026-02-28 07:45:00	8.41	128.73	0.31	7.75	11.14	32.47	0.06
EAS-DS	2026-02-28 08:00:00	8.45	127.90	0.32	7.77	11.11	32.18	0.06
EAS-DS	2026-02-28 08:15:00	6.78	91.28	0.32	7.62	11.85	32.72	0.04
EAS-DS	2026-02-28 08:30:00	8.44	125.97	0.32	7.74	11.11	42.08	0.06
EAS-DS	2026-02-28 08:45:00	8.42	126.09	0.31	7.74	11.06	34.34	0.06
EAS-DS	2026-02-28 09:00:00	8.53	129.00	0.31	7.77	10.97	33.76	0.06
EAS-DS	2026-02-28 09:15:00	8.55	129.33	0.31	7.77	10.95	33.14	0.06
EAS-DS	2026-02-28 09:30:00	8.58	128.52	0.30	7.75	10.99	40.04	0.06
EAS-DS	2026-02-28 09:45:00	8.58	124.92	0.31	7.77	11.07	33.31	0.06
EAS-DS	2026-02-28 10:00:00	8.65	126.69	0.32	7.76	11.06	33.79	0.06
EAS-DS	2026-02-28 10:15:00	7.43	94.01	0.32	7.65	11.58	34.52	0.04
EAS-DS	2026-02-28 10:30:00	8.81	128.16	0.32	7.75	10.96	40.22	0.06
EAS-DS	2026-02-28 10:45:00	8.94	130.66	0.31	7.79	10.79	34.77	0.06
EAS-DS	2026-02-28 11:00:00	8.24	113.61	0.31	7.68	11.01	33.72	0.05
EAS-DS	2026-02-28 11:15:00	8.70	110.27	0.31	7.82	10.73	32.73	0.05
EAS-DS	2026-02-28 11:30:00	9.11	133.03	0.30	7.82	10.61	42.18	0.06
EAS-DS	2026-02-28 11:45:00	9.20	134.25	0.31	7.83	10.71	33.58	0.06
EAS-DS	2026-02-28 12:00:00	9.22	133.88	0.31	7.81	10.69	33.55	0.06
EAS-DS	2026-02-28 12:15:00	7.71	64.29	0.31	7.63	10.97	33.50	0.03
EAS-DS	2026-02-28 12:30:00	9.37	133.62	0.31	7.77	10.61	35.88	0.06
EAS-DS	2026-02-28 12:45:00	8.67	115.93	0.31	7.67	10.69	35.08	0.05
EAS-DS	2026-02-28 13:00:00	9.52	137.87	0.30	7.85	10.20	35.49	0.06
EAS-DS	2026-02-28 13:15:00	9.54	139.63	0.30	7.87	10.11	35.62	0.07
EAS-DS	2026-02-28 13:30:00	8.76	86.88	0.29	7.85	10.05	45.33	0.04
EAS-DS	2026-02-28 13:45:00	8.24	81.37	0.31	7.68	10.89	42.05	0.04
EAS-DS	2026-02-28 14:00:00	9.33	132.27	0.31	7.74	10.54	41.57	0.06
EAS-DS	2026-02-28 14:15:00	9.42	133.20	0.32	7.79	10.57	43.55	0.06
EAS-DS	2026-02-28 14:30:00	9.42	133.08	0.31	7.79	10.57	57.02	0.06
EAS-DS	2026-02-28 14:45:00	9.40	132.34	0.30	7.81	10.26	42.55	0.06
EAS-DS	2026-02-28 15:00:00	8.24	78.58	0.30	7.72	10.67	40.85	0.04
EAS-DS	2026-02-28 15:15:00	9.34	130.05	0.31	7.79	10.21	47.34	0.06
EAS-DS	2026-02-28 15:30:00	8.66	110.23	0.31	7.60	10.90	50.29	0.05
EAS-DS	2026-02-28 15:45:00	9.26	126.40	0.31	7.77	10.56	42.66	0.06
EAS-DS	2026-02-28 16:00:00	9.36	132.23	0.31	7.80	10.49	41.45	0.06
EAS-DS	2026-02-28 16:15:00	9.36	134.79	0.31	7.81	10.45	42.64	0.06
EAS-DS	2026-02-28 16:30:00	8.86	128.68	0.31	7.71	10.78	67.97	0.06
EAS-DS	2026-02-28 16:45:00	9.27	136.36	0.30	7.83	10.15	45.86	0.06
EAS-DS	2026-02-28 17:00:00	8.38	97.74	0.30	7.75	10.54	48.42	0.05
EAS-DS	2026-02-28 17:15:00	9.01	130.45	0.31	7.74	10.55	52.11	0.06

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-02-28 17:30:00	9.26	134.47	0.30	7.76	10.24	49.69	0.06
EAS-DS	2026-02-28 17:45:00	9.27	135.81	0.30	7.78	10.56	39.43	0.06
EAS-DS	2026-02-28 18:00:00	9.29	137.46	0.30	7.78	10.51	39.39	0.06
EAS-DS	2026-02-28 18:15:00	8.89	124.11	0.31	7.72	10.70	39.17	0.06
EAS-DS	2026-02-28 18:30:00	9.22	138.26	0.31	7.76	10.45	55.74	0.06
EAS-DS	2026-02-28 18:45:00	9.02	135.35	0.30	7.79	10.37	41.54	0.06
EAS-DS	2026-02-28 19:00:00	9.09	138.53	0.30	7.85	10.11	41.27	0.06
EAS-DS	2026-02-28 19:15:00	9.04	136.57	0.30	7.83	10.19	40.97	0.06
EAS-DS	2026-02-28 19:30:00	8.32	110.34	0.30	7.73	10.50	43.81	0.05
EAS-DS	2026-02-28 19:45:00	8.96	133.44	0.31	7.76	10.67	40.41	0.06
EAS-DS	2026-02-28 20:00:00	8.96	133.87	0.31	7.76	10.75	40.97	0.06
EAS-DS	2026-02-28 20:15:00	8.08	101.50	0.31	7.70	10.58	40.88	0.05
EAS-DS	2026-02-28 20:30:00	8.82	133.36	0.31	7.74	10.79	50.46	0.06
EAS-DS	2026-02-28 20:45:00	8.84	132.99	0.31	7.78	10.61	41.39	0.06
EAS-DS	2026-02-28 21:00:00	8.83	131.93	0.31	7.76	10.63	41.01	0.06
EAS-DS	2026-02-28 21:15:00	7.90	93.68	0.31	7.72	10.86	41.11	0.04
EAS-DS	2026-02-28 21:30:00	8.60	126.79	0.31	7.74	10.83	43.07	0.06
EAS-DS	2026-02-28 21:45:00	8.76	131.96	0.31	7.75	10.87	40.58	0.06
EAS-DS	2026-02-28 22:00:00	8.78	131.13	0.31	7.75	10.85	43.36	0.06
EAS-DS	2026-02-28 22:15:00	6.41	49.85	0.31	7.53	11.47	40.16	0.02
EAS-DS	2026-02-28 22:30:00	8.54	126.21	0.32	7.63	11.03	47.97	0.06
EAS-DS	2026-02-28 22:45:00	8.70	128.99	0.31	7.72	10.76	41.65	0.06
EAS-DS	2026-02-28 23:00:00	8.72	129.76	0.31	7.73	10.71	40.55	0.06
EAS-DS	2026-02-28 23:15:00	8.71	130.08	0.31	7.72	10.70	43.05	0.06
EAS-DS	2026-02-28 23:30:00	7.16	62.67	0.30	7.68	10.78	55.00	0.03
EAS-DS	2026-02-28 23:45:00	8.58	126.34	0.31	7.67	11.03	47.17	0.06
EAS-DS	2026-03-01 00:00:00	8.57	127.34	0.31	7.70	11.03	48.58	0.06
EAS-DS	2026-03-01 00:15:00	8.60	125.67	0.31	7.74	11.01	46.94	0.06
EAS-DS	2026-03-01 00:30:00	8.63	124.32	0.31	7.78	10.95	57.30	0.06
EAS-DS	2026-03-01 00:45:00	8.62	123.63	0.31	7.81	10.79	46.30	0.06
EAS-DS	2026-03-01 01:00:00	7.20	74.48	0.31	7.79	11.16	46.57	0.03
EAS-DS	2026-03-01 01:15:00	8.60	123.84	0.31	7.84	10.75	44.77	0.06
EAS-DS	2026-03-01 01:30:00	8.63	124.99	0.31	7.82	10.68	45.76	0.06
EAS-DS	2026-03-01 01:45:00	8.61	124.28	0.31	7.83	10.97	45.11	0.06
EAS-DS	2026-03-01 02:00:00	6.88	80.90	0.31	7.73	11.07	43.83	0.04
EAS-DS	2026-03-01 02:15:00	8.32	117.17	0.32	7.75	11.07	44.52	0.05
EAS-DS	2026-03-01 02:30:00	8.43	117.81	0.31	7.81	10.98	49.62	0.05
EAS-DS	2026-03-01 02:45:00	8.18	111.43	0.31	7.82	10.89	41.94	0.05
EAS-DS	2026-03-01 03:00:00	7.95	107.82	0.31	7.71	11.07	41.95	0.05
EAS-DS	2026-03-01 03:15:00	8.37	113.38	0.31	7.75	10.83	41.50	0.05
EAS-DS	2026-03-01 03:30:00	7.43	81.81	0.31	7.72	10.66	47.34	0.04
EAS-DS	2026-03-01 03:45:00	8.20	113.32	0.31	7.72	11.02	42.64	0.05
EAS-DS	2026-03-01 04:00:00	8.42	124.85	0.32	7.73	10.85	42.26	0.06
EAS-DS	2026-03-01 04:15:00	7.47	98.06	0.32	7.70	10.66	42.24	0.05
EAS-DS	2026-03-01 04:30:00	8.39	137.08	0.32	7.69	10.77	52.72	0.06
EAS-DS	2026-03-01 04:45:00	8.30	135.25	0.31	7.74	10.37	49.38	0.06
EAS-DS	2026-03-01 05:00:00	8.14	139.96	0.31	7.69	10.53	45.81	0.07
EAS-DS	2026-03-01 05:15:00	8.31	139.70	0.31	7.73	10.17	48.49	0.07
EAS-DS	2026-03-01 05:30:00	8.38	140.96	0.31	7.73	10.18	53.67	0.07
EAS-DS	2026-03-01 05:45:00	7.55	113.35	0.31	7.79	10.81	44.97	0.05
EAS-DS	2026-03-01 06:00:00	7.97	149.80	0.31	7.81	10.85	50.43	0.07
EAS-DS	2026-03-01 06:15:00	8.09	183.60	0.31	7.82	10.67	53.45	0.09
EAS-DS	2026-03-01 06:30:00	6.48	115.61	0.28	8.66	10.92	70.66	0.05
EAS-DS	2026-03-01 06:45:00	5.33	40.68	0.31	7.74	10.26	53.08	0.02
EAS-DS	2026-03-01 07:00:00	5.08	30.14	0.32	7.37	8.99	47.87	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-03-01 07:15:00	5.01	30.78	0.32	7.26	10.30	48.03	0.01
EAS-DS	2026-03-01 07:30:00	4.93	32.43	0.32	7.23	10.85	60.58	0.01
EAS-DS	2026-03-01 07:45:00	7.86	233.69	0.25	9.33	10.67	71.11	0.11
EAS-DS	2026-03-01 08:00:00	7.90	211.75	0.27	8.62	10.83	51.68	0.10
EAS-DS	2026-03-01 08:15:00	8.11	191.43	0.30	7.98	10.58	50.32	0.09
EAS-DS	2026-03-01 08:30:00	8.33	191.57	0.30	7.97	10.50	73.70	0.09
EAS-DS	2026-03-01 08:45:00	8.23	165.11	0.30	7.98	10.37	58.62	0.08
EAS-DS	2026-03-01 09:00:00	8.32	165.79	0.30	7.96	10.26	56.59	0.08
EAS-DS	2026-03-01 09:15:00	8.28	153.13	0.30	7.97	10.24	57.35	0.07
EAS-DS	2026-03-01 09:30:00	8.46	155.65	0.30	7.94	10.21	59.90	0.07
EAS-DS	2026-03-01 09:45:00	8.37	145.35	0.29	7.93	10.57	51.80	0.07
EAS-DS	2026-03-01 10:00:00	8.54	149.98	0.30	7.89	10.57	51.77	0.07
EAS-DS	2026-03-01 10:15:00	8.51	145.49	0.30	7.89	10.56	52.56	0.07
EAS-DS	2026-03-01 10:30:00	8.72	149.69	0.30	7.84	10.38	68.43	0.07
EAS-DS	2026-03-01 10:45:00	8.64	144.25	0.29	7.87	9.99	57.21	0.07
EAS-DS	2026-03-01 11:00:00	8.91	149.81	0.22	7.90	10.91	0.00	0.07
EAS-DS	2026-03-01 11:15:00	8.81	145.42	0.23	7.95	10.87	0.56	0.07
EAS-DS	2026-03-01 11:30:00	9.06	169.02	0.24	7.95	10.78	0.00	0.08
EAS-DS	2026-03-01 11:45:00	8.93	2.14	0.23	8.06	10.62	17.77	0.00
EAS-DS	2026-03-01 12:00:00	8.92	151.27	0.25	7.93	10.58	0.34	0.07
EAS-DS	2026-03-01 12:15:00	9.11	156.93	0.25	7.95	10.41	1.56	0.07
EAS-DS	2026-03-01 12:30:00	9.27	156.80	0.26	7.96	10.35	3.02	0.07
EAS-DS	2026-03-01 12:45:00	9.45	157.53	0.27	7.94	10.61	3.06	0.07
EAS-DS	2026-03-01 13:00:00	9.48	156.84	0.27	7.93	10.59	0.99	0.07
EAS-DS	2026-03-01 13:15:00	9.39	157.59	0.27	7.87	10.69	1.99	0.07
EAS-DS	2026-03-01 13:30:00	9.58	156.64	0.27	7.89	10.56	2.18	0.07
EAS-DS	2026-03-01 13:45:00	9.63	154.77	0.27	7.90	10.55	5.48	0.07
EAS-DS	2026-03-01 14:00:00		154.03		7.92	10.53	3.61	0.07
EAS-DS	2026-03-01 14:15:00	8.53	3.65	0.26	8.00	10.67	0.12	0.00
EAS-DS	2026-03-01 14:30:00	9.38	151.61	0.28	7.92	10.63	2.81	0.07
EAS-DS	2026-03-01 14:45:00	9.60	159.71	0.29	7.94	10.60	6.53	0.07
EAS-DS	2026-03-01 15:00:00	9.61	163.27	0.29	7.94	10.60	4.55	0.08
EAS-DS	2026-03-01 15:15:00	9.60	164.16	0.30	7.93	10.58	2.37	0.08
EAS-DS	2026-03-01 15:30:00	9.44	154.20	0.29	7.96	10.49	8.88	0.07
EAS-DS	2026-03-01 15:45:00	9.58	167.02	0.29	7.99	10.51	4.40	0.08
EAS-DS	2026-03-01 16:00:00	9.54	1.85	0.29	8.05	10.50	0.00	0.00
EAS-DS	2026-03-01 16:15:00	9.53	165.83	0.29	7.97	10.58	4.49	0.08
EAS-DS	2026-03-01 16:30:00	9.51	165.96	0.29	8.04	10.55	5.98	0.08
EAS-DS	2026-03-01 16:45:00	9.42	167.10	0.30	8.29	10.55	6.39	0.08
EAS-DS	2026-03-01 17:00:00	9.09	163.09	0.30	7.94	10.81	1.08	0.08
EAS-DS	2026-03-01 17:15:00	9.36	165.91	0.31	7.86	10.61	0.00	0.08
EAS-DS	2026-03-01 17:30:00	9.34	166.74	0.31	7.92	10.54	1.50	0.08
EAS-DS	2026-03-01 17:45:00	9.31	170.41	0.30	8.00	10.54	1.44	0.08
EAS-DS	2026-03-01 18:00:00	8.38	1.19	0.30	7.96	10.84	0.00	0.00
EAS-DS	2026-03-01 18:15:00	9.22	167.19	0.31	7.92	10.63	1.06	0.08
EAS-DS	2026-03-01 18:30:00	9.24	165.90	0.31	7.93	10.57	4.80	0.08
EAS-DS	2026-03-01 18:45:00	9.22	162.41	0.31	7.88	10.66	1.21	0.08
EAS-DS	2026-03-01 19:00:00	9.18	169.55	0.31	7.94	10.67	15.85	0.08
EAS-DS	2026-03-01 19:15:00	9.01	174.77	0.31	7.82	10.77	13.64	0.08
EAS-DS	2026-03-01 19:30:00	9.05	183.10	0.31	7.84	10.64	12.98	0.09
EAS-DS	2026-03-01 19:45:00	8.98	171.31	0.31	7.89	10.69	7.85	0.08
EAS-DS	2026-03-01 20:00:00	9.04	161.28	0.31	7.96	10.61	1.90	0.08
EAS-DS	2026-03-01 20:15:00	8.62	1.38	0.30	8.01	10.74	0.00	0.00
EAS-DS	2026-03-01 20:30:00	9.01	152.07	0.32	7.93	10.68	4.94	0.07
EAS-DS	2026-03-01 20:45:00	8.85	150.68	0.32	7.66	10.89	0.32	0.07

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-DS	2026-03-01 21:00:00	9.00	157.69	0.32	7.96	10.74	0.27	0.07
EAS-DS	2026-03-01 21:15:00	9.00	164.25	0.32	7.98	10.71	0.29	0.08
EAS-DS	2026-03-01 21:30:00	8.73	1.29	0.30	8.11	10.69	0.10	0.00
EAS-DS	2026-03-01 21:45:00	8.94	175.91	0.32	7.96	10.61	1.88	0.08
EAS-DS	2026-03-01 22:00:00	9.00	178.15	0.31	8.00	10.52	2.21	0.08
EAS-DS	2026-03-01 22:15:00	7.62	1.20	0.31	7.96	11.07	0.00	0.00
EAS-DS	2026-03-01 22:30:00	8.66	165.11	0.32	7.86	10.70	4.60	0.08
EAS-DS	2026-03-01 22:45:00	7.35	83.54	0.32	7.85	11.29	0.00	0.04
EAS-DS	2026-03-01 23:00:00	8.93	169.81	0.32	7.96	10.73	1.33	0.08
EAS-DS	2026-03-01 23:15:00	8.52	1.51	0.30	7.94	10.72	0.00	0.00
EAS-DS	2026-03-01 23:30:00	8.73	140.65	0.32	7.85	10.70	1.22	0.07
EAS-DS	2026-03-01 23:45:00	8.45	0.97	0.30	7.91	10.82	0.00	0.00
EAS-US	2026-02-23 00:00:00	4.78	45.41	0.40	7.44	12.36	9.63	0.02
EAS-US	2026-02-23 00:15:00	4.81	43.96	0.40	7.43	12.32	10.57	0.02
EAS-US	2026-02-23 00:30:00	4.83	42.49	0.41	7.42	12.34	3.89	0.02
EAS-US	2026-02-23 00:45:00	4.85	40.07	0.40	7.28	12.32	1.05	0.02
EAS-US	2026-02-23 01:00:00	4.86	37.30	0.41	7.30	12.32	1.39	0.02
EAS-US	2026-02-23 01:15:00	4.88	33.81	0.42	7.12	12.35	0.75	0.01
EAS-US	2026-02-23 01:30:00	4.89	31.62	0.41	7.24	12.32	0.46	0.01
EAS-US	2026-02-23 01:45:00	4.91	30.26	0.39	7.24	12.33	0.46	0.01
EAS-US	2026-02-23 02:00:00	4.92	28.59	0.40	7.16	12.34	0.02	0.01
EAS-US	2026-02-23 02:15:00	4.92	27.50	0.40	7.09	12.36	1.97	0.01
EAS-US	2026-02-23 02:30:00	4.91	27.46	0.40	7.15	12.35	1.24	0.01
EAS-US	2026-02-23 02:45:00	4.88	29.04	0.38	7.18	12.35	4.75	0.01
EAS-US	2026-02-23 03:00:00	4.86	30.15	0.40	7.14	12.36	18.69	0.01
EAS-US	2026-02-23 03:15:00	4.89	33.32	0.40	7.21	12.34	12.10	0.01
EAS-US	2026-02-23 03:30:00	4.91	35.26	0.40	7.34	12.33	6.12	0.02
EAS-US	2026-02-23 03:45:00	4.93	39.59	0.39	7.37	12.34	6.18	0.02
EAS-US	2026-02-23 04:00:00	4.94	38.73	0.40	7.28	12.31	5.66	0.02
EAS-US	2026-02-23 04:15:00	4.96	36.88	0.39	7.42	12.32	1.73	0.02
EAS-US	2026-02-23 04:30:00	4.99	35.75	0.39	7.34	12.32	2.75	0.02
EAS-US	2026-02-23 04:45:00	4.99	34.35	0.38	7.27	12.31	5.51	0.01
EAS-US	2026-02-23 05:00:00	5.03	35.29	0.39	7.27	12.34	5.14	0.02
EAS-US	2026-02-23 05:15:00	5.09	35.70	0.40	7.27	12.32	2.96	0.02
EAS-US	2026-02-23 05:30:00	5.12	35.80	0.40	7.25	12.31	3.97	0.02
EAS-US	2026-02-23 05:45:00	5.14	34.88	0.38	7.32	12.28	2.61	0.01
EAS-US	2026-02-23 06:00:00	5.16	32.83	0.39	7.29	12.28	0.99	0.01
EAS-US	2026-02-23 06:15:00	5.19	31.10	0.40	7.26	12.29	2.30	0.01
EAS-US	2026-02-23 06:30:00	5.20	29.31	0.40	7.23	12.26	0.77	0.01
EAS-US	2026-02-23 06:45:00	5.22	27.66	0.39	7.14	12.26	1.51	0.01
EAS-US	2026-02-23 07:00:00	5.24	26.34	0.40	7.10	12.28	1.15	0.01
EAS-US	2026-02-23 07:15:00	5.26	25.68	0.41	7.05	12.25	0.00	0.01
EAS-US	2026-02-23 07:30:00	5.27	25.17	0.41	7.08	12.27	1.24	0.01
EAS-US	2026-02-23 07:45:00	5.29	24.82	0.39	7.14	12.24	3.42	0.01
EAS-US	2026-02-23 08:00:00	5.31	24.57	0.40	7.14	12.25	0.31	0.01
EAS-US	2026-02-23 08:15:00	5.33	24.25	0.41	7.09	12.27	3.05	0.01
EAS-US	2026-02-23 08:30:00	5.35	24.14	0.41	7.11	12.25	3.46	0.01
EAS-US	2026-02-23 08:45:00	5.43	24.10	0.40	7.03	12.25	0.00	0.01
EAS-US	2026-02-23 09:00:00	5.46	24.07	0.41	7.05	12.24	0.00	0.01
EAS-US	2026-02-23 09:15:00	5.52	23.91	0.41	7.05	12.24	0.00	0.01
EAS-US	2026-02-23 09:30:00	5.57	23.72	0.41	7.02	12.22	1.05	0.01
EAS-US	2026-02-23 09:45:00	5.60	23.39	0.39	7.12	12.19	0.60	0.01
EAS-US	2026-02-23 10:00:00	5.62	22.81	0.39	7.17	12.20	1.03	0.01
EAS-US	2026-02-23 10:15:00	5.64	22.47	0.39	7.17	12.18	0.46	0.01
EAS-US	2026-02-23 10:30:00	5.66	22.20	0.39	7.16	12.17	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-23 10:45:00	5.69	22.16	0.38	6.99	12.15	0.02	0.01
EAS-US	2026-02-23 11:00:00	5.72	21.85	0.40	6.99	12.18	0.00	0.01
EAS-US	2026-02-23 11:15:00	5.76	21.66	0.40	7.01	12.17	1.18	0.01
EAS-US	2026-02-23 11:30:00	5.80	21.36	0.41	6.95	12.15	0.00	0.01
EAS-US	2026-02-23 11:45:00	5.86	21.10	0.39	7.08	12.12	0.06	0.01
EAS-US	2026-02-23 12:00:00	5.93	20.85	0.40	7.02	12.11	0.00	0.01
EAS-US	2026-02-23 12:15:00	5.93	20.61	0.40	7.04	12.11	0.00	0.01
EAS-US	2026-02-23 12:30:00	5.98	20.44	0.41	7.03	12.09	2.21	0.01
EAS-US	2026-02-23 12:45:00	5.97	20.27	0.39	6.96	12.07	0.31	0.01
EAS-US	2026-02-23 13:00:00	6.04	20.12	0.40	6.96	12.07	0.00	0.01
EAS-US	2026-02-23 13:15:00	6.16	20.01	0.41	6.94	12.05	0.00	0.01
EAS-US	2026-02-23 13:30:00	6.16	19.83	0.41	6.95	12.03	0.39	0.01
EAS-US	2026-02-23 13:45:00	6.22	19.64	0.39	7.02	11.97	0.00	0.01
EAS-US	2026-02-23 14:00:00	6.18	19.52	0.40	7.01	12.00	0.00	0.01
EAS-US	2026-02-23 14:15:00	6.16	19.41	0.41	6.95	12.01	0.00	0.01
EAS-US	2026-02-23 14:30:00	6.13	19.31	0.41	6.98	12.01	0.00	0.01
EAS-US	2026-02-23 14:45:00	6.11	19.21	0.39	6.91	12.00	0.00	0.01
EAS-US	2026-02-23 15:00:00	6.13	19.18	0.40	6.91	12.00	0.00	0.01
EAS-US	2026-02-23 15:15:00	6.10	19.13	0.41	6.84	12.00	0.00	0.01
EAS-US	2026-02-23 15:30:00	6.10	19.09	0.41	6.91	12.00	0.00	0.01
EAS-US	2026-02-23 15:45:00	6.08	19.06	0.39	6.95	11.99	0.00	0.01
EAS-US	2026-02-23 16:00:00	6.04	17.95	0.40	6.96	12.03	0.00	0.01
EAS-US	2026-02-23 16:15:00	6.04	17.83	0.41	7.00	12.05	0.00	0.01
EAS-US	2026-02-23 16:30:00	6.01	17.78	0.41	6.98	12.04	0.00	0.01
EAS-US	2026-02-23 16:45:00	5.98	19.00	0.37	6.87	12.02	0.00	0.01
EAS-US	2026-02-23 17:00:00	5.96	18.05	0.39	7.02	12.04	0.00	0.01
EAS-US	2026-02-23 17:15:00	5.94	17.91	0.40	7.01	12.05	0.00	0.01
EAS-US	2026-02-23 17:30:00	5.93	17.86	0.40	7.01	12.05	0.00	0.01
EAS-US	2026-02-23 17:45:00	5.91	17.83	0.34	7.01	12.04	0.00	0.01
EAS-US	2026-02-23 18:00:00	5.88	17.80	0.36	6.96	12.05	0.00	0.01
EAS-US	2026-02-23 18:15:00	5.84	17.76	0.37	7.04	12.06	0.00	0.01
EAS-US	2026-02-23 18:30:00	5.80	17.74	0.38	6.93	12.06	0.00	0.01
EAS-US	2026-02-23 18:45:00	5.75	18.00	0.37	6.95	12.10	0.00	0.01
EAS-US	2026-02-23 19:00:00	5.71	17.98	0.39	7.04	12.10	0.00	0.01
EAS-US	2026-02-23 19:15:00	5.66	17.95	0.40	7.03	12.11	0.00	0.01
EAS-US	2026-02-23 19:30:00	5.63	17.90	0.40	7.01	12.14	0.00	0.01
EAS-US	2026-02-23 19:45:00	5.60	18.20	0.34	7.02	12.14	0.00	0.01
EAS-US	2026-02-23 20:00:00	5.56	18.18	0.36	6.99	12.14	0.00	0.01
EAS-US	2026-02-23 20:15:00	5.52	18.15	0.37	7.04	12.16	0.00	0.01
EAS-US	2026-02-23 20:30:00	5.49	18.14	0.37	7.01	12.16	0.00	0.01
EAS-US	2026-02-23 20:45:00	5.45	17.89	0.37	6.98	12.16	0.00	0.01
EAS-US	2026-02-23 21:00:00	5.42	17.82	0.39	6.99	12.18	0.00	0.01
EAS-US	2026-02-23 21:15:00	5.37	17.81	0.40	6.94	12.19	0.00	0.01
EAS-US	2026-02-23 21:30:00	5.32	17.81	0.40	7.00	12.19	0.00	0.01
EAS-US	2026-02-23 21:45:00	5.28	17.87	0.34	6.98	12.20	0.00	0.01
EAS-US	2026-02-23 22:00:00	5.27	17.81	0.36	7.03	12.19	2.95	0.01
EAS-US	2026-02-23 22:15:00	5.25	17.79	0.37	6.98	12.22	0.00	0.01
EAS-US	2026-02-23 22:30:00	5.21	17.78	0.38	6.99	12.23	0.00	0.01
EAS-US	2026-02-23 22:45:00	5.16	17.69	0.37	6.98	12.24	0.00	0.01
EAS-US	2026-02-23 23:00:00	5.14	17.66	0.39	7.01	12.26	0.00	0.01
EAS-US	2026-02-23 23:15:00	5.11	17.63	0.40	7.00	12.26	0.00	0.01
EAS-US	2026-02-23 23:30:00	5.11	17.60	0.40	7.05	12.25	0.00	0.01
EAS-US	2026-02-23 23:45:00	5.11	17.75	0.34	7.03	12.25	0.00	0.01
EAS-US	2026-02-24 00:00:00	5.12	17.74	0.36	7.07	12.26	0.00	0.01
EAS-US	2026-02-24 00:15:00	5.11	17.73	0.37	7.04	12.27	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-24 00:30:00	5.10	17.70	0.37	7.07	12.25	0.00	0.01
EAS-US	2026-02-24 00:45:00	5.07	17.63	0.36	7.04	12.26	0.00	0.01
EAS-US	2026-02-24 01:00:00	5.04	17.61	0.39	6.99	12.27	0.00	0.01
EAS-US	2026-02-24 01:15:00	5.01	17.59	0.39	7.05	12.28	0.00	0.01
EAS-US	2026-02-24 01:30:00	4.98	17.54	0.40	7.08	12.27	0.00	0.01
EAS-US	2026-02-24 01:45:00	4.96	17.76	0.34	6.98	12.29	0.00	0.01
EAS-US	2026-02-24 02:00:00	4.94	17.74	0.36	7.06	12.28	0.00	0.01
EAS-US	2026-02-24 02:15:00	4.94	17.71	0.37	7.04	12.31	0.00	0.01
EAS-US	2026-02-24 02:30:00	4.94	17.66	0.37	7.06	12.30	0.00	0.01
EAS-US	2026-02-24 02:45:00	4.94	17.31	0.36	7.04	12.29	0.00	0.01
EAS-US	2026-02-24 03:00:00	4.95	17.32	0.39	7.04	12.27	0.00	0.01
EAS-US	2026-02-24 03:15:00	4.97	17.29	0.39	7.03	12.28	0.44	0.01
EAS-US	2026-02-24 03:30:00	4.98	17.28	0.40	7.06	12.27	0.00	0.01
EAS-US	2026-02-24 03:45:00	4.98	17.96	0.33	7.04	12.27	0.00	0.01
EAS-US	2026-02-24 04:00:00	4.97	17.99	0.36	7.05	12.27	0.00	0.01
EAS-US	2026-02-24 04:15:00	4.98	18.00	0.36	7.05	12.27	0.00	0.01
EAS-US	2026-02-24 04:30:00	4.98	17.98	0.37	7.07	12.28	0.00	0.01
EAS-US	2026-02-24 04:45:00	4.98	17.55	0.36	7.02	12.27	0.00	0.01
EAS-US	2026-02-24 05:00:00	4.96	17.57	0.39	7.03	12.27	0.00	0.01
EAS-US	2026-02-24 05:15:00	4.96	17.54	0.39	7.05	12.26	0.00	0.01
EAS-US	2026-02-24 05:30:00	4.95	17.56	0.40	7.01	12.27	0.00	0.01
EAS-US	2026-02-24 05:45:00	4.94	17.84	0.33	7.05	12.27	0.00	0.01
EAS-US	2026-02-24 06:00:00	4.95	17.84	0.36	7.03	12.27	0.00	0.01
EAS-US	2026-02-24 06:15:00	4.93	17.84	0.37	7.05	12.27	0.00	0.01
EAS-US	2026-02-24 06:30:00	4.92	17.86	0.37	7.07	12.27	0.00	0.01
EAS-US	2026-02-24 06:45:00	4.90	17.57	0.36	7.03	12.28	0.15	0.01
EAS-US	2026-02-24 07:00:00	4.87	17.53	0.39	7.02	12.27	0.00	0.01
EAS-US	2026-02-24 07:15:00	4.86	17.49	0.39	7.05	12.29	0.00	0.01
EAS-US	2026-02-24 07:30:00	4.87	17.45	0.40	7.04	12.29	0.00	0.01
EAS-US	2026-02-24 07:45:00	4.87	17.71	0.33	7.06	12.30	0.00	0.01
EAS-US	2026-02-24 08:00:00	4.87	17.77	0.36	7.06	12.31	0.00	0.01
EAS-US	2026-02-24 08:15:00	4.88	17.89	0.36	7.04	12.33	0.00	0.01
EAS-US	2026-02-24 08:30:00	4.92	17.59	0.37	7.04	12.33	0.00	0.01
EAS-US	2026-02-24 08:45:00	4.98	17.41	0.36	7.06	12.33	0.00	0.01
EAS-US	2026-02-24 09:00:00	5.06	17.40	0.38	7.06	12.30	0.00	0.01
EAS-US	2026-02-24 09:15:00	5.10	17.35	0.39	7.06	12.28	0.00	0.01
EAS-US	2026-02-24 09:30:00	5.12	17.41	0.39	7.03	12.29	0.00	0.01
EAS-US	2026-02-24 09:45:00	5.17	17.46	0.32	7.07	12.26	0.00	0.01
EAS-US	2026-02-24 10:00:00	5.23	17.49	0.35	7.02	12.26	0.00	0.01
EAS-US	2026-02-24 10:15:00	5.30	17.59	0.35	7.07	12.23	0.00	0.01
EAS-US	2026-02-24 10:30:00	5.35	17.43	0.36	7.04	12.20	0.00	0.01
EAS-US	2026-02-24 10:45:00	5.40	17.17	0.35	7.02	12.19	0.00	0.01
EAS-US	2026-02-24 11:00:00	5.47	17.14	0.38	7.05	12.17	0.00	0.01
EAS-US	2026-02-24 11:15:00	5.55	17.12	0.38	7.07	12.15	0.00	0.01
EAS-US	2026-02-24 11:30:00	5.62	17.09	0.39	7.06	12.11	6.10	0.01
EAS-US	2026-02-24 11:45:00	5.69	17.23	0.32	7.07	12.09	0.00	0.01
EAS-US	2026-02-24 12:00:00	5.77	17.27	0.35	7.06	12.06	0.00	0.01
EAS-US	2026-02-24 12:15:00	5.85	16.96	0.35	7.06	12.06	0.00	0.01
EAS-US	2026-02-24 12:30:00	5.91	17.12	0.36	7.03	12.02	0.00	0.01
EAS-US	2026-02-24 12:45:00	5.94	16.91	0.35	7.04	12.00	0.00	0.01
EAS-US	2026-02-24 13:00:00	5.97	16.84	0.37	7.06	11.99	0.00	0.01
EAS-US	2026-02-24 13:15:00	5.98	16.77	0.39	7.00	11.99	2.89	0.01
EAS-US	2026-02-24 13:30:00	5.97	16.74	0.38	7.06	11.97	0.00	0.01
EAS-US	2026-02-24 13:45:00	5.98	16.96	0.31	7.06	11.96	0.00	0.01
EAS-US	2026-02-24 14:00:00	5.99	17.03	0.34	7.04	11.95	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-24 14:15:00	5.99	17.01	0.35	7.02	11.94	0.00	0.01
EAS-US	2026-02-24 14:30:00	5.98	16.92	0.35	7.06	11.95	0.00	0.01
EAS-US	2026-02-24 14:45:00	5.98	16.83	0.35	6.99	11.94	1.95	0.01
EAS-US	2026-02-24 15:00:00	5.97	16.79	0.38	7.03	11.92	0.00	0.01
EAS-US	2026-02-24 15:15:00	5.97	16.78	0.38	7.02	11.94	0.00	0.01
EAS-US	2026-02-24 15:30:00	5.98	16.77	0.39	7.02	11.94	0.00	0.01
EAS-US	2026-02-24 15:45:00	5.97	16.34	0.31	7.01	11.93	0.00	0.01
EAS-US	2026-02-24 16:00:00	5.94	16.29	0.34	7.04	11.93	0.00	0.01
EAS-US	2026-02-24 16:15:00	5.89	16.35	0.35	7.06	11.95	0.00	0.01
EAS-US	2026-02-24 16:30:00	5.85	16.53	0.36	7.03	11.96	0.00	0.01
EAS-US	2026-02-24 16:45:00	5.82	16.85	0.35	7.03	11.97	0.00	0.01
EAS-US	2026-02-24 17:00:00	5.79	16.90	0.38	6.97	11.97	0.00	0.01
EAS-US	2026-02-24 17:15:00	5.77	16.84	0.39	6.95	11.97	0.00	0.01
EAS-US	2026-02-24 17:30:00	5.76	16.82	0.39	7.03	11.97	0.00	0.01
EAS-US	2026-02-24 17:45:00	5.73	16.40	0.32	6.96	11.96	0.00	0.01
EAS-US	2026-02-24 18:00:00	5.70	16.41	0.35	7.04	11.98	0.00	0.01
EAS-US	2026-02-24 18:15:00	5.68	16.42	0.35	7.03	12.00	0.00	0.01
EAS-US	2026-02-24 18:30:00	5.66	16.41	0.36	7.04	11.99	0.00	0.01
EAS-US	2026-02-24 18:45:00	5.63	16.82	0.35	6.99	11.99	0.00	0.01
EAS-US	2026-02-24 19:00:00	5.60	16.83	0.38	7.01	12.00	0.00	0.01
EAS-US	2026-02-24 19:15:00	5.57	16.89	0.39	6.99	12.01	0.00	0.01
EAS-US	2026-02-24 19:30:00	5.55	16.90	0.39	7.01	12.02	0.00	0.01
EAS-US	2026-02-24 19:45:00	5.52	16.70	0.32	7.02	12.04	0.00	0.01
EAS-US	2026-02-24 20:00:00	5.51	16.71	0.35	6.98	12.05	0.00	0.01
EAS-US	2026-02-24 20:15:00	5.49	16.72	0.36	7.03	12.05	0.00	0.01
EAS-US	2026-02-24 20:30:00	5.48	16.73	0.36	7.03	12.05	0.00	0.01
EAS-US	2026-02-24 20:45:00	5.46	16.90	0.35	7.02	12.06	0.00	0.01
EAS-US	2026-02-24 21:00:00	5.45	16.90	0.38	7.03	12.05	0.00	0.01
EAS-US	2026-02-24 21:15:00	5.43	16.94	0.39	7.01	12.07	0.00	0.01
EAS-US	2026-02-24 21:30:00	5.42	16.92	0.39	7.00	12.06	0.00	0.01
EAS-US	2026-02-24 21:45:00	5.41	16.74	0.32	7.03	12.06	0.00	0.01
EAS-US	2026-02-24 22:00:00	5.39	16.64	0.35	7.03	12.08	0.00	0.01
EAS-US	2026-02-24 22:15:00	5.36	16.71	0.36	7.05	12.08	0.00	0.01
EAS-US	2026-02-24 22:30:00	5.34	16.73	0.36	7.03	12.09	0.00	0.01
EAS-US	2026-02-24 22:45:00	5.33	16.86	0.36	6.99	12.12	0.00	0.01
EAS-US	2026-02-24 23:00:00	5.31	16.78	0.38	7.03	12.10	0.00	0.01
EAS-US	2026-02-24 23:15:00	5.29	16.78	0.39	7.00	12.11	0.00	0.01
EAS-US	2026-02-24 23:30:00	5.27	16.75	0.39	7.02	12.13	0.00	0.01
EAS-US	2026-02-24 23:45:00	5.25	17.69	0.32	7.03	12.12	0.00	0.01
EAS-US	2026-02-25 00:00:00	5.26	17.80	0.35	7.04	12.14	0.00	0.01
EAS-US	2026-02-25 00:15:00	5.26	17.93	0.36	7.04	12.14	0.00	0.01
EAS-US	2026-02-25 00:30:00	5.24	18.00	0.36	7.03	12.15	0.00	0.01
EAS-US	2026-02-25 00:45:00	5.23	17.68	0.35	7.02	12.14	0.00	0.01
EAS-US	2026-02-25 01:00:00	5.22	17.66	0.38	7.00	12.15	0.00	0.01
EAS-US	2026-02-25 01:15:00	5.21	17.54	0.39	7.02	12.15	0.00	0.01
EAS-US	2026-02-25 01:30:00	5.19	17.65	0.39	7.03	12.15	0.00	0.01
EAS-US	2026-02-25 01:45:00	5.17	17.74	0.32	7.02	12.15	0.00	0.01
EAS-US	2026-02-25 02:00:00	5.15	17.83	0.35	6.99	12.16	0.00	0.01
EAS-US	2026-02-25 02:15:00	5.13	17.75	0.36	7.03	12.18	0.00	0.01
EAS-US	2026-02-25 02:30:00	5.11	17.73	0.36	7.05	12.18	0.00	0.01
EAS-US	2026-02-25 02:45:00	5.09	17.48	0.35	7.01	12.18	0.00	0.01
EAS-US	2026-02-25 03:00:00	5.07	17.51	0.38	7.03	12.20	0.00	0.01
EAS-US	2026-02-25 03:15:00	5.08	17.46	0.39	6.97	12.18	0.00	0.01
EAS-US	2026-02-25 03:30:00	5.09	17.47	0.39	7.02	12.18	0.00	0.01
EAS-US	2026-02-25 03:45:00	5.11	17.24	0.31	7.01	12.19	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-25 04:00:00	5.11	17.30	0.35	7.02	12.18	0.00	0.01
EAS-US	2026-02-25 04:15:00	5.12	17.31	0.35	7.02	12.18	0.00	0.01
EAS-US	2026-02-25 04:30:00	5.13	17.27	0.36	7.02	12.19	0.00	0.01
EAS-US	2026-02-25 04:45:00	5.14	17.34	0.35	7.02	12.18	0.00	0.01
EAS-US	2026-02-25 05:00:00	5.14	17.35	0.38	7.02	12.18	0.00	0.01
EAS-US	2026-02-25 05:15:00	5.14	17.34	0.38	7.04	12.18	0.39	0.01
EAS-US	2026-02-25 05:30:00	5.14	17.24	0.39	6.97	12.18	0.00	0.01
EAS-US	2026-02-25 05:45:00	5.17	17.43	0.31	7.03	12.16	0.00	0.01
EAS-US	2026-02-25 06:00:00	5.20	17.43	0.34	7.03	12.17	0.00	0.01
EAS-US	2026-02-25 06:15:00	5.21	17.48	0.35	7.05	12.16	0.00	0.01
EAS-US	2026-02-25 06:30:00	5.22	17.57	0.35	7.03	12.16	0.00	0.01
EAS-US	2026-02-25 06:45:00	5.24	16.86	0.34	7.03	12.16	0.00	0.01
EAS-US	2026-02-25 07:00:00	5.26	16.82	0.37	7.04	12.14	0.00	0.01
EAS-US	2026-02-25 07:15:00	5.27	16.82	0.38	7.03	12.15	0.00	0.01
EAS-US	2026-02-25 07:30:00	5.28	16.94	0.39	7.00	12.15	0.00	0.01
EAS-US	2026-02-25 07:45:00	5.28	16.72	0.31	7.03	12.15	0.00	0.01
EAS-US	2026-02-25 08:00:00	5.29	16.76	0.34	7.05	12.16	0.00	0.01
EAS-US	2026-02-25 08:15:00	5.30	16.67	0.35	7.06	12.16	0.00	0.01
EAS-US	2026-02-25 08:30:00	5.33	16.78	0.35	7.04	12.17	0.00	0.01
EAS-US	2026-02-25 08:45:00	5.36	16.81	0.34	7.02	12.17	0.00	0.01
EAS-US	2026-02-25 09:00:00	5.39	16.91	0.37	7.05	12.16	0.00	0.01
EAS-US	2026-02-25 09:15:00	5.42	16.66	0.38	7.05	12.17	0.00	0.01
EAS-US	2026-02-25 09:30:00	5.44	16.86	0.38	6.99	12.15	0.00	0.01
EAS-US	2026-02-25 09:45:00	5.47	16.59	0.30	7.06	12.14	0.00	0.01
EAS-US	2026-02-25 10:00:00	5.50	16.67	0.33	7.07	12.15	0.00	0.01
EAS-US	2026-02-25 10:15:00	5.53	16.65	0.34	7.07	12.14	0.00	0.01
EAS-US	2026-02-25 10:30:00	5.57	16.55	0.34	7.08	12.14	0.00	0.01
EAS-US	2026-02-25 10:45:00	5.62	16.78	0.34	7.05	12.14	0.00	0.01
EAS-US	2026-02-25 11:00:00	5.67	16.70	0.37	7.09	12.14	0.00	0.01
EAS-US	2026-02-25 11:15:00	5.72	16.88	0.37	7.07	12.10	0.00	0.01
EAS-US	2026-02-25 11:30:00	5.75	16.74	0.37	7.06	12.10	0.00	0.01
EAS-US	2026-02-25 11:45:00	5.79	16.56	0.29	7.08	12.09	0.00	0.01
EAS-US	2026-02-25 12:00:00	5.80	16.59	0.33	7.06	12.08	0.00	0.01
EAS-US	2026-02-25 12:15:00	5.79	16.61	0.33	7.08	12.06	0.00	0.01
EAS-US	2026-02-25 12:30:00	5.79	16.55	0.34	7.08	12.06	0.00	0.01
EAS-US	2026-02-25 12:45:00	5.80	16.63	0.33	7.05	12.06	0.00	0.01
EAS-US	2026-02-25 13:00:00	5.82	16.63	0.36	7.06	12.05	0.00	0.01
EAS-US	2026-02-25 13:15:00	5.83	16.65	0.38	7.03	12.06	0.00	0.01
EAS-US	2026-02-25 13:30:00	5.84	16.59	0.37	7.07	12.06	0.00	0.01
EAS-US	2026-02-25 13:45:00	5.84	16.48	0.29	7.05	12.06	0.00	0.01
EAS-US	2026-02-25 14:00:00	5.84	16.46	0.33	7.08	12.04	0.00	0.01
EAS-US	2026-02-25 14:15:00	5.85	16.50	0.34	7.09	12.03	0.00	0.01
EAS-US	2026-02-25 14:30:00	5.84	16.53	0.34	7.10	12.03	0.00	0.01
EAS-US	2026-02-25 14:45:00	5.82	16.89	0.33	7.06	12.03	0.00	0.01
EAS-US	2026-02-25 15:00:00	5.82	16.86	0.36	7.08	12.03	0.00	0.01
EAS-US	2026-02-25 15:15:00	5.81	16.93	0.37	7.06	12.04	0.00	0.01
EAS-US	2026-02-25 15:30:00	5.80	17.01	0.37	7.13	12.02	0.00	0.01
EAS-US	2026-02-25 15:45:00	5.79	16.75	0.29	7.14	12.04	0.00	0.01
EAS-US	2026-02-25 16:00:00	5.77	16.93	0.33	7.11	12.05	0.00	0.01
EAS-US	2026-02-25 16:15:00	5.77	16.88	0.34	7.08	12.03	0.00	0.01
EAS-US	2026-02-25 16:30:00	5.76	16.86	0.34	7.07	12.03	0.00	0.01
EAS-US	2026-02-25 16:45:00	5.75	17.16	0.33	7.05	12.04	0.00	0.01
EAS-US	2026-02-25 17:00:00	5.75	17.19	0.36	7.08	12.03	0.00	0.01
EAS-US	2026-02-25 17:15:00	5.75	17.23	0.37	7.07	12.02	0.00	0.01
EAS-US	2026-02-25 17:30:00	5.75	17.16	0.37	7.11	12.02	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-25 17:45:00	5.74	16.76	0.29	7.07	12.03	0.00	0.01
EAS-US	2026-02-25 18:00:00	5.74	16.81	0.33	7.08	12.04	0.00	0.01
EAS-US	2026-02-25 18:15:00	5.74	16.79	0.34	7.07	12.04	0.00	0.01
EAS-US	2026-02-25 18:30:00	5.74	16.72	0.34	7.07	12.02	0.00	0.01
EAS-US	2026-02-25 18:45:00	5.74	16.96	0.33	7.05	12.04	0.00	0.01
EAS-US	2026-02-25 19:00:00	5.74	16.88	0.36	7.04	12.03	0.00	0.01
EAS-US	2026-02-25 19:15:00	5.74	16.94	0.37	7.03	12.02	0.00	0.01
EAS-US	2026-02-25 19:30:00	5.74	16.92	0.37	7.07	12.02	0.00	0.01
EAS-US	2026-02-25 19:45:00	5.74	16.67	0.29	7.06	12.01	0.00	0.01
EAS-US	2026-02-25 20:00:00	5.74	16.66	0.33	7.07	12.03	0.00	0.01
EAS-US	2026-02-25 20:15:00	5.75	16.67	0.34	7.05	12.03	0.00	0.01
EAS-US	2026-02-25 20:30:00	5.75	16.67	0.34	7.07	12.03	0.00	0.01
EAS-US	2026-02-25 20:45:00	5.75	16.99	0.33	7.05	12.02	0.00	0.01
EAS-US	2026-02-25 21:00:00	5.75	16.96	0.36	7.04	12.02	0.00	0.01
EAS-US	2026-02-25 21:15:00	5.75	17.06	0.37	7.06	12.03	0.00	0.01
EAS-US	2026-02-25 21:30:00	5.76	16.98	0.37	7.05	12.01	0.00	0.01
EAS-US	2026-02-25 21:45:00	5.76	16.75	0.29	7.04	12.03	0.00	0.01
EAS-US	2026-02-25 22:00:00	5.76	16.75	0.33	7.06	12.04	0.00	0.01
EAS-US	2026-02-25 22:15:00	5.77	16.79	0.34	7.07	12.03	0.00	0.01
EAS-US	2026-02-25 22:30:00	5.77	16.82	0.34	7.03	12.02	0.00	0.01
EAS-US	2026-02-25 22:45:00	5.77	17.02	0.33	7.05	12.02	0.00	0.01
EAS-US	2026-02-25 23:00:00	5.78	17.24	0.36	7.06	12.02	0.00	0.01
EAS-US	2026-02-25 23:15:00	5.79	17.25	0.37	7.07	12.01	0.00	0.01
EAS-US	2026-02-25 23:30:00	5.79	17.37	0.37	7.07	12.02	0.00	0.01
EAS-US	2026-02-25 23:45:00	5.79	17.29	0.29	7.07	12.01	0.00	0.01
EAS-US	2026-02-26 00:00:00	5.79	17.22	0.33	7.08	12.01	0.00	0.01
EAS-US	2026-02-26 00:15:00	5.79	17.15	0.33	7.07	12.01	0.00	0.01
EAS-US	2026-02-26 00:30:00	5.80	17.37	0.34	7.08	12.02	0.00	0.01
EAS-US	2026-02-26 00:45:00	5.80	17.49	0.33	7.06	12.01	0.00	0.01
EAS-US	2026-02-26 01:00:00	5.81	17.42	0.36	7.04	12.01	0.00	0.01
EAS-US	2026-02-26 01:15:00	5.82	17.43	0.37	7.08	12.00	0.00	0.01
EAS-US	2026-02-26 01:30:00	5.81	17.47	0.37	7.05	12.02	0.00	0.01
EAS-US	2026-02-26 01:45:00	5.82	17.11	0.28	7.05	11.99	0.00	0.01
EAS-US	2026-02-26 02:00:00	5.83	17.43	0.33	7.08	12.01	0.00	0.01
EAS-US	2026-02-26 02:15:00	5.84	17.58	0.33	7.08	11.99	0.00	0.01
EAS-US	2026-02-26 02:30:00	5.84	17.73	0.33	7.09	12.01	0.00	0.01
EAS-US	2026-02-26 02:45:00	5.84	18.17	0.32	7.08	12.00	0.00	0.01
EAS-US	2026-02-26 03:00:00	5.85	18.67	0.36	7.11	12.00	0.00	0.01
EAS-US	2026-02-26 03:15:00	5.85	19.00	0.37	7.11	11.99	0.00	0.01
EAS-US	2026-02-26 03:30:00	5.84	19.30	0.36	7.13	12.00	0.00	0.01
EAS-US	2026-02-26 03:45:00	5.83	19.06	0.28	7.13	12.01	0.00	0.01
EAS-US	2026-02-26 04:00:00	5.83	19.15	0.32	7.16	12.00	0.00	0.01
EAS-US	2026-02-26 04:15:00	5.84	19.00	0.33	7.15	12.01	0.00	0.01
EAS-US	2026-02-26 04:30:00	5.84	18.89	0.34	7.14	12.01	0.00	0.01
EAS-US	2026-02-26 04:45:00	5.84	19.18	0.33	7.08	12.01	0.00	0.01
EAS-US	2026-02-26 05:00:00	5.84	19.28	0.36	7.11	12.00	0.00	0.01
EAS-US	2026-02-26 05:15:00	5.84	19.46	0.36	7.14	12.00	0.00	0.01
EAS-US	2026-02-26 05:30:00	5.84	19.61	0.36	7.13	12.01	0.00	0.01
EAS-US	2026-02-26 05:45:00	5.84	19.71	0.29	7.15	11.99	0.00	0.01
EAS-US	2026-02-26 06:00:00	5.84	19.74	0.32	7.18	12.01	0.00	0.01
EAS-US	2026-02-26 06:15:00	5.84	19.82	0.33	7.18	12.01	0.00	0.01
EAS-US	2026-02-26 06:30:00	5.84	19.95	0.33	7.15	12.01	0.00	0.01
EAS-US	2026-02-26 06:45:00	5.85	20.42	0.32	7.16	12.01	0.00	0.01
EAS-US	2026-02-26 07:00:00	5.86	20.38	0.36	7.16	12.01	0.00	0.01
EAS-US	2026-02-26 07:15:00	5.86	20.52	0.36	7.17	12.00	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-26 07:30:00	5.87	20.45	0.36	7.17	12.00	0.00	0.01
EAS-US	2026-02-26 07:45:00	5.89	19.99	0.28	7.18	12.00	0.00	0.01
EAS-US	2026-02-26 08:00:00	5.90	19.93	0.32	7.19	12.02	0.00	0.01
EAS-US	2026-02-26 08:15:00	5.92	19.90	0.33	7.18	12.03	0.00	0.01
EAS-US	2026-02-26 08:30:00	5.95	19.78	0.33	7.19	12.03	0.00	0.01
EAS-US	2026-02-26 08:45:00	5.97	19.96	0.32	7.13	12.01	0.00	0.01
EAS-US	2026-02-26 09:00:00	6.00	19.94	0.36	7.18	12.01	0.00	0.01
EAS-US	2026-02-26 09:15:00	6.03	20.04	0.36	7.19	12.00	0.00	0.01
EAS-US	2026-02-26 09:30:00	6.06	20.08	0.36	7.20	11.99	0.00	0.01
EAS-US	2026-02-26 09:45:00	6.09	19.81	0.28	7.17	12.00	0.00	0.01
EAS-US	2026-02-26 10:00:00	6.14	19.84	0.31	7.22	12.00	0.00	0.01
EAS-US	2026-02-26 10:15:00	6.18	19.92	0.32	7.22	12.00	0.00	0.01
EAS-US	2026-02-26 10:30:00	6.22	20.07	0.32	7.22	11.99	0.00	0.01
EAS-US	2026-02-26 10:45:00	6.26	20.38	0.31	7.20	11.96	0.00	0.01
EAS-US	2026-02-26 11:00:00	6.28	20.69	0.36	7.18	11.95	0.00	0.01
EAS-US	2026-02-26 11:15:00	6.30	21.15	0.35	7.23	11.95	0.00	0.01
EAS-US	2026-02-26 11:30:00	6.32	23.04	0.36	7.25	11.94	0.00	0.01
EAS-US	2026-02-26 11:45:00	6.39	23.36	0.28	7.28	11.93	0.19	0.01
EAS-US	2026-02-26 12:00:00	6.45	24.76	0.31	7.32	11.93	0.96	0.01
EAS-US	2026-02-26 12:15:00	6.48	25.32	0.32	7.33	11.90	0.54	0.01
EAS-US	2026-02-26 12:30:00	6.49	25.23	0.32	7.32	11.89	0.41	0.01
EAS-US	2026-02-26 12:45:00	6.50	25.98	0.31	7.30	11.87	0.73	0.01
EAS-US	2026-02-26 13:00:00	6.48	26.54	0.35	7.29	11.87	0.88	0.01
EAS-US	2026-02-26 13:15:00	6.48	28.02	0.35	7.34	11.87	1.04	0.01
EAS-US	2026-02-26 13:30:00	6.51	29.45	0.36	7.38	11.87	1.25	0.01
EAS-US	2026-02-26 13:45:00	6.53	28.53	0.27	7.39	11.87	1.71	0.01
EAS-US	2026-02-26 14:00:00	6.54	29.48	0.31	7.42	11.87	1.49	0.01
EAS-US	2026-02-26 14:15:00	6.55	29.90	0.32	7.42	11.86	2.32	0.01
EAS-US	2026-02-26 14:30:00	6.54	29.92	0.32	7.43	11.87	1.22	0.01
EAS-US	2026-02-26 14:45:00	6.53	30.40	0.31	7.42	11.83	2.67	0.01
EAS-US	2026-02-26 15:00:00	6.52	30.76	0.34	7.44	11.84	1.01	0.01
EAS-US	2026-02-26 15:15:00	6.53	30.34	0.35	7.43	11.85	0.84	0.01
EAS-US	2026-02-26 15:30:00	6.51	30.45	0.35	7.44	11.85	1.17	0.01
EAS-US	2026-02-26 15:45:00	6.50	30.42	0.27	7.43	11.85	1.64	0.01
EAS-US	2026-02-26 16:00:00	6.49	29.93	0.31	7.40	11.85	0.90	0.01
EAS-US	2026-02-26 16:15:00	6.48	29.41	0.32	7.41	11.86	0.44	0.01
EAS-US	2026-02-26 16:30:00	6.45	29.01	0.32	7.42	11.86	0.60	0.01
EAS-US	2026-02-26 16:45:00	6.44	28.65	0.30	7.38	11.86	0.00	0.01
EAS-US	2026-02-26 17:00:00	6.42	28.56	0.34	7.38	11.86	0.78	0.01
EAS-US	2026-02-26 17:15:00	6.40	28.05	0.35	7.38	11.86	0.00	0.01
EAS-US	2026-02-26 17:30:00	6.38	27.68	0.35	7.38	11.84	0.00	0.01
EAS-US	2026-02-26 17:45:00	6.36	27.26	0.27	7.37	11.87	0.00	0.01
EAS-US	2026-02-26 18:00:00	6.34	26.97	0.31	7.37	11.87	0.00	0.01
EAS-US	2026-02-26 18:15:00	6.33	26.70	0.30	7.37	11.88	0.00	0.01
EAS-US	2026-02-26 18:30:00	6.31	26.76	0.30	7.35	11.89	0.00	0.01
EAS-US	2026-02-26 18:45:00	6.30	27.35	0.29	7.35	11.89	0.00	0.01
EAS-US	2026-02-26 19:00:00	6.29	27.77	0.33	7.37	11.90	0.00	0.01
EAS-US	2026-02-26 19:15:00	6.28	28.33	0.34	7.38	11.88	0.00	0.01
EAS-US	2026-02-26 19:30:00	6.27	29.44	0.34	7.38	11.89	0.00	0.01
EAS-US	2026-02-26 19:45:00	6.25	31.08	0.26	7.41	11.90	0.48	0.01
EAS-US	2026-02-26 20:00:00	6.24	32.59	0.30	7.41	11.92	2.11	0.01
EAS-US	2026-02-26 20:15:00	6.23	34.68	0.30	7.47	11.94	1.53	0.01
EAS-US	2026-02-26 20:30:00	6.22	36.17	0.30	7.49	11.92	2.04	0.02
EAS-US	2026-02-26 20:45:00	6.21	38.07	0.28	7.50	11.94	1.84	0.02
EAS-US	2026-02-26 21:00:00	6.20	38.83	0.33	7.49	11.92	1.16	0.02

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-26 21:15:00	6.18	39.62	0.33	7.55	11.94	1.62	0.02
EAS-US	2026-02-26 21:30:00	6.17	39.53	0.33	7.55	11.95	1.28	0.02
EAS-US	2026-02-26 21:45:00	6.16	38.61	0.25	7.54	11.94	0.52	0.02
EAS-US	2026-02-26 22:00:00	6.15	38.17	0.29	7.49	11.95	0.30	0.02
EAS-US	2026-02-26 22:15:00	6.14	36.94	0.29	7.54	11.96	0.23	0.02
EAS-US	2026-02-26 22:30:00	6.13	35.81	0.30	7.51	11.95	0.05	0.02
EAS-US	2026-02-26 22:45:00	6.13	35.26	0.28	7.49	11.97	0.56	0.02
EAS-US	2026-02-26 23:00:00	6.12	34.61	0.33	7.48	11.95	0.00	0.01
EAS-US	2026-02-26 23:15:00	6.11	33.65	0.34	7.45	11.97	0.90	0.01
EAS-US	2026-02-26 23:30:00	6.11	33.12	0.33	7.47	11.95	1.01	0.01
EAS-US	2026-02-26 23:45:00	6.10	32.07	0.25	7.46	11.96	0.16	0.01
EAS-US	2026-02-27 00:00:00	6.09	31.87	0.29	7.44	11.98	0.00	0.01
EAS-US	2026-02-27 00:15:00	6.09	32.78	0.29	7.48	11.98	0.00	0.01
EAS-US	2026-02-27 00:30:00	6.08	32.86	0.30	7.43	11.98	0.00	0.01
EAS-US	2026-02-27 00:45:00	6.07	34.20	0.28	7.45	11.98	0.33	0.01
EAS-US	2026-02-27 01:00:00	6.06	34.80	0.33	7.46	11.98	0.02	0.01
EAS-US	2026-02-27 01:15:00	6.06	35.21	0.33	7.47	11.98	2.03	0.02
EAS-US	2026-02-27 01:30:00	6.05	35.51	0.33	7.48	11.99	2.21	0.02
EAS-US	2026-02-27 01:45:00	6.04	34.86	0.25	7.49	11.98	1.85	0.01
EAS-US	2026-02-27 02:00:00	6.04	34.99	0.29	7.49	11.99	1.40	0.01
EAS-US	2026-02-27 02:15:00	6.03	35.19	0.29	7.49	11.99	1.63	0.02
EAS-US	2026-02-27 02:30:00	6.02	35.19	0.29	7.50	11.99	1.51	0.02
EAS-US	2026-02-27 02:45:00	6.02	34.88	0.28	7.48	12.00	1.80	0.01
EAS-US	2026-02-27 03:00:00	6.01	34.24	0.33	7.48	12.00	0.69	0.01
EAS-US	2026-02-27 03:15:00	6.00	33.91	0.33	7.48	12.01	0.53	0.01
EAS-US	2026-02-27 03:30:00	6.00	33.84	0.33	7.47	12.01	1.18	0.01
EAS-US	2026-02-27 03:45:00	5.99	34.16	0.25	7.49	11.99	0.58	0.01
EAS-US	2026-02-27 04:00:00	5.99	34.52	0.29	7.49	12.01	0.81	0.01
EAS-US	2026-02-27 04:15:00	5.98	35.18	0.29	7.50	12.03	0.62	0.02
EAS-US	2026-02-27 04:30:00	5.98	35.95	0.29	7.51	12.03	1.18	0.02
EAS-US	2026-02-27 04:45:00	5.97	36.92	0.28	7.48	12.02	1.60	0.02
EAS-US	2026-02-27 05:00:00	5.96	37.20	0.33	7.52	12.02	1.56	0.02
EAS-US	2026-02-27 05:15:00	5.96	37.61	0.33	7.52	12.00	1.10	0.02
EAS-US	2026-02-27 05:30:00	5.95	37.72	0.33	7.49	12.02	0.92	0.02
EAS-US	2026-02-27 05:45:00	5.95	36.91	0.25	7.53	12.01	0.36	0.02
EAS-US	2026-02-27 06:00:00	5.95	36.31	0.29	7.51	12.03	0.80	0.02
EAS-US	2026-02-27 06:15:00	5.95	35.81	0.29	7.52	12.02	0.14	0.02
EAS-US	2026-02-27 06:30:00	5.95	35.40	0.29	7.49	12.04	0.00	0.02
EAS-US	2026-02-27 06:45:00	5.94	36.19	0.28	7.47	12.03	0.00	0.02
EAS-US	2026-02-27 07:00:00		36.62	0.33	7.49	12.02	0.00	0.02
EAS-US	2026-02-27 07:15:00	5.94	36.60	0.33	7.51	12.02	0.44	0.02
EAS-US	2026-02-27 07:30:00	5.94	36.49	0.33	7.50	12.03	0.15	0.02
EAS-US	2026-02-27 07:45:00	5.94	35.98	0.25	7.51	12.06	0.97	0.02
EAS-US	2026-02-27 08:00:00	5.94	36.59	0.29	7.53	12.07	1.11	0.02
EAS-US	2026-02-27 08:15:00	5.96	37.07	0.29	7.53	12.07	1.63	0.02
EAS-US	2026-02-27 08:30:00	5.97	37.33	0.29	7.55	12.06	2.63	0.02
EAS-US	2026-02-27 08:45:00	5.99	37.69	0.27	7.53	12.06	1.59	0.02
EAS-US	2026-02-27 09:00:00	6.00	37.51	0.32	7.53	12.07	1.53	0.02
EAS-US	2026-02-27 09:15:00	6.03	37.33	0.33	7.54	12.04	1.06	0.02
EAS-US	2026-02-27 09:30:00	6.06	37.18	0.33	7.52	12.06	0.91	0.02
EAS-US	2026-02-27 09:45:00	6.11	36.27	0.25	7.55	12.05	0.46	0.02
EAS-US	2026-02-27 10:00:00	6.15	35.58	0.28	7.55	12.05	0.71	0.02
EAS-US	2026-02-27 10:15:00	6.17	34.61	0.29	7.56	12.04	0.72	0.01
EAS-US	2026-02-27 10:30:00	6.19	33.99	0.29	7.52	12.03	0.57	0.01
EAS-US	2026-02-27 10:45:00	6.27	34.29	0.27	7.50	12.03	0.10	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-27 11:00:00	6.34	34.25	0.32	7.53	12.01	2.02	0.01
EAS-US	2026-02-27 11:15:00	6.40	34.60	0.33	7.53	11.99	0.97	0.01
EAS-US	2026-02-27 11:30:00	6.49	34.32	0.32	7.52	11.96	0.25	0.01
EAS-US	2026-02-27 11:45:00	6.52	33.53	0.24	7.54	11.94	0.88	0.01
EAS-US	2026-02-27 12:00:00	6.56	33.06	0.28	7.52	11.94	0.51	0.01
EAS-US	2026-02-27 12:15:00	6.68	32.99	0.29	7.53	11.91	0.72	0.01
EAS-US	2026-02-27 12:30:00	6.71	32.90	0.29	7.53	11.90	0.33	0.01
EAS-US	2026-02-27 12:45:00	6.81	32.76	0.27	7.51	11.88	0.00	0.01
EAS-US	2026-02-27 13:00:00	6.80	32.18	0.32	7.50	11.86	0.00	0.01
EAS-US	2026-02-27 13:15:00	6.76	31.42	0.32	7.48	11.86	0.40	0.01
EAS-US	2026-02-27 13:30:00	6.76	30.84	0.33	7.46	11.87	3.06	0.01
EAS-US	2026-02-27 13:45:00	6.74	30.02	0.24	7.48	11.86	0.00	0.01
EAS-US	2026-02-27 14:00:00	6.72	29.39	0.28	7.47	11.85	0.00	0.01
EAS-US	2026-02-27 14:15:00	6.69	28.87	0.29	7.39	11.85	0.00	0.01
EAS-US	2026-02-27 14:30:00	6.67	28.39	0.29	7.44	11.87	0.00	0.01
EAS-US	2026-02-27 14:45:00	6.65	28.10	0.28	7.40	11.86	0.04	0.01
EAS-US	2026-02-27 15:00:00	6.63	27.60	0.32	7.39	11.86	0.00	0.01
EAS-US	2026-02-27 15:15:00	6.61	27.29	0.33	7.38	11.86	0.66	0.01
EAS-US	2026-02-27 15:30:00	6.60	26.99	0.33	7.36	11.86	0.00	0.01
EAS-US	2026-02-27 15:45:00	6.58	26.40	0.25	7.37	11.86	0.00	0.01
EAS-US	2026-02-27 16:00:00	6.56	26.20	0.29	7.37	11.87	0.00	0.01
EAS-US	2026-02-27 16:15:00	6.54	25.72	0.29	7.38	11.87	0.00	0.01
EAS-US	2026-02-27 16:30:00	6.51	25.47	0.29	7.38	11.87	0.00	0.01
EAS-US	2026-02-27 16:45:00	6.49	26.27	0.28	7.35	11.86	0.80	0.01
EAS-US	2026-02-27 17:00:00	6.47	25.86	0.33	7.34	11.89	0.00	0.01
EAS-US	2026-02-27 17:15:00	6.45	25.63	0.33	7.35	11.88	0.00	0.01
EAS-US	2026-02-27 17:30:00	6.42	25.42	0.33	7.31	11.87	0.00	0.01
EAS-US	2026-02-27 17:45:00	6.40	25.07	0.25	7.33	11.89	0.00	0.01
EAS-US	2026-02-27 18:00:00	6.38	24.82	0.29	7.34	11.88	0.00	0.01
EAS-US	2026-02-27 18:15:00	6.36	24.64	0.29	7.29	11.90	0.00	0.01
EAS-US	2026-02-27 18:30:00	6.34	24.33	0.29	7.30	11.90	0.00	0.01
EAS-US	2026-02-27 18:45:00	6.32	24.40	0.28	7.27	11.91	0.00	0.01
EAS-US	2026-02-27 19:00:00	6.30	24.32	0.33	7.28	11.91	0.00	0.01
EAS-US	2026-02-27 19:15:00	6.29	24.14	0.33	7.28	11.92	0.00	0.01
EAS-US	2026-02-27 19:30:00	6.27	24.03	0.33	7.28	11.91	0.00	0.01
EAS-US	2026-02-27 19:45:00	6.26	23.59	0.25	7.28	11.92	0.00	0.01
EAS-US	2026-02-27 20:00:00	6.25	23.51	0.29	7.29	11.93	0.00	0.01
EAS-US	2026-02-27 20:15:00	6.24	23.31	0.29	7.29	11.92	0.00	0.01
EAS-US	2026-02-27 20:30:00	6.24	23.25	0.30	7.25	11.94	0.00	0.01
EAS-US	2026-02-27 20:45:00	6.23	23.29	0.28	7.26	11.94	0.00	0.01
EAS-US	2026-02-27 21:00:00	6.22	23.22	0.33	7.25	11.92	0.00	0.01
EAS-US	2026-02-27 21:15:00	6.21	23.07	0.33	7.27	11.94	0.00	0.01
EAS-US	2026-02-27 21:30:00	6.21	22.99	0.33	7.28	11.94	0.00	0.01
EAS-US	2026-02-27 21:45:00	6.20	22.66	0.25	7.27	11.94	0.00	0.01
EAS-US	2026-02-27 22:00:00	6.18	22.53	0.29	7.23	11.94	0.00	0.01
EAS-US	2026-02-27 22:15:00	6.15	22.37	0.29	7.25	11.96	0.00	0.01
EAS-US	2026-02-27 22:30:00	6.12	22.42	0.29	7.26	11.97	0.00	0.01
EAS-US	2026-02-27 22:45:00	6.08	22.31	0.28	7.24	11.98	0.00	0.01
EAS-US	2026-02-27 23:00:00	6.04	22.32	0.33	7.20	11.99	0.00	0.01
EAS-US	2026-02-27 23:15:00	6.01	22.01	0.34	7.20	11.99	0.00	0.01
EAS-US	2026-02-27 23:30:00	5.98	21.82	0.33	7.23	12.01	0.00	0.01
EAS-US	2026-02-27 23:45:00	5.95	21.59	0.25	7.22	12.01	0.00	0.01
EAS-US	2026-02-28 00:00:00	5.92	21.43	0.29	7.22	12.03	0.00	0.01
EAS-US	2026-02-28 00:15:00	5.88	21.31	0.29	7.20	12.02	0.00	0.01
EAS-US	2026-02-28 00:30:00	5.86	21.18	0.30	7.22	12.04	0.00	0.01

Woodfibre LNG (East Creek)								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-02-28 00:45:00	5.83	21.25	0.29	7.20	12.06	0.00	0.01
EAS-US	2026-02-28 01:00:00	5.80	21.22	0.33	7.19	12.05	0.00	0.01
EAS-US	2026-02-28 01:15:00	5.77	21.09	0.34	7.19	12.06	0.00	0.01
EAS-US	2026-02-28 01:30:00	5.75	21.01	0.34	7.17	12.07	0.00	0.01
EAS-US	2026-02-28 01:45:00	5.71	20.70	0.25	7.18	12.08	0.00	0.01
EAS-US	2026-02-28 02:00:00	5.68	20.58	0.29	7.21	12.08	0.00	0.01
EAS-US	2026-02-28 02:15:00	5.64	20.46	0.30	7.20	12.10	0.00	0.01
EAS-US	2026-02-28 02:30:00	5.61	20.38	0.30	7.20	12.12	0.00	0.01
EAS-US	2026-02-28 02:45:00	5.57	20.78	0.29	7.15	12.11	0.00	0.01
EAS-US	2026-02-28 03:00:00	5.53	20.71	0.34	7.18	12.14	0.00	0.01
EAS-US	2026-02-28 03:15:00	5.50	20.68	0.34	7.19	12.14	0.00	0.01
EAS-US	2026-02-28 03:30:00	5.47	20.61	0.34	7.19	12.16	0.00	0.01
EAS-US	2026-02-28 03:45:00	5.46	20.03	0.25	7.17	12.15	0.00	0.01
EAS-US	2026-02-28 04:00:00	5.45	19.92	0.29	7.17	12.17	0.00	0.01
EAS-US	2026-02-28 04:15:00	5.43	19.76	0.30	7.16	12.16	0.00	0.01
EAS-US	2026-02-28 04:30:00	5.41	19.71	0.30	7.18	12.16	0.00	0.01
EAS-US	2026-02-28 04:45:00	5.40	20.01	0.29	7.15	12.18	0.00	0.01
EAS-US	2026-02-28 05:00:00	5.40	19.99	0.33	7.16	12.18	0.00	0.01
EAS-US	2026-02-28 05:15:00	5.40	19.91	0.34	7.13	12.18	0.00	0.01
EAS-US	2026-02-28 05:30:00	5.39	19.85	0.34	7.15	12.17	0.00	0.01
EAS-US	2026-02-28 05:45:00	5.37	19.60	0.25	7.16	12.16	0.00	0.01
EAS-US	2026-02-28 06:00:00	5.35	19.54	0.30	7.18	12.20	0.00	0.01
EAS-US	2026-02-28 06:15:00	5.32	19.49	0.30	7.16	12.19	0.00	0.01
EAS-US	2026-02-28 06:30:00	5.31	19.45	0.30	7.13	12.22	0.00	0.01
EAS-US	2026-02-28 06:45:00	5.30	19.67	0.29	7.14	12.20	0.00	0.01
EAS-US	2026-02-28 07:00:00	5.29	19.66	0.33	7.12	12.20	0.00	0.01
EAS-US	2026-02-28 07:15:00	5.29	19.67	0.34	7.16	12.22	0.00	0.01
EAS-US	2026-02-28 07:30:00	5.28	19.47	0.33	7.17	12.23	0.00	0.01
EAS-US	2026-02-28 07:45:00	5.25	19.17	0.25	7.16	12.24	0.00	0.01
EAS-US	2026-02-28 08:00:00	5.23	19.08	0.29	7.17	12.26	0.00	0.01
EAS-US	2026-02-28 08:15:00	5.26	19.03	0.30	7.19	12.27	0.00	0.01
EAS-US	2026-02-28 08:30:00	5.31	18.92	0.30	7.18	12.30	0.00	0.01
EAS-US	2026-02-28 08:45:00	5.38	19.32	0.28	7.17	12.28	0.00	0.01
EAS-US	2026-02-28 09:00:00	5.45	19.41	0.33	7.18	12.26	0.00	0.01
EAS-US	2026-02-28 09:15:00	5.51	19.34	0.33	7.18	12.27	0.00	0.01
EAS-US	2026-02-28 09:30:00	5.60	19.43	0.33	7.18	12.24	0.00	0.01
EAS-US	2026-02-28 09:45:00	5.68	19.08	0.25	7.18	12.20	0.00	0.01
EAS-US	2026-02-28 10:00:00	5.75	19.04	0.29	7.20	12.19	0.00	0.01
EAS-US	2026-02-28 10:15:00	5.82	18.96	0.29	7.20	12.18	0.00	0.01
EAS-US	2026-02-28 10:30:00	5.91	18.84	0.29	7.19	12.16	0.00	0.01
EAS-US	2026-02-28 10:45:00	5.99	18.89	0.28	7.16	12.13	0.00	0.01
EAS-US	2026-02-28 11:00:00	6.06	18.81	0.33	7.19	12.09	0.00	0.01
EAS-US	2026-02-28 11:15:00	6.14	18.66	0.33	7.16	12.07	0.00	0.01
EAS-US	2026-02-28 11:30:00	6.27	18.67	0.33	7.17	12.04	0.00	0.01
EAS-US	2026-02-28 11:45:00	6.36	18.31	0.24	7.18	11.98	0.00	0.01
EAS-US	2026-02-28 12:00:00	6.46	18.20	0.28	7.19	11.97	0.00	0.01
EAS-US	2026-02-28 12:15:00	6.58	18.08	0.29	7.20	11.94	0.00	0.01
EAS-US	2026-02-28 12:30:00	6.67	18.06	0.28	7.19	11.92	0.00	0.01
EAS-US	2026-02-28 12:45:00	6.75	18.12	0.28	7.15	11.86	0.00	0.01
EAS-US	2026-02-28 13:00:00	6.77	17.99	0.32	7.18	11.85	0.00	0.01
EAS-US	2026-02-28 13:15:00	6.76	18.01	0.32	7.16	11.85	0.00	0.01
EAS-US	2026-02-28 13:30:00	6.74	17.99	0.32	7.18	11.85	0.00	0.01
EAS-US	2026-02-28 13:45:00	6.74	17.65	0.24	7.16	11.84	0.00	0.01
EAS-US	2026-02-28 14:00:00	6.75	17.57	0.28	7.17	11.84	0.00	0.01
EAS-US	2026-02-28 14:15:00	6.73	17.56	0.29	7.17	11.84	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-02-28 14:30:00	6.72	17.47	0.29	7.14	11.84	0.00	0.01
EAS-US	2026-02-28 14:45:00	6.71	17.65	0.28	7.12	11.84	0.00	0.01
EAS-US	2026-02-28 15:00:00	6.72	17.71	0.32	7.14	11.83	0.00	0.01
EAS-US	2026-02-28 15:15:00	6.72	17.68	0.32	7.14	11.82	0.00	0.01
EAS-US	2026-02-28 15:30:00	6.71	17.69	0.32	7.15	11.80	0.00	0.01
EAS-US	2026-02-28 15:45:00	6.68	17.47	0.24	7.13	11.82	0.00	0.01
EAS-US	2026-02-28 16:00:00	6.65	17.48	0.28	7.14	11.83	0.00	0.01
EAS-US	2026-02-28 16:15:00	6.62	17.51	0.29	7.14	11.82	0.00	0.01
EAS-US	2026-02-28 16:30:00	6.58	17.50	0.29	7.13	11.82	0.00	0.01
EAS-US	2026-02-28 16:45:00	6.55	17.78	0.28	7.10	11.83	0.00	0.01
EAS-US	2026-02-28 17:00:00	6.53	17.85	0.33	7.12	11.81	0.00	0.01
EAS-US	2026-02-28 17:15:00	6.50	17.81	0.33	7.12	11.82	0.00	0.01
EAS-US	2026-02-28 17:30:00	6.46	17.66	0.33	7.12	11.81	0.00	0.01
EAS-US	2026-02-28 17:45:00	6.42	17.54	0.25	7.10	11.82	0.00	0.01
EAS-US	2026-02-28 18:00:00	6.38	17.57	0.28	7.12	11.84	0.00	0.01
EAS-US	2026-02-28 18:15:00	6.33	17.57	0.29	7.11	11.83	0.00	0.01
EAS-US	2026-02-28 18:30:00	6.28	17.68	0.29	7.10	11.86	0.00	0.01
EAS-US	2026-02-28 18:45:00	6.23	17.85	0.28	7.06	11.88	0.00	0.01
EAS-US	2026-02-28 19:00:00	6.19	18.08	0.33	7.10	11.88	0.00	0.01
EAS-US	2026-02-28 19:15:00	6.14	17.83	0.33	7.10	11.90	0.00	0.01
EAS-US	2026-02-28 19:30:00	6.10	17.82	0.33	7.10	11.91	0.00	0.01
EAS-US	2026-02-28 19:45:00	6.07	17.61	0.25	7.09	11.91	0.00	0.01
EAS-US	2026-02-28 20:00:00	6.03	17.66	0.29	7.11	11.93	0.00	0.01
EAS-US	2026-02-28 20:15:00	5.99	17.64	0.29	7.10	11.94	0.00	0.01
EAS-US	2026-02-28 20:30:00	5.95	17.62	0.29	7.11	11.97	0.00	0.01
EAS-US	2026-02-28 20:45:00	5.90	18.10	0.28	7.09	11.97	0.00	0.01
EAS-US	2026-02-28 21:00:00	5.85	18.11	0.33	7.11	11.97	0.00	0.01
EAS-US	2026-02-28 21:15:00	5.82	18.12	0.33	7.10	11.99	0.00	0.01
EAS-US	2026-02-28 21:30:00	5.78	18.22	0.33	7.11	12.01	0.00	0.01
EAS-US	2026-02-28 21:45:00	5.74	17.63	0.25	7.09	12.04	0.00	0.01
EAS-US	2026-02-28 22:00:00	5.70	17.60	0.29	7.09	12.04	0.00	0.01
EAS-US	2026-02-28 22:15:00	5.67	17.60	0.29	7.11	12.06	0.00	0.01
EAS-US	2026-02-28 22:30:00	5.64	17.57	0.29	7.11	12.07	0.00	0.01
EAS-US	2026-02-28 22:45:00	5.61	18.09	0.28	7.08	12.08	0.00	0.01
EAS-US	2026-02-28 23:00:00	5.56	18.08	0.33	7.09	12.08	0.00	0.01
EAS-US	2026-02-28 23:15:00	5.52	18.07	0.33	7.11	12.09	0.00	0.01
EAS-US	2026-02-28 23:30:00	5.49	17.99	0.33	7.10	12.12	0.00	0.01
EAS-US	2026-02-28 23:45:00	5.45	17.63	0.25	7.09	12.13	0.00	0.01
EAS-US	2026-03-01 00:00:00	5.41	17.62	0.29	7.11	12.13	0.00	0.01
EAS-US	2026-03-01 00:15:00	5.38	17.69	0.29	7.11	12.14	0.00	0.01
EAS-US	2026-03-01 00:30:00	5.35	17.67	0.29	7.11	12.16	0.00	0.01
EAS-US	2026-03-01 00:45:00	5.33	18.21	0.28	7.07	12.16	0.00	0.01
EAS-US	2026-03-01 01:00:00	5.31	18.23	0.33	7.10	12.16	0.31	0.01
EAS-US	2026-03-01 01:15:00	5.29	18.16	0.33	7.09	12.17	0.00	0.01
EAS-US	2026-03-01 01:30:00	5.25	18.24	0.33	7.08	12.17	0.00	0.01
EAS-US	2026-03-01 01:45:00	5.22	17.60	0.25	7.10	12.18	0.00	0.01
EAS-US	2026-03-01 02:00:00	5.18	17.59	0.29	7.11	12.20	0.00	0.01
EAS-US	2026-03-01 02:15:00	5.15	17.61	0.29	7.09	12.22	0.00	0.01
EAS-US	2026-03-01 02:30:00	5.12	17.69	0.29	7.11	12.22	0.00	0.01
EAS-US	2026-03-01 02:45:00	5.09	17.92	0.29	7.05	12.22	0.00	0.01
EAS-US	2026-03-01 03:00:00	5.06	17.91	0.33	7.10	12.22	0.00	0.01
EAS-US	2026-03-01 03:15:00	5.03	17.90	0.34	7.09	12.25	0.00	0.01
EAS-US	2026-03-01 03:30:00	5.01	17.82	0.34	7.10	12.25	0.00	0.01
EAS-US	2026-03-01 03:45:00	4.99	17.56	0.25	7.06	12.27	0.00	0.01
EAS-US	2026-03-01 04:00:00	4.98	17.60	0.29	7.11	12.28	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-03-01 04:15:00	4.97	17.54	0.29	7.10	12.26	0.00	0.01
EAS-US	2026-03-01 04:30:00	4.96	17.48	0.29	7.11	12.27	0.00	0.01
EAS-US	2026-03-01 04:45:00	4.94	17.70	0.28	7.07	12.27	0.00	0.01
EAS-US	2026-03-01 05:00:00	4.92	17.65	0.33	7.10	12.28	0.00	0.01
EAS-US	2026-03-01 05:15:00	4.89	17.66	0.33	7.08	12.29	0.00	0.01
EAS-US	2026-03-01 05:30:00	4.86	17.75	0.34	7.08	12.30	0.00	0.01
EAS-US	2026-03-01 05:45:00	4.85	17.52	0.25	7.08	12.30	0.00	0.01
EAS-US	2026-03-01 06:00:00	4.84	17.52	0.29	7.10	12.31	0.00	0.01
EAS-US	2026-03-01 06:15:00	4.84	17.47	0.29	7.10	12.31	0.00	0.01
EAS-US	2026-03-01 06:30:00	4.83	17.51	0.29	7.10	12.30	0.00	0.01
EAS-US	2026-03-01 06:45:00	4.81	17.67	0.29	7.07	12.32	0.00	0.01
EAS-US	2026-03-01 07:00:00	4.80	17.67	0.33	7.09	12.32	0.00	0.01
EAS-US	2026-03-01 07:15:00	4.78	17.61	0.33	7.10	12.34	0.00	0.01
EAS-US	2026-03-01 07:30:00	4.77	17.60	0.33	7.09	12.34	0.00	0.01
EAS-US	2026-03-01 07:45:00	4.77	17.31	0.25	7.09	12.36	0.00	0.01
EAS-US	2026-03-01 08:00:00	4.77	17.50	0.29	7.11	12.36	0.00	0.01
EAS-US	2026-03-01 08:15:00	4.82	17.31	0.29	7.11	12.41	0.00	0.01
EAS-US	2026-03-01 08:30:00	4.90	17.34	0.29	7.13	12.39	0.00	0.01
EAS-US	2026-03-01 08:45:00	4.99	17.41	0.28	7.09	12.37	0.00	0.01
EAS-US	2026-03-01 09:00:00	5.06	17.41	0.33	7.13	12.35	0.00	0.01
EAS-US	2026-03-01 09:15:00	5.13	17.50	0.33	7.12	12.34	0.00	0.01
EAS-US	2026-03-01 09:30:00	5.19	17.59	0.33	7.14	12.32	0.00	0.01
EAS-US	2026-03-01 09:45:00	5.29	18.04	0.25	7.09	12.30	0.00	0.01
EAS-US	2026-03-01 10:00:00	5.39	18.05	0.29	7.14	12.28	0.00	0.01
EAS-US	2026-03-01 10:15:00	5.50	18.21	0.29	7.13	12.24	0.00	0.01
EAS-US	2026-03-01 10:30:00	5.60	17.85	0.29	7.14	12.21	0.00	0.01
EAS-US	2026-03-01 10:45:00	5.70	18.69	0.25	7.04	12.18	0.00	0.01
EAS-US	2026-03-01 11:00:00	5.80	18.60	0.28	7.07	12.14	0.00	0.01
EAS-US	2026-03-01 11:15:00	5.90	18.54	0.29	7.07	12.11	0.00	0.01
EAS-US	2026-03-01 11:30:00	6.01	18.46	0.29	7.04	12.08	0.00	0.01
EAS-US	2026-03-01 11:45:00	6.13	18.15	0.24	7.14	12.03	0.00	0.01
EAS-US	2026-03-01 12:00:00	6.23	18.16	0.28	7.14	12.00	0.00	0.01
EAS-US	2026-03-01 12:15:00	6.34	18.15	0.28	7.14	11.96	0.00	0.01
EAS-US	2026-03-01 12:30:00	6.45	17.58	0.29	7.12	11.93	0.00	0.01
EAS-US	2026-03-01 12:45:00	6.55	18.26	0.26	7.00	11.89	0.00	0.01
EAS-US	2026-03-01 13:00:00	6.62	18.20	0.31	6.99	11.86	0.00	0.01
EAS-US	2026-03-01 13:15:00	6.65	18.17	0.31	6.95	11.84	0.00	0.01
EAS-US	2026-03-01 13:30:00	6.68	18.09	0.31	6.99	11.84	0.00	0.01
EAS-US	2026-03-01 13:45:00	6.71	18.05	0.27	7.01	11.81	0.00	0.01
EAS-US	2026-03-01 14:00:00	6.72	17.99	0.32	7.02	11.80	0.00	0.01
EAS-US	2026-03-01 14:15:00	6.70	17.96	0.32	7.06	11.78	0.00	0.01
EAS-US	2026-03-01 14:30:00	6.67	17.91	0.33	7.02	11.78	0.00	0.01
EAS-US	2026-03-01 14:45:00	6.64	17.88	0.28	6.93	11.79	0.00	0.01
EAS-US	2026-03-01 15:00:00	6.64	17.88	0.32	6.94	11.78	0.00	0.01
EAS-US	2026-03-01 15:15:00	6.64	17.84	0.32	6.92	11.78	0.00	0.01
EAS-US	2026-03-01 15:30:00	6.64	17.85	0.32	6.94	11.77	0.00	0.01
EAS-US	2026-03-01 15:45:00	6.63	17.83	0.28	6.97	11.76	0.00	0.01
EAS-US	2026-03-01 16:00:00	6.61	17.87	0.33	6.96	11.76	0.00	0.01
EAS-US	2026-03-01 16:15:00	6.57	17.85	0.33	7.00	11.76	0.00	0.01
EAS-US	2026-03-01 16:30:00	6.49	17.87	0.33	6.95	11.78	0.00	0.01
EAS-US	2026-03-01 16:45:00	6.45	17.89	0.29	6.88	11.80	0.00	0.01
EAS-US	2026-03-01 17:00:00	6.42	17.91	0.33	6.88	11.81	0.00	0.01
EAS-US	2026-03-01 17:15:00	6.40	17.94	0.33	6.88	11.81	0.00	0.01
EAS-US	2026-03-01 17:30:00	6.38	17.95	0.33	6.91	11.80	0.00	0.01
EAS-US	2026-03-01 17:45:00	6.36	17.97	0.28	6.92	11.80	0.00	0.01

Woodfibre LNG (East Creek)								
Station	**Date/Time**	**Temperature (C)**	**Specific Conductivity (µS/cm)**	**ORP (V)**	**pH (pH units)**	**Dissolved Oxygen (mg/L)**	**Turbidity (NTU)**	**Salinity (PSU)**
EAS-US	2026-03-01 18:00:00	6.34	18.00	0.33	6.97	11.81	0.00	0.01
EAS-US	2026-03-01 18:15:00	6.31	18.01	0.34	6.95	11.81	0.00	0.01
EAS-US	2026-03-01 18:30:00	6.29	18.05	0.34	6.93	11.81	0.00	0.01
EAS-US	2026-03-01 18:45:00	6.27	18.05	0.29	6.86	11.83	0.00	0.01
EAS-US	2026-03-01 19:00:00	6.25	18.07	0.33	6.90	11.85	0.00	0.01
EAS-US	2026-03-01 19:15:00	6.22	18.10	0.34	6.85	11.84	0.00	0.01
EAS-US	2026-03-01 19:30:00	6.20	18.11	0.34	6.90	11.85	0.00	0.01
EAS-US	2026-03-01 19:45:00	6.17	18.14	0.29	6.96	11.86	0.00	0.01
EAS-US	2026-03-01 20:00:00	6.15	18.17	0.34	6.95	11.86	0.00	0.01
EAS-US	2026-03-01 20:15:00	6.12	18.17	0.35	6.94	11.87	0.00	0.01
EAS-US	2026-03-01 20:30:00	6.08	18.18	0.35	6.98	11.87	0.00	0.01
EAS-US	2026-03-01 20:45:00	6.05	18.19	0.29	6.86	11.91	0.00	0.01
EAS-US	2026-03-01 21:00:00	6.02	18.20	0.34	6.85	11.90	0.00	0.01
EAS-US	2026-03-01 21:15:00	5.99	18.20	0.34	6.87	11.92	0.00	0.01
EAS-US	2026-03-01 21:30:00	5.97	18.21	0.34	6.87	11.94	0.00	0.01
EAS-US	2026-03-01 21:45:00	5.95	18.22	0.29	6.96	11.93	0.00	0.01
EAS-US	2026-03-01 22:00:00	5.92	18.24	0.34	6.97	11.94	0.00	0.01
EAS-US	2026-03-01 22:15:00	5.90	18.24	0.35	6.96	11.95	0.00	0.01
EAS-US	2026-03-01 22:30:00	5.87	18.24	0.35	6.95	11.95	0.00	0.01
EAS-US	2026-03-01 22:45:00	5.86	18.27	0.29	6.88	11.96	0.00	0.01
EAS-US	2026-03-01 23:00:00	5.84	18.28	0.34	6.87	11.95	0.00	0.01
EAS-US	2026-03-01 23:15:00	5.83	18.28	0.35	6.87	11.97	0.00	0.01
EAS-US	2026-03-01 23:30:00	5.83	18.26	0.35	6.92	11.97	0.00	0.01
EAS-US	2026-03-01 23:45:00	5.83	18.26	0.29	6.94	11.98	0.00	0.01

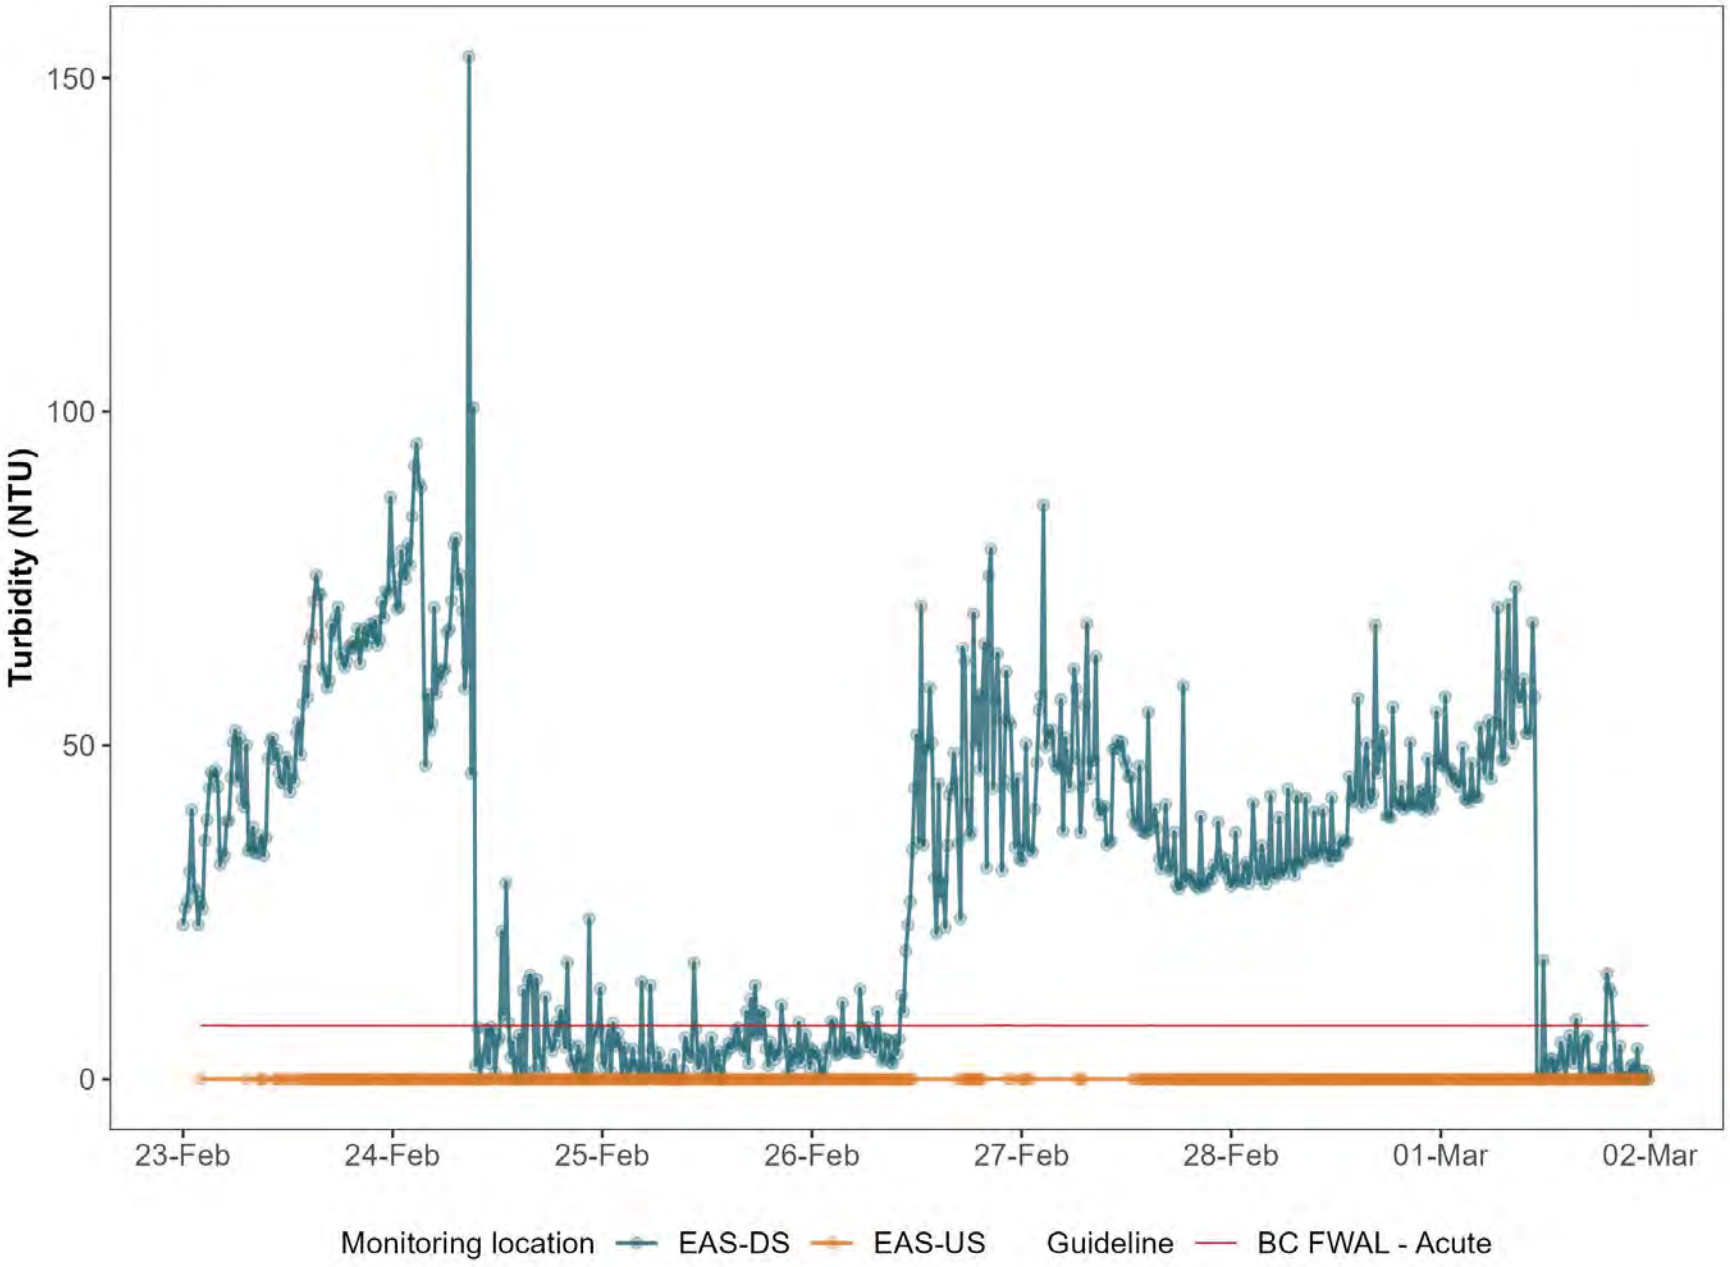
Turbidity (NTU)
150
100
50
0
23-Feb
24-Feb
25-Feb
26-Feb
27-Feb
28-Feb
01-Mar
02-Mar
Monitoring location
EAS-DS
EAS-US
Guideline
BC FWAL - Acute

Water Quality Field Data Sheet

Project: FORTIS11234

Location Information

Site ID:	WLNG (EAS) DS			**Date:**	February 24, 2026
Site Name:	East Creek			**Time:**	9:25
Site UTM:	Zone: 10U	E:	482092	**Crew:**	HM
(NAD83)		N:	5501875	**Weather:**	Clear/sun

In Situ Parameters

pH:	7.12		DO:	14.3	(mg/L)
Temp:	7.1	(°C)	Cond:	129	(us/cm)
Turbidity:	0.73	NTU	Salinity:	0.06	(ppt)
Visible Sheen:	N		ORP:	67.8	(mV)

Water Surface Condition: Clear

Photo Record

Observations

Brown sediment layer on rocks.

Water Quality Field Data Sheet

Project: FORTIS11234

Location Information

Site ID:	WLNG (EAS) US			**Date:**	February 24, 2026
Site Name:	East Creek			**Time:**	8:50
Site UTM:	Zone:10U	E:	481908	**Crew:**	HM
(NAD83)		N:	5501909	**Weather:**	Partly sunny

In Situ Parameters

pH:	7.61		DO:	15.1	(mg/L)
Temp.:	4.9	(°C)	Cond:	64.4	(us/cm)
Turbidity:	0.12	NTU	Salinity:	0.03	(ppt)
Visible Sheen:	N		ORP:	47.4	(mV)

Water Surface Condition: Clear

Photo Record

Observations

Some foam observed.

Appendix E:
Lab Documentation

Your P.O. #: 4800010213
Your Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your C.O.C. #: 124189

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
N. VANCOUVER
200-850 Harbourside Dr
North Vancouver, BC
Canada V7P 0A3

Report Date: 2026/03/04
Report #: R3763439
Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C609961
Received: 2026/02/24, 14:20

Sample Matrix: Water
Samples Received: 6

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Alkalinity @25C (pp, total), CO3,HCO3,OH	6	N/A	2026/02/26	BBY6SOP-00026	SM 24 2320 B m
Chloride/Sulphate by Auto Colourimetry	6	N/A	2026/02/25	BBY6SOP-00011 / BBY6SOP-00017	SM24-4500-Cl/SO4-E m
Chromium III (Calc'd)	6	N/A	2026/03/03		
Total Hexavalent Chromium	6	N/A	2026/03/03	BBY6SOP-00054	SM 24 3500-Cr B m
Carbon (DOC) -Lab Filtered (2)	6	N/A	2026/02/26	BBY6SOP-00053	SM 24 5310 B m
Fluoride	6	N/A	2026/02/25	BBY6SOP-00037	SM 24 4500-F C m
Glycols in Water by GC/FID (1)	2	N/A	2026/02/27	CAL SOP-00093	BCMOE Glycols 09/17
Sulphide (as H2S) (1)	5	N/A	2026/02/26		Auto Calc
Sulphide (as H2S) (1)	1	N/A	2026/02/27		Auto Calc
Un-ionized Hydrogen Sulphide as S Calc	3	N/A	2026/02/26	BBY WI-00033	Auto Calc
Un-ionized Hydrogen Sulphide as S Calc	1	N/A	2026/02/27	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO3) (3)	4	N/A	2026/03/02	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO3) (3)	2	N/A	2026/03/03	BBY WI-00033	Auto Calc
Hardness (calculated as CaCO3)	6	N/A	2026/02/27	BBY WI-00033	Auto Calc
Mercury (Dissolved) by CV-Lab Filtered	6	2026/02/27	2026/02/27	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Mercury (Total) by CV	6	2026/02/26	2026/02/26	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Bromide as Bromine (Br) by ICPMS	6	N/A	2026/03/03	BBY7SOP-00002	EPA 6020B R2 m
EPH in Water when PAH required	2	2026/02/26	2026/02/26	BBY8SOP-00029	BCMOE BCLM Sep2017 m
Na, K, Ca, Mg, S by CRC ICPMS (diss.)	6	N/A	2026/02/27	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (lab filter) (4)	6	N/A	2026/02/27	BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	2	2026/03/02	2026/03/02	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Na, K, Ca, Mg, S by CRC ICPMS (total)	4	N/A	2026/03/02	BBY WI-00033	Auto Calc
Na, K, Ca, Mg, S by CRC ICPMS (total)	2	N/A	2026/03/03	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (total)	4	N/A	2026/02/27	BBY7SOP-00002	EPA 6020b R2 m
Nitrogen (Total)	6	N/A	2026/02/26	BBY6SOP-00016	SM 24 4500-N C m
Ammonia-N (Total)	6	N/A	2026/02/25	AB SOP-00007	SM 24 4500 NH3 A G m
Nitrate + Nitrite (N)	6	N/A	2026/02/25	BBY6SOP-00010	SM 24 4500-NO3- H m
Nitrite (N) Regular Level Water	6	N/A	2026/02/25	BBY6SOP-00010	SM 24 4500-NO2- m
Nitrogen - Nitrate (as N)	4	N/A	2026/02/26	BBY WI-00033	Auto Calc

Your P.O. #: 4800010213
Your Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your C.O.C. #: 124189

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
N. VANCOUVER
200-850 Harbourside Dr
North Vancouver, BC
Canada V7P 0A3

Report Date: 2026/03/04
Report #: R3763439
Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C609961
Received: 2026/02/24, 14:20

Sample Matrix: Water
Samples Received: 6

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Nitrogen - Nitrate (as N)	2	N/A	2026/02/27	BBY WI-00033	Auto Calc
PAH in Water by GC/MS (SIM)	2	2026/02/26	2026/02/26	BBY8SOP-00021	BCMOE BCLM Jul2017m
Total LMW, HMW, Total PAH Calc (5)	2	N/A	2026/02/27	BBY WI-00033	Auto Calc
pH @25°C (6)	6	N/A	2026/02/26	BBY6SOP-00026	SM 24 4500-H+ B m
Phenols (4-AAP) (1)	2	N/A	2026/03/02	AB SOP-00088	EPA 9066 R0 m
Rainbow Trout LC50 Multi-concentration	1	N/A	2026/02/25	BBY2SOP-00004	EPS1/RM/13(2nd)&RM/9
Total Sulphide (1)	5	2026/02/26	2026/02/26	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Sulphide (1)	1	2026/02/26	2026/02/27	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Dissolved Solids (Filt. Residue)	6	2026/02/26	2026/02/27	BBY6SOP-00033	SM 24 2540 C m
EPH less PAH in Water by GC/FID (7)	2	N/A	2026/02/27	BBY WI-00033	Auto Calc
Carbon (Total Organic) (8)	5	N/A	2026/02/26	BBY6SOP-00053	SM 24 5310 B m
Carbon (Total Organic) (8)	1	N/A	2026/02/27	BBY6SOP-00053	SM 24 5310 B m
Total Phosphorus Low Level Total	6	2026/02/26	2026/02/27	BBY6SOP-00013	SM 24 4500-P E m
Total Suspended Solids (NFR)	6	2026/02/25	2026/02/26	BBY6SOP-00034	SM 24 2540 D m
Field pH	4	N/A	2026/02/25	Field Test	Field Test
Field Temperature	4	N/A	2026/02/25	Field Test	Field Test
VOCs, VH, F1, LH in Water by HS GC/MS	2	N/A	2026/02/27	BBY8SOP-00009 / BBY8SOP-00011 / BBY8SOP-00012	BCMOE BCLM Jul2017 m
Volatile HC-BTEX (9)	2	N/A	2026/03/01	BBY WI-00033	Auto Calc

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, EPA, APHA or the Quebec Ministry of Environment.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report.

Your P.O. #: 4800010213
Your Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your C.O.C. #: 124189

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
N. VANCOUVER
200-850 Harbourside Dr
North Vancouver, BC
Canada V7P 0A3

Report Date: 2026/03/04
Report #: R3763439
Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C609961

Received: 2026/02/24, 14:20

Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.
Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.
This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) This test was performed by Bureau Veritas Calgary, 4000 - 19 St. , Calgary, AB, T2E 6P8
(2) DOC present in the sample should be considered as non-purgeable DOC. Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
(3) "Total Hardness" was calculated from Total Ca and Mg concentrations and may be biased high (Hardness, or Dissolved Hardness, calculated from Dissolved Ca and Mg, should be used for compliance if available).
(4) Samples were filtered and preserved at the lab. Values may not reflect concentrations at the time of sampling.
For Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
(5) Total PAHs in Water include: Quinoline, Naphthalene, 1-Methylnaphthalene, 2-Methylnaphthalene, Acenaphthylene, Acenaphthene, Fluorene, Phenanthrene, Anthracene, Acridine, Fluoranthene, Pyrene, Benzo(a)anthracene, Chrysene, Benzo(b&j)fluoranthene, Benzo(k)fluoranthene, Benzo(a)pyrene, Indeno(1,2,3-cd)pyrene, Dibenz(a,h)anthracene, and Benzo(g,h,i)perylene.
(6) The CCME method requires pH to be analysed within 15 minutes of sampling and therefore field analysis is required for compliance. All Laboratory pH analyses in this report are reported past the CCME holding time. Bureau Veritas endeavours to analyze samples as soon as possible after receipt.
(7) LEPH = EPH (C10 to C19) - (Acenaphthene + Acridine + Anthracene + Fluorene + Naphthalene + Phenanthrene)
HEPH = EPH (C19 to C32) - (Benzo(a)anthracene + Benzo(a)pyrene + Fluoranthene + Pyrene)
(8) TOC present in the sample should be considered as non-purgeable TOC.
(9) VPH = VH - (Benzene + Toluene + Ethylbenzene + m & p-Xylene + o-Xylene + Styrene)

Encryption Key

Please direct all questions regarding this Certificate of Analysis to:
Levi Manchak, Project Manager SR
Email: Levi.MANCHAK@bureauveritas.com
Phone# (780)862-5634

==========

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE788			EBE788			EBE789		
Sampling Date		2026/02/24 09:25			2026/02/24 09:25			2026/02/24 10:00		
COC Number		124189			124189			124189		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L	0.0053	0.0050	C234162				0.0314	0.0050	C234162
Calculated Parameters										
Total Chromium III	mg/L	0.0021	0.00099	C233728				0.0042	0.00099	C233728
Dissolved Hardness (CaCO3)	mg/L	50.1	0.50	C232788				106	0.50	C232788
Total Hardness (CaCO3)	mg/L	47.5	0.50	C232544				103	0.50	C232544
Nitrate (N)	mg/L	ND	0.020	C233556				0.075	0.020	C233556
Sulphide (as H2S)	mg/L	ND	0.0020	C233198				ND	0.0020	C233198
Field Parameters										
Field pH	pH	7.12	N/A	ONSITE				7.0	N/A	ONSITE
Field Temperature	°C	7.1	N/A	ONSITE				10.2	N/A	ONSITE
Misc. Inorganics										
pH	pH	6.95	N/A	C234214				7.24	N/A	C234214
Total Organic Carbon (C)	mg/L	7.9	0.50	C234649	8.2	0.50	C234649	24	0.50	C234649
Total Dissolved Solids	mg/L	76	10	C234492				190	10	C234492
Total Suspended Solids	mg/L	2.4	1.0	C233769				7.2	1.0	C233769
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L	6.8	0.50	C234440				22	0.50	C234440
Anions										
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C234211				ND	1.0	C234211
Alkalinity (Total as CaCO3)	mg/L	35	1.0	C234211				62	1.0	C234211
Bicarbonate (HCO3)	mg/L	42	1.0	C234211				76	1.0	C234211
Carbonate (CO3)	mg/L	ND	1.0	C234211				ND	1.0	C234211
Fluoride (F)	mg/L	0.18	0.050	C234107				0.35	0.050	C234107
Hydroxide (OH)	mg/L	ND	1.0	C234211				ND	1.0	C234211
Total Sulphide	mg/L	ND	0.0018	C234533				ND	0.0018	C234533
Chloride (Cl)	mg/L	8.5	1.0	C233926				18	1.0	C233926
Sulphate (SO4)	mg/L	8.7	1.0	C233926				17	1.0	C233926

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
N/A = Not Applicable

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE788			EBE788			EBE789		
Sampling Date		2026/02/24 09:25			2026/02/24 09:25			2026/02/24 10:00		
COC Number		124189			124189			124189		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C237929	ND	0.00099	C237929	ND	0.00099	C237929
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C233770				ND	0.015	C233770
Total Phosphorus (P)	mg/L	0.012	0.0010	C235060	0.010	0.0010	C235060	0.0035	0.0010	C235060
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C234160				0.107	0.020	C234160
Total Nitrogen (N)	mg/L	0.159	0.020	C233833	0.161	0.020	C233833	0.306	0.020	C233833
Misc. Organics										
Phenols	mg/L							ND	0.0015	C237067
Rainbow Trout										
LC50	% vol/vol							ATTACHED	N/A	C234549

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
N/A = Not Applicable

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE789			EBE790			EBE791		
Sampling Date		2026/02/24 10:00			2026/02/24 08:50			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L				ND	0.0050	C234162	ND	0.0050	C234162
Calculated Parameters										
Total Chromium III	mg/L				ND	0.00099	C233728	ND	0.00099	C233728
Dissolved Hardness (CaCO3)	mg/L				5.91	0.50	C232788	ND	0.50	C232788
Total Hardness (CaCO3)	mg/L				5.65	0.50	C232544	ND	0.50	C232544
Nitrate (N)	mg/L				0.022	0.020	C233556	ND	0.020	C233556
Sulphide (as H2S)	mg/L				ND	0.0020	C233198	ND	0.0020	C233198
Field Parameters										
Field pH	pH				7.61	N/A	ONSITE			
Field Temperature	°C				4.9	N/A	ONSITE			
Misc. Inorganics										
pH	pH				6.35	N/A	C234214	5.81	N/A	C234214
Total Organic Carbon (C)	mg/L				ND	0.50	C234649	ND	0.50	C234649
Total Dissolved Solids	mg/L				16	10	C234492	ND	10	C234492
Total Suspended Solids	mg/L	8.4	1.0	C233769	ND	1.0	C233769	ND	1.0	C233769
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L				2.4	0.50	C234440	ND	0.50	C234440
Anions										
Alkalinity (PP as CaCO3)	mg/L				ND	1.0	C234211	ND	1.0	C234211
Alkalinity (Total as CaCO3)	mg/L				5.2	1.0	C234211	ND	1.0	C234211
Bicarbonate (HCO3)	mg/L				6.3	1.0	C234211	ND	1.0	C234211
Carbonate (CO3)	mg/L				ND	1.0	C234211	ND	1.0	C234211
Fluoride (F)	mg/L				ND	0.050	C234107	ND	0.050	C234107
Hydroxide (OH)	mg/L				ND	1.0	C234211	ND	1.0	C234211
Total Sulphide	mg/L				ND	0.0018	C234533	ND	0.0018	C234533
Chloride (Cl)	mg/L				ND	1.0	C233926	ND	1.0	C233926
Sulphate (SO4)	mg/L				ND	1.0	C233926	ND	1.0	C233926

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
N/A = Not Applicable

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE789			EBE790			EBE791		
Sampling Date		2026/02/24 10:00			2026/02/24 08:50			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	WLNG -EOP Lab-Dup	RDL	QC Batch	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L				ND	0.00099	C237929	ND	0.00099	C237929
Nutrients										
Total Ammonia (N)	mg/L				ND	0.015	C233770	ND	0.015	C233770
Total Phosphorus (P)	mg/L				0.039	0.0010	C235060	ND	0.0010	C235060
Nitrate plus Nitrite (N)	mg/L				0.022	0.020	C234160	ND	0.020	C234160
Total Nitrogen (N)	mg/L				0.097	0.020	C233833	ND	0.020	C233833
Misc. Organics										
Phenols	mg/L	ND	0.0015	C237067						

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE791			EBE792			EBE792		
Sampling Date		2026/02/24			2026/02/24			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch	Trip Blank Lab-Dup	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L				ND	0.0050	C234168			
Calculated Parameters										
Total Chromium III	mg/L				ND	0.00099	C233728			
Dissolved Hardness (CaCO3)	mg/L				ND	0.50	C232788			
Total Hardness (CaCO3)	mg/L				ND	0.50	C232544			
Nitrate (N)	mg/L				ND	0.020	C233556			
Sulphide (as H2S)	mg/L				ND	0.0020	C233198			
Misc. Inorganics										
pH	pH				5.69	N/A	C234214			
Total Organic Carbon (C)	mg/L				ND	0.50	C234649			
Total Dissolved Solids	mg/L	ND	10	C234492	ND	10	C234492			
Total Suspended Solids	mg/L				ND	1.0	C233769			
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L				ND	0.50	C234440	ND	0.50	C234440
Anions										
Alkalinity (PP as CaCO3)	mg/L				ND	1.0	C234211			
Alkalinity (Total as CaCO3)	mg/L				ND	1.0	C234211			
Bicarbonate (HCO3)	mg/L				ND	1.0	C234211			
Carbonate (CO3)	mg/L				ND	1.0	C234211			
Fluoride (F)	mg/L				ND	0.050	C234107			
Hydroxide (OH)	mg/L				ND	1.0	C234211			
Total Sulphide	mg/L				ND	0.0018	C234533			
Chloride (Cl)	mg/L				ND	1.0	C234191			
Sulphate (SO4)	mg/L				ND	1.0	C234191			
Metals										
Total Hex. Chromium (Cr 6+)	mg/L				ND	0.00099	C237929			

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
N/A = Not Applicable

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE791			EBE792			EBE792		
Sampling Date		2026/02/24			2026/02/24			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch	Trip Blank Lab-Dup	RDL	QC Batch
Nutrients										
Total Ammonia (N)	mg/L				ND	0.015	C233770			
Total Phosphorus (P)	mg/L				ND	0.0010	C235060			
Nitrate plus Nitrite (N)	mg/L				ND	0.020	C234166			
Total Nitrogen (N)	mg/L				ND	0.020	C233833			

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE793		
Sampling Date		2026/02/24 10:00		
COC Number		124189		
	UNITS	DUP	RDL	QC Batch
ANIONS				
Nitrite (N)	mg/L	0.0324	0.0050	C234168
Calculated Parameters				
Total Chromium III	mg/L	0.0038	0.00099	C233728
Dissolved Hardness (CaCO3)	mg/L	100	0.50	C232788
Total Hardness (CaCO3)	mg/L	95.1	0.50	C232544
Nitrate (N)	mg/L	0.084	0.020	C233556
Sulphide (as H2S)	mg/L	ND	0.0020	C233198
Field Parameters				
Field pH	pH	7.0	N/A	ONSITE
Field Temperature	°C	10.2	N/A	ONSITE
Misc. Inorganics				
pH	pH	7.11	N/A	C234214
Total Organic Carbon (C)	mg/L	24	0.50	C234649
Total Dissolved Solids	mg/L	160	10	C234492
Total Suspended Solids	mg/L	14	1.0	C233769
Lab Filtered Inorganics				
Dissolved Organic Carbon (C)	mg/L	22	0.50	C234440
Anions				
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C234211
Alkalinity (Total as CaCO3)	mg/L	60	1.0	C234211
Bicarbonate (HCO3)	mg/L	74	1.0	C234211
Carbonate (CO3)	mg/L	ND	1.0	C234211
Fluoride (F)	mg/L	0.34	0.050	C234107
Hydroxide (OH)	mg/L	ND	1.0	C234211
Total Sulphide	mg/L	ND	0.0018	C234554
Chloride (Cl)	mg/L	17	1.0	C233926
Sulphate (SO4)	mg/L	16	1.0	C233926

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.
N/A = Not Applicable

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EBE793		
Sampling Date		2026/02/24 10:00		
COC Number		124189		
	UNITS	DUP	RDL	QC Batch
Metals				
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C237929
Nutrients				
Total Ammonia (N)	mg/L	0.020	0.015	C233770
Total Phosphorus (P)	mg/L	0.0050	0.0010	C235060
Nitrate plus Nitrite (N)	mg/L	0.117	0.020	C234166
Total Nitrogen (N)	mg/L	0.436	0.020	C233833
Misc. Organics				
Phenols	mg/L	ND	0.0015	C237067

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

GLYCOLS BY GC-FID (WATER)

Bureau Veritas ID		EBE789	EBE793		
Sampling Date		2026/02/24 10:00	2026/02/24 10:00		
COC Number		124189	124189		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Glycols					
Ethylene Glycol	mg/L	ND	ND	3.0	C235355
Diethylene Glycol	mg/L	ND	ND	5.0	C235355
Triethylene Glycol	mg/L	ND	ND	5.0	C235355
Propylene Glycol	mg/L	ND	ND	5.0	C235355
Surrogate Recovery (%)					
Methyl Sulfone (sur.)	%	95	96		C235355

RDL = Reportable Detection Limit

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Job #: C609961
Report Date: 2026/03/04

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

MERCURY BY COLD VAPOR (WATER)

Bureau Veritas ID		EBE788	EBE789	EBE790	EBE791	EBE792	EBE793		
Sampling Date		2026/02/24 09:25	2026/02/24 10:00	2026/02/24 08:50	2026/02/24	2026/02/24	2026/02/24 10:00		
COC Number		124189	124189	124189	124189	124189	124189		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	Field Blank	Trip Blank	DUP	RDL	QC Batch
Elements									
Total Mercury (Hg)	ug/L	0.0019	ND	0.0028	ND	ND	ND	0.0019	C234779
Lab Filtered Elements									
Dissolved Mercury (Hg)	ug/L	ND	ND	ND	ND	ND	ND	0.0019	C235925

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE788			EBE788			EBE789	EBE790		
Sampling Date		2026/02/24 09:25			2026/02/24 09:25			2026/02/24 10:00	2026/02/24 08:50		
COC Number		124189			124189			124189	124189		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	WLNG-US	RDL	QC Batch
ANIONS											
Bromide (Br)	mg/L	ND	0.010	C237487				ND	ND	0.010	C237487
Dissolved Metals by ICPMS											
Dissolved Calcium (Ca)	mg/L	18.7	0.050	C232791				40.0	1.92	0.050	C232791
Dissolved Magnesium (Mg)	mg/L	0.833	0.050	C232791				1.53	0.270	0.050	C232791
Dissolved Potassium (K)	mg/L	0.919	0.050	C232791				1.76	0.177	0.050	C232791
Dissolved Sodium (Na)	mg/L	4.05	0.050	C232791				7.57	1.12	0.050	C232791
Dissolved Sulphur (S)	mg/L	3.0	3.0	C232791				5.4	ND	3.0	C232791
Lab Filtered Metals											
Dissolved Aluminum (Al)	ug/L	923	0.50	C234637	886	0.50	C234637	2640	84.1	0.50	C234637
Dissolved Antimony (Sb)	ug/L	0.091	0.020	C234637	0.088	0.020	C234637	0.189	0.028	0.020	C234637
Dissolved Arsenic (As)	ug/L	0.715	0.020	C234637	0.688	0.020	C234637	1.49	0.150	0.020	C234637
Dissolved Barium (Ba)	ug/L	6.61	0.020	C234637	6.68	0.020	C234637	11.9	2.31	0.020	C234637
Dissolved Beryllium (Be)	ug/L	ND	0.010	C234637	ND	0.010	C234637	ND	ND	0.010	C234637
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	ND	0.0050	C234637
Dissolved Boron (B)	ug/L	ND	10	C234637	ND	10	C234637	13	ND	10	C234637
Dissolved Cadmium (Cd)	ug/L	0.0079	0.0050	C234637	0.0087	0.0050	C234637	0.0155	0.0069	0.0050	C234637
Dissolved Cesium (Cs)	ug/L	ND	0.050	C234637	0.053	0.050	C234637	0.110	ND	0.050	C234637
Dissolved Chromium (Cr)	ug/L	1.70	0.10	C234637	1.66	0.10	C234637	3.84	ND	0.10	C234637
Dissolved Cobalt (Co)	ug/L	0.0371	0.0050	C234637	0.0392	0.0050	C234637	0.0804	0.0251	0.0050	C234637
Dissolved Copper (Cu)	ug/L	0.539	0.050	C234637	0.536	0.050	C234637	0.793	0.881	0.050	C234637
Dissolved Iron (Fe)	ug/L	47.0	1.0	C234637	47.2	1.0	C234637	155	18.0	1.0	C234637
Dissolved Lead (Pb)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	0.0241	0.0104	0.0050	C234637
Dissolved Lithium (Li)	ug/L	1.83	0.50	C234637	1.77	0.50	C234637	3.67	ND	0.50	C234637
Dissolved Manganese (Mn)	ug/L	12.8	0.050	C234637	12.4	0.050	C234637	32.8	0.663	0.050	C234637
Dissolved Molybdenum (Mo)	ug/L	16.5	0.050	C234637	16.0	0.050	C234637	31.1	0.342	0.050	C234637
Dissolved Nickel (Ni)	ug/L	0.319	0.020	C234637	0.342	0.020	C234637	0.600	0.250	0.020	C234637
Dissolved Phosphorus (P)	ug/L	8.6	2.0	C234637	7.1	2.0	C234637	4.9	60.0	2.0	C234637
Dissolved Rubidium (Rb)	ug/L	2.21	0.050	C234637	2.18	0.050	C234637	4.35	0.233	0.050	C234637
Dissolved Selenium (Se)	ug/L	ND	0.040	C234637	ND	0.040	C234637	0.046	ND	0.040	C234637

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE788			EBE788			EBE789	EBE790		
Sampling Date		2026/02/24 09:25			2026/02/24 09:25			2026/02/24 10:00	2026/02/24 08:50		
COC Number		124189			124189			124189	124189		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	WLNG-US	RDL	QC Batch
Dissolved Silicon (Si)	ug/L	6010	50	C234637	5830	50	C234637	9570	3330	50	C234637
Dissolved Silver (Ag)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	ND	0.0050	C234637
Dissolved Strontium (Sr)	ug/L	36.2	0.050	C234637	35.5	0.050	C234637	69.8	8.02	0.050	C234637
Dissolved Tellurium (Te)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	ND	0.020	C234637
Dissolved Thallium (Tl)	ug/L	0.0026	0.0020	C234637	0.0038	0.0020	C234637	0.0055	ND	0.0020	C234637
Dissolved Thorium (Th)	ug/L	0.0080	0.0050	C234637	0.0081	0.0050	C234637	0.0093	0.0115	0.0050	C234637
Dissolved Tin (Sn)	ug/L	ND	0.20	C234637	ND	0.20	C234637	ND	ND	0.20	C234637
Dissolved Titanium (Ti)	ug/L	ND	0.50	C234637	ND	0.50	C234637	ND	ND	0.50	C234637
Dissolved Uranium (U)	ug/L	1.48	0.0020	C234637	1.46	0.0020	C234637	3.14	0.0971	0.0020	C234637
Dissolved Vanadium (V)	ug/L	0.87	0.20	C234637	0.83	0.20	C234637	1.71	ND	0.20	C234637
Dissolved Zinc (Zn)	ug/L	2.32	0.10	C234637	2.27	0.10	C234637	5.17	1.09	0.10	C234637
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C234637	ND	0.10	C234637	ND	ND	0.10	C234637
Total Metals by ICPMS											
Total Aluminum (Al)	ug/L	1010	3.0	C237038				2850	105	0.50	C234817
Total Antimony (Sb)	ug/L	0.090	0.020	C237038				0.184	0.037	0.020	C234817
Total Arsenic (As)	ug/L	0.731	0.020	C237038				1.47	0.164	0.020	C234817
Total Barium (Ba)	ug/L	7.15	0.050	C237038				12.1	2.51	0.020	C234817
Total Beryllium (Be)	ug/L	ND	0.010	C237038				ND	ND	0.010	C234817
Total Bismuth (Bi)	ug/L	ND	0.010	C237038				ND	ND	0.0050	C234817
Total Boron (B)	ug/L	ND	10	C237038				11	ND	10	C234817
Total Cadmium (Cd)	ug/L	0.0090	0.0050	C237038				0.0107	ND	0.0050	C234817
Total Cesium (Cs)	ug/L	0.060	0.050	C237038				0.118	ND	0.050	C234817
Total Chromium (Cr)	ug/L	2.09	0.10	C237038				4.15	ND	0.10	C234817
Total Cobalt (Co)	ug/L	0.084	0.010	C237038				0.103	0.0369	0.0050	C234817
Total Copper (Cu)	ug/L	0.83	0.10	C237038				1.32	0.904	0.050	C234817
Total Iron (Fe)	ug/L	110	5.0	C237038				306	42.4	1.0	C234817
Total Lead (Pb)	ug/L	0.032	0.020	C237038				0.0644	0.0237	0.0050	C234817
Total Lithium (Li)	ug/L	1.74	0.50	C237038				3.47	ND	0.50	C234817
Total Manganese (Mn)	ug/L	15.0	0.10	C237038				35.5	1.47	0.050	C234817
Total Molybdenum (Mo)	ug/L	16.5	0.050	C237038				30.3	0.312	0.050	C234817

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE788			EBE788			EBE789	EBE790		
Sampling Date		2026/02/24 09:25			2026/02/24 09:25			2026/02/24 10:00	2026/02/24 08:50		
COC Number		124189			124189			124189	124189		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	WLNG-US	RDL	QC Batch
Total Nickel (Ni)	ug/L	2.30	0.10	C237038				0.694	0.742	0.020	C234817
Total Phosphorus (P)	ug/L	18.0	5.0	C237038				5.2	54.1	2.0	C234817
Total Rubidium (Rb)	ug/L	2.22	0.050	C237038				4.17	0.197	0.050	C234817
Total Selenium (Se)	ug/L	ND	0.040	C237038				0.049	ND	0.040	C234817
Total Silicon (Si)	ug/L	5530	50	C237038				9670	3340	50	C234817
Total Silver (Ag)	ug/L	ND	0.010	C237038				ND	ND	0.0050	C234817
Total Strontium (Sr)	ug/L	38.1	0.050	C237038				71.1	8.13	0.050	C234817
Total Tellurium (Te)	ug/L	ND	0.020	C237038				ND	ND	0.020	C234817
Total Thallium (Tl)	ug/L	0.0044	0.0020	C237038				0.0053	ND	0.0020	C234817
Total Thorium (Th)	ug/L	ND	0.050	C237038				ND	ND	0.050	C234817
Total Tin (Sn)	ug/L	ND	0.20	C237038				ND	ND	0.20	C234817
Total Titanium (Ti)	ug/L	ND	2.0	C237038				3.96	1.14	0.50	C234817
Total Uranium (U)	ug/L	1.44	0.0050	C237038				3.13	0.108	0.0020	C234817
Total Vanadium (V)	ug/L	0.82	0.20	C237038				1.96	ND	0.20	C234817
Total Zinc (Zn)	ug/L	3.5	1.0	C237038				7.05	1.22	0.10	C234817
Total Zirconium (Zr)	ug/L	ND	0.10	C237038				0.11	ND	0.10	C234817
Total Calcium (Ca)	mg/L	17.7	0.25	C233054				39.1	1.85	0.050	C233054
Total Magnesium (Mg)	mg/L	0.82	0.25	C233054				1.39	0.251	0.050	C233054
Total Potassium (K)	mg/L	0.87	0.25	C233054				1.67	0.169	0.050	C233054
Total Sodium (Na)	mg/L	4.06	0.25	C233054				7.05	1.08	0.050	C233054
Total Sulphur (S)	mg/L	ND	3.0	C233054				5.5	ND	3.0	C233054

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE791			EBE791			EBE792		
Sampling Date		2026/02/24			2026/02/24			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch
ANIONS										
Bromide (Br)	mg/L	ND	0.010	C237487				ND	0.010	C237487
Dissolved Metals by ICPMS										
Dissolved Calcium (Ca)	mg/L	ND	0.050	C232791				ND	0.050	C232791
Dissolved Magnesium (Mg)	mg/L	ND	0.050	C232791				ND	0.050	C232791
Dissolved Potassium (K)	mg/L	ND	0.050	C232791				ND	0.050	C232791
Dissolved Sodium (Na)	mg/L	ND	0.050	C232791				ND	0.050	C232791
Dissolved Sulphur (S)	mg/L	ND	3.0	C232791				ND	3.0	C232791
Lab Filtered Metals										
Dissolved Aluminum (Al)	ug/L	ND	0.50	C234637	ND	0.50	C234637	ND	0.50	C234637
Dissolved Antimony (Sb)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	0.020	C234637
Dissolved Arsenic (As)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	0.020	C234637
Dissolved Barium (Ba)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	0.020	C234637
Dissolved Beryllium (Be)	ug/L	ND	0.010	C234637	ND	0.010	C234637	ND	0.010	C234637
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Boron (B)	ug/L	ND	10	C234637	ND	10	C234637	ND	10	C234637
Dissolved Cadmium (Cd)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Cesium (Cs)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Chromium (Cr)	ug/L	ND	0.10	C234637	ND	0.10	C234637	ND	0.10	C234637
Dissolved Cobalt (Co)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Copper (Cu)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Iron (Fe)	ug/L	ND	1.0	C234637	ND	1.0	C234637	ND	1.0	C234637
Dissolved Lead (Pb)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Lithium (Li)	ug/L	ND	0.50	C234637	ND	0.50	C234637	ND	0.50	C234637
Dissolved Manganese (Mn)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Molybdenum (Mo)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Nickel (Ni)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	0.020	C234637
Dissolved Phosphorus (P)	ug/L	4.0	2.0	C234637	4.1	2.0	C234637	ND	2.0	C234637
Dissolved Rubidium (Rb)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Selenium (Se)	ug/L	ND	0.040	C234637	ND	0.040	C234637	ND	0.040	C234637

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE791			EBE791			EBE792		
Sampling Date		2026/02/24			2026/02/24			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch
Dissolved Silicon (Si)	ug/L	ND	50	C234637	ND	50	C234637	ND	50	C234637
Dissolved Silver (Ag)	ug/L	ND	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Strontium (Sr)	ug/L	ND	0.050	C234637	ND	0.050	C234637	ND	0.050	C234637
Dissolved Tellurium (Te)	ug/L	ND	0.020	C234637	ND	0.020	C234637	ND	0.020	C234637
Dissolved Thallium (Tl)	ug/L	ND	0.0020	C234637	ND	0.0020	C234637	ND	0.0020	C234637
Dissolved Thorium (Th)	ug/L	0.0076	0.0050	C234637	ND	0.0050	C234637	ND	0.0050	C234637
Dissolved Tin (Sn)	ug/L	ND	0.20	C234637	ND	0.20	C234637	ND	0.20	C234637
Dissolved Titanium (Ti)	ug/L	ND	0.50	C234637	ND	0.50	C234637	ND	0.50	C234637
Dissolved Uranium (U)	ug/L	ND	0.0020	C234637	ND	0.0020	C234637	ND	0.0020	C234637
Dissolved Vanadium (V)	ug/L	ND	0.20	C234637	ND	0.20	C234637	ND	0.20	C234637
Dissolved Zinc (Zn)	ug/L	ND	0.10	C234637	ND	0.10	C234637	ND	0.10	C234637
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C234637	ND	0.10	C234637	ND	0.10	C234637
Total Metals by ICPMS										
Total Aluminum (Al)	ug/L	ND	0.50	C234817				ND	0.50	C234817
Total Antimony (Sb)	ug/L	ND	0.020	C234817				ND	0.020	C234817
Total Arsenic (As)	ug/L	ND	0.020	C234817				ND	0.020	C234817
Total Barium (Ba)	ug/L	ND	0.020	C234817				ND	0.020	C234817
Total Beryllium (Be)	ug/L	ND	0.010	C234817				ND	0.010	C234817
Total Bismuth (Bi)	ug/L	ND	0.0050	C234817				ND	0.0050	C234817
Total Boron (B)	ug/L	ND	10	C234817				ND	10	C234817
Total Cadmium (Cd)	ug/L	ND	0.0050	C234817				ND	0.0050	C234817
Total Cesium (Cs)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Chromium (Cr)	ug/L	ND	0.10	C234817				ND	0.10	C234817
Total Cobalt (Co)	ug/L	ND	0.0050	C234817				ND	0.0050	C234817
Total Copper (Cu)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Iron (Fe)	ug/L	ND	1.0	C234817				ND	1.0	C234817
Total Lead (Pb)	ug/L	ND	0.0050	C234817				ND	0.0050	C234817
Total Lithium (Li)	ug/L	ND	0.50	C234817				ND	0.50	C234817
Total Manganese (Mn)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Molybdenum (Mo)	ug/L	ND	0.050	C234817				ND	0.050	C234817

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE-110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE791			EBE791			EBE792		
Sampling Date		2026/02/24			2026/02/24			2026/02/24		
COC Number		124189			124189			124189		
	UNITS	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch
Total Nickel (Ni)	ug/L	ND	0.020	C234817				ND	0.020	C234817
Total Phosphorus (P)	ug/L	ND	2.0	C234817				ND	2.0	C234817
Total Rubidium (Rb)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Selenium (Se)	ug/L	ND	0.040	C234817				ND	0.040	C234817
Total Silicon (Si)	ug/L	ND	50	C234817				ND	50	C234817
Total Silver (Ag)	ug/L	ND	0.0050	C234817				ND	0.0050	C234817
Total Strontium (Sr)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Tellurium (Te)	ug/L	ND	0.020	C234817				ND	0.020	C234817
Total Thallium (Tl)	ug/L	ND	0.0020	C234817				ND	0.0020	C234817
Total Thorium (Th)	ug/L	ND	0.050	C234817				ND	0.050	C234817
Total Tin (Sn)	ug/L	ND	0.20	C234817				ND	0.20	C234817
Total Titanium (Ti)	ug/L	ND	0.50	C234817				ND	0.50	C234817
Total Uranium (U)	ug/L	ND	0.0020	C234817				ND	0.0020	C234817
Total Vanadium (V)	ug/L	ND	0.20	C234817				ND	0.20	C234817
Total Zinc (Zn)	ug/L	ND	0.10	C234817				ND	0.10	C234817
Total Zirconium (Zr)	ug/L	ND	0.10	C234817				ND	0.10	C234817
Total Calcium (Ca)	mg/L	ND	0.050	C233054				ND	0.050	C233054
Total Magnesium (Mg)	mg/L	ND	0.050	C233054				ND	0.050	C233054
Total Potassium (K)	mg/L	ND	0.050	C233054				ND	0.050	C233054
Total Sodium (Na)	mg/L	ND	0.050	C233054				ND	0.050	C233054
Total Sulphur (S)	mg/L	ND	3.0	C233054				ND	3.0	C233054

RDL = Reportable Detection Limit
Lab-Dup = Laboratory Initiated Duplicate
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE793		
Sampling Date		2026/02/24 10:00		
COC Number		124189		
	UNITS	DUP	RDL	QC Batch
ANIONS				
Bromide (Br)	mg/L	ND	0.010	C237487
Dissolved Metals by ICPMS				
Dissolved Calcium (Ca)	mg/L	37.7	0.050	C232791
Dissolved Magnesium (Mg)	mg/L	1.48	0.050	C232791
Dissolved Potassium (K)	mg/L	1.77	0.050	C232791
Dissolved Sodium (Na)	mg/L	7.33	0.050	C232791
Dissolved Sulphur (S)	mg/L	5.3	3.0	C232791
Lab Filtered Metals				
Dissolved Aluminum (Al)	ug/L	2700	0.50	C234637
Dissolved Antimony (Sb)	ug/L	0.174	0.020	C234637
Dissolved Arsenic (As)	ug/L	1.49	0.020	C234637
Dissolved Barium (Ba)	ug/L	12.1	0.020	C234637
Dissolved Beryllium (Be)	ug/L	ND	0.010	C234637
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C234637
Dissolved Boron (B)	ug/L	12	10	C234637
Dissolved Cadmium (Cd)	ug/L	0.0170	0.0050	C234637
Dissolved Cesium (Cs)	ug/L	0.103	0.050	C234637
Dissolved Chromium (Cr)	ug/L	3.49	0.10	C234637
Dissolved Cobalt (Co)	ug/L	0.0888	0.0050	C234637
Dissolved Copper (Cu)	ug/L	0.863	0.050	C234637
Dissolved Iron (Fe)	ug/L	164	1.0	C234637
Dissolved Lead (Pb)	ug/L	0.0221	0.0050	C234637
Dissolved Lithium (Li)	ug/L	3.50	0.50	C234637
Dissolved Manganese (Mn)	ug/L	34.7	0.050	C234637
Dissolved Molybdenum (Mo)	ug/L	31.9	0.050	C234637
Dissolved Nickel (Ni)	ug/L	0.599	0.020	C234637
Dissolved Phosphorus (P)	ug/L	4.9	2.0	C234637
Dissolved Rubidium (Rb)	ug/L	4.46	0.050	C234637
Dissolved Selenium (Se)	ug/L	0.042	0.040	C234637

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE793		
Sampling Date		2026/02/24 10:00		
COC Number		124189		
	UNITS	DUP	RDL	QC Batch
Dissolved Silicon (Si)	ug/L	9070	50	C234637
Dissolved Silver (Ag)	ug/L	ND	0.0050	C234637
Dissolved Strontium (Sr)	ug/L	71.7	0.050	C234637
Dissolved Tellurium (Te)	ug/L	ND	0.020	C234637
Dissolved Thallium (Tl)	ug/L	0.0060	0.0020	C234637
Dissolved Thorium (Th)	ug/L	0.0061	0.0050	C234637
Dissolved Tin (Sn)	ug/L	ND	0.20	C234637
Dissolved Titanium (Ti)	ug/L	ND	0.50	C234637
Dissolved Uranium (U)	ug/L	3.23	0.0020	C234637
Dissolved Vanadium (V)	ug/L	1.59	0.20	C234637
Dissolved Zinc (Zn)	ug/L	5.99	0.10	C234637
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C234637
Total Metals by ICPMS				
Total Aluminum (Al)	ug/L	3160	3.0	C237038
Total Antimony (Sb)	ug/L	0.193	0.020	C237038
Total Arsenic (As)	ug/L	1.57	0.020	C237038
Total Barium (Ba)	ug/L	13.0	0.050	C237038
Total Beryllium (Be)	ug/L	0.011	0.010	C237038
Total Bismuth (Bi)	ug/L	ND	0.010	C237038
Total Boron (B)	ug/L	15	10	C237038
Total Cadmium (Cd)	ug/L	0.0184	0.0050	C237038
Total Cesium (Cs)	ug/L	0.121	0.050	C237038
Total Chromium (Cr)	ug/L	3.84	0.10	C237038
Total Cobalt (Co)	ug/L	0.107	0.010	C237038
Total Copper (Cu)	ug/L	1.48	0.10	C237038
Total Iron (Fe)	ug/L	356	5.0	C237038
Total Lead (Pb)	ug/L	0.120	0.020	C237038
Total Lithium (Li)	ug/L	3.60	0.50	C237038
Total Manganese (Mn)	ug/L	38.2	0.10	C237038
Total Molybdenum (Mo)	ug/L	32.3	0.050	C237038

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBE793		
Sampling Date		2026/02/24 10:00		
COC Number		124189		
	UNITS	DUP	RDL	QC Batch
Total Nickel (Ni)	ug/L	0.77	0.10	C237038
Total Phosphorus (P)	ug/L	7.7	5.0	C237038
Total Rubidium (Rb)	ug/L	4.50	0.050	C237038
Total Selenium (Se)	ug/L	0.047	0.040	C237038
Total Silicon (Si)	ug/L	8670	50	C237038
Total Silver (Ag)	ug/L	ND	0.010	C237038
Total Strontium (Sr)	ug/L	75.2	0.050	C237038
Total Tellurium (Te)	ug/L	ND	0.020	C237038
Total Thallium (Tl)	ug/L	0.0074	0.0020	C237038
Total Thorium (Th)	ug/L	ND	0.050	C237038
Total Tin (Sn)	ug/L	ND	0.20	C237038
Total Titanium (Ti)	ug/L	5.2	2.0	C237038
Total Uranium (U)	ug/L	3.52	0.0050	C237038
Total Vanadium (V)	ug/L	1.76	0.20	C237038
Total Zinc (Zn)	ug/L	8.7	1.0	C237038
Total Zirconium (Zr)	ug/L	0.16	0.10	C237038
Total Calcium (Ca)	mg/L	35.6	0.25	C233054
Total Magnesium (Mg)	mg/L	1.51	0.25	C233054
Total Potassium (K)	mg/L	1.77	0.25	C233054
Total Sodium (Na)	mg/L	7.45	0.25	C233054
Total Sulphur (S)	mg/L	5.0	3.0	C233054

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

MISCELLANEOUS (WATER)

Bureau Veritas ID		EBE788	EBE789	EBE790	EBE793		
Sampling Date		2026/02/24 09:25	2026/02/24 10:00	2026/02/24 08:50	2026/02/24 10:00		
COC Number		124189	124189	124189	124189		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	DUP	RDL	QC Batch
Calculated Parameters							
Total Un-ionized Hydrogen Sulfide as S	mg/L	ND	ND	ND	ND	0.0018	C233732
Total Un-ionized Hydrogen Sulfide as H2S	mg/L	ND	ND	ND	ND	0.0019	C233732

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EBE789	EBE793		
Sampling Date		2026/02/24 10:00	2026/02/24 10:00		
COC Number		124189	124189		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Calculated Parameters					
Low Molecular Weight PAH`s	ug/L	ND	ND	0.10	C232903
High Molecular Weight PAH`s	ug/L	ND	ND	0.050	C232903
Total PAH	ug/L	ND	ND	0.10	C232903
Polycyclic Aromatics					
Quinoline	ug/L	ND	ND	0.020	C234435
Naphthalene	ug/L	ND	ND	0.10	C234435
1-Methylnaphthalene	ug/L	ND	ND	0.050	C234435
2-Methylnaphthalene	ug/L	ND	ND	0.10	C234435
Acenaphthylene	ug/L	ND	ND	0.050	C234435
Acenaphthene	ug/L	ND	ND	0.050	C234435
Fluorene	ug/L	ND	ND	0.050	C234435
Phenanthrene	ug/L	ND	ND	0.050	C234435
Anthracene	ug/L	ND	ND	0.010	C234435
Acridine	ug/L	ND	ND	0.050	C234435
Fluoranthene	ug/L	ND	ND	0.020	C234435
Pyrene	ug/L	ND	ND	0.020	C234435
Benzo(a)anthracene	ug/L	ND	ND	0.010	C234435
Chrysene	ug/L	ND	ND	0.020	C234435
Benzo(b&j)fluoranthene	ug/L	ND	ND	0.030	C234435
Benzo(k)fluoranthene	ug/L	ND	ND	0.050	C234435
Benzo(a)pyrene	ug/L	ND	ND	0.0050	C234435
Indeno(1,2,3-cd)pyrene	ug/L	ND	ND	0.050	C234435
Dibenz(a,h)anthracene	ug/L	ND	ND	0.0030	C234435
Benzo(g,h,i)perylene	ug/L	ND	ND	0.050	C234435
Calculated Parameters					
LEPH (C10-C19 less PAH)	mg/L	ND	ND	0.20	C233181
HEPH (C19-C32 less PAH)	mg/L	ND	ND	0.20	C233181
Ext. Pet. Hydrocarbon					
EPH (C10-C19)	mg/L	ND	ND	0.20	C234439
EPH (C19-C32)	mg/L	ND	ND	0.20	C234439

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EBE789	EBE793		
Sampling Date		2026/02/24 10:00	2026/02/24 10:00		
COC Number		124189	124189		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Surrogate Recovery (%)					
O-TERPHENYL (sur.)	%	101	95		C234439
D10-ANTHRACENE (sur.)	%	99	99		C234435
D8-ACENAPHTHYLENE (sur.)	%	95	95		C234435
D8-NAPHTHALENE (sur.)	%	75	79		C234435
TERPHENYL-D14 (sur.)	%	95	96		C234435
RDL = Reportable Detection Limit					

CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EBE789	EBE793		
Sampling Date		2026/02/24 10:00	2026/02/24 10:00		
COC Number		124189	124189		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Calculated Parameters					
VPH (VH6 to 10 - BTEX)	ug/L	ND	ND	300	C232907
Volatiles					
VH C6-C10	ug/L	ND	ND	300	C234631
1,1,1,2-tetrachloroethane	ug/L	ND	ND	0.50	C234631
1,1,1-trichloroethane	ug/L	ND	ND	0.50	C234631
1,1,2,2-tetrachloroethane	ug/L	ND	ND	0.50	C234631
1,1,2Trichloro-1,2,2Trifluoroethane	ug/L	ND	ND	2.0	C234631
1,1,2-trichloroethane	ug/L	ND	ND	0.50	C234631
1,1-dichloroethane	ug/L	ND	ND	0.50	C234631
1,1-dichloroethene	ug/L	ND	ND	0.50	C234631
1,2,3-trichlorobenzene	ug/L	ND	ND	2.0	C234631
1,2,4-trichlorobenzene	ug/L	ND	ND	2.0	C234631
1,2-dibromoethane	ug/L	ND	ND	0.20	C234631
1,2-dichlorobenzene	ug/L	ND	ND	0.50	C234631
1,2-dichloroethane	ug/L	ND	ND	0.50	C234631
1,2-dichloropropane	ug/L	ND	ND	0.50	C234631
1,3,5-trimethylbenzene	ug/L	ND	ND	2.0	C234631
1,3-Butadiene	ug/L	ND	ND	0.50	C234631
1,3-dichlorobenzene	ug/L	ND	ND	0.50	C234631
1,3-dichloropropane	ug/L	ND	ND	1.0	C234631
1,4-dichlorobenzene	ug/L	ND	ND	0.50	C234631
Benzene	ug/L	ND	ND	0.40	C234631
Bromobenzene	ug/L	ND	ND	2.0	C234631
Bromodichloromethane	ug/L	ND	ND	1.0	C234631
Bromoform	ug/L	ND	ND	1.0	C234631
Bromomethane	ug/L	ND	ND	1.0	C234631
Carbon tetrachloride	ug/L	ND	ND	0.50	C234631
Chlorobenzene	ug/L	ND	ND	0.50	C234631
Dibromochloromethane	ug/L	ND	ND	1.0	C234631
Chloroethane	ug/L	ND	ND	1.0	C234631

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EBE789	EBE793		
Sampling Date		2026/02/24 10:00	2026/02/24 10:00		
COC Number		124189	124189		
	UNITS	WLNG -EOP	DUP	RDL	QC Batch
Chloroform	ug/L	ND	ND	1.0	C234631
Chloromethane	ug/L	ND	ND	1.0	C234631
cis-1,2-dichloroethene	ug/L	ND	ND	1.0	C234631
cis-1,3-dichloropropene	ug/L	ND	ND	1.0	C234631
Dichlorodifluoromethane	ug/L	ND	ND	2.0	C234631
Dichloromethane	ug/L	ND	ND	2.0	C234631
Ethylbenzene	ug/L	ND	ND	0.40	C234631
Hexachlorobutadiene	ug/L	ND	ND	0.50	C234631
Isopropylbenzene	ug/L	ND	ND	2.0	C234631
Methyl-tert-butylether (MTBE)	ug/L	ND	ND	4.0	C234631
Styrene	ug/L	ND	ND	0.50	C234631
Tetrachloroethene	ug/L	ND	ND	0.50	C234631
Toluene	ug/L	ND	ND	0.40	C234631
trans-1,2-dichloroethene	ug/L	ND	ND	1.0	C234631
trans-1,3-dichloropropene	ug/L	ND	ND	1.0	C234631
Trichloroethene	ug/L	ND	ND	0.50	C234631
Trichlorofluoromethane	ug/L	ND	ND	4.0	C234631
Vinyl chloride	ug/L	ND	ND	0.50	C234631
m & p-Xylene	ug/L	ND	ND	0.40	C234631
o-Xylene	ug/L	ND	ND	0.40	C234631
Xylenes (Total)	ug/L	ND	ND	0.40	C234631
Surrogate Recovery (%)					
1,4-Difluorobenzene (sur.)	%	100	102		C234631
4-Bromofluorobenzene (sur.)	%	87	86		C234631
D4-1,2-Dichloroethane (sur.)	%	79	75		C234631

RDL = Reportable Detection Limit
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

GENERAL COMMENTS

Results relate only to the items tested.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C233769	AG8	Matrix Spike [EBE792-02]	Total Suspended Solids	2026/02/26		102	%	80 - 120
C233769	AG8	Spiked Blank	Total Suspended Solids	2026/02/26		100	%	80 - 120
C233769	AG8	Method Blank	Total Suspended Solids	2026/02/26	ND, RDL=1.0		mg/L	
C233769	AG8	RPD [EBE789-02]	Total Suspended Solids	2026/02/26	15		%	20
C233770	BB3	Matrix Spike	Total Ammonia (N)	2026/02/25		103	%	80 - 120
C233770	BB3	Spiked Blank	Total Ammonia (N)	2026/02/25		105	%	80 - 120
C233770	BB3	Method Blank	Total Ammonia (N)	2026/02/25	ND, RDL=0.015		mg/L	
C233770	BB3	RPD	Total Ammonia (N)	2026/02/25	0.51		%	20
C233833	TSO	Matrix Spike [EBE788-04]	Total Nitrogen (N)	2026/02/26		104	%	80 - 120
C233833	TSO	Spiked Blank	Total Nitrogen (N)	2026/02/26		103	%	80 - 120
C233833	TSO	Method Blank	Total Nitrogen (N)	2026/02/26	ND, RDL=0.020		mg/L	
C233833	TSO	RPD [EBE788-04]	Total Nitrogen (N)	2026/02/26	1.4		%	20
C233926	JAV	Matrix Spike	Chloride (Cl)	2026/02/25		97	%	80 - 120
			Sulphate (SO4)	2026/02/25		97	%	80 - 120
C233926	JAV	Spiked Blank	Chloride (Cl)	2026/02/25		95	%	80 - 120
			Sulphate (SO4)	2026/02/25		94	%	80 - 120
C233926	JAV	Method Blank	Chloride (Cl)	2026/02/25	ND, RDL=1.0		mg/L	
			Sulphate (SO4)	2026/02/25	ND, RDL=1.0		mg/L	
C233926	JAV	RPD	Sulphate (SO4)	2026/02/25	NC		%	20
C234107	CJY	Matrix Spike	Dissolved Fluoride (F)	2026/02/25		103	%	80 - 120
C234107	CJY	Spiked Blank	Dissolved Fluoride (F)	2026/02/25		103	%	80 - 120
C234107	CJY	Method Blank	Dissolved Fluoride (F)	2026/02/25	ND, RDL=0.050		mg/L	
C234107	CJY	RPD	Fluoride (F)	2026/02/25	NC		%	20
C234160	CBK	Matrix Spike	Nitrate plus Nitrite (N)	2026/02/25		113	%	80 - 120
C234160	CBK	Spiked Blank	Nitrate plus Nitrite (N)	2026/02/25		107	%	80 - 120
C234160	CBK	Method Blank	Nitrate plus Nitrite (N)	2026/02/25	ND, RDL=0.020		mg/L	
C234160	CBK	RPD	Nitrate plus Nitrite (N)	2026/02/25	8.8		%	25
C234162	CBK	Matrix Spike	Nitrite (N)	2026/02/25		129 (1)	%	80 - 120
C234162	CBK	Spiked Blank	Nitrite (N)	2026/02/25		111	%	80 - 120
C234162	CBK	Method Blank	Nitrite (N)	2026/02/25	ND, RDL=0.0050		mg/L	
C234162	CBK	RPD	Nitrite (N)	2026/02/25	NC		%	20
C234166	CBK	Matrix Spike	Nitrate plus Nitrite (N)	2026/02/25		108	%	80 - 120
C234166	CBK	Spiked Blank	Nitrate plus Nitrite (N)	2026/02/25		108	%	80 - 120
C234166	CBK	Method Blank	Nitrate plus Nitrite (N)	2026/02/25	ND, RDL=0.020		mg/L	
C234166	CBK	RPD	Nitrate plus Nitrite (N)	2026/02/25	9.7		%	25
C234168	CBK	Matrix Spike	Nitrite (N)	2026/02/25		131 (1)	%	80 - 120
C234168	CBK	Spiked Blank	Nitrite (N)	2026/02/25		109	%	80 - 120
C234168	CBK	Method Blank	Nitrite (N)	2026/02/25	ND, RDL=0.0050		mg/L	
C234168	CBK	RPD	Nitrite (N)	2026/02/25	NC		%	20
C234191	JAV	Matrix Spike	Chloride (Cl)	2026/02/25		NC	%	80 - 120
			Sulphate (SO4)	2026/02/25		NC	%	80 - 120
C234191	JAV	Spiked Blank	Chloride (Cl)	2026/02/25		94	%	80 - 120
			Sulphate (SO4)	2026/02/25		94	%	80 - 120

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C234191	JAV	Method Blank	Chloride (Cl)	2026/02/25	ND, RDL=1.0		mg/L	
			Sulphate (SO4)	2026/02/25	ND, RDL=1.0		mg/L	
C234191	JAV	RPD	Chloride (Cl)	2026/02/25	0.26		%	20
			Sulphate (SO4)	2026/02/25	0.72		%	20
C234211	JLP	Spiked Blank	Alkalinity (Total as CaCO3)	2026/02/26		97	%	80 - 120
C234211	JLP	Method Blank	Alkalinity (PP as CaCO3)	2026/02/26	ND, RDL=1.0		mg/L	
			Alkalinity (Total as CaCO3)	2026/02/26	ND, RDL=1.0		mg/L	
			Bicarbonate (HCO3)	2026/02/26	ND, RDL=1.0		mg/L	
			Carbonate (CO3)	2026/02/26	ND, RDL=1.0		mg/L	
			Hydroxide (OH)	2026/02/26	ND, RDL=1.0		mg/L	
C234211	JLP	RPD	Alkalinity (PP as CaCO3)	2026/02/26	NC		%	20
			Alkalinity (Total as CaCO3)	2026/02/26	NC		%	20
			Bicarbonate (HCO3)	2026/02/26	NC		%	20
			Carbonate (CO3)	2026/02/26	NC		%	20
			Hydroxide (OH)	2026/02/26	NC		%	20
C234214	JLP	Spiked Blank	pH	2026/02/26		101	%	97 - 103
C234214	JLP	RPD	pH	2026/02/26	10		%	N/A
C234435	JP1	Spiked Blank	D10-ANTHRACENE (sur.)	2026/02/26		93	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/02/26		92	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/02/26		77	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/02/26		93	%	50 - 140
			Quinoline	2026/02/26		107	%	50 - 140
			Naphthalene	2026/02/26		82	%	50 - 140
			1-Methylnaphthalene	2026/02/26		85	%	50 - 140
			2-Methylnaphthalene	2026/02/26		86	%	50 - 140
			Acenaphthylene	2026/02/26		90	%	50 - 140
			Acenaphthene	2026/02/26		86	%	50 - 140
			Fluorene	2026/02/26		89	%	50 - 140
			Phenanthrene	2026/02/26		88	%	50 - 140
			Anthracene	2026/02/26		88	%	50 - 140
			Acridine	2026/02/26		95	%	50 - 140
			Fluoranthene	2026/02/26		89	%	50 - 140
			Pyrene	2026/02/26		90	%	50 - 140
			Benzo(a)anthracene	2026/02/26		87	%	50 - 140
			Chrysene	2026/02/26		87	%	50 - 140
			Benzo(b&j)fluoranthene	2026/02/26		87	%	50 - 140
			Benzo(k)fluoranthene	2026/02/26		91	%	50 - 140
			Benzo(a)pyrene	2026/02/26		88	%	50 - 140
			Indeno(1,2,3-cd)pyrene	2026/02/26		90	%	50 - 140
			Dibenz(a,h)anthracene	2026/02/26		91	%	50 - 140
			Benzo(g,h,i)perylene	2026/02/26		89	%	50 - 140
C234435	JP1	Method Blank	D10-ANTHRACENE (sur.)	2026/02/26		98	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/02/26		95	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/02/26		72	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/02/26		98	%	50 - 140

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Quinoline	2026/02/26	ND, RDL=0.020		ug/L	
			Naphthalene	2026/02/26	ND, RDL=0.10		ug/L	
			1-Methylnaphthalene	2026/02/26	ND, RDL=0.050		ug/L	
			2-Methylnaphthalene	2026/02/26	ND, RDL=0.10		ug/L	
			Acenaphthylene	2026/02/26	ND, RDL=0.050		ug/L	
			Acenaphthene	2026/02/26	ND, RDL=0.050		ug/L	
			Fluorene	2026/02/26	ND, RDL=0.050		ug/L	
			Phenanthrene	2026/02/26	ND, RDL=0.050		ug/L	
			Anthracene	2026/02/26	ND, RDL=0.010		ug/L	
			Acridine	2026/02/26	ND, RDL=0.050		ug/L	
			Fluoranthene	2026/02/26	ND, RDL=0.020		ug/L	
			Pyrene	2026/02/26	ND, RDL=0.020		ug/L	
			Benzo(a)anthracene	2026/02/26	ND, RDL=0.010		ug/L	
			Chrysene	2026/02/26	ND, RDL=0.020		ug/L	
			Benzo(b&j)fluoranthene	2026/02/26	ND, RDL=0.030		ug/L	
			Benzo(k)fluoranthene	2026/02/26	ND, RDL=0.050		ug/L	
			Benzo(a)pyrene	2026/02/26	ND, RDL=0.0050		ug/L	
			Indeno(1,2,3-cd)pyrene	2026/02/26	ND, RDL=0.050		ug/L	
			Dibenz(a,h)anthracene	2026/02/26	ND, RDL=0.0030		ug/L	
			Benzo(g,h,i)perylene	2026/02/26	ND, RDL=0.050		ug/L	
C234435	JP1	RPD	Quinoline	2026/02/26	NC		%	40
			Naphthalene	2026/02/26	NC		%	40
			1-Methylnaphthalene	2026/02/26	NC		%	40
			2-Methylnaphthalene	2026/02/26	NC		%	40
			Acenaphthylene	2026/02/26	NC		%	40
			Acenaphthene	2026/02/26	1.6		%	40
			Fluorene	2026/02/26	0.73		%	40
			Phenanthrene	2026/02/26	3.4		%	40
			Anthracene	2026/02/26	NC		%	40
			Acridine	2026/02/26	NC		%	40
			Fluoranthene	2026/02/26	NC		%	40
			Pyrene	2026/02/26	3.2		%	40
			Benzo(a)anthracene	2026/02/26	NC		%	40
			Chrysene	2026/02/26	13		%	40

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Benzo(b&j)fluoranthene	2026/02/26	NC		%	40
			Benzo(k)fluoranthene	2026/02/26	NC		%	40
			Benzo(a)pyrene	2026/02/26	NC		%	40
			Indeno(1,2,3-cd)pyrene	2026/02/26	NC		%	40
			Dibenz(a,h)anthracene	2026/02/26	NC		%	40
			Benzo(g,h,i)perylene	2026/02/26	NC		%	40
C234439	PN2	Spiked Blank	O-TERPHENYL (sur.)	2026/02/26		97	%	60 - 140
			EPH (C10-C19)	2026/02/26		95	%	70 - 130
			EPH (C19-C32)	2026/02/26		99	%	70 - 130
C234439	PN2	Method Blank	O-TERPHENYL (sur.)	2026/02/26		101	%	60 - 140
			EPH (C10-C19)	2026/02/26	ND, RDL=0.20		mg/L	
			EPH (C19-C32)	2026/02/26	ND, RDL=0.20		mg/L	
C234439	PN2	RPD	EPH (C10-C19)	2026/02/27	NC		%	30
			EPH (C19-C32)	2026/02/27	NC		%	30
C234440	BTM	Matrix Spike [EBE792-01]	Dissolved Organic Carbon (C)	2026/02/26		100	%	80 - 120
C234440	BTM	Spiked Blank	Dissolved Organic Carbon (C)	2026/02/26		97	%	80 - 120
C234440	BTM	Method Blank	Dissolved Organic Carbon (C)	2026/02/26	ND, RDL=0.50		mg/L	
C234440	BTM	RPD [EBE792-01]	Dissolved Organic Carbon (C)	2026/02/26	NC		%	20
C234492	AG8	Matrix Spike [EBE792-12]	Total Dissolved Solids	2026/02/27		99	%	80 - 120
C234492	AG8	Spiked Blank	Total Dissolved Solids	2026/02/27		102	%	80 - 120
C234492	AG8	Method Blank	Total Dissolved Solids	2026/02/27	ND, RDL=10		mg/L	
C234492	AG8	RPD [EBE791-12]	Total Dissolved Solids	2026/02/27	NC		%	20
C234533	CT6	Matrix Spike	Total Sulphide	2026/02/26		100	%	80 - 120
C234533	CT6	Spiked Blank	Total Sulphide	2026/02/26		89	%	80 - 120
C234533	CT6	Method Blank	Total Sulphide	2026/02/26	ND, RDL=0.0018		mg/L	
C234533	CT6	RPD	Total Sulphide	2026/02/26	NC		%	20
C234554	IDV	Matrix Spike	Total Sulphide	2026/02/27		88	%	80 - 120
C234554	IDV	Spiked Blank	Total Sulphide	2026/02/27		93	%	80 - 120
C234554	IDV	Method Blank	Total Sulphide	2026/02/27	ND, RDL=0.0018		mg/L	
C234554	IDV	RPD	Total Sulphide	2026/02/27	4.2		%	20
C234631	KYC	Matrix Spike	1,4-Difluorobenzene (sur.)	2026/02/27		99	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/27		92	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/27		79	%	50 - 140
			1,1,1,2-tetrachloroethane	2026/02/27		79	%	50 - 140
			1,1,1-trichloroethane	2026/02/27		86	%	50 - 140
			1,1,2,2-tetrachloroethane	2026/02/27		80	%	50 - 140
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/27		84	%	50 - 140
			1,1,2-trichloroethane	2026/02/27		77	%	50 - 140
			1,1-dichloroethane	2026/02/27		89	%	50 - 140
			1,1-dichloroethene	2026/02/27		103	%	50 - 140
			1,2,3-trichlorobenzene	2026/02/27		90	%	50 - 140
			1,2,4-trichlorobenzene	2026/02/27		92	%	50 - 140
			1,2-dibromoethane	2026/02/27		78	%	50 - 140
			1,2-dichlorobenzene	2026/02/27		90	%	50 - 140
			1,2-dichloroethane	2026/02/27		80	%	50 - 140
			1,2-dichloropropane	2026/02/27		79	%	50 - 140
			1,3,5-trimethylbenzene	2026/02/27		98	%	50 - 140

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,3-Butadiene	2026/02/27		61	%	50 - 140
			1,3-dichlorobenzene	2026/02/27		93	%	50 - 140
			1,3-dichloropropane	2026/02/27		79	%	50 - 140
			1,4-dichlorobenzene	2026/02/27		88	%	50 - 140
			Benzene	2026/02/27		83	%	50 - 140
			Bromobenzene	2026/02/27		87	%	50 - 140
			Bromodichloromethane	2026/02/27		77	%	50 - 140
			Bromoform	2026/02/27		81	%	50 - 140
			Bromomethane	2026/02/27		78	%	50 - 140
			Carbon tetrachloride	2026/02/27		87	%	50 - 140
			Chlorobenzene	2026/02/27		81	%	50 - 140
			Dibromochloromethane	2026/02/27		79	%	50 - 140
			Chloroethane	2026/02/27		88	%	50 - 140
			Chloroform	2026/02/27		68	%	50 - 140
			Chloromethane	2026/02/27		103	%	50 - 140
			cis-1,2-dichloroethene	2026/02/27		82	%	50 - 140
			cis-1,3-dichloropropene	2026/02/27		69	%	50 - 140
			Dichlorodifluoromethane	2026/02/27		119	%	50 - 140
			Dichloromethane	2026/02/27		73	%	50 - 140
			Ethylbenzene	2026/02/27		85	%	50 - 140
			Hexachlorobutadiene	2026/02/27		92	%	50 - 140
			Isopropylbenzene	2026/02/27		90	%	50 - 140
			Methyl-tert-butylether (MTBE)	2026/02/27		72	%	50 - 140
			Styrene	2026/02/27		89	%	50 - 140
			Tetrachloroethene	2026/02/27		81	%	50 - 140
			Toluene	2026/02/27		84	%	50 - 140
			trans-1,2-dichloroethene	2026/02/27		89	%	50 - 140
			trans-1,3-dichloropropene	2026/02/27		55	%	50 - 140
			Trichloroethene	2026/02/27		81	%	50 - 140
			Trichlorofluoromethane	2026/02/27		87	%	50 - 140
			Vinyl chloride	2026/02/27		101	%	50 - 140
			m & p-Xylene	2026/02/27		89	%	50 - 140
			o-Xylene	2026/02/27		84	%	50 - 140
C234631	KYC	Spiked Blank	1,4-Difluorobenzene (sur.)	2026/02/27		98	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/27		91	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/27		79	%	50 - 140
			VH C6-C10	2026/02/27		105	%	70 - 130
			1,1,1,2-tetrachloroethane	2026/02/27		80	%	60 - 130
			1,1,1-trichloroethane	2026/02/27		85	%	60 - 130
			1,1,2,2-tetrachloroethane	2026/02/27		82	%	60 - 130
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/27		84	%	60 - 130
			1,1,2-trichloroethane	2026/02/27		80	%	60 - 130
			1,1-dichloroethane	2026/02/27		90	%	60 - 130
			1,1-dichloroethene	2026/02/27		103	%	60 - 130
			1,2,3-trichlorobenzene	2026/02/27		90	%	60 - 130
			1,2,4-trichlorobenzene	2026/02/27		92	%	60 - 130
			1,2-dibromoethane	2026/02/27		81	%	60 - 130
			1,2-dichlorobenzene	2026/02/27		91	%	60 - 130
			1,2-dichloroethane	2026/02/27		83	%	60 - 130
			1,2-dichloropropane	2026/02/27		80	%	60 - 130
			1,3,5-trimethylbenzene	2026/02/27		98	%	60 - 130
			1,3-Butadiene	2026/02/27		60	%	50 - 140
			1,3-dichlorobenzene	2026/02/27		93	%	60 - 130

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,3-dichloropropane	2026/02/27		80	%	60 - 130
			1,4-dichlorobenzene	2026/02/27		89	%	60 - 130
			Benzene	2026/02/27		84	%	60 - 130
			Bromobenzene	2026/02/27		89	%	60 - 130
			Bromodichloromethane	2026/02/27		78	%	60 - 130
			Bromoform	2026/02/27		83	%	60 - 130
			Bromomethane	2026/02/27		78	%	50 - 140
			Carbon tetrachloride	2026/02/27		86	%	60 - 130
			Chlorobenzene	2026/02/27		81	%	60 - 130
			Dibromochloromethane	2026/02/27		82	%	60 - 130
			Chloroethane	2026/02/27		86	%	50 - 140
			Chloroform	2026/02/27		68	%	60 - 130
			Chloromethane	2026/02/27		104	%	50 - 140
			cis-1,2-dichloroethene	2026/02/27		83	%	60 - 130
			cis-1,3-dichloropropene	2026/02/27		69	%	50 - 140
			Dichlorodifluoromethane	2026/02/27		118	%	50 - 140
			Dichloromethane	2026/02/27		75	%	60 - 130
			Ethylbenzene	2026/02/27		85	%	60 - 130
			Hexachlorobutadiene	2026/02/27		92	%	60 - 130
			Isopropylbenzene	2026/02/27		89	%	60 - 130
			Methyl-tert-butylether (MTBE)	2026/02/27		73	%	60 - 130
			Styrene	2026/02/27		89	%	60 - 130
			Tetrachloroethene	2026/02/27		81	%	60 - 130
			Toluene	2026/02/27		84	%	60 - 130
			trans-1,2-dichloroethene	2026/02/27		89	%	60 - 130
			trans-1,3-dichloropropene	2026/02/27		52	%	50 - 140
			Trichloroethene	2026/02/27		81	%	60 - 130
			Trichlorofluoromethane	2026/02/27		85	%	60 - 130
			Vinyl chloride	2026/02/27		101	%	50 - 140
			m & p-Xylene	2026/02/27		88	%	60 - 130
			o-Xylene	2026/02/27		85	%	60 - 130
C234631	KYC	Method Blank	1,4-Difluorobenzene (sur.)	2026/02/27		101	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/02/27		85	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/02/27		76	%	50 - 140
			VH C6-C10	2026/02/27	ND, RDL=300		ug/L	
			1,1,1,2-tetrachloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,1,1-trichloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,1,2,2-tetrachloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/27	ND, RDL=2.0		ug/L	
			1,1,2-trichloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,1-dichloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,1-dichloroethene	2026/02/27	ND, RDL=0.50		ug/L	
			1,2,3-trichlorobenzene	2026/02/27	ND, RDL=2.0		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,2,4-trichlorobenzene	2026/02/27	ND, RDL=2.0		ug/L	
			1,2-dibromoethane	2026/02/27	ND, RDL=0.20		ug/L	
			1,2-dichlorobenzene	2026/02/27	ND, RDL=0.50		ug/L	
			1,2-dichloroethane	2026/02/27	ND, RDL=0.50		ug/L	
			1,2-dichloropropane	2026/02/27	ND, RDL=0.50		ug/L	
			1,3,5-trimethylbenzene	2026/02/27	ND, RDL=2.0		ug/L	
			1,3-Butadiene	2026/02/27	ND, RDL=0.50		ug/L	
			1,3-dichlorobenzene	2026/02/27	ND, RDL=0.50		ug/L	
			1,3-dichloropropane	2026/02/27	ND, RDL=1.0		ug/L	
			1,4-dichlorobenzene	2026/02/27	ND, RDL=0.50		ug/L	
			Benzene	2026/02/27	ND, RDL=0.40		ug/L	
			Bromobenzene	2026/02/27	ND, RDL=2.0		ug/L	
			Bromodichloromethane	2026/02/27	ND, RDL=1.0		ug/L	
			Bromoform	2026/02/27	ND, RDL=1.0		ug/L	
			Bromomethane	2026/02/27	ND, RDL=1.0		ug/L	
			Carbon tetrachloride	2026/02/27	ND, RDL=0.50		ug/L	
			Chlorobenzene	2026/02/27	ND, RDL=0.50		ug/L	
			Dibromochloromethane	2026/02/27	ND, RDL=1.0		ug/L	
			Chloroethane	2026/02/27	ND, RDL=1.0		ug/L	
			Chloroform	2026/02/27	ND, RDL=1.0		ug/L	
			Chloromethane	2026/02/27	ND, RDL=1.0		ug/L	
			cis-1,2-dichloroethene	2026/02/27	ND, RDL=1.0		ug/L	
			cis-1,3-dichloropropene	2026/02/27	ND, RDL=1.0		ug/L	
			Dichlorodifluoromethane	2026/02/27	ND, RDL=2.0		ug/L	
			Dichloromethane	2026/02/27	ND, RDL=2.0		ug/L	
			Ethylbenzene	2026/02/27	ND, RDL=0.40		ug/L	
			Hexachlorobutadiene	2026/02/27	ND, RDL=0.50		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Isopropylbenzene	2026/02/27	ND, RDL=2.0		ug/L	
			Methyl-tert-butylether (MTBE)	2026/02/27	ND, RDL=4.0		ug/L	
			Styrene	2026/02/27	ND, RDL=0.50		ug/L	
			Tetrachloroethene	2026/02/27	ND, RDL=0.50		ug/L	
			Toluene	2026/02/27	ND, RDL=0.40		ug/L	
			trans-1,2-dichloroethene	2026/02/27	ND, RDL=1.0		ug/L	
			trans-1,3-dichloropropene	2026/02/27	ND, RDL=1.0		ug/L	
			Trichloroethene	2026/02/27	ND, RDL=0.50		ug/L	
			Trichlorofluoromethane	2026/02/27	ND, RDL=4.0		ug/L	
			Vinyl chloride	2026/02/27	ND, RDL=0.50		ug/L	
			m & p-Xylene	2026/02/27	ND, RDL=0.40		ug/L	
			o-Xylene	2026/02/27	ND, RDL=0.40		ug/L	
			Xylenes (Total)	2026/02/27	ND, RDL=0.40		ug/L	
C234631	KYC	RPD	VH C6-C10	2026/02/27	NC		%	30
			1,1,1,2-tetrachloroethane	2026/02/27	NC		%	30
			1,1,1-trichloroethane	2026/02/27	NC		%	30
			1,1,2,2-tetrachloroethane	2026/02/27	NC		%	30
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/02/27	NC		%	30
			1,1,2-trichloroethane	2026/02/27	NC		%	30
			1,1-dichloroethane	2026/02/27	NC		%	30
			1,1-dichloroethene	2026/02/27	NC		%	30
			1,2,3-trichlorobenzene	2026/02/27	NC		%	30
			1,2,4-trichlorobenzene	2026/02/27	NC		%	30
			1,2-dibromoethane	2026/02/27	NC		%	30
			1,2-dichlorobenzene	2026/02/27	NC		%	30
			1,2-dichloroethane	2026/02/27	NC		%	30
			1,2-dichloropropane	2026/02/27	NC		%	30
			1,3,5-trimethylbenzene	2026/02/27	NC		%	30
			1,3-dichlorobenzene	2026/02/27	NC		%	30
			1,4-dichlorobenzene	2026/02/27	NC		%	30
			Benzene	2026/02/27	NC		%	30
			Bromobenzene	2026/02/27	NC		%	30
			Bromodichloromethane	2026/02/27	NC		%	30
			Bromoform	2026/02/27	NC		%	30
			Bromomethane	2026/02/27	NC		%	30
			Carbon tetrachloride	2026/02/27	NC		%	30
			Chlorobenzene	2026/02/27	NC		%	30
			Dibromochloromethane	2026/02/27	NC		%	30
			Chloroethane	2026/02/27	NC		%	30
			Chloroform	2026/02/27	NC		%	30

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Chloromethane	2026/02/27	NC		%	30
			cis-1,2-dichloroethene	2026/02/27	NC		%	30
			cis-1,3-dichloropropene	2026/02/27	NC		%	30
			Dichlorodifluoromethane	2026/02/27	NC		%	30
			Dichloromethane	2026/02/27	NC		%	30
			Ethylbenzene	2026/02/27	NC		%	30
			Hexachlorobutadiene	2026/02/27	NC		%	30
			Isopropylbenzene	2026/02/27	NC		%	30
			Methyl-tert-butylether (MTBE)	2026/02/27	NC		%	30
			Styrene	2026/02/27	NC		%	30
			Tetrachloroethene	2026/02/27	NC		%	30
			Toluene	2026/02/27	NC		%	30
			trans-1,2-dichloroethene	2026/02/27	NC		%	30
			trans-1,3-dichloropropene	2026/02/27	NC		%	30
			Trichloroethene	2026/02/27	NC		%	30
			Trichlorofluoromethane	2026/02/27	NC		%	30
			Vinyl chloride	2026/02/27	NC		%	30
			m & p-Xylene	2026/02/27	NC		%	30
			o-Xylene	2026/02/27	NC		%	30
			Xylenes (Total)	2026/02/27	NC		%	30
C234637	AA1	Matrix Spike [EBE788-11]	Dissolved Aluminum (Al)	2026/02/27		NC	%	80 - 120
			Dissolved Antimony (Sb)	2026/02/27		99	%	80 - 120
			Dissolved Arsenic (As)	2026/02/27		96	%	80 - 120
			Dissolved Barium (Ba)	2026/02/27		94	%	80 - 120
			Dissolved Beryllium (Be)	2026/02/27		99	%	80 - 120
			Dissolved Bismuth (Bi)	2026/02/27		94	%	80 - 120
			Dissolved Boron (B)	2026/02/27		105	%	80 - 120
			Dissolved Cadmium (Cd)	2026/02/27		95	%	80 - 120
			Dissolved Cesium (Cs)	2026/02/27		87	%	80 - 120
			Dissolved Chromium (Cr)	2026/02/27		86	%	80 - 120
			Dissolved Cobalt (Co)	2026/02/27		86	%	80 - 120
			Dissolved Copper (Cu)	2026/02/27		86	%	80 - 120
			Dissolved Iron (Fe)	2026/02/27		96	%	80 - 120
			Dissolved Lead (Pb)	2026/02/27		90	%	80 - 120
			Dissolved Lithium (Li)	2026/02/27		96	%	80 - 120
			Dissolved Manganese (Mn)	2026/02/27		89	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/02/27		NC	%	80 - 120
			Dissolved Nickel (Ni)	2026/02/27		90	%	80 - 120
			Dissolved Phosphorus (P)	2026/02/27		99	%	80 - 120
			Dissolved Rubidium (Rb)	2026/02/27		96	%	80 - 120
			Dissolved Selenium (Se)	2026/02/27		95	%	80 - 120
			Dissolved Silicon (Si)	2026/02/27		NC	%	80 - 120
			Dissolved Silver (Ag)	2026/02/27		93	%	80 - 120
			Dissolved Strontium (Sr)	2026/02/27		86	%	80 - 120
			Dissolved Tellurium (Te)	2026/02/27		102	%	80 - 120
			Dissolved Thallium (Tl)	2026/02/27		95	%	80 - 120
			Dissolved Thorium (Th)	2026/02/27		98	%	80 - 120
			Dissolved Tin (Sn)	2026/02/27		98	%	80 - 120
			Dissolved Titanium (Ti)	2026/02/27		93	%	80 - 120
			Dissolved Uranium (U)	2026/02/27		97	%	80 - 120
			Dissolved Vanadium (V)	2026/02/27		89	%	80 - 120
			Dissolved Zinc (Zn)	2026/02/27		92	%	80 - 120
			Dissolved Zirconium (Zr)	2026/02/27		99	%	80 - 120

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C234637	AA1	Spiked Blank	Dissolved Aluminum (Al)	2026/02/27		106	%	80 - 120
			Dissolved Antimony (Sb)	2026/02/27		109	%	80 - 120
			Dissolved Arsenic (As)	2026/02/27		104	%	80 - 120
			Dissolved Barium (Ba)	2026/02/27		103	%	80 - 120
			Dissolved Beryllium (Be)	2026/02/27		105	%	80 - 120
			Dissolved Bismuth (Bi)	2026/02/27		102	%	80 - 120
			Dissolved Boron (B)	2026/02/27		107	%	80 - 120
			Dissolved Cadmium (Cd)	2026/02/27		104	%	80 - 120
			Dissolved Cesium (Cs)	2026/02/27		96	%	80 - 120
			Dissolved Chromium (Cr)	2026/02/27		95	%	80 - 120
			Dissolved Cobalt (Co)	2026/02/27		97	%	80 - 120
			Dissolved Copper (Cu)	2026/02/27		95	%	80 - 120
			Dissolved Iron (Fe)	2026/02/27		102	%	80 - 120
			Dissolved Lead (Pb)	2026/02/27		96	%	80 - 120
			Dissolved Lithium (Li)	2026/02/27		102	%	80 - 120
			Dissolved Manganese (Mn)	2026/02/27		100	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/02/27		109	%	80 - 120
			Dissolved Nickel (Ni)	2026/02/27		100	%	80 - 120
			Dissolved Phosphorus (P)	2026/02/27		106	%	80 - 120
			Dissolved Rubidium (Rb)	2026/02/27		105	%	80 - 120
			Dissolved Selenium (Se)	2026/02/27		102	%	80 - 120
			Dissolved Silicon (Si)	2026/02/27		104	%	80 - 120
			Dissolved Silver (Ag)	2026/02/27		103	%	80 - 120
			Dissolved Strontium (Sr)	2026/02/27		100	%	80 - 120
			Dissolved Tellurium (Te)	2026/02/27		114	%	80 - 120
			Dissolved Thallium (Tl)	2026/02/27		100	%	80 - 120
			Dissolved Thorium (Th)	2026/02/27		103	%	80 - 120
			Dissolved Tin (Sn)	2026/02/27		108	%	80 - 120
			Dissolved Titanium (Ti)	2026/02/27		103	%	80 - 120
			Dissolved Uranium (U)	2026/02/27		100	%	80 - 120
			Dissolved Vanadium (V)	2026/02/27		97	%	80 - 120
			Dissolved Zinc (Zn)	2026/02/27		102	%	80 - 120
			Dissolved Zirconium (Zr)	2026/02/27		107	%	80 - 120
C234637	AA1	Method Blank	Dissolved Aluminum (Al)	2026/02/27	ND, RDL=0.50		ug/L	
			Dissolved Antimony (Sb)	2026/02/27	ND, RDL=0.020		ug/L	
			Dissolved Arsenic (As)	2026/02/27	ND, RDL=0.020		ug/L	
			Dissolved Barium (Ba)	2026/02/27	ND, RDL=0.020		ug/L	
			Dissolved Beryllium (Be)	2026/02/27	ND, RDL=0.010		ug/L	
			Dissolved Bismuth (Bi)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Boron (B)	2026/02/27	ND, RDL=10		ug/L	
			Dissolved Cadmium (Cd)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Cesium (Cs)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Chromium (Cr)	2026/02/27	ND, RDL=0.10		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Cobalt (Co)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Copper (Cu)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Iron (Fe)	2026/02/27	ND, RDL=1.0		ug/L	
			Dissolved Lead (Pb)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Lithium (Li)	2026/02/27	ND, RDL=0.50		ug/L	
			Dissolved Manganese (Mn)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Molybdenum (Mo)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Nickel (Ni)	2026/02/27	ND, RDL=0.020		ug/L	
			Dissolved Phosphorus (P)	2026/02/27	ND, RDL=2.0		ug/L	
			Dissolved Rubidium (Rb)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Selenium (Se)	2026/02/27	ND, RDL=0.040		ug/L	
			Dissolved Silicon (Si)	2026/02/27	ND, RDL=50		ug/L	
			Dissolved Silver (Ag)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Strontium (Sr)	2026/02/27	ND, RDL=0.050		ug/L	
			Dissolved Tellurium (Te)	2026/02/27	ND, RDL=0.020		ug/L	
			Dissolved Thallium (Tl)	2026/02/27	ND, RDL=0.0020		ug/L	
			Dissolved Thorium (Th)	2026/02/27	ND, RDL=0.0050		ug/L	
			Dissolved Tin (Sn)	2026/02/27	ND, RDL=0.20		ug/L	
			Dissolved Titanium (Ti)	2026/02/27	ND, RDL=0.50		ug/L	
			Dissolved Uranium (U)	2026/02/27	ND, RDL=0.0020		ug/L	
			Dissolved Vanadium (V)	2026/02/27	ND, RDL=0.20		ug/L	
			Dissolved Zinc (Zn)	2026/02/27	ND, RDL=0.10		ug/L	
			Dissolved Zirconium (Zr)	2026/02/27	ND, RDL=0.10		ug/L	
C234637	AA1	RPD	Dissolved Aluminum (Al)	2026/02/27	5.9		%	20
			Dissolved Antimony (Sb)	2026/02/27	NC		%	20
			Dissolved Arsenic (As)	2026/02/27	NC		%	20
			Dissolved Barium (Ba)	2026/02/27	NC		%	20
			Dissolved Beryllium (Be)	2026/02/27	NC		%	20
			Dissolved Bismuth (Bi)	2026/02/27	NC		%	20
			Dissolved Boron (B)	2026/02/27	NC		%	20
			Dissolved Cadmium (Cd)	2026/02/27	NC		%	20

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Chromium (Cr)	2026/02/27	NC		%	20
			Dissolved Cobalt (Co)	2026/02/27	NC		%	20
			Dissolved Copper (Cu)	2026/02/27	NC		%	20
			Dissolved Iron (Fe)	2026/02/27	NC		%	20
			Dissolved Lead (Pb)	2026/02/27	NC		%	20
			Dissolved Lithium (Li)	2026/02/27	NC		%	20
			Dissolved Manganese (Mn)	2026/02/27	NC		%	20
			Dissolved Molybdenum (Mo)	2026/02/27	NC		%	20
			Dissolved Nickel (Ni)	2026/02/27	NC		%	20
			Dissolved Phosphorus (P)	2026/02/27	18		%	20
			Dissolved Selenium (Se)	2026/02/27	NC		%	20
			Dissolved Silicon (Si)	2026/02/27	NC		%	20
			Dissolved Silver (Ag)	2026/02/27	NC		%	20
			Dissolved Strontium (Sr)	2026/02/27	NC		%	20
			Dissolved Thallium (Tl)	2026/02/27	NC		%	20
			Dissolved Tin (Sn)	2026/02/27	NC		%	20
			Dissolved Titanium (Ti)	2026/02/27	NC		%	20
			Dissolved Uranium (U)	2026/02/27	NC		%	20
			Dissolved Vanadium (V)	2026/02/27	NC		%	20
			Dissolved Zinc (Zn)	2026/02/27	NC		%	20
			Dissolved Zirconium (Zr)	2026/02/27	NC		%	20
C234637	AA1	RPD [EBE788-11]	Dissolved Aluminum (Al)	2026/02/27	4.1		%	20
			Dissolved Antimony (Sb)	2026/02/27	3.7		%	20
			Dissolved Arsenic (As)	2026/02/27	3.8		%	20
			Dissolved Barium (Ba)	2026/02/27	1.1		%	20
			Dissolved Beryllium (Be)	2026/02/27	NC		%	20
			Dissolved Bismuth (Bi)	2026/02/27	NC		%	20
			Dissolved Boron (B)	2026/02/27	NC		%	20
			Dissolved Cadmium (Cd)	2026/02/27	9.6		%	20
			Dissolved Cesium (Cs)	2026/02/27	4.9		%	20
			Dissolved Chromium (Cr)	2026/02/27	2.3		%	20
			Dissolved Cobalt (Co)	2026/02/27	5.5		%	20
			Dissolved Copper (Cu)	2026/02/27	0.60		%	20
			Dissolved Iron (Fe)	2026/02/27	0.43		%	20
			Dissolved Lead (Pb)	2026/02/27	NC		%	20
			Dissolved Lithium (Li)	2026/02/27	3.3		%	20
			Dissolved Manganese (Mn)	2026/02/27	2.6		%	20
			Dissolved Molybdenum (Mo)	2026/02/27	3.0		%	20
			Dissolved Nickel (Ni)	2026/02/27	7.0		%	20
			Dissolved Phosphorus (P)	2026/02/27	19		%	20
			Dissolved Rubidium (Rb)	2026/02/27	1.4		%	20
			Dissolved Selenium (Se)	2026/02/27	NC		%	20
			Dissolved Silicon (Si)	2026/02/27	3.1		%	20
			Dissolved Silver (Ag)	2026/02/27	NC		%	20
			Dissolved Strontium (Sr)	2026/02/27	1.9		%	20
			Dissolved Tellurium (Te)	2026/02/27	NC		%	20
			Dissolved Thallium (Tl)	2026/02/27	NC		%	20
			Dissolved Thorium (Th)	2026/02/27	1.2		%	20
			Dissolved Tin (Sn)	2026/02/27	NC		%	20
			Dissolved Titanium (Ti)	2026/02/27	NC		%	20
			Dissolved Uranium (U)	2026/02/27	1.7		%	20
			Dissolved Vanadium (V)	2026/02/27	5.2		%	20
			Dissolved Zinc (Zn)	2026/02/27	1.8		%	20

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Zirconium (Zr)	2026/02/27	NC		%	20
C234637	AA1	RPD [EBE791-11]	Dissolved Aluminum (Al)	2026/02/27	NC		%	20
			Dissolved Antimony (Sb)	2026/02/27	NC		%	20
			Dissolved Arsenic (As)	2026/02/27	NC		%	20
			Dissolved Barium (Ba)	2026/02/27	NC		%	20
			Dissolved Beryllium (Be)	2026/02/27	NC		%	20
			Dissolved Bismuth (Bi)	2026/02/27	NC		%	20
			Dissolved Boron (B)	2026/02/27	NC		%	20
			Dissolved Cadmium (Cd)	2026/02/27	NC		%	20
			Dissolved Cesium (Cs)	2026/02/27	NC		%	20
			Dissolved Chromium (Cr)	2026/02/27	NC		%	20
			Dissolved Cobalt (Co)	2026/02/27	NC		%	20
			Dissolved Copper (Cu)	2026/02/27	NC		%	20
			Dissolved Iron (Fe)	2026/02/27	NC		%	20
			Dissolved Lead (Pb)	2026/02/27	NC		%	20
			Dissolved Lithium (Li)	2026/02/27	NC		%	20
			Dissolved Manganese (Mn)	2026/02/27	NC		%	20
			Dissolved Molybdenum (Mo)	2026/02/27	NC		%	20
			Dissolved Nickel (Ni)	2026/02/27	NC		%	20
			Dissolved Phosphorus (P)	2026/02/27	1.2		%	20
			Dissolved Rubidium (Rb)	2026/02/27	NC		%	20
			Dissolved Selenium (Se)	2026/02/27	NC		%	20
			Dissolved Silicon (Si)	2026/02/27	NC		%	20
			Dissolved Silver (Ag)	2026/02/27	NC		%	20
			Dissolved Strontium (Sr)	2026/02/27	NC		%	20
			Dissolved Tellurium (Te)	2026/02/27	NC		%	20
			Dissolved Thallium (Tl)	2026/02/27	NC		%	20
			Dissolved Thorium (Th)	2026/02/27	NC		%	20
			Dissolved Tin (Sn)	2026/02/27	NC		%	20
			Dissolved Titanium (Ti)	2026/02/27	NC		%	20
			Dissolved Uranium (U)	2026/02/27	NC		%	20
			Dissolved Vanadium (V)	2026/02/27	NC		%	20
			Dissolved Zinc (Zn)	2026/02/27	NC		%	20
			Dissolved Zirconium (Zr)	2026/02/27	NC		%	20
C234649	BTM	Matrix Spike [EBE788-04]	Total Organic Carbon (C)	2026/02/27		110	%	80 - 120
C234649	BTM	Spiked Blank	Total Organic Carbon (C)	2026/02/26		97	%	80 - 120
C234649	BTM	Method Blank	Total Organic Carbon (C)	2026/02/26	ND, RDL=0.50		mg/L	
C234649	BTM	RPD [EBE788-04]	Total Organic Carbon (C)	2026/02/27	4.2		%	20
C234779	C2L	Matrix Spike	Total Mercury (Hg)	2026/02/26		100	%	80 - 120
C234779	C2L	Spiked Blank	Total Mercury (Hg)	2026/02/26		99	%	80 - 120
C234779	C2L	Method Blank	Total Mercury (Hg)	2026/02/26	ND, RDL=0.0019		ug/L	
C234779	C2L	RPD	Total Mercury (Hg)	2026/02/26	NC		%	20
C234817	SOM	Matrix Spike	Total Aluminum (Al)	2026/02/27		101	%	80 - 120
			Total Antimony (Sb)	2026/02/27		102	%	80 - 120
			Total Arsenic (As)	2026/02/27		100	%	80 - 120
			Total Barium (Ba)	2026/02/27		94	%	80 - 120
			Total Beryllium (Be)	2026/02/27		95	%	80 - 120
			Total Bismuth (Bi)	2026/02/27		95	%	80 - 120
			Total Boron (B)	2026/02/27		104	%	80 - 120
			Total Cadmium (Cd)	2026/02/27		97	%	80 - 120
			Total Cesium (Cs)	2026/02/27		101	%	80 - 120

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Chromium (Cr)	2026/02/27		95	%	80 - 120
			Total Cobalt (Co)	2026/02/27		93	%	80 - 120
			Total Copper (Cu)	2026/02/27		90	%	80 - 120
			Total Iron (Fe)	2026/02/27		101	%	80 - 120
			Total Lead (Pb)	2026/02/27		97	%	80 - 120
			Total Lithium (Li)	2026/02/27		97	%	80 - 120
			Total Manganese (Mn)	2026/02/27		94	%	80 - 120
			Total Molybdenum (Mo)	2026/02/27		107	%	80 - 120
			Total Nickel (Ni)	2026/02/27		93	%	80 - 120
			Total Phosphorus (P)	2026/02/27		104	%	80 - 120
			Total Rubidium (Rb)	2026/02/27		102	%	80 - 120
			Total Selenium (Se)	2026/02/27		100	%	80 - 120
			Total Silicon (Si)	2026/02/27		102	%	80 - 120
			Total Silver (Ag)	2026/02/27		94	%	80 - 120
			Total Strontium (Sr)	2026/02/27		NC	%	80 - 120
			Total Tellurium (Te)	2026/02/27		102	%	80 - 120
			Total Thallium (Tl)	2026/02/27		99	%	80 - 120
			Total Thorium (Th)	2026/02/27		101	%	80 - 120
			Total Tin (Sn)	2026/02/27		101	%	80 - 120
			Total Titanium (Ti)	2026/02/27		97	%	80 - 120
			Total Uranium (U)	2026/02/27		97	%	80 - 120
			Total Vanadium (V)	2026/02/27		97	%	80 - 120
			Total Zinc (Zn)	2026/02/27		95	%	80 - 120
			Total Zirconium (Zr)	2026/02/27		101	%	80 - 120
C234817	SOM	Spiked Blank	Total Aluminum (Al)	2026/02/27		102	%	80 - 120
			Total Antimony (Sb)	2026/02/27		103	%	80 - 120
			Total Arsenic (As)	2026/02/27		102	%	80 - 120
			Total Barium (Ba)	2026/02/27		99	%	80 - 120
			Total Beryllium (Be)	2026/02/27		101	%	80 - 120
			Total Bismuth (Bi)	2026/02/27		101	%	80 - 120
			Total Boron (B)	2026/02/27		108	%	80 - 120
			Total Cadmium (Cd)	2026/02/27		100	%	80 - 120
			Total Cesium (Cs)	2026/02/27		106	%	80 - 120
			Total Chromium (Cr)	2026/02/27		100	%	80 - 120
			Total Cobalt (Co)	2026/02/27		99	%	80 - 120
			Total Copper (Cu)	2026/02/27		97	%	80 - 120
			Total Iron (Fe)	2026/02/27		108	%	80 - 120
			Total Lead (Pb)	2026/02/27		98	%	80 - 120
			Total Lithium (Li)	2026/02/27		103	%	80 - 120
			Total Manganese (Mn)	2026/02/27		98	%	80 - 120
			Total Molybdenum (Mo)	2026/02/27		107	%	80 - 120
			Total Nickel (Ni)	2026/02/27		100	%	80 - 120
			Total Phosphorus (P)	2026/02/27		105	%	80 - 120
			Total Rubidium (Rb)	2026/02/27		104	%	80 - 120
			Total Selenium (Se)	2026/02/27		101	%	80 - 120
			Total Silicon (Si)	2026/02/27		111	%	80 - 120
			Total Silver (Ag)	2026/02/27		96	%	80 - 120
			Total Strontium (Sr)	2026/02/27		98	%	80 - 120
			Total Tellurium (Te)	2026/02/27		116	%	80 - 120
			Total Thallium (Tl)	2026/02/27		102	%	80 - 120
			Total Thorium (Th)	2026/02/27		106	%	80 - 120
			Total Tin (Sn)	2026/02/27		105	%	80 - 120
			Total Titanium (Ti)	2026/02/27		105	%	80 - 120

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Uranium (U)	2026/02/27		102	%	80 - 120
			Total Vanadium (V)	2026/02/27		101	%	80 - 120
			Total Zinc (Zn)	2026/02/27		102	%	80 - 120
			Total Zirconium (Zr)	2026/02/27		102	%	80 - 120
C234817	SOM	Method Blank	Total Aluminum (Al)	2026/02/27	ND, RDL=0.50		ug/L	
			Total Antimony (Sb)	2026/02/27	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/02/27	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/02/27	ND, RDL=0.020		ug/L	
			Total Beryllium (Be)	2026/02/27	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/02/27	ND, RDL=0.0050		ug/L	
			Total Boron (B)	2026/02/27	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/02/27	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/02/27	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/02/27	ND, RDL=0.0050		ug/L	
			Total Copper (Cu)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Iron (Fe)	2026/02/27	ND, RDL=1.0		ug/L	
			Total Lead (Pb)	2026/02/27	ND, RDL=0.0050		ug/L	
			Total Lithium (Li)	2026/02/27	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Molybdenum (Mo)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/02/27	ND, RDL=0.020		ug/L	
			Total Phosphorus (P)	2026/02/27	ND, RDL=2.0		ug/L	
			Total Rubidium (Rb)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/02/27	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/02/27	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/02/27	ND, RDL=0.0050		ug/L	
			Total Strontium (Sr)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/02/27	ND, RDL=0.020		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Thallium (Tl)	2026/02/27	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/02/27	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/02/27	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/02/27	ND, RDL=0.50		ug/L	
			Total Uranium (U)	2026/02/27	ND, RDL=0.0020		ug/L	
			Total Vanadium (V)	2026/02/27	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/02/27	ND, RDL=0.10		ug/L	
			Total Zirconium (Zr)	2026/02/27	ND, RDL=0.10		ug/L	
C234817	SOM	RPD	Total Aluminum (Al)	2026/02/27	5.9		%	20
			Total Antimony (Sb)	2026/02/27	8.9		%	20
			Total Arsenic (As)	2026/02/27	2.4		%	20
			Total Barium (Ba)	2026/02/27	0.55		%	20
			Total Beryllium (Be)	2026/02/27	NC		%	20
			Total Bismuth (Bi)	2026/02/27	NC		%	20
			Total Boron (B)	2026/02/27	NC		%	20
			Total Cadmium (Cd)	2026/02/27	16		%	20
			Total Chromium (Cr)	2026/02/27	NC		%	20
			Total Cobalt (Co)	2026/02/27	1.8		%	20
			Total Copper (Cu)	2026/02/27	2.5		%	20
			Total Iron (Fe)	2026/02/27	0.57		%	20
			Total Lead (Pb)	2026/02/27	2.4		%	20
			Total Lithium (Li)	2026/02/27	0.50		%	20
			Total Manganese (Mn)	2026/02/27	5.0		%	20
			Total Molybdenum (Mo)	2026/02/27	3.3		%	20
			Total Nickel (Ni)	2026/02/27	2.5		%	20
			Total Phosphorus (P)	2026/02/27	12		%	20
			Total Selenium (Se)	2026/02/27	4.4		%	20
			Total Silicon (Si)	2026/02/27	0.13		%	20
			Total Silver (Ag)	2026/02/27	NC		%	20
			Total Strontium (Sr)	2026/02/27	0.29		%	20
			Total Tellurium (Te)	2026/02/27	NC		%	20
			Total Thallium (Tl)	2026/02/27	NC		%	20
			Total Thorium (Th)	2026/02/27	NC		%	20
			Total Tin (Sn)	2026/02/27	NC		%	20
			Total Titanium (Ti)	2026/02/27	NC		%	20
			Total Uranium (U)	2026/02/27	0.40		%	20
			Total Vanadium (V)	2026/02/27	1.5		%	20
			Total Zinc (Zn)	2026/02/27	0.86		%	20
			Total Zirconium (Zr)	2026/02/27	NC		%	20
C235060	KA5	Matrix Spike [EBE788-04]	Total Phosphorus (P)	2026/02/27		62	%	N/A
C235060	KA5	Spiked Blank	Total Phosphorus (P)	2026/02/27		101	%	80 - 120
C235060	KA5	Method Blank	Total Phosphorus (P)	2026/02/27	ND, RDL=0.0010		mg/L	
C235060	KA5	RPD [EBE788-04]	Total Phosphorus (P)	2026/02/27	14		%	20
C235355	LSH	Matrix Spike	Methyl Sulfone (sur.)	2026/02/27		102	%	50 - 140

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Ethylene Glycol	2026/02/27		87	%	60 - 140
			Diethylene Glycol	2026/02/27		118	%	60 - 140
			Triethylene Glycol	2026/02/27		101	%	60 - 140
			Propylene Glycol	2026/02/27		99	%	60 - 140
C235355	LSH	Spiked Blank	Methyl Sulfone (sur.)	2026/02/27		96	%	50 - 140
			Ethylene Glycol	2026/02/27		76	%	70 - 130
			Diethylene Glycol	2026/02/27		106	%	70 - 130
			Triethylene Glycol	2026/02/27		85	%	70 - 130
			Propylene Glycol	2026/02/27		89	%	70 - 130
C235355	LSH	Method Blank	Methyl Sulfone (sur.)	2026/02/27		101	%	50 - 140
			Ethylene Glycol	2026/02/27	ND, RDL=3.0		mg/L	
			Diethylene Glycol	2026/02/27	ND, RDL=5.0		mg/L	
			Triethylene Glycol	2026/02/27	ND, RDL=5.0		mg/L	
			Propylene Glycol	2026/02/27	ND, RDL=5.0		mg/L	
C235355	LSH	RPD	Ethylene Glycol	2026/02/27	NC		%	30
			Diethylene Glycol	2026/02/27	NC		%	30
			Triethylene Glycol	2026/02/27	NC		%	30
			Propylene Glycol	2026/02/27	NC		%	30
C235925	C2L	Matrix Spike	Dissolved Mercury (Hg)	2026/02/27		100	%	80 - 120
C235925	C2L	Spiked Blank	Dissolved Mercury (Hg)	2026/02/27		98	%	80 - 120
C235925	C2L	Method Blank	Dissolved Mercury (Hg)	2026/02/27	ND, RDL=0.0019		ug/L	
C235925	C2L	RPD	Dissolved Mercury (Hg)	2026/02/27	4.8		%	20
C237038	AA1	Matrix Spike	Total Aluminum (Al)	2026/03/02		132 (1)	%	80 - 120
			Total Antimony (Sb)	2026/03/02		106	%	80 - 120
			Total Arsenic (As)	2026/03/02		103	%	80 - 120
			Total Barium (Ba)	2026/03/02		NC	%	80 - 120
			Total Beryllium (Be)	2026/03/02		102	%	80 - 120
			Total Bismuth (Bi)	2026/03/02		99	%	80 - 120
			Total Boron (B)	2026/03/02		111	%	80 - 120
			Total Cadmium (Cd)	2026/03/02		101	%	80 - 120
			Total Cesium (Cs)	2026/03/02		95	%	80 - 120
			Total Chromium (Cr)	2026/03/02		95	%	80 - 120
			Total Cobalt (Co)	2026/03/02		91	%	80 - 120
			Total Copper (Cu)	2026/03/02		92	%	80 - 120
			Total Iron (Fe)	2026/03/02		109	%	80 - 120
			Total Lead (Pb)	2026/03/02		98	%	80 - 120
			Total Lithium (Li)	2026/03/02		102	%	80 - 120
			Total Manganese (Mn)	2026/03/02		NC	%	80 - 120
			Total Molybdenum (Mo)	2026/03/02		112	%	80 - 120
			Total Nickel (Ni)	2026/03/02		94	%	80 - 120
			Total Phosphorus (P)	2026/03/02		107	%	80 - 120
			Total Rubidium (Rb)	2026/03/02		104	%	80 - 120
			Total Selenium (Se)	2026/03/02		100	%	80 - 120
			Total Silicon (Si)	2026/03/02		NC	%	80 - 120
			Total Silver (Ag)	2026/03/02		100	%	80 - 120
			Total Strontium (Sr)	2026/03/02		NC	%	80 - 120
			Total Tellurium (Te)	2026/03/02		111	%	80 - 120
			Total Thallium (Tl)	2026/03/02		103	%	80 - 120

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Thorium (Th)	2026/03/02		106	%	80 - 120
			Total Tin (Sn)	2026/03/02		102	%	80 - 120
			Total Titanium (Ti)	2026/03/02		104	%	80 - 120
			Total Uranium (U)	2026/03/02		112	%	80 - 120
			Total Vanadium (V)	2026/03/02		96	%	80 - 120
			Total Zinc (Zn)	2026/03/02		99	%	80 - 120
			Total Zirconium (Zr)	2026/03/02		108	%	80 - 120
C237038	AA1	Spiked Blank	Total Aluminum (Al)	2026/03/02		105	%	80 - 120
			Total Antimony (Sb)	2026/03/02		107	%	80 - 120
			Total Arsenic (As)	2026/03/02		103	%	80 - 120
			Total Barium (Ba)	2026/03/02		101	%	80 - 120
			Total Beryllium (Be)	2026/03/02		101	%	80 - 120
			Total Bismuth (Bi)	2026/03/02		101	%	80 - 120
			Total Boron (B)	2026/03/02		106	%	80 - 120
			Total Cadmium (Cd)	2026/03/02		101	%	80 - 120
			Total Cesium (Cs)	2026/03/02		95	%	80 - 120
			Total Chromium (Cr)	2026/03/02		98	%	80 - 120
			Total Cobalt (Co)	2026/03/02		94	%	80 - 120
			Total Copper (Cu)	2026/03/02		96	%	80 - 120
			Total Iron (Fe)	2026/03/02		99	%	80 - 120
			Total Lead (Pb)	2026/03/02		98	%	80 - 120
			Total Lithium (Li)	2026/03/02		97	%	80 - 120
			Total Manganese (Mn)	2026/03/02		100	%	80 - 120
			Total Molybdenum (Mo)	2026/03/02		109	%	80 - 120
			Total Nickel (Ni)	2026/03/02		100	%	80 - 120
			Total Phosphorus (P)	2026/03/02		106	%	80 - 120
			Total Rubidium (Rb)	2026/03/02		104	%	80 - 120
			Total Selenium (Se)	2026/03/02		100	%	80 - 120
			Total Silicon (Si)	2026/03/02		98	%	80 - 120
			Total Silver (Ag)	2026/03/02		99	%	80 - 120
			Total Strontium (Sr)	2026/03/02		102	%	80 - 120
			Total Tellurium (Te)	2026/03/02		110	%	80 - 120
			Total Thallium (Tl)	2026/03/02		104	%	80 - 120
			Total Thorium (Th)	2026/03/02		102	%	80 - 120
			Total Tin (Sn)	2026/03/02		107	%	80 - 120
			Total Titanium (Ti)	2026/03/02		102	%	80 - 120
			Total Uranium (U)	2026/03/02		108	%	80 - 120
			Total Vanadium (V)	2026/03/02		96	%	80 - 120
			Total Zinc (Zn)	2026/03/02		100	%	80 - 120
			Total Zirconium (Zr)	2026/03/02		106	%	80 - 120
C237038	AA1	Method Blank	Total Aluminum (Al)	2026/03/02	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/03/02	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/03/02	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/03/02	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/03/02	ND, RDL=0.010		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Boron (B)	2026/03/02	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/03/02	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/03/02	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/03/02	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/03/02	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/03/02	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/03/02	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/03/02	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/03/02	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/03/02	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/03/02	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/03/02	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/03/02	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/03/02	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/03/02	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/03/02	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/03/02	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/03/02	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/03/02	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/03/02	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/03/02	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/03/02	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/03/02	ND, RDL=0.10		ug/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C237038	AA1	RPD	Total Aluminum (Al)	2026/03/02	2.5		%	20
			Total Antimony (Sb)	2026/03/02	5.1		%	20
			Total Arsenic (As)	2026/03/02	0.25		%	20
			Total Barium (Ba)	2026/03/02	1.4		%	20
			Total Beryllium (Be)	2026/03/02	3.5		%	20
			Total Bismuth (Bi)	2026/03/02	NC		%	20
			Total Boron (B)	2026/03/02	NC		%	20
			Total Cadmium (Cd)	2026/03/02	0.31		%	20
			Total Chromium (Cr)	2026/03/02	NC		%	20
			Total Cobalt (Co)	2026/03/02	0.099		%	20
			Total Copper (Cu)	2026/03/02	0.36		%	20
			Total Iron (Fe)	2026/03/02	1.2		%	20
			Total Lead (Pb)	2026/03/02	3.5		%	20
			Total Lithium (Li)	2026/03/02	1.2		%	20
			Total Manganese (Mn)	2026/03/02	1.1		%	20
			Total Molybdenum (Mo)	2026/03/02	2.2		%	20
			Total Nickel (Ni)	2026/03/02	2.3		%	20
			Total Phosphorus (P)	2026/03/02	7.6		%	20
			Total Selenium (Se)	2026/03/02	NC		%	20
			Total Silicon (Si)	2026/03/02	0.52		%	20
			Total Silver (Ag)	2026/03/02	NC		%	20
			Total Strontium (Sr)	2026/03/02	2.1		%	20
			Total Tellurium (Te)	2026/03/02	NC		%	20
			Total Thallium (Tl)	2026/03/02	7.6		%	20
			Total Thorium (Th)	2026/03/02	NC		%	20
			Total Tin (Sn)	2026/03/02	NC		%	20
			Total Titanium (Ti)	2026/03/02	NC		%	20
			Total Uranium (U)	2026/03/02	1.5		%	20
			Total Vanadium (V)	2026/03/02	NC		%	20
			Total Zinc (Zn)	2026/03/02	0.73		%	20
			Total Zirconium (Zr)	2026/03/02	NC		%	20
C237067	MDO	Matrix Spike [EBE789-17]	Phenols	2026/03/02		103	%	80 - 120
C237067	MDO	Spiked Blank	Phenols	2026/03/02		101	%	80 - 120
C237067	MDO	Method Blank	Phenols	2026/03/02	ND, RDL=0.0015		mg/L	
C237067	MDO	RPD [EBE789-17]	Phenols	2026/03/02	NC		%	20
C237487	RLC	Matrix Spike	Bromide (Br)	2026/03/03		89	%	78 - 120
C237487	RLC	Spiked Blank	Bromide (Br)	2026/03/03		100	%	80 - 120
C237487	RLC	Method Blank	Bromide (Br)	2026/03/03	ND, RDL=0.010		mg/L	
C237487	RLC	RPD	Bromide (Br)	2026/03/03	NC		%	20
C237929	JLP	Matrix Spike [EBE788-09]	Total Hex. Chromium (Cr 6+)	2026/03/03		108	%	80 - 120
C237929	JLP	Spiked Blank	Total Hex. Chromium (Cr 6+)	2026/03/03		104	%	80 - 120
C237929	JLP	Method Blank	Total Hex. Chromium (Cr 6+)	2026/03/03	ND, RDL=0.00099		mg/L	

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C237929	JLP	RPD [EBE788-09]	Total Hex. Chromium (Cr 6+)	2026/03/03	NC		%	20

N/A = Not Applicable

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference <= 2x RDL).

(1) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:



David Huang, M.Sc., P.Chem., QP, Scientific Services Manager

Ghayasuddin Khan, M.Sc., P.Chem., QP, Scientific Specialist, Inorganics



Luba Shymushovska, B.Sc., QP, Senior Analyst, Organics



Melissa Thompson, Scientist



Rochelle Pacheco, Project Solutions Representative

Bureau Veritas Certified by Ghayasuddin Khan, M.Sc., P.Chem., QP, Scientific Specialist, Inorganics

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.

Bureau Veritas Burnaby: 4606 Canada Way V5G 1K5 Telephone(604) 734-7276 Fax(604) 731-2386

C609961
2026/02/24 14:20

Custody Tracking Form

eCOC Number: W124189

Please use this form for custody tracking when submitting the work instructions via eCOC (electronic Chain of Custody). Please ensure your form **has a barcode or a Bureau Veritas eCOC confirmation number** in the top right hand side. This number links your electronic submission to your samples. This form should be **placed in the cooler with your samples.**

Relinquished By:				Received By:			
Hayley Masson		Date	2026/02/24	Marta Zamora	NA	Date	2026/02/24
		Time (24 HR)	14:18			Time (24 HR)	14:20
		Date				Date	
		Time (24 HR)				Time (24 HR)	
		Date				Date	
		Time (24 HR)				Time (24 HR)	

Unless otherwise agreed to, submissions and use of services are governed by Bureau Veritas' standard terms and conditions which can be found at www.bvna.com.

Triage Information

Sampled By (Print): Hayley Masson

# of Coolers/Pkgs: 3

Rush ☐ Micro ☐ Immediate Test ☐ Food Residue ☐ Food Chemistry ☐

***** Laboratory Use Only *****

Received At:

Labeled By:

Verified By:

Lab Comments: ICE FROZEN

MVAN-2026-02-1737

Custody Seal		Cooling Media	Temperature °C		
Present (Y/N)	Intact (Y/N)	Present (Y/N)	1	2	3
Y	Y	Y	13	11	12
Y	Y	Y	5	8	7
Y	Y	Y	7	8	10

Drinking Water Metals Preservation Check Done (Circle) YES NO

COR FCD-00340 /5 PAGE 1 of 1

EPH in Water when PAH required Chromatogram

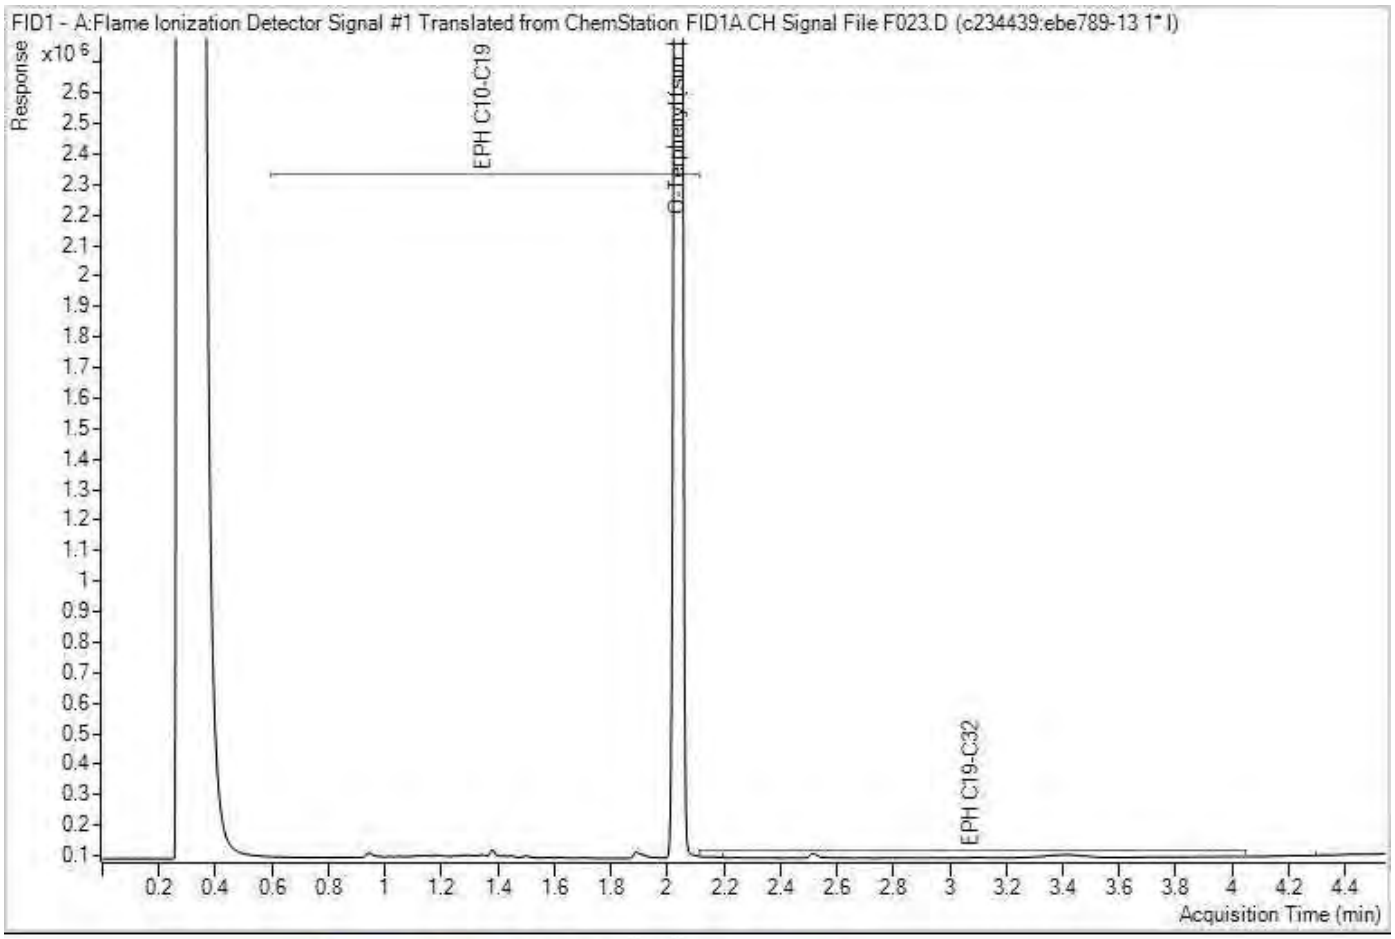

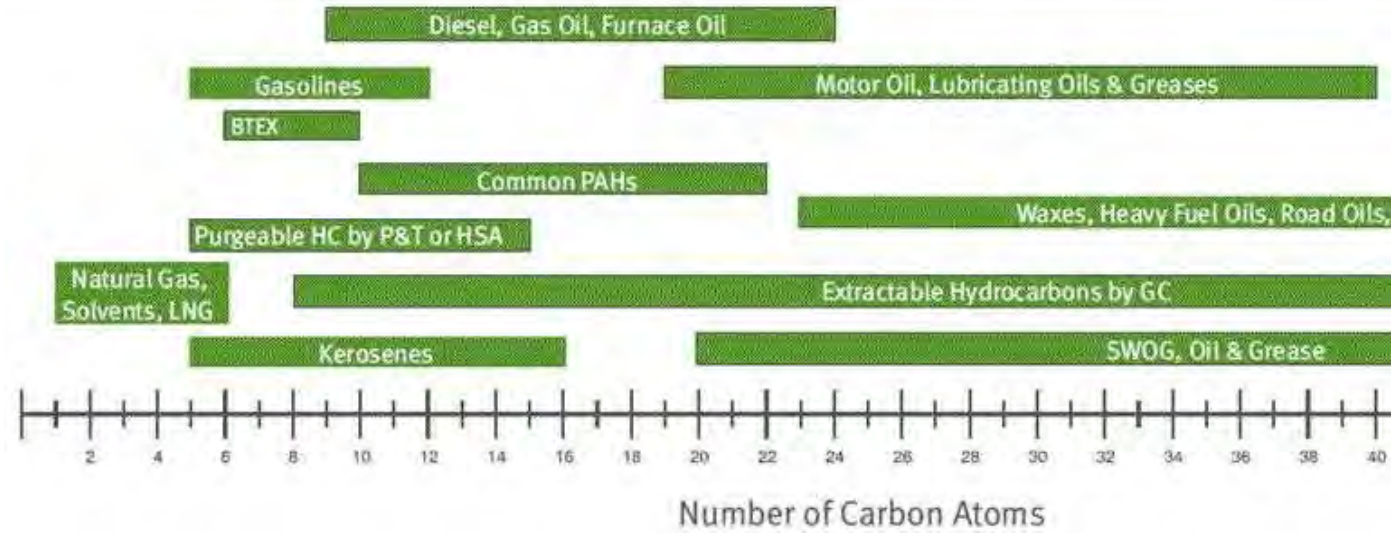

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.

EPH in Water when PAH required Chromatogram

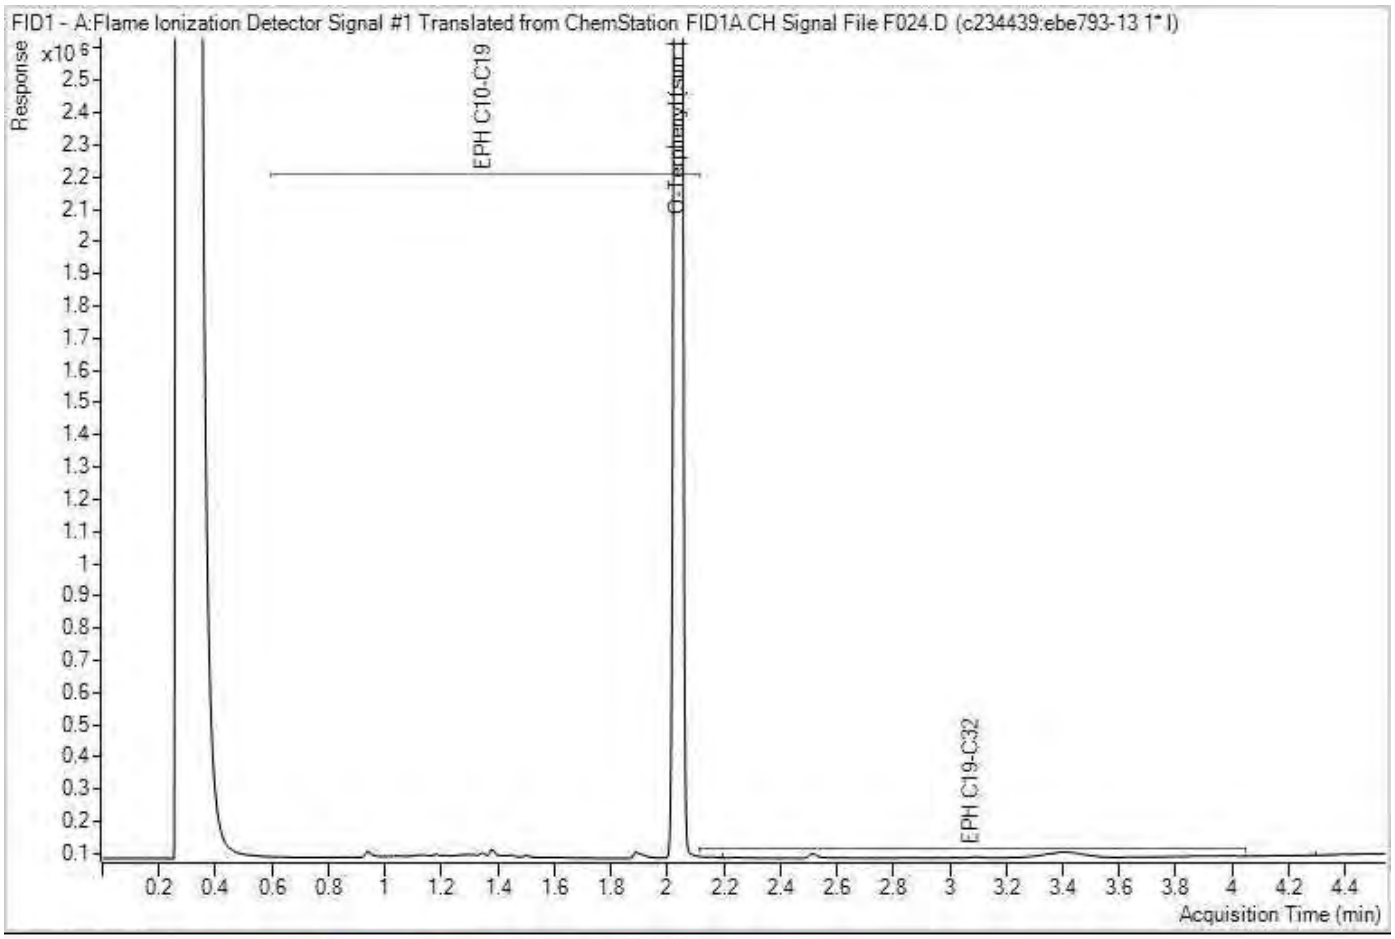

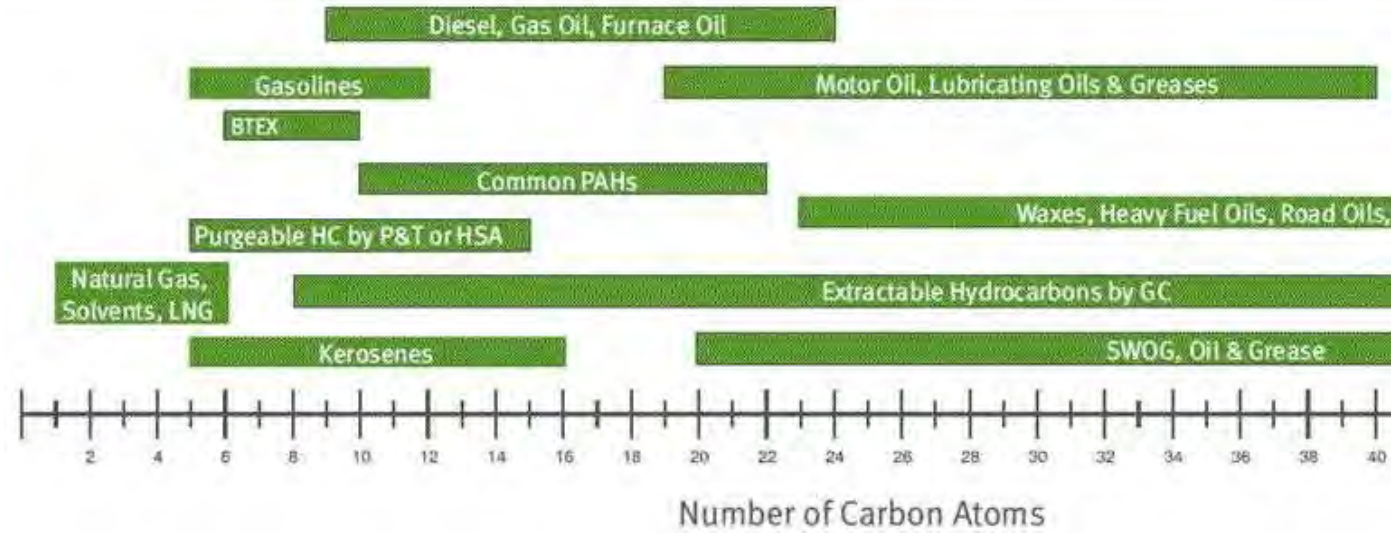

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.

eCOC: W124189

Project Information:	C609961
Job Received:	2026/02/24 14:20
Expected TAT:	Standard TAT
Expected Arrival:	2026/02/24 04:59
Submitted By:	Sam Wolf
Submitted To:	Burnaby ENV: 4606 Canada Way

Invoice Information

Attn: Accounts Payable
Fortis BC Energy Inc
16705 Fraser Hwy
Surrey , BC , V4N 0E8
Email to:
einvoices@fortisbc.com

Report Information

Attn: Brett Lucas
HATFIELD CONSULTANTS
200-850 Harbourside Dr
North Vancouver , BC , V7P 0A3
Email to:
blucas@hatfieldgroup.com
danielle.samels@fortisbc.com
smangwani@hatfieldgroup.com
jmacpherson@hatfieldgroup.com
swolf@hatfieldgroup.com

Project Information

Quote #:	C50083
PO/AFE#:	4800010213
Project #:	Fortis11234/PE-110163
Site Location:	Woodfibre Pipeline Project

Analytical Summary

A: Standard TAT

Client Sample ID	Clnt Ref	Sampling Date/Time	Matrix	#Cont	Woodfibre	Woodfibre Additional	Woodfibre Blank	Rainbow Trout LC50 Multi-concentration	Set Number
WLNG-DS	1	2026/02/24	WATER	14	A				1
WLNG -EOP	2	2026/02/24	WATER	22	A	A		A	2
WLNG-US	3	2026/02/24	WATER	14	A				1
Field Blank	4	2026/02/24	WATER	14			A		3
Trip Blank	5	2026/02/24	WATER	14			A		3
DUP	6	2026/02/24	WATER	18	A	A			4

Deadlines are estimates only and are subject to change. Please refer to your Job Confirmation report for final due dates.

Submission Information

# of Samples: 6

Sample Set Listing

Set 1 (2 samples)	Set 2 (1 sample)	Set 3 (2 samples)	Set 4 (1 sample)
WLNG-DS WLNG-US	WLNG -EOP	Field Blank Trip Blank	DUP

RESULTS OF RAINBOW TROUT LC50 MULTI-CONCENTRATION

Client : 12239 Fortis BC Energy Inc, Surrey Job Number: C609961

Client Project Name & Number: WOODFIBRE PIPELINE PROJECT FORTIS11234/PE-110163

Test Result:

96 hrs LC50 % vol/vol (95% CL): >100 (N/A) Statistical Method: Visual

Sample Name : WLNG -EOP

Description:	Clear, colourless, slight hydrocarbon odor			Sample Number:	EBE789-16
Sample Collected:	Feb 24, 2026 10:00 AM	Sampling Method :	N/A	Site Collection:	N/A
Sample Collected By:	N/A	Volume Received:	4 x ECO10	Avg Temp Arrival:	9 °C Storage: 2-6°C
Sample Received:	Feb 24, 2026 02:20 PM	pH:	7.6	Dissolved Oxygen:	10.1 mg/L
Analysis Start :	Feb 25, 2026 11:55 AM	Temperature :	15 °C	Sample Conductance:	204 µS/cm

Concentration	Temperature (°C)	Temperature (°C)	Dissolved Oxygen (mg/L)	Dissolved Oxygen (mg/L)	pH	pH	Conductivity (uS/cm)	Mortality (#)	Mortality (%)	Atypical Behaviour (#)
% vol/vol	Initial	96 hrs	Initial	96 hrs	Initial	96 hrs	Initial	96 hrs	96 hrs	96 hrs
0	14	15	10.2	9.6	7.6	7.6	46	0	0	0
6.25	15	15	10.2	9.2	7.6	7.5	59	0	0	0
12.5	15	15	10.2	9.7	7.7	7.7	68	0	0	0
25	15	15	10.2	9.7	7.7	7.7	89	0	0	0
50	15	15	10.2	9.9	7.6	7.7	132	0	0	0
100	15	15	10.2	9.7	7.6	7.7	205	0	0	0

Comments : All fish appeared and behaved normally at 24 hours, 48 hours, 72 hours, and 96 hours into testing.

Culture/Control/Dilution Water Burnaby Municipal Dechlorinated Water

Hardness: 23 mg/L $CaCO_3$ Other parameters available on request.

Test Conditions Test concentration : 0,6.25,12.5,25,50,100 (% vol/vol)

Organisms per Vessel :	10	Test Temperature :	15 ± 1 °C	Solution Depth :	>15 cm
Total # of Organisms Used :	60	Pre-aeration Time :	30 min.	Rate of Aeration	6.5±1 mL/ (min*L)
Test Volume :	18 L	Vessel Volume :	20L	Test pH Adjusted:	No
Loading Density :	0.4 g/L	Photoperiod :	16:8 (light: dark)		

Test Organism : Rainbow Trout *(Oncorhynchus mykiss)* Source : Aqua Farm

Culture Temperature :	15 ± 2 °C	Weight (Mean) +- SD :	0.6 ± 0.1 g	Length (Mean) +- SD :	4.31 ± 0.30 cm
Culture Water Renewal :	≥ 1L/min/kg fish	Weight (Range) :	0.5 – 1.0 g	Length (Range) :	4.00 – 5.00 cm
Culture Photoperiod :	16:8 (light: dark)			% Mortality within 7 days :	0.38%
Feeding rate and frequency :	daily: 1-5% biomass of trout.			Acclimation Time:	>14 days

Reference chemical: Zinc Test Date: Feb 06, 2026

Test Endpoint 96 hrs LC50 (95% confidence interval) : 0.27 (0.20, 0.39)mg/L Statistical Method : Probit

Historical Mean LC50 (warning limits) : 0.24 (0.13, 0.46) mg/L Concentration : 0,0.04,0.08,0.16,0.32,0.64 mg/L

Test Method BV Lab's BBY2SOP-00004 is based on the latest version of EPS 1/RM9 and EPS 1 /RM13.

Method Deviations : None.

Note: The results contained in this report refer only to the testing of the sample submitted. Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation, including the toxicity parameters reported herein. The conductivity, dissolved oxygen and pH data contained within the toxicity report are provided for information purposes and are not individually accredited parameters. This report may not be reproduced, except in its entirety, without the written approval of the laboratory.

Analyst : Dayna Lee, Navpreet Shergill, Nayshan Blassnitz



Verified By : Melissa Thompson, Scientist Date: Mar 04, 2026 03:52 PM