



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week

Mar 2, 2026 to  
Mar 8, 2026

Report #

102

Page

1 of 7

# **Eagle Mountain – Woodfibre Gas Pipeline Project**

## **BCER Waste Discharge Permit Weekly Report**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Page	2 of 7

## Contents

Preamble .....	3
Introduction .....	3
Sampling Methodology .....	3
Summary-BC Rail Site .....	5
Site Activities .....	5
Discharge from Water Treatment Plant.....	5
Receiving Environment Monitoring-Squamish River .....	5
Summary-Woodfibre .....	6
Site Activities .....	6
Exceedances.....	6
Discharge from Water Treatment Plant.....	7
Receiving Environment Monitoring-East Creek.....	7

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

Appendix E: Lab Documentation



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Page	3 of 7

## Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environments (upstream and downstream) and points of discharge.

FortisBC has retained Hatfield Consultants as the Qualified Professional to implement and oversee the monitoring and sampling programs. The data represented below, including laboratory reported exceedances, represent conditions measured from final discharge points and the associated receiving environments, as required under the Waste Discharge Permit.

## Introduction

The results provided in this document have been submitted to BCER by FortisBC as per the requirements listed in Section 4.2 of the Waste Discharge Permit PE-110163:

The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to [Waste.Management@bc-er.ca](mailto:Waste.Management@bc-er.ca). A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

## Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and laboratory samples to meet daily and real-time requirements for the Waste Discharge Permit.

In the receiving environments, real-time and daily readings were monitored at the same time with one piece of equipment, allowing real-time daily readings. Visible sheen was monitored through visual inspections during times of discharge or sampling.

At the point of discharges, parameters are monitored using field equipment and water quality sondes, as well as discrete weekly water quality sampling events for laboratory analyses. Table 1 and Table 2 below describe this monitoring.



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Page	4 of 7

**Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre**

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real-time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observator NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples*

\*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.

**Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre**

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real-time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples

\*indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week

Mar 2, 2026 to  
Mar 8, 2026

Report #

102

Page

5 of 7

## Summary-BC Rail Site

### Site Activities

- Water produced by the water treatment plant is being recirculated for tunneling and to create grout for tunneling.

### Discharge from Water Treatment Plant

- There was no discharges this week from the BC Rail Site.

### Receiving Environment Monitoring-Squamish River

Tables 3 and 4 below provide information on water quality and lab sampling. Lab Sampling has been put on hold with permission from BCER as there are no discharges. Appendix B includes a full set of lab results with real-time data. The receiving environment is being monitored as outlined in the permit and confirmed by BCER, with additional oversight by the QP.

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Upstream	N/A	Yes *	Full set of results are provided in Appendix B. **

**Table 4. Downstream Monitoring Information**

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Downstream	N/A	Yes *	Full set of results are provided in Appendix B.

\* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

\*\*Data gaps in available in-situ continuous monitoring data, included:

- No data gaps were observed.



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week

Mar 2, 2026 to  
Mar 8, 2026

Report #

102

Page

6 of 7

## Summary-Woodfibre

### Site Activities

- Weekly upstream, downstream, and end of pipe water quality sampling performed by the QP.
- On-going tunnelling at WLNG and grouting works to mitigate water ingress.

### Exceedances

The following exceedances were reported during the March 2 to March 8, 2026, reporting period:

#### Turbidity

- Turbidity at EAS DS exceeded the BC acute water quality guidelines protective of aquatic life (WQGPAL; i.e., a change from background of 8 NTU) for a period of more than 24 hours from March 6 at 16:45 to March 8 at 23:45, the water quality logger was cleaned on March 9, which correlating in a drop in turbidity.
- A review of continuous EOP turbidity monitoring indicated that EOP turbidity values remained below the EAS DS turbidity values for most of the reporting period, except for a few spike events. Although there was some misalignment between the EAS DS and WLNG EOP results, WLNG EOP turbidity results did exceed BC acute WQGs at times during the exceedance event, but were noted to be within guidelines as well.

#### pH

- Field pH measured at WLNG EOP on March 3, 2026 (6.11) was less than the BC freshwater WQGPAL range (6.5 to 9). Lab pH was within normal range.
- The field pH at the upstream WLNG US (6.95) and downstream WLNG DS (7.22) stations were within the BC freshwater WQGPAL range (6.5 to 9).
- Following a review of FKM's continuous discharge data, the pH levels were recorded between 6.9 and 7 at the time the field pH measurement (6.11), which was taken on March 3, 2026. It is important to highlight that the field pH was documented using a handheld pH device, which may not always yield the most precise readings. This was not deemed an exceedance.

#### Dissolved Copper (D-Cu)

- The WLNG EOP D-Cu concentration (0.000412 mg/L) was above its sample-specific BC short-term WQGPAL (freshwater) of 0.0002 mg/L by a factor of 2.1 times, although it is important to note that this guideline includes a 2-fold safety factor.
- The D-Cu at the upstream reference station WLNG US (0.00143 mg/L) was above its sample-specific BC short-term WQGPAL (freshwater) of 0.00129 mg/L by a factor of 1.1 times and exceeded the value observed in the EOP sample, indicating elevated background concentrations.



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week

Mar 2, 2026 to  
Mar 8, 2026

Report #

102

Page

7 of 7

- D-Cu at the downstream WLNG DS (0.00091 mg/L) station was within its sample-specific BC short-term WQGPAL (freshwater) and below the WLNG US upstream reference station results.

### Discharge from Water Treatment Plant

Appendix C includes volume information and real-time/field samples from the discharge.

### Receiving Environment Monitoring-East Creek

Tables 5 and 6 below provide information on water quality and lab sampling. Appendix D includes a full set of lab results with real-time data. The receiving environment is being monitored as outlined in the permit with additional oversight by the QP.

**Table 5. Upstream Monitoring Information**

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Upstream	2026-03-03	Yes *	Full set of results provided in Appendix D.**

**Table 6. Downstream Monitoring Information**

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Downstream	2026-03-03	Yes *	Full set of results provided in Appendix D.**

\* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

\*\*Data gaps in available in-situ continuous monitoring data, included:

- EAS US
  - 2026-03-02: Temperature, conductivity and salinity data were missing at 20:00.
  - 2026-03-07: Temperature, conductivity and salinity data were missing at 6:00.
  - 2026-03-08: Temperature data was missing at 6:00.
- EAS DS
  - 2026-03-02: Temperature and ORP data were missing at 3:00.
  - 2026-03-03: Temperature and ORP data were missing at 7:00.
  - 2026-03-05: Temperature and ORP data were missing at 23:00.
  - 2026-03-07: Temperature and ORP data were missing at 7:00.



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix A	A-1

**Appendix A:  
BCR Site Point of Discharge from Water  
Treatment Plant Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix A	A-2

**BCR Site Batch Sample Analysis  
No discharges**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix A	A-3

**BCR Site WTP Discharge Field Notes and Logs  
No Discharges**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix B	B-1

**Appendix B:  
BCR Site Receiving Environment Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix B	B-2

**BCR Site Receiving Environment Sample Analysis  
No sampling**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix B	B-3

## BCR Site Receiving Environment Field Notes and Logs

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-02 00:00:00	3.86	0.09	0.56	7.09	12.17	0.00	0.00
SQU-DS	2026-03-02 00:15:00	3.83	0.09	0.56	7.08	12.18	0.00	0.00
SQU-DS	2026-03-02 00:30:00	3.82	0.09	0.55	7.07	12.18	0.00	0.00
SQU-DS	2026-03-02 00:45:00	3.77	0.09	0.55	7.06	12.20	0.00	0.00
SQU-DS	2026-03-02 01:00:00	3.75	0.09	0.55	7.04	12.21	0.00	0.00
SQU-DS	2026-03-02 01:15:00	3.76	0.09	0.55	7.03	12.20	0.00	0.00
SQU-DS	2026-03-02 01:30:00	3.73	0.09	0.55	7.02	12.21	0.00	0.00
SQU-DS	2026-03-02 01:45:00	3.69	0.09	0.55	7.01	12.23	0.00	0.00
SQU-DS	2026-03-02 02:00:00	3.64	0.09	0.55	7.00	12.25	0.00	0.00
SQU-DS	2026-03-02 02:15:00	3.59	0.09	0.55	6.99	12.26	0.00	0.00
SQU-DS	2026-03-02 02:30:00	3.49	0.09	0.55	6.98	12.29	0.00	0.00
SQU-DS	2026-03-02 02:45:00	4.44	65.08	0.53	7.25	11.77	1.44	0.03
SQU-DS	2026-03-02 03:00:00	4.52	64.63	0.54	7.33	11.26	0.72	0.03
SQU-DS	2026-03-02 03:15:00	4.51	64.10	0.54	7.32	11.19	0.66	0.03
SQU-DS	2026-03-02 03:30:00	4.49	63.56	0.54	7.32	11.15	0.79	0.03
SQU-DS	2026-03-02 03:45:00	4.48	63.27	0.54	7.33	11.05	0.96	0.03
SQU-DS	2026-03-02 04:00:00	4.47	63.10	0.54	7.34	11.02	0.60	0.03
SQU-DS	2026-03-02 04:15:00	4.44	62.80	0.54	7.34	11.01	0.80	0.03
SQU-DS	2026-03-02 04:30:00	4.42	62.45	0.54	7.34	11.01	0.55	0.03
SQU-DS	2026-03-02 04:45:00	4.40	62.41	0.55	7.36	11.03	0.69	0.03
SQU-DS	2026-03-02 05:00:00	4.38	61.91	0.55	7.36	11.07	0.82	0.03
SQU-DS	2026-03-02 05:15:00	4.35	61.49	0.54	7.37	11.13	0.75	0.03
SQU-DS	2026-03-02 05:30:00	4.31	60.85	0.55	7.37	11.17	1.09	0.03
SQU-DS	2026-03-02 05:45:00	4.27	60.62	0.55	7.37	11.19	1.35	0.03
SQU-DS	2026-03-02 06:00:00	4.24	60.19	0.55	7.37	11.21	1.13	0.03
SQU-DS	2026-03-02 06:15:00	4.20	59.93	0.55	7.38	11.23	1.36	0.03
SQU-DS	2026-03-02 06:30:00	4.15	59.68	0.55	7.38	11.28	1.46	0.03
SQU-DS	2026-03-02 06:45:00	4.13	59.65	0.55	7.39	11.34	1.43	0.03
SQU-DS	2026-03-02 07:00:00	4.12	61.24	0.55	7.39	11.31	1.63	0.03
SQU-DS	2026-03-02 07:15:00	4.14	62.76	0.55	7.38	11.26	1.80	0.03
SQU-DS	2026-03-02 07:30:00	4.15	64.74	0.55	7.37	11.20	1.75	0.03
SQU-DS	2026-03-02 07:45:00	4.15	65.23	0.55	7.38	11.14	1.88	0.03
SQU-DS	2026-03-02 08:00:00	4.14	65.39	0.55	7.38	11.11	1.71	0.03
SQU-DS	2026-03-02 08:15:00	4.14	65.63	0.55	7.37	11.16	2.03	0.03
SQU-DS	2026-03-02 08:30:00	4.17	66.79	0.55	7.34	11.20	1.86	0.03
SQU-DS	2026-03-02 08:45:00	4.18	66.51	0.55	7.37	11.13	1.99	0.03
SQU-DS	2026-03-02 09:00:00	4.19	66.30	0.55	7.37	11.11	1.81	0.03
SQU-DS	2026-03-02 09:15:00	4.23	65.76	0.55	7.34	11.13	2.22	0.03
SQU-DS	2026-03-02 09:30:00	4.29	65.45	0.55	7.30	11.23	2.09	0.03
SQU-DS	2026-03-02 09:45:00	4.54	53.36	0.55	7.32	11.58	1.27	0.02
SQU-DS	2026-03-02 10:00:00	4.70	0.09	0.55	7.32	11.81	0.08	0.00
SQU-DS	2026-03-02 10:15:00	4.61	0.09	0.55	7.30	11.88	0.06	0.00
SQU-DS	2026-03-02 10:30:00	4.64	0.09	0.55	7.29	11.90	0.00	0.00
SQU-DS	2026-03-02 10:45:00	4.74	0.09	0.55	7.28	11.88	0.00	0.00
SQU-DS	2026-03-02 11:00:00	4.94	0.09	0.55	7.27	11.83	0.00	0.00
SQU-DS	2026-03-02 11:15:00	5.08	0.09	0.55	7.26	11.79	0.00	0.00
SQU-DS	2026-03-02 11:30:00	5.16	0.09	0.55	7.25	11.76	0.02	0.00
SQU-DS	2026-03-02 11:45:00	5.31	0.09	0.55	7.24	11.72	0.00	0.00
SQU-DS	2026-03-02 12:00:00	5.50	0.09	0.55	7.23	11.66	0.00	0.00
SQU-DS	2026-03-02 12:15:00	5.79	0.09	0.55	7.22	11.58	0.00	0.00
SQU-DS	2026-03-02 12:30:00	6.05	0.09	0.55	7.21	11.50	0.00	0.00
SQU-DS	2026-03-02 12:45:00	6.28	0.09	0.55	7.19	11.42	0.01	0.00
SQU-DS	2026-03-02 13:00:00	6.51	0.08	0.55	7.18	11.35	0.00	0.00
SQU-DS	2026-03-02 13:15:00	6.70	0.08	0.55	7.16	11.29	0.00	0.00
SQU-DS	2026-03-02 13:30:00	5.66	65.65	0.54	7.31	11.40	4.19	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-02 13:45:00	5.67	65.26	0.54	7.32	11.32	1.28	0.03
SQU-DS	2026-03-02 14:00:00	5.73	65.23	0.54	7.36	11.22	0.76	0.03
SQU-DS	2026-03-02 14:15:00	5.79	65.37	0.54	7.34	11.14	0.85	0.03
SQU-DS	2026-03-02 14:30:00	5.86	65.33	0.54	7.36	11.18	0.85	0.03
SQU-DS	2026-03-02 14:45:00	5.92	65.36	0.54	7.37	11.23	0.71	0.03
SQU-DS	2026-03-02 15:00:00	5.96	65.28	0.54	7.38	11.17	0.66	0.03
SQU-DS	2026-03-02 15:15:00	5.97	65.14	0.54	7.37	11.12	0.71	0.03
SQU-DS	2026-03-02 15:30:00	5.97	64.79	0.54	7.38	11.12	0.98	0.03
SQU-DS	2026-03-02 15:45:00	5.96	64.58	0.54	7.39	11.18	0.75	0.03
SQU-DS	2026-03-02 16:00:00	5.97	64.39	0.54	7.39	11.15	0.64	0.03
SQU-DS	2026-03-02 16:15:00	5.94	64.19	0.54	7.40	11.14	0.75	0.03
SQU-DS	2026-03-02 16:30:00	5.90	64.11	0.54	7.41	11.17	0.89	0.03
SQU-DS	2026-03-02 16:45:00	5.85	64.01	0.54	7.43	11.17	1.09	0.03
SQU-DS	2026-03-02 17:00:00	5.77	63.80	0.54	7.43	11.15	0.84	0.03
SQU-DS	2026-03-02 17:15:00	5.68	64.79	0.54	7.42	11.19	0.83	0.03
SQU-DS	2026-03-02 17:30:00	5.59	65.84	0.54	7.42	11.21	0.74	0.03
SQU-DS	2026-03-02 17:45:00	5.56	70.30	0.54	7.41	11.19	0.74	0.03
SQU-DS	2026-03-02 18:00:00	5.48	70.72	0.54	7.41	11.14	0.99	0.03
SQU-DS	2026-03-02 18:15:00	5.39	70.44	0.54	7.41	11.03	0.98	0.03
SQU-DS	2026-03-02 18:30:00	5.29	69.70	0.54	7.39	11.03	0.75	0.03
SQU-DS	2026-03-02 18:45:00	5.22	68.72	0.54	7.39	11.00	1.17	0.03
SQU-DS	2026-03-02 19:00:00	5.16	67.76	0.54	7.39	10.99	1.41	0.03
SQU-DS	2026-03-02 19:15:00	5.07	66.21	0.55	7.32	11.09	2.06	0.03
SQU-DS	2026-03-02 19:30:00	5.02	65.28	0.54	7.35	11.20	5.72	0.03
SQU-DS	2026-03-02 19:45:00	5.14	55.83	0.55	7.34	11.45	1.18	0.02
SQU-DS	2026-03-02 20:00:00	4.98	47.92	0.55	7.31	11.66	0.72	0.02
SQU-DS	2026-03-02 20:15:00	4.95	6.94	0.55	7.29	11.71	0.72	0.00
SQU-DS	2026-03-02 20:30:00	4.87	14.92	0.55	7.27	11.78	0.64	0.01
SQU-DS	2026-03-02 20:45:00	5.06	13.46	0.56	7.26	11.70	0.80	0.00
SQU-DS	2026-03-02 21:00:00	5.00	20.80	0.56	7.26	11.71	0.94	0.01
SQU-DS	2026-03-02 21:15:00	4.81	12.08	0.56	7.25	11.81	0.83	0.00
SQU-DS	2026-03-02 21:30:00	4.78	58.90	0.56	7.24	11.79	1.05	0.03
SQU-DS	2026-03-02 21:45:00	4.88	56.23	0.56	7.23	11.70	1.34	0.02
SQU-DS	2026-03-02 22:00:00	4.83	58.15	0.56	7.22	11.76	1.60	0.03
SQU-DS	2026-03-02 22:15:00	4.76	39.98	0.56	7.22	11.76	1.66	0.02
SQU-DS	2026-03-02 22:30:00	4.78	34.54	0.56	7.21	11.65	1.29	0.01
SQU-DS	2026-03-02 22:45:00	4.86	50.45	0.56	7.21	11.65	1.08	0.02
SQU-DS	2026-03-02 23:00:00	4.75	56.26	0.56	7.20	11.66	0.93	0.02
SQU-DS	2026-03-02 23:15:00	4.70	36.57	0.56	7.20	11.72	2.73	0.02
SQU-DS	2026-03-02 23:30:00	4.71	47.81	0.56	7.20	11.74	0.92	0.02
SQU-DS	2026-03-02 23:45:00	4.74	61.44	0.56	7.17	11.68	3.77	0.03
SQU-DS	2026-03-03 00:00:00	4.77	35.06	0.56	7.17	11.68	1.07	0.01
SQU-DS	2026-03-03 00:15:00	4.71	26.90	0.56	7.16	11.72	0.97	0.01
SQU-DS	2026-03-03 00:30:00	4.68	52.67	0.56	7.15	11.74	2.25	0.02
SQU-DS	2026-03-03 00:45:00	4.69	57.46	0.56	7.14	11.69	1.04	0.03
SQU-DS	2026-03-03 01:00:00	4.68	49.48	0.56	7.12	11.70	1.07	0.02
SQU-DS	2026-03-03 01:15:00	4.70	40.23	0.56	7.11	11.71	1.24	0.02
SQU-DS	2026-03-03 01:30:00	4.70	61.99	0.56	7.09	11.70	3.43	0.03
SQU-DS	2026-03-03 01:45:00	4.73	55.21	0.56	7.09	11.69	1.31	0.02
SQU-DS	2026-03-03 02:00:00	4.62	49.36	0.56	7.08	11.74	1.70	0.02
SQU-DS	2026-03-03 02:15:00	4.59	55.42	0.56	7.06	11.68	1.14	0.02
SQU-DS	2026-03-03 02:30:00	4.62	56.79	0.56	7.04	11.68	157.41	0.03
SQU-DS	2026-03-03 02:45:00	4.58	62.96	0.56	7.02	11.56	213.62	0.03
SQU-DS	2026-03-03 03:00:00	4.54	64.18	0.55	7.38	11.46	0.89	0.03
SQU-DS	2026-03-03 03:15:00	4.52	64.09	0.55	7.39	11.38	0.86	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-03 03:30:00	4.51	63.84	0.55	7.39	11.33	0.77	0.03
SQU-DS	2026-03-03 03:45:00	4.48	63.04	0.55	7.37	11.38	0.55	0.03
SQU-DS	2026-03-03 04:00:00	4.46	62.36	0.55	7.38	11.38	0.83	0.03
SQU-DS	2026-03-03 04:15:00	4.44	61.86	0.55	7.40	11.42	0.61	0.03
SQU-DS	2026-03-03 04:30:00	4.43	61.58	0.55	7.41	11.35	0.57	0.03
SQU-DS	2026-03-03 04:45:00	4.41	61.42	0.55	7.42	11.28	0.80	0.03
SQU-DS	2026-03-03 05:00:00	4.40	61.15	0.55	7.42	11.29	0.61	0.03
SQU-DS	2026-03-03 05:15:00	4.37	60.52	0.55	7.43	11.36	1.39	0.03
SQU-DS	2026-03-03 05:30:00	4.35	60.23	0.55	7.43	11.36	2.05	0.03
SQU-DS	2026-03-03 05:45:00	4.34	60.05	0.55	7.43	11.37	3.23	0.03
SQU-DS	2026-03-03 06:00:00	4.32	59.78	0.55	7.42	11.46	7.07	0.03
SQU-DS	2026-03-03 06:15:00	4.31	59.47	0.55	7.43	11.45	6.12	0.03
SQU-DS	2026-03-03 06:30:00	4.29	59.24	0.55	7.44	11.46	5.01	0.03
SQU-DS	2026-03-03 06:45:00	4.28	59.24	0.55	7.43	11.45	6.05	0.03
SQU-DS	2026-03-03 07:00:00	4.28	59.79	0.55	7.43	11.44	6.61	0.03
SQU-DS	2026-03-03 07:15:00	4.28	60.05	0.55	7.43	11.40	7.02	0.03
SQU-DS	2026-03-03 07:30:00	4.30	61.24	0.55	7.43	11.36	7.53	0.03
SQU-DS	2026-03-03 07:45:00	4.30	61.82	0.55	7.42	11.28	6.70	0.03
SQU-DS	2026-03-03 08:00:00	4.33	63.71	0.55	7.42	11.24	7.36	0.03
SQU-DS	2026-03-03 08:15:00	4.34	63.97	0.55	7.42	11.20	4.92	0.03
SQU-DS	2026-03-03 08:30:00	4.35	64.52	0.55	7.40	11.23	6.66	0.03
SQU-DS	2026-03-03 08:45:00	4.35	64.22	0.55	7.41	11.19	6.23	0.03
SQU-DS	2026-03-03 09:00:00	4.36	63.96	0.55	7.41	11.31	6.62	0.03
SQU-DS	2026-03-03 09:15:00	4.36	63.76	0.55	7.37	11.33	5.33	0.03
SQU-DS	2026-03-03 09:30:00	4.35	63.24	0.55	7.42	11.29	5.01	0.03
SQU-DS	2026-03-03 09:45:00	4.35	62.76	0.55	7.39	11.33	4.78	0.03
SQU-DS	2026-03-03 10:00:00	4.36	62.71	0.55	7.40	11.35	5.35	0.03
SQU-DS	2026-03-03 10:15:00	4.37	62.58	0.55	7.39	11.43	5.85	0.03
SQU-DS	2026-03-03 10:30:00	4.39	62.26	0.55	7.38	11.43	6.67	0.03
SQU-DS	2026-03-03 10:45:00	4.39	62.16	0.55	7.34	11.54	10.03	0.03
SQU-DS	2026-03-03 11:00:00	4.47	62.31	0.55	7.31	11.53	5.96	0.03
SQU-DS	2026-03-03 11:15:00	4.46	62.28	0.55	7.35	11.59	4.93	0.03
SQU-DS	2026-03-03 11:30:00	4.49	62.33	0.55	7.33	11.58	5.13	0.03
SQU-DS	2026-03-03 11:45:00	4.52	62.40	0.55	7.34	11.63	6.21	0.03
SQU-DS	2026-03-03 12:00:00	4.57	62.56	0.55	7.38	11.64	7.02	0.03
SQU-DS	2026-03-03 12:15:00	4.59	62.55	0.55	7.36	11.64	5.30	0.03
SQU-DS	2026-03-03 12:30:00	4.63	62.63	0.54	7.35	11.64	5.51	0.03
SQU-DS	2026-03-03 12:45:00	4.67	62.71	0.54	7.39	11.66	5.69	0.03
SQU-DS	2026-03-03 13:00:00	4.73	62.72	0.54	7.38	11.63	5.36	0.03
SQU-DS	2026-03-03 13:15:00	4.78	62.75	0.54	7.35	11.64	5.38	0.03
SQU-DS	2026-03-03 13:30:00	4.74	62.80	0.54	7.38	11.66	4.96	0.03
SQU-DS	2026-03-03 13:45:00	4.75	62.83	0.54	7.35	11.65	4.83	0.03
SQU-DS	2026-03-03 14:00:00	4.73	62.83	0.54	7.36	11.61	4.97	0.03
SQU-DS	2026-03-03 14:15:00	4.75	62.91	0.54	7.38	11.51	5.10	0.03
SQU-DS	2026-03-03 14:30:00	4.75	62.86	0.54	7.40	11.56	4.93	0.03
SQU-DS	2026-03-03 14:45:00	4.73	62.74	0.54	7.41	11.53	5.13	0.03
SQU-DS	2026-03-03 15:00:00	4.71	62.60	0.54	7.41	11.51	4.90	0.03
SQU-DS	2026-03-03 15:15:00	4.71	62.46	0.54	7.41	11.54	4.83	0.03
SQU-DS	2026-03-03 15:30:00	4.70	61.92	0.54	7.43	11.53	4.94	0.03
SQU-DS	2026-03-03 15:45:00	4.71	61.69	0.54	7.44	11.57	5.39	0.03
SQU-DS	2026-03-03 16:00:00	4.70	61.37	0.54	7.44	11.63	5.13	0.03
SQU-DS	2026-03-03 16:15:00	4.70	61.12	0.54	7.46	11.57	5.23	0.03
SQU-DS	2026-03-03 16:30:00	4.69	60.89	0.54	7.46	11.50	5.21	0.03
SQU-DS	2026-03-03 16:45:00	4.68	60.81	0.54	7.45	11.50	5.18	0.03
SQU-DS	2026-03-03 17:00:00	4.67	60.58	0.54	7.47	11.48	5.32	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-03 17:15:00	4.66	60.62	0.54	7.47	11.46	6.12	0.03
SQU-DS	2026-03-03 17:30:00	4.65	60.62	0.54	7.48	11.44	5.89	0.03
SQU-DS	2026-03-03 17:45:00	4.64	60.70	0.54	7.47	11.52	6.11	0.03
SQU-DS	2026-03-03 18:00:00	4.64	60.98	0.54	7.48	11.49	6.49	0.03
SQU-DS	2026-03-03 18:15:00	4.67	62.81	0.54	7.48	11.46	6.24	0.03
SQU-DS	2026-03-03 18:30:00	4.69	64.22	0.54	7.47	11.44	6.34	0.03
SQU-DS	2026-03-03 18:45:00	4.69	64.81	0.54	7.45	11.37	5.79	0.03
SQU-DS	2026-03-03 19:00:00	4.66	63.78	0.54	7.45	11.37	5.63	0.03
SQU-DS	2026-03-03 19:15:00	4.65	64.23	0.54	7.46	11.38	5.92	0.03
SQU-DS	2026-03-03 19:30:00	4.63	63.75	0.55	7.42	11.33	6.33	0.03
SQU-DS	2026-03-03 19:45:00	4.62	62.99	0.54	7.45	11.36	6.54	0.03
SQU-DS	2026-03-03 20:00:00	4.62	62.65	0.54	7.45	11.31	5.80	0.03
SQU-DS	2026-03-03 20:15:00	4.61	61.89	0.55	7.44	11.31	6.11	0.03
SQU-DS	2026-03-03 20:30:00	4.60	61.47	0.55	7.42	11.31	5.80	0.03
SQU-DS	2026-03-03 20:45:00	4.60	61.17	0.55	7.41	11.32	6.69	0.03
SQU-DS	2026-03-03 21:00:00	4.59	60.82	0.55	7.40	11.37	6.40	0.03
SQU-DS	2026-03-03 21:15:00	4.60	60.59	0.55	7.41	11.39	6.63	0.03
SQU-DS	2026-03-03 21:30:00	4.61	60.46	0.55	7.39	11.38	6.38	0.03
SQU-DS	2026-03-03 21:45:00	4.62	60.24	0.55	7.41	11.35	6.45	0.03
SQU-DS	2026-03-03 22:00:00	4.59	59.90	0.55	7.40	11.38	6.78	0.03
SQU-DS	2026-03-03 22:15:00	4.58	59.82	0.55	7.35	11.41	7.66	0.03
SQU-DS	2026-03-03 22:30:00	4.58	59.58	0.55	7.39	11.40	6.93	0.03
SQU-DS	2026-03-03 22:45:00	4.58	59.42	0.55	7.41	11.40	6.99	0.03
SQU-DS	2026-03-03 23:00:00	4.56	59.16	0.55	7.40	11.39	7.96	0.03
SQU-DS	2026-03-03 23:15:00	4.58	59.01	0.55	7.41	11.35	7.79	0.03
SQU-DS	2026-03-03 23:30:00	4.55	58.61	0.55	7.39	11.37	7.25	0.03
SQU-DS	2026-03-03 23:45:00	4.53	58.26	0.55	7.40	11.38	7.40	0.03
SQU-DS	2026-03-04 00:00:00	4.52	58.04	0.55	7.40	11.40	7.28	0.03
SQU-DS	2026-03-04 00:15:00	4.51	57.61	0.55	7.40	11.44	7.49	0.03
SQU-DS	2026-03-04 00:30:00	4.49	57.09	0.55	7.40	11.46	7.59	0.03
SQU-DS	2026-03-04 00:45:00	4.49	56.82	0.55	7.41	11.43	8.04	0.03
SQU-DS	2026-03-04 01:00:00	4.46	56.48	0.55	7.40	11.48	8.20	0.03
SQU-DS	2026-03-04 01:15:00	4.44	56.12	0.55	7.40	11.51	8.79	0.02
SQU-DS	2026-03-04 01:30:00	4.43	55.69	0.55	7.40	11.50	9.24	0.02
SQU-DS	2026-03-04 01:45:00	4.42	55.57	0.55	7.39	11.46	13.18	0.02
SQU-DS	2026-03-04 02:00:00	4.38	54.50	0.55	7.40	11.51	8.30	0.02
SQU-DS	2026-03-04 02:15:00	4.37	54.38	0.55	7.43	11.54	9.24	0.02
SQU-DS	2026-03-04 02:30:00	4.36	54.23	0.55	7.41	11.54	11.21	0.02
SQU-DS	2026-03-04 02:45:00	4.34	53.72	0.55	7.41	11.53	10.29	0.02
SQU-DS	2026-03-04 03:00:00	4.31	53.18	0.55	7.40	11.56	10.76	0.02
SQU-DS	2026-03-04 03:15:00	4.29	52.52	0.55	7.43	11.56	9.03	0.02
SQU-DS	2026-03-04 03:30:00	4.27	52.14	0.55	7.42	11.55	10.06	0.02
SQU-DS	2026-03-04 03:45:00	4.25	51.72	0.55	7.40	11.61	10.07	0.02
SQU-DS	2026-03-04 04:00:00	4.22	51.07	0.55	7.43	11.60	9.55	0.02
SQU-DS	2026-03-04 04:15:00	4.20	50.54	0.55	7.46	11.55	10.68	0.02
SQU-DS	2026-03-04 04:30:00	4.16	49.67	0.55	7.41	11.54	10.20	0.02
SQU-DS	2026-03-04 04:45:00	4.13	49.15	0.55	7.45	11.52	9.69	0.02
SQU-DS	2026-03-04 05:00:00	4.11	48.65	0.55	7.46	11.51	10.35	0.02
SQU-DS	2026-03-04 05:15:00	4.09	48.25	0.55	7.47	11.53	9.14	0.02
SQU-DS	2026-03-04 05:30:00	4.06	47.75	0.55	7.47	11.54	11.40	0.02
SQU-DS	2026-03-04 05:45:00	4.03	47.01	0.55	7.46	11.55	21.91	0.02
SQU-DS	2026-03-04 06:00:00	4.00	46.77	0.55	7.47	11.59	29.90	0.02
SQU-DS	2026-03-04 06:15:00	3.98	46.46	0.55	7.46	11.61	87.23	0.02
SQU-DS	2026-03-04 06:30:00	3.98	46.68	0.55	7.45	11.68	73.57	0.02
SQU-DS	2026-03-04 06:45:00	3.97	46.37	0.55	7.47	11.71	68.26	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-04 07:00:00	3.97	46.52	0.55	7.49	11.60	70.45	0.02
SQU-DS	2026-03-04 07:15:00	3.98	47.01	0.55	7.48	11.56	66.13	0.02
SQU-DS	2026-03-04 07:30:00	3.99	47.63	0.55	7.48	11.46	65.04	0.02
SQU-DS	2026-03-04 07:45:00	3.99	46.78	0.55	7.47	11.43	64.93	0.02
SQU-DS	2026-03-04 08:00:00	3.99	46.71	0.55	7.45	11.42	17.84	0.02
SQU-DS	2026-03-04 08:15:00	3.99	46.51	0.55	7.47	11.41	18.91	0.02
SQU-DS	2026-03-04 08:30:00	4.00	46.00	0.55	7.45	11.46	14.40	0.02
SQU-DS	2026-03-04 08:45:00	4.02	46.31	0.55	7.45	11.45	13.61	0.02
SQU-DS	2026-03-04 09:00:00	4.04	46.29	0.55	7.45	11.49	13.78	0.02
SQU-DS	2026-03-04 09:15:00	4.06	46.61	0.55	7.45	11.50	13.24	0.02
SQU-DS	2026-03-04 09:30:00	4.08	46.45	0.55	7.41	11.60	15.75	0.02
SQU-DS	2026-03-04 09:45:00	4.12	46.56	0.55	7.41	11.62	14.92	0.02
SQU-DS	2026-03-04 10:00:00	4.16	46.79	0.55	7.43	11.56	15.95	0.02
SQU-DS	2026-03-04 10:15:00	4.18	46.55	0.55	7.43	11.60	14.81	0.02
SQU-DS	2026-03-04 10:30:00	4.22	46.80	0.54	7.43	11.64	18.49	0.02
SQU-DS	2026-03-04 10:45:00	4.25	46.71	0.54	7.42	11.63	12.87	0.02
SQU-DS	2026-03-04 11:00:00	4.28	46.65	0.54	7.44	11.55	13.04	0.02
SQU-DS	2026-03-04 11:15:00	4.31	46.72	0.54	7.45	11.51	13.56	0.02
SQU-DS	2026-03-04 11:30:00	4.35	46.62	0.54	7.43	11.49	14.04	0.02
SQU-DS	2026-03-04 11:45:00	4.38	46.48	0.54	7.41	11.53	12.81	0.02
SQU-DS	2026-03-04 12:00:00	4.42	46.40	0.54	7.43	11.52	12.90	0.02
SQU-DS	2026-03-04 12:15:00	4.46	46.47	0.54	7.41	11.56	13.29	0.02
SQU-DS	2026-03-04 12:30:00	4.51	46.65	0.54	7.43	11.52	12.73	0.02
SQU-DS	2026-03-04 12:45:00	4.56	46.57	0.54	7.41	11.52	13.32	0.02
SQU-DS	2026-03-04 13:00:00	4.60	46.45	0.54	7.39	11.54	13.08	0.02
SQU-DS	2026-03-04 13:15:00	4.63	46.24	0.54	7.41	11.55	13.40	0.02
SQU-DS	2026-03-04 13:30:00	4.67	46.30	0.54	7.41	11.53	12.99	0.02
SQU-DS	2026-03-04 13:45:00	4.72	46.52	0.54	7.39	11.45	13.06	0.02
SQU-DS	2026-03-04 14:00:00	4.76	46.38	0.54	7.41	11.50	13.54	0.02
SQU-DS	2026-03-04 14:15:00	4.80	46.45	0.54	7.40	11.50	12.95	0.02
SQU-DS	2026-03-04 14:30:00	4.85	46.67	0.54	7.42	11.48	12.69	0.02
SQU-DS	2026-03-04 14:45:00	4.92	46.73	0.54	7.41	11.50	13.13	0.02
SQU-DS	2026-03-04 15:00:00	4.97	46.65	0.54	7.42	11.49	12.79	0.02
SQU-DS	2026-03-04 15:15:00	5.03	46.77	0.54	7.41	11.46	12.49	0.02
SQU-DS	2026-03-04 15:30:00	5.07	46.78	0.54	7.42	11.45	12.06	0.02
SQU-DS	2026-03-04 15:45:00	5.08	46.93	0.54	7.42	11.37	12.39	0.02
SQU-DS	2026-03-04 16:00:00	5.03	46.69	0.54	7.39	11.45	12.87	0.02
SQU-DS	2026-03-04 16:15:00	5.01	46.60	0.54	7.40	11.47	12.35	0.02
SQU-DS	2026-03-04 16:30:00	4.97	46.45	0.54	7.38	11.56	14.16	0.02
SQU-DS	2026-03-04 16:45:00	4.93	46.41	0.54	7.42	11.47	13.84	0.02
SQU-DS	2026-03-04 17:00:00	4.88	45.94	0.54	7.43	11.48	12.82	0.02
SQU-DS	2026-03-04 17:15:00	4.86	45.69	0.54	7.44	11.40	12.75	0.02
SQU-DS	2026-03-04 17:30:00	4.83	45.84	0.54	7.43	11.41	13.31	0.02
SQU-DS	2026-03-04 17:45:00	4.82	45.92	0.54	7.46	11.34	12.95	0.02
SQU-DS	2026-03-04 18:00:00	4.81	46.05	0.54	7.44	11.32	13.24	0.02
SQU-DS	2026-03-04 18:15:00	4.79	45.93	0.54	7.45	11.25	12.95	0.02
SQU-DS	2026-03-04 18:30:00	4.78	46.05	0.55	7.45	11.20	12.99	0.02
SQU-DS	2026-03-04 18:45:00	4.78	46.84	0.55	7.42	11.22	13.63	0.02
SQU-DS	2026-03-04 19:00:00	4.80	48.20	0.55	7.43	11.25	13.64	0.02
SQU-DS	2026-03-04 19:15:00	4.81	48.13	0.55	7.42	11.19	13.79	0.02
SQU-DS	2026-03-04 19:30:00	4.81	47.98	0.55	7.41	11.20	14.07	0.02
SQU-DS	2026-03-04 19:45:00	4.83	48.31	0.55	7.40	11.16	14.21	0.02
SQU-DS	2026-03-04 20:00:00	4.84	48.44	0.55	7.40	11.27	13.78	0.02
SQU-DS	2026-03-04 20:15:00	4.86	48.22	0.55	7.39	11.26	13.38	0.02
SQU-DS	2026-03-04 20:30:00	4.88	48.25	0.55	7.36	11.28	14.24	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-04 20:45:00	4.91	48.42	0.55	7.36	11.28	12.87	0.02
SQU-DS	2026-03-04 21:00:00	4.92	48.34	0.55	7.37	11.19	13.29	0.02
SQU-DS	2026-03-04 21:15:00	4.95	48.55	0.55	7.37	11.12	12.80	0.02
SQU-DS	2026-03-04 21:30:00	4.96	48.60	0.55	7.36	11.12	12.40	0.02
SQU-DS	2026-03-04 21:45:00	4.95	48.49	0.55	7.33	11.14	12.92	0.02
SQU-DS	2026-03-04 22:00:00	4.94	48.47	0.55	7.33	11.16	12.78	0.02
SQU-DS	2026-03-04 22:15:00	4.95	48.62	0.55	7.32	11.16	13.04	0.02
SQU-DS	2026-03-04 22:30:00	4.94	48.65	0.55	7.33	11.19	14.96	0.02
SQU-DS	2026-03-04 22:45:00	4.95	48.93	0.55	7.32	11.18	13.13	0.02
SQU-DS	2026-03-04 23:00:00	4.94	48.81	0.55	7.32	11.14	13.30	0.02
SQU-DS	2026-03-04 23:15:00	4.93	48.98	0.55	7.33	11.12	12.29	0.02
SQU-DS	2026-03-04 23:30:00	4.95	49.08	0.55	7.33	11.07	12.28	0.02
SQU-DS	2026-03-04 23:45:00	4.92	48.77	0.55	7.30	11.14	12.14	0.02
SQU-DS	2026-03-05 00:00:00	4.94	49.02	0.55	7.32	11.08	12.03	0.02
SQU-DS	2026-03-05 00:15:00	4.96	49.32	0.55	7.30	11.01	12.01	0.02
SQU-DS	2026-03-05 00:30:00	4.95	48.79	0.55	7.29	11.06	12.15	0.02
SQU-DS	2026-03-05 00:45:00	4.96	49.03	0.55	7.29	11.07	12.15	0.02
SQU-DS	2026-03-05 01:00:00	4.94	48.74	0.55	7.29	11.12	12.09	0.02
SQU-DS	2026-03-05 01:15:00	4.96	48.93	0.55	7.29	11.06	11.95	0.02
SQU-DS	2026-03-05 01:30:00	5.10	50.25	0.55	7.26	10.86	12.53	0.02
SQU-DS	2026-03-05 01:45:00	4.98	48.78	0.56	7.23	10.87	12.27	0.02
SQU-DS	2026-03-05 02:00:00	4.92	48.30	0.55	7.26	11.06	12.55	0.02
SQU-DS	2026-03-05 02:15:00	4.91	48.19	0.56	7.23	11.14	12.73	0.02
SQU-DS	2026-03-05 02:30:00	4.89	48.04	0.56	7.27	11.21	13.50	0.02
SQU-DS	2026-03-05 02:45:00	4.97	48.71	0.55	7.30	11.06	12.32	0.02
SQU-DS	2026-03-05 03:00:00	4.94	48.66	0.55	7.29	11.02	12.47	0.02
SQU-DS	2026-03-05 03:15:00	4.86	48.36	0.56	7.23	11.15	12.04	0.02
SQU-DS	2026-03-05 03:30:00	4.84	48.30	0.56	7.27	11.23	12.59	0.02
SQU-DS	2026-03-05 03:45:00	4.82	48.30	0.55	7.29	11.22	12.20	0.02
SQU-DS	2026-03-05 04:00:00	4.80	48.10	0.55	7.31	11.15	12.28	0.02
SQU-DS	2026-03-05 04:15:00	4.78	47.95	0.55	7.28	11.20	12.42	0.02
SQU-DS	2026-03-05 04:30:00	4.75	47.85	0.55	7.30	11.22	12.42	0.02
SQU-DS	2026-03-05 04:45:00	4.72	47.40	0.55	7.29	11.22	11.72	0.02
SQU-DS	2026-03-05 05:00:00	4.69	47.08	0.55	7.33	11.19	12.32	0.02
SQU-DS	2026-03-05 05:15:00	4.68	46.97	0.55	7.36	11.13	12.37	0.02
SQU-DS	2026-03-05 05:30:00	4.64	46.85	0.55	7.35	11.10	14.89	0.02
SQU-DS	2026-03-05 05:45:00	4.62	46.74	0.55	7.37	11.05	11.88	0.02
SQU-DS	2026-03-05 06:00:00	4.61	46.59	0.55	7.37	11.03	11.26	0.02
SQU-DS	2026-03-05 06:15:00	4.59	46.40	0.55	7.37	11.03	17.96	0.02
SQU-DS	2026-03-05 06:30:00	4.55	46.20	0.55	7.38	11.08	14.39	0.02
SQU-DS	2026-03-05 06:45:00	4.51	46.08	0.55	7.38	11.09	19.76	0.02
SQU-DS	2026-03-05 07:00:00	4.48	45.92	0.55	7.39	11.09	20.04	0.02
SQU-DS	2026-03-05 07:15:00	4.47	46.09	0.55	7.38	11.12	16.51	0.02
SQU-DS	2026-03-05 07:30:00	4.44	46.22	0.55	7.38	11.14	14.96	0.02
SQU-DS	2026-03-05 07:45:00	4.41	46.75	0.55	7.37	11.15	18.99	0.02
SQU-DS	2026-03-05 08:00:00	4.44	48.61	0.55	7.37	11.13	22.87	0.02
SQU-DS	2026-03-05 08:15:00	4.47	49.76	0.55	7.36	11.08	19.94	0.02
SQU-DS	2026-03-05 08:30:00	4.48	55.82	0.55	7.37	11.07	17.71	0.02
SQU-DS	2026-03-05 08:45:00	4.51	49.54	0.55	7.37	11.11	17.81	0.02
SQU-DS	2026-03-05 09:00:00	4.56	49.39	0.55	7.37	11.12	16.93	0.02
SQU-DS	2026-03-05 09:15:00	4.63	48.89	0.55	7.36	11.27	17.30	0.02
SQU-DS	2026-03-05 09:30:00	4.71	48.76	0.55	7.37	11.31	18.02	0.02
SQU-DS	2026-03-05 09:45:00	4.78	48.81	0.55	7.36	11.36	20.18	0.02
SQU-DS	2026-03-05 10:00:00	4.86	49.03	0.55	7.35	11.39	18.78	0.02
SQU-DS	2026-03-05 10:15:00	4.91	49.13	0.55	7.37	11.33	18.89	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-05 10:30:00	4.98	49.21	0.55	7.38	11.37	18.73	0.02
SQU-DS	2026-03-05 10:45:00	5.05	49.37	0.55	7.37	11.32	19.12	0.02
SQU-DS	2026-03-05 11:00:00	5.12	49.55	0.55	7.39	11.27	18.18	0.02
SQU-DS	2026-03-05 11:15:00	5.19	49.74	0.55	7.37	11.26	19.03	0.02
SQU-DS	2026-03-05 11:30:00	5.23	51.67	0.55	7.39	11.26	19.06	0.02
SQU-DS	2026-03-05 11:45:00	5.23	50.11	0.55	7.35	11.29	20.67	0.02
SQU-DS	2026-03-05 12:00:00	5.24	50.10	0.55	7.37	11.28	19.84	0.02
SQU-DS	2026-03-05 12:15:00	5.24	50.23	0.55	7.36	11.31	21.11	0.02
SQU-DS	2026-03-05 12:30:00	5.28	50.38	0.55	7.36	11.27	18.94	0.02
SQU-DS	2026-03-05 12:45:00	5.32	50.32	0.55	7.36	11.26	20.18	0.02
SQU-DS	2026-03-05 13:00:00	5.41	50.43	0.55	7.38	11.25	18.89	0.02
SQU-DS	2026-03-05 13:15:00	5.41	50.47	0.55	7.36	11.20	18.57	0.02
SQU-DS	2026-03-05 13:30:00	5.41	50.41	0.55	7.36	11.18	18.08	0.02
SQU-DS	2026-03-05 13:45:00	5.42	50.61	0.55	7.38	11.19	19.01	0.02
SQU-DS	2026-03-05 14:00:00	5.43	50.50	0.55	7.35	11.23	18.30	0.02
SQU-DS	2026-03-05 14:15:00	5.49	50.75	0.55	7.36	11.21	16.97	0.02
SQU-DS	2026-03-05 14:30:00	5.52	50.63	0.55	7.33	11.24	17.75	0.02
SQU-DS	2026-03-05 14:45:00	5.55	50.70	0.55	7.38	11.19	17.33	0.02
SQU-DS	2026-03-05 15:00:00	5.50	50.72	0.55	7.35	11.20	17.24	0.02
SQU-DS	2026-03-05 15:15:00	5.46	50.81	0.55	7.35	11.22	18.76	0.02
SQU-DS	2026-03-05 15:30:00	5.46	50.88	0.55	7.36	11.21	17.18	0.02
SQU-DS	2026-03-05 15:45:00	5.48	51.13	0.55	7.38	11.11	17.68	0.02
SQU-DS	2026-03-05 16:00:00	5.43	51.37	0.55	7.35	11.12	16.37	0.02
SQU-DS	2026-03-05 16:15:00	5.41	51.25	0.55	7.36	11.14	18.64	0.02
SQU-DS	2026-03-05 16:30:00	5.39	51.23	0.55	7.35	11.16	18.54	0.02
SQU-DS	2026-03-05 16:45:00	5.38	51.21	0.55	7.38	11.11	18.89	0.02
SQU-DS	2026-03-05 17:00:00	5.39	51.16	0.55	7.35	11.13	20.60	0.02
SQU-DS	2026-03-05 17:15:00	5.33	51.04	0.55	7.35	11.17	17.49	0.02
SQU-DS	2026-03-05 17:30:00	5.29	50.90	0.55	7.36	11.24	18.16	0.02
SQU-DS	2026-03-05 17:45:00	5.29	50.74	0.55	7.39	11.22	18.35	0.02
SQU-DS	2026-03-05 18:00:00	5.29	50.90	0.55	7.34	11.21	19.03	0.02
SQU-DS	2026-03-05 18:15:00	5.28	50.77	0.55	7.42	11.14	17.54	0.02
SQU-DS	2026-03-05 18:30:00	5.26	50.35	0.55	7.41	11.12	17.60	0.02
SQU-DS	2026-03-05 18:45:00	5.24	50.47	0.55	7.40	11.14	17.88	0.02
SQU-DS	2026-03-05 19:00:00	5.23	51.03	0.55	7.42	10.97	17.23	0.02
SQU-DS	2026-03-05 19:15:00	5.23	51.19	0.55	7.41	10.88	18.47	0.02
SQU-DS	2026-03-05 19:30:00	5.22	51.26	0.55	7.41	11.03	17.36	0.02
SQU-DS	2026-03-05 19:45:00	5.22	51.61	0.55	7.42	10.99	17.29	0.02
SQU-DS	2026-03-05 20:00:00	5.21	52.10	0.55	7.42	10.96	17.80	0.02
SQU-DS	2026-03-05 20:15:00	5.23	53.08	0.55	7.41	10.96	20.20	0.02
SQU-DS	2026-03-05 20:30:00	5.26	54.23	0.55	7.41	10.94	18.02	0.02
SQU-DS	2026-03-05 20:45:00	5.28	53.78	0.55	7.40	10.91	17.04	0.02
SQU-DS	2026-03-05 21:00:00	5.28	53.74	0.55	7.41	10.86	17.01	0.02
SQU-DS	2026-03-05 21:15:00	5.32	53.86	0.55	7.37	10.85	16.93	0.02
SQU-DS	2026-03-05 21:30:00	5.34	53.88	0.55	7.38	10.86	18.64	0.02
SQU-DS	2026-03-05 21:45:00	5.36	53.87	0.55	7.38	10.85	18.57	0.02
SQU-DS	2026-03-05 22:00:00	5.39	53.61	0.55	7.39	10.80	17.80	0.02
SQU-DS	2026-03-05 22:15:00	5.40	53.55	0.55	7.37	10.80	18.27	0.02
SQU-DS	2026-03-05 22:30:00	5.43	53.85	0.55	7.34	10.80	18.30	0.02
SQU-DS	2026-03-05 22:45:00	5.44	54.00	0.55	7.34	10.74	18.36	0.02
SQU-DS	2026-03-05 23:00:00	5.45	53.87	0.55	7.27	10.75	16.85	0.02
SQU-DS	2026-03-05 23:15:00	5.50	54.80	0.55	7.27	10.88	16.81	0.02
SQU-DS	2026-03-05 23:30:00	5.45	54.26	0.55	7.31	10.88	21.10	0.02
SQU-DS	2026-03-05 23:45:00	5.44	54.14	0.55	7.31	10.94	20.06	0.02
SQU-DS	2026-03-06 00:00:00	5.45	54.69	0.55	7.28	10.89	20.02	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-06 00:15:00	5.45	54.92	0.56	7.23	10.88	21.58	0.02
SQU-DS	2026-03-06 00:30:00	5.44	54.96	0.55	7.24	10.91	19.21	0.02
SQU-DS	2026-03-06 00:45:00	5.48	55.69	0.56	7.20	10.82	19.24	0.02
SQU-DS	2026-03-06 01:00:00	5.59	56.88	0.56	7.16	10.70	18.99	0.03
SQU-DS	2026-03-06 01:15:00	5.47	55.53	0.56	7.14	10.74	19.22	0.02
SQU-DS	2026-03-06 01:30:00	5.67	56.90	0.56	7.13	10.52	269.19	0.03
SQU-DS	2026-03-06 01:45:00	5.39	54.59	0.56	7.15	10.86	14.07	0.02
SQU-DS	2026-03-06 02:00:00	5.36	54.11	0.56	7.19	10.85	11.21	0.02
SQU-DS	2026-03-06 02:15:00	5.34	53.80	0.56	7.24	10.89	10.05	0.02
SQU-DS	2026-03-06 02:30:00	5.35	53.84	0.56	7.23	10.86	11.63	0.02
SQU-DS	2026-03-06 02:45:00	5.33	53.59	0.55	7.26	10.87	10.46	0.02
SQU-DS	2026-03-06 03:00:00	5.33	53.66	0.55	7.27	10.82	10.24	0.02
SQU-DS	2026-03-06 03:15:00	5.32	53.79	0.55	7.28	10.83	11.78	0.02
SQU-DS	2026-03-06 03:30:00	5.30	53.23	0.55	7.27	10.90	12.54	0.02
SQU-DS	2026-03-06 03:45:00	5.30	53.32	0.55	7.28	10.80	12.26	0.02
SQU-DS	2026-03-06 04:00:00	5.28	53.23	0.55	7.30	10.84	11.29	0.02
SQU-DS	2026-03-06 04:15:00	5.26	53.07	0.55	7.32	10.86	13.26	0.02
SQU-DS	2026-03-06 04:30:00	5.25	52.99	0.55	7.33	10.81	12.11	0.02
SQU-DS	2026-03-06 04:45:00	5.24	52.74	0.55	7.33	10.76	12.70	0.02
SQU-DS	2026-03-06 05:00:00	5.22	52.33	0.55	7.31	10.82	13.36	0.02
SQU-DS	2026-03-06 05:15:00	5.21	51.94	0.55	7.35	10.86	12.12	0.02
SQU-DS	2026-03-06 05:30:00	5.19	51.46	0.55	7.34	10.83	13.11	0.02
SQU-DS	2026-03-06 05:45:00	5.18	50.97	0.55	7.36	10.86	12.16	0.02
SQU-DS	2026-03-06 06:00:00	5.18	50.54	0.55	7.34	10.82	12.38	0.02
SQU-DS	2026-03-06 06:15:00	5.16	50.07	0.55	7.37	10.70	11.93	0.02
SQU-DS	2026-03-06 06:30:00	5.16	49.69	0.55	7.37	10.69	10.89	0.02
SQU-DS	2026-03-06 06:45:00	5.13	49.30	0.55	7.37	10.74	11.47	0.02
SQU-DS	2026-03-06 07:00:00	5.12	49.05	0.55	7.37	10.70	11.61	0.02
SQU-DS	2026-03-06 07:15:00	5.11	48.93	0.55	7.37	10.71	11.48	0.02
SQU-DS	2026-03-06 07:30:00	5.07	48.97	0.55	7.37	10.74	11.71	0.02
SQU-DS	2026-03-06 07:45:00	5.05	49.18	0.55	7.39	10.75	11.88	0.02
SQU-DS	2026-03-06 08:00:00	5.04	49.59	0.55	7.38	10.76	12.18	0.02
SQU-DS	2026-03-06 08:15:00	5.02	50.27	0.55	7.37	10.79	12.40	0.02
SQU-DS	2026-03-06 08:30:00	5.02	51.95	0.55	7.39	10.85	12.95	0.02
SQU-DS	2026-03-06 08:45:00	5.04	53.78	0.55	7.35	10.83	13.34	0.02
SQU-DS	2026-03-06 09:00:00	5.06	54.31	0.55	7.37	10.86	12.35	0.02
SQU-DS	2026-03-06 09:15:00	5.08	54.69	0.55	7.36	10.98	13.14	0.02
SQU-DS	2026-03-06 09:30:00	5.10	54.55	0.55	7.35	11.03	13.06	0.02
SQU-DS	2026-03-06 09:45:00	5.11	53.94	0.55	7.35	11.02	12.03	0.02
SQU-DS	2026-03-06 10:00:00	5.12	53.84	0.55	7.42	11.01	11.72	0.02
SQU-DS	2026-03-06 10:15:00	5.16	54.03	0.55	7.39	11.05	23.88	0.02
SQU-DS	2026-03-06 10:30:00	5.19	54.11	0.55	7.38	10.97	17.01	0.02
SQU-DS	2026-03-06 10:45:00	5.21	54.17	0.55	7.36	11.01	12.91	0.02
SQU-DS	2026-03-06 11:00:00	5.25	54.39	0.55	7.34	11.05	19.96	0.02
SQU-DS	2026-03-06 11:15:00	5.25	54.27	0.55	7.38	11.13	33.72	0.02
SQU-DS	2026-03-06 11:30:00	5.29	54.55	0.55	7.36	11.17	28.96	0.02
SQU-DS	2026-03-06 11:45:00	5.31	54.62	0.55	7.35	11.13	19.96	0.02
SQU-DS	2026-03-06 12:00:00	5.30	54.41	0.55	7.36	11.13	19.09	0.02
SQU-DS	2026-03-06 12:15:00	5.33	54.81	0.55	7.33	11.11	12.50	0.02
SQU-DS	2026-03-06 12:30:00	5.30	54.51	0.55	7.33	11.12	14.42	0.02
SQU-DS	2026-03-06 12:45:00	5.30	54.64	0.55	7.36	11.14	12.69	0.02
SQU-DS	2026-03-06 13:00:00	5.29	54.46	0.55	7.30	11.17	41.67	0.02
SQU-DS	2026-03-06 13:15:00	5.29	54.47	0.55	7.34	11.20	13.30	0.02
SQU-DS	2026-03-06 13:30:00	5.33	54.82	0.55	7.34	11.20	17.58	0.02
SQU-DS	2026-03-06 13:45:00	5.32	54.63	0.55	7.31	11.16	17.12	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-06 14:00:00	5.32	54.69	0.55	7.33	11.16	14.97	0.02
SQU-DS	2026-03-06 14:15:00	5.31	54.75	0.55	7.31	11.15	77.99	0.02
SQU-DS	2026-03-06 14:30:00	5.33	54.94	0.55	7.32	11.10	15.43	0.02
SQU-DS	2026-03-06 14:45:00	5.32	55.12	0.55	7.32	11.10	91.16	0.02
SQU-DS	2026-03-06 15:00:00	5.35	55.46	0.55	7.30	11.02	25.54	0.02
SQU-DS	2026-03-06 15:15:00	5.35	55.59	0.55	7.29	11.08	16.39	0.02
SQU-DS	2026-03-06 15:30:00	5.42	56.48	0.55	7.27	11.00	14.82	0.03
SQU-DS	2026-03-06 15:45:00	5.42	56.60	0.55	7.24	11.02	17.60	0.03
SQU-DS	2026-03-06 16:00:00	5.51	57.29	0.55	7.21	10.92	26.16	0.03
SQU-DS	2026-03-06 16:15:00	5.53	57.66	0.56	7.20	10.99	20.32	0.03
SQU-DS	2026-03-06 16:30:00	5.54	57.85	0.56	7.29	11.05	45.47	0.03
SQU-DS	2026-03-06 16:45:00	5.62	58.27	0.56	7.30	11.00	18.18	0.03
SQU-DS	2026-03-06 17:00:00	5.85	60.51	0.55	7.31	11.03	934.40	0.03
SQU-DS	2026-03-06 17:15:00	5.66	59.90	0.56	7.27	11.15	11.75	0.03
SQU-DS	2026-03-06 17:30:00	5.54	59.26	0.55	7.34	11.03	15.03	0.03
SQU-DS	2026-03-06 17:45:00	5.40	57.90	0.55	7.31	11.04	4.40	0.03
SQU-DS	2026-03-06 18:00:00	5.38	57.22	0.55	7.32	10.93	29.85	0.03
SQU-DS	2026-03-06 18:15:00	5.33	56.82	0.55	7.35	10.95	54.11	0.03
SQU-DS	2026-03-06 18:30:00	5.30	56.57	0.55	7.35	10.93	9.73	0.03
SQU-DS	2026-03-06 18:45:00	5.29	56.34	0.55	7.38	10.97	4.45	0.03
SQU-DS	2026-03-06 19:00:00	5.27	56.10	0.55	7.39	10.90	4.95	0.02
SQU-DS	2026-03-06 19:15:00	5.25	56.30	0.55	7.39	10.90	12.46	0.03
SQU-DS	2026-03-06 19:30:00	5.25	56.95	0.55	7.39	10.89	4.76	0.03
SQU-DS	2026-03-06 19:45:00	5.23	56.42	0.55	7.39	10.88	4.26	0.03
SQU-DS	2026-03-06 20:00:00	5.20	56.15	0.55	7.40	10.83	4.31	0.02
SQU-DS	2026-03-06 20:15:00	5.20	56.67	0.55	7.40	10.80	4.48	0.03
SQU-DS	2026-03-06 20:30:00	5.24	57.99	0.55	7.38	10.78	5.30	0.03
SQU-DS	2026-03-06 20:45:00	5.22	57.26	0.55	7.40	10.73	4.49	0.03
SQU-DS	2026-03-06 21:00:00	5.22	57.05	0.55	7.38	10.76	44.16	0.03
SQU-DS	2026-03-06 21:15:00	5.24	59.09	0.55	7.38	10.82	4.42	0.03
SQU-DS	2026-03-06 21:30:00	5.28	60.64	0.55	7.36	10.70	4.20	0.03
SQU-DS	2026-03-06 21:45:00	5.26	59.29	0.55	7.36	10.67	11.81	0.03
SQU-DS	2026-03-06 22:00:00	5.28	59.46	0.55	7.38	10.64	4.20	0.03
SQU-DS	2026-03-06 22:15:00	5.30	59.56	0.55	7.35	10.58	5.24	0.03
SQU-DS	2026-03-06 22:30:00	5.29	58.68	0.55	7.35	10.56	5.73	0.03
SQU-DS	2026-03-06 22:45:00	5.32	58.63	0.55	7.33	10.52	4.49	0.03
SQU-DS	2026-03-06 23:00:00	5.34	58.24	0.55	7.32	10.51	4.71	0.03
SQU-DS	2026-03-06 23:15:00	5.36	58.02	0.55	7.30	10.55	5.49	0.03
SQU-DS	2026-03-06 23:30:00	5.43	58.05	0.55	7.22	10.49	10.98	0.03
SQU-DS	2026-03-06 23:45:00	5.62	59.37	0.56	7.21	10.40	7.84	0.03
SQU-DS	2026-03-07 00:00:00	6.15	53.86	0.56	7.20	11.06	3.11	0.02
SQU-DS	2026-03-07 00:15:00	6.50	20.32	0.56	7.19	11.02	1.98	0.01
SQU-DS	2026-03-07 00:30:00	6.37	3.80	0.56	7.19	11.15	1.80	0.00
SQU-DS	2026-03-07 00:45:00	6.33	14.84	0.56	7.20	11.20	1.59	0.01
SQU-DS	2026-03-07 01:00:00	6.49	0.44	0.56	7.18	11.15	1.57	0.00
SQU-DS	2026-03-07 01:15:00	6.44	7.03	0.56	7.17	11.17	1.82	0.00
SQU-DS	2026-03-07 01:30:00	6.55	5.68	0.56	7.16	11.13	1.74	0.00
SQU-DS	2026-03-07 01:45:00	6.49	3.99	0.57	7.16	11.14	1.73	0.00
SQU-DS	2026-03-07 02:00:00	6.28	1.65	0.57	7.14	11.23	1.70	0.00
SQU-DS	2026-03-07 02:15:00	6.52	1.53	0.57	7.14	11.12	1.70	0.00
SQU-DS	2026-03-07 02:30:00	6.60	0.63	0.57	7.13	11.11	1.69	0.00
SQU-DS	2026-03-07 02:45:00	6.54	3.04	0.57	7.12	11.14	1.63	0.00
SQU-DS	2026-03-07 03:00:00	6.27	11.72	0.57	7.11	11.22	1.86	0.00
SQU-DS	2026-03-07 03:15:00	6.26	1.11	0.57	7.10	11.24	1.76	0.00
SQU-DS	2026-03-07 03:30:00	6.09	26.80	0.57	7.10	11.28	2.36	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-07 03:45:00	6.01	58.11	0.57	7.07	11.22	513.32	0.03
SQU-DS	2026-03-07 04:00:00	5.66	56.37	0.55	7.32	10.76	4.07	0.03
SQU-DS	2026-03-07 04:15:00	5.50	54.55	0.56	7.22	10.75	2.13	0.02
SQU-DS	2026-03-07 04:30:00	5.44	54.04	0.56	7.24	10.71	2.42	0.02
SQU-DS	2026-03-07 04:45:00	5.38	53.51	0.55	7.28	10.68	2.33	0.02
SQU-DS	2026-03-07 05:00:00	5.36	53.32	0.55	7.28	10.69	12.62	0.02
SQU-DS	2026-03-07 05:15:00	5.34	53.16	0.55	7.28	10.75	2.30	0.02
SQU-DS	2026-03-07 05:30:00	5.32	52.80	0.55	7.31	10.81	2.84	0.02
SQU-DS	2026-03-07 05:45:00	5.28	52.45	0.55	7.32	10.82	2.28	0.02
SQU-DS	2026-03-07 06:00:00	5.25	52.35	0.55	7.34	10.79	3.21	0.02
SQU-DS	2026-03-07 06:15:00	5.24	52.24	0.55	7.33	10.72	21.84	0.02
SQU-DS	2026-03-07 06:30:00	5.22	52.04	0.55	7.33	10.79	2.52	0.02
SQU-DS	2026-03-07 06:45:00	5.20	52.04	0.55	7.35	10.74	3.29	0.02
SQU-DS	2026-03-07 07:00:00	5.18	51.96	0.55	7.35	10.72	3.34	0.02
SQU-DS	2026-03-07 07:15:00	5.17	51.94	0.55	7.36	10.65	4.19	0.02
SQU-DS	2026-03-07 07:30:00	5.14	51.76	0.55	7.36	10.78	4.14	0.02
SQU-DS	2026-03-07 07:45:00	5.12	51.67	0.55	7.36	10.75	4.01	0.02
SQU-DS	2026-03-07 08:00:00	5.11	51.53	0.55	7.37	10.74	3.79	0.02
SQU-DS	2026-03-07 08:15:00	5.10	51.60	0.55	7.37	10.78	3.81	0.02
SQU-DS	2026-03-07 08:30:00	5.10	52.75	0.55	7.37	10.86	4.06	0.02
SQU-DS	2026-03-07 08:45:00	5.16	54.92	0.55	7.36	10.80	4.21	0.02
SQU-DS	2026-03-07 09:00:00	5.16	54.64	0.55	7.37	10.73	4.30	0.02
SQU-DS	2026-03-07 09:15:00	5.20	56.12	0.55	7.36	10.81	5.51	0.02
SQU-DS	2026-03-07 09:30:00	5.22	56.26	0.55	7.34	10.74	4.36	0.02
SQU-DS	2026-03-07 09:45:00	5.23	55.24	0.55	7.37	10.73	4.35	0.02
SQU-DS	2026-03-07 10:00:00	5.24	54.58	0.55	7.36	10.81	5.27	0.02
SQU-DS	2026-03-07 10:15:00	5.26	54.12	0.55	7.36	10.75	4.60	0.02
SQU-DS	2026-03-07 10:30:00	5.30	54.35	0.55	7.35	10.74	5.02	0.02
SQU-DS	2026-03-07 10:45:00	5.34	54.33	0.55	7.31	10.80	13.25	0.02
SQU-DS	2026-03-07 11:00:00	5.41	54.56	0.55	7.29	10.71	29.00	0.02
SQU-DS	2026-03-07 11:15:00	5.49	55.34	0.55	7.26	10.84	4.66	0.02
SQU-DS	2026-03-07 11:30:00	5.72	57.04	0.55	7.21	10.65	25.74	0.03
SQU-DS	2026-03-07 11:45:00	5.80	57.18	0.55	7.28	10.80	6.73	0.03
SQU-DS	2026-03-07 12:00:00	5.90	58.17	0.55	7.34	10.73	9.06	0.03
SQU-DS	2026-03-07 12:15:00	5.79	55.87	0.55	7.37	10.85	7.10	0.02
SQU-DS	2026-03-07 12:30:00	5.81	56.26	0.55	7.39	10.88	8.99	0.03
SQU-DS	2026-03-07 12:45:00	5.76	55.17	0.55	7.40	10.95	7.94	0.02
SQU-DS	2026-03-07 13:00:00	5.95	56.87	0.55	7.37	10.81	6.83	0.03
SQU-DS	2026-03-07 13:15:00	6.05	57.10	0.55	7.33	10.61	7.18	0.03
SQU-DS	2026-03-07 13:30:00	5.95	56.07	0.56	7.29	10.76	7.54	0.02
SQU-DS	2026-03-07 13:45:00	5.86	55.32	0.56	7.23	10.94	5.52	0.02
SQU-DS	2026-03-07 14:00:00	5.85	54.86	0.56	7.23	10.93	8.11	0.02
SQU-DS	2026-03-07 14:15:00	5.88	55.17	0.56	7.19	10.93	6.71	0.02
SQU-DS	2026-03-07 14:30:00	5.82	54.56	0.55	7.19	10.98	8.53	0.02
SQU-DS	2026-03-07 14:45:00	5.90	54.18	0.56	7.15	11.02	18.60	0.02
SQU-DS	2026-03-07 15:00:00	5.83	53.63	0.55	7.18	10.99	7.38	0.02
SQU-DS	2026-03-07 15:15:00	5.87	53.92	0.55	7.18	10.99	7.76	0.02
SQU-DS	2026-03-07 15:30:00	6.00	54.46	0.55	7.19	10.79	7.62	0.02
SQU-DS	2026-03-07 15:45:00	5.85	53.13	0.55	7.16	10.88	7.96	0.02
SQU-DS	2026-03-07 16:00:00	5.92	53.45	0.55	7.18	10.88	9.00	0.02
SQU-DS	2026-03-07 16:15:00	5.90	53.26	0.55	7.20	10.92	8.37	0.02
SQU-DS	2026-03-07 16:30:00	5.92	53.37	0.55	7.21	10.92	8.46	0.02
SQU-DS	2026-03-07 16:45:00	5.86	52.65	0.55	7.19	10.92	9.59	0.02
SQU-DS	2026-03-07 17:00:00	5.87	52.57	0.55	7.24	10.88	9.05	0.02
SQU-DS	2026-03-07 17:15:00	5.87	52.52	0.55	7.27	10.89	9.07	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-07 17:30:00	5.81	52.38	0.55	7.27	10.88	8.88	0.02
SQU-DS	2026-03-07 17:45:00	5.82	52.42	0.55	7.29	10.83	10.46	0.02
SQU-DS	2026-03-07 18:00:00	5.82	52.40	0.55	7.29	10.68	11.79	0.02
SQU-DS	2026-03-07 18:15:00	5.76	51.96	0.55	7.29	10.70	10.18	0.02
SQU-DS	2026-03-07 18:30:00	5.75	51.76	0.55	7.31	10.70	10.10	0.02
SQU-DS	2026-03-07 18:45:00	5.69	51.54	0.55	7.31	10.75	10.07	0.02
SQU-DS	2026-03-07 19:00:00	5.68	51.22	0.55	7.33	10.66	10.58	0.02
SQU-DS	2026-03-07 19:15:00	5.65	50.69	0.55	7.34	10.74	10.26	0.02
SQU-DS	2026-03-07 19:30:00	5.63	50.56	0.55	7.33	10.83	11.11	0.02
SQU-DS	2026-03-07 19:45:00	5.62	50.29	0.55	7.36	10.79	10.59	0.02
SQU-DS	2026-03-07 20:00:00	5.61	50.20	0.55	7.38	10.77	11.15	0.02
SQU-DS	2026-03-07 20:15:00	5.59	49.88	0.55	7.39	10.72	11.78	0.02
SQU-DS	2026-03-07 20:30:00	5.56	49.75	0.55	7.39	10.80	11.22	0.02
SQU-DS	2026-03-07 20:45:00	5.54	50.13	0.55	7.39	10.71	8.78	0.02
SQU-DS	2026-03-07 21:00:00	5.53	49.88	0.55	7.38	10.85	10.69	0.02
SQU-DS	2026-03-07 21:15:00	5.53	49.80	0.55	7.40	10.69	10.27	0.02
SQU-DS	2026-03-07 21:30:00	5.52	49.53	0.55	7.42	10.70	35.99	0.02
SQU-DS	2026-03-07 21:45:00	5.50	49.17	0.55	7.40	10.88	12.15	0.02
SQU-DS	2026-03-07 22:00:00	5.49	49.21	0.55	7.43	10.78	12.36	0.02
SQU-DS	2026-03-07 22:15:00	5.47	48.69	0.55	7.43	10.78	9.59	0.02
SQU-DS	2026-03-07 22:30:00	5.44	47.85	0.55	7.43	10.96	9.70	0.02
SQU-DS	2026-03-07 22:45:00	5.41	47.52	0.55	7.43	11.02	9.88	0.02
SQU-DS	2026-03-07 23:00:00	5.37	46.90	0.55	7.43	11.05	12.22	0.02
SQU-DS	2026-03-07 23:15:00	5.35	46.16	0.55	7.41	11.08	12.14	0.02
SQU-DS	2026-03-07 23:30:00	5.32	45.25	0.55	7.41	11.10	13.50	0.02
SQU-DS	2026-03-07 23:45:00	5.29	44.87	0.55	7.43	11.15	13.29	0.02
SQU-DS	2026-03-08 00:00:00	5.27	44.25	0.55	7.43	11.12	13.14	0.02
SQU-DS	2026-03-08 00:15:00	5.23	43.95	0.55	7.41	11.17	13.65	0.02
SQU-DS	2026-03-08 00:30:00	5.21	43.26	0.55	7.35	11.14	16.96	0.02
SQU-DS	2026-03-08 00:45:00	5.18	42.28	0.55	7.38	11.18	20.96	0.02
SQU-DS	2026-03-08 01:00:00	5.16	41.89	0.55	7.41	11.18	17.40	0.02
SQU-DS	2026-03-08 01:15:00	5.14	41.15	0.55	7.39	11.19	19.18	0.02
SQU-DS	2026-03-08 01:30:00	5.11	40.42	0.55	7.34	11.18	21.05	0.02
SQU-DS	2026-03-08 01:45:00	5.05	40.01	0.55	7.34	11.18	34.74	0.02
SQU-DS	2026-03-08 03:00:00	5.00	39.57	0.55	7.41	11.21	31.73	0.02
SQU-DS	2026-03-08 03:15:00	4.98	38.61	0.55	7.40	11.27	39.90	0.02
SQU-DS	2026-03-08 03:30:00	4.99	38.59	0.55	7.35	11.30	29.49	0.02
SQU-DS	2026-03-08 03:45:00	4.97	37.68	0.55	7.40	11.36	30.14	0.02
SQU-DS	2026-03-08 04:00:00	4.93	36.90	0.55	7.41	11.35	30.99	0.02
SQU-DS	2026-03-08 04:15:00	4.91	36.76	0.55	7.39	11.36	28.01	0.02
SQU-DS	2026-03-08 04:30:00	4.88	35.59	0.55	7.41	11.47	38.68	0.02
SQU-DS	2026-03-08 04:45:00	4.86	34.96	0.55	7.41	11.50	37.66	0.01
SQU-DS	2026-03-08 05:00:00	4.82	35.62	0.55	7.34	11.50	41.82	0.02
SQU-DS	2026-03-08 05:15:00	4.74	33.31	0.55	7.41	11.56	32.21	0.01
SQU-DS	2026-03-08 05:30:00	4.70	33.07	0.55	7.38	11.53	32.67	0.01
SQU-DS	2026-03-08 05:45:00	4.67	32.61	0.55	7.39	11.60	39.41	0.01
SQU-DS	2026-03-08 06:00:00	4.64	31.84	0.55	7.35	11.58	43.64	0.01
SQU-DS	2026-03-08 06:15:00	4.60	31.34	0.55	7.41	11.59	45.15	0.01
SQU-DS	2026-03-08 06:30:00	4.55	30.68	0.55	7.35	11.58	38.01	0.01
SQU-DS	2026-03-08 06:45:00	4.51	30.22	0.55	7.40	11.57	41.23	0.01
SQU-DS	2026-03-08 07:00:00	4.47	30.01	0.55	7.40	11.54	42.03	0.01
SQU-DS	2026-03-08 07:15:00	4.43	29.60	0.55	7.42	11.54	48.04	0.01
SQU-DS	2026-03-08 07:30:00	4.37	29.01	0.55	7.41	11.51	46.77	0.01
SQU-DS	2026-03-08 07:45:00	4.33	29.07	0.55	7.44	11.39	50.37	0.01
SQU-DS	2026-03-08 08:00:00	4.30	28.53	0.55	7.43	11.31	27.79	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-08 08:15:00	4.27	27.93	0.55	7.43	11.08	53.69	0.01
SQU-DS	2026-03-08 08:30:00	4.25	28.05	0.55	7.45	10.89	25.20	0.01
SQU-DS	2026-03-08 08:45:00	4.22	28.05	0.55	7.44	10.75	27.18	0.01
SQU-DS	2026-03-08 09:00:00	4.20	27.82	0.55	7.43	10.63	11.43	0.01
SQU-DS	2026-03-08 09:15:00	4.21	28.14	0.55	7.42	10.36	13.90	0.01
SQU-DS	2026-03-08 09:30:00	4.22	26.67	0.55	7.38	10.07	79.06	0.01
SQU-DS	2026-03-08 09:45:00	4.23	26.05	0.55	7.36	10.48	148.88	0.01
SQU-DS	2026-03-08 10:00:00	4.25	25.73	0.55	7.36	10.86	111.58	0.01
SQU-DS	2026-03-08 10:15:00	4.28	25.83	0.55	7.38	10.68	111.25	0.01
SQU-DS	2026-03-08 10:30:00	4.31	26.01	0.55	7.36	10.49	38.68	0.01
SQU-DS	2026-03-08 10:45:00	4.35	26.23	0.55	7.34	10.31	40.68	0.01
SQU-DS	2026-03-08 11:00:00	4.38	26.37	0.55	7.34	10.17	53.06	0.01
SQU-DS	2026-03-08 11:15:00	4.42	26.54	0.55	7.33	9.81	88.58	0.01
SQU-DS	2026-03-08 11:30:00	4.45	26.69	0.55	7.31	9.46	48.37	0.01
SQU-DS	2026-03-08 11:45:00	4.48	26.76	0.55	7.31	9.16	139.63	0.01
SQU-DS	2026-03-08 12:00:00	4.49	27.01	0.55	7.31	8.88	100.63	0.01
SQU-DS	2026-03-08 12:15:00	4.51	27.05	0.55	7.29	8.64	111.09	0.01
SQU-DS	2026-03-08 12:30:00	4.52	27.26	0.55	7.27	8.49	83.85	0.01
SQU-DS	2026-03-08 12:45:00	4.56	27.32	0.55	7.26	8.24	67.45	0.01
SQU-DS	2026-03-08 13:00:00	4.62	27.38	0.55	7.28	8.34	98.32	0.01
SQU-DS	2026-03-08 13:15:00	4.68	27.42	0.55	7.27	8.37	44.16	0.01
SQU-DS	2026-03-08 13:30:00	4.74	27.76	0.55	7.27	8.38	29.54	0.01
SQU-DS	2026-03-08 13:45:00	4.79	27.70	0.55	7.26	8.46	33.79	0.01
SQU-DS	2026-03-08 14:00:00	4.84	27.82	0.54	7.26	8.45	20.54	0.01
SQU-DS	2026-03-08 14:15:00	4.90	27.72	0.54	7.27	8.49	27.33	0.01
SQU-DS	2026-03-08 14:30:00	4.95	27.83	0.54	7.27	8.53	27.09	0.01
SQU-DS	2026-03-08 14:45:00	4.97	27.80	0.54	7.27	8.51	27.54	0.01
SQU-DS	2026-03-08 15:00:00	4.99	27.82	0.54	7.27	8.50	26.22	0.01
SQU-DS	2026-03-08 15:15:00	5.00	27.91	0.54	7.27	8.54	25.45	0.01
SQU-DS	2026-03-08 15:30:00	5.00	28.01	0.54	7.26	8.56	23.90	0.01
SQU-DS	2026-03-08 15:45:00	5.01	28.43	0.54	7.27	8.68	29.55	0.01
SQU-DS	2026-03-08 16:00:00	5.02	28.43	0.54	7.27	8.72	22.06	0.01
SQU-DS	2026-03-08 16:15:00	5.02	28.61	0.54	7.26	8.75	18.28	0.01
SQU-DS	2026-03-08 16:30:00	5.00	28.43	0.54	7.27	8.76	22.93	0.01
SQU-DS	2026-03-08 16:45:00	4.99	28.63	0.54	7.26	8.80	21.51	0.01
SQU-DS	2026-03-08 17:00:00	4.98	28.81	0.54	7.27	8.81	20.13	0.01
SQU-DS	2026-03-08 17:15:00	4.96	28.90	0.54	7.27	8.70	22.79	0.01
SQU-DS	2026-03-08 17:30:00	4.92	29.03	0.54	7.24	8.66	24.67	0.01
SQU-DS	2026-03-08 17:45:00	4.87	29.15	0.54	7.25	8.77	26.22	0.01
SQU-DS	2026-03-08 18:00:00	4.84	29.33	0.54	7.24	8.86	20.93	0.01
SQU-DS	2026-03-08 18:15:00	4.81	29.51	0.54	7.25	8.94	25.15	0.01
SQU-DS	2026-03-08 18:30:00	4.77	29.58	0.54	7.26	9.01	23.66	0.01
SQU-DS	2026-03-08 18:45:00	4.76	29.92	0.55	7.26	9.06	23.95	0.01
SQU-DS	2026-03-08 19:00:00	4.74	30.05	0.55	7.27	9.04	21.54	0.01
SQU-DS	2026-03-08 19:15:00	4.74	30.04	0.55	7.27	9.00	20.57	0.01
SQU-DS	2026-03-08 19:30:00	4.71	29.99	0.55	7.25	9.06	25.05	0.01
SQU-DS	2026-03-08 19:45:00	4.69	29.98	0.55	7.26	9.21	24.23	0.01
SQU-DS	2026-03-08 20:00:00	4.67	29.91	0.55	7.26	9.45	23.26	0.01
SQU-DS	2026-03-08 20:15:00	4.66	30.32	0.55	7.28	9.58	27.95	0.01
SQU-DS	2026-03-08 20:30:00	4.66	30.43	0.55	7.27	9.74	25.18	0.01
SQU-DS	2026-03-08 20:45:00	4.64	30.69	0.55	7.25	9.81	22.93	0.01
SQU-DS	2026-03-08 21:00:00	4.62	30.66	0.55	7.26	9.83	30.22	0.01
SQU-DS	2026-03-08 21:15:00	4.61	30.79	0.55	7.29	9.81	26.76	0.01
SQU-DS	2026-03-08 21:30:00	4.58	30.82	0.55	7.28	9.71	27.26	0.01
SQU-DS	2026-03-08 21:45:00	4.56	30.91	0.55	7.28	9.66	50.64	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-03-08 22:00:00	4.52	31.11	0.55	7.28	9.69	40.19	0.01
SQU-DS	2026-03-08 22:15:00	4.50	30.92	0.55	7.28	9.62	21.43	0.01
SQU-DS	2026-03-08 22:30:00	4.45	31.18	0.55	7.29	9.63	17.67	0.01
SQU-DS	2026-03-08 22:45:00	4.43	31.26	0.55	7.29	9.52	18.82	0.01
SQU-DS	2026-03-08 23:00:00	4.41	31.51	0.55	7.29	9.49	25.35	0.01
SQU-DS	2026-03-08 23:15:00	4.39	31.68	0.55	7.30	9.42	23.47	0.01
SQU-DS	2026-03-08 23:30:00	4.37	31.76	0.55	7.30	9.40	20.72	0.01
SQU-DS	2026-03-08 23:45:00	4.33	31.77	0.55	7.31	9.36	18.14	0.01
SQU-US	2026-03-02 00:00:00	4.55	0.00	357.72	7.29	13.09	9.44	0.00
SQU-US	2026-03-02 00:15:00	4.57	0.00	359.32	7.27	13.09	9.51	0.00
SQU-US	2026-03-02 00:30:00	4.57	0.09	367.79	7.04	13.06	9.78	0.00
SQU-US	2026-03-02 00:45:00	4.55	0.00	358.49	7.27	13.09	9.55	0.00
SQU-US	2026-03-02 01:00:00	4.58	0.00	359.18	7.28	13.07	9.62	0.00
SQU-US	2026-03-02 01:15:00	4.55	0.00	359.90	7.27	13.07	9.61	0.00
SQU-US	2026-03-02 01:30:00	4.61	0.09	364.82	7.25	13.05	9.70	0.00
SQU-US	2026-03-02 01:45:00	4.55	0.00	360.93	7.26	13.07	9.62	0.00
SQU-US	2026-03-02 02:00:00	4.51	0.00	361.43	7.22	13.09	9.68	0.00
SQU-US	2026-03-02 02:15:00	4.51	0.00	361.52	7.26	13.09	9.59	0.00
SQU-US	2026-03-02 02:30:00	4.51	0.09	374.14	7.15	13.10	9.67	0.00
SQU-US	2026-03-02 02:45:00	4.47	0.00	357.41	7.28	13.11	9.62	0.00
SQU-US	2026-03-02 03:00:00	4.39	0.00	361.69	7.22	13.12	9.65	0.00
SQU-US	2026-03-02 03:15:00	4.40	0.00	363.27	7.23	13.13	9.49	0.00
SQU-US	2026-03-02 03:30:00	4.60	64.98	349.24	7.10	12.25	8.38	0.03
SQU-US	2026-03-02 03:45:00	4.59	64.95	333.96	7.19	12.31	7.00	0.03
SQU-US	2026-03-02 04:00:00	4.58	64.13	335.18	7.19	12.32	7.04	0.03
SQU-US	2026-03-02 04:15:00	4.52	62.63	338.62	7.22	12.36	7.61	0.03
SQU-US	2026-03-02 04:30:00	4.49	56.04	342.12	7.26	12.43	7.52	0.02
SQU-US	2026-03-02 04:45:00	4.48	55.65	343.69	7.27	12.46	7.39	0.02
SQU-US	2026-03-02 05:00:00	4.46	55.38	346.24	7.28	12.48	7.61	0.02
SQU-US	2026-03-02 05:15:00	4.45	55.26	348.81	7.28	12.49	7.60	0.02
SQU-US	2026-03-02 05:30:00	4.42	55.20	353.57	7.25	12.49	7.36	0.02
SQU-US	2026-03-02 05:45:00	4.41	54.94	353.13	7.28	12.52	7.38	0.02
SQU-US	2026-03-02 06:00:00	4.38	54.58	354.70	7.29	12.53	7.51	0.02
SQU-US	2026-03-02 06:15:00	4.34	54.26	355.97	7.30	12.55	7.46	0.02
SQU-US	2026-03-02 06:30:00	4.30	54.23	358.92	7.29	12.60	7.77	0.02
SQU-US	2026-03-02 06:45:00	4.26	54.04	359.02	7.31	12.62	7.38	0.02
SQU-US	2026-03-02 07:00:00	4.23	53.96	360.07	7.32	12.63	7.26	0.02
SQU-US	2026-03-02 07:15:00	4.18	53.88	360.95	7.33	12.65	7.48	0.02
SQU-US	2026-03-02 07:30:00	4.16	54.43	364.42	7.28	12.67	7.86	0.02
SQU-US	2026-03-02 07:45:00	4.19	56.27	363.25	7.29	12.59	7.85	0.02
SQU-US	2026-03-02 08:00:00	4.21	57.95	363.46	7.27	12.52	7.15	0.03
SQU-US	2026-03-02 08:15:00	4.24	61.28	363.04	7.26	12.46	7.54	0.03
SQU-US	2026-03-02 08:30:00	4.22	62.18	363.65	7.25	12.43	8.29	0.03
SQU-US	2026-03-02 08:45:00	4.21	62.30	360.93	7.27	12.45	7.40	0.03
SQU-US	2026-03-02 09:00:00	4.21	62.62	359.88	7.26	12.45	7.36	0.03
SQU-US	2026-03-02 09:15:00	4.24	64.19	358.82	7.24	12.39	7.46	0.03
SQU-US	2026-03-02 09:30:00	4.24	63.62	360.06	7.21	12.41	7.50	0.03
SQU-US	2026-03-02 09:45:00	4.26	62.55	356.97	7.22	12.44	7.57	0.03
SQU-US	2026-03-02 10:00:00	4.31	61.80	355.74	7.22	12.46	7.85	0.03
SQU-US	2026-03-02 10:15:00	4.37	61.45	354.70	7.19	12.46	7.56	0.03
SQU-US	2026-03-02 10:30:00	4.44	62.05	356.07	7.19	12.48	7.82	0.03
SQU-US	2026-03-02 10:45:00	4.51	61.86	355.38	7.18	12.47	7.70	0.03
SQU-US	2026-03-02 11:00:00	4.60	61.91	354.61	7.17	12.49	7.52	0.03
SQU-US	2026-03-02 11:15:00	4.72	47.06	352.20	7.11	12.45	9.47	0.02
SQU-US	2026-03-02 11:30:00	4.88	13.59	341.75	7.18	12.65	9.27	0.00

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-02 11:45:00	4.97	0.00	334.84	7.21	12.88	9.39	0.00
SQU-US	2026-03-02 12:00:00	5.17	0.00	338.83	7.20	12.86	9.35	0.00
SQU-US	2026-03-02 12:15:00	5.24	0.00	339.90	7.15	12.86	9.37	0.00
SQU-US	2026-03-02 12:30:00	5.34	0.09	341.98	6.89	12.82	9.51	0.00
SQU-US	2026-03-02 12:45:00	5.44	0.00	328.84	7.13	12.78	9.39	0.00
SQU-US	2026-03-02 13:00:00	5.58	0.00	328.19	7.09	12.75	9.41	0.00
SQU-US	2026-03-02 13:15:00	5.71	0.00	316.92	7.10	12.63	9.50	0.00
SQU-US	2026-03-02 13:30:00	5.83	0.63	306.89	7.35	12.37	9.31	0.00
SQU-US	2026-03-02 13:45:00	5.79	60.42	307.87	7.14	12.38	7.14	0.03
SQU-US	2026-03-02 14:00:00	5.85	61.13	311.33	7.19	12.45	7.06	0.03
SQU-US	2026-03-02 14:15:00	5.92	61.12	314.49	7.20	12.44	7.05	0.03
SQU-US	2026-03-02 14:30:00	5.97	61.21	320.29	7.17	12.43	7.71	0.03
SQU-US	2026-03-02 14:45:00	6.02	60.76	322.93	7.21	12.47	7.16	0.03
SQU-US	2026-03-02 15:00:00	6.09	60.54	325.38	7.21	12.46	7.13	0.03
SQU-US	2026-03-02 15:15:00	6.12	59.90	327.20	7.23	12.51	7.14	0.03
SQU-US	2026-03-02 15:30:00	6.21	60.25	330.96	7.26	12.54	7.09	0.03
SQU-US	2026-03-02 15:45:00	6.25	59.83	331.35	7.31	12.54	7.11	0.03
SQU-US	2026-03-02 16:00:00	6.22	59.24	333.22	7.34	12.58	7.00	0.03
SQU-US	2026-03-02 16:15:00	6.20	58.56	334.76	7.36	12.58	7.10	0.03
SQU-US	2026-03-02 16:30:00	6.20	58.57	338.47	7.32	12.58	7.36	0.03
SQU-US	2026-03-02 16:45:00	6.20	58.34	338.22	7.37	12.60	7.15	0.03
SQU-US	2026-03-02 17:00:00	6.18	58.17	339.78	7.38	12.60	7.00	0.03
SQU-US	2026-03-02 17:15:00	6.14	58.26	341.37	7.38	12.58	6.95	0.03
SQU-US	2026-03-02 17:30:00	6.05	57.91	334.83	7.35	12.59	7.29	0.03
SQU-US	2026-03-02 17:45:00	5.95	57.47	331.12	7.39	12.59	6.92	0.03
SQU-US	2026-03-02 18:00:00	5.89	58.38	330.09	7.38	12.57	7.03	0.03
SQU-US	2026-03-02 18:15:00	5.78	60.04	328.46	7.36	12.54	7.31	0.03
SQU-US	2026-03-02 18:30:00	5.81	68.34	325.94	7.28	12.37	7.30	0.03
SQU-US	2026-03-02 18:45:00	5.71	69.43	320.16	7.29	12.31	7.26	0.03
SQU-US	2026-03-02 19:00:00	5.60	69.27	311.91	7.26	12.27	7.72	0.03
SQU-US	2026-03-02 19:15:00	5.49	68.14	307.63	7.24	12.28	7.46	0.03
SQU-US	2026-03-02 19:30:00	5.39	67.32	304.59	7.18	12.23	7.42	0.03
SQU-US	2026-03-02 19:45:00	5.31	65.56	293.69	7.17	12.20	7.48	0.03
SQU-US	2026-03-02 20:00:00	5.22	64.01	291.84	7.15	12.18	7.61	0.03
SQU-US	2026-03-02 20:15:00	5.11	62.30	294.10	7.17	12.24	7.62	0.03
SQU-US	2026-03-02 20:30:00	5.03	61.27	297.34	7.14	12.25	7.60	0.03
SQU-US	2026-03-02 20:45:00	4.98	60.70	300.11	7.13	12.23	7.45	0.03
SQU-US	2026-03-02 21:00:00	4.94	60.88	301.80	7.16	12.27	7.99	0.03
SQU-US	2026-03-02 21:15:00	4.90	60.22	305.34	7.15	12.26	7.61	0.03
SQU-US	2026-03-02 21:30:00	4.87	66.04	312.20	7.10	12.27	9.90	0.03
SQU-US	2026-03-02 21:45:00	4.84	65.89	311.04	7.16	12.29	7.47	0.03
SQU-US	2026-03-02 22:00:00	4.84	66.61	314.30	7.16	12.28	7.66	0.03
SQU-US	2026-03-02 22:15:00	4.81	66.03	316.39	7.17	12.28	7.38	0.03
SQU-US	2026-03-02 22:30:00	4.80	59.81	319.25	7.14	12.28	7.94	0.03
SQU-US	2026-03-02 22:45:00	4.79	59.73	317.00	7.16	12.30	7.58	0.03
SQU-US	2026-03-02 23:00:00	4.77	59.99	318.06	7.16	12.30	7.75	0.03
SQU-US	2026-03-02 23:15:00	4.77	59.89	320.18	7.15	12.29	7.70	0.03
SQU-US	2026-03-02 23:30:00	4.77	59.45	323.15	7.13	12.31	8.03	0.03
SQU-US	2026-03-02 23:45:00	4.76	59.20	319.46	7.16	12.32	8.01	0.03
SQU-US	2026-03-03 00:00:00	4.76	59.13	319.57	7.16	12.34	7.90	0.03
SQU-US	2026-03-03 00:15:00	4.75	59.02	319.50	7.17	12.34	7.91	0.03
SQU-US	2026-03-03 00:30:00	4.74	58.94	322.29	7.17	12.37	8.73	0.03
SQU-US	2026-03-03 00:45:00	4.73	58.78	323.14	7.18	12.36	8.15	0.03
SQU-US	2026-03-03 01:00:00	4.73	58.60	324.55	7.19	12.37	8.01	0.03
SQU-US	2026-03-03 01:15:00	4.72	58.68	326.61	7.18	12.38	8.03	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-03 01:30:00	4.70	58.29	322.80	7.15	12.37	8.37	0.03
SQU-US	2026-03-03 01:45:00	4.70	58.48	313.36	7.15	12.39	7.60	0.03
SQU-US	2026-03-03 02:00:00	4.69	58.20	305.73	7.19	12.40	7.50	0.03
SQU-US	2026-03-03 02:15:00	4.68	58.29	302.07	7.20	12.40	7.44	0.03
SQU-US	2026-03-03 02:30:00	4.68	58.63	302.65	7.20	12.42	9.07	0.03
SQU-US	2026-03-03 02:45:00	4.67	58.59	303.43	7.21	12.44	7.52	0.03
SQU-US	2026-03-03 03:00:00	4.66	58.88	306.46	7.20	12.42	7.58	0.03
SQU-US	2026-03-03 03:15:00	4.66	59.11	309.58	7.20	12.42	7.37	0.03
SQU-US	2026-03-03 03:30:00	4.64	58.79	314.18	7.18	12.44	9.37	0.03
SQU-US	2026-03-03 03:45:00	4.64	58.79	312.88	7.21	12.44	7.63	0.03
SQU-US	2026-03-03 04:00:00	4.63	58.74	315.39	7.22	12.45	7.60	0.03
SQU-US	2026-03-03 04:15:00	4.63	58.05	317.00	7.22	12.45	7.45	0.03
SQU-US	2026-03-03 04:30:00	4.60	57.37	319.77	7.23	12.51	8.43	0.03
SQU-US	2026-03-03 04:45:00	4.55	56.09	321.51	7.30	12.57	7.70	0.02
SQU-US	2026-03-03 05:00:00	4.52	55.74	325.36	7.32	12.59	7.54	0.02
SQU-US	2026-03-03 05:15:00	4.51	55.36	328.63	7.33	12.60	7.39	0.02
SQU-US	2026-03-03 05:30:00	4.50	54.74	334.45	7.29	12.62	7.16	0.02
SQU-US	2026-03-03 05:45:00	4.50	54.43	336.32	7.32	12.61	7.24	0.02
SQU-US	2026-03-03 06:00:00	4.48	54.13	339.47	7.33	12.63	7.77	0.02
SQU-US	2026-03-03 06:15:00	4.46	53.95	342.44	7.33	12.64	7.14	0.02
SQU-US	2026-03-03 06:30:00	4.44	54.30	345.71	7.31	12.66	8.23	0.02
SQU-US	2026-03-03 06:45:00	4.43	54.14	346.94	7.34	12.66	7.22	0.02
SQU-US	2026-03-03 07:00:00	4.42	54.02	348.56	7.34	12.65	7.17	0.02
SQU-US	2026-03-03 07:15:00	4.40	53.85	350.20	7.35	12.66	7.75	0.02
SQU-US	2026-03-03 07:30:00	4.39	53.78	353.06	7.31	12.68	7.05	0.02
SQU-US	2026-03-03 07:45:00	4.39	53.90	351.16	7.35	12.67	7.07	0.02
SQU-US	2026-03-03 08:00:00	4.40	54.60	351.40	7.33	12.63	7.19	0.02
SQU-US	2026-03-03 08:15:00	4.44	56.51	351.36	7.31	12.58	7.17	0.03
SQU-US	2026-03-03 08:30:00	4.46	58.80	351.10	7.29	12.55	7.79	0.03
SQU-US	2026-03-03 08:45:00	4.50	60.93	348.78	7.28	12.48	7.15	0.03
SQU-US	2026-03-03 09:00:00	4.51	61.20	346.66	7.28	12.47	7.50	0.03
SQU-US	2026-03-03 09:15:00	4.53	62.38	344.89	7.27	12.44	7.53	0.03
SQU-US	2026-03-03 09:30:00	4.52	61.55	345.27	7.24	12.46	7.46	0.03
SQU-US	2026-03-03 09:45:00	4.52	61.38	341.76	7.28	12.45	7.31	0.03
SQU-US	2026-03-03 10:00:00	4.53	61.31	341.08	7.26	12.45	7.27	0.03
SQU-US	2026-03-03 10:15:00	4.51	59.94	338.50	7.28	12.48	7.44	0.03
SQU-US	2026-03-03 10:30:00	4.51	59.17	339.37	7.24	12.52	8.11	0.03
SQU-US	2026-03-03 10:45:00	4.53	59.02	338.76	7.24	12.51	7.62	0.03
SQU-US	2026-03-03 11:00:00	4.55	58.83	340.20	7.21	12.53	7.59	0.03
SQU-US	2026-03-03 11:15:00	4.55	58.67	341.02	7.23	12.53	7.70	0.03
SQU-US	2026-03-03 11:30:00	4.57	63.92	344.98	7.17	12.55	9.09	0.03
SQU-US	2026-03-03 11:45:00	4.58	63.74	342.20	7.23	12.58	7.47	0.03
SQU-US	2026-03-03 12:00:00	4.60	63.70	343.28	7.23	12.60	7.66	0.03
SQU-US	2026-03-03 12:15:00	4.63	63.90	344.61	7.23	12.62	8.42	0.03
SQU-US	2026-03-03 12:30:00	4.67	58.42	345.77	7.23	12.64	7.68	0.03
SQU-US	2026-03-03 12:45:00	4.72	58.58	345.61	7.24	12.64	7.78	0.03
SQU-US	2026-03-03 13:00:00	4.78	58.69	345.65	7.24	12.65	7.81	0.03
SQU-US	2026-03-03 13:15:00	4.84	58.73	345.49	7.25	12.67	8.25	0.03
SQU-US	2026-03-03 13:30:00	4.90	58.45	347.69	7.22	12.67	8.36	0.03
SQU-US	2026-03-03 13:45:00	4.94	58.48	346.43	7.25	12.69	7.95	0.03
SQU-US	2026-03-03 14:00:00	4.98	58.25	346.90	7.25	12.70	7.86	0.03
SQU-US	2026-03-03 14:15:00	5.01	58.47	347.91	7.25	12.69	8.02	0.03
SQU-US	2026-03-03 14:30:00	5.04	58.61	349.19	7.25	12.69	8.39	0.03
SQU-US	2026-03-03 14:45:00	5.04	58.58	349.12	7.25	12.67	8.53	0.03
SQU-US	2026-03-03 15:00:00	5.04	58.59	349.88	7.25	12.65	8.06	0.03

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-03 15:15:00	5.03	58.42	350.85	7.24	12.66	8.06	0.03
SQU-US	2026-03-03 15:30:00	5.03	58.03	352.02	7.19	12.66	7.88	0.03
SQU-US	2026-03-03 15:45:00	5.01	57.85	349.99	7.25	12.66	8.05	0.03
SQU-US	2026-03-03 16:00:00	5.03	57.49	349.61	7.24	12.64	8.04	0.03
SQU-US	2026-03-03 16:15:00	5.00	56.65	349.03	7.30	12.72	7.91	0.03
SQU-US	2026-03-03 16:30:00	4.95	56.83	349.96	7.33	12.77	8.55	0.03
SQU-US	2026-03-03 16:45:00	4.94	56.34	347.90	7.38	12.78	8.08	0.03
SQU-US	2026-03-03 17:00:00	4.93	56.01	348.02	7.39	12.79	7.93	0.02
SQU-US	2026-03-03 17:15:00	4.89	55.49	348.55	7.40	12.81	7.88	0.02
SQU-US	2026-03-03 17:30:00	4.89	55.57	351.43	7.37	12.81	8.10	0.02
SQU-US	2026-03-03 17:45:00	4.88	55.27	350.12	7.42	12.80	7.88	0.02
SQU-US	2026-03-03 18:00:00	4.87	55.39	350.57	7.42	12.79	8.16	0.02
SQU-US	2026-03-03 18:15:00	4.85	55.48	351.86	7.41	12.79	7.85	0.02
SQU-US	2026-03-03 18:30:00	4.84	55.95	353.71	7.38	12.76	8.14	0.02
SQU-US	2026-03-03 18:45:00	4.84	56.27	352.96	7.39	12.74	8.12	0.02
SQU-US	2026-03-03 19:00:00	4.89	58.67	353.82	7.35	12.66	8.11	0.03
SQU-US	2026-03-03 19:15:00	4.94	61.81	353.91	7.32	12.54	8.16	0.03
SQU-US	2026-03-03 19:30:00	4.97	70.03	357.03	7.24	12.50	10.60	0.03
SQU-US	2026-03-03 19:45:00	4.90	67.31	353.61	7.31	12.52	7.87	0.03
SQU-US	2026-03-03 20:00:00	4.90	67.98	354.02	7.31	12.51	8.12	0.03
SQU-US	2026-03-03 20:15:00	4.87	67.26	355.49	7.29	12.46	8.38	0.03
SQU-US	2026-03-03 20:30:00	4.85	60.84	356.73	7.29	12.46	8.36	0.03
SQU-US	2026-03-03 20:45:00	4.85	60.00	356.46	7.22	12.42	8.51	0.03
SQU-US	2026-03-03 21:00:00	4.84	59.24	355.22	7.21	12.43	8.70	0.03
SQU-US	2026-03-03 21:15:00	4.84	58.74	354.91	7.16	12.39	8.50	0.03
SQU-US	2026-03-03 21:30:00	4.84	60.16	356.22	7.10	12.41	9.28	0.03
SQU-US	2026-03-03 21:45:00	4.82	59.77	354.06	7.14	12.39	9.38	0.03
SQU-US	2026-03-03 22:00:00	4.82	59.46	352.79	7.19	12.40	9.78	0.03
SQU-US	2026-03-03 22:15:00	4.82	59.55	351.88	7.20	12.41	9.42	0.03
SQU-US	2026-03-03 22:30:00	4.82	56.92	350.92	7.20	12.43	9.06	0.03
SQU-US	2026-03-03 22:45:00	4.81	56.51	350.28	7.20	12.45	9.95	0.03
SQU-US	2026-03-03 23:00:00	4.81	56.51	349.78	7.19	12.44	9.58	0.03
SQU-US	2026-03-03 23:15:00	4.81	56.44	349.28	7.17	12.43	9.78	0.03
SQU-US	2026-03-03 23:30:00	4.79	61.34	352.49	7.13	12.42	10.04	0.03
SQU-US	2026-03-03 23:45:00	4.80	61.32	351.74	7.10	12.40	9.92	0.03
SQU-US	2026-03-04 00:00:00	4.79	60.90	354.24	7.11	12.43	9.38	0.03
SQU-US	2026-03-04 00:15:00	4.77	60.49	356.79	7.13	12.41	9.96	0.03
SQU-US	2026-03-04 00:30:00	4.78	54.91	359.20	7.09	12.44	10.39	0.02
SQU-US	2026-03-04 00:45:00	4.73	54.54	358.59	7.16	12.44	9.73	0.02
SQU-US	2026-03-04 01:00:00	4.71	54.16	358.37	7.14	12.48	10.05	0.02
SQU-US	2026-03-04 01:15:00	4.70	53.75	358.34	7.14	12.49	10.21	0.02
SQU-US	2026-03-04 01:30:00	4.67	53.24	360.11	7.13	12.52	10.08	0.02
SQU-US	2026-03-04 01:45:00	4.65	52.62	358.29	7.19	12.54	11.88	0.02
SQU-US	2026-03-04 02:00:00	4.63	52.33	359.01	7.18	12.54	10.61	0.02
SQU-US	2026-03-04 02:15:00	4.60	51.68	359.46	7.19	12.55	11.06	0.02
SQU-US	2026-03-04 02:30:00	4.58	51.23	361.79	7.17	12.56	11.14	0.02
SQU-US	2026-03-04 02:45:00	4.55	50.23	359.98	7.22	12.58	11.48	0.02
SQU-US	2026-03-04 03:00:00	4.53	49.75	360.38	7.19	12.59	12.37	0.02
SQU-US	2026-03-04 03:15:00	4.52	49.95	361.31	7.19	12.60	13.27	0.02
SQU-US	2026-03-04 03:30:00	4.49	49.30	364.38	7.14	12.59	1034.03	0.02
SQU-US	2026-03-04 03:45:00	4.47	48.90	363.31	7.16	12.61	12.13	0.02
SQU-US	2026-03-04 04:00:00	4.44	48.04	364.12	7.18	12.61	12.66	0.02
SQU-US	2026-03-04 04:15:00	4.39	47.27	364.58	7.22	12.66	11.33	0.02
SQU-US	2026-03-04 04:30:00	4.36	47.00	365.73	7.26	12.70	16.12	0.02
SQU-US	2026-03-04 04:45:00	4.33	46.28	365.13	7.28	12.73	10.69	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-04 05:00:00	4.28	45.50	365.22	7.33	12.79	10.97	0.02
SQU-US	2026-03-04 05:15:00	4.23	44.67	365.33	7.35	12.80	11.24	0.02
SQU-US	2026-03-04 05:30:00	4.20	43.95	367.84	7.32	12.82	12.26	0.02
SQU-US	2026-03-04 05:45:00	4.17	43.50	367.30	7.35	12.84	12.36	0.02
SQU-US	2026-03-04 06:00:00	4.15	43.14	367.33	7.36	12.86	10.62	0.02
SQU-US	2026-03-04 06:15:00	4.13	42.80	368.45	7.36	12.85	10.67	0.02
SQU-US	2026-03-04 06:30:00	4.09	42.13	370.30	7.35	12.87	16.52	0.02
SQU-US	2026-03-04 06:45:00	4.07	42.14	370.62	7.36	12.89	10.51	0.02
SQU-US	2026-03-04 07:00:00	4.06	42.05	371.81	7.36	12.89	10.95	0.02
SQU-US	2026-03-04 07:15:00	4.05	42.28	372.89	7.35	12.91	10.80	0.02
SQU-US	2026-03-04 07:30:00	4.05	46.46	377.72	7.28	12.91	16.25	0.02
SQU-US	2026-03-04 07:45:00	4.06	47.07	374.95	7.34	12.90	10.85	0.02
SQU-US	2026-03-04 08:00:00	4.07	47.69	375.13	7.33	12.89	10.36	0.02
SQU-US	2026-03-04 08:15:00	4.11	49.31	376.25	7.31	12.83	12.61	0.02
SQU-US	2026-03-04 08:30:00	4.09	43.97	376.61	7.30	12.84	11.48	0.02
SQU-US	2026-03-04 08:45:00	4.10	43.44	375.35	7.31	12.83	9.84	0.02
SQU-US	2026-03-04 09:00:00	4.11	43.54	375.21	7.30	12.83	12.53	0.02
SQU-US	2026-03-04 09:15:00	4.10	42.39	374.11	7.31	12.85	10.42	0.02
SQU-US	2026-03-04 09:30:00	4.11	46.57	376.14	7.27	12.88	13.76	0.02
SQU-US	2026-03-04 09:45:00	4.12	46.59	373.41	7.31	12.88	10.92	0.02
SQU-US	2026-03-04 10:00:00	4.13	47.23	373.58	7.31	12.91	11.14	0.02
SQU-US	2026-03-04 10:15:00	4.15	47.00	373.03	7.31	12.91	11.24	0.02
SQU-US	2026-03-04 10:30:00	4.17	42.16	372.24	7.32	12.94	9.63	0.02
SQU-US	2026-03-04 10:45:00	4.20	42.31	372.26	7.31	12.93	9.62	0.02
SQU-US	2026-03-04 11:00:00	4.24	42.45	371.71	7.31	12.93	9.16	0.02
SQU-US	2026-03-04 11:15:00	4.27	42.37	371.31	7.31	12.94	9.24	0.02
SQU-US	2026-03-04 11:30:00	4.32	46.96	374.94	7.24	12.94	11.81	0.02
SQU-US	2026-03-04 11:45:00	4.36	46.67	371.74	7.27	12.91	9.17	0.02
SQU-US	2026-03-04 12:00:00	4.39	46.66	372.77	7.24	12.91	9.44	0.02
SQU-US	2026-03-04 12:15:00	4.44	46.58	373.53	7.22	12.90	9.46	0.02
SQU-US	2026-03-04 12:30:00	4.49	42.68	374.64	7.21	12.88	9.63	0.02
SQU-US	2026-03-04 12:45:00	4.51	42.45	374.06	7.20	12.88	9.50	0.02
SQU-US	2026-03-04 13:00:00	4.56	42.46	373.56	7.19	12.87	9.84	0.02
SQU-US	2026-03-04 13:15:00	4.62	42.73	373.17	7.18	12.87	9.40	0.02
SQU-US	2026-03-04 13:30:00	4.67	42.80	374.15	7.17	12.87	10.22	0.02
SQU-US	2026-03-04 13:45:00	4.72	42.77	371.56	7.21	12.87	9.37	0.02
SQU-US	2026-03-04 14:00:00	4.76	42.59	371.15	7.19	12.85	9.15	0.02
SQU-US	2026-03-04 14:15:00	4.80	42.33	370.34	7.22	12.87	9.13	0.02
SQU-US	2026-03-04 14:30:00	4.85	42.26	370.59	7.21	12.85	9.84	0.02
SQU-US	2026-03-04 14:45:00	4.88	42.13	368.91	7.23	12.86	9.49	0.02
SQU-US	2026-03-04 15:00:00	4.92	42.05	368.71	7.22	12.84	9.02	0.02
SQU-US	2026-03-04 15:15:00	4.97	42.28	368.58	7.22	12.85	9.09	0.02
SQU-US	2026-03-04 15:30:00	5.05	42.84	370.02	7.18	12.82	9.99	0.02
SQU-US	2026-03-04 15:45:00	5.11	42.56	367.45	7.19	12.80	8.95	0.02
SQU-US	2026-03-04 16:00:00	5.17	42.62	367.00	7.19	12.78	9.20	0.02
SQU-US	2026-03-04 16:15:00	5.23	42.81	366.28	7.19	12.78	8.87	0.02
SQU-US	2026-03-04 16:30:00	5.25	42.94	366.69	7.21	12.78	9.88	0.02
SQU-US	2026-03-04 16:45:00	5.24	42.80	365.21	7.19	12.73	9.04	0.02
SQU-US	2026-03-04 17:00:00	5.18	42.37	364.74	7.29	12.79	8.92	0.02
SQU-US	2026-03-04 17:15:00	5.14	42.05	364.50	7.31	12.79	10.04	0.02
SQU-US	2026-03-04 17:30:00	5.09	42.46	366.87	7.28	12.77	8.85	0.02
SQU-US	2026-03-04 17:45:00	5.03	41.78	364.77	7.34	12.79	8.97	0.02
SQU-US	2026-03-04 18:00:00	4.98	41.37	365.31	7.34	12.81	8.80	0.02
SQU-US	2026-03-04 18:15:00	4.96	41.35	365.81	7.35	12.78	8.62	0.02
SQU-US	2026-03-04 18:30:00	4.95	42.11	367.72	7.33	12.78	10.03	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-04 18:45:00	4.93	42.16	367.86	7.33	12.75	8.72	0.02
SQU-US	2026-03-04 19:00:00	4.90	41.99	368.54	7.34	12.76	8.46	0.02
SQU-US	2026-03-04 19:15:00	4.89	42.08	369.35	7.33	12.74	8.74	0.02
SQU-US	2026-03-04 19:30:00	4.89	47.66	374.34	7.25	12.70	9.80	0.02
SQU-US	2026-03-04 19:45:00	4.92	49.85	372.29	7.29	12.63	8.45	0.02
SQU-US	2026-03-04 20:00:00	4.91	49.66	374.13	7.28	12.60	8.25	0.02
SQU-US	2026-03-04 20:15:00	4.92	49.41	375.19	7.28	12.60	8.47	0.02
SQU-US	2026-03-04 20:30:00	4.94	45.73	376.04	7.27	12.57	8.39	0.02
SQU-US	2026-03-04 20:45:00	4.95	45.89	376.47	7.25	12.55	8.39	0.02
SQU-US	2026-03-04 21:00:00	4.96	45.66	375.61	7.25	12.54	8.25	0.02
SQU-US	2026-03-04 21:15:00	4.98	45.53	375.18	7.24	12.54	8.59	0.02
SQU-US	2026-03-04 21:30:00	5.00	46.00	377.07	7.20	12.52	8.62	0.02
SQU-US	2026-03-04 21:45:00	5.02	45.52	374.97	7.22	12.50	8.29	0.02
SQU-US	2026-03-04 22:00:00	5.06	45.80	376.45	7.12	12.42	8.50	0.02
SQU-US	2026-03-04 22:15:00	5.06	45.97	377.83	7.12	12.42	9.17	0.02
SQU-US	2026-03-04 22:30:00	5.07	46.00	379.77	7.07	12.42	8.52	0.02
SQU-US	2026-03-04 22:45:00	5.07	45.62	381.11	7.00	12.38	8.87	0.02
SQU-US	2026-03-04 23:00:00	5.05	45.82	381.25	7.05	12.43	8.74	0.02
SQU-US	2026-03-04 23:15:00	5.04	46.14	381.08	7.07	12.41	10.10	0.02
SQU-US	2026-03-04 23:30:00	5.03	45.93	382.92	7.04	12.43	8.54	0.02
SQU-US	2026-03-04 23:45:00	5.02	45.99	380.77	7.07	12.43	8.67	0.02
SQU-US	2026-03-05 00:00:00	5.01	46.08	380.72	7.09	12.44	8.58	0.02
SQU-US	2026-03-05 00:15:00	5.00	45.99	381.23	7.08	12.45	8.72	0.02
SQU-US	2026-03-05 00:30:00	4.99	45.78	382.00	7.09	12.46	8.78	0.02
SQU-US	2026-03-05 00:45:00	4.99	45.76	381.21	7.09	12.47	8.66	0.02
SQU-US	2026-03-05 01:00:00	4.99	45.65	381.53	7.08	12.47	8.51	0.02
SQU-US	2026-03-05 01:15:00	4.98	45.17	381.74	7.07	12.46	8.76	0.02
SQU-US	2026-03-05 01:30:00	4.99	45.92	383.85	7.05	12.44	8.81	0.02
SQU-US	2026-03-05 01:45:00	4.99	45.59	382.35	7.08	12.46	8.75	0.02
SQU-US	2026-03-05 02:00:00	4.98	45.60	382.44	7.08	12.45	8.83	0.02
SQU-US	2026-03-05 02:15:00	4.98	45.23	382.65	7.08	12.46	8.84	0.02
SQU-US	2026-03-05 02:30:00	4.98	45.15	383.57	7.08	12.43	8.73	0.02
SQU-US	2026-03-05 02:45:00	4.95	44.82	383.15	7.07	12.47	8.88	0.02
SQU-US	2026-03-05 03:00:00	4.93	44.91	383.73	7.06	12.46	8.45	0.02
SQU-US	2026-03-05 03:15:00	4.90	44.42	384.06	7.08	12.46	9.15	0.02
SQU-US	2026-03-05 03:30:00	4.90	44.49	386.93	7.03	12.45	8.55	0.02
SQU-US	2026-03-05 03:45:00	4.89	44.34	385.21	7.06	12.46	8.69	0.02
SQU-US	2026-03-05 04:00:00	4.88	44.82	385.94	7.04	12.48	8.63	0.02
SQU-US	2026-03-05 04:15:00	4.86	44.89	385.77	7.07	12.47	8.67	0.02
SQU-US	2026-03-05 04:30:00	4.83	44.83	386.72	7.08	12.49	8.85	0.02
SQU-US	2026-03-05 04:45:00	4.81	44.68	385.34	7.09	12.49	8.73	0.02
SQU-US	2026-03-05 05:00:00	4.79	44.31	385.77	7.12	12.50	8.63	0.02
SQU-US	2026-03-05 05:15:00	4.76	44.12	384.93	7.18	12.55	8.80	0.02
SQU-US	2026-03-05 05:30:00	4.71	43.41	385.89	7.22	12.61	9.11	0.02
SQU-US	2026-03-05 05:45:00	4.67	42.88	383.15	7.27	12.65	8.23	0.02
SQU-US	2026-03-05 06:00:00	4.64	42.66	383.25	7.28	12.66	8.36	0.02
SQU-US	2026-03-05 06:15:00	4.62	42.53	383.67	7.28	12.67	8.31	0.02
SQU-US	2026-03-05 06:30:00	4.60	42.66	385.09	7.27	12.69	10.07	0.02
SQU-US	2026-03-05 06:45:00	4.59	42.31	384.11	7.29	12.69	8.24	0.02
SQU-US	2026-03-05 07:00:00	4.57	42.17	384.86	7.29	12.71	8.19	0.02
SQU-US	2026-03-05 07:15:00	4.55	41.96	385.23	7.30	12.72	8.11	0.02
SQU-US	2026-03-05 07:30:00	4.50	42.12	388.48	7.26	12.74	7.99	0.02
SQU-US	2026-03-05 07:45:00	4.47	41.97	386.84	7.31	12.75	8.14	0.02
SQU-US	2026-03-05 08:00:00	4.45	42.02	387.63	7.31	12.76	8.24	0.02
SQU-US	2026-03-05 08:15:00	4.44	42.18	388.11	7.31	12.78	8.09	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-05 08:30:00	4.42	43.11	389.60	7.28	12.77	8.21	0.02
SQU-US	2026-03-05 08:45:00	4.44	45.54	389.84	7.28	12.72	8.14	0.02
SQU-US	2026-03-05 09:00:00	4.51	48.69	389.81	7.24	12.64	8.13	0.02
SQU-US	2026-03-05 09:15:00	4.52	49.02	388.04	7.24	12.66	8.38	0.02
SQU-US	2026-03-05 09:30:00	4.53	48.21	388.79	7.22	12.70	8.36	0.02
SQU-US	2026-03-05 09:45:00	4.57	48.02	385.55	7.26	12.73	8.45	0.02
SQU-US	2026-03-05 10:00:00	4.62	47.02	384.34	7.28	12.79	8.03	0.02
SQU-US	2026-03-05 10:15:00	4.70	46.63	383.42	7.28	12.82	8.08	0.02
SQU-US	2026-03-05 10:30:00	4.80	50.36	383.31	7.26	12.84	9.27	0.02
SQU-US	2026-03-05 10:45:00	4.88	50.71	381.47	7.28	12.83	8.67	0.02
SQU-US	2026-03-05 11:00:00	4.97	50.78	381.34	7.26	12.83	8.29	0.02
SQU-US	2026-03-05 11:15:00	5.05	50.59	381.10	7.22	12.80	8.34	0.02
SQU-US	2026-03-05 11:30:00	5.13	46.50	381.30	7.23	12.79	8.46	0.02
SQU-US	2026-03-05 11:45:00	5.21	46.70	380.82	7.22	12.82	8.55	0.02
SQU-US	2026-03-05 12:00:00	5.33	46.88	381.31	7.15	12.79	8.41	0.02
SQU-US	2026-03-05 12:15:00	5.39	46.91	382.32	7.10	12.79	8.61	0.02
SQU-US	2026-03-05 12:30:00	5.42	47.04	383.52	7.10	12.77	8.63	0.02
SQU-US	2026-03-05 12:45:00	5.38	46.85	382.92	7.11	12.78	8.38	0.02
SQU-US	2026-03-05 13:00:00	5.38	47.02	383.32	7.11	12.78	8.19	0.02
SQU-US	2026-03-05 13:15:00	5.39	47.06	383.00	7.12	12.78	8.47	0.02
SQU-US	2026-03-05 13:30:00	5.42	51.72	386.73	7.08	12.78	8.75	0.02
SQU-US	2026-03-05 13:45:00	5.49	51.63	381.37	7.15	12.78	8.08	0.02
SQU-US	2026-03-05 14:00:00	5.51	51.51	380.89	7.15	12.79	8.29	0.02
SQU-US	2026-03-05 14:15:00	5.52	51.57	380.56	7.14	12.78	8.20	0.02
SQU-US	2026-03-05 14:30:00	5.54	47.11	380.03	7.14	12.78	8.56	0.02
SQU-US	2026-03-05 14:45:00	5.57	47.15	379.49	7.13	12.76	8.25	0.02
SQU-US	2026-03-05 15:00:00	5.61	47.09	378.94	7.15	12.77	8.46	0.02
SQU-US	2026-03-05 15:15:00	5.70	47.09	378.13	7.16	12.76	8.38	0.02
SQU-US	2026-03-05 15:30:00	5.74	51.93	381.11	7.10	12.74	9.05	0.02
SQU-US	2026-03-05 15:45:00	5.70	51.78	377.89	7.20	12.75	8.41	0.02
SQU-US	2026-03-05 16:00:00	5.62	51.86	378.76	7.21	12.75	8.35	0.02
SQU-US	2026-03-05 16:15:00	5.59	51.75	379.54	7.21	12.74	8.27	0.02
SQU-US	2026-03-05 16:30:00	5.59	47.37	380.24	7.22	12.73	8.27	0.02
SQU-US	2026-03-05 16:45:00	5.55	47.57	380.47	7.17	12.73	8.23	0.02
SQU-US	2026-03-05 17:00:00	5.52	47.65	380.11	7.17	12.72	8.31	0.02
SQU-US	2026-03-05 17:15:00	5.48	47.64	379.89	7.17	12.71	8.16	0.02
SQU-US	2026-03-05 17:30:00	5.45	52.23	383.56	7.12	12.73	8.80	0.02
SQU-US	2026-03-05 17:45:00	5.42	52.10	379.97	7.19	12.72	8.09	0.02
SQU-US	2026-03-05 18:00:00	5.38	52.02	381.41	7.22	12.72	8.21	0.02
SQU-US	2026-03-05 18:15:00	5.36	51.61	382.80	7.23	12.69	7.97	0.02
SQU-US	2026-03-05 18:30:00	5.30	47.28	384.64	7.32	12.75	7.94	0.02
SQU-US	2026-03-05 18:45:00	5.29	47.28	378.22	7.31	12.72	8.04	0.02
SQU-US	2026-03-05 19:00:00	5.27	47.39	377.09	7.32	12.71	8.17	0.02
SQU-US	2026-03-05 19:15:00	5.24	46.48	375.33	7.34	12.71	8.14	0.02
SQU-US	2026-03-05 19:30:00	5.22	46.22	373.63	7.30	12.69	8.39	0.02
SQU-US	2026-03-05 19:45:00	5.21	46.75	370.25	7.33	12.66	7.96	0.02
SQU-US	2026-03-05 20:00:00	5.21	47.35	369.65	7.32	12.57	8.04	0.02
SQU-US	2026-03-05 20:15:00	5.20	47.58	368.69	7.31	12.62	8.10	0.02
SQU-US	2026-03-05 20:30:00	5.18	48.13	370.23	7.28	12.60	8.74	0.02
SQU-US	2026-03-05 20:45:00	5.18	48.39	367.28	7.30	12.58	8.09	0.02
SQU-US	2026-03-05 21:00:00	5.21	49.76	366.36	7.28	12.53	8.16	0.02
SQU-US	2026-03-05 21:15:00	5.23	52.05	364.69	7.26	12.49	8.71	0.02
SQU-US	2026-03-05 21:30:00	5.25	51.85	363.14	7.23	12.48	20.08	0.02
SQU-US	2026-03-05 21:45:00	5.25	51.18	357.50	7.26	12.49	8.04	0.02
SQU-US	2026-03-05 22:00:00	5.27	51.48	357.54	7.24	12.47	7.94	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-05 22:15:00	5.28	51.36	357.06	7.23	12.46	7.94	0.02
SQU-US	2026-03-05 22:30:00	5.33	51.93	358.82	7.14	12.40	9.45	0.02
SQU-US	2026-03-05 22:45:00	5.33	51.33	358.92	7.17	12.39	8.01	0.02
SQU-US	2026-03-05 23:00:00	5.33	51.27	359.69	7.15	12.38	8.36	0.02
SQU-US	2026-03-05 23:15:00	5.35	51.33	360.81	7.06	12.31	8.12	0.02
SQU-US	2026-03-05 23:30:00	5.38	56.54	364.27	6.99	12.33	44.47	0.03
SQU-US	2026-03-05 23:45:00	5.40	56.56	363.69	6.98	12.23	46.77	0.03
SQU-US	2026-03-06 00:00:00	5.36	56.43	363.54	7.07	12.28	48.22	0.03
SQU-US	2026-03-06 00:15:00	5.35	56.35	363.66	7.09	12.28	48.35	0.03
SQU-US	2026-03-06 00:30:00	5.34	51.23	363.17	7.11	12.30	8.16	0.02
SQU-US	2026-03-06 00:45:00	5.32	51.31	361.60	7.13	12.32	8.29	0.02
SQU-US	2026-03-06 01:00:00	5.31	51.18	360.39	7.13	12.32	8.34	0.02
SQU-US	2026-03-06 01:15:00	5.30	51.43	359.48	7.14	12.34	8.40	0.02
SQU-US	2026-03-06 01:30:00	5.30	51.64	361.09	7.11	12.34	8.11	0.02
SQU-US	2026-03-06 01:45:00	5.28	51.43	358.77	7.15	12.34	8.47	0.02
SQU-US	2026-03-06 02:00:00	5.26	50.69	358.37	7.15	12.36	8.17	0.02
SQU-US	2026-03-06 02:15:00	5.25	50.17	358.68	7.16	12.37	8.25	0.02
SQU-US	2026-03-06 02:30:00	5.25	50.20	360.64	7.16	12.37	8.37	0.02
SQU-US	2026-03-06 02:45:00	5.24	50.10	360.54	7.16	12.38	8.63	0.02
SQU-US	2026-03-06 03:00:00	5.23	49.56	361.44	7.15	12.36	8.23	0.02
SQU-US	2026-03-06 03:15:00	5.23	49.56	363.14	7.15	12.37	8.21	0.02
SQU-US	2026-03-06 03:30:00	5.24	54.19	369.30	7.08	12.37	13.50	0.02
SQU-US	2026-03-06 03:45:00	5.23	54.02	367.34	7.12	12.36	8.23	0.02
SQU-US	2026-03-06 04:00:00	5.23	54.02	369.52	7.12	12.38	8.25	0.02
SQU-US	2026-03-06 04:15:00	5.22	53.75	371.48	7.11	12.38	8.29	0.02
SQU-US	2026-03-06 04:30:00	5.24	48.97	374.55	7.07	12.40	8.31	0.02
SQU-US	2026-03-06 04:45:00	5.23	48.88	376.76	7.03	12.37	8.18	0.02
SQU-US	2026-03-06 05:00:00	5.20	48.65	377.78	7.07	12.40	8.20	0.02
SQU-US	2026-03-06 05:15:00	5.19	48.63	378.03	7.11	12.43	8.53	0.02
SQU-US	2026-03-06 05:30:00	5.17	48.47	380.48	7.14	12.43	8.27	0.02
SQU-US	2026-03-06 05:45:00	5.16	48.06	379.00	7.21	12.46	8.27	0.02
SQU-US	2026-03-06 06:00:00	5.13	47.62	379.26	7.26	12.51	8.43	0.02
SQU-US	2026-03-06 06:15:00	5.10	47.21	380.18	7.26	12.52	8.37	0.02
SQU-US	2026-03-06 06:30:00	5.09	47.08	380.76	7.26	12.54	8.53	0.02
SQU-US	2026-03-06 06:45:00	5.10	46.79	379.08	7.28	12.54	8.28	0.02
SQU-US	2026-03-06 07:00:00	5.09	46.31	380.08	7.28	12.55	8.29	0.02
SQU-US	2026-03-06 07:15:00	5.07	46.08	381.02	7.28	12.56	8.14	0.02
SQU-US	2026-03-06 07:30:00	5.06	49.94	385.43	7.22	12.57	9.06	0.02
SQU-US	2026-03-06 07:45:00	5.03	49.87	382.80	7.28	12.59	8.09	0.02
SQU-US	2026-03-06 08:00:00	5.03	49.76	383.38	7.29	12.60	8.24	0.02
SQU-US	2026-03-06 08:15:00	5.01	49.94	386.07	7.27	12.61	8.46	0.02
SQU-US	2026-03-06 08:30:00	4.99	46.08	387.02	7.27	12.62	8.34	0.02
SQU-US	2026-03-06 08:45:00	4.97	46.47	385.74	7.29	12.62	8.22	0.02
SQU-US	2026-03-06 09:00:00	4.97	46.93	385.50	7.29	12.63	8.32	0.02
SQU-US	2026-03-06 09:15:00	4.99	49.24	385.96	7.27	12.59	8.17	0.02
SQU-US	2026-03-06 09:30:00	5.04	56.80	389.87	7.20	12.56	11.19	0.03
SQU-US	2026-03-06 09:45:00	5.07	57.77	385.80	7.27	12.57	8.07	0.03
SQU-US	2026-03-06 10:00:00	5.08	57.97	386.27	7.27	12.61	10.14	0.03
SQU-US	2026-03-06 10:15:00	5.11	57.67	386.98	7.27	12.62	7.97	0.03
SQU-US	2026-03-06 10:30:00	5.13	51.46	386.64	7.28	12.69	8.47	0.02
SQU-US	2026-03-06 10:45:00	5.15	50.62	385.10	7.28	12.70	8.33	0.02
SQU-US	2026-03-06 11:00:00	5.18	50.59	384.40	7.28	12.72	8.96	0.02
SQU-US	2026-03-06 11:15:00	5.23	50.74	384.69	7.22	12.70	8.33	0.02
SQU-US	2026-03-06 11:30:00	5.27	51.11	387.00	7.18	12.70	8.34	0.02
SQU-US	2026-03-06 11:45:00	5.31	51.08	386.65	7.13	12.68	8.50	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-06 12:00:00	5.33	51.14	387.53	7.11	12.70	8.09	0.02
SQU-US	2026-03-06 12:15:00	5.36	51.14	388.99	7.05	12.69	8.25	0.02
SQU-US	2026-03-06 12:30:00	5.40	51.14	390.66	7.05	12.68	11.98	0.02
SQU-US	2026-03-06 12:45:00	5.41	51.09	390.74	7.02	12.69	8.57	0.02
SQU-US	2026-03-06 13:00:00	5.41	50.96	391.05	7.04	12.69	8.37	0.02
SQU-US	2026-03-06 13:15:00	5.42	51.20	391.75	7.04	12.68	8.53	0.02
SQU-US	2026-03-06 13:30:00	5.41	56.22	395.99	6.97	12.68	8.20	0.02
SQU-US	2026-03-06 13:45:00	5.40	56.10	391.75	7.07	12.67	8.61	0.02
SQU-US	2026-03-06 14:00:00	5.40	56.22	391.48	7.08	12.68	8.43	0.02
SQU-US	2026-03-06 14:15:00	5.41	56.21	391.57	7.08	12.67	8.14	0.02
SQU-US	2026-03-06 14:30:00	5.42	51.49	392.57	7.07	12.66	9.05	0.02
SQU-US	2026-03-06 14:45:00	5.42	51.51	392.38	7.09	12.64	8.65	0.02
SQU-US	2026-03-06 15:00:00	5.42	51.53	391.87	7.14	12.61	8.55	0.02
SQU-US	2026-03-06 15:15:00	5.42	51.63	391.28	7.14	12.60	9.07	0.02
SQU-US	2026-03-06 15:30:00	5.43	52.14	392.99	7.11	12.57	9.07	0.02
SQU-US	2026-03-06 15:45:00	5.41	51.85	390.75	7.16	12.56	8.94	0.02
SQU-US	2026-03-06 16:00:00	5.41	52.35	390.73	7.16	12.56	8.96	0.02
SQU-US	2026-03-06 16:15:00	5.40	52.28	390.36	7.18	12.60	9.53	0.02
SQU-US	2026-03-06 16:30:00	5.40	52.19	389.86	7.19	12.62	8.94	0.02
SQU-US	2026-03-06 16:45:00	5.41	52.45	388.16	7.21	12.61	9.17	0.02
SQU-US	2026-03-06 17:00:00	5.42	52.62	387.66	7.21	12.61	9.35	0.02
SQU-US	2026-03-06 17:15:00	5.44	52.78	387.40	7.20	12.58	9.19	0.02
SQU-US	2026-03-06 17:30:00	5.45	58.22	390.66	7.12	12.57	10.05	0.03
SQU-US	2026-03-06 17:45:00	5.45	58.44	386.83	7.18	12.54	9.26	0.03
SQU-US	2026-03-06 18:00:00	5.44	58.58	386.26	7.17	12.54	8.90	0.03
SQU-US	2026-03-06 18:15:00	5.44	58.76	385.79	7.17	12.50	8.96	0.03
SQU-US	2026-03-06 18:30:00	5.43	53.57	385.10	7.19	12.50	9.08	0.02
SQU-US	2026-03-06 18:45:00	5.41	53.14	384.31	7.21	12.48	10.25	0.02
SQU-US	2026-03-06 19:00:00	5.42	52.88	384.98	7.15	12.47	9.17	0.02
SQU-US	2026-03-06 19:15:00	5.41	52.27	386.04	7.15	12.45	8.95	0.02
SQU-US	2026-03-06 19:30:00	5.38	51.76	388.07	7.20	12.48	8.91	0.02
SQU-US	2026-03-06 19:45:00	5.32	51.17	385.58	7.28	12.48	9.18	0.02
SQU-US	2026-03-06 20:00:00	5.30	51.14	385.17	7.30	12.50	9.00	0.02
SQU-US	2026-03-06 20:15:00	5.30	51.82	385.82	7.29	12.45	9.27	0.02
SQU-US	2026-03-06 20:30:00	5.28	51.30	386.20	7.29	12.46	9.02	0.02
SQU-US	2026-03-06 20:45:00	5.25	50.85	385.56	7.31	12.49	9.25	0.02
SQU-US	2026-03-06 21:00:00	5.25	51.51	386.10	7.30	12.46	10.24	0.02
SQU-US	2026-03-06 21:15:00	5.30	53.70	386.98	7.27	12.39	8.93	0.02
SQU-US	2026-03-06 21:30:00	5.27	53.81	388.72	7.24	12.42	9.01	0.02
SQU-US	2026-03-06 21:45:00	5.28	53.82	386.72	7.28	12.41	8.91	0.02
SQU-US	2026-03-06 22:00:00	5.30	55.48	387.03	7.26	12.37	8.89	0.02
SQU-US	2026-03-06 22:15:00	5.38	58.72	387.67	7.21	12.23	8.84	0.03
SQU-US	2026-03-06 22:30:00	5.33	56.76	387.46	7.21	12.29	9.06	0.03
SQU-US	2026-03-06 22:45:00	5.34	56.73	386.55	7.22	12.31	8.91	0.03
SQU-US	2026-03-06 23:00:00	5.40	57.72	388.01	7.11	12.18	8.87	0.03
SQU-US	2026-03-06 23:15:00	5.36	56.22	388.69	7.15	12.22	8.85	0.02
SQU-US	2026-03-06 23:30:00	5.41	62.09	393.84	6.99	12.18	9.05	0.03
SQU-US	2026-03-06 23:45:00	5.40	60.31	391.19	7.04	12.21	9.06	0.03
SQU-US	2026-03-07 00:00:00	5.40	60.45	392.14	7.06	12.12	9.25	0.03
SQU-US	2026-03-07 00:15:00	5.37	59.58	391.13	7.11	12.20	9.55	0.03
SQU-US	2026-03-07 00:30:00	5.36	53.44	388.98	7.13	12.24	9.68	0.02
SQU-US	2026-03-07 00:45:00	5.35	53.15	383.83	7.13	12.23	9.39	0.02
SQU-US	2026-03-07 01:00:00	5.36	52.98	379.86	7.12	12.23	9.52	0.02
SQU-US	2026-03-07 01:15:00	5.36	52.77	377.32	7.10	12.23	9.44	0.02
SQU-US	2026-03-07 01:30:00	5.36	52.71	375.86	7.11	12.25	9.18	0.02


Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-07 01:45:00	5.35	52.39	373.38	7.14	12.26	9.28	0.02
SQU-US	2026-03-07 02:00:00	5.34	52.11	372.53	7.15	12.27	9.06	0.02
SQU-US	2026-03-07 02:15:00	5.34	51.90	371.96	7.16	12.27	9.52	0.02
SQU-US	2026-03-07 02:30:00	5.34	52.15	372.86	7.14	12.27	9.33	0.02
SQU-US	2026-03-07 02:45:00	5.34	51.80	373.41	7.15	12.26	9.02	0.02
SQU-US	2026-03-07 03:00:00	5.34	51.53	373.88	7.15	12.28	9.23	0.02
SQU-US	2026-03-07 03:15:00	5.33	51.43	374.01	7.15	12.24	9.64	0.02
SQU-US	2026-03-07 03:30:00	5.33	56.37	377.69	7.09	12.27	9.95	0.03
SQU-US	2026-03-07 03:45:00	5.33	56.20	373.88	7.15	12.29	9.48	0.02
SQU-US	2026-03-07 04:00:00	5.33	55.96	373.70	7.15	12.27	9.89	0.02
SQU-US	2026-03-07 04:15:00	5.34	56.02	374.11	7.13	12.26	9.65	0.02
SQU-US	2026-03-07 04:30:00	5.33	50.83	373.59	7.15	12.27	9.52	0.02
SQU-US	2026-03-07 04:45:00	5.33	50.74	372.82	7.14	12.27	9.14	0.02
SQU-US	2026-03-07 05:00:00	5.32	50.60	373.77	7.16	12.28	9.52	0.02
SQU-US	2026-03-07 05:15:00	5.31	50.32	375.24	7.18	12.31	9.31	0.02
SQU-US	2026-03-07 05:30:00	5.34	50.47	378.98	7.10	12.23	9.43	0.02
SQU-US	2026-03-07 05:45:00	5.34	50.30	380.30	7.03	12.28	9.20	0.02
SQU-US	2026-03-07 06:00:00	5.32	50.16	382.49	7.11	12.31	9.16	0.02
SQU-US	2026-03-07 06:15:00	5.30	49.57	383.07	7.20	12.34	9.10	0.02
SQU-US	2026-03-07 06:30:00	5.23	48.67	383.74	7.23	12.41	10.43	0.02
SQU-US	2026-03-07 06:45:00	5.20	48.39	383.59	7.28	12.45	9.37	0.02
SQU-US	2026-03-07 07:00:00	5.19	48.21	384.45	7.28	12.45	9.58	0.02
SQU-US	2026-03-07 07:15:00	5.19	47.97	385.43	7.28	12.45	9.52	0.02
SQU-US	2026-03-07 07:30:00	5.17	50.03	388.59	7.25	12.47	10.86	0.02
SQU-US	2026-03-07 07:45:00	5.15	49.89	387.20	7.29	12.48	10.24	0.02
SQU-US	2026-03-07 08:00:00	5.15	49.93	388.02	7.28	12.48	10.13	0.02
SQU-US	2026-03-07 08:15:00	5.13	49.68	388.09	7.29	12.50	10.28	0.02
SQU-US	2026-03-07 08:30:00	5.12	48.05	388.28	7.30	12.50	10.05	0.02
SQU-US	2026-03-07 08:45:00	5.10	47.94	388.32	7.30	12.52	9.99	0.02
SQU-US	2026-03-07 09:00:00	5.11	47.96	388.73	7.30	12.53	9.50	0.02
SQU-US	2026-03-07 09:15:00	5.12	49.11	389.21	7.29	12.50	9.82	0.02
SQU-US	2026-03-07 09:30:00	5.22	59.43	394.45	7.19	12.37	10.44	0.03
SQU-US	2026-03-07 09:45:00	5.20	57.65	390.90	7.26	12.37	9.63	0.03
SQU-US	2026-03-07 10:00:00	5.26	60.44	391.22	7.25	12.35	9.85	0.03
SQU-US	2026-03-07 10:15:00	5.29	61.39	391.90	7.24	12.34	9.56	0.03
SQU-US	2026-03-07 10:30:00	5.27	53.63	390.88	7.25	12.42	9.63	0.02
SQU-US	2026-03-07 10:45:00	5.28	53.03	389.94	7.25	12.44	9.98	0.02
SQU-US	2026-03-07 11:00:00	5.30	51.99	389.23	7.24	12.47	9.78	0.02
SQU-US	2026-03-07 11:15:00	5.34	52.39	390.10	7.20	12.45	9.53	0.02
SQU-US	2026-03-07 11:30:00	5.38	52.31	393.89	7.07	12.39	8.97	0.02
SQU-US	2026-03-07 11:45:00	5.44	52.71	394.63	7.01	12.32	9.48	0.02
SQU-US	2026-03-07 12:00:00	5.43	52.17	393.89	7.11	12.39	9.43	0.02
SQU-US	2026-03-07 12:15:00	5.45	52.20	392.94	7.15	12.46	9.41	0.02
SQU-US	2026-03-07 12:30:00	5.50	52.03	393.04	7.13	12.46	9.72	0.02
SQU-US	2026-03-07 12:45:00	5.53	51.86	391.33	7.14	12.47	9.48	0.02
SQU-US	2026-03-07 13:00:00	5.57	52.02	390.77	7.15	12.48	8.77	0.02
SQU-US	2026-03-07 13:15:00	5.61	52.07	389.71	7.15	12.49	9.21	0.02
SQU-US	2026-03-07 13:30:00	5.64	54.64	391.17	7.13	12.48	10.08	0.02
SQU-US	2026-03-07 13:45:00	5.66	54.60	389.16	7.16	12.47	9.26	0.02
SQU-US	2026-03-07 14:00:00	5.69	54.59	389.05	7.17	12.49	10.49	0.02
SQU-US	2026-03-07 14:15:00	5.71	54.42	388.99	7.16	12.50	9.73	0.02
SQU-US	2026-03-07 14:30:00	5.74	52.23	388.67	7.17	12.49	9.58	0.02
SQU-US	2026-03-07 14:45:00	5.76	52.18	388.74	7.18	12.49	10.49	0.02
SQU-US	2026-03-07 15:00:00	5.78	52.61	388.69	7.18	12.48	10.11	0.02
SQU-US	2026-03-07 15:15:00	5.78	52.50	388.60	7.19	12.49	9.43	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-07 15:30:00	5.78	57.40	392.04	7.13	12.48	11.92	0.03
SQU-US	2026-03-07 15:45:00	5.78	57.83	389.16	7.18	12.48	11.34	0.03
SQU-US	2026-03-07 16:00:00	5.78	57.55	390.22	7.19	12.47	11.51	0.03
SQU-US	2026-03-07 16:15:00	5.78	57.06	391.09	7.19	12.48	11.55	0.03
SQU-US	2026-03-07 16:30:00	5.80	51.91	391.47	7.20	12.47	11.23	0.02
SQU-US	2026-03-07 16:45:00	5.81	51.89	390.60	7.20	12.49	11.62	0.02
SQU-US	2026-03-07 17:00:00	5.83	51.64	389.58	7.20	12.47	13.05	0.02
SQU-US	2026-03-07 17:15:00	5.85	51.70	389.25	7.19	12.43	11.68	0.02
SQU-US	2026-03-07 17:30:00	5.85	51.34	390.53	7.16	12.44	12.34	0.02
SQU-US	2026-03-07 17:45:00	5.86	51.37	388.26	7.19	12.41	12.28	0.02
SQU-US	2026-03-07 18:00:00	5.84	51.15	388.34	7.20	12.39	14.94	0.02
SQU-US	2026-03-07 18:15:00	5.84	49.87	388.42	7.18	12.39	13.14	0.02
SQU-US	2026-03-07 18:30:00	5.82	51.48	389.81	7.17	12.35	12.39	0.02
SQU-US	2026-03-07 18:45:00	5.80	51.24	388.88	7.18	12.34	12.10	0.02
SQU-US	2026-03-07 19:00:00	5.79	50.87	388.99	7.17	12.32	12.14	0.02
SQU-US	2026-03-07 19:15:00	5.77	51.00	389.84	7.13	12.30	12.84	0.02
SQU-US	2026-03-07 19:30:00	5.75	50.78	393.91	7.08	12.33	11.68	0.02
SQU-US	2026-03-07 19:45:00	5.76	50.44	391.81	7.12	12.32	12.32	0.02
SQU-US	2026-03-07 20:00:00	5.73	49.75	391.19	7.22	12.32	12.19	0.02
SQU-US	2026-03-07 20:15:00	5.69	48.99	390.36	7.28	12.37	11.87	0.02
SQU-US	2026-03-07 20:30:00	5.67	48.70	391.04	7.28	12.38	13.21	0.02
SQU-US	2026-03-07 20:45:00	5.67	48.39	389.65	7.30	12.39	12.09	0.02
SQU-US	2026-03-07 21:00:00	5.67	48.29	389.62	7.31	12.38	12.46	0.02
SQU-US	2026-03-07 21:15:00	5.65	47.80	389.71	7.31	12.40	12.96	0.02
SQU-US	2026-03-07 21:30:00	5.66	51.90	392.80	7.27	12.37	15.54	0.02
SQU-US	2026-03-07 21:45:00	5.64	51.74	390.47	7.30	12.41	16.35	0.02
SQU-US	2026-03-07 22:00:00	5.64	52.07	390.79	7.30	12.39	15.59	0.02
SQU-US	2026-03-07 22:15:00	5.63	51.60	390.66	7.30	12.41	17.14	0.02
SQU-US	2026-03-07 22:30:00	5.62	48.00	391.02	7.30	12.42	17.17	0.02
SQU-US	2026-03-07 22:45:00	5.62	48.52	391.21	7.29	12.41	15.48	0.02
SQU-US	2026-03-07 23:00:00	5.60	48.57	391.12	7.29	12.42	17.00	0.02
SQU-US	2026-03-07 23:15:00	5.56	47.16	390.65	7.31	12.45	17.70	0.02
SQU-US	2026-03-07 23:30:00	5.53	51.12	395.34	7.24	12.47	18.73	0.02
SQU-US	2026-03-07 23:45:00	5.50	50.04	391.60	7.30	12.48	18.22	0.02
SQU-US	2026-03-08 00:00:00	5.46	49.47	391.83	7.30	12.50	17.70	0.02
SQU-US	2026-03-08 00:15:00	5.41	48.15	392.75	7.27	12.52	18.51	0.02
SQU-US	2026-03-08 00:30:00	5.40	43.32	392.30	7.32	12.53	31.78	0.02
SQU-US	2026-03-08 00:45:00	5.37	42.97	391.94	7.29	12.56	24.14	0.02
SQU-US	2026-03-08 01:00:00	5.35	42.59	391.26	7.29	12.56	22.78	0.02
SQU-US	2026-03-08 01:15:00	5.31	41.70	391.40	7.29	12.58	21.65	0.02
SQU-US	2026-03-08 01:30:00	5.27	40.58	394.13	7.26	12.58	21.65	0.02
SQU-US	2026-03-08 01:45:00	5.24	39.72	392.17	7.29	12.60	22.65	0.02
SQU-US	2026-03-08 03:00:00	5.04	36.64	395.76	7.26	12.71	33.22	0.02
SQU-US	2026-03-08 03:15:00	5.05	36.10	395.46	7.27	12.73	33.42	0.02
SQU-US	2026-03-08 03:30:00	5.05	39.46	397.29	7.25	12.76	64.47	0.02
SQU-US	2026-03-08 03:45:00	5.02	38.11	396.17	7.29	12.79	42.66	0.02
SQU-US	2026-03-08 04:00:00	5.00	37.99	396.71	7.28	12.81	44.71	0.02
SQU-US	2026-03-08 04:15:00	4.97	37.01	396.61	7.28	12.85	50.45	0.02
SQU-US	2026-03-08 04:30:00	4.94	32.77	395.62	7.30	12.90	40.85	0.01
SQU-US	2026-03-08 04:45:00	4.92	32.99	397.58	7.27	12.94	40.19	0.01
SQU-US	2026-03-08 05:00:00	4.84	31.70	398.50	7.26	13.00	45.88	0.01
SQU-US	2026-03-08 05:15:00	4.80	31.30	399.94	7.25	13.06	38.25	0.01
SQU-US	2026-03-08 05:30:00	4.76	33.74	402.43	7.23	13.12	72.29	0.01
SQU-US	2026-03-08 05:45:00	4.73	33.18	399.58	7.27	13.16	35.26	0.01
SQU-US	2026-03-08 06:00:00	4.69	32.75	399.80	7.27	13.19	43.80	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-08 06:15:00	4.65	31.69	399.35	7.28	13.24	40.37	0.01
SQU-US	2026-03-08 06:30:00	4.60	28.47	402.19	7.23	13.29	56.51	0.01
SQU-US	2026-03-08 06:45:00	4.57	28.61	401.87	7.24	13.30	48.16	0.01
SQU-US	2026-03-08 07:00:00	4.51	27.96	402.38	7.24	13.33	37.51	0.01
SQU-US	2026-03-08 07:15:00	4.45	27.32	402.66	7.24	13.37	40.32	0.01
SQU-US	2026-03-08 07:30:00	4.40	27.08	405.54	7.21	13.39	53.70	0.01
SQU-US	2026-03-08 07:45:00	4.36	26.71	403.41	7.24	13.40	46.65	0.01
SQU-US	2026-03-08 08:00:00	4.32	26.55	404.53	7.22	13.40	46.20	0.01
SQU-US	2026-03-08 08:15:00	4.30	26.58	404.90	7.23	13.40	44.00	0.01
SQU-US	2026-03-08 08:30:00	4.29	27.05	407.83	7.20	13.39	55.03	0.01
SQU-US	2026-03-08 08:45:00	4.27	26.17	405.14	7.22	13.40	56.31	0.01
SQU-US	2026-03-08 09:00:00	4.25	26.14	404.50	7.23	13.40	52.51	0.01
SQU-US	2026-03-08 09:15:00	4.27	26.48	404.61	7.21	13.38	45.04	0.01
SQU-US	2026-03-08 09:30:00	4.28	26.33	406.08	7.18	13.39	58.79	0.01
SQU-US	2026-03-08 09:45:00	4.30	26.07	402.44	7.21	13.38	57.74	0.01
SQU-US	2026-03-08 10:00:00	4.35	26.50	401.33	7.21	13.37	50.27	0.01
SQU-US	2026-03-08 10:15:00	4.40	26.81	400.37	7.20	13.35	51.49	0.01
SQU-US	2026-03-08 10:30:00	4.44	27.01	402.28	7.16	13.31	56.98	0.01
SQU-US	2026-03-08 10:45:00	4.48	27.01	397.58	7.18	13.31	45.97	0.01
SQU-US	2026-03-08 11:00:00	4.52	26.77	395.62	7.18	13.29	49.04	0.01
SQU-US	2026-03-08 11:15:00	4.55	26.68	393.15	7.19	13.28	30.37	0.01
SQU-US	2026-03-08 11:30:00	4.59	29.02	396.40	7.12	13.14	75.76	0.01
SQU-US	2026-03-08 11:45:00	4.61	29.36	390.71	7.19	13.27	39.81	0.01
SQU-US	2026-03-08 12:00:00	4.61	28.86	389.92	7.19	13.26	32.33	0.01
SQU-US	2026-03-08 12:15:00	4.64	29.34	390.57	7.20	13.24	34.95	0.01
SQU-US	2026-03-08 12:30:00	4.65	26.79	389.99	7.21	13.24	52.74	0.01
SQU-US	2026-03-08 12:45:00	4.71	26.86	386.59	7.19	13.22	36.72	0.01
SQU-US	2026-03-08 13:00:00	4.79	27.09	383.46	7.20	13.20	32.73	0.01
SQU-US	2026-03-08 13:15:00	4.86	26.84	380.66	7.21	13.20	35.74	0.01
SQU-US	2026-03-08 13:30:00	4.93	26.94	380.57	7.18	13.17	38.15	0.01
SQU-US	2026-03-08 13:45:00	4.98	27.19	376.74	7.20	13.16	33.16	0.01
SQU-US	2026-03-08 14:00:00	5.05	27.45	375.34	7.19	13.13	35.51	0.01
SQU-US	2026-03-08 14:15:00	5.08	26.94	374.13	7.19	13.11	30.93	0.01
SQU-US	2026-03-08 14:30:00	5.13	27.14	373.94	7.19	13.10	42.59	0.01
SQU-US	2026-03-08 14:45:00	5.15	27.17	372.20	7.18	13.08	35.69	0.01
SQU-US	2026-03-08 15:00:00	5.15	27.13	371.02	7.19	13.05	35.63	0.01
SQU-US	2026-03-08 15:15:00	5.15	27.53	372.09	7.16	13.03	28.97	0.01
SQU-US	2026-03-08 15:30:00	5.14	30.00	373.98	7.15	13.03	43.79	0.01
SQU-US	2026-03-08 15:45:00	5.13	29.89	369.60	7.21	13.02	31.61	0.01
SQU-US	2026-03-08 16:00:00	5.14	30.84	371.33	7.18	13.00	33.07	0.01
SQU-US	2026-03-08 16:15:00	5.12	30.05	371.07	7.20	12.99	28.59	0.01
SQU-US	2026-03-08 16:30:00	5.09	27.32	371.38	7.20	12.99	47.05	0.01
SQU-US	2026-03-08 16:45:00	5.09	27.65	371.37	7.19	12.97	36.31	0.01
SQU-US	2026-03-08 17:00:00	5.06	28.03	371.20	7.19	12.96	24.46	0.01
SQU-US	2026-03-08 17:15:00	5.02	28.02	371.40	7.20	12.95	37.60	0.01
SQU-US	2026-03-08 17:30:00	4.97	31.00	374.68	7.16	12.93	38.21	0.01
SQU-US	2026-03-08 17:45:00	4.92	31.07	373.01	7.20	12.93	36.05	0.01
SQU-US	2026-03-08 18:00:00	4.87	31.54	374.62	7.20	12.91	36.57	0.01
SQU-US	2026-03-08 18:15:00	4.82	31.19	376.27	7.19	12.91	39.66	0.01
SQU-US	2026-03-08 18:30:00	4.79	28.85	377.82	7.19	12.89	31.13	0.01
SQU-US	2026-03-08 18:45:00	4.79	29.56	378.49	7.18	12.87	25.60	0.01
SQU-US	2026-03-08 19:00:00	4.76	29.19	379.10	7.19	12.87	28.67	0.01
SQU-US	2026-03-08 19:15:00	4.74	28.90	379.10	7.20	12.87	37.16	0.01
SQU-US	2026-03-08 19:30:00	4.72	29.01	381.85	7.17	12.86	41.13	0.01
SQU-US	2026-03-08 19:45:00	4.70	29.45	381.24	7.19	12.85	31.94	0.01

**Squamish River**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-03-08 20:00:00	4.68	29.60	381.40	7.20	12.85	36.29	0.01
SQU-US	2026-03-08 20:15:00	4.68	30.05	382.74	7.19	12.84	30.33	0.01
SQU-US	2026-03-08 20:30:00	4.67	30.63	384.85	7.19	12.82	41.37	0.01
SQU-US	2026-03-08 20:45:00	4.65	30.36	384.54	7.18	12.83	34.64	0.01
SQU-US	2026-03-08 21:00:00	4.63	30.29	384.98	7.19	12.84	41.78	0.01
SQU-US	2026-03-08 21:15:00	4.61	30.58	385.54	7.19	12.84	33.56	0.01
SQU-US	2026-03-08 21:30:00	4.59	33.67	390.77	7.14	12.84	35.53	0.01
SQU-US	2026-03-08 21:45:00	4.54	33.29	388.06	7.20	12.85	34.98	0.01
SQU-US	2026-03-08 22:00:00	4.49	33.08	389.56	7.19	12.86	37.05	0.01
SQU-US	2026-03-08 22:15:00	4.45	33.53	390.22	7.21	12.87	28.79	0.01
SQU-US	2026-03-08 22:30:00	4.43	31.15	392.90	7.19	12.85	29.40	0.01
SQU-US	2026-03-08 22:45:00	4.40	31.38	392.58	7.20	12.84	28.69	0.01
SQU-US	2026-03-08 23:00:00	4.38	31.91	393.76	7.18	12.84	27.80	0.01
SQU-US	2026-03-08 23:15:00	4.36	32.03	393.56	7.17	12.83	27.32	0.01
SQU-US	2026-03-08 23:30:00	4.33	32.00	394.68	7.15	12.83	37.56	0.01
SQU-US	2026-03-08 23:45:00	4.30	32.39	392.04	7.18	12.84	33.74	0.01

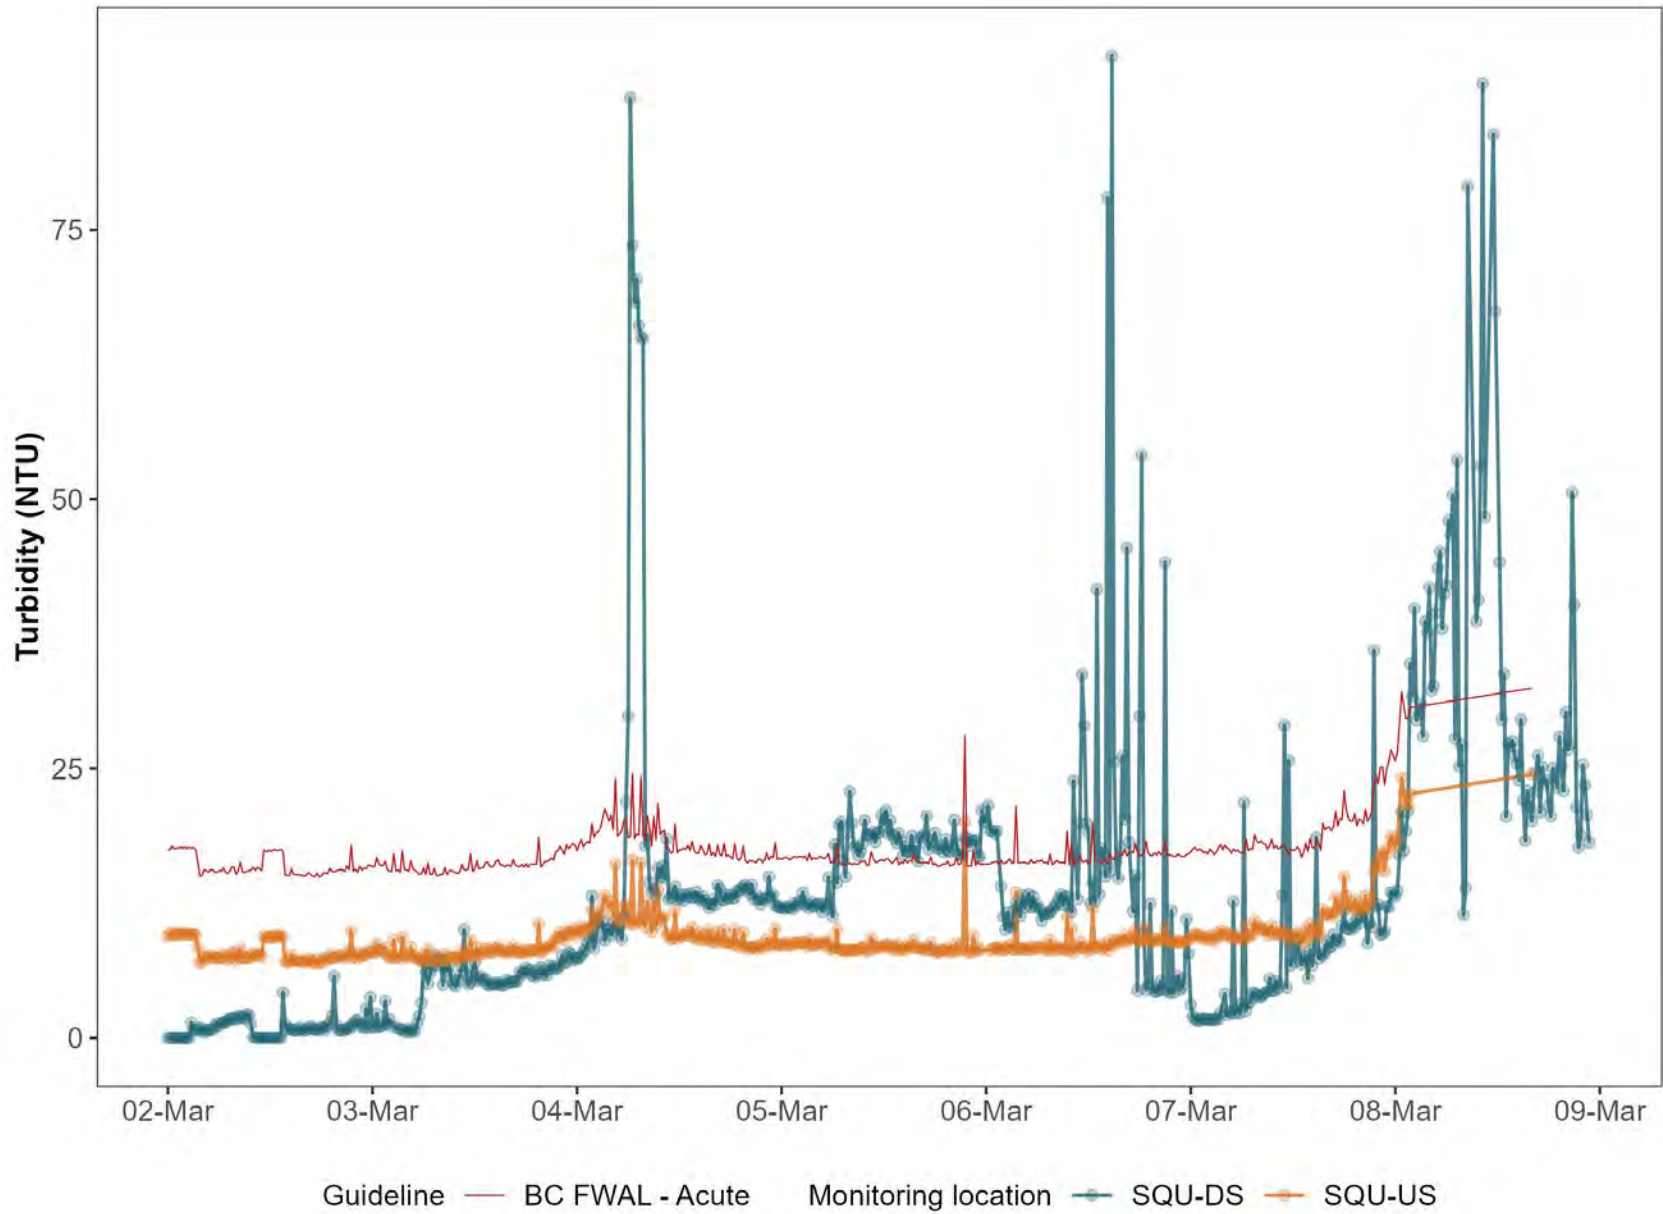



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	C-1

**Appendix C:  
Woodfibre Site Point of Discharge from Water  
Treatment Plant Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	C-2

## Woodfibre Site Sample Analysis



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-03-03 10:26:00
<b>In situ Parameters</b>								
Field pH	pH Units		6.5 - 9			7 - 8.7		<b>6.11</b>
Field Temperature	°C	18	19					10.3
<b>General Parameters</b>								
pH	pH Units							7.07
Alkalinity (Total as CaCO3)	mg/L							53
Alkalinity (PP as CaCO3)	mg/L							<1
Hardness (CaCO3)-Total	mg/L							63.1
Hardness (CaCO3)-Dissolved	mg/L							65
Sulphide-Total	mg/L							<0.0018
Sulphide (as H2S)	mg/L			0.002				<0.002
Un-ionized Hydrogen Sulfide as H2S-T	mg/L							<0.0019
Un-ionized Hydrogen Sulfide as S-Tot	mg/L							<0.0018
<b>Anions and Nutrients</b>								
Ammonia (N)-Total	mg/L	1.82	25.2		20	131		<0.015
Bicarbonate (HCO3)	mg/L							64
Carbonate (CO3)	mg/L							<1
Hydroxide (OH)	mg/L							<1
Nitrate (N)	mg/L	3	32.8		3.7			0.091
Nitrite (N)	mg/L	0.2	0.6					0.0096
Nitrate plus Nitrite (N)	mg/L							0.1
Nitrogen (N)-Total	mg/L							0.256
Phosphorus (P)-Total (4500-P)	mg/L							0.0024
Bromide (Br)	mg/L							<0.01
Chloride (Cl)	mg/L	150	600					12
Fluoride (F)	mg/L		1.148987			1.5		0.32
Sulphate (SO4)-Dissolved	mg/L	218						13
<b>Total Metals</b>								
Aluminum (Al)-Total	mg/L	0.0284201						<b>0.324</b>
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000314
Arsenic (As)-Total	mg/L	0.005			0.0125			0.00102
Barium (Ba)-Total	mg/L			1				0.00732
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001
Bismuth (Bi)-Total	mg/L							<0.000005
Boron (B)-Total	mg/L	1.2			1.2			0.011
Cadmium (Cd)-Total	mg/L						0.00012	<0.000005
Calcium (Ca)-Total	mg/L							23.6
Cesium (Cs)-Total	mg/L							0.000069
Chromium (Cr)-Total	mg/L							0.00044
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-03-03 10:26:00
<b>Total Metals (cont'd.)</b>								
Cobalt (Co)-Total	mg/L							0.000037
Copper (Cu)-Total	mg/L				0.002	0.003		0.000736
Iron (Fe)-Total	mg/L		1					0.099
Lead (Pb)-Total	mg/L				0.002	0.14		0.0000754
Lithium (Li)-Total	mg/L							0.00347
Magnesium (Mg)-Total	mg/L							1.01
Manganese (Mn)-Total	mg/L	0.88264	1.235362				0.1	0.0166
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.0317
Nickel (Ni)-Total	mg/L						0.0083	0.000169
Phosphorus (P)-Total (ICPMS)	mg/L							0.0045
Potassium (K)-Total	mg/L							1.4
Rubidium (Rb)-Total	mg/L							0.00327
Selenium (Se)-Total	mg/L	0.002			0.002			0.000048
Silicon (Si)-Total	mg/L							6.73
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.000005
Sodium (Na)-Total	mg/L							6.16
Strontium (Sr)-Total	mg/L							0.0541
Sulphur (S)-Total	mg/L							4.3
Tellurium (Te)-Total	mg/L							<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000079
Thorium (Th)-Total	mg/L							<0.00005
Tin (Sn)-Total	mg/L							<0.0002
Titanium (Ti)-Total	mg/L							0.00254
Uranium (U)-Total	mg/L		0.0165	0.0075				0.00113
Vanadium (V)-Total	mg/L			0.06			0.005	0.00031
Zinc (Zn)-Total	mg/L				0.01	0.055		0.00255
Zirconium (Zr)-Total	mg/L							<0.0001
<b>Dissolved Metals</b>								
Aluminum (Al)-Dissolved	mg/L							0.0891
Antimony (Sb)-Dissolved	mg/L							0.000272
Arsenic (As)-Dissolved	mg/L							0.000905
Barium (Ba)-Dissolved	mg/L							0.00646
Beryllium (Be)-Dissolved	mg/L							<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005
Boron (B)-Dissolved	mg/L							0.013
Cadmium (Cd)-Dissolved	mg/L	0.0001507	0.0003661					0.0000058
Calcium (Ca)-Dissolved	mg/L							24.4
Cesium (Cs)-Dissolved	mg/L							0.000057
Chromium (Cr)-Dissolved	mg/L							0.00041

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-03-03 10:26:00
<b>Dissolved Metals (cont'd.)</b>								
Cobalt (Co)-Dissolved	mg/L	0.0004214						0.0000253
Copper (Cu)-Dissolved	mg/L	0.0002	0.0002					<b>0.000412</b>
Iron (Fe)-Dissolved	mg/L		0.35					0.0019
Lead (Pb)-Dissolved	mg/L	0.0018762						<0.000005
Lithium (Li)-Dissolved	mg/L							0.00334
Manganese (Mn)-Dissolved	mg/L							0.015
Magnesium (Mg)-Dissolved	mg/L							0.951
Mercury (Hg)-Dissolved	mg/L							<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.0316
Nickel (Ni)-Dissolved	mg/L	0.0012	0.0224					0.000159
Phosphorus (P)-Dissolved	mg/L							0.0046
Potassium (K)-Dissolved	mg/L							1.32
Rubidium (Rb)-Dissolved	mg/L							0.00302
Selenium (Se)-Dissolved	mg/L							<0.00004
Silicon (Si)-Dissolved	mg/L							6.62
Silver (Ag)-Dissolved	mg/L							<0.000005
Sodium (Na)-Dissolved	mg/L							5.83
Strontium (Sr)-Dissolved	mg/L			1.25				0.0496
Sulphur (S)-Dissolved	mg/L							3.8
Tellurium (Te)-Dissolved	mg/L							<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000069
Thorium (Th)-Dissolved	mg/L							0.0000117
Tin (Sn)-Dissolved	mg/L							<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005
Uranium (U)-Dissolved	mg/L							0.0012
Vanadium (V)-Dissolved	mg/L							0.00027
Zinc (Zn)-Dissolved	mg/L	0.0129281	0.0267198					0.00172
Zirconium (Zr)-Dissolved	mg/L							<0.0001
<b>Inorganics</b>								
Organic Carbon (C)-Total	mg/L							1.4
Organic Carbon (C)-Dissolved	mg/L							1
Solids-Total Dissolved	mg/L							76
Solids-Total Suspended	mg/L	6.6	26.6					3.2
<b>Organics</b>								
Ethylene Glycol	mg/L							<3
Diethylene Glycol	mg/L							<5
Triethylene Glycol	mg/L							<5
Propylene Glycol	mg/L							<5
VH C6-C10	mg/L							<0.3
1,1,1,2-Tetrachloroethane	mg/L							<0.0005

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-03-03 10:26:00
<b>Organics (cont'd.)</b>								
1,1,1-Trichloroethane	mg/L							<0.0005
1,1,2,2-Tetrachloroethane	mg/L							<0.0005
1,1,2Trichloro-1,2,2Trifluoroethane	mg/L							<0.002
1,1,2-Trichloroethane	mg/L							<0.0005
1,1-Dichloroethane	mg/L							<0.0005
1,1-Dichloroethene	mg/L							<0.0005
1,2,3-trichlorobenzene	mg/L			0.008				<0.002
1,2,4-trichlorobenzene	mg/L			0.024			0.0054	<0.002
1,2-dibromoethane	mg/L							<0.0002
1,2-Dichlorobenzene	mg/L			0.0007			0.042	<0.0005
1,2-Dichloroethane	mg/L			0.1				<0.0005
1,2-Dichloropropane	mg/L							<0.0005
1,3,5-trimethylbenzene	mg/L							<0.002
1,3-Butadiene	mg/L							<0.0005
1,3-Dichlorobenzene	mg/L			0.15				<0.0005
1,3-dichloropropane	mg/L							<0.001
1,4-Dichlorobenzene	mg/L			0.026				<0.0005
Benzene	mg/L	0.04				0.11		<0.0004
Bromobenzene	mg/L							<0.002
Bromodichloromethane	mg/L							<0.001
Bromoform	mg/L							<0.001
Bromomethane	mg/L							<0.001
Carbon tetrachloride	mg/L							<0.0005
Chlorobenzene	mg/L			0.0013			0.025	<0.0005
Chloroethane	mg/L							<0.001
Chloroform	mg/L							<0.001
Chloromethane	mg/L							<0.001
cis-1,2-Dichloroethene	mg/L							<0.001
cis-1,3-Dichloropropene	mg/L							<0.001
Dibromochloromethane	mg/L							<0.001
Dichlorodifluoromethane	mg/L							<0.002
Dichloromethane	mg/L			0.0981				<0.002
Ethylbenzene	mg/L	0.2				0.25		<0.0004
Hexachlorobutadiene	mg/L							<0.0005
Isopropylbenzene	mg/L							<0.002
Methyl-tert-butylether (MTBE)	mg/L		3.4			0.44		<0.004
Styrene	mg/L			0.072				<0.0005
Tetrachloroethene	mg/L							<0.0005
Toluene	mg/L	0.0005						<0.0004
trans-1,2-dichloroethene	mg/L							<0.001

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNQ EOP 2026-03-03 10:26:00
<b>Organics (cont'd.)</b>								
trans-1,3-dichloropropene	mg/L							<0.001
Trichloroethene	mg/L							<0.0005
Trichlorofluoromethane	mg/L							<0.004
Vinyl chloride	mg/L							<0.0005
VPH (VH6 to 10 - BTEX)	mg/L							<0.3
Xylenes (Total)	mg/L	0.03						<0.0004
m & p-Xylene	mg/L							<0.0004
o-Xylene	mg/L							<0.0004
Phenols	mg/L		0.05					<0.0015

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.


<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	C-3

## Woodfibre Site WTP Discharge Field Notes and Logs

		<b>Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope</b>	
<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Table of Contents:**

1. Executive Summary and Notes
2. Discharge Parameter Summary
3. WTP Calibration Log

**Appendices:**

- Appendix A- WTP Data Log
- Appendix B- YSI Data Log
- Appendix C- Photos

**1. Executive Summary and Field Notes:**

Parameters, including temperature, NTU, pH, DO, salinity, conductivity, and oxidation-reduction potential (ORP), were monitored throughout the discharge process and remained within prescribed limits.

On March 3<sup>rd</sup> some elevated NTU readings were recorded between 13:45 and 16:00 while chemical injection rates were adjusted due to change with influent water quality. During this time interval a reading of 0NTU was recorded at 14:00 during NTU probe calibration. NTU readings were consistently low during discharge throughout this reporting period.

No visible sheen was observed on the surface of the WTP tanks or in the discharged water. All relevant parameters were measured using YSI instruments and WTP probes.

The total discharge volume up to March 8<sup>th</sup> was 1,196,177m<sup>3</sup>.

**Daily Volume Summary:**

**Table 1: Discharge Volumes Daily Summary**

<b>Date</b>	<b>Location</b>	<b>Volume (m3)</b>	<b>Comments</b>
March 02	Woodfibre (WF)	2,730	Exceeded discharge volume limit
March 03	WF	2,773	Exceeded discharge volume limit
March 04	WF	2,835	Exceeded discharge volume limit
March 05	WF	2,734	Exceeded discharge volume limit



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

March 06	WF	2,775	Exceeded discharge volume limit
March 07	WF	2,923	Exceeded discharge volume limit
March 08	WF	2,815	Exceeded discharge volume limit
<b>Total</b>		<b>19,585</b>	<b>None</b>

**1. Discharge Parameter Summary:**

**Table 2: Discharge Parameter Summary**

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
3/2/2026	0:00:00	7.1	2.2939596	2.6	1172083.832	12.1	384
3/2/2026	0:15:00	7.1	3.1078231	3.8	1172108.429	12.5	382
3/2/2026	0:30:00	7.1	2.8693421	5.1	1172152.987	12.3	382
3/2/2026	0:45:00	7.1	3.3160207	8	1172178.183	12.5	379
3/2/2026	1:00:00	7.1	3.2970937	4.7	1172228.041	12.3	379
3/2/2026	1:15:00	7.1	3.2705958	25.1	1172249.466	12.9	380
3/2/2026	1:30:00	7.1	3.4030852	3.1	1172291.446	12	375
3/2/2026	1:45:00	7.1	0.1324894	4.9	1172322.619	12	377
3/2/2026	2:00:00	7.1	3.3311624	6.1	1172367.143	11.7	380
3/2/2026	2:15:00	7.1	3.2933083	3.1	1172412.844	11.6	380
3/2/2026	2:30:00	7.1	3.327377	5.2	1172439.497	11.6	382
3/2/2026	2:45:00	7.1	3.2781666	4.4	1172489.109	11.6	384
3/2/2026	3:00:00	7.1	0.1968414	17.5	1172523.541	11.8	384
3/2/2026	3:15:00	7.1	3.3160207	2.8	1172556.993	11.6	382
3/2/2026	3:30:00	7.1	2.362097	9.1	1172600.854	11.7	382
3/2/2026	3:45:00	7	3.3311624	6	1172622.916	11.8	384
3/2/2026	4:30:00	7	3.3576603	2.1	1172683.153	11.7	380
3/2/2026	4:45:00	7	3.3728019	0.6	1172729.297	11.8	380
3/2/2026	5:00:00	7	3.3992998	4	1172757.82	11.7	380
3/2/2026	5:15:00	7	0.7381553	7.9	1172802.568	11.6	382



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/2/2026	5:30:00	7	3.3992998	9.9	1172842.928	11.6	382
3/2/2026	5:45:00	7	3.3690165	5.8	1172893.372	11.6	382
3/2/2026	6:00:00	7	0.3444725	0.7	1172924.503	11.9	380
3/2/2026	6:15:00	7	3.3728019	2.8	1172966.128	11.7	380
3/2/2026	6:30:00	7	3.3803727	2.2	1172994.004	11.7	380
3/2/2026	6:45:00	7	3.346304	0.5	1173039.958	11.6	382
3/2/2026	7:00:00	7	0.2536226	0	1173074.285	11.7	382
3/2/2026	7:15:00	7	3.3425186	0.6	1173112.165	11.4	383
3/2/2026	7:30:00	7	0.3293308	0.9	1173152.355	11.5	384
3/2/2026	7:45:00	6.9	3.3803727	0.7	1173184.701	11.4	385
3/2/2026	8:00:00	7	3.3311624	0.8	1173235.13	11.4	384
3/2/2026	8:15:00	7	3.4030852	0	1173257.779	11.8	381
3/2/2026	8:30:00	7	2.702784	1.5	1173307.125	11.9	379
3/2/2026	8:45:00	7	2.3772386	10.1	1173344.661	12.2	377
3/2/2026	9:00:00	7	3.346304	0	1173388.398	12.4	376
3/2/2026	9:15:00	7	2.4150927	0.5	1173427.732	12.8	375
3/2/2026	9:30:00	7	0.1589873	0	1173438.381	14	375
3/2/2026	9:45:00	7	1.203761	0.2	1173480.349	12.9	371
3/2/2026	10:00:00	6.9	3.3690165	0	1173504.065	12.7	375
3/2/2026	10:15:00	6.9	0.6548762	0	1173552.045	12.5	379
3/2/2026	10:30:00	6.9	2.3772386	0.7	1173575.568	12.3	380
3/2/2026	10:45:00	6.9	0.5072452	0	1173620.061	12.1	379
3/2/2026	11:00:00	6.9	3.3500894	0	1173648.289	12.1	380
3/2/2026	11:15:00	6.9	0.2687642	0	1173676.684	12.3	380
3/2/2026	11:30:00	6.9	3.3500894	2.6	1173721.34	12	380
3/2/2026	11:45:00	6.9	3.3538749	0.9	1173767.526	12.1	380
3/2/2026	12:15:00	6.9	2.490801	2.4	1173839.04	12.1	380
3/2/2026	13:00:00	6.9	3.263025	0	1173854.117	12.1	380
3/2/2026	13:15:00	6.9	0.3671849	0	1173881.811	12.4	380
3/2/2026	13:30:00	6.9	3.2895229	0	1173925.211	12.2	380
3/2/2026	13:45:00	6.9	3.2743812	0.4	1173970.163	12.1	380
3/2/2026	14:00:00	7	3.2933083	1	1173997.558	12.3	380
3/2/2026	14:15:00	7	3.2668104	3.3	1174042.661	12.2	380
3/2/2026	14:30:00	7	0.2914767	0.5	1174074.296	12.3	380
3/2/2026	14:45:00	7	3.2933083	2.5	1174111.665	12.2	380
3/2/2026	15:00:00	7	3.327377	4.1	1174154.217	12.2	380



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/2/2026	15:15:00	7	3.4295831	6.3	1174177.846	12.5	378
3/2/2026	15:30:00	7	3.391729	4.3	1174224.626	12.3	379
3/2/2026	15:45:00	7	0.3179746	2.1	1174259.928	12.6	375
3/2/2026	16:00:00	7	3.3992998	2.8	1174296.874	12.7	374
3/2/2026	16:15:00	7	3.3765873	5.2	1174343.385	12.8	372
3/2/2026	16:30:00	7	3.4068706	6	1174372.314	13	372
3/2/2026	16:45:00	7	0.2460518	1.5	1174407.446	13.2	372
3/2/2026	17:00:00	7	2.831488	5	1174429.125	13.2	372
3/2/2026	17:15:00	7	3.3235916	9.8	1174472.775	13	369
3/2/2026	17:45:00	7	3.2743812	5.2	1174543.391	13	371
3/2/2026	18:00:00	7	3.2554541	1.6	1174587.772	13.1	371
3/2/2026	18:15:00	7	3.2403125	3.4	1174632.201	13.1	371
3/2/2026	18:30:00	7	3.3008791	7.9	1174658.389	13.3	370
3/2/2026	18:45:00	7	3.3311624	8.8	1174702.538	13.2	369
3/2/2026	19:00:00	7	3.3614457	11.2	1174727.87	13.3	369
3/2/2026	19:15:00	7.1	0.6094513	8.1	1174770.259	13	365
3/2/2026	19:30:00	7.1	3.3500894	2.9	1174794.879	12.9	366
3/2/2026	19:45:00	7.1	3.3311624	0	1174840.717	12.8	369
3/2/2026	20:00:00	7.1	0.3369017	1.3	1174870.288	13.3	369
3/2/2026	20:15:00	7.1	3.3387332	0	1174908.123	12.9	368
3/2/2026	20:30:00	7	3.3122353	0	1174953.62	12.9	368
3/2/2026	21:00:00	7	3.391729	0	1175019.331	12.8	366
3/2/2026	21:15:00	7	3.3614457	0	1175065.793	12.7	368
3/2/2026	21:30:00	7	3.3992998	1.2	1175095.649	12.8	366
3/2/2026	21:45:00	7	3.3652311	1.2	1175141.752	12.7	366
3/2/2026	22:00:00	7	3.4030852	1.5	1175164.437	13	366
3/2/2026	22:30:00	7	3.3803727	0.3	1175223.38	12.4	365
3/2/2026	22:45:00	7	3.3992998	1	1175245.65	12.6	366
3/2/2026	23:00:00	7	0.2271247	0	1175281.407	12.7	366
3/2/2026	23:15:00	7	3.346304	0	1175318.829	12.7	364
3/2/2026	23:30:00	7	0.514816	1.3	1175363.52	12.7	364
3/2/2026	23:45:00	7	3.3841581	0	1175393.152	12.8	363
3/3/2026	0:00:00	7	0.1892706	0	1175430.647	13	364
3/3/2026	0:15:00	7	3.3803727	0	1175466.899	12.8	361
3/3/2026	0:30:00	7	0.2649788	0	1175498.409	13	361
3/3/2026	1:00:00	7	0.2649788	0	1175563.416	13.3	361



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	1:15:00	7	3.3728019	0	1175600.35	12.9	363
3/3/2026	1:30:00	7	3.3690165	4.2	1175624.274	13.6	364
3/3/2026	1:45:00	7	3.3576603	0	1175670.695	12.9	360
3/3/2026	2:00:00	7	3.3803727	1.7	1175698.658	13.1	363
3/3/2026	2:15:00	7	3.346304	3.9	1175748.046	13	361
3/3/2026	2:30:00	7	3.3765873	3.9	1175774.294	13.1	361
3/3/2026	2:45:00	7	3.327377	5.7	1175824.632	13	361
3/3/2026	3:00:00	7	3.3652311	5.2	1175848.454	13.1	361
3/3/2026	3:30:00	7	3.3803727	6.5	1175914.036	13.1	358
3/3/2026	3:45:00	7	0.3331162	4.6	1175943.085	13.4	358
3/3/2026	4:00:00	7	3.391729	6.4	1175982.579	13	358
3/3/2026	4:15:00	7	0.1854852	8.1	1176025.956	13.1	358
3/3/2026	4:30:00	6.9	3.3879436	8.7	1176055.875	13.1	358
3/3/2026	4:45:00	6.9	0.2839059	9.1	1176083.577	13.5	358
3/3/2026	5:00:00	6.9	3.3803727	4.2	1176121.745	13.1	358
3/3/2026	5:30:00	6.9	3.3879436	3.8	1176172.137	13.1	356
3/3/2026	5:45:00	7	0.6624471	6.9	1176220.458	13	355
3/3/2026	6:00:00	7	3.2970937	7.3	1176248.288	13.1	356
3/3/2026	6:15:00	7	3.3728019	10.5	1176298.861	13.1	353
3/3/2026	6:30:00	7	3.4068706	13.2	1176325.601	13.5	355
3/3/2026	6:45:00	7	3.3803727	14	1176372.09	13.1	353
3/3/2026	7:00:00	7	1.0864132	17.4	1176397.388	13.6	354
3/3/2026	7:15:00	7	3.3803727	20.3	1176447.893	13.1	350
3/3/2026	7:30:00	7	0.2990475	0	1176472.479	13.4	349
3/3/2026	7:45:00	7	3.3122353	0	1176508.418	12.8	346
3/3/2026	8:00:00	7	0.4050391	0	1176535.256	12.9	348
3/3/2026	8:15:00	7	3.4257977	0	1176580.98	12.4	344
3/3/2026	9:00:00	7	3.2213854	0.5	1176622.272	13	348
3/3/2026	9:30:00	7	3.2403125	2.2	1176691.635	13	346
3/3/2026	9:45:00	7	3.2251709	4.3	1176735.853	13	346
3/3/2026	10:00:00	7	3.2100292	7.3	1176778.193	13.1	346
3/3/2026	10:15:00	7	3.2138146	8.2	1176820.426	13.2	344
3/3/2026	10:30:00	7	3.2100292	5.6	1176863.633	13.3	344
3/3/2026	10:45:00	7	3.1873167	6.3	1176905.367	13.3	341
3/3/2026	11:00:00	7	3.1797459	2.2	1176948.99	13.3	343
3/3/2026	11:15:00	6.9	3.1646043	3.9	1176992.163	13.4	343



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	11:30:00	6.9	3.198673	3.1	1177018.029	13.4	341
3/3/2026	11:45:00	6.9	3.1570334	2.3	1177061.769	13.4	341
3/3/2026	12:00:00	6.9	3.198673	5.1	1177080.806	13.5	341
3/3/2026	12:15:00	6.9	3.153248	5.1	1177123.71	13.4	341
3/3/2026	12:30:00	6.9	3.1646043	7.2	1177167.333	14.3	353
3/3/2026	12:45:00	6.9	3.1911021	12.8	1177193.062	13.4	340
3/3/2026	13:00:00	6.9	3.3879436	21.6	1177233.135	13.5	340
3/3/2026	13:15:00	6.9	0.2309101	16.5	1177258.512	13.9	340
3/3/2026	13:45:00	6.9	3.2251709	56.3	1177289.465	13.1	339
3/3/2026	14:00:00	6.9	0.386112	0	1177311.387	13.2	339
3/3/2026	14:15:00	6.9	3.1683897	31.2	1177352.273	12.7	343
3/3/2026	14:30:00	6.9	3.1759605	32.4	1177394.291	12.5	341
3/3/2026	14:45:00	6.9	0.2422664	10.6	1177423.473	12.7	341
3/3/2026	15:00:00	6.9	3.1797459	45.1	1177459.684	12.4	341
3/3/2026	15:15:00	6.8	3.153248	56.5	1177503.11	12.3	341
3/3/2026	15:30:00	6.8	1.1318381	57.6	1177527.7	12.4	343
3/3/2026	15:45:00	6.8	3.1570334	104.5	1177572.236	12.2	343
3/3/2026	16:00:00	6.8	3.1873167	43.7	1177614.307	12.2	343
3/3/2026	16:15:00	6.8	3.1759605	13.7	1177643.284	12.2	343
3/3/2026	16:30:00	6.9	3.153248	0	1177685.143	12.1	343
3/3/2026	16:45:00	6.9	3.1494626	0	1177728.763	12.1	343
3/3/2026	17:00:00	6.9	0.2006268	0.4	1177766.181	12.2	343
3/3/2026	17:15:00	6.9	3.1494626	0.2	1177799.837	12.1	343
3/3/2026	17:30:00	6.9	2.6157196	0.2	1177839.27	12.1	344
3/3/2026	17:45:00	6.9	3.2100292	0	1177881.228	12.3	340
3/3/2026	18:00:00	7	3.198673	0	1177925.612	12.6	339
3/3/2026	18:15:00	7	3.2024584	0	1177969.621	12.9	338
3/3/2026	18:30:00	7	3.1797459	0	1178013.6	13.1	339
3/3/2026	18:45:00	7	3.1721751	0	1178057.507	13.2	338
3/3/2026	19:00:00	7	3.1873167	0.1	1178100.986	13.3	338
3/3/2026	19:15:00	7	0.2498372	0.8	1178126.253	13.9	333
3/3/2026	19:30:00	7	3.1873167	2.1	1178163.544	13.6	330
3/3/2026	19:45:00	7	3.2176	1.3	1178183.977	14	335
3/3/2026	20:00:00	7	3.1873167	1.4	1178228.251	13.5	335
3/3/2026	20:15:00	6.9	3.198673	0.3	1178272.23	13.3	334
3/3/2026	20:30:00	6.9	3.1835313	0.5	1178315.717	13.2	337



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	20:45:00	6.9	3.1835313	0.9	1178359.45	13.1	335
3/3/2026	21:00:00	6.9	3.134321	0.7	1178402.865	12.8	335
3/3/2026	21:15:00	6.9	3.1721751	2.1	1178431.29	12.7	337
3/3/2026	21:30:00	6.9	0.2914767	1.2	1178456.345	13.1	335
3/3/2026	21:45:00	6.9	3.1948876	2.7	1178497.618	13.1	333
3/3/2026	22:00:00	7	3.1911021	6.3	1178541.225	13.3	332
3/3/2026	22:15:00	7	3.1759605	9.6	1178585.045	13.4	334
3/3/2026	22:30:00	7	3.1418918	7.2	1178605.146	13.7	332
3/3/2026	22:45:00	7	3.1267501	2.9	1178648.224	13.4	333
3/3/2026	23:00:00	7	3.1040377	5.4	1178691.306	13.5	333
3/3/2026	23:15:00	7	3.1002523	3.5	1178734.054	13.6	330
3/3/2026	23:30:00	7	3.0851106	6.3	1178777.238	13.6	330
3/3/2026	23:45:00	7	0.1400602	4.9	1178810.576	13.9	330
3/4/2026	0:00:00	7	3.0964669	2.9	1178839.894	13.6	330
3/4/2026	0:15:00	7	3.1002523	5.3	1178882.352	13.4	330
3/4/2026	0:30:00	7	3.1078231	9.7	1178925.085	13.4	332
3/4/2026	0:45:00	6.9	3.0964669	17.2	1178967.868	13.3	330
3/4/2026	1:00:00	6.9	3.1191793	9.9	1179009.678	13.3	332
3/4/2026	1:15:00	6.9	3.153248	5.8	1179035.93	13.3	330
3/4/2026	1:30:00	7	3.1418918	4.1	1179079.148	13.4	332
3/4/2026	1:45:00	7	3.1229647	2.4	1179122.135	13.5	328
3/4/2026	2:00:00	7	3.1078231	2.5	1179165.005	13.7	330
3/4/2026	2:15:00	6.9	0.3104038	0.7	1179181.781	14.4	327
3/4/2026	2:30:00	7	3.1229647	5.2	1179224.08	13.8	327
3/4/2026	2:45:00	7	3.1191793	2.6	1179267.4	13.8	327
3/4/2026	3:00:00	7	2.6232904	1.6	1179309.005	13.9	327
3/4/2026	3:15:00	7	2.6422174	1.8	1179331.317	14.1	327
3/4/2026	3:30:00	7	3.1229647	3.6	1179368.951	13.7	327
3/4/2026	3:45:00	7	3.1570334	10.2	1179408.849	13.6	327
3/4/2026	4:00:00	7	3.1494626	2	1179448.384	13.6	327
3/4/2026	4:15:00	7	3.1721751	1.8	1179492.412	13.7	327
3/4/2026	4:45:00	7	3.1683897	2.2	1179544.144	13.8	327
3/4/2026	5:00:00	6.9	3.1456772	4	1179587.566	13.8	327
3/4/2026	5:15:00	6.9	3.1418918	2.9	1179631.117	13.8	327
3/4/2026	5:30:00	6.9	3.1381064	2.9	1179673.991	13.8	327
3/4/2026	5:45:00	6.9	3.1305356	3.7	1179705.376	13.9	325



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/4/2026	6:00:00	6.9	3.1570334	5.3	1179752.527	13.9	325
3/4/2026	6:15:00	6.9	3.1418918	6	1179795.783	13.9	325
3/4/2026	6:30:00	6.9	3.1116085	8.5	1179838.986	13.9	325
3/4/2026	6:45:00	6.9	3.1305356	9.3	1179882.397	13.9	325
3/4/2026	7:00:00	6.9	0.2119831	9.3	1179916.072	13.8	325
3/4/2026	7:15:00	6.9	3.1418918	10.2	1179952.877	13.4	327
3/4/2026	7:30:00	6.9	2.5362259	8.6	1179996.039	13.4	328
3/4/2026	7:45:00	6.9	3.1381064	0	1180035.403	13.5	327
3/4/2026	8:00:00	6.9	0.2271247	0	1180072.705	13.4	327
3/4/2026	8:15:00	6.9	3.1873167	0	1180100.785	13.3	328
3/4/2026	8:30:00	6.9	2.3355991	0	1180142.723	13.3	328
3/4/2026	8:45:00	6.9	3.0623981	0	1180186.805	13.1	328
3/4/2026	9:00:00	6.9	2.3961657	0	1180213.76	13.2	328
3/4/2026	9:15:00	6.9	2.8087756	0	1180258.228	13.1	328
3/4/2026	9:30:00	6.9	2.2561054	0	1180301.968	13.1	328
3/4/2026	9:45:00	6.9	2.6157196	0	1180326.111	13.3	328
3/4/2026	10:00:00	6.9	2.5021572	0	1180369.996	13.1	328
3/4/2026	10:15:00	6.9	2.4794447	0	1180400.279	13.2	328
3/4/2026	10:30:00	6.9	2.2712471	0	1180444.326	13.1	328
3/4/2026	10:45:00	6.9	0.2081976	0	1180466.592	13.5	328
3/4/2026	11:00:00	6.9	2.2939596	0	1180499.767	13.2	328
3/4/2026	11:15:00	6.9	2.2561054	0	1180543.863	13.1	327
3/4/2026	11:45:00	6.9	2.3469553	0	1180600.985	13.2	326
3/4/2026	12:00:00	6.9	2.3545261	0	1180632.132	13.3	328
3/4/2026	12:15:00	6.9	2.2674617	0	1180676.326	13.3	326
3/4/2026	12:30:00	6.9	2.2106805	0	1180717.671	13.2	327
3/4/2026	12:45:00	6.9	2.187968	0	1180761.256	13.2	326
3/4/2026	13:00:00	6.9	2.2561054	0	1180784.294	13.4	327
3/4/2026	13:15:00	6.9	2.2144659	0	1180828.087	13.3	327
3/4/2026	13:30:00	6.9	2.1993243	0	1180870.881	13.3	326
3/4/2026	14:00:00	6.9	2.3128866	0	1180932.357	13.3	325
3/4/2026	14:15:00	6.9	2.2296076	0	1180975.624	13.3	327
3/4/2026	14:30:00	6.9	2.1917534	0	1181018.539	13.3	327
3/4/2026	15:00:00	6.9	2.2258221	0	1181087.131	13.4	327
3/4/2026	15:15:00	6.9	3.1608189	0.5	1181128.07	13.3	324
3/4/2026	15:30:00	6.9	2.1917534	0	1181174.4	13.1	325



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/4/2026	15:45:00	6.9	3.1646043	0	1181197.6	13	326
3/4/2026	16:15:00	6.9	3.1418918	0	1181256.202	12.8	328
3/4/2026	16:45:00	6.9	2.2296076	0	1181319.445	12.8	326
3/4/2026	17:00:00	6.9	2.1955388	1.8	1181364.495	12.6	326
3/4/2026	17:15:00	6.9	1.8434955	2.6	1181381.692	12.6	326
3/4/2026	17:30:00	6.9	1.654225	6.7	1181426.792	12.5	326
3/4/2026	17:45:00	6.9	1.8094268	1.7	1181464.033	12.4	326
3/4/2026	18:00:00	6.9	1.9684141	2.1	1181508.193	12.3	326
3/4/2026	18:15:00	6.9	2.2031097	0	1181547.422	12.4	326
3/4/2026	18:30:00	6.9	2.3545261	0.3	1181592.4	12.4	327
3/4/2026	18:45:00	6.9	2.1652555	0.1	1181632.957	12.4	327
3/4/2026	19:00:00	6.9	2.2144659	0.3	1181677.644	12.4	327
3/4/2026	19:15:00	6.9	2.2636763	0.1	1181697.188	12.5	327
3/4/2026	19:30:00	6.9	3.024544	1.3	1181742.325	12.4	326
3/4/2026	19:45:00	6.9	2.1841826	0.2	1181783.166	12.4	325
3/4/2026	20:00:00	6.9	2.1803972	0.4	1181828.148	12.3	325
3/4/2026	20:15:00	6.9	2.2220367	0.2	1181847.768	12.4	327
3/4/2026	20:30:00	6.9	2.2750325	3.1	1181883.328	12.3	324
3/4/2026	21:00:00	6.8	2.2371784	1.3	1181944.477	12.2	326
3/4/2026	21:15:00	6.9	2.2371784	1.5	1181983.482	12.2	328
3/4/2026	21:30:00	6.9	2.4378052	2.1	1182028.521	12.1	328
3/4/2026	22:00:00	6.9	2.2561054	1.7	1182096.469	12.1	328
3/4/2026	22:15:00	6.9	2.1766118	2.4	1182135.834	12.1	328
3/4/2026	22:30:00	6.9	1.5595897	5.6	1182175.815	12.1	328
3/4/2026	22:45:00	6.9	1.4081732	3	1182185.983	12.2	326
3/4/2026	23:00:00	6.9	2.169041	4.4	1182228.042	12.1	328
3/4/2026	23:30:00	6.9	2.3053158	6.9	1182292.451	12.1	328
3/4/2026	23:45:00	6.9	3.2213854	6.7	1182335.045	12.1	328
3/5/2026	0:00:00	7	2.2826033	8.4	1182381.863	12.2	324
3/5/2026	0:30:00	7	2.3431699	10.9	1182435.059	12.6	321
3/5/2026	0:45:00	7	2.2826033	11.7	1182477.437	12.7	321
3/5/2026	1:00:00	7	2.2750325	8.8	1182523.937	12.7	321
3/5/2026	1:15:00	7	2.3583116	8.2	1182547.259	12.9	321
3/5/2026	1:30:00	7	2.3772386	9.4	1182594.058	12.9	320
3/5/2026	1:45:00	7	0.2346955	10	1182612.61	13.4	321
3/5/2026	2:00:00	7	2.2939596	9.4	1182655.279	13	318



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/5/2026	2:15:00	7	3.1835313	6.9	1182699.939	12.9	319
3/5/2026	2:45:00	7	3.1721751	0	1182746.163	12.6	316
3/5/2026	3:00:00	7	0.0302833	0	1182785.376	12.6	318
3/5/2026	3:15:00	6.9	3.1570334	0	1182818.726	12.5	314
3/5/2026	3:30:00	7	0.1362748	0	1182856.811	12.6	316
3/5/2026	3:45:00	7	2.2636763	0	1182888.589	12.6	318
3/5/2026	4:00:00	7	2.4378052	0	1182933.2	12.7	318
3/5/2026	4:15:00	6.9	2.3848094	0	1182956.231	13	318
3/5/2026	4:30:00	7	2.0062683	0	1182997.496	12.8	316
3/5/2026	4:45:00	6.9	0.2384809	0	1183020.344	13.1	317
3/5/2026	5:00:00	7	2.619505	0	1183030.292	12.8	315
3/5/2026	5:15:00	7	2.3318137	0	1183072.273	12.9	314
3/5/2026	5:30:00	6.9	2.233393	0	1183115.112	12.9	314
3/5/2026	5:45:00	6.9	3.0586127	0	1183140.065	13	314
3/5/2026	6:00:00	6.9	1.8586372	0	1183182.299	13.1	314
3/5/2026	6:15:00	6.9	3.0510419	0	1183225.661	13.1	316
3/5/2026	6:30:00	6.9	1.7715727	0	1183269.19	13.1	314
3/5/2026	6:45:00	6.9	2.2712471	0	1183292.826	13.2	314
3/5/2026	7:00:00	6.9	2.7936339	0	1183335.601	13.2	313
3/5/2026	7:15:00	6.9	3.0169732	0	1183379.724	13.1	313
3/5/2026	7:30:00	6.9	0.2195539	0	1183416.276	13.3	315
3/5/2026	7:45:00	6.9	3.024544	0	1183448.069	13.2	314
3/5/2026	8:00:00	6.9	2.1463285	0	1183491.337	12.9	315
3/5/2026	8:30:00	6.9	2.2598908	0	1183556.873	12.6	318
3/5/2026	8:45:00	6.9	3.1191793	0	1183602.59	12.6	318
3/5/2026	9:00:00	6.9	0.3028329	0	1183629.466	13.2	315
3/5/2026	9:15:00	6.9	3.1191793	0	1183673.986	13	314
3/5/2026	9:30:00	6.9	1.5747313	0	1183717.481	13.1	316
3/5/2026	9:45:00	6.9	2.169041	0	1183723.378	13.8	316
3/5/2026	10:00:00	6.9	2.2409638	0	1183767.588	13.2	314
3/5/2026	10:15:00	6.9	0.5450993	0	1183811.995	13	316
3/5/2026	10:30:00	6.9	2.3015304	0	1183836.138	13	316
3/5/2026	11:00:00	6.9	2.25232	0	1183891.118	12.8	317
3/5/2026	11:15:00	6.9	2.2182513	0	1183934.328	12.8	317
3/5/2026	11:30:00	6.9	2.2485346	0	1183954.357	12.9	317
3/5/2026	11:45:00	6.9	2.2258221	0	1183998.143	12.8	317



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/5/2026	12:00:00	6.9	3.1494626	0	1184009.843	12.8	317
3/5/2026	12:15:00	6.9	2.2258221	0	1184064.198	12.9	316
3/5/2026	12:30:00	6.9	2.25232	0	1184107.738	12.9	317
3/5/2026	12:45:00	6.9	2.2485346	0	1184150.933	13	317
3/5/2026	13:15:00	6.9	2.2371784	0	1184209.043	13.1	317
3/5/2026	13:30:00	6.9	2.490801	0	1184225.57	13.2	317
3/5/2026	13:45:00	6.9	2.426449	0	1184269.761	12.9	317
3/5/2026	14:00:00	6.9	2.3848094	0	1184316.458	13	317
3/5/2026	14:15:00	7	2.4150927	0	1184362.466	12.9	317
3/5/2026	14:45:00	7	2.3999511	0	1184434.998	12.9	317
3/5/2026	15:00:00	7	2.362097	0	1184481.203	12.9	317
3/5/2026	15:15:00	7	2.4075219	0	1184504.487	13	317
3/5/2026	15:30:00	7	2.3848094	0	1184538.609	13	317
3/5/2026	15:45:00	6.9	2.4340198	0.7	1184550.998	13.5	317
3/5/2026	16:15:00	6.9	2.4643031	0	1184590.382	13.7	317
3/5/2026	16:45:00	6.9	2.381024	0	1184657.296	12.9	315
3/5/2026	17:15:00	6.9	2.4037365	0	1184730.124	13.1	316
3/5/2026	17:30:00	6.9	2.3696678	0	1184776.317	13.3	314
3/5/2026	17:45:00	6.9	1.737504	0.4	1184819.501	13.3	314
3/5/2026	18:00:00	6.9	2.4378052	0.1	1184842.112	13.6	310
3/5/2026	18:15:00	6.9	2.4302344	0	1184888.812	13.8	312
3/5/2026	18:45:00	6.9	2.2409638	0	1184958.104	14	307
3/5/2026	19:00:00	7	2.2068951	0	1185001.258	14.1	307
3/5/2026	19:30:00	6.9	2.3885948	0	1185068.99	13.9	309
3/5/2026	19:45:00	6.9	2.3318137	0	1185115.233	13.6	309
3/5/2026	20:00:00	6.9	2.4226636	0	1185139.948	13.3	311
3/5/2026	20:15:00	6.9	2.4150927	0	1185186.084	13	313
3/5/2026	20:30:00	6.9	2.3999511	0	1185232.266	13.2	310
3/5/2026	20:45:00	7	1.8132123	0	1185276.601	13.5	309
3/5/2026	21:00:00	7	1.9381308	0	1185321.284	13.7	307
3/5/2026	21:15:00	7	2.3469553	0	1185365.736	13.7	307
3/5/2026	21:30:00	6.9	0.3066184	0	1185399.169	13.9	309
3/5/2026	21:45:00	6.9	2.3507407	0.4	1185425.364	13.8	308
3/5/2026	22:00:00	6.9	1.911633	0	1185469.513	13.6	308
3/5/2026	22:30:00	6.9	2.3242428	0	1185544.154	13.4	311
3/5/2026	22:45:00	6.9	2.2750325	0	1185588.224	13.3	311



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/5/2026	23:00:00	7	2.2750325	0	1185632.108	13.4	311
3/5/2026	23:30:00	7	2.3091012	0	1185687.735	13.5	308
3/5/2026	23:45:00	7	2.2258221	0	1185731.191	13.5	308
3/6/2026	0:00:00	7	2.3355991	0	1185774.443	13.7	307
3/6/2026	0:15:00	7	2.2485346	0	1185817.336	13.8	305
3/6/2026	0:30:00	7	0.4088245	0	1185858.608	14	305
3/6/2026	0:45:00	7	2.5248697	0	1185884.75	14.3	305
3/6/2026	1:00:00	7	3.0207586	0	1185927.628	14.5	303
3/6/2026	1:15:00	6.9	0.3141892	0	1185968.68	14.7	305
3/6/2026	1:45:00	6.9	3.0131878	0	1186012.856	14.7	303
3/6/2026	2:00:00	6.9	3.0586127	0	1186056.074	14.5	302
3/6/2026	2:15:00	6.9	3.0207586	0	1186098.634	14.5	305
3/6/2026	2:30:00	6.9	3.1153939	0	1186121.304	14.6	303
3/6/2026	2:45:00	6.9	3.1191793	0	1186164.575	14.6	305
3/6/2026	3:00:00	6.9	3.1191793	0	1186207.922	14.7	305
3/6/2026	3:15:00	6.9	3.1040377	0	1186250.659	14.6	305
3/6/2026	3:30:00	6.9	3.1305356	0	1186293.768	14.6	305
3/6/2026	4:00:00	6.9	3.1494626	0	1186354.399	14.7	305
3/6/2026	4:30:00	6.9	3.1646043	0	1186424.762	14.7	304
3/6/2026	4:45:00	6.9	3.1721751	0	1186468.393	14.7	305
3/6/2026	5:00:00	6.9	3.1797459	0	1186512.383	14.7	305
3/6/2026	5:15:00	6.9	3.1456772	0	1186555.571	14.8	304
3/6/2026	5:45:00	6.9	3.1608189	0	1186623.591	14.6	302
3/6/2026	6:00:00	6.9	3.1494626	0.3	1186667.305	14.1	303
3/6/2026	6:30:00	6.9	3.1646043	1.7	1186735.578	13.3	311
3/6/2026	6:45:00	6.9	3.1418918	2.6	1186779.042	13.1	308
3/6/2026	7:00:00	6.9	3.1305356	2.7	1186822.098	13	308
3/6/2026	7:30:00	6.9	3.2176	1	1186885.53	12.6	308
3/6/2026	7:45:00	6.9	3.0813252	1.2	1186927.767	12.5	307
3/6/2026	8:00:00	6.9	3.198673	1.3	1186971.803	12.4	309
3/6/2026	8:30:00	6.9	3.3500894	0	1187035.716	12.3	309
3/6/2026	8:45:00	6.9	3.327377	0	1187081.792	12.3	311
3/6/2026	9:00:00	6.9	3.3046645	0	1187127.626	12.4	311
3/6/2026	9:15:00	6.9	3.3349478	0	1187152.924	12.3	310
3/6/2026	9:30:00	6.9	3.327377	0	1187198.894	12.3	310
3/6/2026	10:00:00	6.9	3.3160207	0	1187260.429	12.5	312



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/6/2026	10:15:00	6.9	3.3349478	0	1187283.838	12.9	308
3/6/2026	10:45:00	6.9	3.3122353	0	1187298.814	12.6	308
3/6/2026	11:00:00	6.9	3.3160207	0	1187299.366	12.6	308
3/6/2026	11:15:00	6.9	3.3160207	0	1187299.366	12.6	308
3/6/2026	11:30:00	6.9	3.3160207	0	1187299.366	12.6	308
3/6/2026	11:45:00	6.9	3.3046645	3.6	1187447.126	12.4	310
3/6/2026	12:00:00	6.9	3.2970937	4.5	1187492.585	12.4	310
3/6/2026	12:15:00	6.9	0.2006268	6.2	1187533.581	12.5	310
3/6/2026	12:30:00	6.9	3.2781666	4	1187560.367	12.4	310
3/6/2026	12:45:00	6.9	3.2554541	5.3	1187605.14	12.5	310
3/6/2026	13:00:00	6.9	0.3141892	15	1187640.761	12.7	310
3/6/2026	13:15:00	7	3.3198061	4.8	1187673.974	12.5	308
3/6/2026	13:30:00	7	3.2933083	3.4	1187716.651	12.5	305
3/6/2026	13:45:00	7	3.327377	4.6	1187731.539	12.8	308
3/6/2026	14:00:00	7	3.3084499	5.6	1187777.286	12.6	305
3/6/2026	14:15:00	7	3.2933083	9.7	1187803.818	12.8	308
3/6/2026	14:30:00	7	3.2592396	6.9	1187843.966	12.6	308
3/6/2026	14:45:00	7	3.3235916	5.5	1187886.802	12.6	303
3/6/2026	15:00:00	7	3.3690165	6.2	1187912.898	12.7	307
3/6/2026	15:15:00	7	3.3500894	6.1	1187959.33	12.6	307
3/6/2026	15:30:00	6.9	3.327377	8.1	1188005.546	12.6	307
3/6/2026	15:45:00	6.9	0.2914767	7.4	1188038.994	12.7	307
3/6/2026	16:00:00	6.9	3.3538749	7.9	1188078.964	12.4	307
3/6/2026	16:15:00	6.9	3.3046645	9.3	1188122.852	12.4	307
3/6/2026	16:30:00	6.9	3.3349478	11.3	1188140.769	12.6	308
3/6/2026	16:45:00	6.9	3.2933083	1.4	1188186.406	12.5	307
3/6/2026	17:00:00	6.9	0.3369017	1	1188217.113	12.6	305
3/6/2026	17:15:00	6.9	3.2895229	2.5	1188260.206	12.3	307
3/6/2026	17:30:00	6.9	3.3084499	5.8	1188305.635	12.3	310
3/6/2026	17:45:00	6.9	3.3235916	13.1	1188334.233	12.6	310
3/6/2026	18:00:00	6.9	3.3311624	10.3	1188377.274	12.4	310
3/6/2026	18:15:00	7	3.0548273	10.9	1188418.436	12.6	308
3/6/2026	18:45:00	7	3.3387332	3.1	1188484.957	12.5	308
3/6/2026	19:00:00	7	3.3311624	3.7	1188530.893	12.6	308
3/6/2026	19:15:00	7	3.3538749	5	1188559.325	12.8	308
3/6/2026	19:30:00	7	3.1948876	2.1	1188604.232	12.5	308



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/6/2026	19:45:00	7	3.1721751	0.7	1188647.946	12.7	305
3/6/2026	20:00:00	7	3.0661836	1.9	1188663.246	13.3	303
3/6/2026	20:15:00	7	3.1873167	0.7	1188707.358	13.1	305
3/6/2026	20:45:00	6.9	3.1721751	1.1	1188762.405	12.9	304
3/6/2026	21:00:00	6.9	3.1797459	1.1	1188805.994	12.8	304
3/6/2026	21:15:00	6.9	3.1911021	2.3	1188827.719	12.6	306
3/6/2026	21:30:00	6.9	3.1835313	6.7	1188871.751	12.5	307
3/6/2026	22:00:00	6.9	3.2176	15	1188937.075	12.5	307
3/6/2026	22:30:00	6.9	3.2592396	15.7	1188995.689	12.6	308
3/6/2026	23:00:00	6.9	3.1608189	12.9	1189062.77	12.9	308
3/6/2026	23:15:00	6.9	3.1002523	0	1189105.133	12.9	306
3/6/2026	23:30:00	6.9	3.1040377	0	1189133.186	13.3	307
3/6/2026	23:45:00	6.9	3.1873167	0	1189174.746	13.2	305
3/7/2026	0:00:00	6.9	3.2213854	0	1189201.407	13.2	305
3/7/2026	0:15:00	6.9	3.2024584	0	1189245.734	13.1	308
3/7/2026	0:30:00	6.9	3.2062438	0	1189289.774	13.1	305
3/7/2026	0:45:00	6.9	3.1381064	0	1189333.253	13.6	303
3/7/2026	1:15:00	6.9	3.2100292	0	1189383.784	14	304
3/7/2026	1:45:00	6.9	3.2062438	1.2	1189448.151	13.6	304
3/7/2026	2:15:00	6.9	3.2440979	10.9	1189515.956	13.8	304
3/7/2026	2:30:00	6.9	3.263025	0	1189556.849	14.1	302
3/7/2026	2:45:00	6.9	3.2478833	0.8	1189601.54	14.4	300
3/7/2026	3:15:00	6.9	3.2478833	2.4	1189673.788	14.5	300
3/7/2026	3:30:00	6.9	3.2516687	0.4	1189718.699	14.5	302
3/7/2026	4:00:00	6.9	3.2403125	3.1	1189787.226	13.9	303
3/7/2026	4:15:00	6.9	3.2213854	6.5	1189831.659	13.4	304
3/7/2026	4:30:00	6.9	3.1911021	4.6	1189852.899	13.5	307
3/7/2026	4:45:00	6.9	3.1608189	3.1	1189896.401	13.8	305
3/7/2026	5:00:00	6.9	3.153248	4.6	1189940.077	14.1	304
3/7/2026	5:30:00	6.9	3.1721751	2.8	1190009.437	14.4	302
3/7/2026	5:45:00	6.9	3.1570334	2.9	1190053.056	14.5	302
3/7/2026	6:00:00	6.9	3.1418918	5	1190096.407	14.2	303
3/7/2026	6:30:00	6.9	3.1570334	4.8	1190164.105	14.3	304
3/7/2026	7:00:00	6.9	3.1759605	5.7	1190226.879	14.4	302
3/7/2026	7:15:00	6.9	3.1418918	5.2	1190270.502	13.9	304
3/7/2026	7:45:00	6.9	3.1683897	3.9	1190337.621	14	303



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/7/2026	8:00:00	6.9	3.1608189	4.7	1190381.539	13.9	302
3/7/2026	8:30:00	6.9	3.1683897	3.5	1190449.484	13.7	308
3/7/2026	8:45:00	6.9	3.1418918	4.2	1190492.997	13.6	307
3/7/2026	9:00:00	6.9	3.1948876	4.1	1190534.038	13.2	305
3/7/2026	9:15:00	6.9	3.153248	4.1	1190564.481	12.9	308
3/7/2026	9:30:00	6.9	3.2176	0	1190588.696	13	310
3/7/2026	9:45:00	6.9	3.2251709	0	1190630.597	12.8	309
3/7/2026	10:00:00	6.9	3.2213854	0	1190674.867	12.7	310
3/7/2026	10:15:00	6.9	3.2024584	0	1190719.05	12.7	309
3/7/2026	10:45:00	6.9	2.4378052	0.3	1190754.081	13.3	308
3/7/2026	11:00:00	6.9	2.4378052	0.3	1190754.081	13.3	308
3/7/2026	11:15:00	6.9	3.3538749	0	1190862.237	13.1	309
3/7/2026	11:30:00	6.9	3.3652311	1.7	1190897.271	13.3	309
3/7/2026	11:45:00	6.9	3.3500894	0	1190943.696	13.5	306
3/7/2026	12:00:00	6.9	3.3500894	3.9	1190989.757	13.7	311
3/7/2026	12:30:00	6.9	3.3690165	1.3	1191055.331	14.1	306
3/7/2026	12:45:00	6.9	3.3425186	2.9	1191101.271	14.1	306
3/7/2026	13:15:00	6.9	3.3728019	4.6	1191171.305	13.9	309
3/7/2026	13:30:00	6.9	3.2478833	3.6	1191216.207	13.6	308
3/7/2026	13:45:00	6.9	3.2365271	5.7	1191260.55	13.4	308
3/7/2026	14:15:00	6.9	3.2138146	0	1191330.758	13.3	308
3/7/2026	14:45:00	6.9	3.2176	0.3	1191395.689	13.2	308
3/7/2026	15:00:00	6.9	3.2289563	0	1191440.209	13.2	308
3/7/2026	15:15:00	6.9	3.2024584	0	1191484.362	13.2	308
3/7/2026	15:30:00	6.9	3.024544	2.4	1191522.338	13.2	308
3/7/2026	15:45:00	6.9	3.2213854	0	1191557.072	13.2	308
3/7/2026	16:00:00	6.9	3.2176	0	1191601.347	13.2	308
3/7/2026	16:30:00	6.9	3.2289563	0.6	1191670.222	13.2	308
3/7/2026	16:45:00	6.9	3.1948876	0.7	1191714.383	13.2	308
3/7/2026	17:30:00	6.9	3.2213854	0.1	1191799.237	13.3	309
3/7/2026	17:45:00	6.9	3.2251709	0	1191843.798	13.7	305
3/7/2026	18:00:00	6.9	3.2251709	0	1191888.512	14.1	303
3/7/2026	18:15:00	6.9	3.2970937	0.9	1191930.81	14.7	302
3/7/2026	18:30:00	6.9	3.2743812	2	1191973.744	14.7	300
3/7/2026	18:45:00	6.9	3.2857374	6.9	1192018.696	14.9	302
3/7/2026	19:15:00	6.9	3.281952	7.9	1192085.293	15.1	300



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/7/2026	19:30:00	6.9	3.2705958	9.6	1192130.468	15.1	300
3/7/2026	20:00:00	6.9	3.1721751	3.7	1192194.324	14.9	302
3/7/2026	20:15:00	6.8	3.0775398	3	1192235.683	14.1	302
3/7/2026	20:30:00	6.8	3.0926814	2.8	1192278.008	14	306
3/7/2026	20:45:00	6.8	0.2044122	0	1192309.082	14.2	303
3/7/2026	21:00:00	6.8	3.1267501	0.3	1192334.906	14.5	302
3/7/2026	21:15:00	6.8	3.0472565	1.5	1192376.811	14.4	301
3/7/2026	21:30:00	6.8	3.0851106	4	1192402.855	14.8	301
3/7/2026	21:45:00	6.8	3.0623981	2.1	1192445.414	14.3	302
3/7/2026	22:00:00	6.8	3.0851106	0.8	1192487.667	14.1	303
3/7/2026	22:15:00	6.9	3.0737544	0.6	1192530.2	14.2	300
3/7/2026	22:30:00	6.9	3.0775398	1.2	1192572.804	14.2	301
3/7/2026	22:45:00	6.8	3.0623981	1.7	1192615.023	14	303
3/7/2026	23:00:00	6.8	3.0586127	1.5	1192657.268	14	305
3/7/2026	23:15:00	6.9	3.0472565	2.1	1192699.161	14	305
3/7/2026	23:30:00	6.9	3.0510419	2	1192740.771	14	305
3/7/2026	23:45:00	6.8	3.0359003	3.3	1192782.588	13.9	303
3/8/2026	0:00:00	6.8	2.9185525	5.6	1192824.035	13.9	301
3/8/2026	0:30:00	6.9	2.941265	5.6	1192880.702	14.8	300
3/8/2026	0:45:00	6.8	3.0396857	6.9	1192921.301	15	297
3/8/2026	1:00:00	6.8	3.0321149	3.3	1192961.029	15.3	297
3/8/2026	1:15:00	6.8	3.0396857	6.2	1193002.952	15.1	300
3/8/2026	1:30:00	6.8	3.0813252	5.1	1193041.469	14.6	300
3/8/2026	1:45:00	6.8	3.0472565	4.1	1193083.729	14.8	302
3/8/2026	2:00:00	6.9	2.1463285	3.2	1193120.137	14.3	302
3/8/2026	2:15:00	6.9	3.0851106	3.4	1193154.974	14.4	300
3/8/2026	2:30:00	6.9	3.0775398	4.4	1193197.375	14.5	299
3/8/2026	2:45:00	6.9	3.0737544	5.3	1193239.919	14.5	300
3/8/2026	3:00:00	6.9	3.069969	4.5	1193282.391	14.7	301
3/8/2026	3:30:00	6.8	3.2478833	4	1193322.407	15.1	300
3/8/2026	3:45:00	6.8	3.0321149	7.4	1193363.391	14.6	299
3/8/2026	4:00:00	6.9	3.0623981	5.7	1193405.266	14.7	297
3/8/2026	4:15:00	6.9	0.5715972	6	1193444.838	15	297
3/8/2026	4:30:00	6.9	3.0737544	6.7	1193467.88	15.4	297
3/8/2026	4:45:00	6.9	3.0623981	9.3	1193509.936	15.4	297
3/8/2026	5:00:00	6.9	3.0321149	4.6	1193549.149	15.2	297



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/8/2026	5:15:00	6.9	3.0283294	4.9	1193591.031	15.5	297
3/8/2026	5:30:00	6.9	3.0094024	7.6	1193632.799	15.6	297
3/8/2026	5:45:00	6.9	3.0207586	9.4	1193674.231	15.7	297
3/8/2026	6:00:00	6.9	3.2705958	9.3	1193718.497	14.6	293
3/8/2026	6:15:00	6.9	0.4277515	4.5	1193749.719	14.7	296
3/8/2026	6:30:00	6.9	3.3008791	7	1193790.496	14	297
3/8/2026	6:45:00	6.9	3.2365271	5.2	1193834.293	13.7	298
3/8/2026	7:00:00	6.8	3.2289563	5.9	1193878.185	13.6	299
3/8/2026	7:15:00	6.9	3.2857374	12.3	1193904.705	13.6	299
3/8/2026	7:30:00	6.9	3.2781666	1.3	1193947.795	13.2	299
3/8/2026	7:45:00	6.8	3.2478833	1	1193992.527	13.2	299
3/8/2026	8:00:00	6.9	3.2365271	0.8	1194037.191	13.3	301
3/8/2026	8:15:00	6.9	3.2176	0.3	1194081.465	13.4	299
3/8/2026	8:30:00	6.9	3.2251709	0.8	1194125.667	13.6	299
3/8/2026	8:45:00	6.9	3.2100292	2.9	1194170.18	13.8	299
3/8/2026	9:00:00	6.8	3.3652311	2	1194198.711	13.9	299
3/8/2026	9:15:00	6.8	3.3387332	1	1194245.158	13.6	299
3/8/2026	9:45:00	6.8	3.3879436	2	1194315.15	13.2	301
3/8/2026	10:00:00	6.8	3.4030852	8.7	1194336.186	13.3	301
3/8/2026	10:15:00	6.8	3.3576603	6.7	1194379.687	12.8	301
3/8/2026	10:30:00	6.8	3.4787934	7.9	1194424.359	12.7	302
3/8/2026	10:45:00	6.8	3.4636518	10	1194472.127	12.6	302
3/8/2026	11:00:00	6.8	3.520433	19.3	1194502.301	12.8	301
3/8/2026	11:15:00	6.8	3.4598664	4.1	1194546.84	12.4	301
3/8/2026	12:30:00	6.8	3.4182269	5.4	1194594.494	12.4	302
3/8/2026	12:45:00	6.8	3.4447247	9.3	1194623.472	12.5	298
3/8/2026	13:00:00	6.8	0.5753826	8.7	1194668.045	12.5	298
3/8/2026	13:15:00	6.8	3.4371539	11.7	1194696.576	12.5	298
3/8/2026	13:30:00	6.8	0.2649788	14.4	1194733.979	12.4	298
3/8/2026	13:45:00	6.8	3.4598664	14.3	1194766.152	12.5	297
3/8/2026	14:00:00	6.8	3.4409393	13.4	1194813.693	12.5	297
3/8/2026	14:15:00	6.9	3.2857374	7.3	1194840.728	12.5	297
3/8/2026	14:30:00	6.9	3.2592396	7.5	1194885.729	12.4	295
3/8/2026	15:00:00	6.9	3.3955144	11.4	1194944.058	12.5	296
3/8/2026	15:15:00	6.8	3.3690165	13.5	1194989.903	12.5	296
3/8/2026	15:30:00	6.8	3.410656	14.7	1195014.592	12.6	297



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/8/2026	15:45:00	6.8	3.4144414	13.8	1195057.636	12.4	297
3/8/2026	16:15:00	6.8	3.346304	30.7	1195121.481	12.4	297
3/8/2026	16:30:00	6.8	3.3728019	17.8	1195143.152	12.4	297
3/8/2026	17:00:00	6.8	3.4712226	7	1195210.858	12.2	298
3/8/2026	17:15:00	6.8	3.4522956	6.5	1195258.119	12.2	298
3/8/2026	17:30:00	6.8	3.4295831	6.9	1195305.569	12.2	298
3/8/2026	17:45:00	6.8	3.4636518	10.7	1195334.573	12.1	297
3/8/2026	18:00:00	6.8	3.4409393	6.8	1195381.86	12.1	297
3/8/2026	18:15:00	6.8	3.4787934	9	1195408.324	12.2	298
3/8/2026	18:30:00	6.8	3.4371539	8.4	1195455.982	12	298
3/8/2026	18:45:00	6.8	3.456081	37.8	1195482.722	12.4	296
3/8/2026	19:15:00	6.8	3.4522956	12.6	1195553.847	13	293
3/8/2026	19:45:00	6.9	3.3122353	6.1	1195622.169	13.5	292
3/8/2026	20:00:00	6.9	3.281952	5.9	1195667.715	13.7	291
3/8/2026	20:15:00	6.9	3.3122353	7.2	1195689.962	14.2	291
3/8/2026	20:30:00	6.8	1.5217355	5.2	1195735.221	14.1	289
3/8/2026	20:45:00	6.8	3.3122353	10	1195760.996	14.3	291
3/8/2026	21:00:00	6.9	3.2857374	19.6	1195806.239	14.5	290
3/8/2026	21:15:00	6.8	3.3122353	6.8	1195833.157	14.8	290
3/8/2026	21:30:00	6.8	3.2857374	5.9	1195878.646	14.9	287
3/8/2026	21:45:00	6.8	3.3198061	3.3	1195903.993	15.5	291
3/8/2026	22:00:00	6.8	3.281952	11.7	1195949.626	14.8	288
3/8/2026	22:15:00	6.8	3.3122353	13.4	1195976.041	14.8	291
3/8/2026	22:30:00	6.8	3.5620725	60	1196021.89	14.8	287
3/8/2026	22:45:00	6.8	0.2763351	7	1196036.657	15.1	288
3/8/2026	23:00:00	6.8	3.3008791	3.5	1196069.605	14.6	289
3/8/2026	23:15:00	6.8	0.3596141	2.1	1196088.381	15.6	290
3/8/2026	23:30:00	6.8	3.3160207	5.6	1196131.792	14.7	289
3/8/2026	23:45:00	6.8	3.2857374	7.5	1196177.308	14.8	289



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>


**Table 3. In-Situ Parameters**

Date	Temperature °C	DO mg/L	Conductivity SPC-uS/cm	SAL-ppt	pH	ORP (mV)	NTU
03/02/2026	13.1	8.76	190.6	0.09	7.73	176.2	1.73
03/03/2026	16.1	9.28	226.6	0.11	7.83	150.4	4.49
03/04/2026	13.2	9.46	192.2	0.09	7.82	167.7	0.98
03/05/2026	12.8	8.71	192.8	0.09	7.51	229.3	1.10
03/06/2026	12.7	8.89	188.1	0.09	7.70	188.1	0.87
03/07/2026	10.7	9.63	196.4	0.11	7.58	185.7	6.78
03/08/2026	11.8	9.76	207.5	0.10	6.89	137.7	8.89

**1. Calibration Log:**

**Table 4. Calibration Log**

Date	Unit	pH	Conductivity/Temp.	Salinity	NTU
3/03/2025	YSI	✓	✓	✓	✓
3/03/2025	WTP	✓	N/A	N/A	✓

		<b>Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope</b>	
<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**APPENDIX A: WTP Log**



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
3/2/2026	0:00:00	7.1	2.293959551	2.6	1,172,084	Open	12.1	384
3/2/2026	0:15:00	7.1	3.107823088	3.8	1,172,108	Open	12.5	382
3/2/2026	0:30:00	7.1	2.869342144	5.1	1,172,153	Open	12.3	382
3/2/2026	0:45:00	7.1	3.316020737	8	1,172,178	Open	12.5	379
3/2/2026	1:00:00	7.1	3.297093678	4.7	1,172,228	Open	12.3	379
3/2/2026	1:15:00	7.1	3.270595795	25.1	1,172,249	Open	12.9	380
3/2/2026	1:30:00	7.1	3.403085208	3.1	1,172,291	Open	12	375
3/2/2026	1:45:00	7.1	0.132489413	4.9	1,172,323	Open	12	377
3/2/2026	2:00:00	7.1	3.331162384	6.1	1,172,367	Open	11.7	380
3/2/2026	2:15:00	7.1	3.293308266	3.1	1,172,413	Open	11.6	380
3/2/2026	2:30:00	7.1	3.327376972	5.2	1,172,439	Open	11.6	382
3/2/2026	2:45:00	7.1	3.278166619	4.4	1,172,489	Open	11.6	384
3/2/2026	3:00:00	7.1	0.196841414	17.5	1,172,524	Open	11.8	384
3/2/2026	3:15:00	7.1	3.316020737	2.8	1,172,557	Open	11.6	382
3/2/2026	3:30:00	7.1	2.362096963	9.1	1,172,601	Open	11.7	382
3/2/2026	3:45:00	7	3.331162384	6	1,172,623	Open	11.8	384
3/2/2026	4:00:00	7.1	3.160818853	6.2	1,172,657	Closed	11.7	380
3/2/2026	4:15:00	7	0.677588712	1.3	1,172,658	Closed	12.2	382
3/2/2026	4:30:00	7	3.357660267	2.1	1,172,683	Open	11.7	380
3/2/2026	4:45:00	7	3.372801914	0.6	1,172,729	Open	11.8	380
3/2/2026	5:00:00	7	3.399299796	4	1,172,758	Open	11.7	380
3/2/2026	5:15:00	7	0.738155301	7.9	1,172,803	Open	11.6	382
3/2/2026	5:30:00	7	3.399299796	9.9	1,172,843	Open	11.6	382
3/2/2026	5:45:00	7	3.369016502	5.8	1,172,893	Open	11.6	382
3/2/2026	6:00:00	7	0.344472474	0.7	1,172,925	Open	11.9	380
3/2/2026	6:15:00	7	3.372801914	2.8	1,172,966	Open	11.7	380
3/2/2026	6:30:00	7	3.380372737	2.2	1,172,994	Open	11.7	380
3/2/2026	6:45:00	7	3.346304031	0.5	1,173,040	Open	11.6	382
3/2/2026	7:00:00	7	0.253622591	0	1,173,074	Open	11.7	382
3/2/2026	7:15:00	7	3.342518619	0.6	1,173,112	Open	11.4	383
3/2/2026	7:30:00	7	0.329330827	0.9	1,173,152	Open	11.5	384
3/2/2026	7:45:00	6.9	3.380372737	0.7	1,173,185	Open	11.4	385



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/2/2026	8:00:00	7	3.331162384	0.8	1,173,235	Open	11.4	384
3/2/2026	8:15:00	7	3.403085208	0	1,173,258	Open	11.8	381
3/2/2026	8:30:00	7	2.702784025	1.5	1,173,307	Open	11.9	379
3/2/2026	8:45:00	7	2.37723861	10.1	1,173,345	Open	12.2	377
3/2/2026	9:00:00	7	3.346304031	0	1,173,388	Open	12.4	376
3/2/2026	9:15:00	7	2.415092728	0.5	1,173,428	Open	12.8	375
3/2/2026	9:30:00	7	0.158987296	0	1,173,438	Open	14	375
3/2/2026	9:45:00	7	1.203760952	0.2	1,173,480	Open	12.9	371
3/2/2026	10:00:00	6.9	3.369016502	0	1,173,504	Open	12.7	375
3/2/2026	10:15:00	6.9	0.654876241	0	1,173,552	Open	12.5	379
3/2/2026	10:30:00	6.9	2.37723861	0.7	1,173,576	Open	12.3	380
3/2/2026	10:45:00	6.9	0.507245181	0	1,173,620	Open	12.1	379
3/2/2026	11:00:00	6.9	3.350089443	0	1,173,648	Open	12.1	380
3/2/2026	11:15:00	6.9	0.268764238	0	1,173,677	Open	12.3	380
3/2/2026	11:30:00	6.9	3.350089443	2.6	1,173,721	Open	12	380
3/2/2026	11:45:00	6.9	3.353874855	0.9	1,173,768	Open	12.1	380
3/2/2026	12:00:00	6.9	0	6.4	1,173,803	Closed	12.2	380
3/2/2026	12:15:00	6.9	2.490800964	2.4	1,173,839	Open	12.1	380
3/2/2026	12:30:00	6.9	0.264978826	1.8	1,173,841	Closed	12.4	380
3/2/2026	12:45:00	6.9	3.304664501	1.1	1,173,841	Closed	12.1	377
3/2/2026	13:00:00	6.9	3.263024972	0	1,173,854	Open	12.1	380
3/2/2026	13:15:00	6.9	0.367184945	0	1,173,882	Open	12.4	380
3/2/2026	13:30:00	6.9	3.289522854	0	1,173,925	Open	12.2	380
3/2/2026	13:45:00	6.9	3.274381207	0.4	1,173,970	Open	12.1	380
3/2/2026	14:00:00	7	3.293308266	1	1,173,998	Open	12.3	380
3/2/2026	14:15:00	7	3.266810383	3.3	1,174,043	Open	12.2	380
3/2/2026	14:30:00	7	0.291476709	0.5	1,174,074	Open	12.3	380
3/2/2026	14:45:00	7	3.293308266	2.5	1,174,112	Open	12.2	380
3/2/2026	15:00:00	7	3.327376972	4.1	1,174,154	Open	12.2	380
3/2/2026	15:15:00	7	3.429583091	6.3	1,174,178	Open	12.5	378
3/2/2026	15:30:00	7	3.391728973	4.3	1,174,225	Open	12.3	379
3/2/2026	15:45:00	7	0.317974591	2.1	1,174,260	Open	12.6	375
3/2/2026	16:00:00	7	3.399299796	2.8	1,174,297	Open	12.7	374
3/2/2026	16:15:00	7	3.376587326	5.2	1,174,343	Open	12.8	372
3/2/2026	16:30:00	7	3.40687062	6	1,174,372	Open	13	372
3/2/2026	16:45:00	7	0.246051767	1.5	1,174,407	Open	13.2	372



## Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/2/2026	17:00:00	7	2.831488026	5	1,174,429	Open	13.2	372
3/2/2026	17:15:00	7	3.32359156	9.8	1,174,473	Open	13	369
3/2/2026	17:30:00	7	2.975333675	7.8	1,174,499	Closed	13.3	369
3/2/2026	17:45:00	7	3.274381207	5.2	1,174,543	Open	13	371
3/2/2026	18:00:00	7	3.255454148	1.6	1,174,588	Open	13.1	371
3/2/2026	18:15:00	7	3.240312501	3.4	1,174,632	Open	13.1	371
3/2/2026	18:30:00	7	3.30087909	7.9	1,174,658	Open	13.3	370
3/2/2026	18:45:00	7	3.331162384	8.8	1,174,703	Open	13.2	369
3/2/2026	19:00:00	7	3.361445678	11.2	1,174,728	Open	13.3	369
3/2/2026	19:15:00	7.1	0.6094513	8.1	1,174,770	Open	13	365
3/2/2026	19:30:00	7.1	3.350089443	2.9	1,174,795	Open	12.9	366
3/2/2026	19:45:00	7.1	3.331162384	0	1,174,841	Open	12.8	369
3/2/2026	20:00:00	7.1	0.33690165	1.3	1,174,870	Open	13.3	369
3/2/2026	20:15:00	7.1	3.338733208	0	1,174,908	Open	12.9	368
3/2/2026	20:30:00	7	3.312235325	0	1,174,954	Open	12.9	368
3/2/2026	20:45:00	7	0	5	1,174,976	Open	13	368
3/2/2026	21:00:00	7	3.391728973	0	1,175,019	Open	12.8	366
3/2/2026	21:15:00	7	3.361445678	0	1,175,066	Open	12.7	368
3/2/2026	21:30:00	7	3.399299796	1.2	1,175,096	Open	12.8	366
3/2/2026	21:45:00	7	3.36523109	1.2	1,175,142	Open	12.7	366
3/2/2026	22:00:00	7	3.403085208	1.5	1,175,164	Open	13	366
3/2/2026	22:15:00	7	0	0	1,175,196	Open	12.9	365
3/2/2026	22:30:00	7	3.380372737	0.3	1,175,223	Open	12.4	365
3/2/2026	22:45:00	7	3.399299796	1	1,175,246	Open	12.6	366
3/2/2026	23:00:00	7	0.227124708	0	1,175,281	Open	12.7	366
3/2/2026	23:15:00	7	3.346304031	0	1,175,319	Open	12.7	364
3/2/2026	23:30:00	7	0.514816005	1.3	1,175,364	Open	12.7	364
3/2/2026	23:45:00	7	3.384158149	0	1,175,393	Open	12.8	363
3/3/2026	0:00:00	7	0.18927059	0	1,175,431	Open	13	364
3/3/2026	0:15:00	7	3.380372737	0	1,175,467	Open	12.8	361
3/3/2026	0:30:00	7	0.264978826	0	1,175,498	Open	13	361
3/3/2026	1:00:00	7	0.264978826	0	1,175,563	Open	13.3	361
3/3/2026	1:15:00	7	3.372801914	0	1,175,600	Open	12.9	363
3/3/2026	1:30:00	7	3.369016502	4.2	1,175,624	Open	13.6	364
3/3/2026	1:45:00	7	3.357660267	0	1,175,671	Open	12.9	360
3/3/2026	2:00:00	7	3.380372737	1.7	1,175,699	Open	13.1	363



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	2:15:00	7	3.346304031	3.9	1,175,748	Open	13	361
3/3/2026	2:30:00	7	3.376587326	3.9	1,175,774	Open	13.1	361
3/3/2026	2:45:00	7	3.327376972	5.7	1,175,825	Open	13	361
3/3/2026	3:00:00	7	3.36523109	5.2	1,175,848	Open	13.1	361
3/3/2026	3:15:00	7	0	5.2	1,175,887	Open	13.3	361
3/3/2026	3:30:00	7	3.380372737	6.5	1,175,914	Open	13.1	358
3/3/2026	3:45:00	7	0.333116238	4.6	1,175,943	Open	13.4	358
3/3/2026	4:00:00	7	3.391728973	6.4	1,175,983	Open	13	358
3/3/2026	4:15:00	7	0.185485178	8.1	1,176,026	Open	13.1	358
3/3/2026	4:30:00	6.9	3.387943561	8.7	1,176,056	Open	13.1	358
3/3/2026	4:45:00	6.9	0.283905885	9.1	1,176,084	Open	13.5	358
3/3/2026	5:00:00	6.9	3.380372737	4.2	1,176,122	Open	13.1	358
3/3/2026	5:15:00	6.9	0	3.3	1,176,131	Open	13.3	356
3/3/2026	5:30:00	6.9	3.387943561	3.8	1,176,172	Open	13.1	356
3/3/2026	5:45:00	7	0.662447065	6.9	1,176,220	Open	13	355
3/3/2026	6:00:00	7	3.297093678	7.3	1,176,248	Open	13.1	356
3/3/2026	6:15:00	7	3.372801914	10.5	1,176,299	Open	13.1	353
3/3/2026	6:30:00	7	3.40687062	13.2	1,176,326	Open	13.5	355
3/3/2026	6:45:00	7	3.380372737	14	1,176,372	Open	13.1	353
3/3/2026	7:00:00	7	1.086413187	17.4	1,176,397	Open	13.6	354
3/3/2026	7:15:00	7	3.380372737	20.3	1,176,448	Open	13.1	350
3/3/2026	7:30:00	7	0.299047532	0	1,176,472	Open	13.4	349
3/3/2026	7:45:00	7	3.312235325	0	1,176,508	Open	12.8	346
3/3/2026	8:00:00	7	0.405039063	0	1,176,535	Open	12.9	348
3/3/2026	8:15:00	7	3.425797679	0	1,176,581	Open	12.4	344
3/3/2026	8:30:00	7	2.967762851	0	1,176,613	Closed	12.5	348
3/3/2026	8:45:00	7	2.740638143	0	1,176,613	Closed	12.6	348
3/3/2026	9:00:00	7	3.221385442	0.5	1,176,622	Open	13	348
3/3/2026	9:15:00	7	0.590524241	0	1,176,664	Closed	12.8	348
3/3/2026	9:30:00	7	3.240312501	2.2	1,176,692	Open	13	346
3/3/2026	9:45:00	7	3.225170854	4.3	1,176,736	Open	13	346
3/3/2026	10:00:00	7	3.210029206	7.3	1,176,778	Open	13.1	346
3/3/2026	10:15:00	7	3.213814618	8.2	1,176,820	Open	13.2	344
3/3/2026	10:30:00	7	3.210029206	5.6	1,176,864	Open	13.3	344
3/3/2026	10:45:00	7	3.187316736	6.3	1,176,905	Open	13.3	341
3/3/2026	11:00:00	7	3.179745912	2.2	1,176,949	Open	13.3	343



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	11:15:00	6.9	3.164604265	3.9	1,176,992	Open	13.4	343
3/3/2026	11:30:00	6.9	3.198672971	3.1	1,177,018	Open	13.4	341
3/3/2026	11:45:00	6.9	3.157033441	2.3	1,177,062	Open	13.4	341
3/3/2026	12:00:00	6.9	3.198672971	5.1	1,177,081	Open	13.5	341
3/3/2026	12:15:00	6.9	3.153248029	5.1	1,177,124	Open	13.4	341
3/3/2026	12:30:00	6.9	3.164604265	7.2	1,177,167	Open	14.3	353
3/3/2026	12:45:00	6.9	3.191102147	12.8	1,177,193	Open	13.4	340
3/3/2026	13:00:00	6.9	3.387943561	21.6	1,177,233	Open	13.5	340
3/3/2026	13:15:00	6.9	0.23091012	16.5	1,177,259	Open	13.9	340
3/3/2026	13:30:00	6.9	3.202458383	34.4	1,177,270	Closed	13.3	336
3/3/2026	13:45:00	6.9	3.225170854	56.3	1,177,289	Open	13.1	339
3/3/2026	14:00:00	6.9	0.386112004	0	1,177,311	Open	13.2	339
3/3/2026	14:15:00	6.9	3.168389677	31.2	1,177,352	Open	12.7	343
3/3/2026	14:30:00	6.9	3.1759605	32.4	1,177,394	Open	12.5	341
3/3/2026	14:45:00	6.9	0.242266355	10.6	1,177,423	Open	12.7	341
3/3/2026	15:00:00	6.9	3.179745912	45.1	1,177,460	Open	12.4	341
3/3/2026	15:15:00	6.8	3.153248029	56.5	1,177,503	Open	12.3	341
3/3/2026	15:30:00	6.8	1.131838128	57.6	1,177,528	Open	12.4	343
3/3/2026	15:45:00	6.8	3.157033441	104.5	1,177,572	Open	12.2	343
3/3/2026	16:00:00	6.8	3.187316736	43.7	1,177,614	Open	12.2	343
3/3/2026	16:15:00	6.8	3.1759605	13.7	1,177,643	Open	12.2	343
3/3/2026	16:30:00	6.9	3.153248029	0	1,177,685	Open	12.1	343
3/3/2026	16:45:00	6.9	3.149462618	0	1,177,729	Open	12.1	343
3/3/2026	17:00:00	6.9	0.200626825	0.4	1,177,766	Open	12.2	343
3/3/2026	17:15:00	6.9	3.149462618	0.2	1,177,800	Open	12.1	343
3/3/2026	17:30:00	6.9	2.615719554	0.2	1,177,839	Open	12.1	344
3/3/2026	17:45:00	6.9	3.210029206	0	1,177,881	Open	12.3	340
3/3/2026	18:00:00	7	3.198672971	0	1,177,926	Open	12.6	339
3/3/2026	18:15:00	7	3.202458383	0	1,177,970	Open	12.9	338
3/3/2026	18:30:00	7	3.179745912	0	1,178,014	Open	13.1	339
3/3/2026	18:45:00	7	3.172175088	0	1,178,058	Open	13.2	338
3/3/2026	19:00:00	7	3.187316736	0.1	1,178,101	Open	13.3	338
3/3/2026	19:15:00	7	0.249837179	0.8	1,178,126	Open	13.9	333
3/3/2026	19:30:00	7	3.187316736	2.1	1,178,164	Open	13.6	330
3/3/2026	19:45:00	7	3.21760003	1.3	1,178,184	Open	14	335
3/3/2026	20:00:00	7	3.187316736	1.4	1,178,228	Open	13.5	335



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/3/2026	20:15:00	6.9	3.198672971	0.3	1,178,272	Open	13.3	334
3/3/2026	20:30:00	6.9	3.183531324	0.5	1,178,316	Open	13.2	337
3/3/2026	20:45:00	6.9	3.183531324	0.9	1,178,359	Open	13.1	335
3/3/2026	21:00:00	6.9	3.13432097	0.7	1,178,403	Open	12.8	335
3/3/2026	21:15:00	6.9	3.172175088	2.1	1,178,431	Open	12.7	337
3/3/2026	21:30:00	6.9	0.291476709	1.2	1,178,456	Open	13.1	335
3/3/2026	21:45:00	6.9	3.194887559	2.7	1,178,498	Open	13.1	333
3/3/2026	22:00:00	7	3.191102147	6.3	1,178,541	Open	13.3	332
3/3/2026	22:15:00	7	3.1759605	9.6	1,178,585	Open	13.4	334
3/3/2026	22:30:00	7	3.141891794	7.2	1,178,605	Open	13.7	332
3/3/2026	22:45:00	7	3.126750147	2.9	1,178,648	Open	13.4	333
3/3/2026	23:00:00	7	3.104037676	5.4	1,178,691	Open	13.5	333
3/3/2026	23:15:00	7	3.100252264	3.5	1,178,734	Open	13.6	330
3/3/2026	23:30:00	7	3.085110617	6.3	1,178,777	Open	13.6	330
3/3/2026	23:45:00	7	0.140060237	4.9	1,178,811	Open	13.9	330
3/4/2026	0:00:00	7	3.096466852	2.9	1,178,840	Open	13.6	330
3/4/2026	0:15:00	7	3.100252264	5.3	1,178,882	Open	13.4	330
3/4/2026	0:30:00	7	3.107823088	9.7	1,178,925	Open	13.4	332
3/4/2026	0:45:00	6.9	3.096466852	17.2	1,178,968	Open	13.3	330
3/4/2026	1:00:00	6.9	3.119179323	9.9	1,179,010	Open	13.3	332
3/4/2026	1:15:00	6.9	3.153248029	5.8	1,179,036	Open	13.3	330
3/4/2026	1:30:00	7	3.141891794	4.1	1,179,079	Open	13.4	332
3/4/2026	1:45:00	7	3.122964735	2.4	1,179,122	Open	13.5	328
3/4/2026	2:00:00	7	3.107823088	2.5	1,179,165	Open	13.7	330
3/4/2026	2:15:00	6.9	0.310403768	0.7	1,179,182	Open	14.4	327
3/4/2026	2:30:00	7	3.122964735	5.2	1,179,224	Open	13.8	327
3/4/2026	2:45:00	7	3.119179323	2.6	1,179,267	Open	13.8	327
3/4/2026	3:00:00	7	2.623290377	1.6	1,179,309	Open	13.9	327
3/4/2026	3:15:00	7	2.642217436	1.8	1,179,331	Open	14.1	327
3/4/2026	3:30:00	7	3.122964735	3.6	1,179,369	Open	13.7	327
3/4/2026	3:45:00	7	3.157033441	10.2	1,179,409	Open	13.6	327
3/4/2026	4:00:00	7	3.149462618	2	1,179,448	Open	13.6	327
3/4/2026	4:15:00	7	3.172175088	1.8	1,179,492	Open	13.7	327
3/4/2026	4:30:00	7	3.164604265	2.5	1,179,506	Closed	13.8	327
3/4/2026	4:45:00	7	3.168389677	2.2	1,179,544	Open	13.8	327
3/4/2026	5:00:00	6.9	3.145677206	4	1,179,588	Open	13.8	327



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/4/2026	5:15:00	6.9	3.141891794	2.9	1,179,631	Open	13.8	327
3/4/2026	5:30:00	6.9	3.138106382	2.9	1,179,674	Open	13.8	327
3/4/2026	5:45:00	6.9	3.130535559	3.7	1,179,705	Open	13.9	325
3/4/2026	6:00:00	6.9	3.157033441	5.3	1,179,753	Open	13.9	325
3/4/2026	6:15:00	6.9	3.141891794	6	1,179,796	Open	13.9	325
3/4/2026	6:30:00	6.9	3.1116085	8.5	1,179,839	Open	13.9	325
3/4/2026	6:45:00	6.9	3.130535559	9.3	1,179,882	Open	13.9	325
3/4/2026	7:00:00	6.9	0.211983061	9.3	1,179,916	Open	13.8	325
3/4/2026	7:15:00	6.9	3.141891794	10.2	1,179,953	Open	13.4	327
3/4/2026	7:30:00	6.9	2.536225906	8.6	1,179,996	Open	13.4	328
3/4/2026	7:45:00	6.9	3.138106382	0	1,180,035	Open	13.5	327
3/4/2026	8:00:00	6.9	0.227124708	0	1,180,073	Open	13.4	327
3/4/2026	8:15:00	6.9	3.187316736	0	1,180,101	Open	13.3	328
3/4/2026	8:30:00	6.9	2.335599081	0	1,180,143	Open	13.3	328
3/4/2026	8:45:00	6.9	3.062398146	0	1,180,187	Open	13.1	328
3/4/2026	9:00:00	6.9	2.396165669	0	1,180,214	Open	13.2	328
3/4/2026	9:15:00	6.9	2.808775556	0	1,180,258	Open	13.1	328
3/4/2026	9:30:00	6.9	2.256105433	0	1,180,302	Open	13.1	328
3/4/2026	9:45:00	6.9	2.615719554	0	1,180,326	Open	13.3	328
3/4/2026	10:00:00	6.9	2.5021572	0	1,180,370	Open	13.1	328
3/4/2026	10:15:00	6.9	2.479444729	0	1,180,400	Open	13.2	328
3/4/2026	10:30:00	6.9	2.27124708	0	1,180,444	Open	13.1	328
3/4/2026	10:45:00	6.9	0.208197649	0	1,180,467	Open	13.5	328
3/4/2026	11:00:00	6.9	2.293959551	0	1,180,500	Open	13.2	328
3/4/2026	11:15:00	6.9	2.256105433	0	1,180,544	Open	13.1	327
3/4/2026	11:30:00	6.9	2.032766137	0	1,180,564	Closed	13.3	329
3/4/2026	11:45:00	6.9	2.346955316	0	1,180,601	Open	13.2	326
3/4/2026	12:00:00	6.9	2.35452614	0	1,180,632	Open	13.3	328
3/4/2026	12:15:00	6.9	2.267461668	0	1,180,676	Open	13.3	326
3/4/2026	12:30:00	6.9	2.210680491	0	1,180,718	Open	13.2	327
3/4/2026	12:45:00	6.9	2.18796802	0	1,180,761	Open	13.2	326
3/4/2026	13:00:00	6.9	2.256105433	0	1,180,784	Open	13.4	327
3/4/2026	13:15:00	6.9	2.214465903	0	1,180,828	Open	13.3	327
3/4/2026	13:30:00	6.9	2.199324256	0	1,180,871	Open	13.3	326
3/4/2026	13:45:00	6.9	0.624592947	0	1,180,904	Closed	13.3	325
3/4/2026	14:00:00	6.9	2.31288661	0	1,180,932	Open	13.3	325



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/4/2026	14:15:00	6.9	2.22960755	0	1,180,976	Open	13.3	327
3/4/2026	14:30:00	6.9	2.191753432	0	1,181,019	Open	13.3	327
3/4/2026	14:45:00	6.9	0.435322357	0	1,181,061	Closed	13.4	327
3/4/2026	15:00:00	6.9	2.225822138	0	1,181,087	Open	13.4	327
3/4/2026	15:15:00	6.9	3.160818853	0.5	1,181,128	Open	13.3	324
3/4/2026	15:30:00	6.9	2.191753432	0	1,181,174	Open	13.1	325
3/4/2026	15:45:00	6.9	3.164604265	0	1,181,198	Open	13	326
3/4/2026	16:00:00	6.9	0	0	1,181,239	Closed	12.8	326
3/4/2026	16:15:00	6.9	3.141891794	0	1,181,256	Open	12.8	328
3/4/2026	16:30:00	6.9	0	0	1,181,287	Closed	12.9	326
3/4/2026	16:45:00	6.9	2.22960755	0	1,181,319	Open	12.8	326
3/4/2026	17:00:00	6.9	2.195538844	1.8	1,181,364	Open	12.6	326
3/4/2026	17:15:00	6.9	1.843495547	2.6	1,181,382	Open	12.6	326
3/4/2026	17:30:00	6.9	1.654224957	6.7	1,181,427	Open	12.5	326
3/4/2026	17:45:00	6.9	1.80942684	1.7	1,181,464	Open	12.4	326
3/4/2026	18:00:00	6.9	1.968414136	2.1	1,181,508	Open	12.3	326
3/4/2026	18:15:00	6.9	2.203109668	0	1,181,547	Open	12.4	326
3/4/2026	18:30:00	6.9	2.35452614	0.3	1,181,592	Open	12.4	327
3/4/2026	18:45:00	6.9	2.16525555	0.1	1,181,633	Open	12.4	327
3/4/2026	19:00:00	6.9	2.214465903	0.3	1,181,678	Open	12.4	327
3/4/2026	19:15:00	6.9	2.263676256	0.1	1,181,697	Open	12.5	327
3/4/2026	19:30:00	6.9	3.024544028	1.3	1,181,742	Open	12.4	326
3/4/2026	19:45:00	6.9	2.184182609	0.2	1,181,783	Open	12.4	325
3/4/2026	20:00:00	6.9	2.180397197	0.4	1,181,828	Open	12.3	325
3/4/2026	20:15:00	6.9	2.222036727	0.2	1,181,848	Open	12.4	327
3/4/2026	20:30:00	6.9	2.275032492	3.1	1,181,883	Open	12.3	324
3/4/2026	20:45:00	6.9	0.249837179	0.6	1,181,924	Closed	12.3	326
3/4/2026	21:00:00	6.8	2.237178374	1.3	1,181,944	Open	12.2	326
3/4/2026	21:15:00	6.9	2.237178374	1.5	1,181,983	Open	12.2	328
3/4/2026	21:30:00	6.9	2.437805199	2.1	1,182,029	Open	12.1	328
3/4/2026	21:45:00	6.9	0	1.5	1,182,063	Closed	12.1	328
3/4/2026	22:00:00	6.9	2.256105433	1.7	1,182,096	Open	12.1	328
3/4/2026	22:15:00	6.9	2.176611785	2.4	1,182,136	Open	12.1	328
3/4/2026	22:30:00	6.9	1.559589662	5.6	1,182,176	Open	12.1	328
3/4/2026	22:45:00	6.9	1.40817319	3	1,182,186	Open	12.2	326
3/4/2026	23:00:00	6.9	2.169040961	4.4	1,182,228	Open	12.1	328



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/4/2026	23:15:00	6.9	0.408824474	5	1,182,267	Closed	12.1	328
3/4/2026	23:30:00	6.9	2.305315786	6.9	1,182,292	Open	12.1	328
3/4/2026	23:45:00	6.9	3.221385442	6.7	1,182,335	Open	12.1	328
3/5/2026	0:00:00	7	2.282603315	8.4	1,182,382	Open	12.2	324
3/5/2026	0:15:00	7	1.366533366	8.3	1,182,421	Closed	12.4	324
3/5/2026	0:30:00	7	2.343169904	10.9	1,182,435	Open	12.6	321
3/5/2026	0:45:00	7	2.282603315	11.7	1,182,477	Open	12.7	321
3/5/2026	1:00:00	7	2.275032492	8.8	1,182,524	Open	12.7	321
3/5/2026	1:15:00	7	2.358311551	8.2	1,182,547	Open	12.9	321
3/5/2026	1:30:00	7	2.37723861	9.4	1,182,594	Open	12.9	320
3/5/2026	1:45:00	7	0.234695532	10	1,182,613	Open	13.4	321
3/5/2026	2:00:00	7	2.293959551	9.4	1,182,655	Open	13	318
3/5/2026	2:15:00	7	3.183531324	6.9	1,182,700	Open	12.9	319
3/5/2026	2:30:00	6.9	2.028980725	11.9	1,182,702	Closed	12.8	321
3/5/2026	2:45:00	7	3.172175088	0	1,182,746	Open	12.6	316
3/5/2026	3:00:00	7	0.030283294	0	1,182,785	Open	12.6	318
3/5/2026	3:15:00	6.9	3.157033441	0	1,182,819	Open	12.5	314
3/5/2026	3:30:00	7	0.136274825	0	1,182,857	Open	12.6	316
3/5/2026	3:45:00	7	2.263676256	0	1,182,889	Open	12.6	318
3/5/2026	4:00:00	7	2.437805199	0	1,182,933	Open	12.7	318
3/5/2026	4:15:00	6.9	2.384809434	0	1,182,956	Open	13	318
3/5/2026	4:30:00	7	2.006268254	0	1,182,997	Open	12.8	316
3/5/2026	4:45:00	6.9	0.238480943	0	1,183,020	Open	13.1	317
3/5/2026	5:00:00	7	2.619504966	0	1,183,030	Open	12.8	315
3/5/2026	5:15:00	7	2.331813669	0	1,183,072	Open	12.9	314
3/5/2026	5:30:00	6.9	2.233392962	0	1,183,115	Open	12.9	314
3/5/2026	5:45:00	6.9	3.058612734	0	1,183,140	Open	13	314
3/5/2026	6:00:00	6.9	1.858637194	0	1,183,182	Open	13.1	314
3/5/2026	6:15:00	6.9	3.051041911	0	1,183,226	Open	13.1	316
3/5/2026	6:30:00	6.9	1.771572722	0	1,183,269	Open	13.1	314
3/5/2026	6:45:00	6.9	2.27124708	0	1,183,293	Open	13.2	314
3/5/2026	7:00:00	6.9	2.793633908	0	1,183,336	Open	13.2	313
3/5/2026	7:15:00	6.9	3.016973205	0	1,183,380	Open	13.1	313
3/5/2026	7:30:00	6.9	0.219553884	0	1,183,416	Open	13.3	315
3/5/2026	7:45:00	6.9	3.024544028	0	1,183,448	Open	13.2	314
3/5/2026	8:00:00	6.9	2.146328491	0	1,183,491	Open	12.9	315



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/5/2026	8:15:00	6.9	0	0	1,183,528	Open	12.8	316
3/5/2026	8:30:00	6.9	2.259890845	0	1,183,557	Open	12.6	318
3/5/2026	8:45:00	6.9	3.119179323	0	1,183,603	Open	12.6	318
3/5/2026	9:00:00	6.9	0.302832944	0	1,183,629	Open	13.2	315
3/5/2026	9:15:00	6.9	3.119179323	0	1,183,674	Open	13	314
3/5/2026	9:30:00	6.9	1.574731309	0	1,183,717	Open	13.1	316
3/5/2026	9:45:00	6.9	2.169040961	0	1,183,723	Open	13.8	316
3/5/2026	10:00:00	6.9	2.240963786	0	1,183,768	Open	13.2	314
3/5/2026	10:15:00	6.9	0.545099299	0	1,183,812	Open	13	316
3/5/2026	10:30:00	6.9	2.301530374	0	1,183,836	Open	13	316
3/5/2026	10:45:00	6.9	2.218251315	0	1,183,874	Closed	12.9	314
3/5/2026	11:00:00	6.9	2.252320021	0	1,183,891	Open	12.8	317
3/5/2026	11:15:00	6.9	2.218251315	0	1,183,934	Open	12.8	317
3/5/2026	11:30:00	6.9	2.248534609	0	1,183,954	Open	12.9	317
3/5/2026	11:45:00	6.9	2.225822138	0	1,183,998	Open	12.8	317
3/5/2026	12:00:00	6.9	3.149462618	0	1,184,010	Open	12.8	317
3/5/2026	12:15:00	6.9	2.225822138	0	1,184,064	Open	12.9	316
3/5/2026	12:30:00	6.9	2.252320021	0	1,184,108	Open	12.9	317
3/5/2026	12:45:00	6.9	2.248534609	0	1,184,151	Open	13	317
3/5/2026	13:00:00	6.9	0	0	1,184,187	Closed	13	317
3/5/2026	13:15:00	6.9	2.237178374	0	1,184,209	Open	13.1	317
3/5/2026	13:30:00	6.9	2.490800964	0	1,184,226	Open	13.2	317
3/5/2026	13:45:00	6.9	2.426448964	0	1,184,270	Open	12.9	317
3/5/2026	14:00:00	6.9	2.384809434	0	1,184,316	Open	13	317
3/5/2026	14:15:00	7	2.415092728	0	1,184,362	Open	12.9	317
3/5/2026	14:30:00	7	0	0	1,184,405	Closed	12.9	317
3/5/2026	14:45:00	7	2.399951081	0	1,184,435	Open	12.9	317
3/5/2026	15:00:00	7	2.362096963	0	1,184,481	Open	12.9	317
3/5/2026	15:15:00	7	2.407521905	0	1,184,504	Open	13	317
3/5/2026	15:30:00	7	2.384809434	0	1,184,539	Open	13	317
3/5/2026	15:45:00	6.9	2.434019787	0.7	1,184,551	Open	13.5	317
3/5/2026	16:00:00	6.9	0.174128943	0	1,184,588	Closed	13	317
3/5/2026	16:15:00	6.9	2.464303082	0	1,184,590	Open	13.7	317
3/5/2026	16:30:00	6.9	0.29526212	0	1,184,612	Closed	13.2	317
3/5/2026	16:45:00	6.9	2.381024022	0	1,184,657	Open	12.9	315
3/5/2026	17:00:00	6.9	0.158987296	0.2	1,184,697	Closed	13	317



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/5/2026	17:15:00	6.9	2.403736493	0	1,184,730	Open	13.1	316
3/5/2026	17:30:00	6.9	2.369667787	0	1,184,776	Open	13.3	314
3/5/2026	17:45:00	6.9	1.737504016	0.4	1,184,820	Open	13.3	314
3/5/2026	18:00:00	6.9	2.437805199	0.1	1,184,842	Open	13.6	310
3/5/2026	18:15:00	6.9	2.430234376	0	1,184,889	Open	13.8	312
3/5/2026	18:30:00	7	0.314189179	0	1,184,934	Closed	13.9	310
3/5/2026	18:45:00	6.9	2.240963786	0	1,184,958	Open	14	307
3/5/2026	19:00:00	7	2.206895079	0	1,185,001	Open	14.1	307
3/5/2026	19:15:00	7	0.662447065	0	1,185,044	Closed	14.1	307
3/5/2026	19:30:00	6.9	2.388594846	0	1,185,069	Open	13.9	309
3/5/2026	19:45:00	6.9	2.331813669	0	1,185,115	Open	13.6	309
3/5/2026	20:00:00	6.9	2.422663552	0	1,185,140	Open	13.3	311
3/5/2026	20:15:00	6.9	2.415092728	0	1,185,186	Open	13	313
3/5/2026	20:30:00	6.9	2.399951081	0	1,185,232	Open	13.2	310
3/5/2026	20:45:00	7	1.813212252	0	1,185,277	Open	13.5	309
3/5/2026	21:00:00	7	1.938130842	0	1,185,321	Open	13.7	307
3/5/2026	21:15:00	7	2.346955316	0	1,185,366	Open	13.7	307
3/5/2026	21:30:00	6.9	0.306618356	0	1,185,399	Open	13.9	309
3/5/2026	21:45:00	6.9	2.350740728	0.4	1,185,425	Open	13.8	308
3/5/2026	22:00:00	6.9	1.911632959	0	1,185,470	Open	13.6	308
3/5/2026	22:15:00	6.9	1.729933193	0	1,185,508	Closed	13.4	308
3/5/2026	22:30:00	6.9	2.324242845	0	1,185,544	Open	13.4	311
3/5/2026	22:45:00	6.9	2.275032492	0	1,185,588	Open	13.3	311
3/5/2026	23:00:00	7	2.275032492	0	1,185,632	Open	13.4	311
3/5/2026	23:15:00	7	2.036551548	0	1,185,674	Closed	13.5	311
3/5/2026	23:30:00	7	2.309101198	0	1,185,688	Open	13.5	308
3/5/2026	23:45:00	7	2.225822138	0	1,185,731	Open	13.5	308
3/6/2026	0:00:00	7	2.335599081	0	1,185,774	Open	13.7	307
3/6/2026	0:15:00	7	2.248534609	0	1,185,817	Open	13.8	305
3/6/2026	0:30:00	7	0.408824474	0	1,185,859	Open	14	305
3/6/2026	0:45:00	7	2.524869671	0	1,185,885	Open	14.3	305
3/6/2026	1:00:00	7	3.020758616	0	1,185,928	Open	14.5	303
3/6/2026	1:15:00	6.9	0.314189179	0	1,185,969	Open	14.7	305
3/6/2026	1:30:00	6.9	3.020758616	0	1,185,971	Closed	14.8	305
3/6/2026	1:45:00	6.9	3.013187793	0	1,186,013	Open	14.7	303
3/6/2026	2:00:00	6.9	3.058612734	0	1,186,056	Open	14.5	302



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/6/2026	2:15:00	6.9	3.020758616	0	1,186,099	Open	14.5	305
3/6/2026	2:30:00	6.9	3.115393911	0	1,186,121	Open	14.6	303
3/6/2026	2:45:00	6.9	3.119179323	0	1,186,165	Open	14.6	305
3/6/2026	3:00:00	6.9	3.119179323	0	1,186,208	Open	14.7	305
3/6/2026	3:15:00	6.9	3.104037676	0	1,186,251	Open	14.6	305
3/6/2026	3:30:00	6.9	3.130535559	0	1,186,294	Open	14.6	305
3/6/2026	3:45:00	6.9	0.003785412	0	1,186,331	Closed	14.8	305
3/6/2026	4:00:00	6.9	3.149462618	0	1,186,354	Open	14.7	305
3/6/2026	4:15:00	6.9	0.003785412	0	1,186,389	Closed	14.9	304
3/6/2026	4:30:00	6.9	3.164604265	0	1,186,425	Open	14.7	304
3/6/2026	4:45:00	6.9	3.172175088	0	1,186,468	Open	14.7	305
3/6/2026	5:00:00	6.9	3.179745912	0	1,186,512	Open	14.7	305
3/6/2026	5:15:00	6.9	3.145677206	0	1,186,556	Open	14.8	304
3/6/2026	5:30:00	6.9	0.003785412	0	1,186,595	Closed	14.8	304
3/6/2026	5:45:00	6.9	3.160818853	0	1,186,624	Open	14.6	302
3/6/2026	6:00:00	6.9	3.149462618	0.3	1,186,667	Open	14.1	303
3/6/2026	6:15:00	6.9	0	4.5	1,186,705	Closed	13.8	305
3/6/2026	6:30:00	6.9	3.164604265	1.7	1,186,736	Open	13.3	311
3/6/2026	6:45:00	6.9	3.141891794	2.6	1,186,779	Open	13.1	308
3/6/2026	7:00:00	6.9	3.130535559	2.7	1,186,822	Open	13	308
3/6/2026	7:15:00	6.9	0.677588712	9.7	1,186,863	Closed	12.9	310
3/6/2026	7:30:00	6.9	3.21760003	1	1,186,886	Open	12.6	308
3/6/2026	7:45:00	6.9	3.081325205	1.2	1,186,928	Open	12.5	307
3/6/2026	8:00:00	6.9	3.198672971	1.3	1,186,972	Open	12.4	309
3/6/2026	8:15:00	6.9	0.374755768	4.5	1,187,010	Closed	12.3	308
3/6/2026	8:30:00	6.9	3.350089443	0	1,187,036	Open	12.3	309
3/6/2026	8:45:00	6.9	3.327376972	0	1,187,082	Open	12.3	311
3/6/2026	9:00:00	6.9	3.304664501	0	1,187,128	Open	12.4	311
3/6/2026	9:15:00	6.9	3.334947796	0	1,187,153	Open	12.3	310
3/6/2026	9:30:00	6.9	3.327376972	0	1,187,199	Open	12.3	310
3/6/2026	9:45:00	6.9	0	0	1,187,235	Open	12.5	310
3/6/2026	10:00:00	6.9	3.316020737	0	1,187,260	Open	12.5	312
3/6/2026	10:15:00	6.9	3.334947796	0	1,187,284	Open	12.9	308
3/6/2026	10:30:00	6.9	3.263024972	0	1,187,296	Closed	12.6	308
3/6/2026	10:45:00	6.9	3.312235325	0	1,187,299	Open	12.6	308
3/6/2026	11:00:00	6.9	3.316020737	0	1,187,299	Open	12.6	308



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/6/2026	11:15:00	6.9	3.316020737	0	1,187,299	Open	12.6	308
3/6/2026	11:30:00	6.9	3.316020737	0	1,187,299	Open	12.6	308
3/6/2026	11:45:00	6.9	3.304664501	3.6	1,187,447	Open	12.4	310
3/6/2026	12:00:00	6.9	3.297093678	4.5	1,187,493	Open	12.4	310
3/6/2026	12:15:00	6.9	0.200626825	6.2	1,187,534	Open	12.5	310
3/6/2026	12:30:00	6.9	3.278166619	4	1,187,560	Open	12.4	310
3/6/2026	12:45:00	6.9	3.255454148	5.3	1,187,605	Open	12.5	310
3/6/2026	13:00:00	6.9	0.314189179	15	1,187,641	Open	12.7	310
3/6/2026	13:15:00	7	3.319806149	4.8	1,187,674	Open	12.5	308
3/6/2026	13:30:00	7	3.293308266	3.4	1,187,717	Open	12.5	305
3/6/2026	13:45:00	7	3.327376972	4.6	1,187,732	Open	12.8	308
3/6/2026	14:00:00	7	3.308449913	5.6	1,187,777	Open	12.6	305
3/6/2026	14:15:00	7	3.293308266	9.7	1,187,804	Open	12.8	308
3/6/2026	14:30:00	7	3.25923956	6.9	1,187,844	Open	12.6	308
3/6/2026	14:45:00	7	3.32359156	5.5	1,187,887	Open	12.6	303
3/6/2026	15:00:00	7	3.369016502	6.2	1,187,913	Open	12.7	307
3/6/2026	15:15:00	7	3.350089443	6.1	1,187,959	Open	12.6	307
3/6/2026	15:30:00	6.9	3.327376972	8.1	1,188,006	Open	12.6	307
3/6/2026	15:45:00	6.9	0.291476709	7.4	1,188,039	Open	12.7	307
3/6/2026	16:00:00	6.9	3.353874855	7.9	1,188,079	Open	12.4	307
3/6/2026	16:15:00	6.9	3.304664501	9.3	1,188,123	Open	12.4	307
3/6/2026	16:30:00	6.9	3.334947796	11.3	1,188,141	Open	12.6	308
3/6/2026	16:45:00	6.9	3.293308266	1.4	1,188,186	Open	12.5	307
3/6/2026	17:00:00	6.9	0.33690165	1	1,188,217	Open	12.6	305
3/6/2026	17:15:00	6.9	3.289522854	2.5	1,188,260	Open	12.3	307
3/6/2026	17:30:00	6.9	3.308449913	5.8	1,188,306	Open	12.3	310
3/6/2026	17:45:00	6.9	3.32359156	13.1	1,188,334	Open	12.6	310
3/6/2026	18:00:00	6.9	3.331162384	10.3	1,188,377	Open	12.4	310
3/6/2026	18:15:00	7	3.054827323	10.9	1,188,418	Open	12.6	308
3/6/2026	18:30:00	7	0	7.6	1,188,448	Closed	12.7	309
3/6/2026	18:45:00	7	3.338733208	3.1	1,188,485	Open	12.5	308
3/6/2026	19:00:00	7	3.331162384	3.7	1,188,531	Open	12.6	308
3/6/2026	19:15:00	7	3.353874855	5	1,188,559	Open	12.8	308
3/6/2026	19:30:00	7	3.194887559	2.1	1,188,604	Open	12.5	308
3/6/2026	19:45:00	7	3.172175088	0.7	1,188,648	Open	12.7	305
3/6/2026	20:00:00	7	3.066183558	1.9	1,188,663	Open	13.3	303



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/6/2026	20:15:00	7	3.187316736	0.7	1,188,707	Open	13.1	305
3/6/2026	20:30:00	7	0.166558119	2.6	1,188,741	Closed	13.3	305
3/6/2026	20:45:00	6.9	3.172175088	1.1	1,188,762	Open	12.9	304
3/6/2026	21:00:00	6.9	3.179745912	1.1	1,188,806	Open	12.8	304
3/6/2026	21:15:00	6.9	3.191102147	2.3	1,188,828	Open	12.6	306
3/6/2026	21:30:00	6.9	3.183531324	6.7	1,188,872	Open	12.5	307
3/6/2026	21:45:00	6.9	0	17.6	1,188,912	Closed	12.5	306
3/6/2026	22:00:00	6.9	3.21760003	15	1,188,937	Open	12.5	307
3/6/2026	22:15:00	6.9	0	19.2	1,188,972	Closed	12.6	307
3/6/2026	22:30:00	6.9	3.25923956	15.7	1,188,996	Open	12.6	308
3/6/2026	22:45:00	6.9	0	19.6	1,189,032	Closed	12.8	307
3/6/2026	23:00:00	6.9	3.160818853	12.9	1,189,063	Open	12.9	308
3/6/2026	23:15:00	6.9	3.100252264	0	1,189,105	Open	12.9	306
3/6/2026	23:30:00	6.9	3.104037676	0	1,189,133	Open	13.3	307
3/6/2026	23:45:00	6.9	3.187316736	0	1,189,175	Open	13.2	305
3/7/2026	0:00:00	6.9	3.221385442	0	1,189,201	Open	13.2	305
3/7/2026	0:15:00	6.9	3.202458383	0	1,189,246	Open	13.1	308
3/7/2026	0:30:00	6.9	3.206243795	0	1,189,290	Open	13.1	305
3/7/2026	0:45:00	6.9	3.138106382	0	1,189,333	Open	13.6	303
3/7/2026	1:00:00	6.9	0	0.2	1,189,359	Closed	14.8	303
3/7/2026	1:15:00	6.9	3.210029206	0	1,189,384	Open	14	304
3/7/2026	1:30:00	6.9	0	1.8	1,189,421	Closed	13.8	304
3/7/2026	1:45:00	6.9	3.206243795	1.2	1,189,448	Open	13.6	304
3/7/2026	2:00:00	6.9	0	2	1,189,483	Closed	13.8	304
3/7/2026	2:15:00	6.9	3.244097913	10.9	1,189,516	Open	13.8	304
3/7/2026	2:30:00	6.9	3.263024972	0	1,189,557	Open	14.1	302
3/7/2026	2:45:00	6.9	3.247883324	0.8	1,189,602	Open	14.4	300
3/7/2026	3:00:00	6.9	3.183531324	4.5	1,189,629	Closed	14.8	302
3/7/2026	3:15:00	6.9	3.247883324	2.4	1,189,674	Open	14.5	300
3/7/2026	3:30:00	6.9	3.251668736	0.4	1,189,719	Open	14.5	302
3/7/2026	3:45:00	6.9	1.919203783	10.5	1,189,746	Closed	14.7	300
3/7/2026	4:00:00	6.9	3.240312501	3.1	1,189,787	Open	13.9	303
3/7/2026	4:15:00	6.9	3.221385442	6.5	1,189,832	Open	13.4	304
3/7/2026	4:30:00	6.9	3.191102147	4.6	1,189,853	Open	13.5	307
3/7/2026	4:45:00	6.9	3.160818853	3.1	1,189,896	Open	13.8	305
3/7/2026	5:00:00	6.9	3.153248029	4.6	1,189,940	Open	14.1	304



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/7/2026	5:15:00	6.9	0.174128943	4.7	1,189,967	Closed	14.6	304
3/7/2026	5:30:00	6.9	3.172175088	2.8	1,190,009	Open	14.4	302
3/7/2026	5:45:00	6.9	3.157033441	2.9	1,190,053	Open	14.5	302
3/7/2026	6:00:00	6.9	3.141891794	5	1,190,096	Open	14.2	303
3/7/2026	6:15:00	6.9	0.132489413	9.1	1,190,127	Closed	14.3	303
3/7/2026	6:30:00	6.9	3.157033441	4.8	1,190,164	Open	14.3	304
3/7/2026	6:45:00	6.9	0	3.7	1,190,190	Closed	14.9	304
3/7/2026	7:00:00	6.9	3.1759605	5.7	1,190,227	Open	14.4	302
3/7/2026	7:15:00	6.9	3.141891794	5.2	1,190,271	Open	13.9	304
3/7/2026	7:30:00	6.9	0.094635295	4.3	1,190,300	Closed	13.9	305
3/7/2026	7:45:00	6.9	3.168389677	3.9	1,190,338	Open	14	303
3/7/2026	8:00:00	6.9	3.160818853	4.7	1,190,382	Open	13.9	302
3/7/2026	8:15:00	6.9	3.005616969	4.2	1,190,422	Closed	13.7	305
3/7/2026	8:30:00	6.9	3.168389677	3.5	1,190,449	Open	13.7	308
3/7/2026	8:45:00	6.9	3.141891794	4.2	1,190,493	Open	13.6	307
3/7/2026	9:00:00	6.9	3.194887559	4.1	1,190,534	Open	13.2	305
3/7/2026	9:15:00	6.9	3.153248029	4.1	1,190,564	Open	12.9	308
3/7/2026	9:30:00	6.9	3.21760003	0	1,190,589	Open	13	310
3/7/2026	9:45:00	6.9	3.225170854	0	1,190,631	Open	12.8	309
3/7/2026	10:00:00	6.9	3.221385442	0	1,190,675	Open	12.7	310
3/7/2026	10:15:00	6.9	3.202458383	0	1,190,719	Open	12.7	309
3/7/2026	10:30:00	6.9	0.174128943	1.2	1,190,746	Closed	13.3	308
3/7/2026	10:45:00	6.9	2.437805199	0.3	1,190,754	Open	13.3	308
3/7/2026	11:00:00	6.9	2.437805199	0.3	1,190,754	Open	13.3	308
3/7/2026	11:15:00	6.9	3.353874855	0	1,190,862	Open	13.1	309
3/7/2026	11:30:00	6.9	3.36523109	1.7	1,190,897	Open	13.3	309
3/7/2026	11:45:00	6.9	3.350089443	0	1,190,944	Open	13.5	306
3/7/2026	12:00:00	6.9	3.350089443	3.9	1,190,990	Open	13.7	311
3/7/2026	12:15:00	6.9	0	1.3	1,191,018	Closed	14.1	308
3/7/2026	12:30:00	6.9	3.369016502	1.3	1,191,055	Open	14.1	306
3/7/2026	12:45:00	6.9	3.342518619	2.9	1,191,101	Open	14.1	306
3/7/2026	13:00:00	6.9	0	3	1,191,133	Closed	14.3	306
3/7/2026	13:15:00	6.9	3.372801914	4.6	1,191,171	Open	13.9	309
3/7/2026	13:30:00	6.9	3.247883324	3.6	1,191,216	Open	13.6	308
3/7/2026	13:45:00	6.9	3.236527089	5.7	1,191,261	Open	13.4	308
3/7/2026	14:00:00	6.9	2.994260734	1.3	1,191,305	Closed	13.4	306



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/7/2026	14:15:00	6.9	3.213814618	0	1,191,331	Open	13.3	308
3/7/2026	14:30:00	6.9	0.242266355	0	1,191,357	Closed	13.5	308
3/7/2026	14:45:00	6.9	3.21760003	0.3	1,191,396	Open	13.2	308
3/7/2026	15:00:00	6.9	3.228956265	0	1,191,440	Open	13.2	308
3/7/2026	15:15:00	6.9	3.202458383	0	1,191,484	Open	13.2	308
3/7/2026	15:30:00	6.9	3.024544028	2.4	1,191,522	Open	13.2	308
3/7/2026	15:45:00	6.9	3.221385442	0	1,191,557	Open	13.2	308
3/7/2026	16:00:00	6.9	3.21760003	0	1,191,601	Open	13.2	308
3/7/2026	16:15:00	6.9	3.096466852	0	1,191,643	Closed	13.2	308
3/7/2026	16:30:00	6.9	3.228956265	0.6	1,191,670	Open	13.2	308
3/7/2026	16:45:00	6.9	3.194887559	0.7	1,191,714	Open	13.2	308
3/7/2026	17:00:00	6.9	0.052995765	0	1,191,745	Closed	13.4	308
3/7/2026	17:15:00	6.9	0.900928008	0	1,191,756	Closed	13.2	308
3/7/2026	17:30:00	6.9	3.221385442	0.1	1,191,799	Open	13.3	309
3/7/2026	17:45:00	6.9	3.225170854	0	1,191,844	Open	13.7	305
3/7/2026	18:00:00	6.9	3.225170854	0	1,191,889	Open	14.1	303
3/7/2026	18:15:00	6.9	3.297093678	0.9	1,191,931	Open	14.7	302
3/7/2026	18:30:00	6.9	3.274381207	2	1,191,974	Open	14.7	300
3/7/2026	18:45:00	6.9	3.285737442	6.9	1,192,019	Open	14.9	302
3/7/2026	19:00:00	6.9	3.255454148	54.4	1,192,043	Closed	15.3	302
3/7/2026	19:15:00	6.9	3.281952031	7.9	1,192,085	Open	15.1	300
3/7/2026	19:30:00	6.9	3.270595795	9.6	1,192,130	Open	15.1	300
3/7/2026	19:45:00	6.8	0.158987296	10.8	1,192,165	Closed	14.8	302
3/7/2026	20:00:00	6.9	3.172175088	3.7	1,192,194	Open	14.9	302
3/7/2026	20:15:00	6.8	3.077539793	3	1,192,236	Open	14.1	302
3/7/2026	20:30:00	6.8	3.092681441	2.8	1,192,278	Open	14	306
3/7/2026	20:45:00	6.8	0.204412237	0	1,192,309	Open	14.2	303
3/7/2026	21:00:00	6.8	3.126750147	0.3	1,192,335	Open	14.5	302
3/7/2026	21:15:00	6.8	3.047256499	1.5	1,192,377	Open	14.4	301
3/7/2026	21:30:00	6.8	3.085110617	4	1,192,403	Open	14.8	301
3/7/2026	21:45:00	6.8	3.062398146	2.1	1,192,445	Open	14.3	302
3/7/2026	22:00:00	6.8	3.085110617	0.8	1,192,488	Open	14.1	303
3/7/2026	22:15:00	6.9	3.073754382	0.6	1,192,530	Open	14.2	300
3/7/2026	22:30:00	6.9	3.077539793	1.2	1,192,573	Open	14.2	301
3/7/2026	22:45:00	6.8	3.062398146	1.7	1,192,615	Open	14	303
3/7/2026	23:00:00	6.8	3.058612734	1.5	1,192,657	Open	14	305



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/7/2026	23:15:00	6.9	3.047256499	2.1	1,192,699	Open	14	305
3/7/2026	23:30:00	6.9	3.051041911	2	1,192,741	Open	14	305
3/7/2026	23:45:00	6.8	3.035900264	3.3	1,192,783	Open	13.9	303
3/8/2026	0:00:00	6.8	2.918552498	5.6	1,192,824	Open	13.9	301
3/8/2026	0:15:00	6.9	0	5.2	1,192,860	Closed	14.1	302
3/8/2026	0:30:00	6.9	2.941264969	5.6	1,192,881	Open	14.8	300
3/8/2026	0:45:00	6.8	3.039685675	6.9	1,192,921	Open	15	297
3/8/2026	1:00:00	6.8	3.032114852	3.3	1,192,961	Open	15.3	297
3/8/2026	1:15:00	6.8	3.039685675	6.2	1,193,003	Open	15.1	300
3/8/2026	1:30:00	6.8	3.081325205	5.1	1,193,041	Open	14.6	300
3/8/2026	1:45:00	6.8	3.047256499	4.1	1,193,084	Open	14.8	302
3/8/2026	2:00:00	6.9	2.146328491	3.2	1,193,120	Open	14.3	302
3/8/2026	2:15:00	6.9	3.085110617	3.4	1,193,155	Open	14.4	300
3/8/2026	2:30:00	6.9	3.077539793	4.4	1,193,197	Open	14.5	299
3/8/2026	2:45:00	6.9	3.073754382	5.3	1,193,240	Open	14.5	300
3/8/2026	3:00:00	6.9	3.06996897	4.5	1,193,282	Open	14.7	301
3/8/2026	3:15:00	6.9	2.918552498	7.1	1,193,321	Closed	14.8	300
3/8/2026	3:30:00	6.8	3.247883324	4	1,193,322	Open	15.1	300
3/8/2026	3:45:00	6.8	3.032114852	7.4	1,193,363	Open	14.6	299
3/8/2026	4:00:00	6.9	3.062398146	5.7	1,193,405	Open	14.7	297
3/8/2026	4:15:00	6.9	0.571597182	6	1,193,445	Open	15	297
3/8/2026	4:30:00	6.9	3.073754382	6.7	1,193,468	Open	15.4	297
3/8/2026	4:45:00	6.9	3.062398146	9.3	1,193,510	Open	15.4	297
3/8/2026	5:00:00	6.9	3.032114852	4.6	1,193,549	Open	15.2	297
3/8/2026	5:15:00	6.9	3.02832944	4.9	1,193,591	Open	15.5	297
3/8/2026	5:30:00	6.9	3.009402381	7.6	1,193,633	Open	15.6	297
3/8/2026	5:45:00	6.9	3.020758616	9.4	1,193,674	Open	15.7	297
3/8/2026	6:00:00	6.9	3.270595795	9.3	1,193,718	Open	14.6	293
3/8/2026	6:15:00	6.9	0.427751533	4.5	1,193,750	Open	14.7	296
3/8/2026	6:30:00	6.9	3.30087909	7	1,193,790	Open	14	297
3/8/2026	6:45:00	6.9	3.236527089	5.2	1,193,834	Open	13.7	298
3/8/2026	7:00:00	6.8	3.228956265	5.9	1,193,878	Open	13.6	299
3/8/2026	7:15:00	6.9	3.285737442	12.3	1,193,905	Open	13.6	299
3/8/2026	7:30:00	6.9	3.278166619	1.3	1,193,948	Open	13.2	299
3/8/2026	7:45:00	6.8	3.247883324	1	1,193,993	Open	13.2	299
3/8/2026	8:00:00	6.9	3.236527089	0.8	1,194,037	Open	13.3	301



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>


3/8/2026	8:15:00	6.9	3.21760003	0.3	1,194,081	Open	13.4	299
3/8/2026	8:30:00	6.9	3.225170854	0.8	1,194,126	Open	13.6	299
3/8/2026	8:45:00	6.9	3.210029206	2.9	1,194,170	Open	13.8	299
3/8/2026	9:00:00	6.8	3.36523109	2	1,194,199	Open	13.9	299
3/8/2026	9:15:00	6.8	3.338733208	1	1,194,245	Open	13.6	299
3/8/2026	9:30:00	6.8	0	2.7	1,194,284	Closed	13.4	299
3/8/2026	9:45:00	6.8	3.387943561	2	1,194,315	Open	13.2	301
3/8/2026	10:00:00	6.8	3.403085208	8.7	1,194,336	Open	13.3	301
3/8/2026	10:15:00	6.8	3.357660267	6.7	1,194,380	Open	12.8	301
3/8/2026	10:30:00	6.8	3.478793444	7.9	1,194,424	Open	12.7	302
3/8/2026	10:45:00	6.8	3.463651797	10	1,194,472	Open	12.6	302
3/8/2026	11:00:00	6.8	3.520432974	19.3	1,194,502	Open	12.8	301
3/8/2026	11:15:00	6.8	3.459866385	4.1	1,194,547	Open	12.4	301
3/8/2026	12:30:00	6.8	3.418226855	5.4	1,194,594	Open	12.4	302
3/8/2026	12:45:00	6.8	3.444724738	9.3	1,194,623	Open	12.5	298
3/8/2026	13:00:00	6.8	0.575382594	8.7	1,194,668	Open	12.5	298
3/8/2026	13:15:00	6.8	3.437153914	11.7	1,194,697	Open	12.5	298
3/8/2026	13:30:00	6.8	0.264978826	14.4	1,194,734	Open	12.4	298
3/8/2026	13:45:00	6.8	3.459866385	14.3	1,194,766	Open	12.5	297
3/8/2026	14:00:00	6.8	3.440939326	13.4	1,194,814	Open	12.5	297
3/8/2026	14:15:00	6.9	3.285737442	7.3	1,194,841	Open	12.5	297
3/8/2026	14:30:00	6.9	3.25923956	7.5	1,194,886	Open	12.4	295
3/8/2026	14:45:00	6.9	3.247883324	7.8	1,194,900	Closed	12.6	296
3/8/2026	15:00:00	6.9	3.395514385	11.4	1,194,944	Open	12.5	296
3/8/2026	15:15:00	6.8	3.369016502	13.5	1,194,990	Open	12.5	296
3/8/2026	15:30:00	6.8	3.410656032	14.7	1,195,015	Open	12.6	297
3/8/2026	15:45:00	6.8	3.414441444	13.8	1,195,058	Open	12.4	297
3/8/2026	16:00:00	6.8	0	14.7	1,195,092	Closed	12.5	297
3/8/2026	16:15:00	6.8	3.346304031	30.7	1,195,121	Open	12.4	297
3/8/2026	16:30:00	6.8	3.372801914	17.8	1,195,143	Open	12.4	297
3/8/2026	16:45:00	6.8	0	6.8	1,195,171	Closed	12.4	297
3/8/2026	17:00:00	6.8	3.471222621	7	1,195,211	Open	12.2	298
3/8/2026	17:15:00	6.8	3.452295562	6.5	1,195,258	Open	12.2	298
3/8/2026	17:30:00	6.8	3.429583091	6.9	1,195,306	Open	12.2	298
3/8/2026	17:45:00	6.8	3.463651797	10.7	1,195,335	Open	12.1	297
3/8/2026	18:00:00	6.8	3.440939326	6.8	1,195,382	Open	12.1	297



**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

3/8/2026	18:15:00	6.8	3.478793444	9	1,195,408	Open	12.2	298
3/8/2026	18:30:00	6.8	3.437153914	8.4	1,195,456	Open	12	298
3/8/2026	18:45:00	6.8	3.456080973	37.8	1,195,483	Open	12.4	296
3/8/2026	19:00:00	6.9	0	11.7	1,195,523	Closed	12.8	294
3/8/2026	19:15:00	6.8	3.452295562	12.6	1,195,554	Open	13	293
3/8/2026	19:30:00	6.9	0	4.6	1,195,593	Closed	13.3	292
3/8/2026	19:45:00	6.9	3.312235325	6.1	1,195,622	Open	13.5	292
3/8/2026	20:00:00	6.9	3.281952031	5.9	1,195,668	Open	13.7	291
3/8/2026	20:15:00	6.9	3.312235325	7.2	1,195,690	Open	14.2	291
3/8/2026	20:30:00	6.8	1.521735544	5.2	1,195,735	Open	14.1	289
3/8/2026	20:45:00	6.8	3.312235325	10	1,195,761	Open	14.3	291
3/8/2026	21:00:00	6.9	3.285737442	19.6	1,195,806	Open	14.5	290
3/8/2026	21:15:00	6.8	3.312235325	6.8	1,195,833	Open	14.8	290
3/8/2026	21:30:00	6.8	3.285737442	5.9	1,195,879	Open	14.9	287
3/8/2026	21:45:00	6.8	3.319806149	3.3	1,195,904	Open	15.5	291
3/8/2026	22:00:00	6.8	3.281952031	11.7	1,195,950	Open	14.8	288
3/8/2026	22:15:00	6.8	3.312235325	13.4	1,195,976	Open	14.8	291
3/8/2026	22:30:00	6.8	3.562072504	60	1,196,022	Open	14.8	287
3/8/2026	22:45:00	6.8	0.276335061	7	1,196,037	Open	15.1	288
3/8/2026	23:00:00	6.8	3.30087909	3.5	1,196,070	Open	14.6	289
3/8/2026	23:15:00	6.8	0.359614121	2.1	1,196,088	Open	15.6	290
3/8/2026	23:30:00	6.8	3.316020737	5.6	1,196,132	Open	14.7	289
3/8/2026	23:45:00	6.8	3.285737442	7.5	1,196,177	Open	14.8	289

		<b>Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope</b>	
<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Appendix B: Photos**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 1: No visible sheen observed in the WTP water, March 2**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 2: No visible sheen observed in the WTP water, March 3**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 3: No visible sheen observed in the WTP water, March 4**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 4: No visible sheen observed in the WTP water, March 5**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 5: No visible sheen observed in the WTP water, March 6**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 5: No visible sheen observed in the WTP water, March 7**





**Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope**

<b>Title</b>	<b>Wood Fibre Weekly Water Discharge Report</b>	<b>Revision:</b>	<b>0</b>
<b>Data Range</b>	<b>March 2, 2026 to March 8, 2026</b>	<b>Prepared by:</b> <b>Approved by:</b> <b>Date:</b>	<b>BC1</b> <b>BC2</b> <b>March 31, 2026</b>

**Photo 5: No visible sheen observed in the WTP water, March 8**





**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	D-1

**Appendix D:  
Woodfibre Site Receiving Environment  
Documentation**



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	D-2

## Woodfibre Site Receiving Environment Sample Analysis



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-03-03 09:57:00	WLNG DS 2026-03-03 10:18:00
<b>In situ Parameters</b>									
Field pH	pH Units		6.5 - 9			7 - 8.7		6.95	7.22
Field Temperature	°C	18	19					6.3	8.3
<b>General Parameters</b>									
pH	pH Units							6.35	6.28
Alkalinity (Total as CaCO3)	mg/L							8	7.5
Alkalinity (PP as CaCO3)	mg/L							<1	<1
Hardness (CaCO3)-Total	mg/L							9.39	8.62
Hardness (CaCO3)-Dissolved	mg/L							9.2	8.65
Sulphide-Total	mg/L							<0.0018	<0.0018
Sulphide (as H2S)	mg/L			0.002				<0.002	<0.002
Un-ionized Hydrogen Sulfide as H2S-Tota	mg/L							<0.0019	<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018	<0.0018
<b>Anions and Nutrients</b>									
Ammonia (N)-Total	mg/L	1.86	16.2		18	121		<0.015	<0.015
Bicarbonate (HCO3)	mg/L							9.8	9.1
Carbonate (CO3)	mg/L							<1	<1
Hydroxide (OH)	mg/L							<1	<1
Nitrate (N)	mg/L	3	32.8		3.7			0.023	<0.02
Nitrite (N)	mg/L	0.02	0.06					<0.005	<0.005
Nitrate plus Nitrite (N)	mg/L							0.023	<0.02
Nitrogen (N)-Total	mg/L							0.139	0.119
Phosphorus (P)-Total (4500-P)	mg/L							0.13	0.048
Bromide (Br)	mg/L							<0.01	<0.01
Chloride (Cl)	mg/L	150	600					<1	<1
Fluoride (F)	mg/L		0.4			1.5		<0.05	<0.05
Sulphate (SO4)-Dissolved	mg/L	128						<1	1.1
<b>Total Metals</b>									
Aluminum (Al)-Total	mg/L	0.0509131						0.258	0.115
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000058	0.000045
Arsenic (As)-Total	mg/L	0.005			0.0125			0.000319	0.000202
Barium (Ba)-Total	mg/L			1				0.00561	0.00364
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001	<0.00001
Bismuth (Bi)-Total	mg/L							<0.000005	<0.000005
Boron (B)-Total	mg/L	1.2			1.2			<0.01	<0.01
Cadmium (Cd)-Total	mg/L						0.00012	0.0000084	0.0000074
Calcium (Ca)-Total	mg/L							2.95	2.91
Cesium (Cs)-Total	mg/L							<0.00005	<0.00005
Chromium (Cr)-Total	mg/L							0.00015	0.00011
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099	<0.00099
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099	<0.00099

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-03-03 09:57:00	WLNG DS 2026-03-03 10:18:00
<b>Total Metals (cont'd)</b>									
Cobalt (Co)-Total	mg/L							0.0000919	0.0000483
Copper (Cu)-Total	mg/L				0.002	0.003		0.00154	0.000959
Iron (Fe)-Total	mg/L		1					0.161	0.0627
Lead (Pb)-Total	mg/L				0.002	0.14		0.0000937	0.000028
Lithium (Li)-Total	mg/L							<0.0005	<0.0005
Magnesium (Mg)-Total	mg/L							0.494	0.33
Manganese (Mn)-Total	mg/L	0.642928	0.6349924				0.1	0.00729	0.00471
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019	<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.000603	0.00119
Nickel (Ni)-Total	mg/L						0.0083	0.000431	0.000407
Phosphorus (P)-Total (ICPMS)	mg/L							0.144	0.0455
Potassium (K)-Total	mg/L							0.345	0.257
Rubidium (Rb)-Total	mg/L							0.000525	0.00043
Selenium (Se)-Total	mg/L	0.002			0.002			<0.00004	<0.00004
Silicon (Si)-Total	mg/L							3.92	3.53
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.000005	<0.000005
Sodium (Na)-Total	mg/L							1.34	1.27
Strontium (Sr)-Total	mg/L							0.0121	0.0113
Sulphur (S)-Total	mg/L							<3	<3
Tellurium (Te)-Total	mg/L							<0.00002	<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000032	0.0000025
Thorium (Th)-Total	mg/L							<0.00005	<0.00005
Tin (Sn)-Total	mg/L							<0.0002	<0.0002
Titanium (Ti)-Total	mg/L							0.00862	0.0017
Uranium (U)-Total	mg/L		0.0165	0.0075				0.000103	0.000115
Vanadium (V)-Total	mg/L			0.06			0.005	0.0004	0.00021
Zinc (Zn)-Total	mg/L				0.01	0.055		0.00267	0.00197
Zirconium (Zr)-Total	mg/L							<0.0001	<0.0001
<b>Dissolved Metals</b>									
Aluminum (Al)-Dissolved	mg/L							0.0627	0.056
Antimony (Sb)-Dissolved	mg/L							0.000058	0.000041
Arsenic (As)-Dissolved	mg/L							0.000301	0.000189
Barium (Ba)-Dissolved	mg/L							0.00301	0.00313
Beryllium (Be)-Dissolved	mg/L							<0.00001	<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005	<0.000005
Boron (B)-Dissolved	mg/L							<0.01	<0.01
Cadmium (Cd)-Dissolved	mg/L	0.0000348	0.0000471					0.0000097	0.0000058
Calcium (Ca)-Dissolved	mg/L							2.93	2.94
Cesium (Cs)-Dissolved	mg/L							<0.00005	<0.00005
Chromium (Cr)-Dissolved	mg/L							0.00011	0.00014

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).



Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-03-03 09:57:00	WLNG DS 2026-03-03 10:18:00
<b>Dissolved Metals (cont'd.)</b>									
Cobalt (Co)-Dissolved	mg/L	0.0003889						0.0000433	0.0000416
Copper (Cu)-Dissolved	mg/L	0.0002	0.00129					<b>0.00143</b>	<b>0.00091</b>
Iron (Fe)-Dissolved	mg/L		0.35					0.0214	0.0209
Lead (Pb)-Dissolved	mg/L	0.0017358						0.0000137	0.000009
Lithium (Li)-Dissolved	mg/L							<0.0005	<0.0005
Manganese (Mn)-Dissolved	mg/L							0.000967	0.00336
Magnesium (Mg)-Dissolved	mg/L							0.458	0.32
Mercury (Hg)-Dissolved	mg/L							0.0000023	0.0000027
Molybdenum (Mo)-Dissolved	mg/L							0.000602	0.00117
Nickel (Ni)-Dissolved	mg/L	0.0007	0.0117					0.00039	0.000406
Phosphorus (P)-Dissolved	mg/L							0.14	0.0427
Potassium (K)-Dissolved	mg/L							0.31	0.242
Rubidium (Rb)-Dissolved	mg/L							0.000321	0.000363
Selenium (Se)-Dissolved	mg/L							0.00005	<0.00004
Silicon (Si)-Dissolved	mg/L							3.43	3.43
Silver (Ag)-Dissolved	mg/L							<0.000005	<0.000005
Sodium (Na)-Dissolved	mg/L							1.26	1.25
Strontium (Sr)-Dissolved	mg/L			1.25				0.0106	0.0103
Sulphur (S)-Dissolved	mg/L							<3	<3
Tellurium (Te)-Dissolved	mg/L							<0.00002	<0.00002
Thallium (Tl)-Dissolved	mg/L							<0.000002	0.0000022
Thorium (Th)-Dissolved	mg/L							0.0000163	0.0000173
Tin (Sn)-Dissolved	mg/L							<0.0002	<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005	<0.0005
Uranium (U)-Dissolved	mg/L							0.0000992	0.000115
Vanadium (V)-Dissolved	mg/L							<0.0002	<0.0002
Zinc (Zn)-Dissolved	mg/L	0.0037027	0.0087868					0.0013	0.00175
Zirconium (Zr)-Dissolved	mg/L							<0.0001	<0.0001
<b>Inorganics</b>									
Organic Carbon (C)-Total	mg/L							2.4	2.2
Organic Carbon (C)-Dissolved	mg/L							1.9	2
Solids-Total Dissolved	mg/L							12	<10
Solids-Total Suspended	mg/L	6.6	26.6					1.6	1.2

<sup>1</sup> Guideline calculated using the in-situ measurements (pH (field), Temperature (field), Turbidity (field), Hardness (as CaCO<sub>3</sub>) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO<sub>3</sub>), and Chloride).

<sup>2</sup> Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

<sup>3</sup> **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per <sup>1</sup> and <sup>2</sup> above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

<sup>4</sup> **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

# Water Quality Field Data Sheet



Hatfield

Project: FORTIS11234

## Location Information

Site ID: WLNG EOP Date: March 3, 2026  
Site Name: East Creek Time: 9:01  
Crew: JM  
Weather: Rain

## In Situ Parameters

pH: 6.11 DO: - (mg/L)  
Temp: 10.3 (°C) Cond: 148 (uS/cm)  
Turbidity: 4.67 NTU Salinity: - (ppt)  
ORP: - (mV)

Visible Sheen: N

Water Surface Condition: Clear

## Photo Record



## Observations

---

---

---



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix C	D-3

## Woodfibre Site Receiving Environment Field Notes and Logs

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-02 00:00:00	8.74	152.96	0.31	7.87	10.61	2.02	0.07
EAS-DS	2026-03-02 00:15:00	8.43	1.26	0.30	7.93	10.78	0.00	0.00
EAS-DS	2026-03-02 00:30:00	8.84	162.54	0.31	7.86	10.72	2.23	0.08
EAS-DS	2026-03-02 00:45:00	7.64	104.91	0.32	7.71	11.32	4.34	0.05
EAS-DS	2026-03-02 01:00:00	8.99	161.83	0.32	7.89	10.74	2.64	0.08
EAS-DS	2026-03-02 01:15:00	8.19	0.97	0.31	7.86	10.96	0.00	0.00
EAS-DS	2026-03-02 01:30:00	8.47	141.60	0.32	7.81	10.92	3.90	0.07
EAS-DS	2026-03-02 01:45:00	8.72	1.01	0.31	7.92	10.69	0.00	0.00
EAS-DS	2026-03-02 02:00:00	8.91	156.70	0.32	7.81	10.73	4.17	0.07
EAS-DS	2026-03-02 02:15:00	8.71	143.96	0.32	7.83	10.64	8.00	0.07
EAS-DS	2026-03-02 02:30:00	8.68	149.27	0.32	7.83	11.01	8.38	0.07
EAS-DS	2026-03-02 02:45:00	8.95	152.65	0.33	7.89	10.73	4.14	0.07
EAS-DS	2026-03-02 03:00:00		1.80		7.88	10.61	0.00	0.00
EAS-DS	2026-03-02 03:15:00	8.81	149.97	0.33	7.70	10.85	1.83	0.07
EAS-DS	2026-03-02 03:30:00	8.72	148.27	0.33	7.82	10.77	29.16	0.07
EAS-DS	2026-03-02 03:45:00	8.33	138.32	0.33	7.70	11.10	2.13	0.06
EAS-DS	2026-03-02 04:00:00	8.71	1.06	0.32	7.89	10.69	0.00	0.00
EAS-DS	2026-03-02 04:15:00	6.72	0.61	0.33	7.87	11.49	0.00	0.00
EAS-DS	2026-03-02 04:30:00	8.05	124.51	0.33	7.75	11.14	1.51	0.06
EAS-DS	2026-03-02 04:45:00	8.51	137.47	0.32	7.80	11.01	0.00	0.06
EAS-DS	2026-03-02 05:00:00	8.37	131.56	0.32	7.66	11.20	0.69	0.06
EAS-DS	2026-03-02 05:15:00	8.55	134.85	0.32	7.79	10.93	1.20	0.06
EAS-DS	2026-03-02 05:30:00	8.76	162.23	0.31	7.83	10.87	6.97	0.08
EAS-DS	2026-03-02 05:45:00	8.78	165.13	0.32	7.78	10.76	3.60	0.08
EAS-DS	2026-03-02 06:00:00	8.48	0.98	0.31	7.82	10.60	1.83	0.00
EAS-DS	2026-03-02 06:15:00	8.70	156.19	0.32	7.76	10.83	0.63	0.07
EAS-DS	2026-03-02 06:30:00	7.79	120.35	0.32	7.67	11.25	5.01	0.06
EAS-DS	2026-03-02 06:45:00	8.48	141.42	0.33	7.78	10.92	0.00	0.07
EAS-DS	2026-03-02 07:00:00	8.56	0.96	0.32	7.82	10.73	0.00	0.00
EAS-DS	2026-03-02 07:15:00	8.66	148.89	0.33	7.77	10.92	0.00	0.07
EAS-DS	2026-03-02 07:30:00	8.43	137.76	0.32	7.76	10.89	5.32	0.06
EAS-DS	2026-03-02 07:45:00	8.62	147.26	0.33	7.66	10.95	0.00	0.07
EAS-DS	2026-03-02 08:00:00	8.73	152.11	0.33	7.83	10.87	0.00	0.07
EAS-DS	2026-03-02 08:15:00	7.26	97.21	0.33	7.60	11.51	1.19	0.04
EAS-DS	2026-03-02 08:30:00	8.70	151.54	0.33	7.83	10.85	1.14	0.07
EAS-DS	2026-03-02 08:45:00	8.50	144.70	0.34	7.84	10.89	0.40	0.07
EAS-DS	2026-03-02 09:00:00	8.53	141.82	0.34	7.80	10.92	0.00	0.07
EAS-DS	2026-03-02 09:15:00	8.40	130.08	0.34	7.79	10.88	0.00	0.06
EAS-DS	2026-03-02 09:30:00	7.59	0.89	0.31	7.81	11.10	0.55	0.00
EAS-DS	2026-03-02 09:45:00	8.58	138.52	0.33	7.74	10.94	0.00	0.06
EAS-DS	2026-03-02 10:00:00	8.47	135.01	0.33	7.69	11.09	0.00	0.06
EAS-DS	2026-03-02 10:15:00	9.03	146.60	0.33	7.74	10.80	0.00	0.07
EAS-DS	2026-03-02 10:30:00	8.70	121.58	0.32	7.70	10.97	2.87	0.06
EAS-DS	2026-03-02 10:45:00	9.09	122.93	0.30	7.84	10.96	9.50	0.06
EAS-DS	2026-03-02 11:00:00	9.06	125.60	0.31	7.80	10.95	1.56	0.06
EAS-DS	2026-03-02 11:15:00	9.02	2.31	0.30	7.84	10.68	0.00	0.00
EAS-DS	2026-03-02 11:30:00	9.38	140.40	0.29	7.79	10.81	0.00	0.07
EAS-DS	2026-03-02 11:45:00	9.30	127.06	0.30	7.77	10.82	1.15	0.06
EAS-DS	2026-03-02 12:00:00	9.34	0.89	0.28	7.97	10.72	0.00	0.00
EAS-DS	2026-03-02 12:15:00	9.51	144.42	0.30	7.81	10.76	0.00	0.07
EAS-DS	2026-03-02 12:30:00	8.21	0.23	0.27	7.92	11.06	0.00	0.00
EAS-DS	2026-03-02 12:45:00	7.48	0.08	0.28	7.88	11.39	0.00	0.00
EAS-DS	2026-03-02 13:00:00	8.60	100.13	0.30	7.31	11.16	0.00	0.05
EAS-DS	2026-03-02 13:15:00	9.41	1.09	0.25	7.77	10.72	80.48	0.00
EAS-DS	2026-03-02 13:30:00	9.68	134.06	0.26	7.81	10.65	0.20	0.06

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-02 13:45:00	9.77	129.24	0.28	7.89	10.76	0.85	0.06
EAS-DS	2026-03-02 14:00:00	8.89	88.32	0.28	7.69	11.05	0.00	0.04
EAS-DS	2026-03-02 14:15:00	9.83	127.97	0.29	7.91	10.67	1.17	0.06
EAS-DS	2026-03-02 14:30:00	9.57	0.74	0.25	7.85	10.56	0.31	0.00
EAS-DS	2026-03-02 14:45:00	9.86	117.99	0.27	7.83	10.63	4.41	0.05
EAS-DS	2026-03-02 15:00:00	9.81	114.66	0.27	7.86	10.61	0.35	0.05
EAS-DS	2026-03-02 15:15:00	8.94	57.91	0.27	7.70	10.70	1.44	0.03
EAS-DS	2026-03-02 15:30:00	9.79	122.78	0.26	7.75	10.47	5.71	0.06
EAS-DS	2026-03-02 15:45:00	9.77	1.08	0.24	7.81	10.43	83.64	0.00
EAS-DS	2026-03-02 16:00:00	9.73	127.62	0.26	7.83	10.57	2.02	0.06
EAS-DS	2026-03-02 16:15:00	9.78	125.14	0.27	7.82	10.58	3.85	0.06
EAS-DS	2026-03-02 16:30:00	9.38	126.27	0.27	7.76	10.76	10.75	0.06
EAS-DS	2026-03-02 16:45:00	9.59	120.39	0.27	7.77	10.51	55.08	0.06
EAS-DS	2026-03-02 17:00:00	9.32	123.74	0.28	7.70	10.59	2.77	0.06
EAS-DS	2026-03-02 17:15:00	9.58	123.53	0.28	7.86	10.69	9.45	0.06
EAS-DS	2026-03-02 17:30:00	9.16	0.08	0.26	7.88	10.65	2.01	0.00
EAS-DS	2026-03-02 17:45:00	9.52	132.18	0.27	7.86	10.70	2.72	0.06
EAS-DS	2026-03-02 18:00:00	9.47	121.40	0.27	7.87	10.73	9.78	0.06
EAS-DS	2026-03-02 18:15:00	9.51	130.19	0.28	7.88	10.67	2.73	0.06
EAS-DS	2026-03-02 18:30:00	8.11	37.10	0.26	7.75	11.03	0.67	0.02
EAS-DS	2026-03-02 18:45:00	9.47	118.40	0.26	8.25	10.72	2.52	0.06
EAS-DS	2026-03-02 19:00:00	8.37	85.24	0.26	7.70	11.25	5.67	0.04
EAS-DS	2026-03-02 19:15:00	9.44	115.44	0.22	9.05	10.71	7.15	0.05
EAS-DS	2026-03-02 19:30:00	9.29	119.52	0.23	8.50	10.75	3.89	0.06
EAS-DS	2026-03-02 19:45:00	9.41	122.62	0.25	8.04	10.63	0.53	0.06
EAS-DS	2026-03-02 20:00:00	9.12	0.11	0.24	7.93	10.67	0.00	0.00
EAS-DS	2026-03-02 20:15:00	9.23	118.72	0.27	7.78	10.78	0.42	0.06
EAS-DS	2026-03-02 20:30:00	9.32	123.98	0.26	7.82	10.54	0.00	0.06
EAS-DS	2026-03-02 20:45:00	9.08	122.21	0.27	7.75	10.86	0.00	0.06
EAS-DS	2026-03-02 21:00:00	9.29	124.70	0.27	7.86	10.83	0.05	0.06
EAS-DS	2026-03-02 21:15:00	9.32	127.71	0.28	7.85	10.80	0.00	0.06
EAS-DS	2026-03-02 21:30:00	8.70	111.60	0.27	7.76	11.07	1.79	0.05
EAS-DS	2026-03-02 21:45:00	9.27	124.99	0.28	7.90	10.84	0.18	0.06
EAS-DS	2026-03-02 22:00:00	7.81	68.08	0.28	7.71	11.24	0.00	0.03
EAS-DS	2026-03-02 22:15:00	9.09	0.14	0.26	7.92	10.72	0.00	0.00
EAS-DS	2026-03-02 22:30:00	9.08	124.75	0.27	7.86	10.88	0.00	0.06
EAS-DS	2026-03-02 22:45:00	7.91	82.96	0.27	7.70	11.23	0.00	0.04
EAS-DS	2026-03-02 23:00:00	9.00	1.13	0.25	7.89	10.72	99.89	0.00
EAS-DS	2026-03-02 23:15:00	9.15	126.49	0.27	7.87	10.86	0.00	0.06
EAS-DS	2026-03-02 23:30:00	9.14	115.58	0.26	7.92	10.83	0.34	0.05
EAS-DS	2026-03-02 23:45:00	9.10	126.61	0.28	7.90	10.74	0.00	0.06
EAS-DS	2026-03-03 00:00:00	9.07	124.76	0.28	7.89	10.73	0.00	0.06
EAS-DS	2026-03-03 00:15:00	9.13	127.70	0.28	7.85	10.57	0.18	0.06
EAS-DS	2026-03-03 00:30:00	8.86	0.15	0.25	7.87	10.71	1.09	0.00
EAS-DS	2026-03-03 00:45:00	9.13	128.85	0.27	7.89	10.89	0.00	0.06
EAS-DS	2026-03-03 01:00:00	8.65	0.12	0.27	7.94	10.85	0.00	0.00
EAS-DS	2026-03-03 01:15:00	9.12	129.06	0.28	7.86	10.88	2.15	0.06
EAS-DS	2026-03-03 01:30:00	8.30	0.08	0.24	7.84	11.00	632.83	0.00
EAS-DS	2026-03-03 01:45:00	9.18	128.66	0.26	7.87	10.87	4.72	0.06
EAS-DS	2026-03-03 02:00:00	8.64	115.10	0.27	7.63	11.20	0.32	0.05
EAS-DS	2026-03-03 02:15:00	9.23	126.94	0.27	7.83	10.82	0.88	0.06
EAS-DS	2026-03-03 02:30:00	8.99	124.53	0.28	7.73	10.99	3.68	0.06
EAS-DS	2026-03-03 02:45:00	9.24	128.64	0.26	7.87	10.79	1.21	0.06
EAS-DS	2026-03-03 03:00:00	8.67	118.94	0.27	7.73	11.15	6.89	0.06
EAS-DS	2026-03-03 03:15:00	9.18	0.67	0.23	7.88	10.63	705.26	0.00

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-03 03:30:00	9.11	123.90	0.26	7.76	10.80	2.20	0.06
EAS-DS	2026-03-03 03:45:00	9.01	0.08	0.24	7.91	10.58	0.00	0.00
EAS-DS	2026-03-03 04:00:00	9.16	126.24	0.27	7.81	10.85	0.00	0.06
EAS-DS	2026-03-03 04:15:00	9.23	124.17	0.27	7.84	10.77	0.00	0.06
EAS-DS	2026-03-03 04:30:00	9.15	120.29	0.27	7.75	10.86	7.69	0.06
EAS-DS	2026-03-03 04:45:00	8.88	0.08	0.27	7.90	10.59	0.88	0.00
EAS-DS	2026-03-03 05:00:00	9.14	124.00	0.27	7.83	10.87	6.02	0.06
EAS-DS	2026-03-03 05:15:00	8.09	0.08	0.27	7.94	10.94	0.62	0.00
EAS-DS	2026-03-03 05:30:00	9.08	125.72	0.25	7.84	10.87	3.03	0.06
EAS-DS	2026-03-03 05:45:00	9.17	125.43	0.26	7.89	10.86	3.33	0.06
EAS-DS	2026-03-03 06:00:00	9.03	123.53	0.27	7.86	10.92	0.00	0.06
EAS-DS	2026-03-03 06:15:00	9.19	126.19	0.27	7.91	10.84	2.27	0.06
EAS-DS	2026-03-03 06:30:00	7.76	63.55	0.27	7.72	11.12	0.00	0.03
EAS-DS	2026-03-03 06:45:00	9.14	126.29	0.26	7.83	10.86	0.00	0.06
EAS-DS	2026-03-03 07:00:00		0.08		7.83	10.58	644.75	0.00
EAS-DS	2026-03-03 07:15:00	9.12	125.95	0.26	7.85	10.86	0.51	0.06
EAS-DS	2026-03-03 07:30:00	8.73	0.10	0.23	7.82	10.76	276.29	0.00
EAS-DS	2026-03-03 07:45:00	9.00	122.22	0.26	7.78	10.94	0.00	0.06
EAS-DS	2026-03-03 08:00:00	8.57	0.08	0.24	7.80	10.79	436.84	0.00
EAS-DS	2026-03-03 08:15:00	9.05	122.76	0.26	7.85	10.91	0.00	0.06
EAS-DS	2026-03-03 08:30:00	8.83	0.73	0.23	7.83	10.89	367.74	0.00
EAS-DS	2026-03-03 08:45:00	6.41	24.48	0.26	7.27	11.63	0.00	0.01
EAS-DS	2026-03-03 09:00:00	7.26	71.19	0.18	7.51	11.38	0.00	0.03
EAS-DS	2026-03-03 09:15:00	8.96	121.81	0.18	7.83	10.96	0.00	0.06
EAS-DS	2026-03-03 09:30:00	8.97	124.42	0.19	7.86	10.94	0.00	0.06
EAS-DS	2026-03-03 09:45:00	9.09	127.20	0.19	7.92	10.88	2.80	0.06
EAS-DS	2026-03-03 10:00:00	9.14	128.46	0.20	7.91	10.69	4.62	0.06
EAS-DS	2026-03-03 10:15:00	9.19	134.13	0.20	7.82	10.60	4.30	0.06
EAS-DS	2026-03-03 10:30:00	9.12	128.62	0.21	7.76	10.62	2.57	0.06
EAS-DS	2026-03-03 10:45:00	9.03	123.16	0.21	7.73	10.59	15.65	0.06
EAS-DS	2026-03-03 11:00:00	9.03	124.04	0.22	7.75	10.84	5.11	0.06
EAS-DS	2026-03-03 11:15:00	9.05	125.70	0.22	7.79	10.86	6.60	0.06
EAS-DS	2026-03-03 11:30:00	9.00	125.17	0.23	7.78	10.92	10.38	0.06
EAS-DS	2026-03-03 11:45:00	9.12	128.00	0.23	7.82	10.85	12.79	0.06
EAS-DS	2026-03-03 12:00:00	8.81	126.08	0.24	7.70	10.79	7.06	0.06
EAS-DS	2026-03-03 12:15:00	9.17	129.81	0.24	7.77	10.58	8.18	0.06
EAS-DS	2026-03-03 12:30:00	9.18	128.07	0.24	7.79	10.43	7.43	0.06
EAS-DS	2026-03-03 12:45:00	9.12	129.71	0.24	7.76	10.74	14.65	0.06
EAS-DS	2026-03-03 13:00:00	9.22	129.96	0.23	7.80	10.84	11.40	0.06
EAS-DS	2026-03-03 13:15:00	8.36	82.17	0.24	7.76	10.97	12.07	0.04
EAS-DS	2026-03-03 13:30:00	7.42	41.78	0.24	7.63	11.32	8.31	0.02
EAS-DS	2026-03-03 13:45:00	9.10	128.74	0.25	7.70	10.93	28.29	0.06
EAS-DS	2026-03-03 14:00:00	8.09	69.40	0.25	7.72	10.66	18.20	0.03
EAS-DS	2026-03-03 14:15:00	9.35	128.16	0.25	7.78	10.34	24.05	0.06
EAS-DS	2026-03-03 14:30:00	9.39	127.57	0.25	7.78	10.25	19.51	0.06
EAS-DS	2026-03-03 14:45:00	8.83	95.23	0.24	7.75	10.23	29.51	0.04
EAS-DS	2026-03-03 15:00:00	9.42	127.89	0.25	7.74	10.79	34.26	0.06
EAS-DS	2026-03-03 15:15:00	9.45	127.95	0.25	7.74	10.73	46.77	0.06
EAS-DS	2026-03-03 15:30:00	9.36	126.04	0.25	7.70	10.86	42.85	0.06
EAS-DS	2026-03-03 15:45:00	9.48	128.16	0.24	7.73	10.78	44.17	0.06
EAS-DS	2026-03-03 16:00:00	9.48	124.78	0.25	7.78	10.74	29.62	0.06
EAS-DS	2026-03-03 16:15:00	9.08	112.23	0.26	7.76	10.96	21.32	0.05
EAS-DS	2026-03-03 16:30:00	9.48	120.04	0.25	7.86	10.76	10.19	0.06
EAS-DS	2026-03-03 16:45:00	9.48	119.42	0.24	7.87	10.68	23.50	0.06
EAS-DS	2026-03-03 17:00:00	9.44	117.46	0.25	7.88	10.75	6.12	0.05

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-03 17:15:00	9.41	116.64	0.25	7.87	10.78	7.19	0.05
EAS-DS	2026-03-03 17:30:00	9.41	115.40	0.25	7.88	10.77	3.78	0.05
EAS-DS	2026-03-03 17:45:00	9.41	116.89	0.25	7.88	10.76	12.03	0.05
EAS-DS	2026-03-03 18:00:00	9.40	116.01	0.25	7.90	10.71	7.51	0.05
EAS-DS	2026-03-03 18:15:00	9.39	115.47	0.25	7.90	10.59	7.95	0.05
EAS-DS	2026-03-03 18:30:00	9.37	114.72	0.24	7.90	10.76	11.30	0.05
EAS-DS	2026-03-03 18:45:00	9.32	114.45	0.23	7.89	10.59	15.75	0.05
EAS-DS	2026-03-03 19:00:00	9.31	114.47	0.24	7.90	10.80	13.62	0.05
EAS-DS	2026-03-03 19:15:00	8.09	62.67	0.24	7.72	11.06	15.60	0.03
EAS-DS	2026-03-03 19:30:00	9.26	119.22	0.25	7.82	10.78	23.49	0.06
EAS-DS	2026-03-03 19:45:00	8.10	79.90	0.25	7.65	11.23	40.55	0.04
EAS-DS	2026-03-03 20:00:00	9.11	118.77	0.25	7.79	10.67	32.39	0.06
EAS-DS	2026-03-03 20:15:00	9.03	114.19	0.25	7.79	10.83	42.67	0.05
EAS-DS	2026-03-03 20:30:00	8.95	110.79	0.26	7.79	10.85	57.41	0.05
EAS-DS	2026-03-03 20:45:00	8.91	110.73	0.24	7.80	10.87	72.02	0.05
EAS-DS	2026-03-03 21:00:00	8.84	107.20	0.25	7.84	10.89	72.75	0.05
EAS-DS	2026-03-03 21:15:00	8.71	103.37	0.26	7.82	10.95	87.27	0.05
EAS-DS	2026-03-03 21:30:00	7.60	63.57	0.26	7.75	11.22	96.72	0.03
EAS-DS	2026-03-03 21:45:00	8.66	102.93	0.26	7.83	10.95	73.93	0.05
EAS-DS	2026-03-03 22:00:00	8.62	100.63	0.26	7.83	10.38	96.37	0.05
EAS-DS	2026-03-03 22:15:00	8.56	98.30	0.26	7.83	10.36	113.96	0.05
EAS-DS	2026-03-03 22:30:00	7.42	62.08	0.27	7.69	10.65	15.43	0.03
EAS-DS	2026-03-03 22:45:00	8.40	94.38	0.26	7.75	10.56	8.70	0.04
EAS-DS	2026-03-03 23:00:00	8.34	91.75	0.26	7.75	11.09	11.00	0.04
EAS-DS	2026-03-03 23:15:00	8.28	90.17	0.27	7.75	11.11	6.35	0.04
EAS-DS	2026-03-03 23:30:00	8.23	88.77	0.27	7.78	11.15	7.69	0.04
EAS-DS	2026-03-03 23:45:00	7.53	61.96	0.27	7.69	11.28	6.77	0.03
EAS-DS	2026-03-04 00:00:00	8.03	82.71	0.28	7.70	10.76	7.80	0.04
EAS-DS	2026-03-04 00:15:00	7.96	79.46	0.28	7.69	10.94	11.91	0.04
EAS-DS	2026-03-04 00:30:00	7.90	76.95	0.28	7.66	10.86	12.90	0.04
EAS-DS	2026-03-04 00:45:00	7.87	77.35	0.27	7.64	10.89	13.29	0.04
EAS-DS	2026-03-04 01:00:00	7.86	76.77	0.28	7.63	11.27	12.21	0.04
EAS-DS	2026-03-04 01:15:00	7.81	73.89	0.28	7.60	11.28	12.19	0.03
EAS-DS	2026-03-04 01:30:00	7.84	71.83	0.28	7.62	11.27	16.15	0.03
EAS-DS	2026-03-04 01:45:00	7.82	69.85	0.28	7.60	11.23	16.57	0.03
EAS-DS	2026-03-04 02:00:00	7.82	68.29	0.28	7.60	10.50	11.06	0.03
EAS-DS	2026-03-04 02:15:00	6.96	36.32	0.29	7.40	10.74	10.21	0.02
EAS-DS	2026-03-04 02:30:00	7.82	64.93	0.29	7.57	10.50	11.17	0.03
EAS-DS	2026-03-04 02:45:00	7.83	63.10	0.28	7.54	10.65	7.04	0.03
EAS-DS	2026-03-04 03:00:00	7.75	60.23	0.29	7.51	11.27	8.97	0.03
EAS-DS	2026-03-04 03:15:00	7.65	59.51	0.30	7.41	11.33	8.32	0.03
EAS-DS	2026-03-04 03:30:00	7.72	60.55	0.30	7.47	11.30	5.37	0.03
EAS-DS	2026-03-04 03:45:00	7.89	66.61	0.29	7.52	11.22	15.61	0.03
EAS-DS	2026-03-04 04:00:00	7.90	66.84	0.30	7.54	10.84	9.73	0.03
EAS-DS	2026-03-04 04:15:00	7.92	66.87	0.30	7.54	10.80	2.74	0.03
EAS-DS	2026-03-04 04:30:00	6.74	23.06	0.31	7.23	11.10	1.90	0.01
EAS-DS	2026-03-04 04:45:00	7.91	67.16	0.29	7.49	10.86	5.45	0.03
EAS-DS	2026-03-04 05:00:00	7.92	68.13	0.30	7.52	11.21	3.28	0.03
EAS-DS	2026-03-04 05:15:00	7.93	69.14	0.30	7.50	11.21	4.93	0.03
EAS-DS	2026-03-04 05:30:00	7.96	69.21	0.30	7.49	11.20	6.48	0.03
EAS-DS	2026-03-04 05:45:00	7.96	69.89	0.30	7.50	11.19	5.78	0.03
EAS-DS	2026-03-04 06:00:00	8.00	70.97	0.30	7.52	10.97	3.47	0.03
EAS-DS	2026-03-04 06:15:00	8.02	71.22	0.30	7.55	10.96	3.66	0.03
EAS-DS	2026-03-04 06:30:00	8.02	70.66	0.30	7.56	10.98	3.64	0.03
EAS-DS	2026-03-04 06:45:00	8.04	71.03	0.29	7.56	11.01	5.69	0.03

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-04 07:00:00	7.47	45.16	0.29	7.53	11.25	2.80	0.02
EAS-DS	2026-03-04 07:15:00	8.05	71.69	0.30	7.54	11.19	6.09	0.03
EAS-DS	2026-03-04 07:30:00	8.07	71.96	0.30	7.57	11.18	3.87	0.03
EAS-DS	2026-03-04 07:45:00	8.07	73.40	0.30	7.58	11.16	3.26	0.03
EAS-DS	2026-03-04 08:00:00	8.08	72.69	0.30	7.61	11.15	1.08	0.03
EAS-DS	2026-03-04 08:15:00	8.09	73.90	0.30	7.60	11.19	0.86	0.03
EAS-DS	2026-03-04 08:30:00	8.01	68.66	0.30	7.61	11.20	1.10	0.03
EAS-DS	2026-03-04 08:45:00	8.15	74.28	0.29	7.60	11.16	3.58	0.03
EAS-DS	2026-03-04 09:00:00	8.14	74.53	0.30	7.57	11.17	5.27	0.03
EAS-DS	2026-03-04 09:15:00	8.20	75.70	0.30	7.62	11.15	0.54	0.03
EAS-DS	2026-03-04 09:30:00	8.22	75.76	0.30	7.62	11.13	2.09	0.03
EAS-DS	2026-03-04 09:45:00	8.01	72.66	0.31	7.47	11.27	0.70	0.03
EAS-DS	2026-03-04 10:00:00	8.26	76.28	0.30	7.62	11.01	0.50	0.03
EAS-DS	2026-03-04 10:15:00	8.16	74.72	0.30	7.56	11.07	1.09	0.03
EAS-DS	2026-03-04 10:30:00	8.31	76.30	0.30	7.63	10.99	2.01	0.03
EAS-DS	2026-03-04 10:45:00	7.20	30.84	0.28	7.35	11.28	0.52	0.01
EAS-DS	2026-03-04 11:00:00	8.32	77.35	0.29	7.57	11.14	7.20	0.04
EAS-DS	2026-03-04 11:15:00	8.39	79.49	0.29	7.57	11.11	4.52	0.04
EAS-DS	2026-03-04 11:30:00	8.29	77.66	0.30	7.46	11.18	6.38	0.04
EAS-DS	2026-03-04 11:45:00	8.47	80.71	0.30	7.56	11.08	3.38	0.04
EAS-DS	2026-03-04 12:00:00	8.26	75.72	0.30	7.46	11.13	12.06	0.03
EAS-DS	2026-03-04 12:15:00	8.56	80.60	0.30	7.60	10.93	13.34	0.04
EAS-DS	2026-03-04 12:30:00	8.57	80.50	0.30	7.61	10.91	21.78	0.04
EAS-DS	2026-03-04 12:45:00	8.60	80.06	0.28	7.59	10.92	5.52	0.04
EAS-DS	2026-03-04 13:00:00	8.47	77.99	0.30	7.46	11.13	9.56	0.04
EAS-DS	2026-03-04 13:15:00	8.64	80.60	0.29	7.59	11.03	6.08	0.04
EAS-DS	2026-03-04 13:30:00	8.67	80.62	0.30	7.61	11.00	6.45	0.04
EAS-DS	2026-03-04 13:45:00	7.96	42.63	0.29	7.55	11.11	8.20	0.02
EAS-DS	2026-03-04 14:00:00	8.71	81.71	0.30	7.59	10.84	18.11	0.04
EAS-DS	2026-03-04 14:15:00	8.82	82.50	0.29	7.63	10.79	18.22	0.04
EAS-DS	2026-03-04 14:30:00	8.88	83.07	0.29	7.64	10.78	15.60	0.04
EAS-DS	2026-03-04 14:45:00	8.92	82.96	0.28	7.64	10.80	21.56	0.04
EAS-DS	2026-03-04 15:00:00	8.92	82.46	0.29	7.60	10.97	20.48	0.04
EAS-DS	2026-03-04 15:15:00	8.78	73.05	0.28	7.63	10.95	15.22	0.03
EAS-DS	2026-03-04 15:30:00	8.96	83.62	0.28	7.68	10.94	15.46	0.04
EAS-DS	2026-03-04 15:45:00	8.82	82.67	0.29	7.59	10.97	20.05	0.04
EAS-DS	2026-03-04 16:00:00	8.84	82.71	0.28	7.69	10.67	15.30	0.04
EAS-DS	2026-03-04 16:15:00	8.71	81.85	0.30	7.54	10.90	22.75	0.04
EAS-DS	2026-03-04 16:30:00	7.78	31.26	0.28	7.56	10.94	19.07	0.01
EAS-DS	2026-03-04 16:45:00	8.64	75.90	0.28	7.63	10.77	33.36	0.03
EAS-DS	2026-03-04 17:00:00	8.78	83.72	0.28	7.68	10.97	27.13	0.04
EAS-DS	2026-03-04 17:15:00	7.88	52.51	0.29	7.25	11.35	24.75	0.02
EAS-DS	2026-03-04 17:30:00	8.76	83.46	0.29	7.66	11.01	40.80	0.04
EAS-DS	2026-03-04 17:45:00	8.47	69.71	0.28	7.65	11.04	34.43	0.03
EAS-DS	2026-03-04 18:00:00	8.74	84.06	0.28	7.69	10.98	33.35	0.04
EAS-DS	2026-03-04 18:15:00	8.54	75.28	0.28	7.68	11.02	32.72	0.03
EAS-DS	2026-03-04 18:30:00	8.73	83.71	0.29	7.69	11.00	31.69	0.04
EAS-DS	2026-03-04 18:45:00	8.53	74.40	0.28	7.65	11.00	16.96	0.03
EAS-DS	2026-03-04 19:00:00	8.73	83.57	0.28	7.65	11.00	21.66	0.04
EAS-DS	2026-03-04 19:15:00	8.29	70.28	0.30	7.44	11.17	15.84	0.03
EAS-DS	2026-03-04 19:30:00	8.74	84.34	0.29	7.65	10.99	14.09	0.04
EAS-DS	2026-03-04 19:45:00	8.55	75.18	0.29	7.64	11.02	19.59	0.03
EAS-DS	2026-03-04 20:00:00	8.76	83.95	0.29	7.68	10.98	18.07	0.04
EAS-DS	2026-03-04 20:15:00	8.42	72.59	0.30	7.55	11.12	20.62	0.03
EAS-DS	2026-03-04 20:30:00	8.58	79.54	0.30	7.57	11.12	30.79	0.04

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-04 20:45:00	8.57	74.30	0.28	7.63	11.04	23.53	0.03
EAS-DS	2026-03-04 21:00:00	8.67	82.73	0.30	7.57	11.09	15.92	0.04
EAS-DS	2026-03-04 21:15:00	8.49	72.72	0.29	7.63	11.09	19.01	0.03
EAS-DS	2026-03-04 21:30:00	8.79	85.77	0.29	7.68	11.01	19.71	0.04
EAS-DS	2026-03-04 21:45:00	8.49	71.08	0.29	7.67	11.03	21.12	0.03
EAS-DS	2026-03-04 22:00:00	8.78	86.84	0.30	7.68	10.99	33.36	0.04
EAS-DS	2026-03-04 22:15:00	8.56	76.68	0.29	7.68	10.98	30.02	0.04
EAS-DS	2026-03-04 22:30:00	8.57	75.29	0.29	7.70	10.96	30.68	0.03
EAS-DS	2026-03-04 22:45:00	7.97	58.13	0.30	7.40	11.31	25.18	0.03
EAS-DS	2026-03-04 23:00:00	8.82	94.32	0.29	7.71	11.01	35.20	0.04
EAS-DS	2026-03-04 23:15:00	8.63	89.19	0.29	7.76	11.04	15.52	0.04
EAS-DS	2026-03-04 23:30:00	8.79	101.14	0.29	7.73	11.03	14.30	0.05
EAS-DS	2026-03-04 23:45:00	8.80	97.04	0.29	7.76	10.98	27.84	0.04
EAS-DS	2026-03-05 00:00:00	8.93	108.03	0.28	7.85	10.69	19.93	0.05
EAS-DS	2026-03-05 00:15:00	8.72	89.66	0.28	7.81	10.81	22.02	0.04
EAS-DS	2026-03-05 00:30:00	8.60	92.27	0.30	7.61	11.11	18.70	0.04
EAS-DS	2026-03-05 00:45:00	8.72	87.18	0.28	7.74	10.90	23.83	0.04
EAS-DS	2026-03-05 01:00:00	8.95	95.53	0.28	7.76	10.99	16.47	0.04
EAS-DS	2026-03-05 01:15:00	8.65	83.46	0.29	7.67	11.08	18.60	0.04
EAS-DS	2026-03-05 01:30:00	8.95	93.84	0.28	7.75	10.99	14.39	0.04
EAS-DS	2026-03-05 01:45:00	7.61	36.33	0.29	7.39	11.38	21.44	0.02
EAS-DS	2026-03-05 02:00:00	8.91	92.13	0.28	7.75	10.90	19.12	0.04
EAS-DS	2026-03-05 02:15:00	8.87	91.20	0.28	7.75	10.90	17.96	0.04
EAS-DS	2026-03-05 02:30:00	7.16	19.65	0.30	7.21	11.43	17.75	0.01
EAS-DS	2026-03-05 02:45:00	8.88	93.13	0.28	7.70	10.95	25.18	0.04
EAS-DS	2026-03-05 03:00:00	8.72	84.44	0.28	7.73	10.98	20.40	0.04
EAS-DS	2026-03-05 03:15:00	8.85	94.43	0.28	7.71	11.04	21.31	0.04
EAS-DS	2026-03-05 03:30:00	8.64	81.21	0.28	7.72	11.00	22.64	0.04
EAS-DS	2026-03-05 03:45:00	8.73	88.69	0.28	7.70	11.04	31.27	0.04
EAS-DS	2026-03-05 04:00:00	8.88	94.09	0.28	7.75	10.95	31.41	0.04
EAS-DS	2026-03-05 04:15:00	7.76	52.39	0.29	7.45	11.39	23.27	0.02
EAS-DS	2026-03-05 04:30:00	8.72	88.08	0.29	7.74	10.97	42.03	0.04
EAS-DS	2026-03-05 04:45:00	7.51	38.24	0.28	7.48	11.31	28.93	0.02
EAS-DS	2026-03-05 05:00:00	7.78	64.74	0.31	7.10	11.55	32.49	0.03
EAS-DS	2026-03-05 05:15:00	8.63	87.93	0.29	7.68	11.09	26.92	0.04
EAS-DS	2026-03-05 05:30:00	8.75	92.67	0.29	7.70	11.06	29.14	0.04
EAS-DS	2026-03-05 05:45:00	8.55	90.98	0.29	7.55	11.18	45.58	0.04
EAS-DS	2026-03-05 06:00:00	8.65	88.25	0.29	7.72	11.06	29.79	0.04
EAS-DS	2026-03-05 06:15:00	8.79	94.33	0.29	7.72	11.04	27.62	0.04
EAS-DS	2026-03-05 06:30:00	8.74	92.27	0.29	7.74	11.02	22.17	0.04
EAS-DS	2026-03-05 06:45:00	8.53	87.09	0.29	7.68	11.09	22.25	0.04
EAS-DS	2026-03-05 07:00:00	8.70	93.37	0.29	7.71	11.07	13.53	0.04
EAS-DS	2026-03-05 07:15:00	8.73	95.06	0.28	7.72	11.09	14.51	0.04
EAS-DS	2026-03-05 07:30:00	8.51	85.06	0.28	7.70	11.08	11.95	0.04
EAS-DS	2026-03-05 07:45:00	8.63	93.74	0.28	7.68	11.15	19.67	0.04
EAS-DS	2026-03-05 08:00:00	8.64	93.14	0.28	7.73	11.10	24.59	0.04
EAS-DS	2026-03-05 08:15:00	8.53	87.02	0.29	7.73	11.10	20.50	0.04
EAS-DS	2026-03-05 08:30:00	8.60	91.01	0.29	7.68	11.12	24.40	0.04
EAS-DS	2026-03-05 08:45:00	8.75	94.59	0.29	7.72	11.10	26.29	0.04
EAS-DS	2026-03-05 09:00:00	7.53	42.17	0.29	7.48	11.40	21.97	0.02
EAS-DS	2026-03-05 09:15:00	8.87	93.59	0.18	7.71	11.15	1.46	0.04
EAS-DS	2026-03-05 09:30:00	8.85	90.42	0.19	7.73	11.07	1.88	0.04
EAS-DS	2026-03-05 09:45:00	7.36	32.49	0.23	7.30	11.55	1.63	0.01
EAS-DS	2026-03-05 10:00:00	8.97	92.72	0.21	7.74	11.10	0.00	0.04
EAS-DS	2026-03-05 10:15:00	9.11	94.64	0.22	7.78	11.09	6.84	0.04

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-05 10:30:00	9.02	89.39	0.22	7.74	11.07	2.59	0.04
EAS-DS	2026-03-05 10:45:00	9.07	90.76	0.22	7.77	11.02	0.00	0.04
EAS-DS	2026-03-05 11:00:00	9.06	89.36	0.23	7.70	11.05	0.00	0.04
EAS-DS	2026-03-05 11:15:00	9.26	89.02	0.23	7.79	10.95	0.00	0.04
EAS-DS	2026-03-05 11:30:00	9.23	87.25	0.23	7.72	10.99	0.00	0.04
EAS-DS	2026-03-05 11:45:00	9.37	90.94	0.23	7.78	10.91	2.18	0.04
EAS-DS	2026-03-05 12:00:00	9.50	91.71	0.23	7.79	10.89	0.00	0.04
EAS-DS	2026-03-05 12:15:00	9.50	88.27	0.24	7.73	10.92	0.00	0.04
EAS-DS	2026-03-05 12:30:00	9.68	89.70	0.23	7.78	10.84	0.00	0.04
EAS-DS	2026-03-05 12:45:00	9.72	90.65	0.23	7.79	10.83	0.15	0.04
EAS-DS	2026-03-05 13:00:00	9.73	84.69	0.23	7.79	10.80	0.76	0.04
EAS-DS	2026-03-05 13:15:00	9.71	89.26	0.24	7.75	10.86	0.00	0.04
EAS-DS	2026-03-05 13:30:00	9.34	82.03	0.25	7.59	11.08	0.04	0.04
EAS-DS	2026-03-05 13:45:00	9.62	100.42	0.23	7.86	10.83	7.66	0.05
EAS-DS	2026-03-05 14:00:00	9.71	94.20	0.23	7.84	10.80	1.37	0.04
EAS-DS	2026-03-05 14:15:00	9.66	90.98	0.23	7.84	10.81	1.94	0.04
EAS-DS	2026-03-05 14:30:00	9.68	91.97	0.23	7.83	10.83	2.59	0.04
EAS-DS	2026-03-05 14:45:00	9.65	93.82	0.23	7.80	10.85	1.28	0.04
EAS-DS	2026-03-05 15:00:00	9.67	95.68	0.23	7.82	10.81	0.00	0.04
EAS-DS	2026-03-05 15:15:00	9.47	91.76	0.24	7.73	10.91	0.00	0.04
EAS-DS	2026-03-05 15:30:00	8.47	32.60	0.24	7.49	11.09	0.00	0.01
EAS-DS	2026-03-05 15:45:00	7.99	20.51	0.26	7.14	11.33	0.00	0.01
EAS-DS	2026-03-05 16:00:00	9.25	78.34	0.23	7.75	10.86	0.00	0.04
EAS-DS	2026-03-05 16:15:00	7.77	19.32	0.27	7.04	11.42	0.00	0.01
EAS-DS	2026-03-05 16:30:00	7.97	24.76	0.25	7.28	11.27	0.00	0.01
EAS-DS	2026-03-05 16:45:00	9.44	98.42	0.23	7.75	10.86	0.00	0.05
EAS-DS	2026-03-05 17:00:00	9.53	98.39	0.24	7.75	10.83	0.00	0.05
EAS-DS	2026-03-05 17:15:00	9.52	99.02	0.24	7.74	10.82	0.00	0.05
EAS-DS	2026-03-05 17:30:00	9.60	100.44	0.24	7.71	10.80	0.00	0.05
EAS-DS	2026-03-05 17:45:00	9.46	95.53	0.23	7.72	10.84	0.00	0.04
EAS-DS	2026-03-05 18:00:00	9.45	102.64	0.23	7.73	10.87	0.00	0.05
EAS-DS	2026-03-05 18:15:00	9.49	104.36	0.23	7.78	10.84	0.60	0.05
EAS-DS	2026-03-05 18:30:00	9.47	105.32	0.23	7.77	10.84	1.70	0.05
EAS-DS	2026-03-05 18:45:00	9.29	100.87	0.23	7.72	10.94	5.80	0.05
EAS-DS	2026-03-05 19:00:00	9.33	101.78	0.23	7.76	10.90	0.00	0.05
EAS-DS	2026-03-05 19:15:00	9.35	103.86	0.23	7.80	10.91	0.00	0.05
EAS-DS	2026-03-05 19:30:00	9.28	103.32	0.23	7.74	10.94	0.00	0.05
EAS-DS	2026-03-05 19:45:00	9.31	102.93	0.23	7.77	10.93	0.03	0.05
EAS-DS	2026-03-05 20:00:00	9.22	102.23	0.23	7.76	11.00	0.00	0.05
EAS-DS	2026-03-05 20:15:00	9.25	102.19	0.23	7.80	10.99	0.00	0.05
EAS-DS	2026-03-05 20:30:00	9.24	102.65	0.23	7.83	11.01	0.23	0.05
EAS-DS	2026-03-05 20:45:00	9.08	95.47	0.23	7.81	11.02	0.09	0.04
EAS-DS	2026-03-05 21:00:00	9.16	99.81	0.23	7.79	10.98	0.70	0.05
EAS-DS	2026-03-05 21:15:00	9.16	100.64	0.23	7.80	11.00	0.43	0.05
EAS-DS	2026-03-05 21:30:00	8.35	58.51	0.23	7.68	11.10	0.00	0.03
EAS-DS	2026-03-05 21:45:00	9.05	100.16	0.23	7.78	11.07	3.12	0.05
EAS-DS	2026-03-05 22:00:00	9.04	96.46	0.22	7.81	11.04	1.93	0.04
EAS-DS	2026-03-05 22:15:00	9.04	96.22	0.22	7.80	11.02	0.11	0.04
EAS-DS	2026-03-05 22:30:00	9.02	96.63	0.22	7.78	11.07	0.99	0.04
EAS-DS	2026-03-05 22:45:00	9.01	95.36	0.22	7.78	11.07	0.24	0.04
EAS-DS	2026-03-05 23:00:00		96.09		7.77	11.07	0.00	0.04
EAS-DS	2026-03-05 23:15:00	9.03	95.94	0.23	7.78	11.06	0.00	0.04
EAS-DS	2026-03-05 23:30:00	8.76	93.47	0.24	7.66	11.21	4.85	0.04
EAS-DS	2026-03-05 23:45:00	8.98	97.19	0.23	7.76	11.08	1.18	0.04
EAS-DS	2026-03-06 00:00:00	8.98	97.41	0.23	7.76	11.08	0.00	0.05

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-06 00:15:00	8.95	96.25	0.22	7.76	11.09	0.00	0.04
EAS-DS	2026-03-06 00:30:00	8.95	96.34	0.22	7.77	11.10	0.95	0.04
EAS-DS	2026-03-06 00:45:00	8.92	96.99	0.22	7.76	11.11	0.00	0.04
EAS-DS	2026-03-06 01:00:00	8.97	97.53	0.22	7.78	11.08	0.70	0.05
EAS-DS	2026-03-06 01:15:00	8.96	97.29	0.22	7.78	11.09	0.74	0.04
EAS-DS	2026-03-06 01:30:00	7.25	23.10	0.24	7.22	11.51	0.00	0.01
EAS-DS	2026-03-06 01:45:00	8.93	97.07	0.22	7.75	11.10	2.57	0.04
EAS-DS	2026-03-06 02:00:00	8.97	97.59	0.22	7.77	11.10	0.48	0.05
EAS-DS	2026-03-06 02:15:00	8.98	95.43	0.22	7.76	11.08	0.19	0.04
EAS-DS	2026-03-06 02:30:00	8.92	95.65	0.22	7.73	11.11	0.00	0.04
EAS-DS	2026-03-06 02:45:00	8.99	95.72	0.22	7.77	11.06	1.45	0.04
EAS-DS	2026-03-06 03:00:00	9.00	96.85	0.22	7.77	11.03	0.40	0.04
EAS-DS	2026-03-06 03:15:00	9.00	96.85	0.22	7.78	11.08	0.00	0.04
EAS-DS	2026-03-06 03:30:00	9.01	97.68	0.22	7.78	11.05	1.31	0.05
EAS-DS	2026-03-06 03:45:00	8.96	94.79	0.22	7.78	11.03	0.75	0.04
EAS-DS	2026-03-06 04:00:00	8.90	96.18	0.22	7.74	11.13	0.13	0.04
EAS-DS	2026-03-06 04:15:00	8.73	83.27	0.22	7.75	11.10	0.00	0.04
EAS-DS	2026-03-06 04:30:00	8.91	97.64	0.22	7.77	11.13	0.88	0.05
EAS-DS	2026-03-06 04:45:00	8.91	98.54	0.22	7.78	11.13	2.23	0.05
EAS-DS	2026-03-06 05:00:00	8.92	98.54	0.22	7.78	11.07	2.76	0.05
EAS-DS	2026-03-06 05:15:00	8.90	97.17	0.21	7.78	11.06	0.00	0.04
EAS-DS	2026-03-06 05:30:00	8.89	97.06	0.21	7.77	11.10	0.00	0.04
EAS-DS	2026-03-06 05:45:00	8.83	97.66	0.21	7.76	11.11	0.47	0.05
EAS-DS	2026-03-06 06:00:00	8.88	97.84	0.21	7.78	11.16	0.90	0.05
EAS-DS	2026-03-06 06:15:00	8.86	96.42	0.21	7.77	11.15	1.38	0.04
EAS-DS	2026-03-06 06:30:00	8.84	97.94	0.21	7.76	11.15	0.00	0.05
EAS-DS	2026-03-06 06:45:00	8.88	97.69	0.21	7.78	11.14	2.01	0.05
EAS-DS	2026-03-06 07:00:00	8.89	97.35	0.21	7.78	11.10	1.68	0.04
EAS-DS	2026-03-06 07:15:00	8.68	84.90	0.21	7.75	11.12	0.00	0.04
EAS-DS	2026-03-06 07:30:00	8.72	92.65	0.21	7.72	11.14	0.00	0.04
EAS-DS	2026-03-06 07:45:00	8.76	92.55	0.21	7.76	11.13	4.30	0.04
EAS-DS	2026-03-06 08:00:00	8.92	100.23	0.21	7.79	11.12	1.98	0.05
EAS-DS	2026-03-06 08:15:00	8.70	88.66	0.20	7.76	11.18	0.00	0.04
EAS-DS	2026-03-06 08:30:00	8.80	95.16	0.20	7.75	11.13	0.53	0.04
EAS-DS	2026-03-06 08:45:00	8.95	100.83	0.20	7.78	11.12	1.89	0.05
EAS-DS	2026-03-06 09:00:00	8.97	100.98	0.20	7.78	11.05	0.26	0.05
EAS-DS	2026-03-06 09:15:00	8.90	100.54	0.20	7.74	11.09	1.15	0.05
EAS-DS	2026-03-06 09:30:00	9.00	100.63	0.20	7.78	11.02	1.34	0.05
EAS-DS	2026-03-06 09:45:00	8.66	78.71	0.21	7.73	11.07	0.59	0.04
EAS-DS	2026-03-06 10:00:00	8.96	99.65	0.21	7.75	11.14	0.03	0.05
EAS-DS	2026-03-06 10:15:00	7.76	45.58	0.21	7.48	11.45	1.07	0.02
EAS-DS	2026-03-06 10:30:00	7.30	23.16	0.22	7.25	11.57	1.18	0.01
EAS-DS	2026-03-06 10:45:00	7.13	20.65	0.24	7.10	11.64	0.00	0.01
EAS-DS	2026-03-06 11:00:00	9.05	101.01	0.22	7.76	11.01	1.96	0.05
EAS-DS	2026-03-06 11:15:00	9.08	105.73	0.22	7.78	10.99	0.24	0.05
EAS-DS	2026-03-06 11:30:00	9.13	114.34	0.22	7.82	10.91	3.64	0.05
EAS-DS	2026-03-06 11:45:00	9.06	121.88	0.22	7.81	10.90	5.42	0.06
EAS-DS	2026-03-06 12:00:00	9.13	128.58	0.23	7.85	10.88	6.10	0.06
EAS-DS	2026-03-06 12:15:00	9.11	126.02	0.23	7.88	10.90	6.40	0.06
EAS-DS	2026-03-06 12:30:00	8.86	109.84	0.23	7.83	11.02	5.12	0.05
EAS-DS	2026-03-06 12:45:00	9.07	121.63	0.23	7.85	11.02	9.28	0.06
EAS-DS	2026-03-06 13:00:00	8.78	107.59	0.23	7.86	10.91	10.20	0.05
EAS-DS	2026-03-06 13:15:00	8.84	124.79	0.23	7.85	11.01	6.04	0.06
EAS-DS	2026-03-06 13:30:00	8.81	113.39	0.24	7.84	10.99	3.89	0.05
EAS-DS	2026-03-06 13:45:00	8.59	113.92	0.24	7.75	11.22	15.80	0.05

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-06 14:00:00	9.02	121.84	0.24	7.85	11.02	6.32	0.06
EAS-DS	2026-03-06 14:15:00	8.25	93.56	0.24	7.67	11.37	6.21	0.04
EAS-DS	2026-03-06 14:30:00	8.74	113.89	0.23	7.82	11.11	10.52	0.05
EAS-DS	2026-03-06 14:45:00	8.79	114.96	0.23	7.84	11.07	8.19	0.05
EAS-DS	2026-03-06 15:00:00	8.67	118.64	0.24	7.77	11.16	14.95	0.06
EAS-DS	2026-03-06 15:15:00	8.96	124.32	0.23	7.82	10.91	11.36	0.06
EAS-DS	2026-03-06 15:30:00	8.98	121.46	0.23	7.83	10.91	16.81	0.06
EAS-DS	2026-03-06 15:45:00	8.32	71.37	0.23	7.75	11.05	10.99	0.03
EAS-DS	2026-03-06 16:00:00	8.87	106.98	0.23	7.82	10.96	10.13	0.05
EAS-DS	2026-03-06 16:15:00	8.83	103.26	0.23	7.82	11.01	9.35	0.05
EAS-DS	2026-03-06 16:30:00	8.30	88.01	0.24	7.68	11.29	8.46	0.04
EAS-DS	2026-03-06 16:45:00	8.97	110.16	0.24	7.83	10.93	18.87	0.05
EAS-DS	2026-03-06 17:00:00	8.15	60.97	0.24	7.69	11.14	7.68	0.03
EAS-DS	2026-03-06 17:15:00	8.98	110.16	0.24	7.80	10.98	8.36	0.05
EAS-DS	2026-03-06 17:30:00	8.99	116.15	0.24	7.82	10.95	13.95	0.05
EAS-DS	2026-03-06 17:45:00	7.91	63.12	0.25	7.64	11.23	15.26	0.03
EAS-DS	2026-03-06 18:00:00	8.74	117.48	0.25	7.82	11.02	18.07	0.05
EAS-DS	2026-03-06 18:15:00	8.75	113.66	0.25	7.84	10.92	16.60	0.05
EAS-DS	2026-03-06 18:30:00	8.10	61.73	0.25	7.75	11.05	9.60	0.03
EAS-DS	2026-03-06 18:45:00	8.71	111.07	0.25	7.84	11.00	26.02	0.05
EAS-DS	2026-03-06 19:00:00	8.96	123.02	0.25	7.85	10.81	15.11	0.06
EAS-DS	2026-03-06 19:15:00	7.55	35.88	0.25	7.55	11.33	15.83	0.02
EAS-DS	2026-03-06 19:30:00	8.85	113.65	0.24	7.83	10.94	14.31	0.05
EAS-DS	2026-03-06 19:45:00	8.89	112.89	0.24	7.84	10.91	42.52	0.05
EAS-DS	2026-03-06 20:00:00	7.39	30.60	0.25	7.44	11.47	12.02	0.01
EAS-DS	2026-03-06 20:15:00	8.86	106.38	0.24	7.81	11.01	14.69	0.05
EAS-DS	2026-03-06 20:30:00	8.61	84.96	0.24	7.78	11.04	7.72	0.04
EAS-DS	2026-03-06 20:45:00	8.77	101.79	0.25	7.76	11.09	16.06	0.05
EAS-DS	2026-03-06 21:00:00	8.87	102.12	0.24	7.79	11.06	11.34	0.05
EAS-DS	2026-03-06 21:15:00	8.73	99.43	0.25	7.73	11.13	10.25	0.05
EAS-DS	2026-03-06 21:30:00	8.89	101.59	0.24	7.78	11.07	11.51	0.05
EAS-DS	2026-03-06 21:45:00	8.87	99.89	0.24	7.79	11.06	12.88	0.05
EAS-DS	2026-03-06 22:00:00	8.82	100.60	0.24	7.76	11.16	11.65	0.05
EAS-DS	2026-03-06 22:15:00	8.78	94.11	0.24	7.78	11.05	11.80	0.04
EAS-DS	2026-03-06 22:30:00	8.80	100.96	0.24	7.76	11.16	13.73	0.05
EAS-DS	2026-03-06 22:45:00	8.80	96.66	0.24	7.78	11.05	12.78	0.04
EAS-DS	2026-03-06 23:00:00	8.89	102.58	0.24	7.77	11.01	10.15	0.05
EAS-DS	2026-03-06 23:15:00	8.77	94.42	0.24	7.77	11.01	10.99	0.04
EAS-DS	2026-03-06 23:30:00	7.88	50.19	0.24	7.60	11.25	10.14	0.02
EAS-DS	2026-03-06 23:45:00	8.77	100.03	0.24	7.77	11.04	21.97	0.05
EAS-DS	2026-03-07 00:00:00	7.47	30.54	0.24	7.46	11.42	9.59	0.01
EAS-DS	2026-03-07 00:15:00	8.90	106.05	0.24	7.79	11.06	11.17	0.05
EAS-DS	2026-03-07 00:30:00	8.93	107.18	0.24	7.80	11.04	13.57	0.05
EAS-DS	2026-03-07 00:45:00	8.92	106.09	0.24	7.79	11.04	16.22	0.05
EAS-DS	2026-03-07 01:00:00	8.42	78.41	0.24	7.73	11.07	12.75	0.04
EAS-DS	2026-03-07 01:15:00	8.76	101.80	0.24	7.73	11.03	12.92	0.05
EAS-DS	2026-03-07 01:30:00	8.85	103.13	0.24	7.78	10.99	15.25	0.05
EAS-DS	2026-03-07 01:45:00	8.86	109.70	0.24	7.77	11.01	24.17	0.05
EAS-DS	2026-03-07 02:00:00	8.74	100.84	0.24	7.81	10.94	17.15	0.05
EAS-DS	2026-03-07 02:15:00	8.87	115.99	0.24	7.82	10.96	17.00	0.05
EAS-DS	2026-03-07 02:30:00	8.93	117.32	0.24	7.84	10.93	26.15	0.05
EAS-DS	2026-03-07 02:45:00	8.94	117.08	0.25	7.84	10.96	17.77	0.05
EAS-DS	2026-03-07 03:00:00	7.84	46.62	0.25	7.64	11.11	14.27	0.02
EAS-DS	2026-03-07 03:15:00	8.90	114.90	0.25	7.79	10.95	17.56	0.05
EAS-DS	2026-03-07 03:30:00	8.93	114.29	0.25	7.79	10.93	18.96	0.05

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-07 03:45:00	7.72	40.81	0.25	7.59	11.13	18.33	0.02
EAS-DS	2026-03-07 04:00:00	8.87	110.15	0.25	7.77	11.03	26.35	0.05
EAS-DS	2026-03-07 04:15:00	8.86	108.45	0.25	7.78	11.02	27.34	0.05
EAS-DS	2026-03-07 04:30:00	8.68	104.07	0.25	7.73	11.15	23.87	0.05
EAS-DS	2026-03-07 04:45:00	8.87	105.68	0.25	7.77	11.02	27.49	0.05
EAS-DS	2026-03-07 05:00:00	8.89	104.76	0.25	7.78	10.99	19.32	0.05
EAS-DS	2026-03-07 05:15:00	7.78	44.21	0.25	7.60	11.12	22.83	0.02
EAS-DS	2026-03-07 05:30:00	8.90	105.17	0.25	7.77	10.94	18.11	0.05
EAS-DS	2026-03-07 05:45:00	8.89	105.75	0.25	7.79	10.93	24.67	0.05
EAS-DS	2026-03-07 06:00:00	8.89	107.65	0.25	7.78	10.96	21.59	0.05
EAS-DS	2026-03-07 06:15:00	8.25	66.33	0.25	7.71	10.97	18.46	0.03
EAS-DS	2026-03-07 06:30:00	8.89	108.57	0.26	7.78	10.92	20.88	0.05
EAS-DS	2026-03-07 06:45:00	7.66	41.97	0.26	7.56	11.25	31.78	0.02
EAS-DS	2026-03-07 07:00:00		109.85		7.81	10.96	21.32	0.05
EAS-DS	2026-03-07 07:15:00	8.90	107.55	0.26	7.83	10.93	19.64	0.05
EAS-DS	2026-03-07 07:30:00	8.13	58.80	0.26	7.68	11.03	20.90	0.03
EAS-DS	2026-03-07 07:45:00	8.88	104.58	0.26	7.78	10.99	24.44	0.05
EAS-DS	2026-03-07 08:00:00	8.89	104.05	0.26	7.79	11.03	21.58	0.05
EAS-DS	2026-03-07 08:15:00	8.86	101.62	0.26	7.80	11.02	19.97	0.05
EAS-DS	2026-03-07 08:30:00	8.82	101.14	0.26	7.77	11.07	20.71	0.05
EAS-DS	2026-03-07 08:45:00	8.84	99.89	0.26	7.77	11.05	23.76	0.05
EAS-DS	2026-03-07 09:00:00	8.77	97.39	0.26	7.74	11.06	19.34	0.04
EAS-DS	2026-03-07 09:15:00	8.70	94.51	0.26	7.71	11.11	21.05	0.04
EAS-DS	2026-03-07 09:30:00	8.78	96.23	0.26	7.73	11.09	18.43	0.04
EAS-DS	2026-03-07 09:45:00	8.78	94.61	0.26	7.75	11.09	28.35	0.04
EAS-DS	2026-03-07 10:00:00	8.86	95.73	0.26	7.79	11.07	20.35	0.04
EAS-DS	2026-03-07 10:15:00	8.86	94.56	0.26	7.79	11.06	28.26	0.04
EAS-DS	2026-03-07 10:30:00	7.81	41.82	0.27	7.58	11.25	23.59	0.02
EAS-DS	2026-03-07 10:45:00	8.89	95.43	0.27	7.76	11.06	50.39	0.04
EAS-DS	2026-03-07 11:00:00	8.98	96.04	0.26	7.78	10.99	22.89	0.04
EAS-DS	2026-03-07 11:15:00	8.97	94.61	0.27	7.76	11.02	28.95	0.04
EAS-DS	2026-03-07 11:30:00	8.97	94.44	0.27	7.75	11.01	25.88	0.04
EAS-DS	2026-03-07 11:45:00	9.03	93.80	0.27	7.76	10.94	34.50	0.04
EAS-DS	2026-03-07 12:00:00	9.05	91.87	0.27	7.75	10.97	27.18	0.04
EAS-DS	2026-03-07 12:15:00	7.91	39.50	0.27	7.54	11.10	29.33	0.02
EAS-DS	2026-03-07 12:30:00	9.03	89.18	0.27	7.71	10.99	32.80	0.04
EAS-DS	2026-03-07 12:45:00	9.08	88.19	0.27	7.70	10.95	31.40	0.04
EAS-DS	2026-03-07 13:00:00	8.29	49.90	0.27	7.60	10.96	26.31	0.02
EAS-DS	2026-03-07 13:15:00	9.04	86.49	0.28	7.67	11.00	39.70	0.04
EAS-DS	2026-03-07 13:30:00	8.89	81.43	0.28	7.67	10.88	43.33	0.04
EAS-DS	2026-03-07 13:45:00	8.97	84.77	0.28	7.69	10.89	26.93	0.04
EAS-DS	2026-03-07 14:00:00	8.96	83.94	0.28	7.71	11.00	21.16	0.04
EAS-DS	2026-03-07 14:15:00	8.89	81.64	0.28	7.69	11.05	23.08	0.04
EAS-DS	2026-03-07 14:30:00	7.97	40.30	0.28	7.54	11.12	19.76	0.02
EAS-DS	2026-03-07 14:45:00	8.94	85.27	0.28	7.70	10.97	23.64	0.04
EAS-DS	2026-03-07 15:00:00	8.97	85.21	0.28	7.74	10.79	17.05	0.04
EAS-DS	2026-03-07 15:15:00	8.96	84.05	0.28	7.73	10.76	16.41	0.04
EAS-DS	2026-03-07 15:30:00	8.95	83.14	0.28	7.74	10.75	16.80	0.04
EAS-DS	2026-03-07 15:45:00	8.92	83.10	0.28	7.71	10.83	17.13	0.04
EAS-DS	2026-03-07 16:00:00	8.94	81.74	0.28	7.72	10.96	18.70	0.04
EAS-DS	2026-03-07 16:15:00	8.91	80.09	0.28	7.71	10.98	21.03	0.04
EAS-DS	2026-03-07 16:30:00	8.87	80.45	0.29	7.69	11.02	22.65	0.04
EAS-DS	2026-03-07 16:45:00	8.90	80.00	0.29	7.69	10.98	28.33	0.04
EAS-DS	2026-03-07 17:00:00	8.28	50.49	0.28	7.63	10.98	23.33	0.02
EAS-DS	2026-03-07 17:15:00	7.85	36.55	0.29	7.48	11.07	22.75	0.02

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-07 17:30:00	8.86	78.75	0.29	7.67	10.98	22.16	0.04
EAS-DS	2026-03-07 17:45:00	8.88	79.03	0.29	7.67	10.94	23.67	0.04
EAS-DS	2026-03-07 18:00:00	8.89	78.49	0.29	7.68	11.00	25.99	0.04
EAS-DS	2026-03-07 18:15:00	8.84	76.47	0.29	7.66	11.06	28.28	0.03
EAS-DS	2026-03-07 18:30:00	8.80	73.42	0.30	7.64	11.05	28.35	0.03
EAS-DS	2026-03-07 18:45:00	8.87	75.66	0.30	7.63	10.97	28.14	0.03
EAS-DS	2026-03-07 19:00:00	7.77	32.03	0.30	7.43	10.90	25.02	0.01
EAS-DS	2026-03-07 19:15:00	8.81	72.56	0.30	7.60	10.84	25.35	0.03
EAS-DS	2026-03-07 19:30:00	8.82	70.25	0.30	7.60	10.82	24.54	0.03
EAS-DS	2026-03-07 19:45:00	8.49	56.85	0.30	7.55	10.84	33.55	0.03
EAS-DS	2026-03-07 20:00:00	8.67	68.13	0.30	7.56	11.06	25.47	0.03
EAS-DS	2026-03-07 20:15:00	8.68	66.52	0.30	7.57	11.05	22.05	0.03
EAS-DS	2026-03-07 20:30:00	8.70	68.00	0.30	7.61	11.04	21.27	0.03
EAS-DS	2026-03-07 20:45:00	8.19	45.77	0.30	7.54	11.08	23.62	0.02
EAS-DS	2026-03-07 21:00:00	8.65	70.37	0.30	7.61	10.98	19.72	0.03
EAS-DS	2026-03-07 21:15:00	8.65	68.75	0.30	7.63	10.89	18.48	0.03
EAS-DS	2026-03-07 21:30:00	7.96	37.04	0.30	7.47	10.92	21.45	0.02
EAS-DS	2026-03-07 21:45:00	8.61	68.68	0.30	7.61	10.95	30.21	0.03
EAS-DS	2026-03-07 22:00:00	8.59	68.50	0.30	7.63	11.05	24.96	0.03
EAS-DS	2026-03-07 22:15:00	8.57	68.12	0.30	7.63	11.08	23.39	0.03
EAS-DS	2026-03-07 22:30:00	8.54	67.51	0.30	7.63	11.08	21.29	0.03
EAS-DS	2026-03-07 22:45:00	8.53	68.82	0.30	7.62	11.08	27.64	0.03
EAS-DS	2026-03-07 23:00:00	8.51	66.42	0.30	7.61	10.98	24.15	0.03
EAS-DS	2026-03-07 23:15:00	8.46	63.02	0.30	7.59	10.99	24.50	0.03
EAS-DS	2026-03-07 23:30:00	8.43	60.64	0.30	7.56	11.00	25.85	0.03
EAS-DS	2026-03-07 23:45:00	8.40	61.94	0.30	7.54	11.04	35.78	0.03
EAS-DS	2026-03-08 00:00:00	8.37	61.32	0.30	7.55	11.15	27.27	0.03
EAS-DS	2026-03-08 00:15:00	8.29	58.64	0.30	7.54	11.16	23.03	0.03
EAS-DS	2026-03-08 00:30:00	8.27	59.07	0.31	7.51	11.17	25.21	0.03
EAS-DS	2026-03-08 00:45:00	8.28	63.88	0.31	7.56	11.15	25.92	0.03
EAS-DS	2026-03-08 01:00:00	8.26	66.60	0.30	7.53	10.95	25.04	0.03
EAS-DS	2026-03-08 01:15:00	8.25	65.38	0.30	7.51	10.96	23.92	0.03
EAS-DS	2026-03-08 01:30:00	8.22	61.89	0.30	7.52	11.03	24.34	0.03
EAS-DS	2026-03-08 01:45:00	8.20	62.89	0.30	7.53	11.03	37.24	0.03
EAS-DS	2026-03-08 03:00:00	8.04	53.26	0.30	7.48	11.23	32.43	0.02
EAS-DS	2026-03-08 03:15:00	8.20	63.35	0.30	7.52	11.16	36.50	0.03
EAS-DS	2026-03-08 03:30:00	8.21	61.23	0.30	7.52	11.15	34.81	0.03
EAS-DS	2026-03-08 03:45:00	8.21	60.61	0.30	7.53	11.14	30.47	0.03
EAS-DS	2026-03-08 04:00:00	8.21	58.05	0.30	7.52	11.05	26.99	0.03
EAS-DS	2026-03-08 04:15:00	8.20	56.50	0.30	7.51	11.04	30.23	0.03
EAS-DS	2026-03-08 04:30:00	7.49	19.59	0.32	7.11	11.32	28.78	0.01
EAS-DS	2026-03-08 04:45:00	8.20	63.02	0.31	7.53	11.04	38.20	0.03
EAS-DS	2026-03-08 05:00:00	8.22	64.74	0.30	7.58	11.14	33.22	0.03
EAS-DS	2026-03-08 05:15:00	8.22	62.60	0.30	7.56	11.12	35.32	0.03
EAS-DS	2026-03-08 05:30:00	8.22	63.16	0.31	7.53	11.14	34.82	0.03
EAS-DS	2026-03-08 05:45:00	8.24	66.14	0.31	7.57	11.09	49.19	0.03
EAS-DS	2026-03-08 06:00:00	8.23	63.13	0.30	7.55	10.99	42.71	0.03
EAS-DS	2026-03-08 06:15:00	8.25	61.56	0.30	7.55	10.96	43.33	0.03
EAS-DS	2026-03-08 06:30:00	8.25	59.85	0.30	7.54	10.94	44.26	0.03
EAS-DS	2026-03-08 06:45:00	8.24	62.49	0.30	7.53	10.94	65.93	0.03
EAS-DS	2026-03-08 07:00:00	8.28	68.90	0.30	7.58	11.12	76.87	0.03
EAS-DS	2026-03-08 07:15:00	7.65	30.47	0.31	7.36	11.26	68.39	0.01
EAS-DS	2026-03-08 07:30:00	8.22	67.68	0.30	7.54	11.14	74.39	0.03
EAS-DS	2026-03-08 07:45:00	8.18	66.44	0.30	7.55	11.12	82.99	0.03
EAS-DS	2026-03-08 08:00:00	8.14	64.19	0.30	7.57	11.04	69.41	0.03

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-08 08:15:00	7.68	47.87	0.31	7.30	11.32	71.42	0.02
EAS-DS	2026-03-08 08:30:00	8.06	61.82	0.30	7.56	11.08	80.71	0.03
EAS-DS	2026-03-08 08:45:00	8.05	62.32	0.30	7.55	11.10	82.57	0.03
EAS-DS	2026-03-08 09:00:00	8.03	61.03	0.30	7.54	11.22	74.73	0.03
EAS-DS	2026-03-08 09:15:00	8.03	60.71	0.30	7.56	11.22	73.15	0.03
EAS-DS	2026-03-08 09:30:00	8.05	61.29	0.30	7.57	11.21	76.00	0.03
EAS-DS	2026-03-08 09:45:00	8.09	62.61	0.30	7.57	11.20	73.47	0.03
EAS-DS	2026-03-08 10:00:00	8.08	62.48	0.31	7.51	11.23	78.15	0.03
EAS-DS	2026-03-08 10:15:00	8.23	62.99	0.30	7.59	11.11	78.53	0.03
EAS-DS	2026-03-08 10:30:00	8.13	52.79	0.30	7.59	11.09	76.33	0.02
EAS-DS	2026-03-08 10:45:00	8.32	63.87	0.31	7.57	11.09	88.53	0.03
EAS-DS	2026-03-08 11:00:00	7.43	18.20	0.32	7.13	11.40	83.25	0.01
EAS-DS	2026-03-08 11:15:00	8.38	67.71	0.30	7.58	11.04	89.96	0.03
EAS-DS	2026-03-08 11:30:00	8.44	69.38	0.30	7.64	11.00	102.52	0.03
EAS-DS	2026-03-08 11:45:00	8.54	69.15	0.30	7.65	10.98	95.40	0.03
EAS-DS	2026-03-08 12:00:00	8.15	51.86	0.31	7.43	11.10	111.55	0.02
EAS-DS	2026-03-08 12:15:00	8.61	68.93	0.30	7.63	10.90	119.28	0.03
EAS-DS	2026-03-08 12:30:00	8.66	68.91	0.30	7.65	10.88	113.60	0.03
EAS-DS	2026-03-08 12:45:00	8.68	72.21	0.30	7.61	10.91	114.26	0.03
EAS-DS	2026-03-08 13:00:00	8.76	74.92	0.29	7.66	10.89	108.20	0.03
EAS-DS	2026-03-08 13:15:00	8.72	73.84	0.30	7.63	10.92	107.04	0.03
EAS-DS	2026-03-08 13:30:00	8.74	70.79	0.30	7.65	10.89	101.77	0.03
EAS-DS	2026-03-08 13:45:00	8.81	72.49	0.30	7.62	10.89	112.04	0.03
EAS-DS	2026-03-08 14:00:00	8.85	73.77	0.29	7.66	10.73	109.70	0.03
EAS-DS	2026-03-08 14:15:00	8.80	70.60	0.30	7.62	10.78	109.27	0.03
EAS-DS	2026-03-08 14:30:00	8.80	69.96	0.30	7.63	10.73	105.55	0.03
EAS-DS	2026-03-08 14:45:00	7.92	21.81	0.30	7.29	10.91	118.19	0.01
EAS-DS	2026-03-08 15:00:00	8.80	70.86	0.30	7.60	10.88	110.35	0.03
EAS-DS	2026-03-08 15:15:00	8.81	70.41	0.30	7.62	10.86	124.06	0.03
EAS-DS	2026-03-08 15:30:00	7.80	18.09	0.31	7.22	10.85	113.94	0.01
EAS-DS	2026-03-08 15:45:00	8.76	73.21	0.30	7.61	10.86	125.45	0.03
EAS-DS	2026-03-08 16:00:00	8.63	66.54	0.29	7.65	10.77	140.94	0.03
EAS-DS	2026-03-08 16:15:00	8.64	74.42	0.30	7.61	10.86	137.43	0.03
EAS-DS	2026-03-08 16:30:00	8.29	63.34	0.31	7.41	10.98	140.00	0.03
EAS-DS	2026-03-08 16:45:00	7.92	30.93	0.30	7.45	10.84	136.32	0.01
EAS-DS	2026-03-08 17:00:00	8.64	76.43	0.30	7.60	10.88	125.43	0.03
EAS-DS	2026-03-08 17:15:00	8.63	76.08	0.30	7.62	10.85	136.87	0.03
EAS-DS	2026-03-08 17:30:00	8.59	76.23	0.29	7.63	10.84	147.13	0.03
EAS-DS	2026-03-08 17:45:00	8.50	80.32	0.29	7.62	10.91	136.07	0.04
EAS-DS	2026-03-08 18:00:00	8.53	81.96	0.29	7.65	10.60	139.35	0.04
EAS-DS	2026-03-08 18:15:00	7.38	21.43	0.30	7.31	10.70	145.08	0.01
EAS-DS	2026-03-08 18:30:00	8.46	79.73	0.29	7.65	10.57	150.48	0.04
EAS-DS	2026-03-08 18:45:00	7.88	64.24	0.30	7.47	10.84	169.46	0.03
EAS-DS	2026-03-08 19:00:00	8.38	85.73	0.29	7.70	10.70	166.10	0.04
EAS-DS	2026-03-08 19:15:00	8.27	82.45	0.30	7.63	10.97	166.46	0.04
EAS-DS	2026-03-08 19:30:00	8.29	79.70	0.30	7.64	10.91	174.68	0.04
EAS-DS	2026-03-08 19:45:00	8.21	78.37	0.30	7.59	10.96	183.37	0.04
EAS-DS	2026-03-08 20:00:00	8.22	77.27	0.30	7.61	10.81	166.02	0.04
EAS-DS	2026-03-08 20:15:00	7.65	60.24	0.31	7.35	11.07	176.23	0.03
EAS-DS	2026-03-08 20:30:00	8.20	76.50	0.30	7.61	10.80	157.13	0.03
EAS-DS	2026-03-08 20:45:00	8.12	76.57	0.30	7.58	10.85	158.89	0.03
EAS-DS	2026-03-08 21:00:00	8.18	77.76	0.30	7.61	11.03	162.56	0.04
EAS-DS	2026-03-08 21:15:00	7.75	67.83	0.31	7.40	10.95	157.02	0.03
EAS-DS	2026-03-08 21:30:00	8.15	78.13	0.30	7.59	10.92	162.60	0.04
EAS-DS	2026-03-08 21:45:00	7.10	38.49	0.31	7.29	10.83	140.99	0.02

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-03-08 22:00:00	8.10	76.99	0.29	7.61	10.94	143.32	0.04
EAS-DS	2026-03-08 22:15:00	7.96	74.91	0.30	7.51	10.88	147.36	0.03
EAS-DS	2026-03-08 22:30:00	8.10	78.67	0.29	7.59	10.82	148.35	0.04
EAS-DS	2026-03-08 22:45:00	7.87	74.72	0.30	7.54	10.74	160.87	0.03
EAS-DS	2026-03-08 23:00:00	8.04	78.63	0.30	7.59	10.99	153.67	0.04
EAS-DS	2026-03-08 23:15:00	6.97	31.55	0.30	7.40	10.90	151.45	0.01
EAS-DS	2026-03-08 23:30:00	8.04	77.55	0.30	7.63	10.98	155.25	0.04
EAS-DS	2026-03-08 23:45:00	8.06	78.12	0.30	7.67	10.93	144.06	0.04
EAS-US	2026-03-02 00:00:00	5.83	18.28	0.35	6.97	11.97	0.00	0.01
EAS-US	2026-03-02 00:15:00	5.83	18.29	0.35	6.99	11.97	0.00	0.01
EAS-US	2026-03-02 00:30:00	5.82	18.28	0.36	6.99	11.96	0.00	0.01
EAS-US	2026-03-02 00:45:00	5.81	18.29	0.30	6.88	11.98	0.00	0.01
EAS-US	2026-03-02 01:00:00	5.80	18.29	0.35	6.94	11.98	0.00	0.01
EAS-US	2026-03-02 01:15:00	5.78	18.31	0.35	6.89	12.00	0.00	0.01
EAS-US	2026-03-02 01:30:00	5.75	18.30	0.36	6.87	11.99	0.00	0.01
EAS-US	2026-03-02 01:45:00	5.73	18.29	0.30	6.98	12.00	0.00	0.01
EAS-US	2026-03-02 02:00:00	5.72	18.29	0.35	6.94	12.02	0.00	0.01
EAS-US	2026-03-02 02:15:00	5.70	18.29	0.36	6.95	12.00	0.00	0.01
EAS-US	2026-03-02 02:30:00	5.67	18.29	0.36	6.94	12.02	0.00	0.01
EAS-US	2026-03-02 02:45:00	5.65	18.28	0.31	6.87	12.03	0.00	0.01
EAS-US	2026-03-02 03:00:00	5.63	18.27	0.35	6.89	12.03	0.00	0.01
EAS-US	2026-03-02 03:15:00	5.60	18.28	0.36	6.88	12.03	0.00	0.01
EAS-US	2026-03-02 03:30:00	5.56	18.27	0.36	6.89	12.04	0.00	0.01
EAS-US	2026-03-02 03:45:00	5.53	18.28	0.30	6.95	12.05	0.00	0.01
EAS-US	2026-03-02 04:00:00	5.51	18.27	0.35	6.97	12.07	0.00	0.01
EAS-US	2026-03-02 04:15:00	5.48	18.27	0.36	6.98	12.08	0.00	0.01
EAS-US	2026-03-02 04:30:00	5.45	18.27	0.37	6.99	12.09	0.00	0.01
EAS-US	2026-03-02 04:45:00	5.42	18.29	0.31	6.88	12.09	0.00	0.01
EAS-US	2026-03-02 05:00:00	5.39	18.30	0.35	6.94	12.10	0.00	0.01
EAS-US	2026-03-02 05:15:00	5.36	18.29	0.36	6.90	12.12	0.00	0.01
EAS-US	2026-03-02 05:30:00	5.33	18.30	0.36	6.89	12.11	0.00	0.01
EAS-US	2026-03-02 05:45:00	5.31	18.27	0.30	6.97	12.13	0.00	0.01
EAS-US	2026-03-02 06:00:00	5.28	18.27	0.36	6.98	12.14	0.00	0.01
EAS-US	2026-03-02 06:15:00	5.26	18.28	0.36	7.00	12.14	0.00	0.01
EAS-US	2026-03-02 06:30:00	5.24	18.28	0.37	6.96	12.17	0.00	0.01
EAS-US	2026-03-02 06:45:00	5.23	18.26	0.31	6.86	12.16	0.00	0.01
EAS-US	2026-03-02 07:00:00	5.20	18.27	0.36	6.88	12.17	0.00	0.01
EAS-US	2026-03-02 07:15:00	5.17	18.25	0.36	6.94	12.19	0.00	0.01
EAS-US	2026-03-02 07:30:00	5.14	18.22	0.36	6.92	12.21	0.00	0.01
EAS-US	2026-03-02 07:45:00	5.14	18.19	0.31	6.96	12.22	0.00	0.01
EAS-US	2026-03-02 08:00:00	5.14	18.19	0.36	7.00	12.22	0.00	0.01
EAS-US	2026-03-02 08:15:00	5.17	18.16	0.37	7.00	12.24	0.00	0.01
EAS-US	2026-03-02 08:30:00	5.24	18.14	0.37	7.00	12.27	0.00	0.01
EAS-US	2026-03-02 08:45:00	5.33	18.12	0.32	6.90	12.24	0.00	0.01
EAS-US	2026-03-02 09:00:00	5.40	18.13	0.36	6.92	12.25	0.00	0.01
EAS-US	2026-03-02 09:15:00	5.47	18.16	0.36	6.95	12.23	0.00	0.01
EAS-US	2026-03-02 09:30:00	5.55	18.18	0.36	6.96	12.20	0.00	0.01
EAS-US	2026-03-02 09:45:00	5.64	18.22	0.31	6.98	12.19	0.00	0.01
EAS-US	2026-03-02 10:00:00	5.72	18.21	0.36	7.01	12.17	0.00	0.01
EAS-US	2026-03-02 10:15:00	5.81	18.22	0.36	7.06	12.14	0.00	0.01
EAS-US	2026-03-02 10:30:00	5.93	18.20	0.36	7.06	12.11	0.00	0.01
EAS-US	2026-03-02 10:45:00	6.02	18.15	0.31	6.98	12.08	0.00	0.01
EAS-US	2026-03-02 11:00:00	6.12	18.10	0.35	6.92	12.05	0.00	0.01
EAS-US	2026-03-02 11:15:00	6.24	18.05	0.36	6.98	12.01	0.00	0.01
EAS-US	2026-03-02 11:30:00	6.36	17.99	0.36	6.94	11.98	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-02 11:45:00	6.48	17.95	0.30	7.04	11.94	0.00	0.01
EAS-US	2026-03-02 12:00:00	6.56	17.87	0.35	7.03	11.91	0.00	0.01
EAS-US	2026-03-02 12:15:00	6.63	17.84	0.36	7.06	11.89	0.00	0.01
EAS-US	2026-03-02 12:30:00	6.69	17.80	0.36	7.07	11.87	0.00	0.01
EAS-US	2026-03-02 12:45:00	6.78	17.76	0.30	6.95	11.84	0.00	0.01
EAS-US	2026-03-02 13:00:00	6.86	17.69	0.35	6.94	11.80	0.00	0.01
EAS-US	2026-03-02 13:15:00	6.89	17.67	0.36	6.92	11.79	0.00	0.01
EAS-US	2026-03-02 13:30:00	6.89	17.66	0.36	6.93	11.77	0.00	0.01
EAS-US	2026-03-02 13:45:00	6.89	17.64	0.30	7.03	11.78	0.00	0.01
EAS-US	2026-03-02 14:00:00	6.91	17.60	0.35	7.03	11.78	0.00	0.01
EAS-US	2026-03-02 14:15:00	6.95	17.57	0.36	7.03	11.76	0.00	0.01
EAS-US	2026-03-02 14:30:00	6.97	17.57	0.36	6.99	11.74	0.00	0.01
EAS-US	2026-03-02 14:45:00	7.03	17.54	0.31	6.94	11.73	0.00	0.01
EAS-US	2026-03-02 15:00:00	7.05	17.50	0.36	6.91	11.72	0.00	0.01
EAS-US	2026-03-02 15:15:00	7.02	17.51	0.36	6.92	11.71	0.00	0.01
EAS-US	2026-03-02 15:30:00	6.95	17.52	0.36	6.95	11.70	0.00	0.01
EAS-US	2026-03-02 15:45:00	6.89	17.53	0.30	6.97	11.72	0.00	0.01
EAS-US	2026-03-02 16:00:00	6.86	17.56	0.36	6.98	11.72	0.00	0.01
EAS-US	2026-03-02 16:15:00	6.84	17.59	0.36	6.99	11.70	0.00	0.01
EAS-US	2026-03-02 16:30:00	6.79	17.64	0.37	6.96	11.71	0.00	0.01
EAS-US	2026-03-02 16:45:00	6.74	17.66	0.31	6.89	11.73	0.00	0.01
EAS-US	2026-03-02 17:00:00	6.73	17.66	0.36	6.88	11.74	0.00	0.01
EAS-US	2026-03-02 17:15:00	6.70	17.65	0.36	6.89	11.74	0.00	0.01
EAS-US	2026-03-02 17:30:00	6.67	17.69	0.36	6.94	11.74	0.00	0.01
EAS-US	2026-03-02 17:45:00	6.64	17.69	0.31	6.98	11.73	0.00	0.01
EAS-US	2026-03-02 18:00:00	6.61	17.73	0.36	6.95	11.73	0.00	0.01
EAS-US	2026-03-02 18:15:00	6.58	17.74	0.37	6.96	11.74	0.00	0.01
EAS-US	2026-03-02 18:30:00	6.55	17.76	0.38	6.94	11.74	0.00	0.01
EAS-US	2026-03-02 18:45:00	6.52	17.79	0.32	6.87	11.76	0.00	0.01
EAS-US	2026-03-02 19:00:00	6.48	17.78	0.36	6.90	11.76	0.00	0.01
EAS-US	2026-03-02 19:15:00	6.45	17.80	0.37	6.88	11.78	0.00	0.01
EAS-US	2026-03-02 19:30:00	6.41	17.79	0.37	6.89	11.79	0.00	0.01
EAS-US	2026-03-02 19:45:00	6.38	17.80	0.32	6.93	11.80	0.00	0.01
EAS-US	2026-03-02 20:00:00			0.36	6.96	11.82	0.00	
EAS-US	2026-03-02 20:15:00	6.32	17.85	0.38	6.94	11.82	0.00	0.01
EAS-US	2026-03-02 20:30:00	6.29	17.87	0.38	6.92	11.83	0.00	0.01
EAS-US	2026-03-02 20:45:00	6.27	17.87	0.32	6.91	11.85	0.00	0.01
EAS-US	2026-03-02 21:00:00	6.25	17.89	0.37	6.85	11.85	0.00	0.01
EAS-US	2026-03-02 21:15:00	6.22	17.91	0.37	6.86	11.86	0.00	0.01
EAS-US	2026-03-02 21:30:00	6.18	17.93	0.38	6.84	11.86	0.00	0.01
EAS-US	2026-03-02 21:45:00	6.16	17.93	0.32	6.94	11.87	0.00	0.01
EAS-US	2026-03-02 22:00:00	6.14	17.96	0.36	7.00	11.87	0.00	0.01
EAS-US	2026-03-02 22:15:00	6.11	17.94	0.38	6.95	11.89	0.00	0.01
EAS-US	2026-03-02 22:30:00	6.08	17.96	0.38	6.95	11.90	0.00	0.01
EAS-US	2026-03-02 22:45:00	6.05	17.98	0.33	6.86	11.90	0.00	0.01
EAS-US	2026-03-02 23:00:00	6.03	17.99	0.37	6.89	11.90	0.00	0.01
EAS-US	2026-03-02 23:15:00	5.99	18.00	0.38	6.87	11.92	0.00	0.01
EAS-US	2026-03-02 23:30:00	5.96	17.98	0.38	6.89	11.92	0.00	0.01
EAS-US	2026-03-02 23:45:00	5.94	17.98	0.32	6.93	11.94	0.00	0.01
EAS-US	2026-03-03 00:00:00	5.94	18.01	0.37	6.94	11.94	0.00	0.01
EAS-US	2026-03-03 00:15:00	5.92	18.01	0.38	6.93	11.94	0.00	0.01
EAS-US	2026-03-03 00:30:00	5.89	18.02	0.38	6.96	11.95	0.00	0.01
EAS-US	2026-03-03 00:45:00	5.89	18.00	0.33	6.87	11.94	0.00	0.01
EAS-US	2026-03-03 01:00:00	5.89	18.01	0.37	6.89	11.95	0.00	0.01
EAS-US	2026-03-03 01:15:00	5.89	18.01	0.38	6.88	11.95	0.56	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-03 01:30:00	5.88	18.02	0.38	6.88	11.96	0.00	0.01
EAS-US	2026-03-03 01:45:00	5.89	18.00	0.32	6.94	11.96	0.00	0.01
EAS-US	2026-03-03 02:00:00	5.88	18.06	0.37	6.95	11.96	0.00	0.01
EAS-US	2026-03-03 02:15:00	5.88	18.05	0.38	6.94	11.95	0.00	0.01
EAS-US	2026-03-03 02:30:00	5.88	18.05	0.39	6.93	11.94	0.00	0.01
EAS-US	2026-03-03 02:45:00	5.88	18.05	0.33	6.89	11.95	0.00	0.01
EAS-US	2026-03-03 03:00:00	5.88	18.05	0.37	6.88	11.93	0.00	0.01
EAS-US	2026-03-03 03:15:00	5.88	18.04	0.38	6.89	11.94	0.00	0.01
EAS-US	2026-03-03 03:30:00	5.88	18.04	0.38	6.91	11.94	0.00	0.01
EAS-US	2026-03-03 03:45:00	5.88	18.02	0.33	6.93	11.95	0.00	0.01
EAS-US	2026-03-03 04:00:00	5.88	18.02	0.37	6.93	11.94	0.00	0.01
EAS-US	2026-03-03 04:15:00	5.88	18.07	0.38	6.98	11.94	0.00	0.01
EAS-US	2026-03-03 04:30:00	5.88	18.09	0.39	6.96	11.94	0.00	0.01
EAS-US	2026-03-03 04:45:00	5.88	18.09	0.33	6.90	11.94	0.00	0.01
EAS-US	2026-03-03 05:00:00	5.88	18.10	0.37	6.87	11.93	0.00	0.01
EAS-US	2026-03-03 05:15:00	5.88	18.17	0.38	6.90	11.95	0.00	0.01
EAS-US	2026-03-03 05:30:00	5.89	18.79	0.38	6.88	11.93	0.00	0.01
EAS-US	2026-03-03 05:45:00	5.91	21.13	0.33	7.02	11.91	0.00	0.01
EAS-US	2026-03-03 06:00:00	5.92	21.51	0.37	7.04	11.92	0.00	0.01
EAS-US	2026-03-03 06:15:00	5.91	21.29	0.38	7.07	11.92	0.00	0.01
EAS-US	2026-03-03 06:30:00	5.89	21.89	0.38	7.07	11.92	0.00	0.01
EAS-US	2026-03-03 06:45:00	5.89	21.47	0.33	7.02	11.92	0.00	0.01
EAS-US	2026-03-03 07:00:00	5.89	21.76	0.37	6.99	11.92	0.00	0.01
EAS-US	2026-03-03 07:15:00	5.88	23.58	0.37	7.02	11.92	0.00	0.01
EAS-US	2026-03-03 07:30:00	5.88	24.15	0.37	7.10	11.92	0.00	0.01
EAS-US	2026-03-03 07:45:00	5.88	24.62	0.32	7.13	11.93	0.00	0.01
EAS-US	2026-03-03 08:00:00	5.87	25.34	0.36	7.16	11.95	0.00	0.01
EAS-US	2026-03-03 08:15:00	5.87	25.29	0.37	7.18	11.94	1.29	0.01
EAS-US	2026-03-03 08:30:00	5.89	28.66	0.38	7.18	11.93	4.48	0.01
EAS-US	2026-03-03 08:45:00	5.92	28.77	0.33	7.19	11.96	2.21	0.01
EAS-US	2026-03-03 09:00:00	5.94	27.64	0.36	7.16	11.93	3.36	0.01
EAS-US	2026-03-03 09:15:00	5.94	26.94	0.37	7.14	11.95	3.60	0.01
EAS-US	2026-03-03 09:30:00	5.95	26.31	0.38	7.12	11.94	4.16	0.01
EAS-US	2026-03-03 09:45:00	6.00	25.89	0.33	7.16	11.94	4.82	0.01
EAS-US	2026-03-03 10:00:00	6.07	25.39	0.36	7.19	11.91	4.77	0.01
EAS-US	2026-03-03 10:15:00	6.15	25.36	0.37	7.16	11.88	5.62	0.01
EAS-US	2026-03-03 10:30:00	6.22	29.71	0.37	7.25	11.88	13.10	0.01
EAS-US	2026-03-03 10:45:00	6.26	39.20	0.33	7.29	11.87	113.05	0.02
EAS-US	2026-03-03 11:00:00	6.33	40.91	0.35	7.36	11.87	92.39	0.02
EAS-US	2026-03-03 11:15:00	6.42	41.39	0.36	7.39	11.86	62.90	0.02
EAS-US	2026-03-03 11:30:00	6.50	44.18	0.36	7.42	11.84	51.65	0.02
EAS-US	2026-03-03 11:45:00	6.58	44.94	0.31	7.53	11.82	63.56	0.02
EAS-US	2026-03-03 12:00:00	6.65	46.33	0.35	7.57	11.79	43.34	0.02
EAS-US	2026-03-03 12:15:00	6.71	46.01	0.36	7.56	11.78	43.06	0.02
EAS-US	2026-03-03 12:30:00	6.75	46.34	0.36	7.56	11.77	33.57	0.02
EAS-US	2026-03-03 12:45:00	6.79	46.61	0.32	7.49	11.74	32.11	0.02
EAS-US	2026-03-03 13:00:00	6.83	45.78	0.35	7.50	11.75	14.81	0.02
EAS-US	2026-03-03 13:15:00	6.85	44.20	0.36	7.47	11.73	12.98	0.02
EAS-US	2026-03-03 13:30:00	6.86	42.76	0.36	7.46	11.71	11.18	0.02
EAS-US	2026-03-03 13:45:00	6.89	41.29	0.31	7.54	11.71	14.15	0.02
EAS-US	2026-03-03 14:00:00	6.91	39.87	0.35	7.53	11.71	7.39	0.02
EAS-US	2026-03-03 14:15:00	6.92	38.48	0.36	7.48	11.70	6.16	0.02
EAS-US	2026-03-03 14:30:00	6.92	37.18	0.37	7.50	11.68	5.43	0.02
EAS-US	2026-03-03 14:45:00	6.93	36.06	0.32	7.39	11.69	2.71	0.02
EAS-US	2026-03-03 15:00:00	6.96	35.34	0.36	7.38	11.69	3.76	0.02

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-03 15:15:00	6.98	34.91	0.36	7.37	11.67	1.68	0.01
EAS-US	2026-03-03 15:30:00	6.99	33.96	0.37	7.37	11.67	1.40	0.01
EAS-US	2026-03-03 15:45:00	7.00	33.45	0.32	7.40	11.67	1.88	0.01
EAS-US	2026-03-03 16:00:00	7.00	33.20	0.35	7.43	11.66	1.49	0.01
EAS-US	2026-03-03 16:15:00	7.00	32.37	0.36	7.41	11.66	1.02	0.01
EAS-US	2026-03-03 16:30:00	6.99	31.55	0.37	7.38	11.64	1.25	0.01
EAS-US	2026-03-03 16:45:00	6.98	30.96	0.32	7.26	11.62	0.59	0.01
EAS-US	2026-03-03 17:00:00	6.98	30.71	0.36	7.24	11.62	0.67	0.01
EAS-US	2026-03-03 17:15:00	6.98	31.95	0.37	7.24	11.62	1.18	0.01
EAS-US	2026-03-03 17:30:00	6.98	34.21	0.37	7.28	11.61	2.80	0.01
EAS-US	2026-03-03 17:45:00	7.00	37.43	0.31	7.39	11.60	4.58	0.02
EAS-US	2026-03-03 18:00:00	7.03	40.91	0.35	7.45	11.59	9.09	0.02
EAS-US	2026-03-03 18:15:00	7.04	43.22	0.36	7.50	11.59	9.28	0.02
EAS-US	2026-03-03 18:30:00	7.05	47.12	0.37	7.52	11.59	19.56	0.02
EAS-US	2026-03-03 18:45:00	7.07	52.18	0.32	7.50	11.59	13.19	0.02
EAS-US	2026-03-03 19:00:00	7.09	55.71	0.35	7.54	11.59	23.44	0.02
EAS-US	2026-03-03 19:15:00	7.08	57.91	0.36	7.58	11.59	17.14	0.03
EAS-US	2026-03-03 19:30:00	7.07	59.83	0.36	7.58	11.60	13.94	0.03
EAS-US	2026-03-03 19:45:00	7.08	63.21	0.30	7.66	11.59	18.44	0.03
EAS-US	2026-03-03 20:00:00	7.09	66.08	0.34	7.69	11.61	25.57	0.03
EAS-US	2026-03-03 20:15:00	7.10	68.03	0.35	7.71	11.61	30.94	0.03
EAS-US	2026-03-03 20:30:00	7.10	70.75	0.35	7.74	11.62	38.50	0.03
EAS-US	2026-03-03 20:45:00	7.08	73.46	0.30	7.71	11.64	27.94	0.03
EAS-US	2026-03-03 21:00:00	7.08	76.02	0.34	7.72	11.65	25.15	0.03
EAS-US	2026-03-03 21:15:00	7.06	76.65	0.34	7.73	11.66	19.58	0.03
EAS-US	2026-03-03 21:30:00	7.04	76.32	0.34	7.74	11.67	19.59	0.03
EAS-US	2026-03-03 21:45:00	7.01	75.28	0.28	7.79	11.67	11.02	0.03
EAS-US	2026-03-03 22:00:00	6.97	73.81	0.33	7.77	11.69	8.86	0.03
EAS-US	2026-03-03 22:15:00	6.93	72.26	0.34	7.75	11.70	9.58	0.03
EAS-US	2026-03-03 22:30:00	6.89	69.44	0.35	7.70	11.72	8.88	0.03
EAS-US	2026-03-03 22:45:00	6.87	67.61	0.29	7.68	11.72	11.10	0.03
EAS-US	2026-03-03 23:00:00	6.85	66.45	0.33	7.66	11.75	11.76	0.03
EAS-US	2026-03-03 23:15:00	6.82	65.61	0.34	7.67	11.75	8.60	0.03
EAS-US	2026-03-03 23:30:00	6.80	64.19	0.34	7.64	11.77	5.41	0.03
EAS-US	2026-03-03 23:45:00	6.80	62.67	0.29	7.69	11.74	12.51	0.03
EAS-US	2026-03-04 00:00:00	6.79	60.79	0.33	7.66	11.76	23.14	0.03
EAS-US	2026-03-04 00:15:00	6.78	59.13	0.35	7.64	11.79	26.19	0.03
EAS-US	2026-03-04 00:30:00	6.77	58.65	0.35	7.64	11.77	22.89	0.03
EAS-US	2026-03-04 00:45:00	6.74	55.75	0.32	7.66	11.81	12.98	0.02
EAS-US	2026-03-04 01:00:00	6.72	53.32	0.35	7.60	11.77	5.04	0.02
EAS-US	2026-03-04 01:15:00	6.69	48.91	0.36	7.61	11.77	4.36	0.02
EAS-US	2026-03-04 01:30:00	6.65	43.75	0.37	7.42	11.77	3.82	0.02
EAS-US	2026-03-04 01:45:00	6.64	43.04	0.29	7.45	11.75	2.87	0.02
EAS-US	2026-03-04 02:00:00	6.62	40.32	0.35	7.38	11.78	3.08	0.02
EAS-US	2026-03-04 02:15:00	6.61	37.91	0.36	7.41	11.76	1.56	0.02
EAS-US	2026-03-04 02:30:00	6.60	36.29	0.37	7.31	11.75	1.38	0.02
EAS-US	2026-03-04 02:45:00	6.60	35.56	0.31	7.29	11.74	0.71	0.02
EAS-US	2026-03-04 03:00:00	6.59	34.16	0.36	7.23	11.78	0.94	0.01
EAS-US	2026-03-04 03:15:00	6.58	32.94	0.37	7.22	11.77	1.67	0.01
EAS-US	2026-03-04 03:30:00	6.58	32.02	0.38	7.13	11.77	3.21	0.01
EAS-US	2026-03-04 03:45:00	6.56	30.60	0.31	7.31	11.76	1.06	0.01
EAS-US	2026-03-04 04:00:00	6.56	29.67	0.33	7.30	11.76	0.23	0.01
EAS-US	2026-03-04 04:15:00	6.55	29.03	0.33	7.31	11.76	0.50	0.01
EAS-US	2026-03-04 04:30:00	6.54	28.38	0.34	7.21	11.78	1.41	0.01
EAS-US	2026-03-04 04:45:00	6.54	28.72	0.31	7.12	11.74	0.53	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-04 05:00:00	6.54	29.48	0.36	7.16	11.75	0.83	0.01
EAS-US	2026-03-04 05:15:00	6.54	27.56	0.34	7.20	11.74	0.18	0.01
EAS-US	2026-03-04 05:30:00	6.53	27.44	0.34	7.25	11.75	0.34	0.01
EAS-US	2026-03-04 05:45:00	6.53	28.29	0.32	7.20	11.74	1.04	0.01
EAS-US	2026-03-04 06:00:00	6.53	28.20	0.36	7.17	11.76	0.26	0.01
EAS-US	2026-03-04 06:15:00	6.53	28.13	0.38	7.11	11.75	0.61	0.01
EAS-US	2026-03-04 06:30:00	6.53	28.75	0.38	7.21	11.75	1.39	0.01
EAS-US	2026-03-04 06:45:00	6.54	29.34	0.34	7.13	11.74	0.42	0.01
EAS-US	2026-03-04 07:00:00	6.53	28.05	0.37	7.15	11.73	0.35	0.01
EAS-US	2026-03-04 07:15:00	6.53	27.77	0.35	7.18	11.75	0.63	0.01
EAS-US	2026-03-04 07:30:00	6.53	27.63	0.34	7.21	11.74	0.00	0.01
EAS-US	2026-03-04 07:45:00	6.53	28.09	0.31	7.13	11.74	0.00	0.01
EAS-US	2026-03-04 08:00:00	6.53	27.95	0.33	7.24	11.76	0.00	0.01
EAS-US	2026-03-04 08:15:00	6.53	27.61	0.34	7.15	11.75	0.00	0.01
EAS-US	2026-03-04 08:30:00	6.54	27.36	0.34	7.23	11.75	0.29	0.01
EAS-US	2026-03-04 08:45:00	6.56	27.35	0.32	7.08	11.74	0.00	0.01
EAS-US	2026-03-04 09:00:00	6.59	26.65	0.36	7.07	11.75	0.00	0.01
EAS-US	2026-03-04 09:15:00	6.61	26.17	0.37	7.08	11.73	0.00	0.01
EAS-US	2026-03-04 09:30:00	6.63	25.67	0.37	7.08	11.73	0.00	0.01
EAS-US	2026-03-04 09:45:00	6.65	25.21	0.32	7.17	11.73	0.00	0.01
EAS-US	2026-03-04 10:00:00	6.66	24.76	0.36	7.15	11.74	0.00	0.01
EAS-US	2026-03-04 10:15:00	6.67	24.39	0.37	7.13	11.74	0.00	0.01
EAS-US	2026-03-04 10:30:00	6.70	23.77	0.38	7.15	11.72	2.12	0.01
EAS-US	2026-03-04 10:45:00	6.72	23.64	0.33	7.03	11.72	0.00	0.01
EAS-US	2026-03-04 11:00:00	6.74	23.31	0.37	7.04	11.73	0.00	0.01
EAS-US	2026-03-04 11:15:00	6.77	23.00	0.37	7.03	11.73	0.00	0.01
EAS-US	2026-03-04 11:30:00	6.81	22.73	0.38	7.02	11.72	0.00	0.01
EAS-US	2026-03-04 11:45:00	6.85	22.50	0.32	7.07	11.70	0.00	0.01
EAS-US	2026-03-04 12:00:00	6.88	22.22	0.36	7.05	11.70	0.00	0.01
EAS-US	2026-03-04 12:15:00	6.92	21.94	0.37	7.11	11.68	0.00	0.01
EAS-US	2026-03-04 12:30:00	6.94	21.73	0.37	7.05	11.69	0.00	0.01
EAS-US	2026-03-04 12:45:00	6.96	21.53	0.31	6.98	11.67	0.00	0.01
EAS-US	2026-03-04 13:00:00	6.98	21.37	0.36	7.01	11.67	2.04	0.01
EAS-US	2026-03-04 13:15:00	7.00	21.21	0.37	6.99	11.66	0.00	0.01
EAS-US	2026-03-04 13:30:00	7.02	21.05	0.37	6.98	11.65	0.00	0.01
EAS-US	2026-03-04 13:45:00	7.06	20.94	0.31	7.06	11.65	0.00	0.01
EAS-US	2026-03-04 14:00:00	7.11	20.85	0.36	6.99	11.63	0.00	0.01
EAS-US	2026-03-04 14:15:00	7.18	20.74	0.37	7.03	11.62	0.00	0.01
EAS-US	2026-03-04 14:30:00	7.23	20.62	0.37	7.03	11.61	0.00	0.01
EAS-US	2026-03-04 14:45:00	7.27	20.49	0.31	6.96	11.59	0.00	0.01
EAS-US	2026-03-04 15:00:00	7.31	20.40	0.36	7.00	11.57	1.52	0.01
EAS-US	2026-03-04 15:15:00	7.27	20.30	0.37	6.94	11.56	0.00	0.01
EAS-US	2026-03-04 15:30:00	7.26	20.22	0.37	6.91	11.55	0.00	0.01
EAS-US	2026-03-04 15:45:00	7.21	20.18	0.31	6.97	11.58	0.00	0.01
EAS-US	2026-03-04 16:00:00	7.20	20.11	0.36	7.01	11.59	0.00	0.01
EAS-US	2026-03-04 16:15:00	7.18	20.10	0.37	6.96	11.58	1.02	0.01
EAS-US	2026-03-04 16:30:00	7.16	20.07	0.38	7.00	11.58	0.00	0.01
EAS-US	2026-03-04 16:45:00	7.13	20.04	0.32	6.90	11.59	0.00	0.01
EAS-US	2026-03-04 17:00:00	7.12	20.03	0.36	6.88	11.57	0.00	0.01
EAS-US	2026-03-04 17:15:00	7.10	20.02	0.37	6.92	11.58	0.00	0.01
EAS-US	2026-03-04 17:30:00	7.07	20.00	0.38	6.91	11.59	0.00	0.01
EAS-US	2026-03-04 17:45:00	7.05	19.99	0.32	6.94	11.60	0.00	0.01
EAS-US	2026-03-04 18:00:00	7.02	20.01	0.36	6.98	11.59	0.00	0.01
EAS-US	2026-03-04 18:15:00	6.99	20.03	0.37	7.00	11.61	0.00	0.01
EAS-US	2026-03-04 18:30:00	6.97	20.04	0.38	6.98	11.60	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-04 18:45:00	6.96	20.08	0.32	6.91	11.61	0.00	0.01
EAS-US	2026-03-04 19:00:00	6.96	20.07	0.37	6.89	11.61	0.00	0.01
EAS-US	2026-03-04 19:15:00	6.97	20.08	0.37	6.87	11.63	0.00	0.01
EAS-US	2026-03-04 19:30:00	6.96	20.12	0.38	6.86	11.61	0.00	0.01
EAS-US	2026-03-04 19:45:00	6.96	20.14	0.32	6.96	11.62	0.00	0.01
EAS-US	2026-03-04 20:00:00	6.97	20.15	0.37	6.96	11.63	0.00	0.01
EAS-US	2026-03-04 20:15:00	6.97	20.16	0.38	6.96	11.62	0.00	0.01
EAS-US	2026-03-04 20:30:00	6.97	20.14	0.38	6.93	11.63	0.00	0.01
EAS-US	2026-03-04 20:45:00	6.97	20.16	0.32	6.88	11.62	0.00	0.01
EAS-US	2026-03-04 21:00:00	6.97	20.17	0.37	6.89	11.62	0.00	0.01
EAS-US	2026-03-04 21:15:00	6.97	20.19	0.38	6.83	11.62	0.00	0.01
EAS-US	2026-03-04 21:30:00	6.97	20.20	0.38	6.89	11.62	0.00	0.01
EAS-US	2026-03-04 21:45:00	6.97	20.22	0.32	7.00	11.62	0.00	0.01
EAS-US	2026-03-04 22:00:00	6.97	20.21	0.37	6.97	11.63	0.00	0.01
EAS-US	2026-03-04 22:15:00	6.97	20.31	0.38	6.96	11.64	0.00	0.01
EAS-US	2026-03-04 22:30:00	6.98	20.42	0.38	6.95	11.63	0.00	0.01
EAS-US	2026-03-04 22:45:00	6.97	20.40	0.32	6.90	11.63	0.00	0.01
EAS-US	2026-03-04 23:00:00	6.98	20.30	0.36	6.93	11.64	0.00	0.01
EAS-US	2026-03-04 23:15:00	6.98	20.26	0.37	6.90	11.63	0.00	0.01
EAS-US	2026-03-04 23:30:00	6.98	20.27	0.38	6.90	11.64	0.00	0.01
EAS-US	2026-03-04 23:45:00	6.99	20.26	0.32	6.96	11.64	0.00	0.01
EAS-US	2026-03-05 00:00:00	6.99	20.25	0.36	7.00	11.61	0.00	0.01
EAS-US	2026-03-05 00:15:00	6.99	20.21	0.37	7.02	11.62	0.00	0.01
EAS-US	2026-03-05 00:30:00	6.98	20.19	0.38	6.99	11.63	0.00	0.01
EAS-US	2026-03-05 00:45:00	6.98	20.17	0.32	6.89	11.64	0.00	0.01
EAS-US	2026-03-05 01:00:00	6.97	20.13	0.36	6.90	11.65	0.00	0.01
EAS-US	2026-03-05 01:15:00	6.96	20.13	0.37	6.88	11.65	0.00	0.01
EAS-US	2026-03-05 01:30:00	6.95	20.10	0.38	6.89	11.64	0.00	0.01
EAS-US	2026-03-05 01:45:00	6.93	20.08	0.32	6.96	11.66	0.00	0.01
EAS-US	2026-03-05 02:00:00	6.91	20.07	0.36	7.00	11.66	0.00	0.01
EAS-US	2026-03-05 02:15:00	6.88	20.04	0.37	7.00	11.68	0.00	0.01
EAS-US	2026-03-05 02:30:00	6.87	19.99	0.38	7.02	11.67	0.00	0.01
EAS-US	2026-03-05 02:45:00	6.86	19.98	0.32	6.87	11.67	0.00	0.01
EAS-US	2026-03-05 03:00:00	6.84	19.97	0.37	6.86	11.70	0.00	0.01
EAS-US	2026-03-05 03:15:00	6.81	19.93	0.37	6.89	11.68	0.00	0.01
EAS-US	2026-03-05 03:30:00	6.80	19.91	0.38	6.92	11.69	0.00	0.01
EAS-US	2026-03-05 03:45:00	6.78	19.88	0.32	6.99	11.71	0.00	0.01
EAS-US	2026-03-05 04:00:00	6.76	19.84	0.36	7.03	11.71	0.00	0.01
EAS-US	2026-03-05 04:15:00	6.73	19.83	0.38	6.95	11.72	0.00	0.01
EAS-US	2026-03-05 04:30:00	6.69	19.82	0.38	6.96	11.73	0.00	0.01
EAS-US	2026-03-05 04:45:00	6.66	19.78	0.32	6.90	11.74	0.00	0.01
EAS-US	2026-03-05 05:00:00	6.62	19.75	0.37	6.87	11.75	0.00	0.01
EAS-US	2026-03-05 05:15:00	6.58	19.75	0.38	6.88	11.77	0.08	0.01
EAS-US	2026-03-05 05:30:00	6.55	19.74	0.38	6.90	11.78	0.00	0.01
EAS-US	2026-03-05 05:45:00	6.52	19.73	0.32	7.00	11.78	0.00	0.01
EAS-US	2026-03-05 06:00:00	6.48	19.72	0.37	6.96	11.80	0.00	0.01
EAS-US	2026-03-05 06:15:00	6.46	19.67	0.38	7.02	11.81	0.00	0.01
EAS-US	2026-03-05 06:30:00	6.42	19.66	0.38	6.98	11.82	0.00	0.01
EAS-US	2026-03-05 06:45:00	6.40	19.64	0.33	6.91	11.84	0.00	0.01
EAS-US	2026-03-05 07:00:00	6.37	19.61	0.37	6.89	11.85	0.00	0.01
EAS-US	2026-03-05 07:15:00	6.33	19.59	0.38	6.90	11.88	0.00	0.01
EAS-US	2026-03-05 07:30:00	6.30	19.55	0.38	6.90	11.90	0.00	0.01
EAS-US	2026-03-05 07:45:00	6.27	19.52	0.32	6.99	11.90	0.00	0.01
EAS-US	2026-03-05 08:00:00	6.28	19.48	0.36	7.02	11.92	0.00	0.01
EAS-US	2026-03-05 08:15:00	6.33	19.47	0.37	7.02	11.93	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-05 08:30:00	6.40	19.44	0.38	7.02	11.93	0.00	0.01
EAS-US	2026-03-05 08:45:00	6.47	19.43	0.32	6.93	11.92	0.00	0.01
EAS-US	2026-03-05 09:00:00	6.55	19.44	0.37	6.93	11.93	0.00	0.01
EAS-US	2026-03-05 09:15:00	6.62	19.41	0.38	6.94	11.90	0.00	0.01
EAS-US	2026-03-05 09:30:00	6.68	19.40	0.38	6.94	11.89	0.00	0.01
EAS-US	2026-03-05 09:45:00	6.77	19.39	0.32	7.04	11.86	0.00	0.01
EAS-US	2026-03-05 10:00:00	6.85	19.36	0.36	7.03	11.85	0.00	0.01
EAS-US	2026-03-05 10:15:00	6.94	19.29	0.37	7.05	11.84	0.00	0.01
EAS-US	2026-03-05 10:30:00	7.02	19.22	0.37	7.06	11.81	0.00	0.01
EAS-US	2026-03-05 10:45:00	7.10	19.15	0.32	6.94	11.81	0.00	0.01
EAS-US	2026-03-05 11:00:00	7.17	19.09	0.36	6.97	11.77	0.00	0.01
EAS-US	2026-03-05 11:15:00	7.25	19.01	0.37	6.94	11.74	0.00	0.01
EAS-US	2026-03-05 11:30:00	7.36	18.96	0.37	6.97	11.71	0.00	0.01
EAS-US	2026-03-05 11:45:00	7.46	18.90	0.31	7.06	11.69	0.00	0.01
EAS-US	2026-03-05 12:00:00	7.57	18.82	0.36	7.06	11.68	0.00	0.01
EAS-US	2026-03-05 12:15:00	7.74	18.73	0.37	7.05	11.63	0.00	0.01
EAS-US	2026-03-05 12:30:00	7.82	18.67	0.37	7.02	11.58	0.91	0.01
EAS-US	2026-03-05 12:45:00	7.88	18.61	0.31	6.95	11.59	0.00	0.01
EAS-US	2026-03-05 13:00:00	7.96	18.58	0.36	6.97	11.55	0.00	0.01
EAS-US	2026-03-05 13:15:00	7.85	18.54	0.37	6.93	11.52	0.00	0.01
EAS-US	2026-03-05 13:30:00	7.73	18.47	0.37	6.95	11.57	0.00	0.01
EAS-US	2026-03-05 13:45:00	7.69	18.41	0.31	6.99	11.59	0.00	0.01
EAS-US	2026-03-05 14:00:00	7.66	18.39	0.36	6.98	11.61	0.00	0.01
EAS-US	2026-03-05 14:15:00	7.64	18.37	0.37	7.00	11.59	0.00	0.01
EAS-US	2026-03-05 14:30:00	7.66	18.37	0.38	6.99	11.58	0.00	0.01
EAS-US	2026-03-05 14:45:00	7.69	18.40	0.32	6.92	11.60	0.00	0.01
EAS-US	2026-03-05 15:00:00	7.63	18.38	0.37	6.91	11.58	0.00	0.01
EAS-US	2026-03-05 15:15:00	7.61	18.40	0.37	6.91	11.61	0.00	0.01
EAS-US	2026-03-05 15:30:00	7.64	18.37	0.38	6.87	11.58	0.00	0.01
EAS-US	2026-03-05 15:45:00	7.59	18.39	0.31	7.00	11.59	0.00	0.01
EAS-US	2026-03-05 16:00:00	7.53	18.41	0.36	7.01	11.59	0.00	0.01
EAS-US	2026-03-05 16:15:00	7.49	18.45	0.38	7.00	11.62	0.00	0.01
EAS-US	2026-03-05 16:30:00	7.44	18.50	0.38	6.97	11.61	0.00	0.01
EAS-US	2026-03-05 16:45:00	7.40	18.53	0.33	6.87	11.60	0.00	0.01
EAS-US	2026-03-05 17:00:00	7.38	18.52	0.37	6.85	11.63	0.00	0.01
EAS-US	2026-03-05 17:15:00	7.35	18.55	0.38	6.89	11.63	0.00	0.01
EAS-US	2026-03-05 17:30:00	7.31	18.59	0.38	6.88	11.62	0.00	0.01
EAS-US	2026-03-05 17:45:00	7.27	18.62	0.32	6.98	11.63	0.00	0.01
EAS-US	2026-03-05 18:00:00	7.24	18.65	0.37	6.98	11.63	0.00	0.01
EAS-US	2026-03-05 18:15:00	7.21	18.68	0.38	7.00	11.65	0.00	0.01
EAS-US	2026-03-05 18:30:00	7.18	18.70	0.38	6.95	11.65	0.00	0.01
EAS-US	2026-03-05 18:45:00	7.15	18.71	0.33	6.87	11.65	0.00	0.01
EAS-US	2026-03-05 19:00:00	7.13	18.72	0.37	6.87	11.67	0.00	0.01
EAS-US	2026-03-05 19:15:00	7.10	18.73	0.38	6.87	11.66	0.00	0.01
EAS-US	2026-03-05 19:30:00	7.07	18.74	0.38	6.85	11.67	0.00	0.01
EAS-US	2026-03-05 19:45:00	7.05	18.80	0.32	6.97	11.69	0.00	0.01
EAS-US	2026-03-05 20:00:00	7.03	18.83	0.37	6.98	11.69	0.00	0.01
EAS-US	2026-03-05 20:15:00	7.01	18.85	0.38	6.97	11.69	0.00	0.01
EAS-US	2026-03-05 20:30:00	6.98	18.83	0.38	6.98	11.70	0.00	0.01
EAS-US	2026-03-05 20:45:00	6.97	18.84	0.33	6.88	11.71	0.00	0.01
EAS-US	2026-03-05 21:00:00	6.96	18.86	0.37	6.84	11.72	0.00	0.01
EAS-US	2026-03-05 21:15:00	6.95	18.87	0.38	6.89	11.72	0.00	0.01
EAS-US	2026-03-05 21:30:00	6.94	18.87	0.38	6.88	11.71	0.00	0.01
EAS-US	2026-03-05 21:45:00	6.94	18.90	0.32	6.97	11.74	0.00	0.01
EAS-US	2026-03-05 22:00:00	6.92	18.91	0.37	6.95	11.73	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-05 22:15:00	6.92	18.95	0.38	6.97	11.73	0.00	0.01
EAS-US	2026-03-05 22:30:00	6.90	19.05	0.38	6.98	11.74	0.00	0.01
EAS-US	2026-03-05 22:45:00	6.89	19.14	0.33	6.92	11.74	0.00	0.01
EAS-US	2026-03-05 23:00:00	6.88	19.16	0.37	6.91	11.74	0.00	0.01
EAS-US	2026-03-05 23:15:00	6.87	19.15	0.38	6.90	11.77	0.00	0.01
EAS-US	2026-03-05 23:30:00	6.86	19.13	0.38	6.91	11.76	0.00	0.01
EAS-US	2026-03-05 23:45:00	6.85	19.13	0.32	6.99	11.75	0.00	0.01
EAS-US	2026-03-06 00:00:00	6.85	19.14	0.37	6.99	11.76	0.00	0.01
EAS-US	2026-03-06 00:15:00	6.84	19.16	0.38	6.99	11.75	0.00	0.01
EAS-US	2026-03-06 00:30:00	6.83	19.23	0.39	6.97	11.75	0.00	0.01
EAS-US	2026-03-06 00:45:00	6.82	19.32	0.33	6.92	11.76	0.00	0.01
EAS-US	2026-03-06 01:00:00	6.81	19.49	0.37	6.91	11.76	0.00	0.01
EAS-US	2026-03-06 01:15:00	6.81	19.64	0.38	6.93	11.77	0.00	0.01
EAS-US	2026-03-06 01:30:00	6.80	19.84	0.38	6.93	11.77	0.00	0.01
EAS-US	2026-03-06 01:45:00	6.79	20.03	0.32	6.98	11.76	0.00	0.01
EAS-US	2026-03-06 02:00:00	6.79	20.23	0.37	7.03	11.76	0.00	0.01
EAS-US	2026-03-06 02:15:00	6.78	20.34	0.38	7.02	11.77	0.00	0.01
EAS-US	2026-03-06 02:30:00	6.76	20.31	0.38	7.01	11.79	0.00	0.01
EAS-US	2026-03-06 02:45:00	6.75	20.21	0.33	6.94	11.78	0.00	0.01
EAS-US	2026-03-06 03:00:00	6.74	20.17	0.37	6.95	11.77	0.00	0.01
EAS-US	2026-03-06 03:15:00	6.73	20.14	0.38	6.90	11.78	0.00	0.01
EAS-US	2026-03-06 03:30:00	6.72	20.13	0.38	6.96	11.79	0.00	0.01
EAS-US	2026-03-06 03:45:00	6.72	20.23	0.32	6.99	11.79	0.00	0.01
EAS-US	2026-03-06 04:00:00	6.71	20.39	0.37	7.01	11.78	0.00	0.01
EAS-US	2026-03-06 04:15:00	6.71	20.66	0.37	7.05	11.79	0.00	0.01
EAS-US	2026-03-06 04:30:00	6.70	21.11	0.38	7.01	11.79	0.00	0.01
EAS-US	2026-03-06 04:45:00	6.70	21.31	0.33	6.97	11.78	0.00	0.01
EAS-US	2026-03-06 05:00:00	6.69	21.28	0.37	6.97	11.80	0.00	0.01
EAS-US	2026-03-06 05:15:00	6.68	21.15	0.38	6.99	11.81	0.00	0.01
EAS-US	2026-03-06 05:30:00	6.67	21.17	0.38	6.96	11.80	0.00	0.01
EAS-US	2026-03-06 05:45:00	6.66	21.16	0.32	7.07	11.81	0.00	0.01
EAS-US	2026-03-06 06:00:00	6.65	21.16	0.36	7.06	11.81	0.00	0.01
EAS-US	2026-03-06 06:15:00	6.65	21.19	0.37	7.07	11.81	0.00	0.01
EAS-US	2026-03-06 06:30:00	6.64	21.22	0.38	7.04	11.82	0.00	0.01
EAS-US	2026-03-06 06:45:00	6.63	21.16	0.33	6.96	11.81	0.00	0.01
EAS-US	2026-03-06 07:00:00	6.62	21.16	0.37	6.97	11.82	0.00	0.01
EAS-US	2026-03-06 07:15:00	6.62	21.14	0.38	6.95	11.84	0.00	0.01
EAS-US	2026-03-06 07:30:00	6.62	21.11	0.38	6.97	11.84	0.00	0.01
EAS-US	2026-03-06 07:45:00	6.63	21.10	0.32	7.06	11.84	0.00	0.01
EAS-US	2026-03-06 08:00:00	6.63	21.10	0.36	7.08	11.85	0.00	0.01
EAS-US	2026-03-06 08:15:00	6.65	21.14	0.37	7.08	11.85	0.00	0.01
EAS-US	2026-03-06 08:30:00	6.66	21.22	0.38	7.10	11.85	0.00	0.01
EAS-US	2026-03-06 08:45:00	6.69	21.24	0.32	7.00	11.87	0.00	0.01
EAS-US	2026-03-06 09:00:00	6.71	21.34	0.37	7.00	11.86	0.00	0.01
EAS-US	2026-03-06 09:15:00	6.72	21.34	0.38	6.97	11.86	0.00	0.01
EAS-US	2026-03-06 09:30:00	6.73	21.31	0.38	7.01	11.85	0.00	0.01
EAS-US	2026-03-06 09:45:00	6.75	21.22	0.32	7.08	11.86	0.00	0.01
EAS-US	2026-03-06 10:00:00	6.78	21.19	0.36	7.09	11.86	0.00	0.01
EAS-US	2026-03-06 10:15:00	6.81	21.23	0.37	7.15	11.86	0.00	0.01
EAS-US	2026-03-06 10:30:00	6.84	21.29	0.38	7.09	11.85	0.00	0.01
EAS-US	2026-03-06 10:45:00	6.87	21.31	0.32	7.00	11.85	0.00	0.01
EAS-US	2026-03-06 11:00:00	6.90	21.35	0.36	7.01	11.84	0.00	0.01
EAS-US	2026-03-06 11:15:00	6.92	21.40	0.37	7.02	11.81	0.00	0.01
EAS-US	2026-03-06 11:30:00	6.95	21.44	0.38	7.02	11.83	0.00	0.01
EAS-US	2026-03-06 11:45:00	6.97	21.45	0.31	7.09	11.82	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-06 12:00:00	6.98	21.57	0.36	7.13	11.80	0.00	0.01
EAS-US	2026-03-06 12:15:00	6.97	21.79	0.37	7.11	11.80	0.00	0.01
EAS-US	2026-03-06 12:30:00	6.97	22.02	0.37	7.10	11.78	0.00	0.01
EAS-US	2026-03-06 12:45:00	6.99	22.70	0.32	7.03	11.80	0.00	0.01
EAS-US	2026-03-06 13:00:00	7.00	23.86	0.36	7.07	11.79	0.00	0.01
EAS-US	2026-03-06 13:15:00	7.01	25.19	0.37	7.12	11.79	0.24	0.01
EAS-US	2026-03-06 13:30:00	7.02	26.12	0.37	7.10	11.77	2.18	0.01
EAS-US	2026-03-06 13:45:00	7.03	27.06	0.31	7.19	11.76	2.34	0.01
EAS-US	2026-03-06 14:00:00	7.04	27.95	0.35	7.29	11.77	3.19	0.01
EAS-US	2026-03-06 14:15:00	7.06	29.30	0.36	7.29	11.75	4.96	0.01
EAS-US	2026-03-06 14:30:00	7.08	31.43	0.37	7.32	11.74	4.10	0.01
EAS-US	2026-03-06 14:45:00	7.11	33.52	0.31	7.26	11.74	8.94	0.01
EAS-US	2026-03-06 15:00:00	7.14	35.88	0.35	7.31	11.73	8.27	0.02
EAS-US	2026-03-06 15:15:00	7.17	37.52	0.36	7.33	11.72	9.61	0.02
EAS-US	2026-03-06 15:30:00	7.18	38.81	0.37	7.34	11.74	10.84	0.02
EAS-US	2026-03-06 15:45:00	7.20	39.48	0.30	7.45	11.73	7.57	0.02
EAS-US	2026-03-06 16:00:00	7.20	39.64	0.35	7.46	11.72	6.77	0.02
EAS-US	2026-03-06 16:15:00	7.20	39.53	0.36	7.49	11.71	6.14	0.02
EAS-US	2026-03-06 16:30:00	7.19	39.23	0.36	7.45	11.70	5.19	0.02
EAS-US	2026-03-06 16:45:00	7.17	38.54	0.31	7.38	11.70	3.87	0.02
EAS-US	2026-03-06 17:00:00	7.15	37.56	0.35	7.35	11.69	4.25	0.02
EAS-US	2026-03-06 17:15:00	7.13	36.66	0.36	7.35	11.68	2.28	0.02
EAS-US	2026-03-06 17:30:00	7.11	35.87	0.36	7.31	11.68	1.71	0.02
EAS-US	2026-03-06 17:45:00	7.09	35.04	0.30	7.41	11.68	1.64	0.02
EAS-US	2026-03-06 18:00:00	7.07	34.23	0.35	7.39	11.70	0.81	0.01
EAS-US	2026-03-06 18:15:00	7.04	33.61	0.36	7.36	11.69	0.90	0.01
EAS-US	2026-03-06 18:30:00	7.02	32.90	0.37	7.34	11.70	2.75	0.01
EAS-US	2026-03-06 18:45:00	7.01	32.24	0.31	7.25	11.71	0.00	0.01
EAS-US	2026-03-06 19:00:00	6.99	31.81	0.35	7.25	11.70	0.00	0.01
EAS-US	2026-03-06 19:15:00	6.98	31.93	0.36	7.23	11.71	0.00	0.01
EAS-US	2026-03-06 19:30:00	6.97	31.37	0.37	7.23	11.71	0.00	0.01
EAS-US	2026-03-06 19:45:00	6.96	30.66	0.30	7.31	11.72	0.00	0.01
EAS-US	2026-03-06 20:00:00	6.95	30.05	0.35	7.29	11.71	0.00	0.01
EAS-US	2026-03-06 20:15:00	6.94	29.51	0.36	7.30	11.72	0.00	0.01
EAS-US	2026-03-06 20:30:00	6.93	29.08	0.37	7.29	11.73	0.07	0.01
EAS-US	2026-03-06 20:45:00	6.92	28.87	0.31	7.16	11.73	0.00	0.01
EAS-US	2026-03-06 21:00:00	6.92	28.56	0.35	7.18	11.74	0.00	0.01
EAS-US	2026-03-06 21:15:00	6.91	28.31	0.36	7.19	11.71	0.00	0.01
EAS-US	2026-03-06 21:30:00	6.91	28.13	0.37	7.20	11.74	0.00	0.01
EAS-US	2026-03-06 21:45:00	6.91	27.95	0.30	7.24	11.74	0.00	0.01
EAS-US	2026-03-06 22:00:00	6.90	27.83	0.35	7.25	11.74	0.00	0.01
EAS-US	2026-03-06 22:15:00	6.90	27.49	0.36	7.23	11.73	0.00	0.01
EAS-US	2026-03-06 22:30:00	6.90	27.09	0.37	7.21	11.75	0.00	0.01
EAS-US	2026-03-06 22:45:00	6.89	26.76	0.31	7.12	11.74	0.00	0.01
EAS-US	2026-03-06 23:00:00	6.89	26.54	0.36	7.10	11.73	0.00	0.01
EAS-US	2026-03-06 23:15:00	6.89	26.26	0.36	7.13	11.72	0.00	0.01
EAS-US	2026-03-06 23:30:00	6.89	26.03	0.37	7.10	11.73	0.00	0.01
EAS-US	2026-03-06 23:45:00	6.89	25.83	0.30	7.17	11.74	0.00	0.01
EAS-US	2026-03-07 00:00:00	6.88	25.63	0.35	7.18	11.74	0.00	0.01
EAS-US	2026-03-07 00:15:00	6.88	25.66	0.36	7.17	11.74	0.00	0.01
EAS-US	2026-03-07 00:30:00	6.88	25.63	0.37	7.19	11.73	0.00	0.01
EAS-US	2026-03-07 00:45:00	6.88	25.45	0.31	7.09	11.74	0.00	0.01
EAS-US	2026-03-07 01:00:00	6.88	25.36	0.36	7.09	11.74	0.00	0.01
EAS-US	2026-03-07 01:15:00	6.88	25.23	0.36	7.10	11.73	0.00	0.01
EAS-US	2026-03-07 01:30:00	6.88	24.98	0.37	7.11	11.74	0.00	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-07 01:45:00	6.87	24.86	0.30	7.19	11.74	0.00	0.01
EAS-US	2026-03-07 02:00:00	6.87	24.75	0.35	7.19	11.73	0.00	0.01
EAS-US	2026-03-07 02:15:00	6.87	24.71	0.36	7.20	11.73	0.00	0.01
EAS-US	2026-03-07 02:30:00	6.88	24.93	0.37	7.16	11.73	0.00	0.01
EAS-US	2026-03-07 02:45:00	6.88	25.41	0.30	7.11	11.72	0.00	0.01
EAS-US	2026-03-07 03:00:00	6.90	26.11	0.35	7.11	11.71	0.00	0.01
EAS-US	2026-03-07 03:15:00	6.91	27.23	0.36	7.14	11.72	0.00	0.01
EAS-US	2026-03-07 03:30:00	6.91	29.15	0.36	7.17	11.71	0.33	0.01
EAS-US	2026-03-07 03:45:00	6.92	30.84	0.30	7.23	11.71	0.00	0.01
EAS-US	2026-03-07 04:00:00	6.93	32.54	0.35	7.29	11.70	0.89	0.01
EAS-US	2026-03-07 04:15:00	6.94	34.25	0.36	7.33	11.70	1.12	0.01
EAS-US	2026-03-07 04:30:00	6.95	35.64	0.36	7.37	11.71	1.43	0.02
EAS-US	2026-03-07 04:45:00	6.96	36.90	0.30	7.30	11.71	1.30	0.02
EAS-US	2026-03-07 05:00:00	6.97	37.62	0.35	7.31	11.70	1.44	0.02
EAS-US	2026-03-07 05:15:00	6.97	38.64	0.36	7.32	11.70	1.89	0.02
EAS-US	2026-03-07 05:30:00	6.98	39.19	0.36	7.34	11.69	0.46	0.02
EAS-US	2026-03-07 05:45:00	6.99	38.65	0.30	7.40	11.70	0.00	0.02
EAS-US	2026-03-07 06:00:00			0.34	7.40	11.69	0.39	
EAS-US	2026-03-07 06:15:00	6.98	37.89	0.36	7.40	11.70	0.00	0.02
EAS-US	2026-03-07 06:30:00	6.99	37.13	0.36	7.40	11.68	0.00	0.02
EAS-US	2026-03-07 06:45:00	6.99	36.13	0.30	7.32	11.68	0.10	0.02
EAS-US	2026-03-07 07:00:00	6.99	35.14	0.35	7.26	11.68	0.00	0.02
EAS-US	2026-03-07 07:15:00	6.99	34.47	0.36	7.28	11.68	0.00	0.01
EAS-US	2026-03-07 07:30:00	7.00	34.48	0.36	7.27	11.68	0.00	0.01
EAS-US	2026-03-07 07:45:00	7.01	34.28	0.30	7.33	11.69	0.01	0.01
EAS-US	2026-03-07 08:00:00	7.02	34.47	0.35	7.33	11.70	0.00	0.01
EAS-US	2026-03-07 08:15:00	7.04	35.81	0.36	7.37	11.69	1.82	0.02
EAS-US	2026-03-07 08:30:00	7.05	36.40	0.36	7.42	11.69	0.80	0.02
EAS-US	2026-03-07 08:45:00	7.06	37.86	0.30	7.33	11.68	2.76	0.02
EAS-US	2026-03-07 09:00:00	7.07	39.14	0.35	7.34	11.69	3.10	0.02
EAS-US	2026-03-07 09:15:00	7.10	40.33	0.35	7.38	11.70	2.76	0.02
EAS-US	2026-03-07 09:30:00	7.14	42.02	0.36	7.39	11.67	5.97	0.02
EAS-US	2026-03-07 09:45:00	7.18	43.50	0.29	7.42	11.69	3.94	0.02
EAS-US	2026-03-07 10:00:00	7.21	43.96	0.34	7.49	11.67	6.30	0.02
EAS-US	2026-03-07 10:15:00	7.25	44.48	0.35	7.51	11.68	5.84	0.02
EAS-US	2026-03-07 10:30:00	7.27	44.32	0.35	7.50	11.66	8.37	0.02
EAS-US	2026-03-07 10:45:00	7.29	43.86	0.29	7.44	11.65	3.35	0.02
EAS-US	2026-03-07 11:00:00	7.30	43.48	0.34	7.41	11.66	2.68	0.02
EAS-US	2026-03-07 11:15:00	7.32	42.59	0.35	7.42	11.66	2.73	0.02
EAS-US	2026-03-07 11:30:00	7.35	41.87	0.35	7.41	11.65	1.13	0.02
EAS-US	2026-03-07 11:45:00	7.37	41.03	0.29	7.39	11.64	4.79	0.02
EAS-US	2026-03-07 12:00:00	7.38	40.13	0.34	7.45	11.63	2.91	0.02
EAS-US	2026-03-07 12:15:00	7.40	39.66	0.35	7.45	11.63	2.34	0.02
EAS-US	2026-03-07 12:30:00	7.40	39.05	0.35	7.43	11.63	2.04	0.02
EAS-US	2026-03-07 12:45:00	7.40	38.41	0.29	7.35	11.62	1.93	0.02
EAS-US	2026-03-07 13:00:00	7.42	37.59	0.34	7.34	11.62	2.67	0.02
EAS-US	2026-03-07 13:15:00	7.43	37.16	0.35	7.36	11.61	3.24	0.02
EAS-US	2026-03-07 13:30:00	7.45	37.32	0.35	7.36	11.61	2.06	0.02
EAS-US	2026-03-07 13:45:00	7.47	36.28	0.29	7.44	11.60	2.14	0.02
EAS-US	2026-03-07 14:00:00	7.48	35.74	0.31	7.39	11.59	0.83	0.02
EAS-US	2026-03-07 14:15:00	7.48	35.34	0.31	7.41	11.59	1.90	0.02
EAS-US	2026-03-07 14:30:00	7.47	34.84	0.31	7.42	11.58	1.35	0.01
EAS-US	2026-03-07 14:45:00	7.47	34.51	0.28	7.29	11.58	0.32	0.01
EAS-US	2026-03-07 15:00:00	7.47	34.31	0.34	7.30	11.60	0.96	0.01
EAS-US	2026-03-07 15:15:00	7.50	34.84	0.35	7.30	11.58	1.38	0.01

**Woodfibre LNG (East Creek) □**


Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-07 15:30:00	7.50	34.99	0.35	7.29	11.58	2.55	0.02
EAS-US	2026-03-07 15:45:00	7.53	35.99	0.28	7.37	11.55	5.85	0.02
EAS-US	2026-03-07 16:00:00	7.56	37.76	0.34	7.41	11.55	5.21	0.02
EAS-US	2026-03-07 16:15:00	7.60	40.42	0.35	7.39	11.55	9.84	0.02
EAS-US	2026-03-07 16:30:00	7.64	42.11	0.35	7.49	11.55	12.82	0.02
EAS-US	2026-03-07 16:45:00	7.66	45.06	0.28	7.44	11.52	21.81	0.02
EAS-US	2026-03-07 17:00:00	7.66	46.73	0.34	7.47	11.54	13.04	0.02
EAS-US	2026-03-07 17:15:00	7.65	47.48	0.34	7.48	11.54	10.76	0.02
EAS-US	2026-03-07 17:30:00	7.62	47.23	0.35	7.46	11.56	10.11	0.02
EAS-US	2026-03-07 17:45:00	7.59	45.33	0.27	7.56	11.53	6.34	0.02
EAS-US	2026-03-07 18:00:00	7.57	43.69	0.30	7.57	11.54	4.10	0.02
EAS-US	2026-03-07 18:15:00	7.56	41.33	0.30	7.53	11.54	3.08	0.02
EAS-US	2026-03-07 18:30:00	7.53	39.13	0.30	7.49	11.54	2.82	0.02
EAS-US	2026-03-07 18:45:00	7.52	37.96	0.27	7.34	11.53	1.96	0.02
EAS-US	2026-03-07 19:00:00	7.52	36.52	0.34	7.29	11.57	2.82	0.02
EAS-US	2026-03-07 19:15:00	7.52	35.31	0.35	7.29	11.53	2.60	0.02
EAS-US	2026-03-07 19:30:00	7.53	35.56	0.35	7.30	11.55	2.58	0.02
EAS-US	2026-03-07 19:45:00	7.54	35.15	0.27	7.36	11.53	1.27	0.02
EAS-US	2026-03-07 20:00:00	7.55	35.56	0.30	7.43	11.52	1.80	0.02
EAS-US	2026-03-07 20:15:00	7.56	36.62	0.30	7.44	11.55	3.87	0.02
EAS-US	2026-03-07 20:30:00	7.58	37.61	0.30	7.37	11.54	2.86	0.02
EAS-US	2026-03-07 20:45:00	7.60	39.05	0.27	7.36	11.51	2.65	0.02
EAS-US	2026-03-07 21:00:00	7.63	40.72	0.33	7.39	11.55	3.87	0.02
EAS-US	2026-03-07 21:15:00	7.64	41.91	0.34	7.38	11.52	8.66	0.02
EAS-US	2026-03-07 21:30:00	7.65	42.86	0.34	7.42	11.51	6.19	0.02
EAS-US	2026-03-07 21:45:00	7.66	43.97	0.27	7.44	11.51	7.31	0.02
EAS-US	2026-03-07 22:00:00	7.66	44.64	0.30	7.55	11.50	11.11	0.02
EAS-US	2026-03-07 22:15:00	7.64	45.03	0.30	7.52	11.51	9.50	0.02
EAS-US	2026-03-07 22:30:00	7.63	45.43	0.30	7.52	11.50	5.95	0.02
EAS-US	2026-03-07 22:45:00	7.62	45.06	0.27	7.44	11.50	3.21	0.02
EAS-US	2026-03-07 23:00:00	7.60	43.97	0.33	7.40	11.52	6.25	0.02
EAS-US	2026-03-07 23:15:00	7.61	43.54	0.34	7.40	11.51	5.73	0.02
EAS-US	2026-03-07 23:30:00	7.62	42.04	0.34	7.47	11.53	10.89	0.02
EAS-US	2026-03-07 23:45:00	7.61	43.29	0.27	7.48	11.52	11.59	0.02
EAS-US	2026-03-08 00:00:00	7.61	43.87	0.30	7.49	11.50	8.74	0.02
EAS-US	2026-03-08 00:15:00	7.59	43.49	0.30	7.43	11.50	5.15	0.02
EAS-US	2026-03-08 00:30:00	7.56	42.35	0.30	7.44	11.51	4.55	0.02
EAS-US	2026-03-08 00:45:00	7.52	38.30	0.26	7.38	11.55	5.93	0.02
EAS-US	2026-03-08 01:00:00	7.49	36.09	0.30	7.41	11.54	2.34	0.02
EAS-US	2026-03-08 01:15:00	7.46	33.70	0.30	7.41	11.42	2.01	0.01
EAS-US	2026-03-08 01:30:00	7.43	31.49	0.31	7.32	11.56	3.65	0.01
EAS-US	2026-03-08 01:45:00	7.41	31.78	0.26	7.26	11.56	2.86	0.01
EAS-US	2026-03-08 03:00:00	7.39	30.03	0.30	7.24	11.55	0.36	0.01
EAS-US	2026-03-08 03:15:00	7.38	28.56	0.30	7.30	11.55	0.92	0.01
EAS-US	2026-03-08 03:30:00	7.36	27.39	0.31	7.12	11.56	0.37	0.01
EAS-US	2026-03-08 03:45:00	7.36	26.48	0.26	7.13	11.56	0.38	0.01
EAS-US	2026-03-08 04:00:00	7.36	26.10	0.31	7.17	11.55	0.83	0.01
EAS-US	2026-03-08 04:15:00	7.36	25.41	0.31	7.10	11.54	1.22	0.01
EAS-US	2026-03-08 04:30:00	7.35	25.08	0.30	7.26	11.55	1.08	0.01
EAS-US	2026-03-08 04:45:00	7.35	25.15	0.26	7.22	11.56	0.24	0.01
EAS-US	2026-03-08 05:00:00	7.35	25.28	0.31	7.17	11.55	0.38	0.01
EAS-US	2026-03-08 05:15:00	7.35	25.10	0.31	7.07	11.53	0.06	0.01
EAS-US	2026-03-08 05:30:00	7.35	24.92	0.31	7.19	11.55	1.16	0.01
EAS-US	2026-03-08 05:45:00	7.35	24.89	0.25	7.23	11.54	19.17	0.01
EAS-US	2026-03-08 06:00:00		25.15	0.30	7.20	11.54	19.90	0.01

**Woodfibre LNG (East Creek) □**

Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-03-08 06:15:00	7.39	25.32	0.30	7.24	11.54	25.39	0.01
EAS-US	2026-03-08 06:30:00	7.38	24.91	0.30	7.24	11.52	24.23	0.01
EAS-US	2026-03-08 06:45:00	7.36	24.11	0.26	7.23	11.55	0.22	0.01
EAS-US	2026-03-08 07:00:00	7.33	23.89	0.31	7.17	11.56	0.00	0.01
EAS-US	2026-03-08 07:15:00	7.28	23.77	0.31	7.21	11.57	0.00	0.01
EAS-US	2026-03-08 07:30:00	7.23	23.58	0.32	7.13	11.59	0.15	0.01
EAS-US	2026-03-08 07:45:00	7.19	24.33	0.26	7.20	11.59	0.23	0.01
EAS-US	2026-03-08 08:00:00	7.14	24.04	0.31	7.17	11.61	0.22	0.01
EAS-US	2026-03-08 08:15:00	7.08	23.66	0.31	7.18	11.65	0.00	0.01
EAS-US	2026-03-08 08:30:00	7.03	23.32	0.31	7.15	11.67	0.23	0.01
EAS-US	2026-03-08 08:45:00	6.98	22.91	0.28	7.16	11.68	0.29	0.01
EAS-US	2026-03-08 09:00:00	6.95	22.52	0.35	7.11	11.71	2.65	0.01
EAS-US	2026-03-08 09:15:00	6.94	22.20	0.36	7.11	11.74	0.00	0.01
EAS-US	2026-03-08 09:30:00	6.95	21.92	0.36	7.11	11.72	0.00	0.01
EAS-US	2026-03-08 09:45:00	7.00	21.67	0.30	7.04	11.71	0.00	0.01
EAS-US	2026-03-08 10:00:00	7.06	21.42	0.35	7.05	11.72	0.00	0.01
EAS-US	2026-03-08 10:15:00	7.10	21.16	0.35	7.09	11.71	8.24	0.01
EAS-US	2026-03-08 10:30:00	7.12	20.93	0.36	7.03	11.70	0.08	0.01
EAS-US	2026-03-08 10:45:00	7.17	20.64	0.30	7.01	11.69	0.00	0.01
EAS-US	2026-03-08 11:00:00	7.21	20.39	0.35	7.02	11.68	0.88	0.01
EAS-US	2026-03-08 11:15:00	7.23	20.18	0.36	7.09	11.66	0.00	0.01
EAS-US	2026-03-08 11:30:00	7.29	19.94	0.36	7.06	11.68	0.00	0.01
EAS-US	2026-03-08 11:45:00	7.31	19.73	0.31	7.01	11.63	0.00	0.01
EAS-US	2026-03-08 12:00:00	7.36	19.55	0.35	7.00	11.65	0.00	0.01
EAS-US	2026-03-08 12:15:00	7.38	19.42	0.36	7.00	11.63	0.00	0.01
EAS-US	2026-03-08 12:30:00	7.45	19.24	0.36	6.99	11.62	0.00	0.01
EAS-US	2026-03-08 12:45:00	7.50	19.10	0.29	7.08	11.57	1.67	0.01
EAS-US	2026-03-08 13:00:00	7.54	19.00	0.35	7.04	11.55	0.00	0.01
EAS-US	2026-03-08 13:15:00	7.49	18.90	0.36	7.03	11.57	0.00	0.01
EAS-US	2026-03-08 13:30:00	7.60	18.76	0.37	6.97	11.55	0.00	0.01
EAS-US	2026-03-08 13:45:00	7.64	18.67	0.31	6.94	11.53	0.00	0.01
EAS-US	2026-03-08 14:00:00	7.63	18.60	0.36	6.97	11.53	0.82	0.01
EAS-US	2026-03-08 14:15:00	7.56	18.34	0.36	6.96	11.52	0.00	0.01
EAS-US	2026-03-08 14:30:00	7.53	18.45	0.37	6.92	11.54	0.00	0.01
EAS-US	2026-03-08 14:45:00	7.52	18.38	0.30	7.02	11.54	0.00	0.01
EAS-US	2026-03-08 15:00:00	7.50	18.29	0.35	7.01	11.53	0.00	0.01
EAS-US	2026-03-08 15:15:00	7.48	18.30	0.36	7.04	11.53	0.39	0.01
EAS-US	2026-03-08 15:30:00	7.46	18.22	0.37	6.98	11.54	0.00	0.01
EAS-US	2026-03-08 15:45:00	7.43	18.20	0.31	6.93	11.54	0.00	0.01
EAS-US	2026-03-08 16:00:00	7.44	18.17	0.36	6.91	11.53	0.00	0.01
EAS-US	2026-03-08 16:15:00	7.42	18.16	0.37	6.88	11.53	0.35	0.01
EAS-US	2026-03-08 16:30:00	7.41	18.13	0.37	6.92	11.54	0.00	0.01
EAS-US	2026-03-08 16:45:00	7.39	18.13	0.30	6.95	11.52	0.00	0.01
EAS-US	2026-03-08 17:00:00	7.34	18.10	0.36	6.98	11.55	0.00	0.01
EAS-US	2026-03-08 17:15:00	7.31	18.10	0.37	6.97	11.56	0.00	0.01
EAS-US	2026-03-08 17:30:00	7.25	18.07	0.37	6.99	11.57	0.00	0.01
EAS-US	2026-03-08 17:45:00	7.20	18.09	0.32	6.89	11.58	0.00	0.01
EAS-US	2026-03-08 18:00:00	7.17	18.09	0.36	6.89	11.59	0.00	0.01
EAS-US	2026-03-08 18:15:00	7.11	18.07	0.37	6.81	11.60	0.79	0.01
EAS-US	2026-03-08 18:30:00	7.11	18.09	0.37	6.86	11.59	0.00	0.01
EAS-US	2026-03-08 18:45:00	7.06	18.11	0.30	7.00	11.59	0.00	0.01
EAS-US	2026-03-08 19:00:00	7.04	18.11	0.36	6.99	11.60	0.00	0.01
EAS-US	2026-03-08 19:15:00	6.97	18.12	0.37	6.96	11.61	0.00	0.01
EAS-US	2026-03-08 19:30:00	6.89	18.23	0.37	6.99	11.64	0.00	0.01
EAS-US	2026-03-08 19:45:00	6.83	18.28	0.32	6.90	11.65	0.00	0.01

**Woodfibre LNG (East Creek) □**

<b>Station</b>	<b>Date/Time</b>	<b>Temperature (C)</b>	<b>Specific Conductivity (µS/cm)</b>	<b>ORP (V)</b>	<b>pH (pH units)</b>	<b>Dissolved Oxygen (mg/L)</b>	<b>Turbidity (NTU)</b>	<b>Salinity (PSU)</b>
EAS-US	2026-03-08 20:00:00	6.78	18.22	0.36	6.90	11.67	0.00	0.01
EAS-US	2026-03-08 20:15:00	6.75	18.21	0.37	6.89	11.66	0.00	0.01
EAS-US	2026-03-08 20:30:00	6.72	18.16	0.37	6.89	11.70	0.00	0.01
EAS-US	2026-03-08 20:45:00	6.68	18.21	0.31	6.94	11.69	0.00	0.01
EAS-US	2026-03-08 21:00:00	6.66	18.23	0.36	6.95	11.69	0.00	0.01
EAS-US	2026-03-08 21:15:00	6.66	18.21	0.37	6.99	11.69	0.00	0.01
EAS-US	2026-03-08 21:30:00	6.63	18.23	0.37	6.99	11.71	0.00	0.01
EAS-US	2026-03-08 21:45:00	6.61	18.23	0.32	6.89	11.71	0.00	0.01
EAS-US	2026-03-08 22:00:00	6.59	18.24	0.37	6.88	11.74	0.00	0.01
EAS-US	2026-03-08 22:15:00	6.56	18.25	0.37	6.91	11.73	0.00	0.01
EAS-US	2026-03-08 22:30:00	6.53	18.35	0.37	6.91	11.74	0.00	0.01
EAS-US	2026-03-08 22:45:00	6.50	18.33	0.31	7.04	11.74	0.00	0.01
EAS-US	2026-03-08 23:00:00	6.47	18.27	0.36	6.96	11.76	0.00	0.01
EAS-US	2026-03-08 23:15:00	6.44	18.24	0.37	6.99	11.77	0.00	0.01
EAS-US	2026-03-08 23:30:00	6.39	18.23	0.38	6.96	11.79	0.00	0.01
EAS-US	2026-03-08 23:45:00	6.32	18.25	0.32	6.92	11.81	0.00	0.01

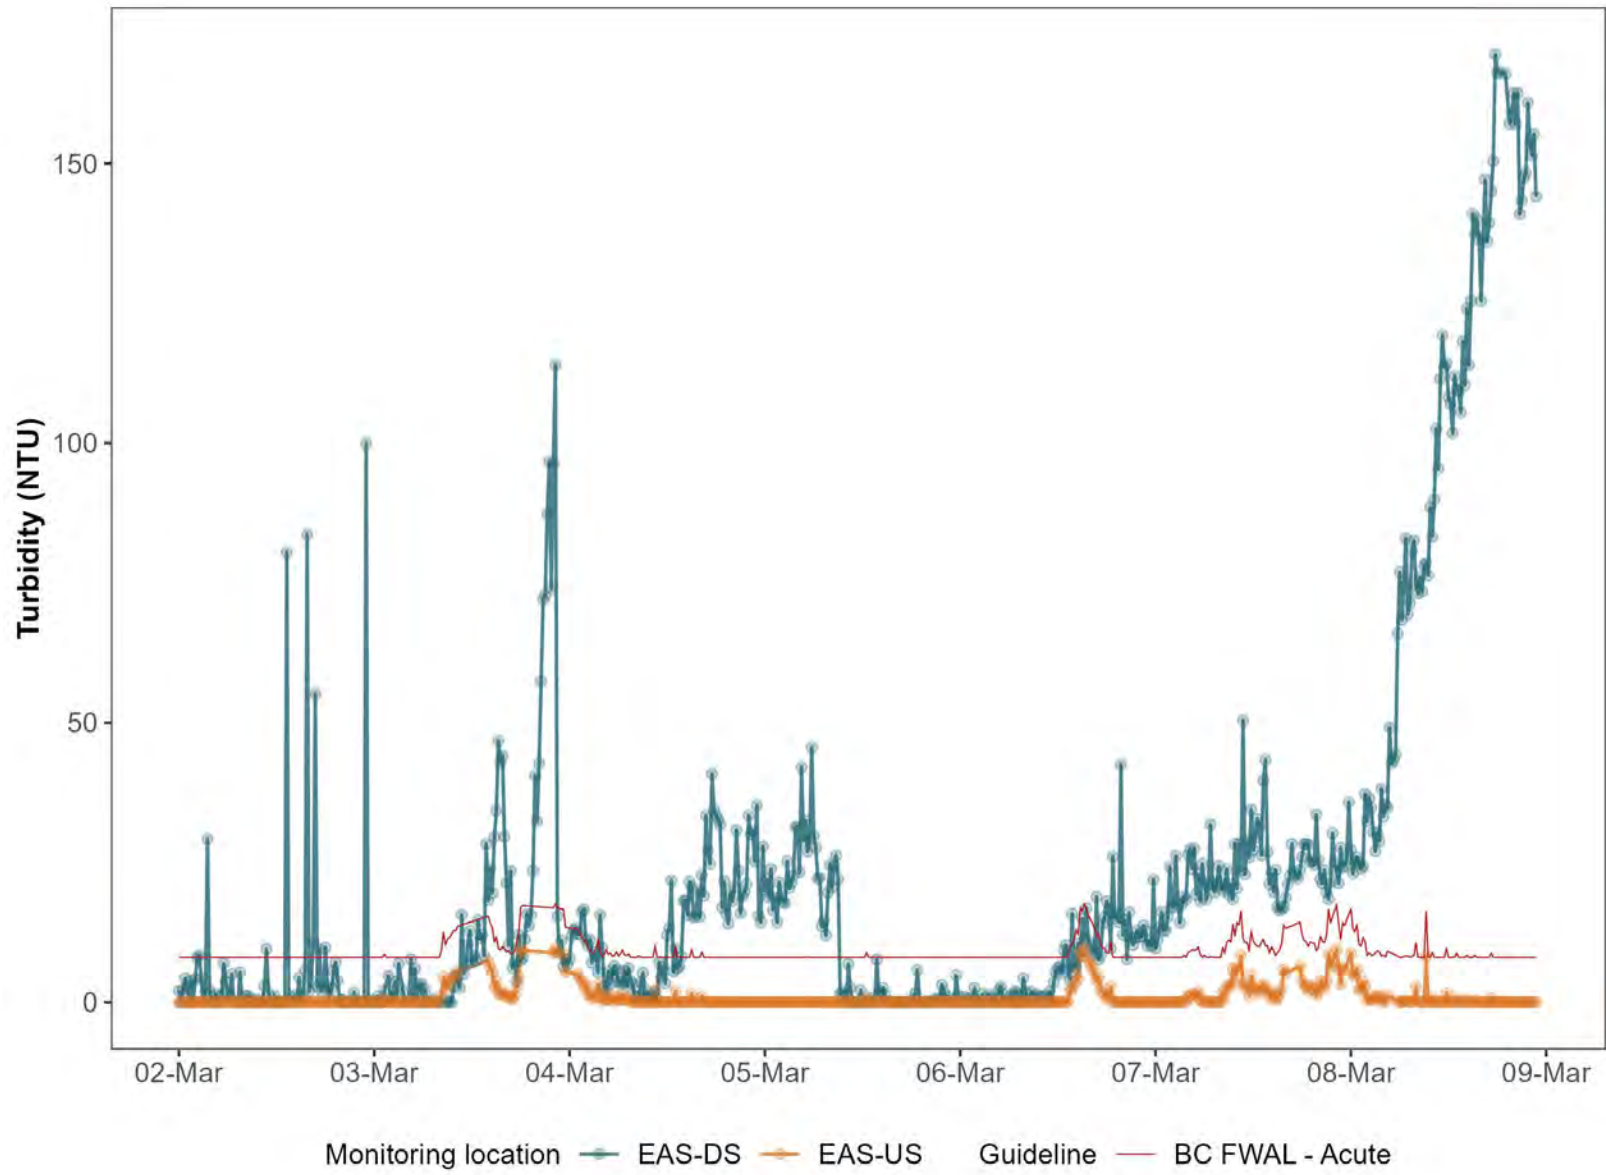



**Eagle Mountain – Woodfibre Gas Pipeline Project  
Waste Discharge Permit PE-110163 Report**

Reporting Week	Mar 2, 2026 to Mar 8, 2026
Report #	102
Appendix D	E-1

**Appendix E:  
Lab Documentation**

# Water Quality Field Data Sheet



Project: FORTIS11234

## Location Information

Site ID:	<u>WLNG (EAS) DS</u>	Date:	<u>March 3, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>8:40</u>
Site UTM:	Zone: 10U E: <u>482092</u>	Crew:	<u>JM</u>
(NAD83)	N: <u>5501875</u>	Weather:	<u>Rain</u>

## In Situ Parameters

pH:	<u>7.22</u>	DO:	<u>-</u> (mg/L)
Temp:	<u>8.3</u> (°C)	Cond:	<u>52</u> (uS/cm)
Turbidity:	<u>1.38</u> NTU	Salinity:	<u>-</u> (ppt)
Visible Sheen:	<u>N</u>	ORP:	<u>-</u> (mV)

Water Surface Condition: Clear

## Photo Record



## Observations

Significant sedimentation in downstream area

# Water Quality Field Data Sheet



Project: FORTIS11234

## Location Information

Site ID:	<u>WLNG (EAS) US</u>	Date:	<u>March 3, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>9:25</u>
Site UTM:	Zone:10U E: <u>481908</u>	Crew:	<u>JM</u>
(NAD83)	N: <u>5501909</u>	Weather:	<u>Partly sunny</u>

## In Situ Parameters

pH:	<u>6.95</u>	DO:	<u>-</u> (mg/L)
Temp.:	<u>6.3</u> (°C)	Cond:	<u>30</u> (uS/cm)
Turbidity:	<u>4.34</u> NTU	Salinity:	<u>-</u> (ppt)
Visible Sheen:	<u>N</u>	ORP:	<u>-</u> (mV)
Water Surface Condition:	<u>Clear</u>		

## Photo Record



## Observations



Your P.O. #: 4800010213  
 Your Project #: FORTIS11234/PE-110163  
 Site Location: WOODFIBRE PIPELINE PROJECT  
 Your C.O.C. #: 124417

**Attention: Saeesh Mangwani**

HATFIELD CONSULTANTS  
 N. VANCOUVER  
 200-850 Harbourside Dr  
 North Vancouver, BC  
 Canada V7P 0A3

**Report Date: 2026/03/10**  
 Report #: R3765016  
 Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C611322**

**Received: 2026/03/03, 13:55**

Sample Matrix: Water  
 # Samples Received: 5

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Alkalinity @25C (pp, total), CO3,HCO3,OH	5	N/A	2026/03/04	BBY6SOP-00026	SM 24 2320 B m
Chloride/Sulphate by Auto Colourimetry	5	N/A	2026/03/04	BBY6SOP-00011 / BBY6SOP-00017	SM24-4500-Cl/SO4-E m
Chromium III (Calc'd)	5	N/A	2026/03/05		
Total Hexavalent Chromium	5	N/A	2026/03/03	BBY6SOP-00054	SM 24 3500-Cr B m
Carbon (DOC) -Lab Filtered (2)	5	N/A	2026/03/05	BBY6SOP-00053	SM 24 5310 B m
Fluoride	5	N/A	2026/03/04	BBY6SOP-00037	SM 24 4500-F C m
Glycols in Water by GC/FID (1)	1	N/A	2026/03/06	CAL SOP-00093	BCMOE Glycols 09/17
Sulphide (as H2S) (1)	5	N/A	2026/03/06		Auto Calc
Un-ionized Hydrogen Sulphide as S Calc	3	N/A	2026/03/06	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO3) (3)	5	N/A	2026/03/05	BBY WI-00033	Auto Calc
Hardness (calculated as CaCO3)	5	N/A	2026/03/04	BBY WI-00033	Auto Calc
Mercury (Dissolved) by CV-Lab Filtered	5	2026/03/09	2026/03/09	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Mercury (Total) by CV	5	2026/03/04	2026/03/04	BBY7SOP-00032	BCMOE LM 2023 C1.1.3
Bromide as Bromine (Br) by ICPMS	5	N/A	2026/03/10	BBY7SOP-00002	EPA 6020B R2 m
Na, K, Ca, Mg, S by CRC ICPMS (diss.)	5	N/A	2026/03/04	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (lab filter) (4)	5	N/A	2026/03/04	BBY7SOP-00002	EPA 6020b R2 m
Na, K, Ca, Mg, S by CRC ICPMS (total)	5	N/A	2026/03/05	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (total)	5	N/A	2026/03/04	BBY7SOP-00002	EPA 6020b R2 m
Nitrogen (Total)	5	N/A	2026/03/06	BBY6SOP-00016	SM 24 4500-N C m
Ammonia-N (Total)	5	N/A	2026/03/04	AB SOP-00007	SM 24 4500 NH3 A G m
Nitrate + Nitrite (N)	5	N/A	2026/03/04	BBY6SOP-00010	SM 24 4500-NO3- H m
Nitrite (N) Regular Level Water	5	N/A	2026/03/04	BBY6SOP-00010	SM 24 4500-NO2- m
Nitrogen - Nitrate (as N)	5	N/A	2026/03/04	BBY WI-00033	Auto Calc
pH @25°C (5)	5	N/A	2026/03/04	BBY6SOP-00026	SM 24 4500-H+ B m
Phenols (4-AAP) (1)	1	N/A	2026/03/06	AB SOP-00088	EPA 9066 R0 m
Total Sulphide (1)	5	2026/03/05	2026/03/06	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Dissolved Solids (Filt. Residue)	5	2026/03/04	2026/03/05	BBY6SOP-00033	SM 24 2540 C m
Carbon (Total Organic) (6)	5	N/A	2026/03/04	BBY6SOP-00053	SM 24 5310 B m
Total Phosphorus Low Level Total	5	2026/03/04	2026/03/05	BBY6SOP-00013	SM 24 4500-P E m
Total Suspended Solids (NFR)	5	2026/03/04	2026/03/05	BBY6SOP-00034	SM 24 2540 D m



Your P.O. #: 4800010213  
 Your Project #: FORTIS11234/PE-110163  
 Site Location: WOODFIBRE PIPELINE PROJECT  
 Your C.O.C. #: 124417

**Attention: Saeesh Mangwani**

HATFIELD CONSULTANTS  
 N. VANCOUVER  
 200-850 Harbourside Dr  
 North Vancouver, BC  
 Canada V7P 0A3

**Report Date: 2026/03/10**  
 Report #: R3765016  
 Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C611322**

**Received: 2026/03/03, 13:55**

Sample Matrix: Water  
 # Samples Received: 5

Analyses	Quantity	Date	Date	Laboratory Method	Analytical Method
		Extracted	Analyzed		
Field pH	3	N/A	2026/03/04	Field Test	Field Test
Field Temperature	3	N/A	2026/03/04	Field Test	Field Test
VOCs, VH, F1, LH in Water by HS GC/MS	1	N/A	2026/03/07	BBY8SOP-00009 / BBY8SOP-00011 / BBY8SOP-00012	BCMOE BCLM Jul2017 m
Volatile HC-BTEX (7)	1	N/A	2026/03/08	BBY WI-00033	Auto Calc

**Remarks:**

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, EPA, APHA or the Quebec Ministry of Environment.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

\* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

(1) This test was performed by Bureau Veritas Calgary, 4000 - 19 St. , Calgary, AB, T2E 6P8

(2) DOC present in the sample should be considered as non-purgeable DOC. Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.

(3) "Total Hardness" was calculated from Total Ca and Mg concentrations and may be biased high (Hardness, or Dissolved Hardness, calculated from Dissolved Ca and Mg, should be used for compliance if available).

(4) Samples were filtered and preserved at the lab. Values may not reflect concentrations at the time of sampling.



Your P.O. #: 4800010213  
Your Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your C.O.C. #: 124417

**Attention: Saeesh Mangwani**

HATFIELD CONSULTANTS  
N. VANCOUVER  
200-850 Harbourside Dr  
North Vancouver, BC  
Canada V7P 0A3

**Report Date: 2026/03/10**  
Report #: R3765016  
Version: 1 - Final

**CERTIFICATE OF ANALYSIS**

**BUREAU VERITAS JOB #: C611322**

**Received: 2026/03/03, 13:55**

- For Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (5) The CCME method requires pH to be analysed within 15 minutes of sampling and therefore field analysis is required for compliance. All Laboratory pH analyses in this report are reported past the CCME holding time. Bureau Veritas endeavours to analyze samples as soon as possible after receipt.
- (6) TOC present in the sample should be considered as non-purgeable TOC.
- (7) VPH = VH - (Benzene + Toluene + Ethylbenzene + m & p-Xylene + o-Xylene + Styrene)

**Encryption Key**

Please direct all questions regarding this Certificate of Analysis to:  
Levi Manchak, Project Manager SR  
Email: Levi.MANCHAK@bureauveritas.com  
Phone# (780)862-5634

=====

This report has been generated and distributed using a secure automated process. Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



**RESULTS OF CHEMICAL ANALYSES OF WATER**

Bureau Veritas ID		EBO571			EBO571			EBO572		
Sampling Date		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
COC Number		124417			124417			124417		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
<b>ANIONS</b>										
Nitrite (N)	mg/L	ND	0.0050	C238974	ND	0.0050	C238974	0.0096	0.0050	C238974
<b>Calculated Parameters</b>										
Total Chromium III	mg/L	ND	0.00099	C238442				ND	0.00099	C238442
Dissolved Hardness (CaCO3)	mg/L	8.65	0.50	C237888				65.0	0.50	C237888
Total Hardness (CaCO3)	mg/L	8.62	0.50	C237755				63.1	0.50	C237755
Nitrate (N)	mg/L	ND	0.020	C237759				0.091	0.020	C237759
Sulphide (as H2S)	mg/L	ND	0.0020	C237620				ND	0.0020	C237620
<b>Field Parameters</b>										
Field pH	pH	7.22	N/A	ONSITE				6.11	N/A	ONSITE
Field Temperature	°C	8.3	N/A	ONSITE				10.3	N/A	ONSITE
<b>Misc. Inorganics</b>										
pH	pH	6.28	N/A	C238990	6.22	N/A	C238990	7.07	N/A	C238990
Total Organic Carbon (C)	mg/L	2.2	0.50	C239122				1.4	0.50	C239122
Total Dissolved Solids	mg/L	ND	10	C239298				76	10	C239298
Total Suspended Solids	mg/L	1.2	1.0	C239098				3.2	1.0	C239098
<b>Lab Filtered Inorganics</b>										
Dissolved Organic Carbon (C)	mg/L	2.0	0.50	C239643				1.0	0.50	C239643
<b>Anions</b>										
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C238942	ND	1.0	C238942	ND	1.0	C238942
Alkalinity (Total as CaCO3)	mg/L	7.5	1.0	C238942	7.4	1.0	C238942	53	1.0	C238942
Bicarbonate (HCO3)	mg/L	9.1	1.0	C238942	9.0	1.0	C238942	64	1.0	C238942
Carbonate (CO3)	mg/L	ND	1.0	C238942	ND	1.0	C238942	ND	1.0	C238942
Fluoride (F)	mg/L	ND	0.050	C239177	ND	0.050	C239177	0.32	0.050	C239177
Hydroxide (OH)	mg/L	ND	1.0	C238942	ND	1.0	C238942	ND	1.0	C238942
Total Sulphide	mg/L	ND	0.0018	C240460				ND	0.0018	C240460
Chloride (Cl)	mg/L	ND	1.0	C238966	ND	1.0	C238966	12	1.0	C238966
Sulphate (SO4)	mg/L	1.1	1.0	C238966	ND	1.0	C238966	13	1.0	C238966
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable										



**RESULTS OF CHEMICAL ANALYSES OF WATER**

Bureau Veritas ID		EBO571			EBO571			EBO572		
Sampling Date		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
COC Number		124417			124417			124417		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
<b>Metals</b>										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C237929				ND	0.00099	C237929
<b>Nutrients</b>										
Total Ammonia (N)	mg/L	ND	0.015	C239422				ND	0.015	C239422
Total Phosphorus (P)	mg/L	0.048	0.0010	C239380				0.0024	0.0010	C239380
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C238915	ND	0.020	C238915	0.100	0.020	C238915
Total Nitrogen (N)	mg/L	0.119	0.020	C239735				0.256	0.020	C239735
<b>Misc. Organics</b>										
Phenols	mg/L							ND	0.0015	C241233
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



**RESULTS OF CHEMICAL ANALYSES OF WATER**

<b>Bureau Veritas ID</b>		EBO572			EBO573			EBO573		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417		
	<b>UNITS</b>	<b>WLNG -EOP Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-US</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-US Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>

<b>ANIONS</b>										
Nitrite (N)	mg/L				ND	0.0050	C238974			
<b>Calculated Parameters</b>										
Total Chromium III	mg/L				ND	0.00099	C238442			
Dissolved Hardness (CaCO3)	mg/L				9.20	0.50	C237888			
Total Hardness (CaCO3)	mg/L				9.39	0.50	C237755			
Nitrate (N)	mg/L				0.023	0.020	C237759			
Sulphide (as H2S)	mg/L				ND	0.0020	C237620			
<b>Field Parameters</b>										
Field pH	pH				6.95	N/A	ONSITE			
Field Temperature	°C				6.3	N/A	ONSITE			
<b>Misc. Inorganics</b>										
pH	pH				6.35	N/A	C238990			
Total Organic Carbon (C)	mg/L				2.4	0.50	C239122			
Total Dissolved Solids	mg/L				12	10	C239298			
Total Suspended Solids	mg/L	3.2	1.0	C239098	1.6	1.0	C239098			
<b>Lab Filtered Inorganics</b>										
Dissolved Organic Carbon (C)	mg/L				1.9	0.50	C239643			
<b>Anions</b>										
Alkalinity (PP as CaCO3)	mg/L				ND	1.0	C238942			
Alkalinity (Total as CaCO3)	mg/L				8.0	1.0	C238942			
Bicarbonate (HCO3)	mg/L				9.8	1.0	C238942			
Carbonate (CO3)	mg/L				ND	1.0	C238942			
Fluoride (F)	mg/L				ND	0.050	C239177			
Hydroxide (OH)	mg/L				ND	1.0	C238942			
Total Sulphide	mg/L				ND	0.0018	C240460			
Chloride (Cl)	mg/L				ND	1.0	C238966			
Sulphate (SO4)	mg/L				ND	1.0	C238966			

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.  
 N/A = Not Applicable



**RESULTS OF CHEMICAL ANALYSES OF WATER**

<b>Bureau Veritas ID</b>		EBO572			EBO573			EBO573		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417		
	<b>UNITS</b>	<b>WLNG -EOP Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-US</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-US Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>

<b>Metals</b>										
Total Hex. Chromium (Cr 6+)	mg/L				ND	0.00099	C237929			
<b>Nutrients</b>										
Total Ammonia (N)	mg/L				ND	0.015	C239422			
Total Phosphorus (P)	mg/L				0.13	0.0010	C239390	0.12	0.0010	C239390
Nitrate plus Nitrite (N)	mg/L				0.023	0.020	C238915			
Total Nitrogen (N)	mg/L				0.139	0.020	C239735			

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



**RESULTS OF CHEMICAL ANALYSES OF WATER**

<b>Bureau Veritas ID</b>		EBO574			EBO574			EBO575		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417		
	<b>UNITS</b>	<b>Field Blank</b>	<b>RDL</b>	<b>QC Batch</b>	<b>Field Blank Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>Trip Blank</b>	<b>RDL</b>	<b>QC Batch</b>

<b>ANIONS</b>										
Nitrite (N)	mg/L	ND	0.0050	C238974				ND	0.0050	C238974
<b>Calculated Parameters</b>										
Total Chromium III	mg/L	ND	0.00099	C238442				ND	0.00099	C238442
Dissolved Hardness (CaCO3)	mg/L	ND	0.50	C237888				ND	0.50	C237888
Total Hardness (CaCO3)	mg/L	ND	0.50	C237755				ND	0.50	C237755
Nitrate (N)	mg/L	ND	0.020	C237759				ND	0.020	C237759
Sulphide (as H2S)	mg/L	ND	0.0020	C237620				ND	0.0020	C237620
<b>Misc. Inorganics</b>										
pH	pH	5.71	N/A	C238990				5.56	N/A	C238990
Total Organic Carbon (C)	mg/L	ND	0.50	C239122				ND	0.50	C239122
Total Dissolved Solids	mg/L	ND	10	C239298				ND	10	C239298
Total Suspended Solids	mg/L	ND	1.0	C239098				ND	1.0	C238798
<b>Lab Filtered Inorganics</b>										
Dissolved Organic Carbon (C)	mg/L	ND	0.50	C239643	ND	0.50	C239643	ND	0.50	C239643
<b>Anions</b>										
Alkalinity (PP as CaCO3)	mg/L	ND	1.0	C238942				ND	1.0	C238942
Alkalinity (Total as CaCO3)	mg/L	ND	1.0	C238942				ND	1.0	C238942
Bicarbonate (HCO3)	mg/L	ND	1.0	C238942				ND	1.0	C238942
Carbonate (CO3)	mg/L	ND	1.0	C238942				ND	1.0	C238942
Fluoride (F)	mg/L	ND	0.050	C239177				ND	0.050	C239177
Hydroxide (OH)	mg/L	ND	1.0	C238942				ND	1.0	C238942
Total Sulphide	mg/L	ND	0.0018	C240460				ND	0.0018	C240460
Chloride (Cl)	mg/L	ND	1.0	C238966				ND	1.0	C238966
Sulphate (SO4)	mg/L	ND	1.0	C238966				ND	1.0	C238966
<b>Metals</b>										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C237929				ND	0.00099	C237929

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.  
 N/A = Not Applicable



Bureau Veritas Job #: C611322  
 Report Date: 2026/03/10

HATFIELD CONSULTANTS  
 Client Project #: FORTIS11234/PE-110163  
 Site Location: WOODFIBRE PIPELINE PROJECT  
 Your P.O. #: 4800010213

**RESULTS OF CHEMICAL ANALYSES OF WATER**

<b>Bureau Veritas ID</b>		EBO574			EBO574			EBO575		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417		
	<b>UNITS</b>	<b>Field Blank</b>	<b>RDL</b>	<b>QC Batch</b>	<b>Field Blank Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>Trip Blank</b>	<b>RDL</b>	<b>QC Batch</b>

<b>Nutrients</b>										
Total Ammonia (N)	mg/L	ND	0.015	C239422				ND	0.015	C239422
Total Phosphorus (P)	mg/L	ND	0.0010	C239390				ND	0.0010	C239390
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C238915				ND	0.020	C238915
Total Nitrogen (N)	mg/L	ND	0.020	C239735				ND	0.020	C239735

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



Bureau Veritas Job #: C611322  
 Report Date: 2026/03/10

HATFIELD CONSULTANTS  
 Client Project #: FORTIS11234/PE-110163  
 Site Location: WOODFIBRE PIPELINE PROJECT  
 Your P.O. #: 4800010213

**GLYCOLS BY GC-FID (WATER)**

<b>Bureau Veritas ID</b>		EBO572		
<b>Sampling Date</b>		2026/03/03 09:30		
<b>COC Number</b>		124417		
	<b>UNITS</b>	<b>WLNG -EOP</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Glycols</b>				
Ethylene Glycol	mg/L	ND	3.0	C239638
Diethylene Glycol	mg/L	ND	5.0	C239638
Triethylene Glycol	mg/L	ND	5.0	C239638
Propylene Glycol	mg/L	ND	5.0	C239638
<b>Surrogate Recovery (%)</b>				
Methyl Sulfone (sur.)	%	92		C239638
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

**MERCURY BY COLD VAPOR (WATER)**

<b>Bureau Veritas ID</b>		EBO571			EBO571			EBO572	EBO573		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30	2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417	124417		
	<b>UNITS</b>	<b>WLNG-DS</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-DS Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG -EOP</b>	<b>WLNG-US</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Elements</b>											
Total Mercury (Hg)	ug/L	ND	0.0019	C238978				ND	ND	0.0019	C238978
<b>Lab Filtered Elements</b>											
Dissolved Mercury (Hg)	ug/L	0.0027	0.0019	C242641	ND	0.0019	C242641	ND	0.0023	0.0019	C242641
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											

<b>Bureau Veritas ID</b>		EBO574	EBO575		
<b>Sampling Date</b>		2026/03/03 09:30	2026/03/03 09:30		
<b>COC Number</b>		124417	124417		
	<b>UNITS</b>	<b>Field Blank</b>	<b>Trip Blank</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Elements</b>					
Total Mercury (Hg)	ug/L	ND	ND	0.0019	C238978
<b>Lab Filtered Elements</b>					
Dissolved Mercury (Hg)	ug/L	ND	ND	0.0019	C242641
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



BUREAU VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

<b>Bureau Veritas ID</b>		EBO571			EBO571			EBO572	EBO573		
<b>Sampling Date</b>		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30	2026/03/03 09:30		
<b>COC Number</b>		124417			124417			124417	124417		
	<b>UNITS</b>	<b>WLNG-DS</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG-DS Lab-Dup</b>	<b>RDL</b>	<b>QC Batch</b>	<b>WLNG -EOP</b>	<b>WLNG-US</b>	<b>RDL</b>	<b>QC Batch</b>

<b>ANIONS</b>											
Bromide (Br)	mg/L	ND	0.010	C242621	ND	0.010	C242621	ND	ND	0.010	C242621
<b>Dissolved Metals by ICPMS</b>											
Dissolved Calcium (Ca)	mg/L	2.94	0.050	C238459				24.4	2.93	0.050	C238459
Dissolved Magnesium (Mg)	mg/L	0.320	0.050	C238459				0.951	0.458	0.050	C238459
Dissolved Potassium (K)	mg/L	0.242	0.050	C238459				1.32	0.310	0.050	C238459
Dissolved Sodium (Na)	mg/L	1.25	0.050	C238459				5.83	1.26	0.050	C238459
Dissolved Sulphur (S)	mg/L	ND	3.0	C238459				3.8	ND	3.0	C238459
<b>Lab Filtered Metals</b>											
Dissolved Aluminum (Al)	ug/L	56.0	0.50	C238773				89.1	62.7	0.50	C238773
Dissolved Antimony (Sb)	ug/L	0.041	0.020	C238773				0.272	0.058	0.020	C238773
Dissolved Arsenic (As)	ug/L	0.189	0.020	C238773				0.905	0.301	0.020	C238773
Dissolved Barium (Ba)	ug/L	3.13	0.020	C238773				6.46	3.01	0.020	C238773
Dissolved Beryllium (Be)	ug/L	ND	0.010	C238773				ND	ND	0.010	C238773
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C238773				ND	ND	0.0050	C238773
Dissolved Boron (B)	ug/L	ND	10	C238773				13	ND	10	C238773
Dissolved Cadmium (Cd)	ug/L	0.0058	0.0050	C238773				0.0058	0.0097	0.0050	C238773
Dissolved Cesium (Cs)	ug/L	ND	0.050	C238773				0.057	ND	0.050	C238773
Dissolved Chromium (Cr)	ug/L	0.14	0.10	C238773				0.41	0.11	0.10	C238773
Dissolved Cobalt (Co)	ug/L	0.0416	0.0050	C238773				0.0253	0.0433	0.0050	C238773
Dissolved Copper (Cu)	ug/L	0.910	0.050	C238773				0.412	1.43	0.050	C238773
Dissolved Iron (Fe)	ug/L	20.9	1.0	C238773				1.9	21.4	1.0	C238773
Dissolved Lead (Pb)	ug/L	0.0090	0.0050	C238773				ND	0.0137	0.0050	C238773
Dissolved Lithium (Li)	ug/L	ND	0.50	C238773				3.34	ND	0.50	C238773
Dissolved Manganese (Mn)	ug/L	3.36	0.050	C238773				15.0	0.967	0.050	C238773
Dissolved Molybdenum (Mo)	ug/L	1.17	0.050	C238773				31.6	0.602	0.050	C238773
Dissolved Nickel (Ni)	ug/L	0.406	0.020	C238773				0.159	0.390	0.020	C238773
Dissolved Phosphorus (P)	ug/L	42.7	2.0	C238773				4.6	140	2.0	C238773
Dissolved Rubidium (Rb)	ug/L	0.363	0.050	C238773				3.02	0.321	0.050	C238773
Dissolved Selenium (Se)	ug/L	ND	0.040	C238773				ND	0.050	0.040	C238773
Dissolved Silicon (Si)	ug/L	3430	50	C238773				6620	3430	50	C238773

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBO571			EBO571			EBO572	EBO573		
Sampling Date		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30	2026/03/03 09:30		
COC Number		124417			124417			124417	124417		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	WLNG-US	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	0.0050	C238773				ND	ND	0.0050	C238773
Dissolved Strontium (Sr)	ug/L	10.3	0.050	C238773				49.6	10.6	0.050	C238773
Dissolved Tellurium (Te)	ug/L	ND	0.020	C238773				ND	ND	0.020	C238773
Dissolved Thallium (Tl)	ug/L	0.0022	0.0020	C238773				0.0069	0.0020	0.0020	C238773
Dissolved Thorium (Th)	ug/L	0.0173	0.0050	C238773				0.0117	0.0163	0.0050	C238773
Dissolved Tin (Sn)	ug/L	ND	0.20	C238773				ND	ND	0.20	C238773
Dissolved Titanium (Ti)	ug/L	ND	0.50	C238773				ND	ND	0.50	C238773
Dissolved Uranium (U)	ug/L	0.115	0.0020	C238773				1.20	0.0992	0.0020	C238773
Dissolved Vanadium (V)	ug/L	ND	0.20	C238773				0.27	ND	0.20	C238773
Dissolved Zinc (Zn)	ug/L	1.75	0.10	C238773				1.72	1.30	0.10	C238773
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C238773				ND	ND	0.10	C238773
<b>Total Metals by ICPMS</b>											
Total Aluminum (Al)	ug/L	115	0.50	C239094				324	258	0.50	C239094
Total Antimony (Sb)	ug/L	0.045	0.020	C239094				0.314	0.058	0.020	C239094
Total Arsenic (As)	ug/L	0.202	0.020	C239094				1.02	0.319	0.020	C239094
Total Barium (Ba)	ug/L	3.64	0.020	C239094				7.32	5.61	0.020	C239094
Total Beryllium (Be)	ug/L	ND	0.010	C239094				ND	ND	0.010	C239094
Total Bismuth (Bi)	ug/L	ND	0.0050	C239094				ND	ND	0.0050	C239094
Total Boron (B)	ug/L	ND	10	C239094				11	ND	10	C239094
Total Cadmium (Cd)	ug/L	0.0074	0.0050	C239094				ND	0.0084	0.0050	C239094
Total Cesium (Cs)	ug/L	ND	0.050	C239094				0.069	ND	0.050	C239094
Total Chromium (Cr)	ug/L	0.11	0.10	C239094				0.44	0.15	0.10	C239094
Total Cobalt (Co)	ug/L	0.0483	0.0050	C239094				0.0370	0.0919	0.0050	C239094
Total Copper (Cu)	ug/L	0.959	0.050	C239094				0.736	1.54	0.050	C239094
Total Iron (Fe)	ug/L	62.7	1.0	C239094				99.0	161	1.0	C239094
Total Lead (Pb)	ug/L	0.0280	0.0050	C239094				0.0754	0.0937	0.0050	C239094
Total Lithium (Li)	ug/L	ND	0.50	C239094				3.47	ND	0.50	C239094
Total Manganese (Mn)	ug/L	4.71	0.050	C239094				16.6	7.29	0.050	C239094
Total Molybdenum (Mo)	ug/L	1.19	0.050	C239094				31.7	0.603	0.050	C239094
Total Nickel (Ni)	ug/L	0.407	0.020	C239094				0.169	0.431	0.020	C239094
Total Phosphorus (P)	ug/L	45.5	2.0	C239094				4.5	144	2.0	C239094
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EBO571			EBO571			EBO572	EBO573		
Sampling Date		2026/03/03 09:30			2026/03/03 09:30			2026/03/03 09:30	2026/03/03 09:30		
COC Number		124417			124417			124417	124417		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	WLNG-US	RDL	QC Batch
Total Rubidium (Rb)	ug/L	0.430	0.050	C239094				3.27	0.525	0.050	C239094
Total Selenium (Se)	ug/L	ND	0.040	C239094				0.048	ND	0.040	C239094
Total Silicon (Si)	ug/L	3530	50	C239094				6730	3920	50	C239094
Total Silver (Ag)	ug/L	ND	0.0050	C239094				ND	ND	0.0050	C239094
Total Strontium (Sr)	ug/L	11.3	0.050	C239094				54.1	12.1	0.050	C239094
Total Tellurium (Te)	ug/L	ND	0.020	C239094				ND	ND	0.020	C239094
Total Thallium (Tl)	ug/L	0.0025	0.0020	C239094				0.0079	0.0032	0.0020	C239094
Total Thorium (Th)	ug/L	ND	0.050	C239094				ND	ND	0.050	C239094
Total Tin (Sn)	ug/L	ND	0.20	C239094				ND	ND	0.20	C239094
Total Titanium (Ti)	ug/L	1.70	0.50	C239094				2.54	8.62	0.50	C239094
Total Uranium (U)	ug/L	0.115	0.0020	C239094				1.13	0.103	0.0020	C239094
Total Vanadium (V)	ug/L	0.21	0.20	C239094				0.31	0.40	0.20	C239094
Total Zinc (Zn)	ug/L	1.97	0.10	C239094				2.55	2.67	0.10	C239094
Total Zirconium (Zr)	ug/L	ND	0.10	C239094				ND	ND	0.10	C239094
Total Calcium (Ca)	mg/L	2.91	0.050	C238461				23.6	2.95	0.050	C238461
Total Magnesium (Mg)	mg/L	0.330	0.050	C238461				1.01	0.494	0.050	C238461
Total Potassium (K)	mg/L	0.257	0.050	C238461				1.40	0.345	0.050	C238461
Total Sodium (Na)	mg/L	1.27	0.050	C238461				6.16	1.34	0.050	C238461
Total Sulphur (S)	mg/L	ND	3.0	C238461				4.3	ND	3.0	C238461

RDL = Reportable Detection Limit  
 Lab-Dup = Laboratory Initiated Duplicate  
 ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



**ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)**

Bureau Veritas ID		EBO574	EBO575		
Sampling Date		2026/03/03 09:30	2026/03/03 09:30		
COC Number		124417	124417		
	UNITS	Field Blank	Trip Blank	RDL	QC Batch
<b>ANIONS</b>					
Bromide (Br)	mg/L	ND	ND	0.010	C242621
<b>Dissolved Metals by ICPMS</b>					
Dissolved Calcium (Ca)	mg/L	ND	ND	0.050	C238459
Dissolved Magnesium (Mg)	mg/L	ND	ND	0.050	C238459
Dissolved Potassium (K)	mg/L	ND	ND	0.050	C238459
Dissolved Sodium (Na)	mg/L	ND	ND	0.050	C238459
Dissolved Sulphur (S)	mg/L	ND	ND	3.0	C238459
<b>Lab Filtered Metals</b>					
Dissolved Aluminum (Al)	ug/L	ND	ND	0.50	C238773
Dissolved Antimony (Sb)	ug/L	ND	ND	0.020	C238773
Dissolved Arsenic (As)	ug/L	ND	ND	0.020	C238773
Dissolved Barium (Ba)	ug/L	ND	ND	0.020	C238773
Dissolved Beryllium (Be)	ug/L	ND	ND	0.010	C238773
Dissolved Bismuth (Bi)	ug/L	ND	ND	0.0050	C238773
Dissolved Boron (B)	ug/L	ND	ND	10	C238773
Dissolved Cadmium (Cd)	ug/L	ND	ND	0.0050	C238773
Dissolved Cesium (Cs)	ug/L	ND	ND	0.050	C238773
Dissolved Chromium (Cr)	ug/L	ND	ND	0.10	C238773
Dissolved Cobalt (Co)	ug/L	ND	ND	0.0050	C238773
Dissolved Copper (Cu)	ug/L	ND	ND	0.050	C238773
Dissolved Iron (Fe)	ug/L	ND	ND	1.0	C238773
Dissolved Lead (Pb)	ug/L	ND	ND	0.0050	C238773
Dissolved Lithium (Li)	ug/L	ND	ND	0.50	C238773
Dissolved Manganese (Mn)	ug/L	ND	ND	0.050	C238773
Dissolved Molybdenum (Mo)	ug/L	ND	ND	0.050	C238773
Dissolved Nickel (Ni)	ug/L	ND	ND	0.020	C238773
Dissolved Phosphorus (P)	ug/L	3.8	ND	2.0	C238773
Dissolved Rubidium (Rb)	ug/L	ND	ND	0.050	C238773
Dissolved Selenium (Se)	ug/L	ND	ND	0.040	C238773
Dissolved Silicon (Si)	ug/L	ND	ND	50	C238773
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



**ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)**

Bureau Veritas ID		EBO574	EBO575		
Sampling Date		2026/03/03 09:30	2026/03/03 09:30		
COC Number		124417	124417		
	UNITS	Field Blank	Trip Blank	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	ND	0.0050	C238773
Dissolved Strontium (Sr)	ug/L	ND	ND	0.050	C238773
Dissolved Tellurium (Te)	ug/L	ND	ND	0.020	C238773
Dissolved Thallium (Tl)	ug/L	ND	ND	0.0020	C238773
Dissolved Thorium (Th)	ug/L	ND	ND	0.0050	C238773
Dissolved Tin (Sn)	ug/L	ND	ND	0.20	C238773
Dissolved Titanium (Ti)	ug/L	ND	ND	0.50	C238773
Dissolved Uranium (U)	ug/L	ND	ND	0.0020	C238773
Dissolved Vanadium (V)	ug/L	ND	ND	0.20	C238773
Dissolved Zinc (Zn)	ug/L	ND	ND	0.10	C238773
Dissolved Zirconium (Zr)	ug/L	ND	ND	0.10	C238773
<b>Total Metals by ICPMS</b>					
Total Aluminum (Al)	ug/L	ND	ND	0.50	C239094
Total Antimony (Sb)	ug/L	ND	ND	0.020	C239094
Total Arsenic (As)	ug/L	ND	ND	0.020	C239094
Total Barium (Ba)	ug/L	ND	ND	0.020	C239094
Total Beryllium (Be)	ug/L	ND	ND	0.010	C239094
Total Bismuth (Bi)	ug/L	ND	ND	0.0050	C239094
Total Boron (B)	ug/L	ND	ND	10	C239094
Total Cadmium (Cd)	ug/L	ND	ND	0.0050	C239094
Total Cesium (Cs)	ug/L	ND	ND	0.050	C239094
Total Chromium (Cr)	ug/L	ND	ND	0.10	C239094
Total Cobalt (Co)	ug/L	ND	ND	0.0050	C239094
Total Copper (Cu)	ug/L	ND	ND	0.050	C239094
Total Iron (Fe)	ug/L	ND	ND	1.0	C239094
Total Lead (Pb)	ug/L	ND	ND	0.0050	C239094
Total Lithium (Li)	ug/L	ND	ND	0.50	C239094
Total Manganese (Mn)	ug/L	ND	ND	0.050	C239094
Total Molybdenum (Mo)	ug/L	ND	ND	0.050	C239094
Total Nickel (Ni)	ug/L	ND	ND	0.020	C239094
Total Phosphorus (P)	ug/L	ND	ND	2.0	C239094
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



**ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)**

Bureau Veritas ID		EBO574	EBO575		
Sampling Date		2026/03/03 09:30	2026/03/03 09:30		
COC Number		124417	124417		
	UNITS	Field Blank	Trip Blank	RDL	QC Batch
Total Rubidium (Rb)	ug/L	ND	ND	0.050	C239094
Total Selenium (Se)	ug/L	ND	ND	0.040	C239094
Total Silicon (Si)	ug/L	ND	ND	50	C239094
Total Silver (Ag)	ug/L	ND	ND	0.0050	C239094
Total Strontium (Sr)	ug/L	ND	ND	0.050	C239094
Total Tellurium (Te)	ug/L	ND	ND	0.020	C239094
Total Thallium (Tl)	ug/L	ND	ND	0.0020	C239094
Total Thorium (Th)	ug/L	ND	ND	0.050	C239094
Total Tin (Sn)	ug/L	ND	ND	0.20	C239094
Total Titanium (Ti)	ug/L	ND	ND	0.50	C239094
Total Uranium (U)	ug/L	ND	ND	0.0020	C239094
Total Vanadium (V)	ug/L	ND	ND	0.20	C239094
Total Zinc (Zn)	ug/L	0.12	ND	0.10	C239094
Total Zirconium (Zr)	ug/L	ND	ND	0.10	C239094
Total Calcium (Ca)	mg/L	ND	ND	0.050	C238461
Total Magnesium (Mg)	mg/L	ND	ND	0.050	C238461
Total Potassium (K)	mg/L	ND	ND	0.050	C238461
Total Sodium (Na)	mg/L	ND	ND	0.050	C238461
Total Sulphur (S)	mg/L	ND	ND	3.0	C238461
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.					



Bureau Veritas Job #: C611322  
 Report Date: 2026/03/10

HATFIELD CONSULTANTS  
 Client Project #: FORTIS11234/PE-110163  
 Site Location: WOODFIBRE PIPELINE PROJECT  
 Your P.O. #: 4800010213

**MISCELLANEOUS (WATER)**

<b>Bureau Veritas ID</b>		EBO571	EBO572	EBO573		
<b>Sampling Date</b>		2026/03/03 09:30	2026/03/03 09:30	2026/03/03 09:30		
<b>COC Number</b>		124417	124417	124417		
	<b>UNITS</b>	<b>WLNG-DS</b>	<b>WLNG -EOP</b>	<b>WLNG-US</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Calculated Parameters</b>						
Total Un-ionized Hydrogen Sulfide as S	mg/L	ND	ND	ND	0.0018	C238456
Total Un-ionized Hydrogen Sulfide as H2S	mg/L	ND	ND	ND	0.0019	C238456
RDL = Reportable Detection Limit						
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.						



**CSR VOC + VPH IN WATER (WATER)**

<b>Bureau Veritas ID</b>		EBO572		
<b>Sampling Date</b>		2026/03/03 09:30		
<b>COC Number</b>		124417		
	<b>UNITS</b>	<b>WLNG -EOP</b>	<b>RDL</b>	<b>QC Batch</b>
<b>Calculated Parameters</b>				
VPH (VH6 to 10 - BTEX)	ug/L	ND	300	C238051
<b>Volatiles</b>				
VH C6-C10	ug/L	ND	300	C241066
1,1,1,2-tetrachloroethane	ug/L	ND	0.50	C241066
1,1,1-trichloroethane	ug/L	ND	0.50	C241066
1,1,2,2-tetrachloroethane	ug/L	ND	0.50	C241066
1,1,2Trichloro-1,2,2Trifluoroethane	ug/L	ND	2.0	C241066
1,1,2-trichloroethane	ug/L	ND	0.50	C241066
1,1-dichloroethane	ug/L	ND	0.50	C241066
1,1-dichloroethene	ug/L	ND	0.50	C241066
1,2,3-trichlorobenzene	ug/L	ND	2.0	C241066
1,2,4-trichlorobenzene	ug/L	ND	2.0	C241066
1,2-dibromoethane	ug/L	ND	0.20	C241066
1,2-dichlorobenzene	ug/L	ND	0.50	C241066
1,2-dichloroethane	ug/L	ND	0.50	C241066
1,2-dichloropropane	ug/L	ND	0.50	C241066
1,3,5-trimethylbenzene	ug/L	ND	2.0	C241066
1,3-Butadiene	ug/L	ND	0.50	C241066
1,3-dichlorobenzene	ug/L	ND	0.50	C241066
1,3-dichloropropane	ug/L	ND	1.0	C241066
1,4-dichlorobenzene	ug/L	ND	0.50	C241066
Benzene	ug/L	ND	0.40	C241066
Bromobenzene	ug/L	ND	2.0	C241066
Bromodichloromethane	ug/L	ND	1.0	C241066
Bromoform	ug/L	ND	1.0	C241066
Bromomethane	ug/L	ND	1.0	C241066
Carbon tetrachloride	ug/L	ND	0.50	C241066
Chlorobenzene	ug/L	ND	0.50	C241066
Dibromochloromethane	ug/L	ND	1.0	C241066
Chloroethane	ug/L	ND	1.0	C241066
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



**CSR VOC + VPH IN WATER (WATER)**

Bureau Veritas ID		EBO572		
Sampling Date		2026/03/03 09:30		
COC Number		124417		
	UNITS	WLNG -EOP	RDL	QC Batch
Chloroform	ug/L	ND	1.0	C241066
Chloromethane	ug/L	ND	1.0	C241066
cis-1,2-dichloroethene	ug/L	ND	1.0	C241066
cis-1,3-dichloropropene	ug/L	ND	1.0	C241066
Dichlorodifluoromethane	ug/L	ND	2.0	C241066
Dichloromethane	ug/L	ND	2.0	C241066
Ethylbenzene	ug/L	ND	0.40	C241066
Hexachlorobutadiene	ug/L	ND	0.50	C241066
Isopropylbenzene	ug/L	ND	2.0	C241066
Methyl-tert-butylether (MTBE)	ug/L	ND	4.0	C241066
Styrene	ug/L	ND	0.50	C241066
Tetrachloroethene	ug/L	ND	0.50	C241066
Toluene	ug/L	ND	0.40	C241066
trans-1,2-dichloroethene	ug/L	ND	1.0	C241066
trans-1,3-dichloropropene	ug/L	ND	1.0	C241066
Trichloroethene	ug/L	ND	0.50	C241066
Trichlorofluoromethane	ug/L	ND	4.0	C241066
Vinyl chloride	ug/L	ND	0.50	C241066
m & p-Xylene	ug/L	ND	0.40	C241066
o-Xylene	ug/L	ND	0.40	C241066
Xylenes (Total)	ug/L	ND	0.40	C241066
<b>Surrogate Recovery (%)</b>				
1,4-Difluorobenzene (sur.)	%	102		C241066
4-Bromofluorobenzene (sur.)	%	90		C241066
D4-1,2-Dichloroethane (sur.)	%	95		C241066
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



**BUREAU  
VERITAS**

Bureau Veritas Job #: C611322

Report Date: 2026/03/10

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE-110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

## GENERAL COMMENTS

Results relate only to the items tested.



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### QUALITY ASSURANCE REPORT

QA/QC	Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
	C237929	JLP	Matrix Spike	Total Hex. Chromium (Cr 6+)	2026/03/03		108	%	80 - 120
	C237929	JLP	Spiked Blank	Total Hex. Chromium (Cr 6+)	2026/03/03		104	%	80 - 120
	C237929	JLP	Method Blank	Total Hex. Chromium (Cr 6+)	2026/03/03	ND, RDL=0.00099		mg/L	
	C237929	JLP	RPD	Total Hex. Chromium (Cr 6+)	2026/03/03	NC		%	20
	C238773	AA1	Matrix Spike	Dissolved Aluminum (Al)	2026/03/04		92	%	80 - 120
				Dissolved Antimony (Sb)	2026/03/04		NC	%	80 - 120
				Dissolved Arsenic (As)	2026/03/04		96	%	80 - 120
				Dissolved Barium (Ba)	2026/03/04		89	%	80 - 120
				Dissolved Beryllium (Be)	2026/03/04		96	%	80 - 120
				Dissolved Bismuth (Bi)	2026/03/04		90	%	80 - 120
				Dissolved Boron (B)	2026/03/04		99	%	80 - 120
				Dissolved Cadmium (Cd)	2026/03/04		93	%	80 - 120
				Dissolved Cesium (Cs)	2026/03/04		87	%	80 - 120
				Dissolved Chromium (Cr)	2026/03/04		87	%	80 - 120
				Dissolved Cobalt (Co)	2026/03/04		86	%	80 - 120
				Dissolved Copper (Cu)	2026/03/04		84	%	80 - 120
				Dissolved Iron (Fe)	2026/03/04		96	%	80 - 120
				Dissolved Lead (Pb)	2026/03/04		86	%	80 - 120
				Dissolved Lithium (Li)	2026/03/04		91	%	80 - 120
				Dissolved Manganese (Mn)	2026/03/04		NC	%	80 - 120
				Dissolved Molybdenum (Mo)	2026/03/04		100	%	80 - 120
				Dissolved Nickel (Ni)	2026/03/04		NC	%	80 - 120
				Dissolved Phosphorus (P)	2026/03/04		96	%	80 - 120
				Dissolved Rubidium (Rb)	2026/03/04		NC	%	80 - 120
				Dissolved Selenium (Se)	2026/03/04		99	%	80 - 120
				Dissolved Silicon (Si)	2026/03/04		93	%	80 - 120
				Dissolved Silver (Ag)	2026/03/04		91	%	80 - 120
				Dissolved Strontium (Sr)	2026/03/04		NC	%	80 - 120
				Dissolved Tellurium (Te)	2026/03/04		98	%	80 - 120
				Dissolved Thallium (Tl)	2026/03/04		93	%	80 - 120
				Dissolved Thorium (Th)	2026/03/04		102	%	80 - 120
				Dissolved Tin (Sn)	2026/03/04		96	%	80 - 120
				Dissolved Titanium (Ti)	2026/03/04		92	%	80 - 120
				Dissolved Uranium (U)	2026/03/04		112	%	80 - 120
				Dissolved Vanadium (V)	2026/03/04		90	%	80 - 120
				Dissolved Zinc (Zn)	2026/03/04		NC	%	80 - 120
				Dissolved Zirconium (Zr)	2026/03/04		98	%	80 - 120
	C238773	AA1	Spiked Blank	Dissolved Aluminum (Al)	2026/03/04		99	%	80 - 120
				Dissolved Antimony (Sb)	2026/03/04		103	%	80 - 120
				Dissolved Arsenic (As)	2026/03/04		99	%	80 - 120
				Dissolved Barium (Ba)	2026/03/04		95	%	80 - 120
				Dissolved Beryllium (Be)	2026/03/04		101	%	80 - 120
				Dissolved Bismuth (Bi)	2026/03/04		99	%	80 - 120
				Dissolved Boron (B)	2026/03/04		102	%	80 - 120
				Dissolved Cadmium (Cd)	2026/03/04		100	%	80 - 120
				Dissolved Cesium (Cs)	2026/03/04		93	%	80 - 120
				Dissolved Chromium (Cr)	2026/03/04		93	%	80 - 120
				Dissolved Cobalt (Co)	2026/03/04		93	%	80 - 120
				Dissolved Copper (Cu)	2026/03/04		93	%	80 - 120
				Dissolved Iron (Fe)	2026/03/04		106	%	80 - 120
				Dissolved Lead (Pb)	2026/03/04		96	%	80 - 120
				Dissolved Lithium (Li)	2026/03/04		95	%	80 - 120



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Manganese (Mn)	2026/03/04		97	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/03/04		107	%	80 - 120
			Dissolved Nickel (Ni)	2026/03/04		97	%	80 - 120
			Dissolved Phosphorus (P)	2026/03/04		99	%	80 - 120
			Dissolved Rubidium (Rb)	2026/03/04		99	%	80 - 120
			Dissolved Selenium (Se)	2026/03/04		103	%	80 - 120
			Dissolved Silicon (Si)	2026/03/04		108	%	80 - 120
			Dissolved Silver (Ag)	2026/03/04		97	%	80 - 120
			Dissolved Strontium (Sr)	2026/03/04		93	%	80 - 120
			Dissolved Tellurium (Te)	2026/03/04		104	%	80 - 120
			Dissolved Thallium (Tl)	2026/03/04		100	%	80 - 120
			Dissolved Thorium (Th)	2026/03/04		109	%	80 - 120
			Dissolved Tin (Sn)	2026/03/04		104	%	80 - 120
			Dissolved Titanium (Ti)	2026/03/04		99	%	80 - 120
			Dissolved Uranium (U)	2026/03/04		117	%	80 - 120
			Dissolved Vanadium (V)	2026/03/04		94	%	80 - 120
			Dissolved Zinc (Zn)	2026/03/04		99	%	80 - 120
			Dissolved Zirconium (Zr)	2026/03/04		105	%	80 - 120
C238773	AA1	Method Blank	Dissolved Aluminum (Al)	2026/03/04	ND, RDL=0.50		ug/L	
			Dissolved Antimony (Sb)	2026/03/04	ND, RDL=0.020		ug/L	
			Dissolved Arsenic (As)	2026/03/04	ND, RDL=0.020		ug/L	
			Dissolved Barium (Ba)	2026/03/04	ND, RDL=0.020		ug/L	
			Dissolved Beryllium (Be)	2026/03/04	ND, RDL=0.010		ug/L	
			Dissolved Bismuth (Bi)	2026/03/04	ND, RDL=0.0050		ug/L	
			Dissolved Boron (B)	2026/03/04	ND, RDL=10		ug/L	
			Dissolved Cadmium (Cd)	2026/03/04	ND, RDL=0.0050		ug/L	
			Dissolved Cesium (Cs)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Chromium (Cr)	2026/03/04	ND, RDL=0.10		ug/L	
			Dissolved Cobalt (Co)	2026/03/04	ND, RDL=0.0050		ug/L	
			Dissolved Copper (Cu)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Iron (Fe)	2026/03/04	ND, RDL=1.0		ug/L	
			Dissolved Lead (Pb)	2026/03/04	ND, RDL=0.0050		ug/L	
			Dissolved Lithium (Li)	2026/03/04	ND, RDL=0.50		ug/L	
			Dissolved Manganese (Mn)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Molybdenum (Mo)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Nickel (Ni)	2026/03/04	ND, RDL=0.020		ug/L	



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Phosphorus (P)	2026/03/04	ND, RDL=2.0		ug/L	
			Dissolved Rubidium (Rb)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Selenium (Se)	2026/03/04	ND, RDL=0.040		ug/L	
			Dissolved Silicon (Si)	2026/03/04	ND, RDL=50		ug/L	
			Dissolved Silver (Ag)	2026/03/04	ND, RDL=0.0050		ug/L	
			Dissolved Strontium (Sr)	2026/03/04	ND, RDL=0.050		ug/L	
			Dissolved Tellurium (Te)	2026/03/04	ND, RDL=0.020		ug/L	
			Dissolved Thallium (Tl)	2026/03/04	ND, RDL=0.0020		ug/L	
			Dissolved Thorium (Th)	2026/03/04	0.0076, RDL=0.0050 (1)		ug/L	
			Dissolved Tin (Sn)	2026/03/04	ND, RDL=0.20		ug/L	
			Dissolved Titanium (Ti)	2026/03/04	ND, RDL=0.50		ug/L	
			Dissolved Uranium (U)	2026/03/04	ND, RDL=0.0020		ug/L	
			Dissolved Vanadium (V)	2026/03/04	ND, RDL=0.20		ug/L	
			Dissolved Zinc (Zn)	2026/03/04	ND, RDL=0.10		ug/L	
			Dissolved Zirconium (Zr)	2026/03/04	ND, RDL=0.10		ug/L	
C238773	AA1	RPD	Dissolved Aluminum (Al)	2026/03/04	6.8		%	20
			Dissolved Antimony (Sb)	2026/03/04	0.40		%	20
			Dissolved Arsenic (As)	2026/03/04	0.33		%	20
			Dissolved Barium (Ba)	2026/03/04	0.91		%	20
			Dissolved Beryllium (Be)	2026/03/04	16		%	20
			Dissolved Bismuth (Bi)	2026/03/04	NC		%	20
			Dissolved Boron (B)	2026/03/04	NC		%	20
			Dissolved Cadmium (Cd)	2026/03/04	4.6		%	20
			Dissolved Chromium (Cr)	2026/03/04	NC		%	20
			Dissolved Cobalt (Co)	2026/03/04	3.2		%	20
			Dissolved Copper (Cu)	2026/03/04	NC		%	20
			Dissolved Iron (Fe)	2026/03/04	2.2		%	20
			Dissolved Lead (Pb)	2026/03/04	NC		%	20
			Dissolved Lithium (Li)	2026/03/04	2.3		%	20
			Dissolved Manganese (Mn)	2026/03/04	2.0		%	20
			Dissolved Molybdenum (Mo)	2026/03/04	4.0		%	20
			Dissolved Nickel (Ni)	2026/03/04	2.5		%	20
			Dissolved Selenium (Se)	2026/03/04	NC		%	20
			Dissolved Silicon (Si)	2026/03/04	3.2		%	20
			Dissolved Silver (Ag)	2026/03/04	NC		%	20
			Dissolved Strontium (Sr)	2026/03/04	1.6		%	20
			Dissolved Thallium (Tl)	2026/03/04	2.6		%	20
			Dissolved Tin (Sn)	2026/03/04	NC		%	20
			Dissolved Titanium (Ti)	2026/03/04	NC		%	20



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Uranium (U)	2026/03/04	1.4		%	20
			Dissolved Vanadium (V)	2026/03/04	NC		%	20
			Dissolved Zinc (Zn)	2026/03/04	1.1		%	20
			Dissolved Zirconium (Zr)	2026/03/04	NC		%	20
C238798	AG8	Matrix Spike [EBO575-01]	Total Suspended Solids	2026/03/05		99	%	80 - 120
C238798	AG8	Spiked Blank	Total Suspended Solids	2026/03/05		99	%	80 - 120
C238798	AG8	Method Blank	Total Suspended Solids	2026/03/05	ND, RDL=1.0		mg/L	
C238798	AG8	RPD	Total Suspended Solids	2026/03/05	11		%	20
C238915	TSO	Matrix Spike [EBO571-02]	Nitrate plus Nitrite (N)	2026/03/04		118	%	80 - 120
C238915	TSO	Spiked Blank	Nitrate plus Nitrite (N)	2026/03/04		107	%	80 - 120
C238915	TSO	Method Blank	Nitrate plus Nitrite (N)	2026/03/04	ND, RDL=0.020		mg/L	
C238915	TSO	RPD [EBO571-02]	Nitrate plus Nitrite (N)	2026/03/04	NC		%	25
C238942	JLP	Spiked Blank	Alkalinity (Total as CaCO3)	2026/03/04		96	%	80 - 120
C238942	JLP	Method Blank	Alkalinity (PP as CaCO3)	2026/03/04	ND, RDL=1.0		mg/L	
			Alkalinity (Total as CaCO3)	2026/03/04	ND, RDL=1.0		mg/L	
			Bicarbonate (HCO3)	2026/03/04	ND, RDL=1.0		mg/L	
			Carbonate (CO3)	2026/03/04	ND, RDL=1.0		mg/L	
			Hydroxide (OH)	2026/03/04	ND, RDL=1.0		mg/L	
C238942	JLP	RPD [EBO571-02]	Alkalinity (PP as CaCO3)	2026/03/04	NC		%	20
			Alkalinity (Total as CaCO3)	2026/03/04	1.6		%	20
			Bicarbonate (HCO3)	2026/03/04	1.6		%	20
			Carbonate (CO3)	2026/03/04	NC		%	20
			Hydroxide (OH)	2026/03/04	NC		%	20
C238966	JAV	Matrix Spike [EBO571-02]	Chloride (Cl)	2026/03/04		106	%	80 - 120
			Sulphate (SO4)	2026/03/04		109	%	80 - 120
C238966	JAV	Spiked Blank	Chloride (Cl)	2026/03/04		101	%	80 - 120
			Sulphate (SO4)	2026/03/04		95	%	80 - 120
C238966	JAV	Method Blank	Chloride (Cl)	2026/03/04	ND, RDL=1.0		mg/L	
			Sulphate (SO4)	2026/03/04	ND, RDL=1.0		mg/L	
C238966	JAV	RPD [EBO571-02]	Chloride (Cl)	2026/03/04	NC		%	20
			Sulphate (SO4)	2026/03/04	6.4		%	20
C238974	TSO	Matrix Spike [EBO571-02]	Nitrite (N)	2026/03/04		109	%	80 - 120
C238974	TSO	Spiked Blank	Nitrite (N)	2026/03/04		106	%	80 - 120
C238974	TSO	Method Blank	Nitrite (N)	2026/03/04	ND, RDL=0.0050		mg/L	
C238974	TSO	RPD [EBO571-02]	Nitrite (N)	2026/03/04	NC		%	20
C238978	C2L	Matrix Spike	Total Mercury (Hg)	2026/03/04		78 (2)	%	80 - 120
C238978	C2L	Spiked Blank	Total Mercury (Hg)	2026/03/04		88	%	80 - 120
C238978	C2L	Method Blank	Total Mercury (Hg)	2026/03/04	ND, RDL=0.0019		ug/L	
C238978	C2L	RPD	Total Mercury (Hg)	2026/03/04	10		%	20
C238990	JLP	Spiked Blank	pH	2026/03/04		100	%	97 - 103
C238990	JLP	RPD [EBO571-02]	pH	2026/03/04	0.90		%	N/A
C239094	AA1	Matrix Spike	Total Aluminum (Al)	2026/03/04		99	%	80 - 120



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Antimony (Sb)	2026/03/04		102	%	80 - 120
			Total Arsenic (As)	2026/03/04		99	%	80 - 120
			Total Barium (Ba)	2026/03/04		96	%	80 - 120
			Total Beryllium (Be)	2026/03/04		99	%	80 - 120
			Total Bismuth (Bi)	2026/03/04		100	%	80 - 120
			Total Boron (B)	2026/03/04		106	%	80 - 120
			Total Cadmium (Cd)	2026/03/04		97	%	80 - 120
			Total Cesium (Cs)	2026/03/04		90	%	80 - 120
			Total Chromium (Cr)	2026/03/04		93	%	80 - 120
			Total Cobalt (Co)	2026/03/04		93	%	80 - 120
			Total Copper (Cu)	2026/03/04		90	%	80 - 120
			Total Iron (Fe)	2026/03/04		98	%	80 - 120
			Total Lead (Pb)	2026/03/04		96	%	80 - 120
			Total Lithium (Li)	2026/03/04		99	%	80 - 120
			Total Manganese (Mn)	2026/03/04		95	%	80 - 120
			Total Molybdenum (Mo)	2026/03/04		103	%	80 - 120
			Total Nickel (Ni)	2026/03/04		94	%	80 - 120
			Total Phosphorus (P)	2026/03/04		109	%	80 - 120
			Total Rubidium (Rb)	2026/03/04		100	%	80 - 120
			Total Selenium (Se)	2026/03/04		96	%	80 - 120
			Total Silicon (Si)	2026/03/04		93	%	80 - 120
			Total Silver (Ag)	2026/03/04		96	%	80 - 120
			Total Strontium (Sr)	2026/03/04		98	%	80 - 120
			Total Tellurium (Te)	2026/03/04		106	%	80 - 120
			Total Thallium (Tl)	2026/03/04		102	%	80 - 120
			Total Thorium (Th)	2026/03/04		102	%	80 - 120
			Total Tin (Sn)	2026/03/04		101	%	80 - 120
			Total Titanium (Ti)	2026/03/04		96	%	80 - 120
			Total Uranium (U)	2026/03/04		101	%	80 - 120
			Total Vanadium (V)	2026/03/04		93	%	80 - 120
			Total Zinc (Zn)	2026/03/04		95	%	80 - 120
			Total Zirconium (Zr)	2026/03/04		103	%	80 - 120
C239094	AA1	Spiked Blank	Total Aluminum (Al)	2026/03/04		107	%	80 - 120
			Total Antimony (Sb)	2026/03/04		108	%	80 - 120
			Total Arsenic (As)	2026/03/04		105	%	80 - 120
			Total Barium (Ba)	2026/03/04		103	%	80 - 120
			Total Beryllium (Be)	2026/03/04		106	%	80 - 120
			Total Bismuth (Bi)	2026/03/04		106	%	80 - 120
			Total Boron (B)	2026/03/04		115	%	80 - 120
			Total Cadmium (Cd)	2026/03/04		104	%	80 - 120
			Total Cesium (Cs)	2026/03/04		96	%	80 - 120
			Total Chromium (Cr)	2026/03/04		100	%	80 - 120
			Total Cobalt (Co)	2026/03/04		100	%	80 - 120
			Total Copper (Cu)	2026/03/04		96	%	80 - 120
			Total Iron (Fe)	2026/03/04		107	%	80 - 120
			Total Lead (Pb)	2026/03/04		101	%	80 - 120
			Total Lithium (Li)	2026/03/04		103	%	80 - 120
			Total Manganese (Mn)	2026/03/04		101	%	80 - 120
			Total Molybdenum (Mo)	2026/03/04		110	%	80 - 120
			Total Nickel (Ni)	2026/03/04		100	%	80 - 120
			Total Phosphorus (P)	2026/03/04		108	%	80 - 120
			Total Rubidium (Rb)	2026/03/04		106	%	80 - 120
			Total Selenium (Se)	2026/03/04		102	%	80 - 120



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Silicon (Si)	2026/03/04		108	%	80 - 120
			Total Silver (Ag)	2026/03/04		103	%	80 - 120
			Total Strontium (Sr)	2026/03/04		103	%	80 - 120
			Total Tellurium (Te)	2026/03/04		113	%	80 - 120
			Total Thallium (Tl)	2026/03/04		107	%	80 - 120
			Total Thorium (Th)	2026/03/04		107	%	80 - 120
			Total Tin (Sn)	2026/03/04		110	%	80 - 120
			Total Titanium (Ti)	2026/03/04		104	%	80 - 120
			Total Uranium (U)	2026/03/04		105	%	80 - 120
			Total Vanadium (V)	2026/03/04		100	%	80 - 120
			Total Zinc (Zn)	2026/03/04		102	%	80 - 120
			Total Zirconium (Zr)	2026/03/04		108	%	80 - 120
C239094	AA1	Method Blank	Total Aluminum (Al)	2026/03/04	ND, RDL=0.50		ug/L	
			Total Antimony (Sb)	2026/03/04	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/03/04	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/03/04	ND, RDL=0.020		ug/L	
			Total Beryllium (Be)	2026/03/04	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/03/04	ND, RDL=0.0050		ug/L	
			Total Boron (B)	2026/03/04	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/03/04	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/03/04	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/03/04	ND, RDL=0.0050		ug/L	
			Total Copper (Cu)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Iron (Fe)	2026/03/04	ND, RDL=1.0		ug/L	
			Total Lead (Pb)	2026/03/04	ND, RDL=0.0050		ug/L	
			Total Lithium (Li)	2026/03/04	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Molybdenum (Mo)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/03/04	ND, RDL=0.020		ug/L	
			Total Phosphorus (P)	2026/03/04	ND, RDL=2.0		ug/L	
			Total Rubidium (Rb)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/03/04	ND, RDL=0.040		ug/L	



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Silicon (Si)	2026/03/04	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/03/04	ND, RDL=0.0050		ug/L	
			Total Strontium (Sr)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/03/04	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/03/04	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/03/04	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/03/04	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/03/04	ND, RDL=0.50		ug/L	
			Total Uranium (U)	2026/03/04	ND, RDL=0.0020		ug/L	
			Total Vanadium (V)	2026/03/04	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/03/04	ND, RDL=0.10		ug/L	
			Total Zirconium (Zr)	2026/03/04	ND, RDL=0.10		ug/L	
C239094	AA1	RPD	Total Aluminum (Al)	2026/03/04	NC		%	20
			Total Antimony (Sb)	2026/03/04	NC		%	20
			Total Arsenic (As)	2026/03/04	NC		%	20
			Total Barium (Ba)	2026/03/04	NC		%	20
			Total Beryllium (Be)	2026/03/04	NC		%	20
			Total Bismuth (Bi)	2026/03/04	NC		%	20
			Total Boron (B)	2026/03/04	NC		%	20
			Total Cadmium (Cd)	2026/03/04	NC		%	20
			Total Chromium (Cr)	2026/03/04	NC		%	20
			Total Cobalt (Co)	2026/03/04	NC		%	20
			Total Copper (Cu)	2026/03/04	2.8		%	20
			Total Iron (Fe)	2026/03/04	NC		%	20
			Total Lead (Pb)	2026/03/04	13		%	20
			Total Lithium (Li)	2026/03/04	NC		%	20
			Total Manganese (Mn)	2026/03/04	NC		%	20
			Total Molybdenum (Mo)	2026/03/04	NC		%	20
			Total Nickel (Ni)	2026/03/04	NC		%	20
			Total Selenium (Se)	2026/03/04	NC		%	20
			Total Silicon (Si)	2026/03/04	NC		%	20
			Total Silver (Ag)	2026/03/04	NC		%	20
			Total Strontium (Sr)	2026/03/04	NC		%	20
			Total Thallium (Tl)	2026/03/04	NC		%	20
			Total Tin (Sn)	2026/03/04	NC		%	20
			Total Titanium (Ti)	2026/03/04	NC		%	20
			Total Uranium (U)	2026/03/04	NC		%	20
			Total Vanadium (V)	2026/03/04	NC		%	20
			Total Zinc (Zn)	2026/03/04	1.1		%	20
			Total Zirconium (Zr)	2026/03/04	NC		%	20
			Total Aluminum (Al)	2026/03/04	NC		%	20



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Antimony (Sb)	2026/03/04	NC		%	20
			Total Arsenic (As)	2026/03/04	NC		%	20
			Total Barium (Ba)	2026/03/04	NC		%	20
			Total Beryllium (Be)	2026/03/04	NC		%	20
			Total Bismuth (Bi)	2026/03/04	NC		%	20
			Total Boron (B)	2026/03/04	NC		%	20
			Total Cadmium (Cd)	2026/03/04	NC		%	20
			Total Chromium (Cr)	2026/03/04	NC		%	20
			Total Cobalt (Co)	2026/03/04	NC		%	20
			Total Copper (Cu)	2026/03/04	NC		%	20
			Total Iron (Fe)	2026/03/04	NC		%	20
			Total Lead (Pb)	2026/03/04	NC		%	20
			Total Lithium (Li)	2026/03/04	NC		%	20
			Total Manganese (Mn)	2026/03/04	NC		%	20
			Total Molybdenum (Mo)	2026/03/04	NC		%	20
			Total Nickel (Ni)	2026/03/04	NC		%	20
			Total Phosphorus (P)	2026/03/04	NC		%	20
			Total Selenium (Se)	2026/03/04	NC		%	20
			Total Silicon (Si)	2026/03/04	NC		%	20
			Total Silver (Ag)	2026/03/04	NC		%	20
			Total Strontium (Sr)	2026/03/04	NC		%	20
			Total Thallium (Tl)	2026/03/04	NC		%	20
			Total Tin (Sn)	2026/03/04	NC		%	20
			Total Titanium (Ti)	2026/03/04	NC		%	20
			Total Uranium (U)	2026/03/04	NC		%	20
			Total Vanadium (V)	2026/03/04	NC		%	20
			Total Zinc (Zn)	2026/03/04	NC		%	20
			Total Zirconium (Zr)	2026/03/04	NC		%	20
C239098	AG8	Matrix Spike [EBO574-01]	Total Suspended Solids	2026/03/05		99	%	80 - 120
C239098	AG8	Spiked Blank	Total Suspended Solids	2026/03/05		101	%	80 - 120
C239098	AG8	Method Blank	Total Suspended Solids	2026/03/05	ND, RDL=1.0		mg/L	
C239098	AG8	RPD [EBO572-01]	Total Suspended Solids	2026/03/05	0		%	20
C239122	BTM	Matrix Spike	Total Organic Carbon (C)	2026/03/04		102	%	80 - 120
C239122	BTM	Spiked Blank	Total Organic Carbon (C)	2026/03/04		103	%	80 - 120
C239122	BTM	Method Blank	Total Organic Carbon (C)	2026/03/04	ND, RDL=0.50		mg/L	
C239122	BTM	RPD	Total Organic Carbon (C)	2026/03/04	NC		%	20
C239177	CJY	Matrix Spike [EBO572-02]	Dissolved Fluoride (F)	2026/03/04		97	%	80 - 120
C239177	CJY	Spiked Blank	Dissolved Fluoride (F)	2026/03/04		97	%	80 - 120
C239177	CJY	Method Blank	Dissolved Fluoride (F)	2026/03/04	ND, RDL=0.050		mg/L	
C239177	CJY	RPD [EBO571-02]	Fluoride (F)	2026/03/04	NC		%	20
C239298	AG8	Matrix Spike	Total Dissolved Solids	2026/03/05		101	%	80 - 120
C239298	AG8	Spiked Blank	Total Dissolved Solids	2026/03/05		98	%	80 - 120
C239298	AG8	Method Blank	Total Dissolved Solids	2026/03/05	ND, RDL=10		mg/L	
C239298	AG8	RPD	Total Dissolved Solids	2026/03/05	11		%	20
C239380	KA5	Matrix Spike	Total Phosphorus (P)	2026/03/05		93	%	N/A
C239380	KA5	Spiked Blank	Total Phosphorus (P)	2026/03/05		95	%	80 - 120
C239380	KA5	Method Blank	Total Phosphorus (P)	2026/03/05	ND, RDL=0.0010		mg/L	
C239380	KA5	RPD	Total Phosphorus (P)	2026/03/05	15		%	20



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C239390	KA5	Matrix Spike [EBO573-09]	Total Phosphorus (P)	2026/03/05		NC	%	N/A
C239390	KA5	Spiked Blank	Total Phosphorus (P)	2026/03/05		101	%	80 - 120
C239390	KA5	Method Blank	Total Phosphorus (P)	2026/03/05	ND, RDL=0.0010		mg/L	
C239390	KA5	RPD [EBO573-09]	Total Phosphorus (P)	2026/03/05	6.6		%	20
C239422	BB3	Matrix Spike	Total Ammonia (N)	2026/03/04		109	%	80 - 120
C239422	BB3	Spiked Blank	Total Ammonia (N)	2026/03/04		103	%	80 - 120
C239422	BB3	Method Blank	Total Ammonia (N)	2026/03/04	ND, RDL=0.015		mg/L	
C239422	BB3	RPD	Total Ammonia (N)	2026/03/04	NC		%	20
C239638	AAX	Matrix Spike	Methyl Sulfone (sur.)	2026/03/05		134	%	50 - 140
			Ethylene Glycol	2026/03/05		88	%	60 - 140
			Diethylene Glycol	2026/03/05		112	%	60 - 140
			Triethylene Glycol	2026/03/05		105	%	60 - 140
			Propylene Glycol	2026/03/05		93	%	60 - 140
C239638	AAX	Spiked Blank	Methyl Sulfone (sur.)	2026/03/05		88	%	50 - 140
			Ethylene Glycol	2026/03/05		89	%	70 - 130
			Diethylene Glycol	2026/03/05		107	%	70 - 130
			Triethylene Glycol	2026/03/05		95	%	70 - 130
			Propylene Glycol	2026/03/05		90	%	70 - 130
C239638	AAX	Method Blank	Methyl Sulfone (sur.)	2026/03/05		87	%	50 - 140
			Ethylene Glycol	2026/03/05	ND, RDL=3.0		mg/L	
			Diethylene Glycol	2026/03/05	ND, RDL=5.0		mg/L	
			Triethylene Glycol	2026/03/05	ND, RDL=5.0		mg/L	
			Propylene Glycol	2026/03/05	ND, RDL=5.0		mg/L	
C239638	AAX	RPD	Ethylene Glycol	2026/03/05	NC		%	30
			Diethylene Glycol	2026/03/05	NC		%	30
			Triethylene Glycol	2026/03/05	NC		%	30
			Propylene Glycol	2026/03/05	NC		%	30
C239643	BTM	Matrix Spike [EBO574-04]	Dissolved Organic Carbon (C)	2026/03/05		96	%	80 - 120
C239643	BTM	Spiked Blank	Dissolved Organic Carbon (C)	2026/03/05		98	%	80 - 120
C239643	BTM	Method Blank	Dissolved Organic Carbon (C)	2026/03/05	ND, RDL=0.50		mg/L	
C239643	BTM	RPD [EBO574-04]	Dissolved Organic Carbon (C)	2026/03/05	NC		%	20
C239735	BB3	Matrix Spike	Total Nitrogen (N)	2026/03/06		98	%	80 - 120
C239735	BB3	Spiked Blank	Total Nitrogen (N)	2026/03/06		98	%	80 - 120
C239735	BB3	Method Blank	Total Nitrogen (N)	2026/03/06	ND, RDL=0.020		mg/L	
C239735	BB3	RPD	Total Nitrogen (N)	2026/03/06	20		%	20
C240460	IDV	Matrix Spike	Total Sulphide	2026/03/06		102	%	80 - 120
C240460	IDV	Spiked Blank	Total Sulphide	2026/03/06		91	%	80 - 120
C240460	IDV	Method Blank	Total Sulphide	2026/03/06	ND, RDL=0.0018		mg/L	
C240460	IDV	RPD	Total Sulphide	2026/03/06	NC		%	20
C241066	KYC	Matrix Spike	1,4-Difluorobenzene (sur.)	2026/03/06		101	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/03/06		98	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/03/06		99	%	50 - 140
			1,1,1,2-tetrachloroethane	2026/03/06		91	%	50 - 140
			1,1,1-trichloroethane	2026/03/06		96	%	50 - 140



BUREAU  
VERITAS

Bureau Veritas Job #: C611322  
Report Date: 2026/03/10

HATFIELD CONSULTANTS  
Client Project #: FORTIS11234/PE-110163  
Site Location: WOODFIBRE PIPELINE PROJECT  
Your P.O. #: 4800010213

### QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,1,2,2-tetrachloroethane	2026/03/06		88	%	50 - 140
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/03/06		90	%	50 - 140
			1,1,2-trichloroethane	2026/03/06		87	%	50 - 140
			1,1-dichloroethane	2026/03/06		99	%	50 - 140
			1,1-dichloroethene	2026/03/06		109	%	50 - 140
			1,2,3-trichlorobenzene	2026/03/06		93	%	50 - 140
			1,2,4-trichlorobenzene	2026/03/06		96	%	50 - 140
			1,2-dibromoethane	2026/03/06		88	%	50 - 140
			1,2-dichlorobenzene	2026/03/06		96	%	50 - 140
			1,2-dichloroethane	2026/03/06		89	%	50 - 140
			1,2-dichloropropane	2026/03/06		90	%	50 - 140
			1,3,5-trimethylbenzene	2026/03/06		105	%	50 - 140
			1,3-Butadiene	2026/03/06		72	%	50 - 140
			1,3-dichlorobenzene	2026/03/06		98	%	50 - 140
			1,3-dichloropropane	2026/03/06		85	%	50 - 140
			1,4-dichlorobenzene	2026/03/06		93	%	50 - 140
			Benzene	2026/03/06		93	%	50 - 140
			Bromobenzene	2026/03/06		94	%	50 - 140
			Bromodichloromethane	2026/03/06		88	%	50 - 140
			Bromoform	2026/03/06		87	%	50 - 140
			Bromomethane	2026/03/06		84	%	50 - 140
			Carbon tetrachloride	2026/03/06		93	%	50 - 140
			Chlorobenzene	2026/03/06		90	%	50 - 140
			Dibromochloromethane	2026/03/06		88	%	50 - 140
			Chloroethane	2026/03/06		92	%	50 - 140
			Chloroform	2026/03/06		90	%	50 - 140
			Chloromethane	2026/03/06		74	%	50 - 140
			cis-1,2-dichloroethene	2026/03/06		90	%	50 - 140
			cis-1,3-dichloropropene	2026/03/06		88	%	50 - 140
			Dichlorodifluoromethane	2026/03/06		72	%	50 - 140
			Dichloromethane	2026/03/06		79	%	50 - 140
			Ethylbenzene	2026/03/06		100	%	50 - 140
			Hexachlorobutadiene	2026/03/06		93	%	50 - 140
			Isopropylbenzene	2026/03/06		98	%	50 - 140
			Methyl-tert-butylether (MTBE)	2026/03/06		83	%	50 - 140
			Styrene	2026/03/06		89	%	50 - 140
			Tetrachloroethene	2026/03/06		91	%	50 - 140
			Toluene	2026/03/06		94	%	50 - 140
			trans-1,2-dichloroethene	2026/03/06		100	%	50 - 140
			trans-1,3-dichloropropene	2026/03/06		81	%	50 - 140
			Trichloroethene	2026/03/06		93	%	50 - 140
			Trichlorofluoromethane	2026/03/06		88	%	50 - 140
			Vinyl chloride	2026/03/06		89	%	50 - 140
			m & p-Xylene	2026/03/06		103	%	50 - 140
			o-Xylene	2026/03/06		100	%	50 - 140
C241066	KYC	Spiked Blank	1,4-Difluorobenzene (sur.)	2026/03/06		103	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/03/06		95	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/03/06		98	%	50 - 140
			VH C6-C10	2026/03/06		105	%	70 - 130
			1,1,1,2-tetrachloroethane	2026/03/06		91	%	60 - 130
			1,1,1-trichloroethane	2026/03/06		96	%	60 - 130
			1,1,2,2-tetrachloroethane	2026/03/06		89	%	60 - 130
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/03/06		90	%	60 - 130



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,1,2-trichloroethane	2026/03/06		87	%	60 - 130
			1,1-dichloroethane	2026/03/06		99	%	60 - 130
			1,1-dichloroethene	2026/03/06		109	%	60 - 130
			1,2,3-trichlorobenzene	2026/03/06		93	%	60 - 130
			1,2,4-trichlorobenzene	2026/03/06		96	%	60 - 130
			1,2-dibromoethane	2026/03/06		88	%	60 - 130
			1,2-dichlorobenzene	2026/03/06		97	%	60 - 130
			1,2-dichloroethane	2026/03/06		89	%	60 - 130
			1,2-dichloropropane	2026/03/06		91	%	60 - 130
			1,3,5-trimethylbenzene	2026/03/06		110	%	60 - 130
			1,3-Butadiene	2026/03/06		82	%	50 - 140
			1,3-dichlorobenzene	2026/03/06		99	%	60 - 130
			1,3-dichloropropane	2026/03/06		86	%	60 - 130
			1,4-dichlorobenzene	2026/03/06		93	%	60 - 130
			Benzene	2026/03/06		93	%	60 - 130
			Bromobenzene	2026/03/06		96	%	60 - 130
			Bromodichloromethane	2026/03/06		88	%	60 - 130
			Bromoform	2026/03/06		87	%	60 - 130
			Bromomethane	2026/03/06		85	%	50 - 140
			Carbon tetrachloride	2026/03/06		93	%	60 - 130
			Chlorobenzene	2026/03/06		89	%	60 - 130
			Dibromochloromethane	2026/03/06		87	%	60 - 130
			Chloroethane	2026/03/06		92	%	50 - 140
			Chloroform	2026/03/06		90	%	60 - 130
			Chloromethane	2026/03/06		73	%	50 - 140
			cis-1,2-dichloroethene	2026/03/06		91	%	60 - 130
			cis-1,3-dichloropropene	2026/03/06		89	%	50 - 140
			Dichlorodifluoromethane	2026/03/06		71	%	50 - 140
			Dichloromethane	2026/03/06		78	%	60 - 130
			Ethylbenzene	2026/03/06		99	%	60 - 130
			Hexachlorobutadiene	2026/03/06		93	%	60 - 130
			Isopropylbenzene	2026/03/06		101	%	60 - 130
			Methyl-tert-butylether (MTBE)	2026/03/06		82	%	60 - 130
			Styrene	2026/03/06		104	%	60 - 130
			Tetrachloroethene	2026/03/06		94	%	60 - 130
			Toluene	2026/03/06		93	%	60 - 130
			trans-1,2-dichloroethene	2026/03/06		100	%	60 - 130
			trans-1,3-dichloropropene	2026/03/06		78	%	50 - 140
			Trichloroethene	2026/03/06		93	%	60 - 130
			Trichlorofluoromethane	2026/03/06		92	%	60 - 130
			Vinyl chloride	2026/03/06		90	%	50 - 140
			m & p-Xylene	2026/03/06		103	%	60 - 130
			o-Xylene	2026/03/06		100	%	60 - 130
C241066	KYC	Method Blank	1,4-Difluorobenzene (sur.)	2026/03/06		102	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/03/06		90	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/03/06		92	%	50 - 140
			VH C6-C10	2026/03/06	ND, RDL=300		ug/L	
			1,1,1,2-tetrachloroethane	2026/03/06	ND, RDL=0.50		ug/L	
			1,1,1-trichloroethane	2026/03/06	ND, RDL=0.50		ug/L	



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			1,1,2,2-tetrachloroethane	2026/03/06	ND, RDL=0.50		ug/L	
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/03/06	ND, RDL=2.0		ug/L	
			1,1,2-trichloroethane	2026/03/06	ND, RDL=0.50		ug/L	
			1,1-dichloroethane	2026/03/06	ND, RDL=0.50		ug/L	
			1,1-dichloroethene	2026/03/06	ND, RDL=0.50		ug/L	
			1,2,3-trichlorobenzene	2026/03/06	ND, RDL=2.0		ug/L	
			1,2,4-trichlorobenzene	2026/03/06	ND, RDL=2.0		ug/L	
			1,2-dibromoethane	2026/03/06	ND, RDL=0.20		ug/L	
			1,2-dichlorobenzene	2026/03/06	ND, RDL=0.50		ug/L	
			1,2-dichloroethane	2026/03/06	ND, RDL=0.50		ug/L	
			1,2-dichloropropane	2026/03/06	ND, RDL=0.50		ug/L	
			1,3,5-trimethylbenzene	2026/03/06	ND, RDL=2.0		ug/L	
			1,3-Butadiene	2026/03/06	ND, RDL=0.50		ug/L	
			1,3-dichlorobenzene	2026/03/06	ND, RDL=0.50		ug/L	
			1,3-dichloropropane	2026/03/06	ND, RDL=1.0		ug/L	
			1,4-dichlorobenzene	2026/03/06	ND, RDL=0.50		ug/L	
			Benzene	2026/03/06	ND, RDL=0.40		ug/L	
			Bromobenzene	2026/03/06	ND, RDL=2.0		ug/L	
			Bromodichloromethane	2026/03/06	ND, RDL=1.0		ug/L	
			Bromoform	2026/03/06	ND, RDL=1.0		ug/L	
			Bromomethane	2026/03/06	ND, RDL=1.0		ug/L	
			Carbon tetrachloride	2026/03/06	ND, RDL=0.50		ug/L	
			Chlorobenzene	2026/03/06	ND, RDL=0.50		ug/L	
			Dibromochloromethane	2026/03/06	ND, RDL=1.0		ug/L	
			Chloroethane	2026/03/06	ND, RDL=1.0		ug/L	
			Chloroform	2026/03/06	ND, RDL=1.0		ug/L	
			Chloromethane	2026/03/06	ND, RDL=1.0		ug/L	



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			cis-1,2-dichloroethene	2026/03/06	ND, RDL=1.0		ug/L	
			cis-1,3-dichloropropene	2026/03/06	ND, RDL=1.0		ug/L	
			Dichlorodifluoromethane	2026/03/06	ND, RDL=2.0		ug/L	
			Dichloromethane	2026/03/06	ND, RDL=2.0		ug/L	
			Ethylbenzene	2026/03/06	ND, RDL=0.40		ug/L	
			Hexachlorobutadiene	2026/03/06	ND, RDL=0.50		ug/L	
			Isopropylbenzene	2026/03/06	ND, RDL=2.0		ug/L	
			Methyl-tert-butylether (MTBE)	2026/03/06	ND, RDL=4.0		ug/L	
			Styrene	2026/03/06	ND, RDL=0.50		ug/L	
			Tetrachloroethene	2026/03/06	ND, RDL=0.50		ug/L	
			Toluene	2026/03/06	ND, RDL=0.40		ug/L	
			trans-1,2-dichloroethene	2026/03/06	ND, RDL=1.0		ug/L	
			trans-1,3-dichloropropene	2026/03/06	ND, RDL=1.0		ug/L	
			Trichloroethene	2026/03/06	ND, RDL=0.50		ug/L	
			Trichlorofluoromethane	2026/03/06	ND, RDL=4.0		ug/L	
			Vinyl chloride	2026/03/06	ND, RDL=0.50		ug/L	
			m & p-Xylene	2026/03/06	ND, RDL=0.40		ug/L	
			o-Xylene	2026/03/06	ND, RDL=0.40		ug/L	
			Xylenes (Total)	2026/03/06	ND, RDL=0.40		ug/L	
C241066	KYC	RPD	Bromodichloromethane	2026/03/07	0.58		%	30
			Bromoform	2026/03/07	NC		%	30
			Dibromochloromethane	2026/03/07	NC		%	30
			Chloroform	2026/03/07	1.4		%	30
C241233	MDO	Matrix Spike	Phenols	2026/03/06		102	%	80 - 120
C241233	MDO	Spiked Blank	Phenols	2026/03/06		101	%	80 - 120
C241233	MDO	Method Blank	Phenols	2026/03/06	ND, RDL=0.0015		mg/L	
C241233	MDO	RPD	Phenols	2026/03/06	NC		%	20
C242621	RLC	Matrix Spike [EBO571-02]	Bromide (Br)	2026/03/10		101	%	78 - 120
C242621	RLC	Spiked Blank	Bromide (Br)	2026/03/10		99	%	80 - 120
C242621	RLC	Method Blank	Bromide (Br)	2026/03/10	ND, RDL=0.010		mg/L	
C242621	RLC	RPD [EBO571-02]	Bromide (Br)	2026/03/10	NC		%	20
C242641	C2L	Matrix Spike [EBO571-08]	Dissolved Mercury (Hg)	2026/03/09		103	%	80 - 120
C242641	C2L	Spiked Blank	Dissolved Mercury (Hg)	2026/03/09		94	%	80 - 120



**QUALITY ASSURANCE REPORT(CONT'D)**

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C242641	C2L	Method Blank	Dissolved Mercury (Hg)	2026/03/10	ND, RDL=0.0019		ug/L	
C242641	C2L	RPD [EBO571-08]	Dissolved Mercury (Hg)	2026/03/09	NC		%	20

N/A = Not Applicable

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference <= 2x RDL).

(1) Method blank exceeds acceptance limits- 2X RDL acceptable for low level metals determination.

(2) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.



### VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

David Huang, M.Sc., P.Chem., QP, Scientific Services Manager

Ghayasuddin Khan, M.Sc., P.Chem., QP, Scientific Specialist, Inorganics

Levi Manchak, Project Manager SR

Luba Shymushovska, B.Sc., QP, Senior Analyst, Organics

---

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.

C611322

2026/03/03 13:55



# Custody Tracking Form



W124417

Please use this form for custody tracking when submitting the work instructions via eCOC (electronic Chain of Custody). Please ensure your form has a barcode or a Bureau Veritas eCOC confirmation number in the top right hand side. This number links your electronic submission to your samples. This form should be placed in the cooler with your samples.

First Sample: W LNG-DS  
Last Sample: Trip Blank  
Sample Count: 5

Relinquished By				Received By			
	Date	MAR-3-2026	Nata Canora		Date	2026/03/03	
	Time (24 HR)	13:51			Time (24 HR)	13:55	
	Date				Date		
	Time (24 HR)				Time (24 HR)		
	Date				Date		
	Time (24 HR)				Time (24 HR)		

Unless otherwise agreed to, submissions and use of services are governed by Bureau Veritas' standard terms and conditions which can be found at [www.bvna.com](http://www.bvna.com).

**Triage Information**

Sampled By (Print): JACKSON MACPHERSON

# of Coolers/Pkgs: 2 \* NONE OF THE FOLLOWING

- BCR-EOP      Immediate Test

- SARI-US/DS

Rush

Micro

**\*\*\* LABORATORY USE ONLY \*\*\***

Received At:

Lab Comments:

ICE frozen



MVAN-2026-03-126


Custody Seal		Cooling Media Present (Y/N)	Temperature °C		
Present (Y/N)	Intact (Y/N)		1	2	3
N	N	Y	7.2	8.2	8.1
N	N	Y	10.7	10.4	11.6

COR FCD-00383/5

Page 1 of 1



eCOC: W124417



Project Information: C611322  
 Job Received: 2026/03/03 13:55  
 Expected TAT: Standard TAT  
 Expected Arrival: 2026/03/03 14:30  
 Submitted By: Jackson Macpherson  
 Submitted To: Burnaby ENV: 4606 Canada Way

**Invoice Information**

Attn: Accounts Payable  
 Fortis BC Energy Inc  
 16705 Fraser Hwy  
 Surrey , BC , V4N 0E8  
 Email to:  
 einvoices@fortisbc.com

**Report Information**

Attn: Brett Lucas  
 HATFIELD CONSULTANTS  
 200-850 Harbourside Dr  
 North Vancouver , BC , V7P 0A3  
 Email to:  
 blucas@hatfieldgroup.com  
 danielle.samels@fortisbc.com  
 smangwani@hatfieldgroup.com  
 jmacpherson@hatfieldgroup.com  
 swolf@hatfieldgroup.com

**Project Information**

**Quote #:** C50083  
**PO/AFE#:** 4800010213  
**Project #:** Fortis11234/PE-110163  
**Site Location:** Woodfibre Pipeline Project

**Analytical Summary**

A: Standard TAT

Client Sample ID	Clnt Ref	Sampling Date/Time	Matrix	#Cont	Woodfibre	Woodfibre Additional	Woodfibre Blank	Set Number
WLNG-DS	1	2026/03/03 09:30	WATER	14	A			1
WLNG -EOP	2	2026/03/03 09:30	WATER	18	A	A		2
WLNG-US	3	2026/03/03 09:30	WATER	14	A			1
SQRI-US	4	2026/03/03 09:30	WATER	14	A			1
SQRI-DS	5	2026/03/03 09:30	WATER	14	A			1
BCR-EOP	6	2026/03/03 09:30	WATER	18	A	A		2
Field Blank	7	2026/03/03 09:30	WATER	14			A	3
Trip Blank	8	2026/03/03 09:30	WATER	14			A	3


Deadlines are estimates only and are subject to change. Please refer to your Job Confirmation report for final due dates.

**Submission Information**

# of Samples: 8



eCOC: W124417



Project Information: C611322  
Job Received: 2026/03/03 13:55  
Expected TAT: Standard TAT  
Expected Arrival: 2026/03/03 14:30  
Submitted By: Jackson Macpherson  
Submitted To: Burnaby ENV: 4606  
Canada Way

### Sample Set Listing

Set 1 (4 samples)	Set 2 (2 samples)	Set 3 (2 samples)
WLNG-DS WLNG-US SQRI-US SQRI-DS	WLNG -EOP BCR-EOP	Field Blank Trip Blank