

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Page	1 of 7

Eagle Mountain – Woodfibre Gas Pipeline Project

BCER Waste Discharge Permit Weekly Report

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Page	2 of 7

Contents

Preamble 3

Introduction 3

Sampling Methodology 3

Summary-BC Rail Site 5

Site Activities 5

Discharge from Water Treatment Plant..... 5

Receiving Environment Monitoring-Squamish River 5

Summary-Woodfibre Site 6

Site Activities 6

Exceedances..... 6

Discharge from Water Treatment Plant..... 6

Receiving Environment Monitoring-East Creek..... 6

Appendix A: BC Rail Point of Discharge from Water Treatment System Documentation

Appendix B: BC Rail Receiving Environment Documentation

Appendix C: Woodfibre Point of Discharge from Water Treatment System Documentation

Appendix D: Woodfibre Receiving Environment Documentation

Appendix E: Lab Documentation



Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report

Reporting Week	June 8 to June 14, 2026
Report #	116
Page	3 of 7

Preamble

This weekly report for the British Columbia Energy Regulator (BCER) Waste Discharge Permit (BCER number PE-110163) for the FortisBC Eagle Mountain – Woodfibre Gas Pipeline (EGP) Project includes the results of water quality monitoring and sampling of the receiving environments (upstream and downstream) and points of discharge during the reporting period.

FortisBC has retained Hatfield Consultants as the Qualified Professional to implement and oversee the monitoring and sampling programs. The data represented below, including laboratory reported exceedances, represent conditions measured from final discharge points and the associated receiving environments, as required under the Waste Discharge Permit.

Introduction

The results provided in this document have been submitted to BCER by FortisBC as per the requirements listed in Section 4.2 of the Waste Discharge Permit PE-110163:

The Permittee shall summarize the results of the discharge and receiving environment compliance sampling and monitoring program in a report that shall be submitted weekly over the term of this permit. The sampling and monitoring results shall be suitably tabulated and include comparison to the respective British Columbia Approved and Working Water Quality Guidelines for Freshwater & Marine Aquatic Life, as published by the Ministry of Environment & Climate Change Strategy. Any exceedance of regulatory guidelines shall be clearly highlighted, and any missed sampling events/missing data shall be identified with an explanation provided. Reporting frequency may be reduced upon a history of compliance and by written confirmation from the BCER. These reports shall be submitted to Waste.Management@bc-er.ca. A copy of the reports shall be provided to each First Nation consulted with regarding the subject permit, and also made publicly available on the FortisBC Eagle Mountain-Woodfibre Gas Pipeline Project | Talking Energy webpage.

Sampling Methodology

The monitoring and sampling has been carried out in accordance with the procedures described in the most recent edition of the “British Columbia Field Sampling Manual” using field equipment and laboratory samples to meet daily and real-time requirements for the Waste Discharge Permit.

In the receiving environments, real-time and daily readings were monitored at the same time with one piece of equipment, allowing real-time daily readings. Visible sheen was monitored through visual inspections during times of discharge or sampling.

At the point of discharges, parameters are monitored using field equipment and water quality sondes, as well as discrete weekly water quality sampling events for laboratory analyses. Table 1 and Table 2 below describe this monitoring.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	June 8 to June 14, 2026
Report #	116
Page	4 of 7

Table 1. Monitor Details for the Point of Discharge from the Water Treatment System-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily (or per batch)	DO	Monitoring using YSI ProDSS
	ORP	Monitoring using YSI ProDSS
	Salinity	Monitoring using YSI ProDSS
Real-time (or per batch)	pH	Monitoring using GF Dryloc pH Series NPT
	Temperature	Monitoring using LevelPro PT100 Temperature and Signet 2350 Temp sensor
	NTU	Monitoring using Observer NEP9504GPI
	Electrical Conductivity	Monitoring using ProCon C450
Weekly (or per batch) Lab Samples	List prescribed in permit	Lab samples*

* Indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.

Table 2. Monitor Details for the Receiving Environment (upstream and downstream)-BC Rail and Woodfibre

Permit Frequency	Parameters	Details
During discharges	Visible Sheen	In field inspection
Daily	DO	Monitoring using Sonde- AquaTROLL 600 datalogger
	ORP	Monitoring using Sonde- AquaTROLL 600 datalogger
	Salinity	Monitoring using Sonde- AquaTROLL 600 datalogger
Real-time	pH	Monitoring using Sonde- AquaTROLL 600 datalogger
	Temperature	Monitoring using Sonde- AquaTROLL 600 datalogger
	NTU	Monitoring using Sonde- AquaTROLL 600 datalogger
	Electrical Conductivity	Monitoring using Sonde- AquaTROLL 600 datalogger
Weekly Lab Samples	List prescribed in permit	Lab samples*

* Indicates that weekly lab samples are currently only collected at the Woodfibre site, as approved by BCER, given that there is currently no discharge from the BC Rail site.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week	June 8 to June 14, 2026
Report #	116
Page	5 of 7

Summary-BC Rail Site

Site Activities

- The soft ground tunnel has been completed and FortisBC is in the process of demobilizing equipment and preparations for pipe stringing.

Discharge from Water Treatment Plant

- There was no discharges this week from the BC Rail Site.

Receiving Environment Monitoring-Squamish River

Tables 3 and 4 below provide information on water quality monitoring. Lab sampling has been put on hold with permission from BCER as there are no discharges. Appendix B includes a full set of results with real-time data. The receiving environment is being monitored as outlined in the permit and confirmed by BCER, with additional oversight by the QP.

Table 3. Upstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Upstream	N/A	Yes *	Full set of real time monitoring results are provided in Appendix B. **

Table 4. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
Squamish River Downstream	N/A	Yes *	Full set of real time monitoring results are provided in Appendix B. **

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

** Data gaps in available in-situ continuous monitoring data, included:

- SQU US
 - No data gaps were observed.
- SQU DS
 - No data gaps were observed.



**Eagle Mountain – Woodfibre Gas Pipeline Project
Waste Discharge Permit PE-110163 Report**

Reporting Week

June 8 to June 14,
2026

Report #

116

Page

6 of 7

Summary-Woodfibre Site

Site Activities

- Weekly upstream, downstream, and end of pipe water quality sampling performed by the QP.
- On-going tunnelling at WLNG and grouting works to mitigate water ingress.

Exceedances

The following reportable exceedance was reported during the June 8 to June 14, 2026, reporting period:

- Turbidity at EAS DS was elevated on June 12th and 13th, it went back within normal range after the data logger was cleaned. This was not deemed an exceedance.
- A review of continuous turbidity monitoring data from the WLNG EOP indicates that turbidity from the water treatment plants were generally lower than turbidity measured at EAS DS throughout most of the reporting period, with the exception of multiple short-duration spike events.

Discharge from Water Treatment Plant

Appendix C includes volume information and real-time/field samples from the discharge.

Receiving Environment Monitoring-East Creek

Tables 5 and 6 below provide information on water quality monitoring. Appendix D includes a full set of results with real-time data. The receiving environment is being monitored as outlined in the permit with additional oversight by the QP.

Table 5. Upstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Upstream	2026-06-09	Yes *	Full set of results are provided in Appendix D.**

Table 6. Downstream Monitoring Information

Location	Date of Lab Sample	Real-time Monitored	Results
East Creek Downstream	2026-06-09	Yes *	Full set of results are provided in Appendix D.**

* Sondes set up to log temperature, specific conductivity, salinity (in PSU), pH, ORP, DO (mg/L), and turbidity (NTU) at 15-minute intervals.

**Data gaps in available in-situ continuous monitoring data, included:

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Page	7 of 7

- EAS US
 - No data gaps were observed.
- EAS DS
 - No data gaps were observed.

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix A	A-1

Appendix A:
BCR Site Point of Discharge from Water
Treatment Plant Documentation

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix A	A-2

BCR Site Batch Sample Analysis
No Discharge

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix A	A-3

BCR Site WTP Discharge Field Notes and Logs
No Discharge

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix B	B-1

Appendix B: BCR Site Receiving Environment Documentation

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix B	B-2

BCR Site Receiving Environment Sample Analysis No Lab Samples

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix B	B-3

BCR Site Receiving Environment Field Notes and Logs

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-08 00:00:00	9.00	32.12	567.34	7.40	10.37	5.10	0.01
SQU-DS	2026-06-08 00:15:00	8.97	31.92	567.52	7.40	10.36	1.21	0.01
SQU-DS	2026-06-08 00:30:00	8.93	31.81	568.12	7.40	10.38	0.40	0.01
SQU-DS	2026-06-08 00:45:00	8.86	31.84	568.34	7.41	10.39	0.65	0.01
SQU-DS	2026-06-08 01:00:00	8.82	31.57	569.72	7.39	10.39	0.79	0.01
SQU-DS	2026-06-08 01:15:00	8.76	31.77	570.07	7.39	10.40	1.02	0.01
SQU-DS	2026-06-08 01:30:00	8.71	31.78	571.13	7.38	10.42	5.91	0.01
SQU-DS	2026-06-08 01:45:00	8.68	31.74	570.92	7.38	10.41	7.25	0.01
SQU-DS	2026-06-08 02:00:00	8.62	31.77	571.18	7.37	10.42	8.72	0.01
SQU-DS	2026-06-08 02:15:00	8.60	31.65	571.88	7.36	10.42	12.14	0.01
SQU-DS	2026-06-08 02:30:00	8.56	31.28	571.92	7.35	10.43	14.49	0.01
SQU-DS	2026-06-08 02:45:00	8.51	31.33	571.95	7.36	10.45	19.74	0.01
SQU-DS	2026-06-08 03:00:00	8.47	31.11	571.95	7.35	10.44	20.56	0.01
SQU-DS	2026-06-08 03:15:00	8.44	31.01	573.78	7.31	10.47	24.32	0.01
SQU-DS	2026-06-08 03:30:00	8.41	30.97	573.74	7.31	10.47	26.21	0.01
SQU-DS	2026-06-08 03:45:00	8.39	30.82	572.28	7.33	10.46	26.62	0.01
SQU-DS	2026-06-08 04:00:00	8.35	30.83	573.23	7.31	10.49	25.01	0.01
SQU-DS	2026-06-08 04:15:00	8.32	30.69	572.75	7.31	10.49	31.17	0.01
SQU-DS	2026-06-08 04:30:00	8.27	30.63	573.22	7.29	10.49	28.39	0.01
SQU-DS	2026-06-08 04:45:00	8.24	30.65	573.57	7.28	10.51	28.71	0.01
SQU-DS	2026-06-08 05:00:00	8.21	30.71	574.66	7.26	10.52	22.96	0.01
SQU-DS	2026-06-08 05:15:00	8.19	30.71	573.13	7.28	10.51	26.49	0.01
SQU-DS	2026-06-08 05:30:00	8.16	30.73	573.17	7.27	10.51	23.85	0.01
SQU-DS	2026-06-08 05:45:00	8.13	30.47	573.08	7.27	10.52	27.84	0.01
SQU-DS	2026-06-08 06:00:00	8.10	30.68	572.83	7.27	10.55	28.41	0.01
SQU-DS	2026-06-08 06:15:00	8.07	30.83	572.71	7.27	10.53	30.72	0.01
SQU-DS	2026-06-08 06:30:00	8.04	30.78	572.93	7.27	10.56	32.62	0.01
SQU-DS	2026-06-08 06:45:00	8.03	30.53	573.31	7.26	10.56	27.66	0.01
SQU-DS	2026-06-08 07:00:00	8.01	30.57	571.99	7.28	10.56	29.86	0.01
SQU-DS	2026-06-08 07:15:00	7.99	30.51	572.37	7.27	10.59	28.64	0.01
SQU-DS	2026-06-08 07:30:00	7.98	30.69	571.83	7.28	10.60	25.18	0.01
SQU-DS	2026-06-08 07:45:00	7.98	30.80	572.42	7.27	10.60	28.74	0.01
SQU-DS	2026-06-08 08:00:00	7.97	30.84	570.49	7.30	10.62	26.91	0.01
SQU-DS	2026-06-08 08:15:00	7.98	30.65	571.16	7.28	10.63	29.62	0.01
SQU-DS	2026-06-08 08:30:00	8.01	30.68	571.57	7.27	10.64	24.34	0.01
SQU-DS	2026-06-08 08:45:00	8.02	30.81	569.88	7.30	10.64	29.15	0.01
SQU-DS	2026-06-08 09:00:00	8.05	30.83	569.34	7.31	10.65	29.87	0.01
SQU-DS	2026-06-08 09:15:00	8.08	31.04	570.16	7.29	10.66	26.61	0.01
SQU-DS	2026-06-08 09:30:00	8.10	31.12	569.11	7.31	10.67	24.83	0.01
SQU-DS	2026-06-08 09:45:00	8.14	31.17	570.73	7.28	10.67	28.22	0.01
SQU-DS	2026-06-08 10:00:00	8.19	31.11	569.57	7.30	10.68	31.03	0.01
SQU-DS	2026-06-08 10:15:00	8.20	31.39	569.16	7.31	10.68	26.88	0.01
SQU-DS	2026-06-08 10:30:00	8.22	31.41	566.80	7.34	10.69	30.72	0.01
SQU-DS	2026-06-08 10:45:00	8.25	31.27	569.05	7.30	10.69	26.23	0.01
SQU-DS	2026-06-08 11:00:00	8.29	31.18	567.07	7.33	10.69	29.84	0.01
SQU-DS	2026-06-08 11:15:00	8.33	31.19	567.52	7.32	10.67	28.52	0.01
SQU-DS	2026-06-08 11:30:00	8.38	31.34	567.05	7.33	10.66	25.10	0.01
SQU-DS	2026-06-08 11:45:00	8.44	31.24	567.38	7.32	10.65	25.93	0.01
SQU-DS	2026-06-08 12:00:00	8.50	31.31	565.32	7.35	10.66	31.03	0.01
SQU-DS	2026-06-08 12:15:00	8.59	31.04	567.55	7.31	10.64	29.72	0.01
SQU-DS	2026-06-08 12:30:00	8.61	31.30	566.82	7.32	10.63	28.45	0.01
SQU-DS	2026-06-08 12:45:00	8.65	31.33	567.05	7.32	10.63	32.14	0.01
SQU-DS	2026-06-08 13:00:00	8.69	31.37	564.53	7.36	10.61	29.56	0.01
SQU-DS	2026-06-08 13:15:00	8.74	31.30	565.69	7.34	10.61	29.79	0.01
SQU-DS	2026-06-08 13:30:00	8.79	31.44	566.20	7.33	10.60	29.55	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-08 13:45:00	8.83	31.49	566.01	7.33	10.59	28.59	0.01
SQU-DS	2026-06-08 14:00:00	8.85	31.31	566.56	7.33	10.58	27.56	0.01
SQU-DS	2026-06-08 14:15:00	8.87	31.34	565.66	7.34	10.58	28.18	0.01
SQU-DS	2026-06-08 14:30:00	8.87	31.41	566.73	7.32	10.57	29.91	0.01
SQU-DS	2026-06-08 14:45:00	8.86	31.50	566.95	7.32	10.57	27.00	0.01
SQU-DS	2026-06-08 15:00:00	8.87	31.33	567.89	7.31	10.55	24.93	0.01
SQU-DS	2026-06-08 15:15:00	8.99	0.08	562.35	7.41	10.54	2.02	0.00
SQU-DS	2026-06-08 15:30:00	8.91	32.45	564.62	7.39	10.57	35.61	0.01
SQU-DS	2026-06-08 15:45:00	8.91	32.93	567.37	7.34	10.56	36.56	0.01
SQU-DS	2026-06-08 16:00:00	8.92	32.61	566.72	7.36	10.56	38.40	0.01
SQU-DS	2026-06-08 16:15:00	8.95	32.37	565.27	7.40	10.55	38.78	0.01
SQU-DS	2026-06-08 16:30:00	8.95	32.76	569.62	7.32	10.55	38.27	0.01
SQU-DS	2026-06-08 16:45:00	8.95	32.82	565.03	7.41	10.54	39.36	0.01
SQU-DS	2026-06-08 17:00:00	8.97	32.73	565.39	7.41	10.55	38.88	0.01
SQU-DS	2026-06-08 17:15:00	9.01	32.89	566.52	7.38	10.50	42.36	0.01
SQU-DS	2026-06-08 17:30:00	9.04	32.88	564.88	7.41	10.51	38.40	0.01
SQU-DS	2026-06-08 17:45:00	9.06	33.06	565.50	7.40	10.50	40.89	0.01
SQU-DS	2026-06-08 18:00:00	9.09	33.09	565.56	7.40	10.48	40.43	0.01
SQU-DS	2026-06-08 18:15:00	9.12	33.09	565.56	7.40	10.48	41.58	0.01
SQU-DS	2026-06-08 18:30:00	9.16	33.06	565.71	7.41	10.47	41.32	0.01
SQU-DS	2026-06-08 18:45:00	9.18	33.38	566.14	7.40	10.46	41.39	0.01
SQU-DS	2026-06-08 19:00:00	9.18	33.40	566.38	7.41	10.45	40.36	0.01
SQU-DS	2026-06-08 19:15:00	9.20	33.48	566.60	7.40	10.44	39.13	0.01
SQU-DS	2026-06-08 19:30:00	9.21	33.43	567.21	7.39	10.41	39.51	0.01
SQU-DS	2026-06-08 19:45:00	9.21	33.59	566.44	7.41	10.41	38.25	0.01
SQU-DS	2026-06-08 20:00:00	9.21	33.64	567.57	7.39	10.40	41.77	0.01
SQU-DS	2026-06-08 20:15:00	9.20	33.57	569.97	7.35	10.36	44.61	0.01
SQU-DS	2026-06-08 20:30:00	9.21	33.36	568.56	7.38	10.36	42.65	0.01
SQU-DS	2026-06-08 20:45:00	9.19	33.44	569.36	7.38	10.36	43.87	0.01
SQU-DS	2026-06-08 21:00:00	9.19	33.27	568.68	7.39	10.35	41.39	0.01
SQU-DS	2026-06-08 21:15:00	9.20	33.18	568.46	7.40	10.33	42.51	0.01
SQU-DS	2026-06-08 21:30:00	9.19	33.14	568.78	7.39	10.33	39.39	0.01
SQU-DS	2026-06-08 21:45:00	9.17	33.13	567.55	7.41	10.31	41.48	0.01
SQU-DS	2026-06-08 22:00:00	9.15	32.92	567.08	7.42	10.31	40.94	0.01
SQU-DS	2026-06-08 22:15:00	9.15	32.70	567.01	7.42	10.31	43.34	0.01
SQU-DS	2026-06-08 22:30:00	9.10	32.79	566.90	7.42	10.31	38.80	0.01
SQU-DS	2026-06-08 22:45:00	9.07	32.94	567.39	7.40	10.31	74.19	0.01
SQU-DS	2026-06-08 23:00:00	9.04	32.87	565.73	7.42	10.33	39.92	0.01
SQU-DS	2026-06-08 23:15:00	9.01	32.99	565.18	7.43	10.32	39.28	0.01
SQU-DS	2026-06-08 23:30:00	8.97	33.75	566.49	7.45	10.33	42.06	0.01
SQU-DS	2026-06-08 23:45:00	8.95	32.98	568.14	7.45	10.34	41.87	0.01
SQU-DS	2026-06-09 00:00:00	8.92	33.30	570.14	7.43	10.34	40.37	0.01
SQU-DS	2026-06-09 00:15:00	8.91	33.41	569.05	7.46	10.34	36.50	0.01
SQU-DS	2026-06-09 00:30:00	8.91	33.52	570.18	7.46	10.35	33.43	0.01
SQU-DS	2026-06-09 00:45:00	8.89	33.85	568.78	7.46	10.34	33.60	0.01
SQU-DS	2026-06-09 01:00:00	8.87	33.89	569.96	7.50	10.35	24.15	0.01
SQU-DS	2026-06-09 01:15:00	8.83	34.35	569.92	7.49	10.36	31.74	0.02
SQU-DS	2026-06-09 01:30:00	8.83	34.80	569.08	7.48	10.37	33.73	0.02
SQU-DS	2026-06-09 01:45:00	8.79	35.36	568.17	7.49	10.37	34.86	0.02
SQU-DS	2026-06-09 02:00:00	8.77	35.50	568.25	7.46	10.36	35.18	0.02
SQU-DS	2026-06-09 02:15:00	8.74	35.45	568.18	7.45	10.37	33.06	0.02
SQU-DS	2026-06-09 02:30:00	8.70	35.74	567.53	7.46	10.36	32.37	0.02
SQU-DS	2026-06-09 02:45:00	8.67	35.40	566.69	7.45	10.36	30.70	0.02
SQU-DS	2026-06-09 03:00:00	8.64	35.07	566.73	7.43	10.36	33.43	0.02
SQU-DS	2026-06-09 03:15:00	8.61	34.48	566.18	7.42	10.38	40.95	0.02

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-09 03:30:00	8.58	34.03	565.18	7.43	10.39	47.73	0.01
SQU-DS	2026-06-09 03:45:00	8.55	33.75	567.75	7.38	10.40	51.95	0.01
SQU-DS	2026-06-09 04:00:00	8.53	33.62	567.19	7.39	10.40	46.42	0.01
SQU-DS	2026-06-09 04:15:00	8.50	33.27	566.63	7.39	10.41	53.84	0.01
SQU-DS	2026-06-09 04:30:00	8.48	33.23	565.10	7.41	10.42	44.69	0.01
SQU-DS	2026-06-09 04:45:00	8.45	33.09	567.14	7.37	10.42	48.59	0.01
SQU-DS	2026-06-09 05:00:00	8.44	32.81	567.06	7.37	10.42	46.11	0.01
SQU-DS	2026-06-09 05:15:00	8.42	33.05	565.11	7.40	10.43	43.79	0.01
SQU-DS	2026-06-09 05:30:00	8.40	33.22	565.83	7.38	10.43	46.45	0.01
SQU-DS	2026-06-09 05:45:00	8.40	32.98	565.48	7.38	10.45	49.70	0.01
SQU-DS	2026-06-09 06:00:00	8.38	33.08	565.45	7.37	10.45	49.55	0.01
SQU-DS	2026-06-09 06:15:00	8.38	32.95	565.10	7.37	10.47	46.76	0.01
SQU-DS	2026-06-09 06:30:00	8.37	33.08	564.95	7.37	10.46	49.85	0.01
SQU-DS	2026-06-09 06:45:00	8.36	33.12	564.16	7.38	10.47	48.64	0.01
SQU-DS	2026-06-09 07:00:00	8.34	33.27	564.03	7.38	10.49	51.20	0.01
SQU-DS	2026-06-09 07:15:00	8.34	33.13	563.01	7.40	10.49	49.69	0.01
SQU-DS	2026-06-09 07:30:00	8.33	33.14	563.75	7.38	10.51	49.50	0.01
SQU-DS	2026-06-09 07:45:00	8.33	33.18	565.32	7.35	10.52	48.72	0.01
SQU-DS	2026-06-09 08:00:00	8.34	33.06	563.78	7.37	10.53	49.82	0.01
SQU-DS	2026-06-09 08:15:00	8.34	33.21	561.86	7.40	10.54	51.43	0.01
SQU-DS	2026-06-09 08:30:00	8.34	33.32	564.69	7.35	10.53	52.27	0.01
SQU-DS	2026-06-09 08:45:00	8.35	33.50	561.92	7.39	10.55	45.04	0.01
SQU-DS	2026-06-09 09:00:00	8.36	33.47	561.83	7.39	10.55	53.21	0.01
SQU-DS	2026-06-09 09:15:00	8.37	33.53	562.68	7.37	10.58	52.79	0.01
SQU-DS	2026-06-09 09:30:00	8.39	33.60	560.00	7.41	10.56	49.54	0.01
SQU-DS	2026-06-09 09:45:00	8.39	33.83	560.20	7.41	10.58	50.40	0.01
SQU-DS	2026-06-09 10:00:00	8.42	33.72	561.36	7.39	10.60	50.47	0.01
SQU-DS	2026-06-09 10:15:00	8.42	33.77	558.31	7.43	10.59	59.95	0.01
SQU-DS	2026-06-09 10:30:00	8.43	33.73	558.60	7.42	10.62	57.19	0.01
SQU-DS	2026-06-09 10:45:00	8.43	33.80	559.26	7.40	10.61	53.13	0.01
SQU-DS	2026-06-09 11:00:00	8.45	33.66	557.02	7.43	10.63	53.69	0.01
SQU-DS	2026-06-09 11:15:00	8.48	33.43	560.80	7.36	10.64	40.18	0.01
SQU-DS	2026-06-09 11:30:00	8.49	33.46	555.52	7.43	10.66	58.71	0.01
SQU-DS	2026-06-09 11:45:00	8.53	33.37	555.11	7.43	10.66	54.08	0.01
SQU-DS	2026-06-09 12:00:00	8.54	33.43	554.80	7.43	10.67	56.20	0.01
SQU-DS	2026-06-09 12:15:00	8.56	33.61	555.57	7.41	10.67	32.15	0.01
SQU-DS	2026-06-09 12:30:00	8.59	33.60	553.98	7.43	10.67	53.80	0.01
SQU-DS	2026-06-09 12:45:00	8.62	33.60	553.73	7.43	10.69	54.51	0.01
SQU-DS	2026-06-09 13:00:00	8.65	33.47	553.41	7.43	10.70	48.52	0.01
SQU-DS	2026-06-09 13:15:00	8.67	33.51	550.13	7.49	10.69	55.30	0.01
SQU-DS	2026-06-09 13:30:00	8.70	33.56	551.46	7.46	10.71	50.04	0.01
SQU-DS	2026-06-09 13:45:00	8.74	33.52	550.65	7.47	10.71	51.88	0.01
SQU-DS	2026-06-09 14:00:00	8.77	33.54	552.68	7.43	10.70	56.12	0.01
SQU-DS	2026-06-09 14:15:00	8.77	33.61	549.17	7.49	10.70	57.00	0.01
SQU-DS	2026-06-09 14:30:00	8.77	33.54	550.82	7.47	10.69	55.01	0.01
SQU-DS	2026-06-09 14:45:00	8.78	33.50	549.89	7.49	10.70	59.81	0.01
SQU-DS	2026-06-09 15:00:00	8.79	33.30	550.94	7.47	10.71	59.66	0.01
SQU-DS	2026-06-09 15:15:00	8.85	33.10	550.48	7.48	10.69	59.77	0.01
SQU-DS	2026-06-09 15:30:00	8.86	33.01	550.48	7.48	10.68	58.28	0.01
SQU-DS	2026-06-09 15:45:00	8.89	33.02	550.61	7.48	10.69	54.82	0.01
SQU-DS	2026-06-09 16:00:00	8.92	32.95	551.78	7.45	10.67	59.86	0.01
SQU-DS	2026-06-09 16:15:00	8.93	32.57	549.42	7.49	10.67	63.45	0.01
SQU-DS	2026-06-09 16:30:00	8.91	32.41	552.28	7.43	10.67	62.33	0.01
SQU-DS	2026-06-09 16:45:00	8.92	32.41	551.76	7.45	10.66	52.55	0.01
SQU-DS	2026-06-09 17:00:00	8.91	32.32	548.73	7.49	10.65	59.65	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-09 17:15:00	8.89	32.55	551.04	7.44	10.66	60.60	0.01
SQU-DS	2026-06-09 17:30:00	8.94	32.65	548.37	7.47	10.65	66.64	0.01
SQU-DS	2026-06-09 17:45:00	8.91	32.35	548.25	7.47	10.64	64.84	0.01
SQU-DS	2026-06-09 18:00:00	8.88	32.50	547.76	7.48	10.66	66.32	0.01
SQU-DS	2026-06-09 18:15:00	8.85	32.60	549.02	7.47	10.65	65.10	0.01
SQU-DS	2026-06-09 18:30:00	8.84	32.75	549.81	7.47	10.64	64.46	0.01
SQU-DS	2026-06-09 18:45:00	8.83	32.69	549.92	7.48	10.64	65.76	0.01
SQU-DS	2026-06-09 19:00:00	8.84	32.53	552.85	7.43	10.63	67.03	0.01
SQU-DS	2026-06-09 19:15:00	8.82	32.54	549.98	7.49	10.63	61.66	0.01
SQU-DS	2026-06-09 19:30:00	8.82	32.71	550.73	7.48	10.63	72.27	0.01
SQU-DS	2026-06-09 19:45:00	8.81	32.53	554.05	7.42	10.62	71.10	0.01
SQU-DS	2026-06-09 20:00:00	8.82	32.26	550.79	7.48	10.63	66.04	0.01
SQU-DS	2026-06-09 20:15:00	8.77	32.46	550.30	7.49	10.63	56.62	0.01
SQU-DS	2026-06-09 20:30:00	8.76	32.85	553.51	7.42	10.62	59.41	0.01
SQU-DS	2026-06-09 20:45:00	8.75	32.53	550.08	7.49	10.63	68.31	0.01
SQU-DS	2026-06-09 21:00:00	8.73	32.30	550.35	7.49	10.64	68.64	0.01
SQU-DS	2026-06-09 21:15:00	8.71	32.30	552.13	7.46	10.64	76.63	0.01
SQU-DS	2026-06-09 21:30:00	8.66	32.23	551.70	7.48	10.63	72.38	0.01
SQU-DS	2026-06-09 21:45:00	8.67	31.99	552.18	7.48	10.64	74.37	0.01
SQU-DS	2026-06-09 22:00:00	8.63	31.91	552.45	7.48	10.63	72.56	0.01
SQU-DS	2026-06-09 22:15:00	8.57	31.44	554.75	7.46	10.66	72.23	0.01
SQU-DS	2026-06-09 22:30:00	8.53	31.23	552.54	7.52	10.67	67.02	0.01
SQU-DS	2026-06-09 22:45:00	8.46	31.21	554.37	7.50	10.69	75.57	0.01
SQU-DS	2026-06-09 23:00:00	8.41	31.69	556.76	7.51	10.71	59.17	0.01
SQU-DS	2026-06-09 23:15:00	8.30	31.32	555.23	7.52	10.74	51.54	0.01
SQU-DS	2026-06-09 23:30:00	8.25	31.53	553.72	7.56	10.75	34.96	0.01
SQU-DS	2026-06-09 23:45:00	8.21	32.09	554.59	7.56	10.77	31.56	0.01
SQU-DS	2026-06-10 00:00:00	8.18	31.79	556.20	7.59	10.80	13.82	0.01
SQU-DS	2026-06-10 00:15:00	8.15	30.63	557.72	7.57	10.83	9.05	0.01
SQU-DS	2026-06-10 00:30:00	8.13	29.73	559.32	7.55	10.84	3.43	0.01
SQU-DS	2026-06-10 00:45:00	8.10	28.91	560.58	7.54	10.86	0.79	0.01
SQU-DS	2026-06-10 01:00:00	8.04	28.54	561.80	7.53	10.85	0.00	0.01
SQU-DS	2026-06-10 01:15:00	7.98	27.59	563.07	7.52	10.87	0.00	0.01
SQU-DS	2026-06-10 01:30:00	7.92	26.82	564.12	7.52	10.90	0.00	0.01
SQU-DS	2026-06-10 01:45:00	7.89	26.31	565.05	7.51	10.91	0.00	0.01
SQU-DS	2026-06-10 02:00:00	7.88	26.08	565.87	7.51	10.90	0.00	0.01
SQU-DS	2026-06-10 02:15:00	7.84	25.54	567.46	7.49	10.91	0.00	0.01
SQU-DS	2026-06-10 02:30:00	7.80	25.32	568.19	7.48	10.92	0.00	0.01
SQU-DS	2026-06-10 02:45:00	7.81	25.06	568.95	7.48	10.91	0.00	0.01
SQU-DS	2026-06-10 03:00:00	7.76	24.84	570.06	7.47	10.92	0.00	0.01
SQU-DS	2026-06-10 03:15:00	7.73	24.49	569.89	7.47	10.92	0.13	0.01
SQU-DS	2026-06-10 03:30:00	7.76	25.05	569.28	7.45	10.92	2.15	0.01
SQU-DS	2026-06-10 03:45:00	7.72	24.73	569.14	7.44	10.93	6.83	0.01
SQU-DS	2026-06-10 04:00:00	7.71	24.57	568.61	7.44	10.93	11.14	0.01
SQU-DS	2026-06-10 04:15:00	7.72	25.14	569.12	7.42	10.92	14.03	0.01
SQU-DS	2026-06-10 04:30:00	7.69	25.09	568.49	7.43	10.93	16.28	0.01
SQU-DS	2026-06-10 04:45:00	7.65	25.20	568.57	7.42	10.95	17.65	0.01
SQU-DS	2026-06-10 05:00:00	7.63	25.39	569.19	7.41	10.95	22.53	0.01
SQU-DS	2026-06-10 05:15:00	7.61	25.28	569.42	7.40	10.96	21.18	0.01
SQU-DS	2026-06-10 05:30:00	7.60	25.50	569.55	7.40	10.96	23.53	0.01
SQU-DS	2026-06-10 05:45:00	7.61	25.53	570.01	7.38	10.96	24.62	0.01
SQU-DS	2026-06-10 06:00:00	7.57	25.49	570.25	7.37	10.97	30.54	0.01
SQU-DS	2026-06-10 06:15:00	7.59	25.55	569.78	7.37	10.98	24.50	0.01
SQU-DS	2026-06-10 06:30:00	7.58	25.89	568.91	7.38	10.98	26.82	0.01
SQU-DS	2026-06-10 06:45:00	7.57	25.71	568.60	7.37	10.99	29.92	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-10 07:00:00	7.57	25.71	567.08	7.38	11.00	34.64	0.01
SQU-DS	2026-06-10 07:15:00	7.58	25.68	565.95	7.37	11.01	32.23	0.01
SQU-DS	2026-06-10 07:30:00	7.58	25.67	565.22	7.36	11.02	35.66	0.01
SQU-DS	2026-06-10 07:45:00	7.58	25.79	563.50	7.37	11.01	29.93	0.01
SQU-DS	2026-06-10 08:00:00	7.63	26.44	561.70	7.38	11.01	39.07	0.01
SQU-DS	2026-06-10 08:15:00	7.65	26.43	560.74	7.38	11.01	34.95	0.01
SQU-DS	2026-06-10 08:30:00	7.68	26.35	559.53	7.38	11.02	34.54	0.01
SQU-DS	2026-06-10 08:45:00	7.73	26.39	558.51	7.38	11.02	36.79	0.01
SQU-DS	2026-06-10 09:00:00	7.80	26.52	556.71	7.37	11.01	36.13	0.01
SQU-DS	2026-06-10 09:15:00	7.85	26.39	554.30	7.38	11.02	34.83	0.01
SQU-DS	2026-06-10 09:30:00	7.92	26.72	553.23	7.36	11.02	34.54	0.01
SQU-DS	2026-06-10 09:45:00	7.97	26.72	551.83	7.37	11.02	33.56	0.01
SQU-DS	2026-06-10 10:00:00	8.08	26.27	549.18	7.37	11.02	33.46	0.01
SQU-DS	2026-06-10 10:15:00	8.13	26.15	547.14	7.38	11.02	35.06	0.01
SQU-DS	2026-06-10 10:30:00	8.18	26.29	545.66	7.39	11.01	31.74	0.01
SQU-DS	2026-06-10 10:45:00	8.24	26.32	544.25	7.38	11.01	37.65	0.01
SQU-DS	2026-06-10 11:00:00	8.25	26.29	543.14	7.40	11.00	35.94	0.01
SQU-DS	2026-06-10 11:15:00	8.27	26.21	543.15	7.39	11.01	34.32	0.01
SQU-DS	2026-06-10 11:30:00	8.32	26.23	543.06	7.38	10.98	34.63	0.01
SQU-DS	2026-06-10 11:45:00	8.38	26.58	541.57	7.40	10.97	35.33	0.01
SQU-DS	2026-06-10 12:00:00	8.41	26.52	541.47	7.41	10.97	39.29	0.01
SQU-DS	2026-06-10 12:15:00	8.47	26.46	542.28	7.39	10.95	30.96	0.01
SQU-DS	2026-06-10 12:30:00	8.54	26.40	541.58	7.41	10.96	37.04	0.01
SQU-DS	2026-06-10 12:45:00	8.57	26.43	542.81	7.39	10.95	31.00	0.01
SQU-DS	2026-06-10 13:00:00	8.58	26.55	542.48	7.40	10.95	36.08	0.01
SQU-DS	2026-06-10 13:15:00	8.63	26.70	542.77	7.40	10.94	36.99	0.01
SQU-DS	2026-06-10 13:30:00	8.68	26.91	543.00	7.41	10.94	31.99	0.01
SQU-DS	2026-06-10 13:45:00	8.71	26.77	544.18	7.40	10.92	33.19	0.01
SQU-DS	2026-06-10 14:00:00	8.73	26.67	544.47	7.40	10.91	36.63	0.01
SQU-DS	2026-06-10 14:15:00	8.77	26.73	544.84	7.40	10.90	34.62	0.01
SQU-DS	2026-06-10 14:30:00	8.82	26.85	545.01	7.41	10.88	36.54	0.01
SQU-DS	2026-06-10 14:45:00	8.87	27.17	545.66	7.42	10.87	27.91	0.01
SQU-DS	2026-06-10 15:00:00	8.91	27.16	546.62	7.40	10.86	35.03	0.01
SQU-DS	2026-06-10 15:15:00	8.94	27.41	547.27	7.40	10.85	35.24	0.01
SQU-DS	2026-06-10 15:30:00	8.95	27.71	547.35	7.42	10.84	34.01	0.01
SQU-DS	2026-06-10 15:45:00	8.96	27.52	548.76	7.41	10.84	28.90	0.01
SQU-DS	2026-06-10 16:00:00	8.97	27.71	549.60	7.41	10.83	33.62	0.01
SQU-DS	2026-06-10 16:15:00	8.98	27.60	551.13	7.39	10.83	33.01	0.01
SQU-DS	2026-06-10 16:30:00	8.97	27.94	551.11	7.41	10.82	36.28	0.01
SQU-DS	2026-06-10 16:45:00	8.96	27.79	552.53	7.40	10.82	37.00	0.01
SQU-DS	2026-06-10 17:00:00	8.93	27.93	553.14	7.40	10.80	33.46	0.01
SQU-DS	2026-06-10 17:15:00	8.92	27.85	554.59	7.38	10.80	34.56	0.01
SQU-DS	2026-06-10 17:30:00	8.91	27.78	554.65	7.40	10.80	35.51	0.01
SQU-DS	2026-06-10 17:45:00	8.90	28.04	555.90	7.39	10.79	36.12	0.01
SQU-DS	2026-06-10 18:00:00	8.89	27.85	557.27	7.38	10.78	34.08	0.01
SQU-DS	2026-06-10 18:15:00	8.89	27.91	557.87	7.38	10.77	34.87	0.01
SQU-DS	2026-06-10 18:30:00	8.90	27.98	558.61	7.38	10.77	36.10	0.01
SQU-DS	2026-06-10 18:45:00	8.90	28.27	557.95	7.39	10.74	36.61	0.01
SQU-DS	2026-06-10 19:00:00	8.90	28.22	559.46	7.38	10.74	32.28	0.01
SQU-DS	2026-06-10 19:15:00	8.90	28.41	559.38	7.38	10.73	33.40	0.01
SQU-DS	2026-06-10 19:30:00	8.93	28.45	560.39	7.38	10.73	33.40	0.01
SQU-DS	2026-06-10 19:45:00	8.95	28.47	560.50	7.38	10.73	31.24	0.01
SQU-DS	2026-06-10 20:00:00	8.95	28.67	561.46	7.37	10.74	33.28	0.01
SQU-DS	2026-06-10 20:15:00	8.98	28.74	561.65	7.37	10.72	38.31	0.01
SQU-DS	2026-06-10 20:30:00	8.97	28.85	561.23	7.38	10.70	35.65	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-10 20:45:00	8.97	28.95	562.08	7.37	10.68	34.96	0.01
SQU-DS	2026-06-10 21:00:00	8.96	29.13	562.44	7.37	10.67	30.90	0.01
SQU-DS	2026-06-10 21:15:00	8.95	29.12	562.46	7.38	10.66	34.60	0.01
SQU-DS	2026-06-10 21:30:00	8.93	29.06	563.77	7.36	10.66	34.46	0.01
SQU-DS	2026-06-10 21:45:00	8.93	29.07	563.81	7.36	10.64	31.38	0.01
SQU-DS	2026-06-10 22:00:00	8.92	29.19	564.27	7.35	10.64	32.63	0.01
SQU-DS	2026-06-10 22:15:00	8.91	29.42	563.16	7.37	10.62	37.03	0.01
SQU-DS	2026-06-10 22:30:00	8.90	29.46	564.02	7.36	10.60	36.23	0.01
SQU-DS	2026-06-10 22:45:00	8.88	29.26	564.26	7.36	10.62	35.65	0.01
SQU-DS	2026-06-10 23:00:00	8.87	29.35	564.25	7.36	10.61	36.08	0.01
SQU-DS	2026-06-10 23:15:00	8.85	29.47	563.97	7.37	10.62	30.25	0.01
SQU-DS	2026-06-10 23:30:00	8.82	29.54	564.07	7.37	10.63	32.39	0.01
SQU-DS	2026-06-10 23:45:00	8.80	29.26	564.16	7.37	10.63	29.80	0.01
SQU-DS	2026-06-11 00:00:00	8.76	29.55	563.91	7.38	10.65	32.64	0.01
SQU-DS	2026-06-11 00:15:00	8.73	29.46	565.41	7.36	10.64	30.51	0.01
SQU-DS	2026-06-11 00:30:00	8.70	29.34	564.20	7.38	10.64	26.41	0.01
SQU-DS	2026-06-11 00:45:00	8.66	29.38	563.79	7.40	10.63	19.53	0.01
SQU-DS	2026-06-11 01:00:00	8.62	29.34	563.82	7.40	10.65	15.85	0.01
SQU-DS	2026-06-11 01:15:00	8.59	29.49	564.94	7.39	10.66	13.70	0.01
SQU-DS	2026-06-11 01:30:00	8.55	29.60	564.97	7.40	10.67	10.66	0.01
SQU-DS	2026-06-11 01:45:00	8.52	29.38	564.66	7.41	10.67	7.32	0.01
SQU-DS	2026-06-11 02:00:00	8.49	29.20	564.49	7.41	10.68	6.31	0.01
SQU-DS	2026-06-11 02:15:00	8.45	28.89	565.76	7.40	10.68	5.03	0.01
SQU-DS	2026-06-11 02:30:00	8.42	29.25	565.84	7.40	10.67	8.20	0.01
SQU-DS	2026-06-11 02:45:00	8.41	29.53	565.81	7.40	10.68	7.52	0.01
SQU-DS	2026-06-11 03:00:00	8.38	29.29	566.70	7.39	10.69	10.77	0.01
SQU-DS	2026-06-11 03:15:00	8.36	29.21	566.42	7.39	10.68	13.00	0.01
SQU-DS	2026-06-11 03:30:00	8.35	29.25	567.19	7.38	10.66	17.54	0.01
SQU-DS	2026-06-11 03:45:00	8.35	29.51	567.45	7.37	10.68	17.16	0.01
SQU-DS	2026-06-11 04:00:00	8.34	29.51	568.67	7.34	10.69	20.41	0.01
SQU-DS	2026-06-11 04:15:00	8.32	29.38	568.72	7.34	10.68	21.07	0.01
SQU-DS	2026-06-11 04:30:00	8.33	29.46	568.61	7.33	10.68	21.69	0.01
SQU-DS	2026-06-11 04:45:00	8.30	29.50	569.06	7.32	10.68	21.53	0.01
SQU-DS	2026-06-11 05:00:00	8.28	29.34	569.33	7.32	10.69	16.04	0.01
SQU-DS	2026-06-11 05:15:00	8.28	29.69	568.34	7.33	10.69	21.17	0.01
SQU-DS	2026-06-11 05:30:00	8.27	29.70	568.65	7.32	10.69	21.43	0.01
SQU-DS	2026-06-11 05:45:00	8.27	29.51	568.18	7.32	10.69	22.70	0.01
SQU-DS	2026-06-11 06:00:00	8.25	29.74	568.53	7.31	10.69	23.03	0.01
SQU-DS	2026-06-11 06:15:00	8.24	29.79	567.74	7.32	10.70	23.59	0.01
SQU-DS	2026-06-11 06:30:00	8.25	29.78	567.83	7.31	10.69	21.37	0.01
SQU-DS	2026-06-11 06:45:00	8.26	29.73	567.86	7.31	10.72	24.33	0.01
SQU-DS	2026-06-11 07:00:00	8.26	29.87	567.22	7.32	10.72	23.05	0.01
SQU-DS	2026-06-11 07:15:00	8.23	29.97	566.75	7.32	10.74	21.54	0.01
SQU-DS	2026-06-11 07:30:00	8.25	29.97	565.81	7.34	10.75	19.78	0.01
SQU-DS	2026-06-11 07:45:00	8.27	29.96	566.15	7.32	10.76	25.00	0.01
SQU-DS	2026-06-11 08:00:00	8.30	29.87	565.32	7.33	10.76	24.59	0.01
SQU-DS	2026-06-11 08:15:00	8.32	30.27	564.83	7.33	10.77	21.91	0.01
SQU-DS	2026-06-11 08:30:00	8.38	30.22	563.47	7.34	10.78	26.00	0.01
SQU-DS	2026-06-11 08:45:00	8.43	30.30	563.74	7.33	10.78	25.55	0.01
SQU-DS	2026-06-11 09:00:00	8.47	30.44	562.13	7.35	10.79	24.58	0.01
SQU-DS	2026-06-11 09:15:00	8.54	30.42	562.13	7.35	10.78	26.62	0.01
SQU-DS	2026-06-11 09:30:00	8.61	30.49	561.33	7.35	10.78	25.28	0.01
SQU-DS	2026-06-11 09:45:00	8.65	30.58	561.38	7.35	10.78	25.83	0.01
SQU-DS	2026-06-11 10:00:00	8.70	30.67	560.14	7.37	10.77	26.06	0.01
SQU-DS	2026-06-11 10:15:00	8.77	30.52	560.19	7.35	10.78	24.60	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-11 10:30:00	8.80	30.59	559.47	7.37	10.76	26.36	0.01
SQU-DS	2026-06-11 10:45:00	8.86	30.64	558.97	7.38	10.77	24.52	0.01
SQU-DS	2026-06-11 11:00:00	8.94	30.69	558.79	7.37	10.75	23.87	0.01
SQU-DS	2026-06-11 11:15:00	9.01	30.55	558.95	7.36	10.75	26.06	0.01
SQU-DS	2026-06-11 11:30:00	9.07	30.50	558.47	7.36	10.76	26.41	0.01
SQU-DS	2026-06-11 11:45:00	9.13	30.61	558.21	7.37	10.74	25.36	0.01
SQU-DS	2026-06-11 12:00:00	9.23	30.54	556.95	7.38	10.74	26.72	0.01
SQU-DS	2026-06-11 12:15:00	9.35	30.57	556.90	7.37	10.72	24.04	0.01
SQU-DS	2026-06-11 12:30:00	9.44	30.67	557.15	7.37	10.70	19.98	0.01
SQU-DS	2026-06-11 12:45:00	9.54	30.61	556.55	7.38	10.70	24.19	0.01
SQU-DS	2026-06-11 13:00:00	9.61	30.46	556.47	7.37	10.69	16.07	0.01
SQU-DS	2026-06-11 13:15:00	9.69	30.35	556.12	7.37	10.68	25.70	0.01
SQU-DS	2026-06-11 13:30:00	9.79	30.20	555.55	7.38	10.66	25.30	0.01
SQU-DS	2026-06-11 13:45:00	9.86	30.23	554.90	7.38	10.64	25.67	0.01
SQU-DS	2026-06-11 14:00:00	9.93	30.06	555.26	7.37	10.64	18.41	0.01
SQU-DS	2026-06-11 14:15:00	10.01	30.00	554.03	7.40	10.61	24.37	0.01
SQU-DS	2026-06-11 14:30:00	10.09	29.90	554.12	7.40	10.61	25.46	0.01
SQU-DS	2026-06-11 14:45:00	10.12	29.92	555.78	7.37	10.59	25.02	0.01
SQU-DS	2026-06-11 15:00:00	10.19	29.81	554.00	7.41	10.58	26.93	0.01
SQU-DS	2026-06-11 15:15:00	10.24	29.69	554.67	7.41	10.56	22.34	0.01
SQU-DS	2026-06-11 15:30:00	10.32	29.78	554.66	7.42	10.56	27.58	0.01
SQU-DS	2026-06-11 15:45:00	10.39	30.14	555.28	7.42	10.54	23.76	0.01
SQU-DS	2026-06-11 16:00:00	10.51	30.28	554.99	7.43	10.52	23.54	0.01
SQU-DS	2026-06-11 16:15:00	10.55	30.44	555.33	7.44	10.51	21.94	0.01
SQU-DS	2026-06-11 16:30:00	10.60	30.73	556.18	7.43	10.49	23.04	0.01
SQU-DS	2026-06-11 16:45:00	10.70	30.92	556.14	7.44	10.49	21.08	0.01
SQU-DS	2026-06-11 17:00:00	10.80	31.10	555.98	7.45	10.48	21.84	0.01
SQU-DS	2026-06-11 17:15:00	10.91	31.11	556.29	7.44	10.45	21.72	0.01
SQU-DS	2026-06-11 17:30:00	10.99	31.28	557.07	7.43	10.43	23.36	0.01
SQU-DS	2026-06-11 17:45:00	11.06	31.50	557.07	7.43	10.42	25.75	0.01
SQU-DS	2026-06-11 18:00:00	11.13	31.51	556.44	7.44	10.40	24.36	0.01
SQU-DS	2026-06-11 18:15:00	11.14	31.58	557.01	7.44	10.37	23.24	0.01
SQU-DS	2026-06-11 18:30:00	11.12	31.70	558.26	7.42	10.36	22.55	0.01
SQU-DS	2026-06-11 18:45:00	11.08	31.84	558.16	7.43	10.34	22.40	0.01
SQU-DS	2026-06-11 19:00:00	11.07	32.10	558.81	7.42	10.32	19.80	0.01
SQU-DS	2026-06-11 19:15:00	11.07	32.05	558.74	7.43	10.31	21.46	0.01
SQU-DS	2026-06-11 19:30:00	11.03	32.22	559.89	7.42	10.29	18.85	0.01
SQU-DS	2026-06-11 19:45:00	11.00	32.46	559.79	7.42	10.27	20.10	0.01
SQU-DS	2026-06-11 20:00:00	10.97	32.59	560.60	7.41	10.26	19.94	0.01
SQU-DS	2026-06-11 20:15:00	10.94	32.72	560.67	7.42	10.25	17.61	0.01
SQU-DS	2026-06-11 20:30:00	10.91	32.92	560.90	7.42	10.23	19.91	0.01
SQU-DS	2026-06-11 20:45:00	10.88	32.97	562.11	7.40	10.21	17.99	0.01
SQU-DS	2026-06-11 21:00:00	10.84	33.00	561.85	7.41	10.20	20.22	0.01
SQU-DS	2026-06-11 21:15:00	10.80	33.17	562.06	7.42	10.20	20.35	0.01
SQU-DS	2026-06-11 21:30:00	10.76	33.33	562.47	7.41	10.18	21.61	0.01
SQU-DS	2026-06-11 21:45:00	10.73	33.37	563.38	7.40	10.16	18.44	0.01
SQU-DS	2026-06-11 22:00:00	10.70	33.12	563.70	7.39	10.16	17.21	0.01
SQU-DS	2026-06-11 22:15:00	10.65	33.36	563.22	7.40	10.16	21.64	0.01
SQU-DS	2026-06-11 22:30:00	10.60	33.30	563.19	7.40	10.15	20.79	0.01
SQU-DS	2026-06-11 22:45:00	10.58	32.93	563.44	7.40	10.15	21.73	0.01
SQU-DS	2026-06-11 23:00:00	10.54	32.62	563.63	7.40	10.13	21.41	0.01
SQU-DS	2026-06-11 23:15:00	10.52	32.19	564.17	7.39	10.14	22.01	0.01
SQU-DS	2026-06-11 23:30:00	10.46	32.18	563.88	7.40	10.16	22.32	0.01
SQU-DS	2026-06-11 23:45:00	10.42	31.88	564.06	7.40	10.15	21.00	0.01
SQU-DS	2026-06-12 00:00:00	10.37	31.65	564.38	7.40	10.16	20.73	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-12 00:15:00	10.33	31.43	564.12	7.41	10.17	19.25	0.01
SQU-DS	2026-06-12 00:30:00	10.28	31.08	564.44	7.40	10.16	17.06	0.01
SQU-DS	2026-06-12 00:45:00	10.22	30.93	564.26	7.41	10.18	17.63	0.01
SQU-DS	2026-06-12 01:00:00	10.17	30.91	564.01	7.42	10.19	14.11	0.01
SQU-DS	2026-06-12 01:15:00	10.10	30.76	564.28	7.42	10.21	11.27	0.01
SQU-DS	2026-06-12 01:30:00	10.04	30.37	564.90	7.42	10.22	8.94	0.01
SQU-DS	2026-06-12 01:45:00	9.97	30.20	566.02	7.40	10.23	6.77	0.01
SQU-DS	2026-06-12 02:00:00	9.87	30.23	565.94	7.41	10.25	4.95	0.01
SQU-DS	2026-06-12 02:15:00	9.81	30.11	566.15	7.42	10.28	3.42	0.01
SQU-DS	2026-06-12 02:30:00	9.74	30.24	566.60	7.42	10.29	2.79	0.01
SQU-DS	2026-06-12 02:45:00	9.67	30.22	567.01	7.42	10.32	2.42	0.01
SQU-DS	2026-06-12 03:00:00	9.61	30.35	567.05	7.42	10.33	1.96	0.01
SQU-DS	2026-06-12 03:15:00	9.56	30.12	567.21	7.42	10.34	1.49	0.01
SQU-DS	2026-06-12 03:30:00	9.49	30.20	566.61	7.43	10.35	1.04	0.01
SQU-DS	2026-06-12 03:45:00	9.45	30.14	565.48	7.43	10.36	1.36	0.01
SQU-DS	2026-06-12 04:00:00	9.40	30.01	565.69	7.44	10.36	1.11	0.01
SQU-DS	2026-06-12 04:15:00	9.36	30.83	566.39	7.43	10.38	9.77	0.01
SQU-DS	2026-06-12 04:30:00	9.31	30.59	567.32	7.41	10.39	9.03	0.01
SQU-DS	2026-06-12 04:45:00	9.26	30.63	568.31	7.39	10.38	13.89	0.01
SQU-DS	2026-06-12 05:00:00	9.22	30.37	568.59	7.38	10.42	15.06	0.01
SQU-DS	2026-06-12 05:15:00	9.18	30.14	568.50	7.38	10.42	15.79	0.01
SQU-DS	2026-06-12 05:30:00	9.14	30.15	568.36	7.38	10.44	15.94	0.01
SQU-DS	2026-06-12 05:45:00	9.09	29.92	568.51	7.38	10.45	14.70	0.01
SQU-DS	2026-06-12 06:00:00	9.05	29.96	567.90	7.38	10.47	15.50	0.01
SQU-DS	2026-06-12 06:15:00	9.02	29.83	567.59	7.39	10.49	14.73	0.01
SQU-DS	2026-06-12 06:30:00	9.00	29.75	567.77	7.38	10.50	15.61	0.01
SQU-DS	2026-06-12 06:45:00	8.98	29.80	567.82	7.37	10.52	16.82	0.01
SQU-DS	2026-06-12 07:00:00	8.97	29.66	567.30	7.38	10.54	16.67	0.01
SQU-DS	2026-06-12 07:15:00	8.96	29.68	566.28	7.39	10.55	11.42	0.01
SQU-DS	2026-06-12 07:30:00	8.95	29.66	565.86	7.39	10.57	15.68	0.01
SQU-DS	2026-06-12 07:45:00	8.96	29.56	565.69	7.39	10.58	15.88	0.01
SQU-DS	2026-06-12 08:00:00	8.95	29.58	566.31	7.38	10.60	16.53	0.01
SQU-DS	2026-06-12 08:15:00	8.96	29.53	564.92	7.40	10.61	16.27	0.01
SQU-DS	2026-06-12 08:30:00	8.99	29.55	565.20	7.39	10.62	17.06	0.01
SQU-DS	2026-06-12 08:45:00	9.02	29.57	564.20	7.40	10.62	12.60	0.01
SQU-DS	2026-06-12 09:00:00	9.07	29.55	563.84	7.40	10.63	15.94	0.01
SQU-DS	2026-06-12 09:15:00	9.11	29.60	563.39	7.40	10.63	15.88	0.01
SQU-DS	2026-06-12 09:30:00	9.17	29.64	563.60	7.39	10.65	15.87	0.01
SQU-DS	2026-06-12 09:45:00	9.23	29.74	562.68	7.40	10.65	15.73	0.01
SQU-DS	2026-06-12 10:00:00	9.28	29.81	562.04	7.40	10.64	14.88	0.01
SQU-DS	2026-06-12 10:15:00	9.36	29.55	561.83	7.40	10.64	15.61	0.01
SQU-DS	2026-06-12 10:30:00	9.41	29.66	560.78	7.41	10.64	13.90	0.01
SQU-DS	2026-06-12 10:45:00	9.49	29.56	561.58	7.39	10.64	16.06	0.01
SQU-DS	2026-06-12 11:00:00	9.56	29.58	560.48	7.40	10.65	14.98	0.01
SQU-DS	2026-06-12 11:15:00	9.63	29.62	559.96	7.41	10.63	16.21	0.01
SQU-DS	2026-06-12 11:30:00	9.73	29.53	559.89	7.40	10.62	10.03	0.01
SQU-DS	2026-06-12 11:45:00	9.82	29.58	559.27	7.40	10.62	13.02	0.01
SQU-DS	2026-06-12 12:00:00	9.91	29.47	559.00	7.40	10.62	14.44	0.01
SQU-DS	2026-06-12 12:15:00	9.98	29.49	557.78	7.43	10.62	14.68	0.01
SQU-DS	2026-06-12 12:30:00	10.08	29.47	558.32	7.41	10.60	14.05	0.01
SQU-DS	2026-06-12 12:45:00	10.19	29.42	558.46	7.40	10.60	12.48	0.01
SQU-DS	2026-06-12 13:00:00	10.28	29.41	558.18	7.40	10.59	12.40	0.01
SQU-DS	2026-06-12 13:15:00	10.37	29.36	557.94	7.40	10.59	14.89	0.01
SQU-DS	2026-06-12 13:30:00	10.44	29.51	557.63	7.40	10.57	13.62	0.01
SQU-DS	2026-06-12 13:45:00	10.54	29.40	558.17	7.38	10.56	16.66	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-12 14:00:00	10.63	29.36	555.82	7.43	10.54	15.96	0.01
SQU-DS	2026-06-12 14:15:00	10.71	29.34	556.66	7.42	10.53	15.70	0.01
SQU-DS	2026-06-12 14:30:00	10.78	29.40	557.01	7.41	10.52	15.10	0.01
SQU-DS	2026-06-12 14:45:00	10.88	29.33	556.35	7.42	10.51	14.66	0.01
SQU-DS	2026-06-12 15:00:00	11.00	29.28	555.96	7.44	10.50	13.30	0.01
SQU-DS	2026-06-12 15:15:00	11.09	29.36	556.52	7.42	10.50	12.71	0.01
SQU-DS	2026-06-12 15:30:00	11.16	29.43	555.76	7.44	10.48	13.57	0.01
SQU-DS	2026-06-12 15:45:00	11.20	29.37	555.87	7.44	10.47	15.56	0.01
SQU-DS	2026-06-12 16:00:00	11.26	29.41	555.33	7.45	10.46	13.34	0.01
SQU-DS	2026-06-12 16:15:00	11.32	29.48	555.55	7.46	10.44	11.34	0.01
SQU-DS	2026-06-12 16:30:00	11.37	29.54	556.21	7.46	10.43	12.19	0.01
SQU-DS	2026-06-12 16:45:00	11.39	29.53	556.42	7.46	10.43	11.36	0.01
SQU-DS	2026-06-12 17:00:00	11.43	29.54	556.60	7.47	10.41	10.20	0.01
SQU-DS	2026-06-12 17:15:00	11.47	29.49	556.79	7.47	10.39	8.13	0.01
SQU-DS	2026-06-12 17:30:00	11.50	29.64	557.61	7.46	10.38	9.12	0.01
SQU-DS	2026-06-12 17:45:00	11.52	29.76	557.95	7.47	10.35	8.50	0.01
SQU-DS	2026-06-12 18:00:00	11.54	29.81	558.14	7.47	10.32	8.37	0.01
SQU-DS	2026-06-12 18:15:00	11.55	30.06	558.73	7.47	10.32	7.00	0.01
SQU-DS	2026-06-12 18:30:00	11.57	30.25	559.18	7.47	10.29	6.46	0.01
SQU-DS	2026-06-12 18:45:00	11.58	30.52	559.75	7.46	10.27	8.16	0.01
SQU-DS	2026-06-12 19:00:00	11.57	30.65	559.93	7.46	10.23	7.60	0.01
SQU-DS	2026-06-12 19:15:00	11.57	30.73	560.27	7.46	10.23	6.56	0.01
SQU-DS	2026-06-12 19:30:00	11.56	30.74	560.86	7.45	10.21	7.74	0.01
SQU-DS	2026-06-12 19:45:00	11.55	30.81	561.17	7.44	10.19	8.39	0.01
SQU-DS	2026-06-12 20:00:00	11.53	30.97	561.47	7.44	10.17	8.01	0.01
SQU-DS	2026-06-12 20:15:00	11.53	30.78	562.07	7.43	10.16	9.04	0.01
SQU-DS	2026-06-12 20:30:00	11.52	30.72	562.98	7.41	10.15	7.76	0.01
SQU-DS	2026-06-12 20:45:00	11.48	30.96	562.92	7.42	10.12	10.12	0.01
SQU-DS	2026-06-12 21:00:00	11.46	30.91	563.17	7.41	10.11	9.24	0.01
SQU-DS	2026-06-12 21:15:00	11.44	30.99	564.09	7.39	10.10	11.32	0.01
SQU-DS	2026-06-12 21:30:00	11.42	30.97	563.26	7.41	10.07	10.29	0.01
SQU-DS	2026-06-12 21:45:00	11.40	30.82	564.17	7.39	10.07	10.26	0.01
SQU-DS	2026-06-12 22:00:00	11.38	30.83	563.25	7.41	10.06	8.65	0.01
SQU-DS	2026-06-12 22:15:00	11.35	30.87	563.76	7.40	10.06	8.99	0.01
SQU-DS	2026-06-12 22:30:00	11.32	30.81	564.07	7.40	10.04	9.80	0.01
SQU-DS	2026-06-12 22:45:00	11.29	30.69	564.85	7.39	10.06	8.44	0.01
SQU-DS	2026-06-12 23:00:00	11.23	30.84	564.60	7.39	10.05	6.45	0.01
SQU-DS	2026-06-12 23:15:00	11.18	30.73	564.49	7.40	10.05	7.37	0.01
SQU-DS	2026-06-12 23:30:00	11.13	30.65	564.71	7.40	10.07	6.97	0.01
SQU-DS	2026-06-12 23:45:00	11.08	30.58	565.43	7.39	10.08	8.15	0.01
SQU-DS	2026-06-13 00:00:00	11.02	30.51	564.94	7.40	10.09	11.25	0.01
SQU-DS	2026-06-13 00:15:00	10.95	30.48	564.94	7.40	10.09	12.33	0.01
SQU-DS	2026-06-13 00:30:00	10.88	30.46	564.42	7.42	10.12	11.00	0.01
SQU-DS	2026-06-13 00:45:00	10.82	30.08	564.99	7.41	10.12	9.36	0.01
SQU-DS	2026-06-13 01:00:00	10.72	30.27	565.59	7.41	10.12	7.60	0.01
SQU-DS	2026-06-13 01:15:00	10.64	30.01	565.50	7.41	10.14	5.15	0.01
SQU-DS	2026-06-13 01:30:00	10.56	29.88	564.84	7.43	10.17	6.53	0.01
SQU-DS	2026-06-13 01:45:00	10.48	29.76	565.49	7.42	10.17	2.70	0.01
SQU-DS	2026-06-13 02:00:00	10.40	29.65	565.97	7.42	10.18	2.31	0.01
SQU-DS	2026-06-13 02:15:00	10.33	29.26	565.91	7.42	10.21	1.37	0.01
SQU-DS	2026-06-13 02:30:00	10.26	28.85	566.06	7.43	10.21	0.38	0.01
SQU-DS	2026-06-13 02:45:00	10.19	28.74	566.15	7.44	10.23	0.35	0.01
SQU-DS	2026-06-13 03:00:00	10.13	28.52	566.27	7.44	10.24	0.89	0.01
SQU-DS	2026-06-13 03:15:00	10.05	28.59	566.84	7.43	10.25	0.00	0.01
SQU-DS	2026-06-13 03:30:00	9.99	28.50	567.44	7.43	10.26	0.00	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-13 03:45:00	9.95	28.25	567.57	7.43	10.25	0.00	0.01
SQU-DS	2026-06-13 04:00:00	9.88	28.22	568.09	7.42	10.27	0.00	0.01
SQU-DS	2026-06-13 04:15:00	9.82	28.03	568.20	7.42	10.27	0.00	0.01
SQU-DS	2026-06-13 04:30:00	9.76	27.92	568.47	7.42	10.30	0.00	0.01
SQU-DS	2026-06-13 04:45:00	9.71	28.28	568.75	7.42	10.30	0.00	0.01
SQU-DS	2026-06-13 05:00:00	9.66	28.47	568.70	7.42	10.31	0.00	0.01
SQU-DS	2026-06-13 05:15:00	9.62	28.58	569.06	7.41	10.33	0.00	0.01
SQU-DS	2026-06-13 05:30:00	9.57	28.50	569.79	7.39	10.37	1.44	0.01
SQU-DS	2026-06-13 05:45:00	9.54	28.35	569.97	7.38	10.38	2.82	0.01
SQU-DS	2026-06-13 06:00:00	9.52	28.41	570.76	7.36	10.40	4.49	0.01
SQU-DS	2026-06-13 06:15:00	9.49	28.24	570.24	7.36	10.42	4.57	0.01
SQU-DS	2026-06-13 06:30:00	9.48	28.12	569.92	7.36	10.43	4.36	0.01
SQU-DS	2026-06-13 06:45:00	9.45	27.95	569.70	7.36	10.44	3.94	0.01
SQU-DS	2026-06-13 07:00:00	9.44	28.08	568.86	7.36	10.46	5.75	0.01
SQU-DS	2026-06-13 07:15:00	9.43	28.04	569.18	7.35	10.48	4.44	0.01
SQU-DS	2026-06-13 07:30:00	9.44	27.93	567.49	7.37	10.48	4.48	0.01
SQU-DS	2026-06-13 07:45:00	9.44	27.82	567.18	7.38	10.50	5.24	0.01
SQU-DS	2026-06-13 08:00:00	9.45	27.60	567.72	7.36	10.52	7.13	0.01
SQU-DS	2026-06-13 08:15:00	9.47	27.78	566.38	7.37	10.53	4.76	0.01
SQU-DS	2026-06-13 08:30:00	9.49	27.76	565.72	7.38	10.54	3.89	0.01
SQU-DS	2026-06-13 08:45:00	9.53	27.64	565.01	7.38	10.55	3.45	0.01
SQU-DS	2026-06-13 09:00:00	9.56	27.62	564.37	7.38	10.55	5.80	0.01
SQU-DS	2026-06-13 09:15:00	9.60	27.64	564.46	7.37	10.58	5.89	0.01
SQU-DS	2026-06-13 09:30:00	9.65	27.70	564.35	7.37	10.58	4.29	0.01
SQU-DS	2026-06-13 09:45:00	9.70	27.79	563.81	7.37	10.57	5.95	0.01
SQU-DS	2026-06-13 10:00:00	9.75	27.68	562.36	7.39	10.58	4.82	0.01
SQU-DS	2026-06-13 10:15:00	9.81	27.95	562.57	7.38	10.58	7.45	0.01
SQU-DS	2026-06-13 10:30:00	9.88	27.96	561.72	7.38	10.58	4.89	0.01
SQU-DS	2026-06-13 10:45:00	9.94	28.14	561.83	7.38	10.58	6.12	0.01
SQU-DS	2026-06-13 11:00:00	10.01	28.06	561.20	7.38	10.57	6.95	0.01
SQU-DS	2026-06-13 11:15:00	10.08	27.98	561.14	7.37	10.58	7.84	0.01
SQU-DS	2026-06-13 11:30:00	10.16	28.06	560.21	7.39	10.58	5.71	0.01
SQU-DS	2026-06-13 11:45:00	10.24	28.10	560.14	7.37	10.56	15.71	0.01
SQU-DS	2026-06-13 12:00:00	10.33	27.92	558.77	7.39	10.55	8.99	0.01
SQU-DS	2026-06-13 12:15:00	10.41	27.99	558.21	7.39	10.56	11.03	0.01
SQU-DS	2026-06-13 12:30:00	10.51	27.98	558.54	7.38	10.55	8.54	0.01
SQU-DS	2026-06-13 12:45:00	10.61	27.84	557.75	7.39	10.53	5.93	0.01
SQU-DS	2026-06-13 13:00:00	10.71	27.76	557.61	7.39	10.52	6.88	0.01
SQU-DS	2026-06-13 13:15:00	10.79	27.96	557.08	7.40	10.51	5.86	0.01
SQU-DS	2026-06-13 13:30:00	10.89	27.95	556.32	7.41	10.51	6.37	0.01
SQU-DS	2026-06-13 13:45:00	10.98	27.79	557.66	7.38	10.50	6.70	0.01
SQU-DS	2026-06-13 14:00:00	11.07	28.06	557.02	7.38	10.49	7.54	0.01
SQU-DS	2026-06-13 14:15:00	11.15	27.81	555.97	7.40	10.48	8.30	0.01
SQU-DS	2026-06-13 14:30:00	11.24	27.93	555.83	7.40	10.46	6.11	0.01
SQU-DS	2026-06-13 14:45:00	11.31	27.80	555.45	7.41	10.45	6.25	0.01
SQU-DS	2026-06-13 15:00:00	11.40	27.74	556.38	7.39	10.45	9.10	0.01
SQU-DS	2026-06-13 15:15:00	11.48	27.70	557.26	7.38	10.45	13.15	0.01
SQU-DS	2026-06-13 15:30:00	11.55	27.87	555.06	7.41	10.42	6.69	0.01
SQU-DS	2026-06-13 15:45:00	11.61	27.92	555.26	7.41	10.40	6.27	0.01
SQU-DS	2026-06-13 16:00:00	11.68	27.84	555.69	7.41	10.38	6.26	0.01
SQU-DS	2026-06-13 16:15:00	11.73	27.73	555.25	7.42	10.38	5.87	0.01
SQU-DS	2026-06-13 16:30:00	11.78	27.84	555.05	7.43	10.37	5.35	0.01
SQU-DS	2026-06-13 16:45:00	11.82	27.72	555.43	7.44	10.34	5.44	0.01
SQU-DS	2026-06-13 17:00:00	11.86	27.82	555.53	7.45	10.33	3.67	0.01
SQU-DS	2026-06-13 17:15:00	11.91	27.95	555.87	7.46	10.31	3.25	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-13 17:30:00	11.94	27.92	556.45	7.46	10.30	5.84	0.01
SQU-DS	2026-06-13 17:45:00	11.97	28.11	556.66	7.47	10.28	1.17	0.01
SQU-DS	2026-06-13 18:00:00	12.00	28.12	557.60	7.47	10.25	0.46	0.01
SQU-DS	2026-06-13 18:15:00	12.02	28.43	558.63	7.46	10.24	0.18	0.01
SQU-DS	2026-06-13 18:30:00	12.04	28.65	559.34	7.46	10.21	0.00	0.01
SQU-DS	2026-06-13 18:45:00	12.05	28.65	559.22	7.47	10.18	0.00	0.01
SQU-DS	2026-06-13 19:00:00	12.07	28.74	560.16	7.46	10.16	0.00	0.01
SQU-DS	2026-06-13 19:15:00	12.07	28.84	560.93	7.45	10.12	0.00	0.01
SQU-DS	2026-06-13 19:30:00	12.08	28.82	560.96	7.46	10.10	0.00	0.01
SQU-DS	2026-06-13 19:45:00	12.07	28.78	561.27	7.46	10.07	0.00	0.01
SQU-DS	2026-06-13 20:00:00	12.06	28.40	561.03	7.47	10.05	0.00	0.01
SQU-DS	2026-06-13 20:15:00	12.05	28.49	562.02	7.46	10.02	0.00	0.01
SQU-DS	2026-06-13 20:30:00	12.03	28.34	562.41	7.45	10.01	0.00	0.01
SQU-DS	2026-06-13 20:45:00	12.01	28.69	562.24	7.43	9.98	0.00	0.01
SQU-DS	2026-06-13 21:00:00	11.99	28.60	557.85	7.44	9.96	0.00	0.01
SQU-DS	2026-06-13 21:15:00	11.96	28.90	560.27	7.42	9.95	0.00	0.01
SQU-DS	2026-06-13 21:30:00	11.93	28.44	561.44	7.42	9.96	0.38	0.01
SQU-DS	2026-06-13 21:45:00	11.90	28.91	562.70	7.41	9.95	0.73	0.01
SQU-DS	2026-06-13 22:00:00	11.87	28.97	563.19	7.41	9.96	0.28	0.01
SQU-DS	2026-06-13 22:15:00	11.83	28.89	564.26	7.39	9.97	0.43	0.01
SQU-DS	2026-06-13 22:30:00	11.77	28.73	564.88	7.39	9.96	0.13	0.01
SQU-DS	2026-06-13 22:45:00	11.71	28.70	564.93	7.39	9.97	1.01	0.01
SQU-DS	2026-06-13 23:00:00	11.66	28.55	566.06	7.37	9.98	1.05	0.01
SQU-DS	2026-06-13 23:15:00	11.59	28.61	566.61	7.36	9.98	1.02	0.01
SQU-DS	2026-06-13 23:30:00	11.52	28.68	566.41	7.37	10.00	1.37	0.01
SQU-DS	2026-06-13 23:45:00	11.45	28.41	565.80	7.38	10.01	0.78	0.01
SQU-DS	2026-06-14 00:00:00	11.37	28.57	566.11	7.38	10.01	0.99	0.01
SQU-DS	2026-06-14 00:15:00	11.30	27.97	565.75	7.38	10.03	1.04	0.01
SQU-DS	2026-06-14 00:30:00	11.23	27.75	566.12	7.38	10.04	1.23	0.01
SQU-DS	2026-06-14 00:45:00	11.14	27.61	565.81	7.38	10.06	0.50	0.01
SQU-DS	2026-06-14 01:00:00	11.07	27.82	565.10	7.40	10.07	0.78	0.01
SQU-DS	2026-06-14 01:15:00	11.00	27.08	565.80	7.39	10.08	0.00	0.01
SQU-DS	2026-06-14 01:30:00	10.93	26.71	565.62	7.39	10.10	0.00	0.01
SQU-DS	2026-06-14 01:45:00	10.86	26.76	565.55	7.40	10.10	0.00	0.01
SQU-DS	2026-06-14 02:00:00	10.78	26.70	565.79	7.39	10.12	0.00	0.01
SQU-DS	2026-06-14 02:15:00	10.72	28.47	566.28	7.39	10.13	0.00	0.01
SQU-DS	2026-06-14 02:30:00	10.65	26.42	566.17	7.39	10.14	0.00	0.01
SQU-DS	2026-06-14 02:45:00	10.60	26.21	566.29	7.38	10.14	0.00	0.01
SQU-DS	2026-06-14 03:00:00	10.53	25.85	566.40	7.38	10.15	0.00	0.01
SQU-DS	2026-06-14 03:15:00	10.46	25.81	566.98	7.38	10.17	0.00	0.01
SQU-DS	2026-06-14 03:30:00	10.38	25.66	566.65	7.39	10.17	0.00	0.01
SQU-DS	2026-06-14 03:45:00	10.32	25.47	568.50	7.40	10.18	0.00	0.01
SQU-DS	2026-06-14 04:00:00	10.26	25.41	570.70	7.38	10.18	0.00	0.01
SQU-DS	2026-06-14 04:15:00	10.20	25.08	571.71	7.37	10.18	0.00	0.01
SQU-DS	2026-06-14 04:30:00	10.14	24.80	571.06	7.38	10.19	0.00	0.01
SQU-DS	2026-06-14 04:45:00	10.09	24.90	571.25	7.37	10.17	0.00	0.01
SQU-DS	2026-06-14 05:00:00	10.02	24.07	571.66	7.37	10.22	0.00	0.01
SQU-DS	2026-06-14 05:15:00	9.99	23.69	571.85	7.37	10.27	0.00	0.01
SQU-DS	2026-06-14 05:30:00	9.93	23.79	571.65	7.37	10.30	0.00	0.01
SQU-DS	2026-06-14 05:45:00	9.90	23.86	571.51	7.37	10.33	0.00	0.01
SQU-DS	2026-06-14 06:00:00	9.87	24.14	571.00	7.37	10.34	0.00	0.01
SQU-DS	2026-06-14 06:15:00	9.84	24.32	570.89	7.37	10.35	0.00	0.01
SQU-DS	2026-06-14 06:30:00	9.82	24.92	570.26	7.37	10.35	0.00	0.01
SQU-DS	2026-06-14 06:45:00	9.79	24.91	570.12	7.36	10.38	0.00	0.01
SQU-DS	2026-06-14 07:00:00	9.77	24.79	569.63	7.36	10.39	0.00	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-14 07:15:00	9.76	24.90	569.62	7.35	10.40	0.00	0.01
SQU-DS	2026-06-14 07:30:00	9.76	24.77	569.10	7.35	10.41	0.00	0.01
SQU-DS	2026-06-14 07:45:00	9.76	24.66	569.10	7.34	10.43	0.00	0.01
SQU-DS	2026-06-14 08:00:00	9.77	24.60	568.18	7.35	10.44	0.44	0.01
SQU-DS	2026-06-14 08:15:00	9.80	24.81	567.12	7.35	10.44	0.00	0.01
SQU-DS	2026-06-14 08:30:00	9.84	24.67	566.60	7.35	10.46	0.22	0.01
SQU-DS	2026-06-14 08:45:00	9.87	24.78	565.89	7.35	10.46	0.00	0.01
SQU-DS	2026-06-14 09:00:00	9.91	24.40	565.20	7.36	10.47	0.00	0.01
SQU-DS	2026-06-14 09:15:00	9.95	24.65	564.78	7.36	10.48	0.00	0.01
SQU-DS	2026-06-14 09:30:00	10.00	24.43	564.03	7.36	10.48	0.40	0.01
SQU-DS	2026-06-14 09:45:00	10.06	24.55	564.05	7.36	10.48	0.37	0.01
SQU-DS	2026-06-14 10:00:00	10.11	24.68	563.19	7.37	10.48	0.00	0.01
SQU-DS	2026-06-14 10:15:00	10.18	24.61	563.22	7.36	10.48	0.00	0.01
SQU-DS	2026-06-14 10:30:00	10.23	24.66	563.06	7.35	10.47	0.03	0.01
SQU-DS	2026-06-14 10:45:00	10.28	24.78	562.35	7.36	10.49	0.00	0.01
SQU-DS	2026-06-14 11:00:00	10.34	24.87	562.23	7.35	10.47	0.00	0.01
SQU-DS	2026-06-14 11:15:00	10.42	24.72	562.16	7.35	10.47	0.00	0.01
SQU-DS	2026-06-14 11:30:00	10.48	24.92	561.29	7.36	10.48	0.00	0.01
SQU-DS	2026-06-14 11:45:00	10.55	24.60	561.27	7.36	10.47	0.00	0.01
SQU-DS	2026-06-14 12:00:00	10.61	24.62	560.37	7.37	10.47	0.00	0.01
SQU-DS	2026-06-14 12:15:00	10.68	24.69	560.10	7.37	10.47	0.20	0.01
SQU-DS	2026-06-14 12:30:00	10.77	24.63	560.10	7.37	10.45	0.00	0.01
SQU-DS	2026-06-14 12:45:00	10.84	24.77	560.47	7.36	10.45	0.00	0.01
SQU-DS	2026-06-14 13:00:00	10.92	24.64	559.88	7.36	10.46	0.00	0.01
SQU-DS	2026-06-14 13:15:00	11.01	24.69	559.57	7.37	10.45	0.00	0.01
SQU-DS	2026-06-14 13:30:00	11.09	24.55	560.07	7.36	10.43	0.00	0.01
SQU-DS	2026-06-14 13:45:00	11.17	24.83	560.08	7.35	10.42	0.00	0.01
SQU-DS	2026-06-14 14:00:00	11.25	24.94	559.38	7.36	10.41	0.00	0.01
SQU-DS	2026-06-14 14:15:00	11.32	24.65	559.51	7.36	10.40	0.00	0.01
SQU-DS	2026-06-14 14:30:00	11.39	24.73	558.75	7.37	10.39	0.00	0.01
SQU-DS	2026-06-14 14:45:00	11.46	24.83	559.95	7.35	10.39	0.00	0.01
SQU-DS	2026-06-14 15:00:00	11.53	25.08	558.86	7.36	10.37	0.00	0.01
SQU-DS	2026-06-14 15:15:00	11.60	25.13	558.72	7.37	10.36	0.00	0.01
SQU-DS	2026-06-14 15:30:00	11.66	25.07	559.40	7.36	10.35	0.00	0.01
SQU-DS	2026-06-14 15:45:00	11.67	24.91	559.24	7.37	10.33	0.00	0.01
SQU-DS	2026-06-14 16:00:00	11.71	24.77	560.20	7.36	10.32	0.08	0.01
SQU-DS	2026-06-14 16:15:00	11.76	24.93	559.86	7.37	10.31	0.00	0.01
SQU-DS	2026-06-14 16:30:00	11.82	25.08	560.41	7.36	10.31	0.62	0.01
SQU-DS	2026-06-14 16:45:00	11.88	25.04	560.43	7.36	10.29	0.00	0.01
SQU-DS	2026-06-14 17:00:00	11.94	24.99	559.44	7.38	10.28	0.00	0.01
SQU-DS	2026-06-14 17:15:00	12.01	25.30	559.38	7.38	10.24	0.00	0.01
SQU-DS	2026-06-14 17:30:00	12.06	25.19	559.16	7.40	10.22	0.00	0.01
SQU-DS	2026-06-14 17:45:00	12.11	25.03	559.39	7.40	10.20	0.00	0.01
SQU-DS	2026-06-14 18:00:00	12.15	25.01	559.66	7.39	10.18	0.00	0.01
SQU-DS	2026-06-14 18:15:00	12.19	25.23	559.27	7.40	10.14	0.00	0.01
SQU-DS	2026-06-14 18:30:00	12.22	25.30	560.11	7.39	10.11	0.00	0.01
SQU-DS	2026-06-14 18:45:00	12.25	25.45	562.31	7.40	10.07	0.00	0.01
SQU-DS	2026-06-14 19:00:00	12.28	25.29	563.40	7.40	10.04	0.00	0.01
SQU-DS	2026-06-14 19:15:00	12.29	25.50	563.77	7.41	10.00	0.00	0.01
SQU-DS	2026-06-14 19:30:00	12.30	25.64	564.68	7.42	9.95	0.00	0.01
SQU-DS	2026-06-14 19:45:00	12.29	25.59	565.74	7.41	9.93	0.00	0.01
SQU-DS	2026-06-14 20:00:00	12.28	25.43	566.46	7.41	9.91	0.00	0.01
SQU-DS	2026-06-14 20:15:00	12.27	25.41	567.78	7.40	9.87	0.00	0.01
SQU-DS	2026-06-14 20:30:00	12.25	24.96	568.50	7.40	9.86	0.00	0.01
SQU-DS	2026-06-14 20:45:00	12.23	24.44	568.93	7.40	9.84	0.00	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-DS	2026-06-14 21:00:00	12.19	24.04	568.90	7.37	9.82	0.00	0.01
SQU-DS	2026-06-14 21:15:00	12.16	24.04	568.77	7.37	9.81	0.00	0.01
SQU-DS	2026-06-14 21:30:00	12.12	23.78	568.11	7.38	9.79	0.00	0.01
SQU-DS	2026-06-14 21:45:00	12.08	23.50	567.94	7.38	9.79	0.00	0.01
SQU-DS	2026-06-14 22:00:00	12.03	23.38	568.44	7.36	9.83	0.00	0.01
SQU-DS	2026-06-14 22:15:00	11.97	22.94	568.20	7.36	9.89	0.00	0.01
SQU-DS	2026-06-14 22:30:00	11.91	23.54	568.05	7.36	9.89	0.00	0.01
SQU-DS	2026-06-14 22:45:00	11.85	23.24	568.43	7.35	9.89	0.00	0.01
SQU-DS	2026-06-14 23:00:00	11.79	23.78	567.66	7.36	9.91	0.00	0.01
SQU-DS	2026-06-14 23:15:00	11.71	23.36	567.60	7.37	9.91	0.00	0.01
SQU-DS	2026-06-14 23:30:00	11.64	23.28	567.91	7.36	9.94	0.00	0.01
SQU-DS	2026-06-14 23:45:00	11.57	23.62	568.97	7.34	9.95	0.00	0.01
SQU-US	2026-06-08 00:00:00	8.77	30.61	0.46	7.28	11.40	8.30	0.01
SQU-US	2026-06-08 00:15:00	8.72	30.94	0.46	7.29	11.39	8.38	0.01
SQU-US	2026-06-08 00:30:00	8.67	30.93	0.46	7.30	11.40	8.38	0.01
SQU-US	2026-06-08 00:45:00	8.63	30.82	0.46	7.30	11.41	8.28	0.01
SQU-US	2026-06-08 01:00:00	8.59	30.71	0.46	7.29	11.42	8.30	0.01
SQU-US	2026-06-08 01:15:00	8.54	30.61	0.46	7.28	11.43	8.34	0.01
SQU-US	2026-06-08 01:30:00	8.49	30.88	0.46	7.30	11.43	8.31	0.01
SQU-US	2026-06-08 01:45:00	8.47	31.30	0.47	7.23	11.38	8.33	0.01
SQU-US	2026-06-08 02:00:00	8.42	31.56	0.47	7.22	11.37	8.30	0.01
SQU-US	2026-06-08 02:15:00	8.41	31.16	0.47	7.21	11.39	8.18	0.01
SQU-US	2026-06-08 02:30:00	8.35	30.44	0.47	7.24	11.42	8.30	0.01
SQU-US	2026-06-08 02:45:00	8.30	30.49	0.47	7.25	11.44	8.25	0.01
SQU-US	2026-06-08 03:00:00	8.27	30.27	0.47	7.25	11.48	8.22	0.01
SQU-US	2026-06-08 03:15:00	8.23	29.85	0.47	7.25	11.48	8.25	0.01
SQU-US	2026-06-08 03:30:00	8.22	29.87	0.47	7.24	11.48	8.22	0.01
SQU-US	2026-06-08 03:45:00	8.18	29.64	0.47	7.26	11.49	8.21	0.01
SQU-US	2026-06-08 04:00:00	8.14	29.69	0.47	7.28	11.49	8.10	0.01
SQU-US	2026-06-08 04:15:00	8.12	29.48	0.47	7.27	11.50	8.16	0.01
SQU-US	2026-06-08 04:30:00	8.08	24.93	0.47	7.22	11.70	8.37	0.01
SQU-US	2026-06-08 04:45:00	8.06	0.08	0.46	7.26	11.82	9.07	0.00
SQU-US	2026-06-08 05:00:00	8.02	0.08	0.45	7.31	11.84	8.71	0.00
SQU-US	2026-06-08 05:15:00	7.99	0.08	0.46	7.37	11.86	8.13	0.00
SQU-US	2026-06-08 05:30:00	7.96	0.08	0.46	7.33	11.86	7.64	0.00
SQU-US	2026-06-08 05:45:00	7.96	0.08	0.46	7.31	11.87	6.45	0.00
SQU-US	2026-06-08 06:00:00	7.95	0.08	0.46	7.29	11.87	5.98	0.00
SQU-US	2026-06-08 06:15:00	7.94	0.08	0.47	7.27	11.87	6.44	0.00
SQU-US	2026-06-08 06:30:00	7.94	0.08	0.47	7.26	11.86	7.17	0.00
SQU-US	2026-06-08 06:45:00	7.97	0.08	0.47	7.24	11.85	6.37	0.00
SQU-US	2026-06-08 07:00:00	7.99	0.08	0.47	7.23	11.84	5.89	0.00
SQU-US	2026-06-08 07:15:00	8.01	0.08	0.47	7.22	11.84	6.37	0.00
SQU-US	2026-06-08 07:30:00	8.07	0.08	0.47	7.20	11.82	5.78	0.00
SQU-US	2026-06-08 07:45:00	8.11	0.08	0.47	7.18	11.79	6.21	0.00
SQU-US	2026-06-08 08:00:00	8.19	0.08	0.47	7.18	11.78	6.32	0.00
SQU-US	2026-06-08 08:15:00	8.26	0.08	0.47	7.17	11.75	6.41	0.00
SQU-US	2026-06-08 08:30:00	8.33	0.08	0.47	7.16	11.74	5.94	0.00
SQU-US	2026-06-08 08:45:00	8.38	0.08	0.47	7.14	11.72	6.92	0.00
SQU-US	2026-06-08 09:00:00	8.55	0.08	0.47	7.14	11.68	6.18	0.00
SQU-US	2026-06-08 09:15:00	8.64	0.08	0.47	7.14	11.65	6.22	0.00
SQU-US	2026-06-08 09:30:00	8.71	0.08	0.48	7.10	11.63	6.84	0.00
SQU-US	2026-06-08 09:45:00	8.83	0.08	0.48	7.09	11.60	8.02	0.00
SQU-US	2026-06-08 10:00:00	8.92	0.08	0.48	7.09	11.57	8.22	0.00
SQU-US	2026-06-08 10:15:00	8.92	0.08	0.48	7.13	11.57	8.20	0.00
SQU-US	2026-06-08 10:30:00	8.97	0.08	0.48	7.15	11.55	8.61	0.00

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-08 10:45:00	8.90	0.08	0.49	7.28	11.57	8.41	0.00
SQU-US	2026-06-08 11:00:00	8.91	0.08	0.49	7.31	11.57	8.47	0.00
SQU-US	2026-06-08 11:15:00	8.87	0.08	0.46	7.36	11.58	8.57	0.00
SQU-US	2026-06-08 11:30:00	8.88	0.08	0.45	7.33	11.57	8.87	0.00
SQU-US	2026-06-08 11:45:00	8.89	0.08	0.44	7.02	11.57	8.86	0.00
SQU-US	2026-06-08 12:00:00	8.89	0.08	0.43	7.22	11.56	8.80	0.00
SQU-US	2026-06-08 12:15:00	8.89	0.08	0.44	7.19	11.56	9.02	0.00
SQU-US	2026-06-08 12:30:00	8.97	0.08	0.44	7.21	11.53	8.88	0.00
SQU-US	2026-06-08 12:45:00	9.04	0.08	0.45	7.27	11.52	8.86	0.00
SQU-US	2026-06-08 13:00:00	9.23	0.08	0.46	7.25	11.46	8.85	0.00
SQU-US	2026-06-08 13:15:00	9.32	0.08	0.47	7.24	11.44	8.21	0.00
SQU-US	2026-06-08 13:30:00	9.42	0.08	0.47	7.26	11.41	8.50	0.00
SQU-US	2026-06-08 13:45:00	9.67	0.08	0.47	7.28	11.33	7.44	0.00
SQU-US	2026-06-08 14:00:00	9.71	0.08	0.47	7.29	11.32	6.18	0.00
SQU-US	2026-06-08 14:15:00	9.75	0.08	0.47	7.28	11.32	6.02	0.00
SQU-US	2026-06-08 14:30:00	9.97	0.08	0.47	7.26	11.25	5.99	0.00
SQU-US	2026-06-08 14:45:00	10.06	0.08	0.47	7.23	11.23	6.02	0.00
SQU-US	2026-06-08 15:00:00	10.11	0.08	0.47	7.19	11.23	5.88	0.00
SQU-US	2026-06-08 15:15:00	10.21	0.08	0.47	7.14	11.18	5.93	0.00
SQU-US	2026-06-08 15:30:00	10.15	0.08	0.47	7.09	11.20	5.71	0.00
SQU-US	2026-06-08 15:45:00	10.34	0.08	0.47	7.08	11.16	5.88	0.00
SQU-US	2026-06-08 16:00:00	10.41	0.08	0.47	7.08	11.15	5.81	0.00
SQU-US	2026-06-08 16:15:00	10.36	0.08	0.47	7.05	11.14	5.68	0.00
SQU-US	2026-06-08 16:30:00	10.25	0.08	0.47	7.01	11.18	5.76	0.00
SQU-US	2026-06-08 16:45:00	10.27	0.08	0.47	7.00	11.17	5.72	0.00
SQU-US	2026-06-08 17:00:00	10.31	0.08	0.47	6.99	11.15	5.76	0.00
SQU-US	2026-06-08 17:15:00	10.41	0.08	0.47	6.99	11.13	5.61	0.00
SQU-US	2026-06-08 17:30:00	10.54	0.08	0.47	7.02	11.09	5.74	0.00
SQU-US	2026-06-08 17:45:00	10.63	0.08	0.47	7.02	11.07	5.42	0.00
SQU-US	2026-06-08 18:00:00	10.69	0.08	0.47	7.01	11.06	5.62	0.00
SQU-US	2026-06-08 18:15:00	10.70	0.08	0.47	6.99	11.04	5.51	0.00
SQU-US	2026-06-08 18:30:00	10.79	0.08	0.47	6.99	11.03	5.50	0.00
SQU-US	2026-06-08 18:45:00	10.88	0.08	0.47	6.97	11.00	5.44	0.00
SQU-US	2026-06-08 19:00:00	10.90	0.08	0.48	6.97	11.00	5.50	0.00
SQU-US	2026-06-08 19:15:00	10.84	0.08	0.47	6.94	11.00	5.44	0.00
SQU-US	2026-06-08 19:30:00	10.79	0.08	0.48	6.91	11.02	5.50	0.00
SQU-US	2026-06-08 19:45:00	10.63	0.08	0.47	6.87	11.06	5.40	0.00
SQU-US	2026-06-08 20:00:00	10.51	0.08	0.48	6.83	11.09	5.51	0.00
SQU-US	2026-06-08 20:15:00	10.36	0.08	0.47	6.78	11.12	5.50	0.00
SQU-US	2026-06-08 20:30:00	10.22	0.08	0.47	6.75	11.15	5.78	0.00
SQU-US	2026-06-08 20:45:00	10.07	0.08	0.47	6.71	11.20	5.94	0.00
SQU-US	2026-06-08 21:00:00	9.93	0.08	0.47	6.68	11.25	6.37	0.00
SQU-US	2026-06-08 21:15:00	9.61	0.08	0.48	7.40	11.31	9.59	0.00
SQU-US	2026-06-08 21:30:00	9.08	20.16	0.45	7.27	11.42	10.57	0.01
SQU-US	2026-06-08 21:45:00	9.07	30.48	0.45	7.32	11.25	9.55	0.01
SQU-US	2026-06-08 22:00:00	9.05	30.43	0.45	7.28	11.23	9.69	0.01
SQU-US	2026-06-08 22:15:00	9.05	30.10	0.45	7.28	11.24	9.62	0.01
SQU-US	2026-06-08 22:30:00	9.02	30.23	0.45	7.28	11.23	9.66	0.01
SQU-US	2026-06-08 22:45:00	9.00	30.32	0.46	7.27	11.24	9.67	0.01
SQU-US	2026-06-08 23:00:00	8.97	30.28	0.46	7.27	11.24	9.56	0.01
SQU-US	2026-06-08 23:15:00	8.94	30.23	0.46	7.27	11.24	9.34	0.01
SQU-US	2026-06-08 23:30:00	8.92	30.11	0.46	7.31	11.25	9.52	0.01
SQU-US	2026-06-08 23:45:00	8.89	29.99	0.46	7.29	11.25	9.55	0.01
SQU-US	2026-06-09 00:00:00	8.87	29.93	0.46	7.30	11.26	9.63	0.01
SQU-US	2026-06-09 00:15:00	8.84	30.52	0.46	7.31	11.25	9.44	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-09 00:30:00	8.81	30.34	0.46	7.31	11.27	9.62	0.01
SQU-US	2026-06-09 00:45:00	8.80	30.33	0.46	7.29	11.28	9.39	0.01
SQU-US	2026-06-09 01:00:00	8.77	30.46	0.46	7.31	11.29	9.52	0.01
SQU-US	2026-06-09 01:15:00	8.74	30.48	0.46	7.31	11.30	9.54	0.01
SQU-US	2026-06-09 01:30:00	8.74	31.01	0.46	7.30	11.29	9.55	0.01
SQU-US	2026-06-09 01:45:00	8.71	31.39	0.46	7.32	11.28	9.47	0.01
SQU-US	2026-06-09 02:00:00	8.70	31.91	0.46	7.29	11.28	9.44	0.01
SQU-US	2026-06-09 02:15:00	8.66	31.91	0.46	7.32	11.28	9.46	0.01
SQU-US	2026-06-09 02:30:00	8.64	32.21	0.46	7.28	11.27	9.26	0.01
SQU-US	2026-06-09 02:45:00	8.61	32.70	0.46	7.27	11.24	9.23	0.01
SQU-US	2026-06-09 03:00:00	8.59	32.24	0.46	7.26	11.23	9.21	0.01
SQU-US	2026-06-09 03:15:00	8.54	31.98	0.47	7.24	11.26	9.15	0.01
SQU-US	2026-06-09 03:30:00	8.51	31.31	0.47	7.24	11.29	9.08	0.01
SQU-US	2026-06-09 03:45:00	8.49	30.82	0.46	7.29	11.31	9.02	0.01
SQU-US	2026-06-09 04:00:00	8.46	30.77	0.47	7.27	11.32	9.01	0.01
SQU-US	2026-06-09 04:15:00	8.42	30.51	0.47	7.30	11.34	9.11	0.01
SQU-US	2026-06-09 04:30:00	8.41	30.08	0.47	7.25	11.34	9.12	0.01
SQU-US	2026-06-09 04:45:00	8.39	30.12	0.47	7.30	11.35	9.10	0.01
SQU-US	2026-06-09 05:00:00	8.36	29.95	0.47	7.28	11.35	9.14	0.01
SQU-US	2026-06-09 05:15:00	8.34	29.94	0.47	7.26	11.36	9.02	0.01
SQU-US	2026-06-09 05:30:00	8.33	20.11	0.47	7.21	11.62	10.39	0.01
SQU-US	2026-06-09 05:45:00	8.33	0.08	0.45	7.22	11.68	43.62	0.00
SQU-US	2026-06-09 06:00:00	8.34	0.08	0.45	7.28	11.68	9.32	0.00
SQU-US	2026-06-09 06:15:00	8.36	0.08	0.45	7.16	11.67	9.28	0.00
SQU-US	2026-06-09 06:30:00	8.36	0.08	0.45	7.28	11.68	9.20	0.00
SQU-US	2026-06-09 06:45:00	8.37	0.08	0.45	7.29	11.68	9.15	0.00
SQU-US	2026-06-09 07:00:00	8.38	0.08	0.46	7.29	11.68	9.00	0.00
SQU-US	2026-06-09 07:15:00	8.37	0.08	0.45	7.27	11.69	8.97	0.00
SQU-US	2026-06-09 07:30:00	8.38	0.08	0.46	7.26	11.69	9.36	0.00
SQU-US	2026-06-09 07:45:00	8.37	0.08	0.45	7.28	11.69	9.18	0.00
SQU-US	2026-06-09 08:00:00	8.38	0.08	0.45	7.28	11.69	9.48	0.00
SQU-US	2026-06-09 08:15:00	8.40	0.08	0.45	7.28	11.69	9.58	0.00
SQU-US	2026-06-09 08:30:00	8.43	0.08	0.45	7.18	11.68	27.48	0.00
SQU-US	2026-06-09 08:45:00	8.49	0.08	0.45	7.31	11.67	92.81	0.00
SQU-US	2026-06-09 09:00:00	8.53	0.08	0.44	7.24	11.68	10.14	0.00
SQU-US	2026-06-09 09:15:00	8.47	0.08	0.44	7.22	11.68	17.13	0.00
SQU-US	2026-06-09 09:30:00	8.52	0.08	0.44	7.22	11.68	14.04	0.00
SQU-US	2026-06-09 09:45:00	8.47	0.08	0.46	7.31	11.69	19.56	0.00
SQU-US	2026-06-09 10:00:00	8.45	5.33	0.45	7.30	11.66	19.03	0.00
SQU-US	2026-06-09 10:15:00	8.37	0.08	0.45	7.29	11.71	37.78	0.00
SQU-US	2026-06-09 10:30:00	8.40	20.45	0.45	7.28	11.70	57.42	0.01
SQU-US	2026-06-09 10:45:00	8.38	26.96	0.45	7.33	11.68	48.97	0.01
SQU-US	2026-06-09 11:00:00	8.38	23.31	0.45	7.29	11.67	55.13	0.01
SQU-US	2026-06-09 11:15:00	8.38	33.12	0.45	7.34	11.63	49.97	0.01
SQU-US	2026-06-09 11:30:00	8.40	32.95	0.45	7.35	11.64	54.51	0.01
SQU-US	2026-06-09 11:45:00	8.44	32.95	0.45	7.36	11.64	56.60	0.01
SQU-US	2026-06-09 12:00:00	8.46	32.91	0.45	7.35	11.66	56.68	0.01
SQU-US	2026-06-09 12:15:00	8.49	32.87	0.45	7.34	11.66	62.05	0.01
SQU-US	2026-06-09 12:30:00	8.50	33.01	0.45	7.35	11.67	60.96	0.01
SQU-US	2026-06-09 12:45:00	8.54	33.08	0.45	7.33	11.67	58.77	0.01
SQU-US	2026-06-09 13:00:00	8.57	33.02	0.45	7.34	11.68	53.97	0.01
SQU-US	2026-06-09 13:15:00	8.58	33.10	0.45	7.34	11.69	54.52	0.01
SQU-US	2026-06-09 13:30:00	8.62	33.08	0.44	7.36	11.69	54.66	0.01
SQU-US	2026-06-09 13:45:00	8.66	32.87	0.45	7.33	11.70	59.62	0.01
SQU-US	2026-06-09 14:00:00	8.69	32.99	0.44	7.37	11.70	62.48	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-09 14:15:00	8.70	33.28	0.44	7.37	11.70	65.13	0.01
SQU-US	2026-06-09 14:30:00	8.70	32.81	0.44	7.36	11.69	61.21	0.01
SQU-US	2026-06-09 14:45:00	8.69	32.88	0.45	7.36	11.69	56.75	0.01
SQU-US	2026-06-09 15:00:00	8.71	32.46	0.45	7.36	11.70	57.65	0.01
SQU-US	2026-06-09 15:15:00	8.70	32.76	0.45	7.40	11.70	61.92	0.01
SQU-US	2026-06-09 15:30:00	8.74	32.75	0.45	7.37	11.70	65.73	0.01
SQU-US	2026-06-09 15:45:00	8.76	32.26	0.45	7.37	11.70	60.15	0.01
SQU-US	2026-06-09 16:00:00	8.76	32.17	0.45	7.36	11.68	68.69	0.01
SQU-US	2026-06-09 16:15:00	8.78	31.83	0.45	7.33	11.67	56.92	0.01
SQU-US	2026-06-09 16:30:00	8.77	31.94	0.45	7.38	11.66	57.49	0.01
SQU-US	2026-06-09 16:45:00	8.76	32.18	0.45	7.35	11.65	56.53	0.01
SQU-US	2026-06-09 17:00:00	8.77	31.65	0.45	7.33	11.64	55.07	0.01
SQU-US	2026-06-09 17:15:00	8.78	31.68	0.45	7.32	11.64	52.70	0.01
SQU-US	2026-06-09 17:30:00	8.80	32.04	0.44	7.31	11.65	48.48	0.01
SQU-US	2026-06-09 17:45:00	8.78	31.73	0.44	7.30	11.63	46.12	0.01
SQU-US	2026-06-09 18:00:00	8.78	31.40	0.44	7.34	11.62	62.06	0.01
SQU-US	2026-06-09 18:15:00	8.76	31.83	0.44	7.32	11.61	55.13	0.01
SQU-US	2026-06-09 18:30:00	8.75	32.09	0.44	7.31	11.58	57.74	0.01
SQU-US	2026-06-09 18:45:00	8.74	31.69	0.44	7.32	11.59	50.78	0.01
SQU-US	2026-06-09 19:00:00	8.74	31.85	0.44	7.32	11.57	62.79	0.01
SQU-US	2026-06-09 19:15:00	8.71	31.64	0.44	7.34	11.57	53.47	0.01
SQU-US	2026-06-09 19:30:00	8.71	31.58	0.44	7.32	11.57	60.57	0.01
SQU-US	2026-06-09 19:45:00	8.69	31.32	0.44	7.37	11.59	65.20	0.01
SQU-US	2026-06-09 20:00:00	8.69	30.95	0.44	7.35	11.60	70.90	0.01
SQU-US	2026-06-09 20:15:00	8.66	31.11	0.44	7.32	11.61	49.61	0.01
SQU-US	2026-06-09 20:30:00	8.66	30.82	0.44	7.34	11.60	59.20	0.01
SQU-US	2026-06-09 20:45:00	8.64	31.05	0.44	7.34	11.60	57.15	0.01
SQU-US	2026-06-09 21:00:00	8.60	31.03	0.44	7.29	11.60	58.35	0.01
SQU-US	2026-06-09 21:15:00	8.59	30.75	0.45	7.26	11.60	59.77	0.01
SQU-US	2026-06-09 21:30:00	8.56	30.80	0.44	7.35	11.59	63.19	0.01
SQU-US	2026-06-09 21:45:00	8.55	30.24	0.44	7.32	11.60	63.12	0.01
SQU-US	2026-06-09 22:00:00	8.51	29.81	0.45	7.31	11.62	61.18	0.01
SQU-US	2026-06-09 22:15:00	8.48	29.96	0.45	7.28	11.61	63.88	0.01
SQU-US	2026-06-09 22:30:00	8.42	29.60	0.45	7.28	11.64	313.20	0.01
SQU-US	2026-06-09 22:45:00	8.34	28.76	0.45	7.30	11.66	55.47	0.01
SQU-US	2026-06-09 23:00:00	8.29	30.05	0.45	7.33	11.66	57.39	0.01
SQU-US	2026-06-09 23:15:00	8.18	29.69	0.46	7.35	11.71	57.17	0.01
SQU-US	2026-06-09 23:30:00	8.11	29.08	0.45	7.40	11.75	59.78	0.01
SQU-US	2026-06-09 23:45:00	8.08	30.00	0.46	7.36	11.76	56.69	0.01
SQU-US	2026-06-10 00:00:00	8.04	30.16	0.46	7.36	11.79	54.47	0.01
SQU-US	2026-06-10 00:15:00	8.01	30.30	0.46	7.38	11.81	47.87	0.01
SQU-US	2026-06-10 00:30:00	7.99	29.85	0.46	7.36	11.83	45.69	0.01
SQU-US	2026-06-10 00:45:00	7.97	28.52	0.46	7.37	11.87	42.38	0.01
SQU-US	2026-06-10 01:00:00	7.93	29.16	0.46	7.39	11.87	45.67	0.01
SQU-US	2026-06-10 01:15:00	7.87	27.68	0.46	7.39	11.89	43.87	0.01
SQU-US	2026-06-10 01:30:00	7.81	26.85	0.46	7.37	11.92	41.43	0.01
SQU-US	2026-06-10 01:45:00	7.76	26.39	0.46	7.39	11.95	40.36	0.01
SQU-US	2026-06-10 02:00:00	7.75	26.27	0.47	7.35	11.97	38.98	0.01
SQU-US	2026-06-10 02:15:00	7.71	26.66	0.47	7.37	11.98	37.65	0.01
SQU-US	2026-06-10 02:30:00	7.67	25.54	0.47	7.34	12.00	39.13	0.01
SQU-US	2026-06-10 02:45:00	7.66	25.64	0.47	7.33	11.99	37.88	0.01
SQU-US	2026-06-10 03:00:00	7.64	25.44	0.47	7.33	12.00	37.92	0.01
SQU-US	2026-06-10 03:15:00	7.62	25.18	0.47	7.30	12.00	40.51	0.01
SQU-US	2026-06-10 03:30:00	7.60	25.01	0.47	7.28	12.00	44.34	0.01
SQU-US	2026-06-10 03:45:00	7.58	25.09	0.47	7.32	11.99	44.80	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-10 04:00:00	7.61	24.91	0.47	7.27	11.98	42.70	0.01
SQU-US	2026-06-10 04:15:00	7.57	25.17	0.47	7.27	11.98	44.82	0.01
SQU-US	2026-06-10 04:30:00	7.56	25.18	0.48	7.26	11.96	43.72	0.01
SQU-US	2026-06-10 04:45:00	7.53	25.30	0.48	7.27	11.95	58.75	0.01
SQU-US	2026-06-10 05:00:00	7.53	25.08	0.48	7.24	11.97	61.33	0.01
SQU-US	2026-06-10 05:15:00	7.48	24.99	0.48	7.23	11.98	50.21	0.01
SQU-US	2026-06-10 05:30:00	7.50	25.27	0.48	7.22	11.98	45.90	0.01
SQU-US	2026-06-10 05:45:00	7.47	24.88	0.47	7.27	11.98	52.13	0.01
SQU-US	2026-06-10 06:00:00	7.46	25.07	0.47	7.27	11.98	60.42	0.01
SQU-US	2026-06-10 06:15:00	7.47	24.92	0.47	7.26	11.99	60.39	0.01
SQU-US	2026-06-10 06:30:00	7.48	25.35	0.47	7.24	11.99	58.08	0.01
SQU-US	2026-06-10 06:45:00	7.46	25.35	0.47	7.25	11.99	54.69	0.01
SQU-US	2026-06-10 07:00:00	7.45	25.23	0.47	7.27	12.01	62.66	0.01
SQU-US	2026-06-10 07:15:00	7.45	25.17	0.47	7.23	12.01	61.17	0.01
SQU-US	2026-06-10 07:30:00	7.46	25.41	0.46	7.26	12.03	68.54	0.01
SQU-US	2026-06-10 07:45:00	7.48	25.20	0.46	7.27	12.03	63.57	0.01
SQU-US	2026-06-10 08:00:00	7.49	25.32	0.45	7.28	12.02	61.03	0.01
SQU-US	2026-06-10 08:15:00	7.54	26.25	0.45	7.23	12.00	54.34	0.01
SQU-US	2026-06-10 08:30:00	7.56	25.93	0.45	7.25	12.02	57.74	0.01
SQU-US	2026-06-10 08:45:00	7.59	26.64	0.44	7.26	12.02	61.78	0.01
SQU-US	2026-06-10 09:00:00	7.66	26.27	0.44	7.24	12.01	60.80	0.01
SQU-US	2026-06-10 09:15:00	7.74	26.35	0.44	7.26	12.01	64.63	0.01
SQU-US	2026-06-10 09:30:00	7.82	26.70	0.43	7.26	12.02	55.06	0.01
SQU-US	2026-06-10 09:45:00	7.87	26.44	0.43	7.24	12.01	58.09	0.01
SQU-US	2026-06-10 10:00:00	7.98	26.12	0.43	7.26	12.01	59.83	0.01
SQU-US	2026-06-10 10:15:00	8.09	25.87	0.42	7.25	12.02	56.82	0.01
SQU-US	2026-06-10 10:30:00	8.14	25.93	0.42	7.30	12.02	57.09	0.01
SQU-US	2026-06-10 10:45:00	8.20	25.90	0.42	7.26	12.01	50.12	0.01
SQU-US	2026-06-10 11:00:00	8.24	26.02	0.42	7.30	12.00	55.96	0.01
SQU-US	2026-06-10 11:15:00	8.26	26.08	0.42	7.28	11.99	41.93	0.01
SQU-US	2026-06-10 11:30:00	8.29	26.08	0.42	7.30	11.99	62.24	0.01
SQU-US	2026-06-10 11:45:00	8.34	26.25	0.42	7.27	11.97	65.70	0.01
SQU-US	2026-06-10 12:00:00	8.40	26.02	0.42	7.31	11.96	52.43	0.01
SQU-US	2026-06-10 12:15:00	8.44	26.34	0.42	7.30	11.95	55.04	0.01
SQU-US	2026-06-10 12:30:00	8.50	26.31	0.42	7.29	11.94	42.89	0.01
SQU-US	2026-06-10 12:45:00	8.54	26.05	0.42	7.30	11.95	49.02	0.01
SQU-US	2026-06-10 13:00:00	8.57	26.15	0.42	7.29	11.94	43.49	0.01
SQU-US	2026-06-10 13:15:00	8.61	26.28	0.42	7.28	11.93	49.17	0.01
SQU-US	2026-06-10 13:30:00	8.66	26.62	0.42	7.30	11.92	38.36	0.01
SQU-US	2026-06-10 13:45:00	8.71	26.58	0.42	7.30	11.91	49.86	0.01
SQU-US	2026-06-10 14:00:00	8.74	26.28	0.42	7.29	11.90	50.27	0.01
SQU-US	2026-06-10 14:15:00	8.76	26.33	0.42	7.31	11.89	44.86	0.01
SQU-US	2026-06-10 14:30:00	8.83	26.45	0.43	7.31	11.87	45.36	0.01
SQU-US	2026-06-10 14:45:00	8.86	26.59	0.43	7.31	11.85	47.93	0.01
SQU-US	2026-06-10 15:00:00	8.90	26.76	0.43	7.32	11.82	47.71	0.01
SQU-US	2026-06-10 15:15:00	8.93	27.01	0.43	7.31	11.82	50.29	0.01
SQU-US	2026-06-10 15:30:00	8.96	27.41	0.43	7.32	11.80	44.92	0.01
SQU-US	2026-06-10 15:45:00	8.96	27.00	0.43	7.32	11.81	49.94	0.01
SQU-US	2026-06-10 16:00:00	8.96	27.18	0.43	7.32	11.81	49.00	0.01
SQU-US	2026-06-10 16:15:00	8.97	27.44	0.44	7.31	11.79	47.14	0.01
SQU-US	2026-06-10 16:30:00	8.96	27.36	0.44	7.33	11.78	47.99	0.01
SQU-US	2026-06-10 16:45:00	8.96	27.27	0.44	7.34	11.77	48.45	0.01
SQU-US	2026-06-10 17:00:00	8.93	27.14	0.44	7.30	11.77	49.05	0.01
SQU-US	2026-06-10 17:15:00	8.92	27.47	0.44	7.31	11.76	49.76	0.01
SQU-US	2026-06-10 17:30:00	8.90	27.61	0.45	7.31	11.74	48.43	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-10 17:45:00	8.88	27.57	0.45	7.30	11.74	50.85	0.01
SQU-US	2026-06-10 18:00:00	8.87	27.60	0.45	7.32	11.75	52.18	0.01
SQU-US	2026-06-10 18:15:00	8.86	27.64	0.45	7.31	11.74	49.10	0.01
SQU-US	2026-06-10 18:30:00	8.86	27.69	0.45	7.32	11.73	54.51	0.01
SQU-US	2026-06-10 18:45:00	8.86	28.15	0.45	7.30	11.71	55.43	0.01
SQU-US	2026-06-10 19:00:00	8.85	28.05	0.45	7.30	11.70	55.34	0.01
SQU-US	2026-06-10 19:15:00	8.85	28.08	0.45	7.31	11.70	50.27	0.01
SQU-US	2026-06-10 19:30:00	8.87	28.35	0.46	7.30	11.68	48.83	0.01
SQU-US	2026-06-10 19:45:00	8.88	28.48	0.46	7.29	11.68	52.66	0.01
SQU-US	2026-06-10 20:00:00	8.90	28.42	0.46	7.32	11.67	47.94	0.01
SQU-US	2026-06-10 20:15:00	8.90	28.59	0.46	7.29	11.68	48.83	0.01
SQU-US	2026-06-10 20:30:00	8.90	28.56	0.46	7.28	11.66	48.96	0.01
SQU-US	2026-06-10 20:45:00	8.89	28.68	0.46	7.29	11.65	47.32	0.01
SQU-US	2026-06-10 21:00:00	8.89	28.91	0.46	7.29	11.64	49.41	0.01
SQU-US	2026-06-10 21:15:00	8.88	28.89	0.46	7.27	11.62	48.53	0.01
SQU-US	2026-06-10 21:30:00	8.87	28.64	0.47	7.26	11.60	46.45	0.01
SQU-US	2026-06-10 21:45:00	8.85	28.71	0.47	7.28	11.60	41.53	0.01
SQU-US	2026-06-10 22:00:00	8.82	29.19	0.47	7.27	11.59	45.79	0.01
SQU-US	2026-06-10 22:15:00	8.85	28.94	0.47	7.27	11.59	45.05	0.01
SQU-US	2026-06-10 22:30:00	8.80	29.31	0.47	7.28	11.57	46.29	0.01
SQU-US	2026-06-10 22:45:00	8.79	29.27	0.47	7.25	11.58	43.29	0.01
SQU-US	2026-06-10 23:00:00	8.77	29.14	0.47	7.27	11.57	44.64	0.01
SQU-US	2026-06-10 23:15:00	8.77	29.29	0.47	7.27	11.57	47.19	0.01
SQU-US	2026-06-10 23:30:00	8.74	29.16	0.47	7.27	11.57	45.85	0.01
SQU-US	2026-06-10 23:45:00	8.72	29.10	0.47	7.26	11.57	45.60	0.01
SQU-US	2026-06-11 00:00:00	8.68	29.38	0.47	7.25	11.57	45.48	0.01
SQU-US	2026-06-11 00:15:00	8.65	29.32	0.47	7.27	11.58	47.58	0.01
SQU-US	2026-06-11 00:30:00	8.63	29.00	0.48	7.25	11.60	47.70	0.01
SQU-US	2026-06-11 00:45:00	8.59	28.89	0.48	7.28	11.61	43.08	0.01
SQU-US	2026-06-11 01:00:00	8.56	28.91	0.47	7.30	11.62	43.74	0.01
SQU-US	2026-06-11 01:15:00	8.53	29.05	0.48	7.29	11.63	43.23	0.01
SQU-US	2026-06-11 01:30:00	8.48	29.78	0.48	7.26	11.63	45.58	0.01
SQU-US	2026-06-11 01:45:00	8.45	29.42	0.48	7.28	11.64	43.00	0.01
SQU-US	2026-06-11 02:00:00	8.41	29.37	0.48	7.27	11.63	38.32	0.01
SQU-US	2026-06-11 02:15:00	8.38	29.90	0.48	7.27	11.64	42.49	0.01
SQU-US	2026-06-11 02:30:00	8.33	29.31	0.48	7.26	11.65	38.44	0.01
SQU-US	2026-06-11 02:45:00	8.33	29.46	0.48	7.26	11.65	43.73	0.01
SQU-US	2026-06-11 03:00:00	8.30	29.72	0.48	7.25	11.65	54.43	0.01
SQU-US	2026-06-11 03:15:00	8.30	30.35	0.48	7.21	11.61	45.12	0.01
SQU-US	2026-06-11 03:30:00	8.29	30.42	0.48	7.21	11.59	39.86	0.01
SQU-US	2026-06-11 03:45:00	8.28	30.44	0.48	7.19	11.58	43.19	0.01
SQU-US	2026-06-11 04:00:00	8.25	30.41	0.48	7.21	11.59	42.13	0.01
SQU-US	2026-06-11 04:15:00	8.24	29.50	0.48	7.21	11.61	41.65	0.01
SQU-US	2026-06-11 04:30:00	8.25	29.29	0.48	7.21	11.64	42.92	0.01
SQU-US	2026-06-11 04:45:00	8.22	29.35	0.48	7.24	11.65	44.10	0.01
SQU-US	2026-06-11 05:00:00	8.18	29.03	0.48	7.23	11.67	41.78	0.01
SQU-US	2026-06-11 05:15:00	8.19	29.11	0.48	7.21	11.67	40.67	0.01
SQU-US	2026-06-11 05:30:00	8.18	29.37	0.48	7.24	11.65	41.74	0.01
SQU-US	2026-06-11 05:45:00	8.17	29.02	0.48	7.21	11.64	39.80	0.01
SQU-US	2026-06-11 06:00:00	8.15	29.19	0.48	7.24	11.67	40.65	0.01
SQU-US	2026-06-11 06:15:00	8.14	29.19	0.48	7.23	11.67	40.58	0.01
SQU-US	2026-06-11 06:30:00	8.16	29.30	0.48	7.23	11.68	41.55	0.01
SQU-US	2026-06-11 06:45:00	8.15	29.37	0.48	7.23	11.69	40.50	0.01
SQU-US	2026-06-11 07:00:00	8.14	29.47	0.48	7.23	11.69	41.46	0.01
SQU-US	2026-06-11 07:15:00	8.15	29.53	0.48	7.25	11.70	41.39	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-11 07:30:00	8.15	29.69	0.48	7.24	11.71	37.68	0.01
SQU-US	2026-06-11 07:45:00	8.14	29.71	0.48	7.24	11.72	41.47	0.01
SQU-US	2026-06-11 08:00:00	8.18	29.59	0.48	7.23	11.74	38.10	0.01
SQU-US	2026-06-11 08:15:00	8.21	29.78	0.48	7.25	11.73	40.46	0.01
SQU-US	2026-06-11 08:30:00	8.26	30.07	0.48	7.26	11.74	38.69	0.01
SQU-US	2026-06-11 08:45:00	8.34	30.01	0.48	7.25	11.75	36.10	0.01
SQU-US	2026-06-11 09:00:00	8.40	30.02	0.47	7.25	11.75	38.74	0.01
SQU-US	2026-06-11 09:15:00	8.45	30.24	0.47	7.27	11.75	33.15	0.01
SQU-US	2026-06-11 09:30:00	8.53	30.27	0.47	7.27	11.74	32.26	0.01
SQU-US	2026-06-11 09:45:00	8.59	30.37	0.47	7.27	11.73	41.26	0.01
SQU-US	2026-06-11 10:00:00	8.62	30.56	0.47	7.27	11.74	39.24	0.01
SQU-US	2026-06-11 10:15:00	8.69	30.51	0.47	7.27	11.73	39.42	0.01
SQU-US	2026-06-11 10:30:00	8.75	30.56	0.47	7.28	11.73	40.44	0.01
SQU-US	2026-06-11 10:45:00	8.80	30.54	0.47	7.27	11.72	40.30	0.01
SQU-US	2026-06-11 11:00:00	8.88	30.74	0.47	7.27	11.72	40.01	0.01
SQU-US	2026-06-11 11:15:00	8.96	30.57	0.47	7.29	11.72	35.65	0.01
SQU-US	2026-06-11 11:30:00	9.04	30.54	0.47	7.27	11.71	41.66	0.01
SQU-US	2026-06-11 11:45:00	9.09	30.34	0.46	7.31	11.71	39.41	0.01
SQU-US	2026-06-11 12:00:00	9.17	30.16	0.46	7.30	11.70	37.18	0.01
SQU-US	2026-06-11 12:15:00	9.30	30.42	0.46	7.31	11.69	40.37	0.01
SQU-US	2026-06-11 12:30:00	9.41	30.47	0.46	7.31	11.67	41.84	0.01
SQU-US	2026-06-11 12:45:00	9.52	30.11	0.46	7.31	11.66	41.56	0.01
SQU-US	2026-06-11 13:00:00	9.61	30.09	0.46	7.33	11.64	43.10	0.01
SQU-US	2026-06-11 13:15:00	9.66	30.12	0.46	7.30	11.65	35.74	0.01
SQU-US	2026-06-11 13:30:00	9.79	29.91	0.46	7.29	11.63	32.90	0.01
SQU-US	2026-06-11 13:45:00	9.91	29.59	0.46	7.28	11.60	32.26	0.01
SQU-US	2026-06-11 14:00:00	9.99	29.46	0.46	7.29	11.59	33.48	0.01
SQU-US	2026-06-11 14:15:00	10.07	29.10	0.46	7.31	11.58	35.56	0.01
SQU-US	2026-06-11 14:30:00	10.15	28.97	0.46	7.32	11.55	33.86	0.01
SQU-US	2026-06-11 14:45:00	10.22	28.99	0.46	7.31	11.54	34.41	0.01
SQU-US	2026-06-11 15:00:00	10.26	28.89	0.46	7.31	11.53	38.32	0.01
SQU-US	2026-06-11 15:15:00	10.32	28.78	0.46	7.34	11.50	34.85	0.01
SQU-US	2026-06-11 15:30:00	10.40	28.81	0.46	7.33	11.50	29.11	0.01
SQU-US	2026-06-11 15:45:00	10.48	29.07	0.46	7.33	11.47	33.08	0.01
SQU-US	2026-06-11 16:00:00	10.57	29.19	0.46	7.34	11.44	27.04	0.01
SQU-US	2026-06-11 16:15:00	10.66	29.43	0.46	7.35	11.42	30.67	0.01
SQU-US	2026-06-11 16:30:00	10.70	29.64	0.46	7.34	11.41	30.59	0.01
SQU-US	2026-06-11 16:45:00	10.75	29.93	0.46	7.35	11.39	30.50	0.01
SQU-US	2026-06-11 17:00:00	10.87	30.15	0.46	7.35	11.37	32.92	0.01
SQU-US	2026-06-11 17:15:00	10.96	30.02	0.46	7.36	11.36	32.96	0.01
SQU-US	2026-06-11 17:30:00	11.06	30.11	0.46	7.35	11.34	33.06	0.01
SQU-US	2026-06-11 17:45:00	11.12	30.37	0.46	7.36	11.32	33.88	0.01
SQU-US	2026-06-11 18:00:00	11.18	30.69	0.46	7.35	11.31	30.36	0.01
SQU-US	2026-06-11 18:15:00	11.22	30.84	0.46	7.35	11.28	33.69	0.01
SQU-US	2026-06-11 18:30:00	11.20	30.89	0.46	7.35	11.27	32.54	0.01
SQU-US	2026-06-11 18:45:00	11.17	30.70	0.47	7.34	11.25	32.34	0.01
SQU-US	2026-06-11 19:00:00	11.15	30.96	0.47	7.34	11.24	29.37	0.01
SQU-US	2026-06-11 19:15:00	11.14	31.08	0.47	7.35	11.23	34.14	0.01
SQU-US	2026-06-11 19:30:00	11.11	31.48	0.47	7.35	11.21	30.83	0.01
SQU-US	2026-06-11 19:45:00	11.08	31.47	0.47	7.35	11.17	38.74	0.01
SQU-US	2026-06-11 20:00:00	11.03	31.71	0.47	7.35	11.16	34.26	0.01
SQU-US	2026-06-11 20:15:00	10.98	31.85	0.47	7.33	11.14	28.48	0.01
SQU-US	2026-06-11 20:30:00	10.94	31.89	0.47	7.34	11.13	29.62	0.01
SQU-US	2026-06-11 20:45:00	10.90	32.07	0.47	7.34	11.11	28.81	0.01
SQU-US	2026-06-11 21:00:00	10.86	32.04	0.47	7.34	11.08	34.49	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-11 21:15:00	10.81	32.17	0.47	7.34	11.07	42.77	0.01
SQU-US	2026-06-11 21:30:00	10.76	32.34	0.47	7.34	11.06	36.80	0.01
SQU-US	2026-06-11 21:45:00	10.72	32.36	0.47	7.32	11.05	29.68	0.01
SQU-US	2026-06-11 22:00:00	10.67	32.46	0.47	7.31	11.04	40.07	0.01
SQU-US	2026-06-11 22:15:00	10.62	32.40	0.47	7.32	11.03	27.55	0.01
SQU-US	2026-06-11 22:30:00	10.58	32.41	0.47	7.30	11.02	32.10	0.01
SQU-US	2026-06-11 22:45:00	10.53	32.12	0.47	7.29	11.01	29.84	0.01
SQU-US	2026-06-11 23:00:00	10.49	31.77	0.47	7.29	11.02	40.13	0.01
SQU-US	2026-06-11 23:15:00	10.45	31.47	0.47	7.29	11.02	32.69	0.01
SQU-US	2026-06-11 23:30:00	10.42	31.20	0.47	7.28	11.03	51.04	0.01
SQU-US	2026-06-11 23:45:00	10.37	31.10	0.47	7.28	11.04	30.98	0.01
SQU-US	2026-06-12 00:00:00	10.32	30.99	0.48	7.29	11.04	31.41	0.01
SQU-US	2026-06-12 00:15:00	10.28	30.52	0.47	7.30	11.06	33.68	0.01
SQU-US	2026-06-12 00:30:00	10.22	30.40	0.48	7.29	11.07	30.69	0.01
SQU-US	2026-06-12 00:45:00	10.19	29.95	0.48	7.28	11.09	34.41	0.01
SQU-US	2026-06-12 01:00:00	10.11	29.92	0.48	7.29	11.10	39.79	0.01
SQU-US	2026-06-12 01:15:00	10.05	29.83	0.48	7.30	11.11	33.78	0.01
SQU-US	2026-06-12 01:30:00	10.00	29.45	0.48	7.30	11.12	38.96	0.01
SQU-US	2026-06-12 01:45:00	9.93	29.27	0.48	7.30	11.14	48.14	0.01
SQU-US	2026-06-12 02:00:00	9.84	29.18	0.48	7.30	11.16	57.52	0.01
SQU-US	2026-06-12 02:15:00	9.76	29.32	0.48	7.29	11.19	69.96	0.01
SQU-US	2026-06-12 02:30:00	9.70	29.49	0.48	7.31	11.21	61.48	0.01
SQU-US	2026-06-12 02:45:00	9.63	29.45	0.48	7.34	11.24	45.66	0.01
SQU-US	2026-06-12 03:00:00	9.56	29.67	0.48	7.32	11.26	42.85	0.01
SQU-US	2026-06-12 03:15:00	9.49	29.89	0.48	7.29	11.25	68.65	0.01
SQU-US	2026-06-12 03:30:00	9.44	29.86	0.48	7.28	11.27	39.70	0.01
SQU-US	2026-06-12 03:45:00	9.39	30.01	0.49	7.28	11.27	37.34	0.01
SQU-US	2026-06-12 04:00:00	9.35	29.94	0.48	7.28	11.29	59.98	0.01
SQU-US	2026-06-12 04:15:00	9.30	30.31	0.49	7.27	11.27	54.06	0.01
SQU-US	2026-06-12 04:30:00	9.26	30.59	0.49	7.22	11.26	50.60	0.01
SQU-US	2026-06-12 04:45:00	9.21	30.30	0.49	7.21	11.26	45.49	0.01
SQU-US	2026-06-12 05:00:00	9.17	30.25	0.49	7.21	11.28	43.48	0.01
SQU-US	2026-06-12 05:15:00	9.14	29.63	0.49	7.21	11.31	48.32	0.01
SQU-US	2026-06-12 05:30:00	9.10	29.21	0.49	7.23	11.35	36.57	0.01
SQU-US	2026-06-12 05:45:00	9.03	28.88	0.49	7.23	11.37	38.46	0.01
SQU-US	2026-06-12 06:00:00	8.99	29.09	0.49	7.25	11.41	32.50	0.01
SQU-US	2026-06-12 06:15:00	8.96	29.18	0.49	7.26	11.43	36.00	0.01
SQU-US	2026-06-12 06:30:00	8.93	29.04	0.49	7.26	11.44	28.53	0.01
SQU-US	2026-06-12 06:45:00	8.92	28.88	0.48	7.27	11.47	30.89	0.01
SQU-US	2026-06-12 07:00:00	8.88	29.14	0.49	7.25	11.48	25.32	0.01
SQU-US	2026-06-12 07:15:00	8.88	29.09	0.49	7.24	11.50	24.64	0.01
SQU-US	2026-06-12 07:30:00	8.89	28.94	0.48	7.27	11.51	26.12	0.01
SQU-US	2026-06-12 07:45:00	8.90	28.86	0.48	7.25	11.53	23.23	0.01
SQU-US	2026-06-12 08:00:00	8.88	29.05	0.48	7.27	11.55	25.86	0.01
SQU-US	2026-06-12 08:15:00	8.89	29.05	0.48	7.25	11.56	24.55	0.01
SQU-US	2026-06-12 08:30:00	8.90	29.07	0.48	7.29	11.57	23.83	0.01
SQU-US	2026-06-12 08:45:00	8.95	29.18	0.48	7.29	11.58	22.52	0.01
SQU-US	2026-06-12 09:00:00	8.99	29.29	0.48	7.26	11.59	22.54	0.01
SQU-US	2026-06-12 09:15:00	9.05	29.11	0.48	7.29	11.59	22.93	0.01
SQU-US	2026-06-12 09:30:00	9.09	29.32	0.48	7.27	11.60	21.89	0.01
SQU-US	2026-06-12 09:45:00	9.16	29.49	0.48	7.27	11.61	23.78	0.01
SQU-US	2026-06-12 10:00:00	9.22	29.51	0.47	7.29	11.60	22.29	0.01
SQU-US	2026-06-12 10:15:00	9.29	29.60	0.47	7.28	11.59	22.83	0.01
SQU-US	2026-06-12 10:30:00	9.35	29.58	0.47	7.30	11.60	21.85	0.01
SQU-US	2026-06-12 10:45:00	9.43	29.47	0.47	7.29	11.59	21.53	0.01


Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-12 11:00:00	9.51	29.76	0.47	7.30	11.59	21.04	0.01
SQU-US	2026-06-12 11:15:00	9.59	29.75	0.47	7.30	11.57	18.93	0.01
SQU-US	2026-06-12 11:30:00	9.70	29.47	0.47	7.28	11.58	21.34	0.01
SQU-US	2026-06-12 11:45:00	9.79	29.69	0.47	7.29	11.57	19.87	0.01
SQU-US	2026-06-12 12:00:00	9.88	29.62	0.47	7.29	11.57	20.64	0.01
SQU-US	2026-06-12 12:15:00	9.97	29.67	0.46	7.32	11.57	21.59	0.01
SQU-US	2026-06-12 12:30:00	10.07	29.57	0.46	7.31	11.55	20.23	0.01
SQU-US	2026-06-12 12:45:00	10.18	29.36	0.46	7.30	11.55	19.92	0.01
SQU-US	2026-06-12 13:00:00	10.28	29.20	0.46	7.30	11.54	20.77	0.01
SQU-US	2026-06-12 13:15:00	10.37	29.31	0.46	7.31	11.52	22.00	0.01
SQU-US	2026-06-12 13:30:00	10.46	29.28	0.46	7.32	11.52	22.23	0.01
SQU-US	2026-06-12 13:45:00	10.56	29.24	0.46	7.32	11.50	18.99	0.01
SQU-US	2026-06-12 14:00:00	10.65	29.20	0.46	7.31	11.50	18.20	0.01
SQU-US	2026-06-12 14:15:00	10.76	29.20	0.46	7.30	11.48	18.07	0.01
SQU-US	2026-06-12 14:30:00	10.83	29.30	0.46	7.33	11.46	18.12	0.01
SQU-US	2026-06-12 14:45:00	10.92	29.23	0.46	7.29	11.45	17.89	0.01
SQU-US	2026-06-12 15:00:00	11.03	29.18	0.46	7.32	11.44	17.52	0.01
SQU-US	2026-06-12 15:15:00	11.17	29.07	0.46	7.32	11.42	17.79	0.01
SQU-US	2026-06-12 15:30:00	11.24	29.25	0.46	7.31	11.40	17.16	0.01
SQU-US	2026-06-12 15:45:00	11.29	29.09	0.46	7.30	11.38	17.18	0.01
SQU-US	2026-06-12 16:00:00	11.34	29.05	0.46	7.33	11.37	17.30	0.01
SQU-US	2026-06-12 16:15:00	11.39	29.04	0.45	7.35	11.35	17.89	0.01
SQU-US	2026-06-12 16:30:00	11.46	29.06	0.45	7.35	11.34	16.25	0.01
SQU-US	2026-06-12 16:45:00	11.48	29.06	0.45	7.34	11.33	15.93	0.01
SQU-US	2026-06-12 17:00:00	11.51	29.00	0.45	7.36	11.32	15.74	0.01
SQU-US	2026-06-12 17:15:00	11.55	29.00	0.45	7.36	11.30	15.33	0.01
SQU-US	2026-06-12 17:30:00	11.59	29.13	0.45	7.37	11.29	16.25	0.01
SQU-US	2026-06-12 17:45:00	11.60	29.34	0.46	7.36	11.27	15.70	0.01
SQU-US	2026-06-12 18:00:00	11.63	29.61	0.46	7.38	11.24	15.52	0.01
SQU-US	2026-06-12 18:15:00	11.64	29.66	0.46	7.37	11.23	16.31	0.01
SQU-US	2026-06-12 18:30:00	11.67	30.13	0.46	7.36	11.18	16.31	0.01
SQU-US	2026-06-12 18:45:00	11.67	30.48	0.46	7.34	11.15	16.69	0.01
SQU-US	2026-06-12 19:00:00	11.66	30.80	0.46	7.32	11.10	15.22	0.01
SQU-US	2026-06-12 19:15:00	11.65	30.92	0.46	7.30	11.07	16.02	0.01
SQU-US	2026-06-12 19:30:00	11.63	31.05	0.46	7.30	11.05	15.70	0.01
SQU-US	2026-06-12 19:45:00	11.61	31.09	0.46	7.30	11.03	15.47	0.01
SQU-US	2026-06-12 20:00:00	11.58	31.57	0.46	7.30	11.01	14.64	0.01
SQU-US	2026-06-12 20:15:00	11.55	31.26	0.46	7.30	10.99	14.94	0.01
SQU-US	2026-06-12 20:30:00	11.53	31.12	0.47	7.30	10.99	14.56	0.01
SQU-US	2026-06-12 20:45:00	11.50	30.86	0.47	7.30	10.97	14.53	0.01
SQU-US	2026-06-12 21:00:00	11.46	31.12	0.47	7.30	10.97	15.21	0.01
SQU-US	2026-06-12 21:15:00	11.44	31.04	0.47	7.32	10.95	15.00	0.01
SQU-US	2026-06-12 21:30:00	11.41	30.91	0.47	7.29	10.94	14.34	0.01
SQU-US	2026-06-12 21:45:00	11.39	30.87	0.47	7.27	10.93	14.39	0.01
SQU-US	2026-06-12 22:00:00	11.37	30.92	0.47	7.28	10.93	15.47	0.01
SQU-US	2026-06-12 22:15:00	11.34	30.85	0.47	7.26	10.92	15.07	0.01
SQU-US	2026-06-12 22:30:00	11.31	30.79	0.47	7.29	10.91	14.58	0.01
SQU-US	2026-06-12 22:45:00	11.27	30.90	0.47	7.30	10.91	14.38	0.01
SQU-US	2026-06-12 23:00:00	11.24	30.58	0.47	7.29	10.90	14.33	0.01
SQU-US	2026-06-12 23:15:00	11.18	30.62	0.47	7.28	10.90	15.82	0.01
SQU-US	2026-06-12 23:30:00	11.13	30.69	0.47	7.31	10.91	15.94	0.01
SQU-US	2026-06-12 23:45:00	11.07	30.49	0.47	7.28	10.92	17.87	0.01
SQU-US	2026-06-13 00:00:00	11.01	30.37	0.47	7.29	10.94	17.25	0.01
SQU-US	2026-06-13 00:15:00	10.96	30.03	0.47	7.30	10.95	18.11	0.01
SQU-US	2026-06-13 00:30:00	10.89	29.96	0.47	7.30	10.95	17.61	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-13 00:45:00	10.81	29.85	0.47	7.31	10.97	18.13	0.01
SQU-US	2026-06-13 01:00:00	10.73	29.60	0.47	7.31	10.99	18.09	0.01
SQU-US	2026-06-13 01:15:00	10.65	29.56	0.47	7.31	11.00	19.86	0.01
SQU-US	2026-06-13 01:30:00	10.56	29.49	0.48	7.30	11.02	18.41	0.01
SQU-US	2026-06-13 01:45:00	10.49	29.18	0.48	7.30	11.04	19.47	0.01
SQU-US	2026-06-13 02:00:00	10.43	28.90	0.48	7.30	11.06	20.06	0.01
SQU-US	2026-06-13 02:15:00	10.34	28.98	0.48	7.30	11.08	19.67	0.01
SQU-US	2026-06-13 02:30:00	10.26	28.81	0.48	7.31	11.11	19.60	0.01
SQU-US	2026-06-13 02:45:00	10.17	28.76	0.48	7.30	11.12	20.15	0.01
SQU-US	2026-06-13 03:00:00	10.11	28.78	0.48	7.30	11.15	19.94	0.01
SQU-US	2026-06-13 03:15:00	10.04	28.83	0.48	7.30	11.16	19.96	0.01
SQU-US	2026-06-13 03:30:00	9.97	28.91	0.48	7.29	11.16	21.76	0.01
SQU-US	2026-06-13 03:45:00	9.92	28.65	0.48	7.30	11.17	20.70	0.01
SQU-US	2026-06-13 04:00:00	9.86	28.84	0.48	7.30	11.18	21.54	0.01
SQU-US	2026-06-13 04:15:00	9.80	28.58	0.48	7.29	11.18	21.53	0.01
SQU-US	2026-06-13 04:30:00	9.74	28.63	0.48	7.28	11.20	19.73	0.01
SQU-US	2026-06-13 04:45:00	9.69	28.73	0.48	7.28	11.22	20.78	0.01
SQU-US	2026-06-13 05:00:00	9.65	28.90	0.48	7.25	11.22	20.16	0.01
SQU-US	2026-06-13 05:15:00	9.60	29.09	0.49	7.22	11.22	19.78	0.01
SQU-US	2026-06-13 05:30:00	9.56	29.24	0.49	7.21	11.21	18.77	0.01
SQU-US	2026-06-13 05:45:00	9.51	29.05	0.49	7.20	11.23	17.31	0.01
SQU-US	2026-06-13 06:00:00	9.47	28.73	0.49	7.22	11.26	15.26	0.01
SQU-US	2026-06-13 06:15:00	9.45	28.46	0.49	7.21	11.28	14.88	0.01
SQU-US	2026-06-13 06:30:00	9.41	28.40	0.48	7.24	11.33	13.83	0.01
SQU-US	2026-06-13 06:45:00	9.39	27.97	0.49	7.22	11.33	14.94	0.01
SQU-US	2026-06-13 07:00:00	9.38	27.71	0.48	7.25	11.37	16.66	0.01
SQU-US	2026-06-13 07:15:00	9.38	27.78	0.48	7.24	11.38	14.13	0.01
SQU-US	2026-06-13 07:30:00	9.35	28.01	0.48	7.22	11.41	14.88	0.01
SQU-US	2026-06-13 07:45:00	9.37	27.89	0.48	7.22	11.44	12.83	0.01
SQU-US	2026-06-13 08:00:00	9.37	27.69	0.48	7.22	11.46	12.95	0.01
SQU-US	2026-06-13 08:15:00	9.40	27.79	0.48	7.22	11.48	13.00	0.01
SQU-US	2026-06-13 08:30:00	9.41	28.00	0.48	7.24	11.48	12.86	0.01
SQU-US	2026-06-13 08:45:00	9.45	27.83	0.48	7.23	11.50	12.84	0.01
SQU-US	2026-06-13 09:00:00	9.49	27.74	0.48	7.25	11.51	12.60	0.01
SQU-US	2026-06-13 09:15:00	9.53	27.64	0.48	7.26	11.52	12.61	0.01
SQU-US	2026-06-13 09:30:00	9.59	27.83	0.47	7.30	11.52	12.80	0.01
SQU-US	2026-06-13 09:45:00	9.64	27.87	0.48	7.28	11.52	14.81	0.01
SQU-US	2026-06-13 10:00:00	9.70	27.99	0.47	7.27	11.52	22.39	0.01
SQU-US	2026-06-13 10:15:00	9.77	28.20	0.47	7.29	11.52	20.49	0.01
SQU-US	2026-06-13 10:30:00	9.84	28.40	0.47	7.28	11.51	22.88	0.01
SQU-US	2026-06-13 10:45:00	9.92	28.37	0.47	7.29	11.50	20.27	0.01
SQU-US	2026-06-13 11:00:00	9.99	28.43	0.47	7.25	11.50	21.04	0.01
SQU-US	2026-06-13 11:15:00	10.06	28.48	0.47	7.29	11.50	23.43	0.01
SQU-US	2026-06-13 11:30:00	10.14	28.27	0.47	7.27	11.50	22.43	0.01
SQU-US	2026-06-13 11:45:00	10.23	28.33	0.47	7.28	11.50	29.56	0.01
SQU-US	2026-06-13 12:00:00	10.32	28.23	0.47	7.29	11.49	26.01	0.01
SQU-US	2026-06-13 12:15:00	10.41	28.28	0.47	7.30	11.48	29.01	0.01
SQU-US	2026-06-13 12:30:00	10.52	28.03	0.47	7.31	11.46	42.09	0.01
SQU-US	2026-06-13 12:45:00	10.62	27.98	0.46	7.33	11.46	118.35	0.01
SQU-US	2026-06-13 13:00:00	10.72	27.98	0.46	7.30	11.43	131.65	0.01
SQU-US	2026-06-13 13:15:00	10.82	28.34	0.47	7.28	11.43	175.88	0.01
SQU-US	2026-06-13 13:30:00	10.93	27.95	0.47	7.28	11.42	150.01	0.01
SQU-US	2026-06-13 13:45:00	11.02	27.89	0.46	7.29	11.40	141.02	0.01
SQU-US	2026-06-13 14:00:00	11.12	28.22	0.46	7.29	11.40	155.12	0.01
SQU-US	2026-06-13 14:15:00	11.21	28.24	0.46	7.30	11.38	162.28	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-13 14:30:00	11.31	28.29	0.46	7.29	11.37	144.05	0.01
SQU-US	2026-06-13 14:45:00	11.39	28.03	0.46	7.30	11.35	167.84	0.01
SQU-US	2026-06-13 15:00:00	11.47	27.95	0.46	7.33	11.34	191.22	0.01
SQU-US	2026-06-13 15:15:00	11.56	27.80	0.46	7.30	11.33	149.60	0.01
SQU-US	2026-06-13 15:30:00	11.63	27.79	0.46	7.29	11.32	141.17	0.01
SQU-US	2026-06-13 15:45:00	11.71	27.96	0.46	7.32	11.29	151.28	0.01
SQU-US	2026-06-13 16:00:00	11.78	27.75	0.46	7.30	11.27	171.32	0.01
SQU-US	2026-06-13 16:15:00	11.84	27.72	0.46	7.34	11.26	155.37	0.01
SQU-US	2026-06-13 16:30:00	11.89	27.61	0.46	7.34	11.26	156.20	0.01
SQU-US	2026-06-13 16:45:00	11.93	27.48	0.46	7.38	11.24	152.96	0.01
SQU-US	2026-06-13 17:00:00	11.97	27.49	0.46	7.37	11.23	138.65	0.01
SQU-US	2026-06-13 17:15:00	12.01	27.43	0.46	7.37	11.21	142.61	0.01
SQU-US	2026-06-13 17:30:00	12.05	27.64	0.46	7.37	11.19	108.29	0.01
SQU-US	2026-06-13 17:45:00	12.08	27.75	0.46	7.38	11.17	123.56	0.01
SQU-US	2026-06-13 18:00:00	12.10	27.76	0.46	7.38	11.14	123.44	0.01
SQU-US	2026-06-13 18:15:00	12.13	28.00	0.46	7.36	11.12	119.79	0.01
SQU-US	2026-06-13 18:30:00	12.15	28.48	0.46	7.38	11.10	119.43	0.01
SQU-US	2026-06-13 18:45:00	12.16	28.88	0.46	7.39	11.06	116.94	0.01
SQU-US	2026-06-13 19:00:00	12.17	29.01	0.46	7.39	11.03	122.05	0.01
SQU-US	2026-06-13 19:15:00	12.18	29.27	0.46	7.38	11.00	120.96	0.01
SQU-US	2026-06-13 19:30:00	12.18	29.15	0.46	7.38	10.97	104.20	0.01
SQU-US	2026-06-13 19:45:00	12.17	29.07	0.46	7.38	10.93	117.04	0.01
SQU-US	2026-06-13 20:00:00	12.16	29.33	0.47	7.33	10.90	129.72	0.01
SQU-US	2026-06-13 20:15:00	12.15	29.63	0.47	7.31	10.88	134.99	0.01
SQU-US	2026-06-13 20:30:00	12.13	29.93	0.47	7.32	10.85	118.30	0.01
SQU-US	2026-06-13 20:45:00	12.12	30.21	0.47	7.28	10.81	109.83	0.01
SQU-US	2026-06-13 21:00:00	12.10	30.29	0.47	7.26	10.78	129.37	0.01
SQU-US	2026-06-13 21:15:00	12.06	30.11	0.47	7.27	10.77	118.27	0.01
SQU-US	2026-06-13 21:30:00	12.03	29.79	0.47	7.28	10.76	122.66	0.01
SQU-US	2026-06-13 21:45:00	11.99	29.84	0.47	7.25	10.75	107.63	0.01
SQU-US	2026-06-13 22:00:00	11.95	29.59	0.47	7.27	10.75	110.79	0.01
SQU-US	2026-06-13 22:15:00	11.91	29.54	0.47	7.25	10.74	116.76	0.01
SQU-US	2026-06-13 22:30:00	11.86	29.24	0.47	7.27	10.76	131.94	0.01
SQU-US	2026-06-13 22:45:00	11.80	28.77	0.47	7.26	10.76	143.87	0.01
SQU-US	2026-06-13 23:00:00	11.74	28.74	0.47	7.26	10.78	99.80	0.01
SQU-US	2026-06-13 23:15:00	11.66	28.66	0.47	7.24	10.79	121.41	0.01
SQU-US	2026-06-13 23:30:00	11.59	28.41	0.47	7.25	10.80	143.19	0.01
SQU-US	2026-06-13 23:45:00	11.52	28.13	0.47	7.25	10.83	118.68	0.01
SQU-US	2026-06-14 00:00:00	11.44	27.97	0.47	7.27	10.84	130.34	0.01
SQU-US	2026-06-14 00:15:00	11.36	27.68	0.47	7.25	10.87	148.79	0.01
SQU-US	2026-06-14 00:30:00	11.28	27.35	0.47	7.26	10.89	120.52	0.01
SQU-US	2026-06-14 00:45:00	11.19	27.21	0.47	7.27	10.91	121.32	0.01
SQU-US	2026-06-14 01:00:00	11.11	27.09	0.47	7.25	10.92	137.41	0.01
SQU-US	2026-06-14 01:15:00	11.03	26.93	0.47	7.27	10.94	99.02	0.01
SQU-US	2026-06-14 01:30:00	10.96	26.59	0.47	7.27	10.95	110.59	0.01
SQU-US	2026-06-14 01:45:00	10.88	26.44	0.48	7.26	10.97	111.19	0.01
SQU-US	2026-06-14 02:00:00	10.80	26.29	0.48	7.26	10.98	100.30	0.01
SQU-US	2026-06-14 02:15:00	10.73	26.26	0.47	7.27	11.00	124.74	0.01
SQU-US	2026-06-14 02:30:00	10.66	26.03	0.48	7.28	11.02	116.60	0.01
SQU-US	2026-06-14 02:45:00	10.59	25.93	0.48	7.26	11.04	115.10	0.01
SQU-US	2026-06-14 03:00:00	10.51	25.88	0.48	7.26	11.06	133.97	0.01
SQU-US	2026-06-14 03:15:00	10.46	25.50	0.48	7.28	11.08	119.23	0.01
SQU-US	2026-06-14 03:30:00	10.37	25.62	0.48	7.25	11.09	118.38	0.01
SQU-US	2026-06-14 03:45:00	10.28	25.52	0.48	7.26	11.12	106.95	0.01
SQU-US	2026-06-14 04:00:00	10.22	25.42	0.48	7.27	11.12	110.44	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-14 04:15:00	10.13	25.40	0.48	7.27	11.15	113.11	0.01
SQU-US	2026-06-14 04:30:00	10.06	25.41	0.48	7.25	11.17	108.99	0.01
SQU-US	2026-06-14 04:45:00	10.01	25.51	0.48	7.27	11.19	95.07	0.01
SQU-US	2026-06-14 05:00:00	9.95	25.32	0.48	7.27	11.21	91.14	0.01
SQU-US	2026-06-14 05:15:00	9.88	25.24	0.48	7.25	11.23	94.41	0.01
SQU-US	2026-06-14 05:30:00	9.85	25.13	0.48	7.24	11.25	99.23	0.01
SQU-US	2026-06-14 05:45:00	9.82	24.91	0.48	7.22	11.26	96.60	0.01
SQU-US	2026-06-14 06:00:00	9.79	25.14	0.48	7.21	11.28	117.27	0.01
SQU-US	2026-06-14 06:15:00	9.74	25.10	0.48	7.21	11.27	102.78	0.01
SQU-US	2026-06-14 06:30:00	9.73	24.98	0.48	7.19	11.28	103.36	0.01
SQU-US	2026-06-14 06:45:00	9.69	25.12	0.48	7.18	11.27	93.58	0.01
SQU-US	2026-06-14 07:00:00	9.67	24.98	0.48	7.20	11.31	112.61	0.01
SQU-US	2026-06-14 07:15:00	9.65	25.10	0.48	7.19	11.32	95.23	0.01
SQU-US	2026-06-14 07:30:00	9.65	25.03	0.48	7.20	11.35	108.13	0.01
SQU-US	2026-06-14 07:45:00	9.63	25.09	0.48	7.17	11.35	85.12	0.01
SQU-US	2026-06-14 08:00:00	9.63	24.97	0.48	7.18	11.39	128.17	0.01
SQU-US	2026-06-14 08:15:00	9.68	24.71	0.48	7.21	11.39	85.01	0.01
SQU-US	2026-06-14 08:30:00	9.71	24.86	0.48	7.17	11.40	86.25	0.01
SQU-US	2026-06-14 08:45:00	9.77	24.78	0.48	7.22	11.41	112.88	0.01
SQU-US	2026-06-14 09:00:00	9.80	24.66	0.47	7.23	11.41	94.84	0.01
SQU-US	2026-06-14 09:15:00	9.86	24.53	0.47	7.25	11.43	75.29	0.01
SQU-US	2026-06-14 09:30:00	9.90	24.59	0.47	7.25	11.44	122.94	0.01
SQU-US	2026-06-14 09:45:00	9.95	24.91	0.47	7.19	11.45	106.74	0.01
SQU-US	2026-06-14 10:00:00	10.03	24.65	0.47	7.22	11.44	83.45	0.01
SQU-US	2026-06-14 10:15:00	10.10	24.73	0.47	7.22	11.43	101.03	0.01
SQU-US	2026-06-14 10:30:00	10.17	24.92	0.47	7.21	11.43	109.08	0.01
SQU-US	2026-06-14 10:45:00	10.23	25.00	0.47	7.18	11.42	104.54	0.01
SQU-US	2026-06-14 11:00:00	10.30	24.96	0.46	7.23	11.43	85.31	0.01
SQU-US	2026-06-14 11:15:00	10.38	24.85	0.46	7.20	11.43	122.54	0.01
SQU-US	2026-06-14 11:30:00	10.45	25.23	0.46	7.24	11.41	103.63	0.01
SQU-US	2026-06-14 11:45:00	10.53	24.97	0.46	7.21	11.41	103.93	0.01
SQU-US	2026-06-14 12:00:00	10.60	25.04	0.46	7.24	11.43	141.55	0.01
SQU-US	2026-06-14 12:15:00	10.68	25.11	0.46	7.25	11.43	116.24	0.01
SQU-US	2026-06-14 12:30:00	10.76	25.21	0.46	7.26	11.40	92.44	0.01
SQU-US	2026-06-14 12:45:00	10.85	25.27	0.46	7.26	11.40	103.22	0.01
SQU-US	2026-06-14 13:00:00	10.95	24.98	0.46	7.25	11.38	147.18	0.01
SQU-US	2026-06-14 13:15:00	11.04	25.22	0.46	7.25	11.37	105.57	0.01
SQU-US	2026-06-14 13:30:00	11.14	24.89	0.46	7.25	11.37	142.55	0.01
SQU-US	2026-06-14 13:45:00	11.23	25.10	0.46	7.26	11.35	128.37	0.01
SQU-US	2026-06-14 14:00:00	11.32	25.12	0.46	7.22	11.32	107.26	0.01
SQU-US	2026-06-14 14:15:00	11.40	25.13	0.46	7.24	11.31	118.30	0.01
SQU-US	2026-06-14 14:30:00	11.49	25.14	0.46	7.25	11.31	200.89	0.01
SQU-US	2026-06-14 14:45:00	11.56	25.18	0.46	7.25	11.30	187.14	0.01
SQU-US	2026-06-14 15:00:00	11.63	25.02	0.46	7.28	11.28	176.82	0.01
SQU-US	2026-06-14 15:15:00	11.71	24.90	0.46	7.27	11.27	182.29	0.01
SQU-US	2026-06-14 15:30:00	11.79	25.16	0.46	7.24	11.25	200.36	0.01
SQU-US	2026-06-14 15:45:00	11.82	25.22	0.46	7.27	11.23	126.43	0.01
SQU-US	2026-06-14 16:00:00	11.84	25.09	0.46	7.28	11.22	163.44	0.01
SQU-US	2026-06-14 16:15:00	11.88	25.03	0.46	7.28	11.20	183.58	0.01
SQU-US	2026-06-14 16:30:00	11.94	25.11	0.46	7.30	11.19	151.37	0.01
SQU-US	2026-06-14 16:45:00	12.01	24.83	0.46	7.32	11.18	189.06	0.01
SQU-US	2026-06-14 17:00:00	12.07	24.91	0.46	7.30	11.16	194.08	0.01
SQU-US	2026-06-14 17:15:00	12.13	25.10	0.46	7.29	11.14	165.66	0.01
SQU-US	2026-06-14 17:30:00	12.19	25.19	0.45	7.33	11.12	243.56	0.01
SQU-US	2026-06-14 17:45:00	12.24	24.97	0.45	7.33	11.10	279.80	0.01

Squamish River								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
SQU-US	2026-06-14 18:00:00	12.29	25.23	0.45	7.34	11.07	242.86	0.01
SQU-US	2026-06-14 18:15:00	12.34	25.39	0.45	7.36	11.05	167.73	0.01
SQU-US	2026-06-14 18:30:00	12.37	25.39	0.45	7.35	11.01	186.88	0.01
SQU-US	2026-06-14 18:45:00	12.40	25.66	0.46	7.36	10.97	299.76	0.01
SQU-US	2026-06-14 19:00:00	12.42	25.77	0.46	7.36	10.93	216.78	0.01
SQU-US	2026-06-14 19:15:00	12.44	26.01	0.46	7.34	10.90	329.60	0.01
SQU-US	2026-06-14 19:30:00	12.45	26.41	0.46	7.35	10.87	353.09	0.01
SQU-US	2026-06-14 19:45:00	12.44	26.26	0.46	7.36	10.85	369.90	0.01
SQU-US	2026-06-14 20:00:00	12.42	26.27	0.46	7.32	10.82	359.42	0.01
SQU-US	2026-06-14 20:15:00	12.41	26.43	0.46	7.36	10.79	328.22	0.01
SQU-US	2026-06-14 20:30:00	12.40	26.38	0.46	7.35	10.78	307.76	0.01
SQU-US	2026-06-14 20:45:00	12.38	26.05	0.46	7.32	10.77	273.75	0.01
SQU-US	2026-06-14 21:00:00	12.35	26.22	0.46	7.31	10.75	292.21	0.01
SQU-US	2026-06-14 21:15:00	12.31	25.94	0.46	7.31	10.74	287.03	0.01
SQU-US	2026-06-14 21:30:00	12.26	25.60	0.46	7.31	10.72	231.19	0.01
SQU-US	2026-06-14 21:45:00	12.22	25.63	0.47	7.28	10.73	240.55	0.01
SQU-US	2026-06-14 22:00:00	12.17	25.72	0.47	7.27	10.72	190.72	0.01
SQU-US	2026-06-14 22:15:00	12.11	25.35	0.47	7.29	10.72	176.00	0.01
SQU-US	2026-06-14 22:30:00	12.04	24.90	0.47	7.29	10.74	184.52	0.01
SQU-US	2026-06-14 22:45:00	11.98	24.62	0.47	7.24	10.74	222.39	0.01
SQU-US	2026-06-14 23:00:00	11.91	24.72	0.47	7.29	10.75	176.74	0.01
SQU-US	2026-06-14 23:15:00	11.83	24.66	0.47	7.25	10.75	168.47	0.01
SQU-US	2026-06-14 23:30:00	11.74	24.65	0.47	7.23	10.78	261.91	0.01
SQU-US	2026-06-14 23:45:00	11.67	24.35	0.47	7.26	10.79	295.97	0.01

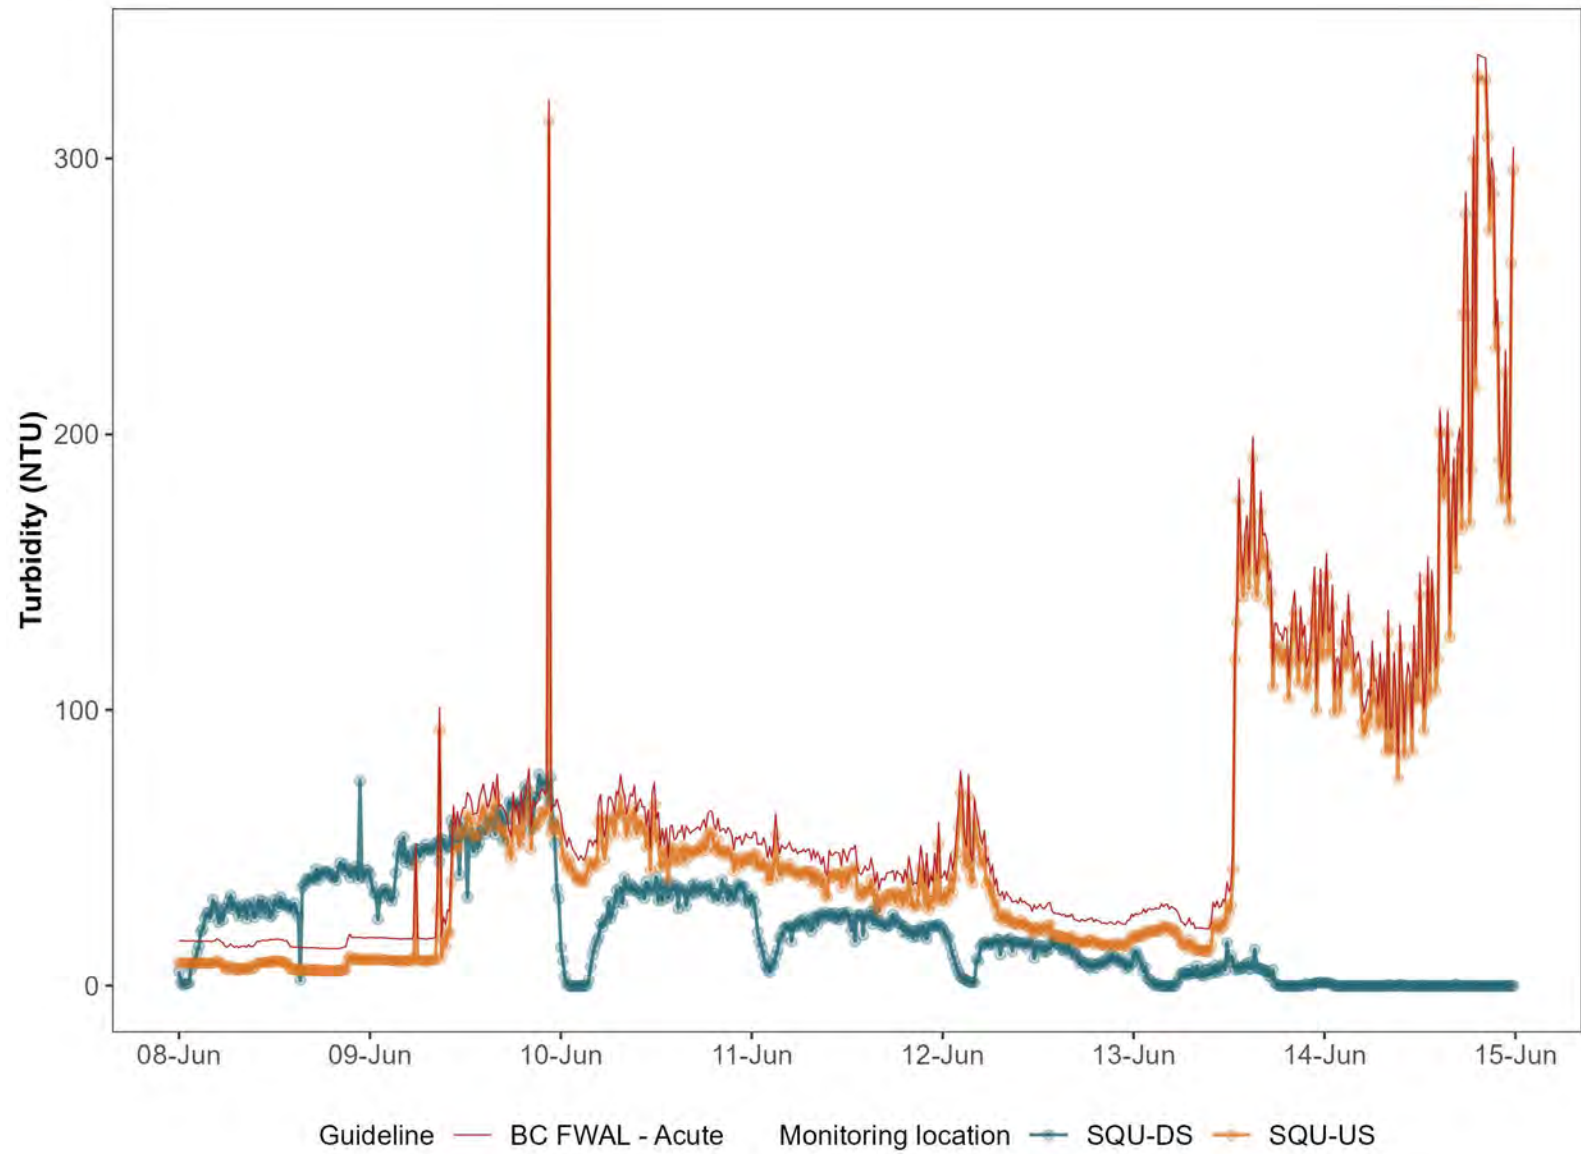

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix C	C-1

Appendix C: Woodfibre Site Point of Discharge from Water Treatment Plant Documentation

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix C	C-2

Woodfibre Site Sample Analysis

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life · Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life · Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-06-09 09:06:00
In situ Parameters								
Field pH	pH Units		6.5 - 9		7 - 8.7			7.2
Field Temperature	°C	18	19					12.3
General Parameters								
pH	pH Units							7.58
Alkalinity (Total as CaCO ₃)	mg/L							80
Alkalinity (PP as CaCO ₃)	mg/L							<1
Hardness (CaCO ₃)-Total	mg/L							130
Hardness (CaCO ₃)-Dissolved	mg/L							136
Sulphide-Total	mg/L							<0.0018
Sulphide (as H ₂ S)	mg/L			0.002				<0.002
Un-ionized Hydrogen Sulfide as H ₂ S-Total	mg/L							<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018
Anions and Nutrients								
Ammonia (N)-Total	mg/L	1.8	17.2		12	83		<0.015
Bicarbonate (HCO ₃)	mg/L							97
Carbonate (CO ₃)	mg/L							<1
Hydroxide (OH)	mg/L							<1
Nitrate (N)	mg/L	3	32.8		3.7			0.6
Nitrite (N)	mg/L	0.2	0.6					0.0107
Nitrate plus Nitrite (N)	mg/L							0.61
Nitrogen (N)-Total	mg/L							0.938
Phosphorus (P)-Total (4500-P)	mg/L							0.013
Bromide (Br)	mg/L							<0.01
Chloride (Cl)	mg/L	150	600					13
Fluoride (F)	mg/L		1.439577			1.5		0.39
Sulphate (SO4)-Dissolved	mg/L	309						24
Total Metals								
Aluminum (Al)-Total	mg/L	0.4071717						1.64
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000789
Arsenic (As)-Total	mg/L	0.005			0.0125			0.00219
Barium (Ba)-Total	mg/L			1				0.0136
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001
Bismuth (Bi)-Total	mg/L							<0.00001
Boron (B)-Total	mg/L	1.2			1.2			0.014
Cadmium (Cd)-Total	mg/L						0.00012	0.0000082
Calcium (Ca)-Total	mg/L							49.4
Cesium (Cs)-Total	mg/L							0.000061
Chromium (Cr)-Total	mg/L							0.00471
Chromium (Cr III)-Total	mg/L			0.0089			0.056	0.0047
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-06-09 09:06:00
Total Metals (Cont'd.)								
Cobalt (Co)-Total	mg/L							0.000134
Copper (Cu)-Total	mg/L				0.002	0.003		0.0011
Iron (Fe)-Total	mg/L		1					0.35
Lead (Pb)-Total	mg/L				0.002	0.14		0.000064
Lithium (Li)-Total	mg/L							0.00431
Magnesium (Mg)-Total	mg/L							1.59
Manganese (Mn)-Total	mg/L						0.1	0.0411
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.038
Nickel (Ni)-Total	mg/L						0.0083	0.00047
Phosphorus (P)-Total (ICPMS)	mg/L							0.0097
Potassium (K)-Total	mg/L							1.97
Rubidium (Rb)-Total	mg/L							0.00464
Selenium (Se)-Total	mg/L	0.002			0.002			0.000101
Silicon (Si)-Total	mg/L							11.2
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.00001
Sodium (Na)-Total	mg/L							6.4
Strontium (Sr)-Total	mg/L							0.0821
Sulphur (S)-Total	mg/L							6.9
Tellurium (Te)-Total	mg/L							<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000109
Thorium (Th)-Total	mg/L							<0.00005
Tin (Sn)-Total	mg/L							<0.0002
Titanium (Ti)-Total	mg/L							0.004
Uranium (U)-Total	mg/L		0.0165	0.0075				0.0042
Vanadium (V)-Total	mg/L			0.06			0.005	0.00241
Zinc (Zn)-Total	mg/L				0.01	0.055		0.0034
Zirconium (Zr)-Total	mg/L							0.00014
Dissolved Metals								
Aluminum (Al)-Dissolved	mg/L							1.59
Antimony (Sb)-Dissolved	mg/L							0.000797
Arsenic (As)-Dissolved	mg/L							0.00213
Barium (Ba)-Dissolved	mg/L							0.0136
Beryllium (Be)-Dissolved	mg/L							<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005
Boron (B)-Dissolved	mg/L							0.012
Cadmium (Cd)-Dissolved	mg/L	0.0002565	0.0007707					0.0000092
Calcium (Ca)-Dissolved	mg/L							51.7
Cesium (Cs)-Dissolved	mg/L							0.000056
Chromium (Cr)-Dissolved	mg/L							0.00491

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life · Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life · Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-06-09 09:06:00
Dissolved Metals (Cont'd.)								
Cobalt (Co)-Dissolved	mg/L	0.0005684						0.000103
Copper (Cu)-Dissolved	mg/L	0.00523	0.03146					0.000888
Iron (Fe)-Dissolved	mg/L							0.222
Lead (Pb)-Dissolved	mg/L	0.0120299						0.0000074
Lithium (Li)-Dissolved	mg/L							0.00485
Manganese (Mn)-Dissolved	mg/L	0.33	4.190386					0.0386
Magnesium (Mg)-Dissolved	mg/L							1.72
Mercury (Hg)-Dissolved	mg/L							<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.0381
Nickel (Ni)-Dissolved	mg/L	0.0052	0.0851					0.000513
Phosphorus (P)-Dissolved	mg/L							0.0042
Potassium (K)-Dissolved	mg/L							2.05
Rubidium (Rb)-Dissolved	mg/L							0.00489
Selenium (Se)-Dissolved	mg/L							0.000083
Silicon (Si)-Dissolved	mg/L							11.7
Silver (Ag)-Dissolved	mg/L							<0.000005
Sodium (Na)-Dissolved	mg/L							6.88
Strontium (Sr)-Dissolved	mg/L			1.25				0.0833
Sulphur (S)-Dissolved	mg/L							7.8
Tellurium (Te)-Dissolved	mg/L							<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000105
Thorium (Th)-Dissolved	mg/L							0.0000086
Tin (Sn)-Dissolved	mg/L							<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005
Uranium (U)-Dissolved	mg/L							0.0042
Vanadium (V)-Dissolved	mg/L							0.00257
Zinc (Zn)-Dissolved	mg/L	0.0503803	0.0967063					0.00193
Zirconium (Zr)-Dissolved	mg/L							0.00016
Inorganics								
Organic Carbon (C)-Total	mg/L							31
Organic Carbon (C)-Dissolved	mg/L							26
Solids-Total Dissolved	mg/L							220
Solids-Total Suspended	mg/L	6	26					8
Organics								
HEPH (C19-C32 less PAH)	mg/L							<0.2
LEPH (C10-C19 less PAH)								0.27
EPH (C10-C19)	mg/L							0.27
EPH (C19-C32)	mg/L							<0.2
Ethylene Glycol	mg/L							<3
Diethylene Glycol	mg/L							<5

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life · Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life · Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-06-09 09:06:00
Organics (Cont'd.)								
Triethylene Glycol	mg/L							<5
Propylene Glycol	mg/L							<5
Acenaphthene	mg/L	0.006			0.006			<0.00005
Acenaphthylene	mg/L							<0.00005
Acridine	mg/L	0.003						<0.00005
Anthracene	mg/L	0.004						<0.00001
Benzo(a)anthracene	mg/L	0.0001						<0.00001
Benzo(a)pyrene	mg/L	0.00001			0.00001			<0.000005
Benzo(b&j)fluoranthene	mg/L							<0.00003
Benzo(g,h,i)perylene	mg/L							<0.00005
Benzo(k)fluoranthene	mg/L							<0.00005
Chrysene	mg/L				0.0001			<0.00002
Dibenz(a,h)anthracene	mg/L							<0.000003
Fluoranthene	mg/L	0.004						<0.00002
Fluorene	mg/L	0.012			0.012			<0.00005
Indeno(1,2,3-cd)pyrene	mg/L							<0.00005
1-Methylnaphthalene	mg/L				0.001			<0.00005
2-Methylnaphthalene	mg/L				0.001			<0.0001
Naphthalene	mg/L	0.001	0.001		0.001			<0.0001
Phenanthrene	mg/L	0.0003						<0.00005
Pyrene	mg/L							<0.00002
Quinoline	mg/L							<0.00002
Low Molecular Weight PAH`s	mg/L							<0.0001
High Molecular Weight PAH`s	mg/L							<0.00005
Total PAH	mg/L							<0.0001
VH C6-C10	mg/L							<0.3
1,1,1,2-Tetrachloroethane	mg/L							<0.0005
1,1,1-Trichloroethane	mg/L							<0.0005
1,1,2,2-Tetrachloroethane	mg/L							<0.0005
1,1,2Trichloro-1,2,2Trifluoroethane	mg/L							<0.002
1,1,2-Trichloroethane	mg/L							<0.0005
1,1-Dichloroethane	mg/L							<0.0005
1,1-Dichloroethene	mg/L							<0.0005
1,2,3-trichlorobenzene	mg/L			0.008				<0.002
1,2,4-trichlorobenzene	mg/L			0.024			0.0054	<0.002
1,2-dibromoethane	mg/L							<0.0002
1,2-Dichlorobenzene	mg/L			0.0007			0.042	<0.0005
1,2-Dichloroethane	mg/L			0.1				<0.0005
1,2-Dichloropropane	mg/L							<0.0005
1,3,5-trimethylbenzene	mg/L							<0.002

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life · Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life · Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG EOP 2026-06-09 09:06:00
1,3-Butadiene	mg/L							<0.0005
1,3-Dichlorobenzene	mg/L			0.15				<0.0005
1,3-dichloropropane	mg/L							<0.001
1,4-Dichlorobenzene	mg/L			0.026				<0.0005
Benzene	mg/L	0.04			0.11			<0.0004
Bromobenzene	mg/L							<0.002
Bromodichloromethane	mg/L							<0.001
Bromoform	mg/L							<0.001
Bromomethane	mg/L							<0.001
Carbon tetrachloride	mg/L							<0.0005
Chlorobenzene	mg/L			0.0013			0.025	<0.0005
Chloroethane	mg/L							<0.001
Chloroform	mg/L							<0.001
Chloromethane	mg/L							<0.001
cis-1,2-Dichloroethene	mg/L							<0.001
cis-1,3-Dichloropropene	mg/L							<0.001
Dibromochloromethane	mg/L							<0.001
Dichlorodifluoromethane	mg/L							<0.002
Dichloromethane	mg/L			0.0981				<0.002
Ethylbenzene	mg/L	0.2			0.25			<0.0004
Hexachlorobutadiene	mg/L							<0.0005
Isopropylbenzene	mg/L							<0.002
Methyl-tert-butylether (MTBE)	mg/L		3.4			0.44		<0.004
Styrene	mg/L			0.072				<0.0005
Tetrachloroethene	mg/L							<0.0005
Toluene	mg/L	0.0005						<0.0004
trans-1,2-dichloroethene	mg/L							<0.001
trans-1,3-dichloropropene	mg/L							<0.001
Trichloroethene	mg/L							<0.0005
Trichlorofluoromethane	mg/L							<0.004
Vinyl chloride	mg/L							<0.0005
VPH (VH6 to 10 - BTEX)	mg/L							<0.3
Xylenes (Total)	mg/L	0.03						<0.0004
m & p-Xylene	mg/L							<0.0004
o-Xylene	mg/L							<0.0004
Phenols	mg/L		0.05					<0.0015

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix C	C-3

Woodfibre Site WTP Discharge
Field Notes and Logs

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Table of Contents:

1. Executive Summary and Field Notes
2. Daily Volume Summary
3. Portal Discharge Parameter Summary
4. CP2 Discharge Parameter Summary
5. In-situ Readings
6. WTP Calibration Log

Appendices:

- Appendix A- Portal WTP Data Log
- Appendix B- CP2 WTP Data Log
- Appendix C- Photos

1. Executive Summary and Field Notes:

Parameters, including temperature, NTU, pH, DO, salinity, conductivity, and oxidation-reduction potential (ORP), were monitored throughout the discharge process.

A reading of 69.7 NTU was recorded on the portal water treatment plant (PWTP) data log on June 9th at 19:15 while the probe and slip stream were being cleaned. The discharge water at the time was ~13 NTU. On June 9th at 22:15 a reading of -0.4 pH was recorded on the PWTP data log while the pH probe was being replaced and calibrated. The discharge water at the time of this reading was ~6.8 pH.

A reading of 729 NTU and 0 uS/cm conductivity was recorded on the data log on June 13th at 19:00 at the CP2 water treatment plant (CP2 WTP) while the NTU and conductivity probes were being calibrated. The discharge water was ~0 NTU at the time of the calibration.

On June 10th between 00:45 and 01:45 there were temperature values of 106.3°C recorded on the PWTP data logs. The readings are considered misreadings as the water was actually ~14°C. A reading of 19.1°C on June 10th at 18:30 was recorded. This reading was recorded after the plant being idle and the stagnant water warmed up in the probe slip stream. Once discharge water flowed through the slip stream and past the probe the temperatures returned to ~14°C. Temperature readings >19°C were recorded on the CP2 WTP data logs on June 8th between 04:00 and 05:30 due to stagnant water in the temperature probe slip stream being heated up by the conductivity/ temperature probe during low discharge flows. A reading of 20.1°C was recorded on June 13th at 17:00 from the water being heated within the slip stream. On June 14th there were 2 readings >19°C recorded, one at 13:00 (20.4°C) and at 21:30

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

(19.4°C). The actual temperature of the water being discharged was ~15°C. Refer to FKM 2026-05-31 Weekly Report WF for details regarding findings and modifications to rectify the issue. YSI readings were taken of the discharge water at CP2 WTP during routine inspections:

- June 7/ 2026 @ 19:24: 12.6°C
- June 8/ 2026 @ 18:07: 14.7°C
- June 8/ 2026 @ 19:56: 12.5°C
- June 13/ 2026 @ 08:54: 13.8°C
- June 13/ 2026 @ 21:44: 14.2°C
- June 14/ 2026 @ 15:58: 17.3°C
- June 14/ 2026 @ 23:17: 12.8°C

No visible sheen was observed on the surface of the WTP tanks or in the discharged water. All relevant parameters were measured using YSI instruments, Hanna NTU meter and WTP's NTU, pH, conductivity and temperature probes.

CP2 WTP received ~343 GPM (1.3 m3/min) and the PWTP received ~232 GPM (0.88 m3/min) from the tunnel.

The total discharge volume up to June 14th was 1,519,511 m3.

2. Daily Volume Summary:

Table 1: Discharge Volumes Daily Summary

Date	Location	Volume (m3)	Comments
June 8	Woodfibre (WF)	3,242	Exceeded discharge volume limit
June 9	WF	3,183	Exceeded discharge volume limit
June 10	WF	3,230	Exceeded discharge volume limit
June 11	WF	3,138	Exceeded discharge volume limit
June 12	WF	3,040	Exceeded discharge volume limit
June 13	WF	3,077	Exceeded discharge volume limit
June 14	WF	3,018	Exceeded discharge volume limit
Total		21,928	None

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

3. Discharge Parameter Summary:

Table 2: Portal Discharge Parameter Summary

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/8/2026	0:00:00	7	0.9993	1.3	1,364,579	14.7	246
6/8/2026	0:15:00	7	0.2498	0	1,364,591	15.2	243
6/8/2026	0:30:00	6.9	1.0145	0.2	1,364,611	15	243
6/8/2026	0:45:00	6.9	1.6277	0.7	1,364,634	14.8	244
6/8/2026	1:00:00	7	0.2196	1.8	1,364,655	15	242
6/8/2026	1:15:00	6.9	1.5937	1.6	1,364,670	14.8	245
6/8/2026	1:30:00	6.9	1.0296	2.2	1,364,692	15	244
6/8/2026	1:45:00	6.9	1.6088	1.9	1,364,714	14.7	245
6/8/2026	2:00:00	6.9	1.0486	4	1,364,725	15.3	245
6/8/2026	2:15:00	6.9	1.6202	2.7	1,364,748	14.5	246
6/8/2026	2:30:00	7	0.1893	6.3	1,364,769	14.6	242
6/8/2026	2:45:00	7	1.5937	2.7	1,364,776	14.6	244
6/8/2026	3:00:00	7	0.2688	3.6	1,364,797	14.5	242
6/8/2026	3:15:00	7	1.5861	4.2	1,364,812	14.4	246
6/8/2026	3:30:00	7	0.5565	7.1	1,364,833	14.3	245
6/8/2026	3:45:00	7	0.2385	0.3	1,364,843	14.8	243
6/8/2026	4:00:00	7	1.1053	0.7	1,364,866	14.4	242
6/8/2026	4:15:00	7	0.2006	1	1,364,882	14.1	244
6/8/2026	4:30:00	7	1.0637	0.1	1,364,901	14.2	244
6/8/2026	4:45:00	7	0.2309	0	1,364,919	14.1	245
6/8/2026	5:00:00	7	1.0637	1.5	1,364,934	14.1	245
6/8/2026	5:15:00	7	1.6845	0.5	1,364,957	13.9	245
6/8/2026	5:30:00	7.1	0.1590	0.5	1,364,976	14.1	245
6/8/2026	5:45:00	7	1.6694	0.1	1,364,996	14.1	243
6/8/2026	6:00:00	7	0.7192	1.8	1,365,018	14.4	245
6/8/2026	6:15:00	7	1.6353	0.2	1,365,032	14.3	244
6/8/2026	6:30:00	7.1	1.0637	1.3	1,365,054	14.8	243
6/8/2026	6:45:00	7	0.2233	0.1	1,365,076	14.4	242
6/8/2026	7:00:00	7	1.0864	3.1	1,365,086	14.9	243



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/8/2026	7:15:00	7	1.6769	0.4	1,365,109	14.5	243
6/8/2026	7:30:00	7	0.2006	2	1,365,120	15.2	243
6/8/2026	7:45:00	7	1.6656	0.4	1,365,143	14.2	242
6/8/2026	8:00:00	7	0.2271	1.3	1,365,157	14.3	245
6/8/2026	8:15:00	7	1.6277	1.7	1,365,176	13.7	242
6/8/2026	8:30:00	7	0.2461	1	1,365,193	13.7	113
6/8/2026	8:45:00	7	1.6164	1.4	1,365,212	13.3	111
6/8/2026	9:00:00	7	0.1098	1.7	1,365,222	13.6	110
6/8/2026	9:15:00	7	1.5596	1.7	1,365,238	13.2	110
6/8/2026	9:45:00	7	1.5634	2.6	1,365,270	13.2	112
6/8/2026	10:00:00	7	0.0568	1.6	1,365,280	13.6	112
6/8/2026	10:15:00	7	1.5142	1.8	1,365,297	13.5	112
6/8/2026	10:30:00	7.1	0.0416	1.3	1,365,306	14.1	112
6/8/2026	10:45:00	7	1.5444	2	1,365,324	13.8	112
6/8/2026	11:15:00	7	1.4839	1.6	1,365,354	13.9	112
6/8/2026	11:45:00	7	1.4952	1.5	1,365,376	14.5	114
6/8/2026	12:15:00	7	1.4801	2.1	1,365,397	14.9	114
6/8/2026	12:45:00	7	1.4574	2.3	1,365,417	14.6	112
6/8/2026	13:15:00	7	0.1590	3.4	1,365,435	14.5	114
6/8/2026	13:45:00	7.1	0.2498	2.1	1,365,442	14.3	112
6/8/2026	14:00:00	7	1.0675	1.8	1,365,449	16	112
6/8/2026	14:15:00	7	0.2347	2	1,365,459	14.9	112
6/8/2026	14:30:00	7	1.0410	2.1	1,365,474	14.6	112
6/8/2026	14:45:00	7	0.2498	1.9	1,365,484	15	113
6/8/2026	15:00:00	7	1.0486	2	1,365,503	14.9	113
6/8/2026	15:15:00	6.9	1.6353	2.1	1,365,510	16.2	242
6/8/2026	15:30:00	7	0.1060	1.8	1,365,528	15.1	114
6/8/2026	15:45:00	6.9	1.6126	2.3	1,365,531	16.4	241
6/8/2026	16:00:00	7	0.1552	2.1	1,365,547	15.1	113
6/8/2026	16:15:00	7	1.5974	2.7	1,365,558	15.2	242
6/8/2026	16:45:00	7	1.6126	2.6	1,365,582	14.8	241
6/8/2026	17:15:00	6.9	1.5899	2.2	1,365,605	14.9	114



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/8/2026	17:45:00	6.9	1.5444	1.2	1,365,626	15.2	241
6/8/2026	18:15:00	6.9	1.5369	1.6	1,365,642	15.3	243
6/8/2026	18:30:00	7	0.0984	0.8	1,365,651	15.6	243
6/8/2026	18:45:00	6.9	1.5217	1	1,365,664	15	241
6/8/2026	19:00:00	7	0.0795	0.6	1,365,669	15.4	243
6/8/2026	19:15:00	6.9	1.4990	0.8	1,365,685	14.8	243
6/8/2026	20:00:00	6.9	0.9615	0.8	1,365,708	16.6	242
6/8/2026	20:15:00	6.9	0.2309	1.3	1,365,728	14.4	241
6/8/2026	20:30:00	7	0.8971	1.2	1,365,731	14.8	241
6/8/2026	21:00:00	7	0.1325	1.5	1,365,753	14.6	243
6/8/2026	21:15:00	6.9	1.4687	1.8	1,365,760	13.7	245
6/8/2026	22:30:00	7	1.5217	2.8	1,365,795	12.8	109
6/8/2026	22:45:00	7	1.4120	5.9	1,365,808	13.2	110
6/8/2026	23:00:00	7	1.5444	2.4	1,365,831	12.9	110
6/8/2026	23:15:00	7	1.5634	2.4	1,365,840	13.6	112
6/8/2026	23:30:00	7	1.5407	1.8	1,365,863	13.4	112
6/8/2026	23:45:00	6.9	0.7647	3.3	1,365,872	13.9	245
6/9/2026	0:00:00	7	1.5937	2.5	1,365,896	13.8	112
6/9/2026	0:15:00	6.9	1.5937	3.8	1,365,903	13.9	245
6/9/2026	0:45:00	6.9	1.5672	0.9	1,365,930	14.1	245
6/9/2026	1:00:00	6.9	0.1098	3.3	1,365,942	14.6	245
6/9/2026	1:30:00	6.9	1.5444	1.2	1,365,954	14.2	245
6/9/2026	2:00:00	6.8	1.4536	0.8	1,365,965	14.2	246
6/9/2026	3:00:00	6.8	1.5747	0.7	1,365,989	14.8	243
6/9/2026	4:00:00	6.8	1.5899	1.7	1,366,016	14.4	241
6/9/2026	4:30:00	6.8	1.6050	5	1,366,047	14.3	114
6/9/2026	5:00:00	6.9	1.5747	0.3	1,366,066	14.2	243
6/9/2026	5:30:00	7.8	1.5937	2.8	1,366,073	14.1	245
6/9/2026	5:45:00	8.3	1.5672	10.6	1,366,097	14.5	246
6/9/2026	6:15:00	8.5	1.5785	1.7	1,366,103	14.2	258
6/9/2026	6:30:00	8	1.5785	8.8	1,366,127	13.9	266
6/9/2026	7:00:00	7.7	1.5672	6.8	1,366,135	13.9	278



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/9/2026	8:15:00	7.1	1.6239	4.3	1,366,154	14	294
6/9/2026	8:45:00	7.2	0.2574	2.4	1,366,167	14.2	302
6/9/2026	9:00:00	7.2	1.6126	5.3	1,366,180	14.9	302
6/9/2026	9:30:00	7.4	1.6088	2.4	1,366,200	14.4	300
6/9/2026	9:45:00	7.3	1.8056	3.9	1,366,210	14.5	299
6/9/2026	10:15:00	7.2	1.7337	2.8	1,366,240	14.8	299
6/9/2026	10:30:00	7.3	1.7072	5.7	1,366,261	14.7	293
6/9/2026	11:00:00	7.2	1.7034	1.9	1,366,293	15.2	293
6/9/2026	12:15:00	7.3	1.6504	7.6	1,366,348	14.9	292
6/9/2026	12:45:00	7.1	1.6504	10	1,366,378	15	295
6/9/2026	13:00:00	7.1	1.6694	9.9	1,366,387	14.6	297
6/9/2026	13:15:00	7	1.6202	9	1,366,407	14.5	297
6/9/2026	13:30:00	6.9	1.9041	8.4	1,366,436	14.6	296
6/9/2026	13:45:00	6.9	2.0782	9.2	1,366,462	14.6	297
6/9/2026	14:00:00	7	0.2044	14.5	1,366,487	14.6	297
6/9/2026	14:15:00	7	2.0441	12	1,366,507	14.7	297
6/9/2026	14:30:00	7	1.9798	12.7	1,366,537	14.8	297
6/9/2026	14:45:00	7.1	2.0366	12	1,366,563	14.9	301
6/9/2026	15:00:00	7.1	0.2498	18.2	1,366,581	14.9	300
6/9/2026	15:15:00	7.1	1.9987	7	1,366,603	14.9	300
6/9/2026	15:30:00	7	2.0138	6.4	1,366,633	16.1	303
6/9/2026	15:45:00	7.1	2.0403	6.6	1,366,660	14.9	304
6/9/2026	16:00:00	7.1	2.0555	7.6	1,366,690	14.8	304
6/9/2026	16:15:00	7.1	1.4877	6.4	1,366,700	14.9	305
6/9/2026	16:30:00	7.1	1.4006	6.9	1,366,722	14.9	305
6/9/2026	16:45:00	7.2	1.2946	7	1,366,738	14.9	303
6/9/2026	17:00:00	7.1	1.7829	7.7	1,366,759	14.9	303
6/9/2026	17:15:00	6.8	1.8435	11.3	1,366,783	15	302
6/9/2026	17:30:00	6.5	1.8359	16.5	1,366,811	14.9	288
6/9/2026	17:45:00	6.8	2.1577	13.1	1,366,838	14.8	294
6/9/2026	18:00:00	7.4	2.1312	11.6	1,366,871	14.7	294
6/9/2026	18:15:00	7.1	1.8019	19.8	1,366,894	14.7	294



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/9/2026	18:30:00	7	1.7905	20.4	1,366,921	15.8	285
6/9/2026	18:45:00	6.9	1.8019	13.3	1,366,945	14.4	285
6/9/2026	19:00:00	7.2	1.7905	18.1	1,366,971	14.5	288
6/9/2026	19:15:00	7.3	0.2347	69.7	1,366,979	15.4	288
6/9/2026	19:30:00	7.1	0.1741	13.4	1,366,982	14.5	285
6/9/2026	19:45:00	7.1	1.8549	13.3	1,367,000	14.5	287
6/9/2026	20:00:00	7.1	1.8397	13.3	1,367,027	14.4	287
6/9/2026	20:15:00	7	1.8511	1.1	1,367,051	14.5	287
6/9/2026	20:30:00	7.1	1.8284	1.4	1,367,079	14.1	289
6/9/2026	20:45:00	7	1.7943	1.1	1,367,102	14.3	289
6/9/2026	21:15:00	7.1	1.7829	0.8	1,367,129	14.2	291
6/9/2026	21:30:00	7.1	1.8208	0.8	1,367,152	14.3	291
6/9/2026	21:45:00	7	2.1123	2.5	1,367,180	14.3	291
6/9/2026	22:00:00	6.8	2.0782	2.6	1,367,208	14.3	291
6/9/2026	22:15:00	-0.4	2.1804	4.9	1,367,239	15.1	291
6/9/2026	22:30:00	6.8	2.4529	2	1,367,271	14.4	289
6/9/2026	22:45:00	6.9	2.5135	2.4	1,367,290	14.1	289
6/9/2026	23:00:00	7.2	0.3785	2.3	1,367,322	14	291
6/9/2026	23:30:00	6.7	2.4984	17.5	1,367,346	16.8	258
6/10/2026	0:15:00	7.2	1.0940	2	1,367,364	13.4	276
6/10/2026	0:45:00	7.3	1.7261	2.2	1,367,382	106.3	279
6/10/2026	1:00:00	7.3	1.7716	2.4	1,367,404	106.3	287
6/10/2026	1:15:00	7.2	1.7867	2.2	1,367,431	106.3	287
6/10/2026	1:45:00	7.1	1.7564	1.8	1,367,453	106.3	287
6/10/2026	2:15:00	7	1.7640	1.8	1,367,480	14	287
6/10/2026	2:30:00	7	1.7829	1.7	1,367,502	13.9	289
6/10/2026	3:00:00	7.1	1.7754	1.8	1,367,540	13.8	291
6/10/2026	3:15:00	7	1.7791	2.6	1,367,566	13.9	291
6/10/2026	3:30:00	7.1	1.7564	2.5	1,367,589	13.6	281
6/10/2026	3:45:00	7.1	1.7678	2.7	1,367,616	13.6	281
6/10/2026	4:00:00	7.2	1.7754	2.7	1,367,637	13.5	282
6/10/2026	4:15:00	7.2	1.7375	2.7	1,367,664	13.5	279



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/10/2026	4:30:00	7.2	1.7602	2.3	1,367,669	13.6	279
6/10/2026	5:00:00	7.2	1.7375	3.3	1,367,678	13.5	277
6/10/2026	5:30:00	7.3	1.7489	2.9	1,367,708	13.3	282
6/10/2026	5:45:00	7.2	1.4195	2.6	1,367,710	13.5	281
6/10/2026	6:15:00	7.1	1.6732	2.2	1,367,729	14	292
6/10/2026	7:30:00	6.7	1.6694	1.7	1,367,762	14.4	287
6/10/2026	7:45:00	6.8	1.6618	2.5	1,367,787	16.9	268
6/10/2026	8:00:00	6.7	1.6656	6.8	1,367,796	14.7	266
6/10/2026	8:30:00	7	1.6845	5.5	1,367,818	15.3	261
6/10/2026	9:00:00	6.9	1.7072	1.3	1,367,851	16.4	261
6/10/2026	9:15:00	6.9	1.6467	1.7	1,367,876	14.3	266
6/10/2026	9:30:00	7.5	1.6732	14.3	1,367,888	18	258
6/10/2026	9:45:00	6.9	1.6429	1.7	1,367,913	14.7	259
6/10/2026	10:00:00	7	1.6996	1.5	1,367,922	16	253
6/10/2026	10:15:00	7.2	1.6694	7.4	1,367,948	14	263
6/10/2026	10:30:00	7.2	1.7299	6.7	1,367,955	14.2	251
6/10/2026	10:45:00	7	1.7451	6.7	1,367,981	15.6	244
6/10/2026	11:00:00	7.2	1.7413	2	1,368,004	13.7	257
6/10/2026	11:15:00	7.1	1.7602	2.2	1,368,017	13.9	254
6/10/2026	11:45:00	7.2	1.7375	2.2	1,368,046	13.6	256
6/10/2026	12:00:00	7.2	1.7640	1.9	1,368,055	13.6	109
6/10/2026	12:15:00	7.2	1.7451	2.7	1,368,082	13.9	264
6/10/2026	12:30:00	7.1	1.7261	2.5	1,368,092	14.4	248
6/10/2026	12:45:00	7.1	1.7224	1.7	1,368,117	14.3	264
6/10/2026	13:00:00	7.1	1.7640	1.5	1,368,127	14.4	248
6/10/2026	13:30:00	7.1	1.7110	2.1	1,368,157	14.3	263
6/10/2026	14:15:00	7.1	1.7602	2.5	1,368,191	14.4	250
6/10/2026	14:30:00	7	1.6277	3.1	1,368,199	14.8	253
6/10/2026	14:45:00	7	0.2044	4	1,368,220	15.6	245
6/10/2026	15:00:00	6.9	1.7110	2.1	1,368,227	14.9	261
6/10/2026	15:15:00	6.9	0.2725	2	1,368,245	17	243
6/10/2026	15:30:00	6.8	1.7375	2.5	1,368,256	15	259



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/10/2026	15:45:00	6.7	0.1703	3.2	1,368,267	17.3	259
6/10/2026	16:00:00	6.7	1.6845	4.1	1,368,281	15.9	243
6/10/2026	16:15:00	6.7	0.2233	3	1,368,285	15.1	258
6/10/2026	16:30:00	6.8	1.7224	3.4	1,368,297	16.2	243
6/10/2026	16:45:00	6.7	0.1590	3.1	1,368,310	15.2	258
6/10/2026	17:00:00	6.8	0.6435	3.5	1,368,321	17.6	242
6/10/2026	17:15:00	6.8	1.2227	2.4	1,368,329	15.5	243
6/10/2026	17:30:00	6.8	0.4088	2.8	1,368,338	15.4	256
6/10/2026	17:45:00	6.8	1.1621	2.5	1,368,364	15.6	243
6/10/2026	18:00:00	6.8	1.7716	3.9	1,368,373	19	243
6/10/2026	18:15:00	6.8	0.2650	2.3	1,368,394	16.9	242
6/10/2026	18:30:00	6.8	1.7034	3.1	1,368,409	19.1	259
6/10/2026	18:45:00	6.8	0.2385	3.6	1,368,432	15.4	240
6/10/2026	19:00:00	6.7	1.7224	3.3	1,368,444	15.7	256
6/10/2026	19:15:00	6.8	0.1211	3.8	1,368,464	16.7	242
6/10/2026	19:30:00	6.7	1.6504	3.4	1,368,479	15	257
6/10/2026	20:00:00	6.7	0.2006	3.6	1,368,502	15.6	245
6/10/2026	21:30:00	6.6	1.6467	1	1,368,514	14.7	258
6/10/2026	21:45:00	7	0.2006	1.1	1,368,537	14.9	253
6/10/2026	22:00:00	7.3	0.0871	1	1,368,539	14.4	255
6/10/2026	22:15:00	7.4	1.6353	1	1,368,555	14.4	256
6/10/2026	22:45:00	7.6	0.1666	1.8	1,368,578	14.4	253
6/10/2026	23:15:00	7.7	1.6694	3.1	1,368,585	14.1	248
6/10/2026	23:30:00	7.7	0.1779	3.2	1,368,600	14.9	257
6/11/2026	0:00:00	7.7	1.6883	3.6	1,368,615	14.3	257
6/11/2026	1:00:00	7.7	0.1817	3.8	1,368,622	15.3	256
6/11/2026	1:30:00	7.7	1.6694	4.1	1,368,644	14.4	258
6/11/2026	1:45:00	7.7	1.1016	4.5	1,368,651	15.7	258
6/11/2026	2:15:00	7.8	0.1893	4.2	1,368,668	14.3	255
6/11/2026	2:30:00	7.8	1.7110	4.2	1,368,685	15.3	256
6/11/2026	3:00:00	7.8	0.1476	4.4	1,368,698	14.4	255
6/11/2026	3:15:00	7.7	1.7299	4.6	1,368,716	15	257



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/11/2026	3:45:00	7.7	0.2006	6.3	1,368,723	14.9	253
6/11/2026	4:00:00	7.7	0.2082	6	1,368,736	15.9	256
6/11/2026	4:30:00	7.7	1.7413	5.4	1,368,746	15.3	258
6/11/2026	5:00:00	7.7	0.1628	0.9	1,368,762	14.5	255
6/11/2026	5:30:00	7.6	1.6883	1.2	1,368,765	15.6	257
6/11/2026	6:00:00	7.6	0.1968	2.9	1,368,786	14.1	256
6/11/2026	6:45:00	7.6	1.6732	3	1,368,790	13.9	246
6/11/2026	7:30:00	7.6	0.1779	2.6	1,368,809	14.7	253
6/11/2026	8:00:00	7.6	1.6959	2.4	1,368,816	14.1	259
6/11/2026	8:45:00	7.7	0.1703	2.3	1,368,824	14.2	263
6/11/2026	9:00:00	7.7	0.1817	1.5	1,368,842	14.6	263
6/11/2026	9:15:00	7.8	0.0000	2.1	1,368,843	14.3	263
6/11/2026	9:30:00	7.8	1.6807	1.1	1,368,850	15.7	247
6/11/2026	10:30:00	7.7	3.8687	1.1	1,368,901	16.7	243
6/11/2026	10:45:00	7.6	1.4422	2	1,368,903	14.8	260
6/11/2026	11:00:00	7.6	1.6807	1.7	1,368,915	16.6	245
6/11/2026	11:15:00	7.6	1.1016	5	1,368,939	15.1	259
6/11/2026	11:30:00	7.6	1.5823	5.1	1,368,962	14.7	251
6/11/2026	11:45:00	7.6	1.6504	4.3	1,368,972	14.6	110
6/11/2026	12:15:00	7.6	1.8321	6.1	1,368,992	14.5	255
6/11/2026	12:45:00	7.6	1.7867	19.4	1,369,028	15.4	263
6/11/2026	13:00:00	7.6	1.8170	3.4	1,369,038	14.8	248
6/11/2026	13:30:00	7.6	1.7829	3.4	1,369,068	14.3	261
6/11/2026	14:30:00	7.6	1.8019	3	1,369,103	14.3	263
6/11/2026	15:00:00	7.5	1.7678	3.2	1,369,123	14.3	263
6/11/2026	15:15:00	7.5	1.1659	3.3	1,369,128	14.9	268
6/11/2026	15:45:00	7.8	1.7716	21.6	1,369,162	14.7	256
6/11/2026	16:00:00	7.6	1.7413	1.4	1,369,166	14.7	268
6/11/2026	16:30:00	7.6	1.7640	3	1,369,202	14.4	273
6/11/2026	16:45:00	7.6	1.7451	3.1	1,369,210	14.7	276
6/11/2026	17:15:00	7.6	1.1205	2.9	1,369,231	14.6	278
6/11/2026	17:30:00	7.6	1.7791	3	1,369,239	14.3	278



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/11/2026	18:00:00	7.6	1.6807	3.5	1,369,264	14.3	278
6/11/2026	18:30:00	7.6	1.6656	2.9	1,369,288	14.2	279
6/11/2026	19:00:00	7.6	1.6618	2.7	1,369,297	14.4	281
6/11/2026	19:30:00	7.6	1.6467	2.6	1,369,328	14.3	283
6/11/2026	20:15:00	7.6	1.6315	4.7	1,369,365	14.1	279
6/11/2026	21:00:00	7.6	1.6618	4.9	1,369,383	14.2	281
6/11/2026	21:30:00	7.6	0.0000	2.3	1,369,396	14.2	281
6/11/2026	21:45:00	7.6	1.6239	2.7	1,369,405	14.6	281
6/11/2026	22:30:00	7.6	1.6542	2.5	1,369,433	14	281
6/11/2026	22:45:00	7.5	0.1476	2.7	1,369,448	14	281
6/11/2026	23:00:00	7.5	1.6580	2.7	1,369,465	13.9	279
6/11/2026	23:15:00	7.6	0.1703	3.2	1,369,469	13.7	279
6/11/2026	23:30:00	7.6	1.1205	3.4	1,369,475	13.6	281
6/11/2026	23:45:00	7.6	1.6050	3.6	1,369,498	13.6	279
6/12/2026	0:00:00	7.6	0.1325	3.4	1,369,506	13.4	277
6/12/2026	0:15:00	7.6	0.1893	8.1	1,369,508	13.3	276
6/12/2026	0:45:00	7.7	0.2082	3.7	1,369,525	13.1	276
6/12/2026	1:00:00	7.7	0.2309	4.4	1,369,528	13.3	276
6/12/2026	1:15:00	7.7	0.2385	5.2	1,369,540	13.4	274
6/12/2026	1:45:00	7.6	1.6315	7.3	1,369,550	13.7	279
6/12/2026	2:00:00	7.5	0.1703	6.2	1,369,569	13.5	281
6/12/2026	2:15:00	7.5	1.6656	7	1,369,586	13.5	281
6/12/2026	2:45:00	7.6	0.0908	8.6	1,369,603	13.6	279
6/12/2026	3:15:00	7.7	0.1855	7.6	1,369,606	13.5	268
6/12/2026	3:45:00	7.7	1.4650	10.4	1,369,612	13.7	269
6/12/2026	5:00:00	7.6	0.1590	4.1	1,369,627	13.3	278
6/12/2026	5:30:00	7.6	1.7640	4.1	1,369,641	13.4	276
6/12/2026	6:00:00	7.6	1.7489	3	1,369,667	13.4	279
6/12/2026	6:15:00	7.7	0.9539	3.4	1,369,677	13.7	279
6/12/2026	6:30:00	7.7	1.3476	3.4	1,369,697	13.4	279
6/12/2026	6:45:00	7.7	0.3255	4.1	1,369,709	13.4	281
6/12/2026	7:00:00	7.6	1.7564	4.1	1,369,732	13.4	281



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/12/2026	7:15:00	7.6	1.7526	6	1,369,745	14	281
6/12/2026	7:30:00	7.6	1.7148	4.8	1,369,771	13.5	283
6/12/2026	8:00:00	7.6	1.7261	4.8	1,369,781	13.5	283
6/12/2026	8:30:00	7.7	1.7034	5.6	1,369,807	13.6	288
6/12/2026	8:45:00	7.7	0.2271	6.7	1,369,827	13.7	272
6/12/2026	9:30:00	7.7	1.3779	19.8	1,369,840	13.4	279
6/12/2026	9:45:00	7.7	0.1211	6.4	1,369,851	13.6	279
6/12/2026	10:00:00	7.7	1.8208	2.5	1,369,865	13.7	279
6/12/2026	10:15:00	7.7	1.7602	2.9	1,369,877	13.8	281
6/12/2026	10:30:00	7.7	1.7413	6.2	1,369,903	13.8	279
6/12/2026	10:45:00	7.4	1.7791	2.6	1,369,913	14.3	268
6/12/2026	11:00:00	7.6	1.7299	3.6	1,369,939	14	279
6/12/2026	11:15:00	7.7	0.2915	4.3	1,369,957	14.4	279
6/12/2026	11:30:00	7.7	1.7261	4.4	1,369,978	14.2	276
6/12/2026	11:45:00	7.7	0.2006	3.8	1,370,002	14.7	268
6/12/2026	12:00:00	7.7	1.7186	3.8	1,370,014	14.3	278
6/12/2026	12:15:00	7.7	1.6845	3.9	1,370,040	14.9	276
6/12/2026	12:30:00	7.7	1.7072	3.2	1,370,051	14.6	279
6/12/2026	12:45:00	7.7	1.7186	5.9	1,370,073	15.2	269
6/12/2026	13:00:00	7.7	1.7337	4	1,370,084	14.9	277
6/12/2026	13:15:00	7.7	0.2423	4.5	1,370,105	15	279
6/12/2026	13:30:00	7.7	1.6996	7.9	1,370,119	15.2	279
6/12/2026	13:45:00	7.7	0.1022	4	1,370,140	15.5	289
6/12/2026	14:00:00	7.7	1.7224	4.2	1,370,151	15.9	289
6/12/2026	14:15:00	7.7	0.2233	5.6	1,370,172	16	287
6/12/2026	14:30:00	7.7	1.6959	4.7	1,370,181	16.4	272
6/12/2026	14:45:00	7.7	0.0000	6.9	1,370,185	16.1	287
6/12/2026	15:00:00	7.7	1.6769	4.7	1,370,209	15.8	287
6/12/2026	15:15:00	7.7	1.0410	3.7	1,370,232	16.5	269
6/12/2026	15:30:00	7.7	1.6542	6	1,370,256	16.1	286
6/12/2026	15:45:00	7.7	1.6315	8.1	1,370,281	16	288
6/12/2026	16:00:00	7.7	1.6656	10.1	1,370,302	15.9	278



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/12/2026	16:15:00	7.7	1.6694	8.4	1,370,327	15.8	276
6/12/2026	16:30:00	7.8	1.6807	6.7	1,370,350	15.8	288
6/12/2026	16:45:00	7.7	1.6921	2	1,370,374	16.9	269
6/12/2026	17:00:00	7.9	1.6807	14.3	1,370,399	16	286
6/12/2026	17:15:00	7.9	0.2309	18.2	1,370,418	16.3	286
6/12/2026	17:30:00	7.8	1.6921	5.9	1,370,434	16.1	286
6/12/2026	17:45:00	7.7	1.9836	3.1	1,370,459	16.6	268
6/12/2026	18:15:00	7.8	1.7375	4.7	1,370,491	16.3	286
6/12/2026	18:30:00	7.8	1.7337	6.2	1,370,517	15.9	286
6/12/2026	18:45:00	7.8	1.7981	8.2	1,370,528	16.2	269
6/12/2026	19:15:00	7.8	1.1508	7.8	1,370,564	16.3	269
6/12/2026	19:30:00	7.8	1.7791	11.5	1,370,590	15.9	278
6/12/2026	19:45:00	7.8	1.7640	7.6	1,370,604	16.3	269
6/12/2026	20:30:00	7.8	1.7564	10.6	1,370,643	15.5	276
6/12/2026	21:15:00	7.7	1.7261	9.8	1,370,676	15.3	279
6/12/2026	21:45:00	7.8	0.8744	25.1	1,370,693	14.8	279
6/12/2026	22:00:00	7.8	1.7261	9.4	1,370,702	14.3	277
6/12/2026	22:30:00	7.8	2.0063	10	1,370,702	14.3	279
6/12/2026	23:00:00	7.8	1.9078	9.8	1,370,704	14.3	279
6/12/2026	23:15:00	7.8	1.8813	11.4	1,370,724	14.3	279
6/12/2026	23:30:00	7.8	1.7716	11.4	1,370,740	14.7	279
6/13/2026	0:30:00	7.8	1.8208	8.2	1,370,775	14.3	279
6/13/2026	1:15:00	7.8	1.8056	10.1	1,370,813	14.2	283
6/13/2026	1:45:00	7.8	1.8321	11.1	1,370,825	14.1	283
6/13/2026	2:15:00	7.8	1.7716	6.9	1,370,852	14.1	279
6/13/2026	2:45:00	7.8	1.7110	4.8	1,370,862	14.1	281
6/13/2026	3:00:00	7.8	1.7034	16.8	1,370,887	14.3	283
6/13/2026	3:30:00	7.8	1.7224	7	1,370,900	14.1	278
6/13/2026	3:45:00	7.8	1.6353	5.3	1,370,925	14.4	279
6/13/2026	4:45:00	7.9	1.6504	4.7	1,370,959	13.9	279
6/13/2026	5:45:00	7.9	1.6467	7.1	1,370,985	13.6	281
6/13/2026	6:15:00	7.7	1.6391	7.9	1,371,006	13.6	278



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/13/2026	6:45:00	7.7	0.4013	7.6	1,371,028	13.5	278
6/13/2026	7:30:00	7.7	1.7526	3.6	1,371,040	14	266
6/13/2026	7:45:00	7.7	1.7110	3.3	1,371,060	13.8	273
6/13/2026	8:00:00	7.7	0.1401	3	1,371,079	13.7	276
6/13/2026	8:15:00	7.7	1.7413	5.1	1,371,093	13.8	271
6/13/2026	8:30:00	7.7	1.7261	3	1,371,118	13.7	274
6/13/2026	8:45:00	7.7	0.2725	2.5	1,371,133	13.9	274
6/13/2026	9:00:00	7.7	1.6807	2.6	1,371,146	13.7	273
6/13/2026	9:15:00	7.7	0.2650	2.9	1,371,162	14	271
6/13/2026	9:30:00	7.7	1.6845	3.4	1,371,178	14.3	273
6/13/2026	9:45:00	7.8	0.2801	3.9	1,371,194	14.3	270
6/13/2026	10:00:00	7.7	1.6769	7.3	1,371,211	14.3	263
6/13/2026	10:45:00	7.7	0.1666	4	1,371,227	14.5	273
6/13/2026	11:00:00	7.7	1.6391	3.1	1,371,246	14.6	274
6/13/2026	11:30:00	7.7	0.2612	2.2	1,371,261	14.8	281
6/13/2026	11:45:00	7.7	1.6315	1.5	1,371,276	15.1	281
6/13/2026	12:00:00	7.8	1.6277	6.1	1,371,298	15.1	279
6/13/2026	12:15:00	7.8	1.6504	7.1	1,371,309	15.3	279
6/13/2026	12:30:00	7.7	1.6126	5.2	1,371,331	15.3	276
6/13/2026	12:45:00	7.7	0.1893	2.1	1,371,347	15.7	281
6/13/2026	13:00:00	7.7	1.6580	2.9	1,371,366	15.5	281
6/13/2026	13:15:00	7.7	0.2953	2.3	1,371,381	15.8	279
6/13/2026	13:30:00	7.7	1.6126	2.7	1,371,396	15.7	279
6/13/2026	13:45:00	7.7	1.5861	2.6	1,371,420	16	279
6/13/2026	14:00:00	7.6	0.2650	2.8	1,371,432	16.2	279
6/13/2026	14:15:00	7.6	1.6391	2.7	1,371,443	16	278
6/13/2026	14:30:00	7.6	0.1628	3.2	1,371,462	15.9	279
6/13/2026	14:45:00	7.6	1.6012	2.7	1,371,474	16	279
6/13/2026	15:00:00	7.6	1.5937	2.8	1,371,494	16.5	265
6/13/2026	15:15:00	7.6	1.5974	3	1,371,518	16	279
6/13/2026	15:30:00	7.6	0.2461	2.6	1,371,532	15.9	279
6/13/2026	15:45:00	7.6	0.7344	2.7	1,371,543	16.7	281



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/13/2026	16:00:00	7.6	0.2423	2.4	1,371,549	15.8	278
6/13/2026	16:15:00	7.6	1.6996	2.3	1,371,574	16.3	279
6/13/2026	16:30:00	7.6	0.3104	2.3	1,371,584	15.9	278
6/13/2026	16:45:00	7.6	1.6959	2.2	1,371,602	16.3	278
6/13/2026	17:00:00	7.6	0.2044	2.6	1,371,614	16	279
6/13/2026	17:15:00	7.6	1.6542	2.3	1,371,635	16.7	276
6/13/2026	17:30:00	7.6	0.1931	2.8	1,371,647	16.3	276
6/13/2026	17:45:00	7.6	1.6580	2.2	1,371,667	16.9	278
6/13/2026	18:00:00	7.6	0.2158	3	1,371,676	16.4	278
6/13/2026	18:15:00	7.6	1.6239	2.1	1,371,689	16.6	276
6/13/2026	18:30:00	7.6	0.2725	2.3	1,371,698	17.4	279
6/13/2026	18:45:00	7.6	1.6694	3.4	1,371,704	16.5	276
6/13/2026	19:15:00	7.6	1.6429	1.7	1,371,727	16.4	260
6/13/2026	20:00:00	7.6	1.6012	2.5	1,371,755	15.2	274
6/13/2026	20:30:00	7.6	1.6277	5.4	1,371,760	15.3	276
6/13/2026	21:00:00	7.6	1.5861	2.7	1,371,784	15.2	268
6/13/2026	21:30:00	7.7	0.8669	2.7	1,371,788	15.1	268
6/13/2026	22:00:00	7.7	1.5293	2.3	1,371,805	14.9	268
6/13/2026	22:45:00	7.7	1.7034	3.6	1,371,826	14.6	268
6/13/2026	23:15:00	7.7	0.6776	4	1,371,834	14.3	266
6/13/2026	23:30:00	7.8	1.7375	5.3	1,371,853	14.1	266
6/14/2026	0:00:00	7.8	1.7110	3.6	1,371,874	14	264
6/14/2026	0:30:00	7.8	1.7413	6.7	1,371,883	13.9	266
6/14/2026	1:30:00	7.7	1.6959	6.2	1,371,908	14.1	279
6/14/2026	3:00:00	7.5	1.6769	3.8	1,371,926	14.4	286
6/14/2026	3:30:00	7.3	1.6959	5.7	1,371,933	14.8	279
6/14/2026	4:30:00	7.6	1.7526	5	1,371,962	13.7	300
6/14/2026	5:00:00	7.7	1.7224	3.4	1,371,997	13.8	304
6/14/2026	6:30:00	7.6	1.6769	7.1	1,372,016	14.4	307
6/14/2026	8:15:00	7.7	1.6921	3.4	1,372,050	14.3	309
6/14/2026	8:30:00	7.7	0.9047	4.1	1,372,054	14.2	305
6/14/2026	9:00:00	7.7	1.0940	5.4	1,372,076	14.8	286



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature	Discharge Conductivity
6/14/2026	9:15:00	7.8	1.6504	7.7	1,372,082	17.9	286
6/14/2026	9:45:00	7.7	1.6769	1.7	1,372,104	15.4	283
6/14/2026	10:15:00	7.8	1.6618	1.8	1,372,124	14.8	294
6/14/2026	11:00:00	7.8	1.6504	2.1	1,372,136	15.2	278
6/14/2026	11:30:00	7.8	1.6429	2	1,372,167	15.1	289
6/14/2026	12:00:00	7.8	1.6164	2.1	1,372,190	16.6	288
6/14/2026	12:45:00	7.9	1.6050	17.2	1,372,220	15.8	271
6/14/2026	13:15:00	7.9	1.6315	11.9	1,372,245	16.1	267
6/14/2026	13:30:00	7.8	0.3218	7.4	1,372,251	17.8	268
6/14/2026	13:45:00	7.7	0.2763	9.6	1,372,264	16.5	268
6/14/2026	14:00:00	7.8	1.6315	6.7	1,372,273	16.8	286
6/14/2026	14:45:00	7.8	0.1741	2.7	1,372,285	16.9	293
6/14/2026	15:00:00	7.8	1.6164	3	1,372,301	16.7	276
6/14/2026	15:15:00	7.7	0.2877	3.8	1,372,313	17.4	296
6/14/2026	15:30:00	7.7	1.5747	2.2	1,372,328	16.9	276
6/14/2026	15:45:00	7.7	0.2612	3.8	1,372,340	16.7	296
6/14/2026	16:15:00	7.7	0.7609	2.1	1,372,346	16.9	278
6/14/2026	16:30:00	7.8	0.2877	11.6	1,372,353	16.7	294
6/14/2026	16:45:00	7.8	1.6088	6.5	1,372,362	17	298
6/14/2026	17:30:00	7.8	1.5634	5.2	1,372,390	18	278
6/14/2026	17:45:00	7.7	1.5520	1.5	1,372,414	16.8	279
6/14/2026	18:30:00	7.9	1.5747	11	1,372,446	16.2	283
6/14/2026	18:45:00	7.9	0.2271	11.6	1,372,460	16.2	284
6/14/2026	19:00:00	7.7	1.1508	3.2	1,372,474	16.2	281
6/14/2026	19:30:00	7.4	0.1363	5.2	1,372,480	16.3	283
6/14/2026	21:30:00	7.5	1.5293	5.2	1,372,493	16.4	286
6/14/2026	21:45:00	7.6	0.2498	3.3	1,372,504	15.9	286
6/14/2026	22:15:00	7.7	1.5672	4.6	1,372,523	15.7	288
6/14/2026	22:30:00	7.7	0.2612	3.2	1,372,534	15.5	286
6/14/2026	23:00:00	7.8	1.5634	2.6	1,372,547	15.5	286
6/14/2026	23:15:00	7.8	0.2385	3.8	1,372,558	15.5	284
6/14/2026	23:45:00	7.8	1.5709	3.2	1,372,567	15.3	281

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

4. CP2 Discharge Parameter Summary:

Table 3: CP2 Discharge Parameter Summary

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	0:00:00	7.55	1.2681	0	134322.4	12.5	154
6/8/2026	0:15:00	7.56	1.0183	0	134338.2	12.7	152
6/8/2026	0:30:00	7.52	2.2031	0	134367.5	12.4	160
6/8/2026	0:45:00	7.52	0.0908	0	134382.5	13	156
6/8/2026	1:00:00	7.5	0.8782	0	134383.1	13.3	156
6/8/2026	1:15:00	7.49	2.0971	0	134407.4	13.3	160
6/8/2026	1:30:00	7.47	1.9533	0	134438.0	13.8	161
6/8/2026	2:00:00	7.46	1.8813	0	134448.0	14.2	163
6/8/2026	2:15:00	7.48	0.4959	0	134463.7	13.3	179
6/8/2026	2:30:00	7.45	0.0492	0	134464.5	13.8	179
6/8/2026	2:45:00	7.48	2.5097	0	134483.7	12.5	179
6/8/2026	3:00:00	7.51	2.5249	0	134517.4	12.6	173
6/8/2026	3:15:00	7.51	0.4845	0	134544.3	12.9	172
6/8/2026	3:45:00	7.47	0.3369	0	134561.2	17	172
6/8/2026	4:00:00	7.45	0.3407	0	134566.2	19.1	173
6/8/2026	4:15:00	7.43	0.3861	0	134573.0	20.8	174
6/8/2026	4:30:00	7.4	1.1508	0	134598.8	21	174
6/8/2026	4:45:00	7.39	0.9956	0	134615.8	20.5	175
6/8/2026	5:00:00	7.38	2.1463	0	134637.0	20	176
6/8/2026	5:15:00	7.36	0.1136	0	134656.5	19.4	175
6/8/2026	5:30:00	7.35	0.2120	0	134659.8	19	176
6/8/2026	5:45:00	7.32	1.1508	0	134664.7	18.7	176
6/8/2026	6:00:00	7.32	2.6725	0	134681.7	18.4	176
6/8/2026	6:15:00	7.32	2.5627	0	134719.4	18	175
6/8/2026	6:30:00	7.3	1.0788	0	134752.2	17.6	176
6/8/2026	6:45:00	7.29	0.3899	0	134761.6	17.2	175
6/8/2026	7:00:00	7.29	0.7874	0	134780.5	17.9	175
6/8/2026	7:15:00	7.27	0.3142	0	134789.0	18.1	176



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	7:30:00	7.24	0.2801	0	134792.4	18.8	175
6/8/2026	7:45:00	7.24	0.7117	0	134796.1	18.5	175
6/8/2026	8:00:00	7.24	2.3659	0	134823.4	18.5	176
6/8/2026	8:15:00	7.23	2.2599	0	134857.5	18.1	175
6/8/2026	8:30:00	7.22	2.1653	0	134889.5	17.9	176
6/8/2026	8:45:00	7.21	1.0183	0	134917.6	17.9	175
6/8/2026	9:15:00	7.2	1.9381	0	134942.2	17.4	175
6/8/2026	9:30:00	7.19	0.1325	0	134968.2	17.5	176
6/8/2026	9:45:00	7.18	1.2870	0	134976.6	17.6	176
6/8/2026	10:00:00	7.18	0.9918	0	134994.2	17.7	176
6/8/2026	10:15:00	7.17	2.2334	0	135008.6	17.7	175
6/8/2026	10:30:00	7.16	1.3249	0	135041.6	17.9	176
6/8/2026	10:45:00	7.15	0.5148	0	135054.6	17.9	176
6/8/2026	11:00:00	7.15	1.9003	0	135067.7	18	176
6/8/2026	11:15:00	7.13	2.4681	0	135102.6	17.9	175
6/8/2026	11:30:00	7.54	1.5899	0	135137.6	13.4	149
6/8/2026	11:45:00	7.49	0.1628	0	135145.4	14.7	149
6/8/2026	12:00:00	7.49	0.4883	0	135156.4	13.2	151
6/8/2026	12:15:00	7.49	0.5035	1	135163.2	14.2	151
6/8/2026	12:30:00	7.48	2.3091	0	135183.5	12.5	152
6/8/2026	12:45:00	7.5	1.2984	0	135208.8	13.3	151
6/8/2026	13:00:00	7.47	1.8700	0	135224.3	12.6	153
6/8/2026	13:15:00	7.48	1.7754	0	135254.9	12.5	154
6/8/2026	13:30:00	7.5	0.3331	0	135267.7	13.1	153
6/8/2026	13:45:00	7.46	0.9123	0	135272.9	13.4	153
6/8/2026	14:00:00	7.47	2.2788	0	135301.9	12.5	156
6/8/2026	14:15:00	7.46	2.2523	0	135333.8	12.4	156
6/8/2026	14:30:00	7.45	1.8435	0	135361.4	12.5	157
6/8/2026	14:45:00	7.45	0.9729	0	135391.6	12.5	157
6/8/2026	15:00:00	7.44	1.0107	0	135403.5	12.7	157
6/8/2026	15:15:00	7.44	2.1728	0	135432.5	12.5	158
6/8/2026	15:45:00	7.42	2.4719	0	135453.9	12.5	159



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	16:00:00	7.42	2.4189	0	135486.5	12.4	160
6/8/2026	16:15:00	7.44	1.7791	0	135516.8	12.6	160
6/8/2026	16:45:00	7.42	1.4309	0	135565.7	12.6	160
6/8/2026	17:00:00	7.43	0.0833	0	135582.4	13.7	157
6/8/2026	17:15:00	7.4	0.1779	0	135585.5	14.3	159
6/8/2026	17:30:00	7.41	1.4498	0	135599.4	12.7	160
6/8/2026	17:45:00	7.41	1.9533	0	135627.5	12.4	161
6/8/2026	18:00:00	7.41	2.2637	0	135664.6	12.3	161
6/8/2026	18:15:00	7.41	1.6467	0	135701.3	12.4	161
6/8/2026	18:30:00	7.41	0.6852	0	135718.2	12.5	161
6/8/2026	18:45:00	7.42	1.9116	0	135730.7	12.6	160
6/8/2026	19:00:00	7.42	2.3810	0	135765.8	12.3	161
6/8/2026	19:15:00	7.43	2.5022	0	135802.9	12.3	161
6/8/2026	19:30:00	7.43	2.4757	0	135839.2	12.3	162
6/8/2026	20:00:00	7.43	2.4908	0	135874.9	12.6	161
6/8/2026	20:15:00	7.44	1.8397	0	135906.2	13.5	158
6/8/2026	20:30:00	7.43	1.2227	0	135931.0	14.2	160
6/8/2026	20:45:00	7.41	0.1666	0	135937.8	16.2	159
6/8/2026	21:00:00	7.4	1.1848	0	135947.2	15.8	159
6/8/2026	21:15:00	7.42	1.9306	0	135975.3	14.2	158
6/8/2026	21:30:00	7.43	0.4126	0	136000.0	14.1	158
6/8/2026	21:45:00	7.39	0.4429	0	136007.5	15.5	160
6/8/2026	22:00:00	7.41	2.6611	0	136027.9	13.8	158
6/8/2026	22:15:00	7.42	2.7179	0	136067.2	13.4	159
6/8/2026	22:30:00	7.42	1.8586	0	136106.2	13.9	157
6/8/2026	22:45:00	7.4	0.1666	0	136116.3	16.3	158
6/8/2026	23:00:00	7.4	2.4264	0	136153.7	13.7	157
6/8/2026	23:15:00	7.39	1.0675	0	136188.4	13.7	157
6/8/2026	23:30:00	7.39	0.3710	0	136197.9	15.7	159
6/8/2026	23:45:00	7.39	0.7192	0	136215.7	14.6	158
6/9/2026	0:00:00	7.38	1.9722	0	136231.1	14.2	160
6/9/2026	0:15:00	7.33	1.0183	0	136263.4	14.3	161



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	0:30:00	7.34	0.4467	0	136273.0	15.3	162
6/9/2026	0:45:00	7.31	2.6271	0	136297.1	13.3	161
6/9/2026	1:00:00	7.29	2.6346	0	136333.5	12.9	162
6/9/2026	1:15:00	7.29	0.6814	0	136360.2	13.5	163
6/9/2026	1:30:00	7.29	0.2953	0	136365.4	14.6	162
6/9/2026	1:45:00	7.27	1.7564	0	136372.4	15.3	164
6/9/2026	2:00:00	7.24	2.4529	0	136408.9	13.2	163
6/9/2026	2:15:00	7.23	2.3242	0	136445.3	12.8	163
6/9/2026	2:30:00	7.25	0.2233	0	136457.6	13.5	164
6/9/2026	3:00:00	7.25	2.5211	0	136473.3	13.6	165
6/9/2026	3:15:00	7.24	1.6429	0	136498.7	14.2	162
6/9/2026	3:30:00	7.24	2.5400	0	136534.8	13.3	160
6/9/2026	3:45:00	7.26	0.3823	0	136550.0	14.4	160
6/9/2026	4:00:00	7.27	1.9798	0	136558.9	13.8	158
6/9/2026	4:15:00	7.3	0.3861	0	136593.0	13	158
6/9/2026	4:30:00	7.28	0.9085	0	136599.9	14	158
6/9/2026	4:45:00	7.3	2.5779	0	136623.5	12.6	157
6/9/2026	5:00:00	7.32	0.9350	0	136650.7	12.7	159
6/9/2026	5:15:00	7.32	0.2612	0	136656.4	13.1	159
6/9/2026	5:30:00	7.31	0.2271	0	136658.7	13.4	159
6/9/2026	5:45:00	7.3	0.1590	0	136660.4	13.7	160
6/9/2026	6:30:00	7.27	0.9653	0	136664.5	14.2	161
6/9/2026	6:45:00	7.35	2.2788	0	136697.8	12.6	277
6/9/2026	7:00:00	7.61	0.1325	0	136722.7	13	302
6/9/2026	7:15:00	7.57	0.2877	0	136726.1	13.4	302
6/9/2026	7:30:00	7.54	0.5716	0	136731.2	13.9	302
6/9/2026	7:45:00	7.83	2.5930	0	136765.3	12.6	291
6/9/2026	8:00:00	7.81	0.2120	0	136793.5	12.9	278
6/9/2026	8:15:00	7.78	0.3748	0	136797.1	13.2	279
6/9/2026	8:30:00	7.22	1.8094	0	136825.8	13	269
6/9/2026	10:30:00	6.89	2.3697	0	136843.4	12.3	266
6/9/2026	10:45:00	6.98	0.0984	0	136872.9	13	261



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	11:00:00	6.96	0.1136	0	136873.4	13.3	262
6/9/2026	11:15:00	6.92	2.3735	1	136877.3	13	259
6/9/2026	11:30:00	7.35	0.1249	0	136908.6	12.6	245
6/9/2026	11:45:00	7.32	0.1514	0	136912.0	13.2	246
6/9/2026	12:00:00	7.21	2.1009	0	136923.4	12.6	249
6/9/2026	12:15:00	7.35	2.3924	0	136957.5	12.2	251
6/9/2026	12:30:00	7.37	0.0908	0	136969.8	12.9	249
6/9/2026	12:45:00	7.36	0.0606	0	136969.8	13.5	248
6/9/2026	13:00:00	7.1	2.1880	4	136972.3	12.7	259
6/9/2026	13:15:00	7.34	1.7526	0	137004.8	12.8	259
6/9/2026	13:45:00	7.32	1.6845	0	137022.3	13	261
6/9/2026	14:00:00	7.29	1.9949	2	137037.2	12.7	266
6/9/2026	14:45:00	7.28	1.3514	0	137079.3	13	272
6/9/2026	15:00:00	7.33	1.2416	0	137099.5	12.9	266
6/9/2026	16:15:00	7.27	0.4732	6	137108.8	13.3	271
6/9/2026	16:30:00	7.31	1.1243	4	137117.2	12.5	274
6/9/2026	16:45:00	7.44	2.6195	2	137147.0	12.4	276
6/9/2026	17:00:00	7.49	2.5816	3	137185.6	12.4	268
6/9/2026	17:15:00	7.47	1.4839	2	137212.4	13.3	258
6/9/2026	17:30:00	7.44	2.6346	3	137243.2	12.3	239
6/9/2026	17:45:00	7.51	1.7754	1	137279.3	12.3	238
6/9/2026	18:00:00	7.42	0.2536	2	137289.1	12.7	238
6/9/2026	18:15:00	7.51	2.6195	2	137315.9	12.3	237
6/9/2026	18:30:00	7.51	0.2461	2	137337.6	12.6	237
6/9/2026	18:45:00	7.49	2.2599	2	137353.7	12.5	247
6/9/2026	19:00:00	7.48	0.0908	2	137377.6	13	247
6/9/2026	19:30:00	7.48	2.5968	2	137407.3	12.8	246
6/9/2026	19:45:00	7.51	2.5930	2	137442.4	12.7	241
6/9/2026	20:00:00	7.48	0.1476	1	137454.1	13.1	239
6/9/2026	20:15:00	7.47	0.1287	1	137457.3	13.2	241
6/9/2026	20:30:00	7.48	1.3060	1	137486.2	13	233
6/9/2026	21:00:00	7.4	0.9729	1	137494.8	13.4	231



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	21:15:00	7.47	2.1955	1	137514.9	12.9	210
6/9/2026	21:30:00	7.47	0.1060	1	137526.4	13.6	206
6/9/2026	21:45:00	7.47	0.9691	1	137530.3	13.6	206
6/9/2026	22:00:00	7.42	0.4088	1	137543.6	13	206
6/9/2026	22:15:00	7.4	0.4013	1	137545.7	13.2	206
6/9/2026	22:30:00	7.4	0.0681	1	137548.5	13.5	209
6/9/2026	22:45:00	7.37	0.3710	1	137550.9	14.1	209
6/9/2026	23:00:00	7.28	2.2107	1	137573.4	14.5	215
6/9/2026	23:15:00	7.32	2.5779	1	137606.7	14.7	205
6/9/2026	23:30:00	7.35	1.8549	1	137624.1	15.4	202
6/9/2026	23:45:00	7.43	2.2258	0	137658.0	14.2	193
6/10/2026	0:00:00	7.44	0.2233	0	137685.0	14.5	194
6/10/2026	0:15:00	7.42	0.4088	0	137689.3	14.7	197
6/10/2026	0:30:00	7.43	0.9918	0	137709.7	13	198
6/10/2026	0:45:00	7.43	0.7949	0	137724.6	13	200
6/10/2026	1:00:00	7.41	0.3748	0	137730.3	14	199
6/10/2026	1:15:00	7.37	2.5438	1	137739.3	13.1	200
6/10/2026	1:30:00	7.41	2.1274	0	137770.1	12.8	196
6/10/2026	1:45:00	7.41	0.4618	0	137791.4	13.4	196
6/10/2026	2:00:00	7.39	0.3710	0	137797.7	14.3	197
6/10/2026	2:15:00	7.39	0.4505	1	137804.6	14.4	200
6/10/2026	2:30:00	7.36	2.2485	2	137813.4	13.5	205
6/10/2026	2:45:00	7.39	2.1047	0	137845.1	13.9	201
6/10/2026	3:00:00	7.35	2.3924	0	137877.2	13.9	204
6/10/2026	3:15:00	7.35	0.9388	0	137900.8	14.2	204
6/10/2026	3:30:00	7.32	0.4656	0	137907.6	15.3	205
6/10/2026	3:45:00	7.35	2.4605	0	137935.7	13.3	207
6/10/2026	4:00:00	7.35	0.5451	0	137958.0	13.4	208
6/10/2026	4:15:00	7.33	0.3710	0	137964.2	14.3	209
6/10/2026	4:30:00	7.33	0.4088	0	137973.8	14.4	212
6/10/2026	4:45:00	7.31	0.4240	0	137978.9	15	214
6/10/2026	5:00:00	7.32	1.6996	0	138003.9	15	213



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	5:15:00	7.4	1.7299	0	138033.5	14.5	214
6/10/2026	5:45:00	7.37	1.9873	0	138054.2	14.3	216
6/10/2026	6:00:00	7.4	1.9306	0	138092.7	12.8	212
6/10/2026	6:15:00	7.38	0.2990	0	138101.1	13	213
6/10/2026	6:30:00	7.35	1.6656	0	138107.8	12.3	216
6/10/2026	6:45:00	7.33	2.1539	0	138140.8	12.1	215
6/10/2026	7:00:00	7.3	2.4416	0	138177.8	12.1	215
6/10/2026	7:15:00	7.3	0.4883	0	138198.4	12.6	215
6/10/2026	7:30:00	7.27	0.3823	0	138203.3	13.7	212
6/10/2026	7:45:00	7.25	1.1546	0	138212.3	14	214
6/10/2026	8:00:00	7.24	0.2423	0	138235.0	14.6	211
6/10/2026	8:15:00	7.21	2.5400	0	138260.2	13.3	207
6/10/2026	8:30:00	7.18	2.4151	0	138297.2	13.2	206
6/10/2026	8:45:00	7.18	1.0183	0	138328.2	12.8	209
6/10/2026	9:00:00	7.18	0.9350	0	138335.1	14.9	212
6/10/2026	9:15:00	7.18	2.2069	0	138366.4	12.6	209
6/10/2026	9:30:00	7.21	2.3470	0	138399.3	12.4	206
6/10/2026	9:45:00	7.23	0.7154	0	138424.4	12.6	204
6/10/2026	10:00:00	7.23	0.3445	0	138428.4	13.9	201
6/10/2026	10:45:00	7.36	2.1350	0	138472.3	12.8	195
6/10/2026	11:15:00	7.32	0.0833	0	138500.6	14.4	193
6/10/2026	11:30:00	7.31	1.9192	0	138514.2	13	195
6/10/2026	11:45:00	7.26	2.4681	0	138546.0	12.6	197
6/10/2026	12:00:00	7.23	1.0826	0	138579.5	12.7	198
6/10/2026	12:15:00	7.24	0.2877	0	138587.4	13.6	198
6/10/2026	12:30:00	7.21	2.2258	0	138595.0	13.2	201
6/10/2026	12:45:00	7.18	2.3886	0	138632.4	12.7	199
6/10/2026	13:00:00	7.17	1.0788	0	138664.3	12.7	199
6/10/2026	13:15:00	7.19	0.8366	0	138674.9	13	200
6/10/2026	13:30:00	7.16	2.3886	0	138708.3	12.6	199
6/10/2026	13:45:00	7.17	0.9350	0	138738.0	12.6	198
6/10/2026	14:00:00	7.19	0.2347	0	138744.2	13.4	198



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	14:15:00	7.17	0.2990	0	138747.6	14.5	196
6/10/2026	14:30:00	7.16	2.3848	0	138770.5	12.7	196
6/10/2026	14:45:00	7.18	1.7261	0	138801.0	12.7	192
6/10/2026	15:00:00	7.2	0.3558	0	138812.1	12.8	193
6/10/2026	15:15:00	7.18	0.3255	0	138815.7	14	191
6/10/2026	15:30:00	7.21	1.6353	0	138841.0	12.7	186
6/10/2026	15:45:00	7.29	2.2107	0	138871.3	12.9	173
6/10/2026	16:00:00	7.35	2.0479	0	138905.2	13.2	168
6/10/2026	16:15:00	7.33	1.5672	0	138933.0	14	167
6/10/2026	16:30:00	7.29	0.3861	0	138937.6	14.6	168
6/10/2026	16:45:00	7.29	0.3748	1	138944.3	13.7	166
6/10/2026	17:00:00	7.33	2.3735	0	138973.7	13	158
6/10/2026	17:15:00	7.33	1.8435	0	139007.3	13.3	155
6/10/2026	17:30:00	7.3	0.1136	0	139019.5	14.2	155
6/10/2026	17:45:00	7.22	1.7754	4	139025.7	13.6	164
6/10/2026	18:00:00	7.31	0.7987	0	139055.9	13.4	159
6/10/2026	18:15:00	7.25	0.7609	0	139066.3	14.2	159
6/10/2026	18:30:00	7.33	2.3053	0	139095.7	12.8	162
6/10/2026	18:45:00	7.36	1.8397	0	139128.5	13.3	161
6/10/2026	19:15:00	7.27	2.1766	0	139148.2	14.3	165
6/10/2026	19:30:00	7.25	2.2069	0	139182.0	14.9	165
6/10/2026	19:45:00	7.23	1.7829	0	139209.1	15.3	165
6/10/2026	20:00:00	7.39	0.9691	0	139236.5	14	161
6/10/2026	20:15:00	7.37	2.1615	0	139255.1	13.6	163
6/10/2026	20:30:00	7.35	2.0479	0	139285.8	14.2	163
6/10/2026	20:45:00	7.33	0.1968	0	139305.8	14.5	164
6/10/2026	21:00:00	7.3	0.1893	0	139309.2	14.8	164
6/10/2026	21:15:00	7.44	2.6346	0	139339.1	12.6	161
6/10/2026	21:30:00	7.48	2.4416	0	139378.3	12.3	162
6/10/2026	21:45:00	7.47	0.1401	0	139390.7	13.3	161
6/10/2026	22:00:00	7.41	2.6536	0	139401.9	13	162
6/10/2026	22:15:00	7.51	2.6195	0	139442.7	13	161



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	22:30:00	7.54	2.6384	0	139483.1	13	164
6/10/2026	22:45:00	7.5	0.3028	0	139499.6	13.5	164
6/10/2026	23:00:00	7.51	2.6195	0	139526.9	13	166
6/10/2026	23:15:00	7.52	2.6195	0	139566.7	12.9	166
6/10/2026	23:45:00	7.46	0.3710	1	139582.9	13.3	168
6/11/2026	0:00:00	7.41	0.8706	0	139607.6	13.5	170
6/11/2026	0:15:00	7.39	0.9539	1	139621.2	13.8	170
6/11/2026	0:30:00	7.48	2.6384	0	139652.6	13.2	172
6/11/2026	0:45:00	7.46	0.2877	0	139665.7	14.2	172
6/11/2026	1:00:00	7.44	0.3596	0	139670.4	15	172
6/11/2026	1:15:00	7.41	2.6460	0	139684.3	15.6	172
6/11/2026	1:30:00	7.42	2.1501	0	139723.6	16.4	173
6/11/2026	1:45:00	7.48	2.6195	0	139762.0	13.3	172
6/11/2026	2:00:00	7.51	2.5930	0	139799.9	12.9	174
6/11/2026	2:30:00	7.49	2.4719	0	139840.8	12.8	179
6/11/2026	2:45:00	7.52	1.5482	0	139875.6	13.2	174
6/11/2026	3:00:00	7.5	0.2915	0	139879.5	13.6	176
6/11/2026	3:15:00	7.42	0.3785	0	139883.9	12.9	177
6/11/2026	3:30:00	7.34	2.5627	0	139919.0	12.7	172
6/11/2026	3:45:00	7.23	2.4719	0	139956.5	12.8	172
6/11/2026	4:00:00	7.22	0.1476	0	139976.3	13.4	175
6/11/2026	4:15:00	7.26	2.5287	0	139988.3	12.3	187
6/11/2026	4:30:00	7.27	2.4757	0	140025.1	12.8	193
6/11/2026	4:45:00	7.25	0.5792	0	140036.2	13.8	192
6/11/2026	5:00:00	7.08	0.8290	0	140053.5	13.1	220
6/11/2026	5:15:00	7.15	2.1615	0	140059.2	13.9	228
6/11/2026	5:30:00	7.08	1.4498	0	140085.1	13.9	229
6/11/2026	5:45:00	7.05	2.1766	0	140113.2	12.8	235
6/11/2026	6:00:00	7.15	2.4832	0	140146.5	12.5	230
6/11/2026	6:30:00	7.19	0.3483	1	140157.3	13.1	233
6/11/2026	6:45:00	7.18	2.2940	0	140190.7	11.9	223
6/11/2026	7:00:00	7.16	2.4340	0	140227.4	11.9	219



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/11/2026	7:15:00	7.2	1.5369	0	140259.7	12	211
6/11/2026	7:45:00	7.19	0.4921	1	140266.6	12.2	216
6/11/2026	8:00:00	7.3	2.5059	0	140300.4	12	200
6/11/2026	8:15:00	7.36	2.4757	0	140337.9	12.1	200
6/11/2026	8:30:00	7.38	0.2461	0	140357.7	12.7	200
6/11/2026	8:45:00	7.41	1.5937	0	140386.8	12.4	198
6/11/2026	9:00:00	7.39	0.0568	0	140392.6	13.5	196
6/11/2026	9:15:00	7.35	0.1703	0	140393.8	14.4	197
6/11/2026	9:30:00	7.32	2.4037	0	140420.6	12.7	199
6/11/2026	9:45:00	7.2	2.3205	0	140457.8	12.7	201
6/11/2026	10:00:00	7.2	1.6429	0	140482.1	13.9	198
6/11/2026	10:15:00	7.19	0.1022	0	140495.2	14.2	201
6/11/2026	10:30:00	7.18	0.1514	0	140498.2	14.9	202
6/11/2026	10:45:00	7.2	1.6580	0	140515.5	13.4	204
6/11/2026	11:00:00	7.15	2.2826	0	140547.2	13	199
6/11/2026	11:15:00	7.15	2.1615	0	140579.4	13.6	197
6/11/2026	11:30:00	7.16	1.9116	0	140609.6	13.8	197
6/11/2026	11:45:00	7.16	1.5823	0	140633.8	14.7	196
6/11/2026	12:30:00	7.23	1.4612	0	140654.6	14.6	195
6/11/2026	12:45:00	7.23	0.5148	0	140668.9	15.5	195
6/11/2026	13:00:00	7.21	0.3710	0	140674.4	16.1	196
6/11/2026	13:15:00	7.13	1.7716	1	140691.4	15.2	193
6/11/2026	13:30:00	7.12	0.0984	1	140700.7	15.8	197
6/11/2026	13:45:00	7.11	0.2006	1	140703.5	16.5	199
6/11/2026	14:00:00	7.15	2.3924	1	140719.1	14.2	197
6/11/2026	14:15:00	7.14	2.2637	0	140754.4	13.8	196
6/11/2026	14:30:00	7.15	1.6353	0	140788.2	14.3	199
6/11/2026	14:45:00	7.14	0.3218	0	140793.8	15.4	200
6/11/2026	15:00:00	7.12	0.3634	0	140799.8	16.3	201
6/11/2026	15:15:00	7.1	2.1993	1	140806.9	17	202
6/11/2026	15:30:00	7.21	1.5974	0	140839.8	14.1	228
6/11/2026	15:45:00	7.19	1.5255	0	140863.7	15.8	227



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/11/2026	16:00:00	7.13	0.1401	0	140876.1	15.5	244
6/11/2026	16:15:00	7.12	0.1211	0	140878.9	16.5	245
6/11/2026	16:30:00	7.16	0.1401	0	140896.1	14.7	249
6/11/2026	16:45:00	7.1	1.9003	0	140920.0	14.3	237
6/11/2026	17:00:00	7.1	1.3552	0	140944.2	15.2	228
6/11/2026	17:30:00	7.16	2.0366	1	140963.7	14.1	229
6/11/2026	17:45:00	7.2	1.4498	0	140989.0	15.2	222
6/11/2026	18:00:00	7.22	1.4990	1	141011.4	14.3	218
6/11/2026	18:30:00	7.18	2.0744	0	141029.1	14.3	221
6/11/2026	18:45:00	7.23	2.0555	0	141058.0	14.1	210
6/11/2026	19:00:00	7.27	1.7905	0	141088.6	14	206
6/11/2026	19:15:00	7.25	0.1666	0	141097.9	15	207
6/11/2026	19:30:00	7.22	0.2498	0	141101.3	15.9	209
6/11/2026	19:45:00	7.25	1.8321	0	141123.7	14.4	204
6/11/2026	20:00:00	7.28	1.7526	0	141152.6	14.1	201
6/11/2026	20:15:00	7.3	0.2385	1	141167.1	14.4	202
6/11/2026	20:30:00	7.24	0.2801	0	141170.5	14.6	203
6/11/2026	20:45:00	7.24	1.8170	2	141178.1	13.7	204
6/11/2026	21:00:00	7.23	0.3634	0	141186.8	14.5	203
6/11/2026	21:15:00	7.27	1.8511	0	141200.6	13.4	200
6/11/2026	21:30:00	7.3	2.2069	0	141234.6	13.1	199
6/11/2026	21:45:00	7.3	0.1931	0	141250.3	13.8	198
6/11/2026	22:00:00	7.27	1.8624	0	141258.5	14.1	200
6/11/2026	22:15:00	7.28	2.0176	0	141289.7	13.1	198
6/11/2026	22:30:00	7.19	1.9533	0	141319.6	13.3	193
6/11/2026	22:45:00	7.15	0.1514	0	141341.9	13.5	189
6/11/2026	23:15:00	7.19	1.7791	1	141346.4	14	193
6/11/2026	23:30:00	7.17	0.8820	0	141369.3	13.9	194
6/11/2026	23:45:00	7.23	2.0555	0	141394.7	12.9	182
6/12/2026	0:00:00	7.25	0.1628	0	141419.5	13.3	181
6/12/2026	0:15:00	7.24	0.1287	0	141422.9	13.7	183
6/12/2026	0:30:00	7.23	2.0895	0	141442.0	13.7	186



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	0:45:00	7.21	1.9116	0	141472.1	14.2	187
6/12/2026	1:00:00	7.2	0.1136	1	141492.0	15	187
6/12/2026	1:30:00	7.17	1.9041	0	141494.8	17.8	187
6/12/2026	1:45:00	7.33	2.5665	0	141527.5	14.4	177
6/12/2026	2:00:00	7.34	0.0984	0	141554.7	14.5	179
6/12/2026	2:15:00	7.31	0.1136	0	141555.5	15.6	181
6/12/2026	2:30:00	7.3	0.1438	0	141558.3	16	182
6/12/2026	2:45:00	7.26	0.3293	0	141562.4	16.2	184
6/12/2026	3:00:00	7.31	1.8170	0	141587.9	14.1	183
6/12/2026	3:15:00	7.29	0.2271	0	141595.5	14.3	186
6/12/2026	3:30:00	7.28	0.2877	0	141598.9	14.6	186
6/12/2026	3:45:00	7.29	0.5716	1	141608.8	14.2	186
6/12/2026	4:00:00	7.27	0.3596	2	141618.8	14.3	186
6/12/2026	4:30:00	7.25	0.3293	1	141632.4	13.8	199
6/12/2026	4:45:00	7.23	1.1508	0	141658.8	13.1	223
6/12/2026	5:00:00	7.15	2.2485	2	141690.2	12.4	239
6/12/2026	5:15:00	7.14	0.3748	2	141701.7	12.9	240
6/12/2026	5:30:00	7.15	2.5249	1	141722.5	12.3	237
6/12/2026	5:45:00	7.15	2.5400	2	141757.3	12.6	229
6/12/2026	6:00:00	7.23	1.8586	1	141794.4	13.2	223
6/12/2026	6:15:00	7.21	0.2271	1	141804.5	14.4	222
6/12/2026	6:30:00	7.19	0.3293	1	141807.9	14.8	225
6/12/2026	6:45:00	7.29	2.5022	1	141831.1	13.7	213
6/12/2026	7:15:00	7.3	0.2650	1	141866.8	13.4	209
6/12/2026	7:30:00	7.3	2.1312	1	141880.5	12.5	211
6/12/2026	7:45:00	7.28	0.2725	1	141906.5	13.1	211
6/12/2026	8:00:00	7.26	0.0568	1	141916.6	13.3	212
6/12/2026	8:15:00	7.25	0.1287	1	141917.1	13.7	212
6/12/2026	8:45:00	7.2	0.0908	4	141929.0	13.9	207
6/12/2026	9:00:00	7.23	1.1583	1	141944.9	12.3	196
6/12/2026	9:15:00	7.3	2.5476	1	141969.5	12.4	193
6/12/2026	9:30:00	7.33	0.6397	1	141996.1	12.9	192



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	9:45:00	7.27	2.0138	1	142002.2	13.5	193
6/12/2026	10:30:00	7.26	0.5413	2	142020.4	13.9	197
6/12/2026	10:45:00	7.37	1.0826	8	142029.0	13.3	197
6/12/2026	11:00:00	7.4	2.3772	2	142055.2	13.4	199
6/12/2026	11:15:00	7.39	2.3772	1	142087.9	13.6	201
6/12/2026	11:30:00	7.38	0.2915	1	142103.8	14.6	199
6/12/2026	11:45:00	7.32	2.0101	1	142115.3	14.3	204
6/12/2026	12:00:00	7.31	1.5444	1	142146.3	14.5	203
6/12/2026	12:15:00	7.3	0.2271	1	142151.4	15.6	203
6/12/2026	12:45:00	7.26	2.0744	1	142179.8	15	208
6/12/2026	13:00:00	7.27	2.0820	1	142212.5	14.5	208
6/12/2026	13:15:00	7.26	1.2643	1	142241.6	15.4	205
6/12/2026	13:30:00	7.24	0.1703	1	142244.1	16.3	203
6/12/2026	13:45:00	7.29	1.8511	1	142271.3	15.1	201
6/12/2026	14:00:00	7.26	0.2233	0	142286.2	16.3	201
6/12/2026	14:15:00	7.26	0.5527	11	142290.7	16.7	203
6/12/2026	14:30:00	7.25	1.9495	17	142300.1	16.2	200
6/12/2026	14:45:00	7.23	0.1249	2	142308.2	16.8	200
6/12/2026	15:00:00	7.31	2.0214	1	142338.3	15.3	197
6/12/2026	15:15:00	7.31	1.4536	1	142366.3	16.3	197
6/12/2026	15:30:00	7.28	0.2574	1	142371.1	17.4	198
6/12/2026	15:45:00	7.24	0.2574	1	142374.5	18.4	200
6/12/2026	16:00:00	7.24	1.8700	2	142382.7	16.6	200
6/12/2026	16:15:00	7.35	1.9987	1	142412.4	16.1	202
6/12/2026	16:30:00	7.42	1.9911	1	142442.9	15.5	208
6/12/2026	16:45:00	7.44	1.7451	1	142471.4	16.3	210
6/12/2026	17:15:00	7.33	2.0025	2	142485.0	15.9	223
6/12/2026	17:30:00	7.39	1.4536	1	142504.8	16	219
6/12/2026	17:45:00	7.4	1.6239	1	142527.9	15.3	207
6/12/2026	18:00:00	7.36	0.1287	1	142533.2	17	207
6/12/2026	18:30:00	7.39	1.8700	1	142565.3	14.7	213
6/12/2026	18:45:00	7.4	0.0757	2	142584.0	16.2	214



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	19:00:00	7.3	1.6050	11	142588.8	15.2	223
6/12/2026	19:15:00	7.39	2.1501	0	142610.0	14.7	222
6/12/2026	19:30:00	7.4	2.3848	0	142644.1	14.3	220
6/12/2026	19:45:00	7.42	1.7375	0	142677.0	14.7	215
6/12/2026	20:15:00	7.39	1.7375	0	142702.1	14.3	213
6/12/2026	20:30:00	7.34	0.4391	0	142721.1	15.6	215
6/12/2026	20:45:00	7.37	0.5148	3	142727.9	14.8	207
6/12/2026	21:00:00	7.36	1.6845	0	142750.5	14.7	204
6/12/2026	21:15:00	7.36	2.0214	0	142778.3	14	202
6/12/2026	21:30:00	7.35	2.2069	0	142811.4	13.7	202
6/12/2026	21:45:00	7.36	2.1728	0	142844.3	13.8	201
6/12/2026	22:00:00	7.38	1.8662	0	142875.6	13.7	201
6/12/2026	22:15:00	7.37	1.5672	0	142901.3	14.4	199
6/12/2026	23:00:00	7.31	2.0630	0	142927.3	14	199
6/12/2026	23:15:00	7.31	2.0063	0	142956.8	14	200
6/12/2026	23:30:00	7.28	0.4278	0	142974.8	14.8	200
6/12/2026	23:45:00	7.26	2.2788	0	143001.6	13.3	203
6/13/2026	0:00:00	7.26	1.7451	0	143034.9	13.5	201
6/13/2026	0:15:00	7.23	0.2915	0	143044.5	14.4	202
6/13/2026	0:30:00	7.22	2.0858	0	143070.1	13.2	202
6/13/2026	0:45:00	7.2	2.5968	0	143104.4	13.2	202
6/13/2026	1:00:00	7.19	0.0833	0	143127.5	14.2	200
6/13/2026	1:15:00	7.17	0.1779	0	143128.5	14.8	200
6/13/2026	1:30:00	7.21	0.0530	0	143135.8	13.9	202
6/13/2026	1:45:00	7.18	1.1091	0	143145.6	13.5	201
6/13/2026	2:00:00	7.15	1.8284	0	143169.8	13.3	200
6/13/2026	2:15:00	7.15	2.5552	0	143197.6	13.4	201
6/13/2026	2:45:00	7.13	0.3634	0	143211.7	14.1	202
6/13/2026	3:00:00	7.15	2.5627	0	143232.9	13.1	205
6/13/2026	3:15:00	7.17	2.2523	0	143267.4	13.2	204
6/13/2026	3:30:00	7.17	2.3394	0	143303.5	13.1	204
6/13/2026	3:45:00	7.18	1.9722	0	143337.0	13.3	201



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	4:00:00	7.18	2.3659	0	143370.0	13.1	200
6/13/2026	4:15:00	7.18	0.0757	0	143383.4	14.3	198
6/13/2026	4:30:00	7.2	2.3507	0	143404.2	13.1	197
6/13/2026	4:45:00	7.21	0.5678	0	143431.3	13.9	193
6/13/2026	5:00:00	7.18	0.5072	0	143438.2	14.3	195
6/13/2026	5:15:00	7.25	1.7451	0	143461.0	13.8	191
6/13/2026	5:30:00	7.24	1.8435	5	143470.1	13.1	194
6/13/2026	5:45:00	7.23	2.3507	0	143500.6	12.7	193
6/13/2026	6:00:00	7.21	2.3545	0	143534.7	12.7	192
6/13/2026	6:15:00	7.2	2.2788	0	143568.8	12.6	192
6/13/2026	6:30:00	7.19	0.0946	0	143590.9	13.3	190
6/13/2026	6:45:00	7.22	2.2372	0	143612.8	12.6	187
6/13/2026	7:00:00	7.26	0.0757	0	143643.6	13.1	183
6/13/2026	7:15:00	7.24	0.2877	0	143645.2	13.6	183
6/13/2026	7:30:00	7.26	2.2372	0	143672.8	12.7	180
6/13/2026	7:45:00	7.29	2.1955	0	143706.9	12.8	177
6/13/2026	8:00:00	7.3	0.2763	0	143735.4	13.4	174
6/13/2026	8:15:00	7.28	0.1476	0	143738.8	14.1	174
6/13/2026	8:30:00	7.26	0.2347	0	143742.2	14.9	175
6/13/2026	8:45:00	7.28	1.8284	0	143765.9	14.3	173
6/13/2026	9:00:00	7.32	2.3205	0	143795.1	13.4	173
6/13/2026	9:15:00	7.35	2.3318	0	143829.2	13.5	174
6/13/2026	9:30:00	7.34	1.5634	0	143854.2	15	172
6/13/2026	9:45:00	7.34	2.3394	0	143883.0	13.7	172
6/13/2026	10:00:00	7.33	0.1287	0	143903.8	15.1	170
6/13/2026	10:15:00	7.31	0.2385	0	143907.2	16.2	171
6/13/2026	10:30:00	7.26	1.9495	0	143914.7	15.6	172
6/13/2026	10:45:00	7.34	2.3318	0	143946.6	14.4	173
6/13/2026	11:00:00	7.37	2.3091	0	143980.7	14.3	174
6/13/2026	11:15:00	7.36	2.3394	0	144011.8	13.7	178
6/13/2026	11:30:00	7.36	0.2233	0	144024.2	15.4	176
6/13/2026	11:45:00	7.32	2.1123	0	144047.4	13.9	176



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	12:15:00	7.29	1.3590	0	144068.3	15.2	174
6/13/2026	12:30:00	7.3	2.3318	2	144091.9	14.3	172
6/13/2026	12:45:00	7.33	2.3621	1	144125.9	13.9	173
6/13/2026	13:00:00	7.33	1.9949	0	144159.8	14	175
6/13/2026	13:15:00	7.3	2.2372	0	144193.4	13.9	175
6/13/2026	13:30:00	7.29	0.0984	0	144203.0	15.9	173
6/13/2026	13:45:00	7.24	2.3091	0	144234.4	14.1	177
6/13/2026	14:30:00	7.21	0.4013	0	144266.9	15.8	182
6/13/2026	14:45:00	7.2	1.4763	0	144288.9	16.4	178
6/13/2026	15:00:00	7.23	2.3356	0	144312.7	15.2	173
6/13/2026	15:15:00	7.24	2.3242	0	144346.8	14.8	172
6/13/2026	15:30:00	7.24	1.3855	0	144375.1	16.1	172
6/13/2026	15:45:00	7.23	2.3091	4	144386.6	15.4	174
6/13/2026	16:00:00	7.24	1.9684	0	144417.0	16.3	175
6/13/2026	16:15:00	7.25	2.3205	0	144450.9	15.8	178
6/13/2026	16:30:00	7.25	0.1703	0	144476.2	16.9	181
6/13/2026	16:45:00	7.2	0.2309	0	144479.6	18.7	183
6/13/2026	17:00:00	7.18	0.3407	0	144483.4	20.1	184
6/13/2026	17:30:00	7.21	0.1817	0	144502.2	17.5	182
6/13/2026	17:45:00	7.24	2.3394	1	144523.0	14.3	179
6/13/2026	18:00:00	7.23	0.2347	0	144535.0	16.8	177
6/13/2026	18:15:00	7.23	2.2372	4	144544.8	14.5	177
6/13/2026	18:30:00	7.26	0.6549	0	144565.4	15.6	176
6/13/2026	18:45:00	7.24	1.5520	0	144582.1	17.8	176
6/13/2026	19:00:00	7.33	2.3621	729	144598.1	15.4	0
6/13/2026	19:15:00	7.21	2.4340	0	144634.4	13.6	188
6/13/2026	19:30:00	7.19	2.4378	0	144667.9	13.5	194
6/13/2026	19:45:00	7.24	2.4037	0	144705.4	13.3	191
6/13/2026	20:00:00	7.24	0.2309	0	144717.0	15.2	190
6/13/2026	20:15:00	7.2	2.2599	0	144721.6	14.9	188
6/13/2026	20:30:00	7.27	1.9949	2	144751.9	13.4	183
6/13/2026	20:45:00	7.29	2.4037	0	144784.9	13.2	181



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	21:00:00	7.33	1.7564	0	144820.5	13.2	181
6/13/2026	21:15:00	7.3	1.3325	0	144844.4	14.8	180
6/13/2026	21:30:00	7.34	2.4567	2	144878.8	13.3	182
6/13/2026	21:45:00	7.37	1.9608	0	144914.7	13.8	179
6/13/2026	22:00:00	7.36	0.2196	0	144932.3	15	178
6/13/2026	22:15:00	7.32	0.2347	0	144935.7	16.2	179
6/13/2026	22:30:00	7.28	2.0063	9	144942.9	14.9	179
6/13/2026	22:45:00	7.3	0.8214	0	144958.3	15.8	179
6/13/2026	23:00:00	7.36	2.4340	0	144984.4	13.3	177
6/13/2026	23:15:00	7.43	2.3621	0	145021.0	13.1	182
6/13/2026	23:30:00	7.49	0.1931	0	145049.7	14.1	197
6/13/2026	23:45:00	7.47	0.2612	0	145053.1	15.2	198
6/14/2026	0:00:00	7.4	2.3242	0	145079.6	13.2	287
6/14/2026	0:15:00	7.5	2.3318	0	145113.6	13.1	311
6/14/2026	0:30:00	7.52	1.2870	0	145139.0	14.5	307
6/14/2026	0:45:00	7.49	1.4952	0	145164.5	13.7	293
6/14/2026	1:00:00	7.48	0.2044	0	145168.8	15	295
6/14/2026	1:15:00	7.41	2.3507	0	145197.2	13.1	268
6/14/2026	1:30:00	7.47	1.7375	0	145230.6	13.2	252
6/14/2026	1:45:00	7.5	0.7154	0	145259.3	13.3	239
6/14/2026	2:15:00	7.42	0.6435	0	145275.8	14.3	241
6/14/2026	2:30:00	7.51	1.6504	0	145290.5	13.9	227
6/14/2026	2:45:00	7.47	0.1136	0	145315.1	14.7	229
6/14/2026	3:00:00	7.44	2.1615	0	145327.4	13.2	215
6/14/2026	3:15:00	7.49	1.8208	0	145357.7	13.6	204
6/14/2026	3:30:00	7.47	2.0176	0	145379.5	13.5	205
6/14/2026	3:45:00	7.54	1.9533	0	145410.1	13.4	202
6/14/2026	4:00:00	7.47	2.4870	0	145441.5	13.3	201
6/14/2026	4:15:00	7.37	2.5022	0	145476.9	13	200
6/14/2026	4:30:00	7.36	1.9608	0	145513.8	13	208
6/14/2026	4:45:00	7.48	2.3848	0	145548.0	13	221
6/14/2026	5:00:00	7.48	0.1211	0	145578.2	13.7	236



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	5:15:00	7.42	0.8176	1	145584.1	14.1	250
6/14/2026	5:30:00	7.38	2.4719	1	145598.4	14.4	242
6/14/2026	5:45:00	7.35	2.1160	0	145623.6	14.3	233
6/14/2026	6:00:00	7.39	2.4719	0	145661.1	12.7	215
6/14/2026	6:30:00	7.42	2.4264	0	145708.7	12.8	203
6/14/2026	6:45:00	7.48	2.3924	0	145746.2	12.8	193
6/14/2026	7:00:00	7.48	0.7912	0	145774.3	13.6	189
6/14/2026	7:15:00	7.42	2.3886	8	145782.5	13.3	191
6/14/2026	7:30:00	7.49	2.3735	0	145814.1	13.6	187
6/14/2026	7:45:00	7.5	0.2082	0	145829.5	14.2	186
6/14/2026	8:00:00	7.5	0.2196	0	145851.5	14.1	179
6/14/2026	8:15:00	7.48	0.1703	0	145854.2	14.8	181
6/14/2026	8:30:00	7.45	2.3924	0	145870.4	13.8	176
6/14/2026	8:45:00	7.52	2.3129	0	145904.7	13.5	171
6/14/2026	9:00:00	7.49	2.3015	0	145935.0	14	170
6/14/2026	9:15:00	7.46	2.2523	0	145969.1	13.9	167
6/14/2026	9:30:00	7.48	1.7678	0	146000.7	14.8	164
6/14/2026	9:45:00	7.43	2.1690	0	146011.3	14.9	167
6/14/2026	10:00:00	7.52	1.8624	0	146045.2	14.4	163
6/14/2026	10:45:00	7.41	0.1703	0	146060.9	18.4	172
6/14/2026	11:00:00	7.44	2.2031	0	146069.5	16.1	159
6/14/2026	11:15:00	7.47	0.2385	0	146093.7	16.1	160
6/14/2026	11:30:00	7.45	2.1123	0	146111.9	15	161
6/14/2026	11:45:00	7.5	1.7943	0	146142.0	15.4	161
6/14/2026	12:15:00	7.4	1.9646	0	146163.0	17.8	165
6/14/2026	12:30:00	7.4	1.7829	0	146190.8	17.5	165
6/14/2026	12:45:00	7.37	1.8170	0	146218.1	19.1	168
6/14/2026	13:00:00	7.32	0.3066	0	146240.2	20.4	169
6/14/2026	13:15:00	6.96	1.8473	2	146249.7	15.4	207
6/14/2026	13:30:00	7.1	1.8662	1	146273.2	14.9	204
6/14/2026	13:45:00	7.19	2.2523	2	146304.2	14.6	204
6/14/2026	14:00:00	7.33	2.5552	0	146340.9	14.5	207



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	14:15:00	7.37	1.7072	0	146371.2	16.2	205
6/14/2026	14:30:00	7.33	1.2303	0	146394.8	18.5	208
6/14/2026	15:00:00	7.39	2.4794	1	146421.1	15.2	207
6/14/2026	15:15:00	7.41	2.4643	0	146458.6	14.9	207
6/14/2026	15:30:00	7.3	0.4959	0	146463.3	16.6	209
6/14/2026	15:45:00	7.35	2.4454	0	146472.8	16.1	202
6/14/2026	16:00:00	7.37	2.4605	0	146509.7	14.8	207
6/14/2026	16:15:00	7.39	1.7526	0	146546.0	14.8	206
6/14/2026	16:30:00	7.33	2.5892	2	146560.6	15.4	206
6/14/2026	16:45:00	7.34	2.5476	0	146598.1	14.7	203
6/14/2026	17:00:00	7.33	1.9949	0	146632.4	14.9	202
6/14/2026	17:15:00	7.35	0.1060	0	146662.7	16.1	201
6/14/2026	17:30:00	7.31	0.3066	0	146666.1	18.5	201
6/14/2026	17:45:00	7.33	2.5059	2	146692.0	15	199
6/14/2026	18:00:00	7.37	2.4681	0	146729.5	14.7	196
6/14/2026	18:15:00	7.37	1.1318	0	146755.6	16	194
6/14/2026	18:30:00	7.35	2.4567	0	146777.9	15	193
6/14/2026	18:45:00	7.35	2.4113	0	146815.4	14.7	194
6/14/2026	19:00:00	7.34	0.1817	0	146826.4	17.4	191
6/14/2026	19:15:00	7.31	2.3735	0	146849.6	15.4	191
6/14/2026	19:30:00	7.32	2.3242	0	146883.8	14.7	190
6/14/2026	19:45:00	7.31	0.1741	0	146908.8	16.2	188
6/14/2026	20:00:00	7.28	0.2990	0	146911.4	17.8	190
6/14/2026	20:15:00	7.27	2.2296	0	146943.8	14.8	184
6/14/2026	20:30:00	7.26	1.5142	0	146969.2	16.7	185
6/14/2026	21:00:00	7.24	1.2908	0	146982.9	17.3	188
6/14/2026	21:15:00	7.22	1.3703	0	147005.2	18.5	191
6/14/2026	21:30:00	7.18	1.6164	0	147026.6	19.4	193
6/14/2026	21:45:00	7.27	2.5022	0	147058.9	14	183
6/14/2026	22:00:00	7.27	2.4908	0	147095.8	13.6	184
6/14/2026	22:15:00	7.27	0.9199	0	147120.5	15.1	181
6/14/2026	22:30:00	7.24	0.9085	0	147134.2	16.6	182

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	23:15:00	6.83	2.4378	0	147147.9	13.1	189
6/14/2026	23:30:00	7.02	2.3810	0	147185.0	13.1	191
6/14/2026	23:45:00	7.06	2.3394	0	147219.4	13.3	191

5. In-Situ Readings

Table 4. In-Situ Readings

Date	Temperature (C°)	DO mg/L	SAL-ppt	pH	ORP (mV)	NTU
06/08/2026	12.0	9.93	0.08	7.49	160.5	4.79
06/09/2026	13.2	10.81	0.11	7.94	138.7	3.04
06/10/2026	14.4	9.83	0.11	7.35	153.9	2.42
06/11/2026	13.2	9.02	0.10	7.41	145.0	2.22
06/12/2026	14.3	8.83	0.12	7.34	137.4	3.60
06/13/2026	13.7	9.71	0.10	7.06	155.1	3.31
06/14/2026	13.5	8.52	0.10	7.32	143.5	2.56

6. Calibration Log:

Table 5. Calibration Log

Date	Unit	pH	Conductivity/ Salinity	NTU
06/13/2026	YSI	✓	✓	✓
06/09/2026	Portal WTP	✓	N/A	✓
06/13/2026	CP2 WTP	✓	✓	✓

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

APPENDIX A: Portal WTP Data Log



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/8/2026	0:00:00	7	0.9993	1.3	1,364,579	Open	14.7	246
6/8/2026	0:15:00	7	0.2498	0	1,364,591	Open	15.2	243
6/8/2026	0:30:00	6.9	1.0145	0.2	1,364,611	Open	15	243
6/8/2026	0:45:00	6.9	1.6277	0.7	1,364,634	Open	14.8	244
6/8/2026	1:00:00	7	0.2196	1.8	1,364,655	Open	15	242
6/8/2026	1:15:00	6.9	1.5937	1.6	1,364,670	Open	14.8	245
6/8/2026	1:30:00	6.9	1.0296	2.2	1,364,692	Open	15	244
6/8/2026	1:45:00	6.9	1.6088	1.9	1,364,714	Open	14.7	245
6/8/2026	2:00:00	6.9	1.0486	4	1,364,725	Open	15.3	245
6/8/2026	2:15:00	6.9	1.6202	2.7	1,364,748	Open	14.5	246
6/8/2026	2:30:00	7	0.1893	6.3	1,364,769	Open	14.6	242
6/8/2026	2:45:00	7	1.5937	2.7	1,364,776	Open	14.6	244
6/8/2026	3:00:00	7	0.2688	3.6	1,364,797	Open	14.5	242
6/8/2026	3:15:00	7	1.5861	4.2	1,364,812	Open	14.4	246
6/8/2026	3:30:00	7	0.5565	7.1	1,364,833	Open	14.3	245
6/8/2026	3:45:00	7	0.2385	0.3	1,364,843	Open	14.8	243
6/8/2026	4:00:00	7	1.1053	0.7	1,364,866	Open	14.4	242
6/8/2026	4:15:00	7	0.2006	1	1,364,882	Open	14.1	244
6/8/2026	4:30:00	7	1.0637	0.1	1,364,901	Open	14.2	244
6/8/2026	4:45:00	7	0.2309	0	1,364,919	Open	14.1	245
6/8/2026	5:00:00	7	1.0637	1.5	1,364,934	Open	14.1	245
6/8/2026	5:15:00	7	1.6845	0.5	1,364,957	Open	13.9	245
6/8/2026	5:30:00	7.1	0.1590	0.5	1,364,976	Open	14.1	245
6/8/2026	5:45:00	7	1.6694	0.1	1,364,996	Open	14.1	243
6/8/2026	6:00:00	7	0.7192	1.8	1,365,018	Open	14.4	245
6/8/2026	6:15:00	7	1.6353	0.2	1,365,032	Open	14.3	244
6/8/2026	6:30:00	7.1	1.0637	1.3	1,365,054	Open	14.8	243
6/8/2026	6:45:00	7	0.2233	0.1	1,365,076	Open	14.4	242
6/8/2026	7:00:00	7	1.0864	3.1	1,365,086	Open	14.9	243
6/8/2026	7:15:00	7	1.6769	0.4	1,365,109	Open	14.5	243
6/8/2026	7:30:00	7	0.2006	2	1,365,120	Open	15.2	243
6/8/2026	7:45:00	7	1.6656	0.4	1,365,143	Open	14.2	242



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/8/2026	8:00:00	7	0.2271	1.3	1,365,157	Open	14.3	245
6/8/2026	8:15:00	7	1.6277	1.7	1,365,176	Open	13.7	242
6/8/2026	8:30:00	7	0.2461	1	1,365,193	Open	13.7	113
6/8/2026	8:45:00	7	1.6164	1.4	1,365,212	Open	13.3	111
6/8/2026	9:00:00	7	0.1098	1.7	1,365,222	Open	13.6	110
6/8/2026	9:15:00	7	1.5596	1.7	1,365,238	Open	13.2	110
6/8/2026	9:30:00	7	0.0000	1	1,365,251	Open	14.5	110
6/8/2026	9:45:00	7	1.5634	2.6	1,365,270	Open	13.2	112
6/8/2026	10:00:00	7	0.0568	1.6	1,365,280	Open	13.6	112
6/8/2026	10:15:00	7	1.5142	1.8	1,365,297	Open	13.5	112
6/8/2026	10:30:00	7.1	0.0416	1.3	1,365,306	Open	14.1	112
6/8/2026	10:45:00	7	1.5444	2	1,365,324	Open	13.8	112
6/8/2026	11:00:00	7	0.0000	1.2	1,365,336	Open	14.1	112
6/8/2026	11:15:00	7	1.4839	1.6	1,365,354	Open	13.9	112
6/8/2026	11:30:00	7	0.0000	1.6	1,365,360	Open	14.5	112
6/8/2026	11:45:00	7	1.4952	1.5	1,365,376	Open	14.5	114
6/8/2026	12:00:00	7	0.0000	1.4	1,365,380	Open	15.5	114
6/8/2026	12:15:00	7	1.4801	2.1	1,365,397	Open	14.9	114
6/8/2026	12:30:00	7	0.0000	2.2	1,365,400	Open	15.4	112
6/8/2026	12:45:00	7	1.4574	2.3	1,365,417	Open	14.6	112
6/8/2026	13:00:00	7	0.0000	1.9	1,365,421	Open	15.3	112
6/8/2026	13:15:00	7	0.1590	3.4	1,365,435	Open	14.5	114
6/8/2026	13:30:00	7	0.0000	3.4	1,365,436	Open	14.7	112
6/8/2026	13:45:00	7.1	0.2498	2.1	1,365,442	Open	14.3	112
6/8/2026	14:00:00	7	1.0675	1.8	1,365,449	Open	16	112
6/8/2026	14:15:00	7	0.2347	2	1,365,459	Open	14.9	112
6/8/2026	14:30:00	7	1.0410	2.1	1,365,474	Open	14.6	112
6/8/2026	14:45:00	7	0.2498	1.9	1,365,484	Open	15	113
6/8/2026	15:00:00	7	1.0486	2	1,365,503	Open	14.9	113
6/8/2026	15:15:00	6.9	1.6353	2.1	1,365,510	Open	16.2	242
6/8/2026	15:30:00	7	0.1060	1.8	1,365,528	Open	15.1	114
6/8/2026	15:45:00	6.9	1.6126	2.3	1,365,531	Open	16.4	241



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/8/2026	16:00:00	7	0.1552	2.1	1,365,547	Open	15.1	113
6/8/2026	16:15:00	7	1.5974	2.7	1,365,558	Open	15.2	242
6/8/2026	16:30:00	7	0.0000	2.4	1,365,576	Open	14.8	112
6/8/2026	16:45:00	7	1.6126	2.6	1,365,582	Open	14.8	241
6/8/2026	17:00:00	7	0.0000	2.5	1,365,594	Open	14.4	112
6/8/2026	17:15:00	6.9	1.5899	2.2	1,365,605	Open	14.9	114
6/8/2026	17:30:00	7	0.0000	1.4	1,365,611	Open	15.6	243
6/8/2026	17:45:00	6.9	1.5444	1.2	1,365,626	Open	15.2	241
6/8/2026	18:00:00	7	0.0000	1.4	1,365,630	Open	16.2	241
6/8/2026	18:15:00	6.9	1.5369	1.6	1,365,642	Open	15.3	243
6/8/2026	18:30:00	7	0.0984	0.8	1,365,651	Open	15.6	243
6/8/2026	18:45:00	6.9	1.5217	1	1,365,664	Open	15	241
6/8/2026	19:00:00	7	0.0795	0.6	1,365,669	Open	15.4	243
6/8/2026	19:15:00	6.9	1.4990	0.8	1,365,685	Open	14.8	243
6/8/2026	19:30:00	7	0.0000	0.5	1,365,688	Open	15.7	244
6/8/2026	19:45:00	6.9	0.0000	0.3	1,365,706	Open	15.6	241
6/8/2026	20:00:00	6.9	0.9615	0.8	1,365,708	Open	16.6	242
6/8/2026	20:15:00	6.9	0.2309	1.3	1,365,728	Open	14.4	241
6/8/2026	20:30:00	7	0.8971	1.2	1,365,731	Open	14.8	241
6/8/2026	20:45:00	7	0.0000	1.4	1,365,751	Open	14.1	114
6/8/2026	21:00:00	7	0.1325	1.5	1,365,753	Open	14.6	243
6/8/2026	21:15:00	6.9	1.4687	1.8	1,365,760	Open	13.7	245
6/8/2026	21:30:00	7	0.0000	1.9	1,365,773	Closed	13.4	110
6/8/2026	21:45:00	7	0.0000	2.6	1,365,778	Closed	13.3	110
6/8/2026	22:00:00	7	1.5217	2.2	1,365,795	Open	13	110
6/8/2026	22:15:00	7	1.4120	5.1	1,365,808	Open	12.8	110
6/8/2026	22:30:00	7	1.5444	2.8	1,365,831	Open	12.8	109
6/8/2026	22:45:00	7	1.5634	5.9	1,365,840	Open	13.2	110
6/8/2026	23:00:00	7	1.5407	2.4	1,365,863	Open	12.9	110
6/8/2026	23:15:00	7	0.7647	2.4	1,365,872	Open	13.6	112
6/8/2026	23:30:00	7	1.5937	1.8	1,365,896	Open	13.4	112
6/8/2026	23:45:00	6.9	1.5937	3.3	1,365,903	Open	13.9	245



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/9/2026	0:00:00	7	0.0000	2.5	1,365,920	Open	13.8	112
6/9/2026	0:15:00	6.9	1.5672	3.8	1,365,930	Open	13.9	245
6/9/2026	0:30:00	7	0.1098	1	1,365,942	Open	14.4	243
6/9/2026	0:45:00	6.9	1.5444	0.9	1,365,954	Open	14.1	245
6/9/2026	1:00:00	6.9	1.4536	3.3	1,365,965	Open	14.6	245
6/9/2026	1:15:00	7	0.0000	0.7	1,365,977	Closed	14.2	245
6/9/2026	1:30:00	6.9	1.5747	1.2	1,365,989	Open	14.2	245
6/9/2026	1:45:00	7	0.0000	1	1,365,996	Closed	14.4	243
6/9/2026	2:00:00	6.8	1.5899	0.8	1,366,016	Open	14.2	246
6/9/2026	2:15:00	6.9	0.0000	1.1	1,366,029	Closed	14.6	242
6/9/2026	2:30:00	6.8	1.6050	0.8	1,366,047	Open	14.5	242
6/9/2026	2:45:00	6.9	0.0000	0.5	1,366,057	Closed	15.5	242
6/9/2026	3:00:00	6.8	1.5747	0.7	1,366,066	Open	14.8	243
6/9/2026	3:15:00	6.8	1.5937	3.1	1,366,073	Closed	15.8	243
6/9/2026	3:30:00	6.8	1.5672	2.3	1,366,097	Open	14.7	243
6/9/2026	3:45:00	6.9	1.5785	3.3	1,366,103	Closed	16.2	241
6/9/2026	4:00:00	6.8	1.5785	1.7	1,366,127	Open	14.4	241
6/9/2026	4:15:00	6.9	1.5672	3.1	1,366,135	Open	14.7	245
6/9/2026	4:30:00	6.8	1.6239	5	1,366,154	Open	14.3	114
6/9/2026	4:45:00	6.9	0.2574	1.4	1,366,167	Open	14.3	114
6/9/2026	5:00:00	6.9	1.6126	0.3	1,366,180	Open	14.2	243
6/9/2026	5:15:00	7	0.0000	0.9	1,366,186	Closed	15.3	243
6/9/2026	5:30:00	7.8	1.6088	2.8	1,366,200	Open	14.1	245
6/9/2026	5:45:00	8.3	1.8056	10.6	1,366,210	Open	14.5	246
6/9/2026	6:00:00	8.5	0.0000	16	1,366,232	Closed	14.1	250
6/9/2026	6:15:00	8.5	1.7337	1.7	1,366,240	Open	14.2	258
6/9/2026	6:30:00	8	1.7072	8.8	1,366,261	Open	13.9	266
6/9/2026	6:45:00	7.2	0.0000	7.1	1,366,275	Closed	14	269
6/9/2026	7:00:00	7.7	1.7034	6.8	1,366,293	Open	13.9	278
6/9/2026	7:15:00	7.5	0.0000	7.3	1,366,302	Closed	14.5	279
6/9/2026	7:30:00	7.1	0.0000	3.4	1,366,319	Closed	13.9	281
6/9/2026	7:45:00	7.1	0.0000	3.4	1,366,319	Closed	14.8	287



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/9/2026	8:00:00	7.1	0.0000	2.6	1,366,336	Closed	14	289
6/9/2026	8:15:00	7.1	1.6504	4.3	1,366,348	Open	14	294
6/9/2026	8:30:00	7.1	0.0000	2.7	1,366,362	Closed	14.3	295
6/9/2026	8:45:00	7.2	1.6504	2.4	1,366,378	Open	14.2	302
6/9/2026	9:00:00	7.2	1.6694	5.3	1,366,387	Open	14.9	302
6/9/2026	9:15:00	7.2	1.6202	4.3	1,366,407	Open	14.5	302
6/9/2026	9:30:00	7.4	1.9041	2.4	1,366,436	Open	14.4	300
6/9/2026	9:45:00	7.3	2.0782	3.9	1,366,462	Open	14.5	299
6/9/2026	10:00:00	7.3	0.2044	2.5	1,366,487	Open	14.7	298
6/9/2026	10:15:00	7.2	2.0441	2.8	1,366,507	Open	14.8	299
6/9/2026	10:30:00	7.3	1.9798	5.7	1,366,537	Open	14.7	293
6/9/2026	10:45:00	7.3	2.0366	3	1,366,563	Open	14.8	293
6/9/2026	11:00:00	7.2	0.2498	1.9	1,366,581	Open	15.2	293
6/9/2026	11:15:00	7.5	1.9987	3.6	1,366,603	Open	15	293
6/9/2026	11:30:00	6.8	2.0138	5.5	1,366,633	Open	15.1	293
6/9/2026	11:45:00	7	2.0403	6.2	1,366,660	Open	15.1	293
6/9/2026	12:00:00	7.8	2.0555	7.1	1,366,690	Open	15	293
6/9/2026	12:15:00	7.3	1.4877	7.6	1,366,700	Open	14.9	292
6/9/2026	12:30:00	7.2	1.4006	8.3	1,366,722	Open	15.8	296
6/9/2026	12:45:00	7.1	1.2946	10	1,366,738	Open	15	295
6/9/2026	13:00:00	7.1	1.7829	9.9	1,366,759	Open	14.6	297
6/9/2026	13:15:00	7	1.8435	9	1,366,783	Open	14.5	297
6/9/2026	13:30:00	6.9	1.8359	8.4	1,366,811	Open	14.6	296
6/9/2026	13:45:00	6.9	2.1577	9.2	1,366,838	Open	14.6	297
6/9/2026	14:00:00	7	2.1312	14.5	1,366,871	Open	14.6	297
6/9/2026	14:15:00	7	1.8019	12	1,366,894	Open	14.7	297
6/9/2026	14:30:00	7	1.7905	12.7	1,366,921	Open	14.8	297
6/9/2026	14:45:00	7.1	1.8019	12	1,366,945	Open	14.9	301
6/9/2026	15:00:00	7.1	1.7905	18.2	1,366,971	Open	14.9	300
6/9/2026	15:15:00	7.1	0.2347	7	1,366,979	Open	14.9	300
6/9/2026	15:30:00	7	0.1741	6.4	1,366,982	Open	16.1	303
6/9/2026	15:45:00	7.1	1.8549	6.6	1,367,000	Open	14.9	304



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/9/2026	16:00:00	7.1	1.8397	7.6	1,367,027	Open	14.8	304
6/9/2026	16:15:00	7.1	1.8511	6.4	1,367,051	Open	14.9	305
6/9/2026	16:30:00	7.1	1.8284	6.9	1,367,079	Open	14.9	305
6/9/2026	16:45:00	7.2	1.7943	7	1,367,102	Open	14.9	303
6/9/2026	17:00:00	7.1	1.7829	7.7	1,367,129	Open	14.9	303
6/9/2026	17:15:00	6.8	1.8208	11.3	1,367,152	Open	15	302
6/9/2026	17:30:00	6.5	2.1123	16.5	1,367,180	Open	14.9	288
6/9/2026	17:45:00	6.8	2.0782	13.1	1,367,208	Open	14.8	294
6/9/2026	18:00:00	7.4	2.1804	11.6	1,367,239	Open	14.7	294
6/9/2026	18:15:00	7.1	2.4529	19.8	1,367,271	Open	14.7	294
6/9/2026	18:30:00	7	2.5135	20.4	1,367,290	Open	15.8	285
6/9/2026	18:45:00	6.9	0.3785	13.3	1,367,322	Open	14.4	285
6/9/2026	19:00:00	7.2	2.4984	18.1	1,367,346	Open	14.5	288
6/9/2026	19:15:00	7.3	1.0940	69.7	1,367,364	Open	15.4	288
6/9/2026	19:30:00	7.1	1.7261	13.4	1,367,382	Open	14.5	285
6/9/2026	19:45:00	7.1	1.7716	13.3	1,367,404	Open	14.5	287
6/9/2026	20:00:00	7.1	1.7867	13.3	1,367,431	Open	14.4	287
6/9/2026	20:15:00	7	1.7564	1.1	1,367,453	Open	14.5	287
6/9/2026	20:30:00	7.1	1.7640	1.4	1,367,480	Open	14.1	289
6/9/2026	20:45:00	7	1.7829	1.1	1,367,502	Open	14.3	289
6/9/2026	21:00:00	7.1	0.0000	0.9	1,367,522	Closed	14.2	289
6/9/2026	21:15:00	7.1	1.7754	0.8	1,367,540	Open	14.2	291
6/9/2026	21:30:00	7.1	1.7791	0.8	1,367,566	Open	14.3	291
6/9/2026	21:45:00	7	1.7564	2.5	1,367,589	Open	14.3	291
6/9/2026	22:00:00	6.8	1.7678	2.6	1,367,616	Open	14.3	291
6/9/2026	22:15:00	-0.4	1.7754	4.9	1,367,637	Open	15.1	291
6/9/2026	22:30:00	6.8	1.7375	2	1,367,664	Open	14.4	289
6/9/2026	22:45:00	6.9	1.7602	2.4	1,367,669	Open	14.1	289
6/9/2026	23:00:00	7.2	1.7375	2.3	1,367,678	Open	14	291
6/9/2026	23:15:00	6.9	0.0000	6.7	1,367,691	Closed	14.9	272
6/9/2026	23:30:00	6.7	1.7489	17.5	1,367,708	Open	16.8	258
6/9/2026	23:45:00	-0.4	1.4195	2.7	1,367,710	Closed	14.5	272



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/10/2026	0:00:00	7.2	0.0000	1.8	1,367,724	Closed	13.4	274
6/10/2026	0:15:00	7.2	1.6732	2	1,367,729	Open	13.4	276
6/10/2026	0:30:00	7.3	0.0000	1.9	1,367,750	Closed	106.3	271
6/10/2026	0:45:00	7.3	1.6694	2.2	1,367,762	Open	106.3	279
6/10/2026	1:00:00	7.3	1.6618	2.4	1,367,787	Open	106.3	287
6/10/2026	1:15:00	7.2	1.6656	2.2	1,367,796	Open	106.3	287
6/10/2026	1:30:00	7.2	0.0000	1.4	1,367,808	Closed	106.3	286
6/10/2026	1:45:00	7.1	1.6845	1.8	1,367,818	Open	106.3	287
6/10/2026	2:00:00	7.1	0.0000	1.7	1,367,833	Closed	14.2	287
6/10/2026	2:15:00	7	1.7072	1.8	1,367,851	Open	14	287
6/10/2026	2:30:00	7	1.6467	1.7	1,367,876	Open	13.9	289
6/10/2026	2:45:00	7	1.6732	1.9	1,367,888	Open	13.9	291
6/10/2026	3:00:00	7.1	1.6429	1.8	1,367,913	Open	13.8	291
6/10/2026	3:15:00	7	1.6996	2.6	1,367,922	Open	13.9	291
6/10/2026	3:30:00	7.1	1.6694	2.5	1,367,948	Open	13.6	281
6/10/2026	3:45:00	7.1	1.7299	2.7	1,367,955	Open	13.6	281
6/10/2026	4:00:00	7.2	1.7451	2.7	1,367,981	Open	13.5	282
6/10/2026	4:15:00	7.2	1.7413	2.7	1,368,004	Open	13.5	279
6/10/2026	4:30:00	7.2	1.7602	2.3	1,368,017	Open	13.6	279
6/10/2026	4:45:00	7.2	0.0000	1.8	1,368,028	Closed	13.8	279
6/10/2026	5:00:00	7.2	1.7375	3.3	1,368,046	Open	13.5	277
6/10/2026	5:15:00	7.2	1.7640	3	1,368,055	Open	13.6	279
6/10/2026	5:30:00	7.3	1.7451	2.9	1,368,082	Open	13.3	282
6/10/2026	5:45:00	7.2	1.7261	2.6	1,368,092	Open	13.5	281
6/10/2026	6:00:00	7.2	1.7224	2.4	1,368,117	Open	13.6	289
6/10/2026	6:15:00	7.1	1.7640	2.2	1,368,127	Open	14	292
6/10/2026	6:30:00	7.1	0.0000	1.3	1,368,144	Closed	14.3	287
6/10/2026	6:45:00	6.9	1.7110	2.1	1,368,157	Open	14.2	289
6/10/2026	7:00:00	6.9	0.0000	1.6	1,368,165	Closed	15.2	289
6/10/2026	7:15:00	6.8	0.0000	1.6	1,368,182	Closed	14.4	286
6/10/2026	7:30:00	6.7	1.7602	1.7	1,368,191	Open	14.4	287
6/10/2026	7:45:00	6.8	1.6277	2.5	1,368,199	Open	16.9	268



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/10/2026	8:00:00	6.7	0.2044	6.8	1,368,220	Open	14.7	266
6/10/2026	8:15:00	6.7	1.7110	1.3	1,368,227	Open	15	281
6/10/2026	8:30:00	7	0.2725	5.5	1,368,245	Open	15.3	261
6/10/2026	8:45:00	6.8	1.7375	1.7	1,368,256	Open	14.6	276
6/10/2026	9:00:00	6.9	0.1703	1.3	1,368,267	Open	16.4	261
6/10/2026	9:15:00	6.9	1.6845	1.7	1,368,281	Open	14.3	266
6/10/2026	9:30:00	7.5	0.2233	14.3	1,368,285	Open	18	258
6/10/2026	9:45:00	6.9	1.7224	1.7	1,368,297	Open	14.7	259
6/10/2026	10:00:00	7	0.1590	1.5	1,368,310	Open	16	253
6/10/2026	10:15:00	7.2	0.6435	7.4	1,368,321	Open	14	263
6/10/2026	10:30:00	7.2	1.2227	6.7	1,368,329	Open	14.2	251
6/10/2026	10:45:00	7	0.4088	6.7	1,368,338	Open	15.6	244
6/10/2026	11:00:00	7.2	1.1621	2	1,368,364	Open	13.7	257
6/10/2026	11:15:00	7.1	1.7716	2.2	1,368,373	Open	13.9	254
6/10/2026	11:30:00	7.2	0.2650	8.3	1,368,394	Open	13.7	246
6/10/2026	11:45:00	7.2	1.7034	2.2	1,368,409	Open	13.6	256
6/10/2026	12:00:00	7.2	0.2385	1.9	1,368,432	Open	13.6	109
6/10/2026	12:15:00	7.2	1.7224	2.7	1,368,444	Open	13.9	264
6/10/2026	12:30:00	7.1	0.1211	2.5	1,368,464	Open	14.4	248
6/10/2026	12:45:00	7.1	1.6504	1.7	1,368,479	Open	14.3	264
6/10/2026	13:00:00	7.1	0.2006	1.5	1,368,502	Open	14.4	248
6/10/2026	13:15:00	7.1	1.6467	2	1,368,514	Open	14.4	255
6/10/2026	13:30:00	7.1	0.2006	2.1	1,368,537	Open	14.3	263
6/10/2026	13:45:00	7.5	0.0871	4.5	1,368,539	Open	16.5	246
6/10/2026	14:00:00	7.1	1.6353	2.4	1,368,555	Open	14.5	253
6/10/2026	14:15:00	7.1	0.1666	2.5	1,368,578	Open	14.4	250
6/10/2026	14:30:00	7	1.6694	3.1	1,368,585	Open	14.8	253
6/10/2026	14:45:00	7	0.1779	4	1,368,600	Open	15.6	245
6/10/2026	15:00:00	6.9	1.6883	2.1	1,368,615	Open	14.9	261
6/10/2026	15:15:00	6.9	0.1817	2	1,368,622	Open	17	243
6/10/2026	15:30:00	6.8	1.6694	2.5	1,368,644	Open	15	259
6/10/2026	15:45:00	6.7	1.1016	3.2	1,368,651	Open	17.3	259



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/10/2026	16:00:00	6.7	0.1893	4.1	1,368,668	Open	15.9	243
6/10/2026	16:15:00	6.7	1.7110	3	1,368,685	Open	15.1	258
6/10/2026	16:30:00	6.8	0.1476	3.4	1,368,698	Open	16.2	243
6/10/2026	16:45:00	6.7	1.7299	3.1	1,368,716	Open	15.2	258
6/10/2026	17:00:00	6.8	0.2006	3.5	1,368,723	Open	17.6	242
6/10/2026	17:15:00	6.8	0.2082	2.4	1,368,736	Open	15.5	243
6/10/2026	17:30:00	6.8	1.7413	2.8	1,368,746	Open	15.4	256
6/10/2026	17:45:00	6.8	0.1628	2.5	1,368,762	Open	15.6	243
6/10/2026	18:00:00	6.8	1.6883	3.9	1,368,765	Open	19	243
6/10/2026	18:15:00	6.8	0.1968	2.3	1,368,786	Open	16.9	242
6/10/2026	18:30:00	6.8	1.6732	3.1	1,368,790	Open	19.1	259
6/10/2026	18:45:00	6.8	0.1779	3.6	1,368,809	Open	15.4	240
6/10/2026	19:00:00	6.7	1.6959	3.3	1,368,816	Open	15.7	256
6/10/2026	19:15:00	6.8	0.1703	3.8	1,368,824	Open	16.7	242
6/10/2026	19:30:00	6.7	0.1817	3.4	1,368,842	Open	15	257
6/10/2026	19:45:00	6.8	0.0000	3.9	1,368,843	Closed	18.3	242
6/10/2026	20:00:00	6.7	1.6807	3.6	1,368,850	Open	15.6	245
6/10/2026	20:15:00	6.8	0.0000	3.5	1,368,862	Closed	15.7	255
6/10/2026	20:30:00	6.7	0.0000	2.9	1,368,878	Closed	14.8	253
6/10/2026	20:45:00	6.8	0.0000	3.1	1,368,878	Closed	16.7	258
6/10/2026	21:00:00	6.6	3.8687	2.5	1,368,901	Closed	14.9	258
6/10/2026	21:15:00	6.6	1.4422	1.9	1,368,903	Closed	16.4	258
6/10/2026	21:30:00	6.6	1.6807	1	1,368,915	Open	14.7	258
6/10/2026	21:45:00	7	1.1016	1.1	1,368,939	Open	14.9	253
6/10/2026	22:00:00	7.3	1.5823	1	1,368,962	Open	14.4	255
6/10/2026	22:15:00	7.4	1.6504	1	1,368,972	Open	14.4	256
6/10/2026	22:30:00	7.8	0.0000	3.9	1,368,984	Closed	14.2	253
6/10/2026	22:45:00	7.6	1.8321	1.8	1,368,992	Open	14.4	253
6/10/2026	23:00:00	7.7	0.0000	1.6	1,369,012	Closed	14.4	255
6/10/2026	23:15:00	7.7	1.7867	3.1	1,369,028	Open	14.1	248
6/10/2026	23:30:00	7.7	1.8170	3.2	1,369,038	Open	14.9	257
6/10/2026	23:45:00	7.7	0.0000	2.8	1,369,056	Closed	14.6	256



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/11/2026	0:00:00	7.7	1.7829	3.6	1,369,068	Open	14.3	257
6/11/2026	0:15:00	7.7	0.0000	4.3	1,369,073	Closed	16.1	258
6/11/2026	0:30:00	7.7	0.0000	5	1,369,084	Closed	15.1	255
6/11/2026	0:45:00	7.7	0.0000	4.6	1,369,101	Closed	14.3	253
6/11/2026	1:00:00	7.7	1.8019	3.8	1,369,103	Open	15.3	256
6/11/2026	1:15:00	7.7	0.0000	3.9	1,369,111	Closed	16.3	258
6/11/2026	1:30:00	7.7	1.7678	4.1	1,369,123	Open	14.4	258
6/11/2026	1:45:00	7.7	1.1659	4.5	1,369,128	Open	15.7	258
6/11/2026	2:00:00	7.8	0.0000	4.2	1,369,144	Closed	14.7	255
6/11/2026	2:15:00	7.8	1.7716	4.2	1,369,162	Open	14.3	255
6/11/2026	2:30:00	7.8	1.7413	4.2	1,369,166	Open	15.3	256
6/11/2026	2:45:00	7.8	0.0000	4.3	1,369,185	Closed	14.5	253
6/11/2026	3:00:00	7.8	1.7640	4.4	1,369,202	Open	14.4	255
6/11/2026	3:15:00	7.7	1.7451	4.6	1,369,210	Open	15	257
6/11/2026	3:30:00	7.7	0.0000	4.6	1,369,222	Closed	15	255
6/11/2026	3:45:00	7.7	1.1205	6.3	1,369,231	Open	14.9	253
6/11/2026	4:00:00	7.7	1.7791	6	1,369,239	Open	15.9	256
6/11/2026	4:15:00	7.7	0.0000	5.1	1,369,261	Closed	14.5	255
6/11/2026	4:30:00	7.7	1.6807	5.4	1,369,264	Open	15.3	258
6/11/2026	4:45:00	7.7	0.0000	1.7	1,369,276	Closed	15	253
6/11/2026	5:00:00	7.7	1.6656	0.9	1,369,288	Open	14.5	255
6/11/2026	5:15:00	7.7	0.0000	0.7	1,369,291	Closed	16.1	255
6/11/2026	5:30:00	7.6	1.6618	1.2	1,369,297	Open	15.6	257
6/11/2026	5:45:00	7.6	0.0000	1.6	1,369,315	Closed	14.4	253
6/11/2026	6:00:00	7.6	1.6467	2.9	1,369,328	Open	14.1	256
6/11/2026	6:15:00	7.6	0.0000	2.7	1,369,340	Closed	14.8	257
6/11/2026	6:30:00	7.6	0.0000	3.7	1,369,350	Closed	14.6	257
6/11/2026	6:45:00	7.6	1.6315	3	1,369,365	Open	13.9	246
6/11/2026	7:00:00	7.6	0.0000	2.3	1,369,366	Closed	15.5	250
6/11/2026	7:15:00	7.6	0.0000	2.5	1,369,381	Closed	13.8	250
6/11/2026	7:30:00	7.6	1.6618	2.6	1,369,383	Open	14.7	253
6/11/2026	7:45:00	7.6	0.0000	2.1	1,369,396	Closed	14.2	261



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/11/2026	8:00:00	7.6	1.6239	2.4	1,369,405	Open	14.1	259
6/11/2026	8:15:00	7.7	0.0000	2.4	1,369,412	Closed	15.3	263
6/11/2026	8:30:00	7.7	0.0000	7.9	1,369,422	Closed	14.5	263
6/11/2026	8:45:00	7.7	1.6542	2.3	1,369,433	Open	14.2	263
6/11/2026	9:00:00	7.7	0.1476	1.5	1,369,448	Open	14.6	263
6/11/2026	9:15:00	7.8	1.6580	2.1	1,369,465	Open	14.3	263
6/11/2026	9:30:00	7.8	0.1703	1.1	1,369,469	Open	15.7	247
6/11/2026	9:45:00	7.7	1.1205	2.5	1,369,475	Open	15.7	259
6/11/2026	10:00:00	7.7	1.6050	1.4	1,369,498	Open	14.5	262
6/11/2026	10:15:00	7.7	0.1325	1.2	1,369,506	Open	15.5	245
6/11/2026	10:30:00	7.7	0.1893	1.1	1,369,508	Open	16.7	243
6/11/2026	10:45:00	7.6	0.2082	2	1,369,525	Open	14.8	260
6/11/2026	11:00:00	7.6	0.2309	1.7	1,369,528	Open	16.6	245
6/11/2026	11:15:00	7.6	0.2385	5	1,369,540	Open	15.1	259
6/11/2026	11:30:00	7.6	1.6315	5.1	1,369,550	Open	14.7	251
6/11/2026	11:45:00	7.6	0.1703	4.3	1,369,569	Open	14.6	110
6/11/2026	12:00:00	7.6	1.6656	4.5	1,369,586	Open	14.4	255
6/11/2026	12:15:00	7.6	0.0908	6.1	1,369,603	Open	14.5	255
6/11/2026	12:30:00	7.6	0.1855	4	1,369,606	Open	15.6	243
6/11/2026	12:45:00	7.6	1.4650	19.4	1,369,612	Open	15.4	263
6/11/2026	13:00:00	7.6	0.1590	3.4	1,369,627	Open	14.8	248
6/11/2026	13:15:00	7.6	1.7640	4	1,369,641	Open	14.5	263
6/11/2026	13:30:00	7.6	1.7489	3.4	1,369,667	Open	14.3	261
6/11/2026	13:45:00	7.6	0.9539	3.1	1,369,677	Open	14.8	263
6/11/2026	14:00:00	7.7	1.3476	2.9	1,369,697	Open	14.3	263
6/11/2026	14:15:00	7.6	0.3255	4.4	1,369,709	Open	15	253
6/11/2026	14:30:00	7.6	1.7564	3	1,369,732	Open	14.3	263
6/11/2026	14:45:00	7.6	1.7526	3	1,369,745	Open	14.7	264
6/11/2026	15:00:00	7.5	1.7148	3.2	1,369,771	Open	14.3	263
6/11/2026	15:15:00	7.5	1.7261	3.3	1,369,781	Open	14.9	268
6/11/2026	15:30:00	7.6	1.7034	3.1	1,369,807	Open	14.3	266
6/11/2026	15:45:00	7.8	0.2271	21.6	1,369,827	Open	14.7	256



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/11/2026	16:00:00	7.6	1.3779	1.4	1,369,840	Open	14.7	268
6/11/2026	16:15:00	7.2	0.1211	9.8	1,369,851	Open	14.7	268
6/11/2026	16:30:00	7.6	1.8208	3	1,369,865	Open	14.4	273
6/11/2026	16:45:00	7.6	1.7602	3.1	1,369,877	Open	14.7	276
6/11/2026	17:00:00	7.6	1.7413	2.8	1,369,903	Open	14.4	276
6/11/2026	17:15:00	7.6	1.7791	2.9	1,369,913	Open	14.6	278
6/11/2026	17:30:00	7.6	1.7299	3	1,369,939	Open	14.3	278
6/11/2026	17:45:00	7.6	0.2915	2.6	1,369,957	Open	14.6	268
6/11/2026	18:00:00	7.6	1.7261	3.5	1,369,978	Open	14.3	278
6/11/2026	18:15:00	7.6	0.2006	2.6	1,370,002	Open	14.2	278
6/11/2026	18:30:00	7.6	1.7186	2.9	1,370,014	Open	14.2	279
6/11/2026	18:45:00	7.6	1.6845	2.4	1,370,040	Open	14.1	279
6/11/2026	19:00:00	7.6	1.7072	2.7	1,370,051	Open	14.4	281
6/11/2026	19:15:00	7.6	1.7186	2.6	1,370,073	Open	14.2	279
6/11/2026	19:30:00	7.6	1.7337	2.6	1,370,084	Open	14.3	283
6/11/2026	19:45:00	7.6	0.2423	3.1	1,370,105	Open	14.4	279
6/11/2026	20:00:00	7.6	1.6996	5.1	1,370,119	Open	14.2	279
6/11/2026	20:15:00	7.6	0.1022	4.7	1,370,140	Open	14.1	279
6/11/2026	20:30:00	7.6	1.7224	5.5	1,370,151	Open	14.1	282
6/11/2026	20:45:00	7.6	0.2233	5.1	1,370,172	Open	14.1	284
6/11/2026	21:00:00	7.6	1.6959	4.9	1,370,181	Open	14.2	281
6/11/2026	21:15:00	7.6	0.0000	5	1,370,185	Closed	15.6	281
6/11/2026	21:30:00	7.6	1.6769	2.3	1,370,209	Open	14.2	281
6/11/2026	21:45:00	7.6	1.0410	2.7	1,370,232	Open	14.6	281
6/11/2026	22:00:00	7.7	1.6542	2.2	1,370,256	Open	14	281
6/11/2026	22:15:00	7.6	1.6315	5.1	1,370,281	Open	13.9	281
6/11/2026	22:30:00	7.6	1.6656	2.5	1,370,302	Open	14	281
6/11/2026	22:45:00	7.5	1.6694	2.7	1,370,327	Open	14	281
6/11/2026	23:00:00	7.5	1.6807	2.7	1,370,350	Open	13.9	279
6/11/2026	23:15:00	7.6	1.6921	3.2	1,370,374	Open	13.7	279
6/11/2026	23:30:00	7.6	1.6807	3.4	1,370,399	Open	13.6	281
6/11/2026	23:45:00	7.6	0.2309	3.6	1,370,418	Open	13.6	279



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/12/2026	0:00:00	7.6	1.6921	3.4	1,370,434	Open	13.4	277
6/12/2026	0:15:00	7.6	1.9836	8.1	1,370,459	Open	13.3	276
6/12/2026	0:30:00	7.7	0.0000	4.7	1,370,469	Closed	13.2	271
6/12/2026	0:45:00	7.7	1.7375	3.7	1,370,491	Open	13.1	276
6/12/2026	1:00:00	7.7	1.7337	4.4	1,370,517	Open	13.3	276
6/12/2026	1:15:00	7.7	1.7981	5.2	1,370,528	Open	13.4	274
6/12/2026	1:30:00	7.6	0.0000	4	1,370,546	Closed	13.6	279
6/12/2026	1:45:00	7.6	1.1508	7.3	1,370,564	Open	13.7	279
6/12/2026	2:00:00	7.5	1.7791	6.2	1,370,590	Open	13.5	281
6/12/2026	2:15:00	7.5	1.7640	7	1,370,604	Open	13.5	281
6/12/2026	2:30:00	7.5	0.0000	8.9	1,370,618	Closed	14.5	279
6/12/2026	2:45:00	7.6	1.7564	8.6	1,370,643	Open	13.6	279
6/12/2026	3:00:00	7.6	0.0000	4.5	1,370,657	Closed	14.1	276
6/12/2026	3:15:00	7.7	1.7261	7.6	1,370,676	Open	13.5	268
6/12/2026	3:30:00	7.7	0.0000	6.4	1,370,690	Closed	13.9	276
6/12/2026	3:45:00	7.7	0.8744	10.4	1,370,693	Open	13.7	269
6/12/2026	4:00:00	7.6	1.7261	26.3	1,370,702	Closed	13.4	266
6/12/2026	4:15:00	7.7	2.0063	37.2	1,370,702	Closed	13.3	268
6/12/2026	4:30:00	7.7	1.9078	25.7	1,370,704	Closed	13.3	271
6/12/2026	4:45:00	7.6	1.8813	18.6	1,370,724	Closed	13.3	274
6/12/2026	5:00:00	7.6	1.7716	4.1	1,370,740	Open	13.3	278
6/12/2026	5:15:00	7.6	0.0000	5.1	1,370,756	Closed	13.5	283
6/12/2026	5:30:00	7.6	1.8208	4.1	1,370,775	Open	13.4	276
6/12/2026	5:45:00	7.6	0.0000	3.3	1,370,788	Closed	13.9	286
6/12/2026	6:00:00	7.6	1.8056	3	1,370,813	Open	13.4	279
6/12/2026	6:15:00	7.7	1.8321	3.4	1,370,825	Open	13.7	279
6/12/2026	6:30:00	7.7	1.7716	3.4	1,370,852	Open	13.4	279
6/12/2026	6:45:00	7.7	1.7110	4.1	1,370,862	Open	13.4	281
6/12/2026	7:00:00	7.6	1.7034	4.1	1,370,887	Open	13.4	281
6/12/2026	7:15:00	7.6	1.7224	6	1,370,900	Open	14	281
6/12/2026	7:30:00	7.6	1.6353	4.8	1,370,925	Open	13.5	283
6/12/2026	7:45:00	7.6	0.0000	5.4	1,370,935	Closed	14.1	291



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/12/2026	8:00:00	7.6	1.6504	4.8	1,370,959	Open	13.5	283
6/12/2026	8:15:00	7.6	0.0000	4.2	1,370,967	Closed	14.3	291
6/12/2026	8:30:00	7.7	1.6467	5.6	1,370,985	Open	13.6	288
6/12/2026	8:45:00	7.7	1.6391	6.7	1,371,006	Open	13.7	272
6/12/2026	9:00:00	7.7	0.4013	5.1	1,371,028	Closed	13.5	277
6/12/2026	9:15:00	7.7	0.0000	8.1	1,371,032	Closed	13.5	279
6/12/2026	9:30:00	7.7	1.7526	19.8	1,371,040	Open	13.4	279
6/12/2026	9:45:00	7.7	1.7110	6.4	1,371,060	Open	13.6	279
6/12/2026	10:00:00	7.7	0.1401	2.5	1,371,079	Open	13.7	279
6/12/2026	10:15:00	7.7	1.7413	2.9	1,371,093	Open	13.8	281
6/12/2026	10:30:00	7.7	1.7261	6.2	1,371,118	Open	13.8	279
6/12/2026	10:45:00	7.4	0.2725	2.6	1,371,133	Open	14.3	268
6/12/2026	11:00:00	7.6	1.6807	3.6	1,371,146	Open	14	279
6/12/2026	11:15:00	7.7	0.2650	4.3	1,371,162	Open	14.4	279
6/12/2026	11:30:00	7.7	1.6845	4.4	1,371,178	Open	14.2	276
6/12/2026	11:45:00	7.7	0.2801	3.8	1,371,194	Open	14.7	268
6/12/2026	12:00:00	7.7	1.6769	3.8	1,371,211	Open	14.3	278
6/12/2026	12:15:00	7.7	0.1666	3.9	1,371,227	Open	14.9	276
6/12/2026	12:30:00	7.7	1.6391	3.2	1,371,246	Open	14.6	279
6/12/2026	12:45:00	7.7	0.2612	5.9	1,371,261	Open	15.2	269
6/12/2026	13:00:00	7.7	1.6315	4	1,371,276	Open	14.9	277
6/12/2026	13:15:00	7.7	1.6277	4.5	1,371,298	Open	15	279
6/12/2026	13:30:00	7.7	1.6504	7.9	1,371,309	Open	15.2	279
6/12/2026	13:45:00	7.7	1.6126	4	1,371,331	Open	15.5	289
6/12/2026	14:00:00	7.7	0.1893	4.2	1,371,347	Open	15.9	289
6/12/2026	14:15:00	7.7	1.6580	5.6	1,371,366	Open	16	287
6/12/2026	14:30:00	7.7	0.2953	4.7	1,371,381	Open	16.4	272
6/12/2026	14:45:00	7.7	1.6126	6.9	1,371,396	Open	16.1	287
6/12/2026	15:00:00	7.7	1.5861	4.7	1,371,420	Open	15.8	287
6/12/2026	15:15:00	7.7	0.2650	3.7	1,371,432	Open	16.5	269
6/12/2026	15:30:00	7.7	1.6391	6	1,371,443	Open	16.1	286
6/12/2026	15:45:00	7.7	0.1628	8.1	1,371,462	Open	16	288



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/12/2026	16:00:00	7.7	1.6012	10.1	1,371,474	Open	15.9	278
6/12/2026	16:15:00	7.7	1.5937	8.4	1,371,494	Open	15.8	276
6/12/2026	16:30:00	7.8	1.5974	6.7	1,371,518	Open	15.8	288
6/12/2026	16:45:00	7.7	0.2461	2	1,371,532	Open	16.9	269
6/12/2026	17:00:00	7.9	0.7344	14.3	1,371,543	Open	16	286
6/12/2026	17:15:00	7.9	0.2423	18.2	1,371,549	Open	16.3	286
6/12/2026	17:30:00	7.8	1.6996	5.9	1,371,574	Open	16.1	286
6/12/2026	17:45:00	7.7	0.3104	3.1	1,371,584	Open	16.6	268
6/12/2026	18:00:00	7.8	1.6959	6.8	1,371,602	Open	16.1	284
6/12/2026	18:15:00	7.8	0.2044	4.7	1,371,614	Open	16.3	286
6/12/2026	18:30:00	7.8	1.6542	6.2	1,371,635	Open	15.9	286
6/12/2026	18:45:00	7.8	0.1931	8.2	1,371,647	Open	16.2	269
6/12/2026	19:00:00	7.8	1.6580	7.7	1,371,667	Open	15.9	287
6/12/2026	19:15:00	7.8	0.2158	7.8	1,371,676	Open	16.3	269
6/12/2026	19:30:00	7.8	1.6239	11.5	1,371,689	Open	15.9	278
6/12/2026	19:45:00	7.8	0.2725	7.6	1,371,698	Open	16.3	269
6/12/2026	20:00:00	7.7	1.6694	21.6	1,371,704	Open	17.4	278
6/12/2026	20:15:00	7.8	0.0000	14.2	1,371,713	Closed	15.7	276
6/12/2026	20:30:00	7.8	1.6429	10.6	1,371,727	Open	15.5	276
6/12/2026	20:45:00	7.8	0.0000	6.3	1,371,734	Closed	15.7	276
6/12/2026	21:00:00	7.7	1.6012	7.9	1,371,755	Open	14.9	279
6/12/2026	21:15:00	7.7	1.6277	9.8	1,371,760	Open	15.3	279
6/12/2026	21:30:00	7.7	1.5861	8.1	1,371,784	Open	14.5	278
6/12/2026	21:45:00	7.8	0.8669	25.1	1,371,788	Open	14.8	279
6/12/2026	22:00:00	7.8	1.5293	9.4	1,371,805	Open	14.3	277
6/12/2026	22:15:00	7.8	0.0000	9.2	1,371,813	Closed	14.5	276
6/12/2026	22:30:00	7.8	1.7034	10	1,371,826	Open	14.3	279
6/12/2026	22:45:00	7.8	0.6776	8.7	1,371,834	Closed	14.5	278
6/12/2026	23:00:00	7.8	1.7375	9.8	1,371,853	Open	14.3	279
6/12/2026	23:15:00	7.8	1.7110	11.4	1,371,874	Open	14.3	279
6/12/2026	23:30:00	7.8	1.7413	11.4	1,371,883	Open	14.7	279
6/12/2026	23:45:00	7.8	0.0000	11.1	1,371,896	Closed	14.5	279



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/13/2026	0:00:00	7.8	1.6959	9.6	1,371,908	Open	14.4	278
6/13/2026	0:15:00	7.8	0.0000	6.4	1,371,909	Closed	14.8	279
6/13/2026	0:30:00	7.8	1.6769	8.2	1,371,926	Open	14.3	279
6/13/2026	0:45:00	7.8	1.6959	9.9	1,371,933	Open	14.5	283
6/13/2026	1:00:00	7.8	0.0000	10.8	1,371,949	Closed	14.2	279
6/13/2026	1:15:00	7.8	1.7526	10.1	1,371,962	Open	14.2	283
6/13/2026	1:30:00	7.8	0.0000	12.5	1,371,974	Closed	14.4	279
6/13/2026	1:45:00	7.8	1.7224	11.1	1,371,997	Open	14.1	283
6/13/2026	2:00:00	7.8	0.0000	8.2	1,372,000	Closed	14.6	279
6/13/2026	2:15:00	7.8	1.6769	6.9	1,372,016	Open	14.1	279
6/13/2026	2:30:00	7.8	0.0000	3.6	1,372,025	Closed	14.5	279
6/13/2026	2:45:00	7.8	1.6921	4.8	1,372,050	Open	14.1	281
6/13/2026	3:00:00	7.8	0.9047	16.8	1,372,054	Open	14.3	283
6/13/2026	3:15:00	7.8	0.0000	9	1,372,070	Closed	14.1	279
6/13/2026	3:30:00	7.8	1.0940	7	1,372,076	Open	14.1	278
6/13/2026	3:45:00	7.8	1.6504	5.3	1,372,082	Open	14.4	279
6/13/2026	4:00:00	7.9	0.0000	3.9	1,372,100	Closed	14.1	276
6/13/2026	4:15:00	7.8	1.6769	4.8	1,372,104	Open	14.2	281
6/13/2026	4:30:00	7.9	0.0000	4.2	1,372,118	Closed	14.1	276
6/13/2026	4:45:00	7.9	1.6618	4.7	1,372,124	Open	13.9	279
6/13/2026	5:00:00	7.9	0.0000	6	1,372,133	Closed	14	278
6/13/2026	5:15:00	7.9	1.6504	5.8	1,372,136	Open	14.2	281
6/13/2026	5:30:00	7.9	0.0000	5.1	1,372,156	Closed	13.7	278
6/13/2026	5:45:00	7.9	1.6429	7.1	1,372,167	Open	13.6	281
6/13/2026	6:00:00	7.8	0.0000	7.2	1,372,184	Closed	13.6	278
6/13/2026	6:15:00	7.7	1.6164	7.9	1,372,190	Open	13.6	278
6/13/2026	6:30:00	7.7	0.0000	5.4	1,372,206	Closed	13.6	274
6/13/2026	6:45:00	7.7	1.6050	7.6	1,372,220	Open	13.5	278
6/13/2026	7:00:00	7.7	0.0000	4.4	1,372,233	Closed	13.7	274
6/13/2026	7:15:00	7.7	1.6315	5.3	1,372,245	Open	13.6	278
6/13/2026	7:30:00	7.7	0.3218	3.6	1,372,251	Open	14	266
6/13/2026	7:45:00	7.7	0.2763	3.3	1,372,264	Open	13.8	273



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/13/2026	8:00:00	7.7	1.6315	3	1,372,273	Open	13.7	276
6/13/2026	8:15:00	7.7	0.1741	5.1	1,372,285	Open	13.8	271
6/13/2026	8:30:00	7.7	1.6164	3	1,372,301	Open	13.7	274
6/13/2026	8:45:00	7.7	0.2877	2.5	1,372,313	Open	13.9	274
6/13/2026	9:00:00	7.7	1.5747	2.6	1,372,328	Open	13.7	273
6/13/2026	9:15:00	7.7	0.2612	2.9	1,372,340	Open	14	271
6/13/2026	9:30:00	7.7	0.7609	3.4	1,372,346	Open	14.3	273
6/13/2026	9:45:00	7.8	0.2877	3.9	1,372,353	Open	14.3	270
6/13/2026	10:00:00	7.7	1.6088	7.3	1,372,362	Open	14.3	263
6/13/2026	10:15:00	7.7	0.0000	2	1,372,371	Closed	14.4	269
6/13/2026	10:30:00	7.7	0.0000	5.6	1,372,385	Closed	14.4	269
6/13/2026	10:45:00	7.7	1.5634	4	1,372,390	Open	14.5	273
6/13/2026	11:00:00	7.7	1.5520	3.1	1,372,414	Open	14.6	274
6/13/2026	11:15:00	7.7	0.0000	1.7	1,372,426	Closed	14.9	279
6/13/2026	11:30:00	7.7	1.5747	2.2	1,372,446	Open	14.8	281
6/13/2026	11:45:00	7.7	0.2271	1.5	1,372,460	Open	15.1	281
6/13/2026	12:00:00	7.8	1.1508	6.1	1,372,474	Open	15.1	279
6/13/2026	12:15:00	7.8	0.1363	7.1	1,372,480	Open	15.3	279
6/13/2026	12:30:00	7.7	1.5293	5.2	1,372,493	Open	15.3	276
6/13/2026	12:45:00	7.7	0.2498	2.1	1,372,504	Open	15.7	281
6/13/2026	13:00:00	7.7	1.5672	2.9	1,372,523	Open	15.5	281
6/13/2026	13:15:00	7.7	0.2612	2.3	1,372,534	Open	15.8	279
6/13/2026	13:30:00	7.7	1.5634	2.7	1,372,547	Open	15.7	279
6/13/2026	13:45:00	7.7	0.2385	2.6	1,372,558	Open	16	279
6/13/2026	14:00:00	7.6	1.5709	2.8	1,372,567	Open	16.2	279
6/13/2026	14:15:00	7.6	0.1514	2.7	1,372,578	Open	16	278
6/13/2026	14:30:00	7.6	1.5558	3.2	1,372,587	Open	15.9	279
6/13/2026	14:45:00	7.6	0.2461	2.7	1,372,598	Open	16	279
6/13/2026	15:00:00	7.6	0.2574	2.8	1,372,602	Open	16.5	265
6/13/2026	15:15:00	7.6	1.5293	3	1,372,612	Open	16	279
6/13/2026	15:30:00	7.6	0.2158	2.6	1,372,626	Open	15.9	279
6/13/2026	15:45:00	7.6	1.5482	2.7	1,372,631	Open	16.7	281



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/13/2026	16:00:00	7.6	1.5142	2.4	1,372,654	Open	15.8	278
6/13/2026	16:15:00	7.6	0.2612	2.3	1,372,660	Open	16.3	279
6/13/2026	16:30:00	7.6	1.4990	2.3	1,372,679	Open	15.9	278
6/13/2026	16:45:00	7.6	0.1438	2.2	1,372,685	Open	16.3	278
6/13/2026	17:00:00	7.6	1.4990	2.6	1,372,702	Open	16	279
6/13/2026	17:15:00	7.6	0.1514	2.3	1,372,708	Open	16.7	276
6/13/2026	17:30:00	7.6	1.5142	2.8	1,372,724	Open	16.3	276
6/13/2026	17:45:00	7.6	0.1817	2.2	1,372,731	Open	16.9	278
6/13/2026	18:00:00	7.6	1.5104	3	1,372,747	Open	16.4	278
6/13/2026	18:15:00	7.6	0.0000	2.1	1,372,753	Open	16.6	276
6/13/2026	18:30:00	7.6	0.0151	2.3	1,372,754	Open	17.4	279
6/13/2026	18:45:00	7.6	0.2082	3.4	1,372,763	Open	16.5	276
6/13/2026	19:00:00	7.6	1.5217	3.7	1,372,772	Open	16.2	279
6/13/2026	19:15:00	7.6	0.2536	1.7	1,372,777	Open	16.4	260
6/13/2026	19:30:00	7.7	0.0000	6.2	1,372,787	Open	15.5	276
6/13/2026	19:45:00	7.6	0.0000	1.9	1,372,791	Closed	15.4	274
6/13/2026	20:00:00	7.6	1.5937	2.5	1,372,810	Open	15.2	274
6/13/2026	20:15:00	7.6	0.0000	1.7	1,372,824	Closed	15.5	274
6/13/2026	20:30:00	7.6	1.5785	5.4	1,372,830	Open	15.3	276
6/13/2026	20:45:00	7.6	0.0000	2.1	1,372,836	Closed	15.8	274
6/13/2026	21:00:00	7.6	1.5672	2.7	1,372,845	Open	15.2	268
6/13/2026	21:15:00	7.7	0.0000	2	1,372,855	Closed	15.6	276
6/13/2026	21:30:00	7.7	1.5520	2.7	1,372,870	Open	15.1	268
6/13/2026	21:45:00	7.7	0.0000	2.3	1,372,875	Closed	15.7	269
6/13/2026	22:00:00	7.7	1.5634	2.3	1,372,894	Open	14.9	268
6/13/2026	22:15:00	7.7	1.1470	2.6	1,372,896	Open	15.6	268
6/13/2026	22:30:00	7.7	0.0000	3.2	1,372,912	Closed	14.8	268
6/13/2026	22:45:00	7.7	1.5899	3.6	1,372,919	Open	14.6	268
6/13/2026	23:00:00	7.7	0.0000	3.3	1,372,931	Closed	14.6	268
6/13/2026	23:15:00	7.7	1.5596	4	1,372,942	Open	14.3	266
6/13/2026	23:30:00	7.8	0.0000	5.3	1,372,951	Open	14.1	266
6/13/2026	23:45:00	7.8	0.0000	5.4	1,372,951	Closed	14.6	268



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/14/2026	0:00:00	7.8	1.5255	3.6	1,372,969	Open	14	264
6/14/2026	0:15:00	7.3	0.0000	10	1,372,975	Closed	14.1	264
6/14/2026	0:30:00	7.8	1.5899	6.7	1,372,995	Open	13.9	266
6/14/2026	0:45:00	7.8	0.0000	6.2	1,373,017	Closed	13.9	268
6/14/2026	1:00:00	7.8	1.5937	7.3	1,373,026	Open	14	271
6/14/2026	1:15:00	7.8	0.0000	5.8	1,373,039	Closed	14.1	274
6/14/2026	1:30:00	7.7	1.5747	6.2	1,373,047	Open	14.1	279
6/14/2026	1:45:00	7.8	0.0000	6	1,373,056	Closed	14.7	291
6/14/2026	2:00:00	7.7	0.0000	4.2	1,373,056	Closed	16	278
6/14/2026	2:15:00	7.1	0.0000	5.3	1,373,064	Closed	14.5	281
6/14/2026	2:30:00	7.1	1.6353	3.5	1,373,070	Open	14.8	284
6/14/2026	2:45:00	7.4	0.0000	3.5	1,373,083	Closed	14.7	296
6/14/2026	3:00:00	7.5	1.3476	3.8	1,373,089	Open	14.4	286
6/14/2026	3:15:00	7.3	0.0000	2.6	1,373,104	Closed	14.3	287
6/14/2026	3:30:00	7.3	0.0000	5.7	1,373,104	Open	14.8	279
6/14/2026	3:45:00	7.3	1.6164	4.9	1,373,107	Open	16.3	278
6/14/2026	4:00:00	7.5	0.0000	3.9	1,373,122	Closed	13.9	284
6/14/2026	4:15:00	7.5	0.0000	2.5	1,373,122	Closed	14.4	286
6/14/2026	4:30:00	7.6	1.6012	5	1,373,141	Open	13.7	300
6/14/2026	4:45:00	7.7	1.5974	3.6	1,373,151	Open	13.7	304
6/14/2026	5:00:00	7.7	1.3022	3.4	1,373,172	Open	13.8	304
6/14/2026	5:15:00	7.8	0.0000	3.8	1,373,182	Closed	14.2	304
6/14/2026	5:30:00	7.7	0.0000	3.6	1,373,192	Closed	14	304
6/14/2026	5:45:00	7.7	0.0000	2.4	1,373,192	Closed	15.2	307
6/14/2026	6:00:00	7.6	1.2719	3.7	1,373,209	Open	14.2	305
6/14/2026	6:15:00	7.6	0.0000	3.3	1,373,222	Closed	14.4	305
6/14/2026	6:30:00	7.6	1.2833	7.1	1,373,226	Open	14.4	307
6/14/2026	6:45:00	7.6	0.0000	3.7	1,373,243	Closed	14.2	305
6/14/2026	7:00:00	7.6	0.0000	2.6	1,373,243	Closed	15.7	310
6/14/2026	7:15:00	7.6	0.0000	4.1	1,373,257	Closed	14.6	307
6/14/2026	7:30:00	7.6	1.2568	5.9	1,373,257	Closed	16.1	309
6/14/2026	7:45:00	7.6	1.2757	3.2	1,373,276	Open	14.2	307



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/14/2026	8:00:00	7.6	0.0000	2.2	1,373,278	Closed	15.4	310
6/14/2026	8:15:00	7.7	0.0908	3.4	1,373,288	Open	14.3	309
6/14/2026	8:30:00	7.7	1.2681	4.1	1,373,295	Open	14.2	305
6/14/2026	8:45:00	7.7	1.2605	3.4	1,373,314	Open	14.2	305
6/14/2026	9:00:00	7.7	0.1893	5.4	1,373,328	Open	14.8	286
6/14/2026	9:15:00	7.8	0.2158	7.7	1,373,331	Open	17.9	286
6/14/2026	9:30:00	7.8	1.2605	2.6	1,373,343	Open	14.8	296
6/14/2026	9:45:00	7.7	0.1590	1.7	1,373,353	Open	15.4	283
6/14/2026	10:00:00	7.8	0.0000	11.4	1,373,358	Open	14.8	292
6/14/2026	10:15:00	7.8	1.2189	1.8	1,373,375	Open	14.8	294
6/14/2026	10:30:00	7.8	1.0751	2.1	1,373,380	Closed	14.5	296
6/14/2026	10:45:00	7.8	1.2038	1.9	1,373,384	Open	14.7	294
6/14/2026	11:00:00	7.8	0.1363	2.1	1,373,390	Open	15.2	278
6/14/2026	11:15:00	7.7	1.2189	2.4	1,373,394	Open	16.9	292
6/14/2026	11:30:00	7.8	1.1924	2	1,373,412	Open	15.1	289
6/14/2026	11:45:00	7.8	0.7949	2.1	1,373,430	Open	15.2	289
6/14/2026	12:00:00	7.8	1.2151	2.1	1,373,435	Open	16.6	288
6/14/2026	12:15:00	7.8	1.2075	2.3	1,373,453	Open	15.5	286
6/14/2026	12:30:00	7.8	1.0902	2.3	1,373,454	Closed	15.5	286
6/14/2026	12:45:00	7.9	0.3066	17.2	1,373,470	Open	15.8	271
6/14/2026	13:00:00	7.9	1.1583	93.7	1,373,475	Open	17.6	269
6/14/2026	13:15:00	7.9	0.3104	11.9	1,373,492	Open	16.1	267
6/14/2026	13:30:00	7.8	0.4429	7.4	1,373,498	Open	17.8	268
6/14/2026	13:45:00	7.7	0.2801	9.6	1,373,508	Open	16.5	268
6/14/2026	14:00:00	7.8	1.8246	6.7	1,373,514	Open	16.8	286
6/14/2026	14:15:00	7.8	0.0000	3.1	1,373,539	Closed	16.4	288
6/14/2026	14:30:00	7.8	0.9653	3.1	1,373,539	Closed	16.5	289
6/14/2026	14:45:00	7.8	0.2461	2.7	1,373,543	Open	16.9	293
6/14/2026	15:00:00	7.8	0.2725	3	1,373,562	Open	16.7	276
6/14/2026	15:15:00	7.7	1.8397	3.8	1,373,570	Open	17.4	296
6/14/2026	15:30:00	7.7	0.1817	2.2	1,373,589	Open	16.9	276
6/14/2026	15:45:00	7.7	1.7905	3.8	1,373,600	Open	16.7	296



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature	Discharge Conductivity
6/14/2026	16:00:00	7.7	1.6126	2.9	1,373,605	Closed	16.7	298
6/14/2026	16:15:00	7.7	0.3142	2.1	1,373,607	Open	16.9	278
6/14/2026	16:30:00	7.8	0.7874	11.6	1,373,614	Open	16.7	294
6/14/2026	16:45:00	7.8	0.2082	6.5	1,373,619	Open	17	298
6/14/2026	17:00:00	7.8	0.2688	7.1	1,373,628	Open	16.7	298
6/14/2026	17:15:00	7.8	0.3066	3.9	1,373,633	Open	17.4	279
6/14/2026	17:30:00	7.8	0.2158	5.2	1,373,636	Open	18	278
6/14/2026	17:45:00	7.7	0.2271	1.5	1,373,658	Open	16.8	279
6/14/2026	18:00:00	7.8	1.7791	2.6	1,373,666	Open	17.2	298
6/14/2026	18:15:00	7.8	1.6353	28.1	1,373,674	Closed	16.5	289
6/14/2026	18:30:00	7.9	0.0000	11	1,373,681	Open	16.2	283
6/14/2026	18:45:00	7.9	0.0000	11.6	1,373,681	Open	16.2	284
6/14/2026	19:00:00	7.7	1.5179	3.2	1,373,702	Open	16.2	281
6/14/2026	19:15:00	7.5	0.0000	7.3	1,373,716	Closed	16.2	279
6/14/2026	19:30:00	7.4	0.8631	5.2	1,373,727	Open	16.3	283
6/14/2026	19:45:00	7.4	0.0000	3.2	1,373,747	Closed	16.2	279
6/14/2026	20:00:00	7.4	0.0000	2.3	1,373,747	Closed	17	283
6/14/2026	20:15:00	7.4	0.0000	2.4	1,373,747	Closed	17.9	284
6/14/2026	20:30:00	7.4	0.0000	19.9	1,373,748	Closed	16.7	286
6/14/2026	20:45:00	7.5	0.0000	13.6	1,373,749	Closed	16.4	284
6/14/2026	21:00:00	7.5	0.0000	5.2	1,373,749	Closed	16.8	286
6/14/2026	21:15:00	7.5	0.0000	4.2	1,373,749	Closed	17.5	286
6/14/2026	21:30:00	7.5	0.5754	5.2	1,373,754	Open	16.4	286
6/14/2026	21:45:00	7.6	1.6050	3.3	1,373,774	Open	15.9	286
6/14/2026	22:00:00	7.6	0.0000	3.8	1,373,794	Closed	15.8	288
6/14/2026	22:15:00	7.7	0.0000	4.6	1,373,803	Open	15.7	288
6/14/2026	22:30:00	7.7	1.6807	3.2	1,373,814	Open	15.5	286
6/14/2026	22:45:00	7.7	1.6732	3	1,373,823	Closed	16	284
6/14/2026	23:00:00	7.8	1.6618	2.6	1,373,848	Open	15.5	286
6/14/2026	23:15:00	7.8	1.6277	3.8	1,373,857	Open	15.5	284
6/14/2026	23:30:00	7.7	0.0000	2.8	1,373,861	Closed	15.9	281
6/14/2026	23:45:00	7.8	1.6126	3.2	1,373,873	Open	15.3	281

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

Appendix B: CP2 WTP Data Logs



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	0:00:00	7.55	1.2681	0	134322.4	ON	12.5	154
6/8/2026	0:15:00	7.56	1.0183	0	134338.2	ON	12.7	152
6/8/2026	0:30:00	7.52	2.2031	0	134367.5	ON	12.4	160
6/8/2026	0:45:00	7.52	0.0908	0	134382.5	ON	13	156
6/8/2026	1:00:00	7.5	0.8782	0	134383.1	ON	13.3	156
6/8/2026	1:15:00	7.49	2.0971	0	134407.4	ON	13.3	160
6/8/2026	1:30:00	7.47	1.9533	0	134438.0	ON	13.8	161
6/8/2026	1:45:00	7.46	0.0000	0	134442.7	ON	14.2	161
6/8/2026	2:00:00	7.46	1.8813	0	134448.0	ON	14.2	163
6/8/2026	2:15:00	7.48	0.4959	0	134463.7	ON	13.3	179
6/8/2026	2:30:00	7.45	0.0492	0	134464.5	ON	13.8	179
6/8/2026	2:45:00	7.48	2.5097	0	134483.7	ON	12.5	179
6/8/2026	3:00:00	7.51	2.5249	0	134517.4	ON	12.6	173
6/8/2026	3:15:00	7.51	0.4845	0	134544.3	ON	12.9	172
6/8/2026	3:30:00	7.5	0.0000	0	134558.5	ON	14.5	172
6/8/2026	3:45:00	7.47	0.3369	0	134561.2	ON	17	172
6/8/2026	4:00:00	7.45	0.3407	0	134566.2	ON	19.1	173
6/8/2026	4:15:00	7.43	0.3861	0	134573.0	ON	20.8	174
6/8/2026	4:30:00	7.4	1.1508	0	134598.8	ON	21	174
6/8/2026	4:45:00	7.39	0.9956	0	134615.8	ON	20.5	175
6/8/2026	5:00:00	7.38	2.1463	0	134637.0	ON	20	176
6/8/2026	5:15:00	7.36	0.1136	0	134656.5	ON	19.4	175
6/8/2026	5:30:00	7.35	0.2120	0	134659.8	ON	19	176
6/8/2026	5:45:00	7.32	1.1508	0	134664.7	ON	18.7	176
6/8/2026	6:00:00	7.32	2.6725	0	134681.7	ON	18.4	176
6/8/2026	6:15:00	7.32	2.5627	0	134719.4	ON	18	175
6/8/2026	6:30:00	7.3	1.0788	0	134752.2	ON	17.6	176
6/8/2026	6:45:00	7.29	0.3899	0	134761.6	ON	17.2	175
6/8/2026	7:00:00	7.29	0.7874	0	134780.5	ON	17.9	175
6/8/2026	7:15:00	7.27	0.3142	0	134789.0	ON	18.1	176
6/8/2026	7:30:00	7.24	0.2801	0	134792.4	ON	18.8	175
6/8/2026	7:45:00	7.24	0.7117	0	134796.1	ON	18.5	175



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	8:00:00	7.24	2.3659	0	134823.4	ON	18.5	176
6/8/2026	8:15:00	7.23	2.2599	0	134857.5	ON	18.1	175
6/8/2026	8:30:00	7.22	2.1653	0	134889.5	ON	17.9	176
6/8/2026	8:45:00	7.21	1.0183	0	134917.6	ON	17.9	175
6/8/2026	9:00:00	7.21	0.0000	0	134921.9	ON	17.6	175
6/8/2026	9:15:00	7.2	1.9381	0	134942.2	ON	17.4	175
6/8/2026	9:30:00	7.19	0.1325	0	134968.2	ON	17.5	176
6/8/2026	9:45:00	7.18	1.2870	0	134976.6	ON	17.6	176
6/8/2026	10:00:00	7.18	0.9918	0	134994.2	ON	17.7	176
6/8/2026	10:15:00	7.17	2.2334	0	135008.6	ON	17.7	175
6/8/2026	10:30:00	7.16	1.3249	0	135041.6	ON	17.9	176
6/8/2026	10:45:00	7.15	0.5148	0	135054.6	ON	17.9	176
6/8/2026	11:00:00	7.15	1.9003	0	135067.7	ON	18	176
6/8/2026	11:15:00	7.13	2.4681	0	135102.6	ON	17.9	175
6/8/2026	11:30:00	7.54	1.5899	0	135137.6	ON	13.4	149
6/8/2026	11:45:00	7.49	0.1628	0	135145.4	ON	14.7	149
6/8/2026	12:00:00	7.49	0.4883	0	135156.4	ON	13.2	151
6/8/2026	12:15:00	7.49	0.5035	1	135163.2	ON	14.2	151
6/8/2026	12:30:00	7.48	2.3091	0	135183.5	ON	12.5	152
6/8/2026	12:45:00	7.5	1.2984	0	135208.8	ON	13.3	151
6/8/2026	13:00:00	7.47	1.8700	0	135224.3	ON	12.6	153
6/8/2026	13:15:00	7.48	1.7754	0	135254.9	ON	12.5	154
6/8/2026	13:30:00	7.5	0.3331	0	135267.7	ON	13.1	153
6/8/2026	13:45:00	7.46	0.9123	0	135272.9	ON	13.4	153
6/8/2026	14:00:00	7.47	2.2788	0	135301.9	ON	12.5	156
6/8/2026	14:15:00	7.46	2.2523	0	135333.8	ON	12.4	156
6/8/2026	14:30:00	7.45	1.8435	0	135361.4	ON	12.5	157
6/8/2026	14:45:00	7.45	0.9729	0	135391.6	ON	12.5	157
6/8/2026	15:00:00	7.44	1.0107	0	135403.5	ON	12.7	157
6/8/2026	15:15:00	7.44	2.1728	0	135432.5	ON	12.5	158
6/8/2026	15:30:00	7.44	0.0000	0	135438.0	ON	13.8	155
6/8/2026	15:45:00	7.42	2.4719	0	135453.9	ON	12.5	159



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/8/2026	16:00:00	7.42	2.4189	0	135486.5	ON	12.4	160
6/8/2026	16:15:00	7.44	1.7791	0	135516.8	ON	12.6	160
6/8/2026	16:30:00	7.43	0.0000	0	135540.7	ON	12.9	159
6/8/2026	16:45:00	7.42	1.4309	0	135565.7	ON	12.6	160
6/8/2026	17:00:00	7.43	0.0833	0	135582.4	ON	13.7	157
6/8/2026	17:15:00	7.4	0.1779	0	135585.5	ON	14.3	159
6/8/2026	17:30:00	7.41	1.4498	0	135599.4	ON	12.7	160
6/8/2026	17:45:00	7.41	1.9533	0	135627.5	ON	12.4	161
6/8/2026	18:00:00	7.41	2.2637	0	135664.6	ON	12.3	161
6/8/2026	18:15:00	7.41	1.6467	0	135701.3	ON	12.4	161
6/8/2026	18:30:00	7.41	0.6852	0	135718.2	ON	12.5	161
6/8/2026	18:45:00	7.42	1.9116	0	135730.7	ON	12.6	160
6/8/2026	19:00:00	7.42	2.3810	0	135765.8	ON	12.3	161
6/8/2026	19:15:00	7.43	2.5022	0	135802.9	ON	12.3	161
6/8/2026	19:30:00	7.43	2.4757	0	135839.2	ON	12.3	162
6/8/2026	19:45:00	7.45	0.0000	0	135852.0	ON	12.8	161
6/8/2026	20:00:00	7.43	2.4908	0	135874.9	ON	12.6	161
6/8/2026	20:15:00	7.44	1.8397	0	135906.2	ON	13.5	158
6/8/2026	20:30:00	7.43	1.2227	0	135931.0	ON	14.2	160
6/8/2026	20:45:00	7.41	0.1666	0	135937.8	ON	16.2	159
6/8/2026	21:00:00	7.4	1.1848	0	135947.2	ON	15.8	159
6/8/2026	21:15:00	7.42	1.9306	0	135975.3	ON	14.2	158
6/8/2026	21:30:00	7.43	0.4126	0	136000.0	ON	14.1	158
6/8/2026	21:45:00	7.39	0.4429	0	136007.5	ON	15.5	160
6/8/2026	22:00:00	7.41	2.6611	0	136027.9	ON	13.8	158
6/8/2026	22:15:00	7.42	2.7179	0	136067.2	ON	13.4	159
6/8/2026	22:30:00	7.42	1.8586	0	136106.2	ON	13.9	157
6/8/2026	22:45:00	7.4	0.1666	0	136116.3	ON	16.3	158
6/8/2026	23:00:00	7.4	2.4264	0	136153.7	ON	13.7	157
6/8/2026	23:15:00	7.39	1.0675	0	136188.4	ON	13.7	157
6/8/2026	23:30:00	7.39	0.3710	0	136197.9	ON	15.7	159
6/8/2026	23:45:00	7.39	0.7192	0	136215.7	ON	14.6	158



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	0:00:00	7.38	1.9722	0	136231.1	ON	14.2	160
6/9/2026	0:15:00	7.33	1.0183	0	136263.4	ON	14.3	161
6/9/2026	0:30:00	7.34	0.4467	0	136273.0	ON	15.3	162
6/9/2026	0:45:00	7.31	2.6271	0	136297.1	ON	13.3	161
6/9/2026	1:00:00	7.29	2.6346	0	136333.5	ON	12.9	162
6/9/2026	1:15:00	7.29	0.6814	0	136360.2	ON	13.5	163
6/9/2026	1:30:00	7.29	0.2953	0	136365.4	ON	14.6	162
6/9/2026	1:45:00	7.27	1.7564	0	136372.4	ON	15.3	164
6/9/2026	2:00:00	7.24	2.4529	0	136408.9	ON	13.2	163
6/9/2026	2:15:00	7.23	2.3242	0	136445.3	ON	12.8	163
6/9/2026	2:30:00	7.25	0.2233	0	136457.6	ON	13.5	164
6/9/2026	2:45:00	7.24	0.0000	0	136458.1	ON	14.1	165
6/9/2026	3:00:00	7.25	2.5211	0	136473.3	ON	13.6	165
6/9/2026	3:15:00	7.24	1.6429	0	136498.7	ON	14.2	162
6/9/2026	3:30:00	7.24	2.5400	0	136534.8	ON	13.3	160
6/9/2026	3:45:00	7.26	0.3823	0	136550.0	ON	14.4	160
6/9/2026	4:00:00	7.27	1.9798	0	136558.9	ON	13.8	158
6/9/2026	4:15:00	7.3	0.3861	0	136593.0	ON	13	158
6/9/2026	4:30:00	7.28	0.9085	0	136599.9	ON	14	158
6/9/2026	4:45:00	7.3	2.5779	0	136623.5	ON	12.6	157
6/9/2026	5:00:00	7.32	0.9350	0	136650.7	ON	12.7	159
6/9/2026	5:15:00	7.32	0.2612	0	136656.4	ON	13.1	159
6/9/2026	5:30:00	7.31	0.2271	0	136658.7	ON	13.4	159
6/9/2026	5:45:00	7.3	0.1590	0	136660.4	ON	13.7	160
6/9/2026	6:00:00	7.29	0.0000	0	136660.5	ON	13.9	160
6/9/2026	6:15:00	7.27	0.0000	0	136661.4	ON	14.1	161
6/9/2026	6:30:00	7.27	0.9653	0	136664.5	ON	14.2	161
6/9/2026	6:45:00	7.35	2.2788	0	136697.8	ON	12.6	277
6/9/2026	7:00:00	7.61	0.1325	0	136722.7	ON	13	302
6/9/2026	7:15:00	7.57	0.2877	0	136726.1	ON	13.4	302
6/9/2026	7:30:00	7.54	0.5716	0	136731.2	ON	13.9	302
6/9/2026	7:45:00	7.83	2.5930	0	136765.3	ON	12.6	291



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	8:00:00	7.81	0.2120	0	136793.5	ON	12.9	278
6/9/2026	8:15:00	7.78	0.3748	0	136797.1	ON	13.2	279
6/9/2026	8:30:00	7.22	1.8094	0	136825.8	ON	13	269
6/9/2026	8:45:00	5.76	0.0000	0	136841.6	OFF	12.2	250
6/9/2026	9:00:00	5.77	0.0000	0	136841.6	OFF	12.1	247
6/9/2026	9:15:00	5.97	0.0000	0	136841.6	OFF	12.3	252
6/9/2026	9:30:00	5.97	0.0000	0	136841.6	OFF	12.5	252
6/9/2026	9:45:00	5.97	0.0000	0	136841.6	OFF	12.5	252
6/9/2026	10:00:00	5.99	0.0000	0	136841.6	OFF	12.6	253
6/9/2026	10:15:00	5.99	0.0000	0	136841.6	OFF	12.6	253
6/9/2026	10:30:00	6.89	2.3697	0	136843.4	ON	12.3	266
6/9/2026	10:45:00	6.98	0.0984	0	136872.9	ON	13	261
6/9/2026	11:00:00	6.96	0.1136	0	136873.4	ON	13.3	262
6/9/2026	11:15:00	6.92	2.3735	1	136877.3	ON	13	259
6/9/2026	11:30:00	7.35	0.1249	0	136908.6	ON	12.6	245
6/9/2026	11:45:00	7.32	0.1514	0	136912.0	ON	13.2	246
6/9/2026	12:00:00	7.21	2.1009	0	136923.4	ON	12.6	249
6/9/2026	12:15:00	7.35	2.3924	0	136957.5	ON	12.2	251
6/9/2026	12:30:00	7.37	0.0908	0	136969.8	ON	12.9	249
6/9/2026	12:45:00	7.36	0.0606	0	136969.8	ON	13.5	248
6/9/2026	13:00:00	7.1	2.1880	4	136972.3	ON	12.7	259
6/9/2026	13:15:00	7.34	1.7526	0	137004.8	ON	12.8	259
6/9/2026	13:30:00	7.33	0.0000	0	137008.1	ON	13.5	257
6/9/2026	13:45:00	7.32	1.6845	0	137022.3	ON	13	261
6/9/2026	14:00:00	7.29	1.9949	2	137037.2	ON	12.7	266
6/9/2026	14:15:00	7.33	0.0000	0	137064.0	ON	12.9	268
6/9/2026	14:30:00	7.31	0.0000	0	137064.0	ON	13.5	268
6/9/2026	14:45:00	7.28	1.3514	0	137079.3	ON	13	272
6/9/2026	15:00:00	7.33	1.2416	0	137099.5	ON	12.9	266
6/9/2026	15:15:00	7.33	0.0000	0	137106.7	ON	13.5	264
6/9/2026	15:30:00	7.32	0.0000	0	137106.7	ON	13.9	265
6/9/2026	15:45:00	7.3	0.0000	0	137106.7	ON	14.2	266



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/9/2026	16:00:00	7.21	0.0000	0	137107.6	ON	13.7	276
6/9/2026	16:15:00	7.27	0.4732	6	137108.8	ON	13.3	271
6/9/2026	16:30:00	7.31	1.1243	4	137117.2	ON	12.5	274
6/9/2026	16:45:00	7.44	2.6195	2	137147.0	ON	12.4	276
6/9/2026	17:00:00	7.49	2.5816	3	137185.6	ON	12.4	268
6/9/2026	17:15:00	7.47	1.4839	2	137212.4	ON	13.3	258
6/9/2026	17:30:00	7.44	2.6346	3	137243.2	ON	12.3	239
6/9/2026	17:45:00	7.51	1.7754	1	137279.3	ON	12.3	238
6/9/2026	18:00:00	7.42	0.2536	2	137289.1	ON	12.7	238
6/9/2026	18:15:00	7.51	2.6195	2	137315.9	ON	12.3	237
6/9/2026	18:30:00	7.51	0.2461	2	137337.6	ON	12.6	237
6/9/2026	18:45:00	7.49	2.2599	2	137353.7	ON	12.5	247
6/9/2026	19:00:00	7.48	0.0908	2	137377.6	ON	13	247
6/9/2026	19:15:00	7.46	0.0000	2	137377.6	ON	13.5	247
6/9/2026	19:30:00	7.48	2.5968	2	137407.3	ON	12.8	246
6/9/2026	19:45:00	7.51	2.5930	2	137442.4	ON	12.7	241
6/9/2026	20:00:00	7.48	0.1476	1	137454.1	ON	13.1	239
6/9/2026	20:15:00	7.47	0.1287	1	137457.3	ON	13.2	241
6/9/2026	20:30:00	7.48	1.3060	1	137486.2	ON	13	233
6/9/2026	20:45:00	7.45	0.0000	0	137488.1	ON	13.3	235
6/9/2026	21:00:00	7.4	0.9729	1	137494.8	ON	13.4	231
6/9/2026	21:15:00	7.47	2.1955	1	137514.9	ON	12.9	210
6/9/2026	21:30:00	7.47	0.1060	1	137526.4	ON	13.6	206
6/9/2026	21:45:00	7.47	0.9691	1	137530.3	ON	13.6	206
6/9/2026	22:00:00	7.42	0.4088	1	137543.6	ON	13	206
6/9/2026	22:15:00	7.4	0.4013	1	137545.7	ON	13.2	206
6/9/2026	22:30:00	7.4	0.0681	1	137548.5	ON	13.5	209
6/9/2026	22:45:00	7.37	0.3710	1	137550.9	ON	14.1	209
6/9/2026	23:00:00	7.28	2.2107	1	137573.4	ON	14.5	215
6/9/2026	23:15:00	7.32	2.5779	1	137606.7	ON	14.7	205
6/9/2026	23:30:00	7.35	1.8549	1	137624.1	ON	15.4	202
6/9/2026	23:45:00	7.43	2.2258	0	137658.0	ON	14.2	193



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	0:00:00	7.44	0.2233	0	137685.0	ON	14.5	194
6/10/2026	0:15:00	7.42	0.4088	0	137689.3	ON	14.7	197
6/10/2026	0:30:00	7.43	0.9918	0	137709.7	ON	13	198
6/10/2026	0:45:00	7.43	0.7949	0	137724.6	ON	13	200
6/10/2026	1:00:00	7.41	0.3748	0	137730.3	ON	14	199
6/10/2026	1:15:00	7.37	2.5438	1	137739.3	ON	13.1	200
6/10/2026	1:30:00	7.41	2.1274	0	137770.1	ON	12.8	196
6/10/2026	1:45:00	7.41	0.4618	0	137791.4	ON	13.4	196
6/10/2026	2:00:00	7.39	0.3710	0	137797.7	ON	14.3	197
6/10/2026	2:15:00	7.39	0.4505	1	137804.6	ON	14.4	200
6/10/2026	2:30:00	7.36	2.2485	2	137813.4	ON	13.5	205
6/10/2026	2:45:00	7.39	2.1047	0	137845.1	ON	13.9	201
6/10/2026	3:00:00	7.35	2.3924	0	137877.2	ON	13.9	204
6/10/2026	3:15:00	7.35	0.9388	0	137900.8	ON	14.2	204
6/10/2026	3:30:00	7.32	0.4656	0	137907.6	ON	15.3	205
6/10/2026	3:45:00	7.35	2.4605	0	137935.7	ON	13.3	207
6/10/2026	4:00:00	7.35	0.5451	0	137958.0	ON	13.4	208
6/10/2026	4:15:00	7.33	0.3710	0	137964.2	ON	14.3	209
6/10/2026	4:30:00	7.33	0.4088	0	137973.8	ON	14.4	212
6/10/2026	4:45:00	7.31	0.4240	0	137978.9	ON	15	214
6/10/2026	5:00:00	7.32	1.6996	0	138003.9	ON	15	213
6/10/2026	5:15:00	7.4	1.7299	0	138033.5	ON	14.5	214
6/10/2026	5:30:00	7.38	0.0000	0	138036.5	ON	14.5	215
6/10/2026	5:45:00	7.37	1.9873	0	138054.2	ON	14.3	216
6/10/2026	6:00:00	7.4	1.9306	0	138092.7	ON	12.8	212
6/10/2026	6:15:00	7.38	0.2990	0	138101.1	ON	13	213
6/10/2026	6:30:00	7.35	1.6656	0	138107.8	ON	12.3	216
6/10/2026	6:45:00	7.33	2.1539	0	138140.8	ON	12.1	215
6/10/2026	7:00:00	7.3	2.4416	0	138177.8	ON	12.1	215
6/10/2026	7:15:00	7.3	0.4883	0	138198.4	ON	12.6	215
6/10/2026	7:30:00	7.27	0.3823	0	138203.3	ON	13.7	212
6/10/2026	7:45:00	7.25	1.1546	0	138212.3	ON	14	214



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	8:00:00	7.24	0.2423	0	138235.0	ON	14.6	211
6/10/2026	8:15:00	7.21	2.5400	0	138260.2	ON	13.3	207
6/10/2026	8:30:00	7.18	2.4151	0	138297.2	ON	13.2	206
6/10/2026	8:45:00	7.18	1.0183	0	138328.2	ON	12.8	209
6/10/2026	9:00:00	7.18	0.9350	0	138335.1	ON	14.9	212
6/10/2026	9:15:00	7.18	2.2069	0	138366.4	ON	12.6	209
6/10/2026	9:30:00	7.21	2.3470	0	138399.3	ON	12.4	206
6/10/2026	9:45:00	7.23	0.7154	0	138424.4	ON	12.6	204
6/10/2026	10:00:00	7.23	0.3445	0	138428.4	ON	13.9	201
6/10/2026	10:15:00	7.28	0.0000	0	138444.3	ON	13.3	199
6/10/2026	10:30:00	7.26	0.0000	0	138444.3	ON	14.4	199
6/10/2026	10:45:00	7.36	2.1350	0	138472.3	ON	12.8	195
6/10/2026	11:00:00	7.36	0.0000	0	138498.3	ON	13.5	192
6/10/2026	11:15:00	7.32	0.0833	0	138500.6	ON	14.4	193
6/10/2026	11:30:00	7.31	1.9192	0	138514.2	ON	13	195
6/10/2026	11:45:00	7.26	2.4681	0	138546.0	ON	12.6	197
6/10/2026	12:00:00	7.23	1.0826	0	138579.5	ON	12.7	198
6/10/2026	12:15:00	7.24	0.2877	0	138587.4	ON	13.6	198
6/10/2026	12:30:00	7.21	2.2258	0	138595.0	ON	13.2	201
6/10/2026	12:45:00	7.18	2.3886	0	138632.4	ON	12.7	199
6/10/2026	13:00:00	7.17	1.0788	0	138664.3	ON	12.7	199
6/10/2026	13:15:00	7.19	0.8366	0	138674.9	ON	13	200
6/10/2026	13:30:00	7.16	2.3886	0	138708.3	ON	12.6	199
6/10/2026	13:45:00	7.17	0.9350	0	138738.0	ON	12.6	198
6/10/2026	14:00:00	7.19	0.2347	0	138744.2	ON	13.4	198
6/10/2026	14:15:00	7.17	0.2990	0	138747.6	ON	14.5	196
6/10/2026	14:30:00	7.16	2.3848	0	138770.5	ON	12.7	196
6/10/2026	14:45:00	7.18	1.7261	0	138801.0	ON	12.7	192
6/10/2026	15:00:00	7.2	0.3558	0	138812.1	ON	12.8	193
6/10/2026	15:15:00	7.18	0.3255	0	138815.7	ON	14	191
6/10/2026	15:30:00	7.21	1.6353	0	138841.0	ON	12.7	186
6/10/2026	15:45:00	7.29	2.2107	0	138871.3	ON	12.9	173



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/10/2026	16:00:00	7.35	2.0479	0	138905.2	ON	13.2	168
6/10/2026	16:15:00	7.33	1.5672	0	138933.0	ON	14	167
6/10/2026	16:30:00	7.29	0.3861	0	138937.6	ON	14.6	168
6/10/2026	16:45:00	7.29	0.3748	1	138944.3	ON	13.7	166
6/10/2026	17:00:00	7.33	2.3735	0	138973.7	ON	13	158
6/10/2026	17:15:00	7.33	1.8435	0	139007.3	ON	13.3	155
6/10/2026	17:30:00	7.3	0.1136	0	139019.5	ON	14.2	155
6/10/2026	17:45:00	7.22	1.7754	4	139025.7	ON	13.6	164
6/10/2026	18:00:00	7.31	0.7987	0	139055.9	ON	13.4	159
6/10/2026	18:15:00	7.25	0.7609	0	139066.3	ON	14.2	159
6/10/2026	18:30:00	7.33	2.3053	0	139095.7	ON	12.8	162
6/10/2026	18:45:00	7.36	1.8397	0	139128.5	ON	13.3	161
6/10/2026	19:00:00	7.33	0.0000	0	139136.7	ON	14	162
6/10/2026	19:15:00	7.27	2.1766	0	139148.2	ON	14.3	165
6/10/2026	19:30:00	7.25	2.2069	0	139182.0	ON	14.9	165
6/10/2026	19:45:00	7.23	1.7829	0	139209.1	ON	15.3	165
6/10/2026	20:00:00	7.39	0.9691	0	139236.5	ON	14	161
6/10/2026	20:15:00	7.37	2.1615	0	139255.1	ON	13.6	163
6/10/2026	20:30:00	7.35	2.0479	0	139285.8	ON	14.2	163
6/10/2026	20:45:00	7.33	0.1968	0	139305.8	ON	14.5	164
6/10/2026	21:00:00	7.3	0.1893	0	139309.2	ON	14.8	164
6/10/2026	21:15:00	7.44	2.6346	0	139339.1	ON	12.6	161
6/10/2026	21:30:00	7.48	2.4416	0	139378.3	ON	12.3	162
6/10/2026	21:45:00	7.47	0.1401	0	139390.7	ON	13.3	161
6/10/2026	22:00:00	7.41	2.6536	0	139401.9	ON	13	162
6/10/2026	22:15:00	7.51	2.6195	0	139442.7	ON	13	161
6/10/2026	22:30:00	7.54	2.6384	0	139483.1	ON	13	164
6/10/2026	22:45:00	7.5	0.3028	0	139499.6	ON	13.5	164
6/10/2026	23:00:00	7.51	2.6195	0	139526.9	ON	13	166
6/10/2026	23:15:00	7.52	2.6195	0	139566.7	ON	12.9	166
6/10/2026	23:30:00	7.48	0.0000	0	139581.0	ON	13.6	165
6/10/2026	23:45:00	7.46	0.3710	1	139582.9	ON	13.3	168



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/11/2026	0:00:00	7.41	0.8706	0	139607.6	ON	13.5	170
6/11/2026	0:15:00	7.39	0.9539	1	139621.2	ON	13.8	170
6/11/2026	0:30:00	7.48	2.6384	0	139652.6	ON	13.2	172
6/11/2026	0:45:00	7.46	0.2877	0	139665.7	ON	14.2	172
6/11/2026	1:00:00	7.44	0.3596	0	139670.4	ON	15	172
6/11/2026	1:15:00	7.41	2.6460	0	139684.3	ON	15.6	172
6/11/2026	1:30:00	7.42	2.1501	0	139723.6	ON	16.4	173
6/11/2026	1:45:00	7.48	2.6195	0	139762.0	ON	13.3	172
6/11/2026	2:00:00	7.51	2.5930	0	139799.9	ON	12.9	174
6/11/2026	2:15:00	7.52	0.0000	0	139825.9	ON	13.6	174
6/11/2026	2:30:00	7.49	2.4719	0	139840.8	ON	12.8	179
6/11/2026	2:45:00	7.52	1.5482	0	139875.6	ON	13.2	174
6/11/2026	3:00:00	7.5	0.2915	0	139879.5	ON	13.6	176
6/11/2026	3:15:00	7.42	0.3785	0	139883.9	ON	12.9	177
6/11/2026	3:30:00	7.34	2.5627	0	139919.0	ON	12.7	172
6/11/2026	3:45:00	7.23	2.4719	0	139956.5	ON	12.8	172
6/11/2026	4:00:00	7.22	0.1476	0	139976.3	ON	13.4	175
6/11/2026	4:15:00	7.26	2.5287	0	139988.3	ON	12.3	187
6/11/2026	4:30:00	7.27	2.4757	0	140025.1	ON	12.8	193
6/11/2026	4:45:00	7.25	0.5792	0	140036.2	ON	13.8	192
6/11/2026	5:00:00	7.08	0.8290	0	140053.5	ON	13.1	220
6/11/2026	5:15:00	7.15	2.1615	0	140059.2	ON	13.9	228
6/11/2026	5:30:00	7.08	1.4498	0	140085.1	ON	13.9	229
6/11/2026	5:45:00	7.05	2.1766	0	140113.2	ON	12.8	235
6/11/2026	6:00:00	7.15	2.4832	0	140146.5	ON	12.5	230
6/11/2026	6:15:00	7.15	0.0000	0	140156.1	ON	13.2	229
6/11/2026	6:30:00	7.19	0.3483	1	140157.3	ON	13.1	233
6/11/2026	6:45:00	7.18	2.2940	0	140190.7	ON	11.9	223
6/11/2026	7:00:00	7.16	2.4340	0	140227.4	ON	11.9	219
6/11/2026	7:15:00	7.2	1.5369	0	140259.7	ON	12	211
6/11/2026	7:30:00	7.19	0.0000	0	140264.1	ON	12.5	211
6/11/2026	7:45:00	7.19	0.4921	1	140266.6	ON	12.2	216



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/11/2026	8:00:00	7.3	2.5059	0	140300.4	ON	12	200
6/11/2026	8:15:00	7.36	2.4757	0	140337.9	ON	12.1	200
6/11/2026	8:30:00	7.38	0.2461	0	140357.7	ON	12.7	200
6/11/2026	8:45:00	7.41	1.5937	0	140386.8	ON	12.4	198
6/11/2026	9:00:00	7.39	0.0568	0	140392.6	ON	13.5	196
6/11/2026	9:15:00	7.35	0.1703	0	140393.8	ON	14.4	197
6/11/2026	9:30:00	7.32	2.4037	0	140420.6	ON	12.7	199
6/11/2026	9:45:00	7.2	2.3205	0	140457.8	ON	12.7	201
6/11/2026	10:00:00	7.2	1.6429	0	140482.1	ON	13.9	198
6/11/2026	10:15:00	7.19	0.1022	0	140495.2	ON	14.2	201
6/11/2026	10:30:00	7.18	0.1514	0	140498.2	ON	14.9	202
6/11/2026	10:45:00	7.2	1.6580	0	140515.5	ON	13.4	204
6/11/2026	11:00:00	7.15	2.2826	0	140547.2	ON	13	199
6/11/2026	11:15:00	7.15	2.1615	0	140579.4	ON	13.6	197
6/11/2026	11:30:00	7.16	1.9116	0	140609.6	ON	13.8	197
6/11/2026	11:45:00	7.16	1.5823	0	140633.8	ON	14.7	196
6/11/2026	12:00:00	7.15	0.0000	0	140642.9	ON	15.5	198
6/11/2026	12:15:00	7.14	0.0000	0	140642.9	ON	16.2	200
6/11/2026	12:30:00	7.23	1.4612	0	140654.6	ON	14.6	195
6/11/2026	12:45:00	7.23	0.5148	0	140668.9	ON	15.5	195
6/11/2026	13:00:00	7.21	0.3710	0	140674.4	ON	16.1	196
6/11/2026	13:15:00	7.13	1.7716	1	140691.4	ON	15.2	193
6/11/2026	13:30:00	7.12	0.0984	1	140700.7	ON	15.8	197
6/11/2026	13:45:00	7.11	0.2006	1	140703.5	ON	16.5	199
6/11/2026	14:00:00	7.15	2.3924	1	140719.1	ON	14.2	197
6/11/2026	14:15:00	7.14	2.2637	0	140754.4	ON	13.8	196
6/11/2026	14:30:00	7.15	1.6353	0	140788.2	ON	14.3	199
6/11/2026	14:45:00	7.14	0.3218	0	140793.8	ON	15.4	200
6/11/2026	15:00:00	7.12	0.3634	0	140799.8	ON	16.3	201
6/11/2026	15:15:00	7.1	2.1993	1	140806.9	ON	17	202
6/11/2026	15:30:00	7.21	1.5974	0	140839.8	ON	14.1	228
6/11/2026	15:45:00	7.19	1.5255	0	140863.7	ON	15.8	227



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/11/2026	16:00:00	7.13	0.1401	0	140876.1	ON	15.5	244
6/11/2026	16:15:00	7.12	0.1211	0	140878.9	ON	16.5	245
6/11/2026	16:30:00	7.16	0.1401	0	140896.1	ON	14.7	249
6/11/2026	16:45:00	7.1	1.9003	0	140920.0	ON	14.3	237
6/11/2026	17:00:00	7.1	1.3552	0	140944.2	ON	15.2	228
6/11/2026	17:15:00	7.09	0.0000	0	140949.8	ON	16.1	231
6/11/2026	17:30:00	7.16	2.0366	1	140963.7	ON	14.1	229
6/11/2026	17:45:00	7.2	1.4498	0	140989.0	ON	15.2	222
6/11/2026	18:00:00	7.22	1.4990	1	141011.4	ON	14.3	218
6/11/2026	18:15:00	7.21	0.0000	0	141020.1	ON	15.7	218
6/11/2026	18:30:00	7.18	2.0744	0	141029.1	ON	14.3	221
6/11/2026	18:45:00	7.23	2.0555	0	141058.0	ON	14.1	210
6/11/2026	19:00:00	7.27	1.7905	0	141088.6	ON	14	206
6/11/2026	19:15:00	7.25	0.1666	0	141097.9	ON	15	207
6/11/2026	19:30:00	7.22	0.2498	0	141101.3	ON	15.9	209
6/11/2026	19:45:00	7.25	1.8321	0	141123.7	ON	14.4	204
6/11/2026	20:00:00	7.28	1.7526	0	141152.6	ON	14.1	201
6/11/2026	20:15:00	7.3	0.2385	1	141167.1	ON	14.4	202
6/11/2026	20:30:00	7.24	0.2801	0	141170.5	ON	14.6	203
6/11/2026	20:45:00	7.24	1.8170	2	141178.1	ON	13.7	204
6/11/2026	21:00:00	7.23	0.3634	0	141186.8	ON	14.5	203
6/11/2026	21:15:00	7.27	1.8511	0	141200.6	ON	13.4	200
6/11/2026	21:30:00	7.3	2.2069	0	141234.6	ON	13.1	199
6/11/2026	21:45:00	7.3	0.1931	0	141250.3	ON	13.8	198
6/11/2026	22:00:00	7.27	1.8624	0	141258.5	ON	14.1	200
6/11/2026	22:15:00	7.28	2.0176	0	141289.7	ON	13.1	198
6/11/2026	22:30:00	7.19	1.9533	0	141319.6	ON	13.3	193
6/11/2026	22:45:00	7.15	0.1514	0	141341.9	ON	13.5	189
6/11/2026	23:00:00	7.14	0.0000	0	141343.3	ON	13.9	191
6/11/2026	23:15:00	7.19	1.7791	1	141346.4	ON	14	193
6/11/2026	23:30:00	7.17	0.8820	0	141369.3	ON	13.9	194
6/11/2026	23:45:00	7.23	2.0555	0	141394.7	ON	12.9	182



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	0:00:00	7.25	0.1628	0	141419.5	ON	13.3	181
6/12/2026	0:15:00	7.24	0.1287	0	141422.9	ON	13.7	183
6/12/2026	0:30:00	7.23	2.0895	0	141442.0	ON	13.7	186
6/12/2026	0:45:00	7.21	1.9116	0	141472.1	ON	14.2	187
6/12/2026	1:00:00	7.2	0.1136	1	141492.0	ON	15	187
6/12/2026	1:15:00	7.19	0.0000	1	141492.6	ON	16.7	187
6/12/2026	1:30:00	7.17	1.9041	0	141494.8	ON	17.8	187
6/12/2026	1:45:00	7.33	2.5665	0	141527.5	ON	14.4	177
6/12/2026	2:00:00	7.34	0.0984	0	141554.7	ON	14.5	179
6/12/2026	2:15:00	7.31	0.1136	0	141555.5	ON	15.6	181
6/12/2026	2:30:00	7.3	0.1438	0	141558.3	ON	16	182
6/12/2026	2:45:00	7.26	0.3293	0	141562.4	ON	16.2	184
6/12/2026	3:00:00	7.31	1.8170	0	141587.9	ON	14.1	183
6/12/2026	3:15:00	7.29	0.2271	0	141595.5	ON	14.3	186
6/12/2026	3:30:00	7.28	0.2877	0	141598.9	ON	14.6	186
6/12/2026	3:45:00	7.29	0.5716	1	141608.8	ON	14.2	186
6/12/2026	4:00:00	7.27	0.3596	2	141618.8	ON	14.3	186
6/12/2026	4:15:00	7.28	0.0000	1	141631.8	ON	14	188
6/12/2026	4:30:00	7.25	0.3293	1	141632.4	ON	13.8	199
6/12/2026	4:45:00	7.23	1.1508	0	141658.8	ON	13.1	223
6/12/2026	5:00:00	7.15	2.2485	2	141690.2	ON	12.4	239
6/12/2026	5:15:00	7.14	0.3748	2	141701.7	ON	12.9	240
6/12/2026	5:30:00	7.15	2.5249	1	141722.5	ON	12.3	237
6/12/2026	5:45:00	7.15	2.5400	2	141757.3	ON	12.6	229
6/12/2026	6:00:00	7.23	1.8586	1	141794.4	ON	13.2	223
6/12/2026	6:15:00	7.21	0.2271	1	141804.5	ON	14.4	222
6/12/2026	6:30:00	7.19	0.3293	1	141807.9	ON	14.8	225
6/12/2026	6:45:00	7.29	2.5022	1	141831.1	ON	13.7	213
6/12/2026	7:00:00	7.33	0.0000	1	141863.5	ON	13	208
6/12/2026	7:15:00	7.3	0.2650	1	141866.8	ON	13.4	209
6/12/2026	7:30:00	7.3	2.1312	1	141880.5	ON	12.5	211
6/12/2026	7:45:00	7.28	0.2725	1	141906.5	ON	13.1	211



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	8:00:00	7.26	0.0568	1	141916.6	ON	13.3	212
6/12/2026	8:15:00	7.25	0.1287	1	141917.1	ON	13.7	212
6/12/2026	8:30:00	7.21	0.0000	5	141928.9	ON	13.3	206
6/12/2026	8:45:00	7.2	0.0908	4	141929.0	ON	13.9	207
6/12/2026	9:00:00	7.23	1.1583	1	141944.9	ON	12.3	196
6/12/2026	9:15:00	7.3	2.5476	1	141969.5	ON	12.4	193
6/12/2026	9:30:00	7.33	0.6397	1	141996.1	ON	12.9	192
6/12/2026	9:45:00	7.27	2.0138	1	142002.2	ON	13.5	193
6/12/2026	10:00:00	7.27	0.0000	1	142012.1	ON	14.1	192
6/12/2026	10:15:00	7.3	0.0000	1	142012.1	ON	14.6	194
6/12/2026	10:30:00	7.26	0.5413	2	142020.4	ON	13.9	197
6/12/2026	10:45:00	7.37	1.0826	8	142029.0	ON	13.3	197
6/12/2026	11:00:00	7.4	2.3772	2	142055.2	ON	13.4	199
6/12/2026	11:15:00	7.39	2.3772	1	142087.9	ON	13.6	201
6/12/2026	11:30:00	7.38	0.2915	1	142103.8	ON	14.6	199
6/12/2026	11:45:00	7.32	2.0101	1	142115.3	ON	14.3	204
6/12/2026	12:00:00	7.31	1.5444	1	142146.3	ON	14.5	203
6/12/2026	12:15:00	7.3	0.2271	1	142151.4	ON	15.6	203
6/12/2026	12:30:00	7.27	0.0000	0	142167.6	ON	15.4	204
6/12/2026	12:45:00	7.26	2.0744	1	142179.8	ON	15	208
6/12/2026	13:00:00	7.27	2.0820	1	142212.5	ON	14.5	208
6/12/2026	13:15:00	7.26	1.2643	1	142241.6	ON	15.4	205
6/12/2026	13:30:00	7.24	0.1703	1	142244.1	ON	16.3	203
6/12/2026	13:45:00	7.29	1.8511	1	142271.3	ON	15.1	201
6/12/2026	14:00:00	7.26	0.2233	0	142286.2	ON	16.3	201
6/12/2026	14:15:00	7.26	0.5527	11	142290.7	ON	16.7	203
6/12/2026	14:30:00	7.25	1.9495	17	142300.1	ON	16.2	200
6/12/2026	14:45:00	7.23	0.1249	2	142308.2	ON	16.8	200
6/12/2026	15:00:00	7.31	2.0214	1	142338.3	ON	15.3	197
6/12/2026	15:15:00	7.31	1.4536	1	142366.3	ON	16.3	197
6/12/2026	15:30:00	7.28	0.2574	1	142371.1	ON	17.4	198
6/12/2026	15:45:00	7.24	0.2574	1	142374.5	ON	18.4	200



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/12/2026	16:00:00	7.24	1.8700	2	142382.7	ON	16.6	200
6/12/2026	16:15:00	7.35	1.9987	1	142412.4	ON	16.1	202
6/12/2026	16:30:00	7.42	1.9911	1	142442.9	ON	15.5	208
6/12/2026	16:45:00	7.44	1.7451	1	142471.4	ON	16.3	210
6/12/2026	17:00:00	7.4	0.0000	1	142484.1	ON	17.5	211
6/12/2026	17:15:00	7.33	2.0025	2	142485.0	ON	15.9	223
6/12/2026	17:30:00	7.39	1.4536	1	142504.8	ON	16	219
6/12/2026	17:45:00	7.4	1.6239	1	142527.9	ON	15.3	207
6/12/2026	18:00:00	7.36	0.1287	1	142533.2	ON	17	207
6/12/2026	18:15:00	7.3	0.0000	11	142538.1	OFF	15	212
6/12/2026	18:30:00	7.39	1.8700	1	142565.3	ON	14.7	213
6/12/2026	18:45:00	7.4	0.0757	2	142584.0	ON	16.2	214
6/12/2026	19:00:00	7.3	1.6050	11	142588.8	ON	15.2	223
6/12/2026	19:15:00	7.39	2.1501	0	142610.0	ON	14.7	222
6/12/2026	19:30:00	7.4	2.3848	0	142644.1	ON	14.3	220
6/12/2026	19:45:00	7.42	1.7375	0	142677.0	ON	14.7	215
6/12/2026	20:00:00	7.4	0.0000	0	142685.2	ON	15.9	215
6/12/2026	20:15:00	7.39	1.7375	0	142702.1	ON	14.3	213
6/12/2026	20:30:00	7.34	0.4391	0	142721.1	ON	15.6	215
6/12/2026	20:45:00	7.37	0.5148	3	142727.9	ON	14.8	207
6/12/2026	21:00:00	7.36	1.6845	0	142750.5	ON	14.7	204
6/12/2026	21:15:00	7.36	2.0214	0	142778.3	ON	14	202
6/12/2026	21:30:00	7.35	2.2069	0	142811.4	ON	13.7	202
6/12/2026	21:45:00	7.36	2.1728	0	142844.3	ON	13.8	201
6/12/2026	22:00:00	7.38	1.8662	0	142875.6	ON	13.7	201
6/12/2026	22:15:00	7.37	1.5672	0	142901.3	ON	14.4	199
6/12/2026	22:30:00	7.36	0.0000	0	142915.8	ON	14.8	198
6/12/2026	22:45:00	7.34	0.0000	0	142915.8	ON	15.6	199
6/12/2026	23:00:00	7.31	2.0630	0	142927.3	ON	14	199
6/12/2026	23:15:00	7.31	2.0063	0	142956.8	ON	14	200
6/12/2026	23:30:00	7.28	0.4278	0	142974.8	ON	14.8	200
6/12/2026	23:45:00	7.26	2.2788	0	143001.6	ON	13.3	203



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	0:00:00	7.26	1.7451	0	143034.9	ON	13.5	201
6/13/2026	0:15:00	7.23	0.2915	0	143044.5	ON	14.4	202
6/13/2026	0:30:00	7.22	2.0858	0	143070.1	ON	13.2	202
6/13/2026	0:45:00	7.2	2.5968	0	143104.4	ON	13.2	202
6/13/2026	1:00:00	7.19	0.0833	0	143127.5	ON	14.2	200
6/13/2026	1:15:00	7.17	0.1779	0	143128.5	ON	14.8	200
6/13/2026	1:30:00	7.21	0.0530	0	143135.8	ON	13.9	202
6/13/2026	1:45:00	7.18	1.1091	0	143145.6	ON	13.5	201
6/13/2026	2:00:00	7.15	1.8284	0	143169.8	ON	13.3	200
6/13/2026	2:15:00	7.15	2.5552	0	143197.6	ON	13.4	201
6/13/2026	2:30:00	7.15	0.0000	0	143210.1	ON	13.9	200
6/13/2026	2:45:00	7.13	0.3634	0	143211.7	ON	14.1	202
6/13/2026	3:00:00	7.15	2.5627	0	143232.9	ON	13.1	205
6/13/2026	3:15:00	7.17	2.2523	0	143267.4	ON	13.2	204
6/13/2026	3:30:00	7.17	2.3394	0	143303.5	ON	13.1	204
6/13/2026	3:45:00	7.18	1.9722	0	143337.0	ON	13.3	201
6/13/2026	4:00:00	7.18	2.3659	0	143370.0	ON	13.1	200
6/13/2026	4:15:00	7.18	0.0757	0	143383.4	ON	14.3	198
6/13/2026	4:30:00	7.2	2.3507	0	143404.2	ON	13.1	197
6/13/2026	4:45:00	7.21	0.5678	0	143431.3	ON	13.9	193
6/13/2026	5:00:00	7.18	0.5072	0	143438.2	ON	14.3	195
6/13/2026	5:15:00	7.25	1.7451	0	143461.0	ON	13.8	191
6/13/2026	5:30:00	7.24	1.8435	5	143470.1	ON	13.1	194
6/13/2026	5:45:00	7.23	2.3507	0	143500.6	ON	12.7	193
6/13/2026	6:00:00	7.21	2.3545	0	143534.7	ON	12.7	192
6/13/2026	6:15:00	7.2	2.2788	0	143568.8	ON	12.6	192
6/13/2026	6:30:00	7.19	0.0946	0	143590.9	ON	13.3	190
6/13/2026	6:45:00	7.22	2.2372	0	143612.8	ON	12.6	187
6/13/2026	7:00:00	7.26	0.0757	0	143643.6	ON	13.1	183
6/13/2026	7:15:00	7.24	0.2877	0	143645.2	ON	13.6	183
6/13/2026	7:30:00	7.26	2.2372	0	143672.8	ON	12.7	180
6/13/2026	7:45:00	7.29	2.1955	0	143706.9	ON	12.8	177



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	8:00:00	7.3	0.2763	0	143735.4	ON	13.4	174
6/13/2026	8:15:00	7.28	0.1476	0	143738.8	ON	14.1	174
6/13/2026	8:30:00	7.26	0.2347	0	143742.2	ON	14.9	175
6/13/2026	8:45:00	7.28	1.8284	0	143765.9	ON	14.3	173
6/13/2026	9:00:00	7.32	2.3205	0	143795.1	ON	13.4	173
6/13/2026	9:15:00	7.35	2.3318	0	143829.2	ON	13.5	174
6/13/2026	9:30:00	7.34	1.5634	0	143854.2	ON	15	172
6/13/2026	9:45:00	7.34	2.3394	0	143883.0	ON	13.7	172
6/13/2026	10:00:00	7.33	0.1287	0	143903.8	ON	15.1	170
6/13/2026	10:15:00	7.31	0.2385	0	143907.2	ON	16.2	171
6/13/2026	10:30:00	7.26	1.9495	0	143914.7	ON	15.6	172
6/13/2026	10:45:00	7.34	2.3318	0	143946.6	ON	14.4	173
6/13/2026	11:00:00	7.37	2.3091	0	143980.7	ON	14.3	174
6/13/2026	11:15:00	7.36	2.3394	0	144011.8	ON	13.7	178
6/13/2026	11:30:00	7.36	0.2233	0	144024.2	ON	15.4	176
6/13/2026	11:45:00	7.32	2.1123	0	144047.4	ON	13.9	176
6/13/2026	12:00:00	7.34	0.0000	0	144060.5	ON	15.3	174
6/13/2026	12:15:00	7.29	1.3590	0	144068.3	ON	15.2	174
6/13/2026	12:30:00	7.3	2.3318	2	144091.9	ON	14.3	172
6/13/2026	12:45:00	7.33	2.3621	1	144125.9	ON	13.9	173
6/13/2026	13:00:00	7.33	1.9949	0	144159.8	ON	14	175
6/13/2026	13:15:00	7.3	2.2372	0	144193.4	ON	13.9	175
6/13/2026	13:30:00	7.29	0.0984	0	144203.0	ON	15.9	173
6/13/2026	13:45:00	7.24	2.3091	0	144234.4	ON	14.1	177
6/13/2026	14:00:00	7.26	0.0000	0	144263.4	ON	14.8	176
6/13/2026	14:15:00	7.23	0.0000	0	144263.4	ON	16.8	176
6/13/2026	14:30:00	7.21	0.4013	0	144266.9	ON	15.8	182
6/13/2026	14:45:00	7.2	1.4763	0	144288.9	ON	16.4	178
6/13/2026	15:00:00	7.23	2.3356	0	144312.7	ON	15.2	173
6/13/2026	15:15:00	7.24	2.3242	0	144346.8	ON	14.8	172
6/13/2026	15:30:00	7.24	1.3855	0	144375.1	ON	16.1	172
6/13/2026	15:45:00	7.23	2.3091	4	144386.6	ON	15.4	174



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/13/2026	16:00:00	7.24	1.9684	0	144417.0	ON	16.3	175
6/13/2026	16:15:00	7.25	2.3205	0	144450.9	ON	15.8	178
6/13/2026	16:30:00	7.25	0.1703	0	144476.2	ON	16.9	181
6/13/2026	16:45:00	7.2	0.2309	0	144479.6	ON	18.7	183
6/13/2026	17:00:00	7.18	0.3407	0	144483.4	ON	20.1	184
6/13/2026	17:15:00	7.19	0.0000	11	144490.9	OFF	15.2	182
6/13/2026	17:30:00	7.21	0.1817	0	144502.2	ON	17.5	182
6/13/2026	17:45:00	7.24	2.3394	1	144523.0	ON	14.3	179
6/13/2026	18:00:00	7.23	0.2347	0	144535.0	ON	16.8	177
6/13/2026	18:15:00	7.23	2.2372	4	144544.8	ON	14.5	177
6/13/2026	18:30:00	7.26	0.6549	0	144565.4	ON	15.6	176
6/13/2026	18:45:00	7.24	1.5520	0	144582.1	ON	17.8	176
6/13/2026	19:00:00	7.33	2.3621	729	144598.1	ON	15.4	0
6/13/2026	19:15:00	7.21	2.4340	0	144634.4	ON	13.6	188
6/13/2026	19:30:00	7.19	2.4378	0	144667.9	ON	13.5	194
6/13/2026	19:45:00	7.24	2.4037	0	144705.4	ON	13.3	191
6/13/2026	20:00:00	7.24	0.2309	0	144717.0	ON	15.2	190
6/13/2026	20:15:00	7.2	2.2599	0	144721.6	ON	14.9	188
6/13/2026	20:30:00	7.27	1.9949	2	144751.9	ON	13.4	183
6/13/2026	20:45:00	7.29	2.4037	0	144784.9	ON	13.2	181
6/13/2026	21:00:00	7.33	1.7564	0	144820.5	ON	13.2	181
6/13/2026	21:15:00	7.3	1.3325	0	144844.4	ON	14.8	180
6/13/2026	21:30:00	7.34	2.4567	2	144878.8	ON	13.3	182
6/13/2026	21:45:00	7.37	1.9608	0	144914.7	ON	13.8	179
6/13/2026	22:00:00	7.36	0.2196	0	144932.3	ON	15	178
6/13/2026	22:15:00	7.32	0.2347	0	144935.7	ON	16.2	179
6/13/2026	22:30:00	7.28	2.0063	9	144942.9	ON	14.9	179
6/13/2026	22:45:00	7.3	0.8214	0	144958.3	ON	15.8	179
6/13/2026	23:00:00	7.36	2.4340	0	144984.4	ON	13.3	177
6/13/2026	23:15:00	7.43	2.3621	0	145021.0	ON	13.1	182
6/13/2026	23:30:00	7.49	0.1931	0	145049.7	ON	14.1	197
6/13/2026	23:45:00	7.47	0.2612	0	145053.1	ON	15.2	198



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	0:00:00	7.4	2.3242	0	145079.6	ON	13.2	287
6/14/2026	0:15:00	7.5	2.3318	0	145113.6	ON	13.1	311
6/14/2026	0:30:00	7.52	1.2870	0	145139.0	ON	14.5	307
6/14/2026	0:45:00	7.49	1.4952	0	145164.5	ON	13.7	293
6/14/2026	1:00:00	7.48	0.2044	0	145168.8	ON	15	295
6/14/2026	1:15:00	7.41	2.3507	0	145197.2	ON	13.1	268
6/14/2026	1:30:00	7.47	1.7375	0	145230.6	ON	13.2	252
6/14/2026	1:45:00	7.5	0.7154	0	145259.3	ON	13.3	239
6/14/2026	2:00:00	7.47	0.0000	0	145267.9	ON	14.7	241
6/14/2026	2:15:00	7.42	0.6435	0	145275.8	ON	14.3	241
6/14/2026	2:30:00	7.51	1.6504	0	145290.5	ON	13.9	227
6/14/2026	2:45:00	7.47	0.1136	0	145315.1	ON	14.7	229
6/14/2026	3:00:00	7.44	2.1615	0	145327.4	ON	13.2	215
6/14/2026	3:15:00	7.49	1.8208	0	145357.7	ON	13.6	204
6/14/2026	3:30:00	7.47	2.0176	0	145379.5	ON	13.5	205
6/14/2026	3:45:00	7.54	1.9533	0	145410.1	ON	13.4	202
6/14/2026	4:00:00	7.47	2.4870	0	145441.5	ON	13.3	201
6/14/2026	4:15:00	7.37	2.5022	0	145476.9	ON	13	200
6/14/2026	4:30:00	7.36	1.9608	0	145513.8	ON	13	208
6/14/2026	4:45:00	7.48	2.3848	0	145548.0	ON	13	221
6/14/2026	5:00:00	7.48	0.1211	0	145578.2	ON	13.7	236
6/14/2026	5:15:00	7.42	0.8176	1	145584.1	ON	14.1	250
6/14/2026	5:30:00	7.38	2.4719	1	145598.4	ON	14.4	242
6/14/2026	5:45:00	7.35	2.1160	0	145623.6	ON	14.3	233
6/14/2026	6:00:00	7.39	2.4719	0	145661.1	ON	12.7	215
6/14/2026	6:15:00	7.41	0.0000	0	145690.0	ON	13.6	211
6/14/2026	6:30:00	7.42	2.4264	0	145708.7	ON	12.8	203
6/14/2026	6:45:00	7.48	2.3924	0	145746.2	ON	12.8	193
6/14/2026	7:00:00	7.48	0.7912	0	145774.3	ON	13.6	189
6/14/2026	7:15:00	7.42	2.3886	8	145782.5	ON	13.3	191
6/14/2026	7:30:00	7.49	2.3735	0	145814.1	ON	13.6	187
6/14/2026	7:45:00	7.5	0.2082	0	145829.5	ON	14.2	186



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	8:00:00	7.5	0.2196	0	145851.5	ON	14.1	179
6/14/2026	8:15:00	7.48	0.1703	0	145854.2	ON	14.8	181
6/14/2026	8:30:00	7.45	2.3924	0	145870.4	ON	13.8	176
6/14/2026	8:45:00	7.52	2.3129	0	145904.7	ON	13.5	171
6/14/2026	9:00:00	7.49	2.3015	0	145935.0	ON	14	170
6/14/2026	9:15:00	7.46	2.2523	0	145969.1	ON	13.9	167
6/14/2026	9:30:00	7.48	1.7678	0	146000.7	ON	14.8	164
6/14/2026	9:45:00	7.43	2.1690	0	146011.3	ON	14.9	167
6/14/2026	10:00:00	7.52	1.8624	0	146045.2	ON	14.4	163
6/14/2026	10:15:00	7.49	0.0000	0	146059.2	ON	16.1	163
6/14/2026	10:30:00	7.44	0.0000	0	146059.2	ON	17.6	166
6/14/2026	10:45:00	7.41	0.1703	0	146060.9	ON	18.4	172
6/14/2026	11:00:00	7.44	2.2031	0	146069.5	ON	16.1	159
6/14/2026	11:15:00	7.47	0.2385	0	146093.7	ON	16.1	160
6/14/2026	11:30:00	7.45	2.1123	0	146111.9	ON	15	161
6/14/2026	11:45:00	7.5	1.7943	0	146142.0	ON	15.4	161
6/14/2026	12:00:00	7.45	0.0000	0	146159.5	ON	17.1	162
6/14/2026	12:15:00	7.4	1.9646	0	146163.0	ON	17.8	165
6/14/2026	12:30:00	7.4	1.7829	0	146190.8	ON	17.5	165
6/14/2026	12:45:00	7.37	1.8170	0	146218.1	ON	19.1	168
6/14/2026	13:00:00	7.32	0.3066	0	146240.2	ON	20.4	169
6/14/2026	13:15:00	6.96	1.8473	2	146249.7	ON	15.4	207
6/14/2026	13:30:00	7.1	1.8662	1	146273.2	ON	14.9	204
6/14/2026	13:45:00	7.19	2.2523	2	146304.2	ON	14.6	204
6/14/2026	14:00:00	7.33	2.5552	0	146340.9	ON	14.5	207
6/14/2026	14:15:00	7.37	1.7072	0	146371.2	ON	16.2	205
6/14/2026	14:30:00	7.33	1.2303	0	146394.8	ON	18.5	208
6/14/2026	14:45:00	7.29	0.0000	0	146395.6	ON	20.3	209
6/14/2026	15:00:00	7.39	2.4794	1	146421.1	ON	15.2	207
6/14/2026	15:15:00	7.41	2.4643	0	146458.6	ON	14.9	207
6/14/2026	15:30:00	7.3	0.4959	0	146463.3	ON	16.6	209
6/14/2026	15:45:00	7.35	2.4454	0	146472.8	ON	16.1	202



Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope


Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Date	Time	Discharge pH	Discharge Flow Rate (m3PM)	Discharge NTU	Flow Total (m3)	Discharge Valve Status	Discharge Temperature (C°)	Discharge Conductivity
6/14/2026	16:00:00	7.37	2.4605	0	146509.7	ON	14.8	207
6/14/2026	16:15:00	7.39	1.7526	0	146546.0	ON	14.8	206
6/14/2026	16:30:00	7.33	2.5892	2	146560.6	ON	15.4	206
6/14/2026	16:45:00	7.34	2.5476	0	146598.1	ON	14.7	203
6/14/2026	17:00:00	7.33	1.9949	0	146632.4	ON	14.9	202
6/14/2026	17:15:00	7.35	0.1060	0	146662.7	ON	16.1	201
6/14/2026	17:30:00	7.31	0.3066	0	146666.1	ON	18.5	201
6/14/2026	17:45:00	7.33	2.5059	2	146692.0	ON	15	199
6/14/2026	18:00:00	7.37	2.4681	0	146729.5	ON	14.7	196
6/14/2026	18:15:00	7.37	1.1318	0	146755.6	ON	16	194
6/14/2026	18:30:00	7.35	2.4567	0	146777.9	ON	15	193
6/14/2026	18:45:00	7.35	2.4113	0	146815.4	ON	14.7	194
6/14/2026	19:00:00	7.34	0.1817	0	146826.4	ON	17.4	191
6/14/2026	19:15:00	7.31	2.3735	0	146849.6	ON	15.4	191
6/14/2026	19:30:00	7.32	2.3242	0	146883.8	ON	14.7	190
6/14/2026	19:45:00	7.31	0.1741	0	146908.8	ON	16.2	188
6/14/2026	20:00:00	7.28	0.2990	0	146911.4	ON	17.8	190
6/14/2026	20:15:00	7.27	2.2296	0	146943.8	ON	14.8	184
6/14/2026	20:30:00	7.26	1.5142	0	146969.2	ON	16.7	185
6/14/2026	20:45:00	7.23	0.0000	0	146973.9	ON	18	187
6/14/2026	21:00:00	7.24	1.2908	0	146982.9	ON	17.3	188
6/14/2026	21:15:00	7.22	1.3703	0	147005.2	ON	18.5	191
6/14/2026	21:30:00	7.18	1.6164	0	147026.6	ON	19.4	193
6/14/2026	21:45:00	7.27	2.5022	0	147058.9	ON	14	183
6/14/2026	22:00:00	7.27	2.4908	0	147095.8	ON	13.6	184
6/14/2026	22:15:00	7.27	0.9199	0	147120.5	ON	15.1	181
6/14/2026	22:30:00	7.24	0.9085	0	147134.2	ON	16.6	182
6/14/2026	22:45:00	6.16	0.0000	0	147140.3	OFF	13.9	166
6/14/2026	23:00:00	5.76	0.0000	736	147140.9	OFF	14.3	0
6/14/2026	23:15:00	6.83	2.4378	0	147147.9	ON	13.1	189
6/14/2026	23:30:00	7.02	2.3810	0	147185.0	ON	13.1	191
6/14/2026	23:45:00	7.06	2.3394	0	147219.4	ON	13.3	191

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

Appendix C: Photos

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

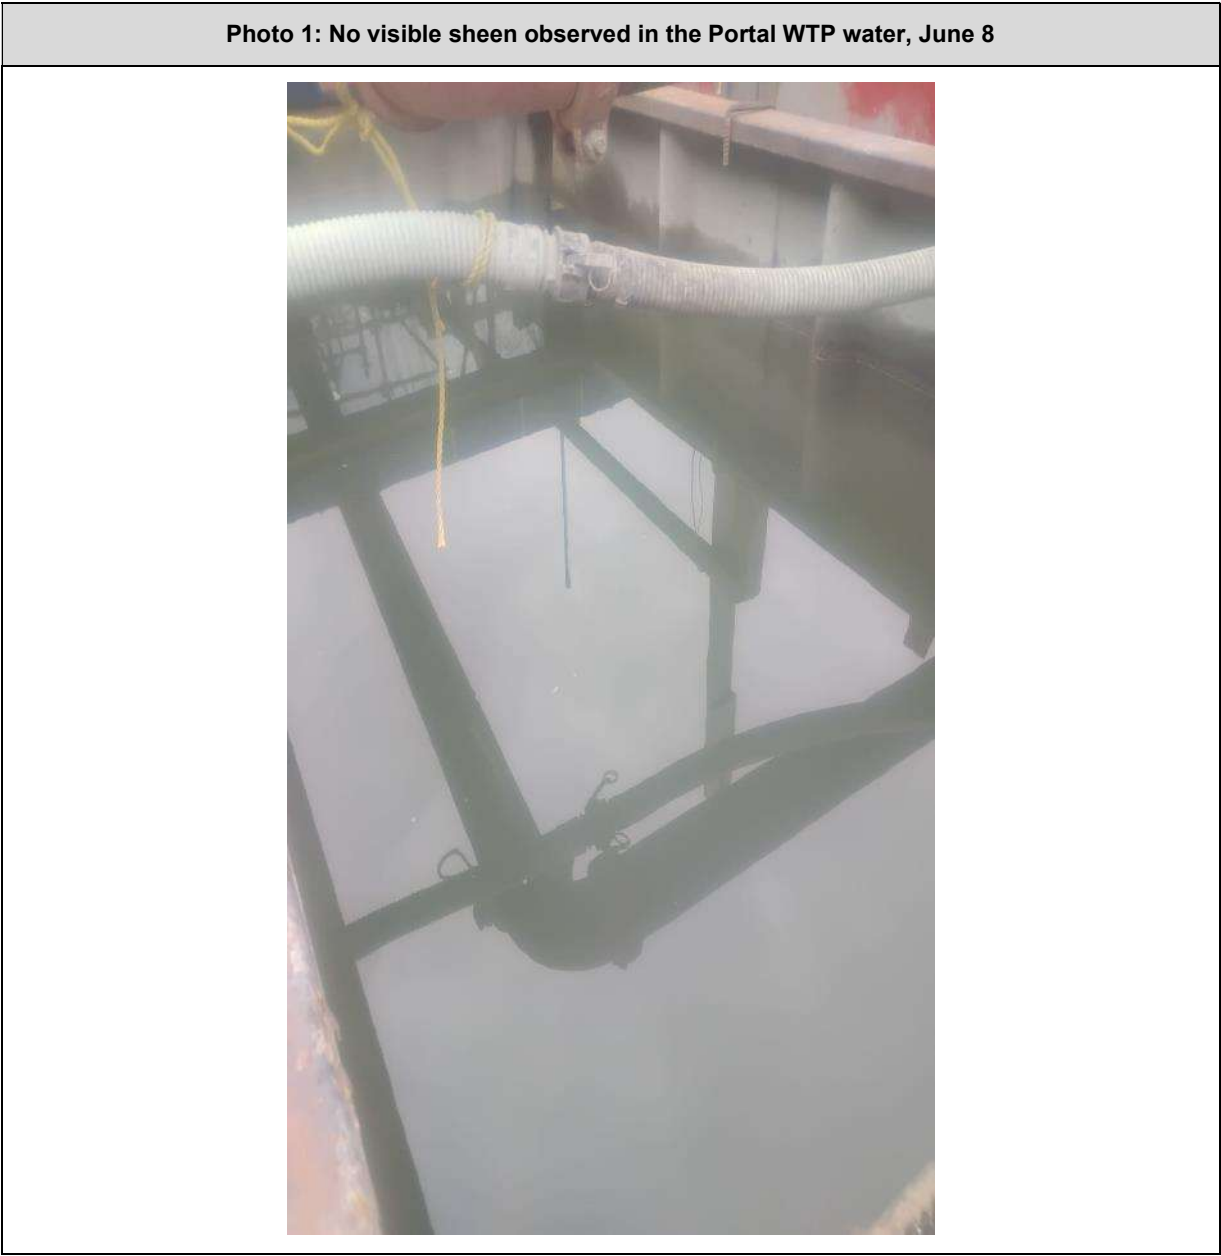




Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

Photo 2: No visible sheen observed in the CP2 WTP, June 8



		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

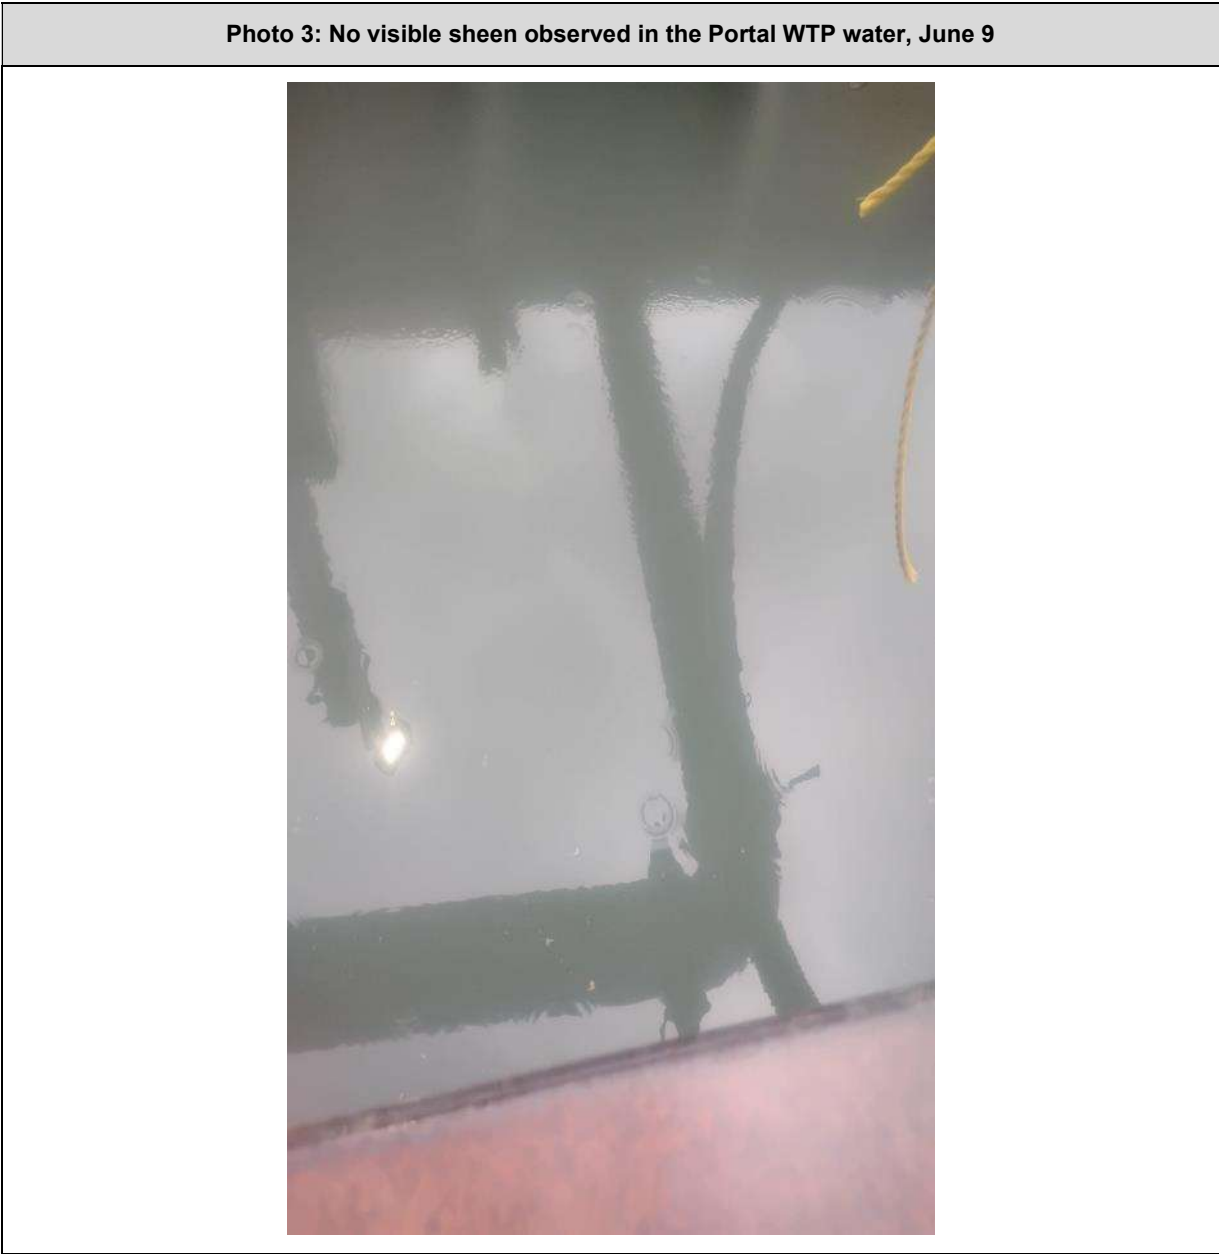




Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026


Photo 4: No visible sheen observed in the CP2 WTP water, June 9




		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

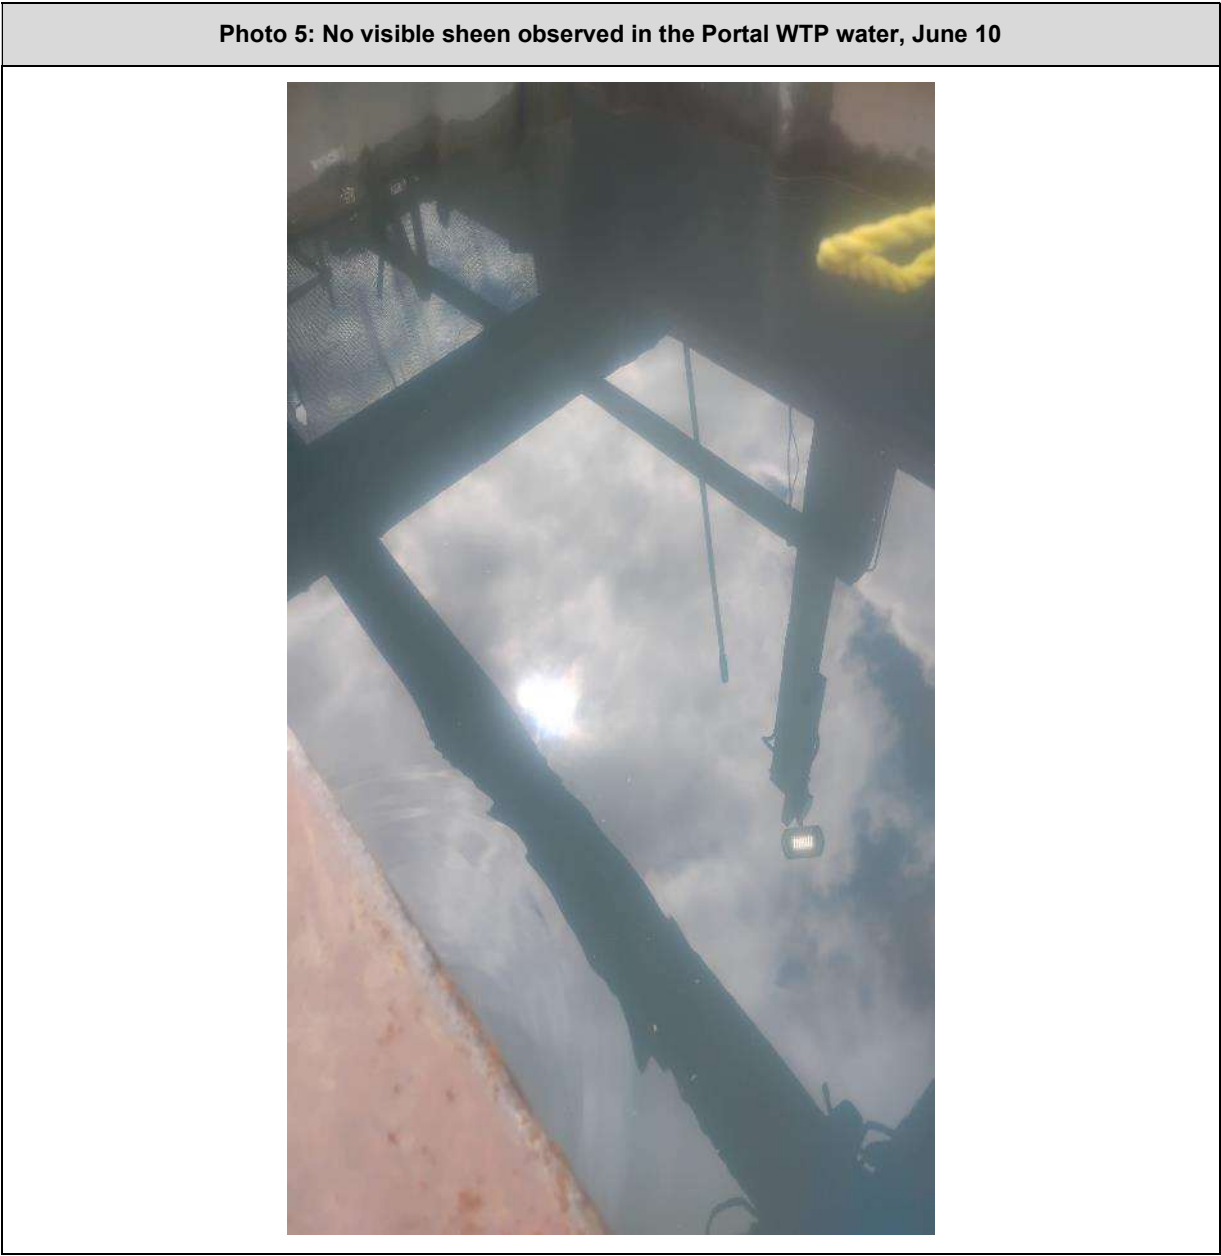

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

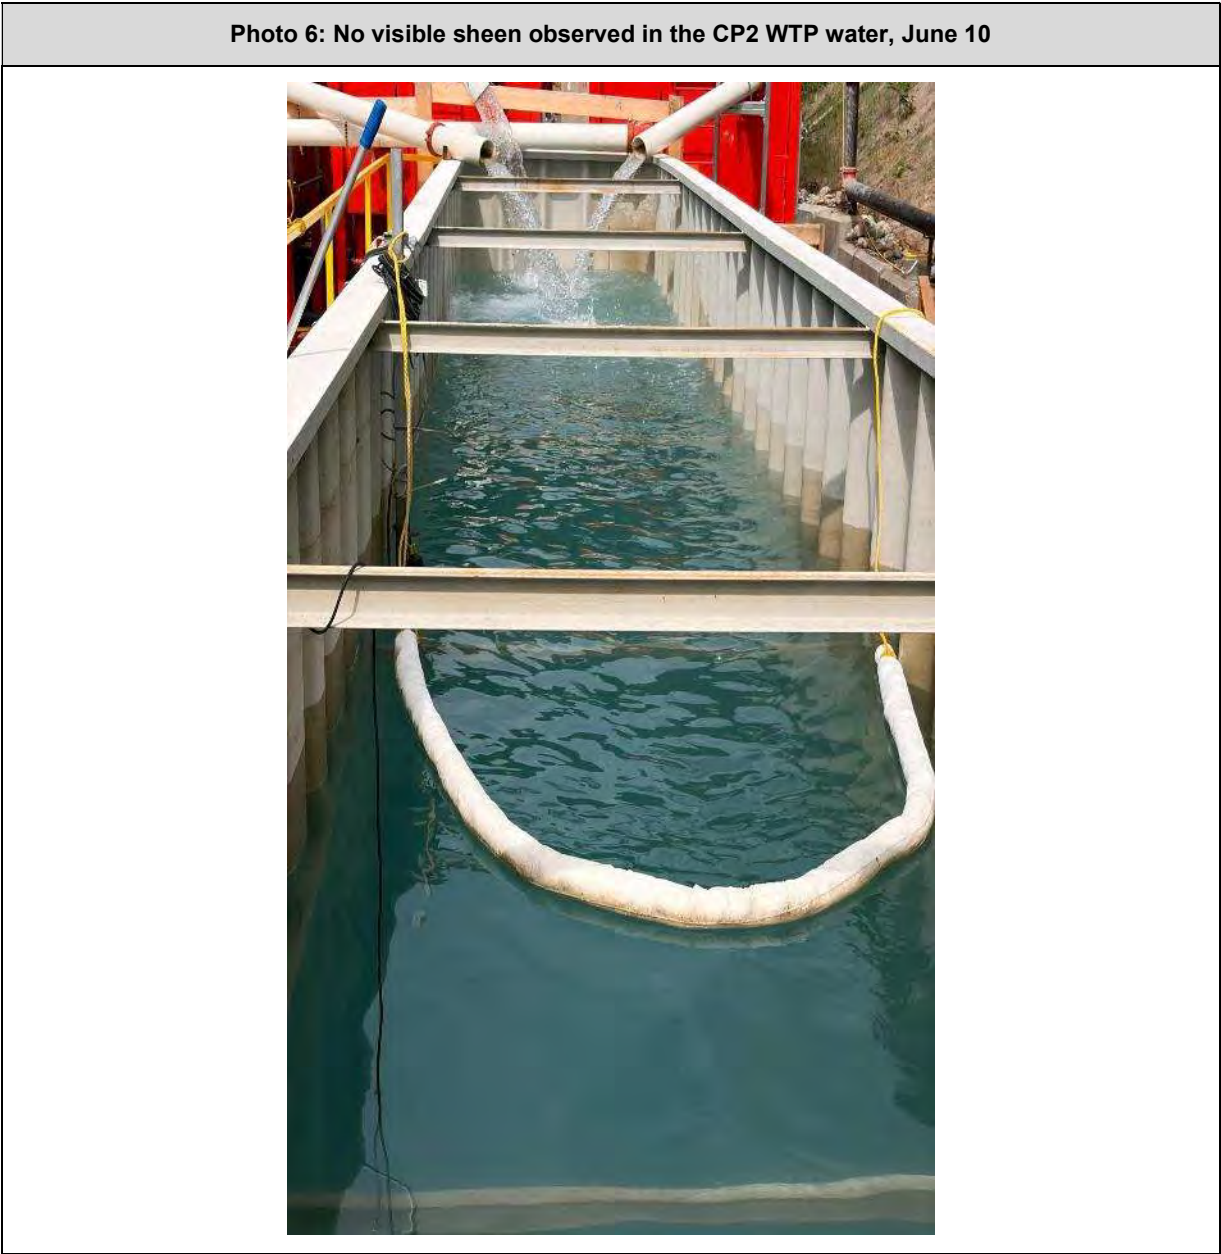

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

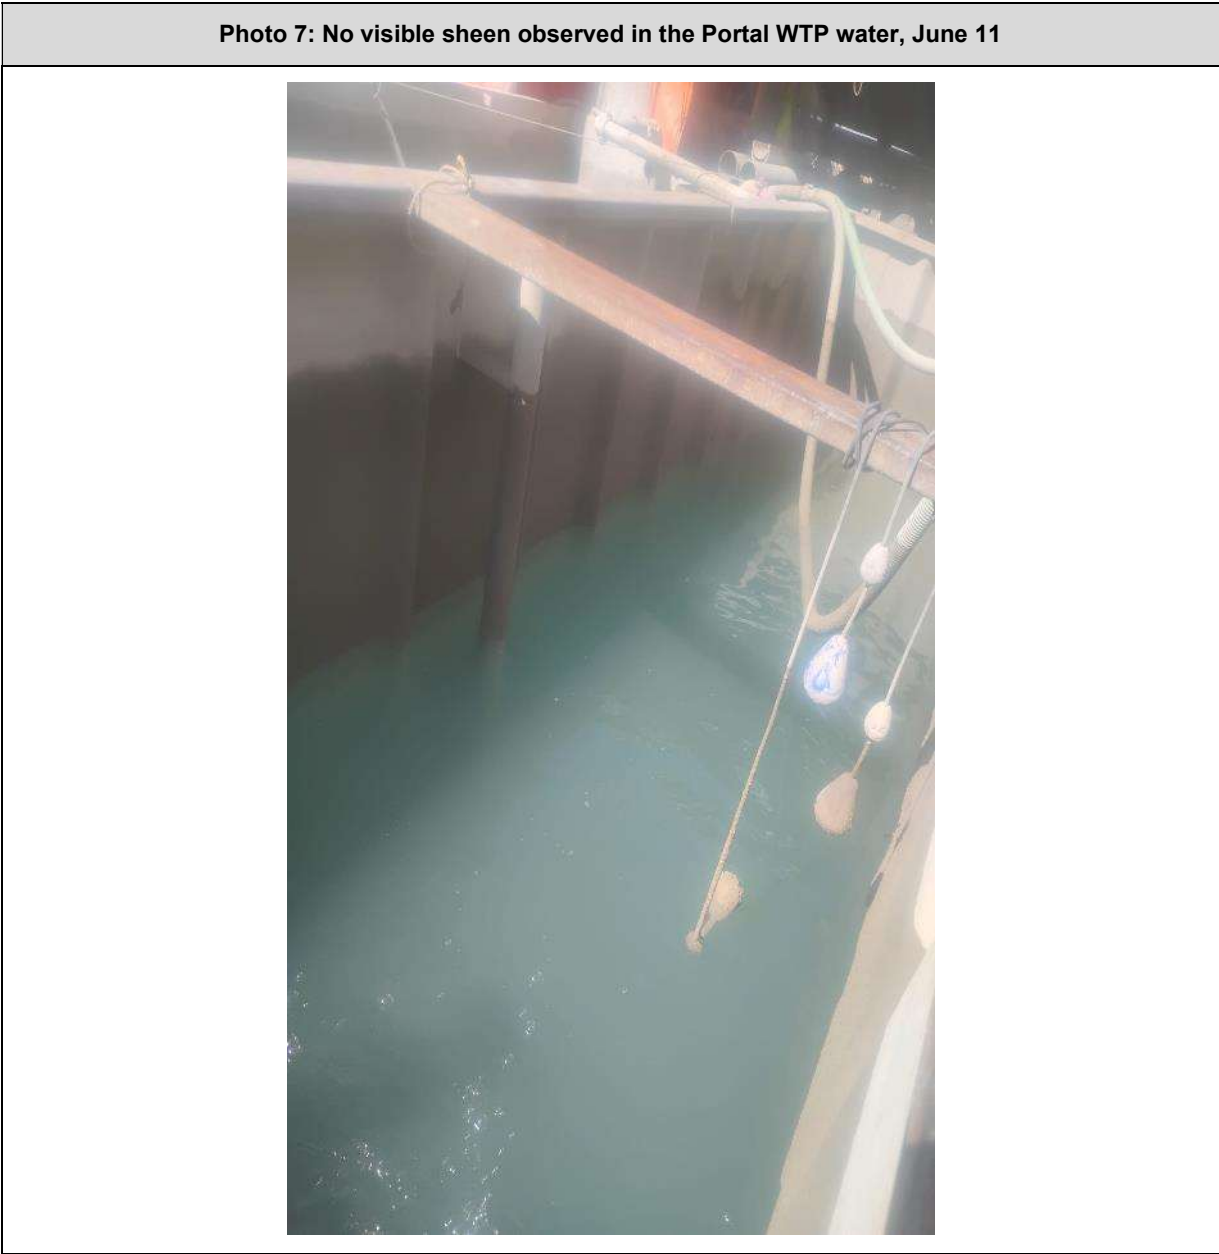




Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026


Photo 8: No visible sheen observed in the CP2 WTP water, June 11




		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

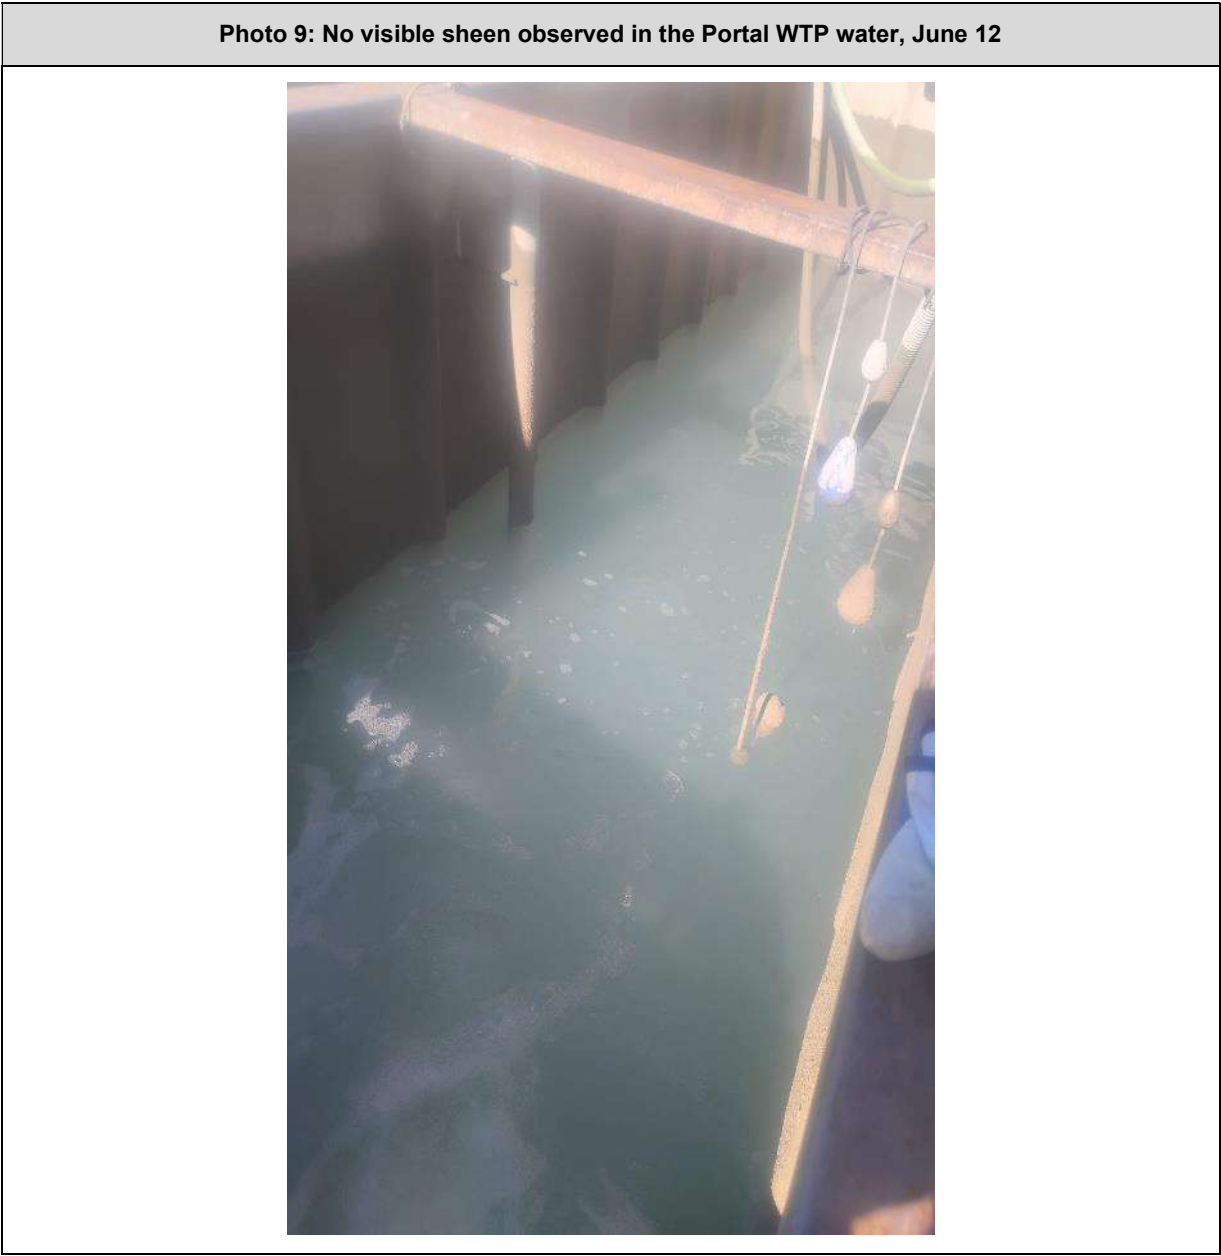

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

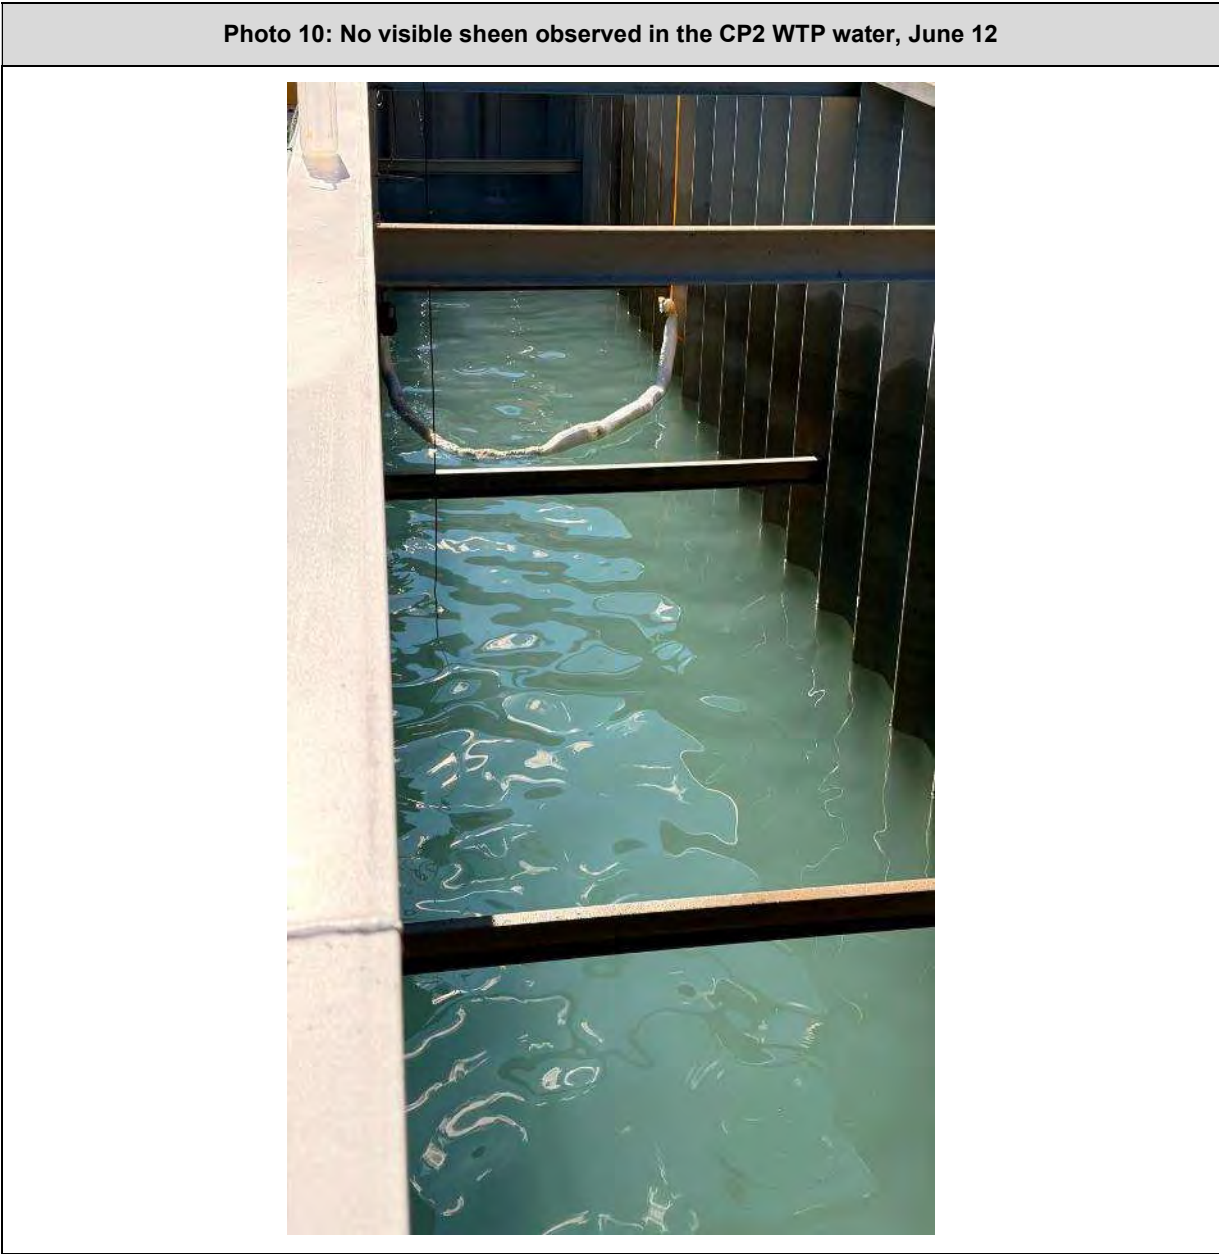

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

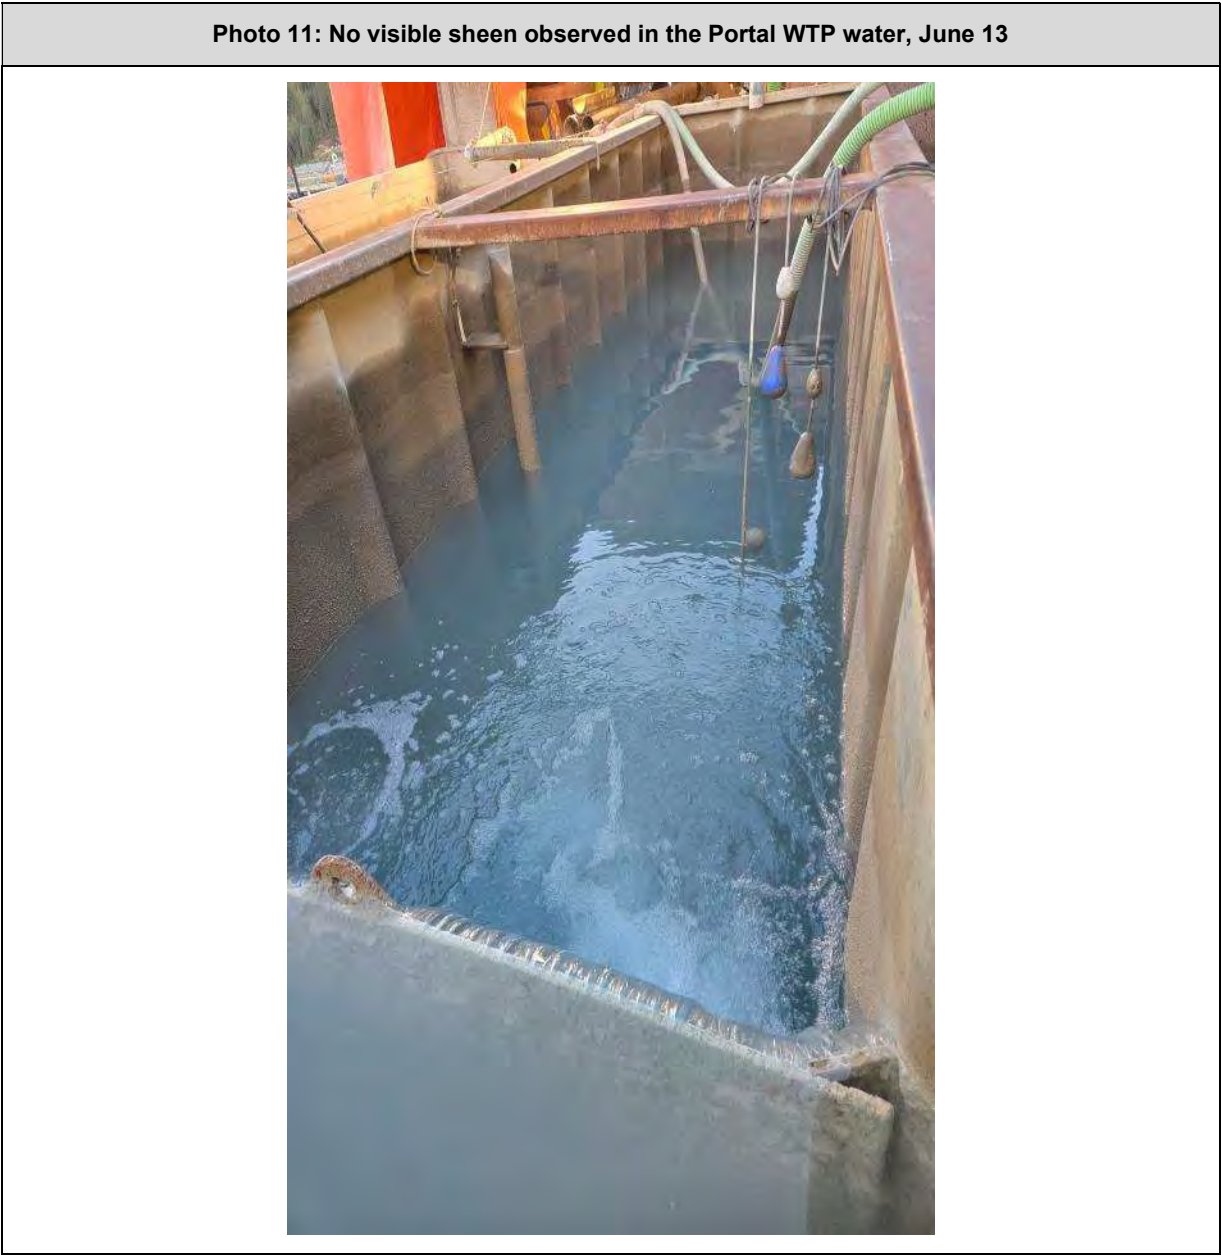




Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope

Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026


Photo 12: No visible sheen observed in the CP2 WTP water, June 13



		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: Approved by: Date:	BC1 BC2 July 16, 2026

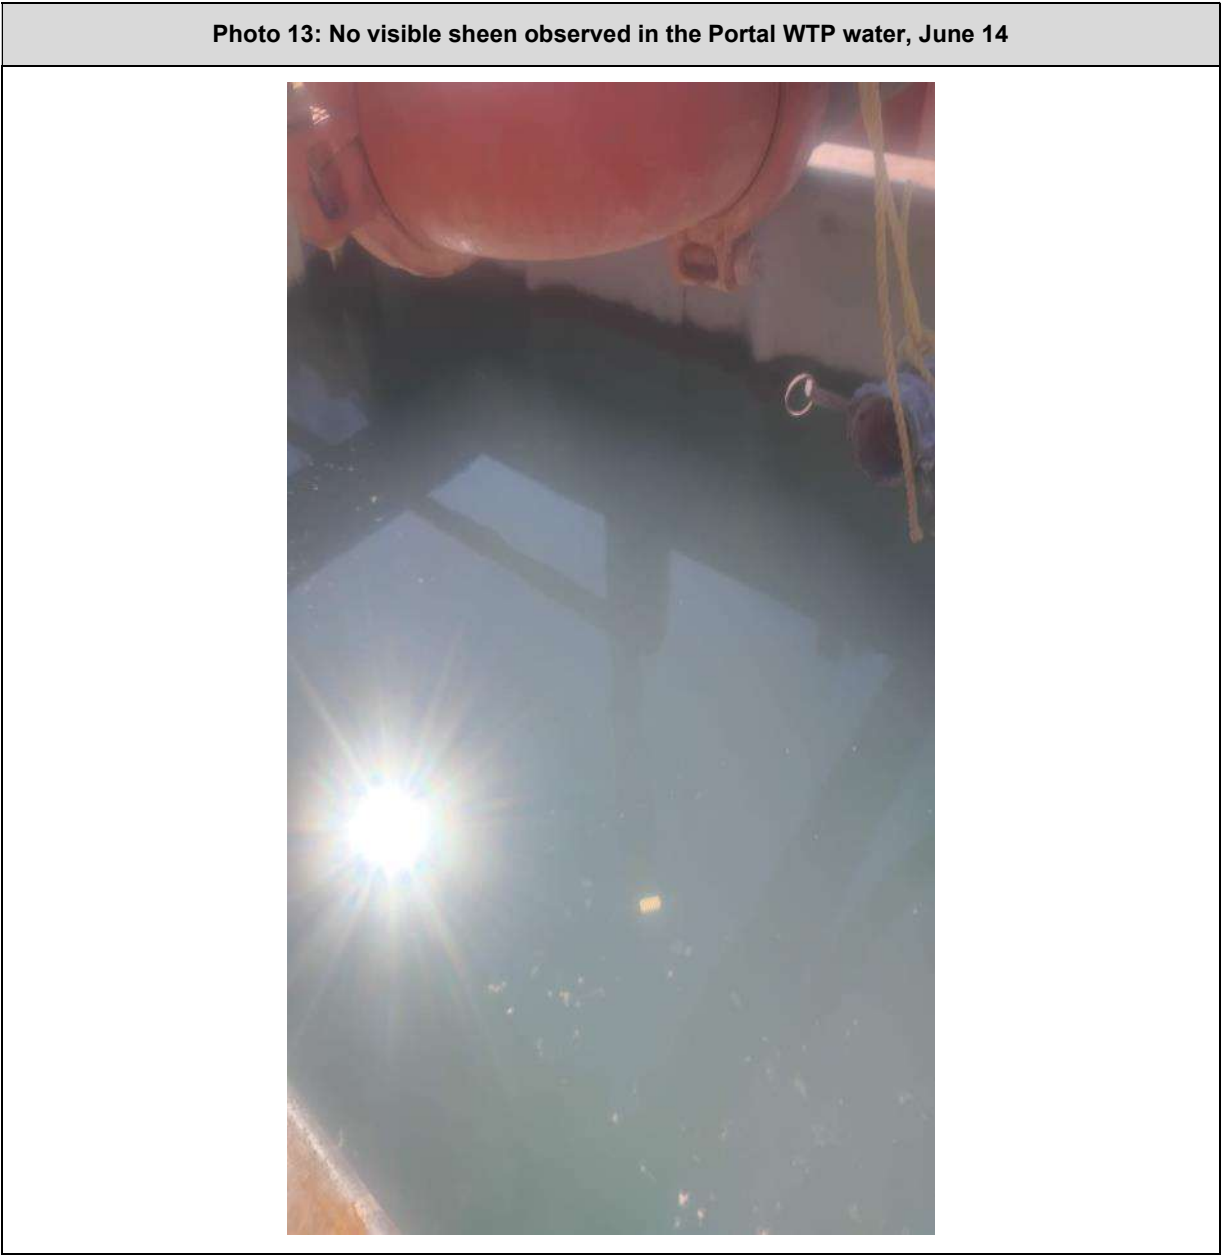

		Eagle Mountain- Woodfibre Gas Pipeline Project- Tunnel Scope	
Title	Woodfibre Weekly Water Discharge Report	Revision:	1
Data Range	June 8, 2026 to June 14, 2026	Prepared by: BC1 Approved by: BC2 Date: July 16, 2026	

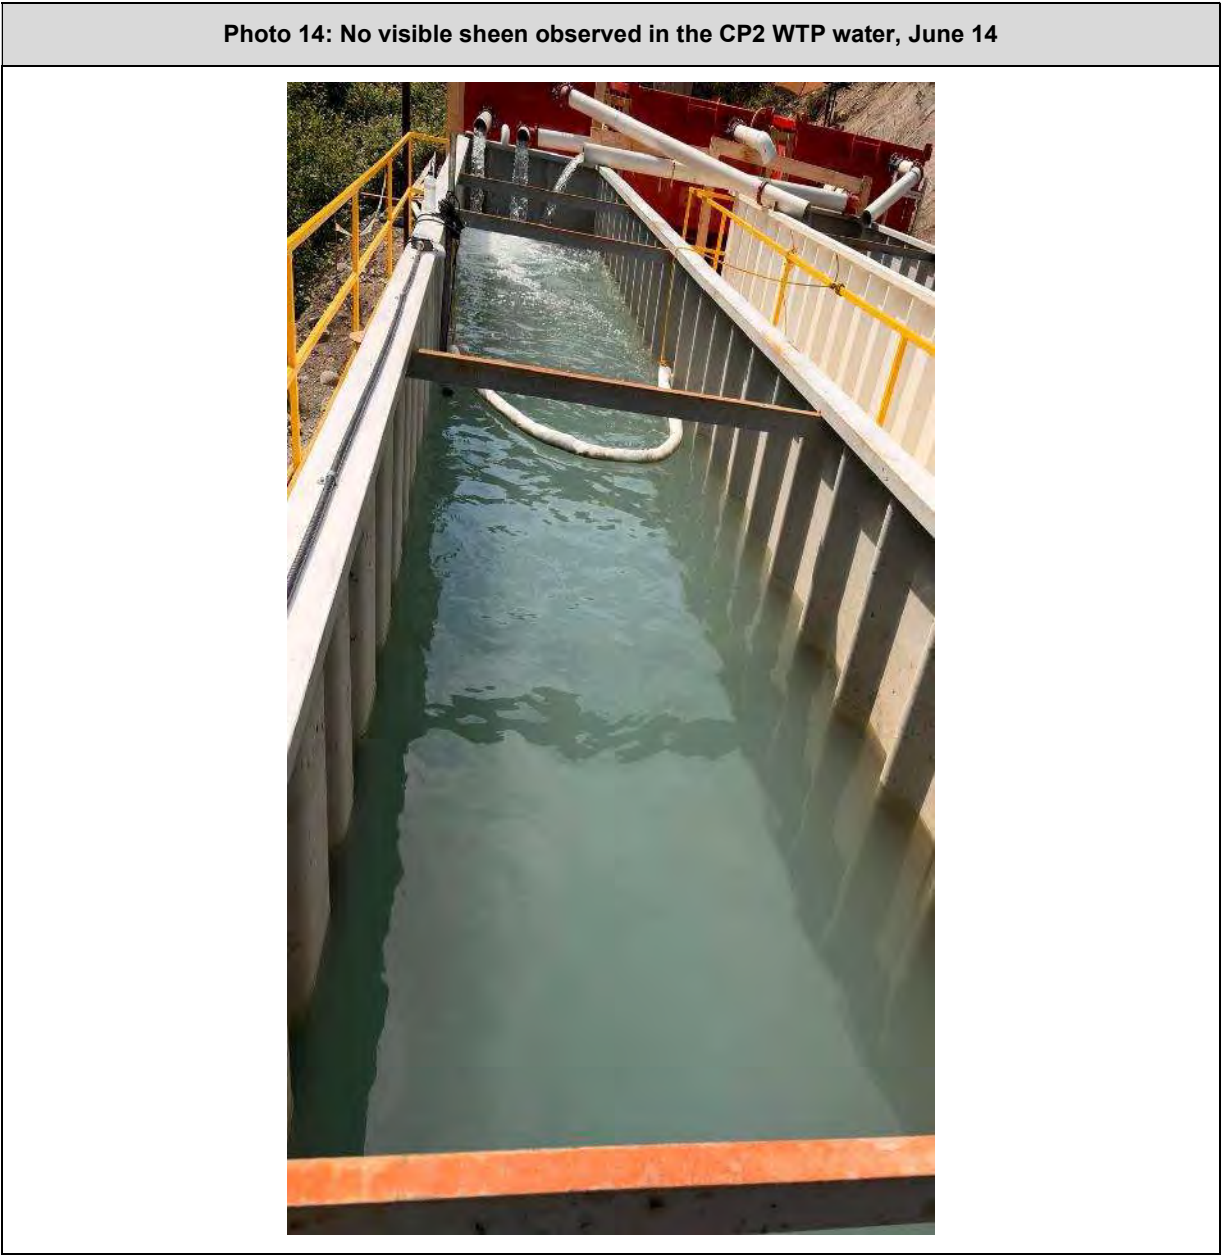

Water Quality Field Data Sheet



Project: FORTIS11234

Location Information

Site ID:	<u>WLNG EOP</u>	Date:	<u>June 9, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>9:16</u>
Crew:	<u>HM</u>		
Weather:	<u>Cloudy/light rain</u>		

In Situ Parameters

pH:	<u>7.2</u>	DO:	<u>4.63</u> (mg/L)
Temp:	<u>12.3</u> (°C)	Cond:	<u>267.7</u> (us/cm)
Turbidity:	<u>2.88</u> NTU	Salinity:	<u>0.13</u> (ppt)
		ORP:	<u>154.7</u> (mV)

Visible Sheen: N

Water Surface Condition: Clear

Photo Record



Observations

No issues observed

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix D	D-1

Appendix D:
Woodfibre Site Receiving Environment
Documentation

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix D	D-2

Woodfibre Site Receiving Environment
Sample Analysis

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-06-09 10:05:00	WLNG DS 2026-06-09 09:44:00
In situ Parameters									
Field pH	pH Units	6.5 - 9			7 - 8.7			7.6	7.8
Field Temperature	°C	18	19					11.1	11.7
General Parameters									
pH	pH Units							6.77	7.55
Alkalinity (Total as CaCO ₃)	mg/L							7.4	68
Alkalinity (PP as CaCO ₃)	mg/L							<1	<1
Hardness (CaCO ₃)-Total	mg/L							9.15	117
Hardness (CaCO ₃)-Dissolved	mg/L							8.63	109
Sulphide-Total	mg/L							<0.0018	<0.0018
Sulphide (as H ₂ S)	mg/L			0.002				<0.002	<0.002
Un-ionized Hydrogen Sulfide as H ₂ S-Total	mg/L							<0.0019	<0.0019
Un-ionized Hydrogen Sulfide as S-Total	mg/L							<0.0018	<0.0018
Anions and Nutrients									
Ammonia (N)-Total	mg/L	1.56	11		3.1	21		<0.015	<0.015
Bicarbonate (HCO ₃)	mg/L							9	83
Carbonate (CO ₃)	mg/L							<1	<1
Hydroxide (OH)	mg/L							<1	<1
Nitrate (N)	mg/L	3	32.8		3.7			0.023	0.477
Nitrite (N)	mg/L	0.02	0.06					<0.005	0.0095
Nitrate plus Nitrite (N)	mg/L							0.023	0.487
Nitrogen (N)-Total	mg/L							0.08	0.744
Phosphorus (P)-Total (4500-P)	mg/L							0.027	0.0087
Bromide (Br)	mg/L							<0.01	<0.01
Chloride (Cl)	mg/L	150	600					<1	13
Fluoride (F)	mg/L		0.4			1.5		<0.05	0.34
Sulphate (SO4)-Dissolved	mg/L	128						2.1	21
Total Metals									
Aluminum (Al)-Total	mg/L	0.1376954						0.0768	1.46
Antimony (Sb)-Total	mg/L	0.074	0.25					0.000036	0.000781
Arsenic (As)-Total	mg/L	0.005			0.0125			0.000145	0.00173
Barium (Ba)-Total	mg/L			1				0.00496	0.0115
Beryllium (Be)-Total	mg/L			0.00013			0.1	<0.00001	<0.00001
Bismuth (Bi)-Total	mg/L							<0.000005	<0.00001
Boron (B)-Total	mg/L	1.2			1.2			<0.01	<0.01
Cadmium (Cd)-Total	mg/L						0.00012	0.0000073	<0.000005
Calcium (Ca)-Total	mg/L							3.03	44.2
Cesium (Cs)-Total	mg/L							<0.00005	<0.00005
Chromium (Cr)-Total	mg/L							<0.0001	0.00429
Chromium (Cr III)-Total	mg/L			0.0089			0.056	<0.00099	0.0043
Chromium (Cr VI)-Total	mg/L			0.0025			0.0015	<0.00099	<0.00099

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-06-09 10:05:00	WLNG DS 2026-06-09 09:44:00
Total Metals (Cont'd.)									
Cobalt (Co)-Total	mg/L							0.0000295	0.000075
Copper (Cu)-Total	mg/L				0.002	0.003		0.000776	0.00101
Iron (Fe)-Total	mg/L	0.14	1					0.0585	0.197
Lead (Pb)-Total	mg/L				0.002	0.14		0.0000248	0.000043
Lithium (Li)-Total	mg/L							<0.0005	0.00442
Magnesium (Mg)-Total	mg/L							0.384	1.54
Manganese (Mn)-Total	mg/L						0.1	0.00196	0.0273
Mercury (Hg)-Total	mg/L	0.00002			0.0001			<0.0000019	<0.0000019
Molybdenum (Mo)-Total	mg/L	7.6	46					0.000704	0.0357
Nickel (Ni)-Total	mg/L						0.0083	0.000231	0.00042
Phosphorus (P)-Total (ICPMS)	mg/L							0.0237	0.0082
Potassium (K)-Total	mg/L							0.258	1.89
Rubidium (Rb)-Total	mg/L							0.000506	0.00414
Selenium (Se)-Total	mg/L	0.002			0.002			<0.00004	0.000091
Silicon (Si)-Total	mg/L							4.23	10.8
Silver (Ag)-Total	mg/L	0.00012			0.0005	0.0037	0.0005	<0.000005	<0.00001
Sodium (Na)-Total	mg/L							1.64	6.96
Strontium (Sr)-Total	mg/L							0.0138	0.0741
Sulphur (S)-Total	mg/L							<3	7
Tellurium (Te)-Total	mg/L							<0.00002	<0.00002
Thallium (Tl)-Total	mg/L			0.00003				0.0000029	0.0000085
Thorium (Th)-Total	mg/L							<0.00005	<0.00005
Tin (Sn)-Total	mg/L							<0.0002	<0.0002
Titanium (Ti)-Total	mg/L							0.00149	0.0023
Uranium (U)-Total	mg/L		0.0165	0.0075				0.0000696	0.00434
Vanadium (V)-Total	mg/L			0.06			0.005	0.00023	0.00209
Zinc (Zn)-Total	mg/L				0.01	0.055		0.00128	0.0023
Zirconium (Zr)-Total	mg/L							<0.0001	0.00013
Dissolved Metals									
Aluminum (Al)-Dissolved	mg/L							0.0406	1.29
Antimony (Sb)-Dissolved	mg/L							0.00003	0.000737
Arsenic (As)-Dissolved	mg/L							0.000144	0.0017
Barium (Ba)-Dissolved	mg/L							0.00421	0.0112
Beryllium (Be)-Dissolved	mg/L							0.000011	<0.00001
Bismuth (Bi)-Dissolved	mg/L							<0.000005	<0.000005
Boron (B)-Dissolved	mg/L							<0.01	<0.01
Cadmium (Cd)-Dissolved	mg/L	0.0000364	0.0000501					0.0000059	0.0000114
Calcium (Ca)-Dissolved	mg/L							2.86	41.2
Cesium (Cs)-Dissolved	mg/L							<0.00005	<0.00005
Chromium (Cr)-Dissolved	mg/L							<0.0001	0.00393

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

Analyte	Unit	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Freshwater Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Freshwater Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Long Term Average	BC Approved Water Quality Guideline - Marine Aquatic Life - Short Term Max	BC Working Water Quality Guideline - Marine Aquatic Life - Long Term Average	WLNG US 2026-06-09 10:05:00	WLNG DS 2026-06-09 09:44:00
Dissolved Metals (Cont'd.)									
Cobalt (Co)-Dissolved	mg/L	0.0003889						0.0000272	0.0000803
Copper (Cu)-Dissolved	mg/L	0.00064	0.00366					0.000737	0.000822
Iron (Fe)-Dissolved	mg/L							0.0239	0.139
Lead (Pb)-Dissolved	mg/L	0.0019043						0.0000126	0.0000058
Lithium (Li)-Dissolved	mg/L							<0.0005	0.00399
Manganese (Mn)-Dissolved	mg/L	0.185	0.4076988					0.000847	0.0264
Magnesium (Mg)-Dissolved	mg/L							0.363	1.51
Mercury (Hg)-Dissolved	mg/L							<0.0000019	<0.0000019
Molybdenum (Mo)-Dissolved	mg/L							0.000671	0.0344
Nickel (Ni)-Dissolved	mg/L	0.0009	0.0129					0.000306	0.00042
Phosphorus (P)-Dissolved	mg/L							0.0219	0.0037
Potassium (K)-Dissolved	mg/L							0.233	1.76
Rubidium (Rb)-Dissolved	mg/L							0.000422	0.00408
Selenium (Se)-Dissolved	mg/L							<0.00004	0.000086
Silicon (Si)-Dissolved	mg/L							4.29	10.2
Silver (Ag)-Dissolved	mg/L							<0.000005	<0.000005
Sodium (Na)-Dissolved	mg/L							1.55	6.51
Strontium (Sr)-Dissolved	mg/L			1.25				0.0131	0.0714
Sulphur (S)-Dissolved	mg/L							<3	6.8
Tellurium (Te)-Dissolved	mg/L							<0.00002	<0.00002
Thallium (Tl)-Dissolved	mg/L							0.0000026	0.0000097
Thorium (Th)-Dissolved	mg/L							0.0000088	0.0000068
Tin (Sn)-Dissolved	mg/L							<0.0002	<0.0002
Titanium (Ti)-Dissolved	mg/L							<0.0005	<0.0005
Uranium (U)-Dissolved	mg/L							0.0000544	0.004
Vanadium (V)-Dissolved	mg/L							<0.0002	0.00196
Zinc (Zn)-Dissolved	mg/L	0.002872	0.009199					0.00077	0.00145
Zirconium (Zr)-Dissolved	mg/L							<0.0001	<0.0001
Inorganics									
Organic Carbon (C)-Total	mg/L							2.5	30
Organic Carbon (C)-Dissolved	mg/L							2.3	26
Solids-Total Dissolved	mg/L							24	190
Solids-Total Suspended	mg/L	6	26					<1	4.4

¹ Guideline calculated using the in-situ measurements (pH (field),Temperature (field), Turbidity (field), Hardness (as CaCO₃) – total, Dissolved Organic Carbon (DOC), Total Alkalinity (CaCO₃), and Chloride).

² Guideline values presented represent the lower of the co-factor dependent guidelines for the upstream and downstream stations when they differ, but exceedance bolding is dependent on guidelines calculated using in situ co-factor considerations.

³ **Bold text** denotes value exceeding guidelines, except in cases where they are below a station-specific guideline that isn't displayed as per ¹ and ² above. Given that application of chronic BC water quality guidelines for protection of aquatic life in the receiving environment downstream of the discharge does not represent a regulatory requirement and instead data are intended to be assessed relative to monthly average concentrations, exceedances of these guidelines are highlighted for information purposes, but detailed interpretation of guideline exceedances are not provided given that an interpretation of monthly trends and consideration of background influences and discharge chemistry is required.

⁴ **Bold and shaded text** outlines a reportable exceedance given that it exceeds the applicable BC water quality guideline (i.e., the short-term acute freshwater aquatic life guideline), consistent with recommendations outlined in Hatfield (2024).

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix D	D-3

Woodfibre Site Receiving Environment
Field Notes and Logs

Water Quality Field Data Sheet



Project: FORTIS11234

Location Information

Site ID:	<u>WLNG (EAS) DS</u>	Date:	<u>June 9, 2026</u>
Site Name:	<u>East Creek</u>	Time:	<u>9:44</u>
Site UTM:	Zone: 10U E: <u>482092</u>	Crew:	<u>HM</u>
(NAD83)	N: <u>5501875</u>	Weather:	<u>Cloudy/light rain</u>

In Situ Parameters

pH:	<u>7.79</u>	DO:	<u>5.25</u> (mg/L)
Temp:	<u>11.7</u> (°C)	Cond:	<u>226.1</u> (us/cm)
Turbidity:	<u>0</u> NTU	Salinity:	<u>0.11</u> (ppt)
Visible Sheen:	<u>N</u>	ORP:	<u>124</u> (mV)

Water Surface Condition: Clear

Photo Record



Observations

No issues observed

Water Quality Field Data Sheet



Project: FORTIS11234

Location Information

Site ID:	<u>WLNG (EAS) US</u>		Date:	<u>June 9, 2026</u>
Site Name:	<u>East Creek</u>		Time:	<u>10:05</u>
Site UTM:	Zone:10U	E: <u>481908</u>	Crew:	<u>HM</u>
(NAD83)		N: <u>5501909</u>	Weather:	<u>Cloudy/light rain</u>

In Situ Parameters

pH:	<u>7.55</u>	DO:	<u>4.59</u>	(mg/L)
Temp.:	<u>11.1</u>	Cond:	<u>56</u>	(us)
Turbidity:	<u>0</u>	Salinity:	<u>0.03</u>	(ppt)
Visible Sheen:	<u>N</u>	ORP:	<u>101.5</u>	(mV)
Water Surface Condition:	<u>Clear</u>			

Photo Record



Observations

No issues observed

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-08 00:00:00	11.59	147.91	0.30	7.90	10.03	9.26	0.07
EAS-DS	2026-06-08 00:15:00	11.56	146.21	0.30	7.88	9.32	10.04	0.07
EAS-DS	2026-06-08 00:30:00	11.52	154.26	0.30	7.88	10.08	9.59	0.07
EAS-DS	2026-06-08 00:45:00	11.51	148.53	0.30	7.88	9.62	9.15	0.07
EAS-DS	2026-06-08 01:00:00	11.53	145.68	0.30	7.90	9.99	9.11	0.07
EAS-DS	2026-06-08 01:15:00	11.43	152.95	0.30	7.87	9.26	9.35	0.07
EAS-DS	2026-06-08 01:30:00	11.43	159.74	0.30	7.88	10.11	9.40	0.08
EAS-DS	2026-06-08 01:45:00	11.46	148.78	0.30	7.88	9.52	9.18	0.07
EAS-DS	2026-06-08 02:00:00	11.45	144.01	0.30	7.88	9.95	9.43	0.07
EAS-DS	2026-06-08 02:15:00	11.38	157.77	0.31	7.86	9.34	9.22	0.07
EAS-DS	2026-06-08 02:30:00	11.41	147.65	0.30	7.89	9.95	9.44	0.07
EAS-DS	2026-06-08 02:45:00	11.26	160.50	0.31	7.83	9.57	9.79	0.08
EAS-DS	2026-06-08 03:00:00	11.30	160.95	0.30	7.87	10.14	9.79	0.08
EAS-DS	2026-06-08 03:15:00	11.28	159.44	0.31	7.87	9.64	9.29	0.08
EAS-DS	2026-06-08 03:30:00	11.31	153.54	0.31	7.88	10.11	9.13	0.07
EAS-DS	2026-06-08 03:45:00	11.37	146.99	0.31	7.87	9.49	9.09	0.07
EAS-DS	2026-06-08 04:00:00	11.34	149.95	0.30	7.89	10.02	9.23	0.07
EAS-DS	2026-06-08 04:15:00	11.33	150.43	0.31	7.86	9.48	9.09	0.07
EAS-DS	2026-06-08 04:30:00	11.22	154.66	0.30	7.88	10.14	10.11	0.07
EAS-DS	2026-06-08 04:45:00	11.28	151.43	0.31	7.86	9.48	9.29	0.07
EAS-DS	2026-06-08 05:00:00	11.24	150.99	0.30	7.88	10.09	9.34	0.07
EAS-DS	2026-06-08 05:15:00	11.24	149.75	0.31	7.85	9.71	9.21	0.07
EAS-DS	2026-06-08 05:30:00	11.30	147.11	0.30	7.89	10.07	9.14	0.07
EAS-DS	2026-06-08 05:45:00	11.27	146.69	0.31	7.82	9.77	9.49	0.07
EAS-DS	2026-06-08 06:00:00	11.26	148.93	0.30	7.88	10.08	9.14	0.07
EAS-DS	2026-06-08 06:15:00	11.17	149.93	0.31	7.85	9.46	9.45	0.07
EAS-DS	2026-06-08 06:30:00	11.25	149.66	0.31	7.88	10.17	9.27	0.07
EAS-DS	2026-06-08 06:45:00	11.33	147.63	0.31	7.85	9.95	9.28	0.07
EAS-DS	2026-06-08 07:00:00	11.19	147.03	0.31	7.89	10.12	45.93	0.07
EAS-DS	2026-06-08 07:15:00	11.35	146.87	0.31	7.87	9.67	9.17	0.07
EAS-DS	2026-06-08 07:30:00	11.36	143.87	0.31	7.88	10.05	9.08	0.07
EAS-DS	2026-06-08 07:45:00	11.38	146.04	0.31	7.84	9.80	9.31	0.07
EAS-DS	2026-06-08 08:00:00	11.29	146.54	0.31	7.89	10.11	9.11	0.07
EAS-DS	2026-06-08 08:15:00	11.31	149.09	0.31	7.87	9.38	13.35	0.07
EAS-DS	2026-06-08 08:30:00	11.34	148.29	0.30	7.89	9.98	9.20	0.07
EAS-DS	2026-06-08 08:45:00	11.36	149.04	0.31	7.88	9.48	9.19	0.07
EAS-DS	2026-06-08 09:00:00	11.41	143.50	0.30	7.90	10.08	9.23	0.07
EAS-DS	2026-06-08 09:15:00	11.46	147.05	0.31	7.87	9.12	9.52	0.07
EAS-DS	2026-06-08 09:30:00	11.47	145.85	0.30	7.90	10.00	9.14	0.07
EAS-DS	2026-06-08 09:45:00	11.53	143.81	0.31	7.88	9.69	9.46	0.07
EAS-DS	2026-06-08 10:00:00	11.56	142.53	0.31	7.90	10.00	9.44	0.07
EAS-DS	2026-06-08 10:15:00	11.63	143.43	0.31	7.90	9.37	10.68	0.07
EAS-DS	2026-06-08 10:30:00	11.65	142.18	0.31	7.91	9.93	9.35	0.07
EAS-DS	2026-06-08 10:45:00	11.71	143.35	0.31	7.91	9.18	9.34	0.07
EAS-DS	2026-06-08 11:00:00	11.82	142.11	0.31	7.90	9.91	9.26	0.07
EAS-DS	2026-06-08 11:15:00	11.88	148.04	0.31	7.88	8.64	9.44	0.07
EAS-DS	2026-06-08 11:30:00	11.89	146.35	0.31	7.91	9.91	11.92	0.07
EAS-DS	2026-06-08 11:45:00	12.06	148.58	0.31	7.90	9.63	9.11	0.07
EAS-DS	2026-06-08 12:00:00	12.09	146.31	0.30	7.92	9.82	9.13	0.07
EAS-DS	2026-06-08 12:15:00	12.24	155.20	0.31	7.91	9.79	10.29	0.07
EAS-DS	2026-06-08 12:30:00	12.14	147.47	0.30	7.90	9.78	9.15	0.07
EAS-DS	2026-06-08 12:45:00	12.22	156.58	0.31	7.88	8.20	9.16	0.07
EAS-DS	2026-06-08 13:00:00	12.22	148.48	0.30	7.91	9.56	9.20	0.07
EAS-DS	2026-06-08 13:15:00	12.22	155.68	0.31	7.85	8.59	10.03	0.07
EAS-DS	2026-06-08 13:30:00	12.16	144.36	0.31	7.89	9.53	9.17	0.07
EAS-DS	2026-06-08 13:45:00	12.16	137.29	0.31	7.84	9.66	9.22	0.06
EAS-DS	2026-06-08 14:00:00	12.18	148.84	0.31	7.89	9.22	13.69	0.07

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-08 14:15:00	12.12	150.73	0.31	7.88	8.37	9.14	0.07
EAS-DS	2026-06-08 14:30:00	12.13	153.90	0.31	7.89	9.54	10.50	0.07
EAS-DS	2026-06-08 14:45:00	12.09	151.78	0.31	7.88	8.64	9.14	0.07
EAS-DS	2026-06-08 15:00:00	12.15	154.51	0.31	7.92	9.64	10.22	0.07
EAS-DS	2026-06-08 15:15:00	12.11	150.91	0.31	7.90	8.59	9.15	0.07
EAS-DS	2026-06-08 15:30:00	12.29	154.70	0.31	7.91	9.38	9.25	0.07
EAS-DS	2026-06-08 15:45:00	12.26	145.98	0.31	7.85	9.48	9.22	0.07
EAS-DS	2026-06-08 16:00:00	12.21	154.88	0.31	7.88	9.78	9.24	0.07
EAS-DS	2026-06-08 16:15:00	12.10	152.24	0.31	7.87	8.02	9.37	0.07
EAS-DS	2026-06-08 16:30:00	12.22	156.95	0.31	7.89	9.00	9.27	0.07
EAS-DS	2026-06-08 16:45:00	12.12	153.42	0.31	7.89	8.55	9.23	0.07
EAS-DS	2026-06-08 17:00:00	12.17	154.91	0.31	7.90	9.69	9.28	0.07
EAS-DS	2026-06-08 17:15:00	12.16	136.27	0.31	7.79	9.58	9.29	0.06
EAS-DS	2026-06-08 17:30:00	12.21	151.33	0.31	7.88	9.43	9.90	0.07
EAS-DS	2026-06-08 17:45:00	12.19	157.97	0.31	7.85	7.68	11.39	0.07
EAS-DS	2026-06-08 18:00:00	12.07	154.17	0.31	7.88	9.69	9.63	0.07
EAS-DS	2026-06-08 18:15:00	12.12	158.51	0.31	7.85	8.90	9.40	0.08
EAS-DS	2026-06-08 18:30:00	12.12	153.18	0.31	7.89	9.74	9.16	0.07
EAS-DS	2026-06-08 18:45:00	12.14	154.25	0.31	7.84	9.21	9.24	0.07
EAS-DS	2026-06-08 19:00:00	12.03	154.88	0.31	7.89	9.59	9.16	0.07
EAS-DS	2026-06-08 19:15:00	12.06	158.26	0.31	7.86	8.01	9.26	0.07
EAS-DS	2026-06-08 19:30:00	11.98	154.98	0.31	7.88	9.57	9.12	0.07
EAS-DS	2026-06-08 19:45:00	12.04	156.56	0.31	7.88	7.85	9.28	0.07
EAS-DS	2026-06-08 20:00:00	11.94	153.46	0.31	7.88	9.10	9.32	0.07
EAS-DS	2026-06-08 20:15:00	11.93	157.30	0.31	7.88	8.02	9.32	0.07
EAS-DS	2026-06-08 20:30:00	11.85	151.89	0.31	7.88	8.78	9.15	0.07
EAS-DS	2026-06-08 20:45:00	11.90	155.61	0.31	7.86	7.43	9.10	0.07
EAS-DS	2026-06-08 21:00:00	11.84	141.87	0.31	7.85	9.64	9.45	0.07
EAS-DS	2026-06-08 21:15:00	11.73	152.14	0.31	7.85	7.59	9.13	0.07
EAS-DS	2026-06-08 21:30:00	11.75	155.94	0.31	7.86	8.67	9.66	0.07
EAS-DS	2026-06-08 21:45:00	11.72	149.34	0.31	7.84	8.75	9.21	0.07
EAS-DS	2026-06-08 22:00:00	11.70	155.53	0.31	7.85	8.80	39.78	0.07
EAS-DS	2026-06-08 22:15:00	11.66	155.99	0.31	7.82	8.72	9.58	0.07
EAS-DS	2026-06-08 22:30:00	11.64	155.04	0.31	7.83	8.13	9.62	0.07
EAS-DS	2026-06-08 22:45:00	11.65	150.25	0.31	7.86	9.72	9.26	0.07
EAS-DS	2026-06-08 23:00:00	11.63	155.47	0.31	7.84	8.74	9.18	0.07
EAS-DS	2026-06-08 23:15:00	11.60	153.93	0.31	7.85	8.87	9.14	0.07
EAS-DS	2026-06-08 23:30:00	11.69	153.92	0.31	7.87	9.86	9.75	0.07
EAS-DS	2026-06-08 23:45:00	11.59	153.17	0.31	7.81	7.95	9.20	0.07
EAS-DS	2026-06-09 00:00:00	11.71	155.93	0.31	7.86	9.68	9.13	0.07
EAS-DS	2026-06-09 00:15:00	11.58	157.12	0.32	7.81	7.96	9.13	0.07
EAS-DS	2026-06-09 00:30:00	11.73	155.16	0.31	7.85	9.45	9.43	0.07
EAS-DS	2026-06-09 00:45:00	11.59	157.68	0.32	7.79	8.01	13.02	0.07
EAS-DS	2026-06-09 01:00:00	11.56	156.51	0.32	7.84	8.33	18.53	0.07
EAS-DS	2026-06-09 01:15:00	11.60	157.29	0.32	7.81	8.07	9.10	0.07
EAS-DS	2026-06-09 01:30:00	11.56	142.36	0.32	7.80	9.72	9.14	0.07
EAS-DS	2026-06-09 01:45:00	11.68	149.48	0.32	7.81	8.44	13.22	0.07
EAS-DS	2026-06-09 02:00:00	11.60	159.38	0.32	7.75	7.68	9.70	0.08
EAS-DS	2026-06-09 02:15:00	11.58	159.45	0.32	7.78	8.36	14.83	0.08
EAS-DS	2026-06-09 02:30:00	11.62	156.55	0.32	7.84	9.54	9.12	0.07
EAS-DS	2026-06-09 02:45:00	11.68	150.31	0.32	7.82	7.83	9.12	0.07
EAS-DS	2026-06-09 03:00:00	11.55	141.40	0.32	7.67	9.03	9.66	0.07
EAS-DS	2026-06-09 03:15:00	11.54	152.86	0.32	7.79	7.13	9.20	0.07
EAS-DS	2026-06-09 03:30:00	11.59	157.80	0.32	7.77	9.77	9.28	0.07
EAS-DS	2026-06-09 03:45:00	11.57	148.43	0.32	7.81	9.00	9.28	0.07
EAS-DS	2026-06-09 04:00:00	11.68	152.48	0.31	7.83	9.80	9.55	0.07
EAS-DS	2026-06-09 04:15:00	11.49	151.22	0.32	7.81	9.09	9.14	0.07

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-09 04:30:00	11.69	151.74	0.31	7.83	9.82	9.26	0.07
EAS-DS	2026-06-09 04:45:00	11.59	153.80	0.32	7.78	9.02	11.48	0.07
EAS-DS	2026-06-09 05:00:00	11.55	152.30	0.31	7.81	9.66	9.69	0.07
EAS-DS	2026-06-09 05:15:00	11.61	147.85	0.31	7.81	9.62	9.14	0.07
EAS-DS	2026-06-09 05:30:00	11.56	139.36	0.32	7.74	9.58	9.40	0.07
EAS-DS	2026-06-09 05:45:00	11.67	175.13	0.30	8.27	9.00	9.59	0.08
EAS-DS	2026-06-09 06:00:00	11.74	261.60	0.29	8.84	9.44	14.53	0.13
EAS-DS	2026-06-09 06:15:00	11.67	237.78	0.28	8.44	9.12	14.76	0.11
EAS-DS	2026-06-09 06:30:00	11.73	299.87	0.28	8.40	9.22	20.07	0.14
EAS-DS	2026-06-09 06:45:00	11.62	283.25	0.29	7.90	5.51	11.40	0.14
EAS-DS	2026-06-09 07:00:00	11.66	318.21	0.30	7.95	9.41	20.89	0.15
EAS-DS	2026-06-09 07:15:00	11.76	325.32	0.29	7.99	8.77	11.12	0.16
EAS-DS	2026-06-09 07:30:00	11.73	325.38	0.29	7.93	8.99	11.29	0.16
EAS-DS	2026-06-09 07:45:00	11.57	272.65	0.29	7.91	9.61	10.53	0.13
EAS-DS	2026-06-09 08:00:00	11.71	295.31	0.29	7.91	7.72	9.85	0.14
EAS-DS	2026-06-09 08:15:00	11.66	243.85	0.29	7.86	8.60	9.60	0.12
EAS-DS	2026-06-09 08:30:00	11.72	267.91	0.29	7.80	9.31	9.47	0.13
EAS-DS	2026-06-09 08:45:00	11.70	263.74	0.30	7.58	7.46	9.46	0.13
EAS-DS	2026-06-09 09:00:00	11.80	268.64	0.29	7.80	9.14	9.24	0.13
EAS-DS	2026-06-09 09:15:00	11.80	239.49	0.29	7.91	8.47	13.37	0.11
EAS-DS	2026-06-09 09:30:00	11.86	227.48	0.29	7.96	9.26	9.93	0.11
EAS-DS	2026-06-09 09:45:00	11.83	216.90	0.29	7.90	9.48	93.13	0.10
EAS-DS	2026-06-09 10:00:00	11.85	211.66	0.21	7.96	9.90	10.59	0.10
EAS-DS	2026-06-09 10:15:00	11.81	200.95	0.22	7.93	9.85	10.35	0.10
EAS-DS	2026-06-09 10:30:00	11.83	201.95	0.23	7.92	9.97	10.50	0.10
EAS-DS	2026-06-09 10:45:00	11.77	223.85	0.24	7.81	10.04	11.80	0.11
EAS-DS	2026-06-09 11:00:00	11.82	204.49	0.24	7.86	9.81	9.84	0.10
EAS-DS	2026-06-09 11:15:00	11.84	200.41	0.25	7.89	9.96	19.10	0.10
EAS-DS	2026-06-09 11:30:00	11.81	223.31	0.25	7.83	10.03	15.24	0.11
EAS-DS	2026-06-09 11:45:00	11.89	211.88	0.24	8.28	9.96	16.08	0.10
EAS-DS	2026-06-09 12:00:00	11.94	221.52	0.25	7.81	10.00	15.54	0.11
EAS-DS	2026-06-09 12:15:00	11.80	225.46	0.26	7.81	10.00	13.47	0.11
EAS-DS	2026-06-09 12:30:00	11.94	211.69	0.25	7.90	9.92	11.40	0.10
EAS-DS	2026-06-09 12:45:00	11.97	203.70	0.26	7.90	9.89	10.47	0.10
EAS-DS	2026-06-09 13:00:00	12.01	211.36	0.25	7.91	9.90	9.93	0.10
EAS-DS	2026-06-09 13:15:00	11.94	234.06	0.26	7.89	10.05	10.75	0.11
EAS-DS	2026-06-09 13:30:00	12.02	223.43	0.26	7.91	9.97	13.72	0.11
EAS-DS	2026-06-09 13:45:00	12.01	237.63	0.26	7.88	10.01	13.97	0.11
EAS-DS	2026-06-09 14:00:00	12.06	233.25	0.26	7.91	9.94	15.95	0.11
EAS-DS	2026-06-09 14:15:00	12.02	244.11	0.26	7.91	10.00	12.89	0.12
EAS-DS	2026-06-09 14:30:00	12.14	235.07	0.26	7.94	9.94	11.40	0.11
EAS-DS	2026-06-09 14:45:00	12.12	246.19	0.26	7.92	9.97	10.97	0.12
EAS-DS	2026-06-09 15:00:00	12.11	239.19	0.26	7.93	9.98	9.85	0.11
EAS-DS	2026-06-09 15:15:00	12.08	240.38	0.26	7.78	8.80	10.76	0.11
EAS-DS	2026-06-09 15:30:00	12.06	202.01	0.26	7.75	7.21	14.00	0.10
EAS-DS	2026-06-09 15:45:00	12.07	192.95	0.27	7.89	9.92	23.59	0.09
EAS-DS	2026-06-09 16:00:00	12.08	165.34	0.26	7.85	9.99	17.97	0.08
EAS-DS	2026-06-09 16:15:00	12.04	146.78	0.27	7.79	10.02	23.08	0.07
EAS-DS	2026-06-09 16:30:00	12.13	170.08	0.26	7.83	10.00	45.01	0.08
EAS-DS	2026-06-09 16:45:00	12.10	195.42	0.27	7.80	9.52	133.04	0.09
EAS-DS	2026-06-09 17:00:00	12.07	190.79	0.26	7.66	9.73	222.76	0.09
EAS-DS	2026-06-09 17:15:00	12.03	174.72	0.26	7.73	8.87	227.64	0.08
EAS-DS	2026-06-09 17:30:00	12.01	171.88	0.26	7.67	8.91	1957.66	0.08
EAS-DS	2026-06-09 17:45:00	12.00	158.55	0.25	7.68	8.59	841.82	0.08
EAS-DS	2026-06-09 18:00:00	12.06	134.71	0.25	7.71	9.61	237.16	0.06
EAS-DS	2026-06-09 18:15:00	12.04	142.29	0.25	7.71	9.11	2142.05	0.07
EAS-DS	2026-06-09 18:30:00	12.04	117.93	0.26	7.65	9.82	103.63	0.06

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-09 18:45:00	12.11	148.16	0.25	7.68	8.76	884.10	0.07
EAS-DS	2026-06-09 19:00:00	12.06	149.38	0.24	7.70	9.32	141.11	0.07
EAS-DS	2026-06-09 19:15:00	12.01	100.46	0.23	7.60	9.91	67.44	0.05
EAS-DS	2026-06-09 19:30:00	11.95	158.56	0.23	7.73	9.75	115.37	0.08
EAS-DS	2026-06-09 19:45:00	11.95	164.15	0.23	7.78	9.61	135.50	0.08
EAS-DS	2026-06-09 20:00:00	11.97	118.64	0.22	7.74	10.04	37.27	0.06
EAS-DS	2026-06-09 20:15:00	11.91	116.02	0.22	7.71	10.10	24.05	0.05
EAS-DS	2026-06-09 20:30:00	11.88	154.91	0.21	7.79	9.92	11.01	0.07
EAS-DS	2026-06-09 20:45:00	11.89	122.72	0.22	7.74	10.13	20.04	0.06
EAS-DS	2026-06-09 21:00:00	11.86	132.76	0.22	7.75	10.15	13.50	0.06
EAS-DS	2026-06-09 21:15:00	11.83	140.66	0.22	7.79	10.07	51.33	0.07
EAS-DS	2026-06-09 21:30:00	11.87	132.16	0.22	7.79	10.13	12.81	0.06
EAS-DS	2026-06-09 21:45:00	11.86	128.61	0.23	7.78	10.13	19.58	0.06
EAS-DS	2026-06-09 22:00:00	11.83	148.62	0.23	7.78	10.15	12.01	0.07
EAS-DS	2026-06-09 22:15:00	11.77	133.99	0.23	7.75	10.10	13.76	0.06
EAS-DS	2026-06-09 22:30:00	11.80	157.63	0.23	7.79	10.11	10.53	0.07
EAS-DS	2026-06-09 22:45:00	11.54	76.28	0.24	7.51	10.05	13.96	0.04
EAS-DS	2026-06-09 23:00:00	11.56	143.78	0.23	7.76	10.18	10.45	0.07
EAS-DS	2026-06-09 23:15:00	11.68	170.61	0.24	7.82	10.16	10.91	0.08
EAS-DS	2026-06-09 23:30:00	11.72	161.32	0.23	7.78	10.18	12.47	0.08
EAS-DS	2026-06-09 23:45:00	11.55	153.39	0.24	7.78	10.21	12.34	0.07
EAS-DS	2026-06-10 00:00:00	11.67	162.87	0.23	7.80	10.17	14.59	0.08
EAS-DS	2026-06-10 00:15:00	11.43	89.86	0.24	7.57	10.09	12.71	0.04
EAS-DS	2026-06-10 00:30:00	11.65	160.32	0.23	7.79	10.21	10.62	0.08
EAS-DS	2026-06-10 00:45:00	11.56	153.39	0.24	7.77	10.24	10.04	0.07
EAS-DS	2026-06-10 01:00:00	11.67	150.91	0.23	7.78	10.13	10.71	0.07
EAS-DS	2026-06-10 01:15:00	11.37	93.79	0.24	7.58	10.17	10.33	0.04
EAS-DS	2026-06-10 01:30:00	11.54	151.19	0.23	7.76	10.19	10.20	0.07
EAS-DS	2026-06-10 01:45:00	11.44	128.92	0.24	7.68	10.24	13.40	0.06
EAS-DS	2026-06-10 02:00:00	11.64	146.52	0.24	7.73	10.13	10.38	0.07
EAS-DS	2026-06-10 02:15:00	11.62	153.58	0.24	7.77	10.20	11.37	0.07
EAS-DS	2026-06-10 02:30:00	11.66	152.63	0.24	7.78	10.18	9.92	0.07
EAS-DS	2026-06-10 02:45:00	11.46	153.19	0.24	7.74	10.25	11.46	0.07
EAS-DS	2026-06-10 03:00:00	11.62	170.15	0.24	7.78	10.23	10.32	0.08
EAS-DS	2026-06-10 03:15:00	11.44	146.68	0.24	7.70	10.20	9.68	0.07
EAS-DS	2026-06-10 03:30:00	11.59	148.63	0.24	7.77	10.21	10.24	0.07
EAS-DS	2026-06-10 03:45:00	11.41	157.00	0.25	7.72	10.27	9.75	0.07
EAS-DS	2026-06-10 04:00:00	11.58	164.25	0.24	7.78	10.23	10.05	0.08
EAS-DS	2026-06-10 04:15:00	11.56	155.36	0.25	7.77	10.22	11.65	0.07
EAS-DS	2026-06-10 04:30:00	11.39	136.29	0.24	7.70	10.20	10.12	0.06
EAS-DS	2026-06-10 04:45:00	11.49	148.44	0.25	7.73	10.17	9.80	0.07
EAS-DS	2026-06-10 05:00:00	11.55	174.89	0.25	7.77	10.27	10.35	0.08
EAS-DS	2026-06-10 05:15:00	11.46	168.83	0.25	7.75	10.28	11.40	0.08
EAS-DS	2026-06-10 05:30:00	11.60	154.65	0.25	7.78	10.19	9.81	0.07
EAS-DS	2026-06-10 05:45:00	11.38	165.13	0.25	7.73	10.29	10.51	0.08
EAS-DS	2026-06-10 06:00:00	11.59	179.69	0.24	7.80	10.28	12.17	0.09
EAS-DS	2026-06-10 06:15:00	11.28	107.81	0.25	7.61	10.16	10.10	0.05
EAS-DS	2026-06-10 06:30:00	11.57	161.80	0.25	7.78	10.20	10.23	0.08
EAS-DS	2026-06-10 06:45:00	11.52	179.24	0.26	7.79	10.29	10.21	0.09
EAS-DS	2026-06-10 07:00:00	11.48	168.27	0.25	7.75	10.29	9.88	0.08
EAS-DS	2026-06-10 07:15:00	11.62	170.82	0.26	7.79	10.24	10.08	0.08
EAS-DS	2026-06-10 07:30:00	11.23	92.63	0.26	7.56	10.22	10.57	0.04
EAS-DS	2026-06-10 07:45:00	11.39	125.98	0.26	7.67	10.20	10.14	0.06
EAS-DS	2026-06-10 08:00:00	11.67	167.76	0.25	7.79	10.22	10.09	0.08
EAS-DS	2026-06-10 08:15:00	11.63	168.21	0.26	7.72	10.28	9.93	0.08
EAS-DS	2026-06-10 08:30:00	11.76	174.90	0.25	7.76	10.25	10.39	0.08
EAS-DS	2026-06-10 08:45:00	11.74	168.22	0.26	7.74	10.28	12.89	0.08

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-10 09:00:00	11.70	134.29	0.26	7.70	10.13	11.62	0.06
EAS-DS	2026-06-10 09:15:00	12.02	172.53	0.26	7.76	10.21	10.40	0.08
EAS-DS	2026-06-10 09:30:00	11.96	165.79	0.26	7.73	10.22	9.65	0.08
EAS-DS	2026-06-10 09:45:00	11.93	156.87	0.27	7.73	10.24	9.43	0.07
EAS-DS	2026-06-10 10:00:00	11.92	138.03	0.26	7.74	10.09	10.38	0.07
EAS-DS	2026-06-10 10:15:00	12.05	165.16	0.27	7.74	10.21	9.51	0.08
EAS-DS	2026-06-10 10:30:00	11.80	79.05	0.27	7.51	10.10	10.04	0.04
EAS-DS	2026-06-10 10:45:00	12.09	161.07	0.28	7.68	10.20	10.30	0.08
EAS-DS	2026-06-10 11:00:00	12.15	160.30	0.27	7.73	10.18	9.42	0.08
EAS-DS	2026-06-10 11:15:00	12.05	106.87	0.28	7.58	10.04	9.36	0.05
EAS-DS	2026-06-10 11:30:00	12.30	156.54	0.27	7.70	10.14	15.00	0.07
EAS-DS	2026-06-10 11:45:00	12.26	164.78	0.27	7.71	10.16	10.20	0.08
EAS-DS	2026-06-10 12:00:00	12.33	168.10	0.27	7.73	10.14	10.55	0.08
EAS-DS	2026-06-10 12:15:00	12.33	130.04	0.27	7.67	10.07	10.02	0.06
EAS-DS	2026-06-10 12:30:00	12.55	157.73	0.27	7.76	10.06	9.81	0.07
EAS-DS	2026-06-10 12:45:00	12.50	171.66	0.27	7.76	10.12	10.69	0.08
EAS-DS	2026-06-10 13:00:00	12.52	172.71	0.27	7.77	10.13	10.23	0.08
EAS-DS	2026-06-10 13:15:00	12.42	149.93	0.27	7.73	10.11	9.41	0.07
EAS-DS	2026-06-10 13:30:00	12.52	173.11	0.27	7.76	10.13	9.62	0.08
EAS-DS	2026-06-10 13:45:00	12.33	164.12	0.27	7.72	10.10	9.60	0.08
EAS-DS	2026-06-10 14:00:00	12.61	159.22	0.27	7.78	10.05	10.83	0.08
EAS-DS	2026-06-10 14:15:00	12.72	159.25	0.27	7.79	10.01	9.39	0.08
EAS-DS	2026-06-10 14:30:00	12.48	165.01	0.27	7.72	10.13	9.76	0.08
EAS-DS	2026-06-10 14:45:00	12.44	165.58	0.27	7.75	10.10	13.01	0.08
EAS-DS	2026-06-10 15:00:00	12.50	158.80	0.28	7.76	10.11	10.94	0.08
EAS-DS	2026-06-10 15:15:00	12.49	131.23	0.28	7.69	9.98	10.24	0.06
EAS-DS	2026-06-10 15:30:00	12.52	168.14	0.28	7.76	10.14	10.15	0.08
EAS-DS	2026-06-10 15:45:00	12.27	153.34	0.28	7.77	10.17	9.86	0.07
EAS-DS	2026-06-10 16:00:00	12.40	160.09	0.28	7.81	10.14	10.31	0.08
EAS-DS	2026-06-10 16:15:00	12.41	158.11	0.28	7.81	10.12	17.35	0.07
EAS-DS	2026-06-10 16:30:00	12.59	150.50	0.28	7.78	9.93	9.69	0.07
EAS-DS	2026-06-10 16:45:00	12.60	154.85	0.29	7.79	10.05	10.19	0.07
EAS-DS	2026-06-10 17:00:00	12.32	143.09	0.28	7.76	10.13	11.66	0.07
EAS-DS	2026-06-10 17:15:00	12.40	154.80	0.29	7.77	10.12	11.20	0.07
EAS-DS	2026-06-10 17:30:00	12.21	129.43	0.28	7.69	9.96	9.38	0.06
EAS-DS	2026-06-10 17:45:00	12.63	151.92	0.29	7.76	9.90	10.05	0.07
EAS-DS	2026-06-10 18:00:00	12.16	142.27	0.29	7.75	10.14	9.94	0.07
EAS-DS	2026-06-10 18:15:00	12.49	154.37	0.29	7.78	10.06	10.95	0.07
EAS-DS	2026-06-10 18:30:00	12.09	144.60	0.29	7.78	10.16	9.98	0.07
EAS-DS	2026-06-10 18:45:00	12.27	157.06	0.29	7.81	10.13	10.56	0.07
EAS-DS	2026-06-10 19:00:00	12.09	126.34	0.28	7.73	9.95	9.33	0.06
EAS-DS	2026-06-10 19:15:00	12.27	130.53	0.29	7.75	10.03	11.19	0.06
EAS-DS	2026-06-10 19:30:00	12.26	157.81	0.28	7.81	10.14	11.13	0.07
EAS-DS	2026-06-10 19:45:00	12.03	141.60	0.29	7.80	10.14	9.55	0.07
EAS-DS	2026-06-10 20:00:00	11.96	139.64	0.28	7.79	10.14	10.64	0.07
EAS-DS	2026-06-10 20:15:00	12.11	147.55	0.28	7.81	10.14	11.54	0.07
EAS-DS	2026-06-10 20:30:00	12.10	153.43	0.28	7.82	10.17	11.21	0.07
EAS-DS	2026-06-10 20:45:00	11.87	138.91	0.28	7.78	10.16	9.27	0.07
EAS-DS	2026-06-10 21:00:00	12.35	153.59	0.28	7.79	10.05	9.99	0.07
EAS-DS	2026-06-10 21:15:00	11.89	142.94	0.29	7.81	10.23	12.88	0.07
EAS-DS	2026-06-10 21:30:00	11.94	151.71	0.29	7.80	10.24	10.26	0.07
EAS-DS	2026-06-10 21:45:00	12.13	148.61	0.29	7.81	10.12	9.49	0.07
EAS-DS	2026-06-10 22:00:00	12.13	147.42	0.29	7.82	10.16	11.55	0.07
EAS-DS	2026-06-10 22:15:00	11.84	147.88	0.29	7.82	10.27	12.94	0.07
EAS-DS	2026-06-10 22:30:00	11.86	150.71	0.29	7.84	10.23	10.04	0.07
EAS-DS	2026-06-10 22:45:00	11.79	138.23	0.29	7.78	10.02	9.59	0.07
EAS-DS	2026-06-10 23:00:00	11.95	155.53	0.29	7.84	10.21	9.56	0.07

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-10 23:15:00	11.90	155.69	0.29	7.85	10.22	11.18	0.07
EAS-DS	2026-06-10 23:30:00	11.86	146.12	0.29	7.81	10.05	9.67	0.07
EAS-DS	2026-06-10 23:45:00	12.09	145.72	0.29	7.82	10.11	9.81	0.07
EAS-DS	2026-06-11 00:00:00	11.82	150.57	0.29	7.84	10.25	11.46	0.07
EAS-DS	2026-06-11 00:15:00	11.78	133.87	0.29	7.76	10.10	9.79	0.06
EAS-DS	2026-06-11 00:30:00	11.81	156.98	0.29	7.83	10.22	9.63	0.07
EAS-DS	2026-06-11 00:45:00	11.96	150.62	0.29	7.84	10.15	9.62	0.07
EAS-DS	2026-06-11 01:00:00	11.75	110.77	0.29	7.71	10.06	9.53	0.05
EAS-DS	2026-06-11 01:15:00	11.83	133.22	0.29	7.79	10.09	10.85	0.06
EAS-DS	2026-06-11 01:30:00	11.77	157.27	0.29	7.84	10.26	10.11	0.07
EAS-DS	2026-06-11 01:45:00	11.69	155.79	0.29	7.83	10.26	10.05	0.07
EAS-DS	2026-06-11 02:00:00	11.78	160.85	0.28	7.85	10.24	9.80	0.08
EAS-DS	2026-06-11 02:15:00	11.78	159.39	0.29	7.85	10.23	9.41	0.08
EAS-DS	2026-06-11 02:30:00	11.69	140.48	0.29	7.78	10.24	10.01	0.07
EAS-DS	2026-06-11 02:45:00	11.76	160.88	0.29	7.87	10.24	11.82	0.08
EAS-DS	2026-06-11 03:00:00	11.77	148.54	0.29	7.84	10.19	10.01	0.07
EAS-DS	2026-06-11 03:15:00	11.72	126.42	0.29	7.78	10.08	11.47	0.06
EAS-DS	2026-06-11 03:30:00	11.68	157.70	0.29	7.80	10.24	13.86	0.07
EAS-DS	2026-06-11 03:45:00	11.65	156.76	0.29	7.75	10.25	10.13	0.07
EAS-DS	2026-06-11 04:00:00	11.65	154.65	0.29	7.73	10.04	9.55	0.07
EAS-DS	2026-06-11 04:15:00	11.89	155.63	0.29	7.77	10.15	9.49	0.07
EAS-DS	2026-06-11 04:30:00	11.56	168.60	0.29	7.72	10.25	9.64	0.08
EAS-DS	2026-06-11 04:45:00	11.86	157.60	0.29	7.74	10.02	9.93	0.07
EAS-DS	2026-06-11 05:00:00	11.65	179.44	0.29	7.71	10.25	11.15	0.09
EAS-DS	2026-06-11 05:15:00	11.75	163.27	0.30	7.64	9.63	9.24	0.08
EAS-DS	2026-06-11 05:30:00	11.55	190.27	0.29	7.74	10.12	10.11	0.09
EAS-DS	2026-06-11 05:45:00	11.73	193.08	0.29	7.77	10.19	11.54	0.09
EAS-DS	2026-06-11 06:00:00	11.65	191.46	0.29	7.79	10.21	12.72	0.09
EAS-DS	2026-06-11 06:15:00	11.73	174.91	0.29	7.80	9.90	14.12	0.08
EAS-DS	2026-06-11 06:30:00	11.68	161.61	0.29	7.77	10.01	14.06	0.08
EAS-DS	2026-06-11 06:45:00	11.59	194.40	0.29	7.82	10.20	11.32	0.09
EAS-DS	2026-06-11 07:00:00	11.50	191.12	0.28	7.81	10.20	9.93	0.09
EAS-DS	2026-06-11 07:15:00	11.61	192.28	0.28	7.82	10.20	11.17	0.09
EAS-DS	2026-06-11 07:30:00	11.55	177.90	0.28	7.68	9.52	11.94	0.08
EAS-DS	2026-06-11 07:45:00	11.72	176.83	0.29	7.83	9.91	10.69	0.08
EAS-DS	2026-06-11 08:00:00	11.58	177.40	0.28	7.80	10.20	10.32	0.08
EAS-DS	2026-06-11 08:15:00	11.67	176.97	0.28	7.80	10.16	12.23	0.08
EAS-DS	2026-06-11 08:30:00	11.80	181.03	0.28	7.82	10.01	9.84	0.09
EAS-DS	2026-06-11 08:45:00	11.89	181.23	0.28	7.82	10.14	11.50	0.09
EAS-DS	2026-06-11 09:00:00	11.91	173.28	0.28	7.83	9.89	10.09	0.08
EAS-DS	2026-06-11 09:15:00	11.97	167.94	0.28	7.82	9.96	10.01	0.08
EAS-DS	2026-06-11 09:30:00	12.21	175.25	0.28	7.82	10.05	10.25	0.08
EAS-DS	2026-06-11 09:45:00	12.22	177.86	0.28	7.82	10.05	9.90	0.08
EAS-DS	2026-06-11 10:00:00	12.32	181.91	0.28	7.85	10.00	9.91	0.09
EAS-DS	2026-06-11 10:15:00	12.32	171.90	0.28	7.84	9.75	9.93	0.08
EAS-DS	2026-06-11 10:30:00	12.32	135.45	0.29	7.65	7.95	9.45	0.06
EAS-DS	2026-06-11 10:45:00	12.74	184.15	0.28	7.84	9.92	10.47	0.09
EAS-DS	2026-06-11 11:00:00	12.72	178.38	0.28	7.85	9.90	12.29	0.08
EAS-DS	2026-06-11 11:15:00	12.82	182.74	0.28	7.86	9.87	11.83	0.09
EAS-DS	2026-06-11 11:30:00	12.84	180.24	0.28	7.85	9.87	12.29	0.09
EAS-DS	2026-06-11 11:45:00	13.01	182.71	0.28	7.87	9.84	11.16	0.09
EAS-DS	2026-06-11 12:00:00	13.12	177.06	0.28	7.86	9.63	10.73	0.08
EAS-DS	2026-06-11 12:15:00	13.23	175.88	0.28	7.86	9.60	13.61	0.08
EAS-DS	2026-06-11 12:30:00	13.46	161.78	0.28	7.84	9.49	10.39	0.08
EAS-DS	2026-06-11 12:45:00	13.37	166.74	0.28	7.84	9.48	9.68	0.08
EAS-DS	2026-06-11 13:00:00	13.41	178.69	0.28	7.84	9.48	10.33	0.08
EAS-DS	2026-06-11 13:15:00	13.42	180.81	0.29	7.83	9.69	13.46	0.09

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-11 13:30:00	13.30	181.54	0.28	7.87	9.58	10.15	0.09
EAS-DS	2026-06-11 13:45:00	13.29	171.67	0.28	7.82	9.27	9.99	0.08
EAS-DS	2026-06-11 14:00:00	13.34	184.14	0.28	7.86	9.74	12.06	0.09
EAS-DS	2026-06-11 14:15:00	13.15	181.26	0.29	7.84	9.75	12.56	0.09
EAS-DS	2026-06-11 14:30:00	13.12	190.19	0.28	7.84	9.74	10.30	0.09
EAS-DS	2026-06-11 14:45:00	13.31	185.62	0.28	7.85	9.37	10.15	0.09
EAS-DS	2026-06-11 15:00:00	13.43	196.29	0.28	7.86	9.58	12.44	0.09
EAS-DS	2026-06-11 15:15:00	13.57	180.72	0.29	7.83	9.31	9.89	0.09
EAS-DS	2026-06-11 15:30:00	13.51	207.30	0.29	7.83	9.66	14.37	0.10
EAS-DS	2026-06-11 15:45:00	13.49	214.88	0.29	7.85	9.67	11.80	0.10
EAS-DS	2026-06-11 16:00:00	13.55	205.76	0.29	7.84	9.37	10.15	0.10
EAS-DS	2026-06-11 16:15:00	13.54	211.90	0.29	7.85	9.32	11.45	0.10
EAS-DS	2026-06-11 16:30:00	13.50	223.36	0.29	7.83	9.62	11.60	0.11
EAS-DS	2026-06-11 16:45:00	13.36	219.76	0.29	7.80	9.58	11.31	0.10
EAS-DS	2026-06-11 17:00:00	13.25	222.14	0.29	7.81	9.68	16.06	0.11
EAS-DS	2026-06-11 17:15:00	13.22	205.46	0.30	7.65	9.12	9.97	0.10
EAS-DS	2026-06-11 17:30:00	13.26	215.72	0.30	7.79	9.68	12.46	0.10
EAS-DS	2026-06-11 17:45:00	13.18	212.79	0.30	7.80	9.68	10.92	0.10
EAS-DS	2026-06-11 18:00:00	13.14	210.68	0.29	7.79	9.74	11.19	0.10
EAS-DS	2026-06-11 18:15:00	13.11	206.86	0.30	7.79	9.59	10.68	0.10
EAS-DS	2026-06-11 18:30:00	13.14	177.83	0.30	7.76	9.54	12.66	0.08
EAS-DS	2026-06-11 18:45:00	12.99	205.94	0.30	7.78	9.80	12.77	0.10
EAS-DS	2026-06-11 19:00:00	12.74	192.84	0.30	7.78	9.82	13.25	0.09
EAS-DS	2026-06-11 19:15:00	12.99	204.64	0.30	7.80	9.65	12.37	0.10
EAS-DS	2026-06-11 19:30:00	12.97	182.21	0.30	7.72	8.87	10.54	0.09
EAS-DS	2026-06-11 19:45:00	12.85	204.41	0.30	7.80	9.85	16.43	0.10
EAS-DS	2026-06-11 20:00:00	12.63	196.73	0.30	7.79	9.91	11.78	0.09
EAS-DS	2026-06-11 20:15:00	12.78	205.01	0.30	7.80	9.76	11.60	0.10
EAS-DS	2026-06-11 20:30:00	12.70	160.22	0.30	7.73	9.58	14.00	0.08
EAS-DS	2026-06-11 20:45:00	12.78	202.36	0.30	7.81	9.77	11.39	0.10
EAS-DS	2026-06-11 21:00:00	12.53	170.14	0.30	7.78	9.68	10.85	0.08
EAS-DS	2026-06-11 21:15:00	12.49	167.20	0.30	7.79	9.69	10.94	0.08
EAS-DS	2026-06-11 21:30:00	12.36	195.32	0.30	7.81	9.97	13.95	0.09
EAS-DS	2026-06-11 21:45:00	12.44	192.83	0.30	7.83	9.85	10.74	0.09
EAS-DS	2026-06-11 22:00:00	12.38	186.32	0.30	7.84	9.91	13.73	0.09
EAS-DS	2026-06-11 22:15:00	12.20	187.29	0.30	7.83	10.04	14.98	0.09
EAS-DS	2026-06-11 22:30:00	12.15	182.89	0.30	7.78	10.01	12.28	0.09
EAS-DS	2026-06-11 22:45:00	12.17	181.23	0.30	7.77	10.01	13.42	0.09
EAS-DS	2026-06-11 23:00:00	12.30	174.76	0.30	7.79	9.78	12.64	0.08
EAS-DS	2026-06-11 23:15:00	12.29	171.40	0.30	7.79	9.81	12.00	0.08
EAS-DS	2026-06-11 23:30:00	12.11	175.81	0.30	7.76	10.02	12.39	0.08
EAS-DS	2026-06-11 23:45:00	12.02	171.67	0.30	7.75	10.03	13.28	0.08
EAS-DS	2026-06-12 00:00:00	11.96	170.51	0.30	7.75	10.06	16.34	0.08
EAS-DS	2026-06-12 00:15:00	12.05	163.49	0.30	7.77	9.84	11.31	0.08
EAS-DS	2026-06-12 00:30:00	11.87	168.93	0.30	7.76	10.06	15.57	0.08
EAS-DS	2026-06-12 00:45:00	11.85	171.62	0.30	7.77	10.07	12.52	0.08
EAS-DS	2026-06-12 01:00:00	11.83	170.67	0.30	7.77	10.04	12.34	0.08
EAS-DS	2026-06-12 01:15:00	11.91	161.63	0.31	7.67	9.41	11.11	0.08
EAS-DS	2026-06-12 01:30:00	11.84	160.71	0.30	7.73	9.84	12.77	0.08
EAS-DS	2026-06-12 01:45:00	11.71	171.43	0.30	7.74	10.10	13.30	0.08
EAS-DS	2026-06-12 02:00:00	11.68	168.59	0.30	7.73	10.10	17.45	0.08
EAS-DS	2026-06-12 02:15:00	11.72	139.83	0.31	7.67	9.53	12.87	0.07
EAS-DS	2026-06-12 02:30:00	11.70	154.22	0.30	7.68	9.87	13.81	0.07
EAS-DS	2026-06-12 02:45:00	11.68	160.81	0.31	7.72	9.99	14.37	0.08
EAS-DS	2026-06-12 03:00:00	11.53	172.42	0.30	7.75	10.10	13.41	0.08
EAS-DS	2026-06-12 03:15:00	11.65	161.86	0.30	7.77	9.97	14.86	0.08
EAS-DS	2026-06-12 03:30:00	11.64	168.63	0.30	7.79	9.86	13.29	0.08

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-12 03:45:00	11.45	160.77	0.30	7.75	9.96	11.90	0.08
EAS-DS	2026-06-12 04:00:00	11.50	165.46	0.30	7.78	9.86	13.86	0.08
EAS-DS	2026-06-12 04:15:00	11.40	184.67	0.30	7.80	9.92	13.47	0.09
EAS-DS	2026-06-12 04:30:00	11.48	147.64	0.30	7.66	8.65	13.42	0.07
EAS-DS	2026-06-12 04:45:00	11.43	210.18	0.30	7.82	10.09	15.99	0.10
EAS-DS	2026-06-12 05:00:00	11.40	217.17	0.29	7.78	10.12	19.55	0.10
EAS-DS	2026-06-12 05:15:00	11.56	201.49	0.29	7.79	9.75	13.23	0.10
EAS-DS	2026-06-12 05:30:00	11.48	217.53	0.29	7.80	10.03	21.09	0.10
EAS-DS	2026-06-12 05:45:00	11.43	212.93	0.29	7.79	10.08	14.99	0.10
EAS-DS	2026-06-12 06:00:00	11.51	212.68	0.29	7.81	10.06	16.50	0.10
EAS-DS	2026-06-12 06:15:00	11.57	211.42	0.29	7.74	9.55	13.05	0.10
EAS-DS	2026-06-12 06:30:00	11.60	206.38	0.29	7.85	9.91	15.82	0.10
EAS-DS	2026-06-12 06:45:00	11.37	203.57	0.29	7.83	10.12	16.88	0.10
EAS-DS	2026-06-12 07:00:00	11.52	201.75	0.29	7.83	10.09	15.21	0.10
EAS-DS	2026-06-12 07:15:00	11.61	192.44	0.29	7.81	9.73	13.47	0.09
EAS-DS	2026-06-12 07:30:00	11.60	195.24	0.29	7.81	10.05	17.25	0.09
EAS-DS	2026-06-12 07:45:00	11.54	186.47	0.29	7.78	9.95	13.59	0.09
EAS-DS	2026-06-12 08:00:00	11.69	190.60	0.29	7.79	10.04	19.75	0.09
EAS-DS	2026-06-12 08:15:00	11.75	192.33	0.29	7.67	9.39	14.66	0.09
EAS-DS	2026-06-12 08:30:00	11.78	190.07	0.29	7.80	10.03	16.75	0.09
EAS-DS	2026-06-12 08:45:00	11.84	180.59	0.29	7.80	9.72	17.48	0.09
EAS-DS	2026-06-12 09:00:00	11.97	187.51	0.29	7.82	9.99	17.24	0.09
EAS-DS	2026-06-12 09:15:00	12.02	176.43	0.29	7.80	9.96	21.47	0.08
EAS-DS	2026-06-12 09:30:00	12.11	178.77	0.29	7.79	9.89	17.29	0.08
EAS-DS	2026-06-12 09:45:00	12.25	181.06	0.29	7.82	9.77	16.62	0.09
EAS-DS	2026-06-12 10:00:00	12.35	184.23	0.29	7.83	9.69	20.36	0.09
EAS-DS	2026-06-12 10:15:00	12.36	155.63	0.30	7.77	9.29	18.20	0.07
EAS-DS	2026-06-12 10:30:00	12.64	184.30	0.29	7.85	9.70	16.72	0.09
EAS-DS	2026-06-12 10:45:00	12.72	179.17	0.29	7.79	9.57	15.67	0.09
EAS-DS	2026-06-12 11:00:00	12.93	182.77	0.29	7.84	9.78	21.29	0.09
EAS-DS	2026-06-12 11:15:00	13.02	187.21	0.29	7.86	9.79	16.22	0.09
EAS-DS	2026-06-12 11:30:00	13.14	185.55	0.29	7.85	9.57	17.16	0.09
EAS-DS	2026-06-12 11:45:00	13.36	183.57	0.29	7.87	9.59	18.39	0.09
EAS-DS	2026-06-12 12:00:00	13.47	191.88	0.29	7.85	9.67	24.25	0.09
EAS-DS	2026-06-12 12:15:00	13.56	182.15	0.29	7.85	9.48	15.89	0.09
EAS-DS	2026-06-12 12:30:00	13.86	193.56	0.29	7.86	9.63	20.34	0.09
EAS-DS	2026-06-12 12:45:00	14.06	190.17	0.29	7.86	9.52	18.54	0.09
EAS-DS	2026-06-12 13:00:00	14.01	195.21	0.29	7.85	9.59	21.31	0.09
EAS-DS	2026-06-12 13:15:00	14.04	194.68	0.30	7.86	9.56	19.68	0.09
EAS-DS	2026-06-12 13:30:00	14.08	176.67	0.30	7.69	8.17	15.34	0.08
EAS-DS	2026-06-12 13:45:00	14.36	193.33	0.30	7.86	9.53	19.38	0.09
EAS-DS	2026-06-12 14:00:00	14.37	192.92	0.29	7.86	9.36	18.04	0.09
EAS-DS	2026-06-12 14:15:00	14.65	185.92	0.29	7.87	9.28	17.24	0.09
EAS-DS	2026-06-12 14:30:00	14.60	190.18	0.29	7.86	9.24	17.88	0.09
EAS-DS	2026-06-12 14:45:00	14.75	184.36	0.30	7.86	9.24	17.32	0.09
EAS-DS	2026-06-12 15:00:00	14.58	191.61	0.30	7.88	9.47	21.67	0.09
EAS-DS	2026-06-12 15:15:00	14.47	185.67	0.30	7.85	9.41	17.32	0.09
EAS-DS	2026-06-12 15:30:00	14.74	163.97	0.30	7.81	9.11	16.70	0.08
EAS-DS	2026-06-12 15:45:00	14.82	184.89	0.30	7.86	9.26	18.57	0.09
EAS-DS	2026-06-12 16:00:00	15.00	165.77	0.30	7.81	9.02	18.26	0.08
EAS-DS	2026-06-12 16:15:00	14.63	192.64	0.30	7.85	9.41	22.79	0.09
EAS-DS	2026-06-12 16:30:00	14.54	197.75	0.30	7.85	9.42	21.42	0.09
EAS-DS	2026-06-12 16:45:00	14.45	198.62	0.30	7.85	9.37	20.53	0.09
EAS-DS	2026-06-12 17:00:00	14.53	198.96	0.29	7.84	9.16	21.43	0.09
EAS-DS	2026-06-12 17:15:00	14.65	176.68	0.30	7.80	8.96	19.06	0.08
EAS-DS	2026-06-12 17:30:00	14.63	200.78	0.30	7.86	9.38	30.80	0.10
EAS-DS	2026-06-12 17:45:00	14.35	192.68	0.30	7.83	9.28	18.78	0.09

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-12 18:00:00	14.56	192.69	0.29	7.85	9.17	21.98	0.09
EAS-DS	2026-06-12 18:15:00	14.56	189.15	0.29	7.83	9.10	19.05	0.09
EAS-DS	2026-06-12 18:30:00	14.33	199.84	0.29	7.86	9.45	26.88	0.10
EAS-DS	2026-06-12 18:45:00	14.12	198.35	0.29	7.84	9.29	18.99	0.09
EAS-DS	2026-06-12 19:00:00	14.48	199.80	0.29	7.85	9.15	25.23	0.10
EAS-DS	2026-06-12 19:15:00	14.03	202.10	0.29	7.85	9.33	20.99	0.10
EAS-DS	2026-06-12 19:30:00	13.90	206.25	0.29	7.86	9.54	32.38	0.10
EAS-DS	2026-06-12 19:45:00	13.61	202.57	0.29	7.84	9.55	18.80	0.10
EAS-DS	2026-06-12 20:00:00	13.68	188.10	0.29	7.81	9.02	18.44	0.09
EAS-DS	2026-06-12 20:15:00	13.71	199.11	0.29	7.83	9.41	22.56	0.09
EAS-DS	2026-06-12 20:30:00	13.66	201.63	0.30	7.84	9.57	40.49	0.10
EAS-DS	2026-06-12 20:45:00	13.78	188.70	0.30	7.81	9.18	20.25	0.09
EAS-DS	2026-06-12 21:00:00	13.48	198.00	0.30	7.83	9.63	28.70	0.09
EAS-DS	2026-06-12 21:15:00	13.03	187.42	0.30	7.78	9.60	18.05	0.09
EAS-DS	2026-06-12 21:30:00	13.17	194.50	0.30	7.81	9.70	31.70	0.09
EAS-DS	2026-06-12 21:45:00	12.89	186.81	0.30	7.78	9.70	20.97	0.09
EAS-DS	2026-06-12 22:00:00	12.99	191.14	0.30	7.80	9.80	36.12	0.09
EAS-DS	2026-06-12 22:15:00	12.86	184.96	0.30	7.78	9.64	22.80	0.09
EAS-DS	2026-06-12 22:30:00	12.91	184.31	0.30	7.79	9.71	27.87	0.09
EAS-DS	2026-06-12 22:45:00	13.28	188.92	0.30	7.76	9.29	26.19	0.09
EAS-DS	2026-06-12 23:00:00	13.17	192.25	0.30	7.82	9.67	32.23	0.09
EAS-DS	2026-06-12 23:15:00	12.93	192.36	0.30	7.81	9.83	31.84	0.09
EAS-DS	2026-06-12 23:30:00	12.80	184.14	0.29	7.77	9.60	21.59	0.09
EAS-DS	2026-06-12 23:45:00	12.89	193.67	0.30	7.79	9.84	33.28	0.09
EAS-DS	2026-06-13 00:00:00	12.79	193.53	0.30	7.78	9.92	38.29	0.09
EAS-DS	2026-06-13 00:15:00	12.78	186.08	0.30	7.67	9.53	23.54	0.09
EAS-DS	2026-06-13 00:30:00	12.84	195.39	0.30	7.79	9.84	32.58	0.09
EAS-DS	2026-06-13 00:45:00	12.57	187.23	0.30	7.75	9.96	41.10	0.09
EAS-DS	2026-06-13 01:00:00	12.82	194.49	0.30	7.79	9.78	28.37	0.09
EAS-DS	2026-06-13 01:15:00	12.86	153.73	0.30	7.73	9.25	23.21	0.07
EAS-DS	2026-06-13 01:30:00	13.04	189.59	0.29	7.82	9.54	24.48	0.09
EAS-DS	2026-06-13 01:45:00	12.91	193.73	0.30	7.82	9.79	33.21	0.09
EAS-DS	2026-06-13 02:00:00	12.53	184.25	0.30	7.72	9.88	23.95	0.09
EAS-DS	2026-06-13 02:15:00	12.68	192.26	0.30	7.80	9.95	31.85	0.09
EAS-DS	2026-06-13 02:30:00	12.73	187.22	0.30	7.78	9.69	34.47	0.09
EAS-DS	2026-06-13 02:45:00	12.97	189.54	0.30	7.84	9.70	28.62	0.09
EAS-DS	2026-06-13 03:00:00	12.54	186.45	0.29	7.73	9.90	28.73	0.09
EAS-DS	2026-06-13 03:15:00	12.64	193.61	0.30	7.81	9.98	45.57	0.09
EAS-DS	2026-06-13 03:30:00	12.44	188.25	0.30	7.73	10.01	24.50	0.09
EAS-DS	2026-06-13 03:45:00	12.43	188.04	0.30	7.73	10.00	26.62	0.09
EAS-DS	2026-06-13 04:00:00	12.60	191.77	0.30	7.80	9.96	33.21	0.09
EAS-DS	2026-06-13 04:15:00	12.35	176.01	0.30	7.70	9.87	20.79	0.08
EAS-DS	2026-06-13 04:30:00	12.51	187.18	0.30	7.77	9.96	30.22	0.09
EAS-DS	2026-06-13 04:45:00	12.28	176.72	0.31	7.68	10.01	22.70	0.08
EAS-DS	2026-06-13 05:00:00	12.56	174.67	0.30	7.78	9.78	23.02	0.08
EAS-DS	2026-06-13 05:15:00	12.22	175.87	0.31	7.68	10.02	24.40	0.08
EAS-DS	2026-06-13 05:30:00	12.56	180.92	0.30	7.82	9.86	31.79	0.09
EAS-DS	2026-06-13 05:45:00	12.28	180.74	0.31	7.75	10.13	32.76	0.09
EAS-DS	2026-06-13 06:00:00	12.29	181.24	0.30	7.76	10.05	68.47	0.09
EAS-DS	2026-06-13 06:15:00	12.08	177.03	0.31	7.69	10.12	25.42	0.08
EAS-DS	2026-06-13 06:30:00	12.26	179.48	0.31	7.73	9.99	27.12	0.09
EAS-DS	2026-06-13 06:45:00	12.22	178.11	0.31	7.73	10.07	30.55	0.08
EAS-DS	2026-06-13 07:00:00	12.19	175.15	0.31	7.75	9.95	23.83	0.08
EAS-DS	2026-06-13 07:15:00	12.20	145.02	0.31	7.69	9.75	25.77	0.07
EAS-DS	2026-06-13 07:30:00	12.12	171.55	0.31	7.76	10.09	29.90	0.08
EAS-DS	2026-06-13 07:45:00	12.21	172.37	0.31	7.78	10.07	28.51	0.08
EAS-DS	2026-06-13 08:00:00	12.17	166.26	0.31	7.78	10.05	23.38	0.08

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-13 08:15:00	12.49	170.62	0.30	7.77	9.81	22.39	0.08
EAS-DS	2026-06-13 08:30:00	12.55	171.36	0.31	7.77	9.77	24.63	0.08
EAS-DS	2026-06-13 08:45:00	12.59	167.28	0.31	7.78	9.96	25.04	0.08
EAS-DS	2026-06-13 09:00:00	12.61	170.16	0.31	7.80	10.02	31.59	0.08
EAS-DS	2026-06-13 09:15:00	12.58	166.93	0.31	7.79	10.03	31.79	0.08
EAS-DS	2026-06-13 09:30:00	12.66	163.17	0.31	7.78	9.92	22.08	0.08
EAS-DS	2026-06-13 09:45:00	12.75	164.75	0.31	7.79	9.98	28.50	0.08
EAS-DS	2026-06-13 10:00:00	12.85	168.56	0.31	7.79	9.89	27.80	0.08
EAS-DS	2026-06-13 10:15:00	13.09	169.75	0.31	7.79	9.69	23.40	0.08
EAS-DS	2026-06-13 10:30:00	13.29	173.47	0.31	7.81	9.60	22.97	0.08
EAS-DS	2026-06-13 10:45:00	13.24	162.70	0.31	7.80	9.85	28.35	0.08
EAS-DS	2026-06-13 11:00:00	13.36	175.13	0.31	7.85	9.81	31.02	0.08
EAS-DS	2026-06-13 11:15:00	13.41	173.82	0.31	7.79	9.46	24.46	0.08
EAS-DS	2026-06-13 11:30:00	13.81	177.59	0.27	7.81	9.59	11.22	0.08
EAS-DS	2026-06-13 11:45:00	13.87	174.05	0.30	7.83	9.72	10.50	0.08
EAS-DS	2026-06-13 12:00:00	13.81	166.82	0.31	7.72	9.37	9.38	0.08
EAS-DS	2026-06-13 12:15:00	14.02	167.38	0.31	7.57	8.67	9.36	0.08
EAS-DS	2026-06-13 12:30:00	14.24	167.83	0.31	7.82	9.53	10.94	0.08
EAS-DS	2026-06-13 12:45:00	14.00	166.70	0.31	7.82	9.71	9.47	0.08
EAS-DS	2026-06-13 13:00:00	14.14	173.65	0.31	7.83	9.71	11.87	0.08
EAS-DS	2026-06-13 13:15:00	14.07	166.90	0.31	7.83	9.70	460.93	0.08
EAS-DS	2026-06-13 13:30:00	14.23	164.17	0.32	7.68	9.11	9.55	0.08
EAS-DS	2026-06-13 13:45:00	14.32	169.60	0.32	7.82	9.62	10.30	0.08
EAS-DS	2026-06-13 14:00:00	14.22	167.98	0.32	7.81	9.52	9.86	0.08
EAS-DS	2026-06-13 14:15:00	14.57	174.35	0.32	7.55	8.81	9.82	0.08
EAS-DS	2026-06-13 14:30:00	14.81	154.02	0.33	7.47	7.82	9.66	0.07
EAS-DS	2026-06-13 14:45:00	14.85	169.36	0.32	7.82	9.38	10.44	0.08
EAS-DS	2026-06-13 15:00:00	14.75	166.82	0.32	7.80	9.34	10.04	0.08
EAS-DS	2026-06-13 15:15:00	14.36	168.58	0.32	7.79	9.67	12.33	0.08
EAS-DS	2026-06-13 15:30:00	14.38	171.47	0.32	7.81	9.49	9.89	0.08
EAS-DS	2026-06-13 15:45:00	14.43	162.50	0.33	7.45	8.48	9.81	0.08
EAS-DS	2026-06-13 16:00:00	14.48	174.48	0.32	7.79	9.58	12.59	0.08
EAS-DS	2026-06-13 16:15:00	14.33	170.59	0.32	7.76	9.54	10.43	0.08
EAS-DS	2026-06-13 16:30:00	14.44	177.95	0.32	7.78	9.54	10.54	0.08
EAS-DS	2026-06-13 16:45:00	14.51	174.05	0.33	7.52	8.66	12.00	0.08
EAS-DS	2026-06-13 17:00:00	14.84	173.34	0.33	7.64	7.83	10.24	0.08
EAS-DS	2026-06-13 17:15:00	14.79	172.11	0.33	7.65	8.28	10.11	0.08
EAS-DS	2026-06-13 17:30:00	14.76	176.43	0.33	7.67	8.10	9.96	0.08
EAS-DS	2026-06-13 17:45:00	14.58	170.80	0.33	7.80	9.47	11.14	0.08
EAS-DS	2026-06-13 18:00:00	14.41	175.58	0.32	7.71	9.09	10.08	0.08
EAS-DS	2026-06-13 18:15:00	14.52	170.01	0.33	7.58	8.59	10.16	0.08
EAS-DS	2026-06-13 18:30:00	14.09	168.00	0.32	7.59	9.21	9.98	0.08
EAS-DS	2026-06-13 18:45:00	14.22	172.58	0.33	7.80	9.55	11.04	0.08
EAS-DS	2026-06-13 19:00:00	14.06	162.87	0.33	7.78	9.22	11.29	0.08
EAS-DS	2026-06-13 19:15:00	13.54	173.34	0.32	7.76	9.74	10.33	0.08
EAS-DS	2026-06-13 19:30:00	13.69	182.02	0.32	7.75	9.72	12.90	0.09
EAS-DS	2026-06-13 19:45:00	13.27	179.34	0.32	7.75	9.83	13.94	0.09
EAS-DS	2026-06-13 20:00:00	13.63	183.21	0.32	7.70	9.43	10.51	0.09
EAS-DS	2026-06-13 20:15:00	13.82	185.24	0.33	7.70	9.09	13.46	0.09
EAS-DS	2026-06-13 20:30:00	13.27	173.38	0.32	7.79	9.77	10.81	0.08
EAS-DS	2026-06-13 20:45:00	13.18	171.57	0.32	7.80	9.78	10.80	0.08
EAS-DS	2026-06-13 21:00:00	13.15	172.70	0.32	7.77	9.93	16.30	0.08
EAS-DS	2026-06-13 21:15:00	13.37	177.18	0.32	7.74	9.54	11.56	0.08
EAS-DS	2026-06-13 21:30:00	13.29	179.49	0.32	7.80	9.85	15.21	0.09
EAS-DS	2026-06-13 21:45:00	12.92	172.20	0.32	7.81	9.85	10.58	0.08
EAS-DS	2026-06-13 22:00:00	13.35	180.71	0.32	7.83	9.69	10.98	0.09
EAS-DS	2026-06-13 22:15:00	13.56	171.94	0.32	7.60	8.86	11.01	0.08

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-13 22:30:00	13.57	177.61	0.32	7.74	8.62	11.31	0.08
EAS-DS	2026-06-13 22:45:00	13.16	166.50	0.32	7.57	9.07	10.82	0.08
EAS-DS	2026-06-13 23:00:00	12.90	172.25	0.32	7.83	9.81	12.16	0.08
EAS-DS	2026-06-13 23:15:00	12.73	172.25	0.32	7.80	10.02	12.37	0.08
EAS-DS	2026-06-13 23:30:00	12.73	184.49	0.32	7.81	9.69	10.77	0.09
EAS-DS	2026-06-13 23:45:00	12.85	172.59	0.32	7.61	8.60	10.93	0.08
EAS-DS	2026-06-14 00:00:00	12.72	222.51	0.32	7.81	9.95	18.24	0.11
EAS-DS	2026-06-14 00:15:00	12.62	269.34	0.32	7.82	9.84	12.97	0.13
EAS-DS	2026-06-14 00:30:00	12.73	268.03	0.31	7.85	9.86	13.22	0.13
EAS-DS	2026-06-14 00:45:00	12.73	270.79	0.31	7.86	9.89	19.06	0.13
EAS-DS	2026-06-14 01:00:00	12.81	258.82	0.31	7.62	8.49	11.70	0.12
EAS-DS	2026-06-14 01:15:00	12.64	262.48	0.31	7.84	9.76	13.12	0.13
EAS-DS	2026-06-14 01:30:00	12.34	237.96	0.31	7.82	9.82	16.05	0.11
EAS-DS	2026-06-14 01:45:00	12.39	232.89	0.31	7.86	9.83	12.02	0.11
EAS-DS	2026-06-14 02:00:00	12.52	231.37	0.31	7.56	8.35	11.25	0.11
EAS-DS	2026-06-14 02:15:00	12.78	230.33	0.31	7.78	9.34	12.71	0.11
EAS-DS	2026-06-14 02:30:00	12.65	222.96	0.31	7.56	7.79	11.58	0.11
EAS-DS	2026-06-14 02:45:00	12.47	224.04	0.31	7.83	9.88	12.79	0.11
EAS-DS	2026-06-14 03:00:00	12.53	191.98	0.31	7.81	8.95	12.08	0.09
EAS-DS	2026-06-14 03:15:00	12.43	212.86	0.30	7.77	9.93	12.34	0.10
EAS-DS	2026-06-14 03:30:00	12.34	204.89	0.30	7.62	9.00	11.87	0.10
EAS-DS	2026-06-14 03:45:00	12.36	195.21	0.31	7.83	9.79	11.77	0.09
EAS-DS	2026-06-14 04:00:00	12.48	205.66	0.30	7.80	9.85	12.48	0.10
EAS-DS	2026-06-14 04:15:00	12.30	191.51	0.31	7.76	9.86	16.55	0.09
EAS-DS	2026-06-14 04:30:00	12.36	204.14	0.31	7.77	9.99	15.19	0.10
EAS-DS	2026-06-14 04:45:00	12.22	203.54	0.31	7.77	10.02	13.57	0.10
EAS-DS	2026-06-14 05:00:00	12.34	222.96	0.30	7.82	9.91	13.04	0.11
EAS-DS	2026-06-14 05:15:00	12.56	221.68	0.31	7.72	9.29	12.47	0.11
EAS-DS	2026-06-14 05:30:00	12.39	220.22	0.31	7.78	8.02	12.90	0.11
EAS-DS	2026-06-14 05:45:00	12.21	216.41	0.31	7.71	9.12	13.46	0.10
EAS-DS	2026-06-14 06:00:00	12.28	215.71	0.30	7.79	10.02	15.12	0.10
EAS-DS	2026-06-14 06:15:00	12.30	215.90	0.30	7.79	9.94	12.05	0.10
EAS-DS	2026-06-14 06:30:00	12.21	196.51	0.30	7.81	9.61	11.91	0.09
EAS-DS	2026-06-14 06:45:00	12.25	203.97	0.30	7.78	10.06	17.70	0.10
EAS-DS	2026-06-14 07:00:00	12.14	185.57	0.30	7.78	9.59	14.46	0.09
EAS-DS	2026-06-14 07:15:00	12.41	212.47	0.31	7.70	8.83	12.49	0.10
EAS-DS	2026-06-14 07:30:00	12.48	182.93	0.30	7.81	9.50	11.79	0.09
EAS-DS	2026-06-14 07:45:00	12.56	202.83	0.30	7.74	9.57	12.32	0.10
EAS-DS	2026-06-14 08:00:00	12.61	179.41	0.30	7.79	9.51	11.69	0.09
EAS-DS	2026-06-14 08:15:00	12.60	180.73	0.31	7.63	8.30	12.26	0.09
EAS-DS	2026-06-14 08:30:00	12.72	173.41	0.30	7.82	9.54	13.41	0.08
EAS-DS	2026-06-14 08:45:00	12.57	175.18	0.30	7.81	10.00	13.51	0.08
EAS-DS	2026-06-14 09:00:00	12.57	172.98	0.30	7.84	9.90	12.21	0.08
EAS-DS	2026-06-14 09:15:00	12.69	164.61	0.31	7.82	9.91	12.74	0.08
EAS-DS	2026-06-14 09:30:00	12.72	169.21	0.30	7.80	9.93	15.35	0.08
EAS-DS	2026-06-14 09:45:00	12.77	175.66	0.31	7.66	9.25	12.62	0.08
EAS-DS	2026-06-14 10:00:00	12.96	165.34	0.30	7.84	9.85	13.40	0.08
EAS-DS	2026-06-14 10:15:00	13.01	168.93	0.31	7.79	9.62	12.59	0.08
EAS-DS	2026-06-14 10:30:00	13.05	170.70	0.31	7.61	8.69	12.24	0.08
EAS-DS	2026-06-14 10:45:00	13.11	158.72	0.31	7.56	7.70	12.47	0.08
EAS-DS	2026-06-14 11:00:00	13.45	164.10	0.31	7.59	8.31	12.26	0.08
EAS-DS	2026-06-14 11:15:00	13.58	156.64	0.31	7.74	9.29	12.74	0.07
EAS-DS	2026-06-14 11:30:00	13.92	164.20	0.30	7.84	9.71	16.35	0.08
EAS-DS	2026-06-14 11:45:00	13.95	163.65	0.30	7.85	9.70	14.36	0.08
EAS-DS	2026-06-14 12:00:00	13.96	159.77	0.30	7.79	9.31	12.32	0.08
EAS-DS	2026-06-14 12:15:00	14.37	167.15	0.31	7.72	8.50	13.02	0.08
EAS-DS	2026-06-14 12:30:00	14.44	160.34	0.31	7.78	8.99	12.28	0.08

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-DS	2026-06-14 12:45:00	14.55	172.63	0.31	7.77	9.51	16.12	0.08
EAS-DS	2026-06-14 13:00:00	14.48	181.77	0.30	7.69	9.18	15.37	0.09
EAS-DS	2026-06-14 13:15:00	14.80	191.25	0.30	7.74	9.01	18.47	0.09
EAS-DS	2026-06-14 13:30:00	14.89	193.10	0.30	7.80	8.62	14.94	0.09
EAS-DS	2026-06-14 13:45:00	14.82	197.56	0.30	7.81	9.39	17.84	0.09
EAS-DS	2026-06-14 14:00:00	14.67	196.53	0.30	7.80	9.40	19.48	0.09
EAS-DS	2026-06-14 14:15:00	14.96	210.91	0.30	7.83	9.38	19.86	0.10
EAS-DS	2026-06-14 14:30:00	14.77	198.56	0.30	7.74	8.35	14.25	0.09
EAS-DS	2026-06-14 14:45:00	14.87	196.67	0.31	7.58	7.39	13.92	0.09
EAS-DS	2026-06-14 15:00:00	15.37	208.77	0.30	7.83	9.33	18.81	0.10
EAS-DS	2026-06-14 15:15:00	14.99	198.37	0.30	7.84	9.35	14.07	0.09
EAS-DS	2026-06-14 15:30:00	15.47	215.08	0.30	7.72	8.46	14.86	0.10
EAS-DS	2026-06-14 15:45:00	15.22	201.04	0.31	7.50	6.30	16.29	0.10
EAS-DS	2026-06-14 16:00:00	14.82	194.50	0.30	7.84	9.21	13.72	0.09
EAS-DS	2026-06-14 16:15:00	14.70	195.01	0.30	7.82	9.45	14.01	0.09
EAS-DS	2026-06-14 16:30:00	14.83	197.56	0.30	7.60	8.30	13.80	0.09
EAS-DS	2026-06-14 16:45:00	14.79	193.69	0.30	7.81	9.43	14.27	0.09
EAS-DS	2026-06-14 17:00:00	14.90	196.96	0.30	7.81	9.38	15.66	0.09
EAS-DS	2026-06-14 17:15:00	14.80	193.19	0.31	7.81	9.32	14.32	0.09
EAS-DS	2026-06-14 17:30:00	14.98	193.24	0.31	7.54	7.76	13.98	0.09
EAS-DS	2026-06-14 17:45:00	15.22	200.12	0.31	7.80	9.38	20.45	0.10
EAS-DS	2026-06-14 18:00:00	14.65	188.84	0.31	7.81	9.45	15.30	0.09
EAS-DS	2026-06-14 18:15:00	14.66	188.88	0.31	7.70	8.94	14.81	0.09
EAS-DS	2026-06-14 18:30:00	14.69	185.80	0.31	7.79	9.20	17.12	0.09
EAS-DS	2026-06-14 18:45:00	14.30	183.87	0.31	7.81	9.51	15.59	0.09
EAS-DS	2026-06-14 19:00:00	14.82	198.33	0.31	7.74	9.05	16.79	0.09
EAS-DS	2026-06-14 19:15:00	14.61	191.13	0.31	7.82	9.38	15.78	0.09
EAS-DS	2026-06-14 19:30:00	14.44	193.68	0.31	7.79	9.48	19.65	0.09
EAS-DS	2026-06-14 19:45:00	14.57	198.01	0.31	7.77	9.47	16.28	0.09
EAS-DS	2026-06-14 20:00:00	14.78	196.28	0.31	7.58	7.73	14.59	0.09
EAS-DS	2026-06-14 20:15:00	13.95	180.04	0.31	7.81	9.58	14.37	0.09
EAS-DS	2026-06-14 20:30:00	13.76	177.39	0.31	7.69	9.04	14.17	0.08
EAS-DS	2026-06-14 20:45:00	13.90	177.82	0.32	7.54	8.42	14.72	0.08
EAS-DS	2026-06-14 21:00:00	14.15	150.99	0.32	7.57	7.69	15.00	0.07
EAS-DS	2026-06-14 21:15:00	13.72	174.27	0.33	7.67	8.72	14.62	0.08
EAS-DS	2026-06-14 21:30:00	13.50	172.90	0.33	7.66	8.97	14.93	0.08
EAS-DS	2026-06-14 21:45:00	13.83	187.01	0.32	7.77	9.69	21.14	0.09
EAS-DS	2026-06-14 22:00:00	13.79	189.79	0.31	7.78	9.67	27.54	0.09
EAS-DS	2026-06-14 22:15:00	13.67	187.47	0.32	7.79	9.57	16.93	0.09
EAS-DS	2026-06-14 22:30:00	13.59	177.95	0.32	7.64	8.57	14.88	0.08
EAS-DS	2026-06-14 22:45:00	14.04	191.03	0.32	7.55	8.81	16.81	0.09
EAS-DS	2026-06-14 23:00:00	14.42	193.34	0.32	7.71	7.72	15.76	0.09
EAS-DS	2026-06-14 23:15:00	14.34	188.10	0.32	7.57	8.05	15.89	0.09
EAS-DS	2026-06-14 23:30:00	13.01	181.55	0.32	7.70	9.65	15.40	0.09
EAS-DS	2026-06-14 23:45:00	13.36	188.82	0.32	7.72	9.79	21.71	0.09
EAS-US	2026-06-08 00:00:00	11.41	28.41	0.13	6.88	10.15	2.44	0.01
EAS-US	2026-06-08 00:15:00	11.38	28.38	0.24	7.01	10.16	2.48	0.01
EAS-US	2026-06-08 00:30:00	11.35	28.40	0.23	7.01	10.17	2.47	0.01
EAS-US	2026-06-08 00:45:00	11.32	28.37	0.23	7.00	10.17	2.47	0.01
EAS-US	2026-06-08 01:00:00	11.29	28.41	0.13	6.79	10.18	2.36	0.01
EAS-US	2026-06-08 01:15:00	11.26	28.38	0.24	6.86	10.18	2.33	0.01
EAS-US	2026-06-08 01:30:00	11.23	28.37	0.24	6.84	10.19	2.36	0.01
EAS-US	2026-06-08 01:45:00	11.20	28.38	0.24	6.83	10.19	2.36	0.01
EAS-US	2026-06-08 02:00:00	11.16	28.39	0.13	6.86	10.18	2.42	0.01
EAS-US	2026-06-08 02:15:00	11.13	28.33	0.24	7.00	10.21	2.34	0.01
EAS-US	2026-06-08 02:30:00	11.10	28.33	0.24	7.00	10.22	2.36	0.01
EAS-US	2026-06-08 02:45:00	11.06	28.31	0.24	7.02	10.22	2.36	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-08 03:00:00	11.03	28.34	0.14	6.79	10.24	2.28	0.01
EAS-US	2026-06-08 03:15:00	11.01	28.34	0.25	6.84	10.24	2.34	0.01
EAS-US	2026-06-08 03:30:00	10.98	28.42	0.24	6.86	10.25	2.41	0.01
EAS-US	2026-06-08 03:45:00	10.95	28.42	0.24	6.83	10.24	2.33	0.01
EAS-US	2026-06-08 04:00:00	10.93	28.47	0.13	6.85	10.26	2.38	0.01
EAS-US	2026-06-08 04:15:00	10.90	28.39	0.24	6.97	10.26	2.37	0.01
EAS-US	2026-06-08 04:30:00	10.87	28.35	0.23	6.96	10.26	2.35	0.01
EAS-US	2026-06-08 04:45:00	10.85	28.31	0.23	7.00	10.27	2.37	0.01
EAS-US	2026-06-08 05:00:00	10.83	28.34	0.14	6.77	10.29	2.27	0.01
EAS-US	2026-06-08 05:15:00	10.81	28.28	0.24	6.81	10.28	2.29	0.01
EAS-US	2026-06-08 05:30:00	10.80	28.28	0.24	6.83	10.29	2.33	0.01
EAS-US	2026-06-08 05:45:00	10.78	28.27	0.24	6.80	10.29	2.28	0.01
EAS-US	2026-06-08 06:00:00	10.77	28.30	0.13	6.87	10.30	2.28	0.01
EAS-US	2026-06-08 06:15:00	10.77	28.25	0.24	6.99	10.31	2.44	0.01
EAS-US	2026-06-08 06:30:00	10.76	28.22	0.24	6.98	10.31	2.31	0.01
EAS-US	2026-06-08 06:45:00	10.75	28.18	0.23	6.98	10.33	2.32	0.01
EAS-US	2026-06-08 07:00:00	10.75	28.18	0.14	6.80	10.34	2.33	0.01
EAS-US	2026-06-08 07:15:00	10.76	28.08	0.24	6.85	10.36	2.22	0.01
EAS-US	2026-06-08 07:30:00	10.77	27.98	0.24	6.87	10.37	2.33	0.01
EAS-US	2026-06-08 07:45:00	10.80	27.90	0.24	6.85	10.41	2.35	0.01
EAS-US	2026-06-08 08:00:00	10.82	27.86	0.14	6.91	10.42	9.67	0.01
EAS-US	2026-06-08 08:15:00	10.84	27.75	0.24	7.01	10.43	2.36	0.01
EAS-US	2026-06-08 08:30:00	10.88	27.68	0.24	7.07	10.44	3.71	0.01
EAS-US	2026-06-08 08:45:00	10.91	27.63	0.24	7.04	10.46	2.32	0.01
EAS-US	2026-06-08 09:00:00	10.96	27.63	0.14	6.86	10.45	2.99	0.01
EAS-US	2026-06-08 09:15:00	11.01	27.54	0.24	6.92	10.48	2.36	0.01
EAS-US	2026-06-08 09:30:00	11.07	27.51	0.24	6.95	10.48	3.13	0.01
EAS-US	2026-06-08 09:45:00	11.11	27.52	0.24	6.94	10.44	2.30	0.01
EAS-US	2026-06-08 10:00:00	11.17	27.52	0.13	6.97	10.46	2.71	0.01
EAS-US	2026-06-08 10:15:00	11.21	27.51	0.24	7.08	10.42	2.38	0.01
EAS-US	2026-06-08 10:30:00	11.25	27.55	0.24	7.06	10.40	2.35	0.01
EAS-US	2026-06-08 10:45:00	11.31	27.54	0.23	7.10	10.42	2.29	0.01
EAS-US	2026-06-08 11:00:00	11.38	27.52	0.14	6.91	10.43	2.34	0.01
EAS-US	2026-06-08 11:15:00	11.45	27.44	0.24	6.96	10.43	2.44	0.01
EAS-US	2026-06-08 11:30:00	11.53	27.42	0.24	6.98	10.44	2.38	0.01
EAS-US	2026-06-08 11:45:00	11.62	27.40	0.24	6.96	10.42	2.37	0.01
EAS-US	2026-06-08 12:00:00	11.65	27.50	0.14	7.02	10.36	2.33	0.01
EAS-US	2026-06-08 12:15:00	11.68	27.55	0.24	7.08	10.32	2.32	0.01
EAS-US	2026-06-08 12:30:00	11.70	27.62	0.23	7.08	10.31	2.36	0.01
EAS-US	2026-06-08 12:45:00	11.72	27.66	0.23	7.13	10.32	2.37	0.01
EAS-US	2026-06-08 13:00:00	11.74	27.73	0.14	6.91	10.31	2.49	0.01
EAS-US	2026-06-08 13:15:00	11.78	27.65	0.24	6.98	10.31	2.41	0.01
EAS-US	2026-06-08 13:30:00	11.80	27.69	0.24	6.95	10.30	2.76	0.01
EAS-US	2026-06-08 13:45:00	11.81	27.80	0.23	6.99	10.24	2.49	0.01
EAS-US	2026-06-08 14:00:00	11.80	27.94	0.14	6.98	10.22	2.42	0.01
EAS-US	2026-06-08 14:15:00	11.79	27.99	0.23	7.11	10.21	2.44	0.01
EAS-US	2026-06-08 14:30:00	11.77	28.08	0.23	7.10	10.20	2.42	0.01
EAS-US	2026-06-08 14:45:00	11.76	28.15	0.23	7.08	10.17	2.39	0.01
EAS-US	2026-06-08 15:00:00	11.75	28.17	0.13	6.89	10.19	2.40	0.01
EAS-US	2026-06-08 15:15:00	11.75	28.12	0.24	6.95	10.23	3.04	0.01
EAS-US	2026-06-08 15:30:00	11.77	28.08	0.24	6.94	10.23	2.38	0.01
EAS-US	2026-06-08 15:45:00	11.78	28.09	0.24	6.96	10.23	2.45	0.01
EAS-US	2026-06-08 16:00:00	11.78	28.23	0.13	6.95	10.18	2.40	0.01
EAS-US	2026-06-08 16:15:00	11.78	28.28	0.24	7.03	10.16	2.37	0.01
EAS-US	2026-06-08 16:30:00	11.78	28.27	0.23	7.09	10.17	2.39	0.01
EAS-US	2026-06-08 16:45:00	11.78	28.25	0.23	7.06	10.18	2.33	0.01
EAS-US	2026-06-08 17:00:00	11.77	28.27	0.14	6.88	10.16	2.41	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-08 17:15:00	11.76	28.27	0.24	6.96	10.13	2.36	0.01
EAS-US	2026-06-08 17:30:00	11.75	28.26	0.24	6.93	10.15	2.42	0.01
EAS-US	2026-06-08 17:45:00	11.74	28.25	0.24	6.95	10.15	2.45	0.01
EAS-US	2026-06-08 18:00:00	11.74	28.31	0.13	6.95	10.14	2.43	0.01
EAS-US	2026-06-08 18:15:00	11.74	28.26	0.24	7.08	10.15	2.40	0.01
EAS-US	2026-06-08 18:30:00	11.74	28.34	0.23	7.05	10.11	2.41	0.01
EAS-US	2026-06-08 18:45:00	11.73	28.42	0.23	7.04	10.10	2.43	0.01
EAS-US	2026-06-08 19:00:00	11.72	28.50	0.14	6.84	10.07	2.62	0.01
EAS-US	2026-06-08 19:15:00	11.71	28.53	0.25	6.90	10.07	2.54	0.01
EAS-US	2026-06-08 19:30:00	11.69	28.63	0.24	6.90	10.06	2.39	0.01
EAS-US	2026-06-08 19:45:00	11.67	28.73	0.24	6.87	10.05	2.33	0.01
EAS-US	2026-06-08 20:00:00	11.65	28.80	0.14	6.91	10.03	2.39	0.01
EAS-US	2026-06-08 20:15:00	11.62	28.75	0.24	7.05	10.03	2.37	0.01
EAS-US	2026-06-08 20:30:00	11.60	28.76	0.24	7.00	10.03	2.39	0.01
EAS-US	2026-06-08 20:45:00	11.57	28.75	0.23	7.03	10.03	2.35	0.01
EAS-US	2026-06-08 21:00:00	11.54	28.79	0.14	6.82	10.03	2.54	0.01
EAS-US	2026-06-08 21:15:00	11.52	28.76	0.24	6.89	10.03	2.39	0.01
EAS-US	2026-06-08 21:30:00	11.49	28.77	0.24	6.90	10.03	2.36	0.01
EAS-US	2026-06-08 21:45:00	11.47	28.74	0.24	6.87	10.03	2.36	0.01
EAS-US	2026-06-08 22:00:00	11.45	28.78	0.14	6.92	10.03	2.92	0.01
EAS-US	2026-06-08 22:15:00	11.43	28.74	0.24	7.07	10.04	2.81	0.01
EAS-US	2026-06-08 22:30:00	11.42	28.71	0.23	7.08	10.06	2.38	0.01
EAS-US	2026-06-08 22:45:00	11.40	28.69	0.23	7.07	10.05	2.35	0.01
EAS-US	2026-06-08 23:00:00	11.38	28.71	0.15	6.79	10.07	2.33	0.01
EAS-US	2026-06-08 23:15:00	11.37	28.68	0.24	6.92	10.06	2.43	0.01
EAS-US	2026-06-08 23:30:00	11.36	28.63	0.24	6.85	10.05	2.38	0.01
EAS-US	2026-06-08 23:45:00	11.34	28.58	0.24	6.86	10.08	2.48	0.01
EAS-US	2026-06-09 00:00:00	11.33	28.66	0.14	6.88	10.08	2.44	0.01
EAS-US	2026-06-09 00:15:00	11.31	29.03	0.24	7.06	10.07	2.59	0.01
EAS-US	2026-06-09 00:30:00	11.31	30.08	0.23	7.08	10.09	2.49	0.01
EAS-US	2026-06-09 00:45:00	11.29	31.31	0.23	7.08	10.09	2.44	0.02
EAS-US	2026-06-09 01:00:00	11.29	32.52	0.14	6.82	10.08	2.51	0.02
EAS-US	2026-06-09 01:15:00	11.28	33.46	0.24	6.88	10.09	2.38	0.02
EAS-US	2026-06-09 01:30:00	11.27	34.11	0.24	6.88	10.10	2.45	0.02
EAS-US	2026-06-09 01:45:00	11.26	34.72	0.24	6.91	10.10	2.37	0.02
EAS-US	2026-06-09 02:00:00	11.25	35.37	0.13	6.95	10.10	3.86	0.02
EAS-US	2026-06-09 02:15:00	11.25	35.73	0.23	7.05	10.12	2.48	0.02
EAS-US	2026-06-09 02:30:00	11.24	36.02	0.23	7.05	10.11	2.46	0.02
EAS-US	2026-06-09 02:45:00	11.23	36.94	0.23	7.01	10.10	2.60	0.02
EAS-US	2026-06-09 03:00:00	11.22	38.86	0.14	6.86	10.11	2.83	0.02
EAS-US	2026-06-09 03:15:00	11.22	41.32	0.24	6.95	10.12	2.68	0.02
EAS-US	2026-06-09 03:30:00	11.22	44.51	0.24	6.94	10.11	2.72	0.02
EAS-US	2026-06-09 03:45:00	11.22	47.77	0.23	6.99	10.13	2.99	0.02
EAS-US	2026-06-09 04:00:00	11.22	51.26	0.12	7.01	10.13	3.79	0.03
EAS-US	2026-06-09 04:15:00	11.22	55.73	0.23	7.11	10.13	3.53	0.03
EAS-US	2026-06-09 04:30:00	11.23	58.16	0.22	7.16	10.12	3.53	0.03
EAS-US	2026-06-09 04:45:00	11.23	58.16	0.22	7.13	10.13	4.26	0.03
EAS-US	2026-06-09 05:00:00	11.23	56.94	0.11	7.02	10.14	3.97	0.03
EAS-US	2026-06-09 05:15:00	11.23	55.18	0.23	7.06	10.15	4.73	0.03
EAS-US	2026-06-09 05:30:00	11.22	53.26	0.23	7.05	10.14	4.24	0.03
EAS-US	2026-06-09 05:45:00	11.22	51.57	0.23	7.08	10.17	4.32	0.03
EAS-US	2026-06-09 06:00:00	11.22	49.83	0.11	7.07	10.17	4.33	0.03
EAS-US	2026-06-09 06:15:00	11.22	48.62	0.23	7.15	10.18	4.40	0.02
EAS-US	2026-06-09 06:30:00	11.22	49.81	0.23	7.18	10.18	4.81	0.03
EAS-US	2026-06-09 06:45:00	11.22	52.31	0.22	7.22	10.18	4.88	0.03
EAS-US	2026-06-09 07:00:00	11.23	53.77	0.12	7.01	10.20	5.28	0.03
EAS-US	2026-06-09 07:15:00	11.24	54.29	0.23	7.06	10.22	5.12	0.03

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-09 07:30:00	11.25	53.59	0.23	7.07	10.21	5.13	0.03
EAS-US	2026-06-09 07:45:00	11.26	52.10	0.23	7.08	10.21	5.92	0.03
EAS-US	2026-06-09 08:00:00	11.27	50.15	0.11	7.08	10.22	4.63	0.03
EAS-US	2026-06-09 08:15:00	11.27	47.78	0.23	7.19	10.21	4.61	0.02
EAS-US	2026-06-09 08:30:00	11.27	45.86	0.22	7.20	10.23	4.14	0.02
EAS-US	2026-06-09 08:45:00	11.28	44.01	0.22	7.19	10.24	4.32	0.02
EAS-US	2026-06-09 09:00:00	11.29	42.60	0.12	7.01	10.23	5.04	0.02
EAS-US	2026-06-09 09:15:00	11.30	41.19	0.23	7.05	10.26	4.23	0.02
EAS-US	2026-06-09 09:30:00	11.31	38.71	0.23	7.04	10.27	3.77	0.02
EAS-US	2026-06-09 09:45:00	11.31	35.80	0.23	7.02	10.25	3.25	0.02
EAS-US	2026-06-09 10:00:00	11.32	33.97	0.12	7.03	10.28	3.05	0.02
EAS-US	2026-06-09 10:15:00	11.32	32.76	0.23	7.17	10.28	3.31	0.02
EAS-US	2026-06-09 10:30:00	11.33	32.64	0.23	7.15	10.28	3.21	0.02
EAS-US	2026-06-09 10:45:00	11.33	32.83	0.23	7.13	10.29	3.19	0.02
EAS-US	2026-06-09 11:00:00	11.34	32.78	0.13	6.92	10.25	3.15	0.02
EAS-US	2026-06-09 11:15:00	11.35	32.40	0.24	6.99	10.29	3.01	0.02
EAS-US	2026-06-09 11:30:00	11.36	32.01	0.24	7.00	10.30	3.01	0.02
EAS-US	2026-06-09 11:45:00	11.37	31.63	0.24	7.01	10.31	3.14	0.02
EAS-US	2026-06-09 12:00:00	11.39	31.31	0.13	7.02	10.33	3.34	0.02
EAS-US	2026-06-09 12:15:00	11.41	31.29	0.24	7.11	10.32	3.08	0.02
EAS-US	2026-06-09 12:30:00	11.43	31.56	0.23	7.12	10.31	2.94	0.02
EAS-US	2026-06-09 12:45:00	11.44	32.70	0.23	7.15	10.31	3.08	0.02
EAS-US	2026-06-09 13:00:00	11.47	34.75	0.13	6.95	10.34	3.01	0.02
EAS-US	2026-06-09 13:15:00	11.49	35.57	0.23	7.02	10.33	3.03	0.02
EAS-US	2026-06-09 13:30:00	11.51	35.28	0.23	7.03	10.32	2.79	0.02
EAS-US	2026-06-09 13:45:00	11.55	35.63	0.23	7.00	10.35	2.84	0.02
EAS-US	2026-06-09 14:00:00	11.59	37.73	0.12	7.05	10.34	3.20	0.02
EAS-US	2026-06-09 14:15:00	11.63	38.96	0.23	7.18	10.35	3.06	0.02
EAS-US	2026-06-09 14:30:00	11.68	38.69	0.22	7.19	10.35	3.01	0.02
EAS-US	2026-06-09 14:45:00	11.69	38.28	0.22	7.21	10.28	3.18	0.02
EAS-US	2026-06-09 15:00:00	11.69	37.78	0.13	6.98	10.24	3.55	0.02
EAS-US	2026-06-09 15:15:00	11.68	36.81	0.23	7.00	10.24	3.66	0.02
EAS-US	2026-06-09 15:30:00	11.65	35.52	0.24	7.03	10.20	5.70	0.02
EAS-US	2026-06-09 15:45:00	11.60	35.53	0.23	6.95	10.21	17.75	0.02
EAS-US	2026-06-09 16:00:00	12.28	108.58	0.10	7.34	10.12	510.79	0.06
EAS-US	2026-06-09 16:15:00	12.51	92.69	0.20	7.45	10.05	539.46	0.05
EAS-US	2026-06-09 16:30:00	12.36	104.96	0.19	7.81	10.11	785.93	0.06
EAS-US	2026-06-09 16:45:00	12.21	90.95	0.18	7.75	10.16	408.65	0.05
EAS-US	2026-06-09 17:00:00	12.20	88.72	0.07	7.47	10.19	243.91	0.05
EAS-US	2026-06-09 17:15:00	12.21	88.25	0.20	7.46	10.19	170.27	0.05
EAS-US	2026-06-09 17:30:00	12.20	87.03	0.20	7.39	10.19	201.05	0.05
EAS-US	2026-06-09 17:45:00	12.28	93.29	0.20	7.37	10.20	129.20	0.05
EAS-US	2026-06-09 18:00:00	12.28	96.31	0.08	7.36	10.19	127.51	0.05
EAS-US	2026-06-09 18:15:00	12.22	96.58	0.20	7.45	10.20	65.31	0.05
EAS-US	2026-06-09 18:30:00	12.17	101.22	0.19	7.43	10.22	51.57	0.05
EAS-US	2026-06-09 18:45:00	12.10	101.71	0.19	7.42	10.23	32.53	0.05
EAS-US	2026-06-09 19:00:00	12.03	99.79	0.07	7.25	10.25	30.50	0.05
EAS-US	2026-06-09 19:15:00	11.96	94.67	0.20	7.28	10.25	25.35	0.05
EAS-US	2026-06-09 19:30:00	11.85	87.40	0.20	7.24	10.26	25.72	0.05
EAS-US	2026-06-09 19:45:00	11.78	92.40	0.20	7.24	10.29	22.95	0.05
EAS-US	2026-06-09 20:00:00	11.77	96.25	0.08	7.26	10.29	24.51	0.05
EAS-US	2026-06-09 20:15:00	11.76	90.81	0.20	7.40	10.29	22.75	0.05
EAS-US	2026-06-09 20:30:00	11.72	84.86	0.20	7.38	10.26	25.02	0.04
EAS-US	2026-06-09 20:45:00	11.69	81.63	0.20	7.36	10.28	24.60	0.04
EAS-US	2026-06-09 21:00:00	11.65	80.12	0.08	7.16	10.28	20.60	0.04
EAS-US	2026-06-09 21:15:00	11.61	77.65	0.22	7.19	10.29	16.73	0.04
EAS-US	2026-06-09 21:30:00	11.57	74.54	0.21	7.16	10.31	17.71	0.04

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-09 21:45:00	11.53	71.71	0.21	7.15	10.32	16.69	0.04
EAS-US	2026-06-09 22:00:00	11.50	73.71	0.09	7.14	10.32	15.84	0.04
EAS-US	2026-06-09 22:15:00	11.47	69.66	0.21	7.28	10.34	14.80	0.04
EAS-US	2026-06-09 22:30:00	11.43	65.89	0.21	7.27	10.33	14.46	0.03
EAS-US	2026-06-09 22:45:00	11.39	62.77	0.20	7.26	10.34	14.32	0.03
EAS-US	2026-06-09 23:00:00	11.36	60.14	0.09	7.05	10.35	14.71	0.03
EAS-US	2026-06-09 23:15:00	11.34	57.69	0.22	7.08	10.36	14.24	0.03
EAS-US	2026-06-09 23:30:00	11.31	55.53	0.22	7.06	10.34	12.51	0.03
EAS-US	2026-06-09 23:45:00	11.29	53.50	0.22	7.06	10.36	12.07	0.03
EAS-US	2026-06-10 00:00:00	11.26	51.64	0.10	7.04	10.37	13.69	0.03
EAS-US	2026-06-10 00:15:00	11.24	50.05	0.22	7.20	10.37	12.95	0.03
EAS-US	2026-06-10 00:30:00	11.21	48.61	0.22	7.19	10.38	12.08	0.02
EAS-US	2026-06-10 00:45:00	11.18	47.19	0.21	7.19	10.38	11.91	0.02
EAS-US	2026-06-10 01:00:00	11.15	46.05	0.10	6.94	10.39	12.18	0.02
EAS-US	2026-06-10 01:15:00	11.12	45.01	0.23	6.94	10.38	11.24	0.02
EAS-US	2026-06-10 01:30:00	11.09	44.09	0.23	6.99	10.41	11.35	0.02
EAS-US	2026-06-10 01:45:00	11.06	42.94	0.23	6.94	10.41	11.32	0.02
EAS-US	2026-06-10 02:00:00	11.04	41.83	0.11	6.93	10.41	12.33	0.02
EAS-US	2026-06-10 02:15:00	11.02	40.97	0.23	7.09	10.42	12.02	0.02
EAS-US	2026-06-10 02:30:00	10.99	40.16	0.22	7.08	10.42	12.19	0.02
EAS-US	2026-06-10 02:45:00	10.97	39.48	0.22	7.07	10.43	11.32	0.02
EAS-US	2026-06-10 03:00:00	10.95	38.96	0.12	6.81	10.43	11.49	0.02
EAS-US	2026-06-10 03:15:00	10.93	38.47	0.23	6.89	10.43	10.87	0.02
EAS-US	2026-06-10 03:30:00	10.90	37.90	0.23	6.84	10.43	10.43	0.02
EAS-US	2026-06-10 03:45:00	10.87	37.34	0.23	6.87	10.45	10.58	0.02
EAS-US	2026-06-10 04:00:00	10.85	36.91	0.12	6.82	10.45	13.96	0.02
EAS-US	2026-06-10 04:15:00	10.83	36.55	0.23	7.03	10.47	11.31	0.02
EAS-US	2026-06-10 04:30:00	10.80	36.23	0.23	7.01	10.46	11.42	0.02
EAS-US	2026-06-10 04:45:00	10.77	35.89	0.23	7.01	10.46	10.72	0.02
EAS-US	2026-06-10 05:00:00	10.75	35.60	0.12	6.76	10.49	10.92	0.02
EAS-US	2026-06-10 05:15:00	10.72	35.34	0.24	6.81	10.49	10.06	0.02
EAS-US	2026-06-10 05:30:00	10.69	35.15	0.24	6.83	10.49	10.23	0.02
EAS-US	2026-06-10 05:45:00	10.67	34.86	0.24	6.80	10.50	10.22	0.02
EAS-US	2026-06-10 06:00:00	10.65	34.56	0.12	6.78	10.54	10.95	0.02
EAS-US	2026-06-10 06:15:00	10.64	34.21	0.23	6.98	10.53	11.52	0.02
EAS-US	2026-06-10 06:30:00	10.63	33.93	0.23	6.98	10.53	11.33	0.02
EAS-US	2026-06-10 06:45:00	10.63	33.63	0.23	6.98	10.54	10.87	0.02
EAS-US	2026-06-10 07:00:00	10.64	33.42	0.12	6.71	10.57	10.59	0.02
EAS-US	2026-06-10 07:15:00	10.66	33.21	0.25	6.80	10.54	9.93	0.02
EAS-US	2026-06-10 07:30:00	10.67	33.05	0.25	6.80	10.55	10.01	0.02
EAS-US	2026-06-10 07:45:00	10.68	32.89	0.24	6.78	10.54	9.48	0.02
EAS-US	2026-06-10 08:00:00	10.71	32.77	0.14	6.75	10.57	11.05	0.02
EAS-US	2026-06-10 08:15:00	10.73	32.51	0.24	6.97	10.55	10.68	0.02
EAS-US	2026-06-10 08:30:00	10.77	32.38	0.23	6.97	10.55	10.82	0.02
EAS-US	2026-06-10 08:45:00	10.82	32.25	0.23	6.97	10.57	10.70	0.02
EAS-US	2026-06-10 09:00:00	10.88	32.11	0.13	6.72	10.60	9.84	0.02
EAS-US	2026-06-10 09:15:00	10.95	31.91	0.25	6.76	10.60	9.77	0.02
EAS-US	2026-06-10 09:30:00	10.99	31.80	0.24	6.80	10.59	9.52	0.02
EAS-US	2026-06-10 09:45:00	11.02	31.66	0.24	6.78	10.58	9.45	0.02
EAS-US	2026-06-10 10:00:00	11.05	31.55	0.14	6.76	10.57	10.78	0.02
EAS-US	2026-06-10 10:15:00	11.10	31.24	0.24	6.99	10.58	10.65	0.02
EAS-US	2026-06-10 10:30:00	11.16	30.87	0.24	7.00	10.59	10.54	0.02
EAS-US	2026-06-10 10:45:00	11.21	30.54	0.24	7.00	10.57	10.44	0.02
EAS-US	2026-06-10 11:00:00	11.30	30.30	0.14	6.73	10.59	9.86	0.01
EAS-US	2026-06-10 11:15:00	11.31	30.01	0.25	6.78	10.54	9.89	0.01
EAS-US	2026-06-10 11:30:00	11.37	29.76	0.24	6.80	10.58	9.20	0.01
EAS-US	2026-06-10 11:45:00	11.38	29.55	0.24	6.71	10.50	8.98	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-10 12:00:00	11.43	29.44	0.14	6.78	10.53	10.49	0.01
EAS-US	2026-06-10 12:15:00	11.50	29.22	0.24	6.99	10.53	10.50	0.01
EAS-US	2026-06-10 12:30:00	11.51	29.15	0.24	6.97	10.46	10.60	0.01
EAS-US	2026-06-10 12:45:00	11.53	29.04	0.24	6.97	10.46	10.40	0.01
EAS-US	2026-06-10 13:00:00	11.54	28.95	0.14	6.69	10.47	9.99	0.01
EAS-US	2026-06-10 13:15:00	11.55	28.74	0.25	6.79	10.44	10.00	0.01
EAS-US	2026-06-10 13:30:00	11.55	28.62	0.25	6.75	10.44	10.22	0.01
EAS-US	2026-06-10 13:45:00	11.57	28.48	0.25	6.72	10.46	9.33	0.01
EAS-US	2026-06-10 14:00:00	11.60	28.39	0.14	6.75	10.46	10.48	0.01
EAS-US	2026-06-10 14:15:00	11.63	28.32	0.24	6.97	10.44	10.57	0.01
EAS-US	2026-06-10 14:30:00	11.63	28.29	0.24	6.94	10.41	10.30	0.01
EAS-US	2026-06-10 14:45:00	11.63	28.25	0.24	6.94	10.40	10.03	0.01
EAS-US	2026-06-10 15:00:00	11.65	28.16	0.15	6.68	10.43	9.97	0.01
EAS-US	2026-06-10 15:15:00	11.68	28.02	0.25	6.74	10.43	9.65	0.01
EAS-US	2026-06-10 15:30:00	11.71	27.95	0.25	6.76	10.42	9.66	0.01
EAS-US	2026-06-10 15:45:00	11.73	27.88	0.25	6.70	10.42	9.30	0.01
EAS-US	2026-06-10 16:00:00	11.73	27.89	0.15	6.73	10.40	10.15	0.01
EAS-US	2026-06-10 16:15:00	11.72	27.82	0.25	6.94	10.36	10.07	0.01
EAS-US	2026-06-10 16:30:00	11.71	27.77	0.24	6.94	10.35	10.06	0.01
EAS-US	2026-06-10 16:45:00	11.70	27.76	0.24	6.93	10.37	10.10	0.01
EAS-US	2026-06-10 17:00:00	11.70	27.78	0.15	6.64	10.35	9.16	0.01
EAS-US	2026-06-10 17:15:00	11.69	27.73	0.26	6.68	10.36	9.10	0.01
EAS-US	2026-06-10 17:30:00	11.68	27.69	0.25	6.66	10.33	9.15	0.01
EAS-US	2026-06-10 17:45:00	11.67	27.66	0.25	6.64	10.33	9.49	0.01
EAS-US	2026-06-10 18:00:00	11.66	27.68	0.16	6.69	10.32	10.14	0.01
EAS-US	2026-06-10 18:15:00	11.65	27.65	0.25	6.91	10.31	9.95	0.01
EAS-US	2026-06-10 18:30:00	11.64	27.61	0.24	6.91	10.31	10.00	0.01
EAS-US	2026-06-10 18:45:00	11.62	27.61	0.24	6.91	10.32	10.09	0.01
EAS-US	2026-06-10 19:00:00	11.61	27.71	0.15	6.60	10.29	9.02	0.01
EAS-US	2026-06-10 19:15:00	11.60	27.63	0.26	6.63	10.29	9.49	0.01
EAS-US	2026-06-10 19:30:00	11.60	27.59	0.25	6.69	10.29	9.49	0.01
EAS-US	2026-06-10 19:45:00	11.59	27.60	0.25	6.66	10.29	9.59	0.01
EAS-US	2026-06-10 20:00:00	11.59	27.62	0.15	6.69	10.29	10.28	0.01
EAS-US	2026-06-10 20:15:00	11.58	27.65	0.25	6.89	10.29	9.88	0.01
EAS-US	2026-06-10 20:30:00	11.57	27.66	0.24	6.89	10.26	10.04	0.01
EAS-US	2026-06-10 20:45:00	11.56	27.68	0.24	6.89	10.25	10.07	0.01
EAS-US	2026-06-10 21:00:00	11.54	27.71	0.15	6.61	10.25	9.74	0.01
EAS-US	2026-06-10 21:15:00	11.53	27.68	0.26	6.62	10.25	9.65	0.01
EAS-US	2026-06-10 21:30:00	11.51	27.64	0.25	6.65	10.25	9.35	0.01
EAS-US	2026-06-10 21:45:00	11.49	27.64	0.25	6.70	10.25	9.30	0.01
EAS-US	2026-06-10 22:00:00	11.48	27.67	0.15	6.65	10.26	10.20	0.01
EAS-US	2026-06-10 22:15:00	11.46	27.60	0.25	6.89	10.26	9.67	0.01
EAS-US	2026-06-10 22:30:00	11.45	27.64	0.24	6.89	10.22	9.78	0.01
EAS-US	2026-06-10 22:45:00	11.44	27.62	0.24	6.88	10.25	9.75	0.01
EAS-US	2026-06-10 23:00:00	11.42	27.65	0.15	6.59	10.24	9.44	0.01
EAS-US	2026-06-10 23:15:00	11.41	27.63	0.25	6.66	10.27	9.28	0.01
EAS-US	2026-06-10 23:30:00	11.40	27.64	0.25	6.64	10.29	9.14	0.01
EAS-US	2026-06-10 23:45:00	11.39	27.62	0.25	6.64	10.27	9.25	0.01
EAS-US	2026-06-11 00:00:00	11.38	27.69	0.15	6.63	10.30	10.24	0.01
EAS-US	2026-06-11 00:15:00	11.37	27.65	0.24	6.89	10.28	9.83	0.01
EAS-US	2026-06-11 00:30:00	11.36	27.66	0.24	6.87	10.26	9.72	0.01
EAS-US	2026-06-11 00:45:00	11.35	27.66	0.24	6.88	10.23	9.82	0.01
EAS-US	2026-06-11 01:00:00	11.34	27.68	0.15	6.58	10.29	9.33	0.01
EAS-US	2026-06-11 01:15:00	11.33	27.68	0.26	6.65	10.26	9.18	0.01
EAS-US	2026-06-11 01:30:00	11.32	27.64	0.25	6.66	10.30	10.03	0.01
EAS-US	2026-06-11 01:45:00	11.31	27.66	0.25	6.66	10.31	9.58	0.01
EAS-US	2026-06-11 02:00:00	11.30	27.69	0.15	6.64	10.29	9.98	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-11 02:15:00	11.29	27.69	0.25	6.87	10.22	9.83	0.01
EAS-US	2026-06-11 02:30:00	11.28	27.69	0.24	6.88	10.27	10.02	0.01
EAS-US	2026-06-11 02:45:00	11.27	27.69	0.24	6.87	10.27	10.17	0.01
EAS-US	2026-06-11 03:00:00	11.26	27.75	0.15	6.59	10.27	8.12	0.01
EAS-US	2026-06-11 03:15:00	11.25	27.65	0.25	6.68	10.29	9.99	0.01
EAS-US	2026-06-11 03:30:00	11.23	27.62	0.25	6.66	10.31	10.69	0.01
EAS-US	2026-06-11 03:45:00	11.22	27.63	0.25	6.65	10.31	10.40	0.01
EAS-US	2026-06-11 04:00:00	11.20	27.63	0.15	6.67	10.31	10.14	0.01
EAS-US	2026-06-11 04:15:00	11.18	27.58	0.24	6.88	10.32	10.69	0.01
EAS-US	2026-06-11 04:30:00	11.16	27.59	0.24	6.88	10.32	10.75	0.01
EAS-US	2026-06-11 04:45:00	11.14	27.55	0.24	6.88	10.32	10.76	0.01
EAS-US	2026-06-11 05:00:00	11.13	27.60	0.15	6.60	10.31	8.71	0.01
EAS-US	2026-06-11 05:15:00	11.11	27.55	0.25	6.70	10.33	9.47	0.01
EAS-US	2026-06-11 05:30:00	11.10	27.51	0.25	6.64	10.35	9.68	0.01
EAS-US	2026-06-11 05:45:00	11.08	27.49	0.25	6.64	10.33	9.49	0.01
EAS-US	2026-06-11 06:00:00	11.07	27.49	0.15	6.65	10.35	10.20	0.01
EAS-US	2026-06-11 06:15:00	11.05	27.43	0.25	6.89	10.36	10.24	0.01
EAS-US	2026-06-11 06:30:00	11.03	27.41	0.24	6.88	10.37	10.10	0.01
EAS-US	2026-06-11 06:45:00	11.01	27.36	0.24	6.89	10.37	10.07	0.01
EAS-US	2026-06-11 07:00:00	10.99	27.40	0.15	6.61	10.33	9.61	0.01
EAS-US	2026-06-11 07:15:00	10.98	27.33	0.25	6.64	10.39	9.02	0.01
EAS-US	2026-06-11 07:30:00	10.97	27.32	0.25	6.69	10.41	8.76	0.01
EAS-US	2026-06-11 07:45:00	10.97	27.30	0.25	6.64	10.42	9.17	0.01
EAS-US	2026-06-11 08:00:00	10.98	27.37	0.15	6.64	10.42	10.59	0.01
EAS-US	2026-06-11 08:15:00	10.99	27.31	0.24	6.89	10.40	10.58	0.01
EAS-US	2026-06-11 08:30:00	11.01	27.29	0.24	6.90	10.40	11.36	0.01
EAS-US	2026-06-11 08:45:00	11.06	27.27	0.24	6.90	10.37	10.53	0.01
EAS-US	2026-06-11 09:00:00	11.11	27.31	0.16	6.62	10.40	8.78	0.01
EAS-US	2026-06-11 09:15:00	11.15	27.23	0.25	6.70	10.42	8.73	0.01
EAS-US	2026-06-11 09:30:00	11.21	27.23	0.25	6.65	10.46	9.52	0.01
EAS-US	2026-06-11 09:45:00	11.25	27.23	0.25	6.70	10.44	9.45	0.01
EAS-US	2026-06-11 10:00:00	11.26	27.31	0.15	6.71	10.45	11.30	0.01
EAS-US	2026-06-11 10:15:00	11.30	27.24	0.24	6.94	10.42	10.95	0.01
EAS-US	2026-06-11 10:30:00	11.39	27.19	0.24	6.94	10.43	11.09	0.01
EAS-US	2026-06-11 10:45:00	11.56	27.12	0.24	6.96	10.51	10.41	0.01
EAS-US	2026-06-11 11:00:00	11.75	27.14	0.15	6.70	10.47	9.61	0.01
EAS-US	2026-06-11 11:15:00	11.82	27.03	0.25	6.78	10.46	9.18	0.01
EAS-US	2026-06-11 11:30:00	11.89	27.00	0.25	6.75	10.45	9.30	0.01
EAS-US	2026-06-11 11:45:00	12.06	26.93	0.24	6.81	10.45	9.46	0.01
EAS-US	2026-06-11 12:00:00	12.10	26.93	0.15	6.78	10.44	11.33	0.01
EAS-US	2026-06-11 12:15:00	12.21	26.89	0.24	7.00	10.42	10.99	0.01
EAS-US	2026-06-11 12:30:00	12.25	26.92	0.24	7.00	10.40	11.12	0.01
EAS-US	2026-06-11 12:45:00	12.30	26.96	0.24	7.00	10.38	10.80	0.01
EAS-US	2026-06-11 13:00:00	12.33	26.95	0.16	6.71	10.34	9.38	0.01
EAS-US	2026-06-11 13:15:00	12.38	26.98	0.25	6.79	10.31	8.31	0.01
EAS-US	2026-06-11 13:30:00	12.38	27.01	0.25	6.72	10.29	8.28	0.01
EAS-US	2026-06-11 13:45:00	12.41	27.06	0.25	6.78	10.28	8.53	0.01
EAS-US	2026-06-11 14:00:00	12.39	27.13	0.15	6.75	10.26	9.01	0.01
EAS-US	2026-06-11 14:15:00	12.42	27.14	0.24	6.99	10.25	9.04	0.01
EAS-US	2026-06-11 14:30:00	12.46	27.14	0.24	6.98	10.28	9.19	0.01
EAS-US	2026-06-11 14:45:00	12.54	27.18	0.24	6.98	10.24	9.03	0.01
EAS-US	2026-06-11 15:00:00	12.66	27.35	0.15	6.71	10.17	8.24	0.01
EAS-US	2026-06-11 15:15:00	12.79	27.36	0.25	6.71	10.13	8.03	0.01
EAS-US	2026-06-11 15:30:00	12.90	27.34	0.24	6.77	10.10	8.37	0.01
EAS-US	2026-06-11 15:45:00	12.99	27.46	0.24	6.75	10.05	8.41	0.01
EAS-US	2026-06-11 16:00:00	13.04	27.53	0.15	6.73	10.02	9.46	0.01
EAS-US	2026-06-11 16:15:00	13.06	27.45	0.24	6.97	10.02	9.18	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-11 16:30:00	13.08	27.45	0.24	6.97	10.05	9.08	0.01
EAS-US	2026-06-11 16:45:00	13.07	27.48	0.23	6.97	10.04	9.09	0.01
EAS-US	2026-06-11 17:00:00	12.99	27.64	0.15	6.69	9.99	8.35	0.01
EAS-US	2026-06-11 17:15:00	12.91	27.66	0.25	6.74	9.98	8.80	0.01
EAS-US	2026-06-11 17:30:00	12.84	27.78	0.25	6.71	9.98	8.63	0.01
EAS-US	2026-06-11 17:45:00	12.80	27.84	0.25	6.73	10.00	8.59	0.01
EAS-US	2026-06-11 18:00:00	12.76	27.81	0.15	6.70	9.97	9.54	0.01
EAS-US	2026-06-11 18:15:00	12.72	28.07	0.24	6.91	9.92	9.63	0.01
EAS-US	2026-06-11 18:30:00	12.68	28.12	0.24	6.91	9.93	9.71	0.01
EAS-US	2026-06-11 18:45:00	12.63	28.17	0.24	6.91	9.92	9.34	0.01
EAS-US	2026-06-11 19:00:00	12.59	28.25	0.15	6.62	9.94	8.46	0.01
EAS-US	2026-06-11 19:15:00	12.56	28.21	0.25	6.70	9.95	8.40	0.01
EAS-US	2026-06-11 19:30:00	12.53	28.24	0.25	6.69	9.95	8.35	0.01
EAS-US	2026-06-11 19:45:00	12.49	28.28	0.25	6.66	9.94	8.61	0.01
EAS-US	2026-06-11 20:00:00	12.46	28.34	0.15	6.66	9.95	9.63	0.01
EAS-US	2026-06-11 20:15:00	12.42	28.41	0.24	6.91	9.94	9.28	0.01
EAS-US	2026-06-11 20:30:00	12.38	28.46	0.24	6.90	9.94	9.43	0.01
EAS-US	2026-06-11 20:45:00	12.35	28.49	0.24	6.90	9.94	9.17	0.01
EAS-US	2026-06-11 21:00:00	12.31	28.52	0.15	6.61	9.94	8.64	0.01
EAS-US	2026-06-11 21:15:00	12.28	28.52	0.25	6.63	9.95	8.63	0.01
EAS-US	2026-06-11 21:30:00	12.24	28.49	0.25	6.64	9.96	8.42	0.01
EAS-US	2026-06-11 21:45:00	12.20	28.48	0.25	6.71	9.96	8.24	0.01
EAS-US	2026-06-11 22:00:00	12.16	28.50	0.15	6.66	9.96	9.47	0.01
EAS-US	2026-06-11 22:15:00	12.13	28.46	0.24	6.90	9.97	9.26	0.01
EAS-US	2026-06-11 22:30:00	12.09	28.40	0.24	6.90	9.99	9.25	0.01
EAS-US	2026-06-11 22:45:00	12.06	28.40	0.24	6.90	10.00	9.33	0.01
EAS-US	2026-06-11 23:00:00	12.02	28.42	0.15	6.61	10.00	8.78	0.01
EAS-US	2026-06-11 23:15:00	11.99	28.37	0.25	6.68	9.98	8.37	0.01
EAS-US	2026-06-11 23:30:00	11.96	28.38	0.25	6.68	10.02	8.71	0.01
EAS-US	2026-06-11 23:45:00	11.93	28.35	0.25	6.68	10.04	8.46	0.01
EAS-US	2026-06-12 00:00:00	11.89	28.39	0.15	6.64	10.04	9.75	0.01
EAS-US	2026-06-12 00:15:00	11.86	28.37	0.25	6.89	10.04	9.55	0.01
EAS-US	2026-06-12 00:30:00	11.83	28.36	0.24	6.90	10.05	9.58	0.01
EAS-US	2026-06-12 00:45:00	11.80	28.36	0.24	6.90	10.06	9.45	0.01
EAS-US	2026-06-12 01:00:00	11.76	28.40	0.15	6.61	10.07	8.57	0.01
EAS-US	2026-06-12 01:15:00	11.73	28.34	0.25	6.65	10.08	8.72	0.01
EAS-US	2026-06-12 01:30:00	11.69	28.34	0.25	6.71	10.08	8.91	0.01
EAS-US	2026-06-12 01:45:00	11.66	28.33	0.25	6.61	10.08	9.72	0.01
EAS-US	2026-06-12 02:00:00	11.63	28.31	0.16	6.66	10.11	10.07	0.01
EAS-US	2026-06-12 02:15:00	11.60	28.29	0.25	6.89	10.09	9.65	0.01
EAS-US	2026-06-12 02:30:00	11.56	28.26	0.24	6.90	10.13	9.31	0.01
EAS-US	2026-06-12 02:45:00	11.53	28.28	0.24	6.90	10.12	9.79	0.01
EAS-US	2026-06-12 03:00:00	11.49	28.28	0.15	6.61	10.09	9.25	0.01
EAS-US	2026-06-12 03:15:00	11.46	28.25	0.25	6.66	10.15	8.47	0.01
EAS-US	2026-06-12 03:30:00	11.42	28.24	0.25	6.68	10.15	8.22	0.01
EAS-US	2026-06-12 03:45:00	11.39	28.20	0.25	6.67	10.17	8.44	0.01
EAS-US	2026-06-12 04:00:00	11.36	28.26	0.15	6.65	10.16	9.39	0.01
EAS-US	2026-06-12 04:15:00	11.33	28.24	0.25	6.89	10.13	9.57	0.01
EAS-US	2026-06-12 04:30:00	11.30	28.26	0.24	6.90	10.03	9.72	0.01
EAS-US	2026-06-12 04:45:00	11.26	28.29	0.24	6.90	9.91	9.88	0.01
EAS-US	2026-06-12 05:00:00	11.23	28.27	0.15	6.59	9.99	8.79	0.01
EAS-US	2026-06-12 05:15:00	11.20	28.14	0.25	6.68	10.05	8.78	0.01
EAS-US	2026-06-12 05:30:00	11.17	28.16	0.25	6.68	10.02	8.77	0.01
EAS-US	2026-06-12 05:45:00	11.16	28.16	0.25	6.65	9.98	8.60	0.01
EAS-US	2026-06-12 06:00:00	11.13	28.07	0.15	6.67	10.13	17.26	0.01
EAS-US	2026-06-12 06:15:00	11.11	28.13	0.25	6.89	10.15	9.44	0.01
EAS-US	2026-06-12 06:30:00	11.10	28.10	0.24	6.90	10.08	9.48	0.01


Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-12 06:45:00	11.08	28.15	0.24	6.90	10.00	9.57	0.01
EAS-US	2026-06-12 07:00:00	11.07	28.06	0.15	6.63	10.11	8.46	0.01
EAS-US	2026-06-12 07:15:00	11.06	27.97	0.26	6.72	10.05	7.45	0.01
EAS-US	2026-06-12 07:30:00	11.05	27.96	0.25	6.66	9.97	7.41	0.01
EAS-US	2026-06-12 07:45:00	11.05	28.09	0.25	6.68	10.20	7.80	0.01
EAS-US	2026-06-12 08:00:00	11.06	27.92	0.15	6.66	10.21	9.54	0.01
EAS-US	2026-06-12 08:15:00	11.06	28.02	0.25	6.90	10.12	13.14	0.01
EAS-US	2026-06-12 08:30:00	11.08	28.05	0.24	6.91	10.21	14.88	0.01
EAS-US	2026-06-12 08:45:00	11.11	28.02	0.24	6.90	10.08	15.34	0.01
EAS-US	2026-06-12 09:00:00	11.17	27.89	0.15	6.62	10.00	15.22	0.01
EAS-US	2026-06-12 09:15:00	11.22	27.94	0.26	6.71	10.23	12.51	0.01
EAS-US	2026-06-12 09:30:00	11.28	27.83	0.25	6.70	10.07	11.65	0.01
EAS-US	2026-06-12 09:45:00	11.36	27.90	0.25	6.72	10.19	14.45	0.01
EAS-US	2026-06-12 10:00:00	11.34	27.90	0.16	6.68	10.23	9.86	0.01
EAS-US	2026-06-12 10:15:00	11.39	27.97	0.25	6.91	10.22	11.32	0.01
EAS-US	2026-06-12 10:30:00	11.49	27.77	0.25	6.93	10.21	11.68	0.01
EAS-US	2026-06-12 10:45:00	11.65	27.77	0.24	6.94	10.37	7.28	0.01
EAS-US	2026-06-12 11:00:00	11.87	27.85	0.16	6.69	10.40	7.85	0.01
EAS-US	2026-06-12 11:15:00	12.06	27.70	0.26	6.75	10.30	7.52	0.01
EAS-US	2026-06-12 11:30:00	12.25	27.78	0.25	6.72	10.30	7.63	0.01
EAS-US	2026-06-12 11:45:00	12.46	27.69	0.25	6.73	10.29	7.48	0.01
EAS-US	2026-06-12 12:00:00	12.71	27.69	0.16	6.79	10.29	8.72	0.01
EAS-US	2026-06-12 12:15:00	12.83	27.69	0.24	7.01	10.26	7.90	0.01
EAS-US	2026-06-12 12:30:00	12.90	27.68	0.24	7.01	10.19	7.67	0.01
EAS-US	2026-06-12 12:45:00	13.00	27.75	0.24	7.01	10.14	9.15	0.01
EAS-US	2026-06-12 13:00:00	13.13	27.96	0.16	6.70	10.07	8.18	0.01
EAS-US	2026-06-12 13:15:00	13.20	27.81	0.25	6.78	10.00	8.01	0.01
EAS-US	2026-06-12 13:30:00	13.32	27.84	0.25	6.66	10.00	7.79	0.01
EAS-US	2026-06-12 13:45:00	13.44	27.91	0.25	6.78	9.90	7.58	0.01
EAS-US	2026-06-12 14:00:00	13.57	28.01	0.16	6.74	9.89	7.83	0.01
EAS-US	2026-06-12 14:15:00	13.69	27.97	0.25	6.97	9.78	7.58	0.01
EAS-US	2026-06-12 14:30:00	13.79	27.93	0.24	6.98	9.49	7.75	0.01
EAS-US	2026-06-12 14:45:00	13.87	28.01	0.24	6.97	9.70	7.83	0.01
EAS-US	2026-06-12 15:00:00	13.93	28.05	0.16	6.71	9.69	7.45	0.01
EAS-US	2026-06-12 15:15:00	14.00	28.20	0.25	6.74	9.41	7.62	0.01
EAS-US	2026-06-12 15:30:00	14.06	28.12	0.25	6.75	9.47	7.70	0.01
EAS-US	2026-06-12 15:45:00	14.08	28.35	0.24	6.80	9.55	7.59	0.01
EAS-US	2026-06-12 16:00:00	14.11	28.18	0.16	6.72	9.39	8.13	0.01
EAS-US	2026-06-12 16:15:00	14.09	28.34	0.24	6.94	9.62	7.91	0.01
EAS-US	2026-06-12 16:30:00	14.13	28.25	0.24	6.90	9.20	7.69	0.01
EAS-US	2026-06-12 16:45:00	14.11	28.36	0.24	6.95	9.14	7.56	0.01
EAS-US	2026-06-12 17:00:00	14.09	28.47	0.16	6.66	8.93	7.42	0.01
EAS-US	2026-06-12 17:15:00	14.04	28.61	0.25	6.68	8.90	7.40	0.01
EAS-US	2026-06-12 17:30:00	13.96	28.69	0.25	6.69	9.25	7.44	0.01
EAS-US	2026-06-12 17:45:00	13.88	28.85	0.25	6.66	9.12	7.31	0.01
EAS-US	2026-06-12 18:00:00	13.80	28.83	0.16	6.66	8.75	7.76	0.01
EAS-US	2026-06-12 18:15:00	13.73	29.09	0.25	6.88	8.45	7.71	0.01
EAS-US	2026-06-12 18:30:00	13.66	29.01	0.24	6.91	9.46	7.47	0.01
EAS-US	2026-06-12 18:45:00	13.60	29.03	0.24	6.91	9.52	7.77	0.01
EAS-US	2026-06-12 19:00:00	13.54	29.12	0.16	6.62	9.09	7.56	0.01
EAS-US	2026-06-12 19:15:00	13.48	29.30	0.25	6.67	9.35	7.55	0.01
EAS-US	2026-06-12 19:30:00	13.43	29.90	0.25	6.67	9.54	7.57	0.01
EAS-US	2026-06-12 19:45:00	13.38	29.89	0.25	6.64	9.19	7.38	0.01
EAS-US	2026-06-12 20:00:00	13.33	29.84	0.16	6.65	9.63	10.36	0.01
EAS-US	2026-06-12 20:15:00	13.29	29.76	0.24	6.90	9.66	7.50	0.01
EAS-US	2026-06-12 20:30:00	13.25	29.78	0.24	6.90	8.97	7.72	0.01
EAS-US	2026-06-12 20:45:00	13.21	29.74	0.24	6.88	9.31	7.55	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-12 21:00:00	13.17	29.72	0.16	6.61	9.36	7.25	0.01
EAS-US	2026-06-12 21:15:00	13.13	29.64	0.25	6.66	9.67	7.38	0.01
EAS-US	2026-06-12 21:30:00	13.09	30.01	0.25	6.67	9.32	7.46	0.01
EAS-US	2026-06-12 21:45:00	13.06	29.58	0.25	6.65	8.97	7.41	0.01
EAS-US	2026-06-12 22:00:00	13.03	29.58	0.15	6.64	9.33	8.45	0.01
EAS-US	2026-06-12 22:15:00	12.99	29.81	0.24	6.87	9.48	7.75	0.01
EAS-US	2026-06-12 22:30:00	12.96	29.65	0.24	6.90	9.66	7.62	0.01
EAS-US	2026-06-12 22:45:00	12.92	29.51	0.24	6.87	9.70	7.73	0.01
EAS-US	2026-06-12 23:00:00	12.89	29.59	0.15	6.60	9.26	6.62	0.01
EAS-US	2026-06-12 23:15:00	12.86	29.52	0.25	6.67	9.77	6.58	0.01
EAS-US	2026-06-12 23:30:00	12.82	29.56	0.25	6.67	9.71	6.50	0.01
EAS-US	2026-06-12 23:45:00	12.78	29.71	0.25	6.64	9.73	6.49	0.01
EAS-US	2026-06-13 00:00:00	12.75	29.52	0.15	6.62	9.74	6.70	0.01
EAS-US	2026-06-13 00:15:00	12.71	29.66	0.25	6.88	8.88	6.56	0.01
EAS-US	2026-06-13 00:30:00	12.68	29.75	0.24	6.87	9.66	6.56	0.01
EAS-US	2026-06-13 00:45:00	12.64	29.48	0.24	6.89	9.82	6.65	0.01
EAS-US	2026-06-13 01:00:00	12.60	29.49	0.16	6.61	9.81	6.73	0.01
EAS-US	2026-06-13 01:15:00	12.57	29.52	0.25	6.65	9.82	6.71	0.01
EAS-US	2026-06-13 01:30:00	12.53	29.47	0.25	6.67	9.79	6.56	0.01
EAS-US	2026-06-13 01:45:00	12.49	29.43	0.25	6.63	9.88	6.63	0.01
EAS-US	2026-06-13 02:00:00	12.46	29.45	0.15	6.66	9.86	6.72	0.01
EAS-US	2026-06-13 02:15:00	12.42	29.43	0.24	6.90	9.79	6.40	0.01
EAS-US	2026-06-13 02:30:00	12.39	29.50	0.24	6.89	9.66	6.54	0.01
EAS-US	2026-06-13 02:45:00	12.36	29.46	0.24	6.89	9.72	6.87	0.01
EAS-US	2026-06-13 03:00:00	12.32	29.42	0.16	6.62	9.50	6.64	0.01
EAS-US	2026-06-13 03:15:00	12.29	29.48	0.26	6.66	9.84	6.54	0.01
EAS-US	2026-06-13 03:30:00	12.25	29.37	0.25	6.69	9.97	6.64	0.01
EAS-US	2026-06-13 03:45:00	12.22	29.41	0.25	6.70	9.85	6.74	0.01
EAS-US	2026-06-13 04:00:00	12.20	29.39	0.16	6.64	9.95	6.95	0.01
EAS-US	2026-06-13 04:15:00	12.17	29.71	0.24	6.88	8.95	6.67	0.01
EAS-US	2026-06-13 04:30:00	12.14	29.52	0.24	6.90	9.35	6.63	0.01
EAS-US	2026-06-13 04:45:00	12.12	29.46	0.24	6.90	9.75	6.83	0.01
EAS-US	2026-06-13 05:00:00	12.09	29.33	0.16	6.61	9.88	7.15	0.01
EAS-US	2026-06-13 05:15:00	12.06	29.28	0.26	6.57	9.92	6.79	0.01
EAS-US	2026-06-13 05:30:00	12.03	29.28	0.25	6.71	9.88	6.77	0.01
EAS-US	2026-06-13 05:45:00	12.01	29.27	0.25	6.64	9.85	6.71	0.01
EAS-US	2026-06-13 06:00:00	11.98	29.17	0.16	6.66	9.91	6.87	0.01
EAS-US	2026-06-13 06:15:00	11.96	29.06	0.25	6.91	9.99	9.93	0.01
EAS-US	2026-06-13 06:30:00	11.95	29.08	0.24	6.91	9.97	6.62	0.01
EAS-US	2026-06-13 06:45:00	11.93	29.16	0.24	6.90	9.97	6.43	0.01
EAS-US	2026-06-13 07:00:00	11.92	29.12	0.16	6.62	9.85	6.65	0.01
EAS-US	2026-06-13 07:15:00	11.91	29.11	0.25	6.75	10.03	6.70	0.01
EAS-US	2026-06-13 07:30:00	11.91	29.05	0.25	6.71	10.01	6.70	0.01
EAS-US	2026-06-13 07:45:00	11.91	29.04	0.25	6.71	10.10	6.67	0.01
EAS-US	2026-06-13 08:00:00	11.91	29.02	0.15	6.67	10.14	6.77	0.01
EAS-US	2026-06-13 08:15:00	11.93	29.01	0.25	6.90	10.05	6.70	0.01
EAS-US	2026-06-13 08:30:00	11.95	29.02	0.24	6.91	10.09	6.51	0.01
EAS-US	2026-06-13 08:45:00	11.98	28.92	0.24	6.92	10.13	6.85	0.01
EAS-US	2026-06-13 09:00:00	12.05	28.94	0.15	6.65	10.13	6.75	0.01
EAS-US	2026-06-13 09:15:00	12.11	28.86	0.26	6.67	10.16	6.81	0.01
EAS-US	2026-06-13 09:30:00	12.16	28.91	0.25	6.74	10.15	6.70	0.01
EAS-US	2026-06-13 09:45:00	12.20	28.94	0.25	6.74	10.11	6.72	0.01
EAS-US	2026-06-13 10:00:00	12.23	28.95	0.16	6.67	10.16	6.77	0.01
EAS-US	2026-06-13 10:15:00	12.28	28.89	0.24	6.95	10.16	6.75	0.01
EAS-US	2026-06-13 10:30:00	12.38	28.91	0.24	6.95	10.15	6.67	0.01
EAS-US	2026-06-13 10:45:00	12.55	28.84	0.24	6.96	10.16	6.86	0.01
EAS-US	2026-06-13 11:00:00	12.77	28.82	0.16	6.71	10.12	6.70	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-13 11:15:00	12.99	28.72	0.25	6.79	10.19	6.56	0.01
EAS-US	2026-06-13 11:30:00	13.19	28.67	0.25	6.79	10.17	6.53	0.01
EAS-US	2026-06-13 11:45:00	13.40	28.60	0.25	6.76	10.16	6.66	0.01
EAS-US	2026-06-13 12:00:00	13.67	28.58	0.17	6.80	10.16	6.95	0.01
EAS-US	2026-06-13 12:15:00	13.73	28.56	0.24	7.04	10.13	6.80	0.01
EAS-US	2026-06-13 12:30:00	13.81	28.56	0.24	7.03	10.06	6.91	0.01
EAS-US	2026-06-13 12:45:00	13.88	28.61	0.24	7.03	10.01	6.77	0.01
EAS-US	2026-06-13 13:00:00	13.99	28.71	0.16	6.76	9.92	6.81	0.01
EAS-US	2026-06-13 13:15:00	14.08	28.71	0.25	6.79	9.86	6.58	0.01
EAS-US	2026-06-13 13:30:00	14.19	28.77	0.24	6.78	9.82	6.71	0.01
EAS-US	2026-06-13 13:45:00	14.33	28.85	0.25	6.77	9.76	6.68	0.01
EAS-US	2026-06-13 14:00:00	14.45	28.92	0.16	6.76	9.70	7.71	0.01
EAS-US	2026-06-13 14:15:00	14.55	28.92	0.24	6.99	9.63	6.70	0.01
EAS-US	2026-06-13 14:30:00	14.68	28.92	0.24	6.99	9.56	6.70	0.01
EAS-US	2026-06-13 14:45:00	14.77	28.96	0.24	6.99	9.58	6.46	0.01
EAS-US	2026-06-13 15:00:00	14.88	29.12	0.17	6.73	9.54	6.72	0.01
EAS-US	2026-06-13 15:15:00	14.97	29.03	0.25	6.74	9.56	6.68	0.01
EAS-US	2026-06-13 15:30:00	15.03	29.06	0.25	6.77	9.56	6.70	0.01
EAS-US	2026-06-13 15:45:00	15.06	29.03	0.25	6.73	9.54	6.79	0.01
EAS-US	2026-06-13 16:00:00	15.10	29.17	0.16	6.73	9.53	6.84	0.01
EAS-US	2026-06-13 16:15:00	15.12	29.20	0.24	6.96	9.26	6.68	0.01
EAS-US	2026-06-13 16:30:00	15.15	29.29	0.24	6.97	8.96	6.91	0.01
EAS-US	2026-06-13 16:45:00	15.14	29.42	0.24	6.96	8.93	6.80	0.01
EAS-US	2026-06-13 17:00:00	15.12	29.42	0.16	6.72	9.37	6.99	0.01
EAS-US	2026-06-13 17:15:00	15.05	29.49	0.25	6.77	9.14	6.79	0.01
EAS-US	2026-06-13 17:30:00	14.96	29.57	0.25	6.78	9.33	6.82	0.01
EAS-US	2026-06-13 17:45:00	14.86	29.62	0.25	6.69	9.44	7.08	0.01
EAS-US	2026-06-13 18:00:00	14.78	29.68	0.17	6.68	9.34	7.12	0.01
EAS-US	2026-06-13 18:15:00	14.70	29.81	0.25	6.92	9.37	7.17	0.01
EAS-US	2026-06-13 18:30:00	14.63	29.83	0.24	6.92	9.17	6.99	0.01
EAS-US	2026-06-13 18:45:00	14.56	29.85	0.25	6.92	9.25	6.87	0.01
EAS-US	2026-06-13 19:00:00	14.50	29.88	0.17	6.63	9.26	6.76	0.01
EAS-US	2026-06-13 19:15:00	14.44	29.88	0.25	6.64	9.32	6.92	0.01
EAS-US	2026-06-13 19:30:00	14.38	29.88	0.25	6.70	9.47	6.88	0.01
EAS-US	2026-06-13 19:45:00	14.33	29.90	0.25	6.71	9.46	6.71	0.01
EAS-US	2026-06-13 20:00:00	14.29	30.00	0.16	6.67	9.42	6.95	0.01
EAS-US	2026-06-13 20:15:00	14.24	29.98	0.25	6.92	9.50	6.87	0.01
EAS-US	2026-06-13 20:30:00	14.19	30.01	0.24	6.92	9.50	6.89	0.01
EAS-US	2026-06-13 20:45:00	14.15	30.11	0.24	6.92	9.37	6.83	0.01
EAS-US	2026-06-13 21:00:00	14.11	30.11	0.17	6.64	9.49	6.44	0.01
EAS-US	2026-06-13 21:15:00	14.07	30.10	0.25	6.72	9.52	6.63	0.01
EAS-US	2026-06-13 21:30:00	14.02	30.11	0.25	6.73	9.48	6.64	0.01
EAS-US	2026-06-13 21:45:00	13.98	30.07	0.25	6.71	9.52	6.68	0.01
EAS-US	2026-06-13 22:00:00	13.94	30.10	0.16	6.67	9.53	7.23	0.01
EAS-US	2026-06-13 22:15:00	13.90	30.09	0.25	6.91	9.54	6.91	0.01
EAS-US	2026-06-13 22:30:00	13.85	30.12	0.24	6.91	9.57	6.86	0.01
EAS-US	2026-06-13 22:45:00	13.81	30.13	0.25	6.90	9.57	7.01	0.01
EAS-US	2026-06-13 23:00:00	13.78	30.21	0.16	6.64	9.57	6.62	0.01
EAS-US	2026-06-13 23:15:00	13.73	30.16	0.26	6.69	9.58	6.52	0.01
EAS-US	2026-06-13 23:30:00	13.69	30.22	0.25	6.71	9.59	7.12	0.01
EAS-US	2026-06-13 23:45:00	13.65	30.21	0.25	6.72	9.60	6.88	0.01
EAS-US	2026-06-14 00:00:00	13.61	30.20	0.16	6.67	9.58	7.11	0.01
EAS-US	2026-06-14 00:15:00	13.57	30.24	0.25	6.90	9.53	6.85	0.01
EAS-US	2026-06-14 00:30:00	13.53	30.36	0.25	6.89	9.07	6.84	0.01
EAS-US	2026-06-14 00:45:00	13.49	30.31	0.24	6.86	9.34	6.90	0.01
EAS-US	2026-06-14 01:00:00	13.45	30.35	0.17	6.62	9.30	7.26	0.01
EAS-US	2026-06-14 01:15:00	13.42	30.27	0.26	6.66	9.66	6.81	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (µS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-14 01:30:00	13.38	30.27	0.25	6.66	9.66	6.76	0.01
EAS-US	2026-06-14 01:45:00	13.34	30.25	0.25	6.69	9.67	6.71	0.01
EAS-US	2026-06-14 02:00:00	13.31	30.29	0.16	6.66	9.50	7.03	0.01
EAS-US	2026-06-14 02:15:00	13.28	30.27	0.24	6.90	9.67	6.99	0.01
EAS-US	2026-06-14 02:30:00	13.25	30.28	0.24	6.90	9.65	6.86	0.01
EAS-US	2026-06-14 02:45:00	13.22	30.30	0.24	6.90	9.65	6.80	0.01
EAS-US	2026-06-14 03:00:00	13.19	30.34	0.16	6.63	9.64	6.73	0.01
EAS-US	2026-06-14 03:15:00	13.17	30.21	0.25	6.66	9.72	6.82	0.01
EAS-US	2026-06-14 03:30:00	13.14	30.18	0.25	6.74	9.74	6.76	0.01
EAS-US	2026-06-14 03:45:00	13.11	30.30	0.25	6.73	9.52	6.95	0.01
EAS-US	2026-06-14 04:00:00	13.09	30.20	0.16	6.66	9.74	7.05	0.01
EAS-US	2026-06-14 04:15:00	13.05	30.16	0.25	6.92	9.70	6.96	0.01
EAS-US	2026-06-14 04:30:00	13.02	30.18	0.24	6.91	9.62	6.82	0.01
EAS-US	2026-06-14 04:45:00	12.99	30.21	0.24	6.92	9.62	6.99	0.01
EAS-US	2026-06-14 05:00:00	12.96	30.13	0.16	6.65	9.49	6.70	0.01
EAS-US	2026-06-14 05:15:00	12.93	30.08	0.26	6.69	9.79	6.77	0.01
EAS-US	2026-06-14 05:30:00	12.90	30.09	0.25	6.67	9.80	6.92	0.01
EAS-US	2026-06-14 05:45:00	12.88	30.04	0.26	6.72	9.81	6.94	0.01
EAS-US	2026-06-14 06:00:00	12.85	30.04	0.17	6.67	9.84	7.20	0.01
EAS-US	2026-06-14 06:15:00	12.83	29.99	0.25	6.92	9.78	6.91	0.01
EAS-US	2026-06-14 06:30:00	12.81	29.93	0.25	6.92	9.87	6.92	0.01
EAS-US	2026-06-14 06:45:00	12.80	29.92	0.25	6.93	9.88	7.70	0.01
EAS-US	2026-06-14 07:00:00	12.78	29.95	0.17	6.67	9.88	6.81	0.01
EAS-US	2026-06-14 07:15:00	12.78	29.89	0.25	6.75	9.86	7.00	0.01
EAS-US	2026-06-14 07:30:00	12.77	29.87	0.26	6.71	9.88	6.98	0.01
EAS-US	2026-06-14 07:45:00	12.77	29.86	0.25	6.63	9.91	6.94	0.01
EAS-US	2026-06-14 08:00:00	12.78	29.85	0.17	6.68	9.90	7.18	0.01
EAS-US	2026-06-14 08:15:00	12.79	29.81	0.24	6.93	9.91	7.01	0.01
EAS-US	2026-06-14 08:30:00	12.81	29.79	0.25	6.94	9.92	6.92	0.01
EAS-US	2026-06-14 08:45:00	12.84	29.79	0.24	6.94	9.95	6.92	0.01
EAS-US	2026-06-14 09:00:00	12.90	29.75	0.17	6.67	9.91	6.63	0.01
EAS-US	2026-06-14 09:15:00	12.96	29.72	0.26	6.70	9.94	6.69	0.01
EAS-US	2026-06-14 09:30:00	13.02	29.77	0.25	6.74	9.87	6.83	0.01
EAS-US	2026-06-14 09:45:00	13.06	29.79	0.25	6.72	9.95	6.81	0.01
EAS-US	2026-06-14 10:00:00	13.09	29.88	0.17	6.71	9.93	7.10	0.01
EAS-US	2026-06-14 10:15:00	13.12	29.85	0.25	6.97	9.90	8.21	0.01
EAS-US	2026-06-14 10:30:00	13.21	29.81	0.24	6.97	9.88	6.95	0.01
EAS-US	2026-06-14 10:45:00	13.38	29.68	0.24	6.99	9.97	6.70	0.01
EAS-US	2026-06-14 11:00:00	13.60	29.62	0.12	6.89	9.98	6.56	0.01
EAS-US	2026-06-14 11:15:00	13.83	29.60	0.24	7.05	10.01	6.63	0.01
EAS-US	2026-06-14 11:30:00	14.06	29.61	0.24	7.04	9.99	6.57	0.01
EAS-US	2026-06-14 11:45:00	14.30	29.36	0.23	7.09	9.98	6.62	0.01
EAS-US	2026-06-14 12:00:00	14.58	29.40	0.13	6.98	9.95	6.31	0.01
EAS-US	2026-06-14 12:15:00	14.73	29.39	0.23	7.09	9.92	6.31	0.01
EAS-US	2026-06-14 12:30:00	14.77	29.44	0.23	7.09	9.85	6.34	0.01
EAS-US	2026-06-14 12:45:00	14.83	29.48	0.23	7.07	9.79	6.42	0.01
EAS-US	2026-06-14 13:00:00	14.93	29.58	0.16	6.77	9.73	6.75	0.01
EAS-US	2026-06-14 13:15:00	14.99	29.54	0.24	6.79	9.64	7.45	0.01
EAS-US	2026-06-14 13:30:00	15.10	29.52	0.24	6.77	9.59	6.65	0.01
EAS-US	2026-06-14 13:45:00	15.22	29.55	0.24	6.80	9.51	6.73	0.01
EAS-US	2026-06-14 14:00:00	15.35	29.65	0.16	6.78	9.49	6.53	0.01
EAS-US	2026-06-14 14:15:00	15.45	29.57	0.24	7.00	9.47	6.88	0.01
EAS-US	2026-06-14 14:30:00	15.57	29.57	0.23	7.02	9.47	6.83	0.01
EAS-US	2026-06-14 14:45:00	15.67	29.56	0.23	7.02	9.30	6.84	0.01
EAS-US	2026-06-14 15:00:00	15.74	29.58	0.17	6.77	9.35	6.94	0.01
EAS-US	2026-06-14 15:15:00	15.80	29.56	0.24	6.80	9.39	6.75	0.01
EAS-US	2026-06-14 15:30:00	15.83	29.56	0.24	6.82	9.36	6.85	0.01

Woodfibre LNG (East Creek)□								
Station	Date/Time	Temperature (C)	Specific Conductivity (μS/cm)	ORP (V)	pH (pH units)	Dissolved Oxygen (mg/L)	Turbidity (NTU)	Salinity (PSU)
EAS-US	2026-06-14 15:45:00	15.85	29.70	0.24	6.81	9.20	6.90	0.01
EAS-US	2026-06-14 16:00:00	15.87	29.72	0.16	6.77	9.27	8.23	0.01
EAS-US	2026-06-14 16:15:00	15.82	29.64	0.24	7.01	9.34	6.91	0.01
EAS-US	2026-06-14 16:30:00	15.86	29.82	0.24	7.00	9.06	6.95	0.01
EAS-US	2026-06-14 16:45:00	15.86	29.86	0.23	7.00	9.19	6.88	0.01
EAS-US	2026-06-14 17:00:00	15.87	29.98	0.17	6.71	9.05	7.14	0.01
EAS-US	2026-06-14 17:15:00	15.84	30.10	0.24	6.73	9.25	6.81	0.01
EAS-US	2026-06-14 17:30:00	15.75	30.26	0.24	6.72	9.06	6.76	0.01
EAS-US	2026-06-14 17:45:00	15.66	30.35	0.24	6.75	9.17	6.75	0.01
EAS-US	2026-06-14 18:00:00	15.58	30.48	0.16	6.67	9.01	7.07	0.01
EAS-US	2026-06-14 18:15:00	15.49	30.59	0.24	6.93	8.77	6.83	0.01
EAS-US	2026-06-14 18:30:00	15.41	30.72	0.24	6.93	9.12	6.83	0.01
EAS-US	2026-06-14 18:45:00	15.32	30.76	0.24	6.93	9.09	6.90	0.01
EAS-US	2026-06-14 19:00:00	15.24	30.76	0.16	6.66	8.94	6.83	0.01
EAS-US	2026-06-14 19:15:00	15.18	30.88	0.24	6.71	8.91	6.73	0.01
EAS-US	2026-06-14 19:30:00	15.12	30.88	0.25	6.71	7.98	6.98	0.01
EAS-US	2026-06-14 19:45:00	15.06	30.77	0.24	6.71	9.18	6.73	0.01
EAS-US	2026-06-14 20:00:00	15.02	30.82	0.16	6.65	9.04	7.01	0.01
EAS-US	2026-06-14 20:15:00	14.98	30.96	0.24	6.92	9.08	6.95	0.01
EAS-US	2026-06-14 20:30:00	14.94	31.14	0.24	6.88	8.69	6.92	0.02
EAS-US	2026-06-14 20:45:00	14.89	31.12	0.24	6.84	8.99	7.34	0.02
EAS-US	2026-06-14 21:00:00	14.85	31.09	0.17	6.66	8.84	6.84	0.02
EAS-US	2026-06-14 21:15:00	14.81	31.19	0.25	6.73	8.94	6.77	0.02
EAS-US	2026-06-14 21:30:00	14.76	31.13	0.25	6.67	9.07	6.76	0.02
EAS-US	2026-06-14 21:45:00	14.73	31.29	0.25	6.70	8.43	6.78	0.02
EAS-US	2026-06-14 22:00:00	14.69	31.17	0.17	6.63	8.77	7.20	0.02
EAS-US	2026-06-14 22:15:00	14.65	31.36	0.25	6.90	8.62	6.83	0.02
EAS-US	2026-06-14 22:30:00	14.61	31.21	0.24	6.91	8.88	6.94	0.02
EAS-US	2026-06-14 22:45:00	14.57	31.19	0.24	6.92	8.62	6.96	0.02
EAS-US	2026-06-14 23:00:00	14.53	31.18	0.17	6.65	8.96	6.78	0.02
EAS-US	2026-06-14 23:15:00	14.50	31.19	0.25	6.68	9.08	6.87	0.02
EAS-US	2026-06-14 23:30:00	14.46	31.22	0.25	6.64	8.79	6.86	0.02
EAS-US	2026-06-14 23:45:00	14.42	31.26	0.25	6.69	8.60	6.79	0.02

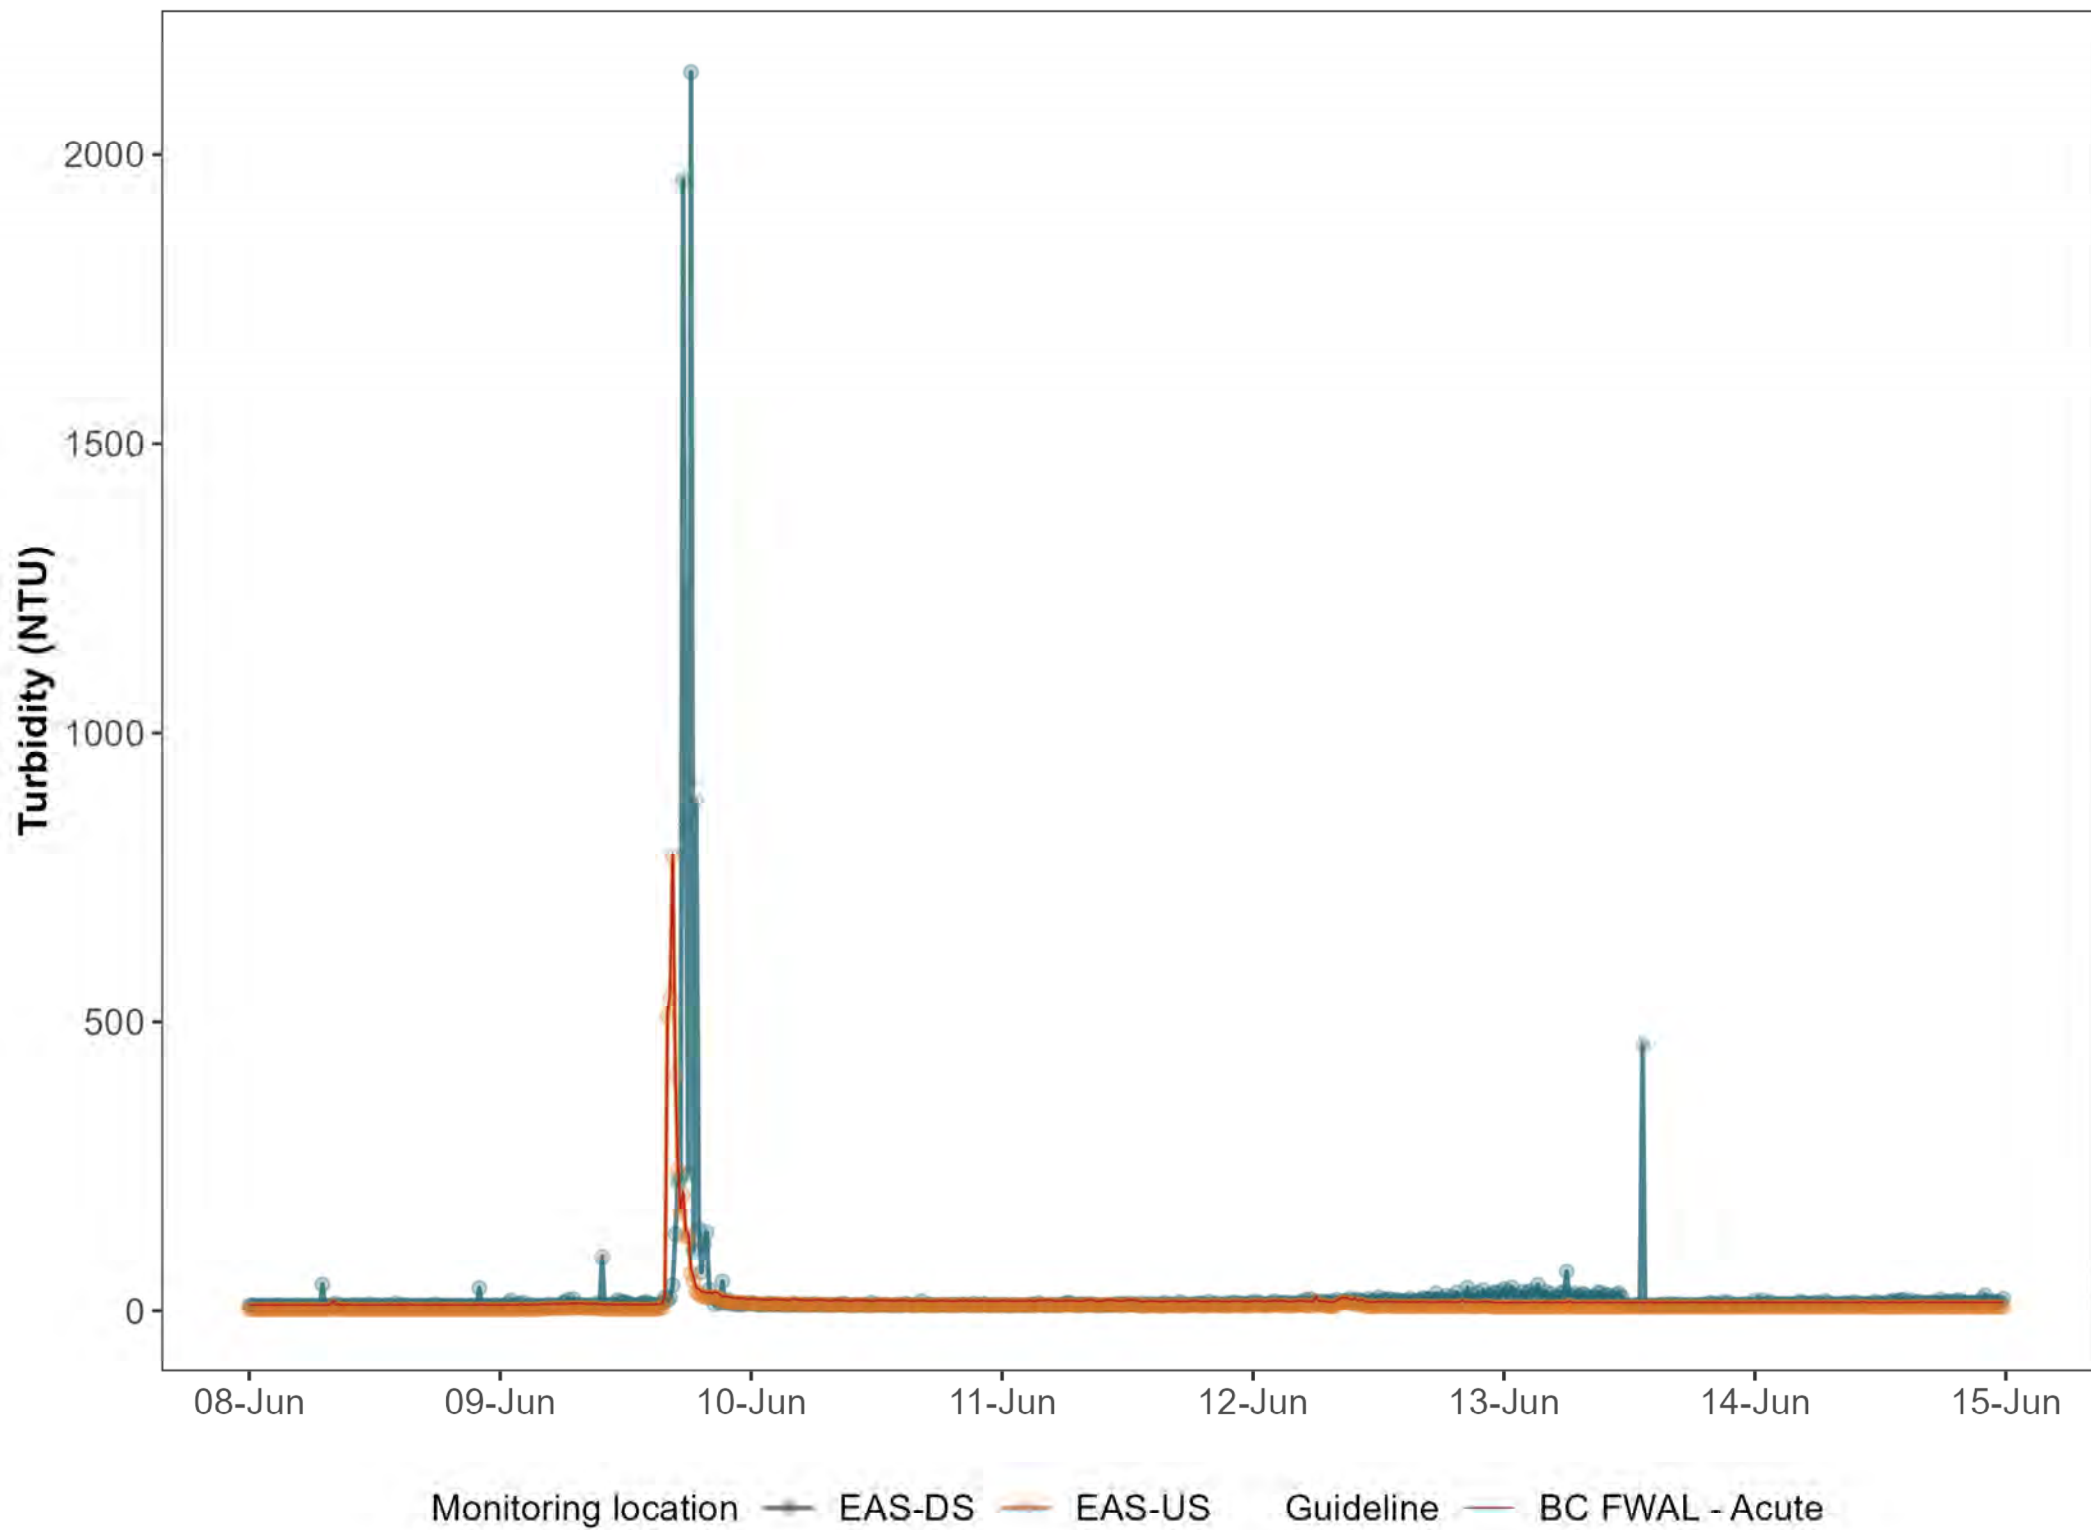

 Eagle Mountain – Woodfibre Gas Pipeline Project Waste Discharge Permit PE-110163 Report	Reporting Week	June 8 to June 14, 2026
	Report #	116
	Appendix E	E-1

Appendix E:
Lab Documentation



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/06/17
 Report #: R3795585
 Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07

Sample Matrix: Water
 # Samples Received: 5

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Alkalinity @25C (pp, total), CO ₃ ,HCO ₃ ,OH	5	N/A	2026/06/10	BBY6SOP-00026	SM 24 2320 B m
Chloride/Sulphate by Auto Colourimetry	5	N/A	2026/06/10	BBY6SOP-00011 / BBY6SOP-00017	SM24-4500-Cl/SO ₄ -E m
Chromium III (Calc'd)	3	N/A	2026/06/12		
Chromium III (Calc'd)	2	N/A	2026/06/15		
Total Hexavalent Chromium	5	N/A	2026/06/11	BBY6SOP-00054	SM 24 3500-Cr B m
Carbon (DOC) -Lab Filtered (2)	5	N/A	2026/06/13	BBY6SOP-00053	SM 24 5310 B m
Fluoride	5	N/A	2026/06/11	BBY6SOP-00037	SM 24 4500-F C m
Glycols in Water by GC/FID (1)	1	N/A	2026/06/15	CAL SOP-00093	BCMOE Glycols 09/17
Sulphide (as H ₂ S) (1)	5	N/A	2026/06/16		Auto Calc
Un-ionized Hydrogen Sulphide as S Calc	3	N/A	2026/06/16	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO ₃) (3)	3	N/A	2026/06/12	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO ₃) (3)	2	N/A	2026/06/15	BBY WI-00033	Auto Calc
Hardness (calculated as CaCO ₃)	5	N/A	2026/06/12	BBY WI-00033	Auto Calc
Mercury (Dissolved) by CV-Lab Filtered	5	2026/06/11	2026/06/11	BBY7SOP-00032	BCMOE LMAug2023 C m
Mercury (Total) by CV	1	2026/06/11	2026/06/11	BBY7SOP-00032	BCMOE LMAug2023 C m
Mercury (Total) by CV	4	2026/06/12	2026/06/15	BBY7SOP-00032	BCMOE LMAug2023 C m
Bromide as Bromine (Br) by ICPMS	5	N/A	2026/06/12	BBY7SOP-00002	EPA 6020B R2 m
EPH in Water when PAH required	1	2026/06/15	2026/06/16	BBY8SOP-00029	BCMOE BCLM Sep2017 m
Na, K, Ca, Mg, S by CRC ICPMS (diss.)	5	N/A	2026/06/12	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (lab filter) (4)	5	N/A	2026/06/11	BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	1	2026/06/12	2026/06/12	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	1	2026/06/12	2026/06/15	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Na, K, Ca, Mg, S by CRC ICPMS (total)	3	N/A	2026/06/12	BBY WI-00033	Auto Calc
Na, K, Ca, Mg, S by CRC ICPMS (total)	2	N/A	2026/06/15	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (total)	3	N/A	2026/06/12	BBY7SOP-00002	EPA 6020b R2 m
Nitrogen (Total)	5	N/A	2026/06/15	BBY6SOP-00016	SM 24 4500-N C m
Ammonia-N (Total)	5	N/A	2026/06/10	AB SOP-00007	SM 24 4500 NH ₃ A G m
Nitrate + Nitrite (N)	5	N/A	2026/06/10	BBY6SOP-00010	SM 24 4500-NO ₃ - H m



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/06/17
 Report #: R3795585
 Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07

Sample Matrix: Water
 # Samples Received: 5

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Nitrite (N) Regular Level Water	5	N/A	2026/06/10	BBY6SOP-00010	SM 24 4500-NO2- m
Nitrogen - Nitrate (as N)	5	N/A	2026/06/10	BBY WI-00033	Auto Calc
PAH in Water by GC/MS (SIM)	1	2026/06/15	2026/06/15	BBY8SOP-00021	BCMOE BCLM Jul2017m
Total LMW, HMW, Total PAH Calc (5)	1	N/A	2026/06/17	BBY WI-00033	Auto Calc
pH @25°C (6)	5	N/A	2026/06/10	BBY6SOP-00026	SM 24 4500-H+ B m
Phenols (4-AAP) (1)	1	N/A	2026/06/12	AB SOP-00088	EPA 9066 R0 m
Total Sulphide (1)	5	2026/06/15	2026/06/16	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Dissolved Solids (Filt. Residue)	5	2026/06/10	2026/06/11	BBY6SOP-00033	SM 24 2540 C m
EPH less PAH in Water by GC/FID (7)	1	N/A	2026/06/17	BBY WI-00033	Auto Calc
Carbon (Total Organic) (8)	5	N/A	2026/06/11	BBY6SOP-00053	SM 24 5310 B m
Total Phosphorus Low Level Total	5	2026/06/10	2026/06/11	BBY6SOP-00013	SM 24 4500-P E m
Total Suspended Solids (NFR)	5	2026/06/10	2026/06/11	BBY6SOP-00034	SM 24 2540 D m
Field pH	3	N/A	2026/06/10	Field Test	Field Test
Field Temperature	3	N/A	2026/06/10	Field Test	Field Test
VOCs, VH, F1, LH in Water by HS GC/MS	1	N/A	2026/06/11	BBY8SOP-00009 / BBY8SOP-00011 / BBY8SOP-00012	BCMOE BCLM Jul2017 m
Volatile HC-BTEX (9)	1	N/A	2026/06/11	BBY WI-00033	Auto Calc

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, EPA, APHA or the Quebec Ministry of Environment.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/06/17
 Report #: R3795585
 Version: 2 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07
 customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.
 This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

- (1) This test was performed by Bureau Veritas Calgary, 4000 - 19 St. , Calgary, AB, T2E 6P8
- (2) DOC present in the sample should be considered as non-purgeable DOC. Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (3) "Total Hardness" was calculated from Total Ca and Mg concentrations and may be biased high (Hardness, or Dissolved Hardness, calculated from Dissolved Ca and Mg, should be used for compliance if available).
- (4) Samples were filtered and preserved at the lab. Values may not reflect concentrations at the time of sampling.
 For Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (5) Total PAHs in Water include: Quinoline, Naphthalene, 1-Methylnaphthalene, 2-Methylnaphthalene, Acenaphthylene, Acenaphthene, Fluorene, Phenanthrene, Anthracene, Acridine, Fluoranthene, Pyrene, Benzo(a)anthracene, Chrysene, Benzo(b&j)fluoranthene, Benzo(k)fluoranthene, Benzo(a)pyrene, Indeno(1,2,3-cd)pyrene, Dibenzo(a,h)anthracene, and Benzo(g,h,i)perylene.
- (6) The CCME method requires pH to be analysed within 15 minutes of sampling and therefore field analysis is required for compliance. All Laboratory pH analyses in this report are reported past the CCME holding time. Bureau Veritas endeavours to analyze samples as soon as possible after receipt.
- (7) LEPH = EPH (C10 to C19) - (Acenaphthene + Acridine + Anthracene + Fluorene + Naphthalene + Phenanthrene)
 HEPPH = EPH (C19 to C32) - (Benzo(a)anthracene + Benzo(a)pyrene + Fluoranthene + Pyrene)
- (8) TOC present in the sample should be considered as non-purgeable TOC.
- (9) VPH = VH - (Benzene + Toluene + Ethylbenzene + m & p-Xylene + o-Xylene + Styrene)

Encryption Key

Please direct all questions regarding this Certificate of Analysis to:
 Levi Manchak, Project Manager SR
 Email: Levi.MANCHAK@bureauveritas.com
 Phone# (780)862-5634

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L	0.0095	0.0050	C309867				0.0107	0.0050	C309867
Calculated Parameters										
Total Chromium III	mg/L	0.0043	0.00099	C309126				0.0047	0.00099	C309126
Dissolved Hardness (CaCO ₃)	mg/L	109	0.50	C307954				136	0.50	C307954
Total Hardness (CaCO ₃)	mg/L	117	0.50	C309055				130	0.50	C309055
Nitrate (N)	mg/L	0.477	0.020	C308150				0.600	0.020	C308150
Sulphide (as H ₂ S)	mg/L	ND	0.0020	C308735				ND	0.0020	C308735
Field Parameters										
Field pH	pH	7.8	N/A	ONSITE				7.2	N/A	ONSITE
Field Temperature	°C	11.7	N/A	ONSITE				12.3	N/A	ONSITE
Misc. Inorganics										
pH	pH	7.55	N/A	C309994				7.58	N/A	C309994
Total Organic Carbon (C)	mg/L	30	0.50	C311273				50	0.50	C311273
Total Dissolved Solids	mg/L	190	10	C309788				220	10	C309788
Total Suspended Solids	mg/L	4.4	1.0	C309407	4.4	1.0	C309407	8.0	1.0	C309407
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L	26	0.50	C312901				36	0.50	C312901
Anions										
Alkalinity (PP as CaCO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Alkalinity (Total as CaCO ₃)	mg/L	68	1.0	C310007				80	1.0	C310007
Bicarbonate (HCO ₃)	mg/L	83	1.0	C310007				97	1.0	C310007
Carbonate (CO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Fluoride (F)	mg/L	0.34	0.050	C311428				0.39	0.050	C311428
Hydroxide (OH)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Total Sulphide	mg/L	ND	0.0018	C314396				ND	0.0018	C314668
Chloride (Cl)	mg/L	13	1.0	C310521				13	1.0	C310521
Sulphate (SO ₄)	mg/L	21	1.0	C310521				24	1.0	C310521
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable										



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C310984				ND	0.00099	C310984
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C310593	ND	0.015	C310593	ND	0.015	C310593
Total Phosphorus (P)	mg/L	0.0087	0.0010	C310613				0.013	0.0010	C310613
Nitrate plus Nitrite (N)	mg/L	0.487	0.020	C309857				0.610	0.020	C309857
Total Nitrogen (N)	mg/L	0.744	0.020	C312443	0.754	0.020	C312443	0.938	0.020	C312443
Misc. Organics										
Phenols	mg/L							ND	0.0015	C312590
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ911			EGJ912			EGJ912		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch

ANIONS										
Nitrite (N)	mg/L	ND	0.0050	C309867	ND	0.0050	C309867			
Calculated Parameters										
Total Chromium III	mg/L	ND	0.00099	C309126	ND	0.00099	C309126			
Dissolved Hardness (CaCO ₃)	mg/L	8.63	0.50	C307954	ND	0.50	C307954			
Total Hardness (CaCO ₃)	mg/L	9.15	0.50	C309055	ND	0.50	C309055			
Nitrate (N)	mg/L	0.023	0.020	C308150	ND	0.020	C308150			
Sulphide (as H ₂ S)	mg/L	ND	0.0020	C308735	ND	0.0020	C308735			
Field Parameters										
Field pH	pH	7.6	N/A	ONSITE						
Field Temperature	°C	11.1	N/A	ONSITE						
Misc. Inorganics										
pH	pH	6.77	N/A	C309994	6.02	N/A	C309994			
Total Organic Carbon (C)	mg/L	2.5	0.50	C311273	ND (1)	0.50	C311273	ND	0.50	C311273
Total Dissolved Solids	mg/L	24	10	C309788	ND	10	C309788			
Total Suspended Solids	mg/L	ND	1.0	C309825	ND	1.0	C309825	ND	1.0	C309825
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L	2.3	0.50	C312901	ND	0.50	C312901			
Anions										
Alkalinity (PP as CaCO ₃)	mg/L	ND	1.0	C310007	ND	1.0	C310007			
Alkalinity (Total as CaCO ₃)	mg/L	7.4	1.0	C310007	ND	1.0	C310007			
Bicarbonate (HCO ₃)	mg/L	9.0	1.0	C310007	ND	1.0	C310007			
Carbonate (CO ₃)	mg/L	ND	1.0	C310007	ND	1.0	C310007			
Fluoride (F)	mg/L	ND	0.050	C311428	ND	0.050	C311428			
Hydroxide (OH)	mg/L	ND	1.0	C310007	ND	1.0	C310007			
Total Sulphide	mg/L	ND	0.0018	C314668	ND	0.0018	C314668	ND	0.0018	C314668
Chloride (Cl)	mg/L	ND	1.0	C310521	ND	1.0	C310521			
Sulphate (SO ₄)	mg/L	2.1	1.0	C310521	ND	1.0	C310521			

RDL = Reportable Detection Limit

Lab-Dup = Laboratory Initiated Duplicate

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.

N/A = Not Applicable

(1) Matrix spike exceeds acceptance limits due to matrix interference. Unable to reanalyze due to insufficient sample.



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ911			EGJ912			EGJ912		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-US	RDL	QC Batch	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C310984	ND	0.00099	C310984	ND	0.00099	C310984
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C310593	ND	0.015	C310593			
Total Phosphorus (P)	mg/L	0.027	0.0010	C310613	ND	0.0010	C310613			
Nitrate plus Nitrite (N)	mg/L	0.023	0.020	C309857	ND	0.020	C309857			
Total Nitrogen (N)	mg/L	0.080	0.020	C312443	ND	0.020	C312443			
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ913		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	Trip Blank	RDL	QC Batch
ANIONS				
Nitrite (N)	mg/L	ND	0.0050	C309867
Calculated Parameters				
Total Chromium III	mg/L	ND	0.00099	C309126
Dissolved Hardness (CaCO ₃)	mg/L	ND	0.50	C307954
Total Hardness (CaCO ₃)	mg/L	ND	0.50	C309055
Nitrate (N)	mg/L	ND	0.020	C308150
Sulphide (as H ₂ S)	mg/L	ND	0.0020	C308735
Misc. Inorganics				
pH	pH	5.91	N/A	C309994
Total Organic Carbon (C)	mg/L	ND	0.50	C311273
Total Dissolved Solids	mg/L	ND	10	C309788
Total Suspended Solids	mg/L	ND	1.0	C309825
Lab Filtered Inorganics				
Dissolved Organic Carbon (C)	mg/L	ND	0.50	C312901
Anions				
Alkalinity (PP as CaCO ₃)	mg/L	ND	1.0	C310007
Alkalinity (Total as CaCO ₃)	mg/L	ND	1.0	C310007
Bicarbonate (HCO ₃)	mg/L	ND	1.0	C310007
Carbonate (CO ₃)	mg/L	ND	1.0	C310007
Fluoride (F)	mg/L	ND	0.050	C311428
Hydroxide (OH)	mg/L	ND	1.0	C310007
Total Sulphide	mg/L	ND	0.0018	C314668
Chloride (Cl)	mg/L	ND	1.0	C310521
Sulphate (SO ₄)	mg/L	ND	1.0	C310521
Metals				
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C310984
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable				



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ913		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	Trip Blank	RDL	QC Batch
Nutrients				
Total Ammonia (N)	mg/L	ND	0.015	C310593
Total Phosphorus (P)	mg/L	0.0014	0.0010	C310613
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C309857
Total Nitrogen (N)	mg/L	ND	0.020	C312443
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

GLYCOLS BY GC-FID (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Glycols				
Ethylene Glycol	mg/L	ND	3.0	C312994
Diethylene Glycol	mg/L	ND	5.0	C312994
Triethylene Glycol	mg/L	ND	5.0	C312994
Propylene Glycol	mg/L	ND	5.0	C312994
Surrogate Recovery (%)				
Methyl Sulfone (sur.)	%	113		C312994
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

MERCURY BY COLD VAPOR (WATER)

Bureau Veritas ID		EGJ909		EGJ910			EGJ910		
Sampling Date		2026/06/09 09:30		2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024		132024			132024		
	UNITS	WLNG-DS	QC Batch	WLNG -EOP	RDL	QC Batch	WLNG -EOP Lab-Dup	RDL	QC Batch
Elements									
Total Mercury (Hg)	ug/L	ND	C313281	ND	0.0019	C311157			
Lab Filtered Elements									
Dissolved Mercury (Hg)	ug/L	ND	C311623	ND	0.0019	C311623	ND	0.0019	C311623
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.									

Bureau Veritas ID		EGJ911	EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30	2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024	132024	132024		
	UNITS	WLNG-US	Field Blank	Trip Blank	RDL	QC Batch
Elements						
Total Mercury (Hg)	ug/L	ND	ND	ND	0.0019	C313281
Lab Filtered Elements						
Dissolved Mercury (Hg)	ug/L	ND	ND	ND	0.0019	C311623
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.						



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
ANIONS										
Bromide (Br)	mg/L	ND	0.010	C313156	ND	0.010	C313156	ND	0.010	C313156
Dissolved Metals by ICPMS										
Dissolved Calcium (Ca)	mg/L	41.2	0.050	C308868				51.7	0.050	C308868
Dissolved Magnesium (Mg)	mg/L	1.51	0.050	C308868				1.72	0.050	C308868
Dissolved Potassium (K)	mg/L	1.76	0.050	C308868				2.05	0.050	C308868
Dissolved Sodium (Na)	mg/L	6.51	0.050	C308868				6.88	0.050	C308868
Dissolved Sulphur (S)	mg/L	6.8	3.0	C308868				7.8	3.0	C308868
Lab Filtered Metals										
Dissolved Aluminum (Al)	ug/L	1290	0.50	C311117				1590	0.50	C311117
Dissolved Antimony (Sb)	ug/L	0.737	0.020	C311117				0.797	0.020	C311117
Dissolved Arsenic (As)	ug/L	1.70	0.020	C311117				2.13	0.020	C311117
Dissolved Barium (Ba)	ug/L	11.2	0.020	C311117				13.6	0.020	C311117
Dissolved Beryllium (Be)	ug/L	ND	0.010	C311117				ND	0.010	C311117
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C311117				ND	0.0050	C311117
Dissolved Boron (B)	ug/L	10	10	C311117				12	10	C311117
Dissolved Cadmium (Cd)	ug/L	0.0114	0.0050	C311117				0.0092	0.0050	C311117
Dissolved Cesium (Cs)	ug/L	ND	0.050	C311117				0.056	0.050	C311117
Dissolved Chromium (Cr)	ug/L	3.93	0.10	C311117				4.91	0.10	C311117
Dissolved Cobalt (Co)	ug/L	0.0803	0.0050	C311117				0.103	0.0050	C311117
Dissolved Copper (Cu)	ug/L	0.822	0.050	C311117				0.888	0.050	C311117
Dissolved Iron (Fe)	ug/L	139	1.0	C311117				222	1.0	C311117
Dissolved Lead (Pb)	ug/L	0.0058	0.0050	C311117				0.0074	0.0050	C311117
Dissolved Lithium (Li)	ug/L	3.99	0.50	C311117				4.85	0.50	C311117
Dissolved Manganese (Mn)	ug/L	26.4	0.050	C311117				38.6	0.050	C311117
Dissolved Molybdenum (Mo)	ug/L	34.4	0.050	C311117				38.1	0.050	C311117
Dissolved Nickel (Ni)	ug/L	0.420	0.020	C311117				0.513	0.020	C311117
Dissolved Phosphorus (P)	ug/L	3.7	2.0	C311117				4.2	2.0	C311117
Dissolved Rubidium (Rb)	ug/L	4.08	0.050	C311117				4.89	0.050	C311117
Dissolved Selenium (Se)	ug/L	0.086	0.040	C311117				0.083	0.040	C311117
Dissolved Silicon (Si)	ug/L	10200	50	C311117				11700	50	C311117
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	0.0050	C311117				ND	0.0050	C311117
Dissolved Strontium (Sr)	ug/L	71.4	0.050	C311117				83.3	0.050	C311117
Dissolved Tellurium (Te)	ug/L	ND	0.020	C311117				ND	0.020	C311117
Dissolved Thallium (Tl)	ug/L	0.0097	0.0020	C311117				0.0105	0.0020	C311117
Dissolved Thorium (Th)	ug/L	0.0068	0.0050	C311117				0.0086	0.0050	C311117
Dissolved Tin (Sn)	ug/L	ND	0.20	C311117				ND	0.20	C311117
Dissolved Titanium (Ti)	ug/L	ND	0.50	C311117				ND	0.50	C311117
Dissolved Uranium (U)	ug/L	4.00	0.0020	C311117				4.20	0.0020	C311117
Dissolved Vanadium (V)	ug/L	1.96	0.20	C311117				2.57	0.20	C311117
Dissolved Zinc (Zn)	ug/L	1.45	0.10	C311117				1.93	0.10	C311117
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C311117				0.16	0.10	C311117
Total Metals by ICPMS										
Total Aluminum (Al)	ug/L	1460	3.0	C313217	1450	3.0	C313217	1640	3.0	C312375
Total Antimony (Sb)	ug/L	0.781	0.020	C313217	0.745	0.020	C313217	0.789	0.020	C312375
Total Arsenic (As)	ug/L	1.73	0.020	C313217	1.74	0.020	C313217	2.19	0.020	C312375
Total Barium (Ba)	ug/L	11.5	0.050	C313217	11.4	0.050	C313217	13.6	0.050	C312375
Total Beryllium (Be)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Bismuth (Bi)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Boron (B)	ug/L	10	10	C313217	ND	10	C313217	14	10	C312375
Total Cadmium (Cd)	ug/L	ND	0.0050	C313217	0.0052	0.0050	C313217	0.0082	0.0050	C312375
Total Cesium (Cs)	ug/L	ND	0.050	C313217	0.051	0.050	C313217	0.061	0.050	C312375
Total Chromium (Cr)	ug/L	4.29	0.10	C313217	4.22	0.10	C313217	4.71	0.10	C312375
Total Cobalt (Co)	ug/L	0.075	0.010	C313217	0.073	0.010	C313217	0.134	0.010	C312375
Total Copper (Cu)	ug/L	1.01	0.10	C313217	1.07	0.10	C313217	1.10	0.10	C312375
Total Iron (Fe)	ug/L	197	5.0	C313217	194	5.0	C313217	350	5.0	C312375
Total Lead (Pb)	ug/L	0.043	0.020	C313217	0.046	0.020	C313217	0.064	0.020	C312375
Total Lithium (Li)	ug/L	4.42	0.50	C313217	4.21	0.50	C313217	4.31	0.50	C312375
Total Manganese (Mn)	ug/L	27.3	0.10	C313217	28.0	0.10	C313217	41.1	0.10	C312375
Total Molybdenum (Mo)	ug/L	35.7	0.050	C313217	36.2	0.050	C313217	38.0	0.050	C312375
Total Nickel (Ni)	ug/L	0.42	0.10	C313217	0.41	0.10	C313217	0.47	0.10	C312375
Total Phosphorus (P)	ug/L	8.2	5.0	C313217	7.6	5.0	C313217	9.7	5.0	C312375
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Total Rubidium (Rb)	ug/L	4.14	0.050	C313217	4.08	0.050	C313217	4.64	0.050	C312375
Total Selenium (Se)	ug/L	0.091	0.040	C313217	0.091	0.040	C313217	0.101	0.040	C312375
Total Silicon (Si)	ug/L	10800	50	C313217	10900	50	C313217	11200	50	C312375
Total Silver (Ag)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Strontium (Sr)	ug/L	74.1	0.050	C313217	72.9	0.050	C313217	82.1	0.050	C312375
Total Tellurium (Te)	ug/L	ND	0.020	C313217	ND	0.020	C313217	ND	0.020	C312375
Total Thallium (Tl)	ug/L	0.0085	0.0020	C313217	0.0081	0.0020	C313217	0.0109	0.0020	C312375
Total Thorium (Th)	ug/L	ND	0.050	C313217	ND	0.050	C313217	ND	0.050	C312375
Total Tin (Sn)	ug/L	ND	0.20	C313217	ND	0.20	C313217	ND	0.20	C312375
Total Titanium (Ti)	ug/L	2.3	2.0	C313217	2.3	2.0	C313217	4.0	2.0	C312375
Total Uranium (U)	ug/L	4.34	0.0050	C313217	4.31	0.0050	C313217	4.20	0.0050	C312375
Total Vanadium (V)	ug/L	2.09	0.20	C313217	2.11	0.20	C313217	2.41	0.20	C312375
Total Zinc (Zn)	ug/L	2.3	1.0	C313217	2.9	1.0	C313217	3.4	1.0	C312375
Total Zirconium (Zr)	ug/L	0.13	0.10	C313217	0.14	0.10	C313217	0.14	0.10	C312375
Total Calcium (Ca)	mg/L	44.2	0.25	C309129				49.4	0.25	C309129
Total Magnesium (Mg)	mg/L	1.54	0.25	C309129				1.59	0.25	C309129
Total Potassium (K)	mg/L	1.89	0.25	C309129				1.97	0.25	C309129
Total Sodium (Na)	mg/L	6.96	0.25	C309129				6.40	0.25	C309129
Total Sulphur (S)	mg/L	7.0	3.0	C309129				6.9	3.0	C309129
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch

ANIONS

Bromide (Br)	mg/L	ND	0.010	C313156				ND	ND	0.010	C313156
--------------	------	----	-------	---------	--	--	--	----	----	-------	---------

Dissolved Metals by ICPMS

Dissolved Calcium (Ca)	mg/L	2.86	0.050	C308868				ND	ND	0.050	C308868
Dissolved Magnesium (Mg)	mg/L	0.363	0.050	C308868				ND	ND	0.050	C308868
Dissolved Potassium (K)	mg/L	0.233	0.050	C308868				ND	ND	0.050	C308868
Dissolved Sodium (Na)	mg/L	1.55	0.050	C308868				ND	ND	0.050	C308868
Dissolved Sulphur (S)	mg/L	ND	3.0	C308868				ND	ND	3.0	C308868

Lab Filtered Metals

Dissolved Aluminum (Al)	ug/L	40.6	0.50	C311117				ND	ND	0.50	C311117
Dissolved Antimony (Sb)	ug/L	0.030	0.020	C311117				ND	ND	0.020	C311117
Dissolved Arsenic (As)	ug/L	0.144	0.020	C311117				ND	ND	0.020	C311117
Dissolved Barium (Ba)	ug/L	4.21	0.020	C311117				ND	ND	0.020	C311117
Dissolved Beryllium (Be)	ug/L	0.011	0.010	C311117				ND	ND	0.010	C311117
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Boron (B)	ug/L	ND	10	C311117				ND	ND	10	C311117
Dissolved Cadmium (Cd)	ug/L	0.0059	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Cesium (Cs)	ug/L	ND	0.050	C311117				ND	ND	0.050	C311117
Dissolved Chromium (Cr)	ug/L	ND	0.10	C311117				ND	ND	0.10	C311117
Dissolved Cobalt (Co)	ug/L	0.0272	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Copper (Cu)	ug/L	0.737	0.050	C311117				ND	ND	0.050	C311117
Dissolved Iron (Fe)	ug/L	23.9	1.0	C311117				ND	ND	1.0	C311117
Dissolved Lead (Pb)	ug/L	0.0126	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Lithium (Li)	ug/L	ND	0.50	C311117				ND	ND	0.50	C311117
Dissolved Manganese (Mn)	ug/L	0.847	0.050	C311117				ND	ND	0.050	C311117
Dissolved Molybdenum (Mo)	ug/L	0.671	0.050	C311117				ND	ND	0.050	C311117
Dissolved Nickel (Ni)	ug/L	0.306	0.020	C311117				ND	ND	0.020	C311117
Dissolved Phosphorus (P)	ug/L	21.9	2.0	C311117				2.7	ND	2.0	C311117
Dissolved Rubidium (Rb)	ug/L	0.422	0.050	C311117				ND	ND	0.050	C311117
Dissolved Selenium (Se)	ug/L	ND	0.040	C311117				ND	ND	0.040	C311117
Dissolved Silicon (Si)	ug/L	4290	50	C311117				ND	ND	50	C311117

RDL = Reportable Detection Limit

Lab-Dup = Laboratory Initiated Duplicate

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Strontium (Sr)	ug/L	13.1	0.050	C311117				ND	ND	0.050	C311117
Dissolved Tellurium (Te)	ug/L	ND	0.020	C311117				ND	ND	0.020	C311117
Dissolved Thallium (Tl)	ug/L	0.0026	0.0020	C311117				ND	0.0021	0.0020	C311117
Dissolved Thorium (Th)	ug/L	0.0088	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Tin (Sn)	ug/L	ND	0.20	C311117				ND	ND	0.20	C311117
Dissolved Titanium (Ti)	ug/L	ND	0.50	C311117				ND	ND	0.50	C311117
Dissolved Uranium (U)	ug/L	0.0544	0.0020	C311117				ND	ND	0.0020	C311117
Dissolved Vanadium (V)	ug/L	ND	0.20	C311117				ND	ND	0.20	C311117
Dissolved Zinc (Zn)	ug/L	0.77	0.10	C311117				ND	ND	0.10	C311117
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C311117				ND	ND	0.10	C311117
Total Metals by ICPMS											
Total Aluminum (Al)	ug/L	76.8	0.50	C311597	76.8	0.50	C311597	ND	ND	0.50	C311597
Total Antimony (Sb)	ug/L	0.036	0.020	C311597	0.038	0.020	C311597	ND	ND	0.020	C311597
Total Arsenic (As)	ug/L	0.145	0.020	C311597	0.145	0.020	C311597	ND	ND	0.020	C311597
Total Barium (Ba)	ug/L	4.96	0.020	C311597	5.06	0.020	C311597	ND	ND	0.020	C311597
Total Beryllium (Be)	ug/L	ND	0.010	C311597	ND	0.010	C311597	ND	ND	0.010	C311597
Total Bismuth (Bi)	ug/L	ND	0.0050	C311597	ND	0.0050	C311597	ND	ND	0.0050	C311597
Total Boron (B)	ug/L	ND	10	C311597	ND	10	C311597	ND	ND	10	C311597
Total Cadmium (Cd)	ug/L	0.0073	0.0050	C311597	0.0065	0.0050	C311597	ND	ND	0.0050	C311597
Total Cesium (Cs)	ug/L	ND	0.050	C311597	ND	0.050	C311597	ND	ND	0.050	C311597
Total Chromium (Cr)	ug/L	ND	0.10	C311597	ND	0.10	C311597	ND	ND	0.10	C311597
Total Cobalt (Co)	ug/L	0.0295	0.0050	C311597	0.0350	0.0050	C311597	ND	ND	0.0050	C311597
Total Copper (Cu)	ug/L	0.776	0.050	C311597	0.837	0.050	C311597	ND	ND	0.050	C311597
Total Iron (Fe)	ug/L	58.5	1.0	C311597	57.2	1.0	C311597	ND	ND	1.0	C311597
Total Lead (Pb)	ug/L	0.0248	0.0050	C311597	0.0249	0.0050	C311597	ND	ND	0.0050	C311597
Total Lithium (Li)	ug/L	ND	0.50	C311597	ND	0.50	C311597	ND	ND	0.50	C311597
Total Manganese (Mn)	ug/L	1.96	0.050	C311597	1.87	0.050	C311597	ND	ND	0.050	C311597
Total Molybdenum (Mo)	ug/L	0.704	0.050	C311597	0.699	0.050	C311597	ND	ND	0.050	C311597
Total Nickel (Ni)	ug/L	0.231	0.020	C311597	0.249	0.020	C311597	ND	ND	0.020	C311597
Total Phosphorus (P)	ug/L	23.7	2.0	C311597	24.3	2.0	C311597	2.6	ND	2.0	C311597
RDL = Reportable Detection Limit											
Lab-Dup = Laboratory Initiated Duplicate											
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Total Rubidium (Rb)	ug/L	0.506	0.050	C311597	0.501	0.050	C311597	ND	ND	0.050	C311597
Total Selenium (Se)	ug/L	ND	0.040	C311597	ND	0.040	C311597	ND	ND	0.040	C311597
Total Silicon (Si)	ug/L	4230	50	C311597	4170	50	C311597	ND	ND	50	C311597
Total Silver (Ag)	ug/L	ND	0.0050	C311597	ND	0.0050	C311597	ND	ND	0.0050	C311597
Total Strontium (Sr)	ug/L	13.8	0.050	C311597	14.0	0.050	C311597	0.054	ND	0.050	C311597
Total Tellurium (Te)	ug/L	ND	0.020	C311597	ND	0.020	C311597	ND	ND	0.020	C311597
Total Thallium (Tl)	ug/L	0.0029	0.0020	C311597	0.0030	0.0020	C311597	ND	0.0039	0.0020	C311597
Total Thorium (Th)	ug/L	ND	0.050	C311597	ND	0.050	C311597	ND	ND	0.050	C311597
Total Tin (Sn)	ug/L	ND	0.20	C311597	ND	0.20	C311597	ND	ND	0.20	C311597
Total Titanium (Ti)	ug/L	1.49	0.50	C311597	1.34	0.50	C311597	ND	ND	0.50	C311597
Total Uranium (U)	ug/L	0.0696	0.0020	C311597	0.0689	0.0020	C311597	ND	ND	0.0020	C311597
Total Vanadium (V)	ug/L	0.23	0.20	C311597	0.24	0.20	C311597	ND	ND	0.20	C311597
Total Zinc (Zn)	ug/L	1.28	0.10	C311597	1.29	0.10	C311597	ND	ND	0.10	C311597
Total Zirconium (Zr)	ug/L	ND	0.10	C311597	ND	0.10	C311597	ND	ND	0.10	C311597
Total Calcium (Ca)	mg/L	3.03	0.050	C309129				ND	ND	0.050	C309129
Total Magnesium (Mg)	mg/L	0.384	0.050	C309129				ND	ND	0.050	C309129
Total Potassium (K)	mg/L	0.258	0.050	C309129				ND	ND	0.050	C309129
Total Sodium (Na)	mg/L	1.64	0.050	C309129				ND	ND	0.050	C309129
Total Sulphur (S)	mg/L	ND	3.0	C309129				ND	ND	3.0	C309129
RDL = Reportable Detection Limit											
Lab-Dup = Laboratory Initiated Duplicate											
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

MISCELLANEOUS (WATER)

Bureau Veritas ID		EGJ909	EGJ910	EGJ911		
Sampling Date		2026/06/09 09:30	2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024	132024	132024		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	RDL	QC Batch
Calculated Parameters						
Total Un-ionized Hydrogen Sulfide as S	mg/L	ND	ND	ND	0.0018	C309128
Total Un-ionized Hydrogen Sulfide as H2S	mg/L	ND	ND	ND	0.0019	C309128
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.						



LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Calculated Parameters				
Low Molecular Weight PAH's	ug/L	ND	0.10	C307964
High Molecular Weight PAH's	ug/L	ND	0.050	C307964
Total PAH	ug/L	ND	0.10	C307964
Polycyclic Aromatics				
Quinoline	ug/L	ND	0.020	C314719
Naphthalene	ug/L	ND	0.10	C314719
1-Methylnaphthalene	ug/L	ND	0.050	C314719
2-Methylnaphthalene	ug/L	ND	0.10	C314719
Acenaphthylene	ug/L	ND	0.050	C314719
Acenaphthene	ug/L	ND	0.050	C314719
Fluorene	ug/L	ND	0.050	C314719
Phenanthrene	ug/L	ND	0.050	C314719
Anthracene	ug/L	ND	0.010	C314719
Acridine	ug/L	ND	0.050	C314719
Fluoranthene	ug/L	ND	0.020	C314719
Pyrene	ug/L	ND	0.020	C314719
Benzo(a)anthracene	ug/L	ND	0.010	C314719
Chrysene	ug/L	ND	0.020	C314719
Benzo(b&j)fluoranthene	ug/L	ND	0.030	C314719
Benzo(k)fluoranthene	ug/L	ND	0.050	C314719
Benzo(a)pyrene	ug/L	ND	0.0050	C314719
Indeno(1,2,3-cd)pyrene	ug/L	ND	0.050	C314719
Dibenz(a,h)anthracene	ug/L	ND	0.0030	C314719
Benzo(g,h,i)perylene	ug/L	ND	0.050	C314719
Calculated Parameters				
LEPH (C10-C19 less PAH)	mg/L	0.27	0.20	C307965
HEPH (C19-C32 less PAH)	mg/L	ND	0.20	C307965
Ext. Pet. Hydrocarbon				
EPH (C10-C19)	mg/L	0.27	0.20	C314723
EPH (C19-C32)	mg/L	ND	0.20	C314723
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Surrogate Recovery (%)				
O-TERPHENYL (sur.)	%	122		C314723
D10-ANTHRACENE (sur.)	%	105		C314719
D8-ACENAPHTHYLENE (sur.)	%	96		C314719
D8-NAPHTHALENE (sur.)	%	76		C314719
TERPHENYL-D14 (sur.)	%	83		C314719
RDL = Reportable Detection Limit				



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Calculated Parameters				
VPH (VH6 to 10 - BTEX)	ug/L	ND	300	C308003
Volatiles				
VH C6-C10	ug/L	ND	300	C309739
1,1,1,2-tetrachloroethane	ug/L	ND	0.50	C309739
1,1,1-trichloroethane	ug/L	ND	0.50	C309739
1,1,2,2-tetrachloroethane	ug/L	ND	0.50	C309739
1,1,2Trichloro-1,2,2Trifluoroethane	ug/L	ND	2.0	C309739
1,1,2-trichloroethane	ug/L	ND	0.50	C309739
1,1-dichloroethane	ug/L	ND	0.50	C309739
1,1-dichloroethene	ug/L	ND	0.50	C309739
1,2,3-trichlorobenzene	ug/L	ND	2.0	C309739
1,2,4-trichlorobenzene	ug/L	ND	2.0	C309739
1,2-dibromoethane	ug/L	ND	0.20	C309739
1,2-dichlorobenzene	ug/L	ND	0.50	C309739
1,2-dichloroethane	ug/L	ND	0.50	C309739
1,2-dichloropropane	ug/L	ND	0.50	C309739
1,3,5-trimethylbenzene	ug/L	ND	2.0	C309739
1,3-Butadiene	ug/L	ND	0.50	C309739
1,3-dichlorobenzene	ug/L	ND	0.50	C309739
1,3-dichloropropane	ug/L	ND	1.0	C309739
1,4-dichlorobenzene	ug/L	ND	0.50	C309739
Benzene	ug/L	ND	0.40	C309739
Bromobenzene	ug/L	ND	2.0	C309739
Bromodichloromethane	ug/L	ND	1.0	C309739
Bromoform	ug/L	ND	1.0	C309739
Bromomethane	ug/L	ND	1.0	C309739
Carbon tetrachloride	ug/L	ND	0.50	C309739
Chlorobenzene	ug/L	ND	0.50	C309739
Dibromochloromethane	ug/L	ND	1.0	C309739
Chloroethane	ug/L	ND	1.0	C309739
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Chloroform	ug/L	ND	1.0	C309739
Chloromethane	ug/L	ND	1.0	C309739
cis-1,2-dichloroethene	ug/L	ND	1.0	C309739
cis-1,3-dichloropropene	ug/L	ND	1.0	C309739
Dichlorodifluoromethane	ug/L	ND	2.0	C309739
Dichloromethane	ug/L	ND	2.0	C309739
Ethylbenzene	ug/L	ND	0.40	C309739
Hexachlorobutadiene	ug/L	ND	0.50	C309739
Isopropylbenzene	ug/L	ND	2.0	C309739
Methyl-tert-butylether (MTBE)	ug/L	ND	4.0	C309739
Styrene	ug/L	ND	0.50	C309739
Tetrachloroethene	ug/L	ND	0.50	C309739
Toluene	ug/L	ND	0.40	C309739
trans-1,2-dichloroethene	ug/L	ND	1.0	C309739
trans-1,3-dichloropropene	ug/L	ND	1.0	C309739
Trichloroethene	ug/L	ND	0.50	C309739
Trichlorofluoromethane	ug/L	ND	4.0	C309739
Vinyl chloride	ug/L	ND	0.50	C309739
m & p-Xylene	ug/L	ND	0.40	C309739
o-Xylene	ug/L	ND	0.40	C309739
Xylenes (Total)	ug/L	ND	0.40	C309739
Surrogate Recovery (%)				
1,4-Difluorobenzene (sur.)	%	102		C309739
4-Bromofluorobenzene (sur.)	%	87		C309739
D4-1,2-Dichloroethane (sur.)	%	119		C309739
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

GENERAL COMMENTS

Results relate only to the items tested.



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309407	SPP	Matrix Spike [EGJ910-02]	Total Suspended Solids	2026/06/11		108	%	80 - 120
C309407	SPP	Spiked Blank	Total Suspended Solids	2026/06/11		100	%	80 - 120
C309407	SPP	Method Blank	Total Suspended Solids	2026/06/11	ND, RDL=1.0		mg/L	
C309407	SPP	RPD [EGJ909-02]	Total Suspended Solids	2026/06/11	0		%	20
C309739	DWL	Matrix Spike	1,4-Difluorobenzene (sur.)	2026/06/11		99	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		102	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		92	%	50 - 140
			1,1,1,2-tetrachloroethane	2026/06/11		90	%	50 - 140
			1,1,1-trichloroethane	2026/06/11		96	%	50 - 140
			1,1,2,2-tetrachloroethane	2026/06/11		91	%	50 - 140
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11		93	%	50 - 140
			1,1,2-trichloroethane	2026/06/11		93	%	50 - 140
			1,1-dichloroethane	2026/06/11		102	%	50 - 140
			1,1-dichloroethene	2026/06/11		114	%	50 - 140
			1,2,3-trichlorobenzene	2026/06/11		100	%	50 - 140
			1,2,4-trichlorobenzene	2026/06/11		98	%	50 - 140
			1,2-dibromoethane	2026/06/11		94	%	50 - 140
			1,2-dichlorobenzene	2026/06/11		101	%	50 - 140
			1,2-dichloroethane	2026/06/11		92	%	50 - 140
			1,2-dichloropropane	2026/06/11		95	%	50 - 140
			1,3,5-trimethylbenzene	2026/06/11		109	%	50 - 140
			1,3-Butadiene	2026/06/11		133	%	50 - 140
			1,3-dichlorobenzene	2026/06/11		101	%	50 - 140
			1,3-dichloropropane	2026/06/11		94	%	50 - 140
			1,4-dichlorobenzene	2026/06/11		97	%	50 - 140
			Benzene	2026/06/11		96	%	50 - 140
			Bromobenzene	2026/06/11		97	%	50 - 140
			Bromodichloromethane	2026/06/11		92	%	50 - 140
			Bromoform	2026/06/11		92	%	50 - 140
			Bromomethane	2026/06/11		87	%	50 - 140
			Carbon tetrachloride	2026/06/11		95	%	50 - 140
			Chlorobenzene	2026/06/11		91	%	50 - 140
			Dibromochloromethane	2026/06/11		91	%	50 - 140
			Chloroethane	2026/06/11		87	%	50 - 140
			Chloroform	2026/06/11		93	%	50 - 140
			Chloromethane	2026/06/11		95	%	50 - 140
			cis-1,2-dichloroethene	2026/06/11		95	%	50 - 140
			cis-1,3-dichloropropene	2026/06/11		88	%	50 - 140
			Dichlorodifluoromethane	2026/06/11		77	%	50 - 140
			Dichloromethane	2026/06/11		89	%	50 - 140
			Ethylbenzene	2026/06/11		95	%	50 - 140
			Hexachlorobutadiene	2026/06/11		94	%	50 - 140
			Isopropylbenzene	2026/06/11		97	%	50 - 140
			Methyl-tert-butylether (MTBE)	2026/06/11		81	%	50 - 140
			Styrene	2026/06/11		83	%	50 - 140
			Tetrachloroethene	2026/06/11		92	%	50 - 140
			Toluene	2026/06/11		76	%	50 - 140
			trans-1,2-dichloroethene	2026/06/11		99	%	50 - 140
			trans-1,3-dichloropropene	2026/06/11		78	%	50 - 140
			Trichloroethene	2026/06/11		92	%	50 - 140
			Trichlorofluoromethane	2026/06/11		92	%	50 - 140
			Vinyl chloride	2026/06/11		98	%	50 - 140



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309739	DWL	Spiked Blank	m & p-Xylene	2026/06/11		99	%	50 - 140
			o-Xylene	2026/06/11		81	%	50 - 140
			1,4-Difluorobenzene (sur.)	2026/06/11		99	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		84	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		102	%	50 - 140
			VH C6-C10	2026/06/11		116	%	70 - 130
			1,1,1,2-tetrachloroethane	2026/06/11		93	%	60 - 130
			1,1,1-trichloroethane	2026/06/11		101	%	60 - 130
			1,1,2,2-tetrachloroethane	2026/06/11		92	%	60 - 130
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11		97	%	60 - 130
			1,1,2-trichloroethane	2026/06/11		97	%	60 - 130
			1,1-dichloroethane	2026/06/11		107	%	60 - 130
			1,1-dichloroethene	2026/06/11		119	%	60 - 130
			1,2,3-trichlorobenzene	2026/06/11		102	%	60 - 130
			1,2,4-trichlorobenzene	2026/06/11		102	%	60 - 130
			1,2-dibromoethane	2026/06/11		97	%	60 - 130
			1,2-dichlorobenzene	2026/06/11		103	%	60 - 130
			1,2-dichloroethane	2026/06/11		93	%	60 - 130
			1,2-dichloropropane	2026/06/11		100	%	60 - 130
			1,3,5-trimethylbenzene	2026/06/11		114	%	60 - 130
			1,3-Butadiene	2026/06/11		143 (1)	%	50 - 140
			1,3-dichlorobenzene	2026/06/11		104	%	60 - 130
			1,3-dichloropropane	2026/06/11		96	%	60 - 130
			1,4-dichlorobenzene	2026/06/11		100	%	60 - 130
			Benzene	2026/06/11		100	%	60 - 130
			Bromobenzene	2026/06/11		101	%	60 - 130
			Bromodichloromethane	2026/06/11		95	%	60 - 130
			Bromoform	2026/06/11		93	%	60 - 130
			Bromomethane	2026/06/11		92	%	50 - 140
			Carbon tetrachloride	2026/06/11		99	%	60 - 130
			Chlorobenzene	2026/06/11		95	%	60 - 130
			Dibromochloromethane	2026/06/11		90	%	60 - 130
			Chloroethane	2026/06/11		83	%	50 - 140
			Chloroform	2026/06/11		95	%	60 - 130
			Chloromethane	2026/06/11		101	%	50 - 140
			cis-1,2-dichloroethene	2026/06/11		98	%	60 - 130
			cis-1,3-dichloropropene	2026/06/11		90	%	50 - 140
			Dichlorodifluoromethane	2026/06/11		83	%	50 - 140
			Dichloromethane	2026/06/11		92	%	60 - 130
			Ethylbenzene	2026/06/11		100	%	60 - 130
			Hexachlorobutadiene	2026/06/11		98	%	60 - 130
			Isopropylbenzene	2026/06/11		102	%	60 - 130
			Methyl-tert-butylether (MTBE)	2026/06/11		85	%	60 - 130
			Styrene	2026/06/11		88	%	60 - 130
			Tetrachloroethene	2026/06/11		97	%	60 - 130
			Toluene	2026/06/11		80	%	60 - 130
			trans-1,2-dichloroethene	2026/06/11		104	%	60 - 130
			trans-1,3-dichloropropene	2026/06/11		80	%	50 - 140
			Trichloroethene	2026/06/11		96	%	60 - 130
			Trichlorofluoromethane	2026/06/11		97	%	60 - 130
			Vinyl chloride	2026/06/11		104	%	50 - 140
			m & p-Xylene	2026/06/11		104	%	60 - 130
			o-Xylene	2026/06/11		86	%	60 - 130



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309739	DWL	Method Blank	1,4-Difluorobenzene (sur.)	2026/06/11		103	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		86	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		111	%	50 - 140
			VH C6-C10	2026/06/11	ND, RDL=300		ug/L	
			1,1,1,2-tetrachloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,1-trichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,2,2-tetrachloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11	ND, RDL=2.0		ug/L	
			1,1,2-trichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1-dichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1-dichloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			1,2,3-trichlorobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,2,4-trichlorobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,2-dibromoethane	2026/06/11	ND, RDL=0.20		ug/L	
			1,2-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			1,2-dichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,2-dichloropropane	2026/06/11	ND, RDL=0.50		ug/L	
			1,3,5-trimethylbenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,3-Butadiene	2026/06/11	ND, RDL=0.50		ug/L	
			1,3-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			1,3-dichloropropane	2026/06/11	ND, RDL=1.0		ug/L	
			1,4-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			Benzene	2026/06/11	ND, RDL=0.40		ug/L	
			Bromobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			Bromodichloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			Bromoform	2026/06/11	ND, RDL=1.0		ug/L	
			Bromomethane	2026/06/11	ND, RDL=1.0		ug/L	
			Carbon tetrachloride	2026/06/11	ND, RDL=0.50		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Chlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			Dibromochloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			Chloroethane	2026/06/11	ND, RDL=1.0		ug/L	
			Chloroform	2026/06/11	ND, RDL=1.0		ug/L	
			Chloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			cis-1,2-dichloroethene	2026/06/11	ND, RDL=1.0		ug/L	
			cis-1,3-dichloropropene	2026/06/11	ND, RDL=1.0		ug/L	
			Dichlorodifluoromethane	2026/06/11	ND, RDL=2.0		ug/L	
			Dichloromethane	2026/06/11	ND, RDL=2.0		ug/L	
			Ethylbenzene	2026/06/11	ND, RDL=0.40		ug/L	
			Hexachlorobutadiene	2026/06/11	ND, RDL=0.50		ug/L	
			Isopropylbenzene	2026/06/11	ND, RDL=2.0		ug/L	
			Methyl-tert-butylether (MTBE)	2026/06/11	ND, RDL=4.0		ug/L	
			Styrene	2026/06/11	ND, RDL=0.50		ug/L	
			Tetrachloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			Toluene	2026/06/11	ND, RDL=0.40		ug/L	
			trans-1,2-dichloroethene	2026/06/11	ND, RDL=1.0		ug/L	
			trans-1,3-dichloropropene	2026/06/11	ND, RDL=1.0		ug/L	
			Trichloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			Trichlorofluoromethane	2026/06/11	ND, RDL=4.0		ug/L	
			Vinyl chloride	2026/06/11	ND, RDL=0.50		ug/L	
			m & p-Xylene	2026/06/11	ND, RDL=0.40		ug/L	
			o-Xylene	2026/06/11	ND, RDL=0.40		ug/L	
			Xylenes (Total)	2026/06/11	ND, RDL=0.40		ug/L	
C309739	DWL	RPD	VH C6-C10	2026/06/11	NC		%	30
			1,2-dibromoethane	2026/06/11	NC		%	30
			1,2-dichloroethane	2026/06/11	NC		%	30
			1,3,5-trimethylbenzene	2026/06/11	NC		%	30
			1,3-Butadiene	2026/06/11	NC		%	30
			Benzene	2026/06/11	NC		%	30



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Ethylbenzene	2026/06/11	NC		%	30
			Isopropylbenzene	2026/06/11	NC		%	30
			Methyl-tert-butylether (MTBE)	2026/06/11	NC		%	30
			Styrene	2026/06/11	NC		%	30
			Toluene	2026/06/11	NC		%	30
			m & p-Xylene	2026/06/11	NC		%	30
			o-Xylene	2026/06/11	NC		%	30
			Xylenes (Total)	2026/06/11	NC		%	30
C309788	SPP	Matrix Spike	Total Dissolved Solids	2026/06/11		97	%	80 - 120
C309788	SPP	Spiked Blank	Total Dissolved Solids	2026/06/11		98	%	80 - 120
C309788	SPP	Method Blank	Total Dissolved Solids	2026/06/11	ND, RDL=10		mg/L	
C309788	SPP	RPD	Total Dissolved Solids	2026/06/11	0		%	20
C309825	SPP	Matrix Spike [EGJ913-02]	Total Suspended Solids	2026/06/11		104	%	80 - 120
C309825	SPP	Spiked Blank	Total Suspended Solids	2026/06/11		105	%	80 - 120
C309825	SPP	Method Blank	Total Suspended Solids	2026/06/11	ND, RDL=1.0		mg/L	
C309825	SPP	RPD [EGJ912-02]	Total Suspended Solids	2026/06/11	NC		%	20
C309857	JGL	Matrix Spike	Nitrate plus Nitrite (N)	2026/06/10		108	%	80 - 120
C309857	JGL	Spiked Blank	Nitrate plus Nitrite (N)	2026/06/10		107	%	80 - 120
C309857	JGL	Method Blank	Nitrate plus Nitrite (N)	2026/06/10	ND, RDL=0.020		mg/L	
C309857	JGL	RPD	Nitrate plus Nitrite (N)	2026/06/10	4.8		%	20
C309867	JGL	Matrix Spike	Nitrite (N)	2026/06/10		106	%	80 - 120
C309867	JGL	Spiked Blank	Nitrite (N)	2026/06/10		103	%	80 - 120
C309867	JGL	Method Blank	Nitrite (N)	2026/06/10	ND, RDL=0.0050		mg/L	
C309867	JGL	RPD	Nitrite (N)	2026/06/10	NC		%	20
C309994	BTM	Spiked Blank	pH	2026/06/10		100	%	97 - 103
C309994	BTM	RPD	pH	2026/06/10	0.16		%	N/A
C310007	BTM	Spiked Blank	Alkalinity (Total as CaCO3)	2026/06/10		98	%	80 - 120
C310007	BTM	Method Blank	Alkalinity (PP as CaCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Alkalinity (Total as CaCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Bicarbonate (HCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Carbonate (CO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Hydroxide (OH)	2026/06/10	ND, RDL=1.0		mg/L	
C310007	BTM	RPD	Alkalinity (PP as CaCO3)	2026/06/10	NC		%	20
			Alkalinity (Total as CaCO3)	2026/06/10	0.30		%	20
			Bicarbonate (HCO3)	2026/06/10	0.30		%	20
			Carbonate (CO3)	2026/06/10	NC		%	20
			Hydroxide (OH)	2026/06/10	NC		%	20
C310521	CBK	Matrix Spike	Chloride (Cl)	2026/06/10		NC	%	80 - 120
			Sulphate (SO4)	2026/06/10		NC	%	80 - 120
C310521	CBK	Spiked Blank	Chloride (Cl)	2026/06/10		103	%	80 - 120
			Sulphate (SO4)	2026/06/10		86	%	80 - 120
C310521	CBK	Method Blank	Chloride (Cl)	2026/06/10	ND, RDL=1.0		mg/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Sulphate (SO4)	2026/06/10	ND, RDL=1.0		mg/L	
C310521	CBK	RPD	Sulphate (SO4)	2026/06/10	4.8		%	20
C310593	TSO	Matrix Spike [EGJ909-05]	Total Ammonia (N)	2026/06/10		93	%	80 - 120
C310593	TSO	Spiked Blank	Total Ammonia (N)	2026/06/10		103	%	80 - 120
C310593	TSO	Method Blank	Total Ammonia (N)	2026/06/10	ND, RDL=0.015		mg/L	
C310593	TSO	RPD [EGJ909-05]	Total Ammonia (N)	2026/06/10	NC		%	20
C310613	KA5	Matrix Spike	Total Phosphorus (P)	2026/06/11		119	%	N/A
C310613	KA5	Spiked Blank	Total Phosphorus (P)	2026/06/11		114	%	80 - 120
C310613	KA5	Method Blank	Total Phosphorus (P)	2026/06/11	ND, RDL=0.0010		mg/L	
C310613	KA5	RPD	Total Phosphorus (P)	2026/06/11	13		%	20
C310984	JGL	Matrix Spike [EGJ912-09]	Total Hex. Chromium (Cr 6+)	2026/06/11		106	%	80 - 120
C310984	JGL	Spiked Blank	Total Hex. Chromium (Cr 6+)	2026/06/11		101	%	80 - 120
C310984	JGL	Method Blank	Total Hex. Chromium (Cr 6+)	2026/06/11	ND, RDL=0.00099		mg/L	
C310984	JGL	RPD [EGJ912-09]	Total Hex. Chromium (Cr 6+)	2026/06/11	NC		%	20
C311117	AA1	Matrix Spike	Dissolved Aluminum (Al)	2026/06/11		95	%	80 - 120
			Dissolved Antimony (Sb)	2026/06/11		96	%	80 - 120
			Dissolved Arsenic (As)	2026/06/11		103	%	80 - 120
			Dissolved Barium (Ba)	2026/06/11		98	%	80 - 120
			Dissolved Beryllium (Be)	2026/06/11		91	%	80 - 120
			Dissolved Bismuth (Bi)	2026/06/11		93	%	80 - 120
			Dissolved Boron (B)	2026/06/11		90	%	80 - 120
			Dissolved Cadmium (Cd)	2026/06/11		99	%	80 - 120
			Dissolved Cesium (Cs)	2026/06/11		98	%	80 - 120
			Dissolved Chromium (Cr)	2026/06/11		96	%	80 - 120
			Dissolved Cobalt (Co)	2026/06/11		92	%	80 - 120
			Dissolved Copper (Cu)	2026/06/11		90	%	80 - 120
			Dissolved Iron (Fe)	2026/06/11		97	%	80 - 120
			Dissolved Lead (Pb)	2026/06/11		93	%	80 - 120
			Dissolved Lithium (Li)	2026/06/11		85	%	80 - 120
			Dissolved Manganese (Mn)	2026/06/11		91	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/06/11		NC	%	80 - 120
			Dissolved Nickel (Ni)	2026/06/11		91	%	80 - 120
			Dissolved Phosphorus (P)	2026/06/11		106	%	80 - 120
			Dissolved Rubidium (Rb)	2026/06/11		NC	%	80 - 120
			Dissolved Selenium (Se)	2026/06/11		101	%	80 - 120
			Dissolved Silicon (Si)	2026/06/11		102	%	80 - 120
			Dissolved Silver (Ag)	2026/06/11		94	%	80 - 120
			Dissolved Strontium (Sr)	2026/06/11		NC	%	80 - 120
			Dissolved Tellurium (Te)	2026/06/11		106	%	80 - 120
			Dissolved Thallium (Tl)	2026/06/11		96	%	80 - 120
			Dissolved Thorium (Th)	2026/06/11		101	%	80 - 120
			Dissolved Tin (Sn)	2026/06/11		99	%	80 - 120
			Dissolved Titanium (Ti)	2026/06/11		102	%	80 - 120
			Dissolved Uranium (U)	2026/06/11		99	%	80 - 120
			Dissolved Vanadium (V)	2026/06/11		99	%	80 - 120
			Dissolved Zinc (Zn)	2026/06/11		93	%	80 - 120
			Dissolved Zirconium (Zr)	2026/06/11		104	%	80 - 120
C311117	AA1	Spiked Blank	Dissolved Aluminum (Al)	2026/06/11		99	%	80 - 120
			Dissolved Antimony (Sb)	2026/06/11		99	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C311117	AA1	Method Blank	Dissolved Arsenic (As)	2026/06/11		102	%	80 - 120
			Dissolved Barium (Ba)	2026/06/11		100	%	80 - 120
			Dissolved Beryllium (Be)	2026/06/11		95	%	80 - 120
			Dissolved Bismuth (Bi)	2026/06/11		96	%	80 - 120
			Dissolved Boron (B)	2026/06/11		95	%	80 - 120
			Dissolved Cadmium (Cd)	2026/06/11		99	%	80 - 120
			Dissolved Cesium (Cs)	2026/06/11		99	%	80 - 120
			Dissolved Chromium (Cr)	2026/06/11		100	%	80 - 120
			Dissolved Cobalt (Co)	2026/06/11		100	%	80 - 120
			Dissolved Copper (Cu)	2026/06/11		98	%	80 - 120
			Dissolved Iron (Fe)	2026/06/11		98	%	80 - 120
			Dissolved Lead (Pb)	2026/06/11		96	%	80 - 120
			Dissolved Lithium (Li)	2026/06/11		92	%	80 - 120
			Dissolved Manganese (Mn)	2026/06/11		99	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/06/11		100	%	80 - 120
			Dissolved Nickel (Ni)	2026/06/11		98	%	80 - 120
			Dissolved Phosphorus (P)	2026/06/11		99	%	80 - 120
			Dissolved Rubidium (Rb)	2026/06/11		102	%	80 - 120
			Dissolved Selenium (Se)	2026/06/11		99	%	80 - 120
			Dissolved Silicon (Si)	2026/06/11		99	%	80 - 120
			Dissolved Silver (Ag)	2026/06/11		96	%	80 - 120
			Dissolved Strontium (Sr)	2026/06/11		98	%	80 - 120
			Dissolved Tellurium (Te)	2026/06/11		100	%	80 - 120
			Dissolved Thallium (Tl)	2026/06/11		98	%	80 - 120
			Dissolved Thorium (Th)	2026/06/11		99	%	80 - 120
			Dissolved Tin (Sn)	2026/06/11		100	%	80 - 120
			Dissolved Titanium (Ti)	2026/06/11		105	%	80 - 120
			Dissolved Uranium (U)	2026/06/11		98	%	80 - 120
			Dissolved Vanadium (V)	2026/06/11		101	%	80 - 120
			Dissolved Zinc (Zn)	2026/06/11		97	%	80 - 120
			Dissolved Zirconium (Zr)	2026/06/11		99	%	80 - 120
			Dissolved Aluminum (Al)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Antimony (Sb)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Arsenic (As)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Barium (Ba)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Beryllium (Be)	2026/06/11	ND, RDL=0.010		ug/L	
			Dissolved Bismuth (Bi)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Boron (B)	2026/06/11	ND, RDL=10		ug/L	
			Dissolved Cadmium (Cd)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Cesium (Cs)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Chromium (Cr)	2026/06/11	ND, RDL=0.10		ug/L	
			Dissolved Cobalt (Co)	2026/06/11	ND, RDL=0.0050		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Copper (Cu)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Iron (Fe)	2026/06/11	ND, RDL=1.0		ug/L	
			Dissolved Lead (Pb)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Lithium (Li)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Manganese (Mn)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Molybdenum (Mo)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Nickel (Ni)	2026/06/11	0.024, RDL=0.020 (2)		ug/L	
			Dissolved Phosphorus (P)	2026/06/11	ND, RDL=2.0		ug/L	
			Dissolved Rubidium (Rb)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Selenium (Se)	2026/06/11	ND, RDL=0.040		ug/L	
			Dissolved Silicon (Si)	2026/06/11	ND, RDL=50		ug/L	
			Dissolved Silver (Ag)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Strontium (Sr)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Tellurium (Te)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Thallium (Tl)	2026/06/11	ND, RDL=0.0020		ug/L	
			Dissolved Thorium (Th)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Tin (Sn)	2026/06/11	ND, RDL=0.20		ug/L	
			Dissolved Titanium (Ti)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Uranium (U)	2026/06/11	ND, RDL=0.0020		ug/L	
			Dissolved Vanadium (V)	2026/06/11	ND, RDL=0.20		ug/L	
			Dissolved Zinc (Zn)	2026/06/11	ND, RDL=0.10		ug/L	
			Dissolved Zirconium (Zr)	2026/06/11	ND, RDL=0.10		ug/L	
C311117	AA1	RPD	Dissolved Aluminum (Al)	2026/06/11	4.6		%	20
			Dissolved Antimony (Sb)	2026/06/11	0.21		%	20
			Dissolved Arsenic (As)	2026/06/11	0.70		%	20
			Dissolved Barium (Ba)	2026/06/11	2.3		%	20
			Dissolved Beryllium (Be)	2026/06/11	NC		%	20
			Dissolved Boron (B)	2026/06/11	2.3		%	20
			Dissolved Cadmium (Cd)	2026/06/11	1.5		%	20
			Dissolved Chromium (Cr)	2026/06/11	NC		%	20
			Dissolved Cobalt (Co)	2026/06/11	0.16		%	20
			Dissolved Copper (Cu)	2026/06/11	2.3		%	20



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Iron (Fe)	2026/06/11	2.1		%	20
			Dissolved Lead (Pb)	2026/06/11	3.5		%	20
			Dissolved Lithium (Li)	2026/06/11	3.3		%	20
			Dissolved Manganese (Mn)	2026/06/11	0.80		%	20
			Dissolved Molybdenum (Mo)	2026/06/11	0.31		%	20
			Dissolved Nickel (Ni)	2026/06/11	0.68		%	20
			Dissolved Selenium (Se)	2026/06/11	1.1		%	20
			Dissolved Silver (Ag)	2026/06/11	NC		%	20
			Dissolved Strontium (Sr)	2026/06/11	0.23		%	20
			Dissolved Thallium (Tl)	2026/06/11	12		%	20
			Dissolved Tin (Sn)	2026/06/11	NC		%	20
			Dissolved Titanium (Ti)	2026/06/11	NC		%	20
			Dissolved Uranium (U)	2026/06/11	0		%	20
			Dissolved Vanadium (V)	2026/06/11	0.57		%	20
			Dissolved Zinc (Zn)	2026/06/11	4.0		%	20
C311157	IC4	Matrix Spike	Total Mercury (Hg)	2026/06/11		99	%	80 - 120
C311157	IC4	Spiked Blank	Total Mercury (Hg)	2026/06/11		98	%	80 - 120
C311157	IC4	Method Blank	Total Mercury (Hg)	2026/06/11	ND, RDL=0.0019		ug/L	
C311157	IC4	RPD	Total Mercury (Hg)	2026/06/11	0.85		%	20
C311273	CJY	Matrix Spike [EGJ912-04]	Total Organic Carbon (C)	2026/06/11		131 (3)	%	80 - 120
C311273	CJY	Spiked Blank	Total Organic Carbon (C)	2026/06/11		118	%	80 - 120
C311273	CJY	Method Blank	Total Organic Carbon (C)	2026/06/11	ND, RDL=0.50		mg/L	
C311273	CJY	RPD [EGJ912-04]	Total Organic Carbon (C)	2026/06/11	NC		%	20
C311428	BTM	Matrix Spike	Dissolved Fluoride (F)	2026/06/11		93	%	80 - 120
C311428	BTM	Spiked Blank	Dissolved Fluoride (F)	2026/06/11		102	%	80 - 120
C311428	BTM	Method Blank	Dissolved Fluoride (F)	2026/06/11	ND, RDL=0.050		mg/L	
C311428	BTM	RPD	Fluoride (F)	2026/06/11	NC		%	20
C311597	AA1	Matrix Spike [EGJ911-10]	Total Aluminum (Al)	2026/06/12		99	%	80 - 120
			Total Antimony (Sb)	2026/06/12		106	%	80 - 120
			Total Arsenic (As)	2026/06/12		103	%	80 - 120
			Total Barium (Ba)	2026/06/12		104	%	80 - 120
			Total Beryllium (Be)	2026/06/12		103	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		100	%	80 - 120
			Total Boron (B)	2026/06/12		105	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		101	%	80 - 120
			Total Cesium (Cs)	2026/06/12		105	%	80 - 120
			Total Chromium (Cr)	2026/06/12		99	%	80 - 120
			Total Cobalt (Co)	2026/06/12		94	%	80 - 120
			Total Copper (Cu)	2026/06/12		97	%	80 - 120
			Total Iron (Fe)	2026/06/12		99	%	80 - 120
			Total Lead (Pb)	2026/06/12		97	%	80 - 120
			Total Lithium (Li)	2026/06/12		101	%	80 - 120
			Total Manganese (Mn)	2026/06/12		98	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		101	%	80 - 120
			Total Nickel (Ni)	2026/06/12		97	%	80 - 120
			Total Phosphorus (P)	2026/06/12		100	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		105	%	80 - 120
			Total Selenium (Se)	2026/06/12		102	%	80 - 120
			Total Silicon (Si)	2026/06/12		102	%	80 - 120
			Total Silver (Ag)	2026/06/12		98	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C311597	AA1	Spiked Blank	Total Strontium (Sr)	2026/06/12		96	%	80 - 120
			Total Tellurium (Te)	2026/06/12		104	%	80 - 120
			Total Thallium (Tl)	2026/06/12		100	%	80 - 120
			Total Thorium (Th)	2026/06/12		107	%	80 - 120
			Total Tin (Sn)	2026/06/12		99	%	80 - 120
			Total Titanium (Ti)	2026/06/12		99	%	80 - 120
			Total Uranium (U)	2026/06/12		105	%	80 - 120
			Total Vanadium (V)	2026/06/12		100	%	80 - 120
			Total Zinc (Zn)	2026/06/12		99	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		102	%	80 - 120
			Total Aluminum (Al)	2026/06/12		103	%	80 - 120
			Total Antimony (Sb)	2026/06/12		109	%	80 - 120
			Total Arsenic (As)	2026/06/12		104	%	80 - 120
			Total Barium (Ba)	2026/06/12		108	%	80 - 120
			Total Beryllium (Be)	2026/06/12		102	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		103	%	80 - 120
			Total Boron (B)	2026/06/12		105	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		108	%	80 - 120
			Total Chromium (Cr)	2026/06/12		104	%	80 - 120
			Total Cobalt (Co)	2026/06/12		98	%	80 - 120
			Total Copper (Cu)	2026/06/12		101	%	80 - 120
			Total Iron (Fe)	2026/06/12		107	%	80 - 120
			Total Lead (Pb)	2026/06/12		100	%	80 - 120
			Total Lithium (Li)	2026/06/12		101	%	80 - 120
			Total Manganese (Mn)	2026/06/12		102	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		108	%	80 - 120
			Total Nickel (Ni)	2026/06/12		101	%	80 - 120
			Total Phosphorus (P)	2026/06/12		100	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		110	%	80 - 120
			Total Selenium (Se)	2026/06/12		105	%	80 - 120
			Total Silicon (Si)	2026/06/12		104	%	80 - 120
			Total Silver (Ag)	2026/06/12		101	%	80 - 120
			Total Strontium (Sr)	2026/06/12		103	%	80 - 120
			Total Tellurium (Te)	2026/06/12		103	%	80 - 120
			Total Thallium (Tl)	2026/06/12		101	%	80 - 120
			Total Thorium (Th)	2026/06/12		109	%	80 - 120
			Total Tin (Sn)	2026/06/12		106	%	80 - 120
			Total Titanium (Ti)	2026/06/12		105	%	80 - 120
			Total Uranium (U)	2026/06/12		111	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		104	%	80 - 120
C311597	AA1	Method Blank	Total Aluminum (Al)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Antimony (Sb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Beryllium (Be)	2026/06/12	ND, RDL=0.010		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Bismuth (Bi)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Boron (B)	2026/06/12	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Copper (Cu)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Iron (Fe)	2026/06/12	ND, RDL=1.0		ug/L	
			Total Lead (Pb)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Lithium (Li)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Molybdenum (Mo)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Phosphorus (P)	2026/06/12	ND, RDL=2.0		ug/L	
			Total Rubidium (Rb)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/12	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/12	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Strontium (Sr)	2026/06/12	0.067, RDL=0.050 (2)		ug/L	
			Total Tellurium (Te)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Uranium (U)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Vanadium (V)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/12	ND, RDL=0.10		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Zirconium (Zr)	2026/06/12	ND, RDL=0.10		ug/L	
C311597	AA1	RPD [EGJ911-10]	Total Aluminum (Al)	2026/06/12	0.0014		%	20
			Total Antimony (Sb)	2026/06/12	5.2		%	20
			Total Arsenic (As)	2026/06/12	0.62		%	20
			Total Barium (Ba)	2026/06/12	1.9		%	20
			Total Beryllium (Be)	2026/06/12	NC		%	20
			Total Bismuth (Bi)	2026/06/12	NC		%	20
			Total Boron (B)	2026/06/12	NC		%	20
			Total Cadmium (Cd)	2026/06/12	12		%	20
			Total Cesium (Cs)	2026/06/12	NC		%	20
			Total Chromium (Cr)	2026/06/12	NC		%	20
			Total Cobalt (Co)	2026/06/12	17		%	20
			Total Copper (Cu)	2026/06/12	7.5		%	20
			Total Iron (Fe)	2026/06/12	2.1		%	20
			Total Lead (Pb)	2026/06/12	0.40		%	20
			Total Lithium (Li)	2026/06/12	NC		%	20
			Total Manganese (Mn)	2026/06/12	4.5		%	20
			Total Molybdenum (Mo)	2026/06/12	0.73		%	20
			Total Nickel (Ni)	2026/06/12	7.6		%	20
			Total Phosphorus (P)	2026/06/12	2.6		%	20
			Total Rubidium (Rb)	2026/06/12	1.1		%	20
			Total Selenium (Se)	2026/06/12	NC		%	20
			Total Silicon (Si)	2026/06/12	1.4		%	20
			Total Silver (Ag)	2026/06/12	NC		%	20
			Total Strontium (Sr)	2026/06/12	1.0		%	20
			Total Tellurium (Te)	2026/06/12	NC		%	20
			Total Thallium (Tl)	2026/06/12	3.4		%	20
			Total Thorium (Th)	2026/06/12	NC		%	20
			Total Tin (Sn)	2026/06/12	NC		%	20
			Total Titanium (Ti)	2026/06/12	11		%	20
			Total Uranium (U)	2026/06/12	1.0		%	20
			Total Vanadium (V)	2026/06/12	6.0		%	20
			Total Zinc (Zn)	2026/06/12	0.086		%	20
			Total Zirconium (Zr)	2026/06/12	NC		%	20
C311623	IC4	Matrix Spike [EGJ910-07]	Dissolved Mercury (Hg)	2026/06/11		98	%	80 - 120
C311623	IC4	Spiked Blank	Dissolved Mercury (Hg)	2026/06/11		95	%	80 - 120
C311623	IC4	Method Blank	Dissolved Mercury (Hg)	2026/06/11	ND, RDL=0.0019		ug/L	
C311623	IC4	RPD [EGJ910-07]	Dissolved Mercury (Hg)	2026/06/11	NC		%	20
C312375	AA1	Matrix Spike [EGJ910-10]	Total Aluminum (Al)	2026/06/12		NC	%	80 - 120
			Total Antimony (Sb)	2026/06/12		104	%	80 - 120
			Total Arsenic (As)	2026/06/12		108	%	80 - 120
			Total Barium (Ba)	2026/06/12		104	%	80 - 120
			Total Beryllium (Be)	2026/06/12		97	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		94	%	80 - 120
			Total Boron (B)	2026/06/12		96	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		104	%	80 - 120
			Total Chromium (Cr)	2026/06/12		100	%	80 - 120
			Total Cobalt (Co)	2026/06/12		100	%	80 - 120
			Total Copper (Cu)	2026/06/12		98	%	80 - 120
			Total Iron (Fe)	2026/06/12		105	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	Spiked Blank	Total Lead (Pb)	2026/06/12		94	%	80 - 120
			Total Lithium (Li)	2026/06/12		91	%	80 - 120
			Total Manganese (Mn)	2026/06/12		98	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		NC	%	80 - 120
			Total Nickel (Ni)	2026/06/12		97	%	80 - 120
			Total Phosphorus (P)	2026/06/12		103	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		106	%	80 - 120
			Total Selenium (Se)	2026/06/12		106	%	80 - 120
			Total Silicon (Si)	2026/06/12		NC	%	80 - 120
			Total Silver (Ag)	2026/06/12		102	%	80 - 120
			Total Strontium (Sr)	2026/06/12		NC	%	80 - 120
			Total Tellurium (Te)	2026/06/12		106	%	80 - 120
			Total Thallium (Tl)	2026/06/12		96	%	80 - 120
			Total Thorium (Th)	2026/06/12		98	%	80 - 120
			Total Tin (Sn)	2026/06/12		100	%	80 - 120
			Total Titanium (Ti)	2026/06/12		107	%	80 - 120
			Total Uranium (U)	2026/06/12		96	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		99	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		110	%	80 - 120
			Total Aluminum (Al)	2026/06/12		100	%	80 - 120
			Total Antimony (Sb)	2026/06/12		104	%	80 - 120
			Total Arsenic (As)	2026/06/12		107	%	80 - 120
			Total Barium (Ba)	2026/06/12		105	%	80 - 120
			Total Beryllium (Be)	2026/06/12		96	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		103	%	80 - 120
			Total Boron (B)	2026/06/12		98	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		104	%	80 - 120
			Total Chromium (Cr)	2026/06/12		102	%	80 - 120
			Total Cobalt (Co)	2026/06/12		103	%	80 - 120
			Total Copper (Cu)	2026/06/12		102	%	80 - 120
			Total Iron (Fe)	2026/06/12		106	%	80 - 120
			Total Lead (Pb)	2026/06/12		101	%	80 - 120
			Total Lithium (Li)	2026/06/12		93	%	80 - 120
			Total Manganese (Mn)	2026/06/12		103	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		107	%	80 - 120
			Total Nickel (Ni)	2026/06/12		101	%	80 - 120
			Total Phosphorus (P)	2026/06/12		102	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		108	%	80 - 120
			Total Selenium (Se)	2026/06/12		105	%	80 - 120
			Total Silicon (Si)	2026/06/12		106	%	80 - 120
			Total Silver (Ag)	2026/06/12		102	%	80 - 120
			Total Strontium (Sr)	2026/06/12		107	%	80 - 120
			Total Tellurium (Te)	2026/06/12		108	%	80 - 120
			Total Thallium (Tl)	2026/06/12		102	%	80 - 120
			Total Thorium (Th)	2026/06/12		105	%	80 - 120
			Total Tin (Sn)	2026/06/12		105	%	80 - 120
			Total Titanium (Ti)	2026/06/12		105	%	80 - 120
			Total Uranium (U)	2026/06/12		105	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		107	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	Method Blank	Total Aluminum (Al)	2026/06/12	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Boron (B)	2026/06/12	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/06/12	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/06/12	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/12	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/12	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/12	ND, RDL=0.050		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	RPD	Total Tin (Sn)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/12	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/12	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Aluminum (Al)	2026/06/12	2.8		%	20
			Total Antimony (Sb)	2026/06/12	0.13		%	20
			Total Arsenic (As)	2026/06/12	0.48		%	20
			Total Barium (Ba)	2026/06/12	0.81		%	20
			Total Beryllium (Be)	2026/06/12	NC		%	20
			Total Bismuth (Bi)	2026/06/12	NC		%	20
			Total Boron (B)	2026/06/12	1.1		%	20
			Total Cadmium (Cd)	2026/06/12	8.9		%	20
			Total Chromium (Cr)	2026/06/12	NC		%	20
			Total Cobalt (Co)	2026/06/12	4.3		%	20
			Total Copper (Cu)	2026/06/12	2.6		%	20
			Total Iron (Fe)	2026/06/12	12		%	20
			Total Lead (Pb)	2026/06/12	5.7		%	20
			Total Lithium (Li)	2026/06/12	0.31		%	20
			Total Manganese (Mn)	2026/06/12	0.18		%	20
			Total Molybdenum (Mo)	2026/06/12	0.76		%	20
			Total Nickel (Ni)	2026/06/12	0.41		%	20
			Total Selenium (Se)	2026/06/12	1.4		%	20
			Total Silver (Ag)	2026/06/12	NC		%	20
			Total Strontium (Sr)	2026/06/12	0.10		%	20
			Total Thallium (Tl)	2026/06/12	15		%	20
			Total Tin (Sn)	2026/06/12	NC		%	20
			Total Titanium (Ti)	2026/06/12	8.9		%	20
			Total Uranium (U)	2026/06/12	3.5		%	20
			Total Vanadium (V)	2026/06/12	NC		%	20
			Total Zinc (Zn)	2026/06/12	NC		%	20
C312443	TSO	Matrix Spike [EGJ909-04]	Total Nitrogen (N)	2026/06/15		97	%	80 - 120
C312443	TSO	Spiked Blank	Total Nitrogen (N)	2026/06/15		101	%	80 - 120
C312443	TSO	Method Blank	Total Nitrogen (N)	2026/06/15	ND, RDL=0.020		mg/L	
C312443	TSO	RPD [EGJ909-04]	Total Nitrogen (N)	2026/06/15	1.4		%	20
C312590	MDO	Matrix Spike	Phenols	2026/06/12		103	%	80 - 120
C312590	MDO	Spiked Blank	Phenols	2026/06/12		104	%	80 - 120
C312590	MDO	Method Blank	Phenols	2026/06/12	ND, RDL=0.0015		mg/L	
C312590	MDO	RPD	Phenols	2026/06/12	NC		%	20
C312901	CJY	Spiked Blank	Dissolved Organic Carbon (C)	2026/06/13		108	%	80 - 120
C312901	CJY	Method Blank	Dissolved Organic Carbon (C)	2026/06/13	ND, RDL=0.50		mg/L	
C312994	AAX	Matrix Spike	Methyl Sulfone (sur.)	2026/06/15		97	%	50 - 140
			Ethylene Glycol	2026/06/15		86	%	60 - 140



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312994	AAX	Spiked Blank	Diethylene Glycol	2026/06/15		99	%	60 - 140
			Triethylene Glycol	2026/06/15		75	%	60 - 140
			Propylene Glycol	2026/06/15		87	%	60 - 140
			Methyl Sulfone (sur.)	2026/06/15		100	%	50 - 140
			Ethylene Glycol	2026/06/15		87	%	70 - 130
			Diethylene Glycol	2026/06/15		102	%	70 - 130
C312994	AAX	Method Blank	Triethylene Glycol	2026/06/15		90	%	70 - 130
			Propylene Glycol	2026/06/15		91	%	70 - 130
			Methyl Sulfone (sur.)	2026/06/15		103	%	50 - 140
			Ethylene Glycol	2026/06/15	ND, RDL=3.0		mg/L	
			Diethylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
			Triethylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
C312994	AAX	RPD	Propylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
			Ethylene Glycol	2026/06/15	NC		%	30
			Diethylene Glycol	2026/06/15	NC		%	30
			Triethylene Glycol	2026/06/15	NC		%	30
			Propylene Glycol	2026/06/15	NC		%	30
			Bromide (Br)	2026/06/12		84	%	78 - 120
C313156	SOM	Matrix Spike [EGJ909-12]	Bromide (Br)	2026/06/12		97	%	80 - 120
C313156	SOM	Method Blank	Bromide (Br)	2026/06/12	ND, RDL=0.010		mg/L	
C313156	SOM	RPD [EGJ909-12]	Bromide (Br)	2026/06/12	NC		%	20
C313217	AA1	Matrix Spike [EGJ909-10]	Total Aluminum (Al)	2026/06/15		NC	%	80 - 120
			Total Antimony (Sb)	2026/06/15		103	%	80 - 120
			Total Arsenic (As)	2026/06/15		106	%	80 - 120
			Total Barium (Ba)	2026/06/15		100	%	80 - 120
			Total Beryllium (Be)	2026/06/15		99	%	80 - 120
			Total Bismuth (Bi)	2026/06/15		96	%	80 - 120
			Total Boron (B)	2026/06/15		103	%	80 - 120
			Total Cadmium (Cd)	2026/06/15		102	%	80 - 120
			Total Cesium (Cs)	2026/06/15		99	%	80 - 120
			Total Chromium (Cr)	2026/06/15		105	%	80 - 120
			Total Cobalt (Co)	2026/06/15		100	%	80 - 120
			Total Copper (Cu)	2026/06/15		98	%	80 - 120
			Total Iron (Fe)	2026/06/15		105	%	80 - 120
			Total Lead (Pb)	2026/06/15		95	%	80 - 120
			Total Lithium (Li)	2026/06/15		103	%	80 - 120
			Total Manganese (Mn)	2026/06/15		103	%	80 - 120
			Total Molybdenum (Mo)	2026/06/15		NC	%	80 - 120
			Total Nickel (Ni)	2026/06/15		100	%	80 - 120
			Total Phosphorus (P)	2026/06/15		109	%	80 - 120
			Total Rubidium (Rb)	2026/06/15		111	%	80 - 120
			Total Selenium (Se)	2026/06/15		106	%	80 - 120
			Total Silicon (Si)	2026/06/15		NC	%	80 - 120
			Total Silver (Ag)	2026/06/15		101	%	80 - 120
			Total Strontium (Sr)	2026/06/15		NC	%	80 - 120
			Total Tellurium (Te)	2026/06/15		100	%	80 - 120
			Total Thallium (Tl)	2026/06/15		100	%	80 - 120
			Total Thorium (Th)	2026/06/15		99	%	80 - 120



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C313217	AA1	Spiked Blank	Total Tin (Sn)	2026/06/15		102	%	80 - 120
			Total Titanium (Ti)	2026/06/15		105	%	80 - 120
			Total Uranium (U)	2026/06/15		104	%	80 - 120
			Total Vanadium (V)	2026/06/15		108	%	80 - 120
			Total Zinc (Zn)	2026/06/15		102	%	80 - 120
			Total Zirconium (Zr)	2026/06/15		108	%	80 - 120
			Total Aluminum (Al)	2026/06/15		102	%	80 - 120
			Total Antimony (Sb)	2026/06/15		103	%	80 - 120
			Total Arsenic (As)	2026/06/15		102	%	80 - 120
			Total Barium (Ba)	2026/06/15		102	%	80 - 120
			Total Beryllium (Be)	2026/06/15		95	%	80 - 120
			Total Bismuth (Bi)	2026/06/15		99	%	80 - 120
			Total Boron (B)	2026/06/15		96	%	80 - 120
			Total Cadmium (Cd)	2026/06/15		100	%	80 - 120
			Total Cesium (Cs)	2026/06/15		99	%	80 - 120
			Total Chromium (Cr)	2026/06/15		104	%	80 - 120
			Total Cobalt (Co)	2026/06/15		99	%	80 - 120
			Total Copper (Cu)	2026/06/15		98	%	80 - 120
			Total Iron (Fe)	2026/06/15		106	%	80 - 120
			Total Lead (Pb)	2026/06/15		98	%	80 - 120
			Total Lithium (Li)	2026/06/15		97	%	80 - 120
			Total Manganese (Mn)	2026/06/15		99	%	80 - 120
			Total Molybdenum (Mo)	2026/06/15		106	%	80 - 120
			Total Nickel (Ni)	2026/06/15		101	%	80 - 120
			Total Phosphorus (P)	2026/06/15		104	%	80 - 120
			Total Rubidium (Rb)	2026/06/15		100	%	80 - 120
			Total Selenium (Se)	2026/06/15		103	%	80 - 120
			Total Silicon (Si)	2026/06/15		108	%	80 - 120
			Total Silver (Ag)	2026/06/15		98	%	80 - 120
			Total Strontium (Sr)	2026/06/15		103	%	80 - 120
			Total Tellurium (Te)	2026/06/15		103	%	80 - 120
			Total Thallium (Tl)	2026/06/15		101	%	80 - 120
			Total Thorium (Th)	2026/06/15		100	%	80 - 120
			Total Tin (Sn)	2026/06/15		101	%	80 - 120
			Total Titanium (Ti)	2026/06/15		106	%	80 - 120
			Total Uranium (U)	2026/06/15		105	%	80 - 120
			Total Vanadium (V)	2026/06/15		103	%	80 - 120
			Total Zinc (Zn)	2026/06/15		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/15		104	%	80 - 120
C313217	AA1	Method Blank	Total Aluminum (Al)	2026/06/15	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Boron (B)	2026/06/15	ND, RDL=10		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Cadmium (Cd)	2026/06/15	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/06/15	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/06/15	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/06/15	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/15	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/15	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/15	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/06/15	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/15	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/06/15	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/06/15	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/15	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/06/15	ND, RDL=0.10		ug/L	
C313217	AA1	RPD [EGJ909-10]	Total Aluminum (Al)	2026/06/15	0.64		%	20
			Total Antimony (Sb)	2026/06/15	4.8		%	20



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Arsenic (As)	2026/06/15	0.42		%	20
			Total Barium (Ba)	2026/06/15	0.63		%	20
			Total Beryllium (Be)	2026/06/15	NC		%	20
			Total Bismuth (Bi)	2026/06/15	NC		%	20
			Total Boron (B)	2026/06/15	2.6		%	20
			Total Cadmium (Cd)	2026/06/15	3.9		%	20
			Total Cesium (Cs)	2026/06/15	1.4		%	20
			Total Chromium (Cr)	2026/06/15	1.7		%	20
			Total Cobalt (Co)	2026/06/15	2.3		%	20
			Total Copper (Cu)	2026/06/15	5.8		%	20
			Total Iron (Fe)	2026/06/15	1.4		%	20
			Total Lead (Pb)	2026/06/15	7.7		%	20
			Total Lithium (Li)	2026/06/15	4.8		%	20
			Total Manganese (Mn)	2026/06/15	2.7		%	20
			Total Molybdenum (Mo)	2026/06/15	1.2		%	20
			Total Nickel (Ni)	2026/06/15	1.5		%	20
			Total Phosphorus (P)	2026/06/15	7.2		%	20
			Total Rubidium (Rb)	2026/06/15	1.5		%	20
			Total Selenium (Se)	2026/06/15	0.33		%	20
			Total Silicon (Si)	2026/06/15	0.69		%	20
			Total Silver (Ag)	2026/06/15	NC		%	20
			Total Strontium (Sr)	2026/06/15	1.6		%	20
			Total Tellurium (Te)	2026/06/15	NC		%	20
			Total Thallium (Tl)	2026/06/15	4.8		%	20
			Total Thorium (Th)	2026/06/15	NC		%	20
			Total Tin (Sn)	2026/06/15	NC		%	20
			Total Titanium (Ti)	2026/06/15	0.89		%	20
			Total Uranium (U)	2026/06/15	0.72		%	20
			Total Vanadium (V)	2026/06/15	0.72		%	20
			Total Zinc (Zn)	2026/06/15	NC		%	20
			Total Zirconium (Zr)	2026/06/15	4.0		%	20
C313281	IC4	Matrix Spike	Total Mercury (Hg)	2026/06/15		96	%	80 - 120
C313281	IC4	Spiked Blank	Total Mercury (Hg)	2026/06/15		104	%	80 - 120
C313281	IC4	Method Blank	Total Mercury (Hg)	2026/06/15	ND, RDL=0.0019		ug/L	
C313281	IC4	RPD	Total Mercury (Hg)	2026/06/15	NC		%	20
C314396	NJD	Matrix Spike	Total Sulphide	2026/06/16		98	%	80 - 120
C314396	NJD	Spiked Blank	Total Sulphide	2026/06/16		103	%	80 - 120
C314396	NJD	Method Blank	Total Sulphide	2026/06/16	ND, RDL=0.0018		mg/L	
C314396	NJD	RPD	Total Sulphide	2026/06/16	NC		%	20
C314668	NJD	Matrix Spike [EGJ911-08]	Total Sulphide	2026/06/16		100	%	80 - 120
C314668	NJD	Spiked Blank	Total Sulphide	2026/06/16		102	%	80 - 120
C314668	NJD	Method Blank	Total Sulphide	2026/06/16	ND, RDL=0.0018		mg/L	
C314668	NJD	RPD [EGJ912-08]	Total Sulphide	2026/06/16	NC		%	20
C314719	LS2	Matrix Spike	D10-ANTHRACENE (sur.)	2026/06/15		87	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		94	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		78	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		62	%	50 - 140
			Quinoline	2026/06/15		109	%	50 - 140
			Naphthalene	2026/06/15		87	%	50 - 140
			1-Methylnaphthalene	2026/06/15		87	%	50 - 140



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314719	LS2	Spiked Blank	2-Methylnaphthalene	2026/06/15		89	%	50 - 140
			Acenaphthylene	2026/06/15		94	%	50 - 140
			Acenaphthene	2026/06/15		92	%	50 - 140
			Fluorene	2026/06/15		93	%	50 - 140
			Phenanthrene	2026/06/15		89	%	50 - 140
			Anthracene	2026/06/15		88	%	50 - 140
			Acridine	2026/06/15		96	%	50 - 140
			Fluoranthene	2026/06/15		74	%	50 - 140
			Pyrene	2026/06/15		78	%	50 - 140
			Benzo(a)anthracene	2026/06/15		78	%	50 - 140
			Chrysene	2026/06/15		76	%	50 - 140
			Benzo(b&j)fluoranthene	2026/06/15		65	%	50 - 140
			Benzo(k)fluoranthene	2026/06/15		70	%	50 - 140
			Benzo(a)pyrene	2026/06/15		67	%	50 - 140
			Indeno(1,2,3-cd)pyrene	2026/06/15		51	%	50 - 140
			Dibenz(a,h)anthracene	2026/06/15		50	%	50 - 140
			Benzo(g,h,i)perylene	2026/06/15		49 (3)	%	50 - 140
			D10-ANTHRACENE (sur.)	2026/06/15		102	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		95	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		71	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		84	%	50 - 140
			Quinoline	2026/06/15		101	%	50 - 140
			Naphthalene	2026/06/15		70	%	50 - 140
			1-Methylnaphthalene	2026/06/15		73	%	50 - 140
			2-Methylnaphthalene	2026/06/15		73	%	50 - 140
			Acenaphthylene	2026/06/15		84	%	50 - 140
			Acenaphthene	2026/06/15		83	%	50 - 140
			Fluorene	2026/06/15		87	%	50 - 140
			Phenanthrene	2026/06/15		86	%	50 - 140
			Anthracene	2026/06/15		86	%	50 - 140
			Acridine	2026/06/15		89	%	50 - 140
			Fluoranthene	2026/06/15		74	%	50 - 140
			Pyrene	2026/06/15		79	%	50 - 140
			Benzo(a)anthracene	2026/06/15		87	%	50 - 140
			Chrysene	2026/06/15		86	%	50 - 140
			Benzo(b&j)fluoranthene	2026/06/15		88	%	50 - 140
			Benzo(k)fluoranthene	2026/06/15		93	%	50 - 140
			Benzo(a)pyrene	2026/06/15		92	%	50 - 140
			Indeno(1,2,3-cd)pyrene	2026/06/15		95	%	50 - 140
			Dibenz(a,h)anthracene	2026/06/15		93	%	50 - 140
			Benzo(g,h,i)perylene	2026/06/15		92	%	50 - 140
C314719	LS2	Method Blank	D10-ANTHRACENE (sur.)	2026/06/15		107	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		93	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		66	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		85	%	50 - 140
			Quinoline	2026/06/15	ND, RDL=0.020		ug/L	
			Naphthalene	2026/06/15	ND, RDL=0.10		ug/L	
			1-Methylnaphthalene	2026/06/15	ND, RDL=0.050		ug/L	
			2-Methylnaphthalene	2026/06/15	ND, RDL=0.10		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314719	LS2	RPD	Acenaphthylene	2026/06/15	ND, RDL=0.050		ug/L	
			Acenaphthene	2026/06/15	ND, RDL=0.050		ug/L	
			Fluorene	2026/06/15	ND, RDL=0.050		ug/L	
			Phenanthrene	2026/06/15	ND, RDL=0.050		ug/L	
			Anthracene	2026/06/15	ND, RDL=0.010		ug/L	
			Acridine	2026/06/15	ND, RDL=0.050		ug/L	
			Fluoranthene	2026/06/15	ND, RDL=0.020		ug/L	
			Pyrene	2026/06/15	ND, RDL=0.020		ug/L	
			Benzo(a)anthracene	2026/06/15	ND, RDL=0.010		ug/L	
			Chrysene	2026/06/15	ND, RDL=0.020		ug/L	
			Benzo(b&j)fluoranthene	2026/06/15	ND, RDL=0.030		ug/L	
			Benzo(k)fluoranthene	2026/06/15	ND, RDL=0.050		ug/L	
			Benzo(a)pyrene	2026/06/15	ND, RDL=0.0050		ug/L	
			Indeno(1,2,3-cd)pyrene	2026/06/15	ND, RDL=0.050		ug/L	
			Dibenz(a,h)anthracene	2026/06/15	ND, RDL=0.0030		ug/L	
			Benzo(g,h,i)perylene	2026/06/15	ND, RDL=0.050		ug/L	
			Quinoline	2026/06/15	NC		%	40
			Naphthalene	2026/06/15	NC		%	40
			1-Methylnaphthalene	2026/06/15	NC		%	40
			2-Methylnaphthalene	2026/06/15	NC		%	40
			Acenaphthylene	2026/06/15	NC		%	40
			Acenaphthene	2026/06/15	NC		%	40
			Fluorene	2026/06/15	NC		%	40
			Phenanthrene	2026/06/15	NC		%	40
			Anthracene	2026/06/15	NC		%	40
			Acridine	2026/06/15	NC		%	40
			Fluoranthene	2026/06/15	NC		%	40
			Pyrene	2026/06/15	NC		%	40
			Benzo(a)anthracene	2026/06/15	NC		%	40
			Chrysene	2026/06/15	NC		%	40
			Benzo(b&j)fluoranthene	2026/06/15	NC		%	40
			Benzo(k)fluoranthene	2026/06/15	NC		%	40
			Benzo(a)pyrene	2026/06/15	NC		%	40
			Indeno(1,2,3-cd)pyrene	2026/06/15	NC		%	40
			Dibenz(a,h)anthracene	2026/06/15	NC		%	40
			Benzo(g,h,i)perylene	2026/06/15	NC		%	40
C314723	IT1	Matrix Spike	O-TERPHENYL (sur.)	2026/06/16		124	%	60 - 140
			EPH (C10-C19)	2026/06/16		112	%	60 - 140



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314723	IT1	Spiked Blank	EPH (C19-C32)	2026/06/16		120	%	60 - 140
			O-TERPHENYL (sur.)	2026/06/15		112	%	60 - 140
			EPH (C10-C19)	2026/06/15		105	%	70 - 130
C314723	IT1	Method Blank	EPH (C19-C32)	2026/06/15		117	%	70 - 130
			O-TERPHENYL (sur.)	2026/06/15		109	%	60 - 140
			EPH (C10-C19)	2026/06/15	ND, RDL=0.20		mg/L	
C314723	IT1	RPD	EPH (C19-C32)	2026/06/15	ND, RDL=0.20		mg/L	
			EPH (C10-C19)	2026/06/16	12		%	30
			EPH (C19-C32)	2026/06/16	NC		%	30

N/A = Not Applicable

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference $\leq 2 \times$ RDL).

(1) Spike recovery exceeds acceptance criteria (high recovery). As results are non-detect, there is no impact on data quality.

(2) Method blank exceeds acceptance limits for TI- 2X RDL acceptable for low level metals determination.

(3) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.



Bureau Veritas Job #: C633706
Report Date: 2026/06/17

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

David Huang, M.Sc., P.Chem., QP, Scientific Services Manager

Levi Manchak, Project Manager SR

Luba Shymushovska, B.Sc., QP, Senior Analyst, Organics

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



Custody Tracking Form

eCOC Number

W132024

Please use this form for custody tracking when submitting the work instructions via eCOC (electronic Chain of Custody). Please ensure your form has a barcode or a Bureau Veritas eCOC confirmation number in the top right hand side. This number links your electronic submission to your samples. This form should be placed in the cooler with your samples.

Relinquished By				Received By			
Hayley Mason	JAM	Date	2026/06/09	Nata Zamora	KA	Date	2026/06/09
		Time (24 HR)	15:07			Time (24 HR)	15:07
		Date				Date	
		Time (24 HR)				Time (24 HR)	
		Date				Date	
		Time (24 HR)				Time (24 HR)	

Unless otherwise agreed to, submissions and use of services are governed by Bureau Veritas' standard terms and conditions which can be found at www.bvna.com.

Triage Information					
Sampled By (Print)	# of Coolers/Pkgs	Rush ☐	Immediate Test ☐	Food Residue ☐	Food Chemistry ☐
Hayley Mason	1	Micro ☐			



*** Laboratory Use Only ***						
Received At	Lab Comments:	Custody Seal				
	ICE frozen	Present (Y/N)	Intact (Y/N)	Cooling Media	Temperature °C	
Labeled By		N	N	Y	1	2
Verified By					10	10
					10	10
Drinking Water Metals Preservation Check Done (Circle)				YES	NO	



C633706_COC

COR FCD-00340 /5 PAGE 1 of 1


EPH in Water when PAH required Chromatogram

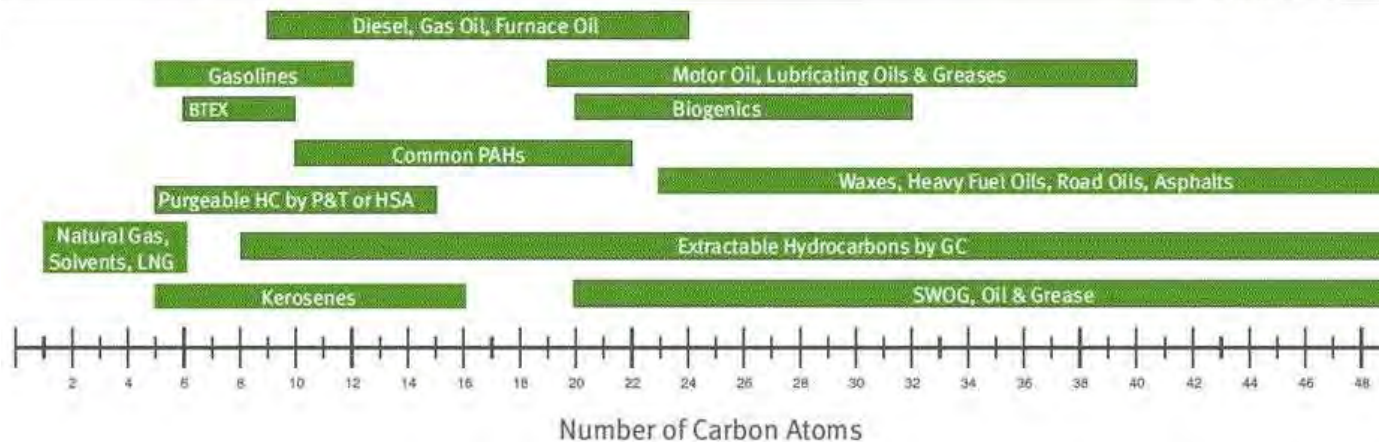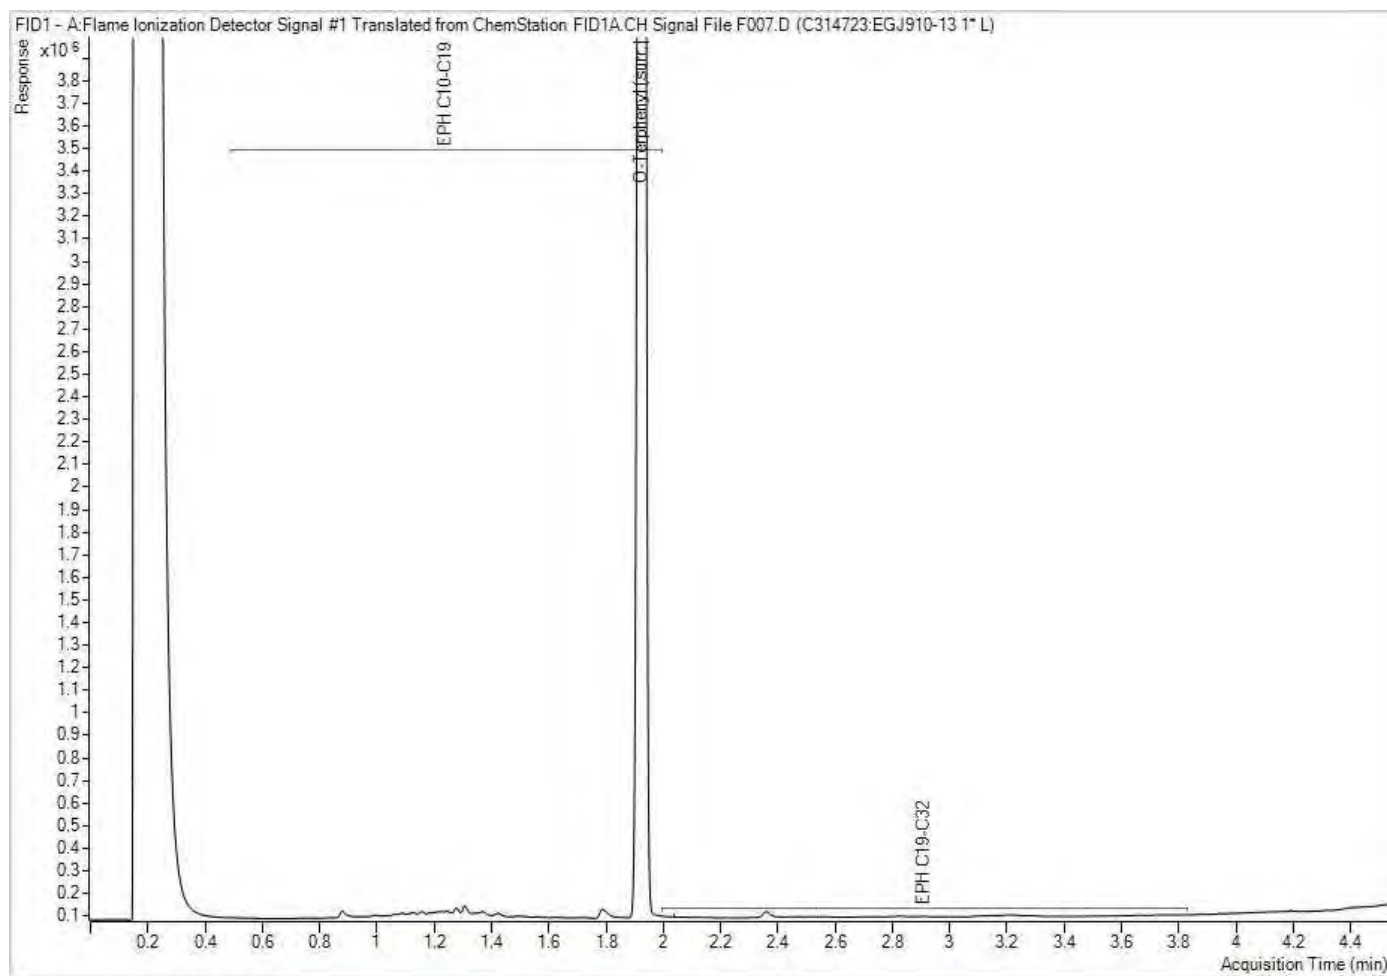

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.



eCOC: W132024



Project Information: C633706
Job Received: 2026/06/09 15:07
Expected TAT: Standard TAT
Expected Arrival: 2026/06/09 14:30
Submitted By: Jackson Macpherson
Submitted To: Burnaby ENV: 4606
Canada Way

Invoice Information

Attn: Accounts Payable
Fortis BC Energy Inc
16705 Fraser Hwy
Surrey , BC , V4N 0E8
Email to:
einvoices@fortisbc.com

Report Information

Attn: Brett Lucas
HATFIELD CONSULTANTS
200-850 Harbourside Dr
North Vancouver , BC , V7P 0A3
Email to:
blucas@hatfieldgroup.com
danielle.samels@fortisbc.com
smangwani@hatfieldgroup.com
jmacpherson@hatfieldgroup.com
swolf@hatfieldgroup.com

Project Information

Quote #: C50083
PO/AFE#: 4800010213
Project #: Fortis11234/PE-110163
Site Location: Woodfibre Pipeline Project

Analytical Summary

A: Standard TAT

Client Sample ID	Cint Ref	Sampling Date/Time	Matrix	#Cont	Woodfibre	Woodfibre Additional	Woodfibre Blank	Set Number
WLNG-DS	1	2026/06/09 09:30	WATER	14	A			1
WLNG -EOP	2	2026/06/09 09:30	WATER	18	A	A		2
WLNG-US	3	2026/06/09 09:30	WATER	14	A			1
Field Blank	4	2026/06/09 09:30	WATER	14			A	3
Trip Blank	5	2026/06/09 09:30	WATER	14			A	3

Deadlines are estimates only and are subject to change. Please refer to your Job Confirmation report for final due dates.

Submission Information

of Samples: 5

Details: **2-day turnaround time for metals samples from WLNG EOP ONLY, all other analytes and samples standard TAT **

eCOC Change Log

Modified By	Date Modified	Changes	Comments
Jackson Macpherson	08 Jun 26 15:52:26	Notes/Comments, Sample Information	Updates

Sample Set Listing

Set 1 (2 samples)	Set 2 (1 sample)	Set 3 (2 samples)
WLNG-DS WLNG-US	WLNG -EOP	Field Blank Trip Blank



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/06/24
 Report #: R3797724
 Version: 3 - Revision

CERTIFICATE OF ANALYSIS – REVISED REPORT

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07

Sample Matrix: Water
 # Samples Received: 5

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Alkalinity @25C (pp, total), CO ₃ ,HCO ₃ ,OH	5	N/A	2026/06/10	BBY6SOP-00026	SM 24 2320 B m
Chloride/Sulphate by Auto Colourimetry	5	N/A	2026/06/10	BBY6SOP-00011 / BBY6SOP-00017	SM24-4500-Cl/SO ₄ -E m
Chromium III (Calc'd)	3	N/A	2026/06/12		
Chromium III (Calc'd)	2	N/A	2026/06/15		
Total Hexavalent Chromium	5	N/A	2026/06/11	BBY6SOP-00054	SM 24 3500-Cr B m
Carbon (DOC) -Lab Filtered (2)	3	N/A	2026/06/13	BBY6SOP-00053	SM 24 5310 B m
Carbon (DOC) -Lab Filtered (2)	2	N/A	2026/06/19	BBY6SOP-00053	SM 24 5310 B m
Fluoride	5	N/A	2026/06/11	BBY6SOP-00037	SM 24 4500-F C m
Glycols in Water by GC/FID (1)	1	N/A	2026/06/15	CAL SOP-00093	BCMOE Glycols 09/17
Sulphide (as H ₂ S) (1)	5	N/A	2026/06/16		Auto Calc
Un-ionized Hydrogen Sulphide as S Calc	3	N/A	2026/06/16	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO ₃) (3)	3	N/A	2026/06/12	BBY WI-00033	Auto Calc
Hardness Total (calculated as CaCO ₃) (3)	2	N/A	2026/06/15	BBY WI-00033	Auto Calc
Hardness (calculated as CaCO ₃)	5	N/A	2026/06/12	BBY WI-00033	Auto Calc
Mercury (Dissolved) by CV-Lab Filtered	5	2026/06/11	2026/06/11	BBY7SOP-00032	BCMOE LMAug2023 C m
Mercury (Total) by CV	1	2026/06/11	2026/06/11	BBY7SOP-00032	BCMOE LMAug2023 C m
Mercury (Total) by CV	4	2026/06/12	2026/06/15	BBY7SOP-00032	BCMOE LMAug2023 C m
Bromide as Bromine (Br) by ICPMS	5	N/A	2026/06/12	BBY7SOP-00002	EPA 6020B R2 m
EPH in Water when PAH required	1	2026/06/15	2026/06/16	BBY8SOP-00029	BCMOE BCLM Sep2017 m
Na, K, Ca, Mg, S by CRC ICPMS (diss.)	5	N/A	2026/06/12	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (lab filter) (4)	5	N/A	2026/06/11	BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	1	2026/06/12	2026/06/12	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Elements by ICPMS Digested LL (total)	1	2026/06/12	2026/06/15	BBY7SOP-00003 / BBY7SOP-00002	EPA 6020b R2 m
Na, K, Ca, Mg, S by CRC ICPMS (total)	3	N/A	2026/06/12	BBY WI-00033	Auto Calc
Na, K, Ca, Mg, S by CRC ICPMS (total)	2	N/A	2026/06/15	BBY WI-00033	Auto Calc
Elements by ICPMS Low Level (total)	3	N/A	2026/06/12	BBY7SOP-00002	EPA 6020b R2 m
Nitrogen (Total)	5	N/A	2026/06/15	BBY6SOP-00016	SM 24 4500-N C m
Ammonia-N (Total)	5	N/A	2026/06/10	AB SOP-00007	SM 24 4500 NH ₃ A G m



Your P.O. #: 4800010213
 Your Project #: FORTIS11234/PE110163
 Site Location: WOODFIBRE PIPELINE PROJECT
 Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
 N. VANCOUVER
 200-850 Harbourside Dr
 North Vancouver, BC
 Canada V7P 0A3

Report Date: 2026/06/24
 Report #: R3797724
 Version: 3 - Revision

CERTIFICATE OF ANALYSIS – REVISED REPORT

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07

Sample Matrix: Water
 # Samples Received: 5

Analyses	Quantity	Date Extracted	Date Analyzed	Laboratory Method	Analytical Method
Nitrate + Nitrite (N)	5	N/A	2026/06/10	BBY6SOP-00010	SM 24 4500-NO3- H m
Nitrite (N) Regular Level Water	5	N/A	2026/06/10	BBY6SOP-00010	SM 24 4500-NO2- m
Nitrogen - Nitrate (as N)	5	N/A	2026/06/10	BBY WI-00033	Auto Calc
PAH in Water by GC/MS (SIM)	1	2026/06/15	2026/06/15	BBY8SOP-00021	BCMOE BCLM Jul2017m
Total LMW, HMW, Total PAH Calc (5)	1	N/A	2026/06/17	BBY WI-00033	Auto Calc
pH @25°C (6)	5	N/A	2026/06/10	BBY6SOP-00026	SM 24 4500-H+ B m
Phenols (4-AAP) (1)	1	N/A	2026/06/12	AB SOP-00088	EPA 9066 R0 m
Total Sulphide (1)	5	2026/06/15	2026/06/16	AB SOP-00080	SM 24 4500 S2-A D Fm
Total Dissolved Solids (Filt. Residue)	5	2026/06/10	2026/06/11	BBY6SOP-00033	SM 24 2540 C m
EPH less PAH in Water by GC/FID (7)	1	N/A	2026/06/17	BBY WI-00033	Auto Calc
Carbon (Total Organic) (8)	3	N/A	2026/06/11	BBY6SOP-00053	SM 24 5310 B m
Carbon (Total Organic) (8)	2	N/A	2026/06/19	BBY6SOP-00053	SM 24 5310 B m
Total Phosphorus Low Level Total	5	2026/06/10	2026/06/11	BBY6SOP-00013	SM 24 4500-P E m
Total Suspended Solids (NFR)	5	2026/06/10	2026/06/11	BBY6SOP-00034	SM 24 2540 D m
Field pH	3	N/A	2026/06/10	Field Test	Field Test
Field Temperature	3	N/A	2026/06/10	Field Test	Field Test
VOCs, VH, F1, LH in Water by HS GC/MS	1	N/A	2026/06/11	BBY8SOP-00009 / BBY8SOP-00011 / BBY8SOP-00012	BCMOE BCLM Jul2017 m
Volatile HC-BTEX (9)	1	N/A	2026/06/11	BBY WI-00033	Auto Calc

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, EPA, APHA or the Quebec Ministry of Environment.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report.



Your P.O. #: 4800010213
Your Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your C.O.C. #: 132024

Attention: Saeesh Mangwani

HATFIELD CONSULTANTS
N. VANCOUVER
200-850 Harbourside Dr
North Vancouver, BC
Canada V7P 0A3

Report Date: 2026/06/24
Report #: R3797724
Version: 3 - Revision

CERTIFICATE OF ANALYSIS – REVISED REPORT

BUREAU VERITAS JOB #: C633706

Received: 2026/06/09, 15:07

Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested.

This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.

- (1) This test was performed by Bureau Veritas Calgary, 4000 - 19 St. , Calgary, AB, T2E 6P8
- (2) DOC present in the sample should be considered as non-purgeable DOC. Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (3) "Total Hardness" was calculated from Total Ca and Mg concentrations and may be biased high (Hardness, or Dissolved Hardness, calculated from Dissolved Ca and Mg, should be used for compliance if available).
- (4) Samples were filtered and preserved at the lab. Values may not reflect concentrations at the time of sampling.
For Dissolved > Total Imbalance: When applicable, Dissolved and Total results were reviewed and data quality meets acceptable levels unless otherwise noted.
- (5) Total PAHs in Water include: Quinoline, Naphthalene, 1-Methylnaphthalene, 2-Methylnaphthalene, Acenaphthylene, Acenaphthene, Fluorene, Phenanthrene, Anthracene, Acridine, Fluoranthene, Pyrene, Benzo(a)anthracene, Chrysene, Benzo(b&j)fluoranthene, Benzo(k)fluoranthene, Benzo(a)pyrene, Indeno(1,2,3-cd)pyrene, Dibenz(a,h)anthracene, and Benzo(g,h,i)perylene.
- (6) The CCME method requires pH to be analysed within 15 minutes of sampling and therefore field analysis is required for compliance. All Laboratory pH analyses in this report are reported past the CCME holding time. Bureau Veritas endeavours to analyze samples as soon as possible after receipt.
- (7) LEPH = EPH (C10 to C19) - (Acenaphthene + Acridine + Anthracene + Fluorene + Naphthalene + Phenanthrene)
HEPH = EPH (C19 to C32) - (Benzo(a)anthracene + Benzo(a)pyrene + Fluoranthene + Pyrene)
- (8) TOC present in the sample should be considered as non-purgeable TOC.
- (9) VPH = VH - (Benzene + Toluene + Ethylbenzene + m & p-Xylene + o-Xylene + Styrene)

Encryption Key

Please direct all questions regarding this Certificate of Analysis to:

Levi Manchak, Senior Project Manager
Email: Levi.MANCHAK@bureauveritas.com
Phone# (780)862-5634

=====

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909		EGJ909		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30		2026/06/09 09:30		
COC Number		132024			132024		132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS REPEAT	QC Batch	WLNG-DS REPEAT	RDL	QC Batch
ANIONS									
Nitrite (N)	mg/L	0.0095	0.0050	C309867					
Calculated Parameters									
Total Chromium III	mg/L	0.0043	0.00099	C309126					
Dissolved Hardness (CaCO ₃)	mg/L	109	0.50	C307954					
Total Hardness (CaCO ₃)	mg/L	117	0.50	C309055					
Nitrate (N)	mg/L	0.477	0.020	C308150					
Sulphide (as H ₂ S)	mg/L	ND	0.0020	C308735					
Field Parameters									
Field pH	pH	7.8	N/A	ONSITE					
Field Temperature	°C	11.7	N/A	ONSITE					
Misc. Inorganics									
pH	pH	7.55	N/A	C309994					
Total Organic Carbon (C)	mg/L	30	0.50	C311273	20	C320705	23	0.50	C324088
Total Dissolved Solids	mg/L	190	10	C309788					
Total Suspended Solids	mg/L	4.4	1.0	C309407					
Lab Filtered Inorganics									
Dissolved Organic Carbon (C)	mg/L	26	0.50	C312901	18	C320686	19	0.50	C324085
Anions									
Alkalinity (PP as CaCO ₃)	mg/L	ND	1.0	C310007					
Alkalinity (Total as CaCO ₃)	mg/L	68	1.0	C310007					
Bicarbonate (HCO ₃)	mg/L	83	1.0	C310007					
Carbonate (CO ₃)	mg/L	ND	1.0	C310007					
Fluoride (F)	mg/L	0.34	0.050	C311428					
Hydroxide (OH)	mg/L	ND	1.0	C310007					
Total Sulphide	mg/L	ND	0.0018	C314396					
Chloride (Cl)	mg/L	13	1.0	C310521					
Sulphate (SO ₄)	mg/L	21	1.0	C310521					
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable									



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909		EGJ909		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30		2026/06/09 09:30		
COC Number		132024			132024		132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS REPEAT	QC Batch	WLNG-DS REPEAT	RDL	QC Batch

Metals									
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C310984					
Nutrients									
Total Ammonia (N)	mg/L	ND	0.015	C310593					
Total Phosphorus (P)	mg/L	0.0087	0.0010	C310613					
Nitrate plus Nitrite (N)	mg/L	0.487	0.020	C309857					
Total Nitrogen (N)	mg/L	0.744	0.020	C312443					
RDL = Reportable Detection Limit									
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.									



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG-DS REPEAT Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L							0.0107	0.0050	C309867
Calculated Parameters										
Total Chromium III	mg/L							0.0047	0.00099	C309126
Dissolved Hardness (CaCO ₃)	mg/L							136	0.50	C307954
Total Hardness (CaCO ₃)	mg/L							130	0.50	C309055
Nitrate (N)	mg/L							0.600	0.020	C308150
Sulphide (as H ₂ S)	mg/L							ND	0.0020	C308735
Field Parameters										
Field pH	pH							7.2	N/A	ONSITE
Field Temperature	°C							12.3	N/A	ONSITE
Misc. Inorganics										
pH	pH							7.58	N/A	C309994
Total Organic Carbon (C)	mg/L				23	0.50	C324088	50	0.50	C311273
Total Dissolved Solids	mg/L							220	10	C309788
Total Suspended Solids	mg/L	4.4	1.0	C309407				8.0	1.0	C309407
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L							36	0.50	C312901
Anions										
Alkalinity (PP as CaCO ₃)	mg/L							ND	1.0	C310007
Alkalinity (Total as CaCO ₃)	mg/L							80	1.0	C310007
Bicarbonate (HCO ₃)	mg/L							97	1.0	C310007
Carbonate (CO ₃)	mg/L							ND	1.0	C310007
Fluoride (F)	mg/L							0.39	0.050	C311428
Hydroxide (OH)	mg/L							ND	1.0	C310007
Total Sulphide	mg/L							ND	0.0018	C314668
Chloride (Cl)	mg/L							13	1.0	C310521
Sulphate (SO ₄)	mg/L							24	1.0	C310521
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable										



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG-DS REPEAT Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L							ND	0.00099	C310984
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C310593				ND	0.015	C310593
Total Phosphorus (P)	mg/L							0.013	0.0010	C310613
Nitrate plus Nitrite (N)	mg/L							0.610	0.020	C309857
Total Nitrogen (N)	mg/L	0.754	0.020	C312443				0.938	0.020	C312443
Misc. Organics										
Phenols	mg/L							ND	0.0015	C312590
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ910		EGJ910			EGJ911		
Sampling Date		2026/06/09 09:30		2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024		132024			132024		
	UNITS	WLNG -EOP REPEAT	QC Batch	WLNG -EOP REPEAT	RDL	QC Batch	WLNG-US	RDL	QC Batch
ANIONS									
Nitrite (N)	mg/L						ND	0.0050	C309867
Calculated Parameters									
Total Chromium III	mg/L						ND	0.00099	C309126
Dissolved Hardness (CaCO ₃)	mg/L						8.63	0.50	C307954
Total Hardness (CaCO ₃)	mg/L						9.15	0.50	C309055
Nitrate (N)	mg/L						0.023	0.020	C308150
Sulphide (as H ₂ S)	mg/L						ND	0.0020	C308735
Field Parameters									
Field pH	pH						7.6	N/A	ONSITE
Field Temperature	°C						11.1	N/A	ONSITE
Misc. Inorganics									
pH	pH						6.77	N/A	C309994
Total Organic Carbon (C)	mg/L	31	C320705	39	0.50	C324088	2.5	0.50	C311273
Total Dissolved Solids	mg/L						24	10	C309788
Total Suspended Solids	mg/L						ND	1.0	C309825
Lab Filtered Inorganics									
Dissolved Organic Carbon (C)	mg/L	26	C320686	29	0.50	C324085	2.3	0.50	C312901
Anions									
Alkalinity (PP as CaCO ₃)	mg/L						ND	1.0	C310007
Alkalinity (Total as CaCO ₃)	mg/L						7.4	1.0	C310007
Bicarbonate (HCO ₃)	mg/L						9.0	1.0	C310007
Carbonate (CO ₃)	mg/L						ND	1.0	C310007
Fluoride (F)	mg/L						ND	0.050	C311428
Hydroxide (OH)	mg/L						ND	1.0	C310007
Total Sulphide	mg/L						ND	0.0018	C314668
Chloride (Cl)	mg/L						ND	1.0	C310521
Sulphate (SO ₄)	mg/L						2.1	1.0	C310521
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit. N/A = Not Applicable									



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ910		EGJ910			EGJ911		
Sampling Date		2026/06/09 09:30		2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024		132024			132024		
	UNITS	WLNG -EOP REPEAT	QC Batch	WLNG -EOP REPEAT	RDL	QC Batch	WLNG-US	RDL	QC Batch

Metals									
Total Hex. Chromium (Cr 6+)	mg/L						ND	0.00099	C310984
Nutrients									
Total Ammonia (N)	mg/L						ND	0.015	C310593
Total Phosphorus (P)	mg/L						0.027	0.0010	C310613
Nitrate plus Nitrite (N)	mg/L						0.023	0.020	C309857
Total Nitrogen (N)	mg/L						0.080	0.020	C312443
RDL = Reportable Detection Limit									
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.									



RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ912			EGJ912			EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch
ANIONS										
Nitrite (N)	mg/L	ND	0.0050	C309867				ND	0.0050	C309867
Calculated Parameters										
Total Chromium III	mg/L	ND	0.00099	C309126				ND	0.00099	C309126
Dissolved Hardness (CaCO ₃)	mg/L	ND	0.50	C307954				ND	0.50	C307954
Total Hardness (CaCO ₃)	mg/L	ND	0.50	C309055				ND	0.50	C309055
Nitrate (N)	mg/L	ND	0.020	C308150				ND	0.020	C308150
Sulphide (as H ₂ S)	mg/L	ND	0.0020	C308735				ND	0.0020	C308735
Misc. Inorganics										
pH	pH	6.02	N/A	C309994				5.91	N/A	C309994
Total Organic Carbon (C)	mg/L	ND (1)	0.50	C311273	ND	0.50	C311273	ND	0.50	C311273
Total Dissolved Solids	mg/L	ND	10	C309788				ND	10	C309788
Total Suspended Solids	mg/L	ND	1.0	C309825	ND	1.0	C309825	ND	1.0	C309825
Lab Filtered Inorganics										
Dissolved Organic Carbon (C)	mg/L	ND	0.50	C312901				ND	0.50	C312901
Anions										
Alkalinity (PP as CaCO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Alkalinity (Total as CaCO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Bicarbonate (HCO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Carbonate (CO ₃)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Fluoride (F)	mg/L	ND	0.050	C311428				ND	0.050	C311428
Hydroxide (OH)	mg/L	ND	1.0	C310007				ND	1.0	C310007
Total Sulphide	mg/L	ND	0.0018	C314668	ND	0.0018	C314668	ND	0.0018	C314668
Chloride (Cl)	mg/L	ND	1.0	C310521				ND	1.0	C310521
Sulphate (SO ₄)	mg/L	ND	1.0	C310521				ND	1.0	C310521
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										
N/A = Not Applicable										
(1) Matrix spike exceeds acceptance limits due to matrix interference. Unable to reanalyze due to insufficient sample.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

RESULTS OF CHEMICAL ANALYSES OF WATER

Bureau Veritas ID		EGJ912			EGJ912			EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	Field Blank	RDL	QC Batch	Field Blank Lab-Dup	RDL	QC Batch	Trip Blank	RDL	QC Batch
Metals										
Total Hex. Chromium (Cr 6+)	mg/L	ND	0.00099	C310984	ND	0.00099	C310984	ND	0.00099	C310984
Nutrients										
Total Ammonia (N)	mg/L	ND	0.015	C310593				ND	0.015	C310593
Total Phosphorus (P)	mg/L	ND	0.0010	C310613				0.0014	0.0010	C310613
Nitrate plus Nitrite (N)	mg/L	ND	0.020	C309857				ND	0.020	C309857
Total Nitrogen (N)	mg/L	ND	0.020	C312443				ND	0.020	C312443
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

GLYCOLS BY GC-FID (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Glycols				
Ethylene Glycol	mg/L	ND	3.0	C312994
Diethylene Glycol	mg/L	ND	5.0	C312994
Triethylene Glycol	mg/L	ND	5.0	C312994
Propylene Glycol	mg/L	ND	5.0	C312994
Surrogate Recovery (%)				
Methyl Sulfone (sur.)	%	113		C312994
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

MERCURY BY COLD VAPOR (WATER)

Bureau Veritas ID		EGJ909		EGJ910			EGJ910		
Sampling Date		2026/06/09 09:30		2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024		132024			132024		
	UNITS	WLNG-DS	QC Batch	WLNG -EOP	RDL	QC Batch	WLNG -EOP Lab-Dup	RDL	QC Batch
Elements									
Total Mercury (Hg)	ug/L	ND	C313281	ND	0.0019	C311157			
Lab Filtered Elements									
Dissolved Mercury (Hg)	ug/L	ND	C311623	ND	0.0019	C311623	ND	0.0019	C311623
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.									

Bureau Veritas ID		EGJ911	EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30	2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024	132024	132024		
	UNITS	WLNG-US	Field Blank	Trip Blank	RDL	QC Batch
Elements						
Total Mercury (Hg)	ug/L	ND	ND	ND	0.0019	C313281
Lab Filtered Elements						
Dissolved Mercury (Hg)	ug/L	ND	ND	ND	0.0019	C311623
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.						



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
ANIONS										
Bromide (Br)	mg/L	ND	0.010	C313156	ND	0.010	C313156	ND	0.010	C313156
Dissolved Metals by ICPMS										
Dissolved Calcium (Ca)	mg/L	41.2	0.050	C308868				51.7	0.050	C308868
Dissolved Magnesium (Mg)	mg/L	1.51	0.050	C308868				1.72	0.050	C308868
Dissolved Potassium (K)	mg/L	1.76	0.050	C308868				2.05	0.050	C308868
Dissolved Sodium (Na)	mg/L	6.51	0.050	C308868				6.88	0.050	C308868
Dissolved Sulphur (S)	mg/L	6.8	3.0	C308868				7.8	3.0	C308868
Lab Filtered Metals										
Dissolved Aluminum (Al)	ug/L	1290	0.50	C311117				1590	0.50	C311117
Dissolved Antimony (Sb)	ug/L	0.737	0.020	C311117				0.797	0.020	C311117
Dissolved Arsenic (As)	ug/L	1.70	0.020	C311117				2.13	0.020	C311117
Dissolved Barium (Ba)	ug/L	11.2	0.020	C311117				13.6	0.020	C311117
Dissolved Beryllium (Be)	ug/L	ND	0.010	C311117				ND	0.010	C311117
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C311117				ND	0.0050	C311117
Dissolved Boron (B)	ug/L	10	10	C311117				12	10	C311117
Dissolved Cadmium (Cd)	ug/L	0.0114	0.0050	C311117				0.0092	0.0050	C311117
Dissolved Cesium (Cs)	ug/L	ND	0.050	C311117				0.056	0.050	C311117
Dissolved Chromium (Cr)	ug/L	3.93	0.10	C311117				4.91	0.10	C311117
Dissolved Cobalt (Co)	ug/L	0.0803	0.0050	C311117				0.103	0.0050	C311117
Dissolved Copper (Cu)	ug/L	0.822	0.050	C311117				0.888	0.050	C311117
Dissolved Iron (Fe)	ug/L	139	1.0	C311117				222	1.0	C311117
Dissolved Lead (Pb)	ug/L	0.0058	0.0050	C311117				0.0074	0.0050	C311117
Dissolved Lithium (Li)	ug/L	3.99	0.50	C311117				4.85	0.50	C311117
Dissolved Manganese (Mn)	ug/L	26.4	0.050	C311117				38.6	0.050	C311117
Dissolved Molybdenum (Mo)	ug/L	34.4	0.050	C311117				38.1	0.050	C311117
Dissolved Nickel (Ni)	ug/L	0.420	0.020	C311117				0.513	0.020	C311117
Dissolved Phosphorus (P)	ug/L	3.7	2.0	C311117				4.2	2.0	C311117
Dissolved Rubidium (Rb)	ug/L	4.08	0.050	C311117				4.89	0.050	C311117
Dissolved Selenium (Se)	ug/L	0.086	0.040	C311117				0.083	0.040	C311117
Dissolved Silicon (Si)	ug/L	10200	50	C311117				11700	50	C311117
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	0.0050	C311117				ND	0.0050	C311117
Dissolved Strontium (Sr)	ug/L	71.4	0.050	C311117				83.3	0.050	C311117
Dissolved Tellurium (Te)	ug/L	ND	0.020	C311117				ND	0.020	C311117
Dissolved Thallium (Tl)	ug/L	0.0097	0.0020	C311117				0.0105	0.0020	C311117
Dissolved Thorium (Th)	ug/L	0.0068	0.0050	C311117				0.0086	0.0050	C311117
Dissolved Tin (Sn)	ug/L	ND	0.20	C311117				ND	0.20	C311117
Dissolved Titanium (Ti)	ug/L	ND	0.50	C311117				ND	0.50	C311117
Dissolved Uranium (U)	ug/L	4.00	0.0020	C311117				4.20	0.0020	C311117
Dissolved Vanadium (V)	ug/L	1.96	0.20	C311117				2.57	0.20	C311117
Dissolved Zinc (Zn)	ug/L	1.45	0.10	C311117				1.93	0.10	C311117
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C311117				0.16	0.10	C311117
Total Metals by ICPMS										
Total Aluminum (Al)	ug/L	1460	3.0	C313217	1450	3.0	C313217	1640	3.0	C312375
Total Antimony (Sb)	ug/L	0.781	0.020	C313217	0.745	0.020	C313217	0.789	0.020	C312375
Total Arsenic (As)	ug/L	1.73	0.020	C313217	1.74	0.020	C313217	2.19	0.020	C312375
Total Barium (Ba)	ug/L	11.5	0.050	C313217	11.4	0.050	C313217	13.6	0.050	C312375
Total Beryllium (Be)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Bismuth (Bi)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Boron (B)	ug/L	10	10	C313217	ND	10	C313217	14	10	C312375
Total Cadmium (Cd)	ug/L	ND	0.0050	C313217	0.0052	0.0050	C313217	0.0082	0.0050	C312375
Total Cesium (Cs)	ug/L	ND	0.050	C313217	0.051	0.050	C313217	0.061	0.050	C312375
Total Chromium (Cr)	ug/L	4.29	0.10	C313217	4.22	0.10	C313217	4.71	0.10	C312375
Total Cobalt (Co)	ug/L	0.075	0.010	C313217	0.073	0.010	C313217	0.134	0.010	C312375
Total Copper (Cu)	ug/L	1.01	0.10	C313217	1.07	0.10	C313217	1.10	0.10	C312375
Total Iron (Fe)	ug/L	197	5.0	C313217	194	5.0	C313217	350	5.0	C312375
Total Lead (Pb)	ug/L	0.043	0.020	C313217	0.046	0.020	C313217	0.064	0.020	C312375
Total Lithium (Li)	ug/L	4.42	0.50	C313217	4.21	0.50	C313217	4.31	0.50	C312375
Total Manganese (Mn)	ug/L	27.3	0.10	C313217	28.0	0.10	C313217	41.1	0.10	C312375
Total Molybdenum (Mo)	ug/L	35.7	0.050	C313217	36.2	0.050	C313217	38.0	0.050	C312375
Total Nickel (Ni)	ug/L	0.42	0.10	C313217	0.41	0.10	C313217	0.47	0.10	C312375
Total Phosphorus (P)	ug/L	8.2	5.0	C313217	7.6	5.0	C313217	9.7	5.0	C312375
RDL = Reportable Detection Limit										
Lab-Dup = Laboratory Initiated Duplicate										
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ909			EGJ909			EGJ910		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30		
COC Number		132024			132024			132024		
	UNITS	WLNG-DS	RDL	QC Batch	WLNG-DS Lab-Dup	RDL	QC Batch	WLNG -EOP	RDL	QC Batch
Total Rubidium (Rb)	ug/L	4.14	0.050	C313217	4.08	0.050	C313217	4.64	0.050	C312375
Total Selenium (Se)	ug/L	0.091	0.040	C313217	0.091	0.040	C313217	0.101	0.040	C312375
Total Silicon (Si)	ug/L	10800	50	C313217	10900	50	C313217	11200	50	C312375
Total Silver (Ag)	ug/L	ND	0.010	C313217	ND	0.010	C313217	ND	0.010	C312375
Total Strontium (Sr)	ug/L	74.1	0.050	C313217	72.9	0.050	C313217	82.1	0.050	C312375
Total Tellurium (Te)	ug/L	ND	0.020	C313217	ND	0.020	C313217	ND	0.020	C312375
Total Thallium (Tl)	ug/L	0.0085	0.0020	C313217	0.0081	0.0020	C313217	0.0109	0.0020	C312375
Total Thorium (Th)	ug/L	ND	0.050	C313217	ND	0.050	C313217	ND	0.050	C312375
Total Tin (Sn)	ug/L	ND	0.20	C313217	ND	0.20	C313217	ND	0.20	C312375
Total Titanium (Ti)	ug/L	2.3	2.0	C313217	2.3	2.0	C313217	4.0	2.0	C312375
Total Uranium (U)	ug/L	4.34	0.0050	C313217	4.31	0.0050	C313217	4.20	0.0050	C312375
Total Vanadium (V)	ug/L	2.09	0.20	C313217	2.11	0.20	C313217	2.41	0.20	C312375
Total Zinc (Zn)	ug/L	2.3	1.0	C313217	2.9	1.0	C313217	3.4	1.0	C312375
Total Zirconium (Zr)	ug/L	0.13	0.10	C313217	0.14	0.10	C313217	0.14	0.10	C312375
Total Calcium (Ca)	mg/L	44.2	0.25	C309129				49.4	0.25	C309129
Total Magnesium (Mg)	mg/L	1.54	0.25	C309129				1.59	0.25	C309129
Total Potassium (K)	mg/L	1.89	0.25	C309129				1.97	0.25	C309129
Total Sodium (Na)	mg/L	6.96	0.25	C309129				6.40	0.25	C309129
Total Sulphur (S)	mg/L	7.0	3.0	C309129				6.9	3.0	C309129
RDL = Reportable Detection Limit Lab-Dup = Laboratory Initiated Duplicate ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.										



ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch

ANIONS

Bromide (Br)	mg/L	ND	0.010	C313156				ND	ND	0.010	C313156
--------------	------	----	-------	---------	--	--	--	----	----	-------	---------

Dissolved Metals by ICPMS

Dissolved Calcium (Ca)	mg/L	2.86	0.050	C308868				ND	ND	0.050	C308868
Dissolved Magnesium (Mg)	mg/L	0.363	0.050	C308868				ND	ND	0.050	C308868
Dissolved Potassium (K)	mg/L	0.233	0.050	C308868				ND	ND	0.050	C308868
Dissolved Sodium (Na)	mg/L	1.55	0.050	C308868				ND	ND	0.050	C308868
Dissolved Sulphur (S)	mg/L	ND	3.0	C308868				ND	ND	3.0	C308868

Lab Filtered Metals

Dissolved Aluminum (Al)	ug/L	40.6	0.50	C311117				ND	ND	0.50	C311117
Dissolved Antimony (Sb)	ug/L	0.030	0.020	C311117				ND	ND	0.020	C311117
Dissolved Arsenic (As)	ug/L	0.144	0.020	C311117				ND	ND	0.020	C311117
Dissolved Barium (Ba)	ug/L	4.21	0.020	C311117				ND	ND	0.020	C311117
Dissolved Beryllium (Be)	ug/L	0.011	0.010	C311117				ND	ND	0.010	C311117
Dissolved Bismuth (Bi)	ug/L	ND	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Boron (B)	ug/L	ND	10	C311117				ND	ND	10	C311117
Dissolved Cadmium (Cd)	ug/L	0.0059	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Cesium (Cs)	ug/L	ND	0.050	C311117				ND	ND	0.050	C311117
Dissolved Chromium (Cr)	ug/L	ND	0.10	C311117				ND	ND	0.10	C311117
Dissolved Cobalt (Co)	ug/L	0.0272	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Copper (Cu)	ug/L	0.737	0.050	C311117				ND	ND	0.050	C311117
Dissolved Iron (Fe)	ug/L	23.9	1.0	C311117				ND	ND	1.0	C311117
Dissolved Lead (Pb)	ug/L	0.0126	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Lithium (Li)	ug/L	ND	0.50	C311117				ND	ND	0.50	C311117
Dissolved Manganese (Mn)	ug/L	0.847	0.050	C311117				ND	ND	0.050	C311117
Dissolved Molybdenum (Mo)	ug/L	0.671	0.050	C311117				ND	ND	0.050	C311117
Dissolved Nickel (Ni)	ug/L	0.306	0.020	C311117				ND	ND	0.020	C311117
Dissolved Phosphorus (P)	ug/L	21.9	2.0	C311117				2.7	ND	2.0	C311117
Dissolved Rubidium (Rb)	ug/L	0.422	0.050	C311117				ND	ND	0.050	C311117
Dissolved Selenium (Se)	ug/L	ND	0.040	C311117				ND	ND	0.040	C311117
Dissolved Silicon (Si)	ug/L	4290	50	C311117				ND	ND	50	C311117

RDL = Reportable Detection Limit

Lab-Dup = Laboratory Initiated Duplicate

ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Dissolved Silver (Ag)	ug/L	ND	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Strontium (Sr)	ug/L	13.1	0.050	C311117				ND	ND	0.050	C311117
Dissolved Tellurium (Te)	ug/L	ND	0.020	C311117				ND	ND	0.020	C311117
Dissolved Thallium (Tl)	ug/L	0.0026	0.0020	C311117				ND	0.0021	0.0020	C311117
Dissolved Thorium (Th)	ug/L	0.0088	0.0050	C311117				ND	ND	0.0050	C311117
Dissolved Tin (Sn)	ug/L	ND	0.20	C311117				ND	ND	0.20	C311117
Dissolved Titanium (Ti)	ug/L	ND	0.50	C311117				ND	ND	0.50	C311117
Dissolved Uranium (U)	ug/L	0.0544	0.0020	C311117				ND	ND	0.0020	C311117
Dissolved Vanadium (V)	ug/L	ND	0.20	C311117				ND	ND	0.20	C311117
Dissolved Zinc (Zn)	ug/L	0.77	0.10	C311117				ND	ND	0.10	C311117
Dissolved Zirconium (Zr)	ug/L	ND	0.10	C311117				ND	ND	0.10	C311117
Total Metals by ICPMS											
Total Aluminum (Al)	ug/L	76.8	0.50	C311597	76.8	0.50	C311597	ND	ND	0.50	C311597
Total Antimony (Sb)	ug/L	0.036	0.020	C311597	0.038	0.020	C311597	ND	ND	0.020	C311597
Total Arsenic (As)	ug/L	0.145	0.020	C311597	0.145	0.020	C311597	ND	ND	0.020	C311597
Total Barium (Ba)	ug/L	4.96	0.020	C311597	5.06	0.020	C311597	ND	ND	0.020	C311597
Total Beryllium (Be)	ug/L	ND	0.010	C311597	ND	0.010	C311597	ND	ND	0.010	C311597
Total Bismuth (Bi)	ug/L	ND	0.0050	C311597	ND	0.0050	C311597	ND	ND	0.0050	C311597
Total Boron (B)	ug/L	ND	10	C311597	ND	10	C311597	ND	ND	10	C311597
Total Cadmium (Cd)	ug/L	0.0073	0.0050	C311597	0.0065	0.0050	C311597	ND	ND	0.0050	C311597
Total Cesium (Cs)	ug/L	ND	0.050	C311597	ND	0.050	C311597	ND	ND	0.050	C311597
Total Chromium (Cr)	ug/L	ND	0.10	C311597	ND	0.10	C311597	ND	ND	0.10	C311597
Total Cobalt (Co)	ug/L	0.0295	0.0050	C311597	0.0350	0.0050	C311597	ND	ND	0.0050	C311597
Total Copper (Cu)	ug/L	0.776	0.050	C311597	0.837	0.050	C311597	ND	ND	0.050	C311597
Total Iron (Fe)	ug/L	58.5	1.0	C311597	57.2	1.0	C311597	ND	ND	1.0	C311597
Total Lead (Pb)	ug/L	0.0248	0.0050	C311597	0.0249	0.0050	C311597	ND	ND	0.0050	C311597
Total Lithium (Li)	ug/L	ND	0.50	C311597	ND	0.50	C311597	ND	ND	0.50	C311597
Total Manganese (Mn)	ug/L	1.96	0.050	C311597	1.87	0.050	C311597	ND	ND	0.050	C311597
Total Molybdenum (Mo)	ug/L	0.704	0.050	C311597	0.699	0.050	C311597	ND	ND	0.050	C311597
Total Nickel (Ni)	ug/L	0.231	0.020	C311597	0.249	0.020	C311597	ND	ND	0.020	C311597
Total Phosphorus (P)	ug/L	23.7	2.0	C311597	24.3	2.0	C311597	2.6	ND	2.0	C311597
RDL = Reportable Detection Limit											
Lab-Dup = Laboratory Initiated Duplicate											
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Bureau Veritas ID		EGJ911			EGJ911			EGJ912	EGJ913		
Sampling Date		2026/06/09 09:30			2026/06/09 09:30			2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024			132024			132024	132024		
	UNITS	WLNG-US	RDL	QC Batch	WLNG-US Lab-Dup	RDL	QC Batch	Field Blank	Trip Blank	RDL	QC Batch
Total Rubidium (Rb)	ug/L	0.506	0.050	C311597	0.501	0.050	C311597	ND	ND	0.050	C311597
Total Selenium (Se)	ug/L	ND	0.040	C311597	ND	0.040	C311597	ND	ND	0.040	C311597
Total Silicon (Si)	ug/L	4230	50	C311597	4170	50	C311597	ND	ND	50	C311597
Total Silver (Ag)	ug/L	ND	0.0050	C311597	ND	0.0050	C311597	ND	ND	0.0050	C311597
Total Strontium (Sr)	ug/L	13.8	0.050	C311597	14.0	0.050	C311597	0.054	ND	0.050	C311597
Total Tellurium (Te)	ug/L	ND	0.020	C311597	ND	0.020	C311597	ND	ND	0.020	C311597
Total Thallium (Tl)	ug/L	0.0029	0.0020	C311597	0.0030	0.0020	C311597	ND	0.0039	0.0020	C311597
Total Thorium (Th)	ug/L	ND	0.050	C311597	ND	0.050	C311597	ND	ND	0.050	C311597
Total Tin (Sn)	ug/L	ND	0.20	C311597	ND	0.20	C311597	ND	ND	0.20	C311597
Total Titanium (Ti)	ug/L	1.49	0.50	C311597	1.34	0.50	C311597	ND	ND	0.50	C311597
Total Uranium (U)	ug/L	0.0696	0.0020	C311597	0.0689	0.0020	C311597	ND	ND	0.0020	C311597
Total Vanadium (V)	ug/L	0.23	0.20	C311597	0.24	0.20	C311597	ND	ND	0.20	C311597
Total Zinc (Zn)	ug/L	1.28	0.10	C311597	1.29	0.10	C311597	ND	ND	0.10	C311597
Total Zirconium (Zr)	ug/L	ND	0.10	C311597	ND	0.10	C311597	ND	ND	0.10	C311597
Total Calcium (Ca)	mg/L	3.03	0.050	C309129				ND	ND	0.050	C309129
Total Magnesium (Mg)	mg/L	0.384	0.050	C309129				ND	ND	0.050	C309129
Total Potassium (K)	mg/L	0.258	0.050	C309129				ND	ND	0.050	C309129
Total Sodium (Na)	mg/L	1.64	0.050	C309129				ND	ND	0.050	C309129
Total Sulphur (S)	mg/L	ND	3.0	C309129				ND	ND	3.0	C309129
RDL = Reportable Detection Limit											
Lab-Dup = Laboratory Initiated Duplicate											
ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.											



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

MISCELLANEOUS (WATER)

Bureau Veritas ID		EGJ909	EGJ910	EGJ911		
Sampling Date		2026/06/09 09:30	2026/06/09 09:30	2026/06/09 09:30		
COC Number		132024	132024	132024		
	UNITS	WLNG-DS	WLNG -EOP	WLNG-US	RDL	QC Batch
Calculated Parameters						
Total Un-ionized Hydrogen Sulfide as S	mg/L	ND	ND	ND	0.0018	C309128
Total Un-ionized Hydrogen Sulfide as H2S	mg/L	ND	ND	ND	0.0019	C309128
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.						



LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Calculated Parameters				
Low Molecular Weight PAH's	ug/L	ND	0.10	C307964
High Molecular Weight PAH's	ug/L	ND	0.050	C307964
Total PAH	ug/L	ND	0.10	C307964
Polycyclic Aromatics				
Quinoline	ug/L	ND	0.020	C314719
Naphthalene	ug/L	ND	0.10	C314719
1-Methylnaphthalene	ug/L	ND	0.050	C314719
2-Methylnaphthalene	ug/L	ND	0.10	C314719
Acenaphthylene	ug/L	ND	0.050	C314719
Acenaphthene	ug/L	ND	0.050	C314719
Fluorene	ug/L	ND	0.050	C314719
Phenanthrene	ug/L	ND	0.050	C314719
Anthracene	ug/L	ND	0.010	C314719
Acridine	ug/L	ND	0.050	C314719
Fluoranthene	ug/L	ND	0.020	C314719
Pyrene	ug/L	ND	0.020	C314719
Benzo(a)anthracene	ug/L	ND	0.010	C314719
Chrysene	ug/L	ND	0.020	C314719
Benzo(b&j)fluoranthene	ug/L	ND	0.030	C314719
Benzo(k)fluoranthene	ug/L	ND	0.050	C314719
Benzo(a)pyrene	ug/L	ND	0.0050	C314719
Indeno(1,2,3-cd)pyrene	ug/L	ND	0.050	C314719
Dibenz(a,h)anthracene	ug/L	ND	0.0030	C314719
Benzo(g,h,i)perylene	ug/L	ND	0.050	C314719
Calculated Parameters				
LEPH (C10-C19 less PAH)	mg/L	0.27	0.20	C307965
HEPH (C19-C32 less PAH)	mg/L	ND	0.20	C307965
Ext. Pet. Hydrocarbon				
EPH (C10-C19)	mg/L	0.27	0.20	C314723
EPH (C19-C32)	mg/L	ND	0.20	C314723
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

LEPH & HEPH WITH CSR/CCME PAH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Surrogate Recovery (%)				
O-TERPHENYL (sur.)	%	122		C314723
D10-ANTHRACENE (sur.)	%	105		C314719
D8-ACENAPHTHYLENE (sur.)	%	96		C314719
D8-NAPHTHALENE (sur.)	%	76		C314719
TERPHENYL-D14 (sur.)	%	83		C314719
RDL = Reportable Detection Limit				



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Calculated Parameters				
VPH (VH6 to 10 - BTEX)	ug/L	ND	300	C308003
Volatiles				
VH C6-C10	ug/L	ND	300	C309739
1,1,1,2-tetrachloroethane	ug/L	ND	0.50	C309739
1,1,1-trichloroethane	ug/L	ND	0.50	C309739
1,1,2,2-tetrachloroethane	ug/L	ND	0.50	C309739
1,1,2Trichloro-1,2,2Trifluoroethane	ug/L	ND	2.0	C309739
1,1,2-trichloroethane	ug/L	ND	0.50	C309739
1,1-dichloroethane	ug/L	ND	0.50	C309739
1,1-dichloroethene	ug/L	ND	0.50	C309739
1,2,3-trichlorobenzene	ug/L	ND	2.0	C309739
1,2,4-trichlorobenzene	ug/L	ND	2.0	C309739
1,2-dibromoethane	ug/L	ND	0.20	C309739
1,2-dichlorobenzene	ug/L	ND	0.50	C309739
1,2-dichloroethane	ug/L	ND	0.50	C309739
1,2-dichloropropane	ug/L	ND	0.50	C309739
1,3,5-trimethylbenzene	ug/L	ND	2.0	C309739
1,3-Butadiene	ug/L	ND	0.50	C309739
1,3-dichlorobenzene	ug/L	ND	0.50	C309739
1,3-dichloropropane	ug/L	ND	1.0	C309739
1,4-dichlorobenzene	ug/L	ND	0.50	C309739
Benzene	ug/L	ND	0.40	C309739
Bromobenzene	ug/L	ND	2.0	C309739
Bromodichloromethane	ug/L	ND	1.0	C309739
Bromoform	ug/L	ND	1.0	C309739
Bromomethane	ug/L	ND	1.0	C309739
Carbon tetrachloride	ug/L	ND	0.50	C309739
Chlorobenzene	ug/L	ND	0.50	C309739
Dibromochloromethane	ug/L	ND	1.0	C309739
Chloroethane	ug/L	ND	1.0	C309739
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



CSR VOC + VPH IN WATER (WATER)

Bureau Veritas ID		EGJ910		
Sampling Date		2026/06/09 09:30		
COC Number		132024		
	UNITS	WLNG -EOP	RDL	QC Batch
Chloroform	ug/L	ND	1.0	C309739
Chloromethane	ug/L	ND	1.0	C309739
cis-1,2-dichloroethene	ug/L	ND	1.0	C309739
cis-1,3-dichloropropene	ug/L	ND	1.0	C309739
Dichlorodifluoromethane	ug/L	ND	2.0	C309739
Dichloromethane	ug/L	ND	2.0	C309739
Ethylbenzene	ug/L	ND	0.40	C309739
Hexachlorobutadiene	ug/L	ND	0.50	C309739
Isopropylbenzene	ug/L	ND	2.0	C309739
Methyl-tert-butylether (MTBE)	ug/L	ND	4.0	C309739
Styrene	ug/L	ND	0.50	C309739
Tetrachloroethene	ug/L	ND	0.50	C309739
Toluene	ug/L	ND	0.40	C309739
trans-1,2-dichloroethene	ug/L	ND	1.0	C309739
trans-1,3-dichloropropene	ug/L	ND	1.0	C309739
Trichloroethene	ug/L	ND	0.50	C309739
Trichlorofluoromethane	ug/L	ND	4.0	C309739
Vinyl chloride	ug/L	ND	0.50	C309739
m & p-Xylene	ug/L	ND	0.40	C309739
o-Xylene	ug/L	ND	0.40	C309739
Xylenes (Total)	ug/L	ND	0.40	C309739
Surrogate Recovery (%)				
1,4-Difluorobenzene (sur.)	%	102		C309739
4-Bromofluorobenzene (sur.)	%	87		C309739
D4-1,2-Dichloroethane (sur.)	%	119		C309739
RDL = Reportable Detection Limit ND = Not Detected at a concentration equal or greater than the indicated Detection Limit.				



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

GENERAL COMMENTS

Revision: Report includes revised data for TOC and DOC on samples WLNG-DS and WLNG-EOP. Request for re-analysis was received from client on 2026/06/23.

Results relate only to the items tested.



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309407	SPP	Matrix Spike [EGJ910-02]	Total Suspended Solids	2026/06/11		108	%	80 - 120
C309407	SPP	Spiked Blank	Total Suspended Solids	2026/06/11		100	%	80 - 120
C309407	SPP	Method Blank	Total Suspended Solids	2026/06/11	ND, RDL=1.0		mg/L	
C309407	SPP	RPD [EGJ909-02]	Total Suspended Solids	2026/06/11	0		%	20
C309739	DWL	Matrix Spike	1,4-Difluorobenzene (sur.)	2026/06/11		99	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		102	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		92	%	50 - 140
			1,1,1,2-tetrachloroethane	2026/06/11		90	%	50 - 140
			1,1,1-trichloroethane	2026/06/11		96	%	50 - 140
			1,1,2,2-tetrachloroethane	2026/06/11		91	%	50 - 140
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11		93	%	50 - 140
			1,1,2-trichloroethane	2026/06/11		93	%	50 - 140
			1,1-dichloroethane	2026/06/11		102	%	50 - 140
			1,1-dichloroethene	2026/06/11		114	%	50 - 140
			1,2,3-trichlorobenzene	2026/06/11		100	%	50 - 140
			1,2,4-trichlorobenzene	2026/06/11		98	%	50 - 140
			1,2-dibromoethane	2026/06/11		94	%	50 - 140
			1,2-dichlorobenzene	2026/06/11		101	%	50 - 140
			1,2-dichloroethane	2026/06/11		92	%	50 - 140
			1,2-dichloropropane	2026/06/11		95	%	50 - 140
			1,3,5-trimethylbenzene	2026/06/11		109	%	50 - 140
			1,3-Butadiene	2026/06/11		133	%	50 - 140
			1,3-dichlorobenzene	2026/06/11		101	%	50 - 140
			1,3-dichloropropane	2026/06/11		94	%	50 - 140
			1,4-dichlorobenzene	2026/06/11		97	%	50 - 140
			Benzene	2026/06/11		96	%	50 - 140
			Bromobenzene	2026/06/11		97	%	50 - 140
			Bromodichloromethane	2026/06/11		92	%	50 - 140
			Bromoform	2026/06/11		92	%	50 - 140
			Bromomethane	2026/06/11		87	%	50 - 140
			Carbon tetrachloride	2026/06/11		95	%	50 - 140
			Chlorobenzene	2026/06/11		91	%	50 - 140
			Dibromochloromethane	2026/06/11		91	%	50 - 140
			Chloroethane	2026/06/11		87	%	50 - 140
			Chloroform	2026/06/11		93	%	50 - 140
			Chloromethane	2026/06/11		95	%	50 - 140
			cis-1,2-dichloroethene	2026/06/11		95	%	50 - 140
			cis-1,3-dichloropropene	2026/06/11		88	%	50 - 140
			Dichlorodifluoromethane	2026/06/11		77	%	50 - 140
			Dichloromethane	2026/06/11		89	%	50 - 140
			Ethylbenzene	2026/06/11		95	%	50 - 140
			Hexachlorobutadiene	2026/06/11		94	%	50 - 140
			Isopropylbenzene	2026/06/11		97	%	50 - 140
			Methyl-tert-butylether (MTBE)	2026/06/11		81	%	50 - 140
			Styrene	2026/06/11		83	%	50 - 140
			Tetrachloroethene	2026/06/11		92	%	50 - 140
			Toluene	2026/06/11		76	%	50 - 140
			trans-1,2-dichloroethene	2026/06/11		99	%	50 - 140
			trans-1,3-dichloropropene	2026/06/11		78	%	50 - 140
			Trichloroethene	2026/06/11		92	%	50 - 140
			Trichlorofluoromethane	2026/06/11		92	%	50 - 140
			Vinyl chloride	2026/06/11		98	%	50 - 140



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309739	DWL	Spiked Blank	m & p-Xylene	2026/06/11		99	%	50 - 140
			o-Xylene	2026/06/11		81	%	50 - 140
			1,4-Difluorobenzene (sur.)	2026/06/11		99	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		84	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		102	%	50 - 140
			VH C6-C10	2026/06/11		116	%	70 - 130
			1,1,1,2-tetrachloroethane	2026/06/11		93	%	60 - 130
			1,1,1-trichloroethane	2026/06/11		101	%	60 - 130
			1,1,2,2-tetrachloroethane	2026/06/11		92	%	60 - 130
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11		97	%	60 - 130
			1,1,2-trichloroethane	2026/06/11		97	%	60 - 130
			1,1-dichloroethane	2026/06/11		107	%	60 - 130
			1,1-dichloroethene	2026/06/11		119	%	60 - 130
			1,2,3-trichlorobenzene	2026/06/11		102	%	60 - 130
			1,2,4-trichlorobenzene	2026/06/11		102	%	60 - 130
			1,2-dibromoethane	2026/06/11		97	%	60 - 130
			1,2-dichlorobenzene	2026/06/11		103	%	60 - 130
			1,2-dichloroethane	2026/06/11		93	%	60 - 130
			1,2-dichloropropane	2026/06/11		100	%	60 - 130
			1,3,5-trimethylbenzene	2026/06/11		114	%	60 - 130
			1,3-Butadiene	2026/06/11		143 (1)	%	50 - 140
			1,3-dichlorobenzene	2026/06/11		104	%	60 - 130
			1,3-dichloropropane	2026/06/11		96	%	60 - 130
			1,4-dichlorobenzene	2026/06/11		100	%	60 - 130
			Benzene	2026/06/11		100	%	60 - 130
			Bromobenzene	2026/06/11		101	%	60 - 130
			Bromodichloromethane	2026/06/11		95	%	60 - 130
			Bromoform	2026/06/11		93	%	60 - 130
			Bromomethane	2026/06/11		92	%	50 - 140
			Carbon tetrachloride	2026/06/11		99	%	60 - 130
			Chlorobenzene	2026/06/11		95	%	60 - 130
			Dibromochloromethane	2026/06/11		90	%	60 - 130
			Chloroethane	2026/06/11		83	%	50 - 140
			Chloroform	2026/06/11		95	%	60 - 130
			Chloromethane	2026/06/11		101	%	50 - 140
			cis-1,2-dichloroethene	2026/06/11		98	%	60 - 130
			cis-1,3-dichloropropene	2026/06/11		90	%	50 - 140
			Dichlorodifluoromethane	2026/06/11		83	%	50 - 140
			Dichloromethane	2026/06/11		92	%	60 - 130
			Ethylbenzene	2026/06/11		100	%	60 - 130
			Hexachlorobutadiene	2026/06/11		98	%	60 - 130
			Isopropylbenzene	2026/06/11		102	%	60 - 130
			Methyl-tert-butylether (MTBE)	2026/06/11		85	%	60 - 130
			Styrene	2026/06/11		88	%	60 - 130
			Tetrachloroethene	2026/06/11		97	%	60 - 130
			Toluene	2026/06/11		80	%	60 - 130
			trans-1,2-dichloroethene	2026/06/11		104	%	60 - 130
			trans-1,3-dichloropropene	2026/06/11		80	%	50 - 140
			Trichloroethene	2026/06/11		96	%	60 - 130
			Trichlorofluoromethane	2026/06/11		97	%	60 - 130
			Vinyl chloride	2026/06/11		104	%	50 - 140
			m & p-Xylene	2026/06/11		104	%	60 - 130
			o-Xylene	2026/06/11		86	%	60 - 130



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309739	DWL	Method Blank	1,4-Difluorobenzene (sur.)	2026/06/11		103	%	50 - 140
			4-Bromofluorobenzene (sur.)	2026/06/11		86	%	50 - 140
			D4-1,2-Dichloroethane (sur.)	2026/06/11		111	%	50 - 140
			VH C6-C10	2026/06/11	ND, RDL=300		ug/L	
			1,1,1,2-tetrachloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,1-trichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,2,2-tetrachloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1,2Trichloro-1,2,2Trifluoroethane	2026/06/11	ND, RDL=2.0		ug/L	
			1,1,2-trichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1-dichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,1-dichloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			1,2,3-trichlorobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,2,4-trichlorobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,2-dibromoethane	2026/06/11	ND, RDL=0.20		ug/L	
			1,2-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			1,2-dichloroethane	2026/06/11	ND, RDL=0.50		ug/L	
			1,2-dichloropropane	2026/06/11	ND, RDL=0.50		ug/L	
			1,3,5-trimethylbenzene	2026/06/11	ND, RDL=2.0		ug/L	
			1,3-Butadiene	2026/06/11	ND, RDL=0.50		ug/L	
			1,3-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			1,3-dichloropropane	2026/06/11	ND, RDL=1.0		ug/L	
			1,4-dichlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			Benzene	2026/06/11	ND, RDL=0.40		ug/L	
			Bromobenzene	2026/06/11	ND, RDL=2.0		ug/L	
			Bromodichloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			Bromoform	2026/06/11	ND, RDL=1.0		ug/L	
			Bromomethane	2026/06/11	ND, RDL=1.0		ug/L	
			Carbon tetrachloride	2026/06/11	ND, RDL=0.50		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C309739	DWL	RPD	Chlorobenzene	2026/06/11	ND, RDL=0.50		ug/L	
			Dibromochloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			Chloroethane	2026/06/11	ND, RDL=1.0		ug/L	
			Chloroform	2026/06/11	ND, RDL=1.0		ug/L	
			Chloromethane	2026/06/11	ND, RDL=1.0		ug/L	
			cis-1,2-dichloroethene	2026/06/11	ND, RDL=1.0		ug/L	
			cis-1,3-dichloropropene	2026/06/11	ND, RDL=1.0		ug/L	
			Dichlorodifluoromethane	2026/06/11	ND, RDL=2.0		ug/L	
			Dichloromethane	2026/06/11	ND, RDL=2.0		ug/L	
			Ethylbenzene	2026/06/11	ND, RDL=0.40		ug/L	
			Hexachlorobutadiene	2026/06/11	ND, RDL=0.50		ug/L	
			Isopropylbenzene	2026/06/11	ND, RDL=2.0		ug/L	
			Methyl-tert-butylether (MTBE)	2026/06/11	ND, RDL=4.0		ug/L	
			Styrene	2026/06/11	ND, RDL=0.50		ug/L	
			Tetrachloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			Toluene	2026/06/11	ND, RDL=0.40		ug/L	
			trans-1,2-dichloroethene	2026/06/11	ND, RDL=1.0		ug/L	
			trans-1,3-dichloropropene	2026/06/11	ND, RDL=1.0		ug/L	
			Trichloroethene	2026/06/11	ND, RDL=0.50		ug/L	
			Trichlorofluoromethane	2026/06/11	ND, RDL=4.0		ug/L	
			Vinyl chloride	2026/06/11	ND, RDL=0.50		ug/L	
			m & p-Xylene	2026/06/11	ND, RDL=0.40		ug/L	
			o-Xylene	2026/06/11	ND, RDL=0.40		ug/L	
			Xylenes (Total)	2026/06/11	ND, RDL=0.40		ug/L	
			VH C6-C10	2026/06/11	NC		%	30
			1,2-dibromoethane	2026/06/11	NC		%	30
			1,2-dichloroethane	2026/06/11	NC		%	30
			1,3,5-trimethylbenzene	2026/06/11	NC		%	30
			1,3-Butadiene	2026/06/11	NC		%	30
			Benzene	2026/06/11	NC		%	30



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Ethylbenzene	2026/06/11	NC		%	30
			Isopropylbenzene	2026/06/11	NC		%	30
			Methyl-tert-butylether (MTBE)	2026/06/11	NC		%	30
			Styrene	2026/06/11	NC		%	30
			Toluene	2026/06/11	NC		%	30
			m & p-Xylene	2026/06/11	NC		%	30
			o-Xylene	2026/06/11	NC		%	30
			Xylenes (Total)	2026/06/11	NC		%	30
C309788	SPP	Matrix Spike	Total Dissolved Solids	2026/06/11		97	%	80 - 120
C309788	SPP	Spiked Blank	Total Dissolved Solids	2026/06/11		98	%	80 - 120
C309788	SPP	Method Blank	Total Dissolved Solids	2026/06/11	ND, RDL=10		mg/L	
C309788	SPP	RPD	Total Dissolved Solids	2026/06/11	0		%	20
C309825	SPP	Matrix Spike [EGJ913-02]	Total Suspended Solids	2026/06/11		104	%	80 - 120
C309825	SPP	Spiked Blank	Total Suspended Solids	2026/06/11		105	%	80 - 120
C309825	SPP	Method Blank	Total Suspended Solids	2026/06/11	ND, RDL=1.0		mg/L	
C309825	SPP	RPD [EGJ912-02]	Total Suspended Solids	2026/06/11	NC		%	20
C309857	JGL	Matrix Spike	Nitrate plus Nitrite (N)	2026/06/10		108	%	80 - 120
C309857	JGL	Spiked Blank	Nitrate plus Nitrite (N)	2026/06/10		107	%	80 - 120
C309857	JGL	Method Blank	Nitrate plus Nitrite (N)	2026/06/10	ND, RDL=0.020		mg/L	
C309857	JGL	RPD	Nitrate plus Nitrite (N)	2026/06/10	4.8		%	20
C309867	JGL	Matrix Spike	Nitrite (N)	2026/06/10		106	%	80 - 120
C309867	JGL	Spiked Blank	Nitrite (N)	2026/06/10		103	%	80 - 120
C309867	JGL	Method Blank	Nitrite (N)	2026/06/10	ND, RDL=0.0050		mg/L	
C309867	JGL	RPD	Nitrite (N)	2026/06/10	NC		%	20
C309994	BTM	Spiked Blank	pH	2026/06/10		100	%	97 - 103
C309994	BTM	RPD	pH	2026/06/10	0.16		%	N/A
C310007	BTM	Spiked Blank	Alkalinity (Total as CaCO3)	2026/06/10		98	%	80 - 120
C310007	BTM	Method Blank	Alkalinity (PP as CaCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Alkalinity (Total as CaCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Bicarbonate (HCO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Carbonate (CO3)	2026/06/10	ND, RDL=1.0		mg/L	
			Hydroxide (OH)	2026/06/10	ND, RDL=1.0		mg/L	
C310007	BTM	RPD	Alkalinity (PP as CaCO3)	2026/06/10	NC		%	20
			Alkalinity (Total as CaCO3)	2026/06/10	0.30		%	20
			Bicarbonate (HCO3)	2026/06/10	0.30		%	20
			Carbonate (CO3)	2026/06/10	NC		%	20
			Hydroxide (OH)	2026/06/10	NC		%	20
C310521	CBK	Matrix Spike	Chloride (Cl)	2026/06/10		NC	%	80 - 120
			Sulphate (SO4)	2026/06/10		NC	%	80 - 120
C310521	CBK	Spiked Blank	Chloride (Cl)	2026/06/10		103	%	80 - 120
			Sulphate (SO4)	2026/06/10		86	%	80 - 120
C310521	CBK	Method Blank	Chloride (Cl)	2026/06/10	ND, RDL=1.0		mg/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Sulphate (SO4)	2026/06/10	ND, RDL=1.0		mg/L	
C310521	CBK	RPD	Sulphate (SO4)	2026/06/10	4.8		%	20
C310593	TSO	Matrix Spike [EGJ909-05]	Total Ammonia (N)	2026/06/10		93	%	80 - 120
C310593	TSO	Spiked Blank	Total Ammonia (N)	2026/06/10		103	%	80 - 120
C310593	TSO	Method Blank	Total Ammonia (N)	2026/06/10	ND, RDL=0.015		mg/L	
C310593	TSO	RPD [EGJ909-05]	Total Ammonia (N)	2026/06/10	NC		%	20
C310613	KA5	Matrix Spike	Total Phosphorus (P)	2026/06/11		119	%	N/A
C310613	KA5	Spiked Blank	Total Phosphorus (P)	2026/06/11		114	%	80 - 120
C310613	KA5	Method Blank	Total Phosphorus (P)	2026/06/11	ND, RDL=0.0010		mg/L	
C310613	KA5	RPD	Total Phosphorus (P)	2026/06/11	13		%	20
C310984	JGL	Matrix Spike [EGJ912-09]	Total Hex. Chromium (Cr 6+)	2026/06/11		106	%	80 - 120
C310984	JGL	Spiked Blank	Total Hex. Chromium (Cr 6+)	2026/06/11		101	%	80 - 120
C310984	JGL	Method Blank	Total Hex. Chromium (Cr 6+)	2026/06/11	ND, RDL=0.00099		mg/L	
C310984	JGL	RPD [EGJ912-09]	Total Hex. Chromium (Cr 6+)	2026/06/11	NC		%	20
C311117	AA1	Matrix Spike	Dissolved Aluminum (Al)	2026/06/11		95	%	80 - 120
			Dissolved Antimony (Sb)	2026/06/11		96	%	80 - 120
			Dissolved Arsenic (As)	2026/06/11		103	%	80 - 120
			Dissolved Barium (Ba)	2026/06/11		98	%	80 - 120
			Dissolved Beryllium (Be)	2026/06/11		91	%	80 - 120
			Dissolved Bismuth (Bi)	2026/06/11		93	%	80 - 120
			Dissolved Boron (B)	2026/06/11		90	%	80 - 120
			Dissolved Cadmium (Cd)	2026/06/11		99	%	80 - 120
			Dissolved Cesium (Cs)	2026/06/11		98	%	80 - 120
			Dissolved Chromium (Cr)	2026/06/11		96	%	80 - 120
			Dissolved Cobalt (Co)	2026/06/11		92	%	80 - 120
			Dissolved Copper (Cu)	2026/06/11		90	%	80 - 120
			Dissolved Iron (Fe)	2026/06/11		97	%	80 - 120
			Dissolved Lead (Pb)	2026/06/11		93	%	80 - 120
			Dissolved Lithium (Li)	2026/06/11		85	%	80 - 120
			Dissolved Manganese (Mn)	2026/06/11		91	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/06/11		NC	%	80 - 120
			Dissolved Nickel (Ni)	2026/06/11		91	%	80 - 120
			Dissolved Phosphorus (P)	2026/06/11		106	%	80 - 120
			Dissolved Rubidium (Rb)	2026/06/11		NC	%	80 - 120
			Dissolved Selenium (Se)	2026/06/11		101	%	80 - 120
			Dissolved Silicon (Si)	2026/06/11		102	%	80 - 120
			Dissolved Silver (Ag)	2026/06/11		94	%	80 - 120
			Dissolved Strontium (Sr)	2026/06/11		NC	%	80 - 120
			Dissolved Tellurium (Te)	2026/06/11		106	%	80 - 120
			Dissolved Thallium (Tl)	2026/06/11		96	%	80 - 120
			Dissolved Thorium (Th)	2026/06/11		101	%	80 - 120
			Dissolved Tin (Sn)	2026/06/11		99	%	80 - 120
			Dissolved Titanium (Ti)	2026/06/11		102	%	80 - 120
			Dissolved Uranium (U)	2026/06/11		99	%	80 - 120
			Dissolved Vanadium (V)	2026/06/11		99	%	80 - 120
			Dissolved Zinc (Zn)	2026/06/11		93	%	80 - 120
			Dissolved Zirconium (Zr)	2026/06/11		104	%	80 - 120
C311117	AA1	Spiked Blank	Dissolved Aluminum (Al)	2026/06/11		99	%	80 - 120
			Dissolved Antimony (Sb)	2026/06/11		99	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Arsenic (As)	2026/06/11		102	%	80 - 120
			Dissolved Barium (Ba)	2026/06/11		100	%	80 - 120
			Dissolved Beryllium (Be)	2026/06/11		95	%	80 - 120
			Dissolved Bismuth (Bi)	2026/06/11		96	%	80 - 120
			Dissolved Boron (B)	2026/06/11		95	%	80 - 120
			Dissolved Cadmium (Cd)	2026/06/11		99	%	80 - 120
			Dissolved Cesium (Cs)	2026/06/11		99	%	80 - 120
			Dissolved Chromium (Cr)	2026/06/11		100	%	80 - 120
			Dissolved Cobalt (Co)	2026/06/11		100	%	80 - 120
			Dissolved Copper (Cu)	2026/06/11		98	%	80 - 120
			Dissolved Iron (Fe)	2026/06/11		98	%	80 - 120
			Dissolved Lead (Pb)	2026/06/11		96	%	80 - 120
			Dissolved Lithium (Li)	2026/06/11		92	%	80 - 120
			Dissolved Manganese (Mn)	2026/06/11		99	%	80 - 120
			Dissolved Molybdenum (Mo)	2026/06/11		100	%	80 - 120
			Dissolved Nickel (Ni)	2026/06/11		98	%	80 - 120
			Dissolved Phosphorus (P)	2026/06/11		99	%	80 - 120
			Dissolved Rubidium (Rb)	2026/06/11		102	%	80 - 120
			Dissolved Selenium (Se)	2026/06/11		99	%	80 - 120
			Dissolved Silicon (Si)	2026/06/11		99	%	80 - 120
			Dissolved Silver (Ag)	2026/06/11		96	%	80 - 120
			Dissolved Strontium (Sr)	2026/06/11		98	%	80 - 120
			Dissolved Tellurium (Te)	2026/06/11		100	%	80 - 120
			Dissolved Thallium (Tl)	2026/06/11		98	%	80 - 120
			Dissolved Thorium (Th)	2026/06/11		99	%	80 - 120
			Dissolved Tin (Sn)	2026/06/11		100	%	80 - 120
			Dissolved Titanium (Ti)	2026/06/11		105	%	80 - 120
			Dissolved Uranium (U)	2026/06/11		98	%	80 - 120
			Dissolved Vanadium (V)	2026/06/11		101	%	80 - 120
			Dissolved Zinc (Zn)	2026/06/11		97	%	80 - 120
			Dissolved Zirconium (Zr)	2026/06/11		99	%	80 - 120
C311117	AA1	Method Blank	Dissolved Aluminum (Al)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Antimony (Sb)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Arsenic (As)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Barium (Ba)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Beryllium (Be)	2026/06/11	ND, RDL=0.010		ug/L	
			Dissolved Bismuth (Bi)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Boron (B)	2026/06/11	ND, RDL=10		ug/L	
			Dissolved Cadmium (Cd)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Cesium (Cs)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Chromium (Cr)	2026/06/11	ND, RDL=0.10		ug/L	
			Dissolved Cobalt (Co)	2026/06/11	ND, RDL=0.0050		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Copper (Cu)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Iron (Fe)	2026/06/11	ND, RDL=1.0		ug/L	
			Dissolved Lead (Pb)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Lithium (Li)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Manganese (Mn)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Molybdenum (Mo)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Nickel (Ni)	2026/06/11	0.024, RDL=0.020 (2)		ug/L	
			Dissolved Phosphorus (P)	2026/06/11	ND, RDL=2.0		ug/L	
			Dissolved Rubidium (Rb)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Selenium (Se)	2026/06/11	ND, RDL=0.040		ug/L	
			Dissolved Silicon (Si)	2026/06/11	ND, RDL=50		ug/L	
			Dissolved Silver (Ag)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Strontium (Sr)	2026/06/11	ND, RDL=0.050		ug/L	
			Dissolved Tellurium (Te)	2026/06/11	ND, RDL=0.020		ug/L	
			Dissolved Thallium (Tl)	2026/06/11	ND, RDL=0.0020		ug/L	
			Dissolved Thorium (Th)	2026/06/11	ND, RDL=0.0050		ug/L	
			Dissolved Tin (Sn)	2026/06/11	ND, RDL=0.20		ug/L	
			Dissolved Titanium (Ti)	2026/06/11	ND, RDL=0.50		ug/L	
			Dissolved Uranium (U)	2026/06/11	ND, RDL=0.0020		ug/L	
			Dissolved Vanadium (V)	2026/06/11	ND, RDL=0.20		ug/L	
			Dissolved Zinc (Zn)	2026/06/11	ND, RDL=0.10		ug/L	
			Dissolved Zirconium (Zr)	2026/06/11	ND, RDL=0.10		ug/L	
C311117	AA1	RPD	Dissolved Aluminum (Al)	2026/06/11	4.6		%	20
			Dissolved Antimony (Sb)	2026/06/11	0.21		%	20
			Dissolved Arsenic (As)	2026/06/11	0.70		%	20
			Dissolved Barium (Ba)	2026/06/11	2.3		%	20
			Dissolved Beryllium (Be)	2026/06/11	NC		%	20
			Dissolved Boron (B)	2026/06/11	2.3		%	20
			Dissolved Cadmium (Cd)	2026/06/11	1.5		%	20
			Dissolved Chromium (Cr)	2026/06/11	NC		%	20
			Dissolved Cobalt (Co)	2026/06/11	0.16		%	20
			Dissolved Copper (Cu)	2026/06/11	2.3		%	20



Bureau Veritas Job #: C633706

Report Date: 2026/06/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Dissolved Iron (Fe)	2026/06/11	2.1		%	20
			Dissolved Lead (Pb)	2026/06/11	3.5		%	20
			Dissolved Lithium (Li)	2026/06/11	3.3		%	20
			Dissolved Manganese (Mn)	2026/06/11	0.80		%	20
			Dissolved Molybdenum (Mo)	2026/06/11	0.31		%	20
			Dissolved Nickel (Ni)	2026/06/11	0.68		%	20
			Dissolved Selenium (Se)	2026/06/11	1.1		%	20
			Dissolved Silver (Ag)	2026/06/11	NC		%	20
			Dissolved Strontium (Sr)	2026/06/11	0.23		%	20
			Dissolved Thallium (Tl)	2026/06/11	12		%	20
			Dissolved Tin (Sn)	2026/06/11	NC		%	20
			Dissolved Titanium (Ti)	2026/06/11	NC		%	20
			Dissolved Uranium (U)	2026/06/11	0		%	20
			Dissolved Vanadium (V)	2026/06/11	0.57		%	20
			Dissolved Zinc (Zn)	2026/06/11	4.0		%	20
C311157	IC4	Matrix Spike	Total Mercury (Hg)	2026/06/11		99	%	80 - 120
C311157	IC4	Spiked Blank	Total Mercury (Hg)	2026/06/11		98	%	80 - 120
C311157	IC4	Method Blank	Total Mercury (Hg)	2026/06/11	ND, RDL=0.0019		ug/L	
C311157	IC4	RPD	Total Mercury (Hg)	2026/06/11	0.85		%	20
C311273	CJY	Matrix Spike [EGJ912-04]	Total Organic Carbon (C)	2026/06/11		131 (3)	%	80 - 120
C311273	CJY	Spiked Blank	Total Organic Carbon (C)	2026/06/11		118	%	80 - 120
C311273	CJY	Method Blank	Total Organic Carbon (C)	2026/06/11	ND, RDL=0.50		mg/L	
C311273	CJY	RPD [EGJ912-04]	Total Organic Carbon (C)	2026/06/11	NC		%	20
C311428	BTM	Matrix Spike	Dissolved Fluoride (F)	2026/06/11		93	%	80 - 120
C311428	BTM	Spiked Blank	Dissolved Fluoride (F)	2026/06/11		102	%	80 - 120
C311428	BTM	Method Blank	Dissolved Fluoride (F)	2026/06/11	ND, RDL=0.050		mg/L	
C311428	BTM	RPD	Fluoride (F)	2026/06/11	NC		%	20
C311597	AA1	Matrix Spike [EGJ911-10]	Total Aluminum (Al)	2026/06/12		99	%	80 - 120
			Total Antimony (Sb)	2026/06/12		106	%	80 - 120
			Total Arsenic (As)	2026/06/12		103	%	80 - 120
			Total Barium (Ba)	2026/06/12		104	%	80 - 120
			Total Beryllium (Be)	2026/06/12		103	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		100	%	80 - 120
			Total Boron (B)	2026/06/12		105	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		101	%	80 - 120
			Total Cesium (Cs)	2026/06/12		105	%	80 - 120
			Total Chromium (Cr)	2026/06/12		99	%	80 - 120
			Total Cobalt (Co)	2026/06/12		94	%	80 - 120
			Total Copper (Cu)	2026/06/12		97	%	80 - 120
			Total Iron (Fe)	2026/06/12		99	%	80 - 120
			Total Lead (Pb)	2026/06/12		97	%	80 - 120
			Total Lithium (Li)	2026/06/12		101	%	80 - 120
			Total Manganese (Mn)	2026/06/12		98	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		101	%	80 - 120
			Total Nickel (Ni)	2026/06/12		97	%	80 - 120
			Total Phosphorus (P)	2026/06/12		100	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		105	%	80 - 120
			Total Selenium (Se)	2026/06/12		102	%	80 - 120
			Total Silicon (Si)	2026/06/12		102	%	80 - 120
			Total Silver (Ag)	2026/06/12		98	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C311597	AA1	Spiked Blank	Total Strontium (Sr)	2026/06/12		96	%	80 - 120
			Total Tellurium (Te)	2026/06/12		104	%	80 - 120
			Total Thallium (Tl)	2026/06/12		100	%	80 - 120
			Total Thorium (Th)	2026/06/12		107	%	80 - 120
			Total Tin (Sn)	2026/06/12		99	%	80 - 120
			Total Titanium (Ti)	2026/06/12		99	%	80 - 120
			Total Uranium (U)	2026/06/12		105	%	80 - 120
			Total Vanadium (V)	2026/06/12		100	%	80 - 120
			Total Zinc (Zn)	2026/06/12		99	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		102	%	80 - 120
			Total Aluminum (Al)	2026/06/12		103	%	80 - 120
			Total Antimony (Sb)	2026/06/12		109	%	80 - 120
			Total Arsenic (As)	2026/06/12		104	%	80 - 120
			Total Barium (Ba)	2026/06/12		108	%	80 - 120
			Total Beryllium (Be)	2026/06/12		102	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		103	%	80 - 120
			Total Boron (B)	2026/06/12		105	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		108	%	80 - 120
			Total Chromium (Cr)	2026/06/12		104	%	80 - 120
			Total Cobalt (Co)	2026/06/12		98	%	80 - 120
			Total Copper (Cu)	2026/06/12		101	%	80 - 120
			Total Iron (Fe)	2026/06/12		107	%	80 - 120
			Total Lead (Pb)	2026/06/12		100	%	80 - 120
			Total Lithium (Li)	2026/06/12		101	%	80 - 120
			Total Manganese (Mn)	2026/06/12		102	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		108	%	80 - 120
			Total Nickel (Ni)	2026/06/12		101	%	80 - 120
			Total Phosphorus (P)	2026/06/12		100	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		110	%	80 - 120
			Total Selenium (Se)	2026/06/12		105	%	80 - 120
			Total Silicon (Si)	2026/06/12		104	%	80 - 120
			Total Silver (Ag)	2026/06/12		101	%	80 - 120
			Total Strontium (Sr)	2026/06/12		103	%	80 - 120
			Total Tellurium (Te)	2026/06/12		103	%	80 - 120
			Total Thallium (Tl)	2026/06/12		101	%	80 - 120
			Total Thorium (Th)	2026/06/12		109	%	80 - 120
			Total Tin (Sn)	2026/06/12		106	%	80 - 120
			Total Titanium (Ti)	2026/06/12		105	%	80 - 120
			Total Uranium (U)	2026/06/12		111	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		104	%	80 - 120
C311597	AA1	Method Blank	Total Aluminum (Al)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Antimony (Sb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Beryllium (Be)	2026/06/12	ND, RDL=0.010		ug/L	



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Bismuth (Bi)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Boron (B)	2026/06/12	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Copper (Cu)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Iron (Fe)	2026/06/12	ND, RDL=1.0		ug/L	
			Total Lead (Pb)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Lithium (Li)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Molybdenum (Mo)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Phosphorus (P)	2026/06/12	ND, RDL=2.0		ug/L	
			Total Rubidium (Rb)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/12	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/12	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Strontium (Sr)	2026/06/12	0.067, RDL=0.050 (2)		ug/L	
			Total Tellurium (Te)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Uranium (U)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Vanadium (V)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/12	ND, RDL=0.10		ug/L	



Bureau Veritas Job #: C633706

Report Date: 2026/06/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Zirconium (Zr)	2026/06/12	ND, RDL=0.10		ug/L	
C311597	AA1	RPD [EGJ911-10]	Total Aluminum (Al)	2026/06/12	0.0014		%	20
			Total Antimony (Sb)	2026/06/12	5.2		%	20
			Total Arsenic (As)	2026/06/12	0.62		%	20
			Total Barium (Ba)	2026/06/12	1.9		%	20
			Total Beryllium (Be)	2026/06/12	NC		%	20
			Total Bismuth (Bi)	2026/06/12	NC		%	20
			Total Boron (B)	2026/06/12	NC		%	20
			Total Cadmium (Cd)	2026/06/12	12		%	20
			Total Cesium (Cs)	2026/06/12	NC		%	20
			Total Chromium (Cr)	2026/06/12	NC		%	20
			Total Cobalt (Co)	2026/06/12	17		%	20
			Total Copper (Cu)	2026/06/12	7.5		%	20
			Total Iron (Fe)	2026/06/12	2.1		%	20
			Total Lead (Pb)	2026/06/12	0.40		%	20
			Total Lithium (Li)	2026/06/12	NC		%	20
			Total Manganese (Mn)	2026/06/12	4.5		%	20
			Total Molybdenum (Mo)	2026/06/12	0.73		%	20
			Total Nickel (Ni)	2026/06/12	7.6		%	20
			Total Phosphorus (P)	2026/06/12	2.6		%	20
			Total Rubidium (Rb)	2026/06/12	1.1		%	20
			Total Selenium (Se)	2026/06/12	NC		%	20
			Total Silicon (Si)	2026/06/12	1.4		%	20
			Total Silver (Ag)	2026/06/12	NC		%	20
			Total Strontium (Sr)	2026/06/12	1.0		%	20
			Total Tellurium (Te)	2026/06/12	NC		%	20
			Total Thallium (Tl)	2026/06/12	3.4		%	20
			Total Thorium (Th)	2026/06/12	NC		%	20
			Total Tin (Sn)	2026/06/12	NC		%	20
			Total Titanium (Ti)	2026/06/12	11		%	20
			Total Uranium (U)	2026/06/12	1.0		%	20
			Total Vanadium (V)	2026/06/12	6.0		%	20
			Total Zinc (Zn)	2026/06/12	0.086		%	20
			Total Zirconium (Zr)	2026/06/12	NC		%	20
C311623	IC4	Matrix Spike [EGJ910-07]	Dissolved Mercury (Hg)	2026/06/11		98	%	80 - 120
C311623	IC4	Spiked Blank	Dissolved Mercury (Hg)	2026/06/11		95	%	80 - 120
C311623	IC4	Method Blank	Dissolved Mercury (Hg)	2026/06/11	ND, RDL=0.0019		ug/L	
C311623	IC4	RPD [EGJ910-07]	Dissolved Mercury (Hg)	2026/06/11	NC		%	20
C312375	AA1	Matrix Spike [EGJ910-10]	Total Aluminum (Al)	2026/06/12		NC	%	80 - 120
			Total Antimony (Sb)	2026/06/12		104	%	80 - 120
			Total Arsenic (As)	2026/06/12		108	%	80 - 120
			Total Barium (Ba)	2026/06/12		104	%	80 - 120
			Total Beryllium (Be)	2026/06/12		97	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		94	%	80 - 120
			Total Boron (B)	2026/06/12		96	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		104	%	80 - 120
			Total Chromium (Cr)	2026/06/12		100	%	80 - 120
			Total Cobalt (Co)	2026/06/12		100	%	80 - 120
			Total Copper (Cu)	2026/06/12		98	%	80 - 120
			Total Iron (Fe)	2026/06/12		105	%	80 - 120



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	Spiked Blank	Total Lead (Pb)	2026/06/12		94	%	80 - 120
			Total Lithium (Li)	2026/06/12		91	%	80 - 120
			Total Manganese (Mn)	2026/06/12		98	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		NC	%	80 - 120
			Total Nickel (Ni)	2026/06/12		97	%	80 - 120
			Total Phosphorus (P)	2026/06/12		103	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		106	%	80 - 120
			Total Selenium (Se)	2026/06/12		106	%	80 - 120
			Total Silicon (Si)	2026/06/12		NC	%	80 - 120
			Total Silver (Ag)	2026/06/12		102	%	80 - 120
			Total Strontium (Sr)	2026/06/12		NC	%	80 - 120
			Total Tellurium (Te)	2026/06/12		106	%	80 - 120
			Total Thallium (Tl)	2026/06/12		96	%	80 - 120
			Total Thorium (Th)	2026/06/12		98	%	80 - 120
			Total Tin (Sn)	2026/06/12		100	%	80 - 120
			Total Titanium (Ti)	2026/06/12		107	%	80 - 120
			Total Uranium (U)	2026/06/12		96	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		99	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		110	%	80 - 120
			Total Aluminum (Al)	2026/06/12		100	%	80 - 120
			Total Antimony (Sb)	2026/06/12		104	%	80 - 120
			Total Arsenic (As)	2026/06/12		107	%	80 - 120
			Total Barium (Ba)	2026/06/12		105	%	80 - 120
			Total Beryllium (Be)	2026/06/12		96	%	80 - 120
			Total Bismuth (Bi)	2026/06/12		103	%	80 - 120
			Total Boron (B)	2026/06/12		98	%	80 - 120
			Total Cadmium (Cd)	2026/06/12		105	%	80 - 120
			Total Cesium (Cs)	2026/06/12		104	%	80 - 120
			Total Chromium (Cr)	2026/06/12		102	%	80 - 120
			Total Cobalt (Co)	2026/06/12		103	%	80 - 120
			Total Copper (Cu)	2026/06/12		102	%	80 - 120
			Total Iron (Fe)	2026/06/12		106	%	80 - 120
			Total Lead (Pb)	2026/06/12		101	%	80 - 120
			Total Lithium (Li)	2026/06/12		93	%	80 - 120
			Total Manganese (Mn)	2026/06/12		103	%	80 - 120
			Total Molybdenum (Mo)	2026/06/12		107	%	80 - 120
			Total Nickel (Ni)	2026/06/12		101	%	80 - 120
			Total Phosphorus (P)	2026/06/12		102	%	80 - 120
			Total Rubidium (Rb)	2026/06/12		108	%	80 - 120
			Total Selenium (Se)	2026/06/12		105	%	80 - 120
			Total Silicon (Si)	2026/06/12		106	%	80 - 120
			Total Silver (Ag)	2026/06/12		102	%	80 - 120
			Total Strontium (Sr)	2026/06/12		107	%	80 - 120
			Total Tellurium (Te)	2026/06/12		108	%	80 - 120
			Total Thallium (Tl)	2026/06/12		102	%	80 - 120
			Total Thorium (Th)	2026/06/12		105	%	80 - 120
			Total Tin (Sn)	2026/06/12		105	%	80 - 120
			Total Titanium (Ti)	2026/06/12		105	%	80 - 120
			Total Uranium (U)	2026/06/12		105	%	80 - 120
			Total Vanadium (V)	2026/06/12		104	%	80 - 120
			Total Zinc (Zn)	2026/06/12		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/12		107	%	80 - 120



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	Method Blank	Total Aluminum (Al)	2026/06/12	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Boron (B)	2026/06/12	ND, RDL=10		ug/L	
			Total Cadmium (Cd)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/06/12	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/06/12	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/06/12	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/12	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/12	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/12	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/06/12	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/06/12	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/12	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/12	ND, RDL=0.050		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312375	AA1	RPD	Total Tin (Sn)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/12	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/06/12	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/06/12	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/12	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/06/12	ND, RDL=0.10		ug/L	
			Total Aluminum (Al)	2026/06/12	2.8		%	20
			Total Antimony (Sb)	2026/06/12	0.13		%	20
			Total Arsenic (As)	2026/06/12	0.48		%	20
			Total Barium (Ba)	2026/06/12	0.81		%	20
			Total Beryllium (Be)	2026/06/12	NC		%	20
			Total Bismuth (Bi)	2026/06/12	NC		%	20
			Total Boron (B)	2026/06/12	1.1		%	20
			Total Cadmium (Cd)	2026/06/12	8.9		%	20
			Total Chromium (Cr)	2026/06/12	NC		%	20
			Total Cobalt (Co)	2026/06/12	4.3		%	20
			Total Copper (Cu)	2026/06/12	2.6		%	20
			Total Iron (Fe)	2026/06/12	12		%	20
			Total Lead (Pb)	2026/06/12	5.7		%	20
			Total Lithium (Li)	2026/06/12	0.31		%	20
			Total Manganese (Mn)	2026/06/12	0.18		%	20
			Total Molybdenum (Mo)	2026/06/12	0.76		%	20
			Total Nickel (Ni)	2026/06/12	0.41		%	20
			Total Selenium (Se)	2026/06/12	1.4		%	20
			Total Silver (Ag)	2026/06/12	NC		%	20
			Total Strontium (Sr)	2026/06/12	0.10		%	20
			Total Thallium (Tl)	2026/06/12	15		%	20
			Total Tin (Sn)	2026/06/12	NC		%	20
			Total Titanium (Ti)	2026/06/12	8.9		%	20
			Total Uranium (U)	2026/06/12	3.5		%	20
			Total Vanadium (V)	2026/06/12	NC		%	20
			Total Zinc (Zn)	2026/06/12	NC		%	20
C312443	TSO	Matrix Spike [EGJ909-04]	Total Nitrogen (N)	2026/06/15		97	%	80 - 120
C312443	TSO	Spiked Blank	Total Nitrogen (N)	2026/06/15		101	%	80 - 120
C312443	TSO	Method Blank	Total Nitrogen (N)	2026/06/15	ND, RDL=0.020		mg/L	
C312443	TSO	RPD [EGJ909-04]	Total Nitrogen (N)	2026/06/15	1.4		%	20
C312590	MDO	Matrix Spike	Phenols	2026/06/12		103	%	80 - 120
C312590	MDO	Spiked Blank	Phenols	2026/06/12		104	%	80 - 120
C312590	MDO	Method Blank	Phenols	2026/06/12	ND, RDL=0.0015		mg/L	
C312590	MDO	RPD	Phenols	2026/06/12	NC		%	20
C312901	CJY	Spiked Blank	Dissolved Organic Carbon (C)	2026/06/13		108	%	80 - 120
C312901	CJY	Method Blank	Dissolved Organic Carbon (C)	2026/06/13	ND, RDL=0.50		mg/L	
C312994	AAX	Matrix Spike	Methyl Sulfone (sur.)	2026/06/15		97	%	50 - 140
			Ethylene Glycol	2026/06/15		86	%	60 - 140



Bureau Veritas Job #: C633706

Report Date: 2026/06/24

HATFIELD CONSULTANTS

Client Project #: FORTIS11234/PE110163

Site Location: WOODFIBRE PIPELINE PROJECT

Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C312994	AAX	Spiked Blank	Diethylene Glycol	2026/06/15		99	%	60 - 140
			Triethylene Glycol	2026/06/15		75	%	60 - 140
			Propylene Glycol	2026/06/15		87	%	60 - 140
			Methyl Sulfone (sur.)	2026/06/15		100	%	50 - 140
			Ethylene Glycol	2026/06/15		87	%	70 - 130
			Diethylene Glycol	2026/06/15		102	%	70 - 130
C312994	AAX	Method Blank	Triethylene Glycol	2026/06/15		90	%	70 - 130
			Propylene Glycol	2026/06/15		91	%	70 - 130
			Methyl Sulfone (sur.)	2026/06/15		103	%	50 - 140
			Ethylene Glycol	2026/06/15	ND, RDL=3.0		mg/L	
			Diethylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
			Triethylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
C312994	AAX	RPD	Propylene Glycol	2026/06/15	ND, RDL=5.0		mg/L	
			Ethylene Glycol	2026/06/15	NC		%	30
			Diethylene Glycol	2026/06/15	NC		%	30
			Triethylene Glycol	2026/06/15	NC		%	30
			Propylene Glycol	2026/06/15	NC		%	30
			Bromide (Br)	2026/06/12		84	%	78 - 120
C313156	SOM	Matrix Spike [EGJ909-12]	Bromide (Br)	2026/06/12		97	%	80 - 120
C313156	SOM	Spiked Blank	Bromide (Br)	2026/06/12				
C313156	SOM	Method Blank	Bromide (Br)	2026/06/12	ND, RDL=0.010		mg/L	
C313156	SOM	RPD [EGJ909-12]	Bromide (Br)	2026/06/12	NC		%	20
C313217	AA1	Matrix Spike [EGJ909-10]	Total Aluminum (Al)	2026/06/15		NC	%	80 - 120
			Total Antimony (Sb)	2026/06/15		103	%	80 - 120
			Total Arsenic (As)	2026/06/15		106	%	80 - 120
			Total Barium (Ba)	2026/06/15		100	%	80 - 120
			Total Beryllium (Be)	2026/06/15		99	%	80 - 120
			Total Bismuth (Bi)	2026/06/15		96	%	80 - 120
			Total Boron (B)	2026/06/15		103	%	80 - 120
			Total Cadmium (Cd)	2026/06/15		102	%	80 - 120
			Total Cesium (Cs)	2026/06/15		99	%	80 - 120
			Total Chromium (Cr)	2026/06/15		105	%	80 - 120
			Total Cobalt (Co)	2026/06/15		100	%	80 - 120
			Total Copper (Cu)	2026/06/15		98	%	80 - 120
			Total Iron (Fe)	2026/06/15		105	%	80 - 120
			Total Lead (Pb)	2026/06/15		95	%	80 - 120
			Total Lithium (Li)	2026/06/15		103	%	80 - 120
			Total Manganese (Mn)	2026/06/15		103	%	80 - 120
			Total Molybdenum (Mo)	2026/06/15		NC	%	80 - 120
			Total Nickel (Ni)	2026/06/15		100	%	80 - 120
			Total Phosphorus (P)	2026/06/15		109	%	80 - 120
			Total Rubidium (Rb)	2026/06/15		111	%	80 - 120
			Total Selenium (Se)	2026/06/15		106	%	80 - 120
			Total Silicon (Si)	2026/06/15		NC	%	80 - 120
			Total Silver (Ag)	2026/06/15		101	%	80 - 120
			Total Strontium (Sr)	2026/06/15		NC	%	80 - 120
			Total Tellurium (Te)	2026/06/15		100	%	80 - 120
			Total Thallium (Tl)	2026/06/15		100	%	80 - 120
			Total Thorium (Th)	2026/06/15		99	%	80 - 120



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C313217	AA1	Spiked Blank	Total Tin (Sn)	2026/06/15		102	%	80 - 120
			Total Titanium (Ti)	2026/06/15		105	%	80 - 120
			Total Uranium (U)	2026/06/15		104	%	80 - 120
			Total Vanadium (V)	2026/06/15		108	%	80 - 120
			Total Zinc (Zn)	2026/06/15		102	%	80 - 120
			Total Zirconium (Zr)	2026/06/15		108	%	80 - 120
			Total Aluminum (Al)	2026/06/15		102	%	80 - 120
			Total Antimony (Sb)	2026/06/15		103	%	80 - 120
			Total Arsenic (As)	2026/06/15		102	%	80 - 120
			Total Barium (Ba)	2026/06/15		102	%	80 - 120
			Total Beryllium (Be)	2026/06/15		95	%	80 - 120
			Total Bismuth (Bi)	2026/06/15		99	%	80 - 120
			Total Boron (B)	2026/06/15		96	%	80 - 120
			Total Cadmium (Cd)	2026/06/15		100	%	80 - 120
			Total Cesium (Cs)	2026/06/15		99	%	80 - 120
			Total Chromium (Cr)	2026/06/15		104	%	80 - 120
			Total Cobalt (Co)	2026/06/15		99	%	80 - 120
			Total Copper (Cu)	2026/06/15		98	%	80 - 120
			Total Iron (Fe)	2026/06/15		106	%	80 - 120
			Total Lead (Pb)	2026/06/15		98	%	80 - 120
			Total Lithium (Li)	2026/06/15		97	%	80 - 120
			Total Manganese (Mn)	2026/06/15		99	%	80 - 120
			Total Molybdenum (Mo)	2026/06/15		106	%	80 - 120
			Total Nickel (Ni)	2026/06/15		101	%	80 - 120
			Total Phosphorus (P)	2026/06/15		104	%	80 - 120
			Total Rubidium (Rb)	2026/06/15		100	%	80 - 120
			Total Selenium (Se)	2026/06/15		103	%	80 - 120
			Total Silicon (Si)	2026/06/15		108	%	80 - 120
			Total Silver (Ag)	2026/06/15		98	%	80 - 120
			Total Strontium (Sr)	2026/06/15		103	%	80 - 120
			Total Tellurium (Te)	2026/06/15		103	%	80 - 120
			Total Thallium (Tl)	2026/06/15		101	%	80 - 120
			Total Thorium (Th)	2026/06/15		100	%	80 - 120
			Total Tin (Sn)	2026/06/15		101	%	80 - 120
			Total Titanium (Ti)	2026/06/15		106	%	80 - 120
			Total Uranium (U)	2026/06/15		105	%	80 - 120
			Total Vanadium (V)	2026/06/15		103	%	80 - 120
			Total Zinc (Zn)	2026/06/15		103	%	80 - 120
			Total Zirconium (Zr)	2026/06/15		104	%	80 - 120
C313217	AA1	Method Blank	Total Aluminum (Al)	2026/06/15	ND, RDL=3.0		ug/L	
			Total Antimony (Sb)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Arsenic (As)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Barium (Ba)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Beryllium (Be)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Bismuth (Bi)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Boron (B)	2026/06/15	ND, RDL=10		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Cadmium (Cd)	2026/06/15	ND, RDL=0.0050		ug/L	
			Total Cesium (Cs)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Chromium (Cr)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Cobalt (Co)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Copper (Cu)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Iron (Fe)	2026/06/15	ND, RDL=5.0		ug/L	
			Total Lead (Pb)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Lithium (Li)	2026/06/15	ND, RDL=0.50		ug/L	
			Total Manganese (Mn)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Molybdenum (Mo)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Nickel (Ni)	2026/06/15	ND, RDL=0.10		ug/L	
			Total Phosphorus (P)	2026/06/15	ND, RDL=5.0		ug/L	
			Total Rubidium (Rb)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Selenium (Se)	2026/06/15	ND, RDL=0.040		ug/L	
			Total Silicon (Si)	2026/06/15	ND, RDL=50		ug/L	
			Total Silver (Ag)	2026/06/15	ND, RDL=0.010		ug/L	
			Total Strontium (Sr)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Tellurium (Te)	2026/06/15	ND, RDL=0.020		ug/L	
			Total Thallium (Tl)	2026/06/15	ND, RDL=0.0020		ug/L	
			Total Thorium (Th)	2026/06/15	ND, RDL=0.050		ug/L	
			Total Tin (Sn)	2026/06/15	ND, RDL=0.20		ug/L	
			Total Titanium (Ti)	2026/06/15	ND, RDL=2.0		ug/L	
			Total Uranium (U)	2026/06/15	ND, RDL=0.0050		ug/L	
			Total Vanadium (V)	2026/06/15	ND, RDL=0.20		ug/L	
			Total Zinc (Zn)	2026/06/15	ND, RDL=1.0		ug/L	
			Total Zirconium (Zr)	2026/06/15	ND, RDL=0.10		ug/L	
C313217	AA1	RPD [EGJ909-10]	Total Aluminum (Al)	2026/06/15	0.64		%	20
			Total Antimony (Sb)	2026/06/15	4.8		%	20



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
			Total Arsenic (As)	2026/06/15	0.42		%	20
			Total Barium (Ba)	2026/06/15	0.63		%	20
			Total Beryllium (Be)	2026/06/15	NC		%	20
			Total Bismuth (Bi)	2026/06/15	NC		%	20
			Total Boron (B)	2026/06/15	2.6		%	20
			Total Cadmium (Cd)	2026/06/15	3.9		%	20
			Total Cesium (Cs)	2026/06/15	1.4		%	20
			Total Chromium (Cr)	2026/06/15	1.7		%	20
			Total Cobalt (Co)	2026/06/15	2.3		%	20
			Total Copper (Cu)	2026/06/15	5.8		%	20
			Total Iron (Fe)	2026/06/15	1.4		%	20
			Total Lead (Pb)	2026/06/15	7.7		%	20
			Total Lithium (Li)	2026/06/15	4.8		%	20
			Total Manganese (Mn)	2026/06/15	2.7		%	20
			Total Molybdenum (Mo)	2026/06/15	1.2		%	20
			Total Nickel (Ni)	2026/06/15	1.5		%	20
			Total Phosphorus (P)	2026/06/15	7.2		%	20
			Total Rubidium (Rb)	2026/06/15	1.5		%	20
			Total Selenium (Se)	2026/06/15	0.33		%	20
			Total Silicon (Si)	2026/06/15	0.69		%	20
			Total Silver (Ag)	2026/06/15	NC		%	20
			Total Strontium (Sr)	2026/06/15	1.6		%	20
			Total Tellurium (Te)	2026/06/15	NC		%	20
			Total Thallium (Tl)	2026/06/15	4.8		%	20
			Total Thorium (Th)	2026/06/15	NC		%	20
			Total Tin (Sn)	2026/06/15	NC		%	20
			Total Titanium (Ti)	2026/06/15	0.89		%	20
			Total Uranium (U)	2026/06/15	0.72		%	20
			Total Vanadium (V)	2026/06/15	0.72		%	20
			Total Zinc (Zn)	2026/06/15	NC		%	20
			Total Zirconium (Zr)	2026/06/15	4.0		%	20
C313281	IC4	Matrix Spike	Total Mercury (Hg)	2026/06/15		96	%	80 - 120
C313281	IC4	Spiked Blank	Total Mercury (Hg)	2026/06/15		104	%	80 - 120
C313281	IC4	Method Blank	Total Mercury (Hg)	2026/06/15	ND, RDL=0.0019		ug/L	
C313281	IC4	RPD	Total Mercury (Hg)	2026/06/15	NC		%	20
C314396	NJD	Matrix Spike	Total Sulphide	2026/06/16		98	%	80 - 120
C314396	NJD	Spiked Blank	Total Sulphide	2026/06/16		103	%	80 - 120
C314396	NJD	Method Blank	Total Sulphide	2026/06/16	ND, RDL=0.0018		mg/L	
C314396	NJD	RPD	Total Sulphide	2026/06/16	NC		%	20
C314668	NJD	Matrix Spike [EGJ911-08]	Total Sulphide	2026/06/16		100	%	80 - 120
C314668	NJD	Spiked Blank	Total Sulphide	2026/06/16		102	%	80 - 120
C314668	NJD	Method Blank	Total Sulphide	2026/06/16	ND, RDL=0.0018		mg/L	
C314668	NJD	RPD [EGJ912-08]	Total Sulphide	2026/06/16	NC		%	20
C314719	LS2	Matrix Spike	D10-ANTHRACENE (sur.)	2026/06/15		87	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		94	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		78	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		62	%	50 - 140
			Quinoline	2026/06/15		109	%	50 - 140
			Naphthalene	2026/06/15		87	%	50 - 140
			1-Methylnaphthalene	2026/06/15		87	%	50 - 140



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314719	LS2	Spiked Blank	2-Methylnaphthalene	2026/06/15		89	%	50 - 140
			Acenaphthylene	2026/06/15		94	%	50 - 140
			Acenaphthene	2026/06/15		92	%	50 - 140
			Fluorene	2026/06/15		93	%	50 - 140
			Phenanthrene	2026/06/15		89	%	50 - 140
			Anthracene	2026/06/15		88	%	50 - 140
			Acridine	2026/06/15		96	%	50 - 140
			Fluoranthene	2026/06/15		74	%	50 - 140
			Pyrene	2026/06/15		78	%	50 - 140
			Benzo(a)anthracene	2026/06/15		78	%	50 - 140
			Chrysene	2026/06/15		76	%	50 - 140
			Benzo(b&j)fluoranthene	2026/06/15		65	%	50 - 140
			Benzo(k)fluoranthene	2026/06/15		70	%	50 - 140
			Benzo(a)pyrene	2026/06/15		67	%	50 - 140
			Indeno(1,2,3-cd)pyrene	2026/06/15		51	%	50 - 140
			Dibenz(a,h)anthracene	2026/06/15		50	%	50 - 140
			Benzo(g,h,i)perylene	2026/06/15		49 (3)	%	50 - 140
			D10-ANTHRACENE (sur.)	2026/06/15		102	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		95	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		71	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		84	%	50 - 140
			Quinoline	2026/06/15		101	%	50 - 140
			Naphthalene	2026/06/15		70	%	50 - 140
			1-Methylnaphthalene	2026/06/15		73	%	50 - 140
			2-Methylnaphthalene	2026/06/15		73	%	50 - 140
			Acenaphthylene	2026/06/15		84	%	50 - 140
			Acenaphthene	2026/06/15		83	%	50 - 140
			Fluorene	2026/06/15		87	%	50 - 140
			Phenanthrene	2026/06/15		86	%	50 - 140
			Anthracene	2026/06/15		86	%	50 - 140
			Acridine	2026/06/15		89	%	50 - 140
			Fluoranthene	2026/06/15		74	%	50 - 140
			Pyrene	2026/06/15		79	%	50 - 140
			Benzo(a)anthracene	2026/06/15		87	%	50 - 140
			Chrysene	2026/06/15		86	%	50 - 140
			Benzo(b&j)fluoranthene	2026/06/15		88	%	50 - 140
			Benzo(k)fluoranthene	2026/06/15		93	%	50 - 140
			Benzo(a)pyrene	2026/06/15		92	%	50 - 140
			Indeno(1,2,3-cd)pyrene	2026/06/15		95	%	50 - 140
			Dibenz(a,h)anthracene	2026/06/15		93	%	50 - 140
			Benzo(g,h,i)perylene	2026/06/15		92	%	50 - 140
C314719	LS2	Method Blank	D10-ANTHRACENE (sur.)	2026/06/15		107	%	50 - 140
			D8-ACENAPHTHYLENE (sur.)	2026/06/15		93	%	50 - 140
			D8-NAPHTHALENE (sur.)	2026/06/15		66	%	50 - 140
			TERPHENYL-D14 (sur.)	2026/06/15		85	%	50 - 140
			Quinoline	2026/06/15	ND, RDL=0.020		ug/L	
			Naphthalene	2026/06/15	ND, RDL=0.10		ug/L	
			1-Methylnaphthalene	2026/06/15	ND, RDL=0.050		ug/L	
			2-Methylnaphthalene	2026/06/15	ND, RDL=0.10		ug/L	



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314719	LS2	RPD	Acenaphthylene	2026/06/15	ND, RDL=0.050		ug/L	
			Acenaphthene	2026/06/15	ND, RDL=0.050		ug/L	
			Fluorene	2026/06/15	ND, RDL=0.050		ug/L	
			Phenanthrene	2026/06/15	ND, RDL=0.050		ug/L	
			Anthracene	2026/06/15	ND, RDL=0.010		ug/L	
			Acridine	2026/06/15	ND, RDL=0.050		ug/L	
			Fluoranthene	2026/06/15	ND, RDL=0.020		ug/L	
			Pyrene	2026/06/15	ND, RDL=0.020		ug/L	
			Benzo(a)anthracene	2026/06/15	ND, RDL=0.010		ug/L	
			Chrysene	2026/06/15	ND, RDL=0.020		ug/L	
			Benzo(b&j)fluoranthene	2026/06/15	ND, RDL=0.030		ug/L	
			Benzo(k)fluoranthene	2026/06/15	ND, RDL=0.050		ug/L	
			Benzo(a)pyrene	2026/06/15	ND, RDL=0.0050		ug/L	
			Indeno(1,2,3-cd)pyrene	2026/06/15	ND, RDL=0.050		ug/L	
			Dibenz(a,h)anthracene	2026/06/15	ND, RDL=0.0030		ug/L	
			Benzo(g,h,i)perylene	2026/06/15	ND, RDL=0.050		ug/L	
			Quinoline	2026/06/15	NC		%	40
			Naphthalene	2026/06/15	NC		%	40
			1-Methylnaphthalene	2026/06/15	NC		%	40
			2-Methylnaphthalene	2026/06/15	NC		%	40
			Acenaphthylene	2026/06/15	NC		%	40
			Acenaphthene	2026/06/15	NC		%	40
			Fluorene	2026/06/15	NC		%	40
			Phenanthrene	2026/06/15	NC		%	40
			Anthracene	2026/06/15	NC		%	40
			Acridine	2026/06/15	NC		%	40
			Fluoranthene	2026/06/15	NC		%	40
			Pyrene	2026/06/15	NC		%	40
			Benzo(a)anthracene	2026/06/15	NC		%	40
			Chrysene	2026/06/15	NC		%	40
			Benzo(b&j)fluoranthene	2026/06/15	NC		%	40
			Benzo(k)fluoranthene	2026/06/15	NC		%	40
			Benzo(a)pyrene	2026/06/15	NC		%	40
			Indeno(1,2,3-cd)pyrene	2026/06/15	NC		%	40
			Dibenz(a,h)anthracene	2026/06/15	NC		%	40
			Benzo(g,h,i)perylene	2026/06/15	NC		%	40
C314723	IT1	Matrix Spike	O-TERPHENYL (sur.)	2026/06/16		124	%	60 - 140
			EPH (C10-C19)	2026/06/16		112	%	60 - 140



QUALITY ASSURANCE REPORT(CONT'D)

QA/QC Batch	Init	QC Type	Parameter	Date Analyzed	Value	Recovery	UNITS	QC Limits
C314723	IT1	Spiked Blank	EPH (C19-C32)	2026/06/16		120	%	60 - 140
			O-TERPHENYL (sur.)	2026/06/15		112	%	60 - 140
			EPH (C10-C19)	2026/06/15		105	%	70 - 130
C314723	IT1	Method Blank	EPH (C19-C32)	2026/06/15		117	%	70 - 130
			O-TERPHENYL (sur.)	2026/06/15		109	%	60 - 140
			EPH (C10-C19)	2026/06/15	ND, RDL=0.20		mg/L	
C314723	IT1	RPD	EPH (C19-C32)	2026/06/15	ND, RDL=0.20		mg/L	
			EPH (C10-C19)	2026/06/16	12		%	30
			EPH (C19-C32)	2026/06/16	NC		%	30
C320686	CJY	Spiked Blank	Dissolved Organic Carbon (C)	2026/06/19		102	%	80 - 120
C320686	CJY	Method Blank	Dissolved Organic Carbon (C)	2026/06/19	ND, RDL=0.50		mg/L	
C320705	CJY	Matrix Spike	Total Organic Carbon (C)	2026/06/19		93	%	80 - 120
C320705	CJY	Spiked Blank	Total Organic Carbon (C)	2026/06/19		102	%	80 - 120
C320705	CJY	Method Blank	Total Organic Carbon (C)	2026/06/19	ND, RDL=0.50		mg/L	
C320705	CJY	RPD	Total Organic Carbon (C)	2026/06/19	8.0		%	20
C324085	CJY	Spiked Blank	Dissolved Organic Carbon (C)	2026/06/23		109	%	80 - 120
C324085	CJY	Method Blank	Dissolved Organic Carbon (C)	2026/06/23	ND, RDL=0.50		mg/L	
C324088	CJY	Matrix Spike [EGJ909-04]	Total Organic Carbon (C)	2026/06/23		NC	%	80 - 120
C324088	CJY	Spiked Blank	Total Organic Carbon (C)	2026/06/23		109	%	80 - 120
C324088	CJY	Method Blank	Total Organic Carbon (C)	2026/06/23	ND, RDL=0.50		mg/L	
C324088	CJY	RPD [EGJ909-04]	Total Organic Carbon (C)	2026/06/23	0.043		%	20

N/A = Not Applicable

Duplicate: Paired analysis of a separate portion of the same sample. Used to evaluate the variance in the measurement.

Matrix Spike: A sample to which a known amount of the analyte of interest has been added. Used to evaluate sample matrix interference.

Spiked Blank: A blank matrix sample to which a known amount of the analyte, usually from a second source, has been added. Used to evaluate method accuracy.

Method Blank: A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

Surrogate: A pure or isotopically labeled compound whose behavior mirrors the analytes of interest. Used to evaluate extraction efficiency.

NC (Matrix Spike): The recovery in the matrix spike was not calculated. The relative difference between the concentration in the parent sample and the spike amount was too small to permit a reliable recovery calculation (matrix spike concentration was less than the native sample concentration)

NC (Duplicate RPD): The duplicate RPD was not calculated. The concentration in the sample and/or duplicate was too low to permit a reliable RPD calculation (absolute difference $\leq 2 \times$ RDL).

(1) Spike recovery exceeds acceptance criteria (high recovery). As results are non-detect, there is no impact on data quality.

(2) Method blank exceeds acceptance limits for TI- 2X RDL acceptable for low level metals determination.

(3) Recovery or RPD for this parameter is outside control limits. The overall quality control for this analysis meets acceptability criteria.



Bureau Veritas Job #: C633706
Report Date: 2026/06/24

HATFIELD CONSULTANTS
Client Project #: FORTIS11234/PE110163
Site Location: WOODFIBRE PIPELINE PROJECT
Your P.O. #: 4800010213

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

David Huang, M.Sc., P.Chem., QP, Scientific Services Manager

Levi Manchak, Senior Project Manager

Luba Shymushovska, B.Sc., QP, Senior Analyst, Organics

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rob Gilbert, BBY General Manager responsible for British Columbia Environmental laboratory operations.



Custody Tracking Form

eCOC Number

W132024

Please use this form for custody tracking when submitting the work instructions via eCOC (electronic Chain of Custody). Please ensure your form has a barcode or a Bureau Veritas eCOC confirmation number in the top right hand side. This number links your electronic submission to your samples. This form should be placed in the cooler with your samples.

Relinquished By				Received By			
Hayley Mason	JAM	Date	2026/06/09	Nata Zamora	KA	Date	2026/06/09
		Time (24 HR)	15:07			Time (24 HR)	15:07
		Date				Date	
		Time (24 HR)				Time (24 HR)	
		Date				Date	
		Time (24 HR)				Time (24 HR)	

Unless otherwise agreed to, submissions and use of services are governed by Bureau Veritas' standard terms and conditions which can be found at www.bvna.com.

Triage Information					
Sampled By (Print)	# of Coolers/Pkgs	Rush	Immediate Test	Food Residue	
Hayley Mason	1	☐	☐	☐	
		Micro		Food Chemistry	
		☐		☐	



*** Laboratory Use Only ***			
Received At	Lab Comments:	Custody Seal	
	ICE frozen	Present (Y/N)	Intact (Y/N)
Labeled By		N	N
Verified By			
		Cooling Media	Temperature °C
		Present (Y/N)	1 2 3
		Y	10 10 10
		Drinking Water Metals Preservation Check Done (Circle) YES NO	



C633706_COC

COR FCD-00340 /5 PAGE 1 of 1


EPH in Water when PAH required Chromatogram

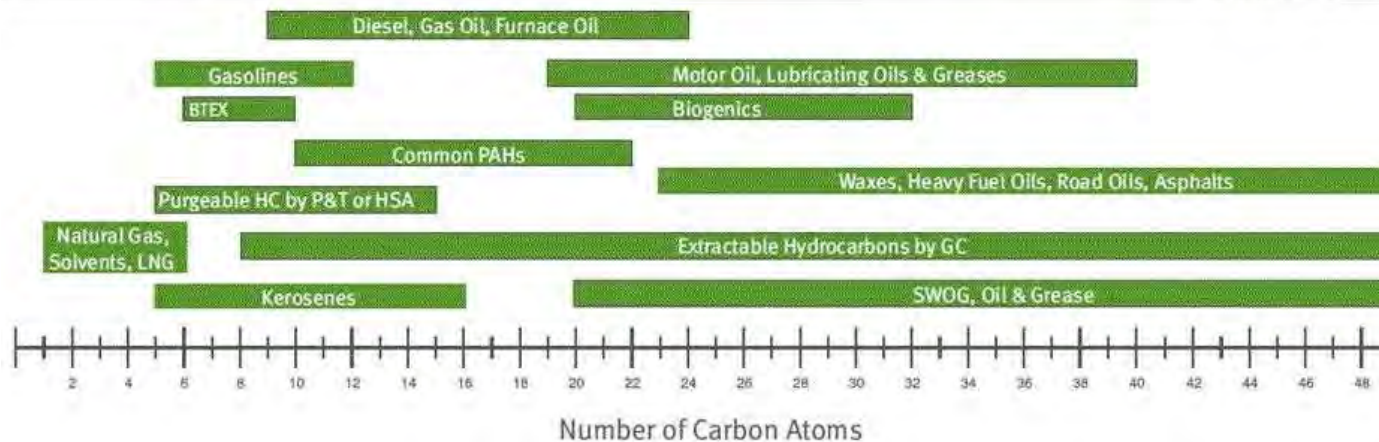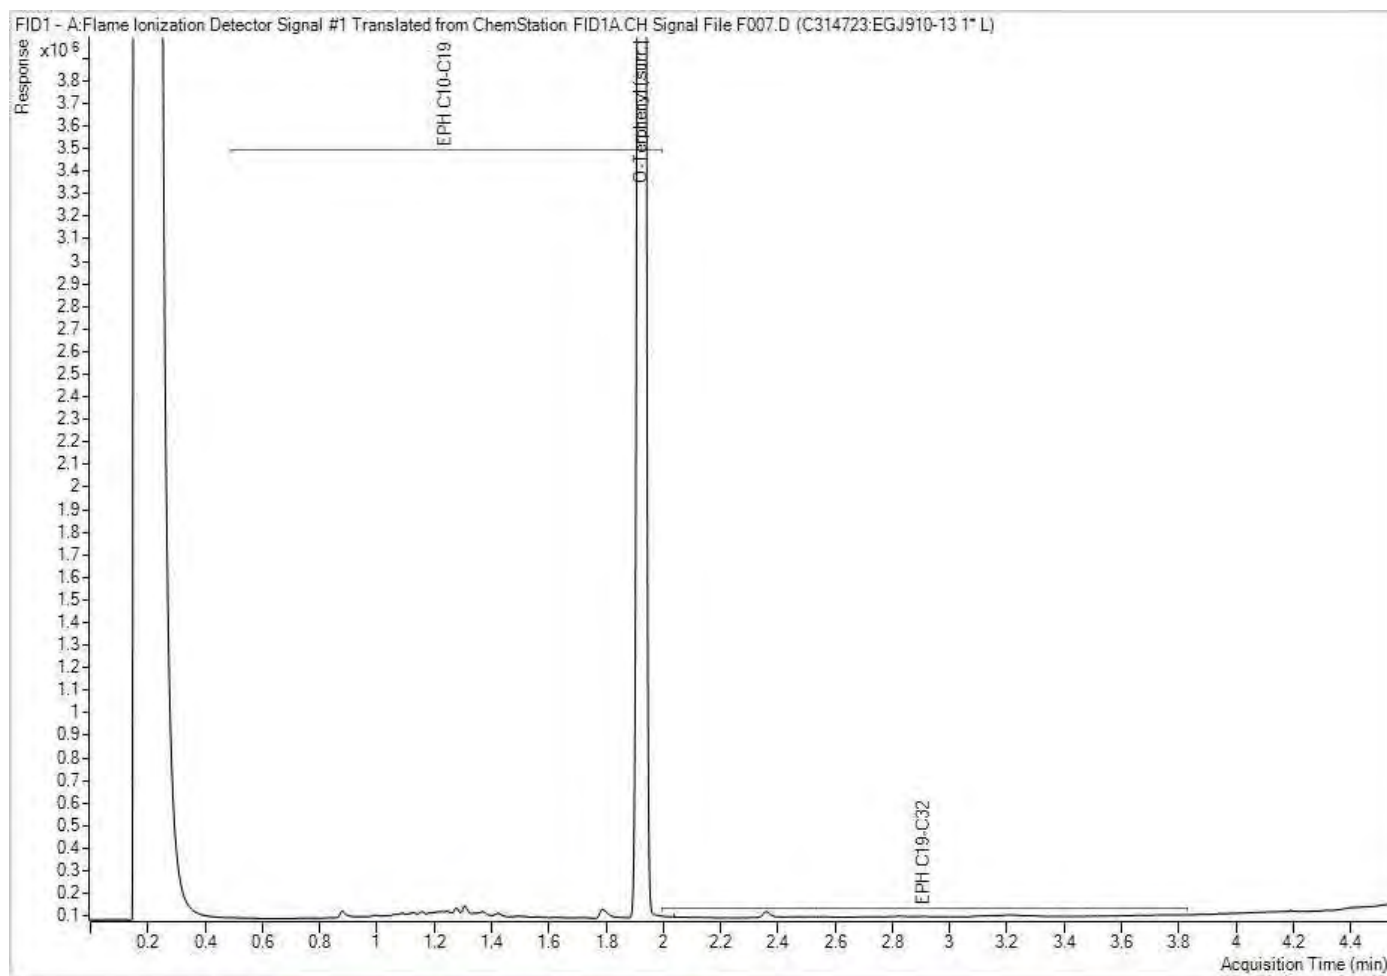

Note: This information is provided for reference purposes only. Should detailed chemist interpretation or fingerprinting be required, please contact the laboratory.



eCOC: W132024



Project Information: C633706
Job Received: 2026/06/09 15:07
Expected TAT: Standard TAT
Expected Arrival: 2026/06/09 14:30
Submitted By: Jackson Macpherson
Submitted To: Burnaby ENV: 4606
Canada Way

Invoice Information

Attn: Accounts Payable
Fortis BC Energy Inc
16705 Fraser Hwy
Surrey , BC , V4N 0E8
Email to:
einvoices@fortisbc.com

Report Information

Attn: Brett Lucas
HATFIELD CONSULTANTS
200-850 Harbourside Dr
North Vancouver , BC , V7P 0A3
Email to:
blucas@hatfieldgroup.com
danielle.samels@fortisbc.com
smangwani@hatfieldgroup.com
jmacpherson@hatfieldgroup.com
swolf@hatfieldgroup.com

Project Information

Quote #: C50083
PO/AFE#: 4800010213
Project #: Fortis11234/PE-110163
Site Location: Woodfibre Pipeline Project

Analytical Summary

A: Standard TAT

Client Sample ID	Cint Ref	Sampling Date/Time	Matrix	#Cont	Woodfibre	Woodfibre Additional	Woodfibre Blank	Set Number
WLNG-DS	1	2026/06/09 09:30	WATER	14	A			1
WLNG -EOP	2	2026/06/09 09:30	WATER	18	A	A		2
WLNG-US	3	2026/06/09 09:30	WATER	14	A			1
Field Blank	4	2026/06/09 09:30	WATER	14			A	3
Trip Blank	5	2026/06/09 09:30	WATER	14			A	3

Deadlines are estimates only and are subject to change. Please refer to your Job Confirmation report for final due dates.

Submission Information

of Samples: 5

Details: **2-day turnaround time for metals samples from WLNG EOP ONLY, all other analytes and samples standard TAT **

eCOC Change Log

Modified By	Date Modified	Changes	Comments
Jackson Macpherson	08 Jun 26 15:52:26	Notes/Comments, Sample Information	Updates

Sample Set Listing

Set 1 (2 samples)	Set 2 (1 sample)	Set 3 (2 samples)
WLNG-DS WLNG-US	WLNG -EOP	Field Blank Trip Blank